



MiTek, Inc.
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Re: 2503400-A
Discovery Animal Hospital

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Lumber Specialties-Dyersville, IA.

Pages or sheets covered by this seal: I73884340 thru I73884407

My license renewal date for the state of Missouri is December 31, 2026.

Missouri COA: Engineering 001193



June 3, 2025

Lu, Jie ,Engineer


IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	CJ21	Roof Special Girder	2	1	Job Reference (optional)
					I73884340

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:34
ID:0ZOk2G1Adk5NKUpN6rzPCSzF0BR-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

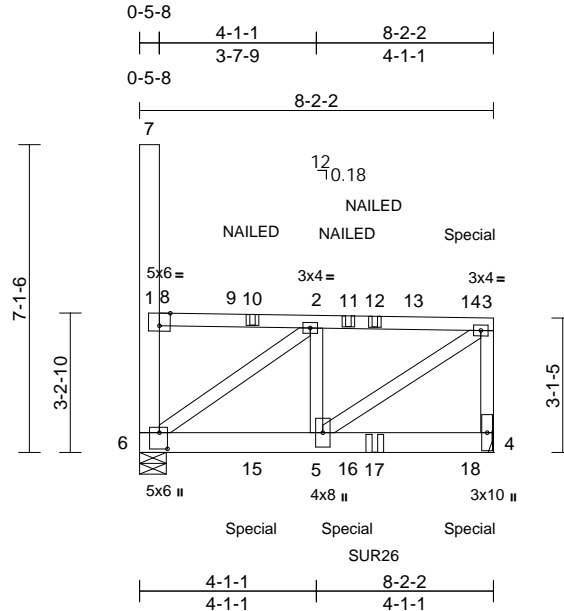

Scale = 1:53.2

Plate Offsets (X, Y): [1:0-3-0,Edge], [6:0-4-8,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	0.03	5-6	>999	240	MT20
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	-0.03	5-6	>999	180	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.59	Horz(CT)	0.00	4	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
Weight: 66 lb FT = 12%											

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x6 SP 2400F 2.0E
WEBS	2x4 SP No.2 *Except* 7-6:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 8-7-7 oc bracing.

REACTIONS	(size) 4= Mechanical, 6=0-7-6
	Max Horiz 6=-309 (LC 9)
	Max Uplift 4=-1106 (LC 10), 6=-988 (LC 9)
	Max Grav 4=1462 (LC 18), 6=1177 (LC 19)

FORCES

TOP CHORD	(lb) - Maximum Compression/Maximum Tension
	1-2=-769/532, 2-3=-1446/1260, 3-4=-1144/1045, 1-6=-179/214, 1-7=0/0
BOT CHORD	5-6=-1330/1527, 4-5=-53/57
WEBS	2-5=-655/805, 3-5=-1574/1808, 2-6=-1563/1632

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1106 lb uplift at joint 4 and 988 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Use Simpson Strong-Tie SUR26 (6-10dx1 1/2 Girder, 6-10dx1 1/2 Truss, Single Ply Girder) or equivalent at 5-5-4 from the left end to connect truss(es) to back face of bottom chord, skewed 45.0 deg.to the right, sloping 0.0 deg. down.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 175 lb down and 83 lb up at 7-7-13 on top chord, and 688 lb down and 664 lb up at 2-7-5, and 372 lb down and 342 lb up at 4-9-14, and 277 lb down and 206 lb up at 7-7-13 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-8=-58, 4-6=-20
Concentrated Loads (lb)
Vert: 3=-1, 9=-1, 10=-21 (B), 11=-70 (F), 12=-63 (B), 14=-175 (F), 15=-13 (B), 16=-50 (F), 17=-52 (B), 18=-112 (F)

Trapezoidal Loads (lb/ft)

Vert: 8=-112-to-9=-88, 9=-83-to-10=-79, 10=-99-to-2=-76, 2=-75-to-11=-63, 11=-81-to-12=-73, 12=-90-to-13=-78, 13=-78-to-14=-62, 14=-61-to-3=-59



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	CJ50	Diagonal Hip Girder	2	1	Job Reference (optional)
					I73884341

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:35
ID:vth61GV?gPt_uKjhlPfJITzF0Ar-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

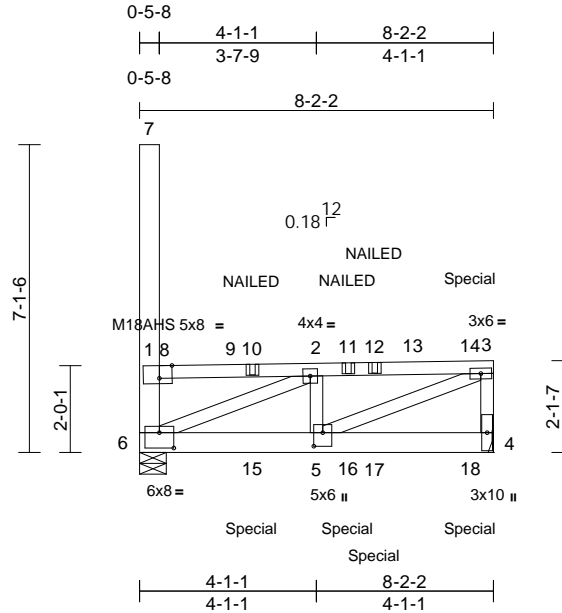

Scale = 1:53.2

Plate Offsets (X, Y): [1:0-3-8,Edge], [5:0-3-12,0-2-8], [6:0-4-0,0-4-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.64	Vert(LL)	0.05	5-6	>999	240	M18AHS 186/179
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.28	Vert(CT)	-0.06	5-6	>999	180	MT20 244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.71	Horz(CT)	0.01	4	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 61 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.2 *Except* 7-6:2x6 SP 2400F 2.0E

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-8-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-9-1 oc bracing.

REACTIONS (size) 4= Mechanical, 6=0-7-6
Max Horiz 6=330 (LC 36)
Max Uplift 4=-1162 (LC 10), 6=-1040 (LC 9)
Max Grav 4=1494 (LC 18), 6=1209 (LC 12)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-1464/989, 2-3=-2424/2103,
3-4=-1155/1048, 1-6=-194/210, 1-7=0/0
BOT CHORD 5-6=-2151/2475, 4-5=-34/36
WEBS 2-5=-653/769, 3-5=-2327/2678,
2-6=-2271/2433

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.

- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1162 lb uplift at joint 4 and 1040 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 172 lb down and 85 lb up at 7-7-13 on top chord, and 703 lb down and 700 lb up at 2-7-5, 392 lb down and 367 lb up at 4-9-14, and 348 lb down and 320 lb up at 5-5-4, and 285 lb down and 217 lb up at 7-7-13 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-8=-58, 4-6=-20
Concentrated Loads (lb)
Vert: 3=-1, 9=-1, 10=-20 (B), 11=-69 (F), 12=-65 (B), 14=-172 (F), 15=-14 (B), 16=-54 (F), 17=-55 (B), 18=-113 (F)
Trapezoidal Loads (lb/ft)

Vert: 8=-112-to-9=-88, 9=-83-to-10=-79, 10=-99-to-2=-75, 2=-75-to-11=-63, 11=-81-to-12=-73, 12=-90-to-13=-78, 13=-78-to-14=-62, 14=-61-to-3=-59



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	J22	Jack-Open	2	1	Job Reference (optional)
					I73884342

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:36
ID:5h_SptWO7yP9PPWvOACOr3zGbN0-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

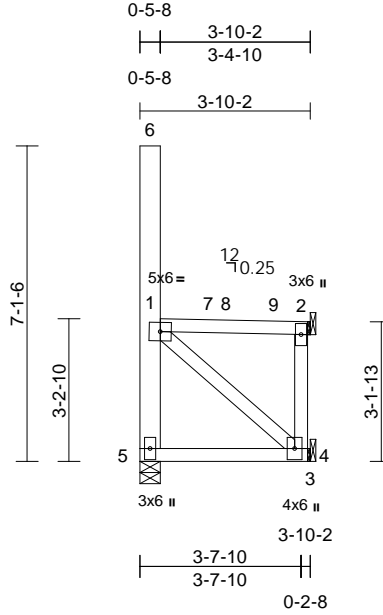

Scale = 1:52

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	n/a	-	n/a	999	MT20
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.13	Vert(CT)	-0.01	4-5	>999	180	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.33	Horz(CT)	0.01	2	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 36 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 6-5:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	Structural wood sheathing directly applied or 3-10-2 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 9-7-1 oc bracing.

REACTIONS	(size)	2= Mechanical, 4= Mechanical, 5=0-5-8
	Max Horiz	5=-311 (LC 9)
	Max Uplift	2=-59 (LC 10), 4=-306 (LC 10), 5=-373 (LC 9)
	Max Grav	2=143 (LC 26), 4=371 (LC 11), 5=442 (LC 19)

FORCES	(lb) - Maximum Compression/Maximum Tension	
	TOP CHORD	1-2=-56/63, 2-4=0/0, 1-5=-560/876, 1-6=0/0
	BOT CHORD	4-5=-602/830, 3-4=0/0
WEBS		1-4=-1038/744

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 373 lb uplift at joint 5, 306 lb uplift at joint 4 and 59 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-5=-20
Concentrated Loads (lb)
Vert: 7=-10
Trapezoidal Loads (lb/ft)
Vert: 1=-119-to-7=-109, 7=-84-to-8=-82, 8=-105-to-9=-91, 9=-90-to-2=-83



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	J23	Jack-Open	2	1	Job Reference (optional)
					I73884343

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:36
ID:z?HqntzDAdBmzFQCc8tIO4zGbMQ-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

Page: 1

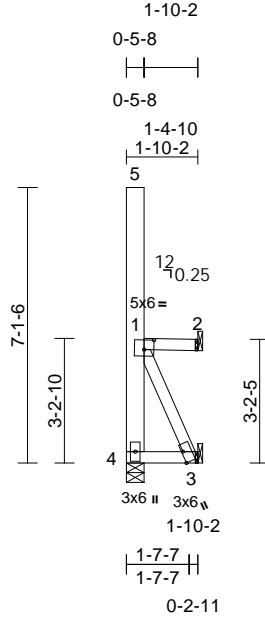

Scale = 1:59.5

Plate Offsets (X, Y): [1:0-3-0,0-3-0], [3:0-3-10,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.35	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	0.00	3-4	>999		
TCDL	15.0	Rep Stress Incr	NO	WB	0.28	Horz(CT)	0.02	2	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 25 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x6 SP 2400F 2.0E *Except* 1-3:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 1-10-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2= Mechanical, 3= Mechanical, 4=0-5-8
Max Horiz 4=-286 (LC 11)
Max Uplift 2=-100 (LC 10), 3=-653 (LC 10), 4=-748 (LC 9)
Max Grav 2=119 (LC 18), 3=705 (LC 11), 4=745 (LC 12)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-4/4, 1-4=-1044/1591, 1-5=0/0
BOT CHORD 3-4=-468/685
WEBS 1-3=-1539/1053

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00

- Provide adequate drainage to prevent water ponding.
 - Plates checked for a plus or minus 5 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint 2, 748 lb uplift at joint 4 and 653 lb uplift at joint 3.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Concentrated Loads (lb)
Vert: 2=-9
Trapezoidal Loads (lb/ft)
Vert: 1=-109-to-2=-91



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	J24	Jack-Open	2	1	Job Reference (optional)
					I73884344

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:36
ID:luP_Jg5ZHCvZdX14ZA26fhzGbKz-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

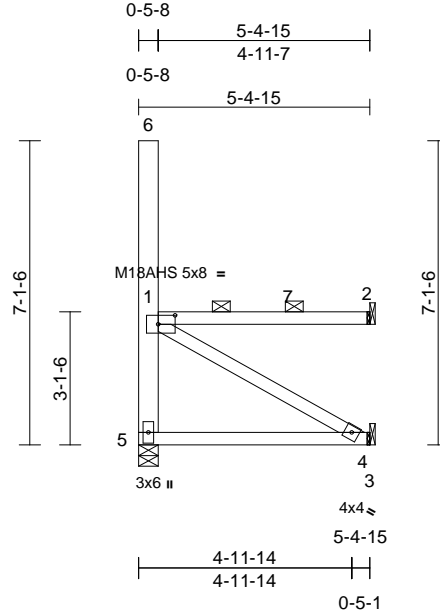

Scale = 1:53.9

Plate Offsets (X, Y): [1:0-4-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.61	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.18	Vert(CT)	-0.03	4-5	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.49	Horz(CT)	0.01	2	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 39 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x6 SP 2400F 2.0E *Except* 1-4:2x4 SP No.2

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-6, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 9-3-15 oc bracing.

REACTIONS (size)	2= Mechanical, 4= Mechanical, 5=0-5-8
Max Horiz	5=-288 (LC 11)
Max Uplift	2=-69 (LC 10), 4=-195 (LC 10), 5=-263 (LC 9)
Max Grav	2=227 (LC 26), 4=288 (LC 11), 5=487 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	1-2=0/0, 1-5=-436/694, 1-6=0/0
BOT CHORD	4-5=-624/823, 3-4=0/0
WEBS	1-4=-944/716

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0

- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 69 lb uplift at joint 2, 263 lb uplift at joint 5 and 195 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-5=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-7=-124, 7=-121-to-2=-89



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	J25	Jack-Open	2	1	Job Reference (optional)
					I73884345

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:36
ID:9wPtUIDGQ2998qL3Fs5rHzGbKi-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWwCDoi7J4zJC?f

Page: 1

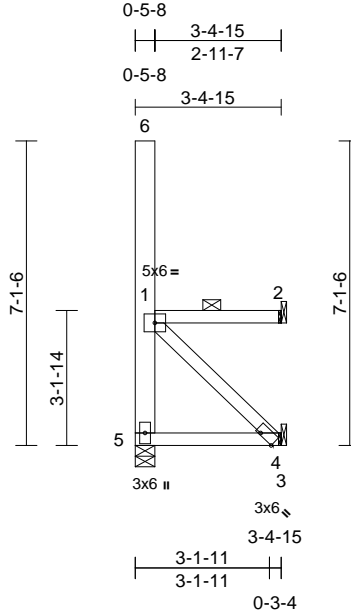

Scale = 1:53.8

Plate Offsets (X, Y): [4:Edge,0-0-7]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.35	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	0.00	4-5	>999	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.29	Horz(CT)	0.01	2	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 31 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x6 SP 2400F 2.0E *Except* 1-4:2x4 SP No.2

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-6, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2= Mechanical, 4= Mechanical, 5=0-5-8
Max Horiz 5=-287 (LC 11)
Max Uplift 2=-60 (LC 10), 4=-325 (LC 10), 5=-382 (LC 9)
Max Grav 2=147 (LC 26), 4=389 (LC 11), 5=466 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/0, 1-5=-557/882, 1-6=0/0
BOT CHORD 4-5=-538/760, 3-4=0/0
WEBS 1-4=-1041/737

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0

- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 60 lb uplift at joint 2, 382 lb uplift at joint 5 and 325 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-5=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-165-to-2=-98



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	J52	Jack-Open	2	1	Job Reference (optional)
					I73884346

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:37

Page: 1

ID: BtlC1p7ACvGsh0XmH1RaCzGafR-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?f

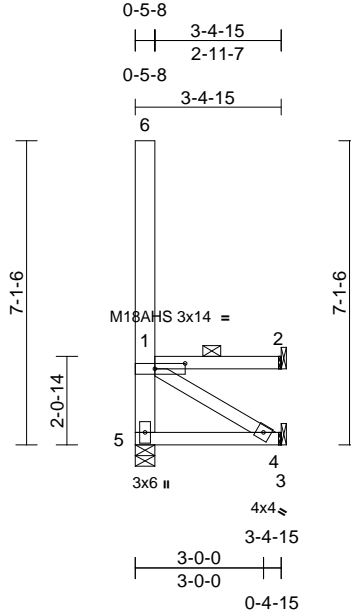

Scale = 1:53.9

Plate Offsets (X, Y): [1:0-8-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.62	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.17	Vert(CT)	0.00	4-5	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.28	Horz(CT)	0.01	2	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 30 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
 BOT CHORD 2x4 SP 1650F 1.6E
 WEBS 2x6 SP 2400F 2.0E *Except* 1-4:2x4 SP No.2

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-6, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 7-10-12 oc bracing.

REACTIONS (size) 2= Mechanical, 4= Mechanical, 5=0-5-8
 Max Horiz 5=-311 (LC 11)
 Max Uplift 2=-65 (LC 10), 4=-350 (LC 10), 5=-415 (LC 9)
 Max Grav 2=145 (LC 26), 4=409 (LC 11), 5=496 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/0, 1-5=-595/957, 1-6=0/0
 BOT CHORD 4-5=-894/1302, 3-4=0/0
 WEBS 1-4=-1511/1038

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0

- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 65 lb uplift at joint 2, 415 lb uplift at joint 5 and 350 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 3-5=-20
 Trapezoidal Loads (lb/ft)
 Vert: 1=-166 to -2=-98



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	J53	Jack-Open	2	1	Job Reference (optional)
					I73884347

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:37

Page: 1

ID:C1ydaoSQ8_2zAaQgkrTK4tzGadJ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

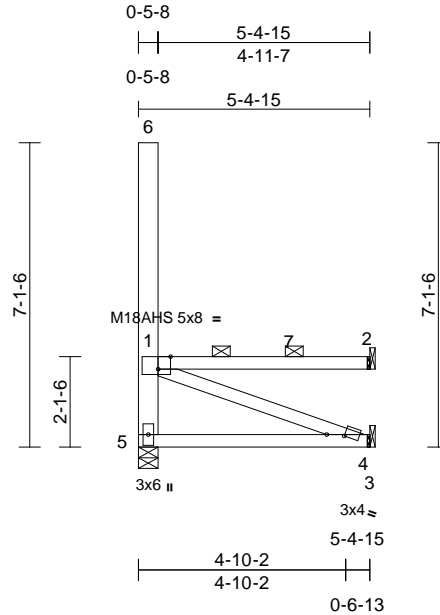

Scale = 1:53.9

Plate Offsets (X, Y): [1:0-3-8,Edge], [4:0-4-12,0-1-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.63	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.03	4-5	>999	180	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.60	Horz(CT)	0.02	2	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 39 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x6 SP 2400F 2.0E *Except* 1-4:2x4 SP No.2

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-6, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 7-4-12 oc bracing.

REACTIONS	(size)	2= Mechanical, 4= Mechanical, 5=0-5-8
	Max Horiz	5=-310 (LC 11)
	Max Uplift	2=-71 (LC 10), 4=-207 (LC 10), 5=-278 (LC 9)
	Max Grav	2=224 (LC 26), 4=295 (LC 11), 5=501 (LC 19)

FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/0, 1-5=-451/730, 1-6=0/0
BOT CHORD	4-5=-996/1349, 3-4=0/0
WEBS	1-4=-1435/1059

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0

- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 71 lb uplift at joint 2, 278 lb uplift at joint 5 and 207 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-5=-20
Concentrated Loads (lb)
Vert: 2=0, 1=-1, 7=-2
Trapezoidal Loads (lb/ft)
Vert: 1=-149-to-7=-123, 7=-120-to-2=-89



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	J54	Jack-Open	2	1	Job Reference (optional)
					I73884348

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:37
ID:RwIR4ukwSxz6UblSHQlqlqzGaWV-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWRCDoi7J4zJC?i

Page: 1

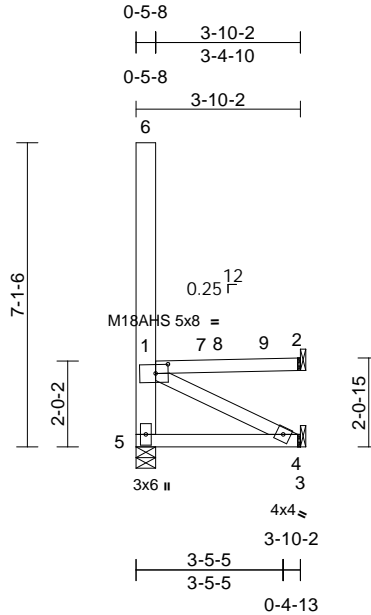

Scale = 1:53.9

Plate Offsets (X, Y): [1:0-3-8,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.64	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.19	Vert(CT)	-0.01	4-5	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.35	Horz(CT)	0.01	2	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 32 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x6 SP 2400F 2.0E *Except* 1-4:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-10-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-7-1 oc bracing.

REACTIONS (size) 2= Mechanical, 4= Mechanical, 5=0-5-8
Max Horiz 5=-313 (LC 11)
Max Uplift 2=-64 (LC 10), 4=-303 (LC 10), 5=-363 (LC 9)
Max Grav 2=145 (LC 26), 4=365 (LC 11), 5=442 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-5/2, 1-5=-532/864, 1-6=0/0
BOT CHORD 4-5=-964/1376, 3-4=0/0
WEBS 1-4=-1531/1072

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00

- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 64 lb uplift at joint 2, 363 lb uplift at joint 5 and 303 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-5=-20
Concentrated Loads (lb)
Vert: 7=-10
Trapezoidal Loads (lb/ft)
Vert: 1=-119-to-7=-109, 7=-84-to-8=-82, 8=-105-to-9=-91, 9=-90-to-2=-83



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	J55	Jack-Open	2	1	Job Reference (optional)
					I73884349

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:37
ID:5AlwqDzSD9PiNLWAV3Y_vPzGZqI-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCdoi7J4zJC?f

Page: 1

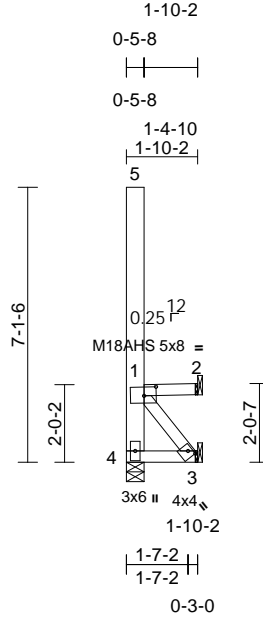

Scale = 1:59.6

Plate Offsets (X, Y): [1:0-3-12,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.64	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.15	Vert(CT)	0.00	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.23	Horz(CT)	0.01	2	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 24 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x6 SP 2400F 2.0E *Except* 1-3:2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 1-10-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-2-5 oc bracing.

REACTIONS (size) 2= Mechanical, 3= Mechanical, 4=0-5-8
Max Horiz 4=-313 (LC 11)
Max Uplift 2=-115 (LC 10), 3=-689 (LC 10), 4=-797 (LC 9)
Max Grav 2=130 (LC 18), 3=720 (LC 11), 4=814 (LC 12)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-4/5, 1-4=-1098/1706, 1-5=0/0
BOT CHORD 3-4=-837/1256
WEBS 1-3=-1920/1279

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00

- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 115 lb uplift at joint 2, 797 lb uplift at joint 4 and 689 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Concentrated Loads (lb)
Vert: 2=-9
Trapezoidal Loads (lb/ft)
Vert: 1=-109-to-2=-91



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M01	Monopitch	39	1	Job Reference (optional)
					I73884350

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:37
ID:5UOe3bOHoWJ6aVna?kntkBzGZxV-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

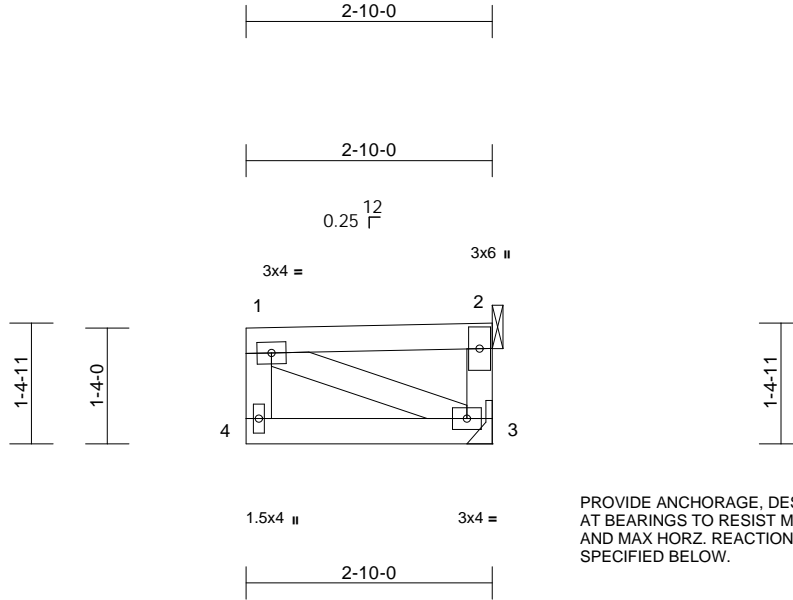

PROVIDE ANCHORAGE, DESIGNED BY OTHERS,
AT BEARINGS TO RESIST MAX. VERTICAL
AND MAX HORZ. REACTIONS
SPECIFIED BELOW.

Scale = 1:26.5												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.12	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	n/a	999		
TCDL	15.0	Rep Stress Incr	YES	WB	0.07	Horz(CT)	n/a	-	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 14 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or
2-10-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS (size) 2= Mechanical, 3= Mechanical
Max Horiz 2=265 (LC 2), 3=265 (LC 2)
Max Uplift 2=-102 (LC 9)
Max Grav 2=229 (LC 2)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 1-4=-26/25, 1-2=-361/266, 2-3=-171/134
BOT CHORD 3-4=-20/22
WEBS 1-3=-286/380

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed ; end vertical left and
right exposed;C-C for members and forces & MWFRS
for reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15
Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL =
1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially
Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation
about its center.
- Refer to girder(s) for truss to truss connections.
- Refer to girder(s) for truss to truss connections.

- Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 102 lb uplift at joint
2.
- Non Standard bearing condition. Review required.
- This truss is designed in accordance with the 2018
International Building Code section 2306.1 and
referenced standard ANSI/TPI 1.
- Gap between inside of top chord bearing and first
diagonal or vertical web shall not exceed 0.500in.

LOAD CASE(S) Standard



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884351
2503400-A	M02	Monopitch	28	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:38
ID:wL935d7MVzURAybKeZ0MMzGa8l-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

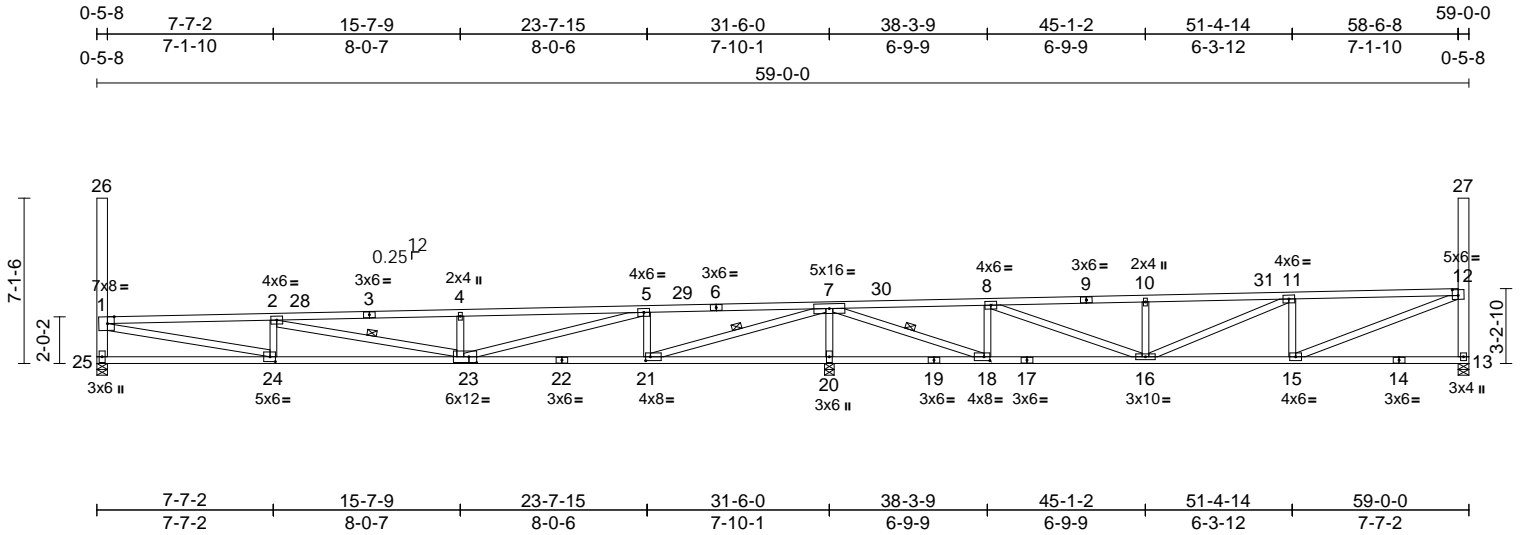

Scale = 1:99.1

Plate Offsets (X, Y): [1:0-3-8,Edge], [12:0-3-0,0-3-0], [18:0-3-0,0-2-0], [21:0-2-8,0-2-0], [23:0-4-0,0-3-0], [24:0-2-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.34	23-24	>999	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.77	Vert(CT)	-0.78	23-24	>482	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.96	Horz(CT)	0.03	20	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 314 lb	FT = 12%

LUMBER
TOP CHORD 2x4 SP 1650F 1.6E *Except* 3-1:2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except*
12-15,7-21,5-23,23-2,1-24:2x4 SP 1650F 1.6E, 26-25,27-13:2x6 SP 2400F 2.0E

WEBS
2-24=-560/440, 5-21=-1226/591, 8-18=-1125/470, 7-20=-3121/1106, 10-16=-446/254, 8-16=-568/1825, 11-15=-523/308, 11-16=-181/63, 12-15=-599/1784, 7-21=-1700/4713, 4-23=-573/323, 5-23=-1080/2639, 2-23=-567/449, 1-24=-1598/3374, 7-18=-1165/3763

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 2-11=-58, 13-25=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-118-to-2=-59, 11=-59-to-12=-118

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-11-6 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 3-5-9 oc bracing.
WEBS 1 Row at midpt 7-21, 2-23, 7-18

REACTIONS
(size) 13=0-5-8, 20=0-5-0, 25=0-5-8
Max Horiz 25=491 (LC 10)
Max Uplift 13=-123 (LC 10), 20=-343 (LC 13), 25=-143 (LC 9)
Max Grav 13=1090 (LC 26), 20=3306 (LC 26), 25=1316 (LC 26)

FORCES
(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-3563/1554, 2-4=-3501/1229, 4-5=-3400/1180, 5-7=-878/300, 7-8=-523/482, 8-10=-1675/929, 10-11=-1676/936, 11-12=-1816/993, 1-25=-1239/483, 1-26=0/0, 12-13=-1016/368, 12-27=0/0
BOT CHORD 24-25=-1613/2017, 21-24=-2116/3570, 20-21=-3654/1082, 18-20=-3654/1082, 16-18=-261/190, 15-16=-600/1778, 13-15=-150/289

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 143 lb uplift at joint 25, 123 lb uplift at joint 13 and 343 lb uplift at joint 20.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884352
2503400-A	M02A	Monopitch	4	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:38
ID:wL935d7MVzURrAybKeZ0MMzGa8l-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

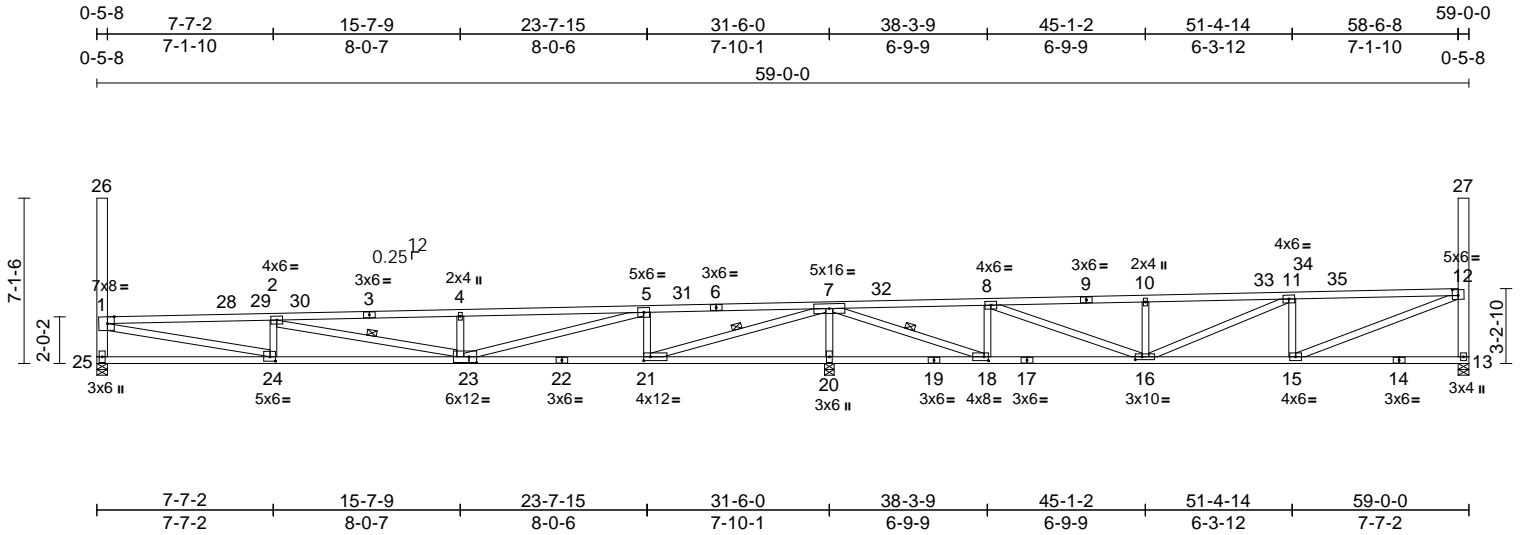

Scale = 1:99.1

Plate Offsets (X, Y): [1:0-3-8,Edge], [12:0-3-0,0-3-0], [16:0-3-8,0-1-8], [18:0-2-4,0-2-0], [21:0-3-8,0-2-0], [23:0-4-0,0-3-0], [24:0-2-12,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.38	23-24	>975	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.81	Vert(CT)	-0.83	23-24	>454	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.99	Horz(CT)	0.03	20	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 314 lb	FT = 12%

LUMBER		
TOP CHORD	2x4 SP 1650F 1.6E *Except* 3-1:2x4 SP 2400F 2.0E	
BOT CHORD	2x4 SP 1650F 1.6E	
WEBS	2x4 SP No.2 *Except* 12-15,7-21,5-23,23-2,1-24:2x4 SP 1650F 1.6E, 26-25,27-13:2x6 SP 2400F 2.0E	
BRACING		
TOP CHORD	Structural wood sheathing directly applied or 2-8-14 oc purlins, except end verticals.	
BOT CHORD	Rigid ceiling directly applied or 3-3-7 oc bracing.	
WEBS	1 Row at midpt 7-21, 2-23, 7-18	
REACTIONS		
(size)	13=0-5-8, 20=0-5-0, (req. 0-5-9), 25=0-5-8	
Max Horiz	25=491 (LC 10)	
Max Uplift	13=123 (LC 10), 20=-343 (LC 13), 25=-143 (LC 9)	
Max Grav	13=1123 (LC 26), 20=3551 (LC 26), 25=1366 (LC 26)	
FORCES		
(lb) - Maximum Compression/Maximum Tension		
TOP CHORD	1-2=-3764/1554, 2-4=-3756/1229, 4-5=-3645/1180, 5-7=-938/300, 7-8=-523/482, 8-10=-1728/929, 10-11=-1727/936, 11-12=-1874/993, 1-25=-1288/483, 1-26=0/0, 12-13=-1049/368, 12-27=0/0	
BOT CHORD	24-25=-1613/2017, 21-24=-2116/3744, 20-21=-3911/1082, 18-20=-3911/1082, 16-18=-261/190, 15-16=-600/1866, 13-15=-150/289	

- WEBS**
- 2-24=-604/440, 5-21=-1327/591, 8-18=-1214/470, 7-20=-3363/1106, 10-16=-477/254, 8-16=-568/1945, 11-15=-558/308, 11-16=-158/63, 12-15=-599/1879, 7-21=-1700/5058, 4-23=-622/323, 5-23=-1080/2815, 2-23=-567/449, 1-24=-1598/3579, 7-18=-1165/4031
- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
 - Provide adequate drainage to prevent water ponding.
 - Plates checked for a plus or minus 5 degree rotation about its center.
 - WARNING: Required bearing size at joint(s) 20 greater than input bearing size.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 143 lb uplift at joint 25, 123 lb uplift at joint 13 and 343 lb uplift at joint 20.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

- 9) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- LOAD CASE(S)** Standard
- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (lb/ft)
- Vert: 2-29=-64, 2-11=-65, 11-34=-64, 13-25=-20
- Concentrated Loads (lb)
- Vert: 11=-1, 29=-1
- Trapezoidal Loads (lb/ft)
- Vert: 1=-118-to-28=-75, 28=-73-to-29=-67, 34=-67-to-35=-73, 35=-75-to-12=-118



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884353
2503400-A	M02G	Roof Special Girder	1	2	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:39

Page: 1

ID:YtoYrGaUxcWJkvBccFue0zF?Xq-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?F

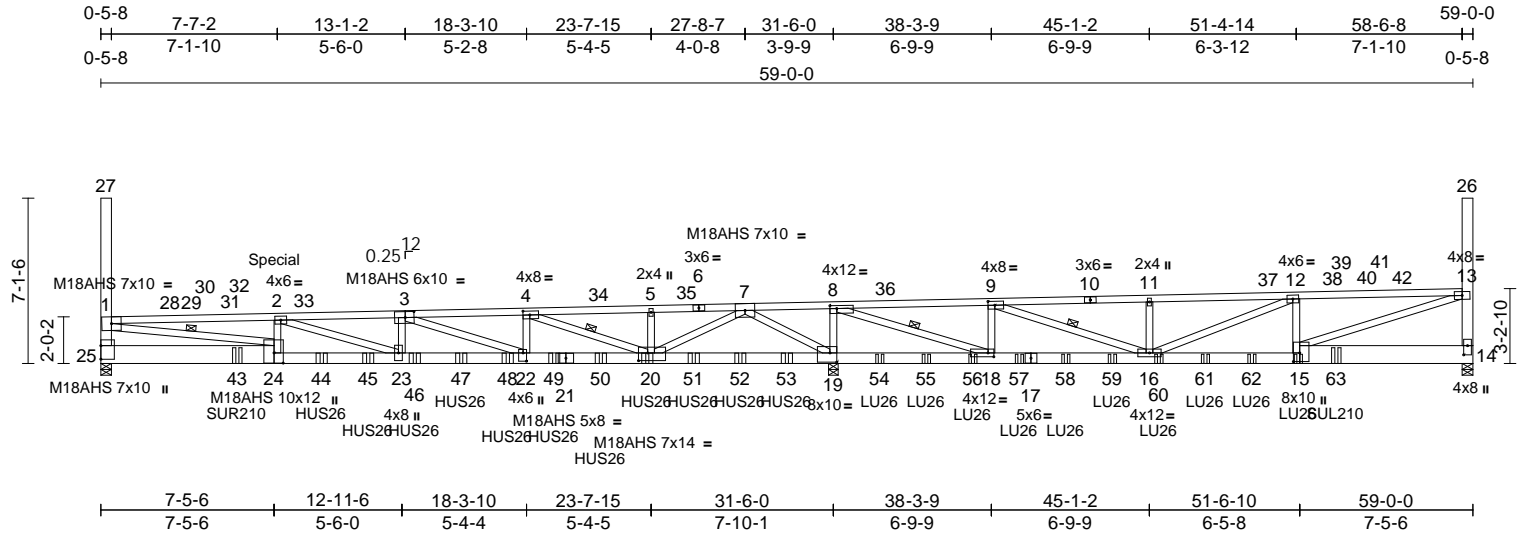

Scale = 1:99.1

[3:0-4-8,0-3-0], [4:0-3-8,0-2-0], [8:0-3-8,0-1-8], [9:0-3-8,0-2-0], [14:0-4-12,0-2-0], [15:0-4-8,0-3-4], [18:0-3-0,0-2-0], [19:0-3-8,0-4-12], [20:0-4-12,0-4-0],

Plate Offsets (X, Y): [22:0-4-4,0-1-12], [24:0-5-4,0-4-12]

loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	1.13	22-23	>333	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.64	Vert(CT)	-1.24	22-23	>302	180	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.99	Horz(CT)	0.06	19	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 774 lb	FT = 12%

LUMBER
TOP CHORD 2x4 SP 1650F 1.6E *Except* 3-1,6-10:2x4 SP 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E *Except* 15-14,24-25:2x10 SP M 23
WEBS 2x4 SP No.2 *Except* 26-14,25-27:2x6 SP 2400F 2.0E, 13-15,1-24,8-18,7-20:2x4 SP 1650F 1.6E

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 4-6-11 oc bracing.
WEBS 1 Row at midpt 9-16, 1-24, 8-18, 4-20
REACTIONS (size) 14=0-5-8, 19=0-5-0, (req. 0-5-6), 25=0-5-8
Max Horiz 25=479 (LC 46)
Max Uplift 14=887 (LC 10), 19=9911 (LC 13), 25=3383 (LC 9)
Max Grav 14=2856 (LC 26), 19=12918 (LC 18), 25=4211 (LC 12)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=15794/13163, 2-4=19135/16367, 4-5=4850/4544, 5-7=4851/4547, 7-8=15339/18356, 8-9=6592/6863, 9-11=6736/1006, 11-12=6735/1013, 12-13=6152/2425, 13-14=2573/906, 13-26=0/0, 1-25=3675/3190, 1-27=0/0
BOT CHORD 23-25=13839/16291, 22-23=16817/19376, 20-22=13081/14758, 19-20=8085/6076, 18-19=18289/15107, 16-18=6599/6288, 14-16=2008/6190

WEBS
2-24=1835/1693, 5-20=429/211, 9-18=3249/2473, 8-19=5461/3525, 11-16=500/257, 9-16=6293/8107, 12-15=1213/1236, 12-16=2659/2444, 13-15=2137/6296, 1-24=12440/14312, 8-18=9430/14690, 4-20=10223/8591, 3-23=1236/1617, 2-23=3786/3924, 3-22=4915/3976, 4-22=2975/3567, 7-19=12517/10734, 7-20=12020/14056

NOTES
1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-6-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
3) Unbalanced roof live loads have been considered for this design.
4) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- 5) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- 6) Provide adequate drainage to prevent water ponding.
- 7) All plates are MT20 plates unless otherwise indicated.
- 8) Plates checked for a plus or minus 5 degree rotation about its center.
- 9) WARNING: Required bearing size at joint(s) 19 greater than input bearing size.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 887 lb uplift at joint 14, 3383 lb uplift at joint 25 and 9911 lb uplift at joint 19.
- 11) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- 12) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.



June 3,2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M02G	Roof Special Girder	1	2	Job Reference (optional)
					I73884353

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:39
ID:YtoTyrGaUxcWJkvBccFue0zF?Xq-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 2

- 13) Use Simpson Strong-Tie SUR210 (10-10d Girder, 10-10dx1 1/2 Truss) or equivalent at 5-10-7 from the left end to connect truss(es) to back face of bottom chord, skewed 45.0 deg.to the right, sloping 0.0 deg. down.
- 14) Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 9-6-0 from the left end to 29-6-0 to connect truss(es) to back face of bottom chord.
- 15) Use Simpson Strong-Tie LU26 (6-10d Girder, 4-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 33-6-0 from the left end to 51-6-0 to connect truss(es) to back face of bottom chord.
- 16) Use Simpson Strong-Tie SUL210 (10-10d Girder, 10-10dx1 1/2 Truss) or equivalent at 53-1-9 from the left end to connect truss(es) to back face of bottom chord, skewed 45.0 deg.to the left, sloping 0.0 deg. down.
- 17) Fill all nail holes where hanger is in contact with lumber.
- 18) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 440 lb down and 279 lb up at 7-6-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 2-32=-79, 2-34=-70, 6-12=-70, 12-38=-79, 14-25=-20
Concentrated Loads (lb)
Vert: 15=-372 (B), 2=-331 (B), 20=-38 (B), 29=-10, 40=-10, 43=-793 (B), 44=-38 (B), 45=-38 (B), 46=-38 (B), 47=-38 (B), 48=-38 (B), 49=-38 (B), 50=-38 (B), 51=-38 (B), 52=-38 (B), 53=-38 (B), 54=-369 (B), 55=-369 (B), 56=-369 (B), 57=-369 (B), 58=-369 (B), 59=-369 (B), 60=-369 (B), 61=-369 (B), 62=-369 (B), 63=-789 (B)
Trapezoidal Loads (lb/ft)
Vert: 1=-111-to-28=-92, 28=-92-to-29=-88, 29=-70-to-30=-68, 30=-81-to-31=-74, 31=-73-to-32=-70, 34=-70-to-5=-70, 5=-70-to-35=-70, 35=-70-to-6=-70, 38=-70-to-39=-73, 39=-74-to-40=-81, 40=-68-to-41=-70, 41=-88-to-42=-92, 42=-92-to-13=-111



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	173884354
2503400-A	M02X	Monopitch	2	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:40
ID:2k1eDacKJjsWckhJA1Sh3zBh3R-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

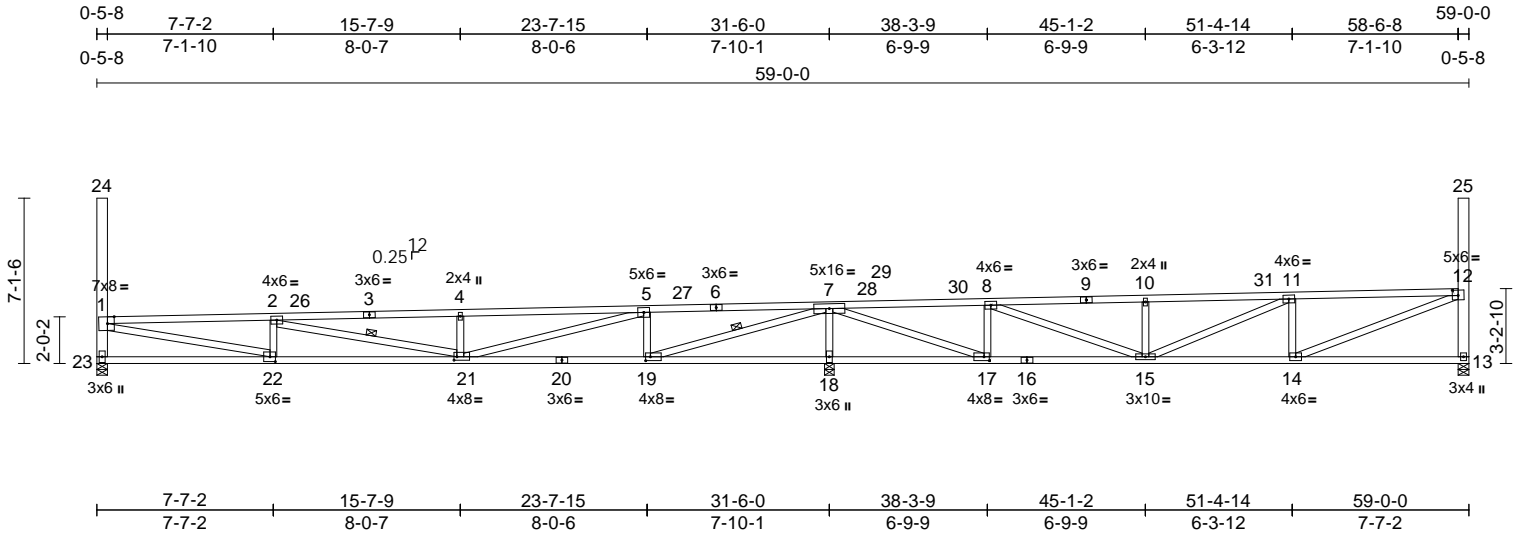

Scale = 1:99.1

Plate Offsets (X, Y): [1:0-3-8,Edge], [12:0-3-0,0-2-12], [17:0-2-12,0-2-0], [19:0-2-8,0-2-0], [21:0-1-8,0-1-12], [22:0-2-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	-0.34	21-22	>999	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.77	Vert(CT)	-0.77	21-22	>486	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.97	Horz(CT)	0.03	18	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 314 lb	FT = 12%

LUMBER
TOP CHORD 2x4 SP 1650F 1.6E *Except* 3-1:2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except*
12-14,5-21,1-22,7-19,21-2:2x4 SP 1650F 1.6E, 24-23,25-13:2x6 SP 2400F 2.0E

WEBS
7-18=-3233/987, 10-15=-431/269, 11-14=-522/294, 11-15=-129/88, 12-14=-563/1782, 5-19=-1218/597, 4-21=-573/319, 5-21=-1069/2674, 2-22=-558/443, 1-22=-1616/3360, 8-17=-1172/416, 7-19=-1721/4691, 2-21=-575/437, 8-15=-638/1739, 7-17=-1003/3904

1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 13-23=-20, 2-28=-58, 28-30=-91, 11-30=-58
Trapezoidal Loads (lb/ft)
Vert: 1=-118-to-2=-59, 11=-58-to-12=-101

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-0-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 3-5-6 oc bracing.
WEBS 1 Row at midpt 7-19, 2-21

REACTIONS
(size) 13=0-5-8, 18=0-5-0, 23=0-5-8
Max Horiz 23=491 (LC 10)
Max Uplift 13=-110 (LC 10), 18=-224 (LC 13), 23=-147 (LC 9)
Max Grav 13=1047 (LC 26), 18=3418 (LC 26), 23=1313 (LC 26)

FORCES
(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-3550/1571, 2-4=-3481/1259, 4-5=-3398/1220, 5-7=-831/351, 7-8=-647/359, 8-10=-1734/872, 10-11=-1735/879, 11-12=-1850/960, 1-23=-1236/488, 1-24=0/0, 12-13=-973/356, 12-25=0/0
BOT CHORD 22-23=-1613/2017, 21-22=-2133/3554, 19-21=-735/898, 18-19=-3671/1052, 17-18=-3671/1052, 15-17=-137/313, 14-15=-567/1766, 13-14=-150/288

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
4) Provide adequate drainage to prevent water ponding.
5) Plates checked for a plus or minus 5 degree rotation about its center.
6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 110 lb uplift at joint 13, 224 lb uplift at joint 18 and 147 lb uplift at joint 23.
7) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
8) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884355
2503400-A	M04	Jack-Closed	2	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:40
ID:WYK5D_w5L9CSVDbJcXmSOzF07i-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

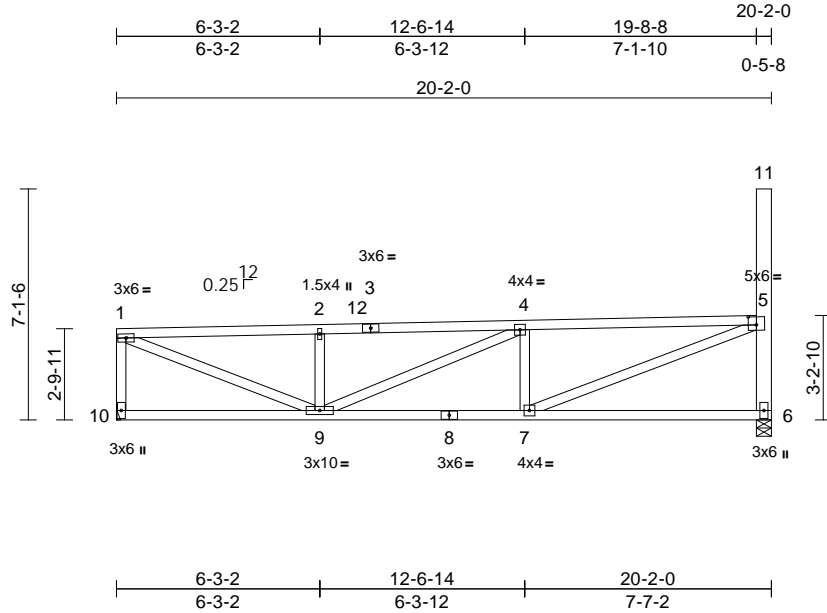

Scale = 1:71

Plate Offsets (X, Y): [5:0-3:0,0-3:0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	0.09	7-9	>999	240	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.38	Vert(CT)	-0.16	7-9	>999	180	
TCDL	15.0	Rep Stress Incr	NO	WB	0.77	Horz(CT)	0.02	6	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS							
BCDL	10.0										
										Weight: 116 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 5-7:2x4 SP 1650F 1.6E, 11-6:2x6 SP 2400F 2.0E

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-0-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-11-3 oc bracing.

REACTIONS (size) 6=0-5-8, 10= Mechanical
Max Horiz 10=316 (LC 10)
Max Uplift 6=215 (LC 10), 10=195 (LC 9)
Max Grav 6=1085 (LC 26), 10=934 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-1583/948, 2-4=-1582/958, 4-5=-1772/1188, 1-10=-873/556, 5-6=-1011/631, 5-11=0/0
BOT CHORD 9-10=-610/450, 7-9=-873/1765, 6-7=-168/287
WEBS 2-9=-443/380, 4-7=-515/514, 4-9=-356/240, 5-7=-1154/1770, 1-9=-1023/1645

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00

- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 215 lb uplift at joint 6 and 195 lb uplift at joint 10.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-4=-58, 6-10=-20
Concentrated Loads (lb)
Vert: 1=-15
Trapezoidal Loads (lb/ft)
Vert: 4=-59-to-5=-118



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884356
2503400-A	M05G	Monopitch Girder	2	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:41

Page: 1

ID:p5cfCmtZyqxjQFYs9GZZY8zF_r8-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

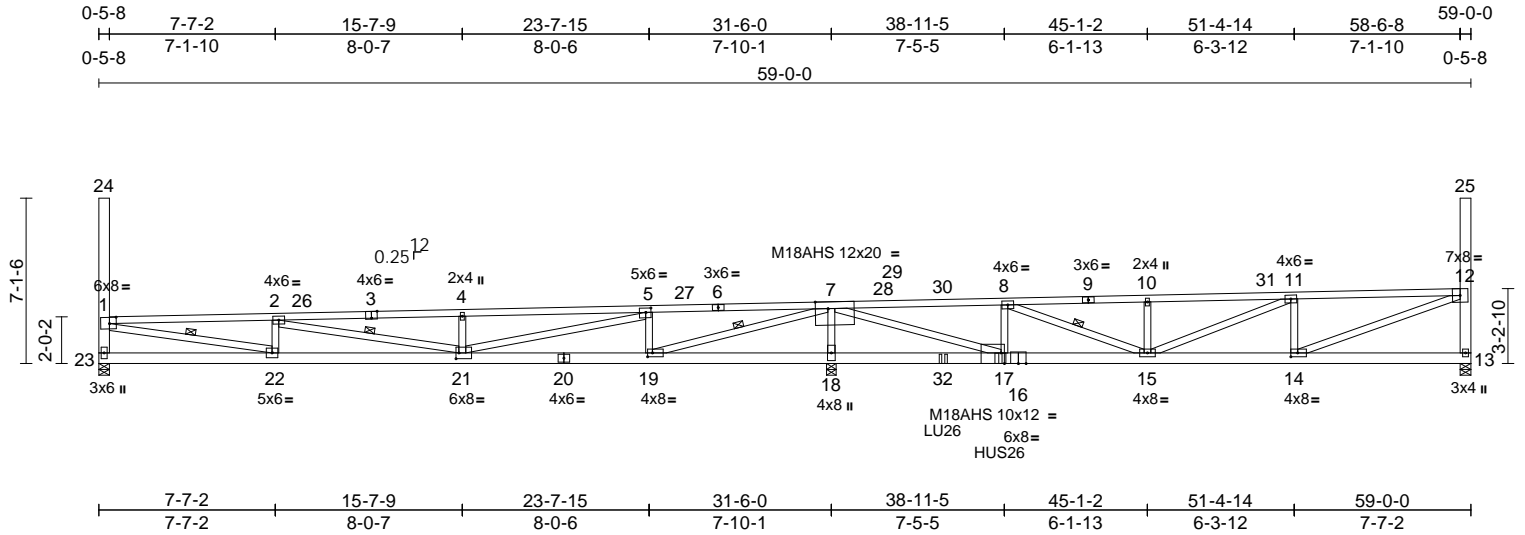

Scale = 1:99.1

Plate Offsets (X, Y): [1:0-3-8,0-3-4], [3:0-3-0,Edge], [5:0-2-12,0-2-4], [7:0-6-8,Edge], [14:0-3-8,0-2-0], [17:0-1-12,Edge], [19:0-2-8,0-2-0], [21:0-1-8,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	1.00	Vert(LL)	0.32	21-22	>999	240	MT20 244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.68	Vert(CT)	-0.61	15-17	>540	180	M18AHS 186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.98	Horz(CT)	-0.03	18	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS							
BCDL	10.0										
Weight: 361 lb FT = 12%											

LUMBER
TOP CHORD 2x4 SP 2400F 2.0E *Except* 3-1,3-6:2x4 SP 1650F 1.6E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.2 *Except*
12-14,7-19,5-21,21-2,1-22:2x4 SP 1650F
1.6E, 7-17:2x4 SP 2400F 2.0E,
23-24,25-13:2x6 SP 2400F 2.0E

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 3-3-11 oc bracing.
WEBS 1 Row at midpt 8-15, 7-19, 2-21, 1-22
REACTIONS (size) 13=0-5-8, 18=0-5-0, (req. 0-5-2), 23=0-5-8
Max Horiz 23=484 (LC 36)
Max Uplift 13=161 (LC 10), 18=311 (LC 13), 23=239 (LC 35)
Max Grav 13=1669 (LC 26), 18=6164 (LC 26), 23=1117 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=2809/1939, 2-4=2071/1936, 4-5=2071/1945, 5-7=200/1496, 7-8=4888/469, 8-10=4683/1044, 10-11=4682/1051, 11-12=3384/1038, 1-23=1003/562, 1-24=0/0, 12-13=1571/389, 12-25=0/0
BOT CHORD 22-23=1607/1995, 21-22=2497/3070, 19-21=1716/262, 18-19=6068/1402, 17-18=6068/1402, 15-17=461/4882, 14-15=649/3377, 13-14=175/331

WEBS
2-22=460/509, 5-19=1361/602,
7-18=5498/1153, 10-15=404/255,
8-15=1890/610, 11-14=1129/338,
11-15=265/1595, 12-14=671/3453,
7-19=1817/4863, 4-21=570/318,
5-21=1191/3578, 2-21=896/390,
1-22=1909/2570, 7-17=1570/11381,
8-17=551/897

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - Plates checked for a plus or minus 5 degree rotation about its center.
 - WARNING: Required bearing size at joint(s) 18 greater than input bearing size.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 161 lb uplift at joint 13, 239 lb uplift at joint 23 and 311 lb uplift at joint 18.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.

- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Use Simpson Strong-Tie LU26 (6-10d Girder, 4-10dx1 1/2 Truss, Single Ply Girder) or equivalent at 36-3-12 from the left end to connect truss(es) to back face of bottom chord.
- Use Simpson Strong-Tie HUS26 (14-16d Girder, 6-16d Truss, Single Ply Girder) or equivalent at 38-9-4 from the left end to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 2-29=58, 29-30=104, 8-30=81, 8-11=58, 13-23=20
Concentrated Loads (lb)
Vert: 8=9, 17=-2448 (B), 32=620 (B)



June 3,2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M05G	Monopitch Girder	2	1	Job Reference (optional)

I73884356

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:41
ID:p5cfCmtZygjQFYs9GZZY8zF_r8-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 2

Trapezoidal Loads (lb/ft)
Vert: 1=-118-to-2=-59, 11=-59-to-12=-118



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884357
2503400-A	M05X	Monopitch	1	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:41
ID:f1?cZuwyJO8TOebKV4dKBqzBgj4-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

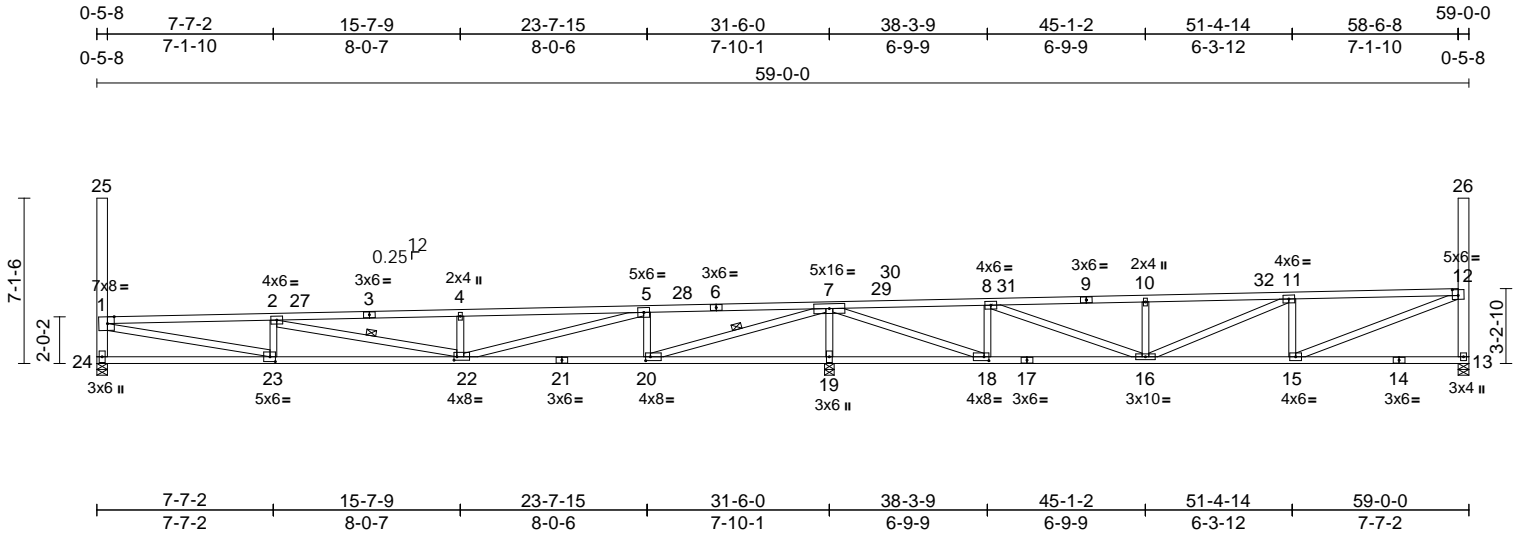

Scale = 1:99.1

Plate Offsets (X, Y): [1:0-3-8,Edge], [12:0-3-0,0-3-0], [18:0-2-8,0-2-0], [20:0-2-8,0-2-0], [22:0-1-8,0-1-12], [23:0-2-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.34	22-23	>999	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.77	Vert(CT)	-0.77	22-23	>487	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.98	Horz(CT)	0.03	19	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 314 lb	FT = 12%

LUMBER			WEBS	7-19=-3233/995, 10-16=-436/263, 11-15=-543/288, 11-16=-135/108, 12-15=-547/1836, 5-20=-1223/593, 4-22=-572/320, 5-22=-1070/2676, 2-23=-556/444, 1-23=-1619/3354, 8-18=-1200/395, 7-20=-1706/4707, 2-22=-579/432, 8-16=-644/1748, 7-18=-940/3987
TOP CHORD	2x4 SP 1650F 1.6E *Except* 3-1:2x4 SP 2400F 2.0E			
BOT CHORD	2x4 SP 1650F 1.6E			
WEBS	2x4 SP No.2 *Except* 12-15,5-22,1-23,7-20,22-2:2x4 SP 1650F 1.6E, 25-24,26-13:2x6 SP 2400F 2.0E			
BRACING			NOTES	1) Unbalanced roof live loads have been considered for this design. 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00 4) Provide adequate drainage to prevent water ponding. 5) Plates checked for a plus or minus 5 degree rotation about its center. 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 105 lb uplift at joint 13, 148 lb uplift at joint 24 and 231 lb uplift at joint 19. 7) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1. 8) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
TOP CHORD	Structural wood sheathing directly applied or 2-11-6 oc purlins, except end verticals.			
BOT CHORD	Rigid ceiling directly applied or 3-5-2 oc bracing.			
WEBS	1 Row at midpt 7-20, 2-22			
REACTIONS			LOAD CASE(S)	Standard
(size)	13=0-5-8, 19=0-5-0, 24=0-5-8			
Max Horiz	24=491 (LC 10)			
Max Uplift	13=-105 (LC 10), 19=-231 (LC 13), 24=-148 (LC 9)			
Max Grav	13=1109 (LC 26), 19=3418 (LC 26), 24=1312 (LC 26)			
FORCES				
(lb) - Maximum Compression/Maximum Tension				
TOP CHORD	1-2=-3544/1574, 2-4=-3468/1266, 4-5=-3385/1228, 5-7=-824/358, 7-8=-684/321, 8-10=-1766/840, 10-11=-1767/847, 11-12=-1865/945, 1-24=-1234/488, 1-25=0/0, 12-13=-1034/350, 12-26=0/0			
BOT CHORD	23-24=-1613/2017, 22-23=-2137/3550, 20-22=-742/891, 19-20=-3702/1031, 18-19=-3702/1031, 16-18=-99/351, 15-16=-552/1827, 13-15=-150/289			

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 2-30=-58, 30-31=-83, 11-31=-58, 13-24=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-118-to-2=-59, 11=-59-to-12=-118



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	
2503400-A	M06G	Flat Girder	1	1	Job Reference (optional)	I73884358

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:42
ID:5Unqo5q3W5nm7iCCT9XzRlZF02g-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

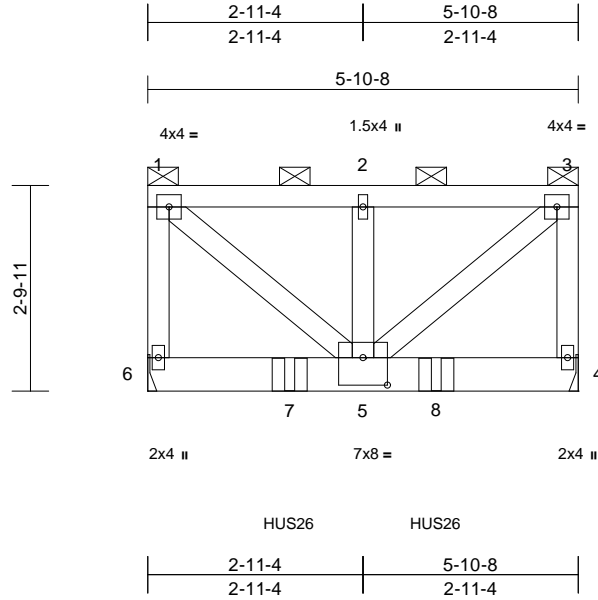

Scale = 1:31.4

Plate Offsets (X, Y): [5:0-4-0,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.14	Vert(LL)	0.01	5-6	>999	240	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.19	Vert(CT)	-0.02	4-5	>999	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.33	Horz(CT)	0.00	4	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP								
BCDL	10.0										Weight: 41 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.2

BRACING

TOP CHORD 2-0-0 oc purlins: 1-3, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 4= Mechanical, 6= Mechanical
Max Horiz 6=88 (LC 11)
Max Uplift 4=197 (LC 10), 6=197 (LC 9)
Max Grav 4=1244 (LC 26), 6=1244 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-6=999/356, 1-2=1014/291,
2-3=1014/291, 3-4=999/356
BOT CHORD 5-6=130/134, 4-5=47/51
WEBS 1-5=429/1345, 2-5=318/244, 3-5=429/1345

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 197 lb uplift at joint 6 and 197 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 1-11-4 from the left end to 3-11-4 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-96, 4-6=-20
Concentrated Loads (lb)
Vert: 7=-914 (B), 8=-914 (B)



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884359
2503400-A	M07G	Flat Girder	1	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:42
ID:V3TyQ6sy09L_9xn9l5g3OzF02d-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWwCDoi7J4zJC?#f

Page: 1

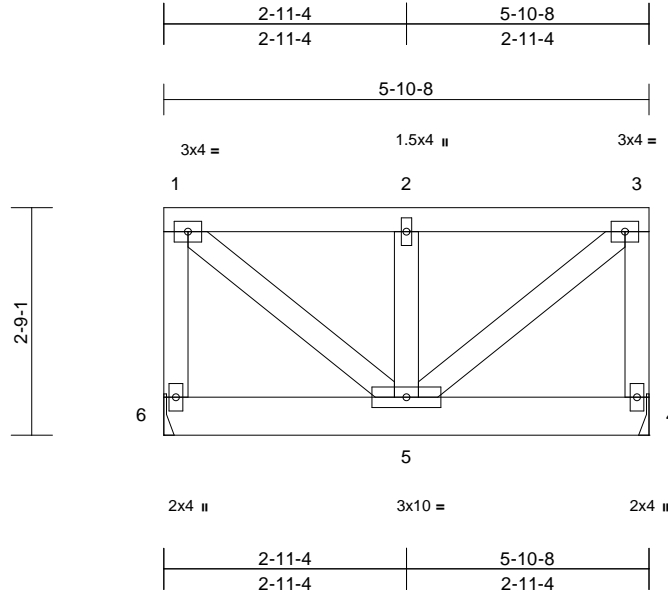

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.14	Vert(LL)	0.00	5	>999	240	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	5	>999	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.07	Horz(CT)	0.00	4	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP								
BCDL	10.0										Weight: 41 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x6 SP 2400F 2.0E
WEBS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-10-8 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	4= Mechanical, 6= Mechanical
	Max Horiz	6=-86 (LC 11)
	Max Grav	4=330 (LC 2), 6=330 (LC 2)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-6=-293/195, 1-2=-219/111, 2-3=-219/111, 3-4=-293/195
BOT CHORD	5-6=-127/131, 4-5=-46/50
WEBS	1-5=-188/288, 2-5=-336/232, 3-5=-188/288

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.

- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-96, 4-6=-20



June 3,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Lumber Specialties, Dyersville, IA - 52040, Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:42 Page: 1
ID: iT4XEBa kD0fxlKEFYt vwzF06k-RfC?PsB70Hq3NSqPqnL8w3uITXbGKWCrD0i7J4zJC?f



LUMBER		2) Wind: ASCE 7-16; Vult=15mph (3-second gust)
TOP CHORD	2x4 DF-N 2850F 2.3E *Except* 6-8:2x4 SP 1650F 1.6E, 6-3:2x4 SP 2400F 2.0E	Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=34ft; eave=4ft; Cat. II; Exp C; Enclosed;
BOT CHORD	2x4 SP 1650F 1.6E	MWFRS (directional) and C-C Corner (3) 0-2-12 to 15-2-12, Exterior (2) 15-2-12 to 21-1-4, Corner (3) 21-1-4 to 36-1-4 zone; cantilever left and right exposed ;
WEBS	2x4 SP No.2 *Except* 5-13,1-14,7-11,13-2:2x4 SP 1650F 1.6E, 15-16:2x6 SP 2400F 2.0E	end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
BRACING		3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
TOP CHORD	Structural wood sheathing directly applied or 2-8-6 oc purlins, except end verticals.	4) Provide adequate drainage to prevent water ponding.
BOT CHORD	Rigid ceiling directly applied or 5-0-15 oc bracing.	5) All plates are MT20 plates unless otherwise indicated.
WEBS	1 Row at midpt 1-14, 7-11	6) Plates checked for a plus or minus 5 degree rotation about its center.
REACTIONS	(size) 10=0-5-0, 15=0-5-8	7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 217 lb uplift at joint 10 and 187 lb uplift at joint 15.
	Max Horiz 15=320 (LC 10)	8) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
	Max Uplift 10=-217 (LC 10), 15=-187 (LC 9)	9) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
	Max Grav 10=1970 (LC 26), 15=1571 (LC 26)	
FORCES		LOAD CASE(S) Standard
(lb) - Maximum Compression/Maximum Tension		1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
TOP CHORD	1-2=-4543/2054, 2-4=-5451/2141, 4-5=-5368/2101, 5-7=-3568/1350, 7-8=-77/343, 1-15=-1491/560, 1-16=0/0	Uniform Loads (lb/ft)
BOT CHORD	14-15=-1014/1533, 13-14=-2087/4531, 11-13=-1358/3561, 10-11=-341/74, 9-10=0/0	
WEBS	7-10=-1625/671, 5-11=-1034/538, 4-13=-569/331, 5-13=-790/1871, 2-14=-850/505, 1-14=-1771/4404, 7-11=-1492/4076, 2-13=-767/1122, 8-9=-48/22, 8-10=-387/84	

LOAD CASE(S) Standard

1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 2-22=-58, 8-22=-104, 9-15=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-118-to-2=-59



Lumber Specialties, Dyersville, IA - 52040, Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:42 Page: 1
ID:0d11XH4SpIz T?Qep63vHHzEzvU-RfC?PsB70Hg3NSoPanL8w3ulTXbGKWRcDoI7J4zJC?f




Plate Offsets (X, Y): [8:0-8-4,Edge], [13:0-3-0,0-3-0], [18:0-2-4,0-2-4], [20:0-2-12,0-4-8]

ROOFER TOP CHORD 2x4 SP 2400F 2.0E *Except* 10-13:2x4 SP 1650F 1.6E BOT CHORD 2x6 SP 2400F 2.0E WEBS 2x4 SP No.2 *Except* 13-15,8-18,1-24,2-23:2x4 SP 1650F 1.6E, 20-8:2x4 SP 2400F 2.0E, 26-25,27-14:2x6 SP 2400F 2.0E	WEBS 2-24=776/305, 6-20=461/78, 9-18=1473/347, 8-19=4936/135, 11-16=446/248, 9-16=190/2918, 12-15=236/487, 12-16=962/0, 13-15=1130/961, 8-20=0/10364, 4-23=156/84, 8-18=978/4396, 1-24=1016/4327, 5-20=1451/734, 5-21=451/649, 4-21=1336/1367, 2-23=0/1157	10) Use Simpson Strong-Tie HUS26 (14-10d Girder, 6-10d Truss, Single Ply Girder) or equivalent at 24-0-4 from the left end to connect truss(es) to front face of bottom chord. 11) Use Simpson Strong-Tie LU24 (4-16d Girder, 2-10dx1 1/2 Truss, Single Ply Girder) or equivalent at 28-7-4 from the left end to connect truss(es) to front face of bottom chord. 12) Fill all nail holes where hanger is in contact with lumber. 13) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
BRACING TOP CHORD Structural wood sheathing directly applied, except end verticals. BOT CHORD Rigid ceiling directly applied or 3-0-14 oc bracing.	NOTES 1) Unbalanced roof live loads have been considered for this design. 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60	LOAD CASE(S) Standard 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15 Uniform Loads (lb/ft) Vert: 2-29=-58, 6-29=-113, 6-31=-80, 12-31=-58, 14-25=-20 Concentrated Loads (lb) Vert: 20=-1665 (F), 31=-9, 34=-442 (F) Trapezoidal Loads (lb/ft) Vert: 1=-118-to-2=-59, 12=-59-to-13=-118
REACTIONS (size) 14=0-5-8, 19=0-5-0, 25=0-5-8 Max Horiz 25=488 (LC 10) Max Uplift 14=-308 (LC 36) Max Grav 14=804 (LC 26), 19=5716 (LC 26), 25=1565 (LC 26)	3) TC LL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00 4) Provide adequate drainage to prevent water ponding. 5) All plates are MT20 plates unless otherwise indicated. 6) Plates checked for a plus or minus 5 degree rotation about its center. 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 308 lb uplift at joint 14. 8) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1. 9) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.	
FORCES (lb) - Maximum Compression/Maximum Tension TOP CHORD 1-2=-4643/990, 2-4=-5508/117, 4-5=-4235/0, 5-6=-3144/0, 6-8=-3147/0, 8-9=0/2610, 9-11=-565/1775, 11-12=-567/1781, 12-13=-1247/1437, 1-25=-1435/322, 1-26=0/0, 13-14=-717/544, 13-27=0/0 BOT CHORD 24-25=-1664/2175, 23-24=-1550/4622, 21-23=-667/5500, 20-21=0/4229, 19-20=-6773/2, 18-19=-6773/2, 16-18=-2605/0, 15-16=-1048/1028, 14-15=-180/317		



June 3.2025



WARNING – verify design parameters and noted notes on this and included MiTek Reference Tag M7473 Rev. 1/2/2023 before use. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884362
2503400-A	M09X	Monopitch	1	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:43
ID:wL935d7MVzURAybKeZ0MMzGa8l-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?f

Page: 1

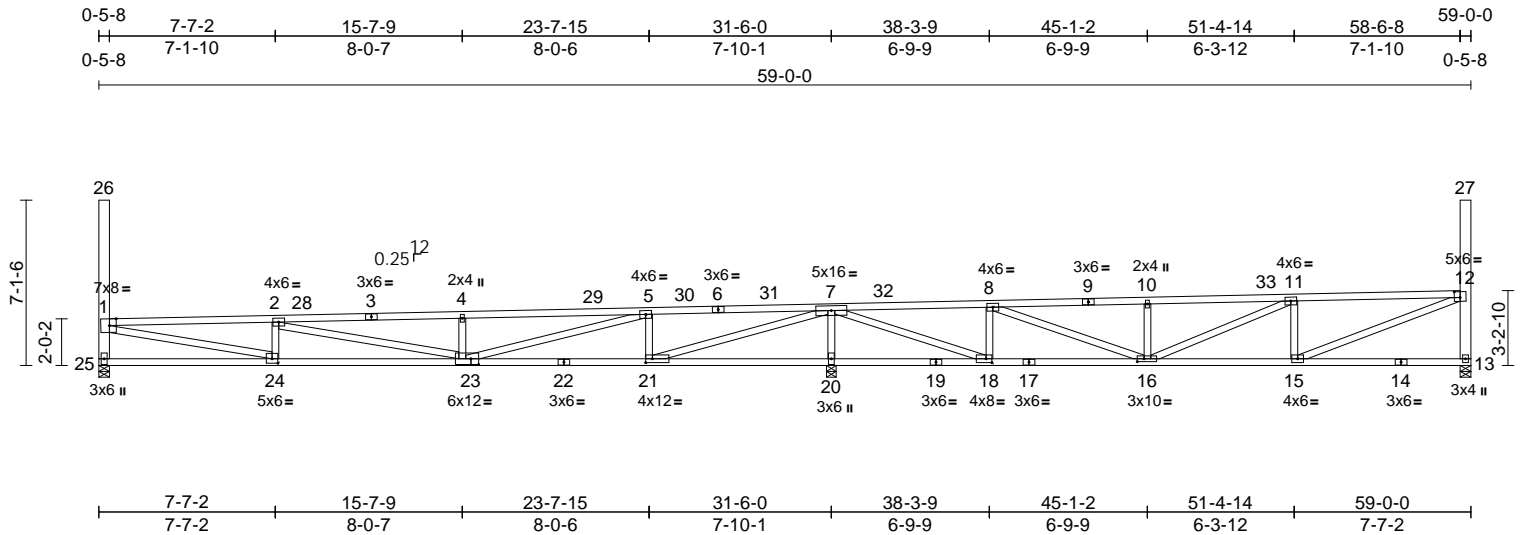

Scale = 1:99.1

Plate Offsets (X, Y): [1:0-3-8,Edge], [12:0-3-0,0-3-0], [16:0-3-8,0-1-8], [18:0-3-0,0-2-0], [21:0-3-8,0-2-0], [23:0-4-0,0-3-0], [24:0-3-0,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.34	23-24	>999	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.80	Vert(CT)	-0.83	23-24	>454	180		
TCDL	15.0	Rep Stress Incr	NO	WB	1.00	Horz(CT)	0.04	20	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 314 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E *Except* 3-1:2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except*
12-15,7-21,5-23,23-2,1-24:2x4 SP 1650F 1.6E, 26-25,27-13:2x6 SP 2400F 2.0E

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-9-9 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 3-3-10 oc bracing.

REACTIONS

(size) 13=0-5-8, 20=0-5-0, 25=0-5-8
Max Horiz 25=491 (LC 10)
Max Uplift 13=146 (LC 10), 20=91 (LC 13), 25=110 (LC 9)
Max Grav 13=1067 (LC 26), 20=3559 (LC 26), 25=1349 (LC 26)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-3693/1424, 2-4=-3751/978, 4-5=-3652/930, 5-7=-1235/0, 7-8=-322/683, 8-10=-1555/1049, 10-11=-1557/1055, 11-12=-1753/1056, 1-25=-1272/451, 1-26=0/0, 12-13=-993/392, 12-27=0/0
BOT CHORD 24-25=-1611/2019, 21-24=-1987/3700, 20-21=-3892/845, 18-20=-3892/845, 16-18=-462/0, 15-16=-663/1715, 13-15=-150/288
WEBS 2-24=-588/412, 5-21=-1408/409, 8-18=-1139/456, 7-20=-3370/857, 10-16=-450/249, 8-16=-481/1912, 11-15=-498/333, 11-16=-243/1, 12-15=-666/1716, 7-21=-1081/5331, 4-23=-568/327, 5-23=-1187/2531, 2-23=-443/573, 1-24=-1467/3505, 7-18=-1127/3801

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 110 lb uplift at joint 25, 146 lb uplift at joint 13 and 91 lb uplift at joint 20.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 2-29=-58, 29-31=-92, 11-31=-58, 13-25=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-118-to-2=-59, 11=-59-to-12=-118



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M10	Jack-Closed	2	1	Job Reference (optional)


I73884363

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:43

Page: 1

ID:FhpXOI?OYMOst_YYCkxw8jzGZee-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

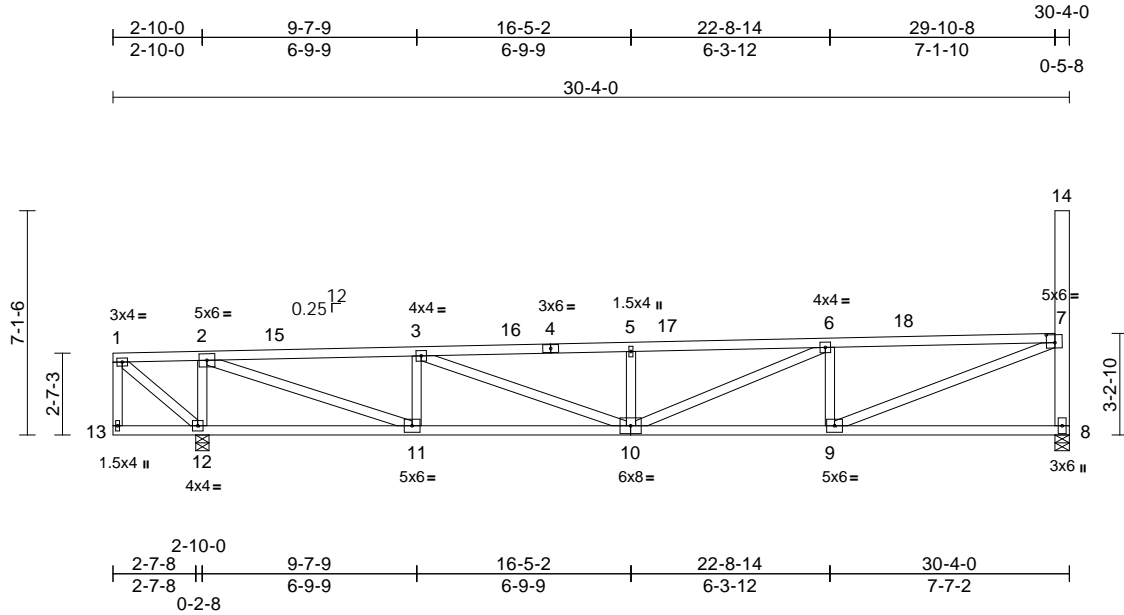

Scale = 1:73.1

Plate Offsets (X, Y): [7:0-3-4,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	-0.18	10	>999	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.54	Vert(CT)	-0.40	10-11	>812	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.97	Horz(CT)	0.05	8	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 168 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E *Except* 4-7:2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 7-9:2x4 SP 1650F 1.6E, 14-8:2x6 SP 2400F 2.0E

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-6-12 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size) 8=0-5-8, 12=0-5-0
Max Horiz 12=315 (LC 10)
Max Uplift 8=-157 (LC 10), 12=-217 (LC 9)
Max Grav 8=1416 (LC 26), 12=1517 (LC 26)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-59/46, 2-3=-2574/985, 3-5=-3291/1373, 5-6=-3292/1381, 6-7=-2643/1266, 1-13=-35/4, 7-8=-1340/565, 7-14=0/0
BOT CHORD 12-13=-52/48, 11-12=-558/419, 9-11=-1196/2635, 8-9=-155/288
WEBS 2-12=-1373/654, 5-10=-441/273, 6-9=-862/489, 6-10=-469/795, 7-9=-1084/2701, 3-11=-770/454, 3-10=-405/765, 2-11=-1097/2732, 1-12=-28/52

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=41ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-1-12 to 5-1-12, Exterior (2) 5-1-12 to 25-1-4, Corner (3) 25-1-4 to 30-1-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 157 lb uplift at joint 8 and 217 lb uplift at joint 12.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-6=-58, 8-13=-20
Concentrated Loads (lb)
Vert: 1=-14
Trapezoidal Loads (lb/ft)
Vert: 6=-59-to-18=-78, 18=-78-to-7=-118



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M12G	Flat Girder	1	1	Job Reference (optional)
					I73884364

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:44
ID:rosjaZwbCTQtCsTbSNImC3zF0AH-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?i

Page: 1

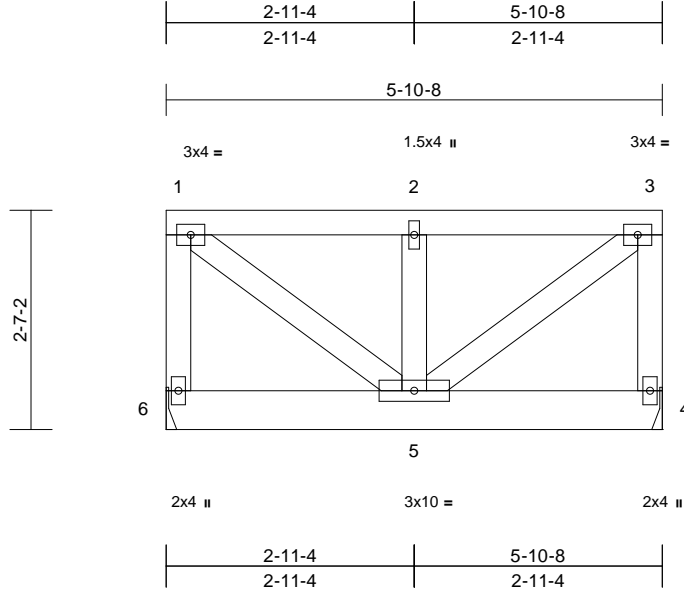

Scale = 1:27.3

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	0.00	5	>999	240	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	-0.01	5	>999	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.10	Horz(CT)	0.00	4	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP								
BCDL	10.0										Weight: 40 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x6 SP 2400F 2.0E
WEBS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-10-8 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	4= Mechanical, 6= Mechanical
	Max Horiz	6=80 (LC 9)
	Max Grav	4=462 (LC 2), 6=462 (LC 2)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-6=-418/64, 1-2=-328/24, 2-3=-328/24, 3-4=-418/64
BOT CHORD	5-6=-119/122, 4-5=-43/46
WEBS	1-5=-69/419, 2-5=-498/70, 3-5=-69/419

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.

- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-144, 4-6=-20



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884365
2503400-A	M13G	Flat Girder	1	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:44
ID:ZSx46ArCrJXssnRFXPg6QazF0AO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

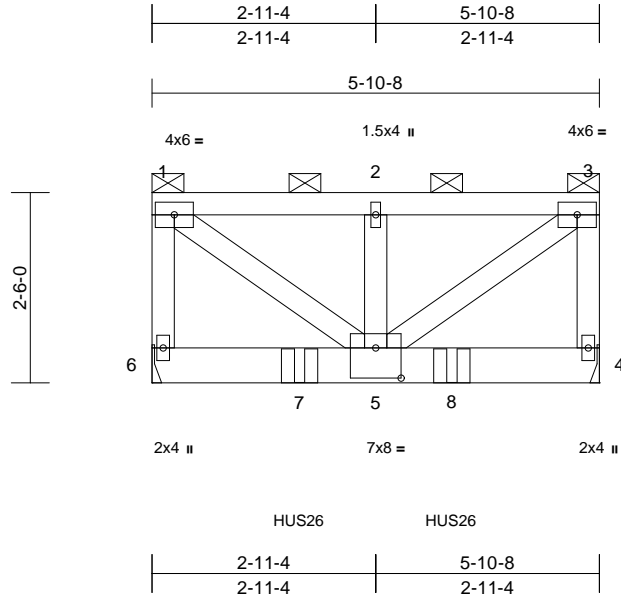

Scale = 1:30.3

Plate Offsets (X, Y): [5:0-4-0,0-4-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.22	Vert(LL)	0.01	5-6	>999	240	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.26	Vert(CT)	-0.03	5-6	>999	180	
TCDL	15.0	Rep Stress Incr	NO	WB	0.48	Horz(CT)	0.00	4	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 39 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.2

BRACING

TOP CHORD 2-0-0 oc purlins (5-8-3 max.): 1-3, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 4= Mechanical, 6= Mechanical
Max Horiz 6=77 (LC 9)
Max Grav 4=1685 (LC 26), 6=1685 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-6=-1353/119, 1-2=-1552/98, 2-3=-1552/98, 3-4=-1353/119
BOT CHORD 5-6=-114/117, 4-5=-41/44
WEBS 1-5=-159/1951, 2-5=-470/88, 3-5=-159/1951

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.

- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 1-11-4 from the left end to 3-11-4 to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-144, 4-6=-20
Concentrated Loads (lb)
Vert: 7=-1222 (F), 8=-1222 (F)



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884366
2503400-A	M14	Jack-Closed	2	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:44
ID:IP0C?wXU1B80sOoldpGYkCzGZgX-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

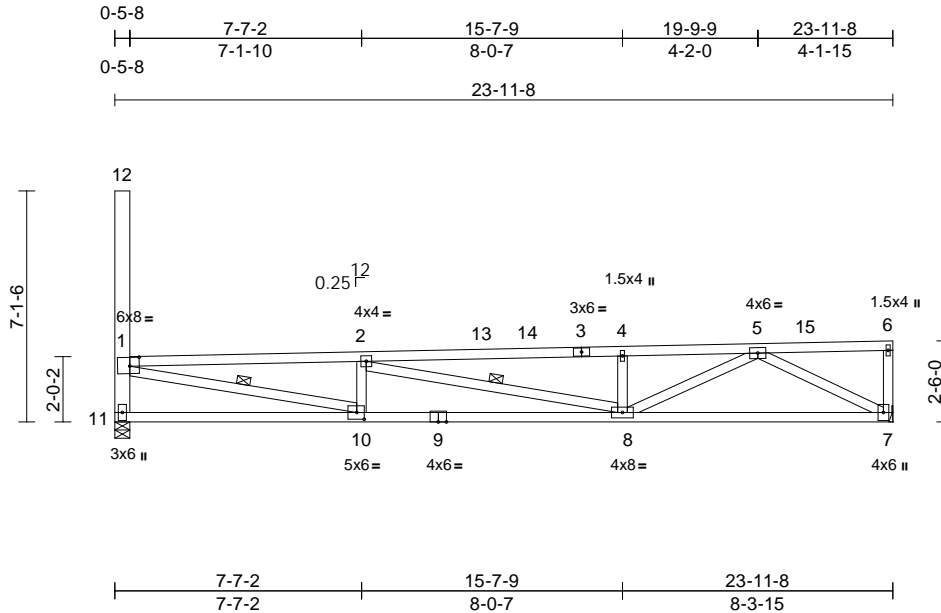

Scale = 1:71

Plate Offsets (X, Y): [1:0-3-8,0-3-4], [10:0-2-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	0.22	8-10	>999	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.45	8-10	>631	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.76	Horz(CT)	0.06	7	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
Weight: 130 lb											FT = 12%	

LUMBER

TOP CHORD 2x4 SP 2400F 2.0E *Except* 3-6:2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 1-10,2-8:2x4 SP 1650F 1.6E, 12-11:2x6 SP 2400F 2.0E

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-6-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 5-1-11 oc bracing.
WEBS 1 Row at midpt 1-10, 2-8

REACTIONS

(size) 7= Mechanical, 11=0-5-8
Max Horiz 11=322 (LC 10)
Max Uplift 7=-62 (LC 10), 11=-208 (LC 9)
Max Grav 7=1242 (LC 26), 11=1269 (LC 26)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-3385/2006, 2-4=-3107/1555, 4-5=-3067/1532, 5-6=-5/4, 1-11=-1190/623, 1-12=0/0
BOT CHORD 10-11=-1110/1649, 8-10=-2034/3366, 7-8=-861/1800
WEBS 4-8=-442/365, 2-10=-533/517, 1-10=-1973/3196, 6-7=-228/0, 5-7=-2036/974, 5-8=-767/1430, 2-8=-575/476

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 208 lb uplift at joint 11 and 62 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 2-15=-58, 6-15=-124, 7-11=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-118-to-2=-59



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M15G	Monopitch Girder	1	1	Job Reference (optional)
					I73884367

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:44

Page: 1

ID:KQ2xmB8q04aXaD8Gj?RiCXzEzfv-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWvCDorJ4zJC7f

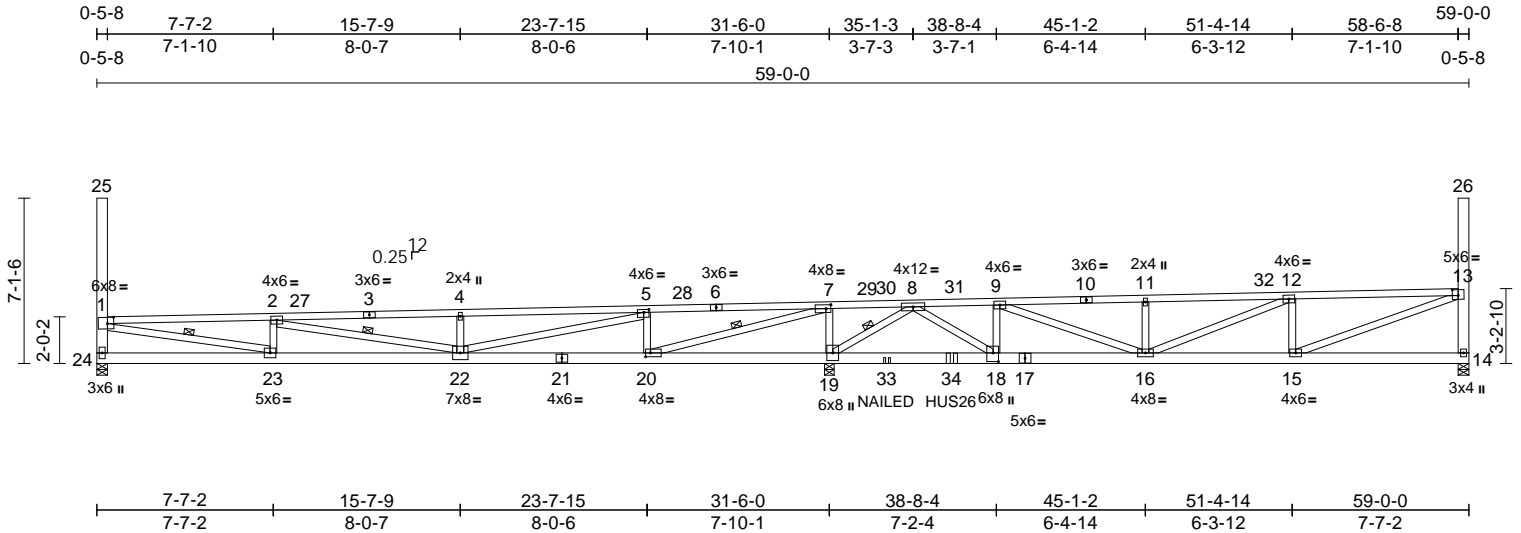

Scale = 1:99.1

Plate Offsets (X, Y): [1:0-3-4,0-3-4], [5:0-2-12,0-1-8], [7:0-2-8,0-2-0], [13:0-3-0,0-3-0], [18:0-4-8,0-2-12], [20:0-2-8,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.97	Vert(LL)	0.30	22-23	>999	240	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.58	Vert(CT)	-0.60	22-23	>628	180	
TCDL	15.0	Rep Stress Incr	NO	WB	0.92	Horz(CT)	-0.02	19	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS							
BCDL	10.0										
Weight: 363 lb FT = 12%											

LUMBER
TOP CHORD 2x4 SP 1650F 1.6E *Except* 3-1,6-10:2x4 SP 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.2 *Except*
13-15,7-20,5-22,22-2,1-23:2x4 SP 1650F 1.6E, 25-24,26-14:2x6 SP 2400F 2.0E

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 3-11-2 oc bracing.
WEBS 1 Row at midpt 7-20, 2-22, 1-23, 8-19
REACTIONS (size) 14=0-5-8, 19=0-5-0, 24=0-5-8
Max Horiz 24=488 (LC 10)
Max Uplift 14=155 (LC 10), 19=538 (LC 13), 24=175 (LC 35)
Max Grav 14=1198 (LC 26), 19=4627 (LC 26), 24=1210 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=3204/1705, 2-4=2780/1473, 4-5=2780/1482, 5-7=276/557, 7-8=1681/4935, 8-9=1617/516, 9-11=2137/950, 11-12=2136/957, 12-13=2120/1016, 1-24=1094/494, 1-25=0/0, 13-14=1112/389, 13-26=0/0
BOT CHORD 23-24=1688/2138, 22-23=2265/3359, 20-22=1043/404, 19-20=4934/1454, 18-19=1705/1059, 16-18=566/1366, 15-16=626/2113, 14-15=175/323

WEBS
2-23=483/444, 5-20=1316/606, 7-19=1756/748, 11-16=432/247, 12-15=604/323, 12-16=202/362, 13-15=679/2115, 7-20=1829/4776, 4-22=560/319, 5-22=1223/3225, 2-22=673/404, 1-23=1725/2911, 9-18=790/677, 9-16=1164/1007, 8-18=882/3463, 8-19=3860/1033

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
 - Provide adequate drainage to prevent water ponding.
 - Plates checked for a plus or minus 5 degree rotation about its center.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 175 lb uplift at joint 24, 538 lb uplift at joint 19 and 155 lb uplift at joint 14.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

- Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent at 36-9-4 from the left end to connect truss(es) to front face of bottom chord.
 - Fill all nail holes where hanger is in contact with lumber.
 - "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 2-29=58, 29-30=67, 12-30=58, 14-24=20
Concentrated Loads (lb)
Vert: 31=-3, 33=-251 (F), 34=-1062 (F)
Trapezoidal Loads (lb/ft)
Vert: 1=-118-to-2=-59, 12=-59-to-13=-118



June 3,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	173884368
2503400-A	M16	Jack-Closed	2	1	Job Reference (optional)	

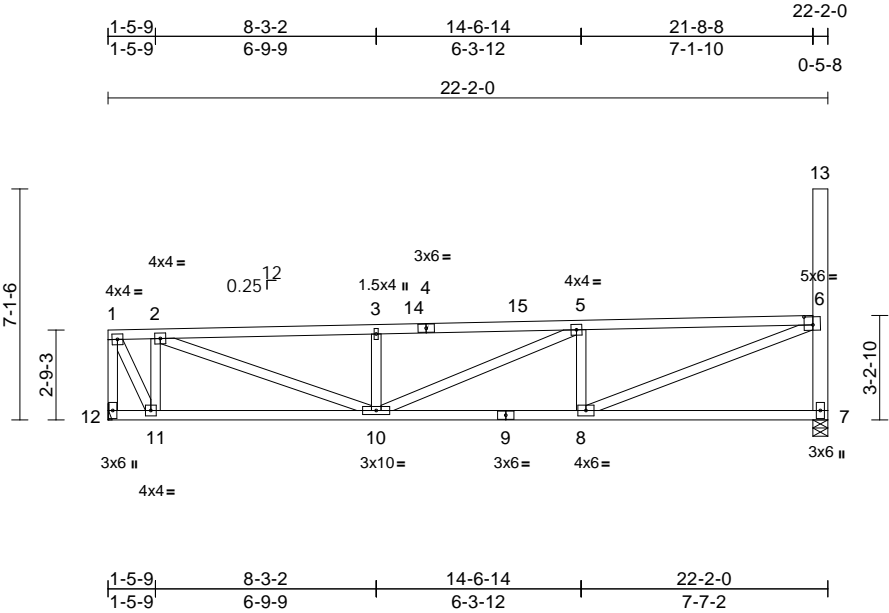

Scale = 1:71
Plate Offsets (X, Y): [6:0-3-4,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.98	Vert(LL)	0.11	8-10	>999	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.41	Vert(CT)	-0.21	8-10	>999	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.81	Horz(CT)	0.03	7	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
Weight: 130 lb											FT = 12%	

LUMBER
TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 6-8:2x4 SP 1650F 1.6E, 13-7:2x6 SP 2400F 2.0E

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-9-4 oc bracing.

REACTIONS (size) 7=0-5-8, 12= Mechanical
Max Horiz 12=316 (LC 10)
Max Uplift 7=-217 (LC 10), 12=-203 (LC 9)
Max Grav 7=1178 (LC 26), 12=1016 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-624/306, 2-3=-2062/1168, 3-5=-2061/1177, 5-6=-2016/1274, 1-12=-1048/509, 6-7=-1103/635, 6-13=0/0
BOT CHORD 11-12=-586/416, 10-11=-821/794, 8-10=-909/2008, 7-8=-166/288
WEBS 3-10=-443/363, 5-8=-613/529, 5-10=-342/282, 6-8=-1195/2031, 2-11=-1041/723, 2-10=-908/1523, 1-11=-719/1326

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
 - Provide adequate drainage to prevent water ponding.
 - Plates checked for a plus or minus 5 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 217 lb uplift at joint 7 and 203 lb uplift at joint 12.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-5=-58, 7-12=-20
Concentrated Loads (lb)
Vert: 1=-10
Trapezoidal Loads (lb/ft)
Vert: 5=-59-to-6=-118



June 3,2025

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M17G	Monopitch Girder	1	1	Job Reference (optional)


173884369

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:45

Page: 1

ID:M37U6ZsHX0mLPABx9pYN1gzEzis-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

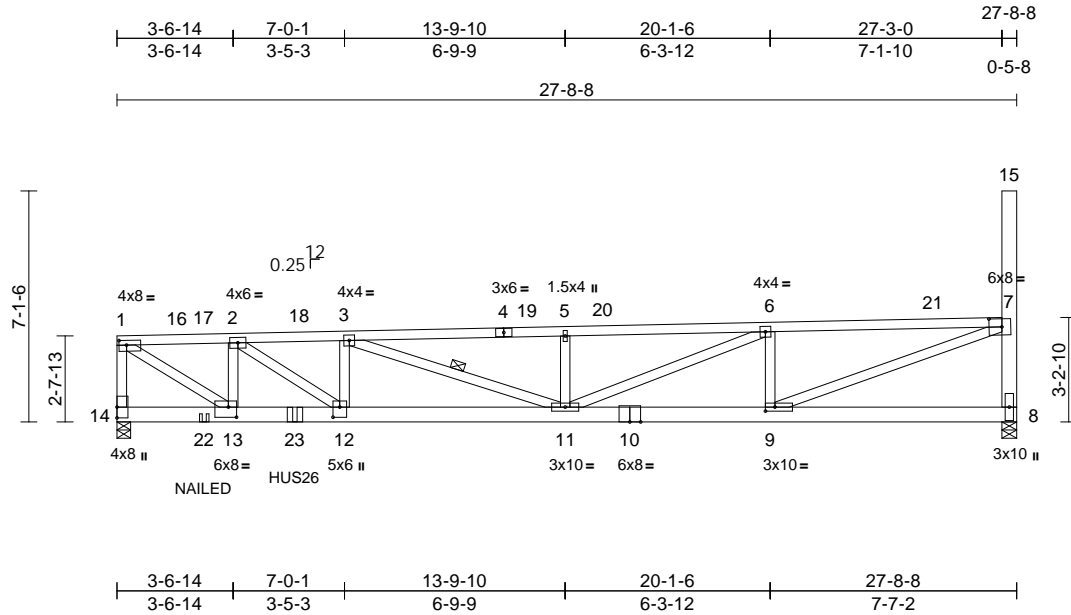

Scale = 1:71

Plate Offsets (X, Y): [1:0-2-12,0-1-12], [7:0-4-12,0-3-0], [9:0-3-8,0-1-8], [12:0-3-12,0-2-8], [13:0-3-0,0-3-12]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	0.24	9-11	>999	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.70	Vert(CT)	-0.50	11	>651	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.92	Horz(CT)	0.05	8	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 178 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E *Except* 4-7:2x4 SP 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SP No.2 *Except* 7-9,13-1:2x4 SP 1650F 1.6E, 15-8:2x6 SP 2400F 2.0E

BRACING

TOP CHORD Structural wood sheathing directly applied or 2-2-10 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-11-2 oc bracing.
WEBS 1 Row at midpt 3-11

REACTIONS

(size) 8=0-5-8, 14=0-5-0
Max Horiz 14=313 (LC 10)
Max Uplift 8=236 (LC 10), 14=251 (LC 9)
Max Grav 8=1645 (LC 26), 14=2693 (LC 26)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-3724/845, 2-3=-5443/1548, 3-5=-5038/1834, 5-6=-5037/1842, 6-7=-3504/1558, 1-14=-2659/666, 7-8=-1550/673, 7-15=0/0
BOT CHORD 13-14=-591/441, 12-13=-1247/3721, 11-12=-1742/5440, 9-11=-1169/3497, 8-9=-189/332
WEBS 5-11=-457/329, 6-9=-1163/586, 6-11=-649/1693, 7-9=-1398/3600, 3-12=-275/692, 3-11=-1155/295, 1-13=-1028/4405, 2-13=-1425/588, 2-12=-848/2084

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=28ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 236 lb uplift at joint 8 and 251 lb uplift at joint 14.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent at 5-5-12 from the left end to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S)

- Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)

Vert: 1-16=-58, 16-17=-81, 17-18=-68, 6-18=-58, 8-14=-20
Concentrated Loads (lb)
Vert: 18=-4, 22=-266 (B), 23=-1448 (B)
Trapezoidal Loads (lb/ft)
Vert: 6=-58-to-21=-79, 21=-79-to-7=-88



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M18G	Flat Girder	1	1	Job Reference (optional)
					I73884370

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:46

Page: 1

ID:ZpZCyEtWqRFoZrRb0mi2MVzF093-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcD0i7J4zJC?f

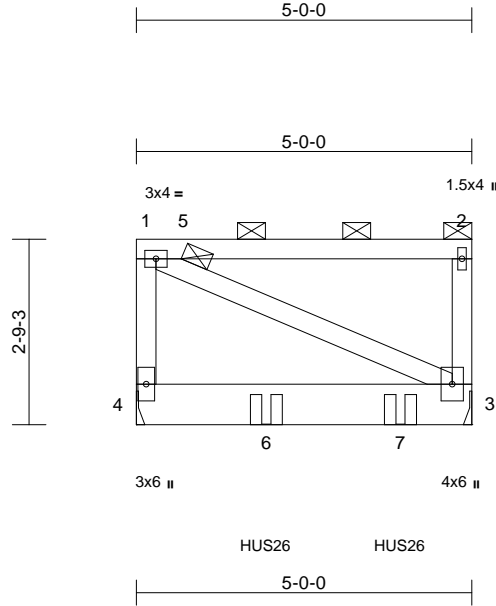

Scale = 1:34.4

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.56	Vert(LL)	0.03	3-4	>999	240	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	-0.07	3-4	>843	180		
TCDL	15.0	Rep Stress Incr	NO	WB	0.04	Horz(CT)	0.00	3	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 36 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x8 SP M 23
WEBS	2x4 SP No.2

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size)	3= Mechanical, 4= Mechanical
	Max Horiz	4=84 (LC 12)
	Max Uplift	3=-242 (LC 10), 4=-179 (LC 9)
	Max Grav	3=1468 (LC 26), 4=1082 (LC 26)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-4=-224/212, 1-2=-45/48, 2-3=-239/157
BOT CHORD	3-4=-124/128
WEBS	1-3=-89/89

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00; Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 179 lb uplift at joint 4 and 242 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 1-11-4 from the left end to 3-11-4 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-5=-68, 2-5=-100, 3-4=-20
Concentrated Loads (lb)
Vert: 6=-996 (B), 7=-997 (B)



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M19G	Flat Girder	1	1	Job Reference (optional)
					I73884371

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:46

Page: 1

ID:wmN5?yxfzt5fcKYpJID3ZzF09_-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

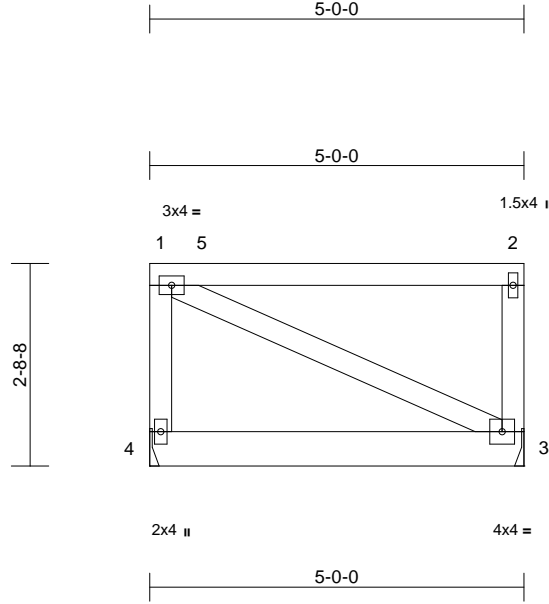

Scale = 1:30.8

Loading	(psf)	Spacing	2'-0'-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.55	Vert(LL)	n/a	-	n/a	999	MT20
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	-0.01	3-4	>999	180	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.04	Horz(CT)	0.00	3	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 32 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x6 SP 2400F 2.0E
WEBS	2x4 SP No.2

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5'-0'-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10'-0'-0 oc bracing.

REACTIONS	(size)	3= Mechanical, 4= Mechanical
	Max Horiz	4=-84 (LC 9)
	Max Uplift	4=-4 (LC 9)
	Max Grav	3=286 (LC 2), 4=271 (LC 2)

FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-4=-224/212, 1-2=-45/49, 2-3=-239/157
BOT CHORD	3-4=-125/129
WEBS	1-3=-89/89

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50'-0'-0
- Provide adequate drainage to prevent water ponding.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.

- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 4 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-5=-68, 2-5=-100, 3-4=-20



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	173884372
2503400-A	M20	Jack-Closed	2	1	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,
Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:46
ID:IKvUjgir2lagibDeX2c_szGZhb-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcD0i7J4zJC?#f
Page: 1

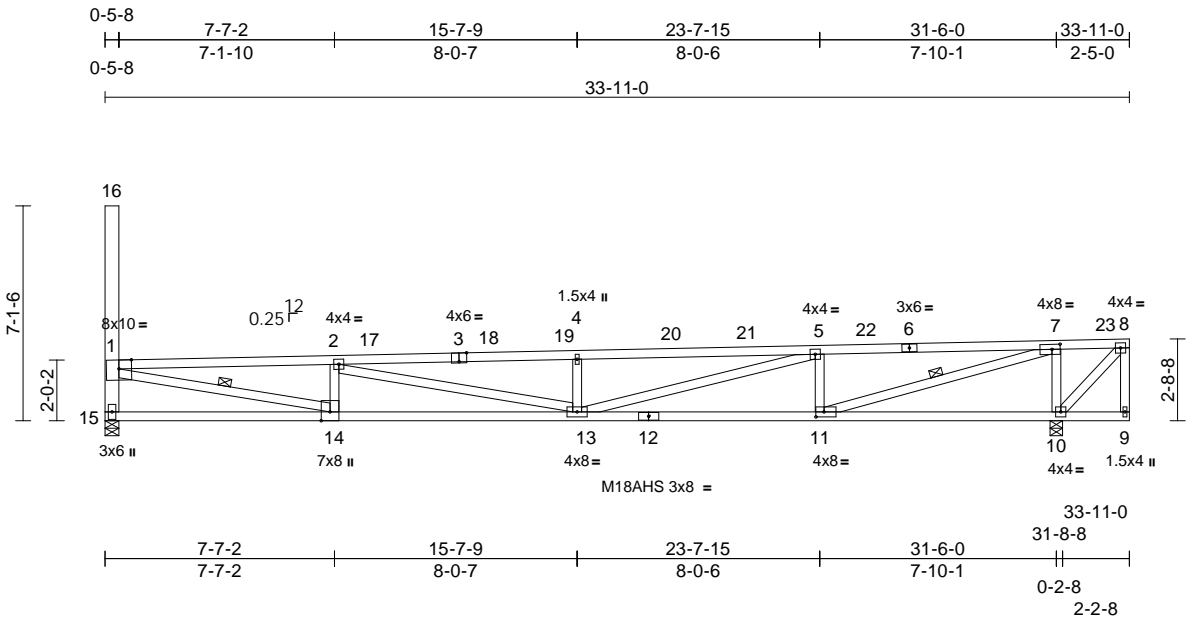

Scale = 1:76.3

Plate Offsets (X, Y): [3:0-3-0,Edge], [7:0-3-4,0-2-0], [11:0-3-4,0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.44	13-14	>846	240	MT20	220/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.96	Vert(CT)	-1.00	13-14	>375	180	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.69	Horz(CT)	0.10	10	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
Weight: 179 lb											FT = 12%	

LUMBER

TOP CHORD 2x4 DF-N 2850F 2.3E *Except* 6-8:2x4 SP 1650F 1.6E, 6-3:2x4 SP 2400F 2.0E

BOT CHORD 2x4 SP 1650F 1.6E *Except* 12-9:2x4 SP 2400F 2.0E

WEBS 2x4 SP No.2 *Except* 5-13,1-14,7-11,13-2:2x4 SP 1650F 1.6E, 16-15:2x6 SP 2400F 2.0E

BRACING

TOP CHORD Structural wood sheathing directly applied, except end verticals.

BOT CHORD Rigid ceiling directly applied or 4-11-1 oc bracing.

WEBS 1 Row at midpt 1-14, 7-11

REACTIONS (size) 10=0-5-0, 15=0-5-8

Max Horiz 15=326 (LC 10)

Max Uplift 10=222 (LC 10), 15=182 (LC 9)

Max Grav 10=1664 (LC 26), 15=1603 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-4677/2183, 2-4=-5692/2319, 4-5=-5609/2277, 5-7=-3904/1515, 7-8=-85/30, 1-15=-1523/597, 1-16=0/0

BOT CHORD 14-15=-1103/1663, 13-14=-2217/4656, 11-13=-1521/3897, 10-11=-30/81, 9-10=0/0

WEBS 7-10=-1567/714, 5-11=-1015/556, 4-13=-567/346, 5-13=-802/1772, 2-14=-798/524, 1-14=-1988/4491, 7-11=-1565/3992, 2-13=-822/1217, 8-9=-55/0, 8-10=-43/119

NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=33ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 15-2-12, Exterior (2) 15-2-12 to 18-9-4, Corner (3) 18-9-4 to 33-9-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 182 lb uplift at joint 15 and 222 lb uplift at joint 10.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.

LOAD CASE(S) Standard

1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (lb/ft)

Vert: 2-23=-58, 8-23=-101, 9-15=-20

Trapezoidal Loads (lb/ft)

Vert: 1=-118-to-2=-59



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M27	Flat	2	1	Job Reference (optional)
					I73884373

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:46
ID:mGDCbSs_aQ7JmLAYwAvWHFzGckM-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRCDoi7J4zJC?i

Page: 1

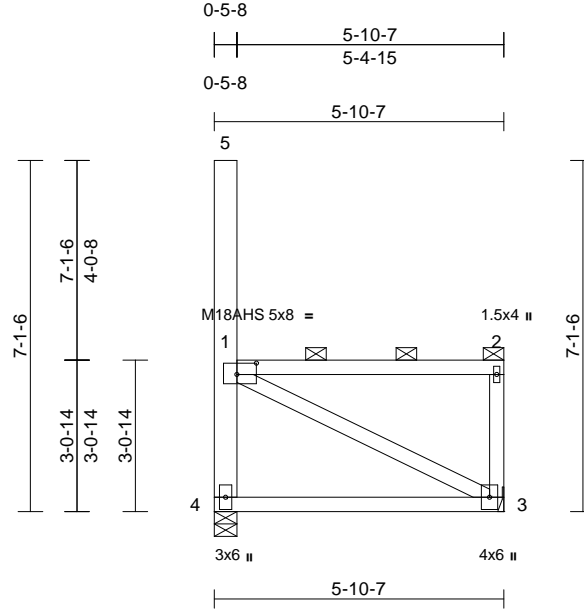

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-4-12,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	-0.05	3-4	>999	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.62	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 45 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-7-8 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
Max Horiz 4=-311 (LC 9)
Max Uplift 3=-262 (LC 10), 4=-262 (LC 9)
Max Grav 3=486 (LC 18), 4=515 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-54/58, 2-3=-256/216, 1-4=-460/703, 1-5=0/0
BOT CHORD 3-4=-725/930
WEBS 1-3=-996/770

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 262 lb uplift at joint 3 and 262 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-106



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M28	Flat	2	1	Job Reference (optional)
					I73884374

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:47

Page: 1

ID:mXle9G3eaeGuJy_pQEjVTqzGck5-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

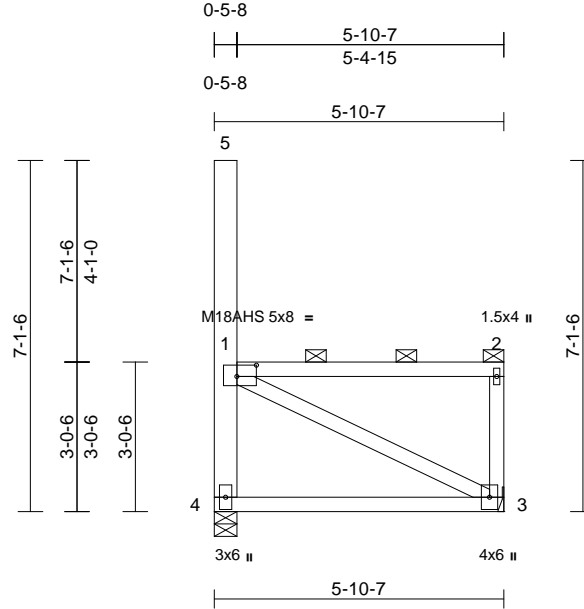

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-4-12,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.71	Vert(LL)	n/a	-	999	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	-0.05	3-4	>999	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.62	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 45 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
 BOT CHORD 2x4 SP 1650F 1.6E
 WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 8-6-13 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
 Max Horiz 4=-312 (LC 9)
 Max Uplift 3=-262 (LC 10), 4=-262 (LC 9)
 Max Grav 3=484 (LC 18), 4=514 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-53/57, 2-3=-253/216, 1-4=-460/704, 1-5=0/0
 BOT CHORD 3-4=-734/945
 WEBS 1-3=-1009/780

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 262 lb uplift at joint 3 and 262 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 3-4=-20
 Trapezoidal Loads (lb/ft)
 Vert: 1=-150-to-2=-105



June 3, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Lumber Specialties, Dyersville, IA - 52040, Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:47 Page: 1
ID:u11YujDoWeu2MyTJgTSYVazGciu-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f




MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M30	Flat	2	1	Job Reference (optional)
					I73884376

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:47
ID:?XJTd9OySdXCQyzpxhBbXJzGcjh-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?i

Page: 1

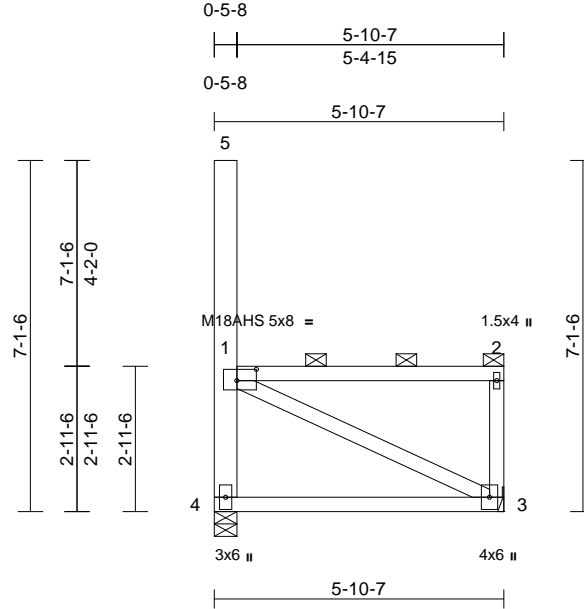

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-4-12,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.71	Vert(LL)	n/a	-	999	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.22	Vert(CT)	-0.05	3-4	>999	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.63	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 45 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-5-7 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
Max Horiz 4=-313 (LC 9)
Max Uplift 3=-263 (LC 10), 4=-263 (LC 9)
Max Grav 3=484 (LC 18), 4=515 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-51/55, 2-3=-253/216, 1-4=-460/705, 1-5=0/0
BOT CHORD 3-4=-755/974
WEBS 1-3=-1038/799

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 263 lb uplift at joint 3 and 263 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M31	Flat	2	1	Job Reference (optional)
					I73884377

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:47
ID:BfUdwwWrs0weFeJw4VtBTezGcJW-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

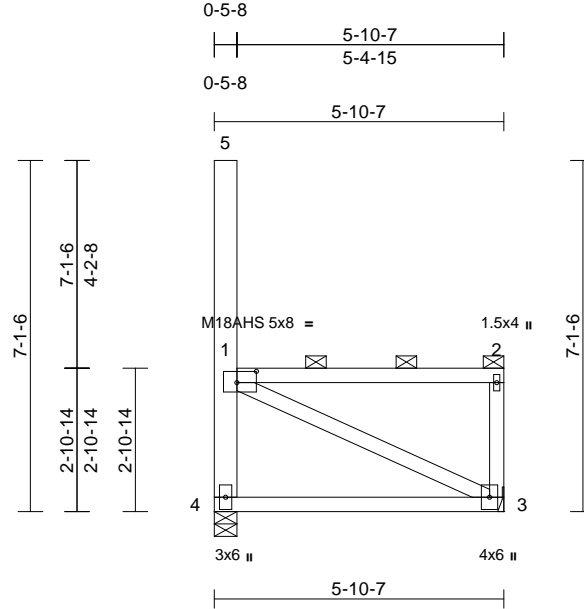

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-4-12,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.71	Vert(LL)	n/a	-	999	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.22	Vert(CT)	-0.05	3-4	>999	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.64	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 45 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-4-12 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
Max Horiz 4=-314 (LC 9)
Max Uplift 3=-263 (LC 10), 4=-263 (LC 9)
Max Grav 3=484 (LC 18), 4=515 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-50/55, 2-3=-253/216, 1-4=-460/706, 1-5=0/0
BOT CHORD 3-4=-766/990
WEBS 1-3=-1052/809

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 263 lb uplift at joint 3 and 263 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Lumber Specialties, Dyersville, IA - 52040, Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:47 Page: 1
ID:qzC9S1fN1iRxhUDEn15?zAzGcjK-RfC?PsB70Hg3NSgPqnL8w3uITXbGKWRcDoi7J4zJc?#f



LUMBER



TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

TOP CHORD	2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 8-4-1 oc bracing.

FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-50/54, 2-3=-253/216, 1-4=-460/707, 1-5=0/0
BOT CHORD	3-4=-777/1006
WEBS	1-3=-1068/820

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
 Vasd=91mph; TCFL=6.0psf; BCDL=6.0psf; h=25ft;
 B=45ft; L=24ft; eave=4ft; Exp. II; Corner C; Enclosed;
 MWFRS (directional) and C-C Corner (3) zone;
 cantilever left and right exposed ; end vertical left and
 right exposed; C-C for members and forces & MWFRS
 for reactions shown; Lumber DOL=1.60 plate grip
 DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15
 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL =
 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially
 Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are MT20 plates unless otherwise indicated.

- 6) Plates checked for a plus or minus 5 degree rotation about its center.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 263 lb uplift at joint 3 and 263 lb uplift at joint 4.
 - 9) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - 10) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard
- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105




16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M33	Flat	2	1	Job Reference (optional)
					I73884379

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:48
ID:yTU4ATpXzh45IUjk2Fq2_vzGcj7-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?i

Page: 1

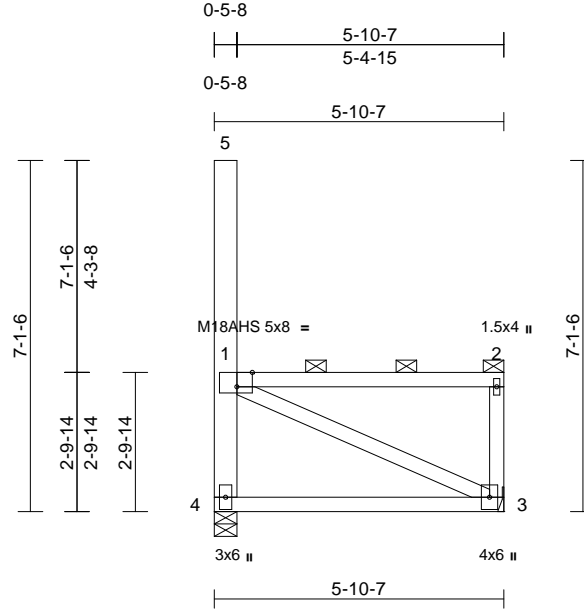

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-3-12,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.22	Vert(CT)	-0.05	3-4	>999	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.65	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-3-6 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
Max Horiz 4=-315 (LC 9)
Max Uplift 3=-264 (LC 10), 4=-264 (LC 9)
Max Grav 3=485 (LC 18), 4=516 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-49/53, 2-3=-253/216, 1-4=-461/708, 1-5=0/0
BOT CHORD 3-4=-788/1022
WEBS 1-3=-1084/831

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 264 lb uplift at joint 3 and 264 lb uplift at joint 4.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M34	Flat	2	1	Job Reference (optional)
					I73884380

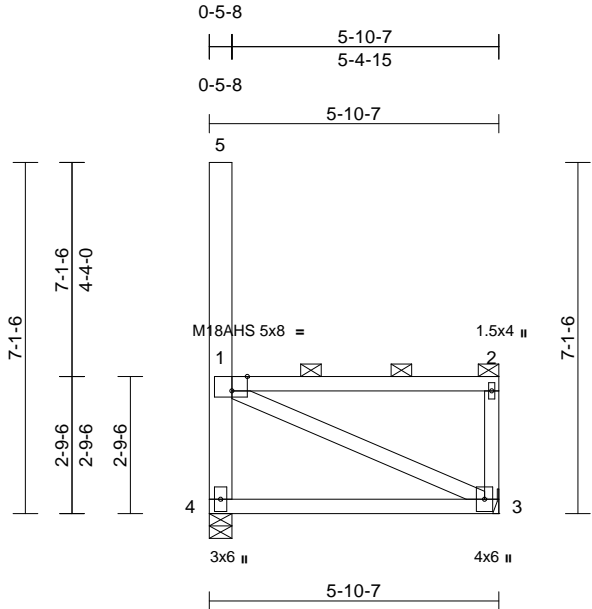

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-3-12,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.22	Vert(CT)	-0.05	3-4	>999	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.66	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E

BOT CHORD 2x4 SP 1650F 1.6E

WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.

BOT CHORD Rigid ceiling directly applied or 8-2-9 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8

Max Horiz 4=-315 (LC 9)

Max Uplift 3=-264 (LC 10), 4=-264 (LC 9)

Max Grav 3=485 (LC 18), 4=516 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-48/52, 2-3=-253/216, 1-4=-461/708, 1-5=0/0

BOT CHORD 3-4=-800/1039

WEBS 1-3=-1100/842

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 264 lb uplift at joint 3 and 264 lb uplift at joint 4.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (lb/ft)
 - Vert: 3-4=-20
 - Trapezoidal Loads (lb/ft)
 - Vert: 1=-150-to-2=-105



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M35	Flat	2	1	Job Reference (optional)
					I73884381

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:48
ID:uOghknF6Vlc_30Tf9pTUSVzGciZ-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?f

Page: 1

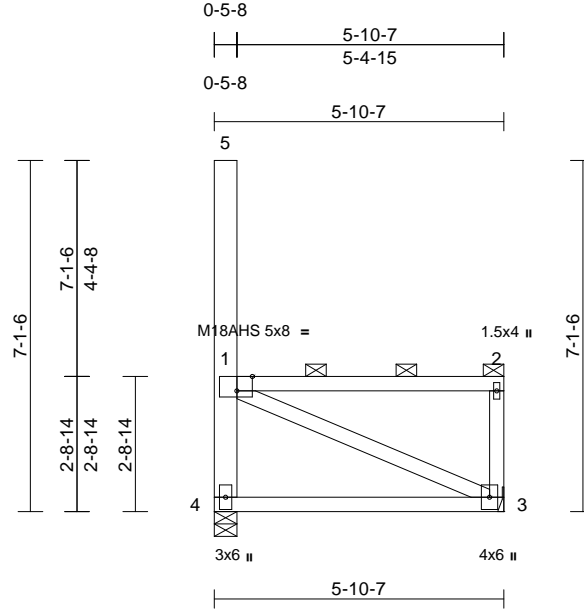

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-3-12,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.23	Vert(CT)	-0.05	3-4	>999	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.66	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-1-14 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
Max Horiz 4=-316 (LC 9)
Max Uplift 3=-264 (LC 10), 4=-264 (LC 9)
Max Grav 3=485 (LC 18), 4=516 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-47/51, 2-3=-253/216, 1-4=-461/709, 1-5=0/0
BOT CHORD 3-4=-813/1057
WEBS 1-3=-1117/854

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 264 lb uplift at joint 3 and 264 lb uplift at joint 4.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Lumber Specialties, Dyersville, IA - 52040, Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:48 Page: 1
ID:0uybSEPGRIF870z9Q2CXTEzGciM-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f



MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M37	Flat Supported Gable	2	1	Job Reference (optional)
					I73884383

Lumber Specialties, Dyersville, IA - 52040,
Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:48
ID:Qk99f3fpjumJW4U?bFZDHSzGci2-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f
Page: 1

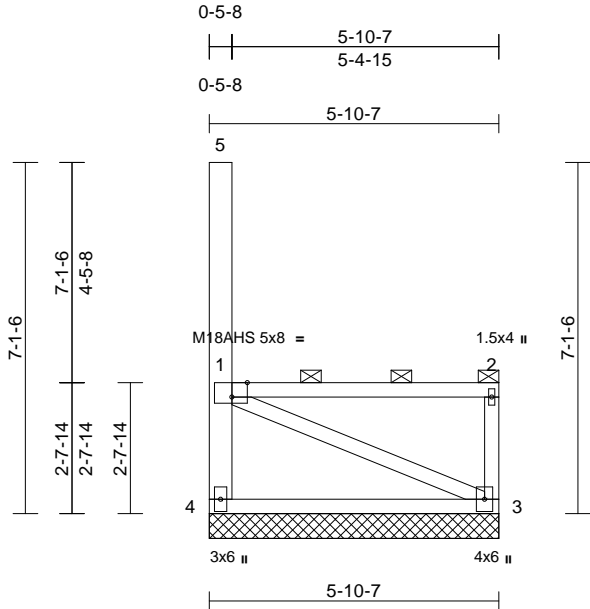

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-3-12,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.23	Vert(TL)	n/a	-	999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.68	Horiz(TL)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

- LUMBER**
TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E
- BRACING**
TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-7-12 oc bracing.
- REACTIONS** (size) 3=5-10-7, 4=5-10-7
Max Horiz 4=-317 (LC 9)
Max Uplift 3=-265 (LC 10), 4=-265 (LC 9)
Max Grav 3=485 (LC 18), 4=550 (LC 19)
- FORCES** (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-46/61, 2-3=-253/218, 1-4=-495/715, 1-5=0/0
BOT CHORD 3-4=-925/1117
WEBS 1-3=-1165/972
- NOTES**
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=2ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
5) Provide adequate drainage to prevent water ponding.
6) All plates are MT20 plates unless otherwise indicated.
7) Plates checked for a plus or minus 5 degree rotation about its center.
8) Gable requires continuous bottom chord bearing.
9) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
10) Gable studs spaced at 8-0-0 oc.
11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 265 lb uplift at joint 4 and 265 lb uplift at joint 3.
12) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
13) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard
1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Concentrated Loads (lb)
Vert: 1=-44
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M38	Flat	1	1	Job Reference (optional)
					I73884384

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:49
ID:YER4OWpZfuPTa4_UrUIGJCzGchr-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

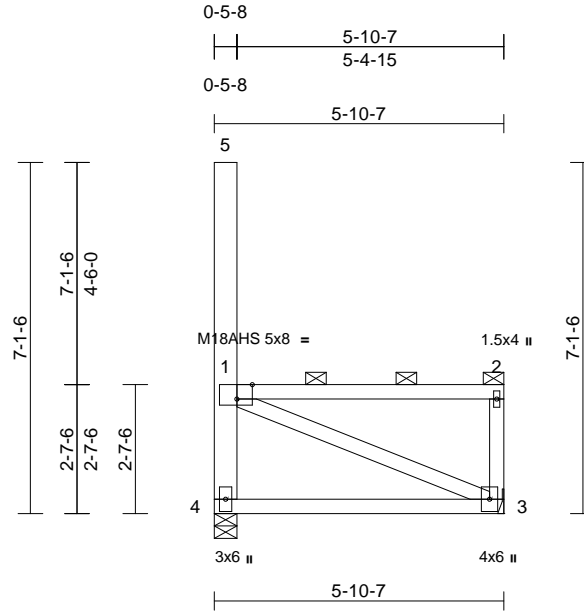

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-3-12,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.23	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.68	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-11-9 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
Max Horiz 4=-318 (LC 9)
Max Uplift 3=-265 (LC 10), 4=-265 (LC 9)
Max Grav 3=486 (LC 18), 4=517 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-45/49, 2-3=-252/216, 1-4=-462/711, 1-5=0/0
BOT CHORD 3-4=-853/1114
WEBS 1-3=-1171/892

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 265 lb uplift at joint 4 and 265 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M39	Flat	1	1	Job Reference (optional)
					I73884385

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:49

Page: 1

ID:gkk_6yz7bt2de4U_6i1KLxzGche-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?f

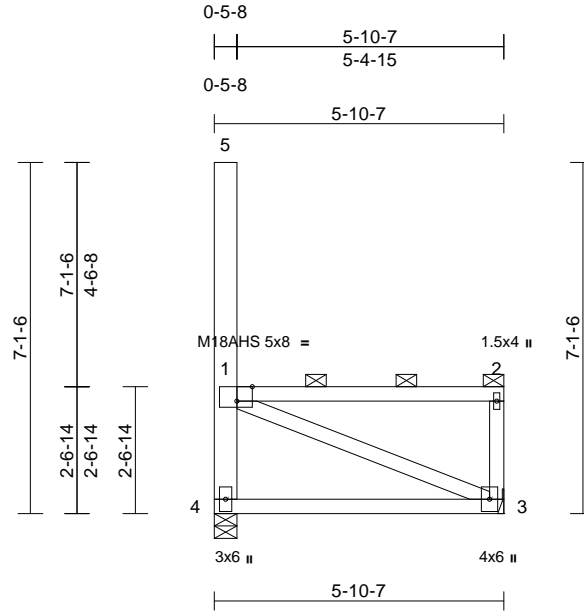

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-3-12,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.69	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
 BOT CHORD 2x4 SP 1650F 1.6E
 WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 7-10-12 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
 Max Horiz 4=-318 (LC 9)
 Max Uplift 3=-265 (LC 10), 4=-265 (LC 9)
 Max Grav 3=486 (LC 18), 4=517 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-44/48, 2-3=-252/216, 1-4=-462/712, 1-5=0/0
 BOT CHORD 3-4=-867/1134
 WEBS 1-3=-1191/906

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 265 lb uplift at joint 4 and 265 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 3-4=-20
 Trapezoidal Loads (lb/ft)
 Vert: 1=-150-to-2=-105



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M40	Flat	1	1	Job Reference (optional)
					I73884386

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:49
ID:J2SWd36fnZYw4wOlpeF8qTzGchS-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

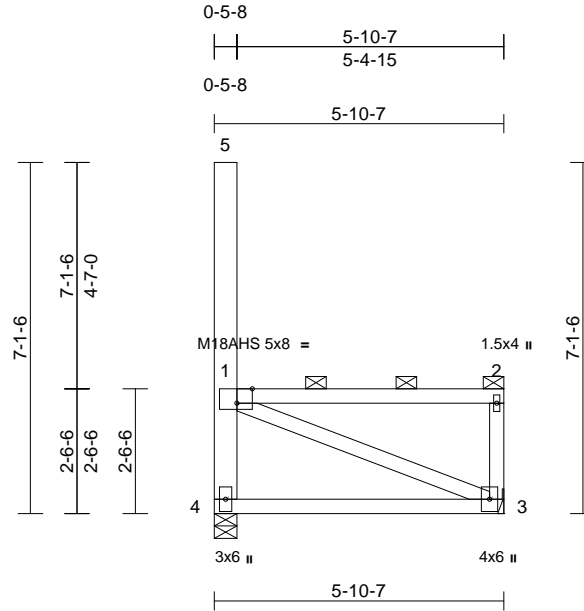

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-3-12, Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.70	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
BOT CHORD 2x4 SP 1650F 1.6E
WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD Rigid ceiling directly applied or 7-9-15 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
Max Horiz 4=319 (LC 10)
Max Uplift 3=-265 (LC 10), 4=-265 (LC 9)
Max Grav 3=486 (LC 18), 4=517 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-43/47, 2-3=-252/216, 1-4=-462/712, 1-5=0/0
BOT CHORD 3-4=-882/1155
WEBS 1-3=-1211/920

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 265 lb uplift at joint 4 and 265 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M41	Flat	1	1	Job Reference (optional)
					I73884387

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:49

Page: 1

Id:gHnrFaNSbKkoJ4X6relj6zGch6-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

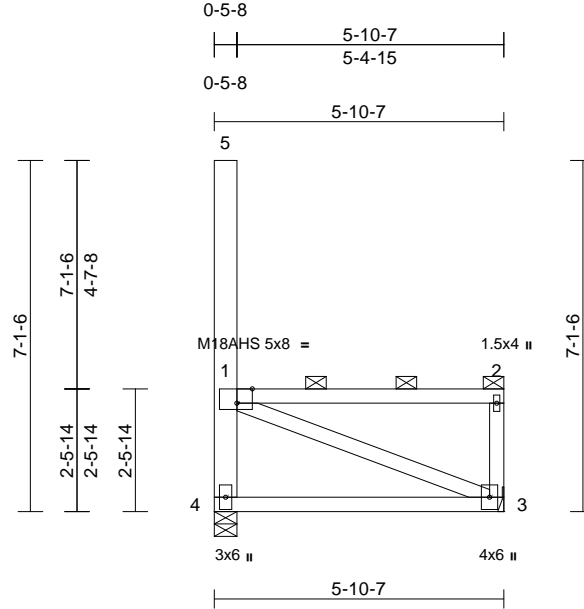

Scale = 1:46.7

Plate Offsets (X, Y): [1:0-3-12,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.71	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

LUMBER

TOP CHORD 2x4 SP 1650F 1.6E
 BOT CHORD 2x4 SP 1650F 1.6E
 WEBS 2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins: 1-2, 1-5, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 7-9-2 oc bracing.

REACTIONS (size) 3= Mechanical, 4=0-5-8
 Max Horiz 4=-320 (LC 11)
 Max Uplift 3=-266 (LC 10), 4=-266 (LC 9)
 Max Grav 3=488 (LC 18), 4=519 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-42/46, 2-3=-254/216, 1-4=-464/713, 1-5=0/0
 BOT CHORD 3-4=-897/1177
 WEBS 1-3=-1232/935

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
 Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
 B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
 MWFRS (directional) and C-C Corner (3) zone;
 cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 266 lb uplift at joint 4 and 266 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 3-4=-20
 Trapezoidal Loads (lb/ft)
 Vert: 1=-151-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
 Chesterfield, MO 63017
 314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M42	Flat	1	1	173884388
					Job Reference (optional)

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:49

Page: 1

ID: on3l_1XcXKzyna1M4NLrzGcgv-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

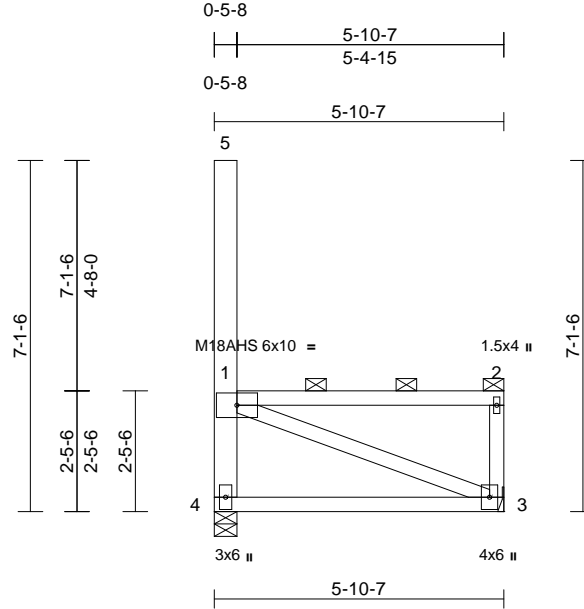

Scale = 1:46.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.72	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 7-8-6 oc bracing.

REACTIONS	(size) 3= Mechanical, 4=0-5-8
	Max Horiz 4=320 (LC 10)
	Max Uplift 3=-266 (LC 10), 4=-266 (LC 9)
	Max Grav 3=486 (LC 18), 4=517 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-42/45, 2-3=-252/216, 1-4=-462/714, 1-5=0/0
BOT CHORD	3-4=-913/1200
WEBS	1-3=-1254/950

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 266 lb uplift at joint 4 and 266 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M43	Flat	1	1	Job Reference (optional)
					I73884389

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:50
ID:Ks1oKVkemE_himo5IRf5ODzGcgf-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

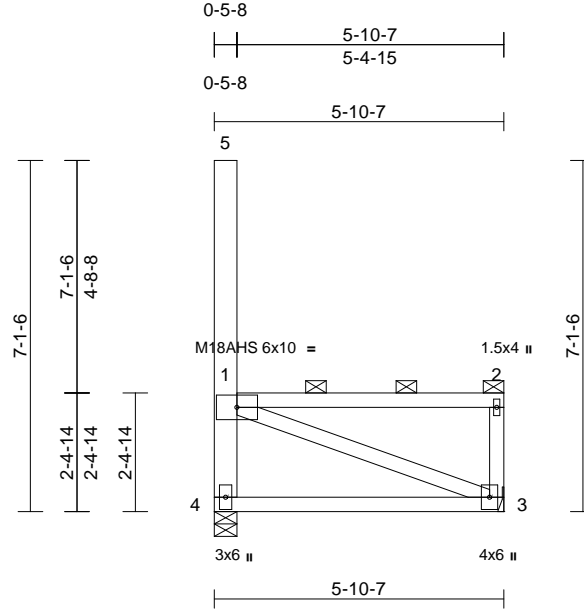

Scale = 1:46.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.73	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 44 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 7-7-9 oc bracing.

REACTIONS	(size) 3= Mechanical, 4=0-5-8
	Max Horiz 4=321 (LC 12)
	Max Uplift 3=-266 (LC 10), 4=-266 (LC 9)
	Max Grav 3=487 (LC 18), 4=517 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-41/44, 2-3=-252/217, 1-4=-463/714, 1-5=0/0
BOT CHORD	3-4=-930/1223
WEBS	1-3=-1277/966

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 266 lb uplift at joint 4 and 266 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M44	Flat	1	1	Job Reference (optional)
					I73884390

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:50
ID:K7ZEvJxlmS7GENbMoWT4apzGcgO-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

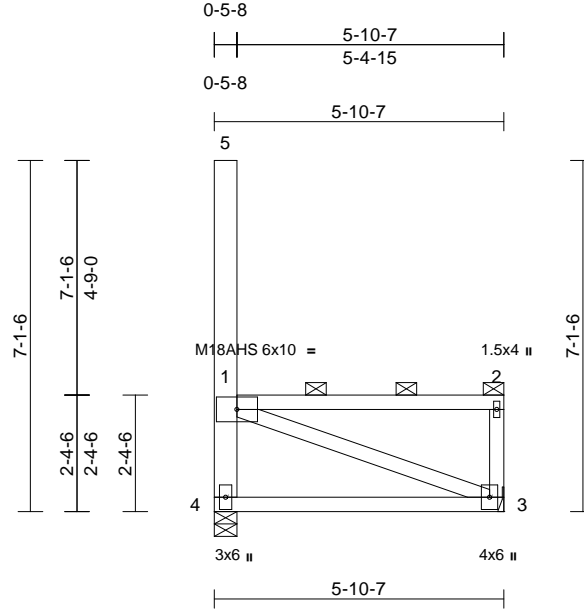

Scale = 1:46.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	n/a	-	999	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.25	Vert(CT)	-0.05	3-4	>999	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.74	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 43 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 7-6-11 oc bracing.

REACTIONS	(size) 3= Mechanical, 4=0-5-8
	Max Horiz 4=321 (LC 10)
	Max Uplift 3=-266 (LC 10), 4=-266 (LC 9)
	Max Grav 3=487 (LC 18), 4=518 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-40/43, 2-3=-252/217, 1-4=-463/715, 1-5=0/0
BOT CHORD	3-4=-947/1248
WEBS	1-3=-1300/983

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 266 lb uplift at joint 3 and 266 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M45	Flat	1	1	173884391
					Job Reference (optional)

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:50
ID:zRHmQQ4qx8dZgDWgV1hu3LzGcgC-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

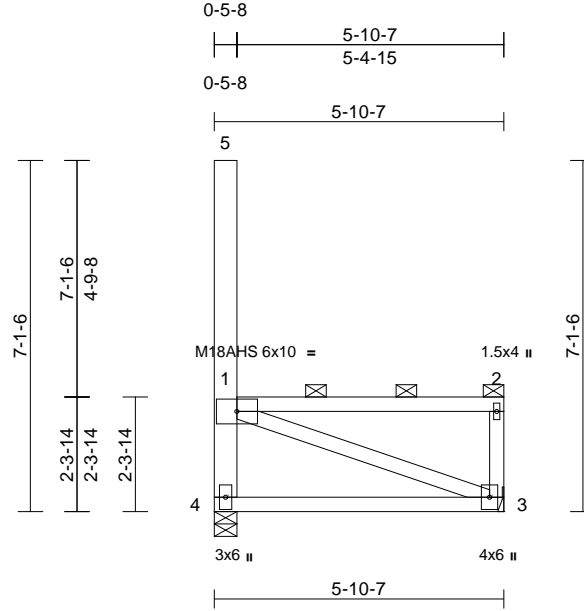

Scale = 1:46.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.25	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.75	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 43 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 7-5-13 oc bracing.

REACTIONS

(size)	3= Mechanical, 4=0-5-8
Max Horiz	4=-322 (LC 9)
Max Uplift	3=-266 (LC 10), 4=-266 (LC 9)
Max Grav	3=486 (LC 18), 4=515 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-39/42, 2-3=-252/217, 1-4=-460/715, 1-5=0/0
BOT CHORD	3-4=-966/1273
WEBS	1-3=-1325/1000

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 266 lb uplift at joint 4 and 266 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Concentrated Loads (lb)
Vert: 2=-1
Trapezoidal Loads (lb/ft)
Vert: 1=-148-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M46	Flat	1	1	173884392
					Job Reference (optional)

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:50
ID:VWFpnuHtA3elbgklROzejzGcfy-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

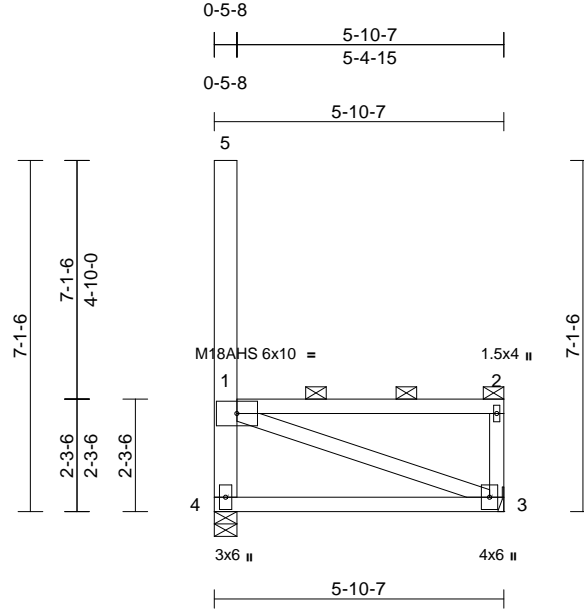

Scale = 1:46.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.25	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.76	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 43 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 7-5-0 oc bracing.

REACTIONS

(size)	3= Mechanical, 4=0-5-8
Max Horiz	4=323 (LC 10)
Max Uplift	3=-267 (LC 10), 4=-267 (LC 9)
Max Grav	3=489 (LC 18), 4=520 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-38/42, 2-3=-254/217, 1-4=-465/716, 1-5=0/0
BOT CHORD	3-4=-985/1300
WEBS	1-3=-1351/1019

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 267 lb uplift at joint 4 and 267 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Concentrated Loads (lb)
Vert: 2=-1
Trapezoidal Loads (lb/ft)
Vert: 1=-151-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M47	Flat	1	1	Job Reference (optional)
					I73884393

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:50
ID:RzZHYKeJ9_74P9q75iylrrzGcaJ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

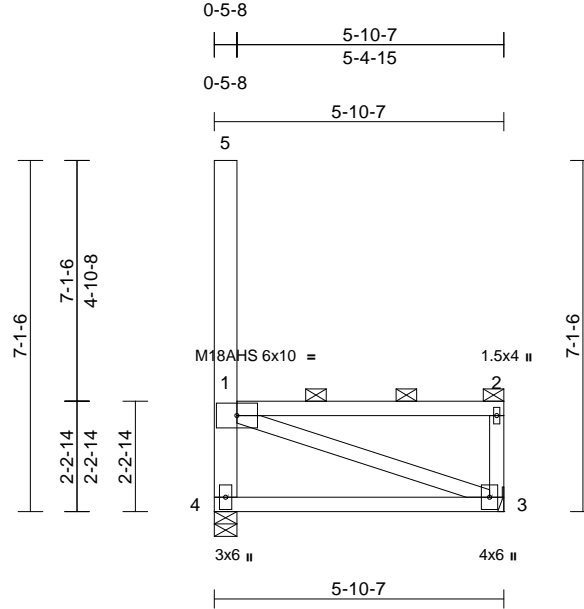

Scale = 1:46.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.26	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.77	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 43 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 7-4-1 oc bracing.

REACTIONS	(size) 3= Mechanical, 4=0-5-8
	Max Horiz 4=-323 (LC 9)
	Max Uplift 3=-267 (LC 10), 4=-267 (LC 9)
	Max Grav 3=488 (LC 18), 4=521 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-37/41, 2-3=-253/217, 1-4=-466/716, 1-5=0/0
BOT CHORD	3-4=-1004/1328
WEBS	1-3=-1378/1038

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 267 lb uplift at joint 4 and 267 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-152-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M48	Flat	1	1	Job Reference (optional)
					I73884394

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:51
ID:k74Dj9LhUoRm3GHUu_vC4zGcZP-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

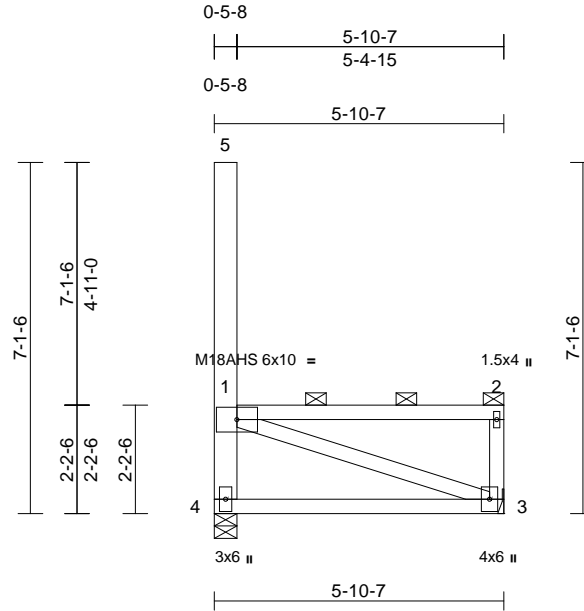

Scale = 1:46.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.73	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.26	Vert(CT)	-0.05	3-4	>999	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.78	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 43 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 7-3-3 oc bracing.

REACTIONS

(size)	3= Mechanical, 4=0-5-8
Max Horiz	4=-324 (LC 11)
Max Uplift	3=-267 (LC 10), 4=-267 (LC 9)
Max Grav	3=487 (LC 18), 4=518 (LC 19)

FORCES

	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-37/40, 2-3=-252/217, 1-4=-463/717, 1-5=0/0
BOT CHORD	3-4=-1025/1357
WEBS	1-3=-1406/1058

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 267 lb uplift at joint 4 and 267 lb uplift at joint 3.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-150-to-2=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M49	Flat	2	1	Job Reference (optional)
					I73884395

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:51

Page: 1

ID:GC2G4dYkijSaHXULQFHfrSzGcZ9-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?i

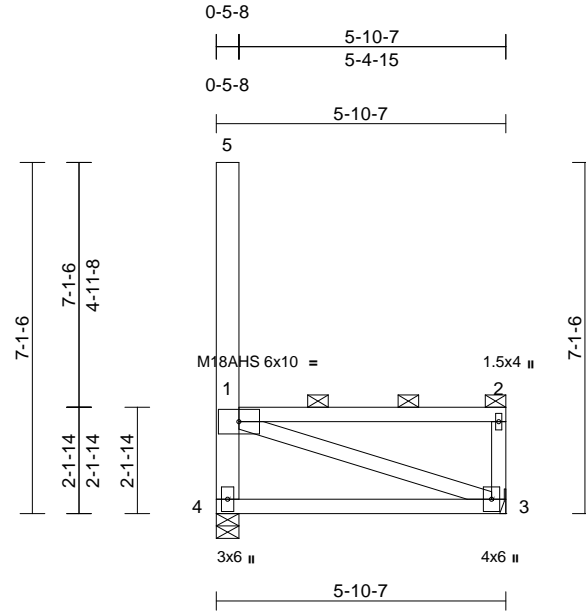

Scale = 1:46.7

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	n/a	-	999	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.26	Vert(CT)	-0.05	3-4	>999	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.79	Horz(CT)	0.01	3	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 43 lb	FT = 12%

LUMBER

TOP CHORD	2x4 SP 1650F 1.6E
BOT CHORD	2x4 SP 1650F 1.6E
WEBS	2x4 SP No.2 *Except* 5-4:2x6 SP 2400F 2.0E

BRACING

TOP CHORD	2-0-0 oc purlins: 1-2, 1-5, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 7-2-5 oc bracing.

REACTIONS

(size)	3= Mechanical, 4=0-5-8
Max Horiz	4=-324 (LC 9)
Max Uplift	3=-267 (LC 10), 4=-267 (LC 9)
Max Grav	3=487 (LC 18), 4=516 (LC 19)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-36/39, 2-3=-252/217, 1-4=-461/718, 1-5=0/0
BOT CHORD	3-4=-1046/1387
WEBS	1-3=-1435/1079

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.

- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 267 lb uplift at joint 3 and 267 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 3-4=-20
Concentrated Loads (lb)
Vert: 1=0
Trapezoidal Loads (lb/ft)
Vert: 1=-147-to-2=-106



June 3, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Lumber Specialties, Dyersville, IA - 52040, Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:51 Page: 1
ID:5ViyvhnKII?8k35ZHhYCumzGcSO-Rfc?PsB70Hg3NSaPqnL8w3ulTXbGKWCrDci?J4zJC?f

[illegible]

TOP CHORD	2x8 SP M 23
BOT CHORD	2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS	2x4 SP No.2 *Except* 8-7:2x6 SP 2400F 2.0E

TOP CHORD	2-0-0 oc purlins (5-2-13 max.): 1-3, 1-8, except end verticals. Except: 5-10-0 oc bracing: 1-8 9-0-0 oc bracing: 1-7
BOT CHORD	Rigid ceiling directly applied or 4-5-1 oc bracing.

WEBS	1 Row at midpt	2-4, 1-8
------	----------------	----------

REACTIONS (size) 4= Mechanical, 6=0-5-8, (req. 0-5-12)
 Max Horiz 6=-536 (LC 11)
 Max Uplift 4=-886 (LC 19), 6=-983 (LC 9)
 Max Grav 4=821 (LC 11), 6=3659 (LC 26)

TOP CHORD 1-2=-3596/2748, 2-3=-38/42, 3-4=-203/247,
1-7=-1018/733, 1-8=0/0

BOT CHORD 6-7=-906/706, 5-6=-3618/2000,
2-5=-2717/1847, 4-5=-2777/3656

WEBS 1-4=-3823/2930, 5-7=-1013/1383,
2-5=-2688/3037


1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed ; end vertical left and
right exposed; C-C for members and forces & MWFRS
for reactions shown; Lumber DOL=1.60 plate grip
DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15
Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL =
1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially
Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are MT20 plates unless otherwise indicated.
- 6) Plates checked for a plus or minus 5 degree rotation
about its center.
- 7) WARNING: Required bearing size at joint(s) 6 greater
than input bearing size.
- 8) Refer to girder(s) for truss to truss connections.
- 9) Provide mechanical connection (by others) of truss to
bearing plate capable of withstanding 886 lb uplift at joint
4 and 983 lb uplift at joint 6.
- 10) This truss is designed in accordance with the 2018
International Building Code section 2306.1 and
referenced standard ANSI/TPI 1.
- 11) Load case(s) 1 has/have been modified. Building
designer must review loads to verify that they are correct
for the intended use of this truss.
- 12) Graphical purlin representation does not depict the size
or the orientation of the purlin along the top and/or
bottom chord.

LOAD CASE(S) Standard

1) Dead & Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Virt: 1-9=-553, 2-9=-272, 6-7=-20, 4-5=-20
Concentrated Loads (lb)
Virt: 9=-84


Trapezoidal Loads (lb/ft)
Vert: 2=-151-to-3=-105



WARNING – verify design parameters and noted notes on this and included MiTek Reference Tag M-7473 Rev. 1/2/2023 before use. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-LLS.com

Lumber Specialties, Dyersville, IA - 52040, Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:51 Page: 1
ID: v61Cx3anKM5SMCxVvR2B6zGcQk-RfC?PsB70Ha3NSaPanL8w3uITXbGKWRcd0i7J4zJC?f



LUMBER
TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING
TOP CHORD 2-0-0 oc purlins (5-0-3 max.): 1-3, 7-9, 1-8, except end verticals. Except:
6-0-0 oc bracing: 1-8
8-2-0 oc bracing: 1-9
BOT CHORD Rigid ceiling directly applied or 4-6-1 oc bracing.
WEBS 1 Row at midpt 2-4, 1-9, 1-8


REACTIONS (size) 4= Mechanical, 6=0-5-8
Max Horiz 6=548 (LC 11)
Max Uplift 4=797 (LC 19), 6=984 (LC 9)
Max Grav 4=821 (LC 11), 6=3229 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=3704/2644, 2-3=35/41, 3-4=173/214, 7-9=0/0, 1-7=1065/763, 1-8=0/0
BOT CHORD 6-7=919/721, 5-6=3191/1988, 2-5=2349/1845, 4-5=2679/3754
WEBS 4-4=3952/2845, 5-7=1062/1459, 1-5=2564/3111

- 3) TCELL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are MT20 plates unless otherwise indicated.
- 6) Plates checked for a plus or minus 5 degree rotation about its center.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 797 lb uplift at joint 4 and 984 lb uplift at joint 6.
- 9) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- 10) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard


- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-476, 6-7=-20, 4-5=-20
Trapezoidal Loads (lb/ft)
Vert: 2=-151-to-3=-105



WARNING – Verify design parameters and READ NOTES on this and INCLUDED MITER KEY EXERCISE PAGE 1473169. 1/2/2023 BDI ONE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcscomponents.com)

MiTek[®]
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Lumber Specialties, Dyersville, IA - 52040, Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:52 Page: 1
ID:LYGB?Gi72V4_MzqVopoK4NzGcJS-RfC?PsB70Hg3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?#




LUMBER
TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING
TOP CHORD 2-0-0 oc purlins (4-11-8 max.): 1-3, 7-9, 1-8, except end verticals. Except:
5-10-0 oc bracing: 1-8
8-2-0 oc bracing: 1-9
BOT CHORD Rigid ceiling directly applied or 4-5-6 oc bracing.
WEBS 1 Row at midpt 2-4, 1-9, 1-8

REACTIONS (size) 4= Mechanical, 6=0-5-8
Max Horiz 6=549 (LC 11)
Max Uplift 4=803 (LC 19), 6=985 (LC 9)
Max Grav 4=822 (LC 11), 6=3248 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=3781/2709, 2-3=38/41, 3-4=170/216, 7-9=0/0, 1-7=1071/766, 1-8=0/0
BOT CHORD 6-7=919/721, 5-6=3210/1989, 2-5=2364/1851, 4-5=2742/3828
WEBS 2-4=4018/2904, 5-7=1067/1467, 1-5=2622/3175

- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
 - 4) Provide adequate drainage to prevent water ponding.
 - 5) All plates are MT20 plates unless otherwise indicated.
 - 6) Plates checked for a plus or minus 5 degree rotation about its center.
 - 7) Refer to girder(S) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 803 lb uplift at joint 4 and 985 lb uplift at joint 6.
 - 9) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - 10) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard
- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 6-7=-20, 4-5=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-102-to-2=-477, 2=-151-to-3=-104



Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M63	Roof Special	1	1	Job Reference (optional)


I73884399

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:52

Page: 1

ID:PiCijD5CVK6RBuGfgXNrN7zGcly-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

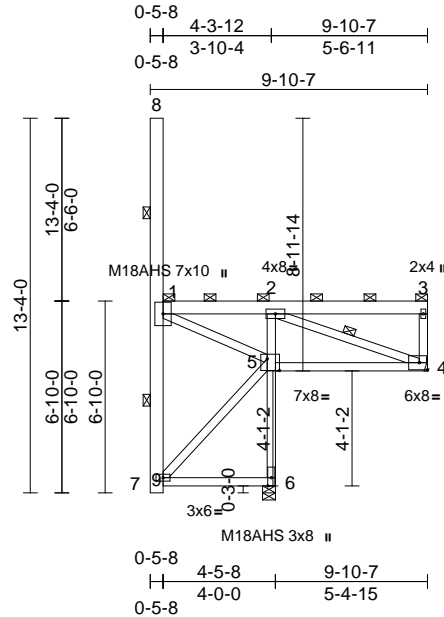

Scale = 1:82

Plate Offsets (X, Y): [5:0-5-4,0-5-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.87	Vert(LL)	-0.03	2	>999	240	M18AHS 186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.53	Vert(CT)	-0.03	4-5	>999	180	MT20 244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.87	Horz(CT)	0.23	4	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS							
BCDL	10.0										
Weight: 101 lb FT = 12%											

LUMBER

TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins (4-10-13 max.): 1-3, 7-9, 1-8, except end verticals. Except:
5-8-0 oc bracing: 1-8
8-1-0 oc bracing: 1-9
BOT CHORD Rigid ceiling directly applied or 4-4-12 oc bracing.
WEBS 1 Row at midpt 2-4, 1-9, 1-8

REACTIONS

(size) 4= Mechanical, 6=0-5-8
Max Horiz 6=-549 (LC 11)
Max Uplift 4=-803 (LC 19), 6=-986 (LC 9)
Max Grav 4=823 (LC 11), 6=3268 (LC 26)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-3862/2769, 2-3=-42/42, 3-4=-170/218, 7-9=0/0, 1-7=-1077/770, 1-8=0/0
BOT CHORD 6-7=-920/720, 5-6=-3230/1991, 2-5=-2384/1856, 4-5=-2801/3904
WEBS 2-4=-4086/2957, 5-7=-1072/1476, 1-5=-2674/3243

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 803 lb uplift at joint 4 and 986 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S)

- Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-483, 6-7=-20, 4-5=-20
Trapezoidal Loads (lb/ft)
Vert: 2=-152-to-3=-105



June 3, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M64	Roof Special	1	1	Job Reference (optional)
					I73884400

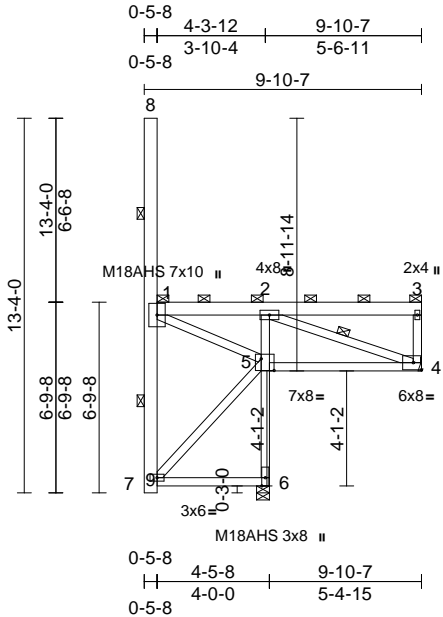

Scale = 1:82
Plate Offsets (X, Y): [5:0-5-8,0-5-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.88	Vert(LL)	-0.03	2	>999	240	M18AHS 186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.54	Vert(CT)	-0.03	4-5	>999	180	MT20 244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.87	Horz(CT)	0.24	4	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS							
BCDL	10.0										
Weight: 101 lb FT = 12%											

LUMBER
TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING
TOP CHORD 2-0-0 oc purlins (4-10-2 max.): 1-3, 7-9, 1-8, except end verticals. Except:
5-6-0 oc bracing: 1-8
8-0-0 oc bracing: 1-9
BOT CHORD Rigid ceiling directly applied or 4-4-8 oc bracing.
WEBS 1 Row at midpt 2-4, 1-9, 1-8

REACTIONS (size) 4= Mechanical, 6=0-5-8
Max Horiz 6=550 (LC 11)
Max Uplift 4=793 (LC 19), 6=986 (LC 9)
Max Grav 4=824 (LC 11), 6=3210 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-3945/2797, 2-3=-47/42, 3-4=-172/221, 7-9=0/0, 1-7=-1083/773, 1-8=0/0
BOT CHORD 6-7=-921/720, 5-6=-3172/1992, 2-5=-2347/1862, 4-5=-2826/3983
WEBS 2-4=-4157/2975, 5-7=-1077/1485, 1-5=-2691/3313

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - Plates checked for a plus or minus 5 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 793 lb uplift at joint 4 and 986 lb uplift at joint 6.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 6-7=-20, 4-5=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-471-to-2=-476, 2=-151-to-3=-105




June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Lumber Specialties, Dyersville, IA - 52040, Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:52 Page: 1
ID:LBOTp5FUw7pOLqvvKExat3zGc5r-RfC?PsB70Hq3NSaPanL8w3uITXbGKWrCDoi7J4zJC?f



LUMBER
TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x6 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING
TOP CHORD 2-0-0 oc purlins (4-9-6 max.): 1-3, 7-9, 1-8, except end verticals. Except:
5-3-0 oc bracing: 1-8
8-0-0 oc bracing: 1-9
BOT CHORD Rigid ceiling directly applied or 4-3-13 oc bracing.
WEBS 1 Row at midpt 2-4, 1-9, 1-8

REACTIONS (size) 4= Mechanical, 6=0-5-8
Tension
Max Horiz 6=550 (LC 11)
Max Uplift 4=799 (LC 19), 6=987 (LC 9)
Max Grav 4=824 (LC 11), 6=3229 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=4032/2868, 2-3=52/43, 3-4=-171/223, 7-9=0/0, 1-7=-1089/776, 1-8=0/0
BOT CHORD 6-7=-921/719, 5-6=-3191/1993, 2-5=-2363/1869, 4-5=-2896/4064
WEBS 2-4=-4229/3039, 5-7=-1082/1494, 1-5=-2755/3385

- 3) TCELL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are MT20 plates unless otherwise indicated.
- 6) Plates checked for a plus or minus 5 degree rotation about its center.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 799 lb uplift at joint 4 and 987 lb uplift at joint 6.
- 9) This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- 10) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-476, 6-7=-20, 4-5=-20
Trapezoidal Loads (lb/ft)
Vert: 2=-151-to-3=-105

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDFL=6.0psf; BCDFL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60



June 3, 2025




WARNING – verify design parameters and noted notes on this and included MiTek Reference Tag M-7473 Rev. 1/2/2023 before use. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek[®]
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M66	Roof Special	1	1	Job Reference (optional)
					I73884402

Lumber Specialties, Dyersville, IA - 52040,
Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:53
Page: 1

ID:e?NzP6kBGizam7YnDLAC2izGc5C-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

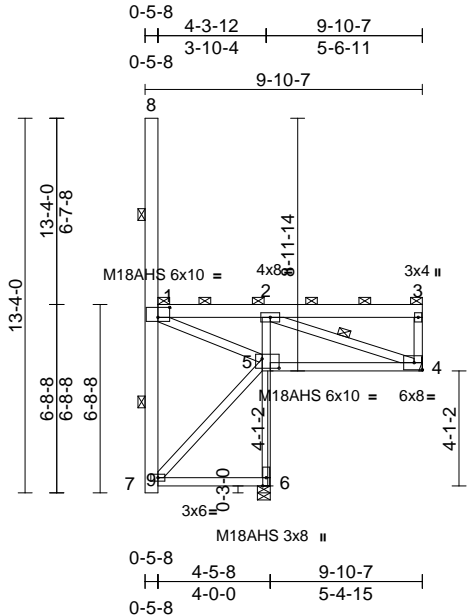

Scale = 1:82
Plate Offsets (X, Y): [1:0-5-0,0-4-4], [5:0-7-4,0-4-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.91	Vert(LL)	-0.03	2	>999	240	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.57	Vert(CT)	-0.03	4-5	>999	180	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.89	Horz(CT)	0.26	4	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 100 lb	FT = 12%

LUMBER

TOP CHORD 2x6 SP 2400F 2.0E

BOT CHORD 2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2

WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins (4-8-10 max.): 1-3, 7-9, 1-8, except end verticals. Except: 5-1-0 oc bracing: 1-8 7-11-0 oc bracing: 1-9

BOT CHORD Rigid ceiling directly applied or 4-3-3 oc bracing.

WEBS 1 Row at midpt 2-4, 1-9, 1-8

REACTIONS (size) 4= Mechanical, 6=0-5-8 Max Horiz 6=-551 (LC 11) Max Uplift 4=-799 (LC 19), 6=-988 (LC 9) Max Grav 4=825 (LC 11), 6=3229 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-4122/2930, 2-3=-58/44, 3-4=-171/226, 7-9=0/0, 1-7=-1095/780, 1-8=0/0

BOT CHORD 6-7=-922/719, 5-6=-3191/1994, 2-5=-2367/1876, 4-5=-2955/4149

WEBS 2-4=-4305/3092, 5-7=-1087/1504, 1-5=-2807/3461

NOTES

1) Unbalanced roof live loads have been considered for this design.

2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - Plates checked for a plus or minus 5 degree rotation about its center.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 799 lb uplift at joint 4 and 988 lb uplift at joint 6.
 - This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
 - Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15 Uniform Loads (lb/ft) Vert: 1-2=-476, 6-7=-20, 4-5=-20 Trapezoidal Loads (lb/ft) Vert: 2=-151-to-3=-105



June 3,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M67	Roof Special	1	1	Job Reference (optional)

I73884403

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:53
ID:LXDJ?wc_MXIOd3rEKUuithzGc_v-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

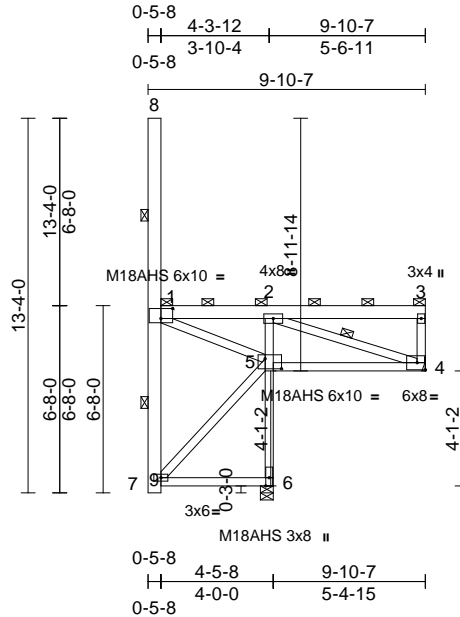

Scale = 1:82

Plate Offsets (X, Y): [1:0-5-0,0-4-4], [5:0-7-0,0-4-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.03	2	>999	240	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.58	Vert(CT)	-0.03	4-5	>999	180	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.89	Horz(CT)	0.27	4	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 100 lb	FT = 12%

LUMBER

TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins (4-7-15 max.): 1-3, 7-9, 1-8, except end verticals. Except:
4-10-0 oc bracing: 1-8
7-10-0 oc bracing: 1-9
BOT CHORD Rigid ceiling directly applied or 4-2-15 oc bracing.
WEBS 1 Row at midpt 2-4, 1-9, 1-8

REACTIONS

(size) 4= Mechanical, 6=0-5-8
Max Horiz 6=-552 (LC 11)
Max Uplift 4=-788 (LC 19), 6=-989 (LC 9)
Max Grav 4=826 (LC 11), 6=3171 (LC 26)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-4215/2962, 2-3=-64/45, 3-4=-173/229, 7-9=0/0, 1-7=-1101/783, 1-8=0/0
BOT CHORD 6-7=-922/718, 5-6=-3133/1995, 2-5=-2330/1883, 4-5=-2984/4236
WEBS 2-4=-4383/3113, 5-7=-1093/1513, 1-5=-2827/3540

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 788 lb uplift at joint 4 and 989 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S)

- Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 6-7=-20, 4-5=-20
Trapezoidal Loads (lb/ft)
Vert: 1=-464-to-2=-469, 2=-150-to-3=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M68	Roof Special	1	1	Job Reference (optional)


I73884404

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:53

Page: 1

ID:ezFgkZX1iaCl6b4fDkklQVzGbzK-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

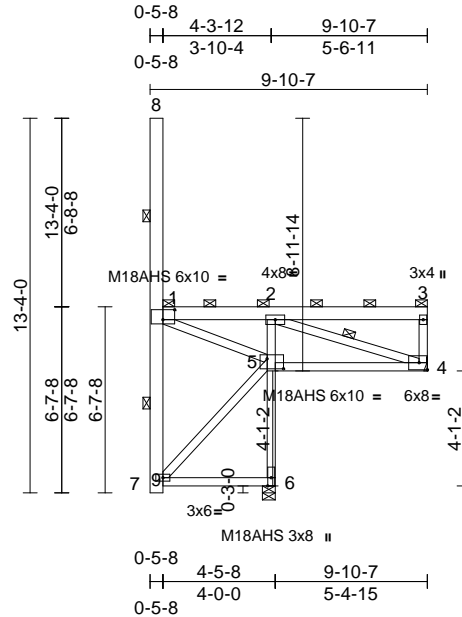

Scale = 1:82

Plate Offsets (X, Y): [1:0-5-0,0-4-4], [5:0-7-0,0-4-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.03	2	>999	240	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.60	Vert(CT)	-0.03	4-5	>999	180	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.92	Horz(CT)	0.28	4	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 100 lb	FT = 12%

LUMBER

TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins (4-7-3 max.): 1-3, 7-9, 1-8, except end verticals. Except:
4-7-0 oc bracing: 1-8
7-10-0 oc bracing: 1-9
BOT CHORD Rigid ceiling directly applied or 4-1-14 oc bracing.
WEBS 1 Row at midpt 2-4, 1-9, 1-8

REACTIONS

(size) 4= Mechanical, 6=0-5-8
Max Horiz 6=-552 (LC 11)
Max Uplift 4=-806 (LC 19), 6=-989 (LC 9)
Max Grav 4=826 (LC 11), 6=3268 (LC 26)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-4312/3078, 2-3=-71/46, 3-4=-178/232,
7-9=0/0, 1-7=-1108/787, 1-8=0/0
BOT CHORD 6-7=-923/718, 5-6=-3230/1996,
2-5=-2404/1890, 4-5=-3099/4327
WEBS 2-4=-4463/3223, 5-7=-1098/1523,
1-5=-2939/3622

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft;
B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed;
MWFRS (directional) and C-C Corner (3) zone;
cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 806 lb uplift at joint 4 and 989 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S)

- Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-483, 6-7=-20, 4-5=-20
Trapezoidal Loads (lb/ft)
Vert: 2=-152-to-3=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M69	Roof Special	1	1	Job Reference (optional)

I73884405

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:54
ID:bRU8QVNxD50qWLR6KR?iFzGbye-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?i

Page: 1

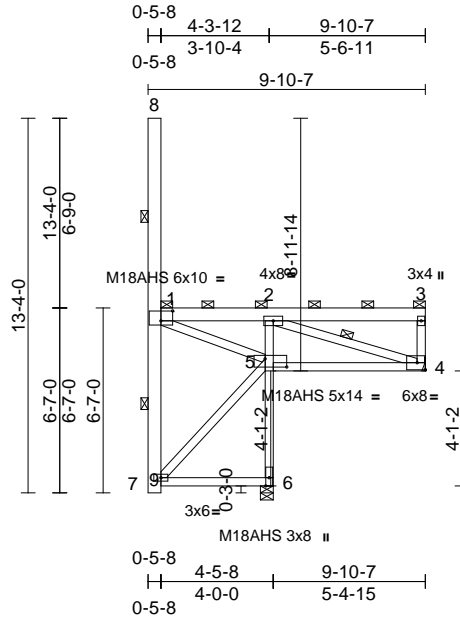

Scale = 1:82

Plate Offsets (X, Y): [1:0-5-0,0-4-4], [5:0-9-4,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.94	Vert(LL)	-0.03	2	>999	240	M18AHS	186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.61	Vert(CT)	-0.03	4-5	>999	180	MT20	244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.92	Horz(CT)	0.29	4	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
Weight: 100 lb											FT = 12%	

LUMBER

TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING

TOP CHORD 2-0-0 oc purlins (4-6-7 max.): 1-3, 7-9, 1-8, except end verticals. Except:
4-5-0 oc bracing: 1-8
7-9-0 oc bracing: 1-9
BOT CHORD Rigid ceiling directly applied or 4-1-8 oc bracing.
WEBS 1 Row at midpt 2-4, 1-9, 1-8

REACTIONS

(size) 4= Mechanical, 6=0-5-8
Max Horiz 6=553 (LC 11)
Max Uplift 4=801 (LC 19), 6=990 (LC 9)
Max Grav 4=827 (LC 11), 6=3229 (LC 26)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=4412/3127, 2-3=78/48, 3-4=184/236, 7-9=0/0, 1-7=1114/790, 1-8=0/0
BOT CHORD 6-7=923/717, 5-6=3190/1997, 2-5=2380/1899, 4-5=3146/4422
WEBS 2-4=4546/3261, 5-7=1104/1532, 1-5=2977/3708

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust)
Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 801 lb uplift at joint 4 and 990 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S)

- Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 6-7=20, 4-5=20
Trapezoidal Loads (lb/ft)
Vert: 1=476-to-2=476, 2=151-to-3=105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M70	Roof Special	1	1	Job Reference (optional)
					I73884406

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:54

Page: 1

ID: ?ZFgr_s0ifpEdlHp3gm1TtzGbQR-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

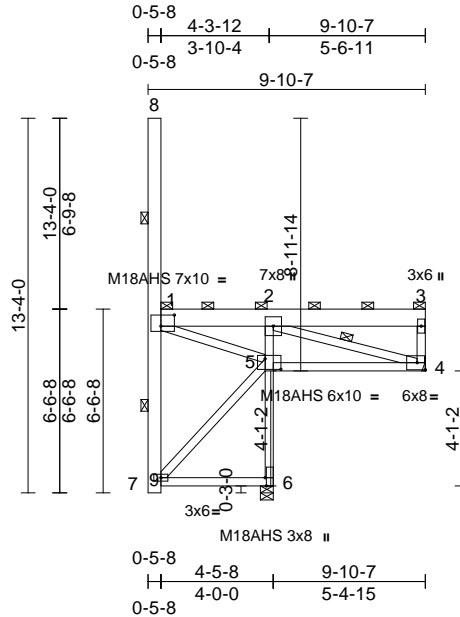

Scale = 1:82
Plate Offsets (X, Y): [1:0-5-12,0-4-12], [5:0-6-12,0-4-8], [6:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.98	Vert(LL)	-0.03	2	>999	240	M18AHS 186/179
Snow (Pf/Pg)	19.0/20.0	Lumber DOL	1.15	BC	0.61	Vert(CT)	-0.04	2	>999	180	MT20 244/190
TCDL	15.0	Rep Stress Incr	NO	WB	0.98	Horz(CT)	0.29	4	n/a	n/a	
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS							
BCDL	10.0										
Weight: 106 lb FT = 12%											

LUMBER
TOP CHORD 2x4 SP M 23
BOT CHORD 2x4 SP 1650F 1.6E *Except* 6-2:2x4 SP No.2
WEBS 2x4 SP No.2 *Except* 8-9:2x6 SP 2400F 2.0E

BRACING
TOP CHORD 2-0-0 oc purlins (4-7-14 max.): 1-3, 7-9, 1-8, except end verticals. Except: 3-6-0 oc bracing: 1-8 8-6-0 oc bracing: 1-9
BOT CHORD Rigid ceiling directly applied or 3-11-5 oc bracing.
WEBS 1 Row at midpt 2-4, 1-9, 1-8

REACTIONS (size) 4= Mechanical, 6=0-5-8, (req. 0-6-3)
Max Horiz 6=-555 (LC 11)
Max Uplift 4=-923 (LC 19), 6=-992 (LC 9)
Max Grav 4=829 (LC 11), 6=3963 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-4385/3398, 2-3=-107/71, 3-4=-279/295, 7-9=0/0, 1-7=-1069/760, 1-8=0/0
BOT CHORD 6-7=-925/716, 5-6=-3922/2008, 2-5=-3054/1945, 4-5=-3405/4393
WEBS 2-4=-4448/3473, 5-7=-1057/1461, 1-5=-3249/3690

NOTES
1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=19.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00, Lu=50-0-0
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- WARNING: Required bearing size at joint(s) 6 greater than input bearing size.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 923 lb uplift at joint 4 and 992 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 6-7=-20, 4-5=-20
Concentrated Loads (lb)
Vert: 2=-91

Trapezoidal Loads (lb/ft)
Vert: 1=-552-to-2=-637, 2=-151-to-3=-105



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com


Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital	I73884407
2503400-A	M202G	Roof Special Girder	1	2	Job Reference (optional)	

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:55

Page: 1

ID:YtoYrGaUxWJkvBccFue0zF?Xq-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDoi7J4zJC?F

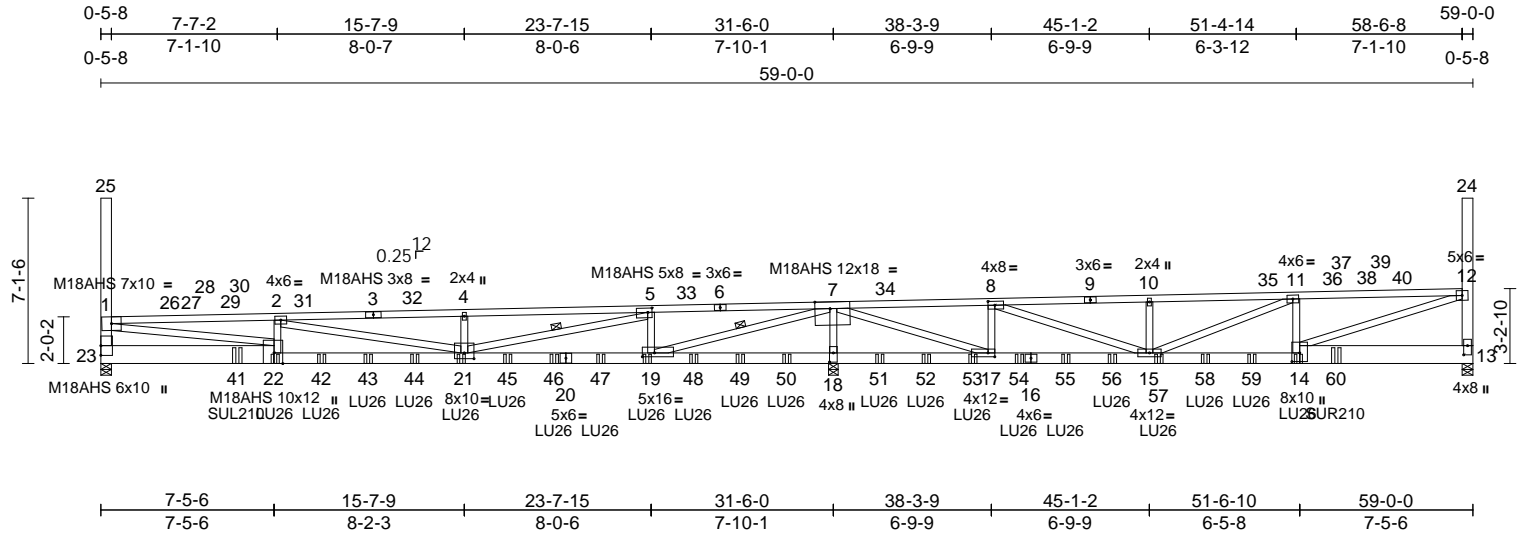

Scale = 1:99.1

[5:0-2-4,0-2-4], [7:0-7-12,Edge], [8:0-3-8,0-2-0], [13:0-4-12,0-2-0], [14:0-4-8,0-4-0], [17:0-3-8,0-2-0], [18:0-4-12,0-2-0], [19:0-6-4,0-2-0], [21:0-5-0,0-3-0],

Plate Offsets (X, Y): [22:0-5-8,Edge]

loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.81	Vert(LL)	0.80	21-22	>472	240	MT20	244/190
Snow (Pf/Pg)	14.0/20.0	Lumber DOL	1.15	BC	0.66	Vert(CT)	-1.01	21-22	>370	180	M18AHS	186/179
TCDL	15.0	Rep Stress Incr	NO	WB	0.95	Horz(CT)	-0.04	13	n/a	n/a		
BCLL	0.0	Code	IBC2018/TPI2014	Matrix-MS								
BCDL	10.0											
											Weight: 767 lb	FT = 12%

LUMBER	
TOP CHORD	2x4 SP 1650F 1.6E *Except* 3-1,3-6:2x4 SP 2400F 2.0E
BOT CHORD	2x6 SP 2400F 2.0E *Except* 14-13,22-23:2x10 SP M 23
WEBS	2x4 SP No.2 *Except* 24-13,23-25:2x6 SP 2400F 2.0E, 12-14,5-21,21-2,1-22,7-17:2x4 SP 1650F 1.6E, 7-19:2x4 SP 2400F 2.0E

WEBS	
2-22=674/635, 5-19=3017/1782, 8-17=3020/1739, 7-18=9764/5357, 10-15=509/258, 8-15=4212/7478, 11-14=447/613, 11-15=998/781, 12-14=3824/6292, 7-19=9657/17450, 4-21=644/322, 5-21=6293/10883, 2-21=1176/970, 1-22=7387/11731, 7-17=7678/14020	

- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Plates checked for a plus or minus 5 degree rotation about its center.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1493 lb uplift at joint 13, 1937 lb uplift at joint 23 and 5577 lb uplift at joint 18.
- This truss is designed in accordance with the 2018 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Use Simpson Strong-Tie SUL210 (10-10d Girder, 10-10dx1 1/2 Truss) or equivalent at 5-10-7 from the left end to connect truss(es) to front face of bottom chord, skewed 45.0 deg.to the left, sloping 0.0 deg. down.

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 4-4-3 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 5-2-13 oc bracing.
WEBS	1 Row at midpt 7-19, 5-21
REACTIONS	(size) 13=0-5-8, 18=0-5-0, 23=0-5-8 Max Horiz 23=479 (LC 10) Max Uplift 13=1493 (LC 10), 18=5577 (LC 13), 23=1937 (LC 9) Max Grav 13=2888 (LC 20), 18=11609 (LC 18), 23=3750 (LC 19)
FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=-12840/7770, 2-4=-12187/6836, 4-5=-12187/6844, 5-7=-1653/762, 7-8=-1442/1897, 8-10=-5430/3285, 10-11=-5429/3292, 11-12=-6336/4019, 12-13=-2483/1495, 12-24=0/0, 1-23=-3166/1930, 1-25=0/0
BOT CHORD	21-23=-8327/12969, 19-21=-1296/1772, 18-19=-15120/8329, 17-18=-15120/8329, 15-17=-1828/1133, 13-15=-3635/6125

- NOTES**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; B=45ft; L=59ft; eave=7ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner (3) 0-2-12 to 5-2-12, Exterior (2) 5-2-12 to 53-9-4, Corner (3) 53-9-4 to 58-9-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=14.0 psf (Lum DOL = 1.15 Plate DOL = 1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.00



June 3,2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Job	Truss	Truss Type	Qty	Ply	Discovery Animal Hospital
2503400-A	M202G	Roof Special Girder	1	2	Job Reference (optional)
					I73884407

Lumber Specialties, Dyersville, IA - 52040,

Run: 8.83 S Apr 24 2025 Print: 8.830 S Apr 24 2025 MiTek Industries, Inc. Mon Jun 02 08:53:55

Page: 2

ID:YtoTyrGaUxcWJkvBccFue0zF?Xq-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDoi7J4zJC?f

- 13) Use Simpson Strong-Tie LU26 (6-10d Girder, 4-10dx1 1/2 Truss) or equivalent spaced at 4-0-0 oc max. starting at 7-6-0 from the left end to 51-6-0 to connect truss(es) to front face of bottom chord.
- 14) Use Simpson Strong-Tie SUR210 (10-10d Girder, 10-10dx1 1/2 Truss) or equivalent at 53-1-9 from the left end to connect truss(es) to front face of bottom chord, skewed 45.0 deg.to the right, sloping 0.0 deg. down.
- 15) Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 2-30=-79, 2-3=-70, 4-11=-70, 11-36=-79, 13-23=-20
Concentrated Loads (lb)
Vert: 14=-372 (F), 22=-369 (F), 19=-372 (F), 21=-369 (F), 27=-10, 38=-10, 41=-793 (F), 42=-369 (F), 43=-371 (F), 44=-372 (F), 45=-369 (F), 46=-369 (F), 47=-369 (F), 48=-369 (F), 49=-369 (F), 50=-369 (F), 51=-369 (F), 52=-369 (F), 53=-369 (F), 54=-369 (F), 55=-369 (F), 56=-369 (F), 57=-369 (F), 58=-369 (F), 59=-369 (F), 60=-789 (F)
Trapezoidal Loads (lb/ft)
Vert: 1=-111-to-26=-92, 26=-92-to-27=-88, 27=-70-to-28=-68, 28=-81-to-29=-74, 29=-73-to-30=-70, 3=-70-to-32=-70, 32=-71-to-4=-70, 36=-70-to-37=-73, 37=-74-to-38=-81, 38=-68-to-39=-70, 39=-88-to-40=-92, 40=-92-to-12=-111



June 3, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®

16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200 / MiTek-US.com

Symbols

PLATE LOCATION AND ORIENTATION

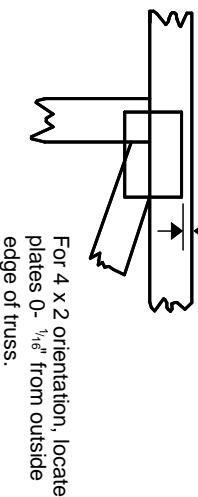

* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

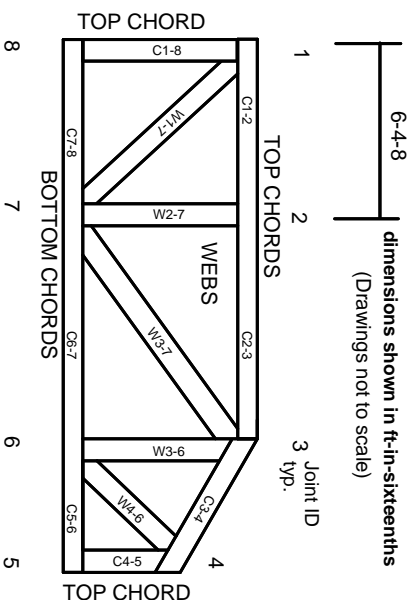

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

MITek®

MITek Engineering Reference Sheet: MIL-7473 rev. 1/2/2023

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.