

1701 State Avenue
Kansas City, KS 66102

t 913-371-0000
f 913-371-6710

AOGeotech.com

GEOTECHNICAL ENGINEERING REPORT

CLUB CARWASH
OLDHAM VILLAGE DEVELOPMENT

1310 MARKET ST., LOT 9
LEE'S SUMMIT, MO 64081
(AOG 250480 E)

Date: August 18, 2025

Submitted to: Club Carwash
Taylor Pridemore
1591 East Prathersville Rd.
Columbia, MO 65202



Submitted by: ALPHA-OMEGA GEOTECH, INC.

TABLE OF CONTENTS

1.0 PROJECT DESCRIPTION4

2.0 SUBSURFACE INVESTIGATION4

3.0 LABORATORY TESTING PROGRAM5

4.0 GROUNDWATER6

5.0 GEOTECHNICAL CONSIDERATIONS7

6.0 SITE DEVELOPMENT7

 6.1 Site Preparation7

 6.2 Undocumented Fill8

 6.3 Engineered Fill Placement8

 6.4 Drainage Considerations9

 6.5 General9

7.0 FOUNDATIONS9

 7.1 Spread Footings Foundations9

 7.2 Allowable Bearing Pressure10

 7.3 Anticipated Settlement10

 7.4 General10

8.0 SLABS ON GRADE11

 8.1 Slab Thicknesses11

 8.2 Low Volume Change (LVC)11

9.0 EARTH PRESSURE COEFICIENTS13

10.0 PAVEMENTS14

 10.1 Subgrade Preparation14

 10.2 Pavement Sections15

 10.3 Recompacted Subgrade Sections16

 10.3.1 Flexible Pavements Sections16

 10.3.2 Rigid Pavement Sections16

 10.4 Subgrade Stabilization Sections16

 10.4.1 Portland Cement17

 10.4.2 Geogrid Reinforcement & Base Rock17

 10.5 General18

11.0 TESTING AND INSPECTION RECOMMENDATIONS19

12.0 LIMITATIONS20

Appendix A – SITE AND BORING LOCATION PLANS

Appendix B – LABORATORY TEST RESULTS

Appendix C – BORING LOGS





1701 State Avenue
Kansas City, KS 66102

t 913-371-0000
f 913-371-6710

AOGeotech.com

Club Carwash
Taylor Pridemore
1591 East Prathersville Rd.
Columbia, MO 65202

Aug. 18, 2025

CLUB CARWASH
OLDHAM VILLAGE DEVELOPMENT

1310 MARKET ST., LOT 9
LEE'S SUMMIT, MO 64081
(AOG 250480 E)

Taylor,

Alpha Omega Geotech, Inc. (AOG) has completed its geotechnical engineering investigation for the above-referenced project.

Attached are the following items that were utilized in the analysis and evaluation of the subsurface conditions at this site: a sketch giving the approximate location of the six (6) auger borings completed during this investigation with reference to the existing site features; detailed laboratory results of three (3) moisture contents (ASTM D2216), three (3) dry densities (ASTM D7263), and two (2) unconfined compression test (ASTM D2166), two (2) sets of Atterberg limits (ASTM D4318), eight (8) calibrated pocket penetrometer readings, and six (6) auger boring (ASTM D1452) logs that describe the materials encountered, their approximate thicknesses, and the sampling depths where Standard Penetration (ASTM D1586) tests were performed.

Representatives of AOG located each of the selected borings by measuring from the existing site features, and these measurements should be considered accurate only to the extent implied by the method of measurement. Elevations were not determined in the field at the time of drilling. Each of the borings was completed by AOG using a CME 55 high-torque drill rig.

1.0 PROJECT DESCRIPTION

Alpha Omega Geotech (AOG) understands the proposed project will consist of constructing the Club Carwash facility with associated parking.

The current construction site covers an area of approximately 1.14 acres. The site is an undeveloped lot that crosses the existing Oldham Rd. that is scheduled to be relocated to the west in the future. The site is relatively flat change of approximately 8 feet across the site.

Based on the information provided, AOG understands there will be a single-story, tunnel-style carwash with an approximate footprint of 5,600 sqft. slab on grade, assumed masonry block construction. There will be a kiosk on the north side of the property, slab on grade with light steel or wood construction. The finished floor elevations were not provided AOG will assume the finished floor elevation for the carwash will be within 5 ft of existing grad as well as the kiosk. The foundation loads were not provided. AOG assumes the buildings to be lightly loaded. There will be new paved drives and parking associated with the project. AOG assumes there will be a water separator tank located under the parking area.

The grading plan was not provided for the site. AOG assumes cuts and fills will be in the range of approximately three (3) to eight (8) feet to achieve the desired construction grade.

2.0 SUBSURFACE INVESTIGATION

Based on the information provided, AOG drilled six (6) auger borings at the proposed site. The borings were advanced to their planned depths or auger refusal, whichever occurred first.

Refusal depths are shown on the following table:

Table 1: Auger Refusal Depths

ROCK REFUSAL TABLE (FT)			
Boring #	Boring Location	Depth to Top of Weathered Rock	Practical Refusal Depth
B1	See Site Sketch	~ 13.5	~ 19.4 *
B2	See Site Sketch	~ 14.0	~ 19.3 *
B3	See Site Sketch	~ 13.5	~ 18.9 *
B4	See Site Sketch	~ 14.0	~ 14.7 *
B5	See Site Sketch	~ 13.0	~ 14.0 *
B6	See Site Sketch	N/A	NONE (10.0 feet)*

(*) Very hard, weathered limestone and shale that was penetrable using our high-torque drilling equipment was encountered above the auger refusal depths shown above (see the boring logs enclosed in Appendix Section 1 of this report).

It should be understood that the depth of boring, split-spoon refusal or auger refusal reported herein applies to the type of drilling equipment that was used. As such, it might be possible to extend some of these borings deeper using different drilling equipment and/or techniques. Conversely, residual sandstone, shale and limestone materials



through which AOG's drill rig penetrated, without achieving refusal, may be difficult to excavate depending upon the equipment being used. As such, Alpha-Omega Geotech, Inc. shall not be responsible, for the determination of Others, regarding the rippability, or ease of excavation, of the in-situ subgrade, bedrock and/or geo-intermediate materials.

Above the depth, at which, boring termination occurred, predominantly clay soils were encountered in the borings. Standard Penetration tests (SPT) (ASTM D1586) were also used to sample and evaluate the consistency of the in-situ subgrade materials encountered in these test borings. Standard Penetration Tests are conducted by advancing a hollow, split spoon sampler into the base of the auger hole by means of dropping a 140-pound hammer a distance of 30 inches onto the drill rods. Each drop of the hammer is one blow, and these blow counts are recorded for each of three, 6-inch advances of the sampler. The first 6-inch advance is the seating drive, and the summation of the blow counts of the final two, 6-inch advances is taken as the standard penetration resistance. The standard penetration resistance, or N-value, as it is known, along with the soil classification, can be used to estimate the density, shear strength and other engineering properties of the materials encountered.

The N-values obtained from each of the SPT's completed in these borings using a CME automatic hammer are included on the boring logs and summarized in the Summary of Laboratory Testing sheet found in Appendix B. Samples retrieved during drilling efforts were returned to AOG's laboratory for testing and evaluation.

3.0 LABORATORY TESTING PROGRAM

Laboratory testing on materials collected during drilling was performed on samples selected by AOG. Results from these tests can be found in Appendix B and on the boring logs in Appendix C. The following laboratory tests were performed by qualified AOG personnel in accordance with ASTM specifications to determine pertinent engineering properties of the soils:

- Visual classification (ASTM D2488)
- Moisture content tests (ASTM D2216)
- Atterberg limits tests (ASTM D4318)
- Dry Unit Weight (ASTM D7263)
- Unconfined compression tests on soil (ASTM D2166)

The dry unit weights of specimens cut from the Shelby tube samples were found to be moderate, ranging from 93.6 pounds per cubic foot (pcf) to 95.9 pcf. Depending upon the material composition and depth below existing grade, the moisture content of the specimens cut from these tube samples ranged from 23.2 to 30.0 percent. The unconfined compressive strength of the specimen cut from the Shelby tube sample ranged from fracture (0.0) to 2120 pounds per square foot (psf). Calibrated pocket penetrometer readings ranging from 1.25 tons per square foot (tsf) (2500 psf) to 4.00 tsf (8000 psf) were obtained on the recovered Shelby tube samples. However, it should be noted that the pocket penetrometer values tend to over-estimate the strength of in-situ subgrade materials relative to the actual unconfined compressive strength test.



The Atterberg consistency limits were determined for two (2), generally, representative sample taken at relatively shallow depth from within the proposed structures' footprints. Based on the Atterberg limits, the samples were classified in accordance with the Unified Soil Classification System (USCS) as Fat Clay (CH) classification materials.

The results of these laboratory analyses are presented in the following table:

Table 2: Atterberg Limits Results

ATTERBERG LIMITS TESTS					
Sample	Depth (ft)	Liquid Limit	Plastic Limit	Plasticity Index	USCS Classification
B2, ST-3	5.0-7.0	58	21	37	Fat Clay (CH)
B3, ST-3	5.0-7.0	68	20	48	Fat Clay (CH)

Based on the Atterberg limits, it is anticipated that the majority of the onsite soil materials generally possess a very high swelling potential. The swelling potential of clay soil is an indication of the volume changes that may take place with variations in the soil moisture content.

Except for the samples for which the Atterberg limits were determined, all of the other soil classifications given throughout the laboratory test data, as well as, the boring logs, were made using the visual and tactile techniques described in ASTM D2488. As a result, additional analyses could reveal other soil types of different classification and potentially higher plasticity and swelling potential both onsite and within the nearby vicinity.

4.0 GROUNDWATER

Free water was encountered in three (3) borings at the time of drilling. The depth of water ranged from 10.0 to 18.0 feet beneath existing grade. Please note, a twenty-four-hour water level was not established in these borings due to time restrictions, as well as potential safety hazards associated with open bore holes.

The following table summarizes the free water measurements recorded at the time of drilling

Table 3: Groundwater Measurements

APPROXIMATE GROUNDWATER MEASUREMENTS		
Boring ID	Depth of Boring (ft)	Depth of Water (ft)
B1	20.0'	10.0'
B3	20.0'	18.0'
B6	15.0'	14.7'

Although the ground water levels given on the boring logs reflect the conditions observed at the time the borings were made, they should not be construed to represent an accurate or permanent condition. There is uncertainty involved with short-term water level observations in bore holes especially in clay soils of relatively low permeability.



The groundwater level should be expected to fluctuate with variations in precipitation, site grading and drainage conditions. In addition, it is also possible that seasonal perched ground water may be encountered within these soil deposits and bedrock formations at different depths during other times of the year based on drainage conditions, seasonal snowmelt and rainwater infiltration.

5.0 GEOTECHNICAL CONSIDERATIONS

The following considerations are given based on observations made by AOG at the time of drilling, during reconnaissance trips, and based on the project requirements and description as stated above:

- 1) ***Expansive Materials:*** Moderately expansive clays were encountered during this exploration. Expansive clays are known to experience significant volume changes with changes in moisture. Expansive clays located beneath any slabs on grade should be removed in accordance with Section 8.0, SLABS ON GRADE of this report.
- 2) ***Undocumented Fill:*** Undocumented fill, in general, consists of foreign materials with unknown densities and consistencies. Undocumented fill is unsuitable beneath structures unless measures are taken to stabilize the materials prior to loading. If encountered, undocumented fill beneath foundations and slabs should be evaluated and addressed in accordance with Section 6.2, "Undocumented Fill," this report

6.0 SITE DEVELOPMENT

6.1 Site Preparation

Based on the information provided, AOG anticipates amounts of cut and fill amounts of about three (3) to eight (8) feet (+/-) from the existing ground surface elevation, within the proposed project limits, will be required to achieve design grades. It is possible that additional cuts and fills may be required to obtain improved surface drainage.

Appropriate erosion control measures, such as proper site contouring during grading activities, as well as silt fences, should be maintained to help keep any eroded materials onsite.

Within the footprint of the proposed new structures, it is recommended that any topsoil, vegetation, utility backfill, and other deleterious material (i.e. concrete slabs, relic foundations, utilities, etc.) or pavements should be stripped and removed prior to the placement of any fill required to achieve the finished floor elevation. In accordance with the local building code, this should be verified by a representative of Alpha-Omega Geotech, Inc. prior to the placement of fill.

Once initial site stripping operations have been completed and prior to the placement of any engineered fill in this area, it is recommended that the exposed subgrade be moisture conditioned and recompacted, as needed, and be thoroughly evaluated by means of a proof-roll with a fully loaded, tandem-axle dump truck to locate any soft, compressible areas within the proposed project site. Any soft, compressible areas identified on the proposed project site must be corrected by over-excavation to a suitable subgrade and replaced with an acceptable material. Although it is not anticipated that any extensive removal and replacement would be necessary, it is possible that some effort may be required to develop a stable platform on which to place the necessary fill material and address any other existing site conditions that become known during construction. It is generally anticipated that the extent



of these efforts would strongly depend upon the ground moisture conditions at the time the site work begins. In the event that the ground is generally dry, it is possible that only a minimal amount of stabilization would be required, which may be possible to accomplish by simple moisture conditioning and re-compaction efforts. Nevertheless, it is recommended that a representative of Alpha-Omega Geotech, Inc. should be onsite to witness this proof-rolling and offer recommendations, as needed, to correct any problem areas identified.

6.2 Undocumented Fill

Undocumented fill is a foreign material, of which no records of testing or evaluation by a qualified professional during the time of placement exist. Undocumented fill is, generally, unsuitable beneath structures, and ***if encountered*** during development, should be thoroughly evaluated by a registered professional engineer and possibly fully removed and replaced with engineered fill in accordance with this report. Undocumented fill beneath pavements should be undercut to a minimum depth of two (2) feet, and the exposed subgrade should be thoroughly evaluated by a registered professional engineer.

6.3 Engineered Fill Placement

It is assumed that any fill material needed will come from cut areas and, if necessary, on-site or nearby borrow sources of similar material. It is recommended that un-weathered shales should NOT be used to construct any of the necessary fill within either the new building or paved portions of the site. Assuming they are properly moisture conditioned and compacted; it generally appears that the clean clay soils encountered in the borings that are free of rubble, trash, concrete, asphalt, and other debris would be acceptable for use as controlled fill. However, due to their very high swelling potential, detailed recommendations for the placement of a non-expansive subbase are provided in Section 8.0, SLABS ON GRADE of this report.

Any imported fill materials for use as structural fill should be tested by Alpha-Omega Geotech, Inc. to determine if they are acceptable for the intended use. Any ground water seeps that are encountered must be diverted prior to placing fill.

In addition, no compaction of soil fill material should be performed during freezing weather. Nevertheless, as weather conditions dictate, it may be possible to substitute crusher-run limestone in lieu of soil fill to allow placement of engineered controlled fill material to continue during the cold fall and winter months. However, any frozen fill material must be stripped prior to placing subsequent lifts.

All general fill within the area of the new buildings (except for the upper 24-inches, as discussed in Section 8.0, SLABS ON GRADE of this report, should be placed in lifts not exceeding 6 inches in thickness, and compacted to a minimum density of 95 percent of the Standard Proctor (ASTM D698) maximum dry density at a moisture content within ± 3 percent of the optimum moisture content.

As required by the local building code, the compaction of any structural fill beneath the new buildings, pavements, and any other areas where settlement control is necessary, as well as any slopes that are steeper than 4:1 (H:V) should be tested lift-by-lift by a representative of Alpha-Omega Geotech, Inc.



6.4 Drainage Considerations

Fluctuations of the ground water level can occur due to seasonal variations in the amount of rainfall and other climatic factors that were not evident at the time the borings were made. The possibility of ground water level fluctuations should be considered when developing the design and construction plans for the project. In spring and late fall, soil moisture contents may be abnormally high and drying of the soils that are exposed and/or undercutting may be required to develop a suitable base for the placement and compaction of engineered fill. Disking and aeration of the exposed soils may be sufficient to develop a stable base. However, if site grading begins during the summer or early fall, moisture contents may be abnormally low and the plastic clay soils encountered during this exploration may undergo significant volume changes with subsequent increases in their moisture content. Therefore, when these conditions exist, disking and moisture conditioning of the exposed subgrade soils may be required.

It is important to consider drainage and construction elements that will help to inhibit future slab on grade problems, foundation cracks, as well as intolerable settlements due to volume changes of the onsite soils. The surface drainage must be designed to prevent ponding and effectively move water away from both the new and existing buildings, pavements and other structures. It is also very important to place all materials under carefully controlled conditions of moisture and density to inhibit significant soil volume changes. Shrubs and trees with deep root systems and requiring large quantities of water should not be planted within 20 feet of the building lines. Any planters located near the building should have impermeable bases with weep holes to discharge water away from the wall lines. Down spouts should be connected to subsurface drains to carry the water to safe exits beyond the building lines, retaining walls, pavements, slopes and other site features or structures that could be adversely affected by water seepage.

6.5 General

Permanent slopes should not be steeper than 3:1 (H:V) to help ensure their future stability and accommodate normal mowing equipment. The responsibility for excavation safety and stability of temporary construction slopes should lie solely with the contractor and should follow the OSHA regulations given in 29 CFR Part 1926.650 - .652, Subpart P. The stability of open excavations is dependent upon a number of factors including but not limited to the presence of gravel, sand and/or silt seams, ground water seepage, strength characteristics of the soil layers, slickensides and other unique geological features, the slope and height of the cut, surcharge loading and vibrations during construction, weather conditions, as well as the length of time the excavation is left open. Alpha-Omega Geotech, Inc. does not assume any responsibility for construction site safety or the contractor's or other parties' compliance with all local, state and federal safety or other regulations including imprudent excavating practices that results in any damage to nearby structures, roadways, utilities, as well as onsite or offsite improvements.

7.0 FOUNDATIONS

7.1 Spread Footings Foundations

Based on the laboratory test data, the available subsurface information that has been obtained and our understanding of the project requirements, it is our opinion that a shallow foundation system consisting of either earth-formed trench or spread footings may be used for this structure as economical foundation elements.



Perimeter footings, and any footings in unheated areas, should be placed at least 3 feet below final exterior grade to provide adequate frost protection and place them in a more stable moisture environment. Under heated areas, the interior footings can be founded at shallower depths of at least 18 inches below the finished floor elevation. The footing excavations should be carried to undisturbed engineered fill.

7.2 Allowable Bearing Pressure

Provided all design and inspection recommendations as given in this report are closely followed and good construction practices are exercised, it is recommended that an allowable bearing value of 2,000 psf may be used for design purposes to proportion the spread/wall footings. A twenty-percent increase, i.e. 2,400 psf, may be used for individual column footings. These allowable bearing capacity values, which are based on shear strength alone and not on settlement, incorporate a factor of safety of 3.0. The actual bearing capacity of all subgrade supporting the foundation elements must be confirmed by a representative of Alpha-Omega Geotech, Inc. as the excavations for the load-bearing wall and column footings are completed and prior to placement of reinforcing steel and concrete. For transient loading conditions, such as un-sustained wind and earthquake, a 33 percent increase may be applied to the above-referenced allowable bearing capacity values.

Based on the subsurface conditions that have been identified, Site Class C conditions (IBC 2018) may be assumed for seismic considerations.

7.3 Anticipated Settlement

Uniform bearing conditions should be provided beneath the footings to minimize differential settlements. If any soft or otherwise unsuitable material is encountered in the footing excavations, it will have to be removed and replaced with engineered controlled fill. Recommendations for the over-excavation and replacement with engineered controlled fill can be made when the footing excavations are inspected during construction, if needed. A representative of Alpha-Omega Geotech, Inc. should inspect all of the footing excavations to verify that uniform and competent bearing material is present beneath all of the foundation elements prior to the placement of any reinforcing steel and concrete.

For spread footings designed and constructed in accordance with this report, it is anticipated that settlements will be limited to 0.75 inches of differential and 1.0 inches in total.

7.4 General

Except for the moisture conditioning discussed in the "Slab On Grade" section of this report, it is recommended that all fill within the new building and paved areas of the site should be constructed as engineered controlled fill placed in lifts not exceeding 6 inches in thickness and compacted to a minimum density of 95 percent of the Standard Proctor (ASTM D698) maximum dry density at a moisture content within ± 3 percent of the optimum moisture content. In accordance with the local building code, a representative of Alpha-Omega Geotech, Inc. should be onsite during placement of all engineered controlled fill within the new building and paved areas to confirm lift thickness and test the compaction of the engineered controlled fill lift-by-lift as it is being placed.



If possible, the over-excavated footings should not be left open for more than 24 hours. The base of the footing excavations should be free of water and loose soil prior to placing reinforcing steel and concrete. No ground water is expected in the footing excavations since ground water was not encountered in any of the borings that were made at the time of drilling. However, if ground water is encountered within the expected depth of excavation for the footings, it is generally anticipated that it can be removed by the use of sumps and pumps. Based on the subsurface conditions that have been identified, it is anticipated that earth-formed trench footing excavations may be used effectively on this project. However, due to the possible presence of existing rocky fill material, it may become necessary to utilize formed footings. A minimum width of 12 inches should be used for trenched wall footings to allow for steel placement and inspection. Minimum widths of 16 and 24 inches should be used for formed wall and column footings, respectively.

8.0 SLABS ON GRADE

8.1 Slab Thicknesses

Slabs on grade that will be subjected to repeated wheel loads, such as passenger vehicles, should be at least 6 inches in thickness. Slabs that are **not** exposed to repeated wheel loads, should be at least 4 inches in thickness. Slabs in storage areas may need to be thicker due to shelving post and other concentrated floor loads. **Actual slab thicknesses should be determined by the project structural engineer.**

8.2 Low Volume Change (LVC)

The following recommendations provided to help protect the slabs from damage caused by volume changes within the underlying subgrade, and should be implemented in conjunction with Section 7.0, FOUNDATIONS of this report:

- 1) Cut the subgrade a minimum of 28-inches beneath the base of slab elevation to allow placement of a 24-inch subbase and a 4-inch base course beneath the slab-on-grade.
- 2) Scarify and recompact the upper 9 inches of exposed subgrade to within 95 to 100 percent of the Standard Proctor (ASTM D698) maximum dry density at a moisture content wet of the optimum moisture content 0 to 3 percent.
- 3) For the 24-inch granular subbase, place crusher-run limestone or rock dust in three (3) approximately equal lifts and compact to a minimum density of 95 percent of the Standard Proctor (ASTM D698) maximum dry density. The moisture content of this material at the time of placement must be sufficient to achieve the specified level of compaction.
- 4) Place a 4-inch base course of clean, open-graded crushed limestone. This granular base course should be compacted with a suitable vibratory steel wheel roller.

Alternatively, it would be possible to consider constructing the 24-inch subbase (in addition to the above recommended 4-inch base course) by chemically stabilizing the onsite expansive clay soil material with Portland cement blended at 5 percent, by weight using a large Bomag Tiller. However, due to the amount of dust that is



generated, the use of these materials may not be a viable alternative for this project site. In addition, it should also be noted that chemical stabilization is, generally, only effective when the ground temperature is a minimum of 50° to 60°F. Nevertheless, if this alternative is utilized, the stabilized subbase should be placed in three (3) equal lifts and compacted to a minimum density of 95 percent of the Standard Proctor (ASTM D698) maximum dry density at a moisture content within ± 3 percent of the optimum moisture content. Compaction of the supplemented soil should be completed within one hour after incorporation. Additional compaction after two hours could cause degradation of the soil strength.

Please note, when constructing in areas where fat clays are present, the owner should recognize there is an inherent risk of distress associated with volume changes of the soil, even with subgrade removal and/or treatment.

8.3 General

It is recommended that under-slab utility trenches should be backfilled with impermeable clay soil (*), flowable fill or lean concrete to help reduce the potential of these trenches acting as aqueducts transmitting groundwater beneath the new building, pavements, retaining walls and other structures.

- (*) If impermeable clay soil is used as backfill, it should be placed in lifts not exceeding 6 inches in thickness and compacted to a minimum density of 95 percent of the Standard Proctor (ASTM D698) maximum dry density at a moisture content within ± 3 percent of the optimum moisture content, which should be verified lift-by-lift during placement by a representative of Alpha-Omega Geotech, Inc. Although clay soil may be less costly than flowable fill or lean concrete, the OSHA excavation safety regulations given in 29 CFR Part 1926.650 - .652, Subpart P must be followed in the event that clay soil is used to backfill any utility trenches.

Finally, it should be noted that the recommendations given, herein, regarding placement of low-volume change fill to help protect the slabs on grade from volume changes associated with fluctuations within the moisture content of the underlying subgrade materials, would still apply.

Plumbing lines and other water leaks occurring beneath the structure's slab-on-grade floor can induce volume changes within the underlying subgrade materials. Therefore, it is recommended that all water supply and wastewater lines should be tested for leaks prior to backfilling the utility trenches. In addition, it is also recommended that every effort should be made to maintain the plumbing in good working order and prevent or minimize water leaks and discharges.

It is assumed the concrete will be reinforced with properly placed steel reinforcement, such as #4 bars, and control joints will be cut during or shortly after finishing (to be designed by the project structural engineer). Properly placed wire mesh may be used as secondary reinforcement. Fiber reinforcement may also be considered to help control shrinkage, cracking, and the use of other admixtures may be considered to enhance the workability and performance of the concrete. Suitable construction and sawed joints should be used to control cracking of the slab. In addition, it is recommended that the slump and temperature of the concrete at the time of placement should be limited to standard American Concrete Institute (ACI) guidelines. Furthermore, it is also recommended that proper concrete curing techniques should be utilized and the addition of jobsite water to the concrete be avoided or very closely controlled to within acceptable parameters. Nevertheless, it should be noted that cracking of concrete used for slabs on grade is a normal occurrence and should be expected.



If a 24-inch-thick subbase layer of crusher-run limestone (AB-3) or rock dust is used, as recommended, a modulus of subgrade reaction of 150 pounds per cubic inch (pci) may be assumed for reinforcement and thickness design to support surface loads. If a higher modulus of subgrade reaction were desired, we would be pleased to work with the project's structural engineer to develop recommendations for alternate bases and/or subbases to achieve a higher modulus of subgrade reaction.

9.0 EARTH PRESSURE COEFFICIENTS

A coefficient of sliding friction over the in-situ clay soils at this site may be taken as 0.32. A minimum factor of safety of 1.5 should be used when considering sliding resistance.

Active, passive and at-rest earth pressure coefficients of 0.25, 4.2 and 0.4 may be assumed for backfills of clean, open-graded crushed limestone.

Active, passive and at-rest earth pressure coefficients of 0.5, 1.9 and 1.0 may be assumed for the in-situ clay soils at this site.

However, some of the in-situ soils encountered during this exploration are classified as a Fat Clay and possess a high swelling potential, and, as such, should not be used as backfill since considerable lateral loads may develop with the addition of water.

If deflection of extended foundation walls or retaining walls is not tolerable, at rest earth pressures should be assumed.

These earth pressure coefficients do not include the effect of surcharge loads, hydrostatic loading or a sloping backfill nor do they incorporate a factor of safety. Also, these earth pressure coefficients do not account for high lateral pressures that may result from volume changes when expansive clay soils are used as backfill behind walls with unbalanced fill depths. In addition, any disturbed soils that are relied upon to provide some level of passive resistance should be placed in lifts not exceeding 6 inches in thickness and compacted to a minimum density of 95 percent of the Standard Proctor (ASTM D698) maximum dry density at a moisture content within ± 3 percent of the optimum moisture content. It is recommended that a representative of Alpha-Omega Geotech, Inc. should verify the compaction of any such materials relied upon to provide passive pressure lift-by-lift during placement.



10.0 PAVEMENTS

10.1 Subgrade Preparation

Please note, a formal pavement design is beyond AOG's scope of service. Standard asphaltic concrete and concrete pavement designs for a given service life requires evaluation of the soil by means of a California Bearing Ratio (CBR) test or other methods, estimates of traffic volumes and axle weights, drainage requirements, and the desired level of maintenance. As such, some standard pavement design options based on assumptions made for materials of this nature are included in this section.

Without stabilization or treatment, the subgrade soils at this site are considered to be poor subgrade materials for the support of pavements. California Bearing Ratio (CBR) values we have obtained rarely exceed 5, soaked, for these materials. Pavements, either total strength flexible or rigid, do not usually perform well when they are placed directly on highly expansive, poor soil subgrades. Soft areas can develop during wet periods and differential shrinkage can occur during dry periods. As a result, no pavement can avoid damage from wheel loads under these circumstances.

Unless the subgrade is stabilized with Portland cement, the subgrade for all pavements should consist of at least 9 inches of properly compacted clean soil, which will require tilling and recompacting in cut sections. It is recommended that any untreated aggregate base or chemically stabilized subgrade layers should extend at least 2 feet beyond the pavement and curb lines. The subgrade should be compacted to a minimum density of 95 percent of the Standard Proctor (ASTM D698) maximum dry density at a moisture content within ± 3 percent of the optimum moisture content. Any additional fill that is required to develop the paved areas should also be placed in loose lifts not exceeding 8 inches in thickness and compacted in accordance with these recommendations. The subgrade should be proof-rolled with a loaded tandem-axle dump truck after the final subgrade elevation has been established throughout the paved area. A representative of Alpha-Omega Geotech, Inc. should witness this proof-rolling.

Please note, if asphaltic pavements are used, annual maintenance including, but not limited to, crack sealing, fog sealing, and possible patch with overlay should be anticipated. In addition, the quality of the aggregates and overall composition of the asphalt or concrete mix, as well as drainage conditions can have a profound effect upon the durability of the pavement section.



10.2 Pavement Sections

Table 4: Recompacted Subgrade Section

RECOMPACTED SUBGRADE SECTIONS (INCHES)			
PAVEMENT MATERIALS	CAR PARKING	DRIVE LANES	HEAVY DUTY AREAS (i.e. Dumpster pads, approach lanes, etc.)
Asphaltic Surface Course	2	2	NA
Asphaltic Base Course	3	5.5	NA
Portland Cement Concrete	5	7	8
Crushed Stone (3/4-inch minus)	4	4	4

*Reference Section 10.3, "Recompacted Subgrade Sections"

Table 5: Recommended Thicknesses with Chemical Subgrade Stabilization

CEMENT SUBGRADE STABILIZATION SECTIONS (INCHES)			
PAVEMENT MATERIALS	CAR PARKING	DRIVE LANES	HEAVY DUTY AREAS (i.e. Dumpster pads, approach lanes, etc.)
Asphaltic Surface Course	2	2	NA
Asphaltic Base Course	2	4	NA
Cement Stabilization	12	12	NA
Portland Cement Concrete	4	6	7
Crushed Stone (3/4-inch minus)	4	4	4
Cement Stabilization	12	12	12

*Reference Section 10.4, "Subgrade Stabilization Sections"

Table 6: Recommended Thicknesses with Geogrid Reinforcement & Baserock

GEOGRID REINFORCEMENT AND BASEROCK SUBGRADE STABILIZATION SECTIONS (INCHES)			
PAVEMENT MATERIALS	CAR PARKING	DRIVE LANES	HEAVY DUTY AREAS (i.e. Dumpster pads, approach lanes, etc.)
Asphaltic Surface Course	2	2	NA
Asphaltic Base Course	2	4	NA
Crushed Stone (3/4-inch minus)	6	6	NA
Portland Cement Concrete	4	6	7
Crushed Stone (3/4-inch minus)	6	6	6

*Reference Section 10.4, "Subgrade Stabilization Sections"



10.3 Recompacted Subgrade Sections

10.3.1 Flexible Pavements Sections

From an initial cost perspective, flexible asphaltic concrete pavement is the most economical pavement section. However, treating the subgrade with Portland cement or using a geogrid reinforced base course can provide a higher quality pavement section, having a much longer service life. Nevertheless, if the subgrade is untreated and asphaltic pavement is used, areas used exclusively for automobile parking should consist of at least 5.0 inches of asphaltic concrete (2.0 inches of surface mix and 3.0 inches of base mix). Drives should be constructed of at least 7.5 inches of asphaltic concrete (2.0 inches of surface and 5.5 inches of base mix). The above-referenced pavement section represents minimum design thicknesses and, as such, periodic maintenance should be anticipated. If an increased pavement performance is desired, as described in Section 10.4, "Subgrade Stabilization," Portland cement stabilization or the use of a layer of base rock and geogrid reinforcement may be considered. Asphaltic cement concrete should NOT be used in areas where heavy truck loads/concentrations are expected.

10.3.2 Rigid Pavement Sections

As an alternative, rigid Portland Cement concrete with a 4-inch-thick base course of crushed limestone may also be used with minimum thicknesses of 5.0 and 7.0 inches for automobile parking areas and drive lanes, respectively. The above-referenced pavement section represents minimum design thicknesses and, as such, periodic maintenance should be anticipated. If a better pavement is desired, as described in Section 10.4, "Subgrade Stabilization," cement stabilization or the use of a layer of base rock and geogrid reinforcement may be considered.

The crusher-run limestone base course should be compacted to a minimum density of 95 percent of the Standard Proctor (ASTM D698) maximum dry density at a moisture content sufficient to achieve the specified level of compaction.

For areas where heavy truck loads/concentrations are anticipated, Portland Cement concrete is recommended. Portland cement concrete slabs having a thickness of 8 inches over a 4-inch, minimum, compacted, crusher-run limestone base should be used for dumpster stations, parking lot entrances, areas where a high concentration of heavily loaded trucks are anticipated, as well as any areas where trucks accelerate/decelerate and execute sharp turning maneuvers.

10.4 Subgrade Stabilization Sections

Alternate pavement sections utilizing chemical stabilization, geogrids, granular base and/or subbase courses should be considered. Treating the subgrade with Portland cement or using a geogrid reinforced base course can provide a pavement section having a much longer service life.

If specific pavement performance standards are to be met, AOG would be pleased to be of further assistance once the actual design loading conditions, service-life and maintenance expectations have been defined.



10.4.1 Portland Cement

The use of Portland cement is usually not effective during cold winter months. Notwithstanding this weather limitation, assuming the Portland Cement is thoroughly and uniformly mixed with the subgrade, chemical stabilization can greatly reduce the swelling potential and improve the strength of the subgrade soil. (This is also assuming the subgrade soil is a relatively clean clay, free from weathered limestone fragments.)

If the subgrade is stabilized with Portland cement to a depth of 12 inches, full depth asphalt pavements with thicknesses of 4.0 and 6.0 inches for parking and drive lanes, respectively, can be used. Likewise, if the subgrade is stabilized with Portland cement, concrete pavement sections over a 4-inch-thick base course of crushed limestone may also be reduced to 4.0 and 6.0 inches, respectively. The crushed limestone base course should be compacted to the specifications given in Section 10.3, "Rigid Pavement Sections," of this report.

It is usually cost effective to determine the optimum amount of cement necessary by laboratory testing; however, it usually ranges from about 4 to 6 percent by weight. The Portland cement should be thoroughly mixed with the subgrade soil by means of a Bomag tiller or other similar equipment specifically designed for such procedures and compacted to a minimum density of 95 percent of the Standard Proctor (ASTM D698) maximum dry density at a moisture content within ± 3 percent of the optimum moisture content.

10.4.2 Geogrid Reinforcement & Base Rock

Soft areas can develop even when the subgrade is stabilized with Portland cement. An even better pavement section can be developed by the use of a tri-axial geogrid over a properly compacted subgrade, as discussed in this report, and a layer of untreated crushed limestone base rock under either flexible or rigid pavements. The purpose of the geogrid is to help span soft spots that will inevitably develop in the subgrade. The geogrid helps to confine the base rock and acts as a "snowshoe," distributing the loads over the subgrade in a tri-axial direction. The layer of base rock, which is placed over the geogrid, must be thick enough to support construction traffic and paving equipment so the geogrid does not become exposed. In general, the crushed limestone base rock should not be less than approximately 6 inches in thickness. If this option is chosen, it is recommended that Tensar TX-140, which is a tri-axial polypropylene geogrid, be used. The geogrid reinforcement should be placed and overlapped as needed in accordance with the manufacturer's recommendations, which should be verified by a representative of Alpha-Omega Geotech, Inc.

Asphaltic concrete thicknesses of 4.0 and 6.0 inches for parking areas and drive lanes, respectively, can be used if geogrid and base rock stabilization are used. Similarly, the Portland cement concrete sections can be reduced to 4.0 and 6.0 inches for the respective areas. Although these thicknesses are the same as given if the subgrade is treated with Portland cement, the use of a tri-axial geogrid and base rock usually represents the most effective, reasonable pavement section.



10.5 General

If asphaltic pavements are used, periodic maintenance including, but not limited to, crack sealing, fog sealing, and possible patch with overlay should be anticipated. In addition, the quality of the aggregates and overall composition of the asphalt or concrete mix, as well as drainage conditions can have a profound effect upon the durability of the pavement section.

Where engineered controlled fill is placed beneath paved areas, it is recommended the compacted fill should extend a minimum distance of two (2) feet beyond the pavement edge or curb line, or a distance equal to the depth of the fill, whichever is greater.

Asphalt mixes meeting KCAPWA specifications may be used for surface and base mixes, respectively. Compaction testing of each pavement layer is recommended to help ensure compliance with the mix design specifications.

For areas where heavy truck loads/concentrations are anticipated, Portland Cement concrete is should be used. It is recommended that load-transfer devices should be installed where construction joints are required. For dumpster stations, the concrete slabs should be large enough to accommodate the dumpster and at least the rear wheels of the disposal vehicle. Rigid pavements should have No. 4 bars on at least 2-foot centers and positioned in the upper third of the slab. Joints should be tooled or cut within 4 hours of hardening to a depth of at least one fourth of the thickness.

The subgrade should be moistened prior to placement of concrete. Fresh concrete should be properly cured as recommended by the American Concrete Institute (ACI). To help resistance to damage caused by alternating cycles of freezing and thawing, it is recommended that any exposed concrete should be properly air entrained; typically, at 5 to 7 percent. In addition, it is also recommended the outer edges of pavement slabs should be thickened to help resist cracking associated with heavy wheel loads near these unrestrained areas.

If full-depth pavement is used, it is important the moisture content of the subgrade should be kept as constant as possible from the time of recompacting until the pavement is laid. However, if the subgrade becomes dry, it should be moistened for at least 72 hours prior to paving, but it should not be saturated. In all cases, pavements should be sloped to inhibit ponding and provide rapid surface drainage. If water is allowed to pond on or adjacent to the pavement, the subgrade could become saturated and lose its bearing capacity which would contribute to premature pavement deterioration under a single cycle of heavy wheel loads or a number of cycles of lighter wheel loads.

The subgrade should be moistened prior to placement of concrete. Fresh concrete should be properly cured as recommended by the American Concrete Institute (ACI). To help resistance to damage caused by alternating cycles of freezing and thawing, it is recommended that any exposed concrete should be properly air entrained; typically, at 5 to 7 percent. In addition, it is also recommended the outer edges of pavement slabs should be thickened to help resist cracking associated with heavy wheel loads near these unrestrained areas.

Pavements should be sloped to inhibit ponding and provide rapid surface drainage. If water is allowed to pond on or adjacent to the pavement, the subgrade could become saturated and lose its bearing capacity which would contribute to premature pavement deterioration under a single cycle of heavy wheel loads or a number of cycles of lighter wheel loads.



11.0 TESTING AND INSPECTION RECOMMENDATIONS

Unless Alpha-Omega Geotech, Inc. is retained to provide the construction observation, monitoring and testing services for this project, we cannot accept any responsibility for any conditions that deviate from those identified in this subsurface investigation nor for the performance of the foundations, pavements and other structures including any retaining walls that are a part of this project. Alpha-Omega Geotech, Inc. is accredited by AASHTO, and we are experienced in construction quality control and have a fully equipped soil, concrete, aggregate, rock and asphalt testing laboratory, as well as qualified field technicians to provide these field services.

It is not economically practical to perform enough exploratory borings on any site to identify all subsurface conditions. Some conditions affecting the design and/or construction may not become known until the project is underway. The boring logs, field SPT and laboratory test results depict subsurface conditions only at the specified locations and depths at the site. The boundaries between soil and rock layers indicated on the boring logs are based on observations made during drilling and an interpretation of the laboratory testing results. The exact depths of these boundaries are approximate and the transitions between soil and rock types may be gradual rather than being clearly defined. Also, due to the prior development at this site, as well as, the natural conditions of the formation of soils and rock, it is possible that unanticipated subsurface conditions may be encountered during construction.

Monitoring of the subsurface conditions that are revealed during construction is needed to verify that subsurface conditions are consistent with those conditions identified in this preliminary geotechnical investigation. If variations in subsurface conditions are encountered, it will be necessary for Alpha-Omega Geotech, Inc. to re-evaluate the recommendations that have been made in this report.

Special Inspections should be performed in accordance with the local building code under which the project is designed, as adopted by Lee's Summit, MO.

Prior to filling, it is recommended that a representative of Alpha-Omega Geotech, Inc. should verify that the site has been properly stripped of all topsoil and other deleterious material, benched as needed and prepared for the placement of fill. The compaction of any structural fill beneath the new building, pavements, and any other areas where settlement control is necessary should be tested lift-by-lift by a representative of Alpha-Omega Geotech, Inc. as it is being placed. This should include the prepared subgrade layers beneath the building's slab-on-grade, as well as any other fill material relied upon to provide passive resistance. Also, in accordance with the local building code, any fill that is used to construct slopes steeper than 4:1 (H:V) must be placed as engineered controlled fill and the compaction tested lift-by-lift during placement.

Assuming that uniform fill material is used, nuclear density gauges (ASTM D6938) should be used to test compaction wherever necessary. However, if fill material of non-uniform consistency is used, other evaluation methods may be required. Such methods may include, but not be limited to, the use of a GeoGauge Stiffness meter, Dynamic Cone Penetrometer (DCP), proof-rolling or other visual inspection techniques.

Any geotextile fabric and geogrid reinforcement that is utilized should be placed and overlapped as needed in accordance with the manufacturer's recommendations, which should be verified by a representative of Alpha-Omega Geotech, Inc. Proper placement of the reinforcing steel for drilled piers, grade beams, pier caps, foundation walls and other structural elements including any necessary wing walls and retaining walls should be verified prior



to the placement of concrete. The subgrade under the slabs on grade and pavements should be checked to verify they are in compliance with the density and moisture requirements. Wherever possible, in addition to compaction testing, cut and fill areas should be proof-rolled with a loaded tandem-axle dump truck to identify soft areas that will need to be corrected. A representative of Alpha-Omega Geotech, Inc. should observe this proof-rolling. Checks should also be made of the subbases, concrete and any pavement materials.

Finally, the inspection and testing services listed herein are given as a minimum and it should be understood that additional inspection and testing services might also be required or otherwise beneficial.

12.0 LIMITATIONS

This report is presented in broad terms to provide a comprehensive assessment of the interpreted subsurface conditions and their potential effect on the adequate design and economical construction of Club Carwash facility located in Lee's Summit, MO as discussed herein. This report has been prepared for the exclusive use of our client for specific application to the project discussed herein and has been prepared within our client's directive and budgetary constraints and in accordance with generally accepted geotechnical engineering practices. No other warranty, expressed or implied, is made.

It should be noted that the concept of risk is an important aspect of the geotechnical engineering evaluation and report since the recommendations given in this report are not based on exact science but rather analytical tools and empirical methods in conjunction with engineering judgment and experience. Therefore, the recommendations given herein should not be considered risk-free and, more importantly, are not a guarantee that the interaction between the soil materials and the proposed structures will perform as planned. Nevertheless, the geotechnical engineering recommendations presented herein are Alpha-Omega Geotech, Inc.'s professional opinion of those measures that are necessary for the proposed structures to perform according to the proposed design based on the information provided to Alpha-Omega Geotech, Inc., the referenced information gathered during the course of this investigation and our experience with these conditions.

Any significant structural changes to the proposed new structure or its location on this site relative to where these test borings were completed shall be assumed to invalidate the conclusions and recommendations given in this report until we have had the opportunity to review these changes and, if necessary, modify our conclusions and recommendations accordingly. It is also strongly suggested that Alpha-Omega Geotech, Inc. should review your plans and specifications dealing with the earthwork, foundations, as well as any pavements prior to construction to confirm compliance with the recommendations given herein. Particular details of foundation design, construction specifications or quality control may develop, and we would be pleased to respond to any questions regarding these details.

If Alpha-Omega Geotech, Inc. is not retained to review the project plans and specifications, address to the proposed building or their location on the site relative to where these test borings were completed, provide the recommended construction phase observation, monitoring and testing services and respond to any subsurface conditions that are identified during construction to evaluate whether or not changes in the recommendations given in this report are needed, we cannot be held responsible for the impact of those conditions on the project or the future performance of the buildings, pavements and/or structures that may be involved.



The scope of our services did not include any environmental assessment or investigation for the presence of hazardous or toxic materials in the soil, surface water, ground water or air, either on, below or adjacent to this site. In addition, no determination regarding the presence or absence of wetlands was made. Furthermore, it should be understood that the scope of geotechnical services for this project does not include either specifically or by implication any biological (i.e. mold, fungi or bacteria) assessment of the site or the proposed construction. Any statements in this report or included on the boring logs regarding odors, colors and unusual or suspicious items or conditions are strictly for informational purposes only.

We appreciate the opportunity to be of service to Club Carwash, as well as the project developers and look forward to working with you throughout the construction process. We are prepared to provide the Special Inspection services that will be required by the local building code under which this project is designed, as adopted by the City of Lee's Summit, MO, as well as the other necessary construction observation, monitoring and testing services discussed in this report. If you have any questions concerning this report, or if we may be of further assistance, please call us at (913) 371-0000.

Sincerely,
ALPHA-OMEGA GEOTECH, INC.

Garic Abendroth

Garic Abendroth, P.E.
Engineering Director

Enclosures



Appendix Section A


SITE SKETCH


Site and Boring Location Plans

Club Carwash

Lee's Summit

Legend

 Boring Locations

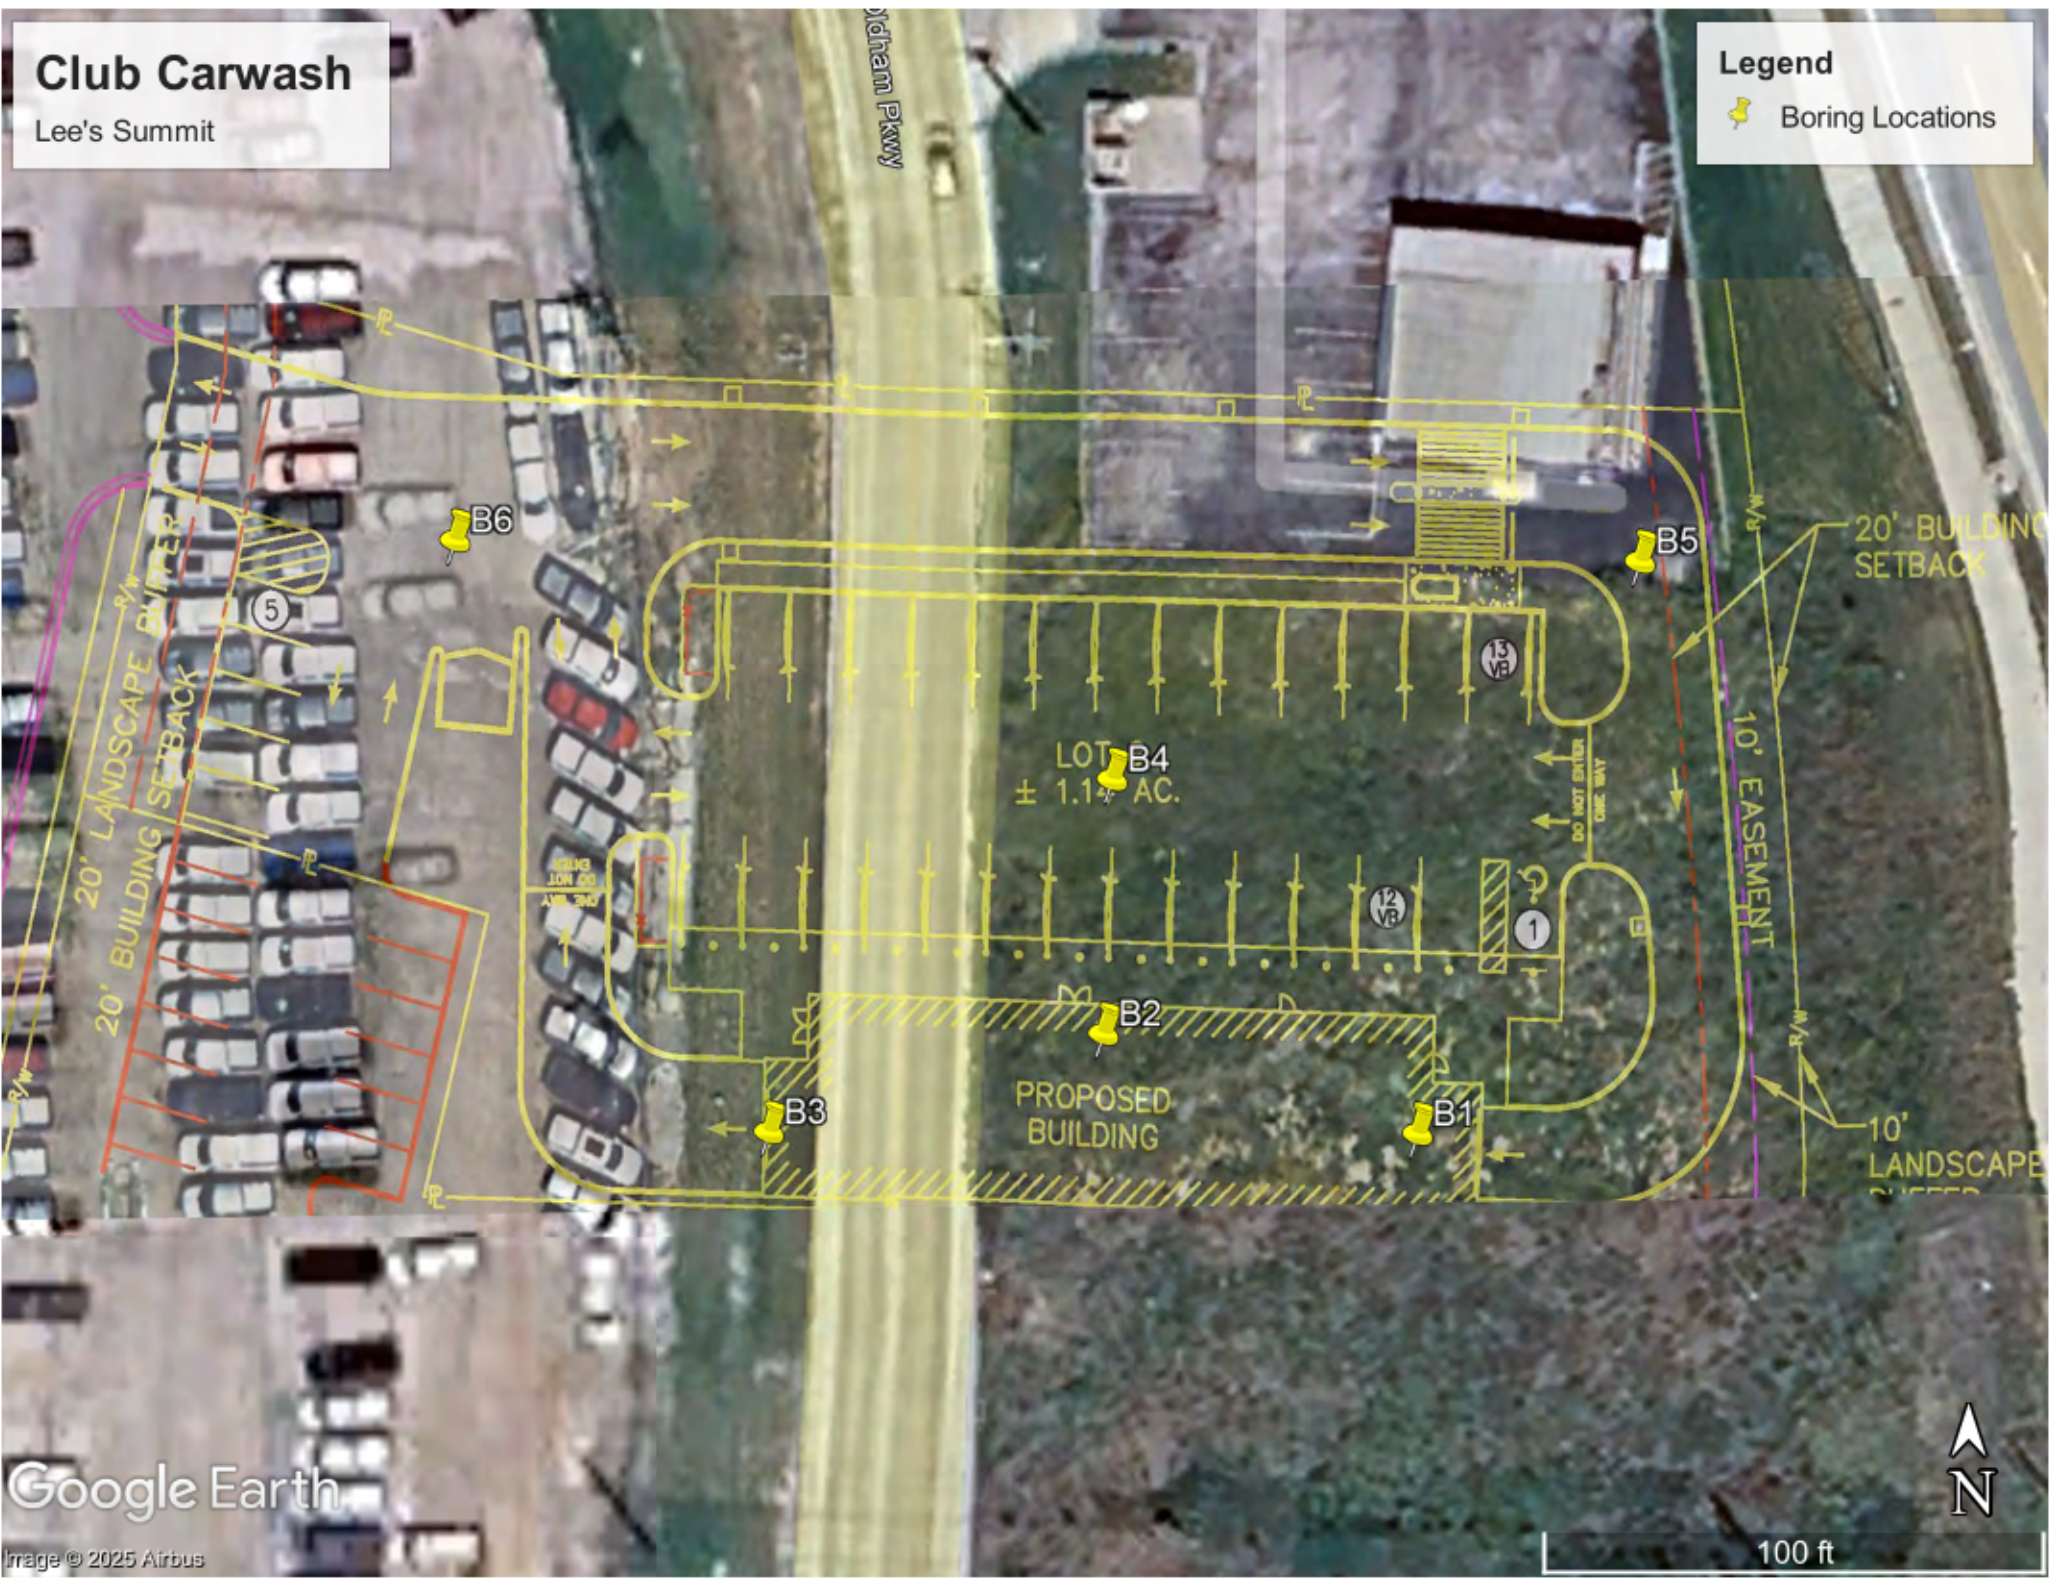

Google Earth

Image © 2025 Airbus

100 ft

Appendix Section B

LABORATORY TEST RESULTS

Summary of Laboratory Testing

SLT 22205

Alpha-Omega Geotech, Inc.
 1701 State Avenue
 Kansas City, KS 66102
 Office: (913) 371-0000 Fax: (913) 371-6710
 Website: www.aogeotech.com



PROJECT NAME: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT
 PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081

PROJECT NUMBER: 250480 E
 DATE: 8/18/2025

Boring Number	Sample Number	Depth or Elevation	Description	Natural Moisture (%)	Dry Unit Weight (pcf)	Atterberg Limits			USCS/ Visual Class.	% Passing No. 200	Unconfined Compression (psf)	%e	% Swell	Remarks
						LL	PL	PI						
B1	SS-1	1.0-2.5	Brown, mottled dark brown LEAN CLAY						CL					N=7
B1	SS-2	3.5-5.0	Dark brown LEAN/FAT CLAY						CL-CH					N=6
B1	ST-3	5.0-7.0	Brown, speckled dark brown and reddish brown FAT CLAY	26.9	95.9	58	21	37	CH	FRACTURED				PP=1.75
B1	ST-4	8.0-10.0	Brown, spotted light gray and dark brown LEAN/FAT CLAY (Weathered SHALE)						SH					PP=4.00
B1	SS-5	13.5-15.0	Light brown LEAN CLAY with Weathered SHALE (Very hard, very slow drilling)						CL					N=50/41
B1	SS-6	18.5-20.0	Gray, spotted light brown LEAN/FAT CLAY (Weathered SHALE) (Very hard, very slow drilling)						SH					N=50/4
B2	SS-1	1.0-2.5	Brown, spotted reddish brown LEAN/FAT CLAY						CL-CH					N=6
B2	SS-2	3.5-5.0	Brown LEAN/FAT CLAY						CL-CH					N=7
B2	ST-3	5.0-7.0	Brown FAT CLAY	23.2	93.6				CH	1303	2.2			PP=1.75

Summary of Laboratory Testing

SLT 22205

Alpha-Omega Geotech, Inc.
 1701 State Avenue
 Kansas City, KS 66102
 Office: (913) 371-0000 Fax: (913) 371-6710
 Website: www.aogeotech.com



PROJECT NAME: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT
 PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081

PROJECT NUMBER: 250480 E
 DATE: 8/18/2025

Boring Number	Sample Number	Depth or Elevation	Description	Natural Moisture (%)	Dry Unit Weight (pcf)	Atterberg Limits			USCS/ Visual Class.	% Passing No. 200	Unconfined Compression (psf)	%e	% Swell	Remarks
						LL	PL	PI						
B2	ST-4	8.0-10.0	Brown, spotted dark brown FAT/LEAN CLAY						CH-CL					PP=2.00
B2	SS-5	13.5-15.0	Light brown, spotted light gray LEAN/FAT CLAY with Weathered SHALE (Very hard, very slow drilling)						CL-CH					N=50/4
B2	SS-6	18.5-20.0	Light brown, mottled gray LEAN/FAT CLAY with Weathered SHALE (Very hard, very slow drilling)						CL-CH					N=50/3
B3	SS-1	1.0-2.5	Dark brown LEAN/FAT CLAY with trace gravel						CL-CH					N=12
B3	SS-2	3.5-5.0	Brown, spotted dark brown FAT/LEAN CLAY with trace gravel						CH-CL					N=9
B3	ST-3	5.0-7.0	Brown, mottled reddish brown FAT CLAY	30.0	93.8	68	20	48	CH		2120	3.5		PP=1.25
B3	ST-4	8.0-10.0	Brown, mottled reddish brown and light gray FAT/LEAN CLAY						CH-CL					PP=1.75
B3	SS-5	13.5-15.0	Brown, mottled gray LEAN/FAT CLAY (Weathered SHALE) (Very hard, very slow drilling)						SH					N=50/5

Summary of Laboratory Testing

SLT 22205

Alpha-Omega Geotech, Inc.
 1701 State Avenue
 Kansas City, KS 66102
 Office: (913) 371-0000 Fax: (913) 371-6710
 Website: www.aogeotech.com



PROJECT NAME: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT
 PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081

PROJECT NUMBER: 250480 E
 DATE: 8/18/2025

Boring Number	Sample Number	Depth or Elevation	Description	Natural Moisture (%)	Dry Unit Weight (pcf)	Atterberg Limits			USCS/ Visual Class.	% Passing No. 200	Unconfined Compression (psf)	%e	% Swell	Remarks
						LL	PL	PI						
B3	SS-6	18.5-20.0	Brown Weathered SHALE (Very hard, very slow drilling)						SH					N=50/4
B4	SS-1	1.0-2.5	Brown, spotted dark brown LEAN/FAT CLAY						CL-CH					N=5
B4	ST-2	3.0-5.0	Brown, speckled reddish brown FAT/LEAN CLAY						CH-CL					PP=3.50
B4	SS-3	8.5-10.0	Brown, mottled light gray and reddish brown FAT CLAY						CH					N=6
B4	SS-4	13.5-15.0	Brown LEAN/FAT CLAY with Weathered SHALE (Very hard, very slow drilling)						CL-CH					N=50/2
B5	SS-1	1.0-2.5	Brown, speckled reddish brown LEAN/FAT CLAY (Possible FILL)						CL-CH					N=6
B5	ST-2	3.0-5.0	Dark brown LEAN/FAT CLAY (Possible FILL)						CL-CH					PP=2.75
B5	SS-3	8.5-10.0	Brown, spotted reddish brown FAT/LEAN CLAY						CH-CL					N=7
B5	SS-4	13.5-14.0	Brown, spotted reddish brown LEAN/FAT CLAY with trace Weathered LIMESTONE fragments (Very hard, very slow drilling)						CL-CH					N=50/6

Summary of Laboratory Testing

SLT 22205

Alpha-Omega Geotech, Inc.
 1701 State Avenue
 Kansas City, KS 66102
 Office: (913) 371-0000 Fax: (913) 371-6710
 Website: www.aogeotech.com




PROJECT NAME: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT
 PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081

PROJECT NUMBER: 250480 E
 DATE: 8/18/2025

Boring Number	Sample Number	Depth or Elevation	Description	Natural Moisture (%)	Dry Unit Weight (pcf)	Atterberg Limits			USCS/ Visual Class.	% Passing No. 200	Unconfined Compression (psf)	%e	% Swell	Remarks
						LL	PL	PI						
B6	SS-1	1.0-2.5	Dark brown LEAN/FAT CLAY (Possible FILL)						CL-CH					N=4
B6	SS-2	3.5-5.0	Brown, mottled reddish brown LEAN/FAT CLAY (Possible FILL)						CL-CH					N=9
B6	SS-3	8.5-10.0	Reddish brown, spotted grayish brown FAT/LEAN CLAY						CH-CL					N=9

LIQUID AND PLASTIC LIMITS TEST REPORT

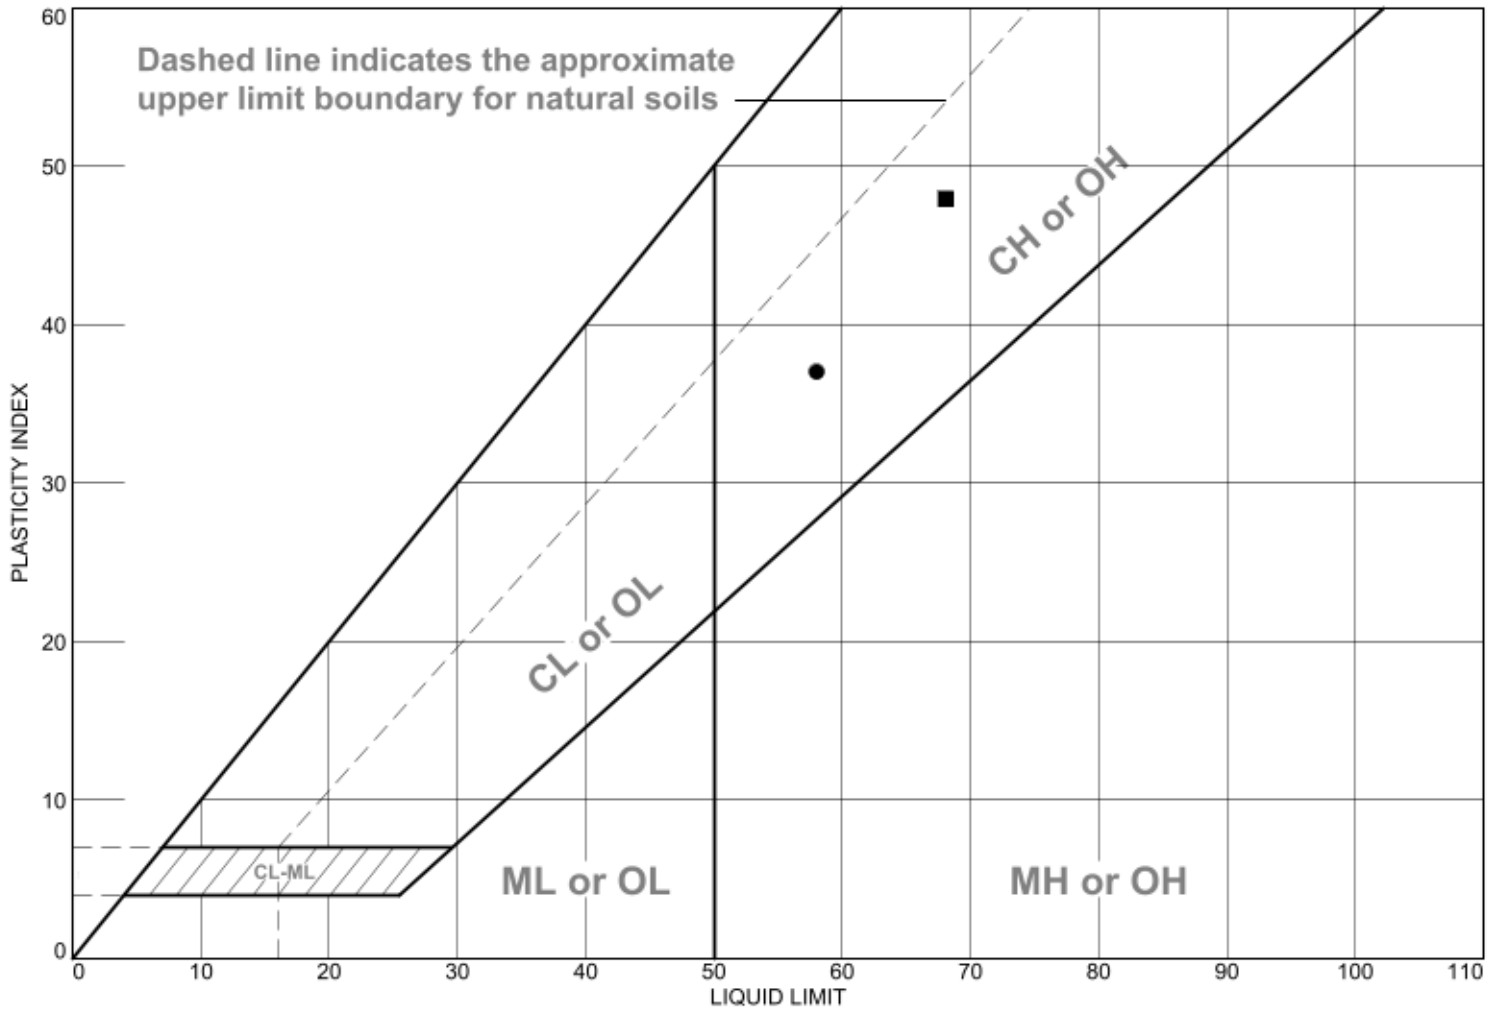

MATERIAL DESCRIPTION	LL	PL	PI	%<#40	%<#200	USCS
● Brown, speckled dark brown and reddish brown FAT CLAY	58	21	37			CH
■ Brown, mottled reddish brown FAT CLAY	68	20	48			CH

Project No. 250480 E **Client:** CLUB CARWASH
Project: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT

● Source of Sample: B1 **Depth:** 5.0 **Sample Number:** ST-3
■ Source of Sample: B3 **Depth:** 5.0 **Sample Number:** ST-3

Remarks:




Figure

Tested By: A.M.

Checked By: T.B.

UNCONFINED COMPRESSION TEST

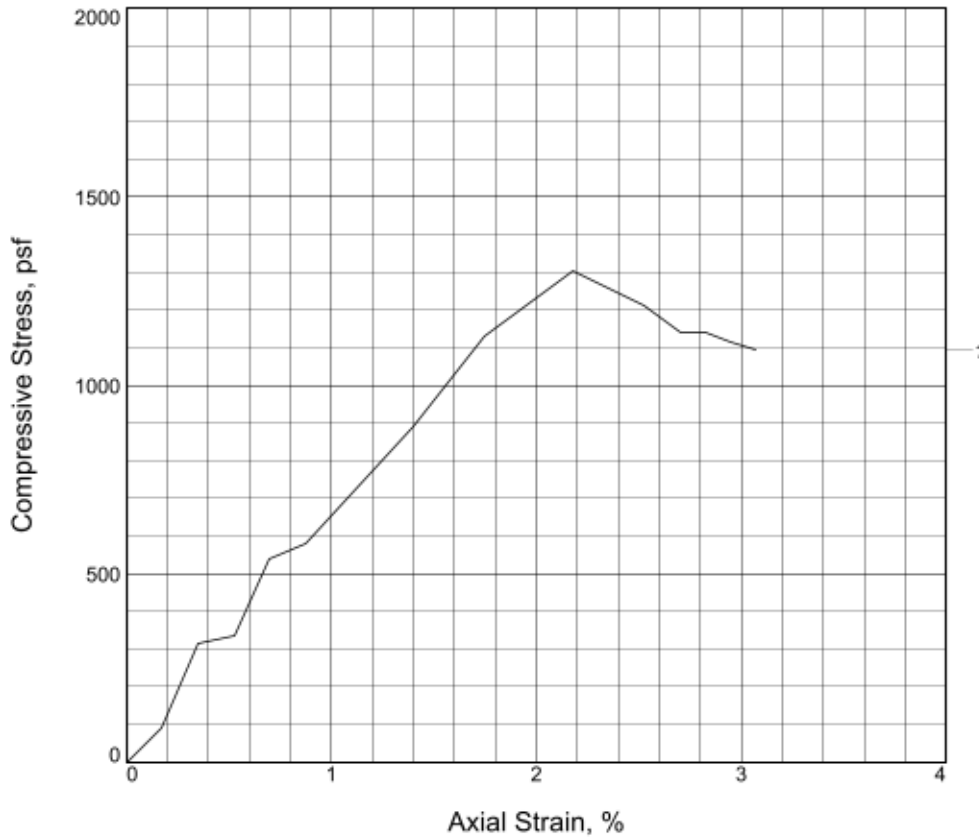

Sample No.	1		
Unconfined strength, psf	1303		
Undrained shear strength, psf	651		
Failure strain, %	2.2		
Strain rate, in./min.	0.098		
Water content, %	23.2		
Wet density, pcf	115.4		
Dry density, pcf	93.6		
Saturation, %	78.3		
Void ratio	0.8003		
Specimen diameter, in.	2.850		
Specimen height, in.	5.730		
Height/diameter ratio	2.01		

Description: Brown FAT CLAY

LL =	PL =	PI =	Assumed GS= 2.70	Type: Undisturbed
-------------	-------------	-------------	-------------------------	--------------------------

Project No.: 250480 E
Date Sampled: 08/08/2025
Remarks:

Client: CLUB CARWASH
Project: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT
Source of Sample: B2 **Depth:** 5.0
Sample Number: ST-3


Figure 1 of 1



Tested By: D.B.

Checked By: T.B.

UNCONFINED COMPRESSION TEST

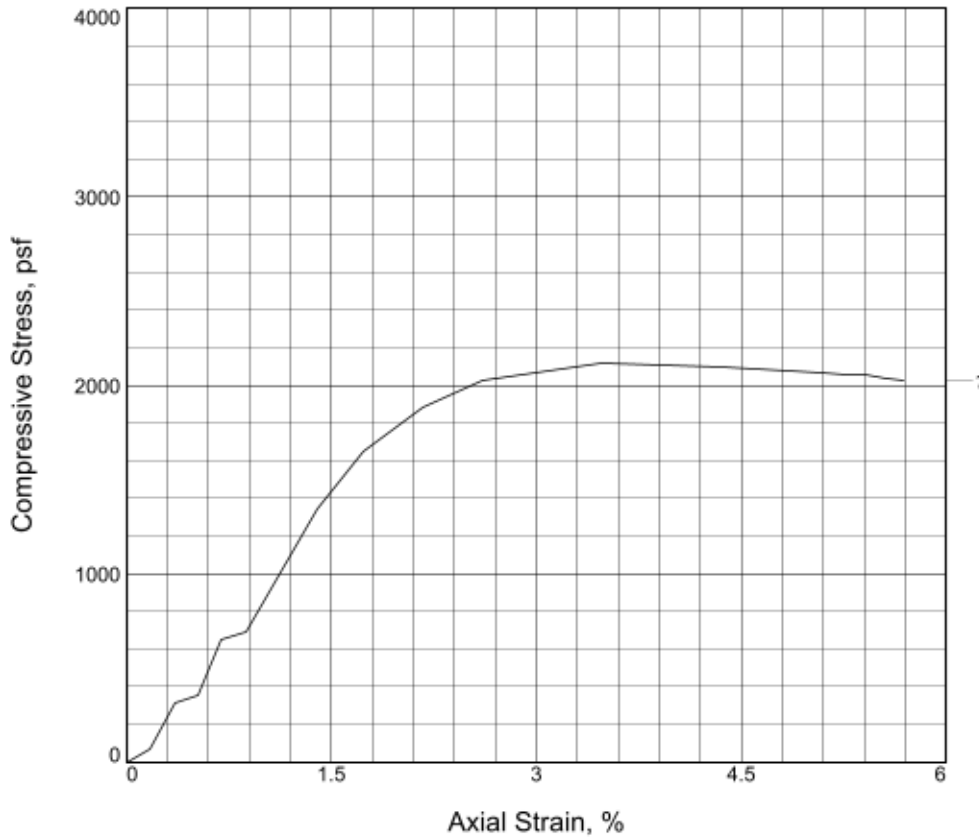

Sample No.	1		
Unconfined strength, psf	2120		
Undrained shear strength, psf	1060		
Failure strain, %	3.5		
Strain rate, in./min.	0.098		
Water content, %	30.0		
Wet density, pcf	122.0		
Dry density, pcf	93.8		
Saturation, %	99.6		
Void ratio	0.8293		
Specimen diameter, in.	2.860		
Specimen height, in.	5.750		
Height/diameter ratio	2.01		

Description: Brown, mottled reddish brown FAT CLAY

LL = 68 **PL = 20** **PI = 48** **Assumed GS= 2.75** **Type: Undisturbed**

Project No.: 250480 E
Date Sampled: 08/08/2025
Remarks:

Client: CLUB CARWASH
Project: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT
Source of Sample: B3 **Depth:** 5.0
Sample Number: ST-3



Figure 1 of 1

Tested By: D.B.

Checked By: T.B.

Appendix Section C

BORING LOGS

Note: The logs of subsurface conditions shown in this section apply only at the specific boring location and depths at the date indicated and might not be indicative of all subsurface conditions that may be encountered. This information is not warranted to be representative of subsurface conditions at other locations, depths and times. The passage of time or construction operations at or adjacent to this site may result in changes to the soil conditions at these boring locations and depths. As a result, the character of subsurface materials shall be each bidder's responsibility.



**LOG OF BORING
No. B1**

PROJECT: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT **PROJECT NO.:** 250480 E
CLIENT: CLUB CARWASH
PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081
LOCATION: SEE SITE SKETCH **ELEVATION:** N/D
DRILLER: KK **LOGGED BY:** NN
DRILLING METHOD: POWER AUGER **DATE:** 7/31/25
DEPTH TO - WATER> INITIAL: ∇ 10.0' **AFTER 24 HOURS:** ∇ **CAVING>** NONE

Elevation	Soil Symbols Sampler Symbols and Field Test Data	Description	w%	DDen pcf	LL	PI	200 %	Uncomp. psf	PPen. tsf	USCS/ Visual Class.
0		Brown, mottled dark brown LEAN CLAY (Root Zone)								CL
			0.25							CL
		Brown, mottled dark brown LEAN CLAY	1.0							CL
		Brown, mottled dark brown LEAN CLAY	2.5							CL-CH
5		Brown, mottled dark brown LEAN CLAY	3.5							CH
		Dark brown LEAN/FAT CLAY	5.0	26.9	95.9	58	37	FRACT	1.75	
		Brown, speckled dark brown and reddish brown FAT CLAY	7.0						4.00	CH
		Brown, speckled dark brown and reddish brown FAT CLAY	8.0							SH
10		Brown, spotted light gray and dark brown LEAN/FAT CLAY (Weathered SHALE)	10.0							SH
		Brown, spotted light gray and dark brown LEAN/FAT CLAY (Weathered SHALE)	13.5							CL
15		Light brown LEAN CLAY with Weathered SHALE (Very hard, very slow drilling)	15.0							CL
		Light brown LEAN CLAY with Weathered SHALE (Very hard, very slow drilling)	18.5							SH
20		Gray, spotted light brown LEAN/FAT CLAY (Weathered SHALE) (Very hard, very slow drilling)	19.4							
		End of boring at about 19.4 feet								



**LOG OF BORING
No. B2**

PROJECT: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT **PROJECT NO.:** 250480 E
CLIENT: CLUB CARWASH
PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081
LOCATION: SEE SITE SKETCH **ELEVATION:** N/D
DRILLER: KK **LOGGED BY:** NN
DRILLING METHOD: POWER AUGER **DATE:** 7/31/25
DEPTH TO - WATER> INITIAL: ∞ NONE **AFTER 24 HOURS:** ∞ NONE **CAVING>** C NONE

Elevation	Soil Symbols Sampler Symbols and Field Test Data	Description	w%	DDen pcf	LL	PI	200 %	Uncomp. psf	PPen. tsf	USCS/ Visual Class.
0		Brown, spotted reddish brown LEAN/FAT CLAY (Root Zone)								CL-CH
			0.25							CL-CH
		Brown, spotted reddish brown LEAN/FAT CLAY	1.0							CL-CH
		Brown, spotted reddish brown LEAN/FAT CLAY	2.5							CL-CH
5		Brown, spotted reddish brown LEAN/FAT CLAY	3.5							CL-CH
		Brown LEAN/FAT CLAY	23.2	93.6				1303	1.75	CL-CH
		Brown FAT CLAY	5.0							CH
		Brown FAT CLAY	7.0							CH
		Brown FAT CLAY	8.0						2.00	CH-CL
10		Brown, spotted dark brown FAT/LEAN CLAY	10.0							CH-CL
		Brown, spotted dark brown FAT/LEAN CLAY	13.5							CH-CL
15		Light brown, spotted light gray LEAN/FAT CLAY with Weathered SHALE (Very hard, very slow drilling)	15.0							CL-CH
		Light brown, spotted light gray LEAN/FAT CLAY with Weathered SHALE (Very hard, very slow drilling)	18.5							CL-CH
20		Light brown, mottled gray LEAN/FAT CLAY with Weathered SHALE (Very hard, very slow drilling)	19.3							CL-CH
		End of boring at about 19.3 feet								
25										
30										
35										



**LOG OF BORING
No. B3**

PROJECT: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT **PROJECT NO.:** 250480 E
CLIENT: CLUB CARWASH
PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081
LOCATION: SEE SITE SKETCH **ELEVATION:** N/D
DRILLER: KK **LOGGED BY:** NN
DRILLING METHOD: POWER AUGER **DATE:** 7/31/25
DEPTH TO - WATER> INITIAL: \approx 18.0' **AFTER 24 HOURS:** \approx **CAVING>** NONE

Elevation	Soil Symbols Sampler Symbols and Field Test Data	Description	w%	DDen pcf	LL	PI	200 %	Uncomp. psf	PPen. tsf	USCS/ Visual Class.
0		Brown LEAN CLAY with gravel								CL
		Dark brown LEAN/FAT CLAY with trace gravel	1.0							CL-CH
		Dark brown LEAN/FAT CLAY with trace gravel	2.5							CL-CH
		Brown, spotted dark brown FAT/LEAN CLAY with trace gravel	3.5							CH-CL
5		Brown, mottled reddish brown FAT CLAY	5.0	30.0	93.8	68	48	2120	1.25	CH
		Brown, mottled reddish brown FAT CLAY	7.0							CH
		Brown, mottled reddish brown and light gray FAT/LEAN CLAY	8.0						1.75	CH-CL
10		Brown, mottled reddish brown and light gray FAT/LEAN CLAY	10.0							CH-CL
		Brown, mottled gray LEAN/FAT CLAY (Weathered SHALE) (Very hard, very slow drilling)	13.5							CL-CH
15		Brown, mottled gray LEAN/FAT CLAY (Weathered SHALE) (Very hard, very slow drilling)	15.0							CL-CH
		Brown Weathered SHALE (Very hard, very slow drilling)	18.5							SH
20		End of boring at about 18.9 feet	18.9							



**LOG OF BORING
No. B4**

PROJECT: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT **PROJECT NO.:** 250480 E
CLIENT: CLUB CARWASH
PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081
LOCATION: SEE SITE SKETCH **ELEVATION:** N/D
DRILLER: KK **LOGGED BY:** NN
DRILLING METHOD: POWER AUGER **DATE:** 7/31/25
DEPTH TO - WATER> INITIAL: ∇ 14.7' **AFTER 24 HOURS:** ∇ **CAVING>** \sphericalangle NONE

Elevation	Soil Symbols Sampler Symbols and Field Test Data	Description	w%	DDen pcf	LL	PI	200 %	Uncomp. psf	PPen. tsf	USCS/ Visual Class.
0		ASPHALT								
		Brown, spotted dark brown LEAN/FAT CLAY	0.50							CL-CH
		Brown, spotted dark brown LEAN/FAT CLAY	1.0							CL-CH
		Brown, spotted dark brown LEAN/FAT CLAY	2.5						3.50	CL-CH
		Brown, speckled reddish brown FAT/LEAN CLAY	3.0							CH-CL
		Brown, speckled reddish brown FAT/LEAN CLAY	5.0							CH-CL
		Brown, mottled light gray and reddish brown FAT CLAY	8.5							CH
		Brown, speckled reddish brown FAT/LEAN CLAY	10.0							CH
		Brown LEAN/FAT CLAY with Weathered SHALE (Very hard, very slow drilling)	13.5							CL-CH
		End of boring at about 14.7 feet	14.7							



**LOG OF BORING
No. B5**

PROJECT: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT **PROJECT NO.:** 250480 E
CLIENT: CLUB CARWASH
PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081
LOCATION: SEE SITE SKETCH **ELEVATION:** N/D
DRILLER: KK **LOGGED BY:** NN
DRILLING METHOD: POWER AUGER **DATE:** 7/31/25
DEPTH TO - WATER> INITIAL: ∞ **AFTER 24 HOURS:** ∞ **CAVING>** C NONE

Elevation	Soil Symbols Sampler Symbols and Field Test Data	Description	w%	DDen pcf	LL	PI	200 %	Uncomp. psf	PPen. tsf	USCS/ Visual Class.
0		Brown LEAN CLAY (Possible FILL)								CL
3.2		Brown, speckled reddish brown LEAN/FAT CLAY (Possible FILL)	1.0							CL-CH
3.3		Brown, speckled reddish brown LEAN/FAT CLAY (Possible FILL)							2.75	CL-CH
2.5		Brown, speckled reddish brown LEAN/FAT CLAY (Possible FILL)								CL-CH
3.0		Dark brown LEAN/FAT CLAY (Possible FILL)								CL-CH
5.0		Dark brown LEAN/FAT CLAY (Possible FILL)								CL-CH
8.5		Brown, spotted reddish brown FAT/LEAN CLAY								CH-CL
10.0		Brown, spotted reddish brown FAT/LEAN CLAY								CH-CL
13.0		SHALE (Very hard, very slow drilling)								SH
13.5		Brown, spotted reddish brown LEAN/FAT CLAY with trace Weathered LIMESTONE fragments (Very hard, very slow drilling)								CL-CH
14.0		End of boring at about 14.0 feet								



**LOG OF BORING
No. B6**

PROJECT: CLUB CARWASH OLDHAM VILLAGE DEVELOPMENT **PROJECT NO.:** 250480 E
CLIENT: CLUB CARWASH
PROJECT LOCATION: 1310 MARKET ST., LOT 9, LEE'S SUMMIT, MO 64081
LOCATION: SEE SITE SKETCH **ELEVATION:** N/D
DRILLER: KK **LOGGED BY:** NN
DRILLING METHOD: POWER AUGER **DATE:** 7/31/25
DEPTH TO - WATER> INITIAL: ∞ **AFTER 24 HOURS:** ∞ **CAVING>** C NONE

Elevation	Soil Symbols Sampler Symbols and Field Test Data	Description	w%	DDen pcf	LL	PI	200 %	Uncomp. psf	PPen. tsf	USCS/ Visual Class.
0		Brown LEAN CLAY (Possible FILL)								CL
		Dark brown LEAN/FAT CLAY (Possible FILL)	1.0							CL-CH
		Dark brown LEAN/FAT CLAY (Possible FILL)	2.5							CL-CH
		Brown, mottled reddish brown LEAN/FAT CLAY (Possible FILL)	3.5							CL-CH
		Brown, mottled reddish brown LEAN/FAT CLAY (Possible FILL)	5.0							CL-CH
		Brown, mottled reddish brown LEAN/FAT CLAY (Possible FILL)	8.5							CH-CL
		Reddish brown, spotted grayish brown FAT/LEAN CLAY	10.0							CH-CL
		End of boring at about 10.0 feet								

KEY TO SYMBOLS


Symbol Description

Symbol Description


Strata symbols

 LEAN CLAY

 LEAN/FAT CLAY


 FAT CLAY

 Weathered SHALE


 ASPHALT


 SHALE

Misc. Symbols

 Water table during drilling

Soil Samplers

 Standard penetration test

 Undisturbed thin wall Shelby tube

Notes:

1. Borings were drilled on July 31, 2025 using solid auger, split spoon sampler and shelly tube sampler techniques.
2. Ground water was encountered while drilling at reported depths.
3. Borings were staked by Alpha-Omega Geotech, Inc.
4. These logs are subject to the limitations, conclusions, and recommendations in this report.
5. Results of tests conducted on samples recovered are reported on the logs.

Abbreviations are:

DDen = natural dry density (pcf) LL = Liquid limit
w% = natural moisture content (%) PI = Plasticity index
UComp = Unconfined compression (psf) PPen = Pocket Penetrometer
-200 = percent passing #200 sieve (%) RQD = Rock Quality
DCP = Dynamic Cone Penetrometer

Important Information about This

Geotechnical-Engineering Report

Subsurface problems are a principal cause of construction delays, cost overruns, claims, and disputes.

While you cannot eliminate all such risks, you can manage them. The following information is provided to help.

The Geoprofessional Business Association (GBA) has prepared this advisory to help you – assumedly a client representative – interpret and apply this geotechnical-engineering report as effectively as possible. In that way, clients can benefit from a lowered exposure to the subsurface problems that, for decades, have been a principal cause of construction delays, cost overruns, claims, and disputes. If you have questions or want more information about any of the issues discussed below, contact your GBA-member geotechnical engineer. Active involvement in the Geoprofessional Business Association exposes geotechnical engineers to a wide array of risk-confrontation techniques that can be of genuine benefit for everyone involved with a construction project.

Geotechnical-Engineering Services Are Performed for Specific Purposes, Persons, and Projects

Geotechnical engineers structure their services to meet the specific needs of their clients. A geotechnical-engineering study conducted for a given civil engineer will not likely meet the needs of a civil-works constructor or even a different civil engineer. Because each geotechnical-engineering study is unique, each geotechnical-engineering report is unique, prepared *solely* for the client. *Those who rely on a geotechnical-engineering report prepared for a different client can be seriously misled.* No one except authorized client representatives should rely on this geotechnical-engineering report without first conferring with the geotechnical engineer who prepared it. *And no one – not even you – should apply this report for any purpose or project except the one originally contemplated.*

Read this Report in Full

Costly problems have occurred because those relying on a geotechnical-engineering report did not read it *in its entirety*. Do not rely on an executive summary. Do not read selected elements only. *Read this report in full.*

You Need to Inform Your Geotechnical Engineer about Change

Your geotechnical engineer considered unique, project-specific factors when designing the study behind this report and developing the confirmation-dependent recommendations the report conveys. A few typical factors include:

- the client's goals, objectives, budget, schedule, and risk-management preferences;
- the general nature of the structure involved, its size, configuration, and performance criteria;
- the structure's location and orientation on the site; and
- other planned or existing site improvements, such as retaining walls, access roads, parking lots, and underground utilities.

Typical changes that could erode the reliability of this report include those that affect:

- the site's size or shape;
- the function of the proposed structure, as when it's changed from a parking garage to an office building, or from a light-industrial plant to a refrigerated warehouse;
- the elevation, configuration, location, orientation, or weight of the proposed structure;
- the composition of the design team; or
- project ownership.

As a general rule, *always* inform your geotechnical engineer of project changes – even minor ones – and request an assessment of their impact. *The geotechnical engineer who prepared this report cannot accept responsibility or liability for problems that arise because the geotechnical engineer was not informed about developments the engineer otherwise would have considered.*

This Report May Not Be Reliable

Do not rely on this report if your geotechnical engineer prepared it:

- for a different client;
- for a different project;
- for a different site (that may or may not include all or a portion of the original site); or
- before important events occurred at the site or adjacent to it; e.g., man-made events like construction or environmental remediation, or natural events like floods, droughts, earthquakes, or groundwater fluctuations.

Note, too, that it could be unwise to rely on a geotechnical-engineering report whose reliability may have been affected by the passage of time, because of factors like changed subsurface conditions; new or modified codes, standards, or regulations; or new techniques or tools. *If your geotechnical engineer has not indicated an "apply-by" date on the report, ask what it should be, and, in general, if you are the least bit uncertain about the continued reliability of this report, contact your geotechnical engineer before applying it. A minor amount of additional testing or analysis – if any is required at all – could prevent major problems.*

Most of the "Findings" Related in This Report Are Professional Opinions

Before construction begins, geotechnical engineers explore a site's subsurface through various sampling and testing procedures. *Geotechnical engineers can observe actual subsurface conditions only at those specific locations where sampling and testing were performed.* The data derived from that sampling and testing were reviewed by your geotechnical engineer, who then applied professional judgment to form opinions about subsurface conditions throughout the site. Actual sitewide-subsurface conditions may differ – maybe significantly – from those indicated in this report. Confront that risk by retaining your geotechnical engineer to serve on the design team from project start to project finish, so the individual can provide informed guidance quickly, whenever needed.

This Report's Recommendations Are Confirmation-Dependent

The recommendations included in this report – including any options or alternatives – are confirmation-dependent. In other words, *they are not final*, because the geotechnical engineer who developed them relied heavily on judgment and opinion to do so. Your geotechnical engineer can finalize the recommendations *only after observing actual subsurface conditions* revealed during construction. If through observation your geotechnical engineer confirms that the conditions assumed to exist actually do exist, the recommendations can be relied upon, assuming no other changes have occurred. *The geotechnical engineer who prepared this report cannot assume responsibility or liability for confirmation-dependent recommendations if you fail to retain that engineer to perform construction observation.*

This Report Could Be Misinterpreted

Other design professionals' misinterpretation of geotechnical-engineering reports has resulted in costly problems. Confront that risk by having your geotechnical engineer serve as a full-time member of the design team, to:

- confer with other design-team members,
- help develop specifications,
- review pertinent elements of other design professionals' plans and specifications, and
- be on hand quickly whenever geotechnical-engineering guidance is needed.

You should also confront the risk of constructors misinterpreting this report. Do so by retaining your geotechnical engineer to participate in prebid and preconstruction conferences and to perform construction observation.

Give Constructors a Complete Report and Guidance

Some owners and design professionals mistakenly believe they can shift unanticipated-subsurface-conditions liability to constructors by limiting the information they provide for bid preparation. To help prevent the costly, contentious problems this practice has caused, include the complete geotechnical-engineering report, along with any attachments or appendices, with your contract documents, *but be certain to note conspicuously that you've included the material for informational purposes only.* To avoid misunderstanding, you may also want to note that "informational purposes" means constructors have no right to rely on the interpretations, opinions, conclusions, or recommendations in the report, but they may rely on the factual data relative to the specific times, locations, and depths/elevations referenced. Be certain that constructors know they may learn about specific project requirements, including options selected from the report, *only* from the design drawings and specifications. Remind constructors that they may

perform their own studies if they want to, and *be sure to allow enough time* to permit them to do so. Only then might you be in a position to give constructors the information available to you, while requiring them to at least share some of the financial responsibilities stemming from unanticipated conditions. Conducting prebid and preconstruction conferences can also be valuable in this respect.

Read Responsibility Provisions Closely

Some client representatives, design professionals, and constructors do not realize that geotechnical engineering is far less exact than other engineering disciplines. That lack of understanding has nurtured unrealistic expectations that have resulted in disappointments, delays, cost overruns, claims, and disputes. To confront that risk, geotechnical engineers commonly include explanatory provisions in their reports. Sometimes labeled "limitations," many of these provisions indicate where geotechnical engineers' responsibilities begin and end, to help others recognize their own responsibilities and risks. *Read these provisions closely.* Ask questions. Your geotechnical engineer should respond fully and frankly.

Geoenvironmental Concerns Are Not Covered

The personnel, equipment, and techniques used to perform an environmental study – e.g., a "phase-one" or "phase-two" environmental site assessment – differ significantly from those used to perform a geotechnical-engineering study. For that reason, a geotechnical-engineering report does not usually relate any environmental findings, conclusions, or recommendations; e.g., about the likelihood of encountering underground storage tanks or regulated contaminants. *Unanticipated subsurface environmental problems have led to project failures.* If you have not yet obtained your own environmental information, ask your geotechnical consultant for risk-management guidance. As a general rule, *do not rely on an environmental report prepared for a different client, site, or project, or that is more than six months old.*

Obtain Professional Assistance to Deal with Moisture Infiltration and Mold

While your geotechnical engineer may have addressed groundwater, water infiltration, or similar issues in this report, none of the engineer's services were designed, conducted, or intended to prevent uncontrolled migration of moisture – including water vapor – from the soil through building slabs and walls and into the building interior, where it can cause mold growth and material-performance deficiencies. Accordingly, *proper implementation of the geotechnical engineer's recommendations will not of itself be sufficient to prevent moisture infiltration.* Confront the risk of moisture infiltration by including building-envelope or mold specialists on the design team. *Geotechnical engineers are not building-envelope or mold specialists.*



Telephone: 301/565-2733

e-mail: info@geoprofessional.org www.geoprofessional.org