




- NOTES:

 1. BRANCH CIRCUIT CONDUCTOR SIZES SHALL MINIMALLY BE #12 AWG. WHERE THE LENGTH OF A HOMERUN, FROM PANEL TO FIRST DEVICE, EXCEEDS 75 FEET FOR A 120 VOLT CIRCUIT OR 175 FEET FOR A 277 VOLT CIRCUIT, THE MINIMUM CONDUCTOR SIZE SHALL BE #10 AWG.
- 2. DEVICES INSTALLED IN FIRE RATED WALLS SHALL BE INSTALLED IN ACCORDANCE WITH IBC ARTICLE 714.4.2. COORDINATE WALL TYPES WITH THE ARCHITECTURAL DRAWINGS.
- PLAN SHADING IDENTIFIES EXISTING LIGHTING, RECEPTACLES, EQUIPMENT WIRING, AND SYSTEMS WIRING TO REMAIN AND BE MAINTAINED UNLESS NOTED OTHERWISE (TYP).

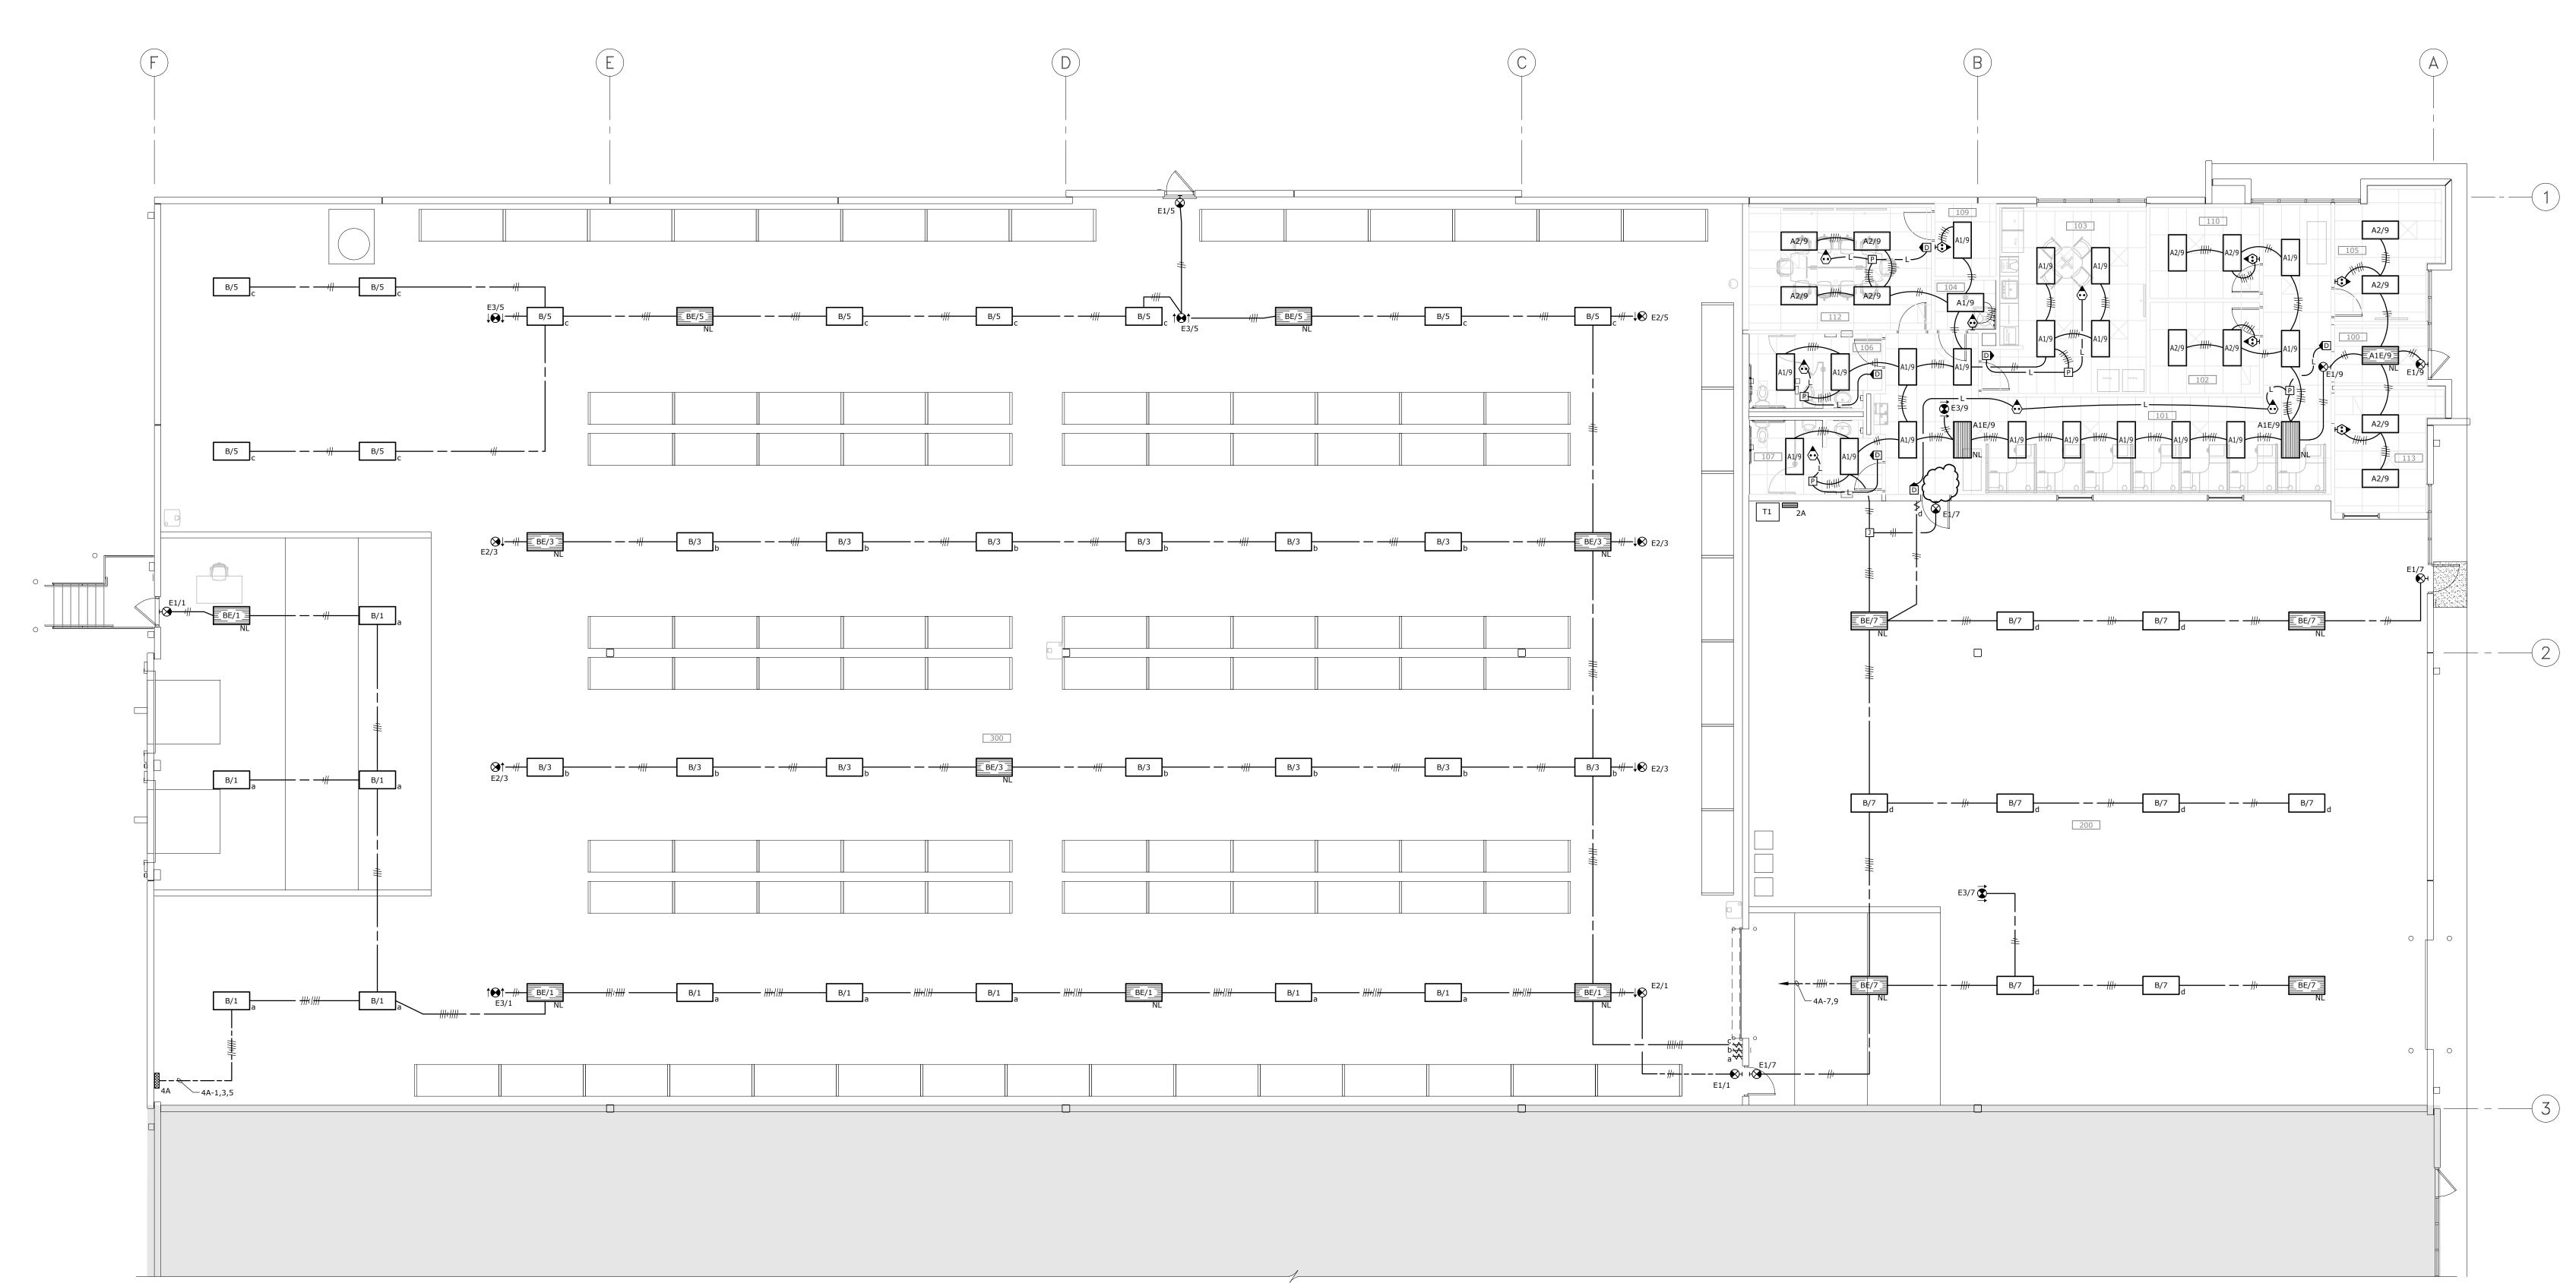

PROJECT #: 016-0402

The Foundation Architecture, LLC and their Consultants shall be deemed the authors and owners of their respective Instruments of Service and shall retain all common law, statutory and other reserved rights, including copyrights. The Instruments of Service shall not be used for future additions or alterations to this Project or for other projects, without the price within agreement of The Foundation Architecture, LLC April the prior written agreement of The Foundation Architecture, LLC. Any unauthorized use of the Instruments of Service shall be at the Owner's sole risk and without liability to The Foundation Architecture, LLC. and their Consultants The Foundation Architecture, LLC © 2025

DRAWN BY: PTA INC CHECKED BY: J.J.J

DRAWING TITLE: LIGHTING PLAN