
RELEASE FOR CONSTRUCTION AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI 09/15/2025

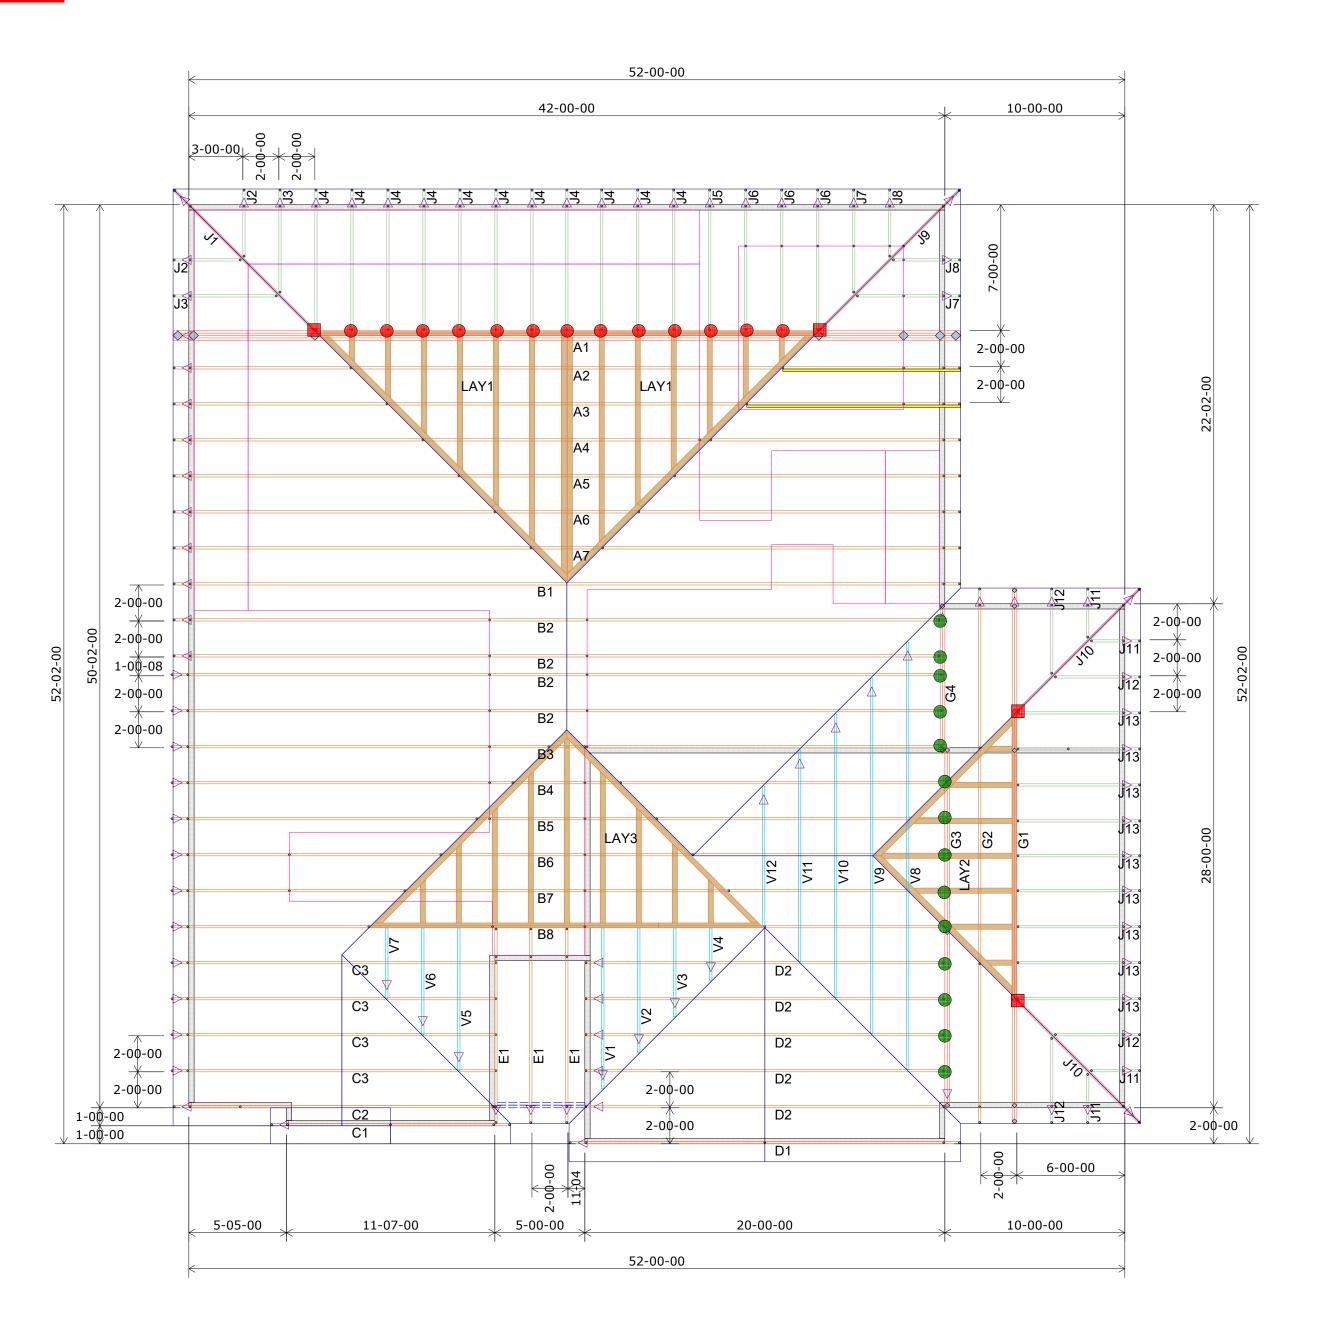

HANGER Quantity SCHEDULE LUS24 13 US26 0 HUS26 14 ▲ HHUS26-2 0 ▲ HGUS26-2 ▲ HGUS28-3 0 LTHJA26 4 0 TJC37 TJC57 0 △ HTS20 0 Triangle denotes the left end of the Truss as it appears on the Engineered Drawings Job Name Job Site A
City,
Designer
4/25/2024 provided. Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift

connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

EVERSTEAD SHOP DRAWINGS/SUBMITTAL REVIEW SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY
AND GENERAL CONFORMANCE TO CONTRACT
DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE
FOR CONFIRMING AND CORRELATING DIMENSIONS AT
JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

> **APPROVED AS** NOTED

STATUS:

REVIEWED BY: <u>HCJ</u>

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871



Roof Truss Layout
Scale: 3/16" = 1'