FIGURE 8.6.5.2.2 Suspended or Floor-Mounted Obstruction

**Elevation View** 

FIGURE 8.6.5.1.2(a) Positioning of Sprinkler to Avoid Ob-

struction to Discharge (SSU/SSP).

in Light Hazard Occupancies Only (SSU/SSP).

Horizontal Distance (A)	Minimum Vertical Distance Below Deflector (B) [in. (mm)]
6 in. (150 mm) or less	3 (75)
More than 6 in. (150 mm) to 9 in. (225 mm)	4 (100)
More than 9 in. (225 mm) to 12 in. (300 mm)	6 (150)
More than 12 in. (300 mm) to 15 in. (375 mm)	8 (200)
More than 15 in. (375 mm) to 18 in. (400 mm)	9½ (240)
More than 18 in. (400 mm) to 24 in. (600 mm)	12½ (315)
More than 24 in. (600 mm) to 30 in. (750 mm)	15½ (395)
More than 30 in. (750 mm)	18 (450)

For SI units, 1 in. = 25.4 mm.


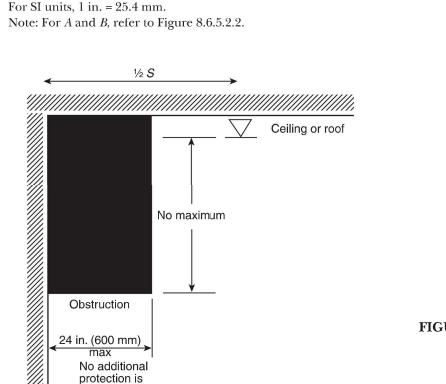


FIGURE 8.6.5.1.2(c) Obstructions Against Walls (SSU/SSP).

required



**Elevation View of Truss** (Obstruction in horizontal orientation)  $A \ge 3C \text{ or } 3D$   $A \le 24 \text{ in. (600 mm)}$ (Use dimension C or D, whichever is greater)


FIGURE 8.6.5.2.1.3(b) Minimum Distance from an Obstruction in the Horizontal Orientation (SSU/SSP).

8.6.6 Clearance to Storage (Standard Pendent and Upright **8.6.6.1** The clearance between the deflector and the top of storage shall be 18 in. (450 mm) or greater.

**8.6.6.2** The 18 in. (450 mm) dimension shall not limit the height of shelving on a wall or shelving against a wall in accordance with 8.6.6, 8.7.6, 8.8.6, and Section 8.9. **8.6.6.2.1** Where shelving is installed on a wall and is not directly below sprinklers, the shelves, including storage thereon, shall be permitted to extend above the level of a plane located 18 in. (450 mm) below ceiling sprinkler deflectors.

**8.6.6.2.2** Shelving, and any storage thereon, directly below the sprinklers shall not extend above a plane located 18 in. (450 mm) below the ceiling sprinkler deflectors. **8.6.6.3** Where other standards specify greater clearance to storage minimums, they shall be followed.

Table 8.6.5.1.2 Positioning of Sprinklers to Avoid

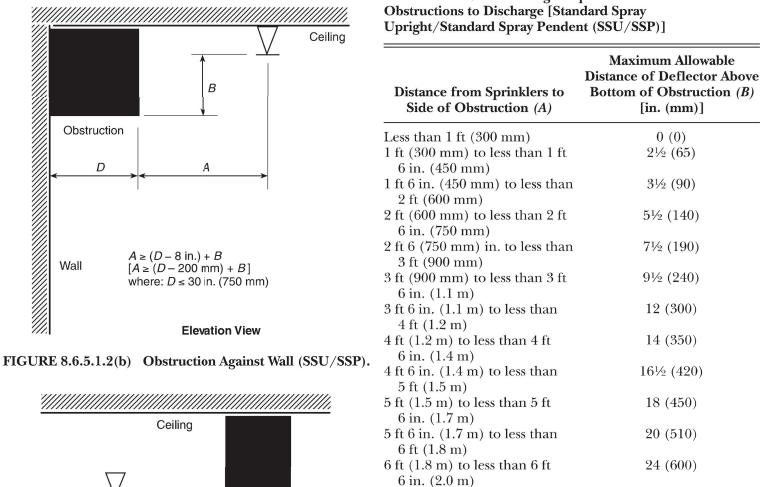

For SI units, 1 in. = 25.4 mm; 1 ft = 0.3048 m. Note: For A and B, refer to Figure 8.6.5.1.2(a).

30 (750)


35 (875)

6 ft 6 in. (2.0 m) to less than


7 ft (2.1 m) to less than 7 ft

7 ft (2.1 m)

6 in. (2.3 m)

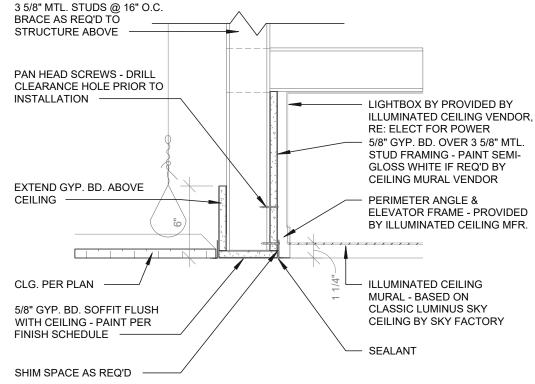

SHIM SPACE AS REQ'D	SEALANT
D3 SOFFIT DETAIL 1 1/2" = 1'-0"	

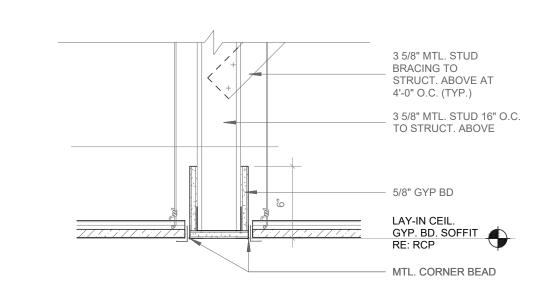

## CODE SUMMARY:

PROJECT CONSTRUCTION PURPOSE: NEW LINEAR ACCELERATOR VAULT WITH CONTROL ROOM, TWO DRESSING ROOMS, AND NEW ADA RESTROOM. ALL CONSTRUCTION TO BE INTERIOR RENOVATION WORK OF EXISTING SHELL SPACE.

OWNER: Saint Luke's East Hospital 100 NE Saint Luke's Blvd Lee's Summit, MO 64063

<u>DESIGNER:</u> ACI BOLAND ARCHITECTS 1710 WYANDOTTE ST. KANSAS CITY, MO 64108 PHONE: (816) 763-9600

## LOCAL AUTHORITY: RESPONDING FIRE SERVICE: CITY OF LEE'S SUMMIT MO LOCAL BUILDING INSPECTION: CITY OF LEE'S SUMMIT MO

LOCAL BUILDING INSPECTION: CITY OF LEE'S SU
CODE INFORMATION:
2018 INTERNATIONAL BUILDING CODE
2018 INTERNATIONAL PLUMBING CODE
2018 INTERNATIONAL MECHANICAL CODE
2017 NATIONAL ELECTRICAL CODE (NFPA 70)

2018 INTERNATIONAL FIRE CODE 2012 LIFE SAFETY CODE (NFPA 101 CHAPTER 20) 2009 ICC/ANSI A117.1 AS AMENDED AND ADOPTED BY THE CITY OF LEE'S SUMMIT 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN / AMERICANS WITH DISABILITIES ACT OF 1990 STATE OF MISSOURI DEPT. OF HEALTH & ENVIRONMENT REFERENCES THE FOLLOWING CODES: 2012 NFPA 101 LIFE SAFETY CODE (LSC) 2018 FGI GUIDELINES FOR DESIGN & CONSTRUCTION OF HOSPITALS & OUTPATIENT FACILITIES 1979 19-CSR-30 NOTE: IF CODE REQUIREMENTS OVERLAP, THE MOST STRINGENT SHALL APPLY

TYPE OF CONSTRUCTION: TYPE 1-A -SECTION 602.2 (TYPE 1 - 332 SPRINKLERED - SECTION 18.1.6.1)

**OCCUPANCY GROUP:** OCCUPANT LOAD:
TOTAL SQUARE FOOTAGE: SF / = TOTAL NUMBER OF OCCUPANTS = DEAD END CORRIDOR LENGTH LIMIT:

**AREA OF CONSTRUCTION:** REQUIRED FIRE RESISTANCE RATINGS (IN HOURS) PER NFPA 101 A.8.2.1.2: EXTERIOR BEARING WALLS INTERIOR BEARING WALLS

## SYSTEM. THE DEVICE TYPE AND LOCATIONS ARE PER THE APPLICABLE CODES AS WELL AS ADA REQUIREMENTS.

- SMOKE CONTROL SYSTEM - ALL DUCTWORK PENETRATING SMOKE RATED WALLS WILL HAVE A SMOKE OR COMBINATION FIRE/SMOKE DAMPER AS INDICATED ON CONSTRUCTION DOCUMENTS. THESE DAMPERS WILL CLOSE UPON DETECTION OF SMOKE BY THE AREA SMOKE DETECTORS OR DUCT SMOKE DETECTORS IN THE AIR HANDLING UNITS.

- FIRE SPRINKLER SYSTEM - SPECIFIED TO BE PER NFPA 13. THE SPRINKLER HEADS ARE SPECIFIED TO BE QUICK RESPONSE TYPE.

## - EMERGENCY LIGHTING AND POWER - EMERGENCY LIGHTING, LIFE SAFETY AND CRITICAL LOADS WILL RECEIVE POWER FROM A BACKUP GENERATOR LOCATED OUTSIDE THE MAIN ELECTRICAL

- ILLUMINATED EXIT SIGNS

PASSIVE FIRE SAFETY FEATURES:

- SMOKE COMPARTMENTS NO GREATER THAN 22,500 SF

I-2 -SECTION 308.3 (HEALTHCARE - SECTION 6.1.5) CORRIDOR, PATIENT ROOMS, OFFICES, ETC.. LIGHT HAZARD 0.10 GPM/S.F. FOR 1500 S.F. MAXIMUM 225 S.F. SPRINKLER SPACING 100 GPM HOSE ALLOWANCE MECHANICAL ROOMS, STORAGE ROOMS, ETC.. **EXIT ACCESS TRAVEL DISTANCE:** ORDINARY HAZARD GROUP II 0.20 GPM/S.F. FOR 1500 S.F. MAXIMUM 130 S.F. SPRINKLER SPACING 1,460+/- SF 250 GPM HOSE ALLOWANCE PLAN NOTES: 1. ALL CEILING HEIGHTS TO BE 9'-0" ABOVE FINISHED FLOOR UNLESS NOTED OTHERWISE. 3 HR PRIMARY STRUCTURAL FRAME 3 HR 2. SPRINKLERS SHALL BE CENTERED IN THE NARROW DIMENSION OF CEILING FLOOR CONSTRUCTION TILES, AS SPECIFIED (211313-3.6.A). ROOF CONSTRUCTION INTERIOR NON-BEARING WALLS 0 HR 3. ALL THREADED PIPING IS TO BE ALLIED "SCHEDULE 40" WITH THREADED CAST IRON FITTINGS. PLUMBING FIXTURE CALCULATIONS: EXISTING TO REMAIN 4. ALL GROOVED PIPING IS TO BE SCH. 10 PIPE, ASTM A-795 NO CHANGE IN OCCUPANCY WITH ROLLED GROOVED ENDS. ALL FITTINGS TO BE IRON GROOVED OR WELDED STEEL OUTLETS. <u>ACTIVE FIRE SAFETY FEATURES:</u>
- FIRE ALARM SYSTEM - THE FIRE ALARM SYSTEM IS SPECIFIED AS AN ADDRESSABLE TYPE CONSTRUCTION:

CONCRETE SLAB, CONCRETE BEAMS AND TEES 8.6.5.2.2.1

IN LIGHT HAZARD OCCUPANCIES, PRIVACY CURTAINS SHALL NOT BE CONSIDERED OBSTRUCTIONS WHERE ALL OF THE FOLLOWING AREA MET: (1) THE CURTAINS ARE SUPPORTED BY FABRIC MESH ON CEILING TRACK. (2) OPENINGS IN THE MESH ARE EQUAL TO 70 PERCENT OR GREATER. (3) THE MESH EXTENDS A MINIMUM OF 22 INCHES DOWN FROM CEILING.

GENERAL NOTES: ALL FITTINGS CONFORM TO SECTION 2-4 OF NFPA PAMPHLET 13.

AND OTHER VALVES IN SUPPLY PIPES TO SPRINKLERS SHALL BE

SUPERVISED OPEN BY AN APPROVED METHOD.

THIS DRAWING TO COMPLY WITH THIS RULE.

€ = CENTER LINE OF PIPE BELOW TOP OF STEEL

DESIGN CRITERIA:

TYPE OF CONSTRUCTION: SEE CODE SUMMARY

AREA OF CONSTRUCTION: SEE CODE SUMMARY

BUILDING CODE: SEE CODE SUMMARY

OCCUPANCY: SEE CODE SUMMARY

PER NFPA 13, 2016 EDITION:

SYSTEM TYPE: WET (EXISTING)

EL = CENTER LINE OF PIPE ABOVE FINISHED FLOOR

SWITCHES (IF REQUIRED) TO BE DONE BY OTHERS.

HANGERS TO BE SPACED TO MEET NFPA REQUIREMENTS

THE SPRINKLER SYSTEM FROM FREEZING.

VALVES ON CONNECTIONS TO WATER SUPPLIES, SECTIONAL CONTROL VALVES

IT IS THE OWNERS RESPONSIBILITY TO PROVIDE ADEQUATE HEAT TO KEEP

ALL ELECTRICAL WIRING OF ALARM BELLS, FLOW SWITCHES AND TAMPER

THE SPRINKLER SYSTEM TO BE INSTALLED IN ACCORDANCE WITH NFPA 13.

PER NFPA 13, SECTION 8.6.3.2.4, WITHIN SMALL ROOMS AS DEFINED IN

SECTION 3.3.20, SPRINKLERS SHALL BE PERMITTED TO BE LOCATED NOT


8.6.2.2.1(a) SHALL NOT BE EXCEEDED. JFS MAY MODIFY HEADS SHOWN ON

MORE THAN 9 FT. FROM ANY SINGLE WALL, AND SPRINKLER SPACING

LIMITATIONS OF SECTION 8.6.3 AND AREA LIMITATIONS OF TABLE



Lee's Summit Fire Department Lee's Summit, Missouri 09/18/2025



NORTH

AREA OF CONSTRUCTION

MISSOURI PE COA #201602567 Engineering, LLC

1624 N Glen Ellyn
Independence, MO 64056


CHRISTOPHER T. GROSS

816-516-9540 SPRINKLER LEGEND VK302 CHROME 155° 1/2" 5.6 K VK608 CHROME 155° 3/4" 11.2 K

DRAWING NUMBER 1ST FLOOR

1 OF 1

VIKING MICROFAST Q.R. PENDENT

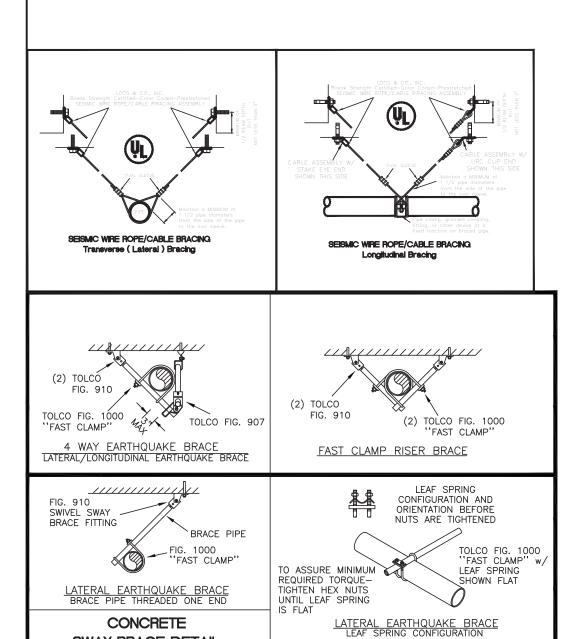

SWAY BRACE DETAIL

304 S.S. FLEXIBLE BRAIDED HOSE (1"Ø NOMINAL) (LENGTHS 31", 48", 60", & 72")

COLLAR


ADAPTER RING


DROP CEILING TILE—


SQUARE BAR


SHEET METAL


(AVAILABLE IN 24" AND 48" LENGTHS)

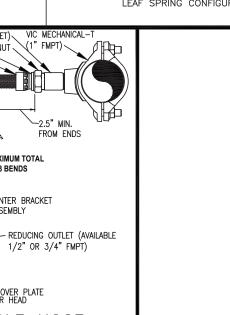


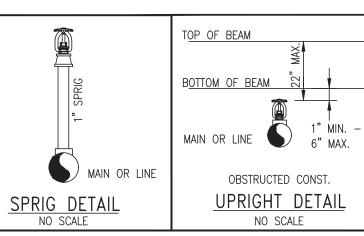


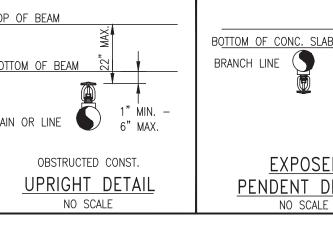

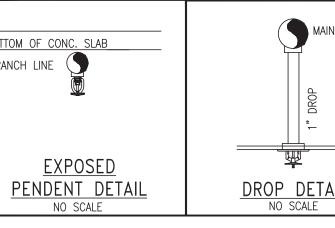







FIRST FLOOR SPRINKLER PLAN

1-All Thread Rod 1-HILTI Shield TYPICAL HANGER NO SCALE

NO WORK IN THIS AREA, EXISTING SPRINKLERS

SPRINKLERS ARE PERMITTED TO BE RELOCATED AND RE-INSTALLED

WHEN THE SPRINKLER BEING REMOVED FROM THE SYSTEM REMAINS

ATTACHED TO THE ORIGINAL FITTING OR WELDED OUTLET, PROVIDED

CARE HAS BEEN TAKEN TO ENSURE THE SPRINKLER HAS NOT BEEN

DAMAGED. PER NFPA 13, WHEN A SPRINKLER HAS BEEN REMOVED

FROM A FITTING OR WELDED OUTLET, IT SHALL NOT BE RE-INSTALLED.

TO PROVIDE ADEQUATE COVERAGE.

PROVIDE NEW SPRINKLERS AS REQUIRED.

-All Thread Rod 1-HILŤI Kwik Anchor 夏벌본 TYPICAL HANGER
NO SCALE

CAULK BEAD PENETRATION FIRESTOP DETAIL FOR RATED CONSTRUCTION ONLY SEE FIRE STOP SUPPLEMENT SHEETS FOR INFO TYP. FIRESTOP DETAIL

NO SCALE

COMPATIBLE.\*\* PIPE END CAP

\*\*ALL SPRINKLER PIPING PASSING

THROUGH FIRE RATED ASSEMBLIES

SHALL BE FIRESTOPPED BY OTHERS.

FIRE STOPPING MATERIAL SHALL BE

SUITABLE FOR THE PIPE MATERIAL

IN USE AND THE ASSEMBLY

PENETRATED.\*\*

\*\*SEALANTS USED FOR CPVC MATERIALS SHALL BE FBC SYSTEM SYMBOL

DESCRIPTION SYMBOL ETR EXISTING SPRINKLER TO REMAIN O ETR | EXISTING RISER NIPPLE TO REMAIN FIRE SPRINKLER STANDPIPE POINT OF CONNECTION NEW SPRINKLER LINE EXISTING SPRINKLER LINE HANGER LOCATION

RELOCATED SPRINKLER FROM EXISTING OUTLET CHANGED EXISTING SPRINKLER FROM S.R. TO Q.R. SYMBOL A ADDED SPRINKLER FROM EXISTING SPRINKLER SYSTEM SYMBOL NEW SPRINKLER BEING INSTALLED FROM NEW SYSTEM SYMBOL R EXISTING SPRINKLER TO BE RELOCATED/REPLACED

SPRINKLER RELOCATION LEGEND

▼ VIKING MICROFAST Q.R.E.C. ELO PENDENT

CHECKED BY: SB

**APPROVAL** ISSUE DATE: 08/28/2025 PLOT DATE: 08/29/2025 **FIRE PROTECTION SPRINKLER SYSTEM**