



Professional Service Industries, Inc.
2828 South 44th Street
Kansas City, KS 66106

Phone: (913) 310-1600
Fax: (913) 310-1601

Report No: PTR:03534146-3-S1

Issue No: 1

Proctor Report

These test results apply only to the specific locations and materials noted and may not represent any other locations or elevations. This report may not be reproduced, except in full, without written permission by Professional Service Industries, Inc. If a non-compliance appears on this report, to the extent that the reported non-compliance impacts the project, the resolution is outside the PSI scope of engagement.

Client: HCA MANAGEMENT SERVICES, LP
P.O. BOX 550, BLDG 3-2
NASHVILLE, TN 37202-0550

CC: DAVID PANTO
DON KELLEY
ERIC SJODIN


Project: LEE'S SUMMIT MEDICAL CENTER
LEE'S SUMMIT, MO

Approved Signatory: Mahdi Sahafnia (Staff Engineer)
Date of Issue: 10/13/2025

Sample Details

Sample ID:	03534146-3-S1	Date Sampled:	9/9/2025
Sampled By:	Mahdi Sahafnia	Specification:	95 +/-2
Source:	In-place material	Material:	Dark Brown XXX Clay w/gravel
Sampling Method:		Location:	

Dry Unit Weight - Water Content Relationship

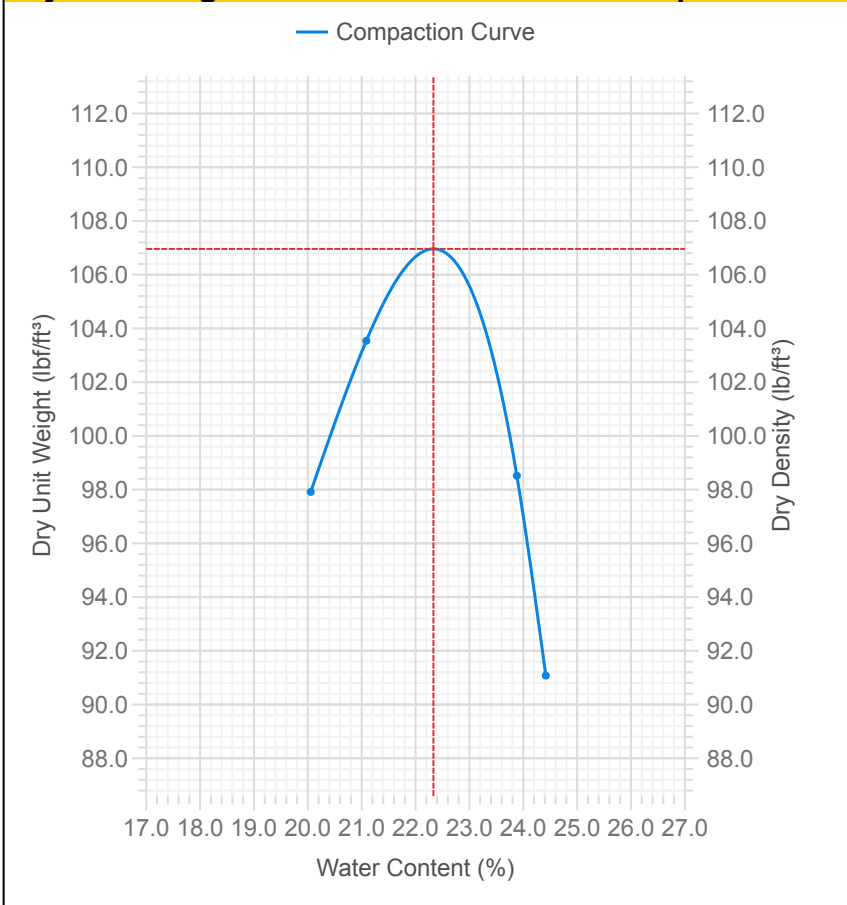

Test Results

ASTM D698

Std. Maximum Dry Unit Weight (lb/ft³):	107.0
Std. Optimum Water Content (%):	22.3
Method:	
Preparation Method:	Dry
Rammer Type:	Automatic
Determined By:	Estimated
Tested By:	
Date Tested:	

ASTM D4318

Liquid Limit:	
Plastic Limit:	
Plasticity Index:	
Tested By:	
Date Tested:	

Comments