

DOUGLAS STATION

NW SLOAN & NE SYCAMORE ST
LEES SUMMIT, MO 64086

POOL CONSTRUCTION DOCUMENTS

OCTOBER 13, 2025

PREPARED BY:



8021 SANTA FE DRIVE, SUITE 200
OVERLAND PARK, KS 66204
913.972.7244

WWW.LORAXDESIGNGROUP.COM

SHEET INDEX

W001	POOL PLAN
W002	POOL ELECTRICAL PLAN
W003	POOL PLUMBING PLAN
W101	POOL STRUCTURAL DETAILS
W102	POOL STRUCTURAL DETAILS
W103	POOL CROSS SECTIONS
W104	POOL DETAILS
W105	POOL DETAILS
W106	POOL DETAILS
W107	POOL DETAILS



DOUGLAS STATION
NW SLOAN & NE SYCAMORE ST
LEE'S SUMMIT, MO 64086

DETAILS LEGEND

KEY	DETAIL	DESCRIPTION	SHEET
1	ADA ACCESSIBLE POOL LIFT	SPECTRUM AQUATICS ADA ACCESSIBLE POOL LIFT WATER DEPTH SHALL NOT EXCEED 48" AT LIFT LOCATION	2 W106
2	POOL LADDER	BONDED S.R. SMITH SNAP-LOG POOL LADDER	9 W103 & W107
3	SKIMMER	HAYWARD 1082 POOL SKIMMER	5 W107
4	HANDRAIL	HANDRAIL AT POOL STEPS & ENTRY REEF	1, 4 & 8 W103
5	POOL STAIRS	12" DEPTH STAIR TREADS W/ 2" WIDE TILE OF CONTRASTING COLOR AT BOTH VERTICAL AND HORIZONTAL LEADING EDGE OF EA. STEP, TYP.	4 W103
6	ENTRY REEF	POOL ENTRY REEF, PROVIDE 2" TILE OF CONTRASTING COLOR W/ INTERIOR FINISH AT BOTH VERTICAL AND HORIZONTAL LEADING EDGE OF REEF, TYP.	3 W103
7	NO DIVING MARKERS	6"x6" NO DIVING MARKERS AND 6"x6" DEPTH MARKERS (TYP) NON-SKID TILE MARKERS ON TOP OF WALL AND INSIDE FACE OF POOL WALL W/ 4" HIGH BLOCK LETTERS AND NUMBER, IMBED FLUSH W/ POOL DECK	10 W104
8	AUTOMATIC POOL COVER VAULT	COVERSTAR AUTOMATIC POOL COVER VAULT WITH SUPPORT BRACKETS, ALUMINUM RECESSED LID & TRAVERTINE COPING	7 W103 & W107
9	EMERGENCY SHUTOFF	POST MOUNTED EMERGENCY SWIMMING POOL SHUTOFF	4 W106
10	POOL ENCLOSURE FENCE	RE: LANDSCAPE	RE: LANDSCAPE
11	EMERGENCY PHONE	PROVIDE EMERGENCY TELEPHONE AT POOL ENCLOSURE. PROVIDE SIGNAGE WITH PROPERTY ADDRESS AND EMERGENCY SERVICES PHONE NUMBER AT NEXT TO PHONE. SLOPE AWAY FROM POOL AT 1" PER FOOT. SEE LANDSCAPE DRAWINGS FOR GRADING AND SPECIFICATIONS.	-
12	POOL DECK	RE: LANDSCAPE	RE: LANDSCAPE
13	POOL SIGNAGE	PROVIDE SIGNAGE INDICATING POOL RULES, NO LIFEGUARD ON DUTY, AND NO DIVING	-

POOL MATERIAL LEGEND

MATERIAL	DESCRIPTION
COPING	3cm TRAVERTINE COPING
WATERLINE TILE	6"x6" COBALT BLUE WATERLINE TILE
PLASTER	WHITE MARCITE PLASTER
MARKER TILE	2"x2" NON-SKID TILE AT HORIZONTAL & VERTICAL LEADING EDGES OF ALL STEPS - CONTRASTING COLOR TO POOL PLASTER



BATHER LOAD

PER KANSAS CITY, MO HEALTH DEPARTMENT PUBLIC HEALTH RULES & REGULATIONS FOR THE OPERATION & MAINTENANCE OF SWIMMING POOLS & BATHING FACILITIES:

POOL SURFACE AREA > 5' DEPTH @ 30 SF / BATHER = 0
POOL SURFACE AREA < 5' DEPTH @ 15 SF / BATHER = 1,000


1,000 / 15 = 66 PERSONS SWIMMING POOL BATHER LOAD

POOL CONSTRUCTION NOTES


- ANY METAL WITHIN 5' OF WATERS EDGE SHALL BE BONDED
- POOL DECK SHALL SLOPE AWAY FROM SWIMMING POOL
- POOL ENCLOSURE & GATE TO MEET LOCAL & NATIONAL STANDARDS, PROVIDED BY OTHERS
- ALL ELEVATIONS SHOWN ON THIS SHEET ARE BASED ON AN ASSUMED WATER ELEVATION OF 100.00. SPOT ELEVATIONS DO NOT CORRELATE TO A SURVEY OR ANY BENCHMARK. TRUE WATER AND COPING ELEVATIONS ARE INDICATED ON GRADING PLAN. CONTRACTOR SHALL CORRELATE ASSUMED POOL FLOOR/WATER/COPING ELEVATIONS ON THIS PLAN TO TRUE POOL DECK AND WATER ELEVATIONS SHOWN ON GRADING PLAN IN ORDER TO ACHIEVE THE POOL WATER DEPTHS SHOWN ON THIS PLAN.
- POOL SHELL SHALL BE WATERPROOFED WITH AN APPROVED WATERPROOFING SYSTEM. SUBMIT PRODUCT DATA TO THE ARCHITECT FOR APPROVAL PRIOR TO CONSTRUCTION.

POOL SAFETY NOTES


- PROVIDE SHEPHERD'S CROOK. SHEPHERD'S CROOK SHALL BE AFFIXED TO A TELESCOPING POLE WITH ADEQUATE LENGTH TO REACH THE BOTTOM CENTER OF THE POOL
- PROVIDE RING BUOY W/ MINIMUM 30' THROW LINE
- EMERGENCY POOL SHUTOFF TO BE PROVIDED NEAR POOL
- PROVIDE LAND LINE EMERGENCY TELEPHONE WITHIN ENCLOSED POOL AREA ALONG WITH SIGN INDICATING THE LOCATION
- ACCESS TO POOL ENCLOSURE SHALL BE LIMITED TO REGULAR POOL HOURS. THIS INCLUDES RESTRICTING ACCESS FROM DOORS WHICH OPEN TO POOL ENCLOSURE
- SAFETY SIGNAGE ADVISING ON THE DANGER OF DIVING INTO SHALLOW AREAS AND ON THE PREVENTION OF DROWNING SHALL BE PROVIDED
- SIGNS SHALL BE POSITIONED FOR EFFECTIVE VISUAL OBSERVATION BY USERS

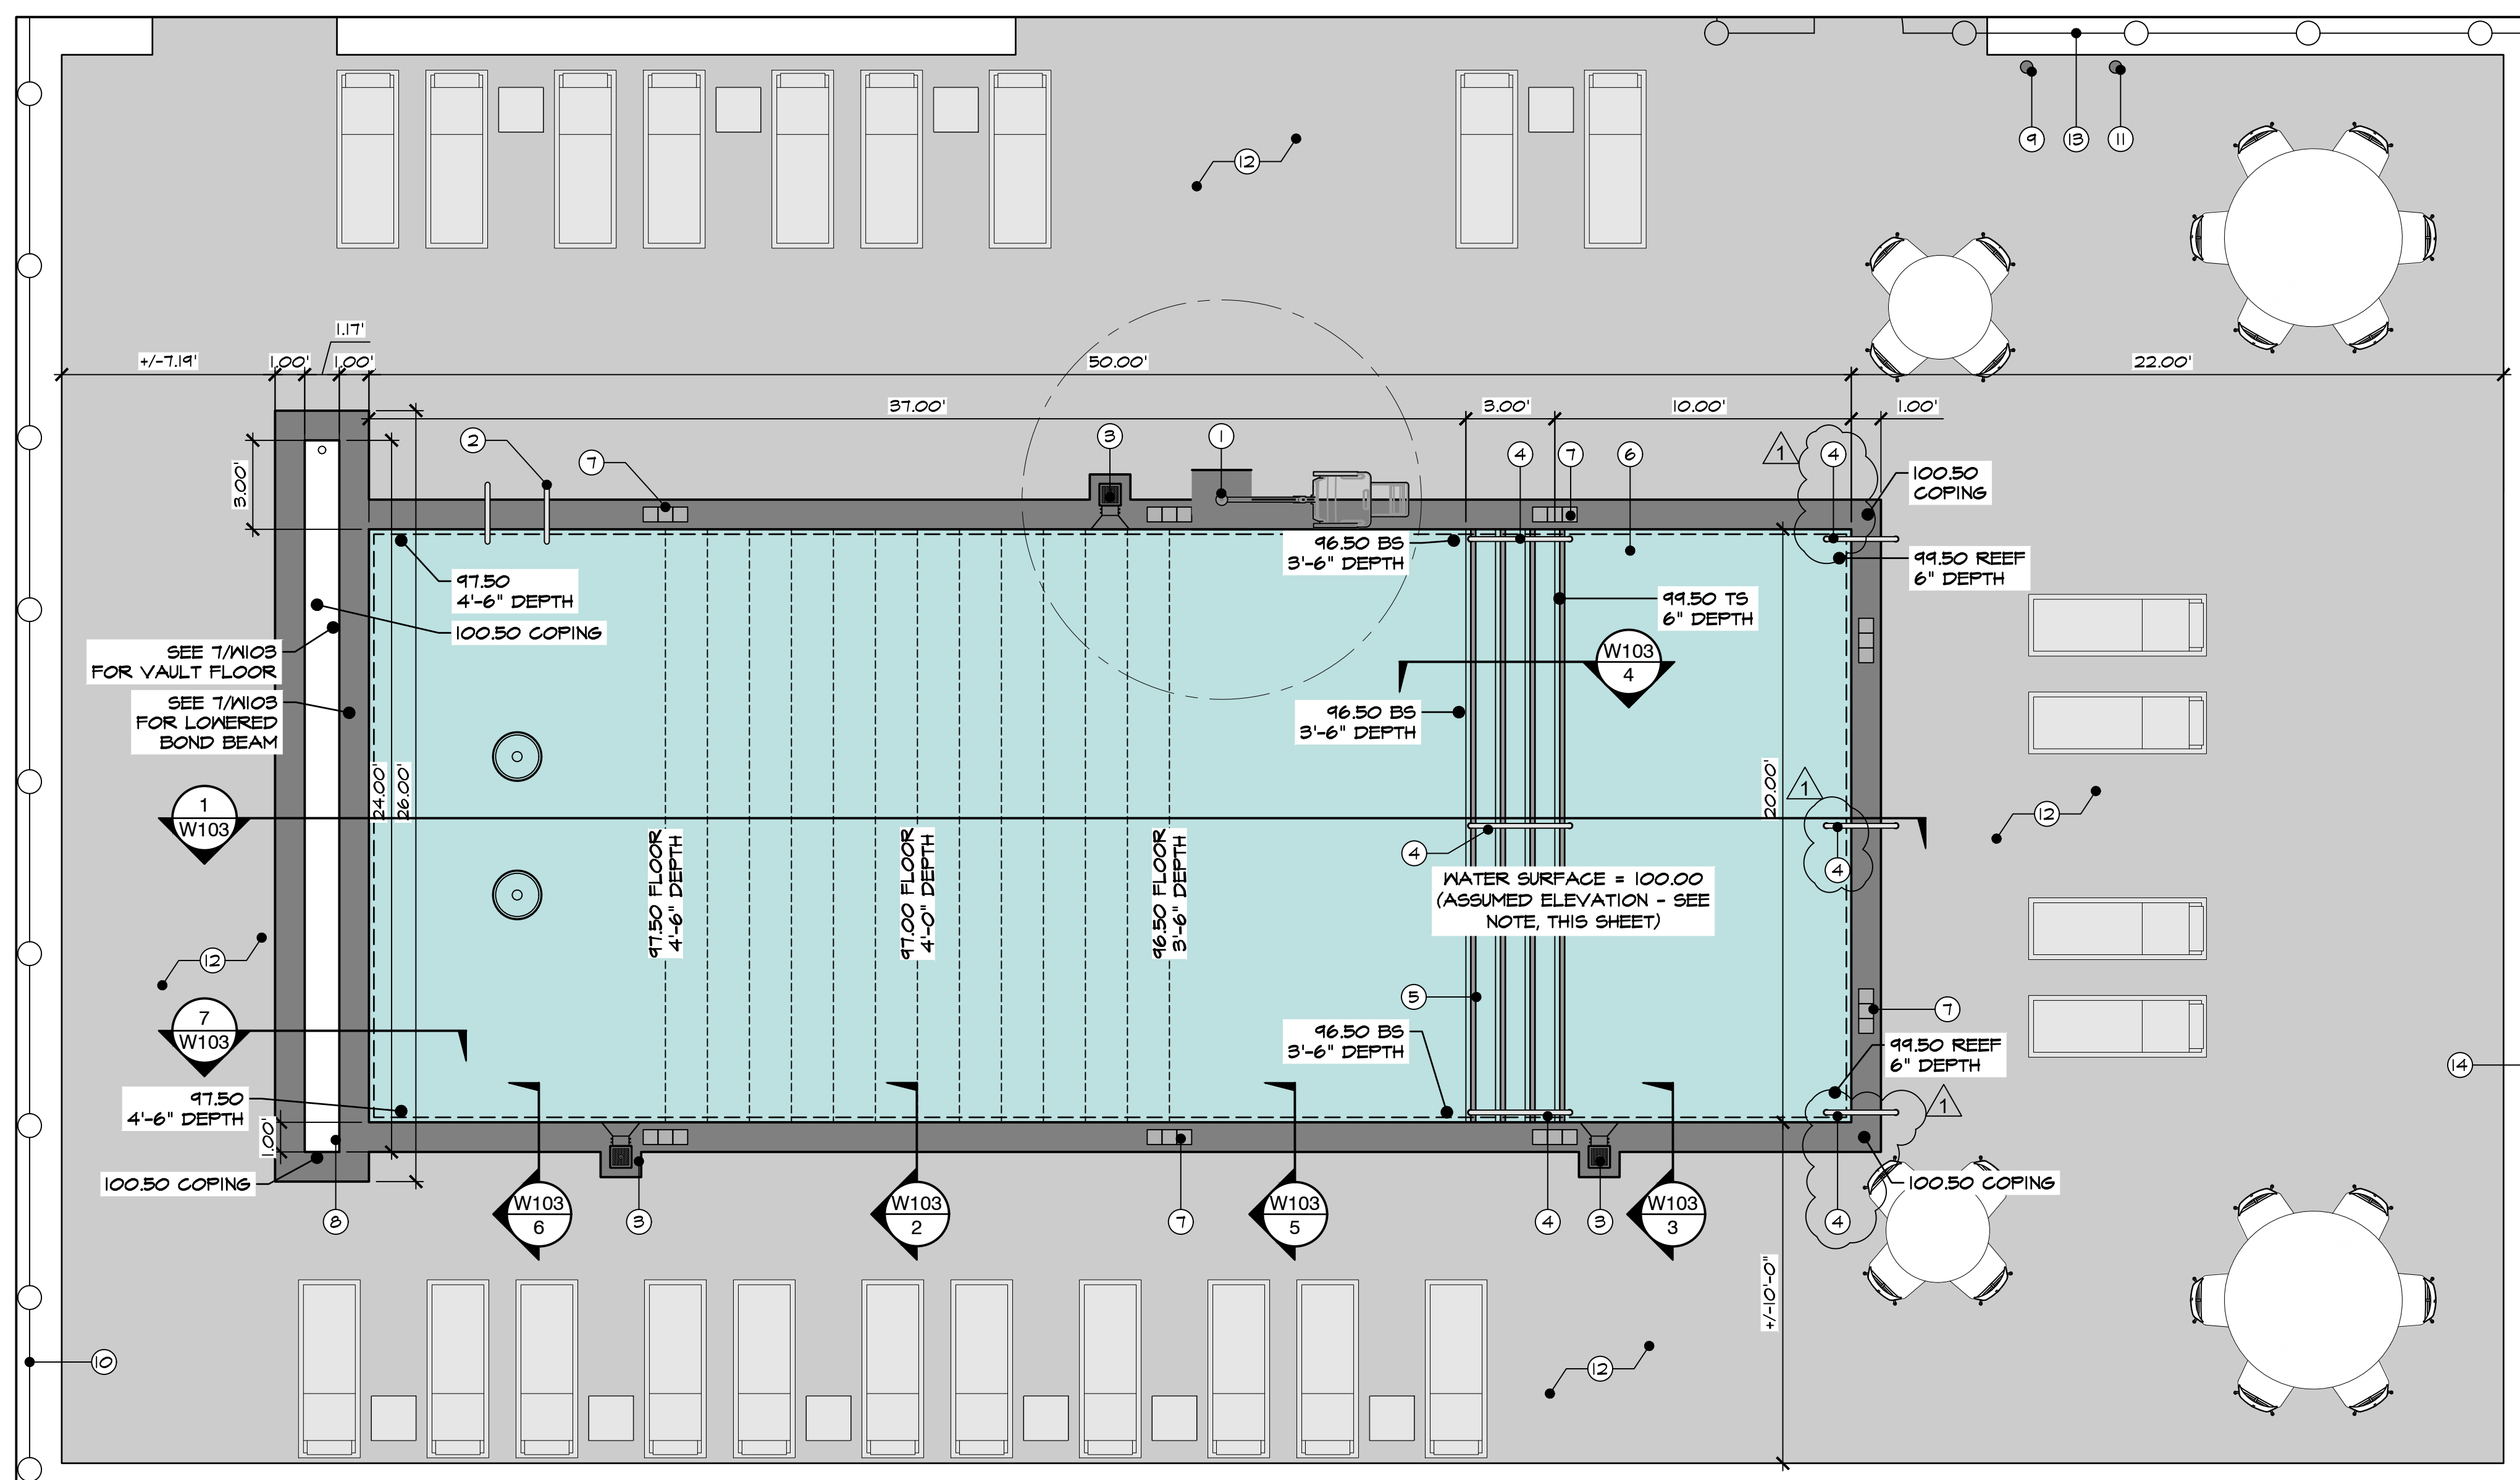


POOL LAYOUT PLAN
SCALE: 1/4" = 1'-0"

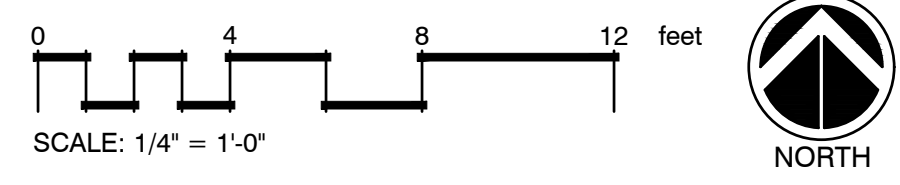

NOTE: THIS IS NOT A DIVING POOL

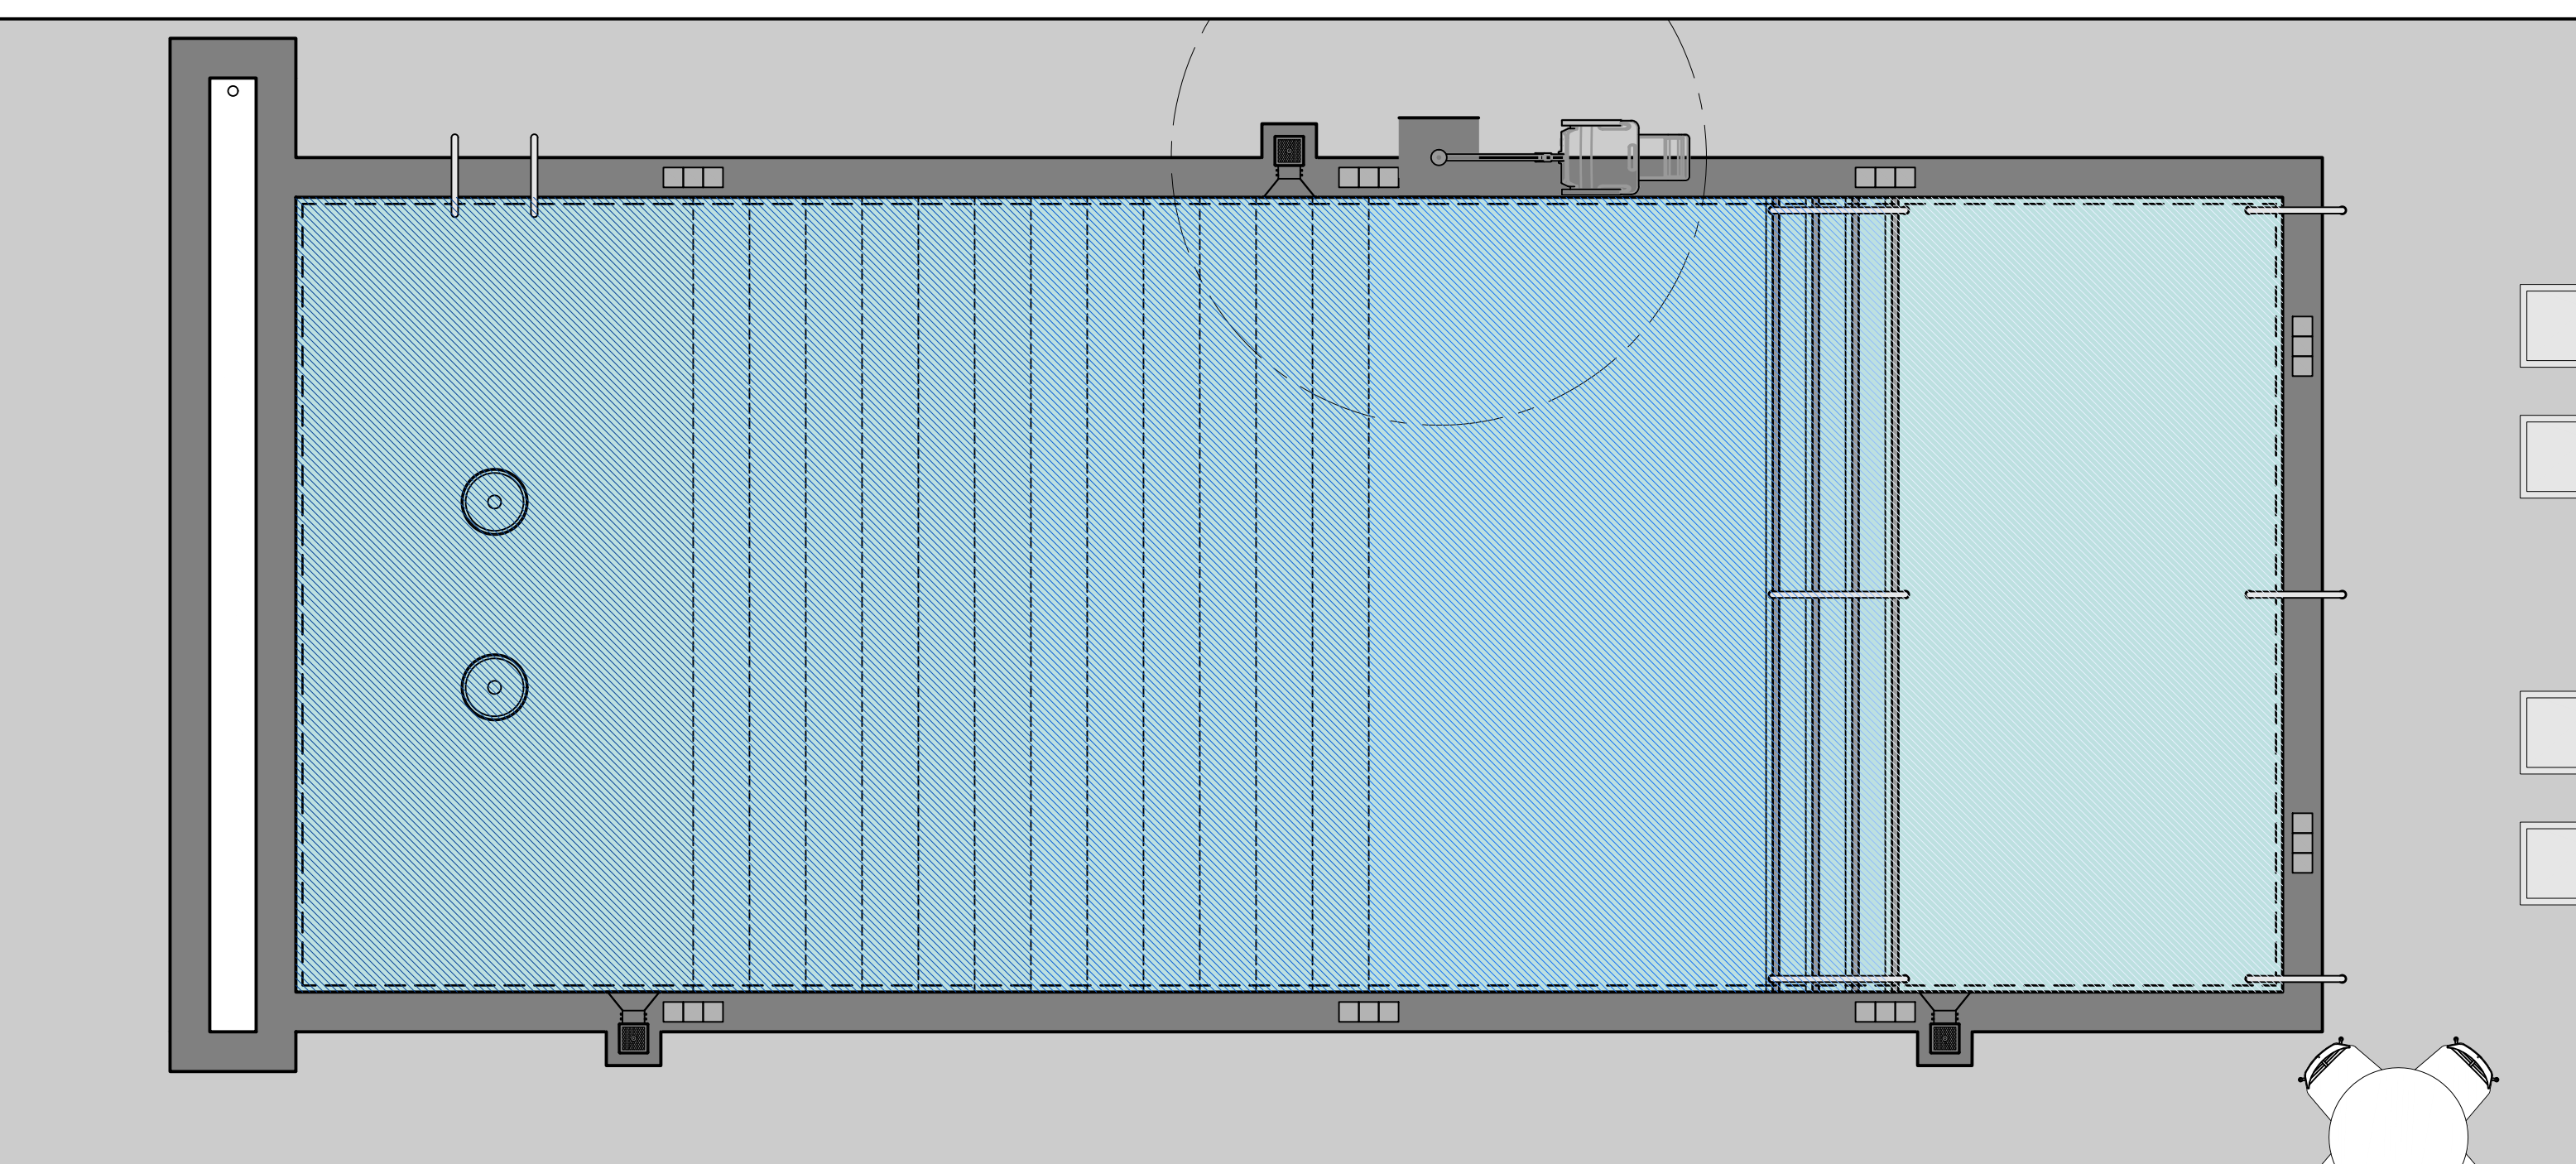

ILLUSTRATIVE WATER DEPTH PLAN
SCALE: 1" = 4'-0"

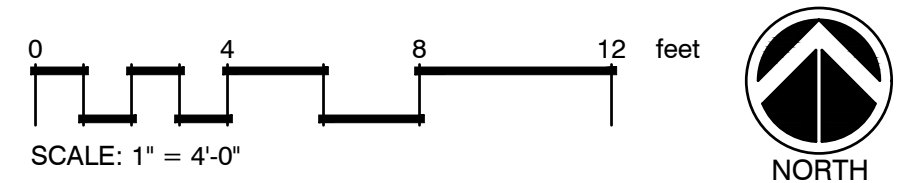

POOL WATER DEPTH


- 0' - 6" WATER DEPTH
- 6" - 1'-3" WATER DEPTH
- 1'-3" - 2'-0" WATER DEPTH
- 2'-0" - 2'-4" WATER DEPTH
- 2'-4" - 3'-6" WATER DEPTH
- 3'-6" - 4'-0" WATER DEPTH
- 4'-0" - 4'-6" WATER DEPTH
- +/- 4'-6" WATER DEPTH

REVISION:

1	CITY COMMENTS	10/27/2025
---	---------------	------------

10/13/2025
POOL PLAN

W001

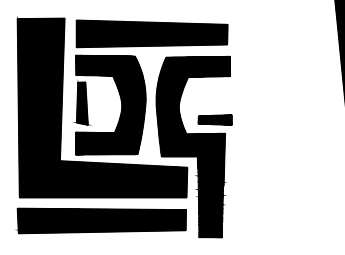

LORAX DESIGN GROUP
8021 SANTA FE DRIVE
OVERLAND PARK, KS 66204
WWW.LORAXDESIGNGROUP.COM



10.13.2025

DOUGLAS STATION
NW SLOAN & NE SYCAMORE ST
LEE'S SUMMIT, MO 64086

REVISION:

10/13/2025
POOL ELECTRICAL PLAN

W002

POOL GROUNDING & BONDING TECHNICAL NOTES

TECHNICAL NOTES:
*680.26 EQUIPOTENTIAL BONDING * (SUMMARIZED)
(A) PERFORMANCE, THE EQUIPOTENTIAL BONDING REQUIRED BY THIS SECTION SHALL BE INSTALLED TO REDUCE VOLTAGE GRADIENTS IN THE POOL AREA.

(B) BONDED PARTS, THE PARTS SPECIFIED IN 680.26(B)(1) THROUGH (B)(7) SHALL BE BONDED TOGETHER USING SOLID COPPER CONDUCTORS, INSULATED COVERED, OR BARE, NOT SMALLER THAN 8 AWG OR WITH RIGID METAL CONDUIT OF BRASS OR OTHER IDENTIFIED CORROSION-RESISTANT METAL. CONNECTIONS TO BONDED PARTS SHALL BE MADE IN ACCORDANCE WITH 250.8**. AN 8 AWG OR LARGER SOLID COPPER CONDUCTOR PROVIDED TO REDUCE VOLTAGE GRADIENTS IN THE POOL AREA SHALL NOT BE REQUIRED OR ATTACHED TO REMOTE PANELBOARDS, SERVICE EQUIPMENT, OR ELECTRODES.

(1) CONDUCTIVE POOL SHELLS, BONDING TO CONDUCTIVE POOL SHELLS SHALL BE PROVIDED AS SPECIFIED IN 680.26(B)(1)(a) OR (B)(1)(b), POURED CONCRETE, PNEUMATICALLY APPLIED OR SPRAYED CONCRETE, AND CONCRETE BLOCK WITH PAINTED PLASTERED COATINGS SHALL ALL BE CONSIDERED CONDUCTIVE MATERIALS DUE TO WATER PERMEABILITY AND POROSITY. VINYL LINERS AND FIBERGLASS COMPOSITE SHELLS SHALL BE CONSIDERED TO BE NONCONDUCTIVE MATERIALS.

(2) STRUCTURAL REINFORCING STEEL, UNENCAPSULATED STRUCTURAL REINFORCING STEEL SHALL BE BONDED TOGETHER BY STEEL TIE WIRES OR THE EQUIVALENT, WHERE STRUCTURAL REINFORCING STEEL IS ENCAPSULATED IN A NONCONDUCTIVE COMPOUND, A COPPER CONDUCTOR GRID SHALL BE INSTALLED IN ACCORDANCE WITH 680.26(B)(1)(b).

(3) COPPER CONDUCTOR GRID, A COPPER CONDUCTOR GRID SHALL BE PROVIDED AND SHALL COMPLY WITH (b)(1) THROUGH (b)(4).

(1) BE CONSTRUCTED OF MINIMUM 8 AWG BARE SOLID COPPER CONDUCTORS BONDED TO EACH OTHER AT ALL POINTS OF CROSSING, THE BONDING SHALL BE IN ACCORDANCE WITH 250.8 OR APPROVED MEANS.
(2) CONFORM TO THE CONTOUR OF THE POOL.
(3) BE ARRANGE DIN A 300mm (12in) BY 300mm (12in) NETWORK OF CONDUCTORS IN A UNIFORMLY SPACED PERPENDICULAR GRID PATTERN WITH A TOLERANCE OF 100mm (4in)
(4) BE SECURED WITHIN OR UNDER THE POOL NO MORE THAN 150mm (6in) FROM THE OUTER CONTOUR OF THE POOL SHELL.

(2) PERIMETER SURFACES, THE PERIMETER SURFACE SHALL EXTEND FOR 1m (3ft) HORIZONTALLY BEYOND THE INSIDE WALLS OF THE POOL AND SHALL INCLUDE UNPAVED SURFACES AS WELL AS PAVED CONCRETE SURFACES AND OTHER TYPES OF PAVING. PERIMETER SURFACES LESS THAN 1m (3ft) SEPARATED BY A PERMANENT WALL OR BUILDING 1.5m (5ft) IN HEIGHT OR MORE SHALL REQUIRE EQUIPOTENTIAL BONDING ON THE POOL SIDE OF THE PERMANENT WALL OR BUILDING, BONDING TO PERIMETER SURFACES SHALL BE PROVIDED AS SPECIFIED IN 680.26(B)(2)(a) OR (2)(b) AND SHALL BE ATTACHED TO THE POOL REINFORCING STEEL OR COPPER CONDUCTOR GRID AT A MINIMUM OF FOUR (4) POINTS UNIFORMLY SPACED AROUND THE PERIMETER OF THE POOL. FOR NONCONDUCTIVE POOL SHELLS, BONDING AT FOUR POINTS SHALL NOT BE REQUIRED.

(a) STRUCTURAL REINFORCING STEEL, STRUCTURAL REINFORCING STEEL SHALL BE BONDED IN ACCORDANCE WITH 680.26(B)(1)(a).
(b) ALTERNATE MEANS, WHERE STRUCTURAL REINFORCING STEEL IS NOT AVAILABLE OR IS ENCAPSULATED IN A NONCONDUCTIVE COMPOUND, A COPPER CONDUCTOR(S) SHALL BE UTILIZED WHERE THE FOLLOWING REQUIREMENTS ARE MET:
(1) AT LEAST ONE MINIMUM 8 AWG BARE SOLID COPPER CONDUCTOR SHALL BE PROVIDED.
(2) THE CONDUCTORS SHALL FOLLOW THE CONTOUR OF THE PERIMETER SURFACE.
(3) ONLY LISTED SPLICES SHALL BE PERMITTED.
(4) THE REQUIRED CONDUCTOR SHALL BE 450mm TO 600mm (18in TO 24") FORM THE INSIDE WALLS OF THE POOL.

(3) METALLIC COMPONENTS, ALL METALLIC PARTS OF THE POOL STRUCTURE, INCLUDING REINFORCING METAL NOT ADDRESSED IN 680.26(B)(1)(a), SHALL BE BONDED, WHERE REINFORCING STEEL IS ENCAPSULATED WITH A NONCONDUCTIVE COMPOUND, THE REINFORCING STEEL SHALL NOT BE REQUIRED TO BE BONDED.

(4) UNDERWATER LIGHTING.
(5) METAL FITTINGS.
(6) ELECTRICAL EQUIPMENT.

(7) FIXED METAL PARTS, ALL FIXED METAL PARTS SHALL BE BONDED INCLUDING, BUT NOT LIMITED TO, METAL-SHEATHED CABLES AND RACEWAYS, METAL PIPING, METAL AWNINGS, METAL FENCES, AND METAL DOOR AND WINDOW FRAMES.


EXCEPTION NO 1: THOSE SEPARATED FROM THE POOL BY PERMANENT BARRIER THAT PREVENTS CONTACT BY A PERSON SHALL NOT BE REQUIRED TO BE BONDED.
EXCEPTION NO 2: THOSE GREATER THAN 1.5m (5ft) HORIZONTALLY FROM THE INSIDE WALLS OF THE POOL SHALL NOT BE REQUIRED TO BE BONDED.
EXCEPTION NO 3: THOSE GREATER THAN 3.7m (12ft) MEASURED VERTICALLY ABOVE THE MAXIMUM WATER LEVEL OF THE POOL, OR AS MEASURED VERTICALLY ABOVE ANY OBSERVATION STANDS, TOWERS, OR PLATFORMS, OR ANY DIVING STRUCTURES, SHALL NO BE REQUIRED TO BE BONDED.

(C) POOL WATER, WHERE NONE OF THE BONDED PARTS IS IN DIRECT CONNECTION WITH THE POOL WATER, THE POOL WATER SHALL BE IN DIRECT CONTACT WITH AN APPROVED CORROSION-RESISTANT CONDUCTIVE SURFACE THAT EXPOSES NOT LESS THAN 5800mm² (9in²) OF SURFACE AREA TO THE POOL WATER AT ALL TIMES. THE CONDUCTIVE SURFACE SHALL BE LOCATED WHERE IT IS NOT EXPOSED TO PHYSICAL DAMAGE OR DISLODGE DURING USUAL POOL ACTIVITIES, AND IT SHALL BE BONDED IN ACCORDANCE WITH 680.26(B).

250.8 CONNECTION OF GROUNDING AND BONDING EQUIPMENT**
(A) PERMITTED METHODS, EQUIPMENT GROUNDING CONDUCTORS, GROUNDING ELECTRODES CONDUCTORS, AND BONDING JUMPERS SHALL BE CONNECTED BY ONE OR MORE OF THE FOLLOWING MEANS:
(1) LISTED PRESSURE CONNECTORS
(2) TERMINAL BARS
(3) PRESSURE CONNECTORS LISTED AS GROUNDING AND BONDING EQUIPMENT
(4) EXOTHERMIC WELDING PROCESS
(5) MACHINE SCREW-TYPE FASTENERS THAT ENGAGE NOT LESS THAN TWO THREADS OR ARE SECURED WITH A NUT
(6) THREAD-FORMING MACHINE SCREWS THAT ENGAGE NOT LESS THAN TWO THREADS IN THE ENCLOSURE
(7) CONNECTIONS THAT ARE PART OF A LISTED ASSEMBLY
(8) OTHER LISTED MEANS

(B) METHODS NOT PERMITTED, CONNECTION DEVICES OR FITTINGS THAT DEPEND SOLELY ON SOLDER SHALL NOT BE USED

**NEC 2017 EQUIPOTENTIAL BONDING ARTICLE 680.26
**NEC 2017 CONNECTION OF GROUNDING AND BONDING EQUIPMENT ARTICLE 250.8

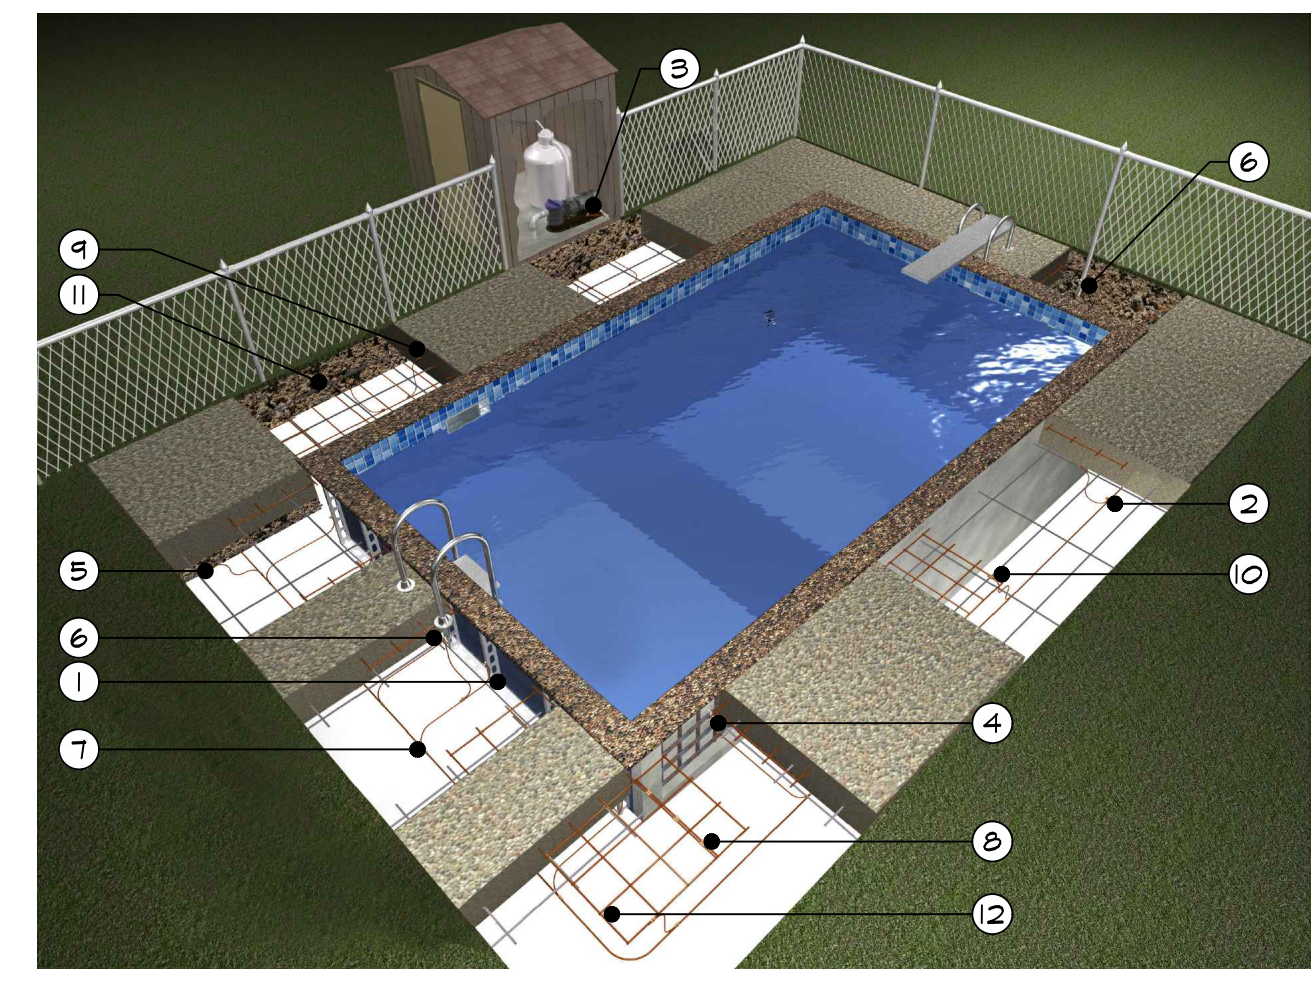

1 ONE-HOLE TINNED COPPER LAY-IN LUGS

PART #	CONDUCTOR RANGE (AWG)	BOLT HOLE SIZE
TC141402B	4 - 14	#10

• SUITABLE FOR DIRECT BURIAL.

2 COPPER SPLIT BOLT

PART #	RANGE FOR EQUAL MAIN (AWG)	MINIMUM TAP
CS5B6	4 Sol. - 8 Sol.	16 Sol.

• SUITABLE FOR DIRECT BURIAL.

3 COPPER OFFSET TERMINAL LUGS

PART #	CONDUCTOR RANGE (AWG)	BOLT HOLE SIZE
GEOL2	14 Str. - 6 Str.	#8

• SUITABLE FOR DIRECT BURIAL.

4 REBAR & WATER PIPE GROUND CLAMPS

PART #	PIPE & REBAR RANGE	CONDUCTOR RANGE (AWG)
RB12A	8" - 1"	10 Sol. - 2 Str.
RB12B	8" - 1"	10 Sol. - 2 Str.

• SUITABLE FOR DIRECT BURIAL.

5 CPC PIPE CLAMPS

PART #	MATERIAL	NOM. PIPE SIZE RANGE	PIPE OUTSIDE DIAMETER
CPCL5/2	TINNED BRONZE	1.5" - 2"	1" - 2.4"
CPCL2.5/3	TINNED BRONZE	2.5" - 3"	2.25" - 3.5"

• SUITABLE FOR DIRECT BURIAL.
• CONDUCTOR RANGE 16 - 250 MCM.
• OTHER SIZES AVAILABLE.

6 CABLE TO CABLE ULTRAWELDED EXOTHERMIC CONNECTION MOLDS

PART #	WELD METAL		REQUIRED HANDLE
	ULTRASHOT	NUT/TUBE	
PT6805B	U525	NUT/TUBE25	MHI
PS6805L	U525	NUT/TUBE25	MHS (INCLUDED)
PS6805L	U525	NUT/TUBE25	MHS (INCLUDED)

7 CABLE TO REBAR ULTRAWELDED EXOTHERMIC CONNECTION MOLDS

PART #	WELD METAL		REQUIRED HANDLE	PACKING MATL #
	ULTRASHOT	NUT/TUBE		
RF305B	U525	NUT/TUBE25	MHI	WRPSLV
RF4125A	U525	NUT/TUBE25	INCLUDED	CERPMI
RO305B	U565	NUT/TUBE65	MHI	WRPSLV
RO485B	U565	NUT/TUBE65	MHI	WRPSLV
RO505B	U565	NUT/TUBE65	MHI	WRPSLV

8 REBAR GROUNDING ASSEMBLY

PART #	REBAR SIZE	CONDUCTOR TYPE (AWG)	CONDUCTOR LENGTH (FT)
RB36A95X5	3	8 Sol.	5

• PREFABRICATED REBAR GROUNDING ASSEMBLY WITH EXOTHERMICALLY WELDED CONNECTION.
• STANDARD 24" LONG REBAR.
• CAN BE WIRE TIED OR WELDED CASE PRIOR TO CONCRETE POUR

9 UL LISTED PREFABRICATED #8 SOLID COPPER GROUND MESH


PART #	WIDTH (FT)	LENGTH (FT)	CONDUCTOR SPACING (IN)	APPROX. WT. (LBS)
6MSB0812	3	50	12	82
6MS15012	3	75	12	42
6MS100812	3	100	12	51

• OTHER MESH SIZES AND WIRE GAUGES AVAILABLE.


TYPICAL POOL GROUNDING & BONDING VIGNETTE

BONDING LOOP GENERAL NOTES

- EQUIPMENT BONDING NOTES**
- ALL METALLIC ITEMS TO BE BONDED AT PUMP ROOM PER NEC 250.26.
 - BOND ALL ITEMS AS NOTED ON THIS POOL BONDING LOOP PLAN, TO INCLUDE LADDERS, STANCHION ANCHORS, FLOATABLE ANCHORS, RAILING, PUMPS, DECK JUNCTION BOXES AND ALL OTHER METALLIC WITHIN 5'-0" OF THE POOL.
 - REINFORCEMENT STEEL AROUND POOL TO BE BONDED TO AT EACH POURED SECTION OR EVERY 20 FEET (WHICHEVER IS LESS), USE ONLY LUGS LISTED AND LABELED FOR BONDING REBAR TO A COPPER CONDUCTOR. LUGS SHOULD ALSO BE RATED FOR DIRECT BURIAL AS LUGS WILL BE ENCLOSED WITHIN CONCRETE AFTER INSTALLED.
 - ALL METAL FITTINGS WITHIN OR ATTACHED TO THE POOL SURFACE TO BE BONDED.
 - ALL FENCE POST AND GATES WITHIN 5 FEET FROM POOL SURFACE TO BE BONDED.
 - ALL PUMP MOTORS AT THE POOL TO BE BONDED TO THE BONDING LOOP UNLESS DOUBLE INSULATED, THIS INCLUDES WATER CIRCULATING, CHEMICAL FEED AND HEATER PUMPS.
 - ALL METAL RACEWAYS, PIPES, FIXED PARTS (AWNING, DOOR FRAMES, WINDOW FRAMES), AND CABLES WITHIN 5 FEET FROM THE POOL SURFACE TO BE BONDED.
 - ALL METALLIC CANOPIES, STAND, TOWERS OR OBSERVATION STANDS WITHIN 12' ABOVE THE MAXIMUM WATER LEVEL OF THE POOL AND LOCATED IN THIS AREA TO BE BONDED. BOND EACH SUPPORT LOCATED IN POOL DECK.
 - ITEMS WITH MULTIPLE ANCHOR SOCKETS, LEGS, ETC TO BE BONDED AT EACH LOCATION IN THE POOL DECK.
 - ALL PIPING TO AND FROM THE PUBLIC BATHING PLACE, INCLUDING INLET AND OUTLET PIPES SHALL BE METALLICALLY BONDED TOGETHER AND ADEQUATELY CONNECTED TO THE SAME GROUNDING ELECTRODE USED TO GROUND THE NEUTRAL CONDUCTOR OF THE ELECTRICAL SYSTEM. METAL FENCES SHALL BE GROUNDING AT BOTH SIDES OF THE ENTRANCE GATE.
 - ALL ELECTRICAL DEVICES SUCH AS PORTABLE ANNOUNCING SYSTEMS, RADIOS, AND SOFT DRINK DISPENSERS THAT MIGHT BE USED AROUND THE POOL AND IMMEDIATE ENVIRONMENT SHALL BE PROHIBITED WITHIN REACH OF BATHERS, FURTHER SPECIAL GROUNDING OF SUCH FIXTURES MUST BE PROVIDED.
 - BONDING LOOP CONDUCTOR AROUND POOL SHALL BE A SOLID COPPER CONDUCTOR AWG, NOT SMALLER THAN A #8 AWG.
 - BONDING LOOP AROUND POOL TO BE AS CONTINUOUS AS POSSIBLE WITH A MINIMUM NUMBER OF SPLICES
 - CONNECTIONS FROM POOL BONDING LOOP CONDUCTOR TO OTHER BONDED ITEMS CAN BE MADE WITH A MINIMUM #8 AWG SOLID COPPER
 - ALL BONDING CONNECTIONS TO BE MADE WITH DEVICES LISTED AND LABELED FOR THIS ENVIRONMENT. BONDING CONNECTORS SHALL BE BRASS, COPPER, COPPER ALLOY, OR STAINLESS STEEL.
 - EXOTHERMIC WELDING IS A PERMITTED METHOD FOR BONDING THE COPPER BONDING LOOP TO THE REINFORCEMENT STEEL.
 - ALL CONNECTIONS BETWEEN BONDED ITEMS AND POOL BONDING LOOP TO BE UNDER 2 OHMS RESISTANCE.

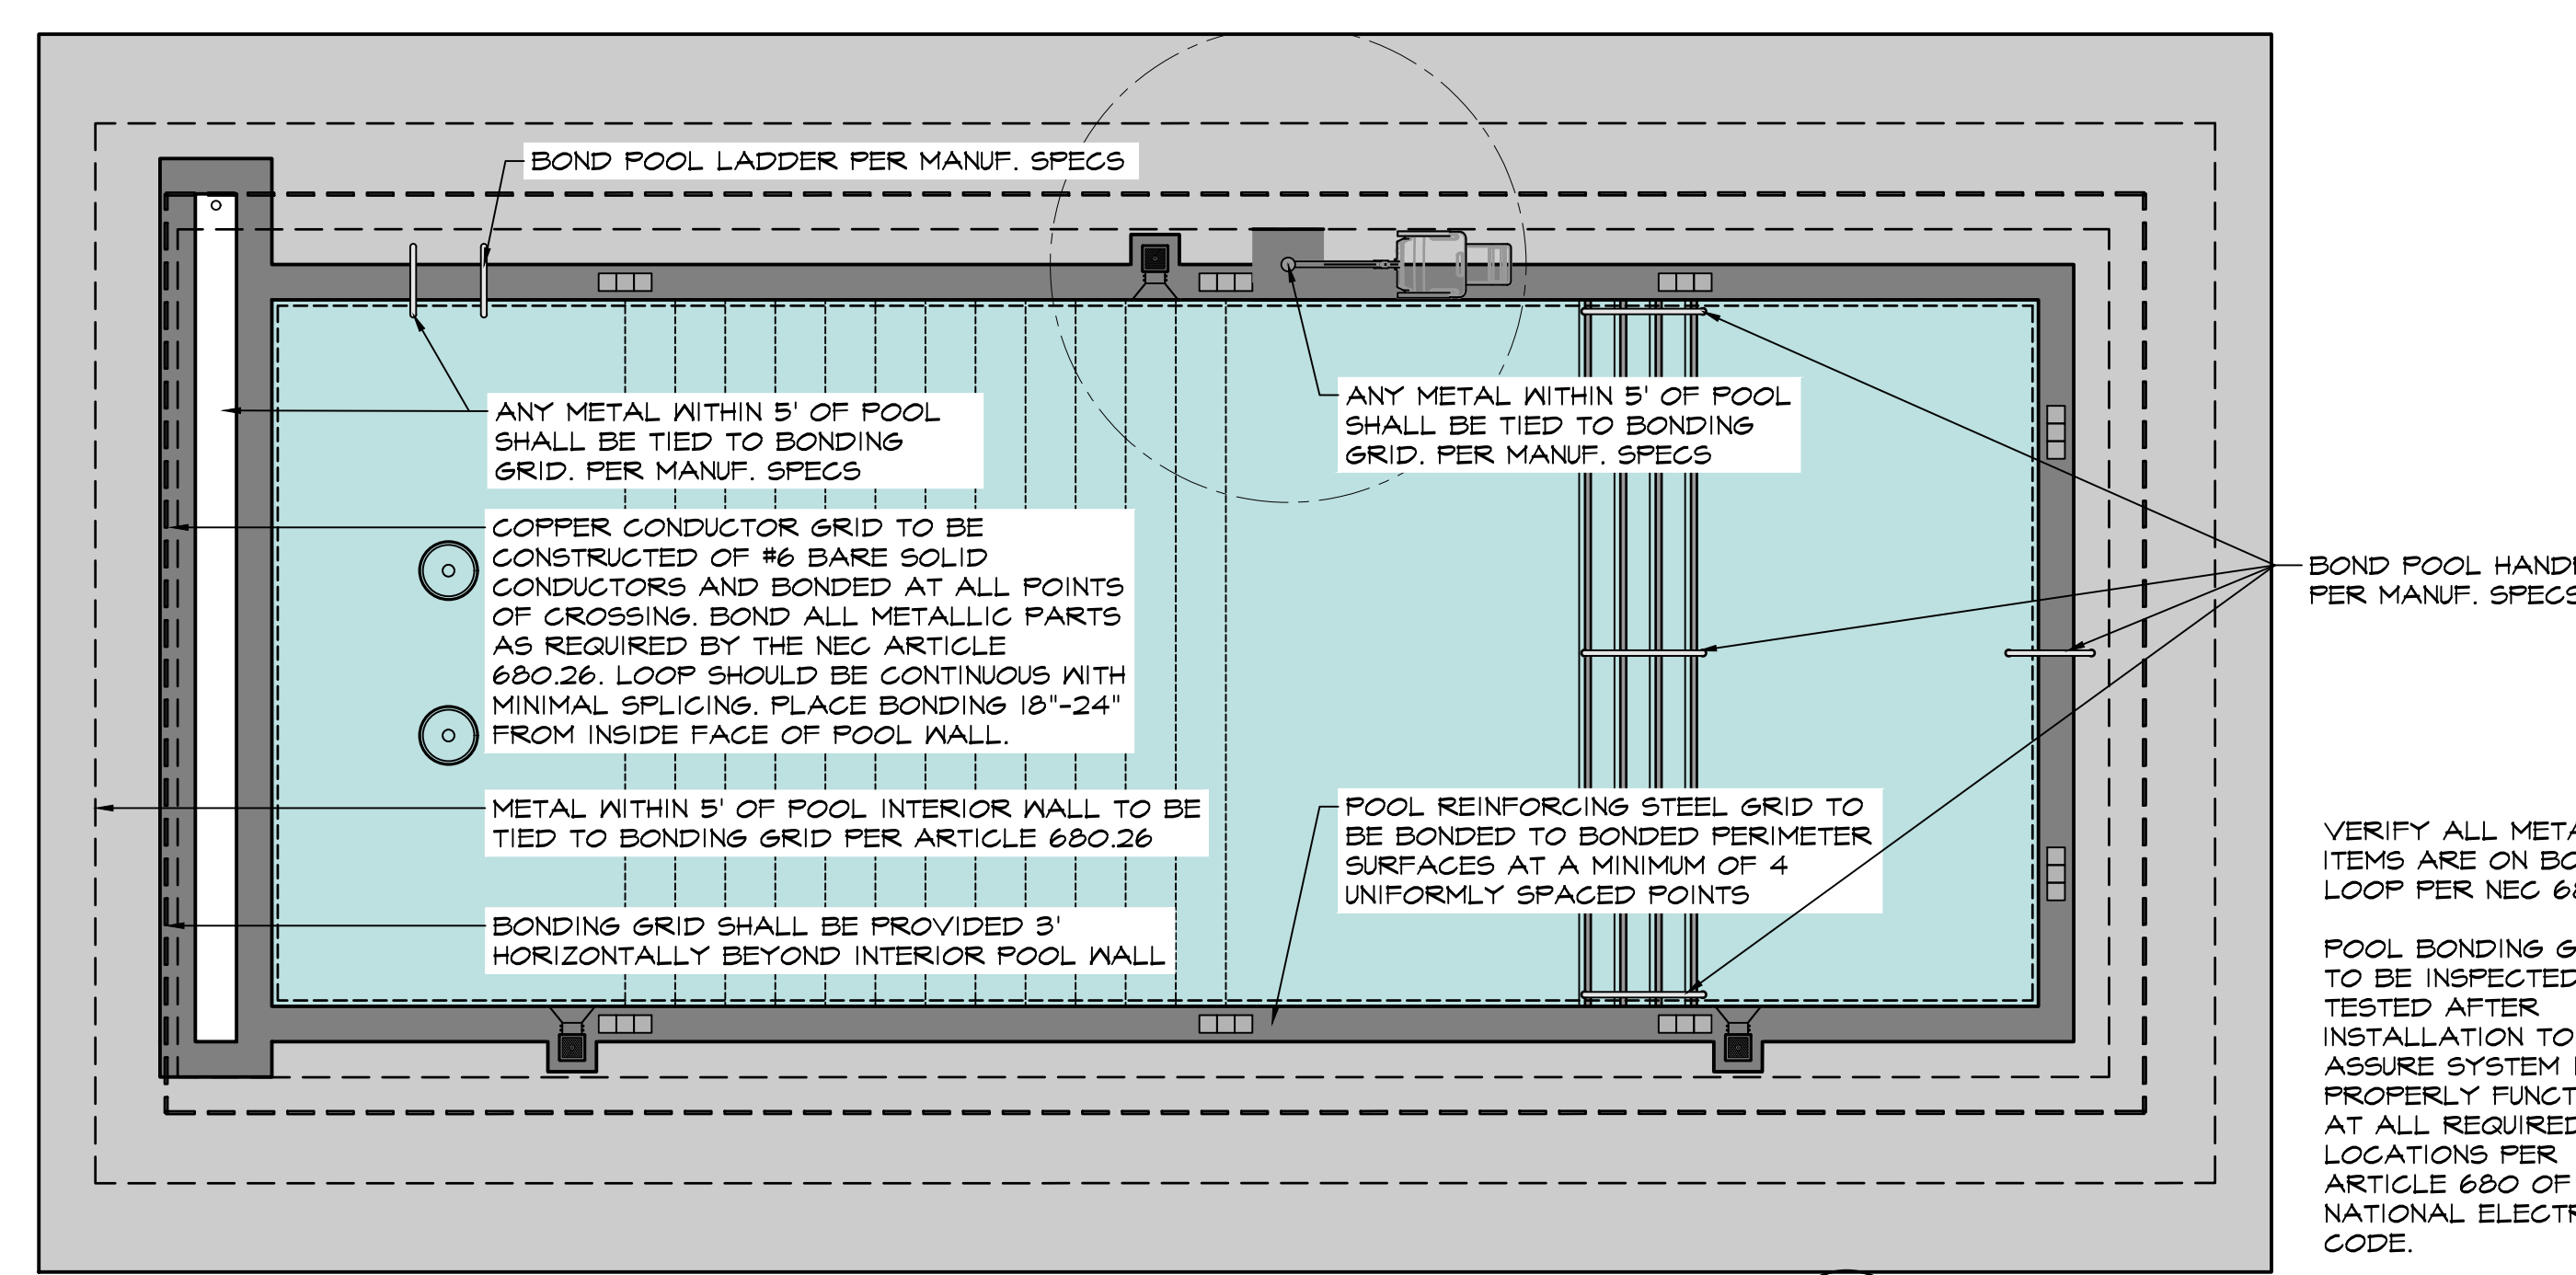

POOL BONDING PLAN
SCALE: 1" = 5'-0"

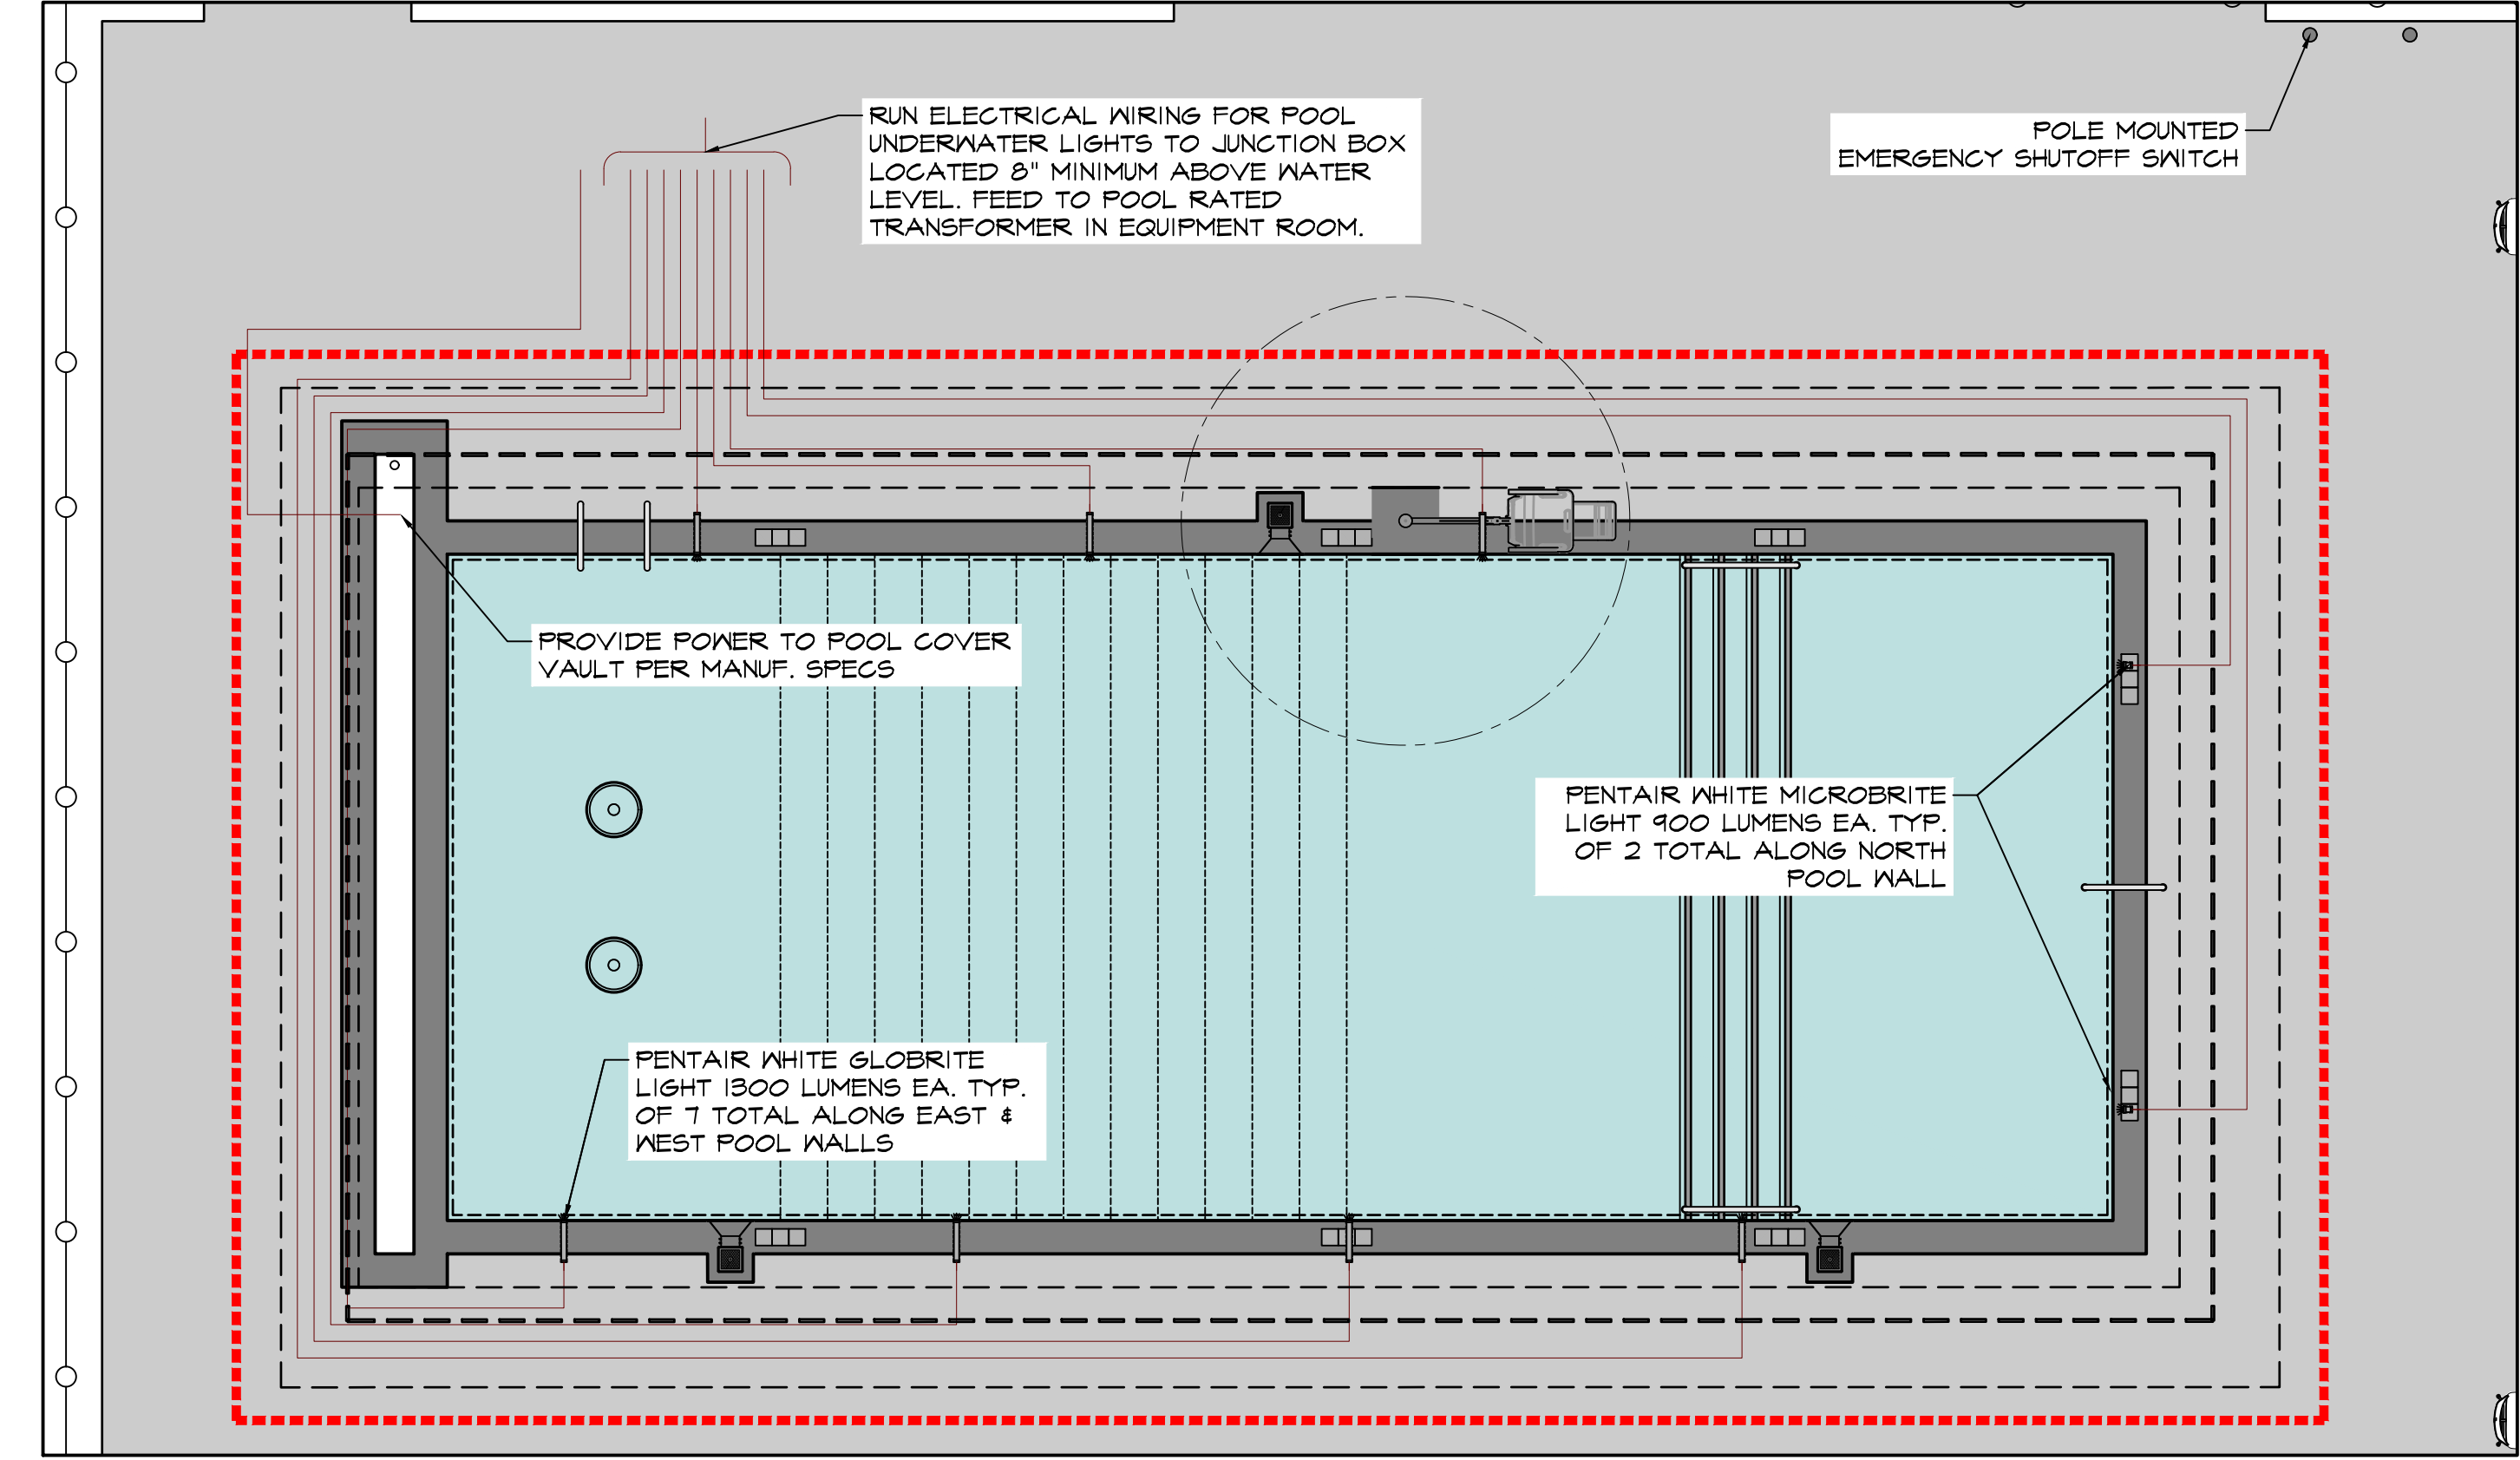

POOL ELECTRICAL PLAN
SCALE: 1" = 5'-0"

ELECTRICAL REQUIREMENTS

- 6' OFFSET FROM WATERS EDGE PER NEC SECTION 680.
- SECTION 680.10** - OVERHEAD CONDUCTOR CLEARANCES. REQUIRES THAT CONDUCTORS/CABLES BE INSTALLED BETWEEN 22.5'-27' ABOVE WATER LEVEL OF POOL (DEPENDING ON VOLTAGE AND CABLE TYPE). THIS WOULD PRESUMABLY APPLY TO FESTOON LIGHTING, AS OPPOSED TO THE BELOW REFERENCED 12' RULE FOR OVERHEAD LIGHTING.
- SECTION 680.22** - OUTLET LOCATIONS. NO ELECTRICAL OUTLETS LOCATED CLOSER THAN 6' FROM INSIDE OF POOL WALL. ALL OUTLETS LOCATED BETWEEN 6'-20' FROM INSIDE OF POOL WALL SHALL BE GFCI PROTECTED. AT LEAST ONE OUTLET IS REQUIRED TO BE PROVIDED WITHIN THIS DISTANCE RANGE FROM THE POOL.
- SECTION 680.22(B)(1)** - ANY LUMINAIRE INSTALLED ABOVE THE POOL OR WITHIN 5' OF THE INSIDE WALL OF THE POOL SHALL BE INSTALLED AT A HEIGHT OF 12' ABOVE THE POOL WATER LEVEL.
- SECTION 680.22(B)(6)** - LISTED LOW-VOLTAGE LUMINAIRES ARE PERMITTED CLOSER THAN 5' FROM THE INSIDE WALLS OF THE POOL PROVIDED THEY ARE SUPPLIED BY A LISTED TRANSFORMER OR POWER SUPPLY THAT IS SWIMMING POOL AND SPA RATED.
- SECTION 680.22(B)(4)** - LINE VOLTAGE LUMINAIRES OR LIGHTING OUTLETS INSTALLED BETWEEN 5'-10' FROM THE INSIDE WALLS OF THE POOL MUST BE GFCI PROTECTED
- SECTION 680.26(B)(7)** - ALL FIXED METAL PARTS WITHIN 5' HORIZONTALLY AND 12' VERTICALLY OF POOLS MUST BE BONDED.
- SECTION 680.26(B)(2)** - ALL PERIMETER SURFACES WITHIN 3' SURROUNDING POOL (PAVED AND UNPAVED) SHALL BE BONDED

ELECTRICAL NOTES

- ELECTRICAL LAYOUT ON THIS SHEET IS A DIAGRAMMATIC EXHIBIT, FIELD ADJUST AS NECESSARY TO AVOID OBSTACLES

LIGHTING REQUIREMENTS

- 8 LUMENS PER POOL SURFACE SF REQUIRED
- SWIMMING POOL : 1000 SF
- LUMENS REQUIRED : 8,000 LUMENS
 - LUMENS PROVIDED : 10,900 LUMENS
 - (7) PENTAIR GLOBRITE WHITE LED LIGHTS (1300 LUMENS EA)
 - (2) PENTAIR MICROBRITTE WHITE LED LIGHTS (900 LUMENS EA)



DOUGLAS STATION
 NW SLOAN & NE SYCAMORE ST
 LEE'S SUMMIT, MO 64086

REVISION:



 10/13/2025
 POOL PLUMBING PLAN
W003

POOL PROJECT DATA




MIN POOL DEPTH (IN REEF), 3'-6"	6"	POOL SKIMMERS	3
MAX POOL DEPTH	4'-6"	POOL RETURNS	10
POOL SURFACE AREA	1,000 SF	POOL DRAIN	DUAL VGB SUPERFLOW 360 PEBBLE TOP DRAINS
POOL VOLUME	23,720 GAL.	FILTRATION PUMP	PENTAIR INTELLIFLO 3 VSF 3HP
285-MIN FILTRATION TURNOVER RATE	83 GPM	FILTER	PENTAIR TR-140C SAND FILTER
POOL PERIMETER	140 LF	FILTER AREA	7.06 SF
TOTAL DYNAMIC HEAD (TDH)	+/-55'	FILTER RATE	11.8 GPM/SF
BATHER LOAD	66 PERSONS	HEATER	PENTAIR ETI 400 NATURAL GAS HEATER
		POOL SANITIZER	PENTAIR INTELLICHEM WITH LIQUID CHLORINE AND ACID
		POOL AUTOMATION	PENTAIR INTELLICENTER AUTOMATION

POOL EQUIPMENT ROOM PROVISIONS



1. PROVIDE FRESH AIR INTAKE & EXHAUST FOR HEATER PER MANUFACTURER'S SPECIFICATIONS
2. PROVIDE 400,000 BTU NATURAL GAS FOR HEATER
3. PROVIDE 1" FRESH WATER LINE FOR AUTOFILL
4. PROVIDE FLOOR DRAIN CAPABLE OF GRAVITY DRAINING AT A RATE OF 106 GPM AT EQUIPMENT ROOM. SLOPE FLOOR TO DRAIN.
5. SEPARATE EQUIPMENT ROOM & CHEMICAL CLOSET FROM ADJACENT SPACES BY EITHER A CONCRETE CURB OR RECESS THE ROOM 6".
6. PROVIDE 60-AMP ELECTRICAL PANEL AT EQUIPMENT ROOM
7. POOL EQUIPMENT AND LINES TO BE LABELED W/ LABELING MACHINE. PROVIDE A LAMINATED WATERPROOF AS-BUILT DIAGRAM OF EQUIPMENT ROOM LAYOUT AT SERVICE CONTROL PANEL W/ BINDER OF ALL EQUIPMENT CUT SHEETS
8. PLUMBING LAYOUT ON THIS SHEET IS A DIAGRAMMATIC EXHIBIT. FIELD ADJUST AS NECESSARY TO AVOID FOOTINGS, TREES AND OTHER OBSTACLES
9. ALL PUMPS SHALL BE CONTROLLED BY A VALVE (VARIABLE SPEED PUMPS SHALL ALSO HAVE THEIR SPEED SETTING LOCKED) SO AS NOT TO EXCEED THE DESIGN FLOW RATES INDICATED ON POOL/SPA PROJECT DATA. THIS SHEET. EXCEEDING THESE FLOW RATES COULD CREATE VELOCITIES THAT WILL DAMAGE PLUMBING.
10. ALL POOL EQUIPMENT SHALL BE HELD ABOVE FLOOR ON HOUSEKEEPING PADS
11. AVOID MIXING CHLORINE AND ACID - DOING SO WILL CREATE POTENTIALLY FATAL GASSES. CHLORINE AND ACID SHALL NOT BE STORED TOGETHER INSIDE OF THE HOUSE.
12. POOL CHEMICALS SHALL NOT BE STORED IN ANY ROOM WITH OPEN AIRFLOW TO LIVING SPACES - PROVIDE BARRIER BETWEEN ROOMS CONTAINING POOL CHEMICALS AND ANY LIVING SPACE ALONG WITH DEDICATED MECHANICAL VENTILATION WHICH EXHAUSTS TO BUILDING EXTERIOR.
13. PROVIDE SEPARATE MECHANICAL VENTILATION AT EQUIPMENT ROOM AND CHEMICAL CLOSET.
14. MAINTAIN AMBIENT TEMPERATURES BELOW 100 DEGREES IN EQUIPMENT ROOM.
15. ALL PIPES SUSPENDED FROM WALLS AND CEILING SHALL BE SCHEDULE 80 PVC
16. PROVIDE MIN. 42" WIDE LOUVERED DOOR TO EQUIPMENT ROOM
17. ALL HARDWARE & EXHAUST FANS IN CHEMICAL CLOSET SHALL BE CORROSION RESISTANT

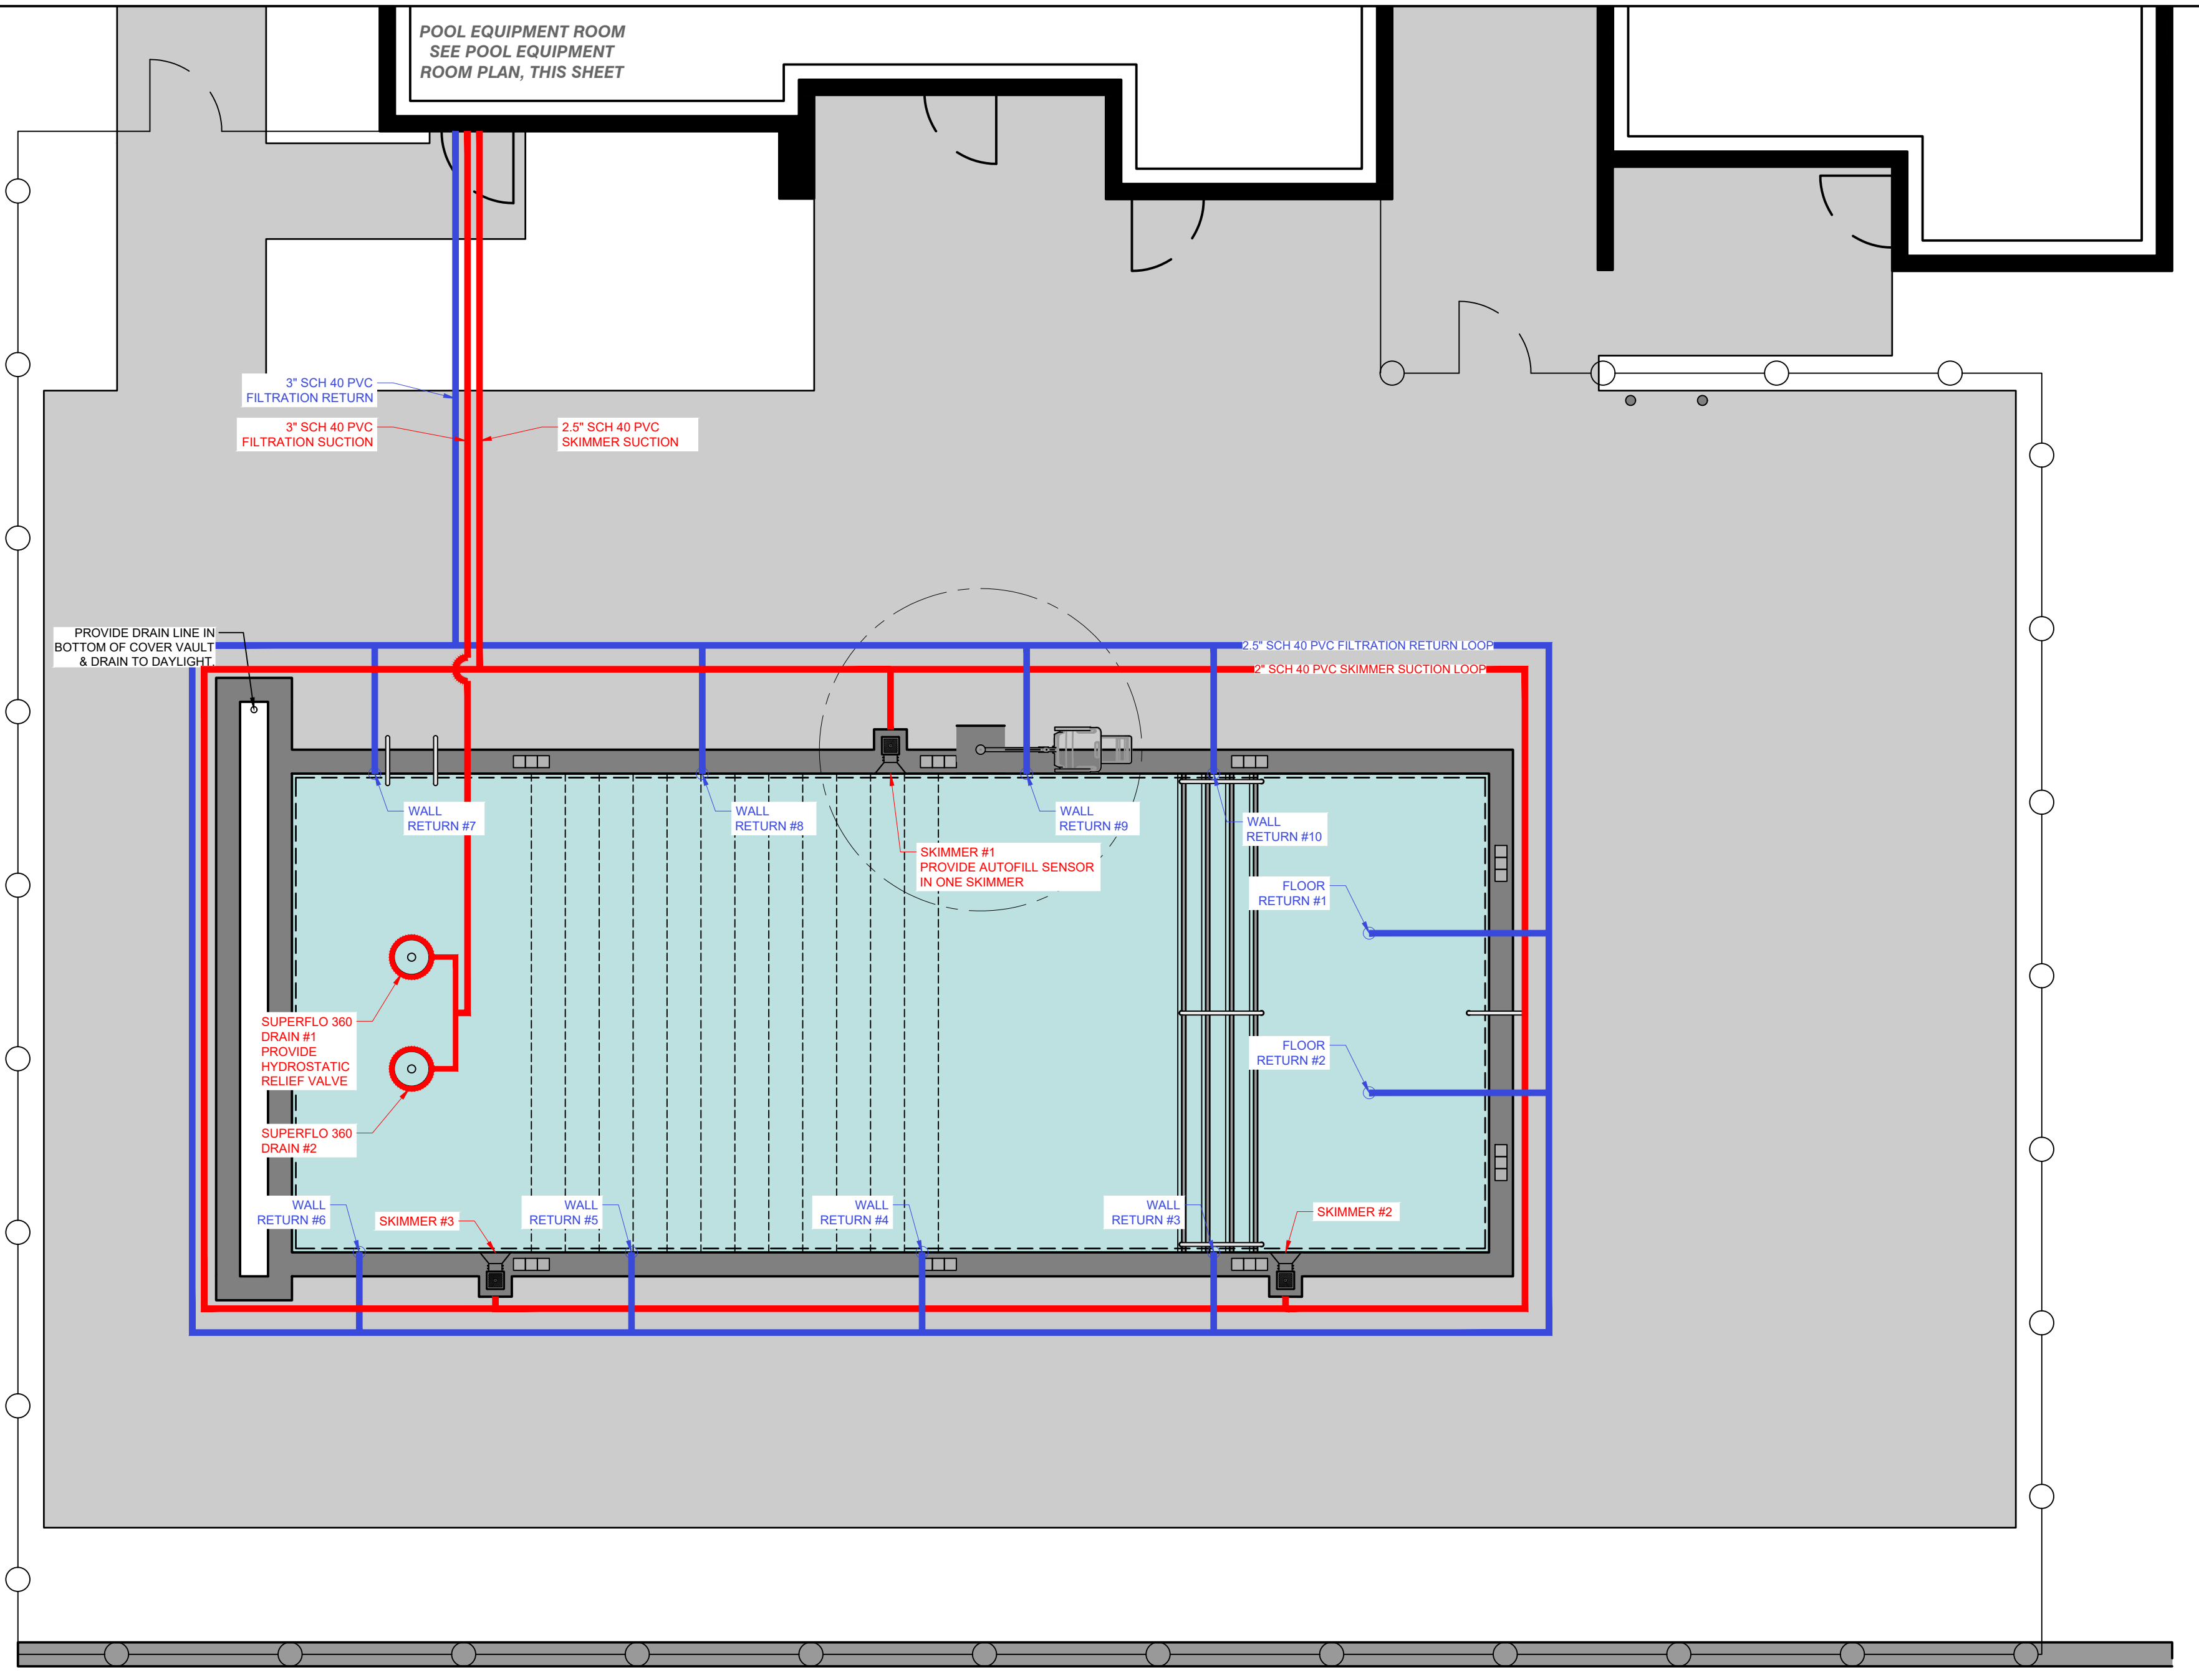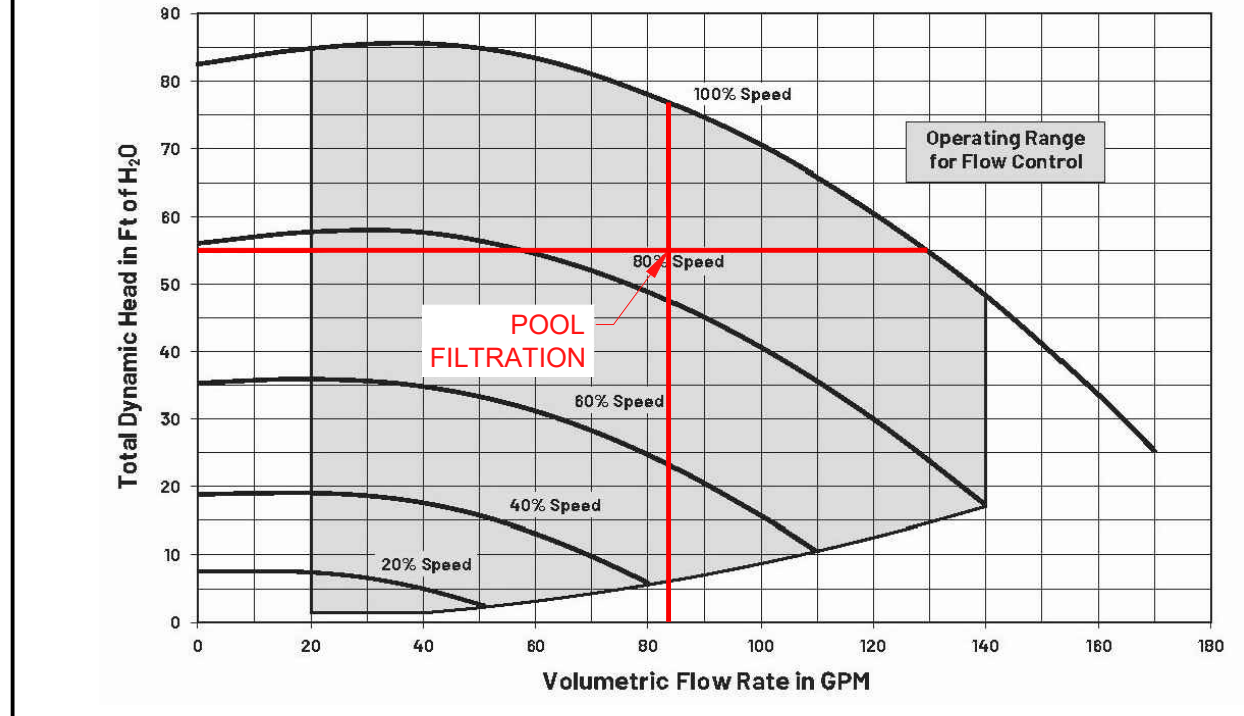


POOL PLUMBING PLAN
 SCALE: 1" = 5'-0"

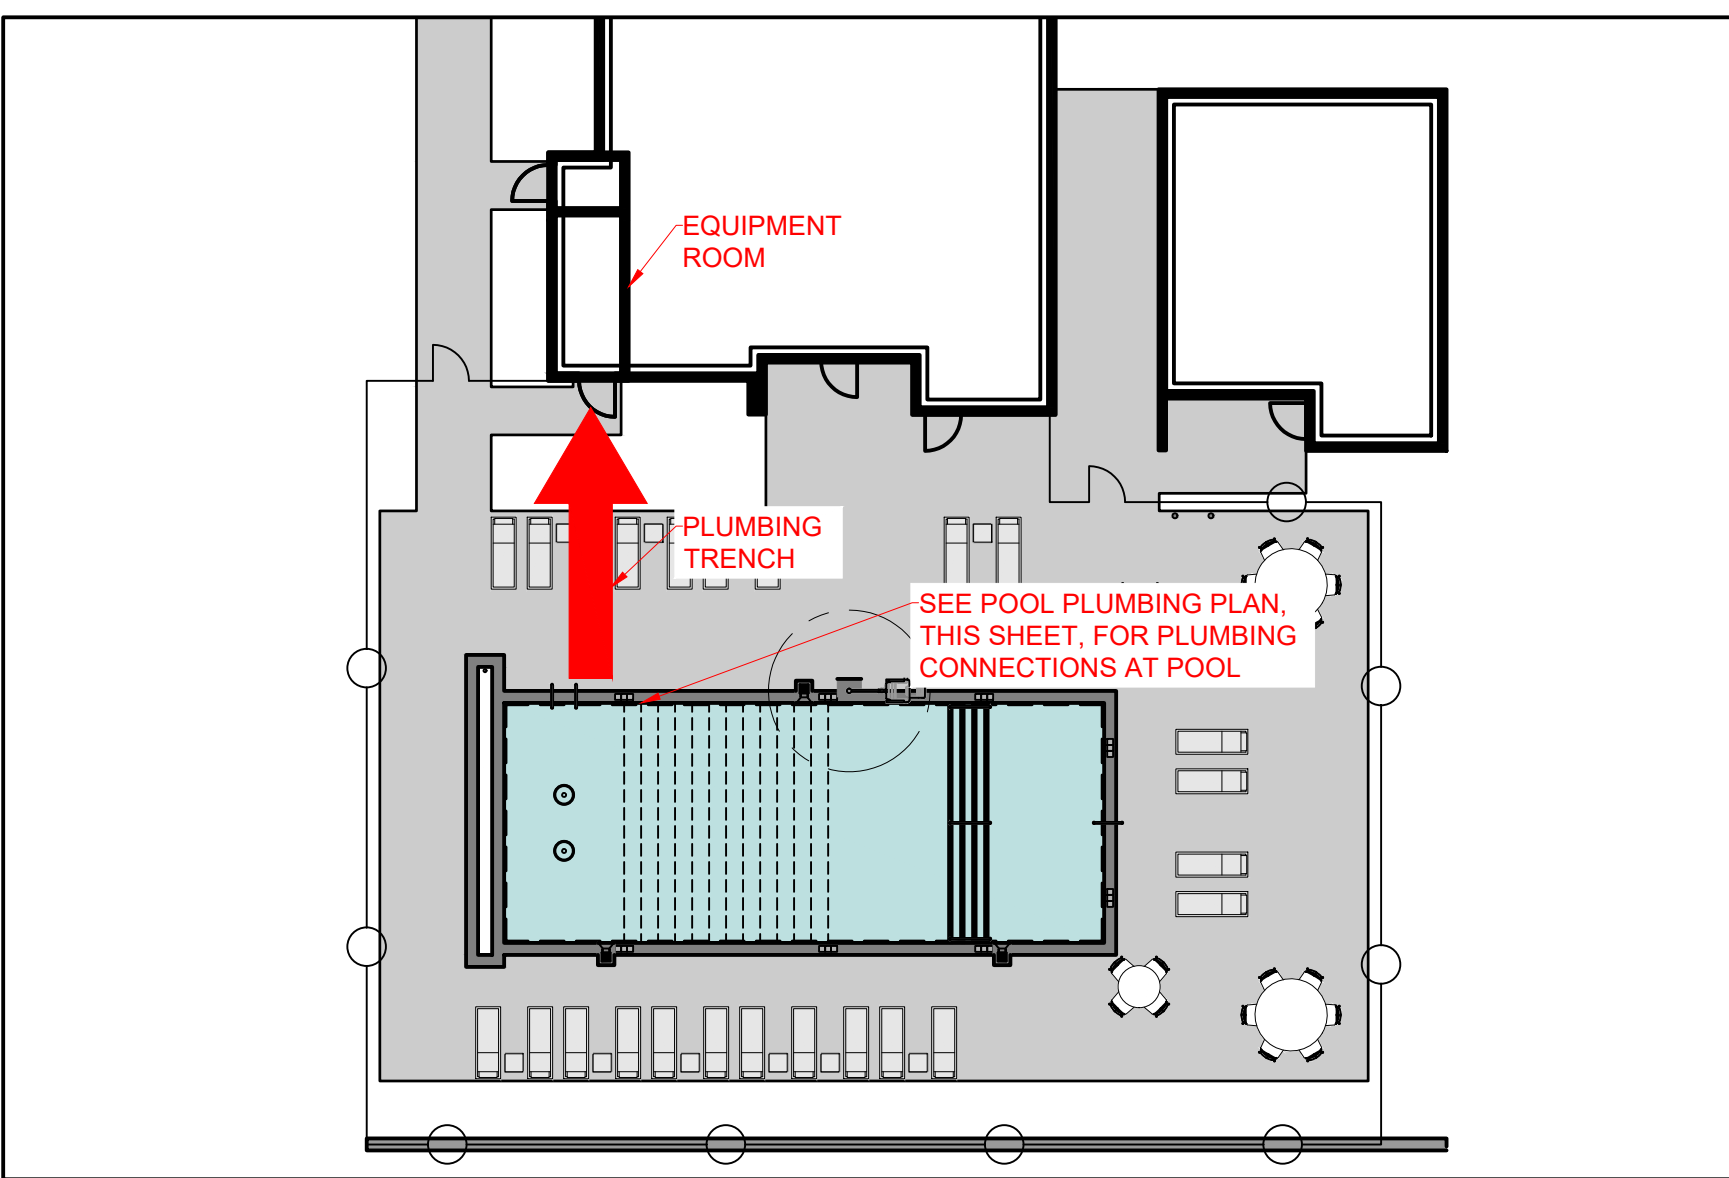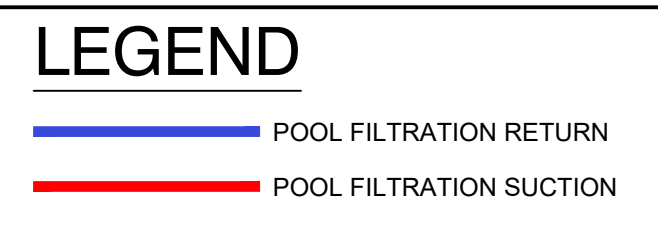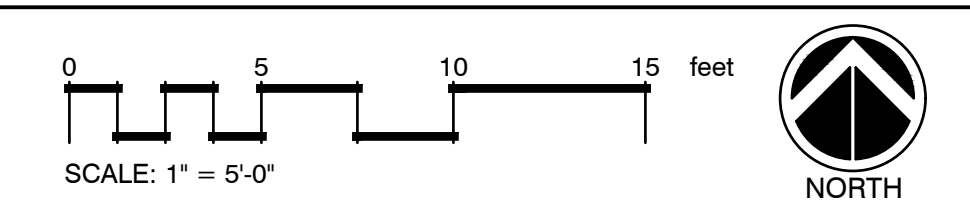

SITE PLAN
 SCALE: 1" = 10'-0"

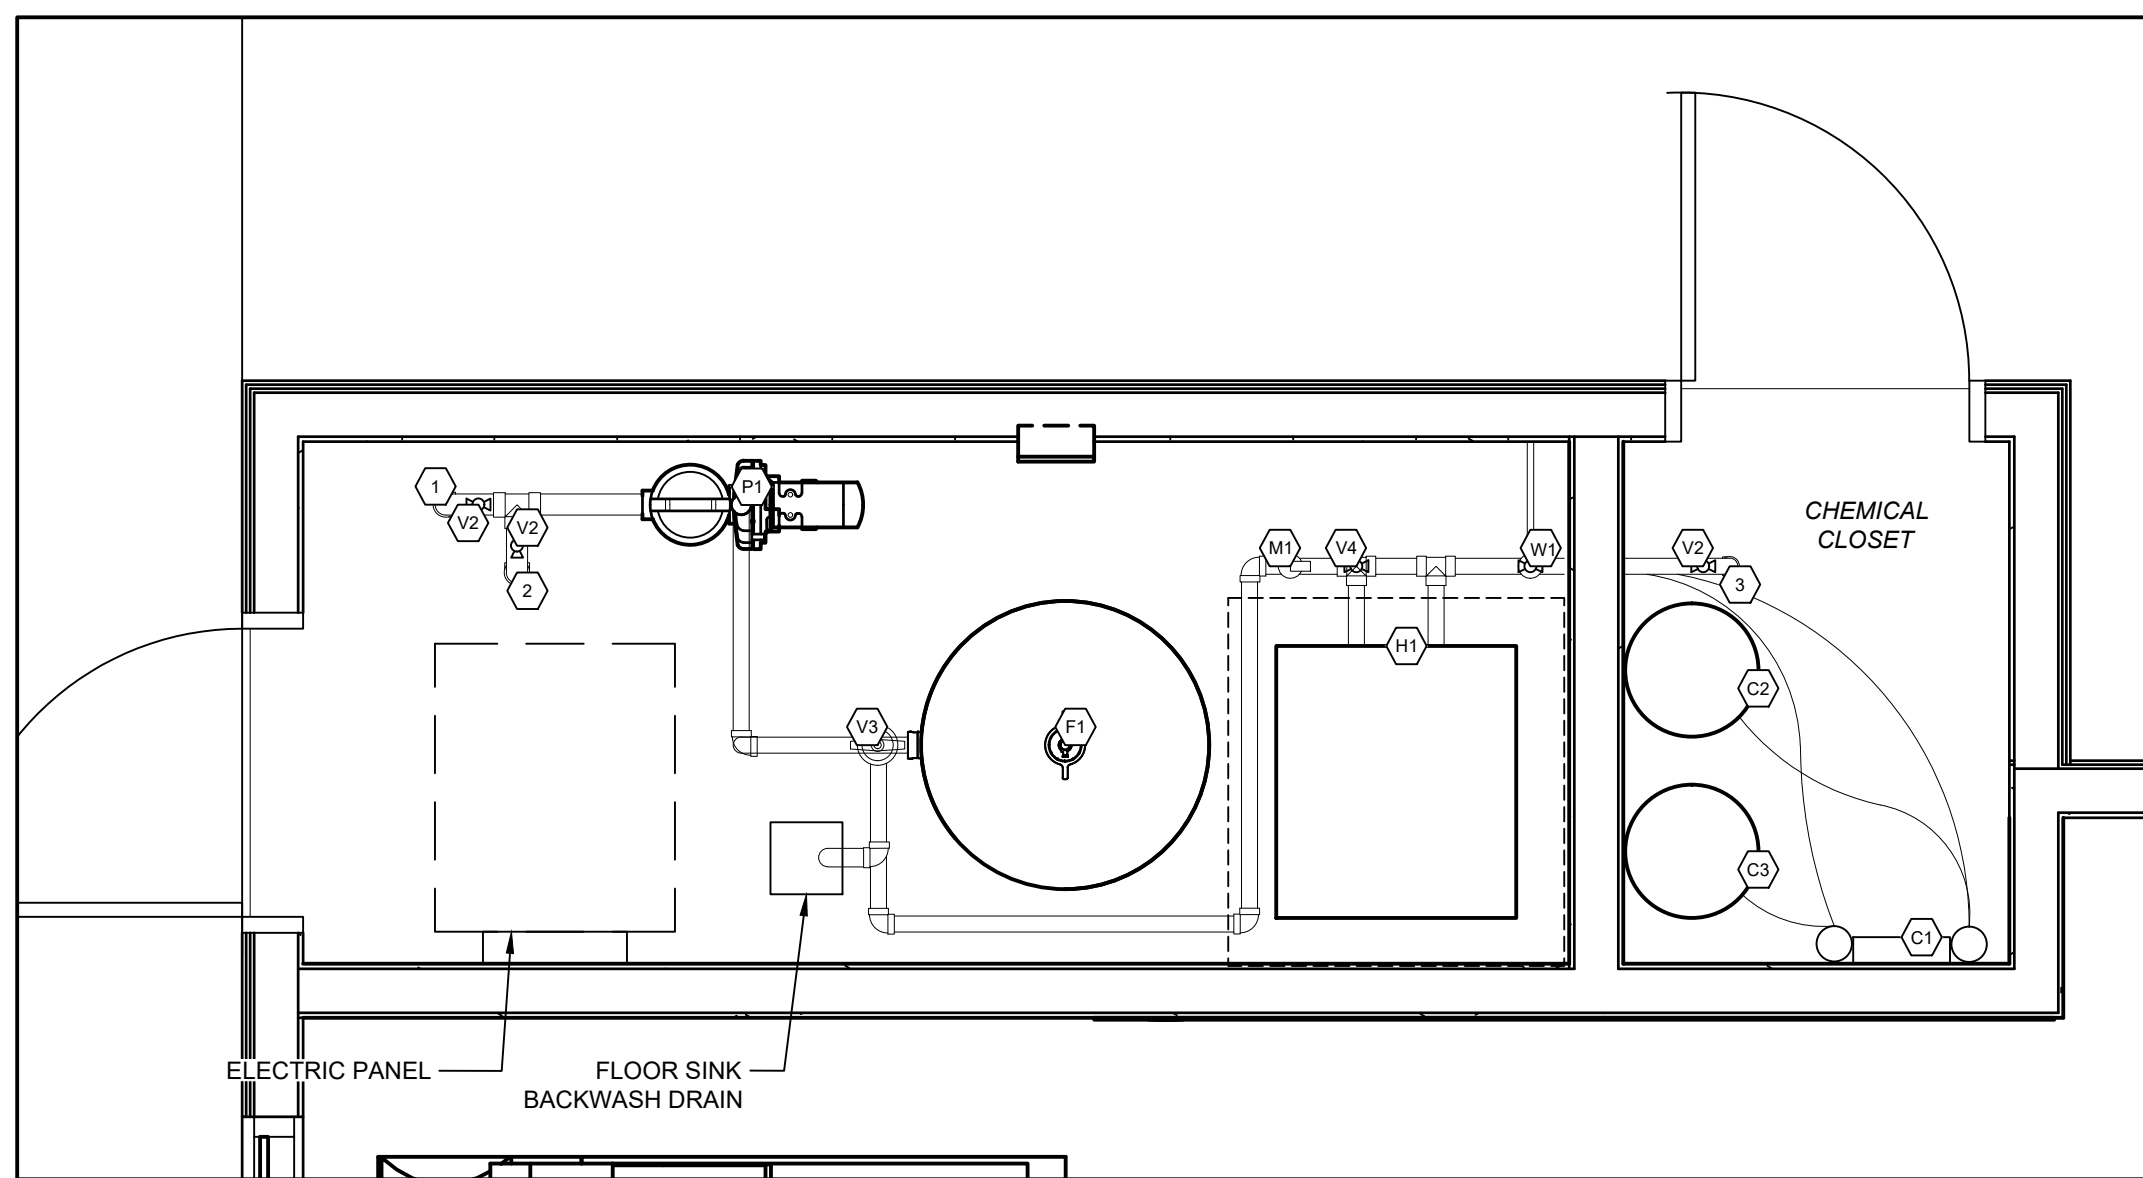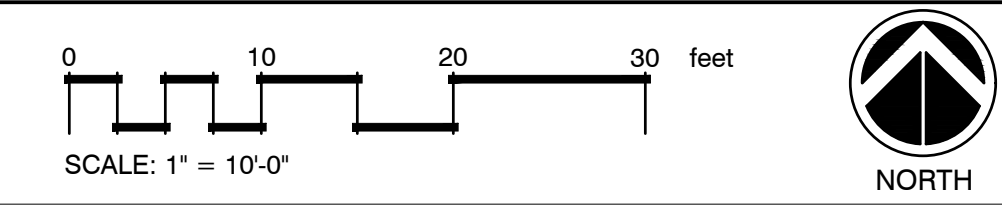


EQUIPMENT ROOM PLAN
 SCALE: 1/2" = 1'-0"

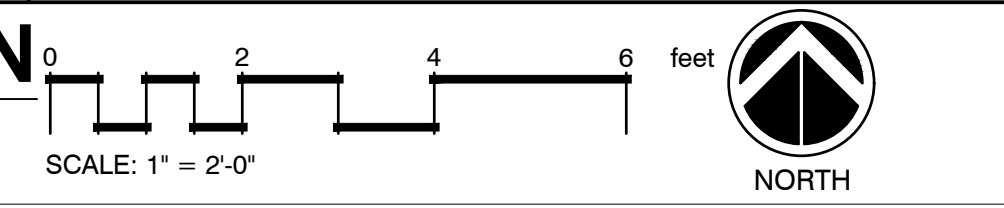

POOL EQUIPMENT ROOM LEGEND

- PENTAIR INTELLIFLO 3 VSF 3HP VARIABLE SPEED PUMP
- PENTAIR TR140C SAND FILTER
- PENTAIR ETI 400 NATURAL GAS HEATER
- FLOW VIZ FLOW METER
- PENTAIR COMMERCIAL INTELLICHEM WATER CHEMISTRY CONTROLLER
- ACID TANK WITH STENNER PUMP
- CHLORINE TANK WITH STENNER PUMP
- CHEMICAL RESISTANT, CORROSION RESISTANT CHECK VALVE
- BALL VALVE
- BACKWASH VALVE
- HEATER BYPASS
- FRESH WATER FEED & ACTUATOR - JANDY LEVOLOR AUTOFILL. CONTRACTOR TO FIELD LOCATE AUTOFILL SENSOR PER MANUFACTURER'S INSTRUCTIONS
- 3" SCH 40 PVC FROM POOL SUPERFLOW 360 DRAINS #1 & #2
- 2.5" SCH 40 PVC FROM POOL SKIMMER LOOP
- 3" SCH 40 PVC TO POOL FILTRATION RETURN

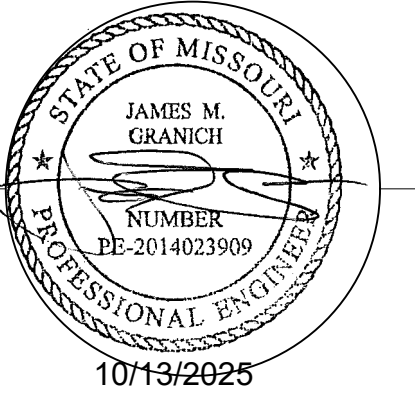

DOUGLAS STATION
NW SLOAN & NE SYCAMORE ST
LEE'S SUMMIT, MO 64086

REVISION:


10/13/2025
POOL STRUCTURAL DETAILS
W102

POOL WALL AND FLOOR REINFORCING SCHEDULE:


WATER DEPTH	SPRING LINE	RADIUS "R"	POOL WALL			FLOOR SLAB		
			THICKNESS "T"	SOIL SIDE VERT. REINF.	SOIL SIDE HORIZ. REINF.	POOL SIDE WALL REINF.	THICKNESS	REINF.
0'-0" TO 3'-0"	0'-0" TO 3'-4"	3'	8" MIN UNLESS NOTED OTHERWISE	#4 @ 12" O.C.	#4 @ 12" O.C.	-	8" MIN.	#4 @ 12" O.C. E.H.
3'-0" TO 8'-0"	3'-6" TO 7'-6"	6'	12" MIN	#4 @ 12" O.C.	#4 @ 12" O.C.	TO MATCH SOIL SIDE	8" MIN.	#4 @ 12" O.C. E.H.
8'-0" TO 10'-0"	6'-2" TO 8'-2"	1'-10"	12" MIN	#4 @ 9" O.C.	#4 @ 12" O.C.	TO MATCH SOIL SIDE	8" MIN.	#4 @ 12" O.C. E.H.

- POOL REINFORCING SCHEDULE NOTES:**
- SEE POOL PLAN FOR SECTIONS AND DETAILS AT THE SHALLOW AREAS OF THE POOL.
 - THE SPRINGLINE ELEVATION IS THE VERTICAL WATER DEPTH WHERE THE RADIUS LENGTH INTERSECTS THE SURFACE OF THE POOL FLOOR.
 - PROVIDE 2" OF CONCRETE, OR GUNITE COVER ON ALL WALL REINFORCING BARS.
 - SUPPORT FLOOR SLAB REINFORCING BARS ON BAR SUPPORTS @ 36" O.C. EACH WAY WITH CONCRETE BLOCK OR CHAIRS PER ACI 301. SEE DETAILS FOR BAR SUPPORT HEIGHTS.
 - REINFORCING STEEL SHOWN IN SCHEDULE IS MINIMUM REQUIRED. CONTRACTOR SHALL PROVIDE ADDITIONAL STEEL AS REQUIRED PER SECTIONS


1 POOL REINFORCING SCHEDULE
SCALE: NTS

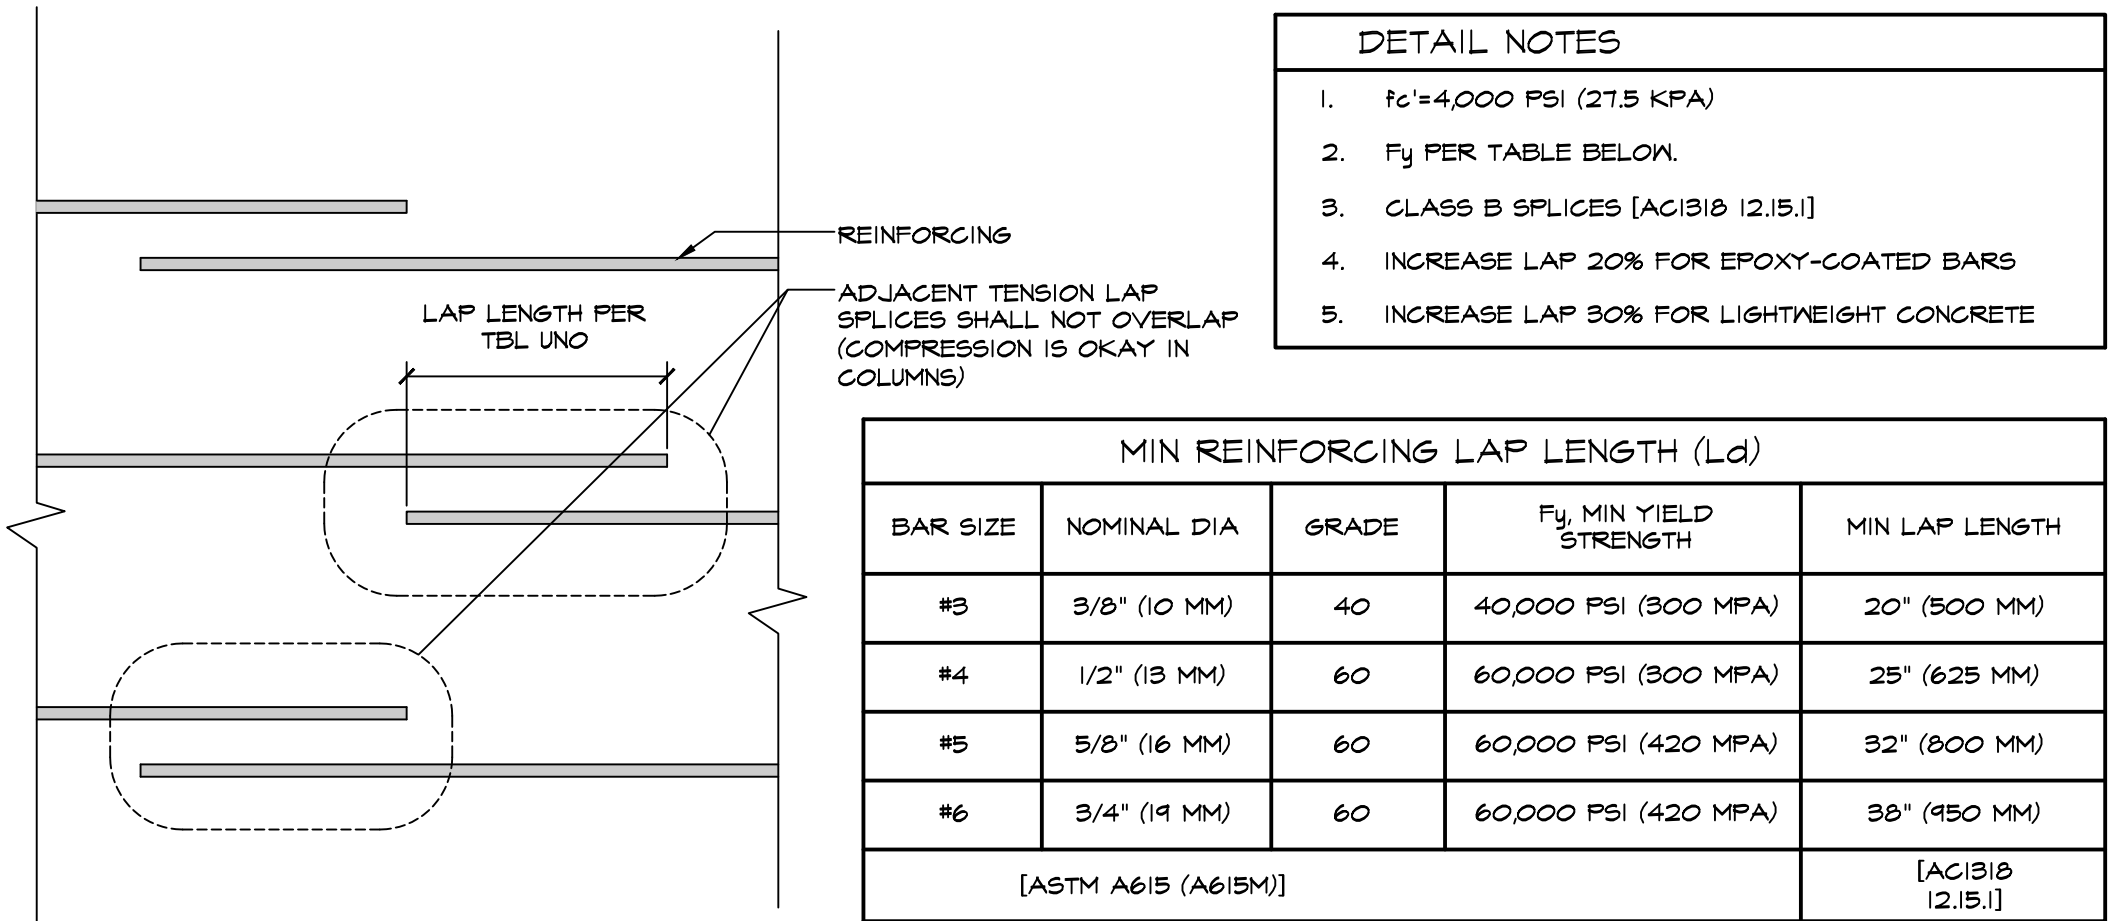

5 SHOTCRETE NON-CONTACT LAP SPLICES
SCALE: NTS

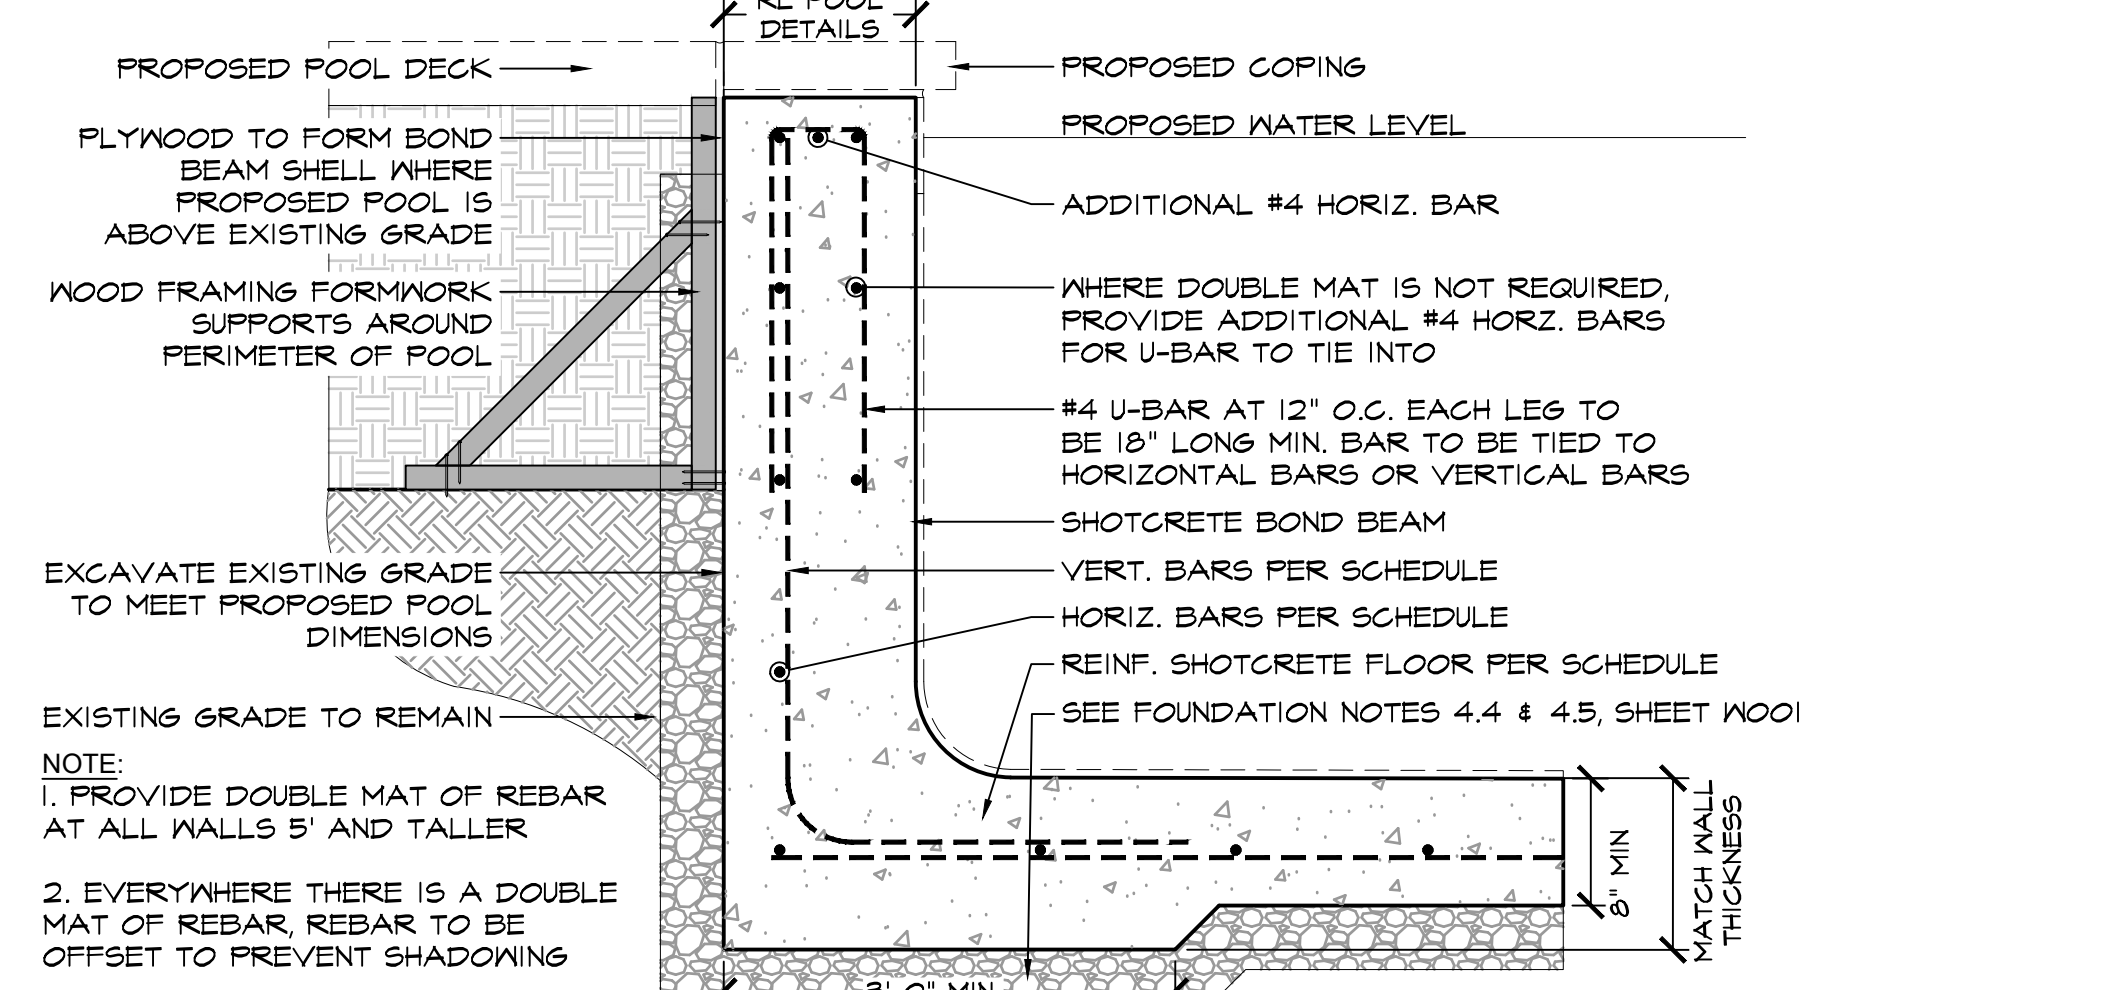


9 TYPICAL REBAR TYING / WALL FRAMING FORMWORK
SCALE: NTS SECTION

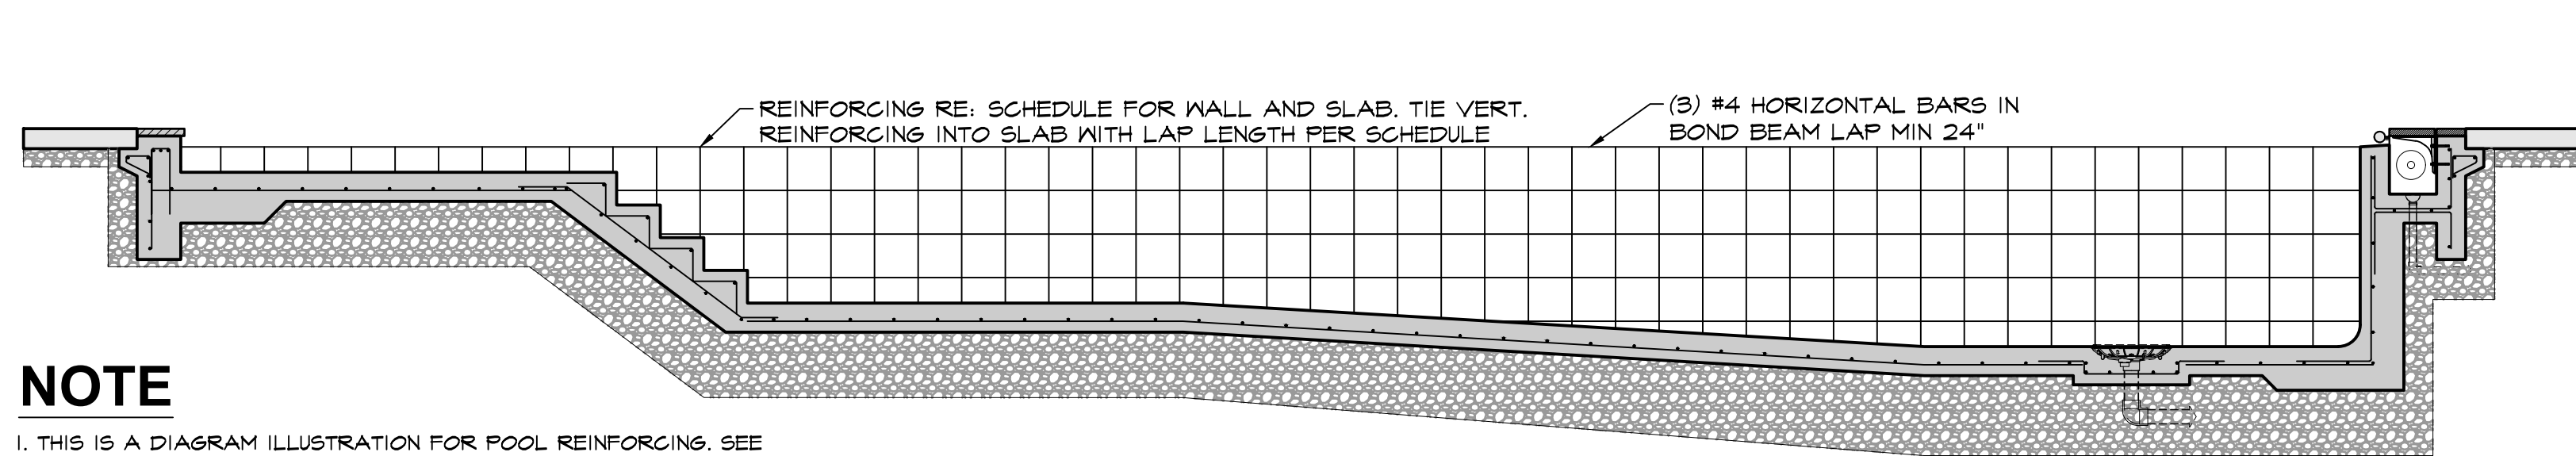


- NOTE**
- THIS IS A DIAGRAM ILLUSTRATION FOR POOL REINFORCING. SEE POOL PLAN AND CROSS SECTIONS FOR DEPTHS AND SLOPES
 - FOOTING DESIGNS ARE BASED ON AN ASSUMED STABLE, NON-EXPANSIVE SOIL WITH AN ALLOWABLE FOUNDATION PRESSURE OF 1500 PSF WITH A MAXIMUM DIFFERENTIAL SETTLEMENT OF 1/2 INCH. CONTRACTOR SHALL HIRE A GEOTECHNICAL ENGINEER TO DETERMINE WHETHER OR NOT SOIL MEETS THIS MINIMUM CRITERIA AND IF IT DOES NOT, SHALL NOTIFY ENGINEER SO THAT THE FOUNDATION MAY BE REDESIGNED ACCORDINGLY.
 - DOUBLE MAT OF REBAR SHALL BE PROVIDED AT ALL SHOTCRETE WALLS 5' AND GREATER IN HEIGHT. REBAR TO BE OFFSET TO PREVENT SHADOWING
 - DOUBLE MAT OF REBAR SHALL BE PROVIDED AT ALL SHOTCRETE WALL GREATER THAN 12" THICK. REBAR TO BE OFFSET TO PREVENT SHADOWING


13 TYPICAL POOL REINFORCING CROSS SECTION
SCALE: NTS

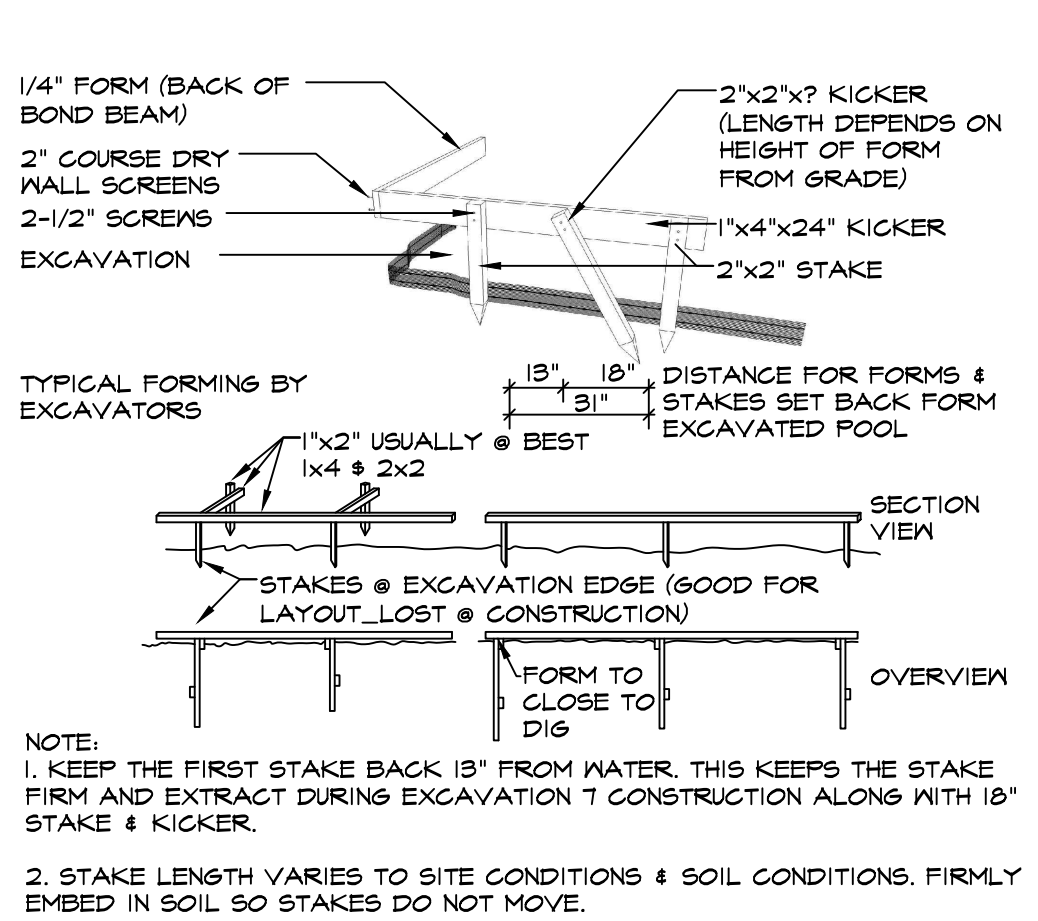


2 STRUCTURAL FRAMING FORMWORK
SCALE: NTS

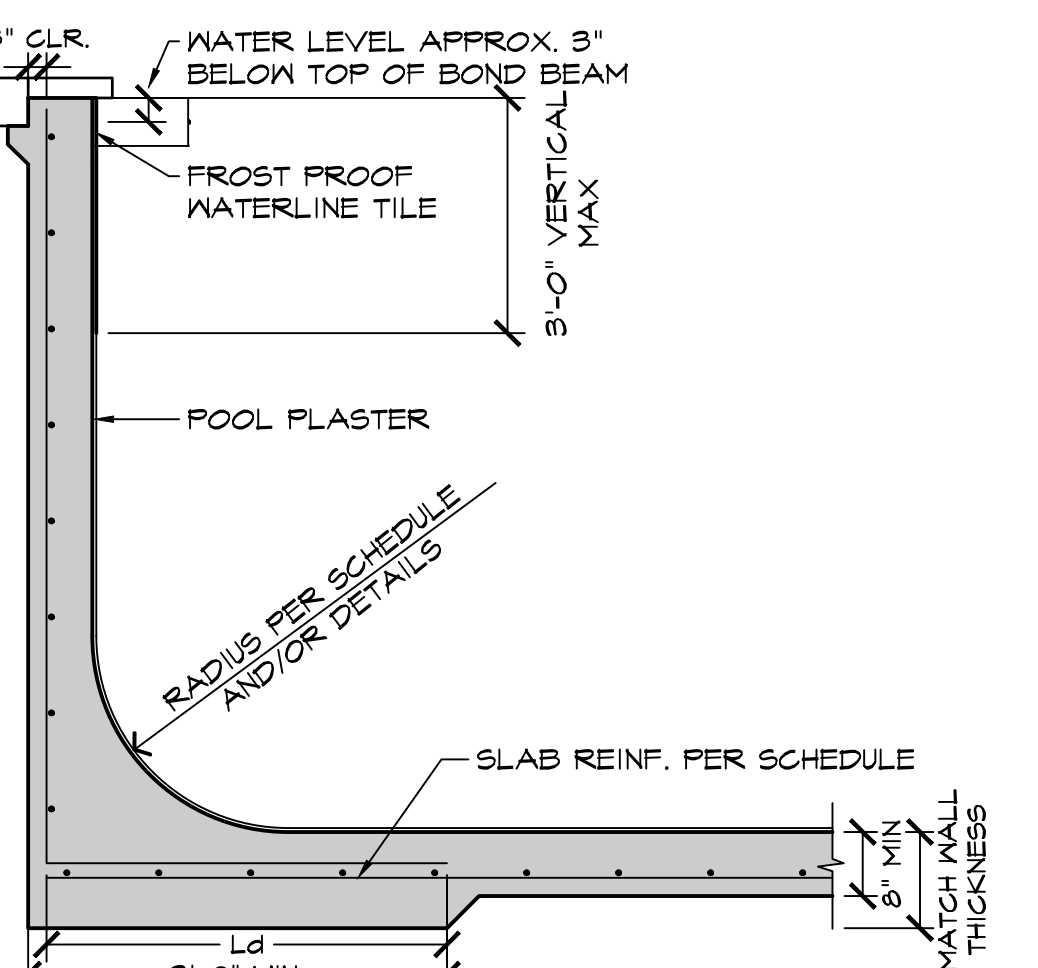


6 WALL TO BOTTOM TRANSITION
SCALE: 1/2" = 1'-0" SECTION

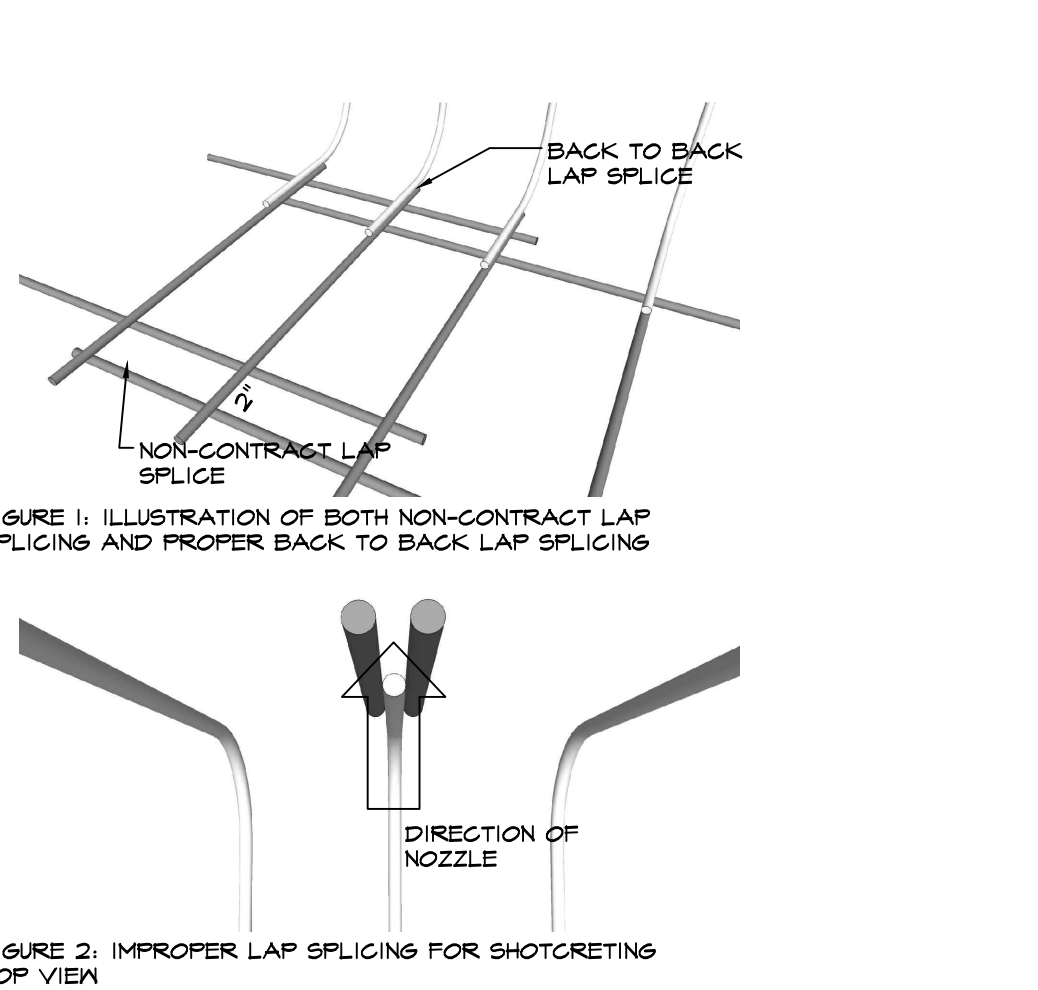


10 LAP SPLICING SHOTCRETE
SCALE: NTS ILLUSTRATIVE VIEW

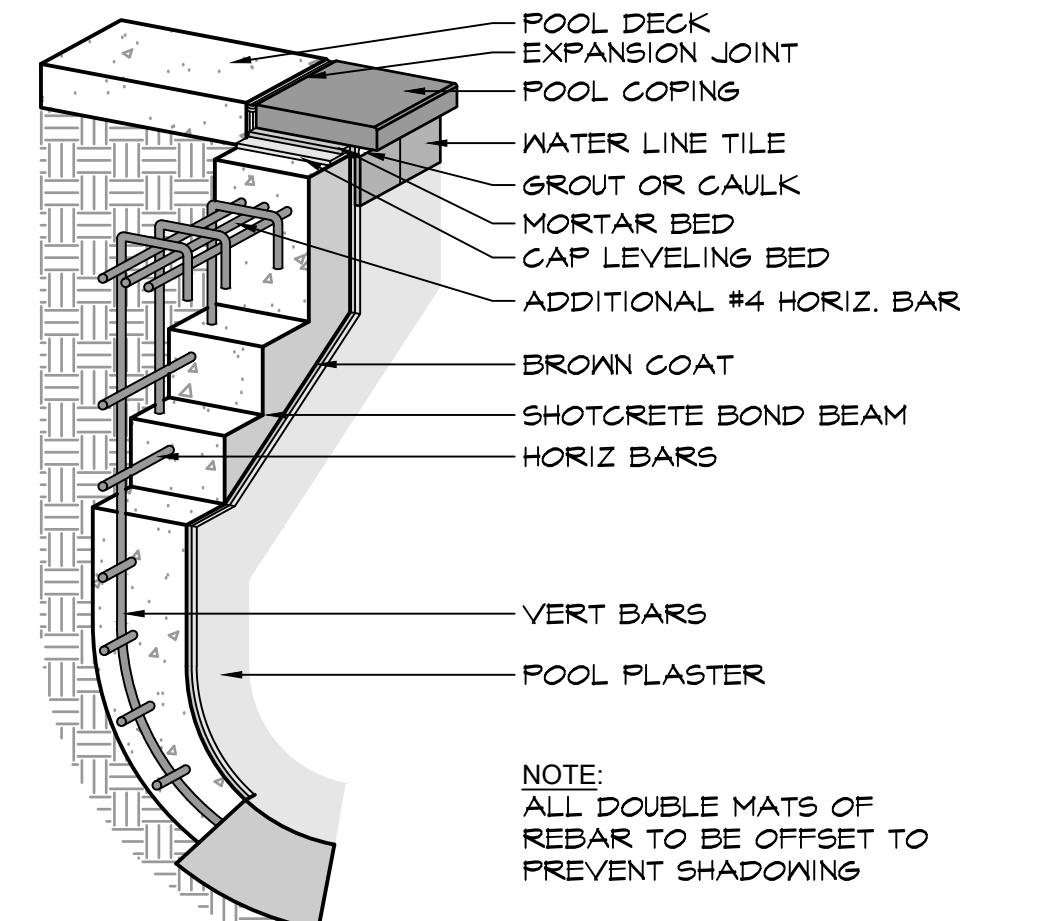


3 BOND BEAM REBAR VIGNETTE
SCALE: NTS ILLUSTRATIVE VIEW

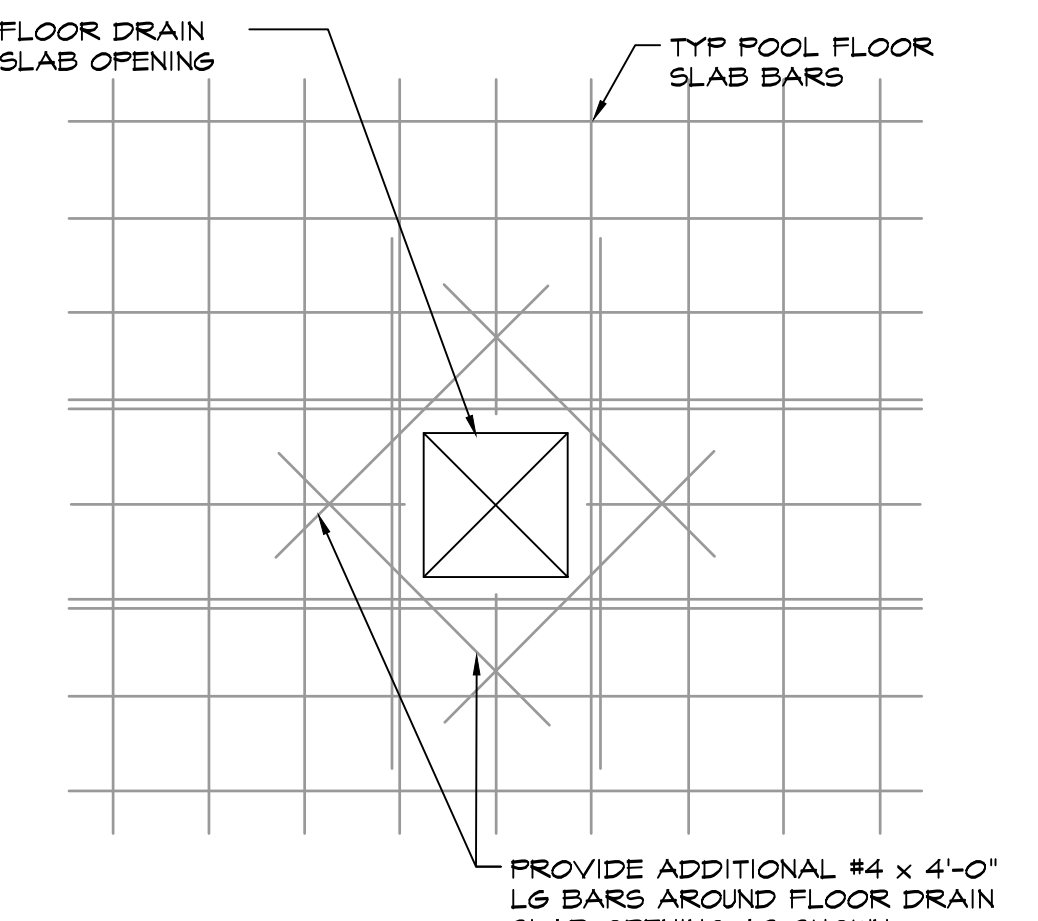


7 TYPICAL REBAR AT POOL DRAIN
SCALE: 1" = 1'-0" SECTION

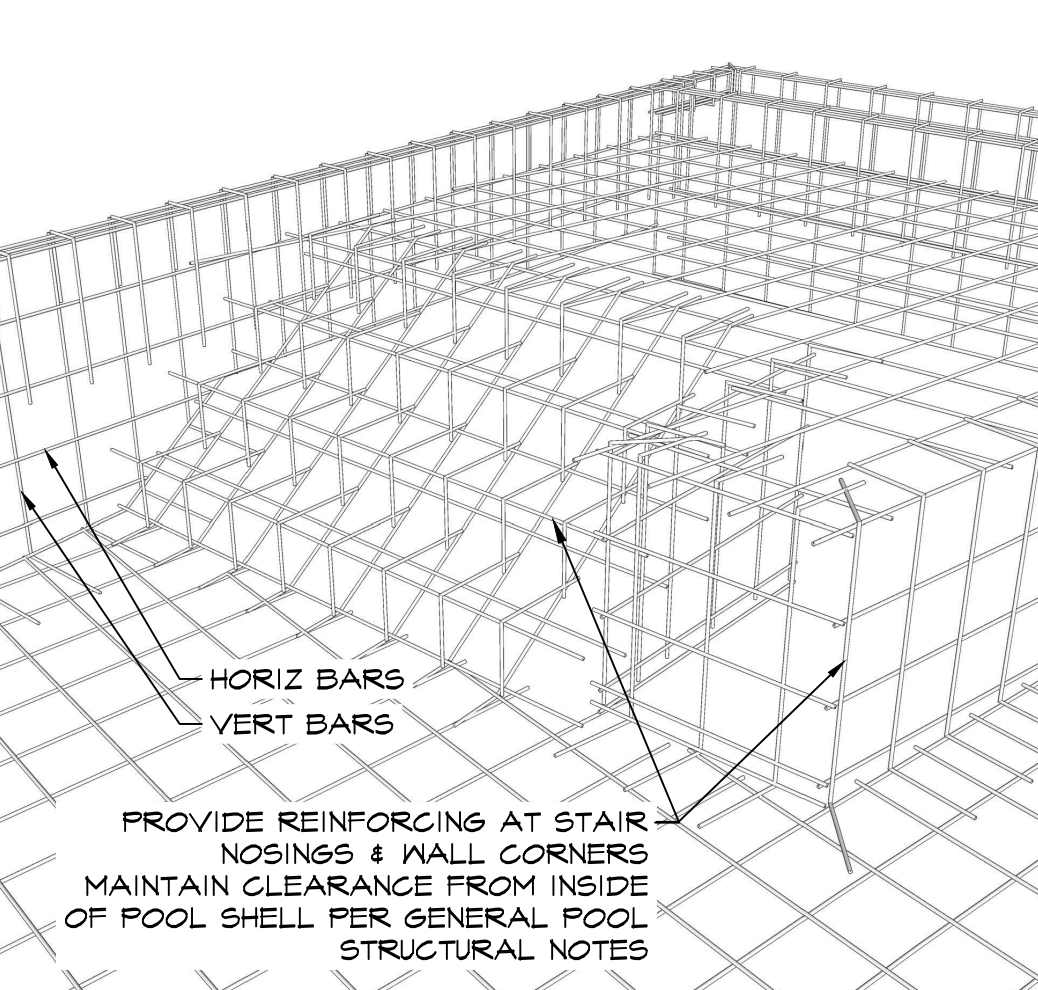


11 TYPICAL REBAR LAYOUT
SCALE: N.T.S. VIGNETTE

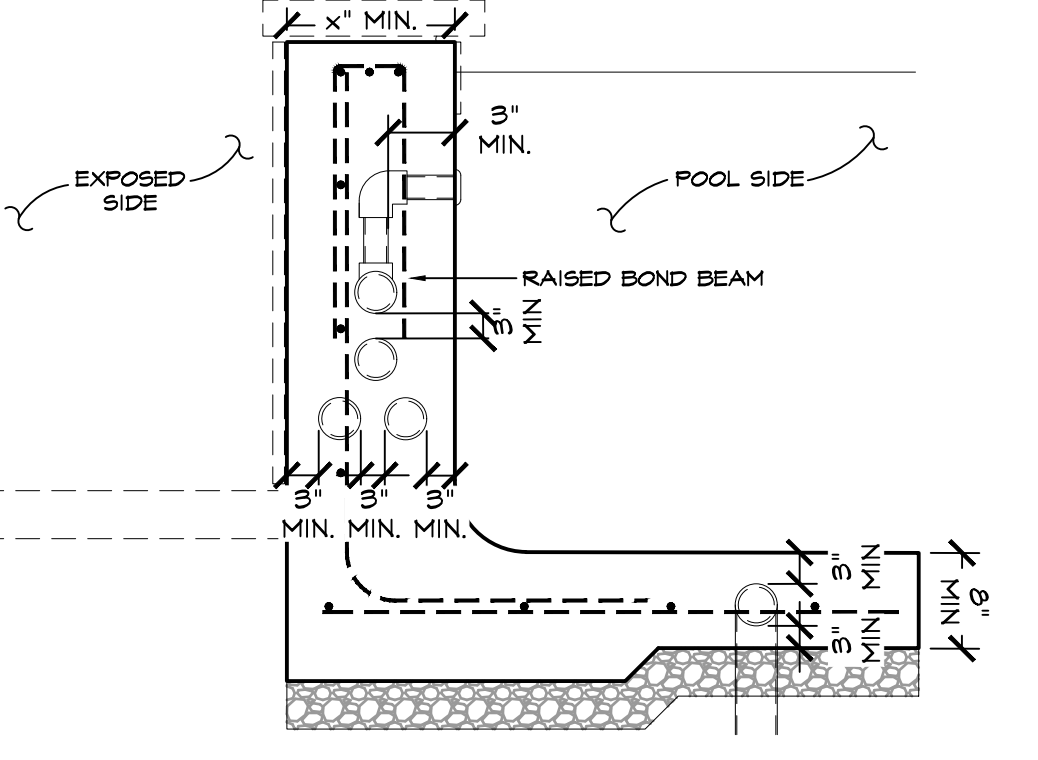

14 BOND BEAM PLUMBING CLEARANCES
SCALE: N.T.S. CROSS SECTION

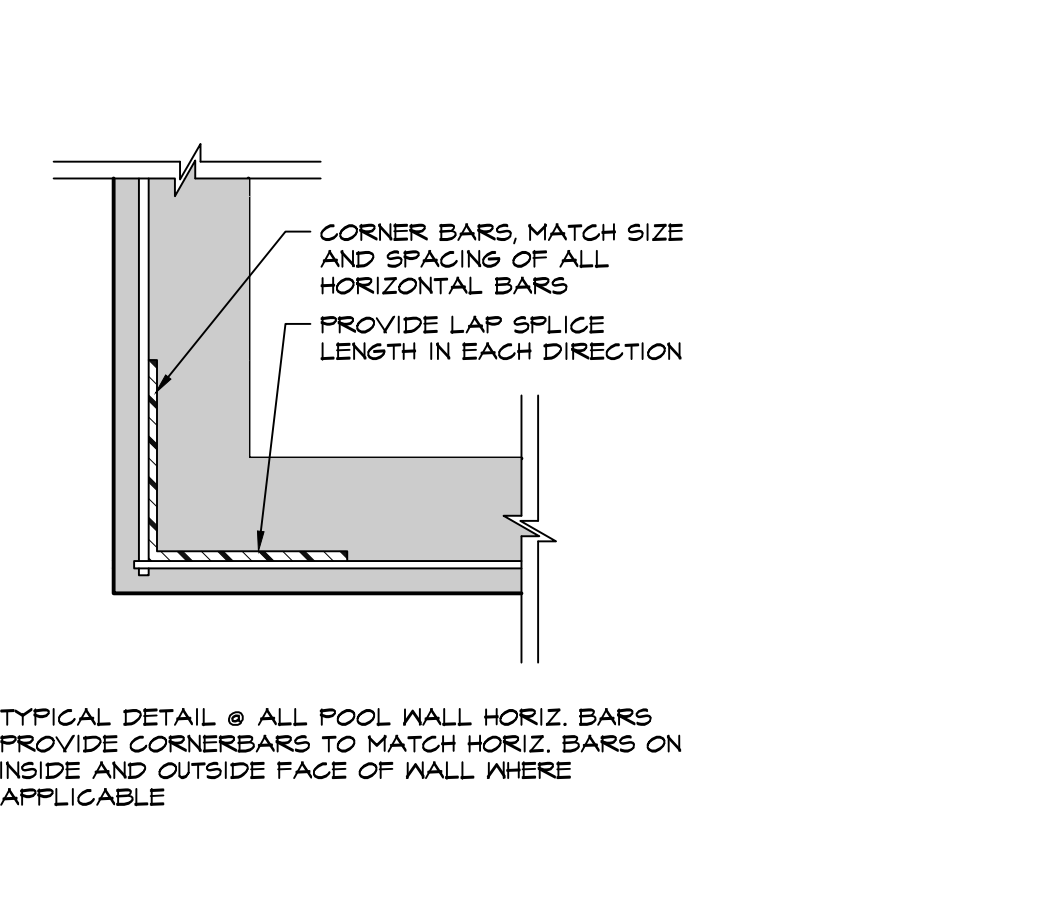


4 CORNER BAR DETAIL
SCALE: NTS

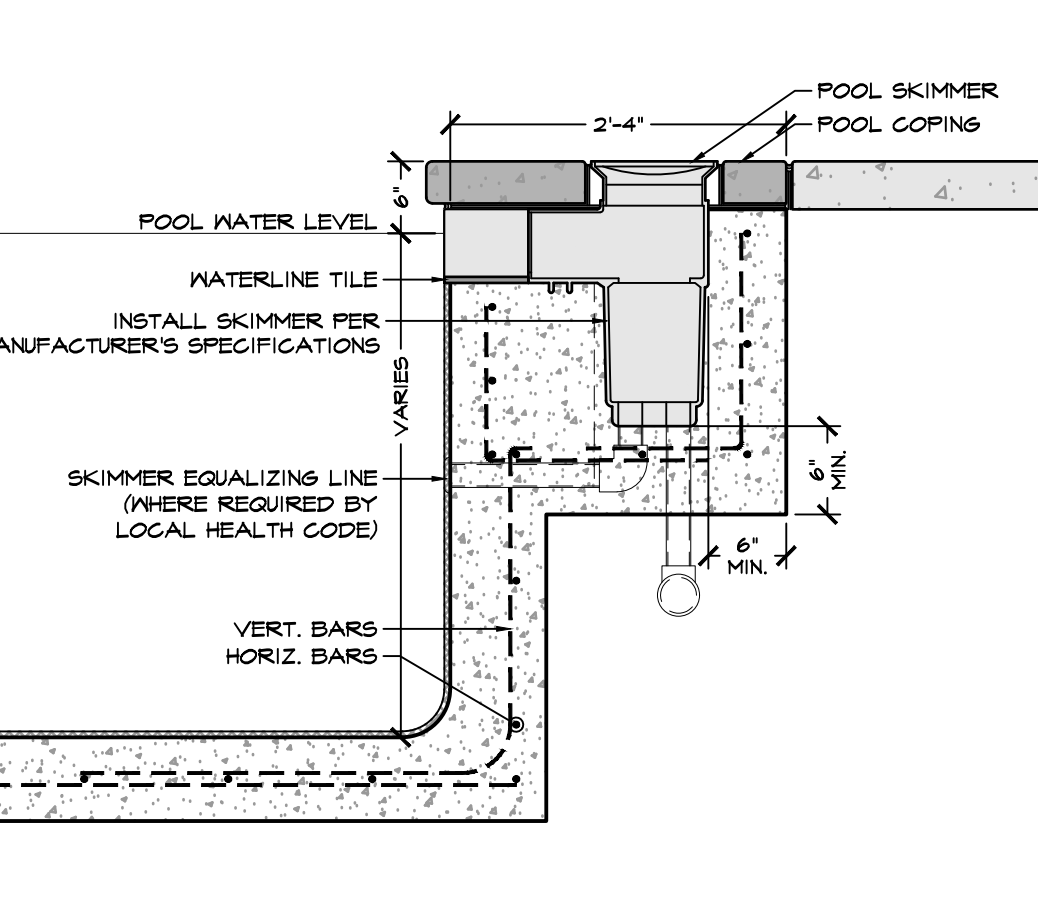



8 REINFORCING AT SKIMMER
SCALE: N.T.S. CROSS SECTION

12 NOT USED
SCALE: N.T.S.


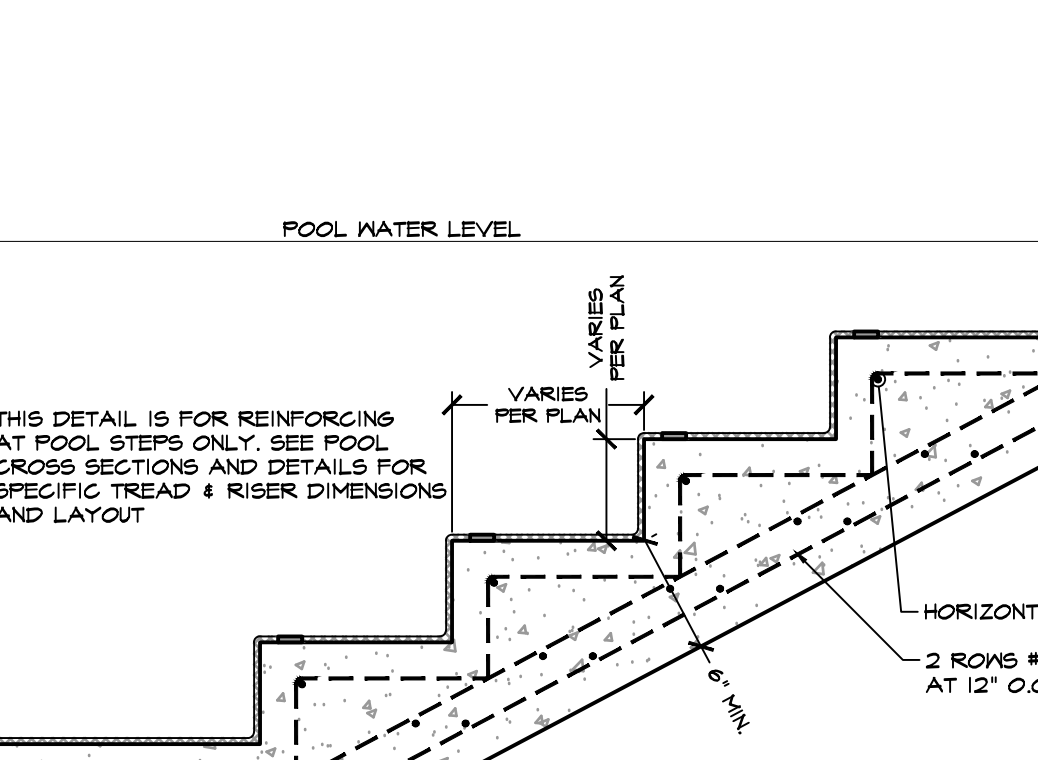


15 REINFORCING AT POOL STEPS
SCALE: N.T.S. CROSS SECTION


14 BOND BEAM PLUMBING CLEARANCES
SCALE: N.T.S. CROSS SECTION

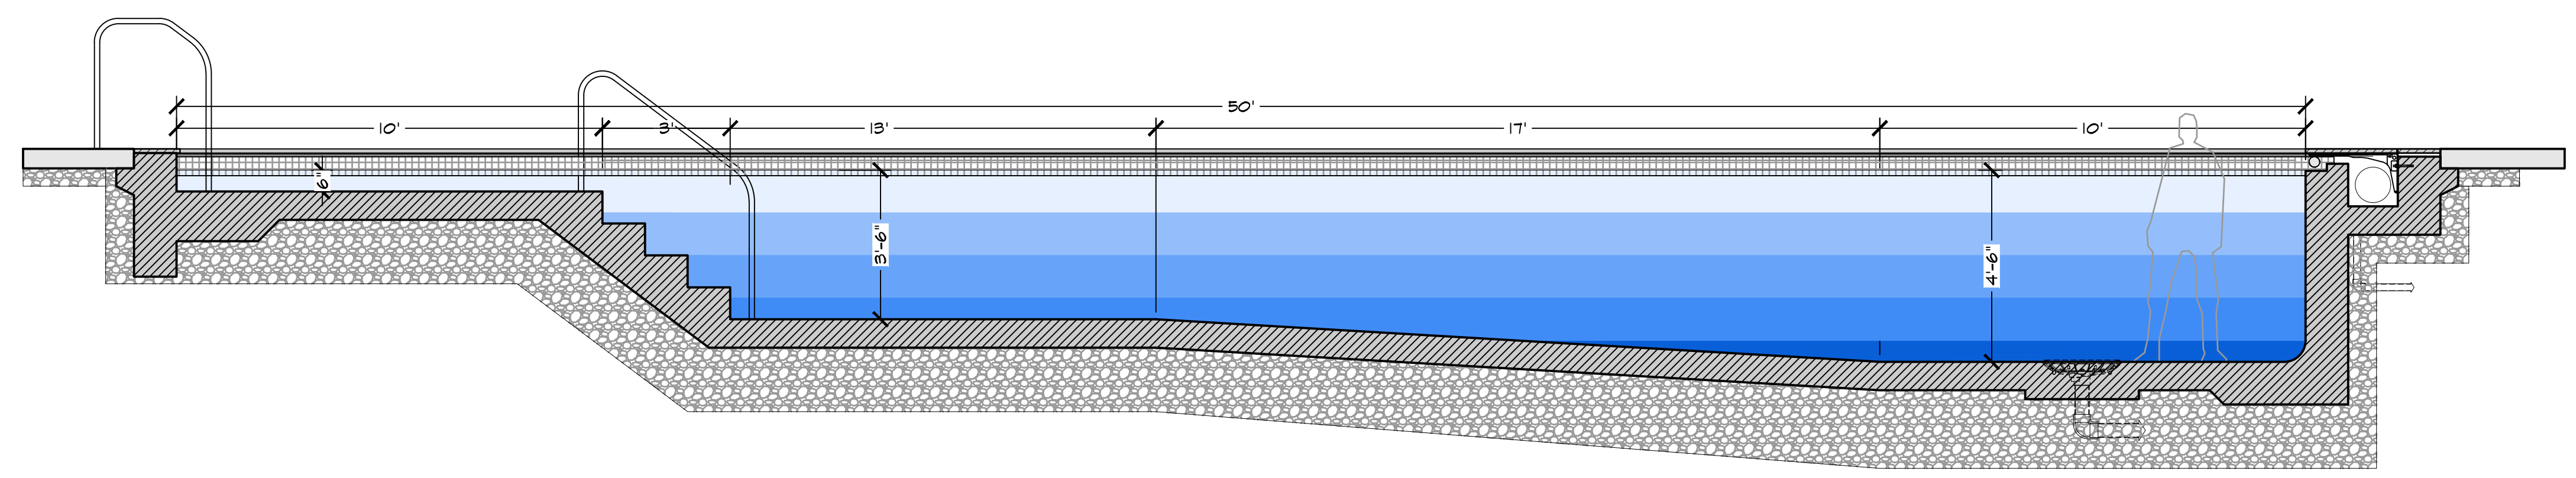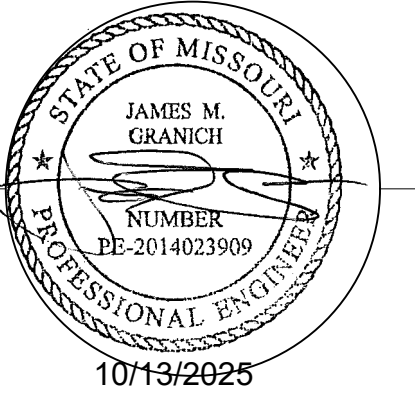

1 POOL CROSS SECTION
 SCALE: 3/8" = 1'-0" SECTION

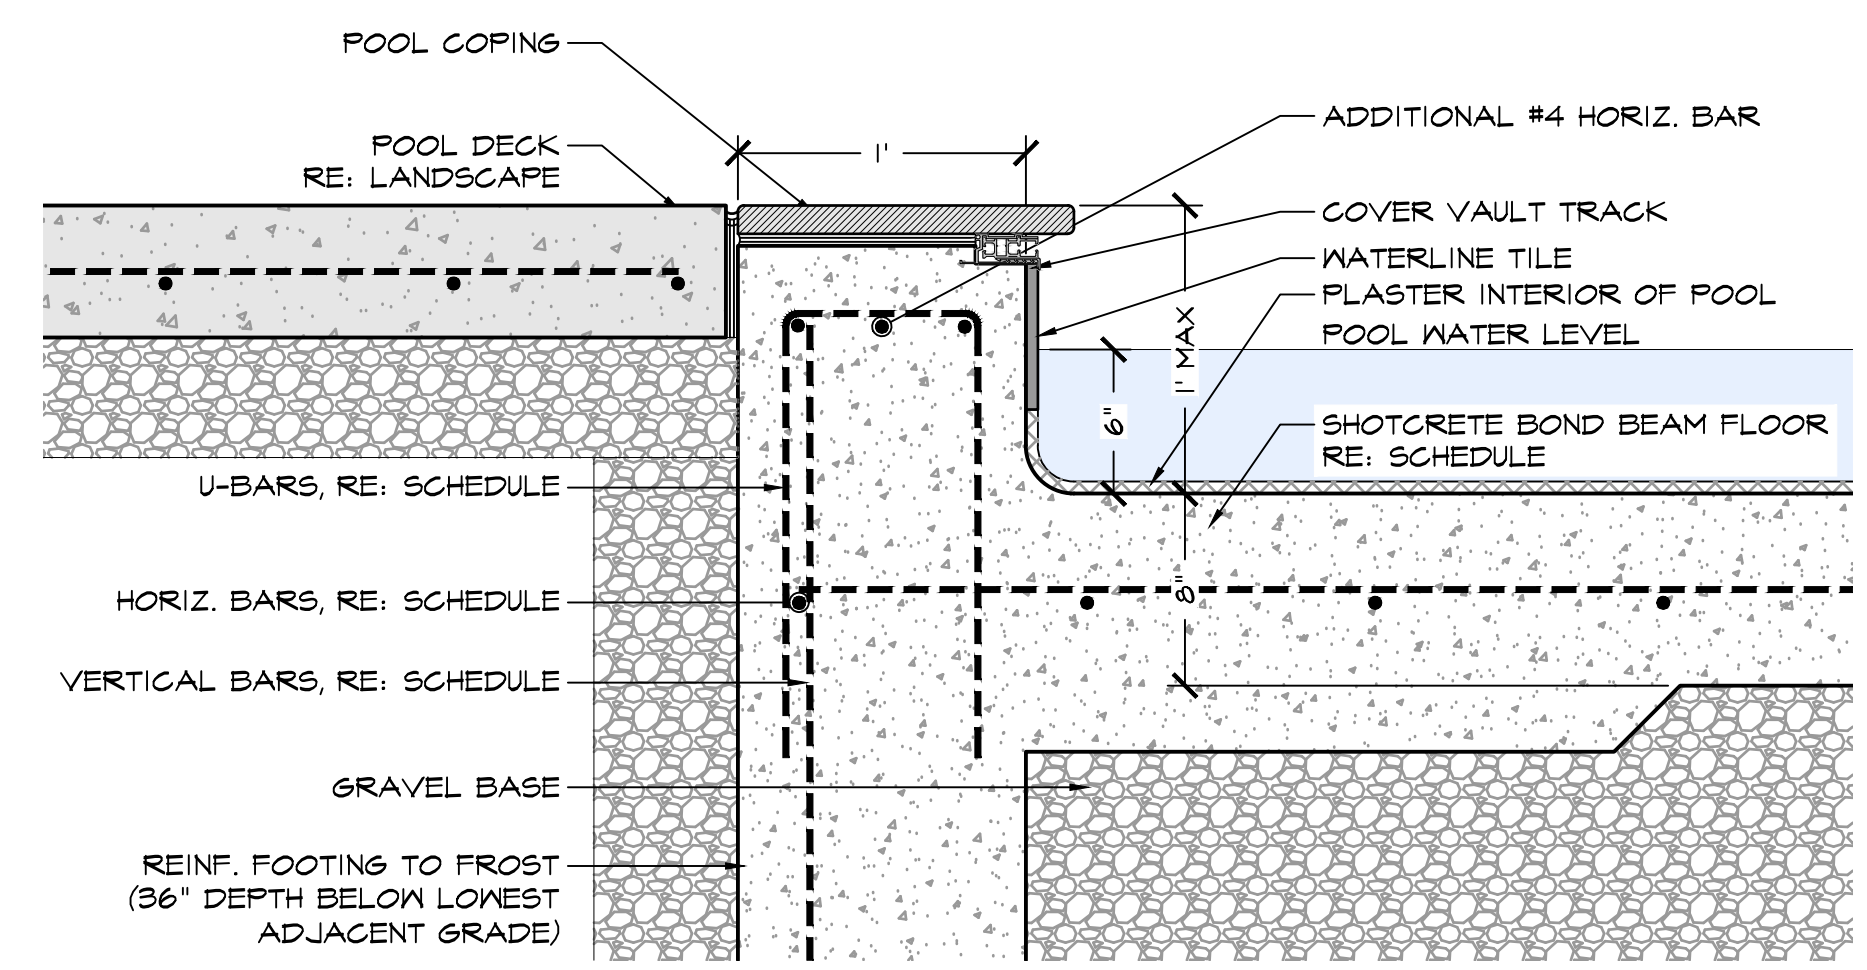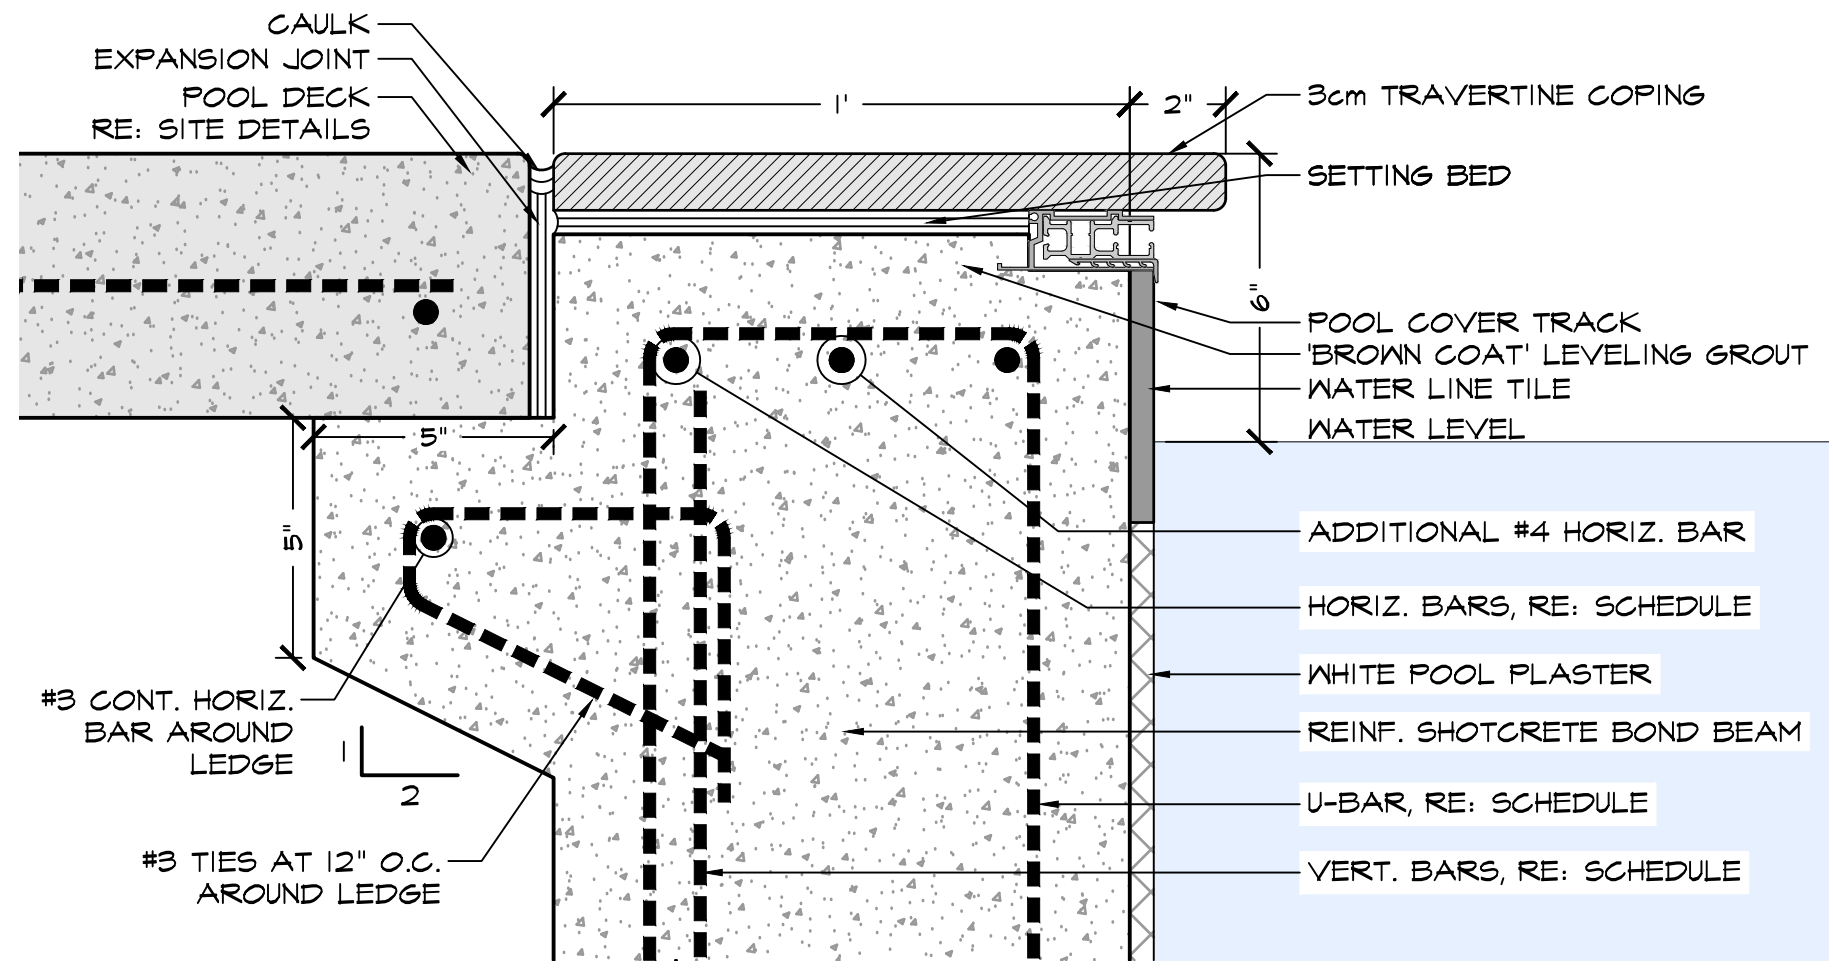


3 TYPICAL POOL ENTRY REEF
 SCALE: 1-1/2" = 1'-0" SECTION

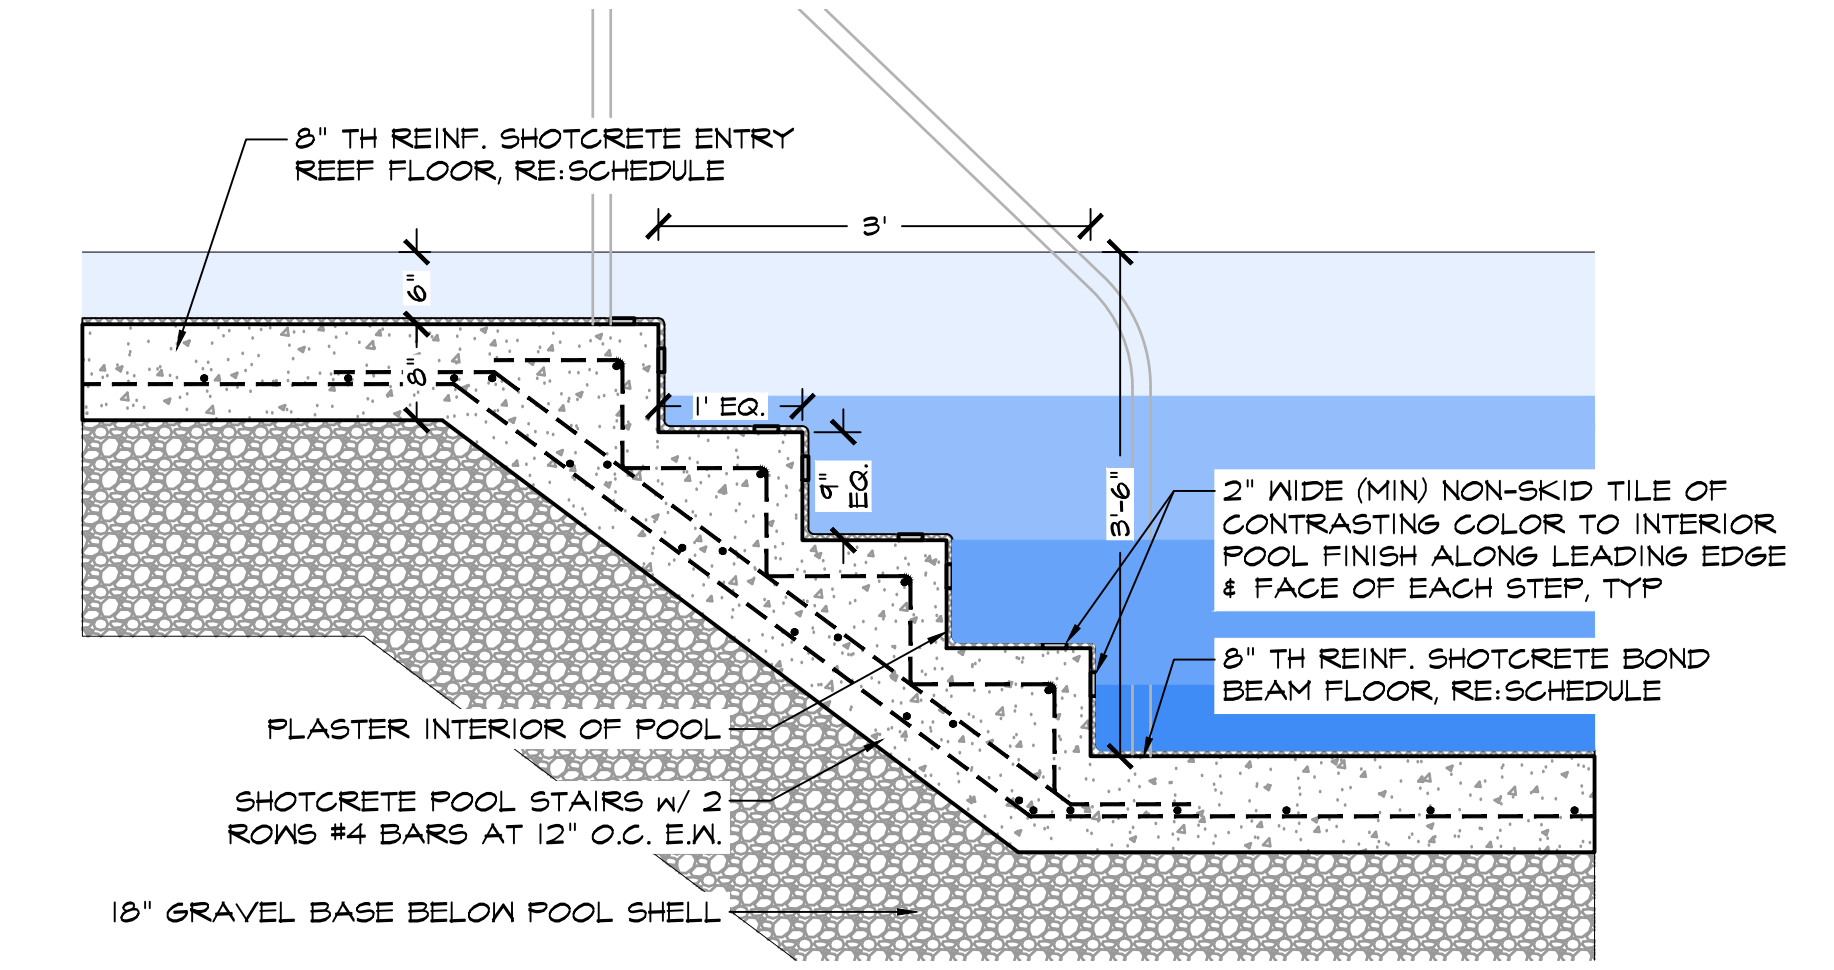


4 POOL STAIRS
 SCALE: 3/4" = 1'-0" SECTION

2 TYP. BOND BEAM AND COPING
 SCALE: 3" = 1'-0" SECTION

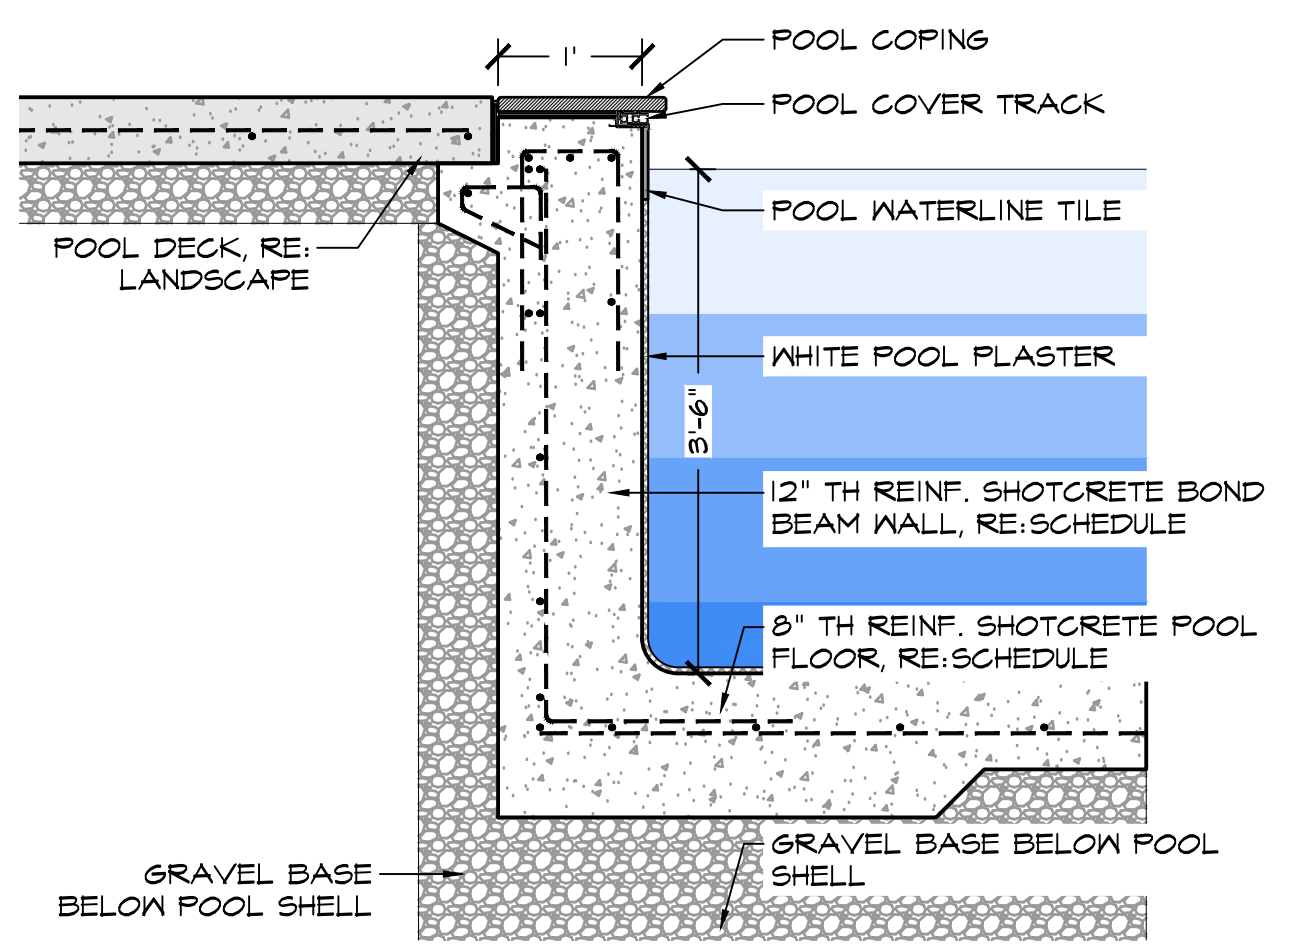


5 SHALLOW END
 SCALE: 3/4" = 1'-0" SECTION

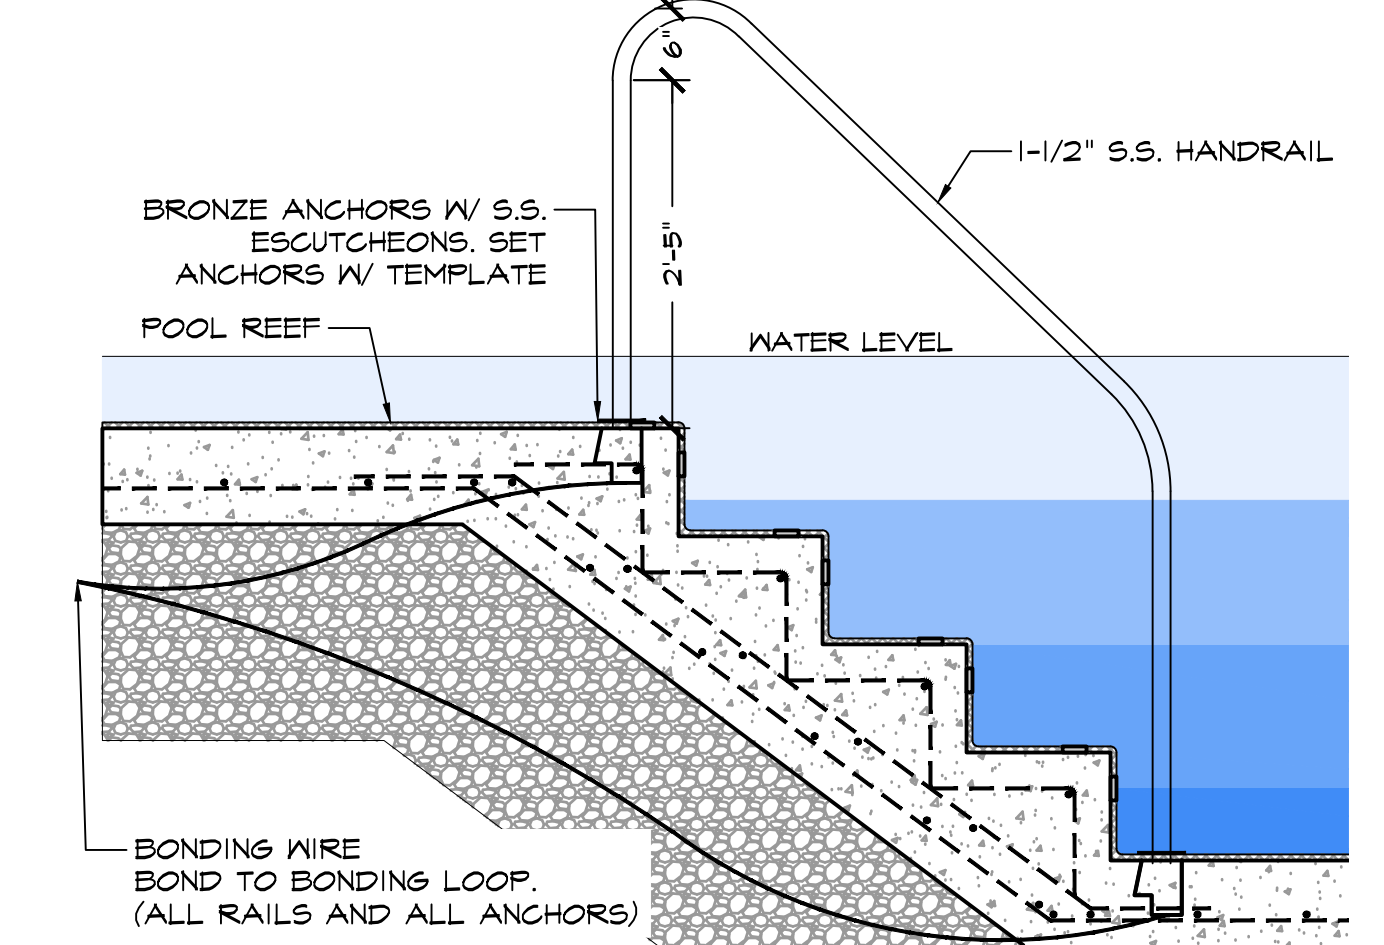


8 REEF HANDRAIL
 SCALE: 1" = 20'-0" SECTION

6 DEEP END
 SCALE: 3/4" = 1'-0" SECTION

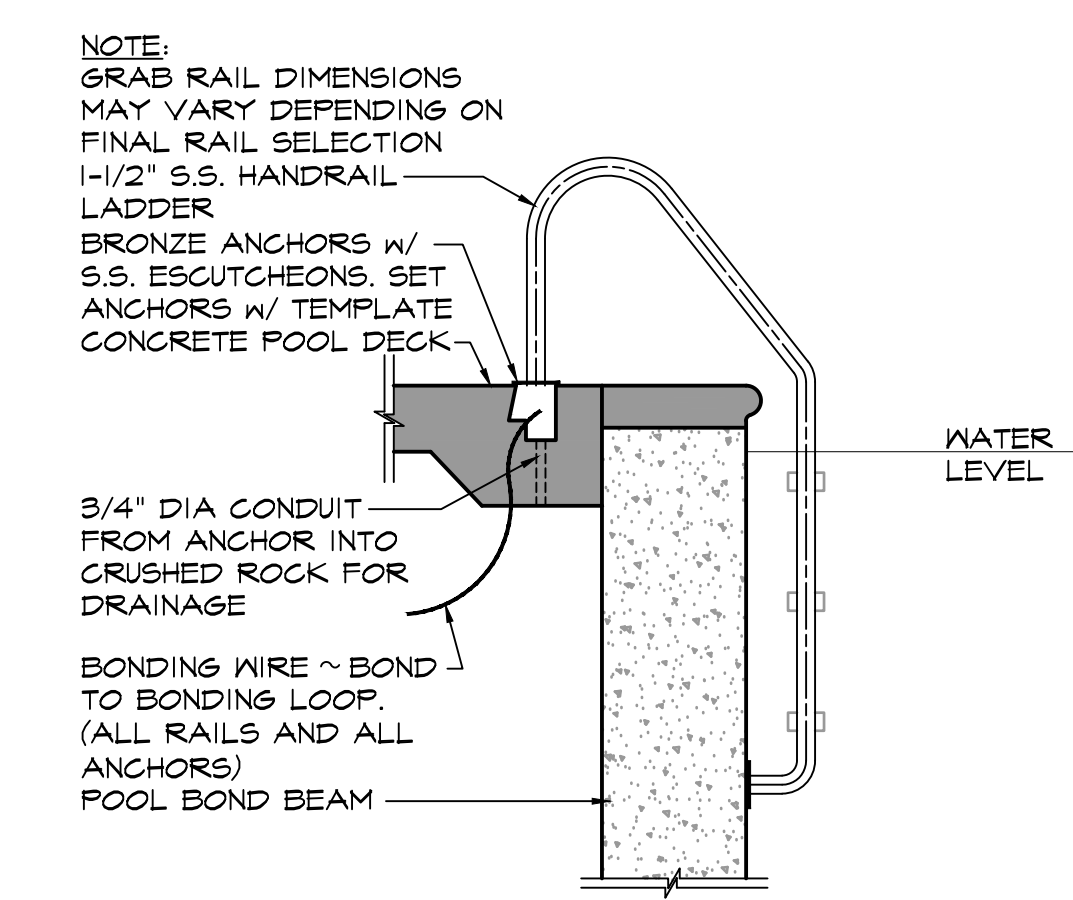

9 LADDER DETAIL
 SCALE: 3/4" = 1'-0" SECTION

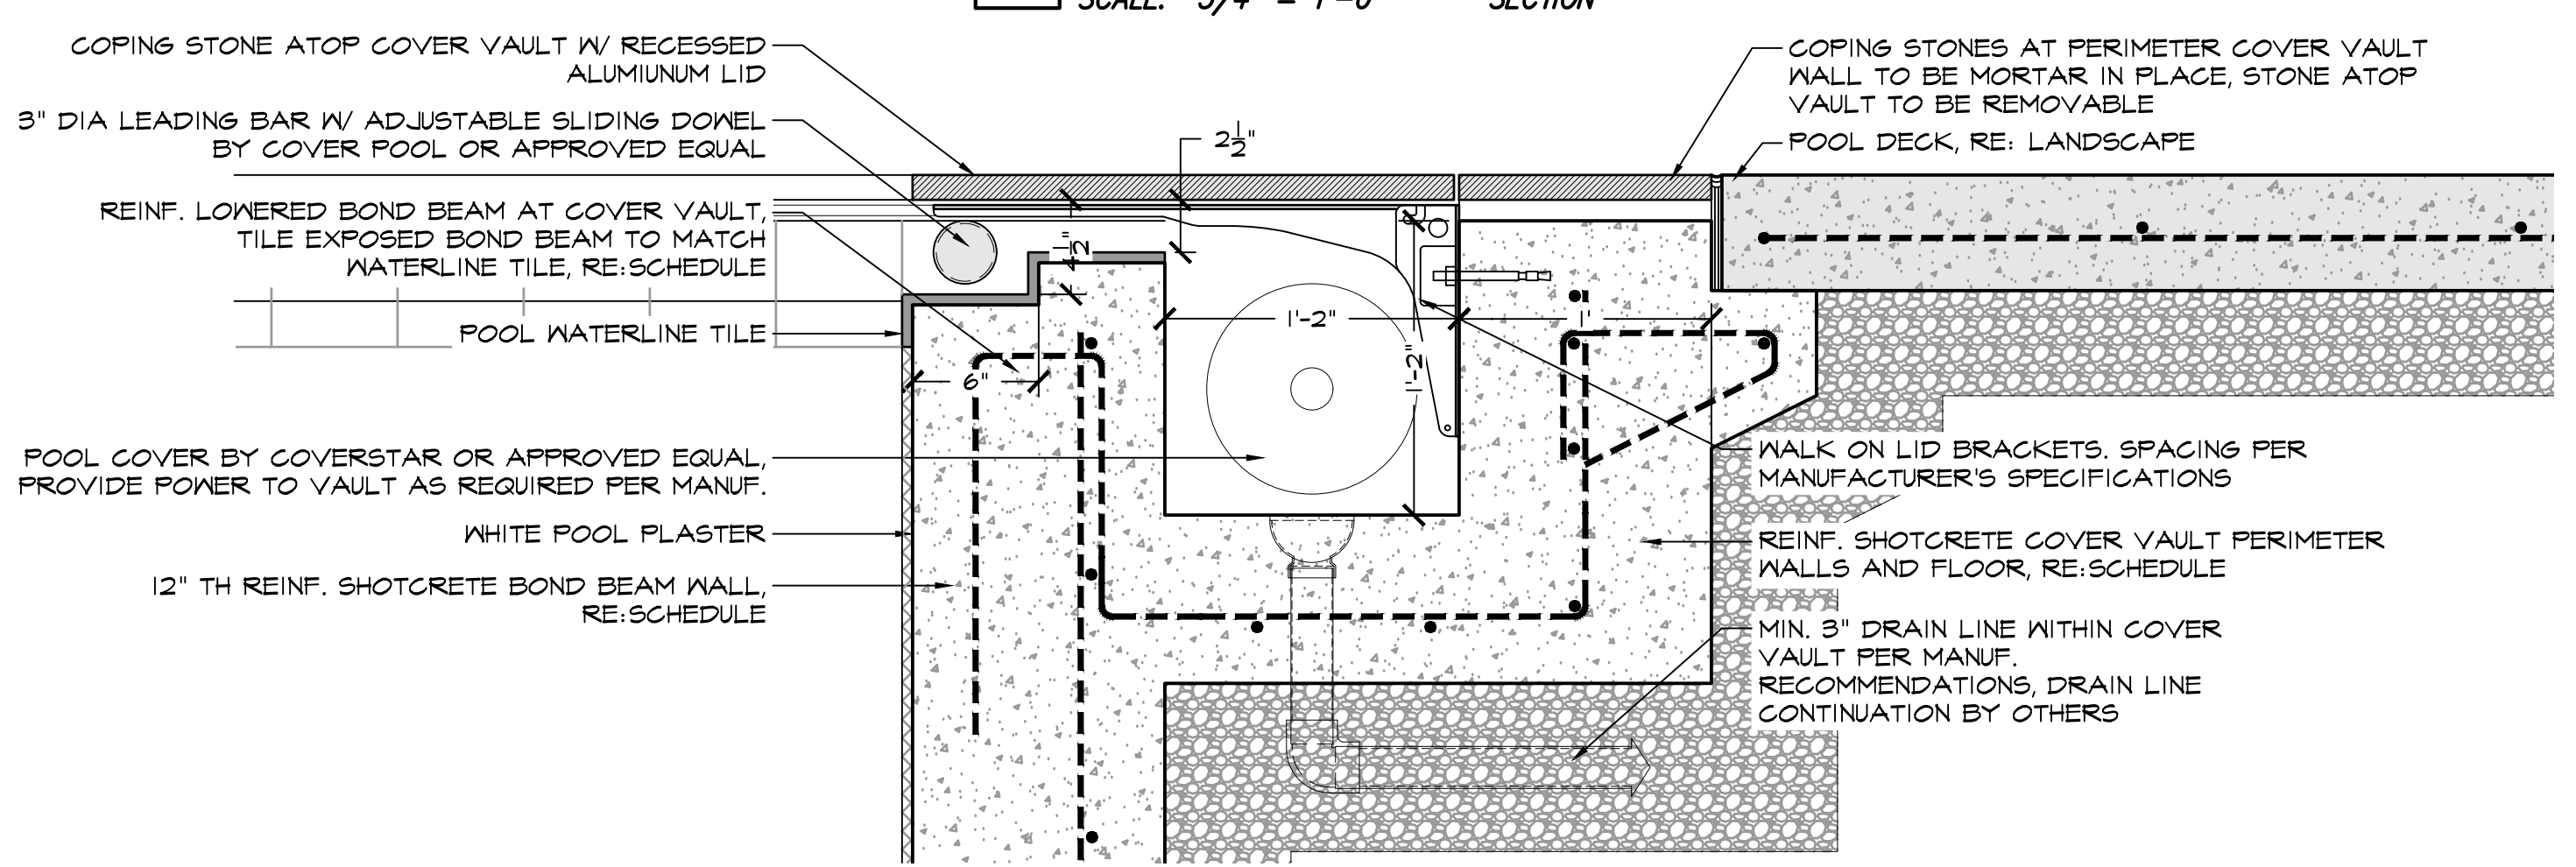

7 POOL COVER VAULT
 SCALE: 1-1/2" = 1'-0" SECTION

DOUGLAS STATION
 NW SLOAN & NE SYCAMORE ST
 LEE'S SUMMIT, MO 64086

REVISION:

 10/13/2025
 POOL CROSS SECTIONS
W103



10.13.2025

DOUGLAS STATION
NW SLOAN & NE SYCAMORE ST
LEE'S SUMMIT, MO 64086

REVISION:


10/13/2025

POOL DETAILS

W105

DETAIL NOTES:
1. INSTALL ALL EQUIPMENT PER MANUFACTURER'S INSTRUCTIONS.
2. INSTALL BONDING PER NEC 680.26
3. INSTALL PER LOCAL CODES. THIS MAY REQUIRE THE ADDITION OF A PRESSURE RELIEF VALVE NOT TO EXCEED 50 PSI

VENT TERMINATION CLEARANCES		TYPE 'B' DOUBLE-WALL VENT w/ TYPE 'B' DOUBLE-WALL CONNECTOR IN FEET				
DESCRIPTION	MIN CLEARANCE DIM	MODEL 175 VENT SIZE	MODEL 200 HEIGHT MIN/MAX	MODEL 250 HEIGHT MIN/MAX	MODEL 300 HEIGHT MIN/MAX	MODEL 350 HEIGHT MIN/MAX
VERTICAL THROUGH ROOF	2' (600MM) ABOVE ALL STRUCTURES WITHIN 10' (3000MM)	6"	6' / 100'	6' / 100'	18' / 100'	30' / 100'
VERTICAL TO UNDERSIDE OF ROOF OR DECK OVERHANGS	3' (900MM)	7"	6' / 100'	6' / 100'	8' / 100'	15' / 100'
CLEARANCE FROM WALLS	6" (150MM)	8"	6' / 100'	6' / 100'	6' / 100'	8' / 100'
CLEARANCE FROM ANY OPENING INTO A BUILDING	4' (1200MM)	9" & 10"	6' / 50'	6' / 50'	6' / 50'	6' / 100'
CLEARANCE FROM ELECTRIC METERS, PANELS, GAS METERS, REGULATORS, AND RELIEF EQUIPMENT	4' (1200MM)	TYPE 'B' DOUBLE-WALL VENT w/ SINGLE WALL CONNECTOR IN FEET				
CLEARANCE FROM PROPERTY LINE	1'-6" (450MM)	6"	6' / 15'	6' / 15'	6' / 15'	NOT REC.
CLEARANCE FROM A/C OR HEAT PUMP	3' (900MM)	7"	6' / 8'	6' / 8'	6' / 8'	10' / 20'
CLEARANCE ABOVE FINISHED GRADE AND NORMAL SNOW LEVEL	1' (300MM)	8"	NOT REC.	NOT REC.	NOT REC.	6' / 20'
		9"	NOT REC.	NOT REC.	NOT REC.	NOT REC.
		10"	NOT REC.	NOT REC.	NOT REC.	NOT REC.

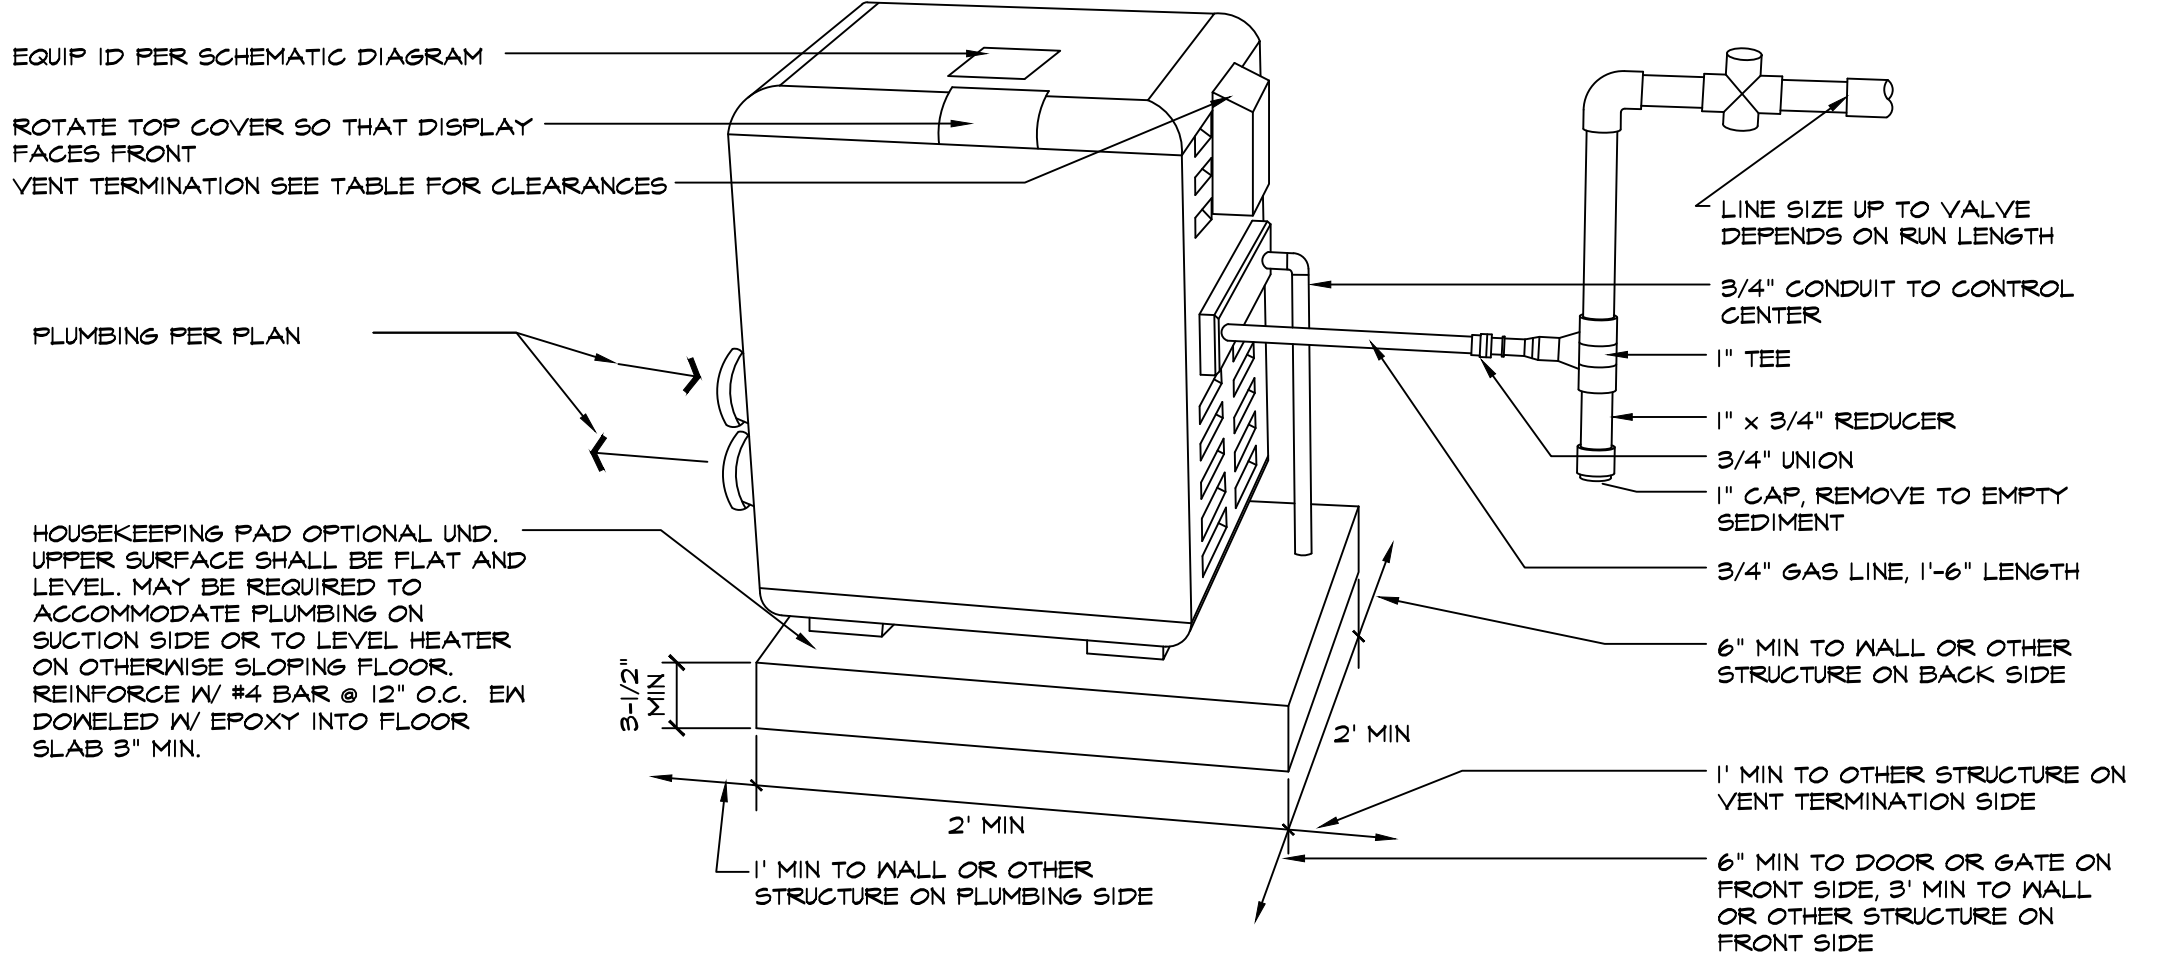


3 TYPICAL HEATER INSTALLATION
SCALE: NTS

POLYETHYLENE (PE) GAS LINE BURIAL DEPTHS		
LOCATION	NORMAL SOIL	CONSOLIDATED ROCK
SERVICE LINES: PRIVATE PROPERTY	18"	18"
SERVICE LINES: UNDER STREETS, ROADS, AND DRIVEWAYS	24"	18"
TRANSMISSION LINES AND MAINS CLASS 1 LOCATION	30"	18"
TRANSMISSION LINES AND MAINS: CLASS 2, 3, AND 4 LOCATION	36"	24"
TRANSMISSION LINES AND MAINS: DRAINAGE DITCHES OF PUBLIC ROADS AND RAILROAD CROSSINGS	36"	24"
TRANSMISSION LINES AND MAINS: NAVIGABLE RIVERS, STREAMS OR HARBORS (MEASURED TOP OF PIPE TO NATURAL BOTTOM)	48"	24"


DETAIL NOTES:
7. A HYDROSTATIC PRESSURE TEST SHALL HOLD MIN 20 PSI WITH ZERO DROP IN 12 HOURS.
8. PE 2406/2708 MOPE YELLOW PIPE BY CHARTER PLASTICS.
9. PROPANE MAX OPERATING PRESSURE IS 30 PSI @ 73.4°F

DETAIL NOTES:
1. POLYETHYLENE PIPE SHALL CONFORM TO ASTM D2513-05D STANDARD SPECIFICATION FOR THERMOPLASTIC GAS PRESSURE PIPE, TUBING, AND FITTINGS.
2. POLYETHYLENE PIPE DIMENSIONS SHALL BE BASED ON IRON PIPE SIZE STANDARDS INSTEAD OF COPPER TUBE SIZE PER TABLE BELOW
3. POLYETHYLENE COLOR SHALL BE YELLOW.
4. GAS PLUMBING SHALL BE INSTALLED WITH AN ELECTRICALLY CONTINUOUS INSULATED NUMBER 18 AWG COPPER TRACER WIRE TERMINATING ABOVE GRADE AT ALL ENDS OF THE GAS LINES.
5. PVC AND COPPER SHALL NOT BE USED FOR GAS PLUMBING.
6. APPROVED PLASTIC-TO-METAL TRANSITION FITTINGS SHALL BE USED TO RISE ABOVE GRADE.

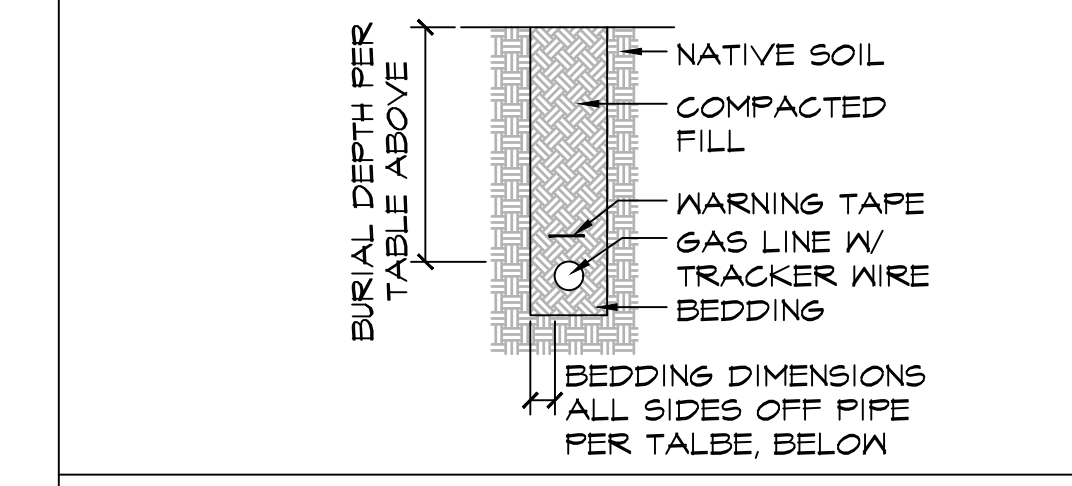

POLYETHYLENE (PE) PIPE SPECIFICATIONS						
NOMINAL SIZE	OUTSIDE DIA (IPS STD)	MIN WALL THICKNESS	DIA RATIO (DR)	MIN BEND RADIUS	NET GAS MAX PRESS	MIN BEDDING DIMENSIONS
1/2"	0.830"	0.041"	4.3	18"	81 PSI	2"
3/4"	1.060"	0.046"	11	21"	68 PSI	2"
1"	1.315"	0.120"	11	27"	68 PSI	2"
-1/4"	1.360"	0.151"	11	34"	68 PSI	2"
-1/2"	1.400"	0.173"	11	38"	68 PSI	2"
2"	2.375"	0.216"	11	48"	68 PSI	2"
3"	3.500"	0.304"	11.5	84"	64 PSI	3"
4"	4.500"	0.333"	13.5	108"	54 PSI	4"
5"	6.625"	0.491"	13.5	160"	54 PSI	6"

7 POLYETHYLENE GAS PIPING
SCALE: NTS ILLUSTRATIVE VIEW

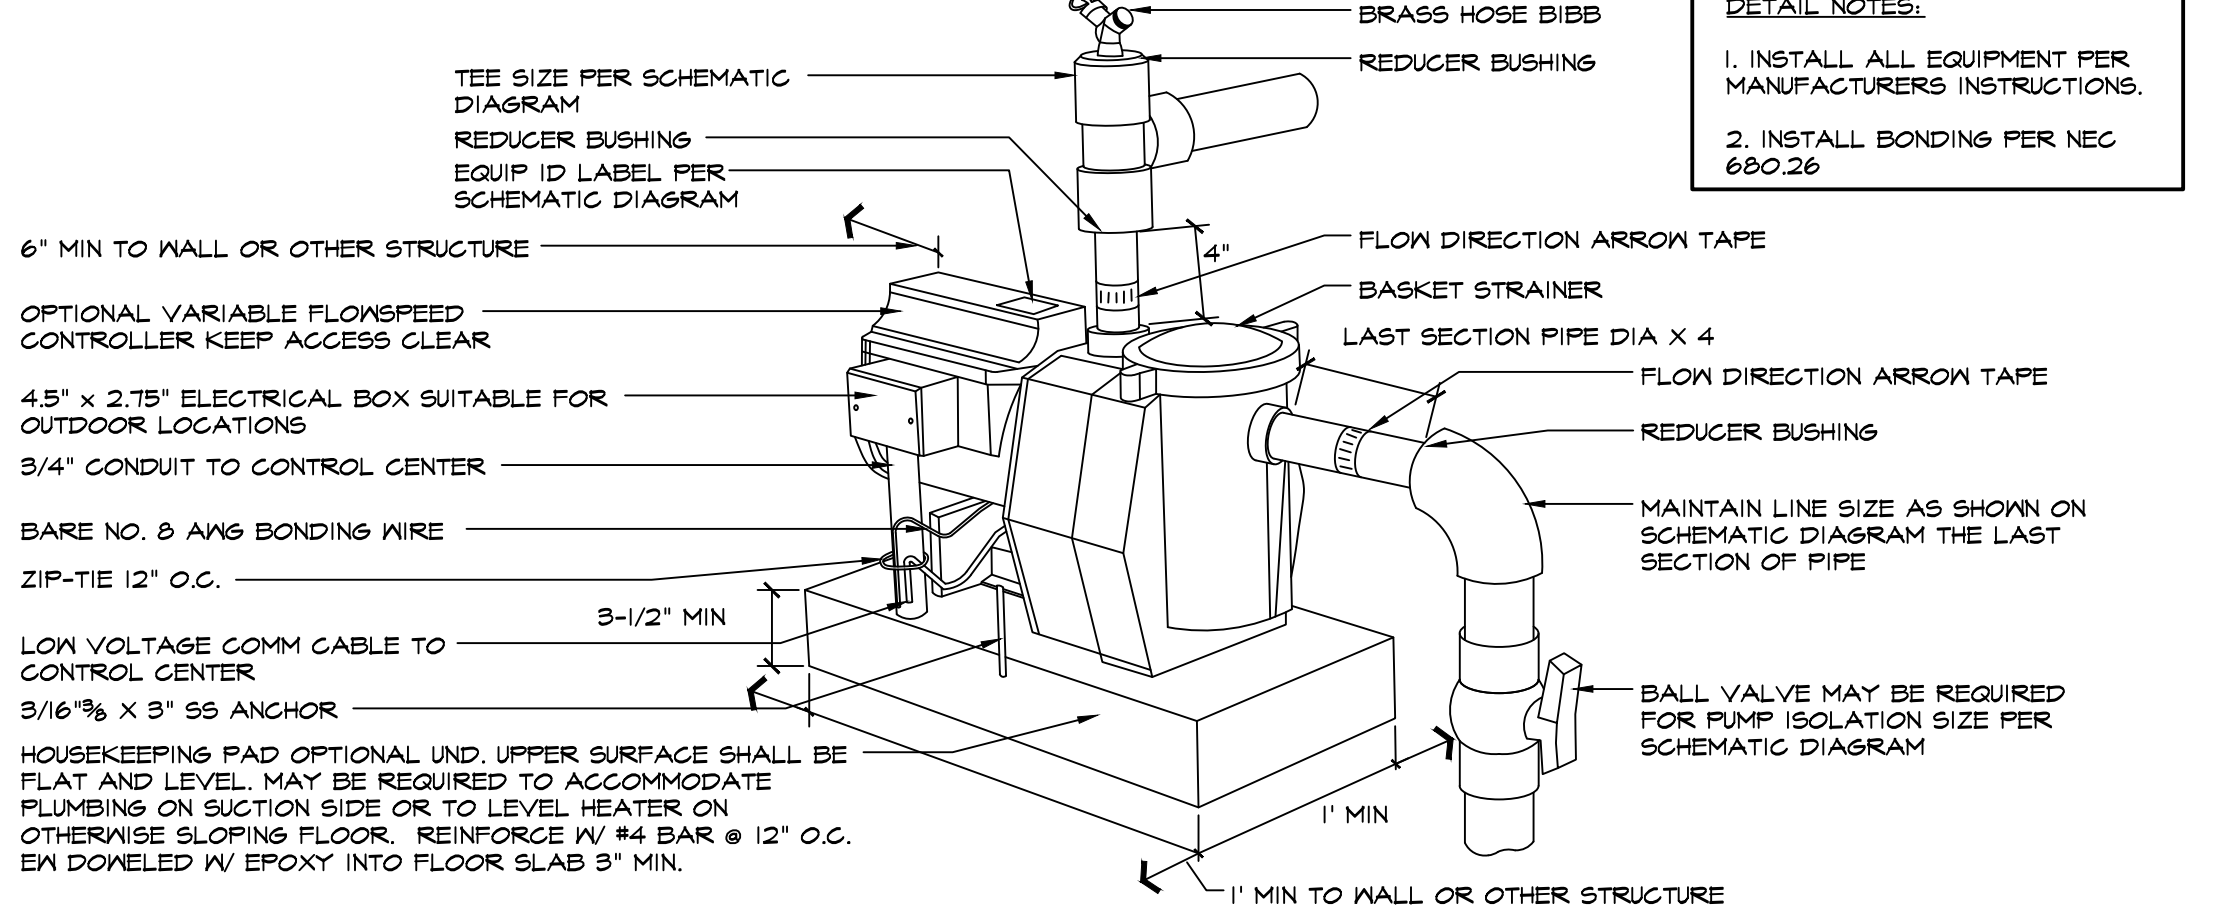


1 TYPICAL PUMP INSTALLATION
SCALE: NTS

METAL FLUE COLLAR	PART NO.
4 x 6"	11107-0016
4 x 8"	11101-0011

1. SEE TABLE 10, TO DETERMINE ALLOWABLE VENT SIZES FOR YOUR HEATER.
NOTICE: TABLE 10 IS FOR INSTALLATIONS IN WHICH THE TOTAL LATERAL VENT LENGTH (THAT IS HORIZONTAL DISTANCE FROM THE FLUE COLLAR TO THE COLLAR TO THE MAIN VERTICAL PORTION OF THE VENT) IS LESS THAN 1/2 THE TOTAL VENT HEIGHT (THE VERTICAL DISTANCE FROM THE FLUE COLLAR TO THE VENT TERMINATION) AND WHICH HAVE THREE OR LESS ELBOWS IN THE SYSTEM. FOR VENTING SYSTEMS WHICH DO NOT MEET THESE CONDITIONS, CONSULT THE NATIONAL FUEL GAS CODE, ANSI Z223.1 (U.S.).
READ "VERTICAL VENTING - NEGATIVE PRESSURE" BEFORE USING THIS TABLE.

TABLE 10 - PERMITTED MINIMUM AND MAXIMUM VENT HEIGHTS BY SIZE AND HEATER MODEL					
TYPE 'B' DOUBLE-WALL VENT WITH TYPE 'B' DOUBLE-WALL CONNECTOR IN FEET (METERS)					
VENT SIZE	MODEL 175 HEIGHT MIN/MAX	MODEL 200 HEIGHT MIN/MAX	MODEL 250 HEIGHT MIN/MAX	MODEL 300 HEIGHT MIN/MAX	MODEL 400 HEIGHT MIN/MAX
6"	6' (1.8)/100' (30.5)	6' (1.8)/100' (30.5)	18' (5.3)/100' (30.5)	30' (9.1)/100' (30.5)	NOT REC.
7"	6' (1.8)/100' (30.5)	6' (1.8)/100' (30.5)	9' (2.4)/100' (30.5)	6' (1.8)/100' (30.5)	15' (4.6)/100' (30.5)
8"	6' (1.8)/100' (30.5)	6' (1.8)/100' (30.5)	6' (1.8)/100' (30.5)	6' (1.8)/100' (30.5)	6' (1.8)/100' (30.5)
9" AND 10"	6' (1.8)/50' (15.3)	6' (1.8)/50' (15.3)	6' (1.8)/50' (15.3)	6' (1.8)/100' (30.5)	6' (1.8)/100' (30.5)

4 PIPE/WALL SEAL (LINK SEAL)
SCALE: NTS

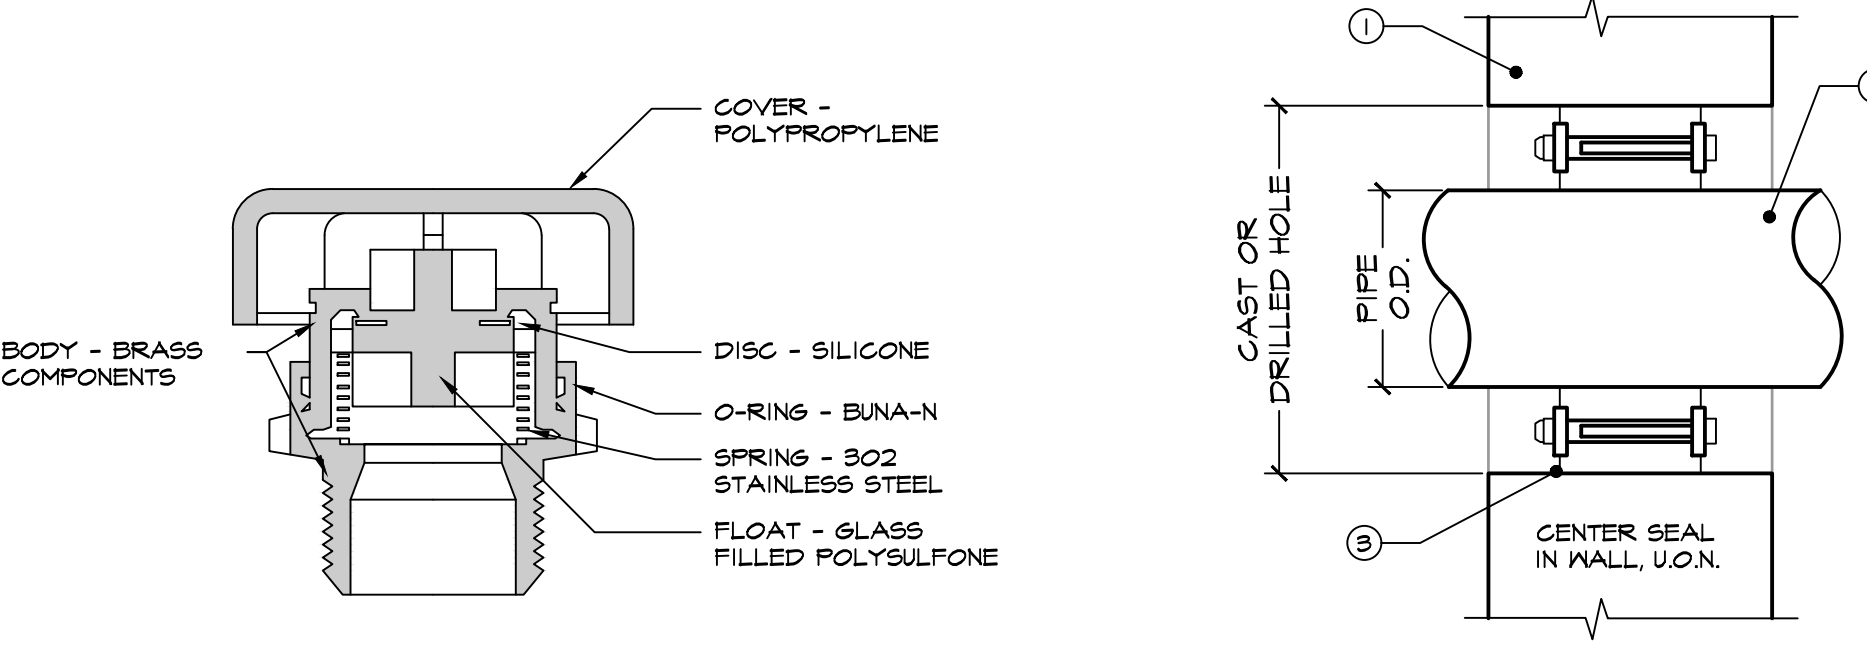

DETAIL KEYNOTES:
1. CAST-IN-PLACE CONCRETE OR MASONRY WALL AS DETAILED ELSEWHERE
2. PIPE AS SHOWN ON PLAN AND AS DETAILED ELSEWHERE
3. PIPE SEAL PER 'LINK-SEAL' TO SIZE SHOWN ON TABLE - INSTALL PER MFR. REQUIREMENTS


PIPE SIZE (NORMAL)	OUTSIDE DIA (IPS O.D.)	CAST OR DRILLED CONG. HOLE INSIDE DIAM. (I.D.)	LINK SEAL PRODUCT #	NO. OF LINKS PER SEAL
1/2"	0.810	2.0	LS-200	4
3/4"	1.050	2.5	LS-215	5
1"	1.315	3.0	LS-300	5
-1/4"	1.660	3.5	LS-215	4
-1/2"	1.900	3.5	LS-300	5
2-1/2"	2.375	4.0	LS-300	5
3"	3.500	4.0	LS-300	5
3-1/2"	4.000	6.0	LS-315	6
4"	4.500	6.0	LS-300	5
5"	5.563	6.0	LS-425	6
6"	6.625	6.0	LS-425	6
8"	8.625	10.0	LS-425	6
10"	10.75	14.0	LS-400	6
12"	12.75	16.0	LS-425	6
14"	14.00	16.0	LS-325	6
16"	16.00	16.0	LS-325	6
18"	18.00	23.0	LS-500	6
20"	20.00	23.0	LS-500	6
22"	22.00	27.0	LS-500	6
24"	24.00	31.0	LS-500	6
26"	26.00	31.0	LS-500	6
28"	28.00	33.0	LS-500	6
30"	30.00	33.0	LS-500	6
32"	32.00	37.0	LS-500	6
34"	34.00	37.0	LS-500	6
36"	36.00	41.0	LS-500	6

6 PIPE/WALL SEAL (LINK SEAL)
SCALE: NTS

MODEL	MAX FLOW RATES (PER OUTLET) MOUNTING POSITIONS (xxx=COLOR SUFFIX)				
	32CDLTxxx (AND 32CDLTFxxx, 32CDLTVxxx)	32CDVxxx (AND 32CDVFRxxx, 32CDVAVxxx, 32CDVAGxxx)	32PDPxxx (MIN. 2" PIPE)	32CDBTxxx, 32CDBTFRxxx	32CDPHxxx (AND 32CDPHFRxxx, 32CDPHVxxx, 32CDPHFSxxx) (MIN. 2" PIPE)
FLOOR	316 GPM @ 3.9 FPS	196 GPM @ 1.3 FPS	236 GPM @ 3.4 FPS	120 GPM @ 1.2 FPS	120 GPM @ 1.2 FPS
WALL	208 GPM @ 2.6 FPS	192 GPM @ 1.2 FPS	136 GPM @ 1.9 FPS	N.A.	N.A.

PIPE SIZE	1 1/2"	2"	2 1/2"	3"
FLOW RATE IN GPM	45	80	110	160

WATER VELOCITY AND FLOW RATES
THE MAX WATER VELOCITY THROUGH DRAIN COVERS IS LIMITED BY LOCAL REGULATIONS, FOR EXAMPLE SOME STATE HEALTH DEPARTMENTS LIMIT THE VELOCITY THROUGH PUBLIC DRAIN COVERS TO 15' PER SECOND. THIS VELOCITY IS LOWER THAN THE FLOW RATINGS PROVIDED BY THE ANSI/APSP-16 2011 CERTIFICATION, THEREFORE THE LOCAL LIMIT APPLIES AND MUST BE FOLLOWED. NEVER EXCEED THE FLOW RATINGS LISTED ON THE COVER EVEN IF THE LOCAL CODE DOES NOT PROVIDE A VELOCITY LIMIT.
PIPING-GENERAL
FOR NEW INSTALLATIONS, THE PIPING BETWEEN DRAINS MUST BE SIZED TO LIMIT THE VELOCITY TO 6 FEET PER SECOND. THIS LIMIT APPLIES TO THE BRANCH PIPING AND ALL FITTINGS BETWEEN MULTIPLE OUTLETS AND THE TREE LEADING BACK TO THE PUMP. IF CODE REQUIRES A LOWER WATER VELOCITY, COMPLY WITH THE CODE. SEE THE CHART ABOVE FOR INFORMATION ON PIPE SIZE FLOW RATINGS AT 6 FEET PER SECOND.

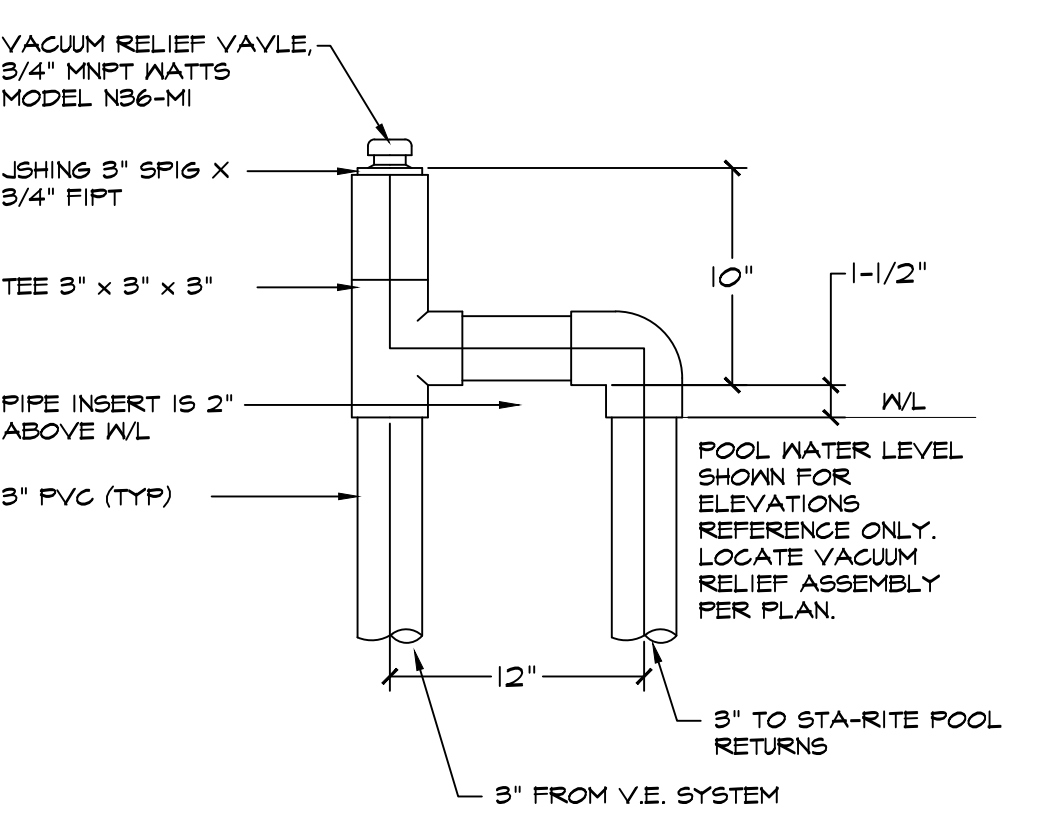

NOTE:
1. LOCATE VACUUM RELIEF ASSEMBLY PER PLAN, IF FIELD CONDITIONS PREVENT CRITICAL ELEVATIONS TO BE ACHIEVED AT THE DESIRED LOCATION, NOTIFY THE DESIGNER IMMEDIATELY. DO NOT INSTALL VALVE HORIZONTALLY.
2. THE TYPE 55 SPRING MAY PREMATURELY FAIL IN SALTWATER APPLICATIONS. IT IS ADVISABLE TO KEEP A SPARE VACUUM RELIEF VALVE ON HAND.
3. VACUUM RELIEF VALVE BY WATTS INDUSTRIES, INC. (WWW.WATTS.COM) OR APPROVED EQUAL.

8 VACUUM RELIEF ASSEMBLY
SCALE: NTS SECTION

9 GENERAL PIPING NOTES
SCALE: NTS ILLUSTRATIVE VIEW



DOUGLAS STATION
NW SLOAN & NE SYCAMORE ST
LEE'S SUMMIT, MO 64086


REVISION:

10/13/2025
POOL DETAILS
W106


Technical Specifications (3 HP Models)

Input Voltage Nominal	208-230 VAC	Environmental Enclosure Rating	NEMA Type 3 / IPX5
Input Current	12.4/11.2 Amps	Ambient Condition Range	
Input Frequency	1PH, L1-L2 or L-N, 50 or 60 Hz	Storage	-40°C to +60°C (-40°F to 140°F)
Max Input Watts	2590 W	Operating	0-50°C (32-122°F)
Max Shaft Horsepower	3.0 HP	Humidity	Relative 0-95% Non-Condensing
Speed Range	450 - 3450 RPM		

Pump Dimensions (3 HP Models)

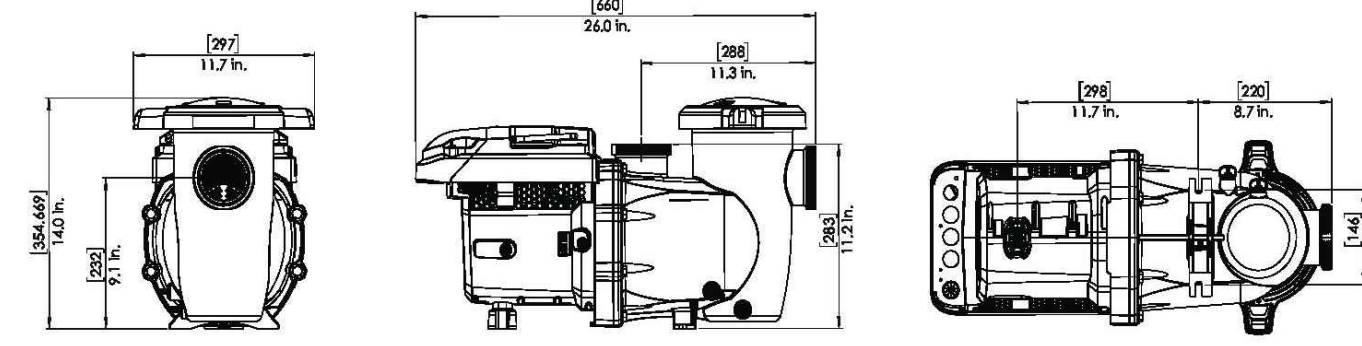

Pump Performance Curves (3 HP Models)


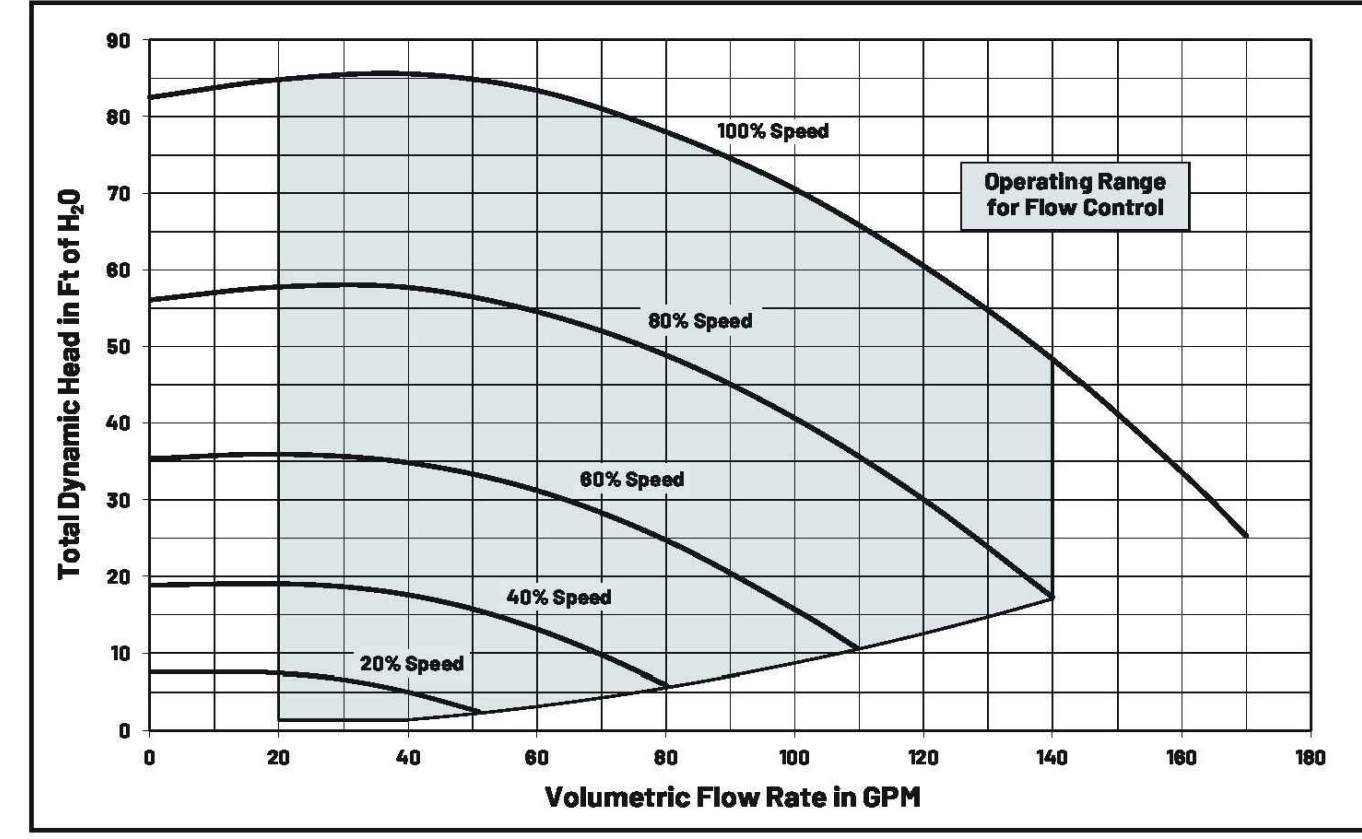


INTELLIFLO3™ VSF / INTELLIPRO3™ VSF Variable Speed and Flow Pump Installation and Maintenance Guide

1 PENTAIR INTELLIFLO 3 3HP PUMP
SCALE: NTS

18 Section 2: Installation Instructions

SPECIFICATIONS (CONTINUED)

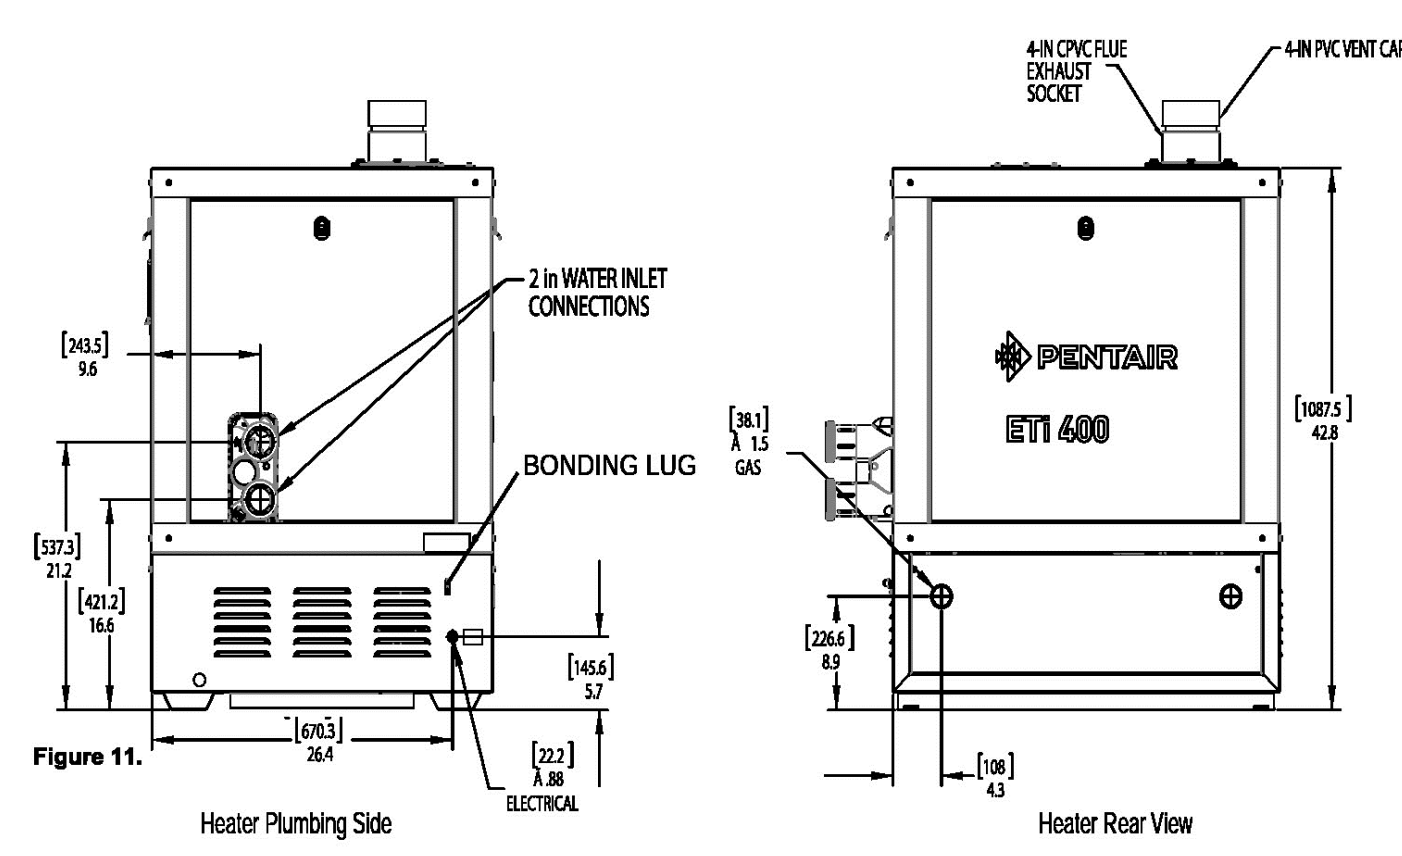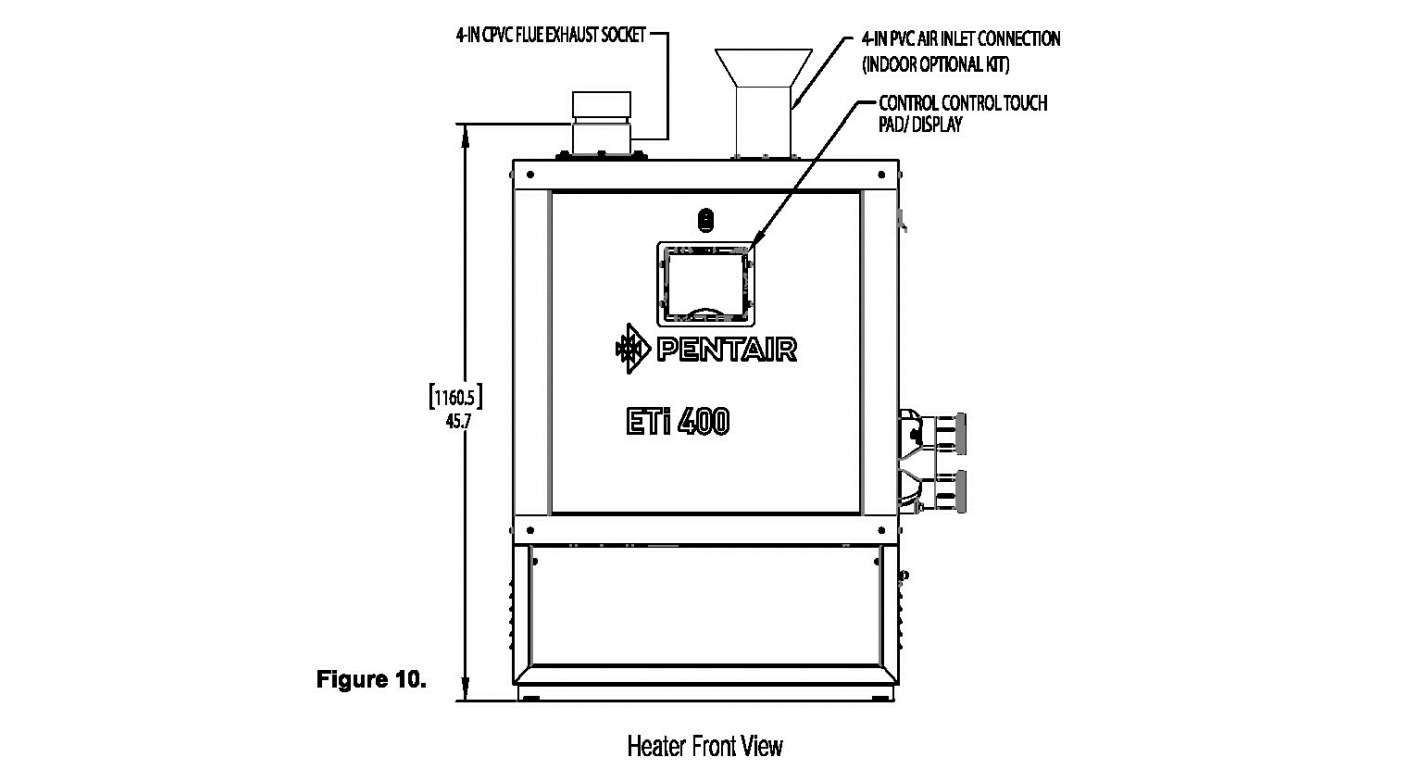


ETI 400 High Efficiency Pool and Spa Heater Installation and User's Guide Rev. E 3/2020

3 PENTAIR ETI 400 HEATER
SCALE: NTS


Motion Trek 350

153121

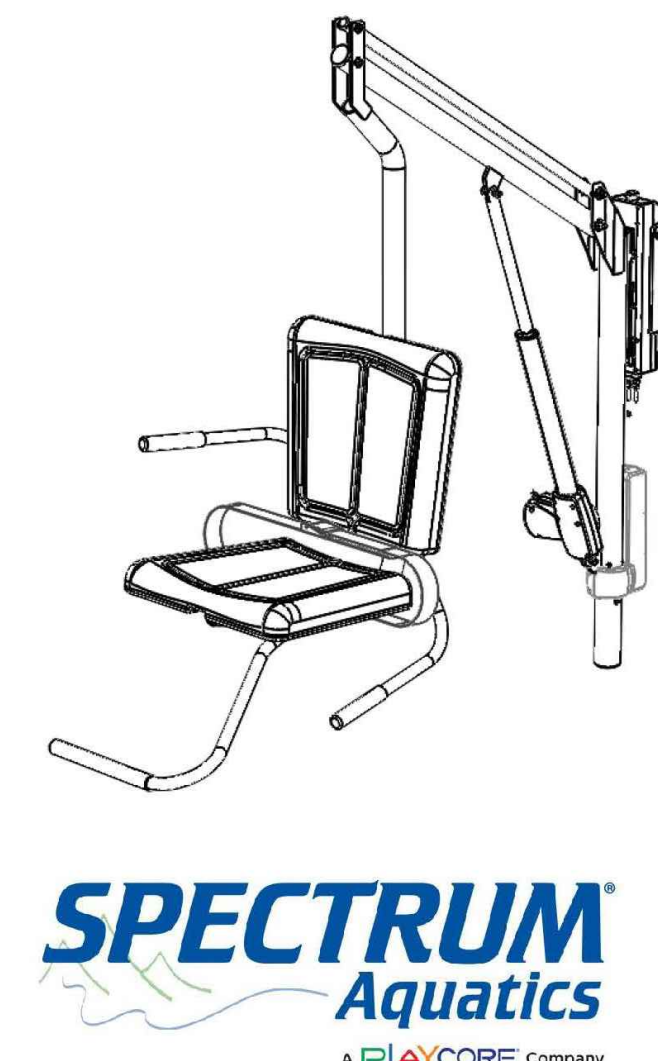

7100 Spectrum Lane ~ Missoula MT 59808
800.791.8056 ~ www.spectrumproducts.com

Components and Hardware:

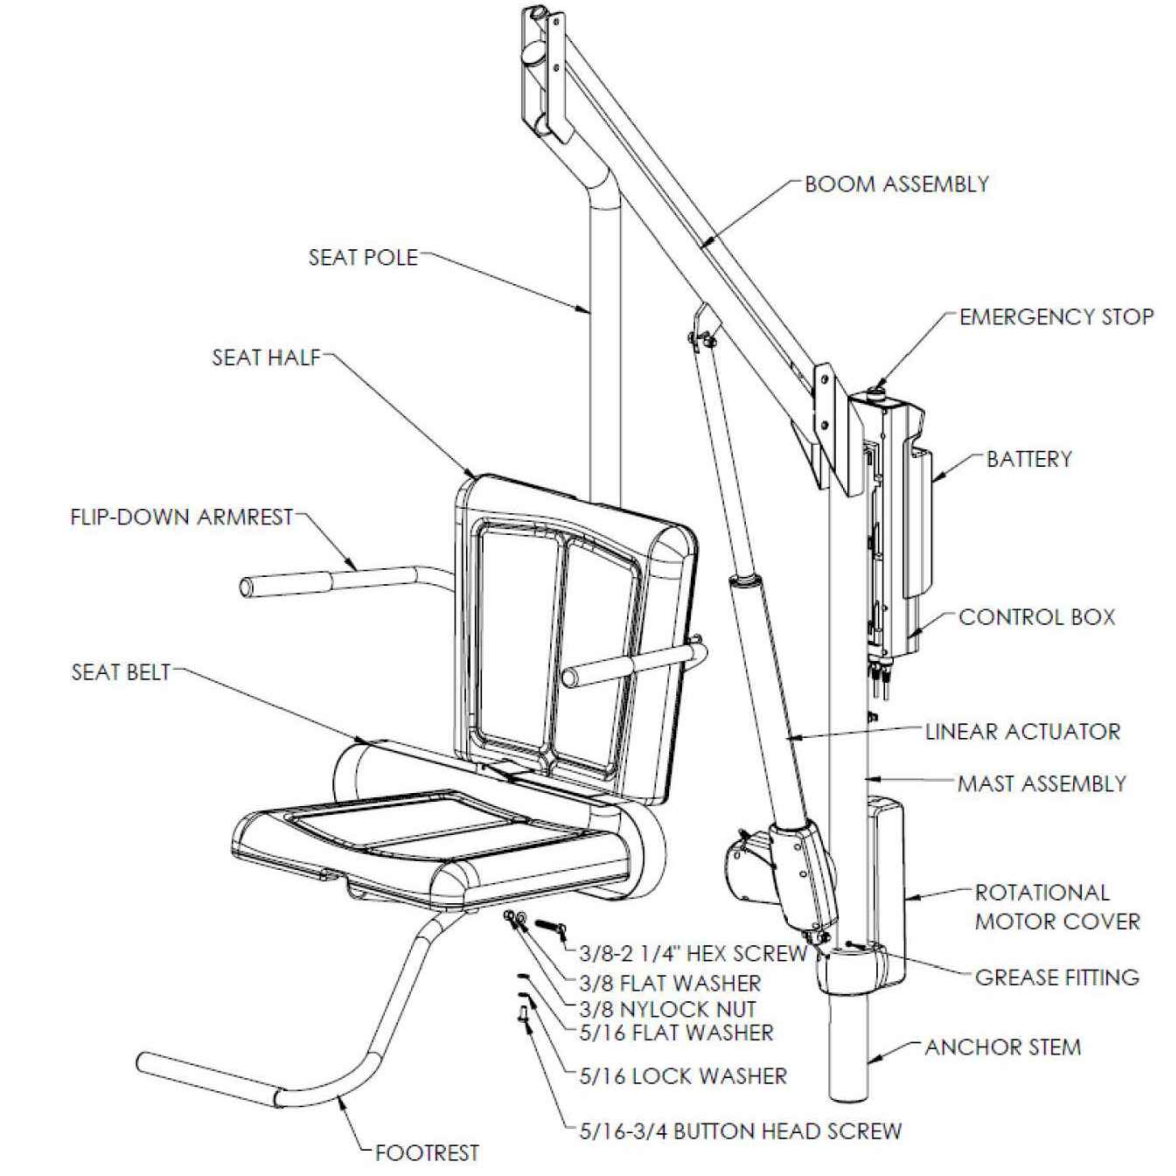

SOME HARDWARE OMITTED FOR CLARITY
HANDSET, ANCHOR, AND CHARGING ACCESSORIES NOT SHOW


2 ADA CHAIR LIFT BY SPECTRUM AQUATICS
SCALE: N.T.S. MANUF. CUT SHEET

Section 2: Installation Instructions 19

PLUMBING CONNECTIONS


The heater has the unique capability of direct schedule 40 PVC plumbing connections. A set of bulkhead fittings is included with the heater to ensure conformity with Pentair's recommended PVC plumbing procedure. Other plumbing connections can be used. See Figure 12 for plumbing connections.

CAUTION
Before operating the heater on a new installation, turn on the circulation pump and bleed all the air from the filter using the air relief valve on top of the filter. Water should flow freely through the heater. Do not operate the heater unless water in the pool/spa is at the proper level. If a manual by-pass is installed, temporarily close it to ensure that all air is purged from the heater.

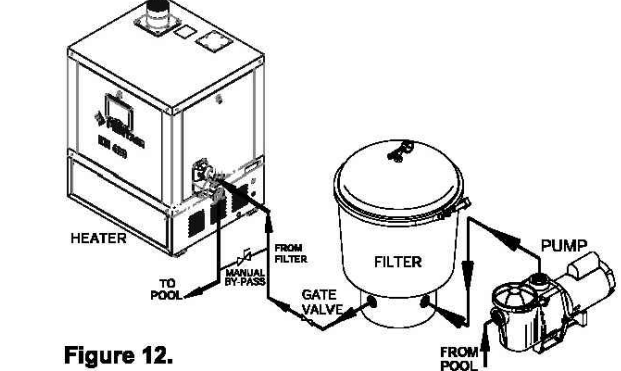

WATER CONNECTIONS

The heater requires proper water flow and pressure for its operation. See Figure 13 for the recommended installation. The filter pump discharges to the filter, the filter discharges to the heater, and the heater discharges directly to the pool or spa. A manual bypass valve should be installed before the heater when the pump flow exceeds 120 GPM (454 LPM). See WATER FLOW RATE Table 1 on page 21 for setting of the manual by-pass valve. Make sure that the outlet plumbing from the heater contains no shut-off valves or other flow restrictions that could prevent flow through the heater (except for pool installations as noted below, or winterizing valves where needed). To switch flow between the pool and spa, use a diverter valve. Do not use any valve that can shut off the flow.

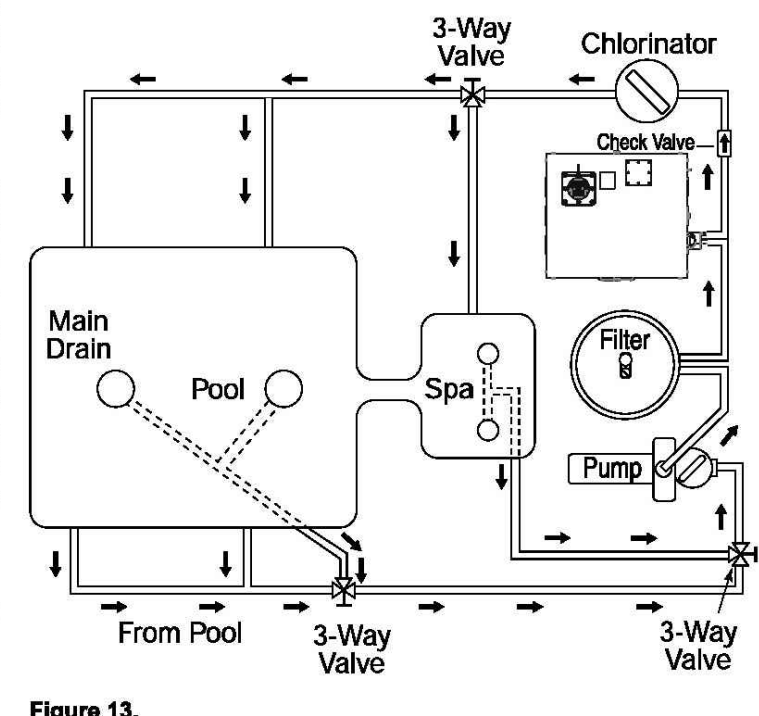

Install the chemical feeder downstream of the heater. Install a chemical resistant one-way check valve between the heater and the chemical feeder to prevent back-siphoning through the heater when the pump is off.
Note: For Multiple Heater installation, see page 20.
NOTICE: If the heater is plumbed in backwards, it will cycle continuously. Make sure piping from filter is not reversed when installing heater.
Connect the heater directly to 2 in PVC pipe, using the provided unions. Heat sinks are not required. The low thermal mass of the heater will prevent overheating of the piping connected to the pump even if the heater shuts down unexpectedly. Occasionally a two-speed pump will not develop enough pressure on the low speed to operate the heater. In this case, run the pump at high speed only to operate the heater. If this does not solve the problem, do not try to run the heater. Instead, correct the installation.
Do not operate the heater while an automatic pool cleaner is also operating. If the circulation pump suction is plugged (for example by leaves), there may not be adequate flow to the heater. Do not rely on the pressure switch in this case.


Rev. E 3/2020 ETI 400 High Efficiency Pool and Spa Heater Installation and User's Guide

Installation Overview

Read all instructions before attempting to assemble or install the lift.

Clear Deck Space:

To be compliant with ADA guidelines, the lift must be installed in a location that is clear from obstacles and other hazards. Clear deck space is defined by the figure to the right. This rectangle is 48" long (along the pool wall) and 36" wide.

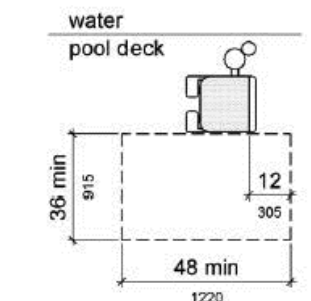

Pool/Spa Depth:

To comply with ADA guidelines the lift must be installed where the water depth does not exceed 48". If the entire pool is deeper than 48" this requirement does not apply.

Anchor Location/Installation:

The lift anchor centerline must be no less than 6", but no greater than 22" from the pool/spa wall (or any feature that sticks out past the pool/spa wall, such as a coping). The lift is installed in a single 2.375" I.D. anchor.


New Construction Anchor Installation

- Place the anchor in the desired location following above guidelines.
- Locate a bonding source to bond (ground) the anchor. The steel rebar-bonding grid of the pool deck is the best choice for bonding the anchor. Attach a No. 8 solid copper wire (NEC Section 680-22) from the bonding bolt on the base of the anchor to the bonding grid.
- Secure anchor in place at the proper height – anchor may be cemented in place. Set the anchor so that the finished top is 1/8" to 1/4" below finished deck level – allowing for anchor cap to be put in place when the lift is not in use.
- Use the carpenter's level to level the anchor making sure the lift mast will be vertically straight up and down (perpendicular to the deck) in all directions. It is important that the mast be vertically straight to ensure ease of rotation when the lift is fully loaded.
- Place tape over the anchor hole before pouring concrete deck – not allowing concrete to enter anchor opening.
- Pour concrete deck and finish.

Allow the concrete to cure for at least 7-days before installing and using the lift.

DETAIL NOTES

- INSTALL ALL EQUIPMENT PER MANUFACTURER'S INSTRUCTIONS.
 - INSTALL BONDING PER NEC 680.26
 - SIGN AND SWITCHES MAY BE FLUSH-MOUNT IN A WALL USING SIMILAR ELECTRICAL BOXES
- STAINLESS STEEL FASTENERS (TYP) PFS POOL PRODUCTS FN PFS1005 4"x6" WHITE TEXT ON RED BACKGROUND WWW.PFSPOOLPRODUCTS.COM
 - EQUIP ID PER SCHEMATIC DIAGRAM (TYP)
 - PENTAIR ES03 WWW.PENTAIRPOOL.COM
 - CARLON 2FSE FN E4802E WWW.CARLON.COM
 - 3/4" PVC CONDUIT
 - PENTAIR RSC1 WWW.PENTAIRPOOL.COM
 - CARLON FSC PART# E481EFN WWW.CARLON.COM

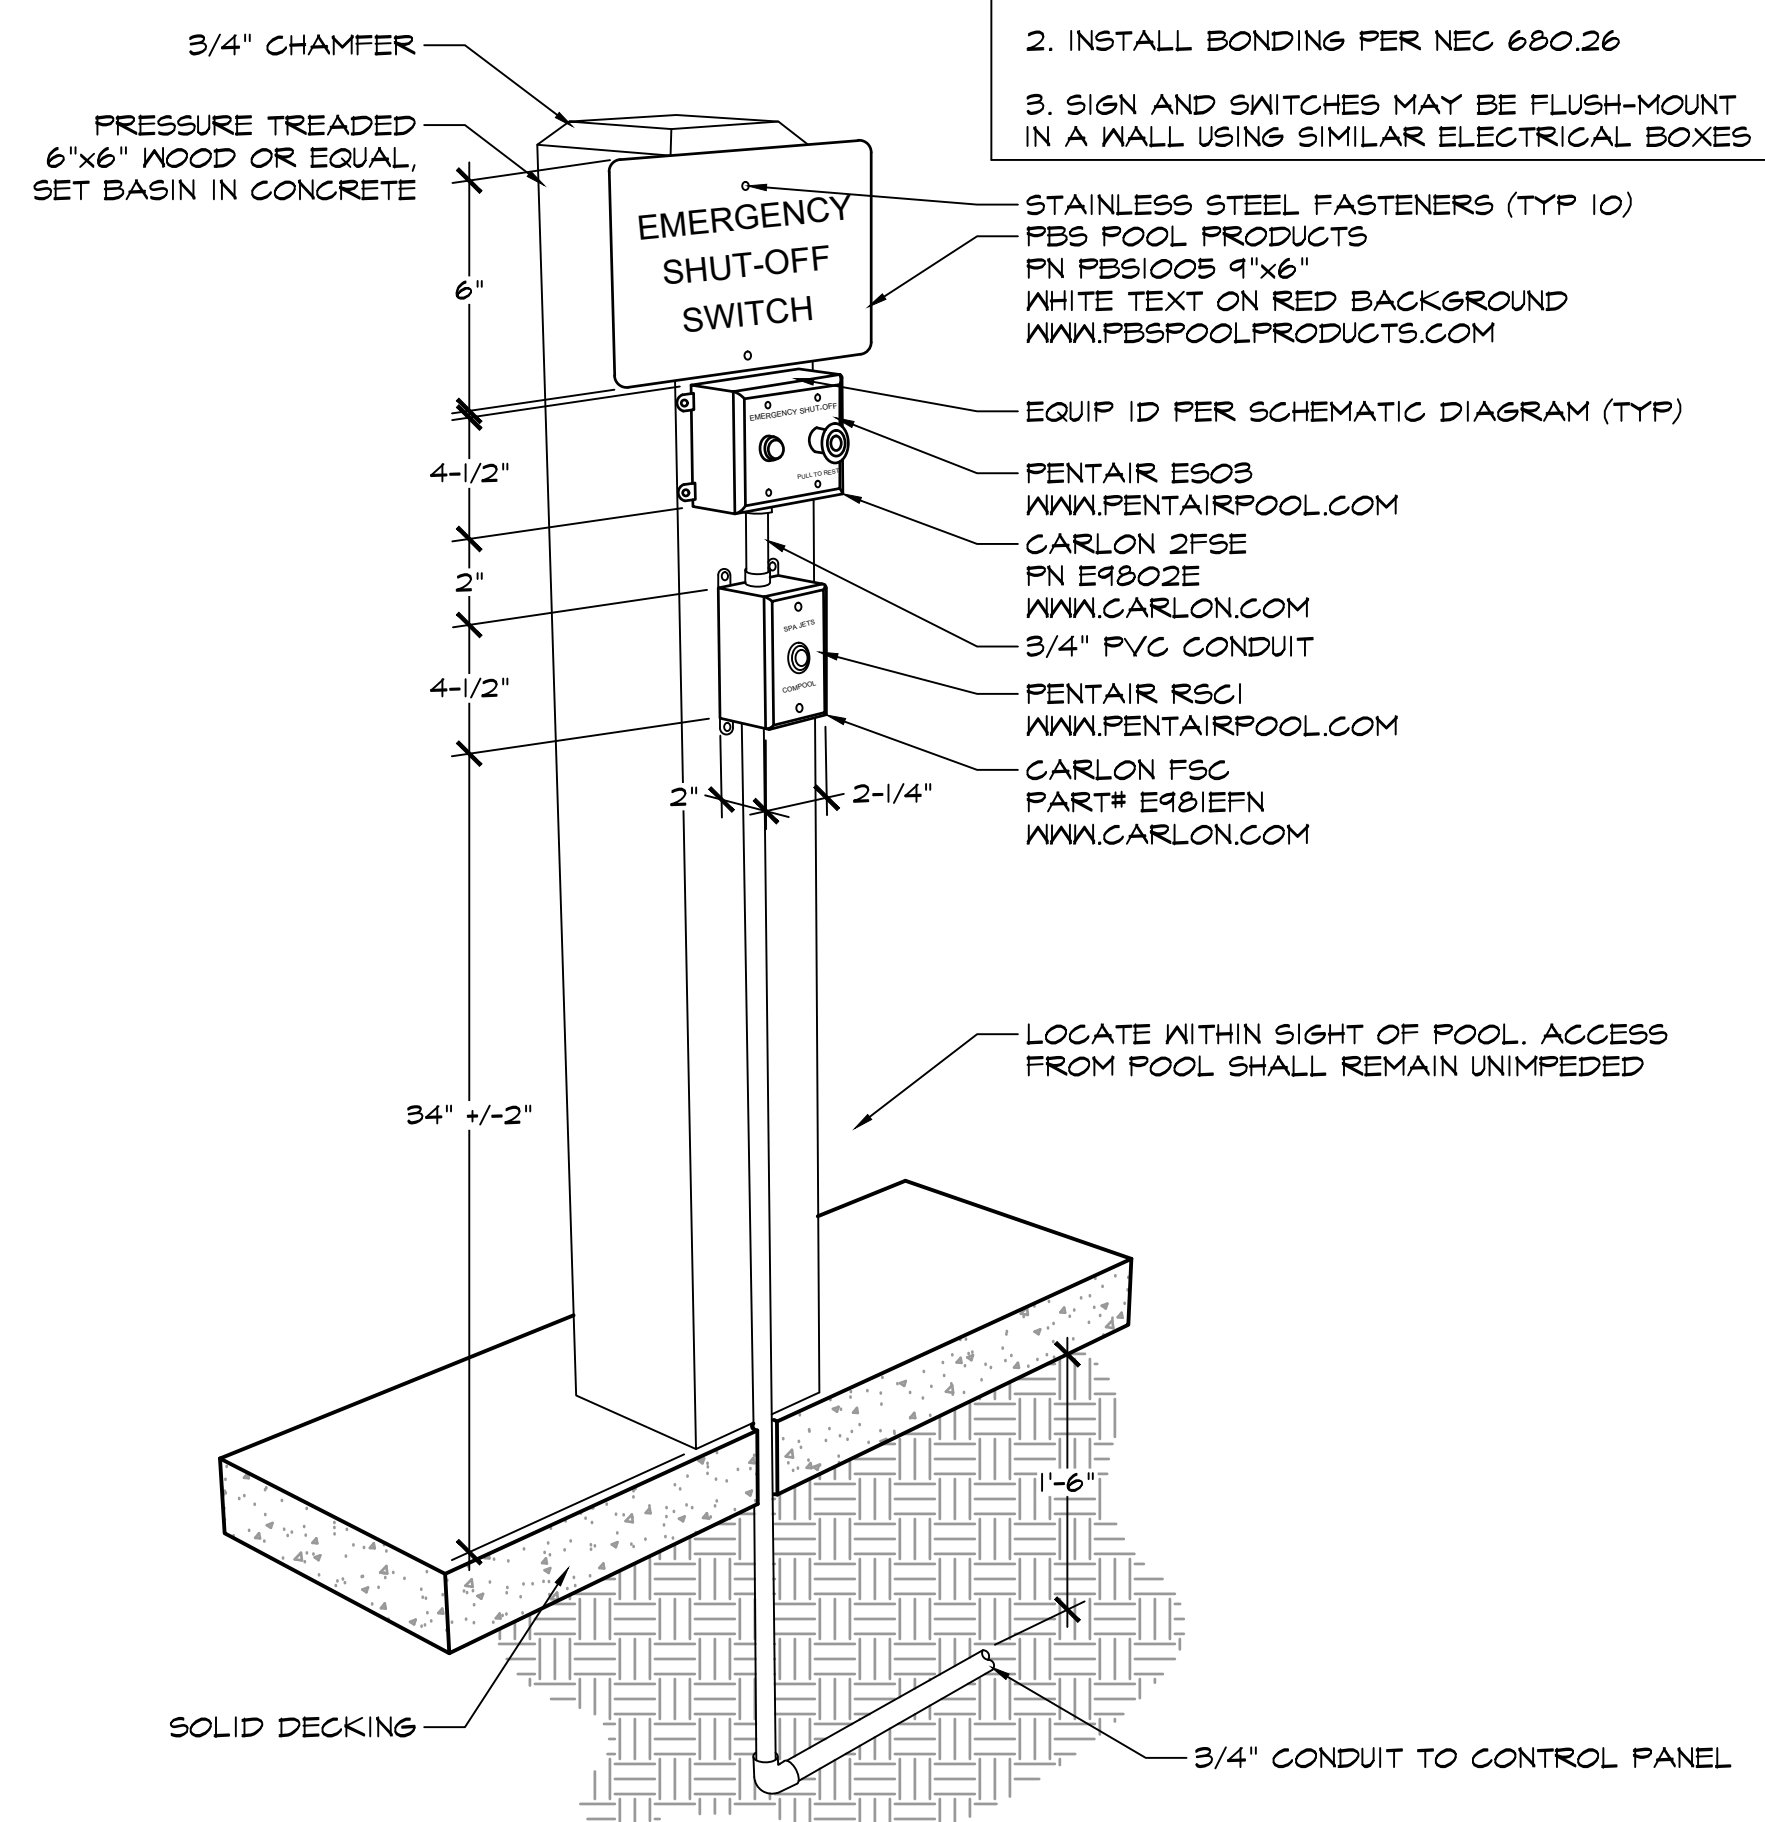

4 EMERGENCY SHUT-OFF
SCALE: NTS SECTION

ETI 400 High Efficiency Pool and Spa Heater Installation and User's Guide

