



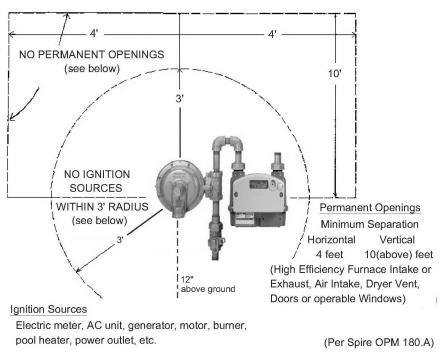
1470

SE Hamblen Rd

THE ROUTE OF THE GAS SERVICE  
MUST BE BROUGHT TO GRADE AND  
CLEARED OF BUILDING MATERIAL BY  
THE CUSTOMER PRIOR TO  
INSTALLATION.

GRANULAR BACKFILL, IF REQUIRED, IS  
TO BE PROVIDED BY THE CUSTOMER.  
IN WHICH CASE, SPIRE WILL NOT BE  
RESPONSIBLE FOR THE DISPOSAL OF  
EXCESS SPOIL FROM THE DITCH.

CUSTOMER APPROVAL SIGNATURE:

GAS METER MUST COMPLY WITH  
REQUIREMENTS SHOWN BELOW

8.5" x 11" sheet may not be to scale

1:600  
1 inch = 50 feet

DESIGNER:  
40170  
DATE:  
10/30/2025

REVISION DATE(S):  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Location: 1460 SE Broadway Dr  
Municipality: Lee's Summit  
Work Order: 36966875

Install 80' 1.25" PL 58 PSI Service

Install 1.25" PL Riser  
1.5M Meter (36966870)

1460 SE Broadway Dr  
Total Load 820 CFH  
2 PSIG Delivery Pressure

1450

1445

1.25" PL EFV (31657)

1.25" PL Service Tee

1455

1515

SE Broadway Dr

SE Kingspoint Dr

SE Kings

