

RENDERING FOR CONCEPTUAL REFERENCE ONLY. IMAGE MAY NOT REFLECT LATEST DESIGN. REFERENCE ELEVATIONS AND SCHEDULES FOR FINISHES.



**DRAWING INDEX**

**ARCHITECTURAL**

- A0.00 COVER SHEET
- A0.01 LEGENDS & GENERAL NOTES
- A0.02 ADA DETAILS
- A0.20 ARCHITECTURAL SITE PLAN & DETAILS
- A1.00 FLOOR PLAN
- A1.50 ROOF PLAN & RCP
- A2.00 EXTERIOR ELEVATIONS
- A3.00 WALL AND BUILDING SECTIONS
- A3.50 DETAILS
- A4.00 INTERIOR ELEVATIONS
- A6.00 DOOR AND FINISH SCHEDULE
- A9.00 EQUIPMENT PLAN

**STRUCTURAL**

- S0.0 GENERAL NOTES
- S0.1 ISOMETRIC
- S1.1 FOUNDATION PLAN
- S2.2 ROOF FRAMING PLAN
- S3.1 TYPICAL FOUNDATION DETAILS
- S4.1 TYPICAL FRAMING DETAILS

**PLUMBING**

- P1.01 GENERAL PLUMBING NOTES
- P2.01 FIRST FLOOR PLUMBING PLAN
- PE0.01 COVER SHEET

**ELECTRICAL**

- E1.01 ELECTRICAL PLAN
- E2.01 ELECTRICAL SCHEDULES & DETAILS

**PROJECT TEAM**

**ARCHITECT**  
 FINKLE + WILLIAMS ARCHITECTURE  
 8787 Renner Blvd, Suite 100  
 Lenexa, Kansas 66219  
 PH. 913.498.1550

**STRUCTURAL**  
 BSE Structural Engineers  
 11320 W. 79th St.  
 Lenexa, KS 66214  
 PH. 913.492.7400

**MECHANICAL**  
 DESIGN / BUILD BY CONTRACTOR

**PLUMBING**  
 PKMR  
 13300 W. 98th St.  
 Lenexa, KS 66215  
 PH. 913.492.2400

**ELECTRICAL**  
 PKMR  
 13300 W. 98th St.  
 Lenexa, KS 66215  
 PH. 913.492.2400



**FINKLE + WILLIAMS ARCHITECTURE**

**PARAGON STAR RR-CONCESSIONS**

PROJECT ADDRESS  
 1401 NW River Rd  
 Lee's Summit, MO 64081

PROJECT NUMBER  
 19050.04b

RELEASE DATE  
 12.08.2025

ISSUED FOR  
 PERMIT

CURRENT REVISION























Design Specifications:

- ASCE 7-16
ACI 318-14
ASCE 800-16
ANSI/AISC NDS - 2018

Design Loads:

Table with columns for Wind Loads, Seismic Loads, and other specifications like Top Chord Dead Load, etc.

Design Loading Notes:

- 1. See components and cladding table for design wind pressures.
2. See net uplift diagram for roof framing due to wind pressures.
3. Roof dead load shown includes a collateral load of 2.5 psf.

Table with columns: Zone, Effective Wind Area (sq ft), Max. +VE Pressure (psf), Max. -VE Pressure (psf). Includes zones 1, 2, and 3.




Components & Cladding Wind Zone Diagram

- 1. The components & cladding (CBC) wind pressures shown assume a mean roof height of 11'-6" above finished floor elevation.
2. The components & cladding wind zone diagram is generalized to show all possible conditions.

COMPONENTS & CLADDING WIND PRESSURES

Table with columns: Zone, Effective Wind Area (sq ft), Max. +VE Pressure (psf), Max. -VE Pressure (psf). Includes zones 1, 2, and 3.



Slab On Grade:

- 1. Welded wire fabric shall be supplied in sheets only. Rolls will not be permitted.
2. Welded wire fabric shall be supported on chairs or blocks prior to concrete placement.
3. Welded wire fabric shall have end and edge laps of one full mesh plus 2" between cross wires.

Foundations:

- 1. Foundations for this project have been designed in accordance with requirements set forth in a geotechnical report prepared by Terracon Consultant Inc.
2. Anchor rods shall conform to ASTM F1554 Gr. 36 and shall be located by means of a template.

Structural Steel:

- 1. All structural steel shall conform to the following:
Structural Steel Wide Flanges: ASTM A992
Miscellaneous Steel: ASTM A36
Concrete formwork: ASTM A500, Grade C (Fy = 50 ksi)
Steel Pipe: ASTM A53, Type E or S, Grade B

Rough Carpentry:

- 1. All roof, floor and wall sheathing shall be APA rated, with exterior gus. Roof sheathing shall have a panel identification index of 24/16.
2. Blocking shall be provided at all sheathing diaphragm boundaries, corners, or changes in inclination.

Concrete and Reinforcing Steel:

Table with columns: Location, Minimum Compressive Strength (psi), Max. Aggregate Size, Water/Cement Ratio, Slump (in.), Air Entrainment (%). Includes Roof Interior, Roof Exterior, Interior Slabs, etc.

These values are based on allowable stresses provided in the NDS (2018) and do not include adjustment factors.

- 1. The following species and commercial grades of dimensional lumber conform to the above minimum design values:
Douglas Fir - Larch: No. 2
Southern pine: No. 2, or approved equal
Spruce-Pine-Fir: No. 2, or approved equal

4. All dimension lumber used for non-load bearing walls shall have the following minimum design values:

Table with columns: Fb, Fv, Fc (Perp), E. Values for various lumber species like Douglas Fir, Southern Pine, etc.

These values are based on allowable stresses provided in the NDS (2018) and do not include adjustment factors.

- 1. A.C.Q. lumber shall be used in all locations where lumber is exposed to weather, moisture, or is in contact with concrete.
2. Embedment and all reinforcing bars marked continuous shall be embedded to develop the full tensile capacity of the bar.

11. All bars are to be supported in forms and spaced with wire bars supported per ACI "Manual of Standard Practice for Detailing Concrete Structures" (latest edition).

13. Concrete placed during cold weather shall conform to the requirements of ACI 308R-88.

14. Do not add water to concrete during delivery, at Project Site, or during placement, unless approved by the Engineer.

15. Provide 3/4" chamfer on all exposed corners unless noted otherwise on architectural or structural construction documents.

16. All cold joints shall be roughened and cleaned unless noted otherwise.

Post-Installed Anchors:

- 1. Post-Installed anchors shall only be used where specified in the construction documents.
2. The Contractor shall obtain written approval from the engineer prior to installing post-installed anchors for mis-placed anchors.

Care shall be taken with placing post-installed anchors to avoid damaging existing reinforcement.

The holes shall be drilled and cleaned in accordance with the manufacturers specifications.

Post-Installed anchors shall meet ACI Appendix D criteria. The following are acceptable post-installed anchors:

- a. HiHi HT #20 VS [ESR 4868]
b. Dewalt AC208- [ESR 4027]
c. Simpson Strong-Tie SET-3G [ESR 4057]
d. Or Approved Equivalent

All screw anchors referred to in these drawings shall be one of the following:

- a. HiHi HT #20 VS [ESR 4868]
b. Dewalt AC208- [ESR 4027]
c. Simpson Strong-Tie Titen HD [ESR 1056]
d. Or Approved Equivalent

Additional components referred to in these drawings shall be one of the following:

- a. Simpson H8 [ESR 3096]
b. Dewalt Power-Bolt [ESR 2360]
c. Simpson Strong-Tie Titen HD [ESR 1056]
d. Simpson ATN Rod [ESR 2320]
e. Simpson Take-Up Device ATUD [ESR 2320]
f. Simpson Ratcheting Take-Up Device RTUD [ESR 2320]
g. Or Approved Equivalent

Delegated Design:

Table with columns: Types of Work, Submittal Document. Includes Prefabricated Roof Trusses, MEP Equipment Seismic Anchorage, etc.

1. The submittals shown for this project are deferred submittals that should be sealed by a professional engineer in the state of issuance and submitted to the E.O.R. for review to the building department. Before submittal.

Special Inspector:

- 1. The following items require special inspection in accordance with the building code:
a. Concrete design mix
b. Placement of concrete & reinforcing steel
c. Bolts & anchors embedded in concrete

3. The Special Inspector shall be a qualified person who shall demonstrate competence, to the satisfaction of the building official, for inspection of the particular type of construction or operation requiring special inspection.

4. The Special Inspector shall observe the work assigned for conformance with the approved design drawings and specifications.

5. The Special Inspector shall furnish inspection reports to the Building Official, the Engineer and Architect of record, and other designated persons. All discrepancies shall be brought to the immediate attention of the Contractor for correction, then if uncorrected, to the proper design authority and to the Building Official.

6. The Special Inspector shall submit a final signed report stating whether the work requiring special inspection was, to the best of the inspector's knowledge, in conformance with the approved plans and specifications and the applicable workmanship provisions of the governing building codes.

Earthworks:

- 1. The Inspector must verify that the preparation of the natural ground and the placement of engineered fill is performed in accordance with the GEOTECHNICAL engineer's recommendations as stated in the GEOTECHNICAL report.

- 2. The Inspector must monitor the placement of all fill to determine whether the type of material, moisture content, and degree of compaction are within the recommended limits contained in the GEOTECHNICAL report. Proceed with subsequent earthwork only after test results for previously completed work comply with recommended limits contained in the GEOTECHNICAL report.

- 3. All Subgrade supporting footings and slabs must be inspected immediately prior to the placement of reinforced concrete.

- 4. Paved and building slab areas shall be tested at Subgrade and at each compacted fill and backfill layer, at least once for every 2000 sq. ft. or less of paved or building slab areas, but in no case fewer than 3 tests.

- 5. Foundation wall backfill shall be tested at each compacted initial and final backfill layer, at least once for each 100 ft. or less of wall length, but no fewer than 2 tests.

- 6. Trench backfill shall be tested at each compacted initial and final backfill layer, at least once for each 150 ft. or less of trench length, but no fewer than 2 tests.

- 7. Test compaction of soils-in-place in accordance with ASTM D 1556, ASTM D 2167, ASTM D 2937, and ASTM D 6938, as applicable.

- 8. Test Reporting: Test results must be reported to BSE and the general contractor in writing within 24 hours after testing, via fax. Reports must contain the project name, the date of the test and the location of the test.

Concrete:

- 1. Strength test cylinders shall be prepared for each day's pour of each concrete mix and at a minimum frequency of every 50 cu. yd. on all concrete placed. Conform to ASTM C39.

- 2. Four (4) test cylinders are to be made and cured on site for the first 24 hours. Test one of the specimens at 7 days and two at 28 days. Hold the fourth specimen in reserve for later testing if needed.

- 3. Slump, air content and temperature tests shall be conducted at a minimum when strength specimens are made and at any other times as specified by the Engineer.

- 4. Perform slump tests on a representative concrete sample at the point of discharge. Perform additional tests when concrete consistency seems to have changed. The maximum allowable field slump is 5 inches. Conform to ASTM C143.

- 5. Perform air content tests on all concrete specified to be air-entrained. Conform to ASTM C231.

- 6. Perform a temperature test every four hour when air temperature is 40°F and below, or when air temperature is 80°F and above. Conform to ASTM C1064.

- 7. Prior to the closing of forms or the delivery of concrete to the job site, the inspector shall verify that the reinforcing steel is in conformance with the city-approved plans, specifications and shop drawings. The inspector shall confirm that the reinforcing steel is of the correct size and grade and ensure that the proper spacing, clearances, splice lengths and embedded items have been provided. All reinforcing steel shall be in place prior to the placement of concrete and be secured against displacement.

- 8. The Inspector shall verify that the bolt size, location and embedment length of all anchor bolts are in conformance with the city-approved plans, specifications and shop drawings.

- 9. Anchor rods 3/4" or smaller may be floated in place following concrete placement, provided that anchor bolts are worked easily by hand into the fresh concrete to allow for full contact with the shank of the bolt. Bolts shall be placed by means of a template and shall be worked into concrete in vertical alignment.

- 10. Test Reporting: Test results must be reported to BSE and the General Contractor in writing within 24 hours after testing, via fax or email. Reports of compressive strength tests must contain the project name, the date of the test, the location of the concrete placement within the structure and the concrete mix design being used.

Structural Wood:

- 1. Special inspections of structural wood framing to be performed in accordance with section 1705.11.2 of the referenced IRC.

- 2. Periodic special inspection is required for nailing, bolting, anchoring, and other fastening of components with the wind force resisting system, including wood shear walls, wood diaphragms, drag struts, braces, shear panels, and hold-downs.

Required Special Inspections and Tests of Concrete Construction Per IRC Table 1705.3

Table with columns: Type, Continuous Special Inspection, Periodic Special Inspection, Referenced Standard. Includes items like inspect reinforcement, reinforcing bar welding, inspect anchors, etc.

Required Special Inspections and Tests of Soils Per IRC Table 1705.6

Table with columns: Type, Continuous Special Inspection, Periodic Special Inspection. Includes items like verify materials below shallow foundations, verify excavations, etc.

Required Special Inspections and Tests of Cast-In-Place Deep Foundation Elements Per IRC Table 1705.8

Table with columns: Type, Continuous Special Inspection, Periodic Special Inspection. Includes items like inspect drilling operations, verify placement of pile caps, etc.

Required Quality Control Inspections (QC) & Quality Assurance Inspections (QA) of Steel Construction Per AISC 360, Specification Chapter M & N

Table with columns: Type, Frequency of Inspections, Referenced Standard. Includes items like fabricator's QC shall inspect, shop welding, etc.

Required Special Inspections of Wood Construction per IRC 1705.5, 1705.11.1 & 1705.12.2

Table with columns: Material/Activity, Service, Y/N, Extent. Includes items like verify fabrication/quality control, high load diaphragms, etc.

Note: Additional inspection may be required for the wind/seismic force resisting systems per IRC 1706 & 1707.

ABBREVIATIONS LIST

Table with columns: Symbol, Abbreviation. Includes AND, DEGREES, EQUALS, GREATER THAN, etc.


SHEET LIST

Table with columns: Sheet Number, Sheet Name. Includes S0.0 GENERAL NOTES, S0.1 ISOMETRIC FOUNDATION PLAN, etc.

MATERIALS LEGEND

Table with columns: Material Name, Symbol. Includes ALUMINUM, CONCRETE, EARTH, GROUT, GYPSUM, etc.

SYMBOLS LEGEND



1401 NW River Rd
Lee's Summit, MO 64081

Project No.: 19050.04b

Date: 12.08.2025

Issued For: PERMIT

REVISIONS

Table with columns: No., Date, Description. Includes revision entries for permit issuance.

REGISTRATION




PROJECT TEAM

Table with columns: Role, Name. Includes ARCHITECT: FINKLE-WILLIAMS ARCHITECTURE, CIVIL: GBA, etc.

REVISION DESIGNATION

Table with columns: Revision Designation, Description. Includes W16x26(12x)3/4, F.O.E. (30x)3/4, etc.

JOIST BEARING ELEVATION



SLAB THICKNESS TRANSITION



SHEET TITLE

GENERAL NOTES

SHEET NUMBER

S0.0













### ELECTRICAL SYMBOL LEGEND

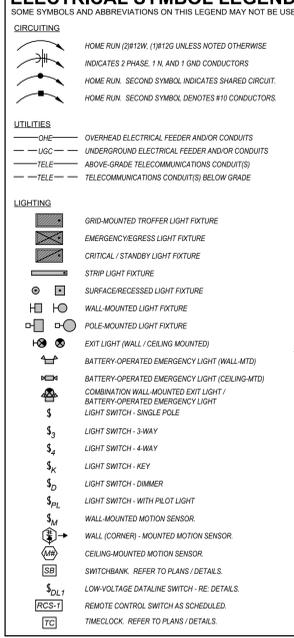

### PLUMBING SYMBOL LEGEND

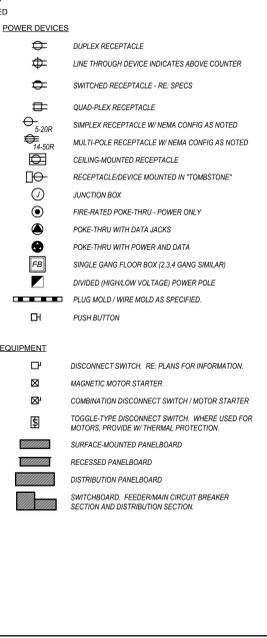

### 22000 - PLUMBING SPECIFICATIONS

SECTION 22000 - PLUMBING - GENERAL REQUIREMENTS
A. ALL WORK SHALL BE IN ACCORDANCE WITH LATEST EDITION OF INTERNATIONAL BUILDING MECHANICAL & PLUMBING CODES...

### 26000 - ELECTRICAL SPECIFICATIONS

SECTION 26000 - ELECTRICAL REQUIREMENTS
GENERAL REQUIREMENTS
A. ALL WORK SHALL BE IN ACCORDANCE WITH LATEST EDITION OF INTERNATIONAL BUILDING CODE...

### GENERAL PLUMBING NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL PLUMBING CODE...
2. NO PIPING SHALL BE INSTALLED WHERE IT WILL BE SUBJECT TO FREEZING TEMPERATURES...

### GENERAL ELECTRICAL NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL ELECTRICAL CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL MECHANICAL NOTES

- 1. MECHANICAL SYSTEM IS DESIGN BUILT BY THE CONTRACTOR AND WILL BE ISSUED AS A DEFERRED SUBMITTAL.

### GENERAL NOTES

- 1. SOME ROOM NAMES MAY NOT BE SHOWN FOR PURPOSE OF CLARIFYING PLAN REFER TO ARCHITECTURAL PLANS FOR REFERENCES TO ROOM NAMES NOT SHOWN...
2. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO MAINTAIN AND KEEP AT THE JOB SITE...

### COORDINATION NOTES

- 1. COORDINATE REQUIREMENTS FOR INSTALLATION OF SYSTEMS AND EQUIPMENT WITH ALL OTHER TRADES...
2. THE CONTRACTOR SHALL COORDINATE THE ROUTING AND PATH OF ALL SYSTEMS CONDUITS, PIPES, DUCTS, ETC. WITH THE POSITION AND LAYOUT OF THE STRUCTURE...

### ABBREVIATIONS

Table with 2 columns: Abbreviation and Description. Includes AE ARCHITECT/ENGINEER, AF ABOVE FINISHED FLOOR, AFG ABOVE FINISHED GRADE, etc.

### GENERAL PLUMBING NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL PLUMBING CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL ELECTRICAL NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL ELECTRICAL CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL MECHANICAL NOTES

- 1. MECHANICAL SYSTEM IS DESIGN BUILT BY THE CONTRACTOR AND WILL BE ISSUED AS A DEFERRED SUBMITTAL.

### GENERAL NOTES

- 1. SOME ROOM NAMES MAY NOT BE SHOWN FOR PURPOSE OF CLARIFYING PLAN REFER TO ARCHITECTURAL PLANS FOR REFERENCES TO ROOM NAMES NOT SHOWN...
2. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO MAINTAIN AND KEEP AT THE JOB SITE...

### COORDINATION NOTES

- 1. COORDINATE REQUIREMENTS FOR INSTALLATION OF SYSTEMS AND EQUIPMENT WITH ALL OTHER TRADES...
2. THE CONTRACTOR SHALL COORDINATE THE ROUTING AND PATH OF ALL SYSTEMS CONDUITS, PIPES, DUCTS, ETC. WITH THE POSITION AND LAYOUT OF THE STRUCTURE...

### ABBREVIATIONS

Table with 2 columns: Abbreviation and Description. Includes AE ARCHITECT/ENGINEER, AF ABOVE FINISHED FLOOR, AFG ABOVE FINISHED GRADE, etc.

### 22000 - PLUMBING SPECIFICATIONS

SECTION 22000 - PLUMBING - GENERAL REQUIREMENTS
A. ALL WORK SHALL BE IN ACCORDANCE WITH LATEST EDITION OF INTERNATIONAL BUILDING MECHANICAL & PLUMBING CODES...

### 26000 - ELECTRICAL SPECIFICATIONS

SECTION 26000 - ELECTRICAL REQUIREMENTS
GENERAL REQUIREMENTS
A. ALL WORK SHALL BE IN ACCORDANCE WITH LATEST EDITION OF INTERNATIONAL BUILDING CODE...

### GENERAL PLUMBING NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL PLUMBING CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL ELECTRICAL NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL ELECTRICAL CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL MECHANICAL NOTES

- 1. MECHANICAL SYSTEM IS DESIGN BUILT BY THE CONTRACTOR AND WILL BE ISSUED AS A DEFERRED SUBMITTAL.

### GENERAL NOTES

- 1. SOME ROOM NAMES MAY NOT BE SHOWN FOR PURPOSE OF CLARIFYING PLAN REFER TO ARCHITECTURAL PLANS FOR REFERENCES TO ROOM NAMES NOT SHOWN...
2. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO MAINTAIN AND KEEP AT THE JOB SITE...

### COORDINATION NOTES

- 1. COORDINATE REQUIREMENTS FOR INSTALLATION OF SYSTEMS AND EQUIPMENT WITH ALL OTHER TRADES...
2. THE CONTRACTOR SHALL COORDINATE THE ROUTING AND PATH OF ALL SYSTEMS CONDUITS, PIPES, DUCTS, ETC. WITH THE POSITION AND LAYOUT OF THE STRUCTURE...

### ABBREVIATIONS

Table with 2 columns: Abbreviation and Description. Includes AE ARCHITECT/ENGINEER, AF ABOVE FINISHED FLOOR, AFG ABOVE FINISHED GRADE, etc.

### GENERAL PLUMBING NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL PLUMBING CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL ELECTRICAL NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL ELECTRICAL CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL MECHANICAL NOTES

- 1. MECHANICAL SYSTEM IS DESIGN BUILT BY THE CONTRACTOR AND WILL BE ISSUED AS A DEFERRED SUBMITTAL.

### GENERAL NOTES

- 1. SOME ROOM NAMES MAY NOT BE SHOWN FOR PURPOSE OF CLARIFYING PLAN REFER TO ARCHITECTURAL PLANS FOR REFERENCES TO ROOM NAMES NOT SHOWN...
2. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO MAINTAIN AND KEEP AT THE JOB SITE...

### COORDINATION NOTES

- 1. COORDINATE REQUIREMENTS FOR INSTALLATION OF SYSTEMS AND EQUIPMENT WITH ALL OTHER TRADES...
2. THE CONTRACTOR SHALL COORDINATE THE ROUTING AND PATH OF ALL SYSTEMS CONDUITS, PIPES, DUCTS, ETC. WITH THE POSITION AND LAYOUT OF THE STRUCTURE...

### ABBREVIATIONS

Table with 2 columns: Abbreviation and Description. Includes AE ARCHITECT/ENGINEER, AF ABOVE FINISHED FLOOR, AFG ABOVE FINISHED GRADE, etc.

### GENERAL PLUMBING NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL PLUMBING CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL ELECTRICAL NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL ELECTRICAL CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL MECHANICAL NOTES

- 1. MECHANICAL SYSTEM IS DESIGN BUILT BY THE CONTRACTOR AND WILL BE ISSUED AS A DEFERRED SUBMITTAL.

### GENERAL NOTES

- 1. SOME ROOM NAMES MAY NOT BE SHOWN FOR PURPOSE OF CLARIFYING PLAN REFER TO ARCHITECTURAL PLANS FOR REFERENCES TO ROOM NAMES NOT SHOWN...
2. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO MAINTAIN AND KEEP AT THE JOB SITE...

### COORDINATION NOTES

- 1. COORDINATE REQUIREMENTS FOR INSTALLATION OF SYSTEMS AND EQUIPMENT WITH ALL OTHER TRADES...
2. THE CONTRACTOR SHALL COORDINATE THE ROUTING AND PATH OF ALL SYSTEMS CONDUITS, PIPES, DUCTS, ETC. WITH THE POSITION AND LAYOUT OF THE STRUCTURE...

### ABBREVIATIONS

Table with 2 columns: Abbreviation and Description. Includes AE ARCHITECT/ENGINEER, AF ABOVE FINISHED FLOOR, AFG ABOVE FINISHED GRADE, etc.

### GENERAL PLUMBING NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL PLUMBING CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL ELECTRICAL NOTES

- 1. COMPLETE INSTALLATION SHALL BE IN ACCORDANCE WITH THE LATEST ADOPTED VERSION OF THE INTERNATIONAL ELECTRICAL CODE...
2. COORDINATE LOCATIONS OF RECEPTACLES, SWITCHES, ETC. WITH ARCHITECTURAL DRAWINGS...

### GENERAL MECHANICAL NOTES

- 1. MECHANICAL SYSTEM IS DESIGN BUILT BY THE CONTRACTOR AND WILL BE ISSUED AS A DEFERRED SUBMITTAL.

### GENERAL NOTES

- 1. SOME ROOM NAMES MAY NOT BE SHOWN FOR PURPOSE OF CLARIFYING PLAN REFER TO ARCHITECTURAL PLANS FOR REFERENCES TO ROOM NAMES NOT SHOWN...
2. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO MAINTAIN AND KEEP AT THE JOB SITE...



PARAGON STAR RR-CONCESSIONS

1401 NW River Rd
Lee's Summit, MO 64081

Project No.: 19050 04b
Date: 12 08 2025


Issued For: PERMIT

Table with 2 columns: No. and Description. Lists revisions.

### REVISIONS

Table with 2 columns: No. and Description. Lists revisions.

### REGISTRATION



Andrew E. Thrasher - Engineer
MOR PE-2021001132

### PROJECT TEAM

Table with 2 columns: Role and Name. Lists project team members.

### ARCHITECT

FINKLE-WILLIAMS ARCHITECTURE

### CIVIL

CIVIL CONSULTANT

### LANDSCAPE

LANDSCAPE

### STRUCTURAL

STRUCTURAL

### PLUMBING

PLUMBING

### MECHANICAL

MECHANICAL

### ELECTRICAL

ELECTRICAL

### FIRE PROTECTION

FIRE PROTECTION

### CONTRACTOR

GC

### pkmr ENGINEERS

PEARSON KENT MCKINLEY RAFF ENGINEERS, LLC
1330 W 89TH STREET, LENEXA, KS 66156
913.682.2400 WWW.PKMR.COM
MO State Certificate of Authority RE-200202688

### SHEET TITLE

COVER SHEET

### SHEET NUMBER

PE0.01



SITE PLAN
SCALE: 1/8" = 1'-0"





PARAGON STAR RR-CONCESSIONS

1401 NW River Rd  
Lee's Summit, MO 64081

Project No.: 19050 04b

Date: 12 08 2025

Issued For: PERMIT

REVISIONS

Table with 3 columns: No., Date, Description. Contains multiple empty rows for revisions.

REGISTRATION



Andrea Peratti - Engineer  
MOI PE-202100132

PROJECT TEAM

ARCHITECT: FINKLE-WILLIAMS ARCHITECTURE

CIVIL: CIVIL CONSULTANT

LANDSCAPE: LANDSCAPE

STRUCTURAL: STRUCTURAL

PLUMBING: PLUMBING

MECHANICAL: MECHANICAL

ELECTRICAL: ELECTRICAL

FIRE PROTECTION: FIRE PROTECTION

CONTRACTOR: GC



PEARSON KENT MCKINLEY RAFF ENGINEERS, LLC  
1330 W 87TH STREET, LENEXA, KS 66215  
913.692.2600 WWW.PKMR.COM  
MO State Certificate of Authority RE-200202686

SHEET TITLE

PLUMBING SCHEDULES & DETAILS

SHEET NUMBER

P2.01

PLUMBING FIXTURE SCHEDULE

Table with columns: MARK, MANUFACTURER, MODEL, DESCRIPTION, FITTINGS, CONNECTION SIZES, REMARKS. Lists various plumbing fixtures like sinks, faucets, and valves.

REMARKS: 1. PROVIDE CHROME-PLATED BRASS TAILPIECE AND GRID DRAIN. 2. PROVIDE CHROME-PLATED BRASS P-TRAP. 3. PROVIDE LOOSE KEY STOPS AND FLEXIBLE RISERS. 4. PROVIDE CONCEALED ARM TYPE CARRIER WITH SQUARE, TUBULAR STEEL UP-RIGHTS AND BLOCK TYPE BASES. 5. INSULATE EXPOSED TAILPIECE, P-TRAP, AND WATER RISERS. REFER TO SPECIFICATIONS FOR INSULATION METHODS. 6. PROVIDE FURISH VALVE HANDLE ON WIDE SIDE OF STALL. 7. PROVIDE HANDLE STOPS AND FLEXIBLE RISERS. 8. PROVIDE CHROME-PLATED BRASS TAILPIECE AND BASKET STRAINER.

PIPING MATERIAL AND INSULATION SCHEDULE

Table with columns: SYSTEM, SIZE, MATERIAL, TYPES/SCHED, ACCEPTABLE FITTINGS, FIELD TEST PRESSURE/TIME, ALLOWABLE IN PLENUMS, INSULATION THICKNESS. Lists piping materials like copper, PVC, and ABS.

REMARKS: 1. ALL LAVATOIRES AND SINKS USED FOR HAND WASHING SHALL BE PROVIDED WITH AN ANTI-SCALD TEMPERATURE MIXING VALVE ON THE HOT WATER SUPPLY. REFER TO DETAIL. 2. ALL INSULATION THICKNESSES SHALL MEET OR SURPASS THE REQUIREMENTS OF BOTH THE CURRENT ADOPPTED VERSION OF THE ENERGY CODE AND DIRECTLY PRECEDING VERSION OF ASHRAE 90.1. 3. REFER TO SPECIFICATIONS FOR MORE DETAILED INFORMATION.

GREASE INTERCEPTOR SCHEDULE

Table with columns: MARK, MANUFACTURER, MODEL, SERVICE, CAPACITIES, CONNECTION SIZES, REMARKS. Lists grease interceptors like GBI.

REMARKS: 1. PROVIDE WITH FIELD ADJUSTABLE RISERS AS REQUIRED TO EXTEND COVERGRATE TO FINISHED FLOOR. 2. PROVIDE WITH BUILT-IN FLOW CONTROL AND TEST CAPS WITH 3 OUTLET OPTIONS. 3. PROVIDE WITH PUMPOUT PORT KIT WITH 3" CAM LOCK AND ADAPTER. 4. FLOOR MOUNTED BELOW SINK.

WATER HEATER SCHEDULE - ELECTRIC

Table with columns: MARK, MANUFACTURER, MODEL, DESCRIPTION, TANK VOLUME, HEATING ELEMENT(S), RECOVERY RATE, ELECTRICAL. Lists water heaters like WH-1.

REMARKS: 1. GLASS-LINED TANK. 2. ELECTRIC ELEMENTS SHALL BE NON-SMALL-TANDEM OPERATION.

FLOOR DRAIN SCHEDULE

Table with columns: MARK, MANUFACTURER, MODEL, SERVICE, TOP/GRATE SIZE, WASTE SIZE, REMARKS. Lists floor drains like FD-1, FD-2, FS-1, FS-2.


REMARKS: 1. PROVIDE WITH NICKEL BRONZE TOP. 2. PROVIDE WITH ARC COATING ON DRAIN AND GRATE. 3. PROVIDE WITH 1/2 GRATE. 4. PROVIDE WITHOUT GRATE.

DOMESTIC RECIRCULATION PUMP SCHEDULE

Table with columns: MARK, MANUFACTURER, MODEL, GPM, HEAD, PUMP HP, MAX RPM, VOLTAGE (V), PH, REMARKS. Lists recirculation pumps like RP-1.


REMARKS: 1. ALL BRONZE CONSTRUCTION. 2. PROVIDE WITH MOTOR RATED DISCONNECT, ADJUSTAST AND TIMER FOR OPERATION OF PUMP. 3. MOUNT PUMP AND ACCESSORIES NEAR WATER HEATER AND NO HIGHER THAN 6' AFF.

NOTES: 1. BACKFLOW PREVENTER MANUFACTURER AND INSTALLATION SHALL BE AS APPROVED BY LOCAL AND STATE AUTHORITIES AND IN ACCORDANCE TO LISTING OF DEVICE. 2. ALL PIPING TO BE RIGIDLY SUPPORTED AND INSTALLED IN SUCH A MANNER AS TO BE DRAINABLE.

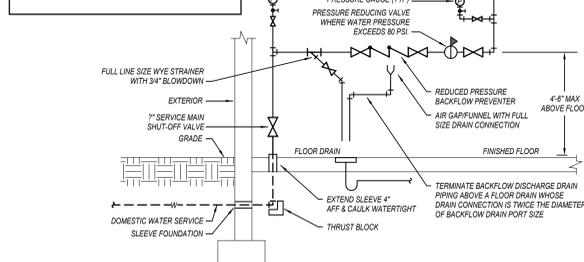


WATER SERVICE REDUCED PRESSURE BACKFLOW PREVENTER DETAIL

NOT TO SCALE

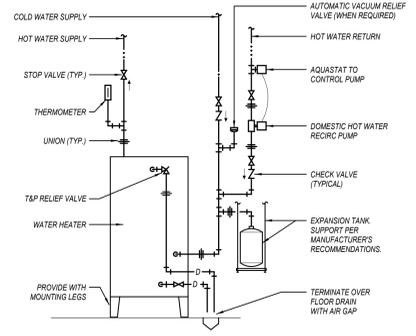


ELECTRIC WATER HEATER

NOT TO SCALE

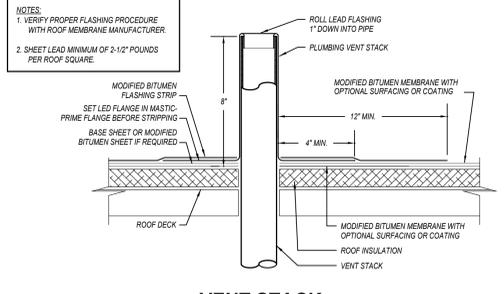


VENT STACK

NOT TO SCALE

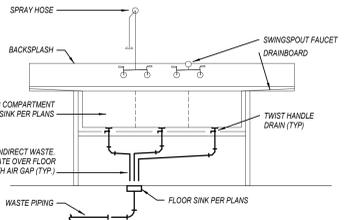


FOOD PREP SINK DETAIL

NOT TO SCALE

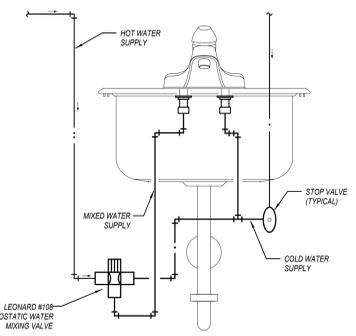


HAND WASHING SINK/LAVATORY TEMPERED WATER SCHEMATIC

NOT TO SCALE




PIPE HANGER DETAIL

NOT TO SCALE




AIR GAP DETAIL

NOT TO SCALE




RECIRCULATING PUMP DETAIL

NOT TO SCALE




P-TRAP DETAIL

NOT TO SCALE




FLOOR CLEANOUT DETAIL

NOT TO SCALE

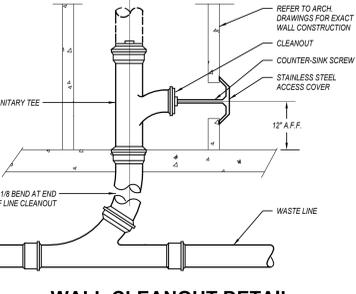

WALL CLEANOUT DETAIL

NOT TO SCALE

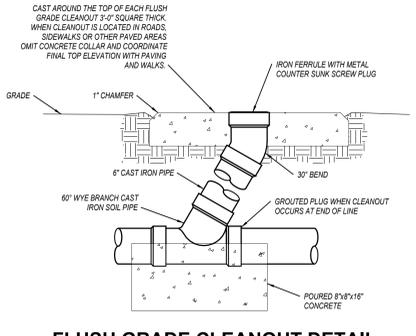

FLUSH GRADE CLEANOUT DETAIL

NOT TO SCALE





PARAGON STAR RR-CONCESSIONS

1401 NW River Rd
Lee's Summit, MO 64081

Project No.: 19050.04b
Date: 12.08.2025
Issued For: PERMIT

Table with 3 columns: No., Date, Description. Includes REVISIONS section.



PROJECT TEAM table listing ARCHITECT, CIVIL, LANDSCAPE, STRUCTURAL, PLUMBING, MECHANICAL, ELECTRICAL, FIRE PROTECTION, and CONTRACTOR.

LIGHTING CONTROLS

- REFER TO SCHEDULES FOR SPECIFIC INFORMATION ON DEVICES. UNLESS NOTED OTHERWISE, WHERE "P" IS USED BELOW IT REFERS TO THE DEVICE IDENTITY IN THE RESPECTIVE SCHEDULE.
STANDARD SENSORS/CONTROLLERS
WALL-MOUNTED SENSOR
WALL-MOUNTED SENSOR - DUAL-RELAY
LOW VOLTAGE MOMENTARY SWITCH (# INDICATES NO. OF BUTTONS)
CORNER-MOUNTED (ON CEILING) MOTION SENSOR
CORNER-MOUNTED (ON WALL) MOTION SENSOR
CEILING-MOUNTED MOTION SENSOR
CEILING-MOUNTED MOTION SENSOR FOR HALLWAYS
CEILING-MOUNTED MOTION SENSOR FOR HIGH CEILING
CEILING-MOUNTED MOTION SENSOR FOR AISLES
CEILING-MOUNTED MOTION SENSOR FOR ENDS OF AISLES
DAYLIGHT SENSOR
DIGITAL LIGHTING MANAGEMENT SENSORS/CONTROLLERS
DIGITAL WALL-MOUNTED SENSOR
DIGITAL WALL-MOUNTED SENSOR - DUAL-RELAY
DIGITAL CORNER-MOUNTED (ON CEILING) MOTION SENSOR
DIGITAL CORNER-MOUNTED (ON WALL) MOTION SENSOR
DIGITAL CEILING-MOUNTED MOTION SENSOR
DIGITAL CEILING-MOUNTED MOTION SENSOR FOR HALLWAYS
DIGITAL CEILING-MOUNTED MOTION SENSOR FOR AISLES
DIGITAL DAYLIGHT SENSOR
DIGITAL ON/OFF SWITCH (# INDICATES NO. OF BUTTONS)
DIGITAL DIMMING SWITCH (# INDICATES NO. OF BUTTONS)
DIGITAL ON/OFF ROOM CONTROLLER
DIGITAL DIMMING ROOM CONTROLLER
TIME-BASED CONTROLS
DIGITAL TIME SWITCH
ASTRONOMICAL TIME CLOCK
LIGHTING CONTROL PANEL SYSTEMS
LIGHTING CONTROL PANEL SWITCH
LIGHTING CONTROL PANEL

TRAINING AND PROGRAMMING

- OWNER TRAINING
PROVIDE FACTORY REPRESENTATIVE TRAINING TO OWNER FOR EACH LIGHTING CONTROL SYSTEM UTILIZED, INCLUDING PROGRAMMING FOR SCHEDULING AND OPERATION OF EACH ROOM PER OWNER DIRECTION.
PROVIDE RECORD OF TIME DELAY SETTINGS ON ALL SENSOR DEVICES FOR OWNER USE.
SENSOR ADJUSTMENTS AND SETTINGS
SYSTEMS SHALL BE SET/PROGRAMMED TO OPERATE TYPICALLY IN MANUAL MODE.
SET WALL MOUNTED MOTION SENSOR TO MANUAL ON MODE.
SET POWER PACKS AND ROOM CONTROLLERS CONTROLLED BY MOTION SENSORS TO MANUAL ON AND CONTROL WITH MOMENTARY WALL SWITCH.
PROVIDE FINAL SETTINGS/ADJUSTMENTS PER OWNER'S DIRECTION.

CONTROLS SEQUENCES

- HALL-MOUNTED LINE VOLTAGE SENSORS
TURN ON LIGHTS IN ROOM/AREA UPON BUTTON ON SENSOR BEING ACTIVATED BY OCCUPANT.
TURN OFF LIGHTS AFTER NO MOTION IS DETECTED AND DELAY EXPIRES.
RESTROOM
MANUAL ON/OFF CONTROL OF LIGHTING VIA LOCAL SWITCHES.
TURN OFF LIGHTS AFTER NO MOTION IS DETECTED BY CEILING SENSOR AND DELAY EXPIRES.

SINGLE-SECTION PANELBOARD SCHEDULE


Table with columns: PANEL DESIGNATION (CB1), MOUNTING SURFACE, LOCATION, PHASE, CIRCUIT #, POLE, TRIP, DESCRIPTION, and various electrical specifications.

PANELBOARD SIZING LOAD table with columns: LOAD DESCRIPTION, CONNECTED, DEMAND, CODE MIN. (VA).


CONNECTED PHASE LOADS table with columns: PHASE, VA, AMPS.

PANELBOARD BREAKER KEYED NOTES

- FURNISH GFCI-PROTECTED BREAKER

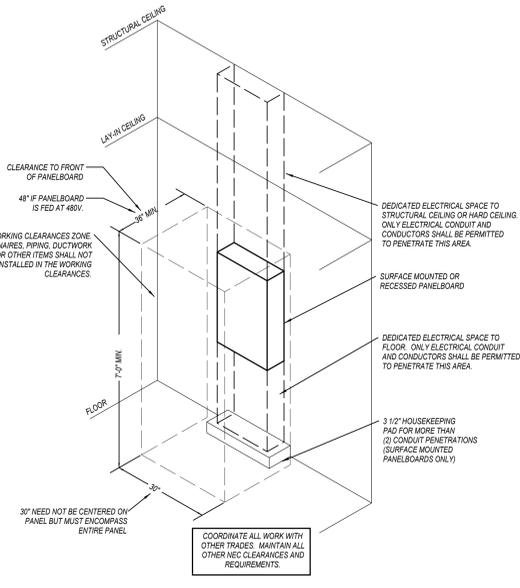


TYPICAL PANELBOARD INSTALLATION DETAIL NOT TO SCALE

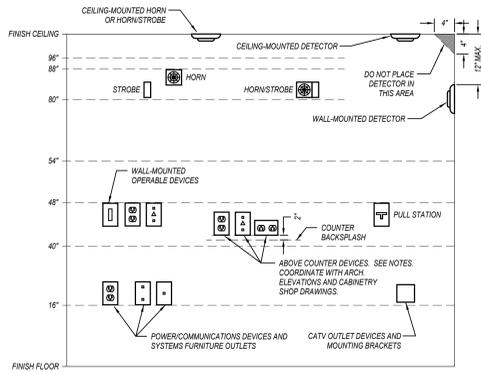

- GENERAL NOTES
MOUNTING HEIGHTS SHOWN IN THIS DETAIL ARE TYPICAL UNLESS OTHERWISE NOTED ON THE PLANS.
SEE ARCHITECTURAL ELEVATIONS FOR SPECIAL CONDITIONS.
WALL-MOUNTED OPERABLE DEVICES
OPERABLE DEVICES SHALL BE LOCATED AT 48" A.F.F. TO THE TOP OF THE OPERABLE PORTION OF THE DEVICE.

MOUNTING HEIGHTS FOR WALL-MOUNTED DEVICES NOT TO SCALE

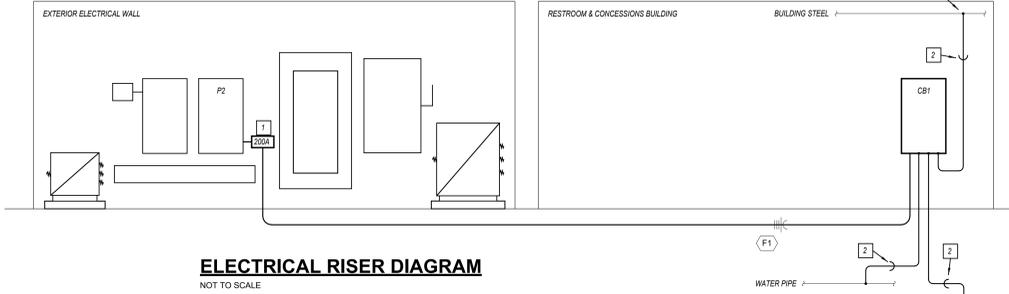

ELECTRICAL RISER DIAGRAM NOT TO SCALE

RISER DIAGRAM KEYED NOTES

- PROVIDE NEW 250A 3P BREAKER IN NEMA 3R ENCLOSURE TO SERVE NEW PANELBOARD. TOP BUS IN EXISTING PANELBOARD P2. MAINTAIN ALL REQUIRED NEC CLEARANCES.
#2 AWG GROUNDING ELECTRODE CONDUCTOR IN 3" CONDUIT.


EQUIPMENT FEEDER SCHEDULE

Table with columns: FEEDER NO., EQUIPMENT, LOAD (AMPS), SETS, # OF WIRES, FEEDER SIZE, GROUND #, MATERIAL, CONDUIT SIZE.


LIGHT FIXTURE SCHEDULE

Table with columns: FIXTURE NUMBER, MANUFACTURER, CATALOG NUMBER, DESCRIPTION, ID, WATTS, LUMENS, CCT, DIMMING, VOLTAGE, REMARKS.

- REMARKS
FURNISH WITH AND INSTALL ALL NECESSARY HARDWARE AND MOUNTING BRACKETS.
GENERAL NOTES (APPLICABLE TO ALL FIXTURES)
ALL DRIVERS ARE INTEGRAL TO FIXTURE UNLESS NOTED OTHERWISE.
ALL FIXTURES WITH PAINTED METAL PARTS SHALL BE PAINTED AFTER FABRICATION.

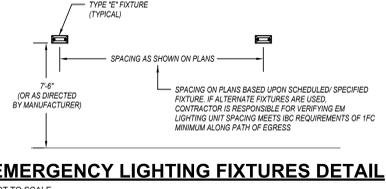


EMERGENCY LIGHTING FIXTURES DETAIL NOT TO SCALE

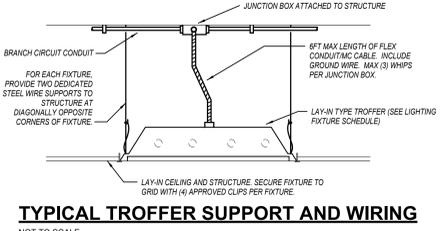


TYPICAL TROFFER SUPPORT AND WIRING NOT TO SCALE

LIGHTING CONTROL DEVICE SCHEDULE

Table with columns: MARK, MANUFACTURER, MODEL, DESCRIPTION, VOLTAGE.

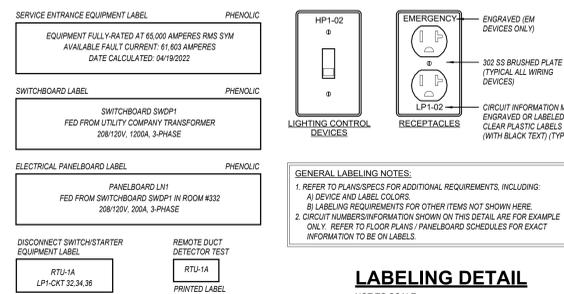

LABELING DETAIL NOT TO SCALE

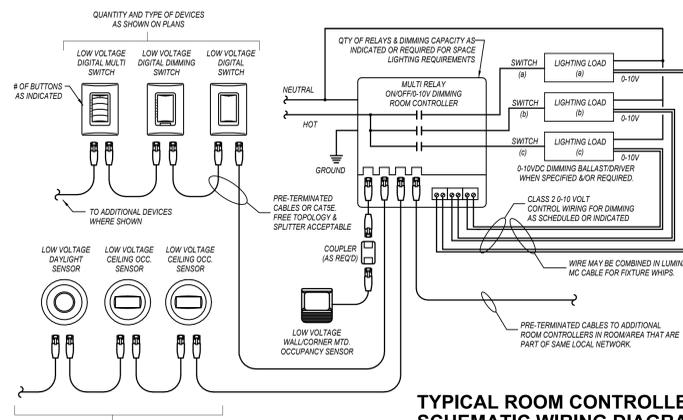

TYPICAL ROOM CONTROLLER SCHEMATIC WIRING DIAGRAM NOT TO SCALE

ELECTRICAL SCHEDULES & DETAILS

SHEET NUMBER

E2.01