

MiTek, Inc.
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Re: Avalon - Contemporary
Avalon - Contemporary

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Wheeler - Waverly.

Pages or sheets covered by this seal: I66389186 thru I66389244

My license renewal date for the state of Kansas is April 30, 2026.

Kansas COA: E-943



June 21, 2024

Garcia, Juan

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:51

MiTek, Inc.
16023 Swingley Ridge Rd.
Chesterfield, MO 63017
314.434.1200

Re: Avalon - Contemporary
Avalon - Contemporary
RS122
1925 SW Hightown Dr
Lee's Summit, MO 64082

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Wheeler - Waverly.

Pages or sheets covered by this seal: I66389186 thru I66389244

My license renewal date for the state of Missouri is December 31, 2024.

Missouri COA: Engineering 001193



June 21, 2024

Garcia, Juan ,Engineer

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.


RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:51

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389186
Avalon -	A1	Hip Girder	1	4	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 E Dec 14 2023 Print: 8.730 E Dec 14 2023 MiTek Industries, Inc. Fri Jun 21 13:18:20
 ID:xxQ6yM2cQGDKA8yJM4PdpizNXbG-UkhxMICz_XUhd5EHmANGdznHqRT6gk3pnpZjCz42UI

Page: 1

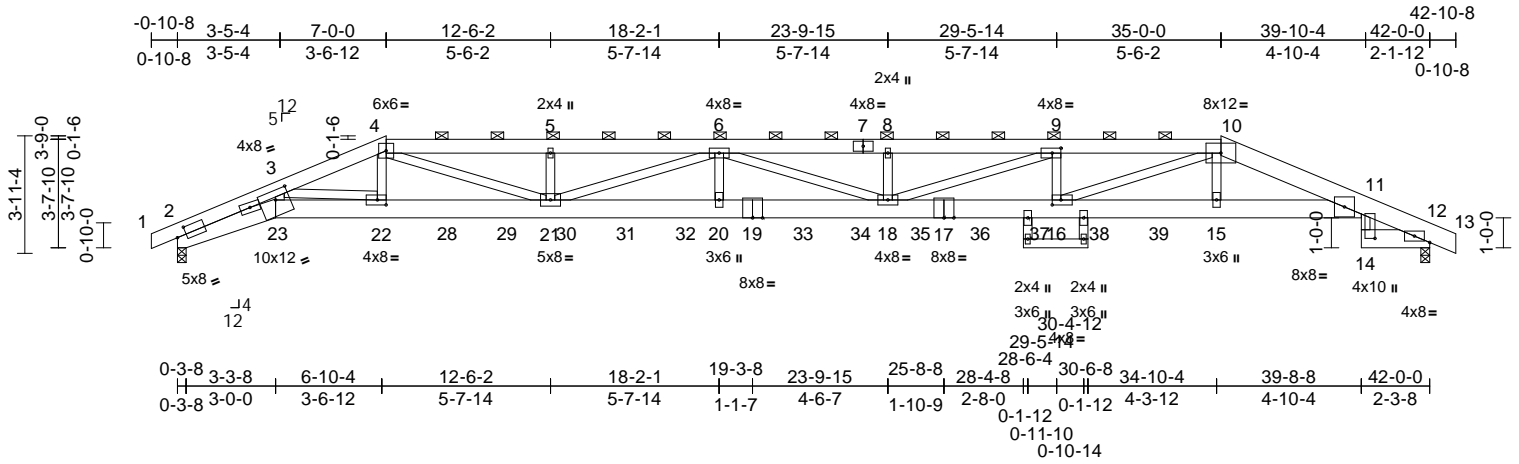

Scale = 1:77.3

Plate Offsets (X, Y): [2:0-3-13,0-3-0], [9:0-3-8,0-2-0], [11:0-2-12,0-1-3], [12:0-2-2,0-0-9], [14:0-1-10,1-10-0], [16:0-3-8,0-2-0], [22:0-3-8,0-2-0], [23:0-5-8,0-3-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.56	Vert(LL)	-0.52	18-20	>962	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.90	18-20	>555	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.47	Horz(CT)	0.32	12	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.33	18-20	>999	240		Weight: 1165 lb FT = 10%

LUMBER
 TOP CHORD 2x6 SP 2400F 2.0E *Except* 10-13:2x8 SP 2400F 2.0E
 BOT CHORD 2x8 SP 2400F 2.0E *Except* 24-25:2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 4-10.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (lb/size) 2=4544/0-3-8, 12=4549/0-3-8
 Max Horiz 2=-35 (LC 11)
 Max Uplift 2=-496 (LC 4), 12=-485 (LC 5)

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-17235/1899, 3-4=-14808/1710, 4-5=-19725/2216, 5-6=-19724/2215, 6-7=-23320/2586, 7-8=-23320/2586, 8-9=-23320/2586, 9-10=-19893/2236, 10-11=-14833/1674, 11-12=-2549/286
 BOT CHORD 2-23=-1687/15522, 22-23=-1557/14293, 22-28=-1524/13720, 28-29=-1524/13720, 21-29=-1524/13720, 21-30=-2544/23547, 30-31=-2544/23547, 31-32=-2544/23547, 20-32=-2544/23547, 19-20=-2544/23547, 19-33=-2544/23547, 33-34=-2544/23547, 18-34=-2544/23547, 18-35=-2168/19893, 17-35=-2168/19893, 17-36=-2168/19893, 36-37=-2168/19893, 16-37=-2168/19893, 16-38=-1549/14208, 38-39=-1549/14208, 15-39=-1549/14208, 11-15=-1533/14061

WEBS 11-14=-78/858, 3-23=-324/3342, 3-22=-420/83, 4-22=-289/2426, 10-15=-215/1967, 10-16=-667/6207, 5-21=-403/96, 4-21=-670/6546, 6-21=-4146/427, 6-20=-58/1042, 6-18=-318/38, 8-18=-364/88, 9-18=-376/3728, 9-16=-1587/214

- NOTES**
- 4-ply truss to be connected together with Simpson SDS 1/4 x 6 screws as follows:
 Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc.
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are 4x8 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.

- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 496 lb uplift at joint 2 and 485 lb uplift at joint 12.
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

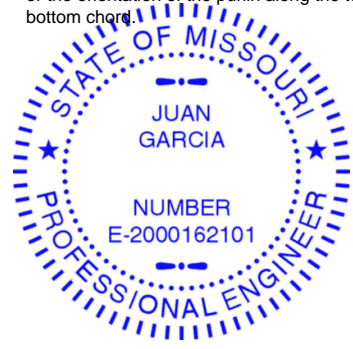

June 21, 2024

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:51

Job Avalon -	Truss A1	Truss Type Hip Girder	Qty 1	Ply 4	Avalon - Contemporary Job Reference (optional)	I66389186
-----------------	-------------	--------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 E Dec 14 2023 Print: 8.730 E Dec 14 2023 MiTek Industries, Inc. Fri Jun 21 13:18:20
ID:xxQ6yM2cQGDKA8yJM4PdpizNXbG-UkhxMICz_XUhd5EHmANGdznHqrBT6gk3pnpZjCz42UI

Page: 2

13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 785 lb down and 185 lb up at 7-0-0, 278 lb down and 38 lb up at 9-0-12, 278 lb down and 38 lb up at 11-0-12, 278 lb down and 38 lb up at 13-0-12, 278 lb down and 38 lb up at 15-0-12, 278 lb down and 38 lb up at 17-0-12, 278 lb down and 38 lb up at 19-0-12, 278 lb down and 38 lb up at 21-0-0, 278 lb down and 38 lb up at 22-11-4, 278 lb down and 38 lb up at 24-11-4, 278 lb down and 38 lb up at 26-11-4, 253 lb down and 46 lb up at 28-11-4, 278 lb down and 38 lb up at 30-11-4, and 278 lb down and 38 lb up at 32-11-4, and 818 lb down and 166 lb up at 34-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

14) Filler applied to ply: 1(Front)

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15,

Plate Increase=1.15

Uniform Loads (lb/ft)

Vert: 1-4=-70, 4-10=-70, 10-13=-70, 2-23=-20,

11-23=-20, 12-14=-20

Concentrated Loads (lb)

Vert: 19=-278 (B), 22=-785 (B), 15=-818 (B),

28=-278 (B), 29=-278 (B), 30=-278 (B), 31=-278 (B),

32=-278 (B), 33=-278 (B), 34=-278 (B), 35=-278 (B),

36=-278 (B), 37=-253 (B), 38=-278 (B), 39=-278 (B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Potosi, MO 63003
816-424-0200 / MiTek.US
01/29/2026 3:02:51

Job Avalon -	Truss A2	Truss Type Hip	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389187
-----------------	-------------	-------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:50
ID:z5TmPe?5Zi29cVg_rNJ0ddzNX_b-RfC?PsB70Hq3NSgPqnL8w3uITxBKwCrDoi7J4zJC?f

Page: 1

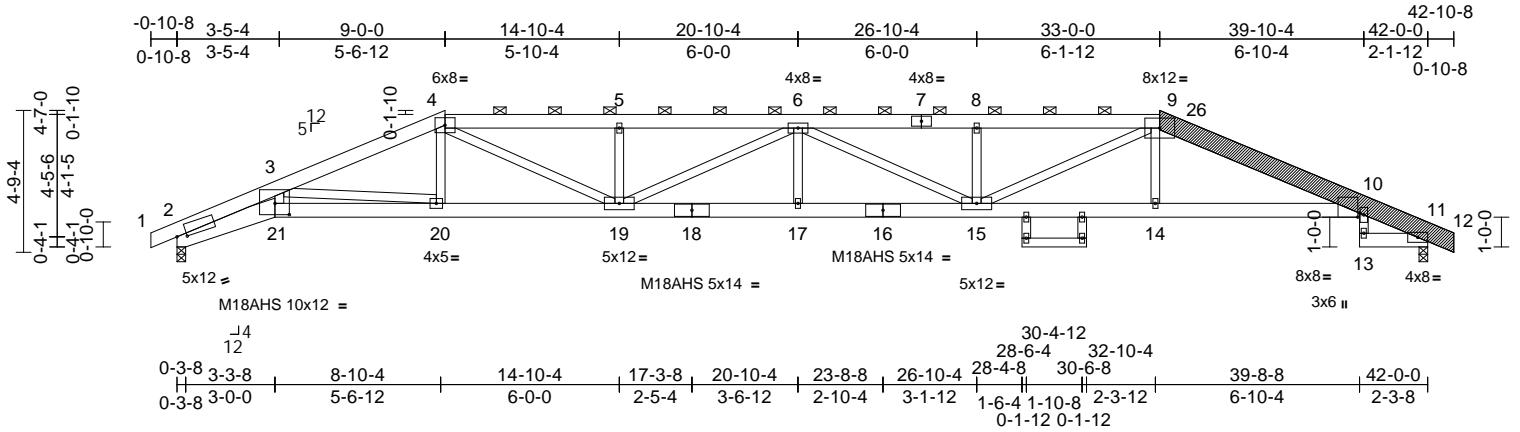

Scale = 1:77.4

Plate Offsets (X, Y): [2:0-4-0,0-1-0], [10:0-0-11,Edge], [21:0-5-12,0-4-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.56	Vert(LL)	-0.51	17	>980	360	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.59	Vert(CT)	-0.92	17	>544	240	M18AHS 186/179
BCLL	0.0*	Rep Stress Incr	YES	WB	0.77	Horz(CT)	0.46	11	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S	0.38	Wind(LL)	0.38	17	>999	240	Weight: 305 lb FT = 10%

LUMBER
TOP CHORD 2x6 SP 2400F 2.0E *Except* 9-12:2x8 SP 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E *Except* 2-21:2x8 SP 2400F 2.0E, 22-23:2x4 SPF No.2
WEBS 2x4 SPF No.2
LBR SCAB 9-12 SP 2400F 2.0E one side

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-5-2 oc purlins, except 2-0-0 oc purlins (4-0-13 max.): 4-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS
(size) 2=0-3-8, 11=0-3-8
Max Horiz 2=-74 (LC 9)
Max Uplift 2=-279 (LC 4), 11=-278 (LC 5)
Max Grav 2=1948 (LC 1), 11=1948 (LC 1)

FORCES
(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/3, 2-3=-7265/968, 3-4=-4810/726, 4-5=-5964/994, 5-6=-5962/992, 6-8=-6020/1001, 8-9=-6020/1001, 9-10=-4754/708, 10-11=-991/154, 11-12=0/6
BOT CHORD 2-21=-855/6544, 20-21=-786/5922, 19-20=-590/4433, 17-19=-991/6572, 15-17=-991/6572, 14-15=-578/4490, 10-14=-583/4484, 11-13=0/0
WEBS 10-13=-3/125, 3-21=-173/1840, 3-20=-1481/293, 4-20=0/490, 9-14=0/278, 4-19=-342/1864, 5-19=-452/183, 6-19=-773/131, 6-17=0/255, 6-15=-711/117, 8-15=-418/179, 9-15=-348/1842

- Attached 10-11-6 scab 9 to 12, front face(s) 2x8 SP 2400F 2.0E with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c.except : starting at 0-3-14 from end at joint 9, nail 2 row(s) at 7" o.c. for 2-0-0; starting at 6-3-11 from end at joint 9, nail 2 row(s) at 4" o.c. for 2-0-0; starting at 8-7-3 from end at joint 9, nail 2 row(s) at 4" o.c. for 2-0-0.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 2x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 279 lb uplift at joint 2 and 278 lb uplift at joint 11.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DESIGNER'S SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:51

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389188
Avalon -	A3	Hip	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:50
 ID:kNvBm0TZ6Ngxz7LGABBEzNWnf-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwCDoi7J4zJC7f

Page: 1

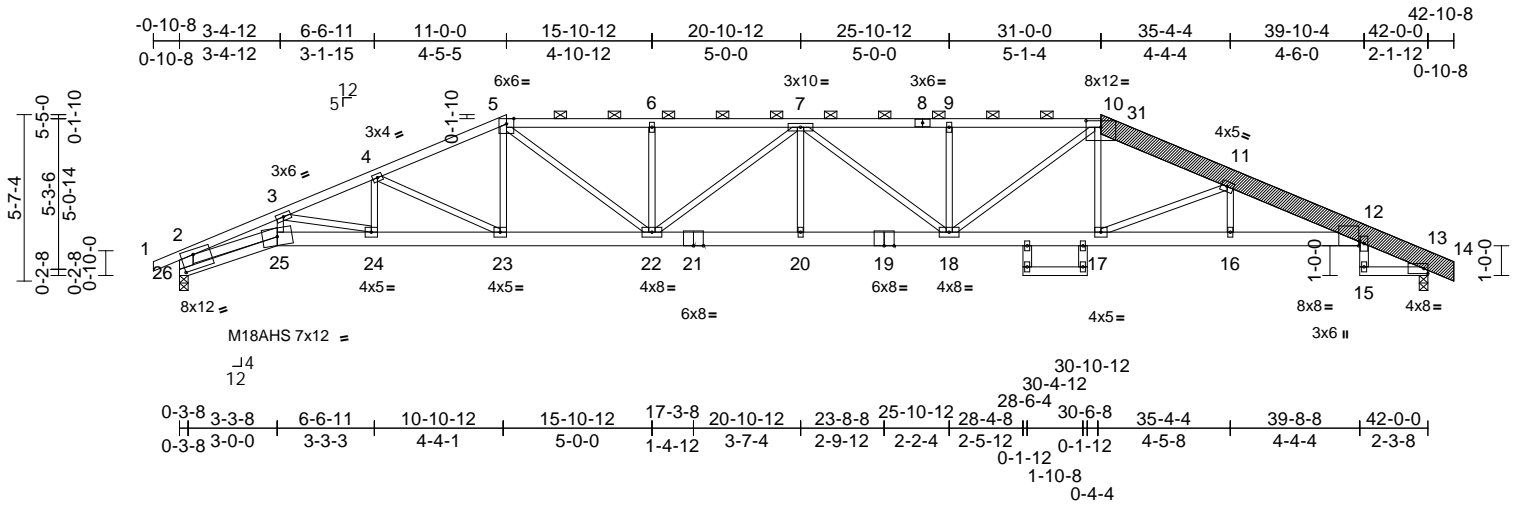

Scale = 1:77.5
 Plate Offsets (X, Y): [10:0-6-0,0-2-10], [12:0-0-7,Edge], [26:0-5-0,0-6-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.96	Vert(LL)	-0.49	20-22	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.49	Vert(CT)	-0.89	20-22	>560	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.63	Horz(CT)	0.43	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.36	20-22	>999	240	Weight: 266 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2 *Except* 10-14:2x8 SP 2400F 2.0E
 BOT CHORD 2x4 SPF No.2 *Except* 25-21,19-12,21-19:2x6 SP 2400F 2.0E
 WEBS 2x3 SPF No.2 *Except* 12-15,27-29,28-30:2x4 SPF No.2, 26-2:2x6 SPF No.2, 25-2:2x4 SPF 2100F 1.8E
 LBR SCAB 10-14 SP 2400F 2.0E one side
BRACING
 TOP CHORD Structural wood sheathing directly applied or 1-5-9 oc purlins, except end verticals, and 2-0-0 oc purlins (2-2-0 max.): 5-10.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS (size) 13=0-3-8, 26=0-3-8
 Max Horiz 26=82 (LC 13)
 Max Uplift 13=254 (LC 5), 26=257 (LC 4)
 Max Grav 13=1944 (LC 1), 26=1951 (LC 1)
FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/30, 2-3=-6109/732, 3-4=-4953/648, 4-5=-4170/610, 5-6=-4680/743, 6-7=-4677/741, 7-9=-4711/745, 9-10=-4712/745, 10-11=-4262/624, 11-12=-5106/654, 12-13=-987/140, 13-14=0/0, 2-26=-1986/279
 BOT CHORD 25-26=-124/498, 24-25=-635/5501, 23-24=-530/4571, 22-23=-445/3796, 20-22=-666/5021, 18-20=-666/5021, 17-18=-449/3918, 16-17=-559/4897, 12-16=-560/4900, 13-15=0/0

WEBS 12-15=0/49, 3-25=-31/654, 5-23=-38/573, 10-17=-31/650, 11-17=-1096/195, 2-25=-596/5104, 11-16=-89/79, 4-23=-851/197, 4-24=-4/391, 3-24=-961/173, 5-22=-220/1250, 6-22=-418/160, 7-22=-541/87, 7-20=0/233, 7-18=-503/80, 9-18=-343/149, 10-18=-200/1124

- NOTES**
- Attached 13-1-6 scab 10 to 14, front face(s) 2x8 SP 2400F 2.0E with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 8-5-11 from end at joint 10, nail 2 row(s) at 4" o.c. for 2-0-0; starting at 10-9-9 from end at joint 10, nail 2 row(s) at 7" o.c. for 2-0-0.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - All bearings are assumed to be SPF No.2 .
 - Bearing at joint(s) 26 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 257 lb uplift at joint 26 and 254 lb uplift at joint 13.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:51

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389189
Avalon -	A4	Hip	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:50
 ID:AMpSFYh9FvFj?ARzUQYstxzNWdl-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwKRCDoi7J4zJC?f

Page: 1

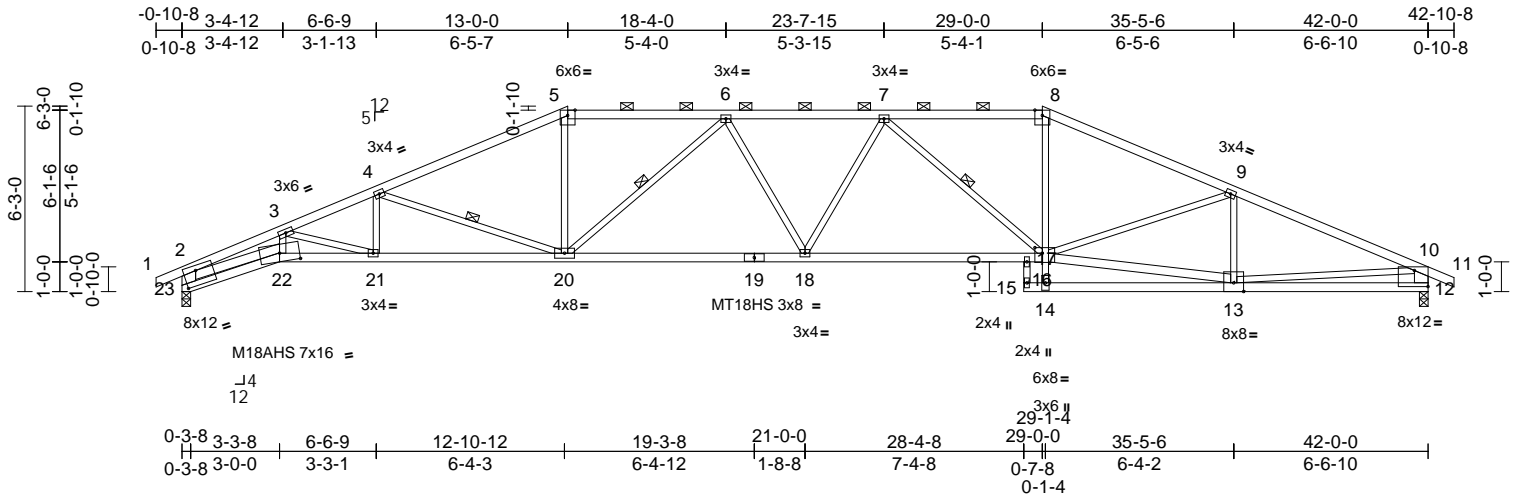

Scale = 1:77.7

Plate Offsets (X, Y): [12:Edge,0-6-8], [16:0-3-0,0-2-4], [22:0-8-0,0-3-7], [23:0-5-0,0-6-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.64	Vert(LL)	-0.41	17-18	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.66	Vert(CT)	-0.77	17-18	>649	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.85	Horz(CT)	0.35	12	n/a	n/a	MT18HS	197/144
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.28	17-18	>999	240	Weight: 165 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF 2100F 1.8E *Except* 5-8:2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 22-19,19-16:2x4 SPF 2100F 1.8E, 17-15:2x3 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 23-2,12-10:2x6 SPF No.2, 22-2:2x4 SPF 2100F 1.8E, 16-13:2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-7-2 oc purlins, except end verticals, and 2-0-0 oc purlins (2-6-11 max.): 5-8.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
 6-0-0 oc bracing: 14-15.
 WEBS 1 Row at midpt 4-20, 6-20, 7-16

REACTIONS (size) 12=0-3-8, 23=0-3-8
 Max Horiz 23=79 (LC 13)
 Max Uplift 12=232 (LC 5), 23=232 (LC 4)
 Max Grav 12=1947 (LC 1), 23=1947 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/30, 2-3=-6014/628, 3-4=-4880/566, 4-5=-3794/505, 5-6=-3410/489, 6-7=-4020/580, 7-8=-3410/488, 8-9=-3761/502, 9-10=-3482/408, 10-11=0/30, 2-23=-2023/259, 10-12=-1868/264
 BOT CHORD 22-23=-150/553, 21-22=-536/5372, 20-21=-457/4517, 18-20=-447/3974, 17-18=-448/3971, 16-17=-407/3894, 15-17=-272/0, 14-15=-42/77, 13-14=-32/134, 12-13=-111/659

WEBS 3-22=-58/740, 4-20=-1154/288, 5-20=-68/1046, 14-16=0/440, 8-16=-69/1031, 9-13=-614/152, 2-22=-496/4953, 10-13=-242/2480, 4-21=0/390, 3-21=-893/148, 6-18=-14/203, 6-20=-913/181, 7-18=-6/207, 7-16=-909/183, 9-16=-24/510, 13-16=-287/3029

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 7) All bearings are assumed to be SPF No.2 .
 - 8) Bearing at joint(s) 23 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 232 lb uplift at joint 23 and 232 lb uplift at joint 12.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:51

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389190
Avalon -	A5	Hip	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:50
 ID:q5HqtzhPb1JIXYhfa?Y3kzNWbA-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRcDoi7J4zJC?f

Page: 1

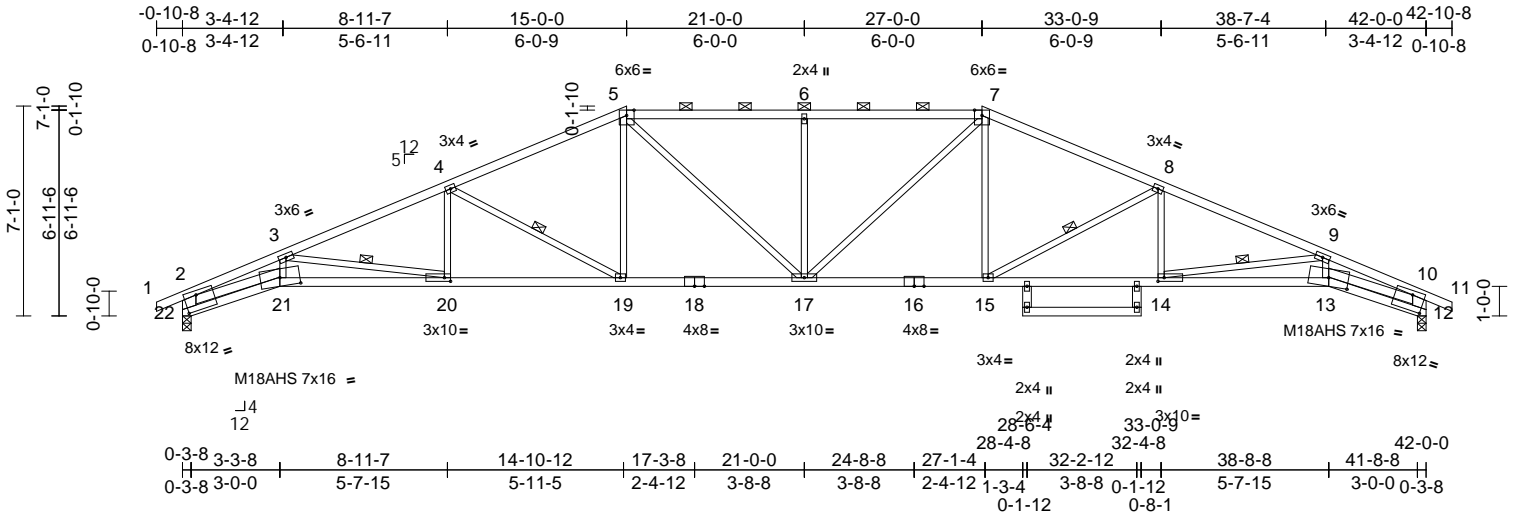

Scale = 1:77.8

Plate Offsets (X, Y): [12:0-5-0,0-6-4], [13:0-8-0,0-3-7], [14:0-2-8,0-1-8], [20:0-2-8,0-1-8], [21:0-8-0,0-3-7], [22:0-5-0,0-6-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.48	17	>999	360	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.79	Vert(CT)	-0.87	15-17	>570	240	M18AHS 142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.55	Horz(CT)	0.54	12	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.32	17	>999	240	Weight: 168 lb FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 21-18,16-13:2x4 SPF 2100F 1.8E
 WEBS 2x3 SPF No.2 *Except* 22-2,12-10:2x6 SPF No.2, 21-2,13-10:2x4 SPF 2100F 1.8E, 23-25,24-26:2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-2-0 max.): 5-7.
 BOT CHORD Rigid ceiling directly applied or 9-6-15 oc bracing.
 WEBS 1 Row at midpt 3-20, 4-19, 8-15, 9-14

REACTIONS (size) 12=0-3-8, 22=0-3-8
 Max Horiz 22=94 (LC 13)
 Max Uplift 12=213 (LC 9), 22=213 (LC 8)
 Max Grav 12=1947 (LC 1), 22=1947 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 5-6=-3479/486, 6-7=-3479/486, 7-8=-3482/436, 8-9=-4412/463, 9-10=-6154/580, 10-11=0/30, 2-22=-1982/263, 10-12=-1982/232, 1-2=0/30, 2-3=-6154/685, 3-4=-4412/463, 4-5=-3482/436
 BOT CHORD 21-22=-138/430, 20-21=-680/5526, 19-20=-363/4040, 17-19=-238/3132, 15-17=-238/3132, 14-15=-337/4040, 13-14=-495/5526, 12-13=-37/430
 WEBS 3-21=-49/761, 3-20=-1507/322, 4-20=0/431, 4-19=-1023/261, 5-19=-53/611, 5-17=-105/670, 6-17=-537/205, 7-17=-105/670, 7-15=-46/611, 8-15=-1023/246, 8-14=0/431, 9-14=-1507/259, 9-13=-7/761, 2-21=-560/5227, 10-13=-477/5227

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Bearing at joint(s) 22, 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 213 lb uplift at joint 22 and 213 lb uplift at joint 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)


MiTek
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:51

Job Avalon -	Truss A6	Truss Type Hip	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389191
-----------------	-------------	-------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 E Dec 14 2023 Print: 8.730 E Dec 14 2023 MiTek Industries, Inc. Fri Jun 21 13:19:51
ID:GNEEB7nAflqmZ7HxHPc7aDzNWTYt-KEhLTPi2ZUyn24hmbnWbp92IOX8twl_TkRmtOQz42St

Page: 1

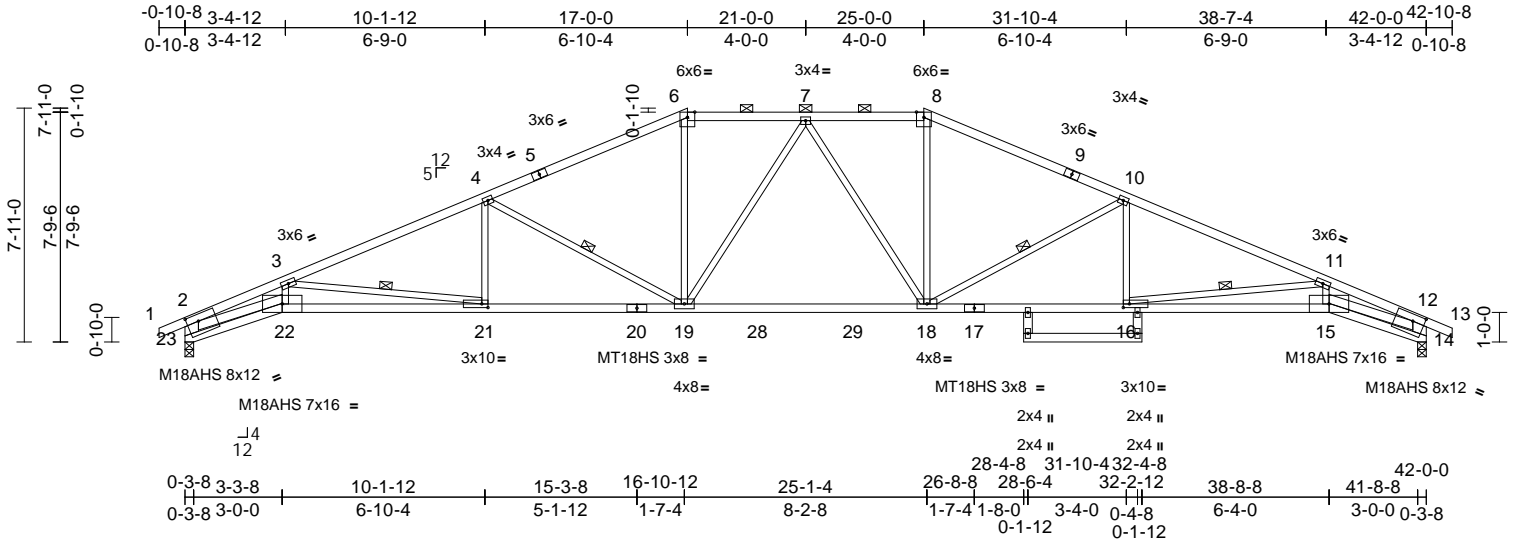

Scale = 1:78

Plate Offsets (X, Y): [14:0-4-12,0-2-12], [16:0-2-8,0-1-8], [21:0-2-8,0-1-8], [23:0-4-12,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.93	Vert(LL)	-0.55	18-19	>902	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.83	Vert(CT)	-0.96	18-19	>521	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.81	Horz(CT)	0.55	14	n/a	n/a	MT18HS	197/144
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.26	18-19	>999	240	Weight: 169 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2 *Except* 1-5,9-13:2x4 SPF 2100F 1.8E
BOT CHORD 2x4 SPF No.2 *Except* 22-20,17-15,20-17:2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except* 23-2,14-12:2x6 SPF No.2, 22-2,15-12:2x4 SPF 2100F 1.8E, 24-26,25-27:2x4 SPF No.2

WEBS
3-22=-53/902, 6-19=-31/1001, 8-18=-31/1001, 11-15=-5/902, 2-22=-657/5460, 12-15=-549/5460, 7-19=-420/109, 7-18=-420/109, 4-21=0/509, 4-19=-1136/299, 3-21=-1771/395, 10-18=-1137/284, 10-16=0/509, 11-16=-1770/320

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-2-11 max.): 6-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 8-10-8 oc bracing: 21-22.
WEBS 1 Row at midpt 4-19, 3-21, 10-18, 11-16
REACTIONS (lb/size) 14=1947/0-3-8, 23=1947/0-3-8
Max Horiz 23=109 (LC 13)
Max Uplift 14=-232 (LC 9), 23=-232 (LC 8)
Max Grav 14=2009 (LC 2), 23=2009 (LC 2)

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - Bearing at joint(s) 23, 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 232 lb uplift at joint 23 and 232 lb uplift at joint 14.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

FORCES (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-6453/783, 3-4=-4407/449, 4-5=-3373/330, 5-6=-3281/357, 6-7=-3028/352, 7-8=-3028/352, 8-9=-3281/357, 9-10=-3373/330, 10-11=-4407/417, 11-12=-6453/663, 2-23=-2048/282, 12-14=-2048/247
BOT CHORD 22-23=-150/532, 21-22=-788/5788, 20-21=-397/4035, 19-20=-397/4035, 19-28=-177/3124, 28-29=-177/3124, 18-29=-177/3124, 17-18=-258/4035, 16-17=-258/4035, 15-16=-575/5788, 14-15=-33/490

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DESIGNER'S SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389192
Avalon -	A7	Hip	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:51
 ID:UqqDauCh0Uc?cPKMLBUyuzNWU2-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRcDoi?J4zJC?f

Page: 1

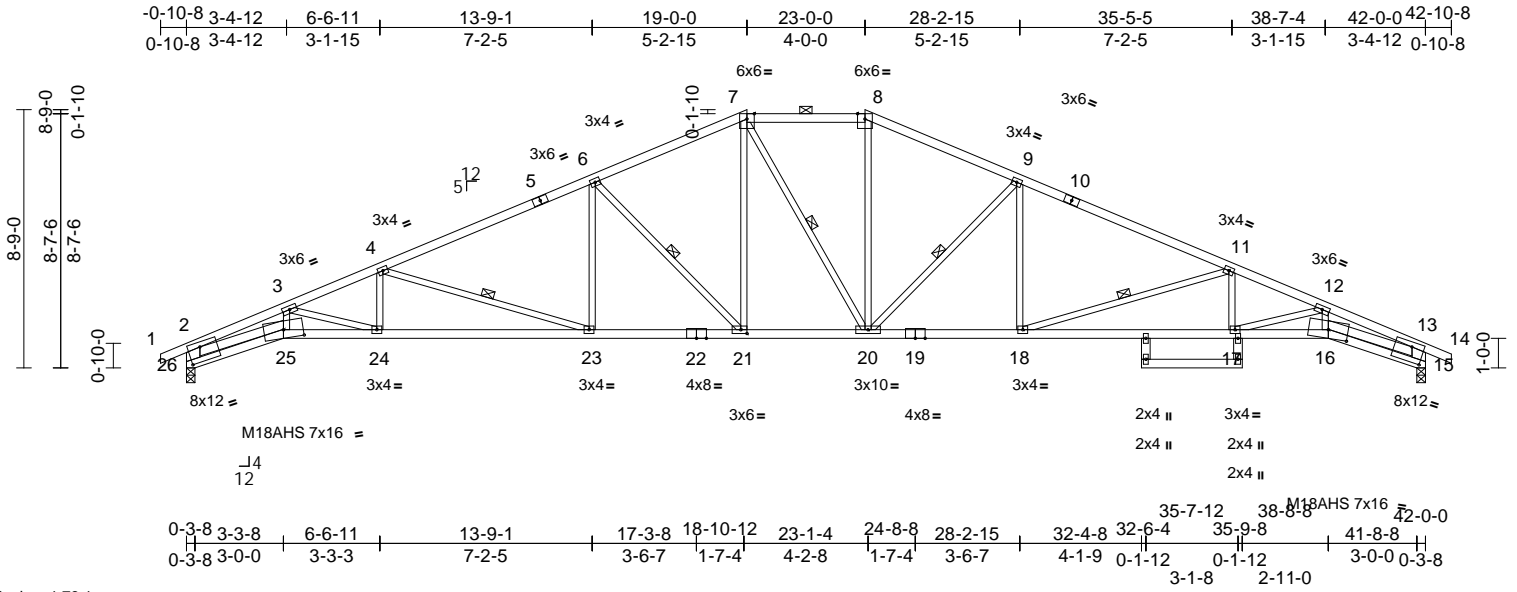

Scale = 1:78.1

Plate Offsets (X, Y): [15:0-5-0,0-6-0], [16:0-8-0,0-3-7], [21:0-2-8,0-1-8], [25:0-8-0,0-3-7], [26:0-5-0,0-6-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.98	Vert(LL)	-0.44	21	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.80	Vert(CT)	-0.80	21-23	>623	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.70	Horz(CT)	0.50	15	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.29	21-23	>999	240		Weight: 176 lb FT = 10%


LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 25-22,19-16:2x4 SPF 2100F 1.8E
 WEBS 2x3 SPF No.2 *Except* 26-2,15-13:2x6 SPF No.2, 25-2,16-13:2x4 SPF 2100F 1.8E, 27-29,28-17:2x4 SPF No.2

WEBS
 3-25=-105/714, 7-21=-133/774,
 7-20=-244/252, 8-20=-66/775,
 12-16=-50/714, 2-25=-628/5010,
 13-16=-502/5010, 6-21=-969/258,
 4-24=0/438, 3-24=-897/205, 4-23=-1294/310,
 6-23=-14/531, 9-20=-965/249, 9-18=-4/528,
 11-18=-1295/277, 11-17=0/438,
 12-17=-896/135

BRACING
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-4-9 max.): 7-8.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 8-8-14 oc bracing: 24-25.
 WEBS 1 Row at midpt 7-20, 6-21, 4-23, 9-20, 11-18
REACTIONS (size) 15=0-3-8, 26=0-3-8
 Max Horiz 26=123 (LC 13)
 Max Uplift 15=-250 (LC 9), 26=-250 (LC 8)
 Max Grav 15=1947 (LC 1), 26=1947 (LC 1)

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) All plates are 3x4 MT20 unless otherwise indicated.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 8) All bearings are assumed to be SPF No.2 .
 - 9) Bearing at joint(s) 26, 15 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 250 lb uplift at joint 26 and 250 lb uplift at joint 15.
 - 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

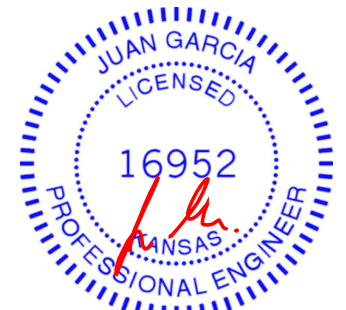

June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:52

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389193
Avalon -	B1	Roof Special	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:51

Page: 1

ID:OxhlzhDjOvRvLroOgWhezjzX478-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRcDoi7J4zJC?f

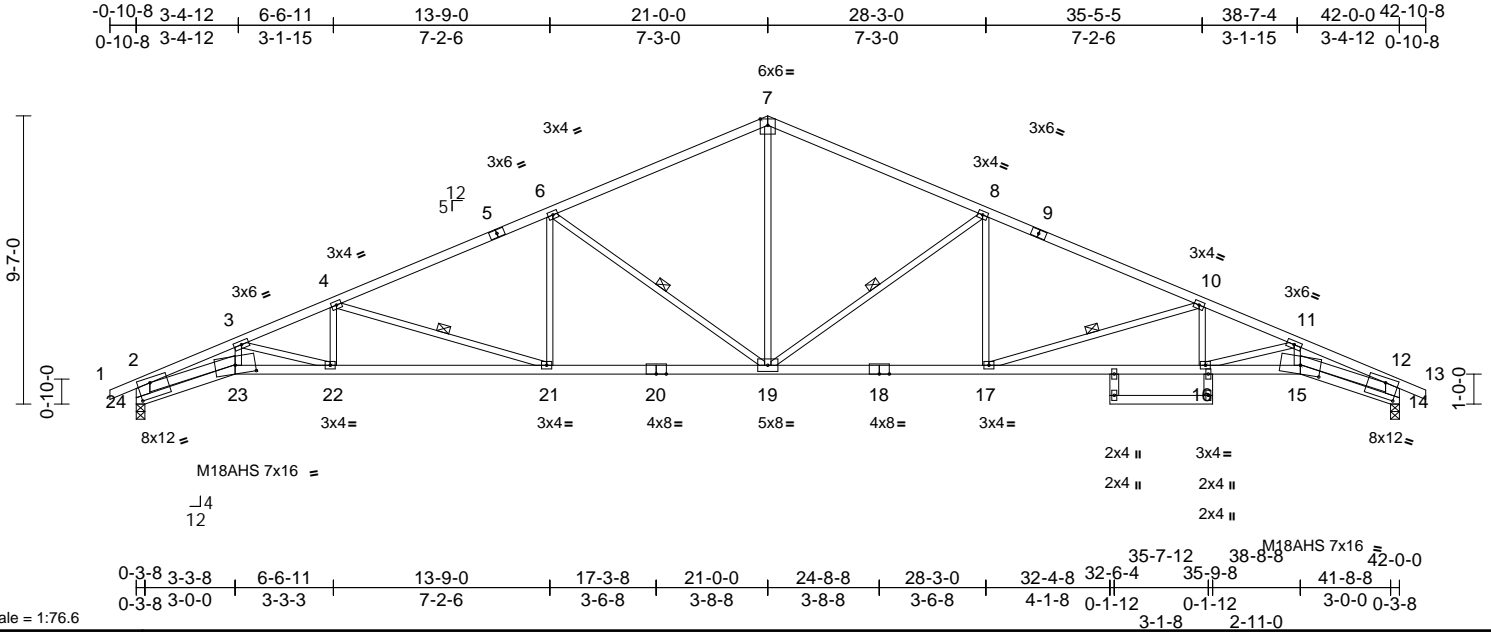


Plate Offsets (X, Y): [14:0-5-0,0-6-0], [15:0-8-0,0-3-7], [23:0-8-0,0-3-7], [24:0-5-0,0-6-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.97	Vert(LL)	-0.44	17-19	>999	360	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.90	Vert(CT)	-0.82	17-19	>608	240	M18AHS 142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.87	Horz(CT)	0.51	14	n/a	n/a	
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.30	21	>999	240	Weight: 167 lb FT = 10%

LUMBER
TOP CHORD 2x4 SPF 2100F 1.8E *Except* 1-5,9-13:2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except* 23-20,18-15:2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except* 24-2,14-12:2x6 SPF No.2, 23-2,15-12:2x4 SPF 2100F 1.8E, 25-27,26-16:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-4-1 oc bracing.
WEBS 1 Row at midpt 8-19, 6-19, 4-21, 10-17

REACTIONS
(size) 14=0-3-8, 24=0-3-8
Max Horiz 24=-139 (LC 9)
Max Uplift 14=-265 (LC 9), 24=-265 (LC 8)
Max Grav 14=1947 (LC 1), 24=1947 (LC 1)

FORCES
(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/30, 2-3=-6030/882, 3-4=-4887/664, 4-6=-3682/466, 6-7=-2676/338, 7-8=-2676/356, 8-10=-3682/437, 10-11=-4887/598, 11-12=-6030/725, 12-13=0/30, 2-24=-2001/345, 12-14=-2001/300
BOT CHORD 23-24=-227/503, 22-23=-892/5399, 21-22=-672/4518, 19-21=-383/3317, 17-19=-217/3317, 16-17=-471/4518, 15-16=-616/5399, 14-15=-79/503
WEBS 7-19=-126/1520, 8-19=-1170/304, 11-15=-54/716, 6-19=-1170/316, 3-23=-116/716, 2-23=-696/5022, 12-15=-554/5022, 4-22=0/431, 3-22=-920/230, 4-21=-1258/303, 6-21=-1/556, 8-17=0/556, 10-17=-1258/266, 10-16=0/431, 11-16=-920/152

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- All plates are 3x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Bearing at joint(s) 24, 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 265 lb uplift at joint 24 and 265 lb uplift at joint 14.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job Avalon -	Truss B2	Truss Type Roof Special	Qty 4	Ply 1	Avalon - Contemporary Job Reference (optional)	I66389194
-----------------	-------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:51
ID:s8F8B0EM9ozMz?NbEEctVxzX477-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC7f

Page: 1

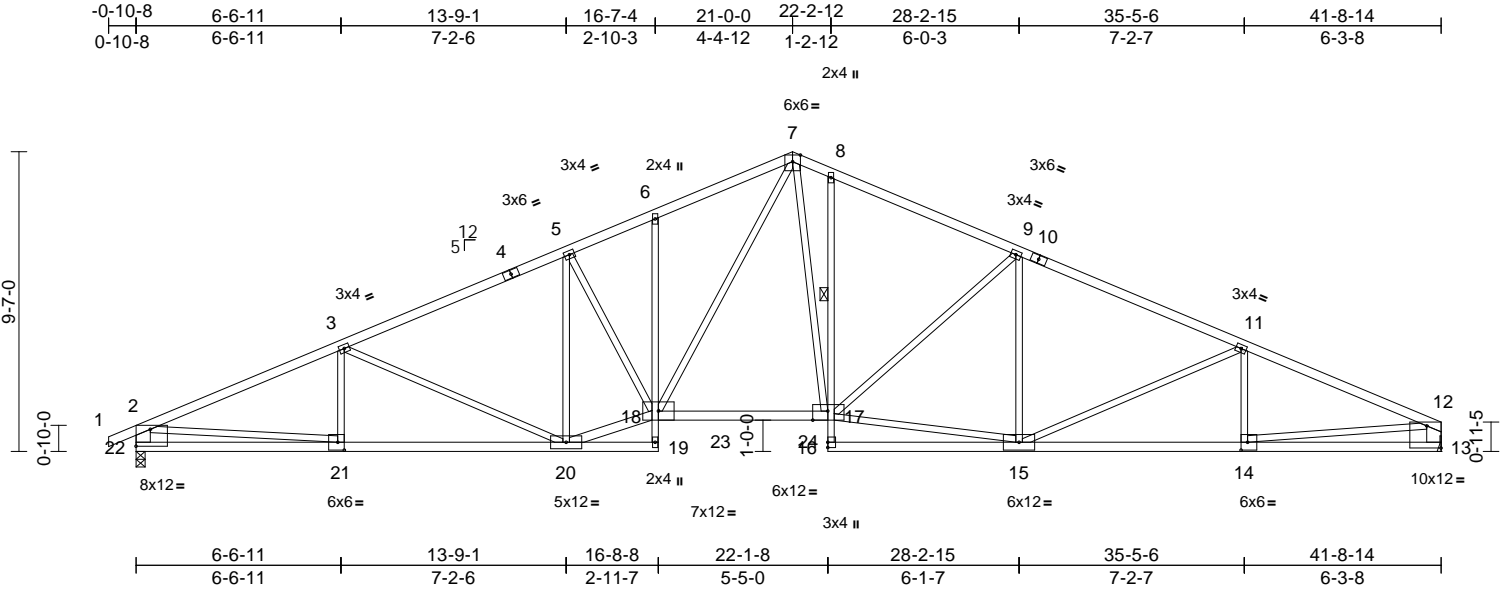

Scale = 1:73.7
Plate Offsets (X, Y): [13:Edge,0-8-8], [14:0-2-8,0-3-0], [17:0-5-12,Edge], [21:0-2-8,0-3-0], [22:Edge,0-6-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.36	17-18	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.98	Vert(CT)	-0.63	17-18	>788	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.97	Horz(CT)	0.17	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.14	17-18	>999	240	Weight: 184 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x3 SPF No.2 *Except* 22-19:2x4 SPF 2100F 1.8E, 18-17,16-13:2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 22-2,13-12:2x6 SPF No.2, 18-20:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
6-0-0 oc bracing: 19-20
2-2-0 oc bracing: 14-15.

1 Row at midpt 8-17

REACTIONS (size) 13= Mechanical, 22=0-3-8
Max Horiz 22=87 (LC 8)
Max Uplift 13=26 (LC 9), 22=-39 (LC 8)
Max Grav 13=1929 (LC 2), 22=1995 (LC 2)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/30, 2-3=-3598/58, 3-5=-3189/65, 5-6=-3289/82, 6-7=-3268/125, 7-8=-2807/96, 8-9=-2875/63, 9-11=-3162/63, 11-12=-3480/56, 2-22=-1874/71, 12-13=-1818/56
BOT CHORD 21-22=-127/652, 20-21=-86/3251, 19-20=-42/31, 18-19=0/8, 6-18=-166/59, 17-18=0/2427, 16-17=0/103, 8-17=-260/91, 15-16=-1/88, 14-15=-12/3153, 13-14=-19/367
WEBS 5-18=0/294, 7-18=-103/1195, 7-17=-91/1106, 9-17=-475/112, 2-21=0/2618, 12-14=0/2806, 3-21=-135/104, 3-20=-479/87, 5-20=-654/33, 18-20=0/3049, 9-15=-160/83, 11-15=-411/86, 15-17=0/2812, 11-14=-208/84

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SPF No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 39 lb uplift at joint 22 and 26 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389195
Avalon -	B3	Hip	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:51
 ID:1FPIUnMFZBMonijiN1vSSFzX46y-RfC?PsB70Hq3NSgPqL8w3uTXbGKwRcDoi7J4zJC?f

Page: 1

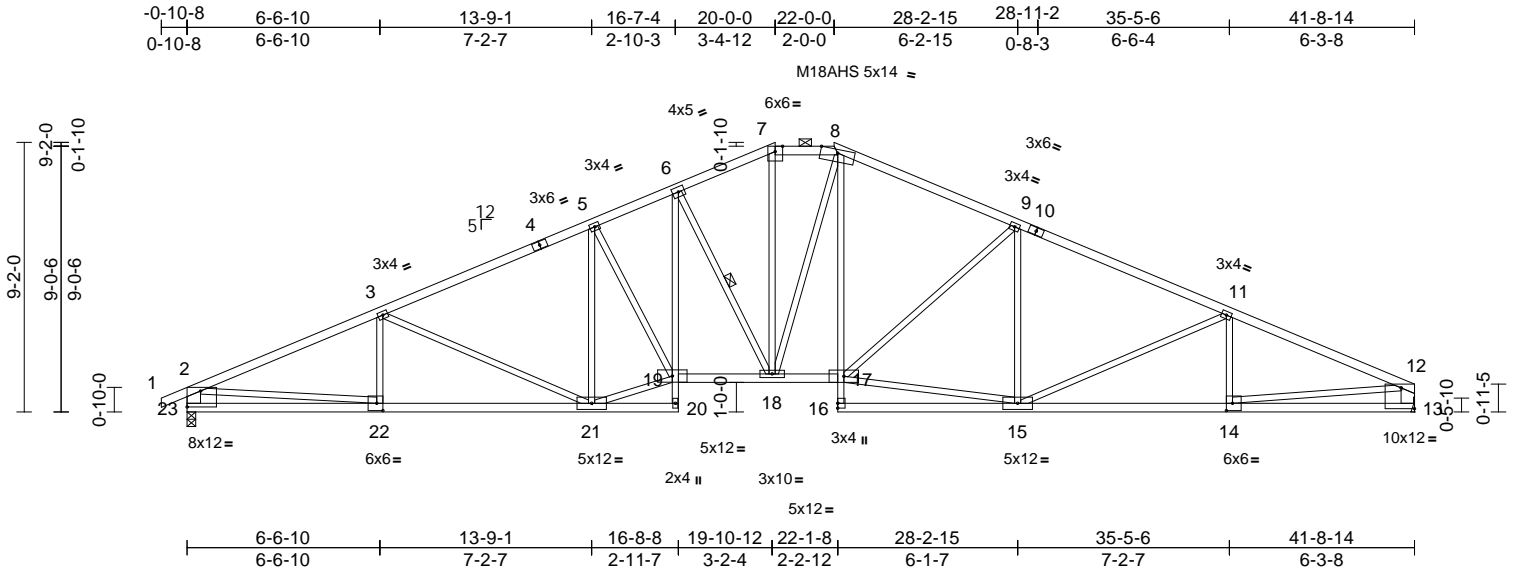

Scale = 1:78.4

Plate Offsets (X, Y): [13:Edge,0-8-8], [14:0-2-8,0-3-0], [22:0-2-8,0-3-0], [23:Edge,0-6-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.86	Vert(LL)	-0.29	18-19	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.88	Vert(CT)	-0.52	18-19	>958	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.96	Horz(CT)	0.18	13	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.14	19	>999	240	Weight: 188 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 20-6,8-16:2x3 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 23-2,13-12:2x6 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-7-7 max.): 7-8.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 6-18

REACTIONS (size) 13= Mechanical, 23=0-3-8
 Max Horiz 23=82 (LC 8)
 Max Uplift 13=21 (LC 9), 23=34 (LC 8)
 Max Grav 13=1857 (LC 1), 23=1936 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/30, 2-3=-3473/50, 3-5=-3070/55, 5-6=-3136/72, 6-7=-2696/59, 7-8=-2467/67, 8-9=-2745/49, 9-11=-3051/53, 11-12=-3359/46, 2-23=-1862/67, 12-13=-1785/52
 BOT CHORD 22-23=-120/600, 21-22=-73/3123, 20-21=-8/110, 19-20=0/14, 6-19=-53/770, 18-19=0/2831, 17-18=0/2439, 16-17=0/104, 8-17=-31/646, 15-16=0/179, 14-15=-3/3030, 13-14=-19/356
 WEBS 5-19=-1/288, 9-17=-484/116, 2-22=0/2536, 12-14=0/2694, 6-18=-789/89, 8-18=-165/338, 9-15=-135/106, 11-15=-401/85, 15-17=0/2583, 11-14=-208/83, 3-22=-131/107, 3-21=-477/88, 5-21=-629/32, 19-21=0/2792, 7-18=-4/795

- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) All bearings are assumed to be SPF No.2 .
- 8) Refer to girder(s) for truss to truss connections.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 23 and 21 lb uplift at joint 13.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

NOTES
 1) Unbalanced roof live loads have been considered for this design.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MIH-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:52

Job Avalon -	Truss B4	Truss Type Hip	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389196
-----------------	-------------	-------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:51
ID:dgk9sIKNGG_DwE_7ivMlqdzX47?-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC7f

Page: 1

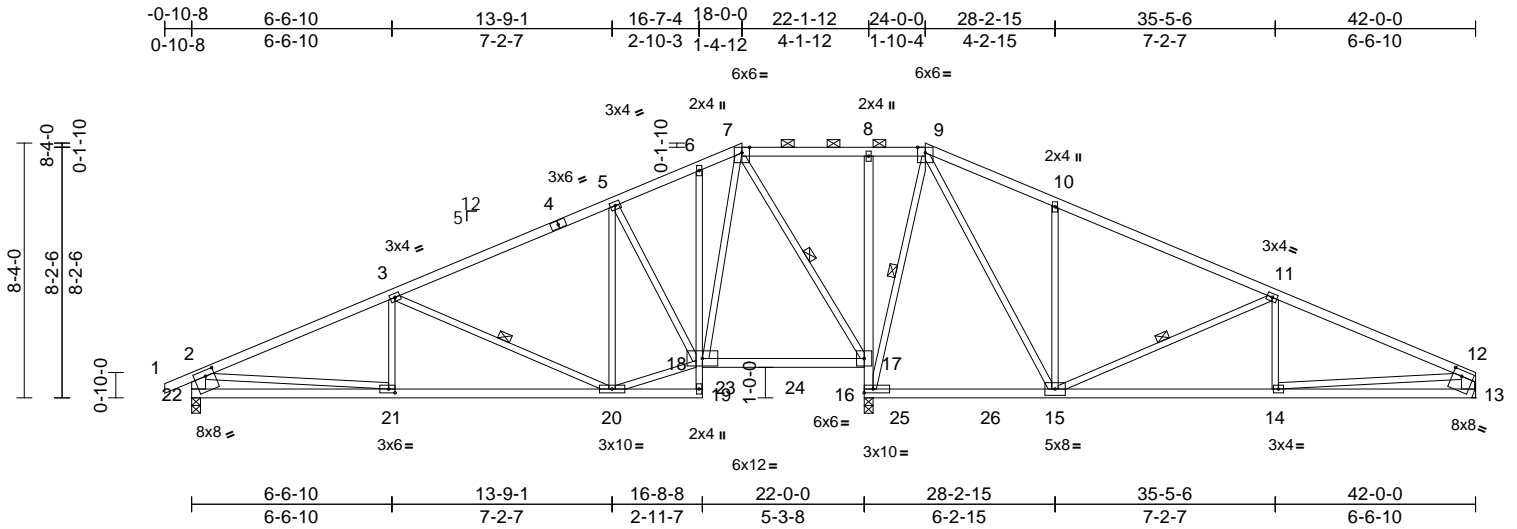

Scale = 1:75.4

Plate Offsets (X, Y): [13:0-3-8,0-2-4], [21:0-2-8,0-1-8], [22:0-3-8,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.10	20-21	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.57	Vert(CT)	-0.19	20-21	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.61	Horz(CT)	-0.04	16	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.04	20-21	>999	240		Weight: 186 lb FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except* 19-6:2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except* 22-2,13-12:2x6 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-4-5 oc purlins, except end verticals, and 2-0-0 oc purlins (10-0-0 max.): 7-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
6-0-0 oc bracing: 19-20,15-16.
WEBS 1 Row at midpt 9-16, 7-17, 11-15, 3-20

REACTIONS (size)
13= Mechanical, 16=0-3-8, 22=0-3-8
Max Horiz 22=72 (LC 10)
Max Uplift 13=69 (LC 9), 22=61 (LC 8)
Max Grav 13=827 (LC 22), 16=2192 (LC 2), 22=1004 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/30, 2-3=-1535/104, 3-5=-868/117, 5-6=-561/140, 6-7=-472/142, 7-8=0/314, 8-9=0/298, 2-22=-932/93, 12-13=-744/101, 9-10=-595/231, 10-11=-621/163, 11-12=-1306/148
BOT CHORD 21-22=-118/412, 20-21=-114/1353, 19-20=-55/4, 18-19=0/7, 6-18=-12/80, 17-18=0/296, 16-17=-1253/17, 8-17=-297/66, 15-16=-96/32, 14-15=-93/1148, 13-14=-29/304
WEBS 5-18=-585/80, 9-16=-858/16, 2-21=0/961, 12-14=-64/848, 7-18=-34/812, 7-17=-1015/28, 10-15=-440/131, 11-15=-723/80, 11-14=0/229, 9-15=-91/1073, 3-21=0/228, 3-20=-690/80, 5-20=0/266, 18-20=-20/805

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SPF No.2.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 61 lb uplift at joint 22 and 69 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)


MiTek
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DESIGNER'S SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389198
Avalon -	B6	Hip	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:52
 ID:hChPR4l6kekWhwrkaUJHICzX471-RfC?PsB70Hq3NSgPqnlL8w3uITXbGKWrCdoi7J4zJC7f

Page: 1

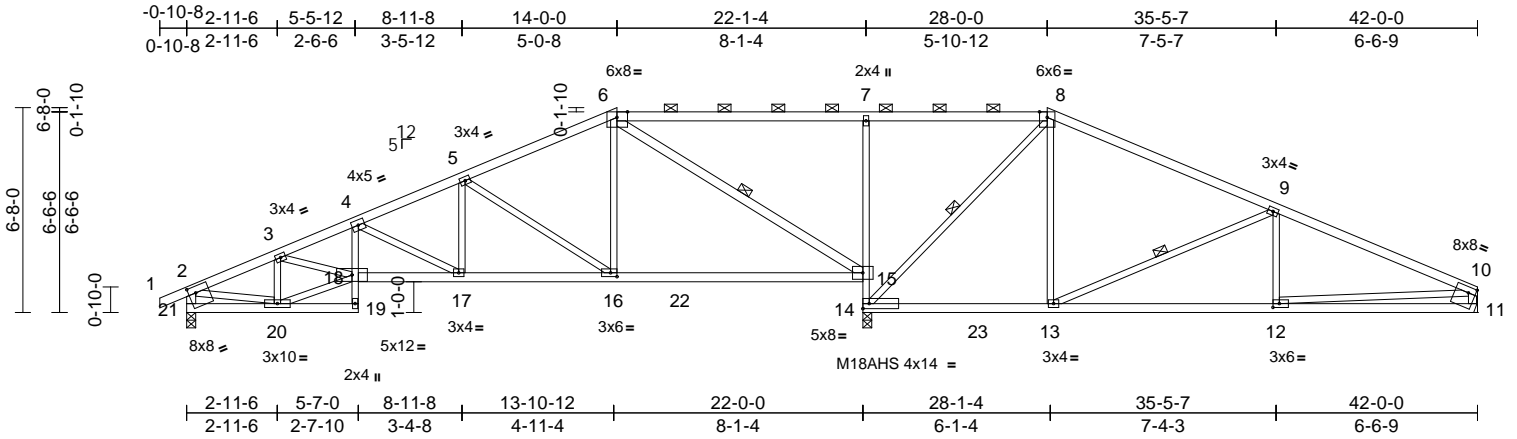

Scale = 1:75

Plate Offsets (X, Y): [6:0-4-2,Edge], [10:0-2-12,0-2-4], [12:0-2-8,0-1-8], [16:0-2-8,0-1-8], [21:0-2-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.14	15-16	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.26	15-16	>995	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.70	Horz(CT)	0.03	11	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.05	17-18	>999	240		Weight: 165 lb FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 19-4,7-14:2x3 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 15-6,21-2,11-10:2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 3-9-15 oc purlins, except end verticals, and 2-0-0 oc purlins (9-10-3 max.): 6-8.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
 WEBS 1 Row at midpt 6-15, 8-14, 9-13

REACTIONS (size) 11= Mechanical, 14=0-3-8, 21=0-3-8
 Max Horiz 21=56 (LC 8)
 Max Uplift 11=58 (LC 9), 21=50 (LC 8)
 Max Grav 11=849 (LC 22), 14=2138 (LC 2), 21=1015 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=0/27, 2-3=-1444/69, 3-4=-2238/135, 4-5=-1654/118, 5-6=-1009/89, 6-7=0/269, 7-8=0/268, 8-9=-642/132, 9-10=-1374/129, 2-21=-946/64, 10-11=-763/90
 BOT CHORD 20-21=-62/205, 19-20=-8/81, 18-19=0/61, 4-18=0/364, 17-18=-120/2066, 16-17=-72/1507, 15-16=0/874, 14-15=-1324/65, 7-15=-579/135, 13-14=0/501, 12-13=-76/1213, 11-12=-24/306
 WEBS 5-16=-742/100, 6-16=0/702, 6-15=-1295/0, 8-14=-1018/0, 8-13=0/617, 9-13=-771/97, 9-12=0/235, 10-12=-53/911, 5-17=0/418, 4-17=-630/55, 3-20=-676/79, 3-18=-31/786, 18-20=-90/1304, 2-20=-31/1133

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SPF No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 21 and 58 lb uplift at joint 11.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:52

Job Avalon -	Truss B7	Truss Type Hip	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389199
-----------------	-------------	-------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:52
ID:D520EkHuzLcf3mGY0no2C_zX472-RfC?PsB70Hq3NSgPqnL8w3ulTXhGKWrCDoi7J4zJC?f

Page: 1

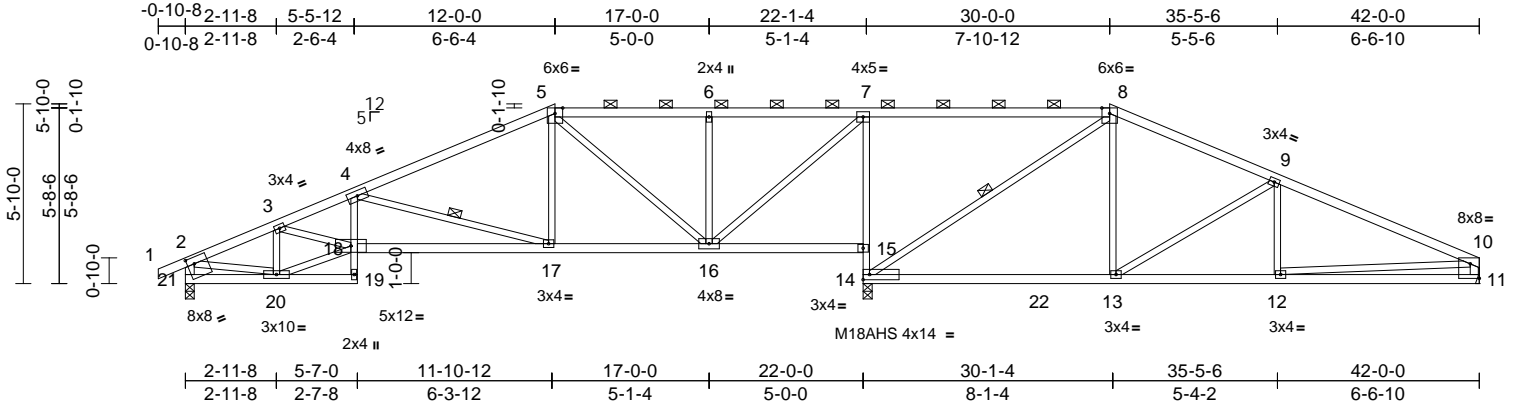

Scale = 1:74.8

Plate Offsets (X, Y): [10:Edge,0-5-11], [21:0-2-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.82	Vert(LL)	-0.15	13-14	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.83	Vert(CT)	-0.29	13-14	>804	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	YES	WB	0.92	Horz(CT)	0.03	11	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.05	17-18	>999	240		Weight: 160 lb FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2 *Except* 19-4,7-14:2x3 SPF No.2

WEBS 2x3 SPF No.2 *Except* 21-2,11-10:2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-7-5 oc purlins, except end verticals, and 2-0-0 oc purlins (5-10-6 max.): 5-8.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 15-16.

WEBS 1 Row at midpt 4-17, 8-14

REACTIONS (size)

11= Mechanical, 14=0-3-8, 21=0-3-8

Max Horiz 21=47 (LC 8)

Max Uplift 11=36 (LC 9), 14=-43 (LC 5), 21=33 (LC 8)

Max Grav 11=882 (LC 22), 14=2053 (LC 2), 21=1031 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/27, 2-3=-1460/32, 3-4=-2347/88, 4-5=-1348/42, 5-6=-759/73, 6-7=-757/71, 7-8=0/165, 8-9=-914/81, 9-10=-1395/81, 2-21=-960/47, 10-11=-770/73

BOT CHORD 20-21=-57/217, 19-20=-22/80, 18-19=0/59, 4-18=0/387, 17-18=-85/2227, 16-17=0/1167, 15-16=-178/34, 14-15=-1349/98, 7-15=-1284/125, 13-14=0/778, 12-13=-30/1226, 11-12=-24/372

WEBS 4-17=-1088/128, 5-17=0/529, 5-16=-556/27, 7-16=-2/1182, 8-14=-1076/0, 8-13=0/578, 9-13=-524/86, 9-12=0/164, 10-12=-6/858, 3-20=-672/48, 3-18=-31/903, 18-20=-29/1332, 2-20=0/1124, 6-16=-326/75

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- All bearings are assumed to be SPF No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 21, 43 lb uplift at joint 14 and 36 lb uplift at joint 11.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

NOTES



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job Avalon -	Truss B8	Truss Type Hip	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389200
-----------------	-------------	-------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:52
ID:lvUe0U0HsC1UoRdhMT3HpgnzX473-RfC?PsB70Hq3NSgPqnL8w3uiTXbGKwRCDoi7J4zJC?f

Page: 1

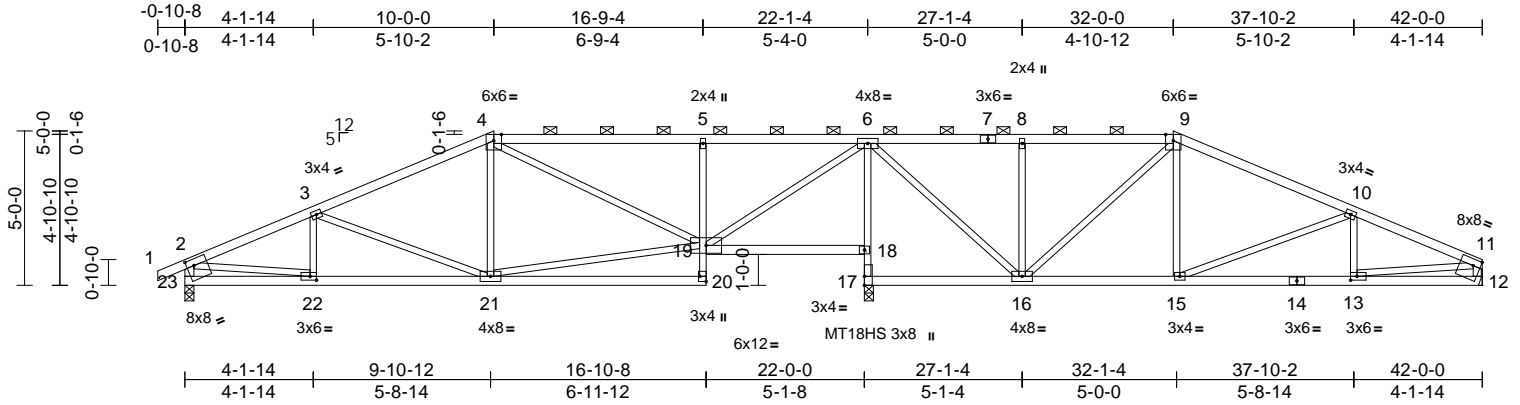

Scale = 1:74.6

Plate Offsets (X, Y): [11:Edge,0-2-8], [13:0-2-8,0-1-8], [20:Edge,0-2-8], [22:0-2-8,0-1-8], [23:0-2-12,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.56	Vert(LL)	-0.08	20-21	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.72	Vert(CT)	-0.17	20-21	>999	240	MT18HS	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.48	Horz(CT)	-0.02	17	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.03	21-22	>999	240	Weight: 163 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except* 20-5,6-17:2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except* 23-2,12-11:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-4-3 oc purlins, except end verticals, and 2-0-0 oc purlins (4-9-13 max.): 4-9.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 18-19,16-17.

REACTIONS (size) 12= Mechanical, 17=0-3-8, 23=0-3-8
Max Horiz 23=39 (LC 8)
Max Uplift 12=-28 (LC 9), 17=-49 (LC 5), 23=-28 (LC 8)
Max Grav 12=850 (LC 20), 17=1958 (LC 1), 23=1026 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/27, 2-3=-1593/43, 3-4=-1296/61, 4-5=-1008/113, 5-6=-1002/107, 6-8=-638/91, 8-9=-640/92, 9-10=-1055/64, 10-11=-1420/61, 2-23=-975/47, 11-12=-804/45
BOT CHORD 22-23=-36/197, 21-22=-45/1425, 20-21=0/80, 19-20=0/123, 5-19=-471/110, 18-19=-168/10, 17-18=-1922/75, 6-18=-1846/106, 16-17=-154/7, 15-16=0/895, 13-15=-34/1272, 12-13=-7/162
WEBS 3-21=-321/85, 4-21=0/257, 19-21=0/1057, 4-19=-147/25, 6-19=-38/1389, 9-15=0/313, 2-22=-10/1241, 11-13=-27/1122, 6-16=-9/1053, 8-16=-366/86, 9-16=-362/4, 10-15=-401/73, 10-13=-78/94, 3-22=-107/60

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 23, 49 lb uplift at joint 17 and 28 lb uplift at joint 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job Avalon -	Truss C1	Truss Type Half Hip	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389201
-----------------	-------------	------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:52
ID:w0foK9PmdPsEGJ1Tct_Oc5zX46u-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

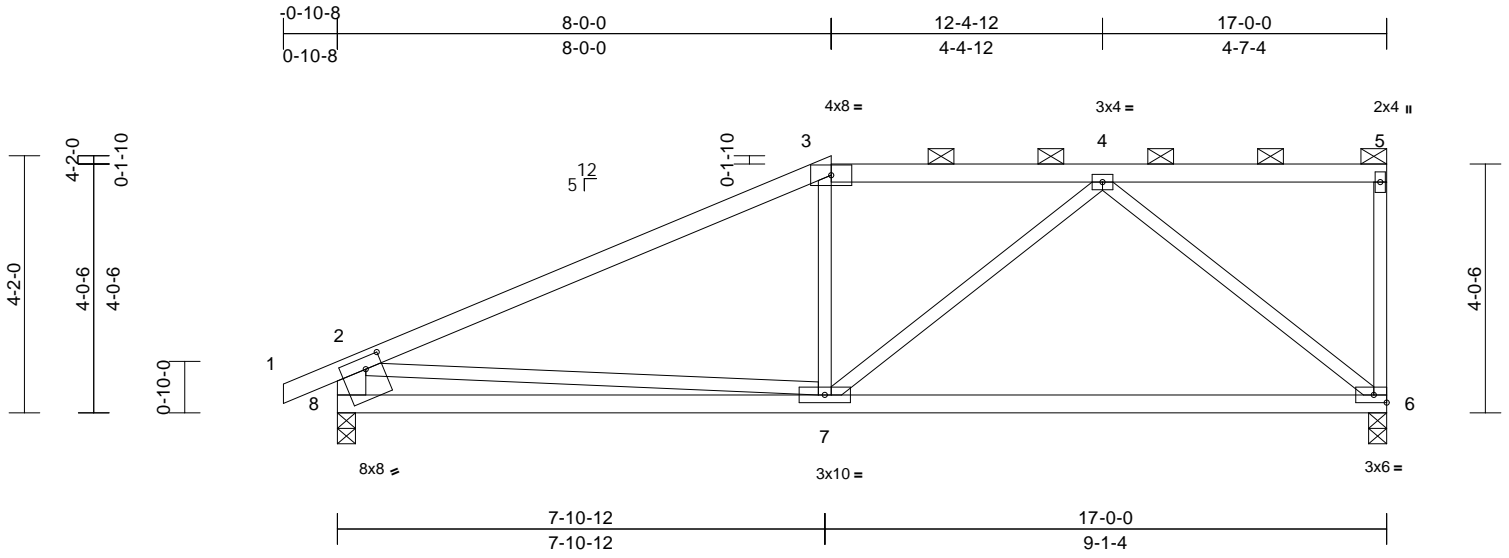

Scale = 1:37.3
Plate Offsets (X, Y): [8:0-3-4,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.79	Vert(LL)	-0.18	6-7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.65	Vert(CT)	-0.36	6-7	>550	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.71	Horz(CT)	0.02	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.02	7-8	>999	240	Weight: 62 lb	FT = 10%


LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 8-2:2x6 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-1-9 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS
(size) 6=0-3-8, 8=0-3-8
Max Horiz 8=169 (LC 7)
Max Uplift 6=-133 (LC 5), 8=-116 (LC 8)
Max Grav 6=747 (LC 1), 8=830 (LC 1)

FORCES
(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/30, 2-3=-1078/120, 3-4=-892/139,
4-5=-65/37, 5-6=-136/57, 2-8=-768/155
BOT CHORD 7-8=-311/685, 6-7=-180/661
WEBS 3-7=-13/161, 4-7=-27/319, 4-6=-835/199,
2-7=0/393

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 133 lb uplift at joint 6 and 116 lb uplift at joint 8.
 - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard

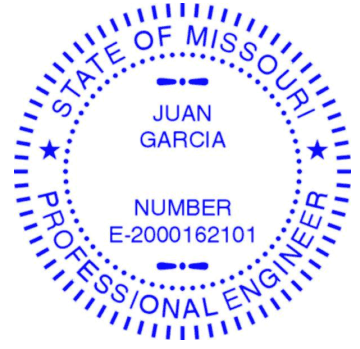

June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DESIGNER'S SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job Avalon -	Truss C2	Truss Type Half Hip	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389202
-----------------	-------------	------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:52
ID:w0foK9PmdPsEGJ1Tct_Oc5zX46u-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

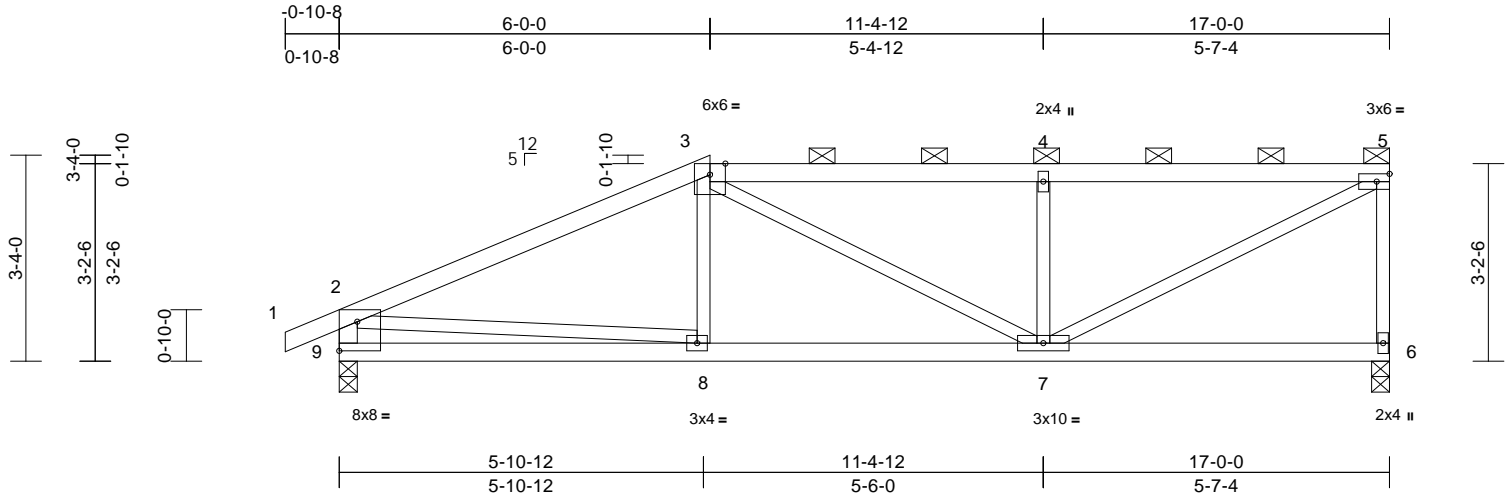


Scale = 1:37.3
Plate Offsets (X, Y): [9:Edge,0-5-11]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.43	Vert(LL)	-0.04	7-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.32	Vert(CT)	-0.08	7-8	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.39	Horz(CT)	0.01	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.03	7-8	>999	240	Weight: 62 lb	FT = 10%

- LUMBER**
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 9-2:2x4 SPF No.2
- BRACING**
TOP CHORD Structural wood sheathing directly applied or 4-11-2 oc purlins, except end verticals, and 2-0-0 oc purlins (5-3-1 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- REACTIONS**
(size) 6=0-3-8, 9=0-3-8
Max Horiz 9=132 (LC 5)
Max Uplift 6=-137 (LC 5), 9=-116 (LC 4)
Max Grav 6=752 (LC 1), 9=827 (LC 1)
- FORCES**
(lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/27, 2-3=-1171/163, 3-4=-1043/209, 4-5=-1040/207, 5-6=-700/163, 2-9=-770/147
BOT CHORD 8-9=-174/414, 7-8=-193/1003, 6-7=-38/29
WEBS 5-7=-211/1149, 2-8=-34/628, 3-8=0/185, 3-7=-40/163, 4-7=-456/185

- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 137 lb uplift at joint 6 and 116 lb uplift at joint 9.
8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard

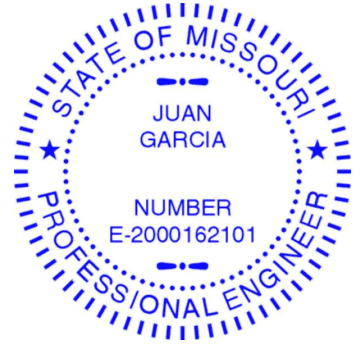

June 21, 2024

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - All bearings are assumed to be SPF No.2 .

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DESIGNER'S SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job Avalon -	Truss C3	Truss Type Roof Special Girder	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389203
-----------------	-------------	-----------------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:53
ID:w0foK9PmdPsEGJ1Tct_Oc5zX46u-RfC?PsB70Hq3NSgPqnL8w3ulTx6GKWrCDoi7J4zJC?f

Page: 1

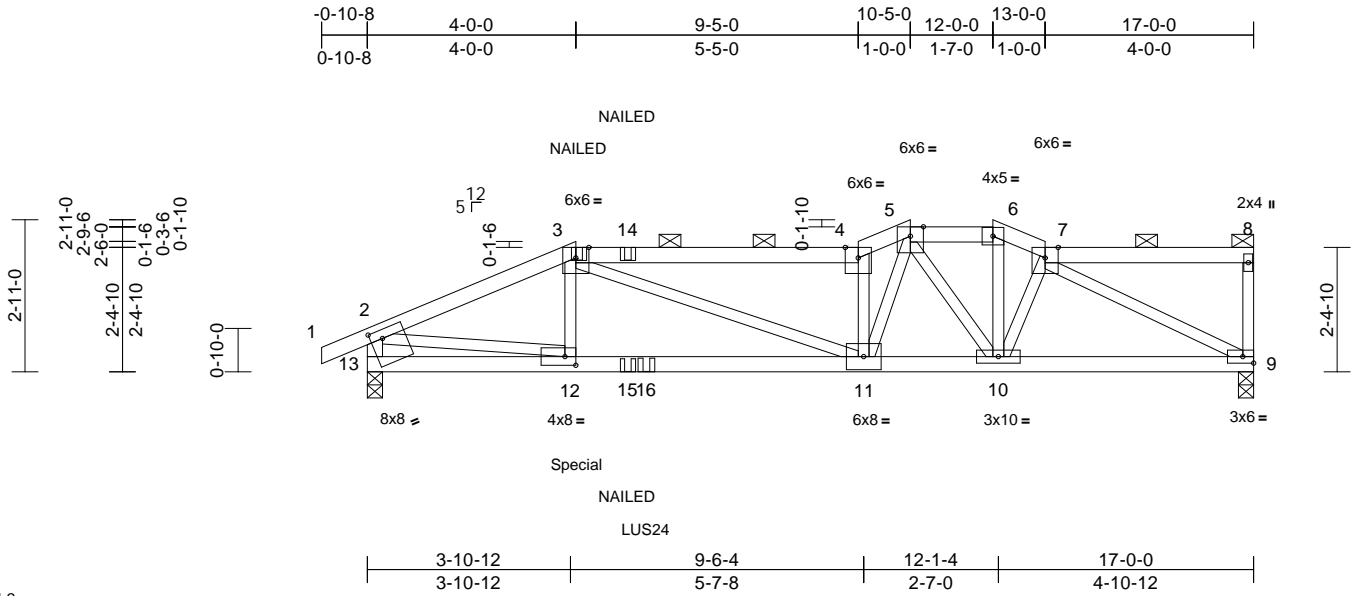

Scale = 1:44.2

Plate Offsets (X, Y): [12:0-2-8.0-2-0], [13:0-2-12.0-2-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	-0.14	11-12	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.75	Vert(CT)	-0.26	11-12	>784	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.81	Horz(CT)	0.03	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.12	11-12	>999	240	Weight: 65 lb	FT = 10%

LUMBER	TOP CHORD	2x4 SPF No.2
	BOT CHORD	2x4 SPF 2100F 1.8E
	WEBS	2x3 SPF No.2 *Except* 13-2:2x4 SPF No.2
BRACING	TOP CHORD	Structural wood sheathing directly applied or 3-7-4 oc purlins, except end verticals, and 2-0-0 oc purlins (2-9-14 max.): 3-4, 5-6, 7-8.
	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS	(size)	9=0-3-8, 13=0-3-8
	Max Horiz	13=96 (LC 5)
	Max Uplift	9=-163 (LC 5), 13=-315 (LC 8)
	Max Grav	9=960 (LC 1), 13=1369 (LC 1)
FORCES	(lb) - Maximum Compression/Maximum Tension	
	TOP CHORD	1-2=0/27, 2-3=-2355/544, 3-4=-2273/470, 4-5=-2424/513, 5-6=-1405/264, 6-7=-1554/284, 7-8=-44/24, 8-9=-140/54, 2-13=-1381/343
	BOT CHORD	12-13=-121/225, 11-12=-490/2112, 10-11=-308/1737, 9-10=-260/1421
	WEBS	3-12=-44/446, 3-11=-264/220, 4-11=-1186/319, 6-10=-84/499, 7-10=-27/137, 7-9=-1587/272, 2-12=-426/1930, 5-11=-361/1443, 5-10=-642/172

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 163 lb uplift at joint 9 and 315 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent at 5-4-4 from the left end to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 219 lb down and 55 lb up at 4-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- LOAD CASE(S)** Standard
- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 5-6=-70, 6-7=-70, 7-8=-70, 9-13=-20
Concentrated Loads (lb)
Vert: 3=-47 (F), 12=-219 (F), 14=-47 (F), 15=-24 (F), 16=-413 (F)



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Lee's Summit, MO 64080
816-424-0200 / MiTek.com
01/29/2026 3:02:52

Job Avalon -	Truss C4	Truss Type Hip Girder	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389204
-----------------	-------------	--------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:53
ID:etku_8VdNB5RrhWZ3V8aOz4MmY-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

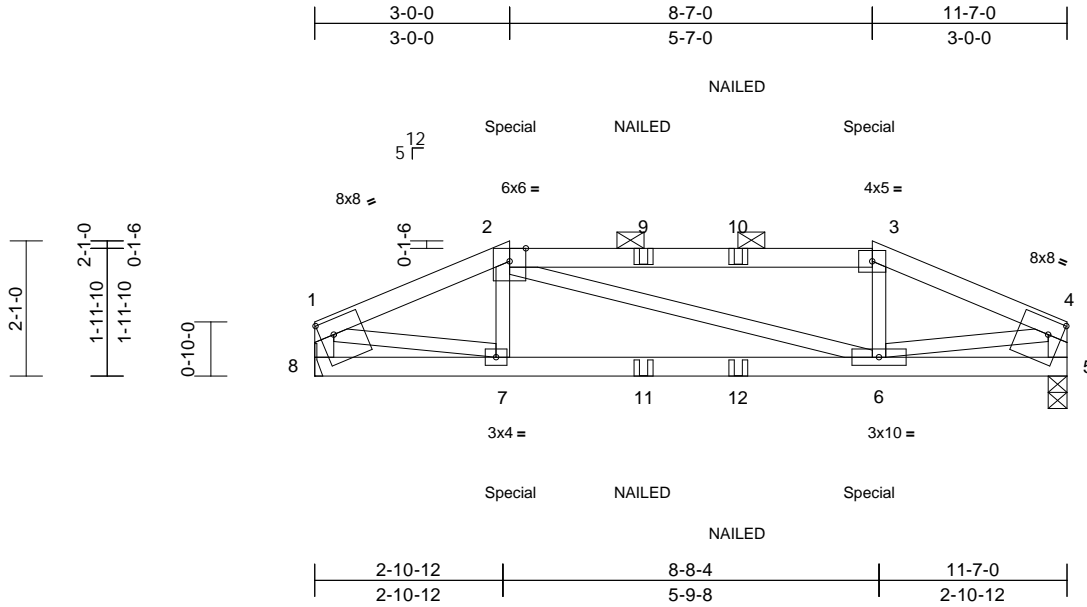

Scale = 1:35.5
Plate Offsets (X, Y): [1:0-2-8,0-2-12], [4:0-2-8,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.60	Vert(LL)	-0.04	6-7	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.35	Vert(CT)	-0.08	6-7	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.25	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.02	6-7	>999	240	Weight: 39 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 8-1,5-4:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (5-4-12 max.): 2-3.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 5=0-3-8, 8= Mechanical
Max Horiz 8=-20 (LC 4)
Max Uplift 5=-146 (LC 9), 8=-146 (LC 8)
Max Grav 5=553 (LC 1), 8=553 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-863/244, 2-3=-778/248, 3-4=-863/243, 1-8=-536/147, 4-5=-536/147
BOT CHORD 7-8=-35/72, 6-7=-225/778, 5-6=-36/72
WEBS 2-7=-36/119, 2-6=-28/28, 3-6=-43/119, 1-7=-196/721, 4-6=-196/721

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
3) Provide adequate drainage to prevent water ponding.
4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
6) All bearings are assumed to be SPF No.2 .

- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 146 lb uplift at joint 8 and 146 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 82 lb down and 139 lb up at 3-0-0, and 82 lb down and 139 lb up at 8-7-0 on top chord, and 30 lb down at 3-0-0, and 30 lb down at 8-6-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 3-4=-70, 5-8=-20
Concentrated Loads (lb)
Vert: 2=-13 (F), 3=-13 (F), 7=-10 (F), 6=-10 (F), 9=-13 (F), 10=-13 (F), 11=-10 (F), 12=-10 (F)



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Lee's Summit, MO 64063
816-424-0200 / MiTek-USA.com
01/29/2026 3:02:52

Job Avalon -	Truss D1	Truss Type Roof Special	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389205
-----------------	-------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:53
ID:RQRL1CjSF16FGTBPWB1Xn?zX4oO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRcDoi7J4zJC?f

Page: 1

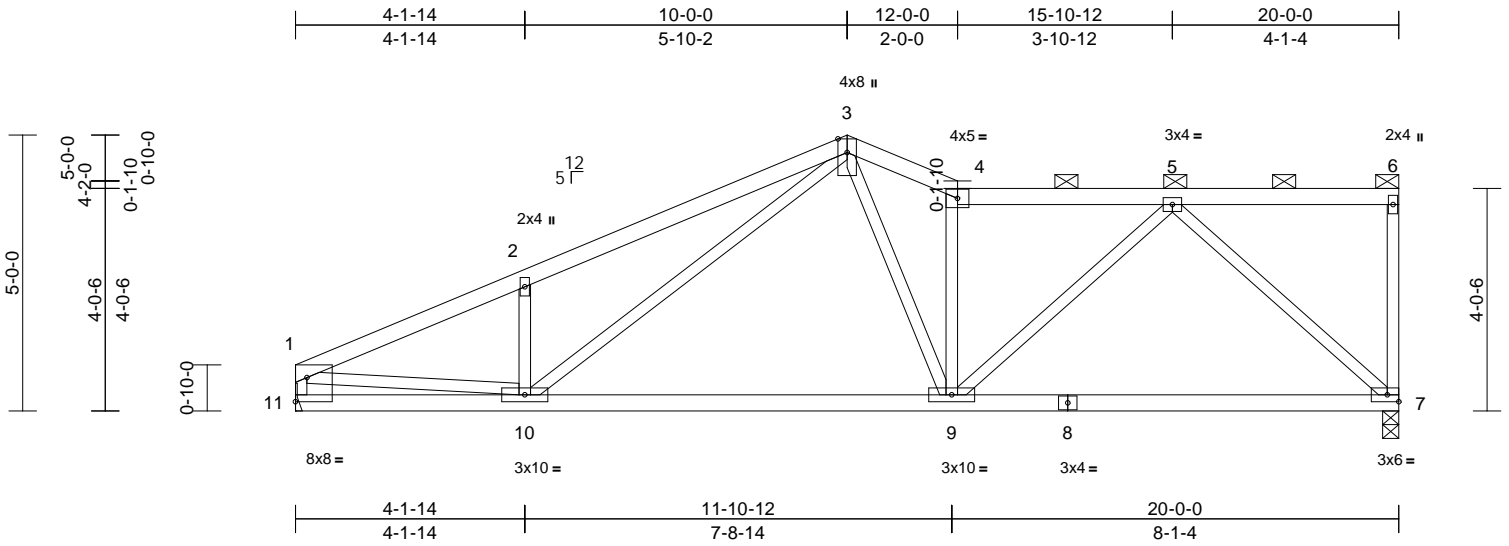

Scale = 1:41.8

Plate Offsets (X, Y): [11:Edge,0-5-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.50	Vert(LL)	-0.11	7-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.57	Vert(CT)	-0.23	7-9	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.78	Horz(CT)	-0.02	11	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.04	9-10	>999	240	Weight: 76 lb	FT = 10%

- LUMBER**
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2
- BRACING**
TOP CHORD Structural wood sheathing directly applied or 3-10-4 oc purlins, except end verticals, and 2-0-0 oc purlins (5-3-6 max.): 4-6.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
- REACTIONS**
(size) 7=0-3-8, 11= Mechanical
Max Horiz 7=157 (LC 5)
Max Uplift 7=-134 (LC 5), 11=-112 (LC 8)
Max Grav 7=891 (LC 1), 11=891 (LC 1)
- FORCES**
(lb) - Maximum Compression/Maximum Tension
TOP CHORD 6-7=-114/43, 4-5=-1157/122, 5-6=-62/37, 3-4=-1255/139, 1-2=-1517/185, 2-3=-1556/292, 1-11=-850/124
BOT CHORD 10-11=-31/154, 9-10=-14/960, 7-9=-40/772
WEBS 1-10=-114/1218, 5-7=-1039/192, 2-10=-390/208, 4-9=-617/116, 5-9=-21/524, 3-10=-179/569, 3-9=-22/523

- 6) All bearings are assumed to be SPF No.2 .
7) Refer to girder(s) for truss to truss connections.
8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 134 lb uplift at joint 7 and 112 lb uplift at joint 11.
9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job Avalon -	Truss D2	Truss Type Roof Special	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389206
-----------------	-------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:53
ID:KxbDhDibrnVqs2xSHhWw?brz4MLA-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

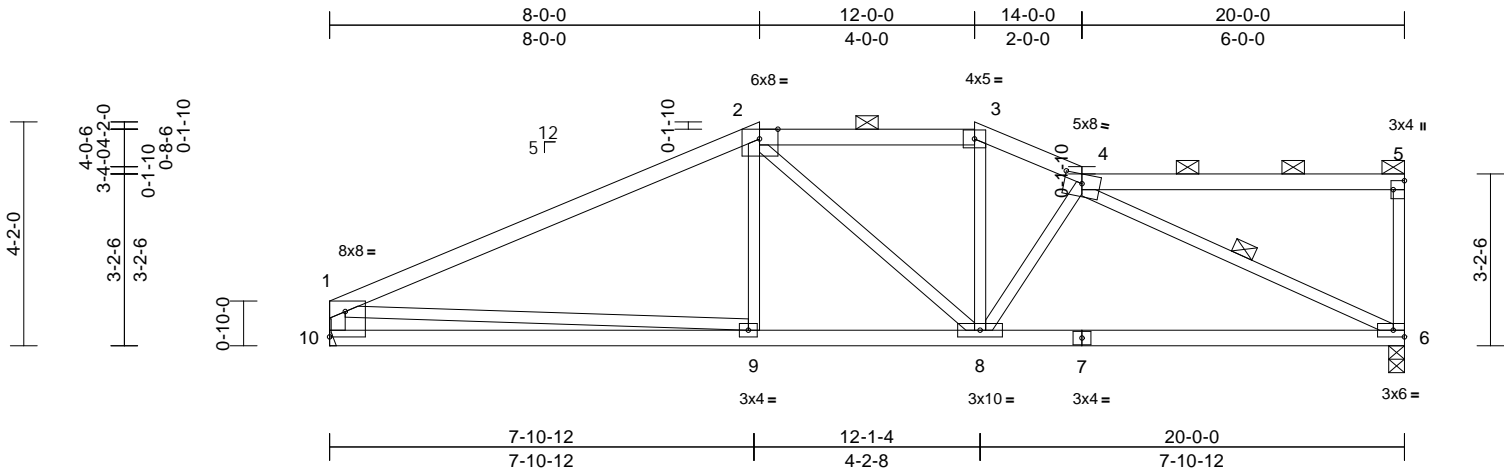

Scale = 1:42.9

Plate Offsets (X, Y): [1:Edge,0-5-11], [2:0-4-2,Edge], [4:0-4-0,0-2-2], [5:Edge,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.61	Vert(LL)	-0.13	6-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.58	Vert(CT)	-0.26	6-8	>899	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.59	Horz(CT)	-0.03	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.04	8-9	>999	240	Weight: 73 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2 *Except* 2-1:2x4 SPF 2100F 1.8E

BOT CHORD 2x4 SPF No.2

WEBS 2x3 SPF No.2 *Except* 10-1:2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-10-12 oc purlins, except end verticals, and 2-0-0 oc purlins (5-2-13 max.): 4-5, 2-3.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 4-6

REACTIONS (size) 6=0-3-8, 10= Mechanical
Max Horiz 6=121 (LC 7)
Max Uplift 6=-138 (LC 5), 10=-96 (LC 8)
Max Grav 6=889 (LC 1), 10=889 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 5-6=-202/80, 4-5=-60/29, 3-4=-1277/160, 2-3=-1130/148, 1-2=-1371/140, 1-10=-810/142

BOT CHORD 9-10=-133/544, 8-9=-68/1167, 6-8=-103/1257

WEBS 4-6=-1362/220, 4-8=-223/124, 3-8=-33/344, 2-8=-164/111, 2-9=0/202, 1-9=-14/635

- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) All bearings are assumed to be SPF No.2 .
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 138 lb uplift at joint 6 and 96 lb uplift at joint 10.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- LOAD CASE(S)** Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®


RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DESIGNER'S SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:52

Job Avalon -	Truss D3	Truss Type Roof Special	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389207
-----------------	-------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:53
ID:s0ZG2hud0PrayOgMdtDIEDz4MKw-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

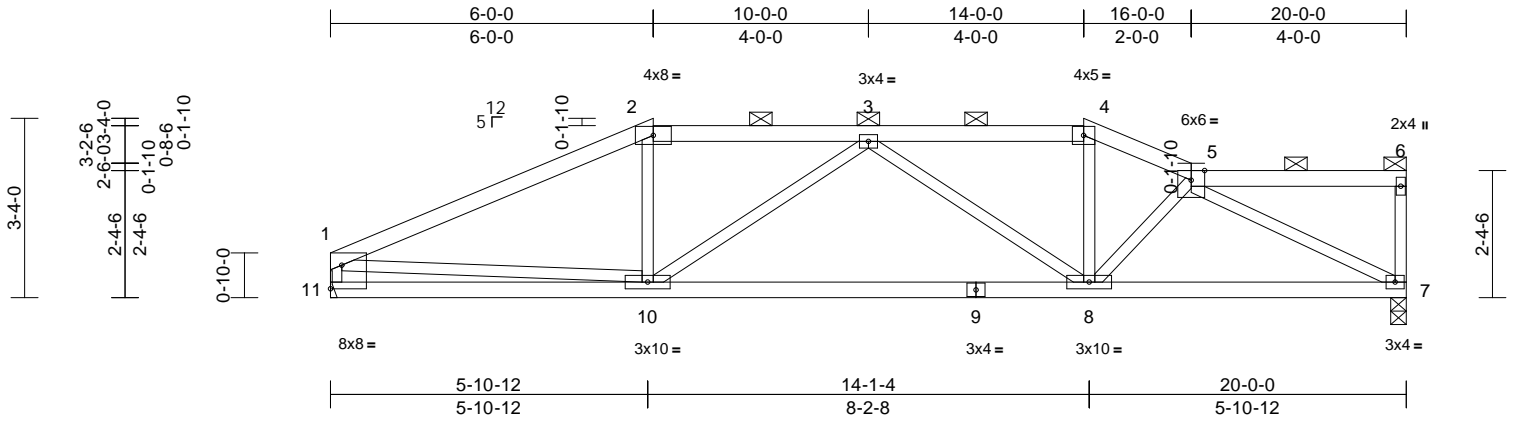

Scale = 1:42.8

Plate Offsets (X, Y): [11:Edge,0-5-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.56	Vert(LL)	-0.11	8-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.56	Vert(CT)	-0.24	8-10	>987	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.74	Horz(CT)	-0.04	11	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.05	8-10	>999	240	Weight: 71 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-8-13 oc purlins, except end verticals, and 2-0-0 oc purlins (5-0-0 max.): 5-6, 2-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 7=0-3-8, 11= Mechanical
Max Horiz 7=85 (LC 5)
Max Uplift 7=-141 (LC 5), 11=-95 (LC 4)
Max Grav 7=891 (LC 1), 11=891 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
TOP CHORD 6-7=-140/54, 5-6=-41/23, 4-5=-1421/191, 2-3=-1297/187, 3-4=-1279/183, 1-2=-1485/177, 1-11=-839/120
BOT CHORD 10-11=-87/316, 8-10=-209/1518, 7-8=-140/1314
WEBS 5-7=-1467/232, 5-8=-51/92, 4-8=-8/352, 2-10=0/285, 1-10=-68/990, 3-10=-378/113, 3-8=-367/123

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 6) All bearings are assumed to be SPF No.2 .
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 141 lb uplift at joint 7 and 95 lb uplift at joint 11.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swingley Ridge Rd
Missouri, MO 64080
816-424-0200 / MiTek-USA.com
01/29/2026 3:02:53

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389208
Avalon -	D4	Roof Special Girder	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:53
 ID:tH5hcV5H?e_AV?Ud7x0kQoz4MKf-RfC?PsB70Hq3NSgPqnL8w3ulTXhGKWrCDoi7J4zJC?f

Page: 1

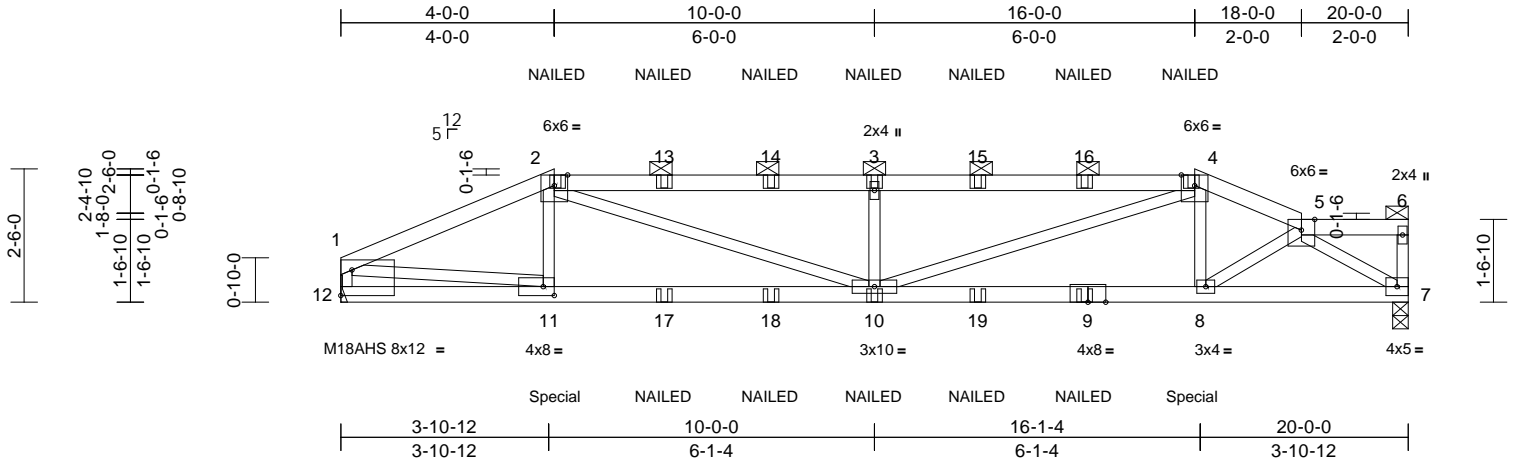

Scale = 1:43.2

Plate Offsets (X, Y): [11:0-2-8,0-2-0], [12:Edge,0-5-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.59	Vert(LL)	-0.16	10-11	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.75	Vert(CT)	-0.29	10-11	>816	240	M18AHS	142/136
BCLL	0.0*	Rep Stress Incr	NO	WB	0.67	Horz(CT)	-0.06	12	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.14	10-11	>999	240	Weight: 68 lb	FT = 10%

- LUMBER**
- TOP CHORD 2x4 SPF No.2 *Except* 4-2:2x4 SPF 2100F 1.8E
- BOT CHORD 2x4 SPF No.2
- WEBS 2x3 SPF No.2
- BRACING**
- TOP CHORD Structural wood sheathing directly applied or 3-7-10 oc purlins, except end verticals, and 2-0-0 oc purlins (3-8-2 max.): 5-6, 2-4.
- BOT CHORD Rigid ceiling directly applied or 8-6-13 oc bracing.
- REACTIONS** (size) 7=0-3-8, 12= Mechanical
 Max Horiz 7=49 (LC 26)
 Max Uplift 7=294 (LC 5), 12=272 (LC 4)
 Max Grav 7=1334 (LC 1), 12=1334 (LC 1)
- FORCES** (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 6-7=-99/34, 5-6=-37/19, 4-5=-2353/523, 2-3=-3407/797, 3-4=-3407/797, 1-2=-2376/519, 1-12=-1296/281
- BOT CHORD 11-12=-62/217, 10-11=-466/2156, 8-10=-463/2169, 7-8=-369/1778
- WEBS 5-7=-2129/478, 5-8=-109/545, 4-8=0/182, 4-10=-315/1355, 3-10=-691/326, 2-10=-317/1379, 2-11=0/172, 1-11=-416/1964

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 294 lb uplift at joint 7 and 272 lb uplift at joint 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 219 lb down and 55 lb up at 4-0-0, and 219 lb down and 55 lb up at 15-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

- LOAD CASE(S)** Standard
- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 5-6=-70, 4-5=-70, 2-4=-70, 1-2=-70, 7-12=-20
 Concentrated Loads (lb)
 Vert: 4=-47 (B), 2=-47 (B), 9=-24 (B), 8=-219 (B), 3=-47 (B), 10=-24 (B), 11=-219 (B), 13=-47 (B), 14=-47 (B), 15=-47 (B), 16=-47 (B), 17=-24 (B), 18=-24 (B), 19=-24 (B)



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:53

Job Avalon -	Truss E1	Truss Type Monopitch	Qty 3	Ply 1	Avalon - Contemporary Job Reference (optional)	I66389209
-----------------	-------------	-------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:54
ID:KKpWOME_w65Da9ynnk628zX476-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

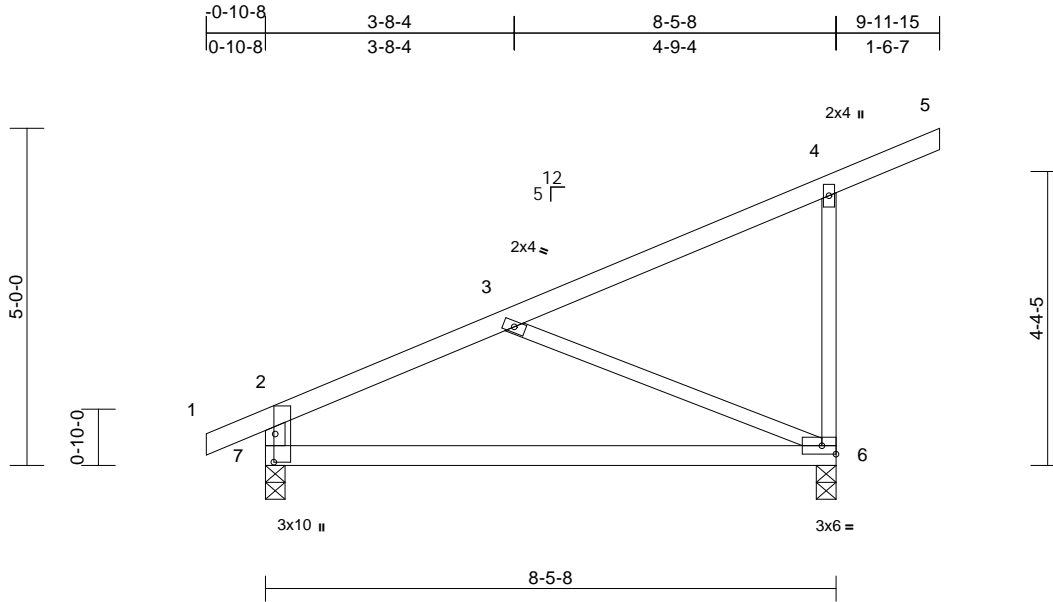

Scale = 1:34.2

Plate Offsets (X, Y): [7:0-5-0,0-0-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.32	Vert(LL)	-0.17	6-7	>569	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.56	Vert(CT)	-0.34	6-7	>291	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.23	Horz(CT)	0.00	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	-0.01	6-7	>999	240	Weight: 31 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 7-2:2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS (size) 6=0-3-8, 7=0-3-8

Max Horiz 7=209 (LC 5)
Max Uplift 6=-142 (LC 8), 7=-57 (LC 8)
Max Grav 6=491 (LC 1), 7=434 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/27, 2-3=-413/84, 3-4=-136/54,
4-5=-44/0, 4-6=-287/123, 2-7=-343/107
BOT CHORD 6-7=-131/334
WEBS 3-6=-346/178

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06"-00 tall by 2'-00"-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 142 lb uplift at joint 6 and 57 lb uplift at joint 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Lee's Summit, MO 64063
816-424-0200 / MiTek-USA.com
01/29/2026 3:02:53

Job Avalon -	Truss G1	Truss Type Hip Girder	Qty 1	Ply 2	Avalon - Contemporary Job Reference (optional)	166389210
-----------------	-------------	--------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:54
ID:ouuJAWSGgeNgkwKErj2KnxxX46q-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWRKDoi7J4zJC?f

Page: 1

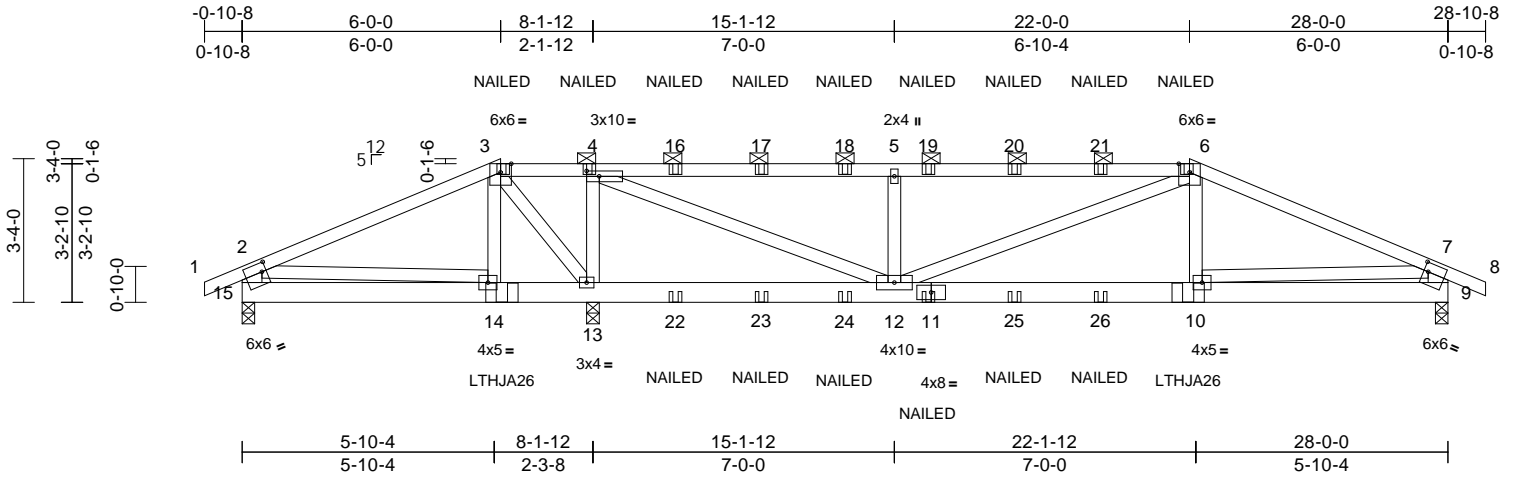

Scale = 1:53.5
Plate Offsets (X, Y): [4:0-3-8,0-1-8], [9:0-1-4,0-2-8], [15:0-1-4,0-2-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.62	Vert(LL)	-0.06	10-12	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.33	Vert(CT)	-0.12	10-12	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.44	Horz(CT)	0.01	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.05	10-12	>999	240	Weight: 260 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x6 SPF No.2
WEBS 2x4 SPF No.2 *Except* 15-2,9-7:2x6 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-6.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.


REACTIONS (size)
9=0-3-8, 13=0-3-8, 15=0-3-8
Max Horiz 15=31 (LC 8)
Max Uplift 9=-303 (LC 9), 13=-659 (LC 4), 15=-225 (LC 27)
Max Grav 9=1465 (LC 1), 13=3211 (LC 1), 15=110 (LC 19)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/30, 2-3=-145/715, 3-4=-232/1269, 4-5=-2065/489, 5-6=-2069/491, 6-7=-2566/537, 7-8=0/30, 2-15=-79/262, 7-9=-1392/322
BOT CHORD 14-15=-184/257, 13-14=-671/178, 12-13=-1272/315, 10-12=-443/2279, 9-10=-186/627
WEBS 3-14=-75/457, 6-10=0/503, 2-14=-817/232, 7-10=-332/1760, 4-13=-1988/543, 3-13=-1144/255, 6-12=-236/88, 5-12=-985/472, 4-12=-781/3595

NOTES
1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 225 lb uplift at joint 15, 303 lb uplift at joint 9 and 659 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie LTHJA26 (LTHJA26 on 2 ply, Right Hand Hip) or equivalent at 6-0-6 from the left end to connect truss(es) to back face of bottom chord.
- Use Simpson Strong-Tie LTHJA26 (LTHJA26 on 2 ply, Left Hand Hip) or equivalent at 21-11-10 from the left end to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 3-6=-70, 6-7=-70, 7-8=-70, 9-15=-20
Concentrated Loads (lb)
Vert: 3=-142 (B), 6=-112 (B), 11=-52 (B), 14=-419 (B), 10=-419 (B), 4=-38 (B), 16=-112 (B), 17=-112 (B), 18=-412 (B), 19=-112 (B), 20=-112 (B), 21=-142 (B), 22=-52 (B), 23=-52 (B), 24=-52 (B), 25=-52 (B), 26=-52 (B)

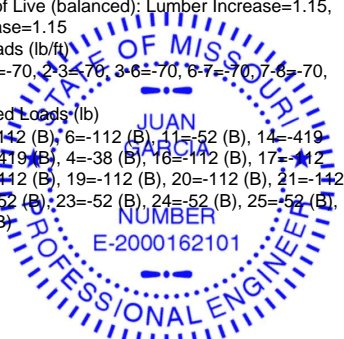

June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW
16023 Swingley Ridge Rd
Missouri, MO 64001
816-424-0200 / MITEK.US
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:53

Job Avalon -	Truss G2	Truss Type Hip	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389211
-----------------	-------------	-------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:54
ID:sPmZlqR0916yVdAsjl0siWzX46s-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?f

Page: 1

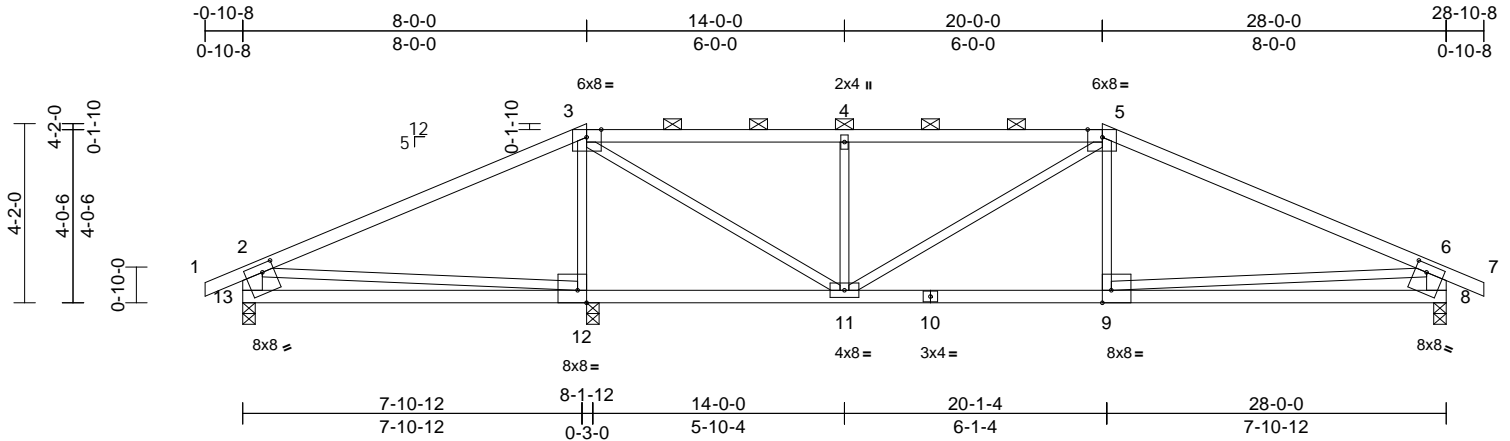

Scale = 1:53.6

Plate Offsets (X, Y): [3:0-4-2,Edge], [5:0-4-2,Edge], [8:0-3-4,0-2-4], [9:0-2-8,Edge], [12:0-2-8,Edge], [13:0-3-4,0-2-4]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.80	Vert(LL)	-0.09	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.47	Vert(CT)	-0.18	8-9	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.98	Horz(CT)	0.03	8	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.04	9-11	>999	240	Weight: 101 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 13-2,8-6:2x6 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-7-0 oc purlins, except end verticals, and 2-0-0 oc purlins (5-6-1 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 11-12.

REACTIONS (size) 8=0-3-8, 12=0-3-8, 13=0-3-8
Max Horiz 13=43 (LC 13)
Max Uplift 8=134 (LC 9), 12=153 (LC 4), 13=134 (LC 8)
Max Grav 8=944 (LC 1), 12=1339 (LC 1), 13=359 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/30, 2-3=-36/258, 3-4=-967/238, 4-5=-967/238, 5-6=-1316/193, 6-7=0/30, 2-13=-295/178, 6-8=-872/179
BOT CHORD 12-13=-287/590, 11-12=-183/35, 9-11=-105/1106, 8-9=-247/718
WEBS 3-12=-1118/229, 3-11=-204/1279, 4-11=-481/194, 5-11=-199/38, 5-9=0/274, 2-12=-677/219, 6-9=0/569

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
3) Provide adequate drainage to prevent water ponding.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 134 lb uplift at joint 13, 153 lb uplift at joint 12 and 134 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcscomponents.com)

MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DESIGNER'S SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:53

Job Avalon -	Truss G3	Truss Type Hip Girder	Qty 1	Ply 2	Avalon - Contemporary Job Reference (optional)	166389212
-----------------	-------------	--------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:54
ID:0h1od5rQsMHx345fsG3xMezNVpv-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWrCDoi7J4zJC7f

Page: 1



Scale = 1:41.7
Plate Offsets (X, Y): [1:Edge,0-8-8], [5:0-4-2,Edge], [8:0-2-0,0-4-4], [9:0-3-8,0-4-0], [10:0-3-8,0-4-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.61	Vert(LL)	-0.12	9-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.21	9-10	>999	240	MT18HS	197/144
BCLL	0.0*	Rep Stress Incr	NO	WB	0.67	Horz(CT)	0.03	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.08	9-10	>999	240	Weight: 231 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SPF No.2 *Except* 11-1:2x6 SP 2400F 2.0E

BRACING
TOP CHORD Structural wood sheathing directly applied or 3-11-10 oc purlins, except end verticals, and 2-0-0 oc purlins (5-5-9 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (size) 7=0-3-8, (req. 0-3-10), 11=0-3-8, (req. 0-4-0)
Max Horiz 11=163 (LC 7)
Max Uplift 7=495 (LC 5), 11=685 (LC 8)
Max Grav 7=4626 (LC 1), 11=5117 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-8433/1029, 2-3=-6385/705, 3-4=-4951/565, 4-5=-4951/565, 5-6=-144/62, 1-11=-4081/518, 6-7=-114/34
BOT CHORD 10-11=-455/2282, 9-10=-999/7722, 8-9=-666/5760, 7-8=-201/1418
WEBS 2-10=-210/1476, 2-9=-2053/460, 3-9=-310/2950, 3-8=-1178/211, 4-8=-457/152, 5-7=-3998/480, 1-10=-583/5484, 5-8=-517/5106

NOTES
1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-6-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-7-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.

- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- WARNING: Required bearing size at joint(s) 11, 7 greater than input bearing size.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 685 lb uplift at joint 11 and 495 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 2-0-12 from the left end to 8-0-12 to connect truss(es) to back face of bottom chord.

- Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 10-0-12 from the left end to 18-0-12 to connect truss(es) to back face of bottom chord.
 - Fill all nail holes where hanger is in contact with lumber.
- LOAD CASE(S)** Standard
1) Dead + Roof Live (balanced); Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-70, 3-5=-70, 5-6=-70, 7-11=-20
Concentrated Loads (lb)
Vert: 8=-806 (B), 12=-1314 (B), 13=-871 (B), 14=-869 (B), 15=-877 (B), 16=-830 (B), 17=-820 (B), 18=-809 (B), 19=-787 (B)

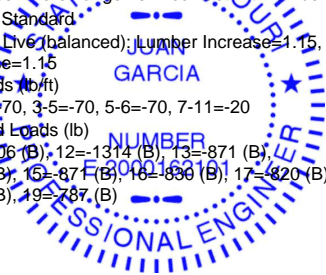

June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DESIGN SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:53

Job Avalon -	Truss G4	Truss Type Monopitch Girder	Qty 1	Ply 2	Avalon - Contemporary Job Reference (optional)	166389213
-----------------	-------------	--------------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:54
ID:BAIOWzLiLIPprf5eA1exASzNVrK-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

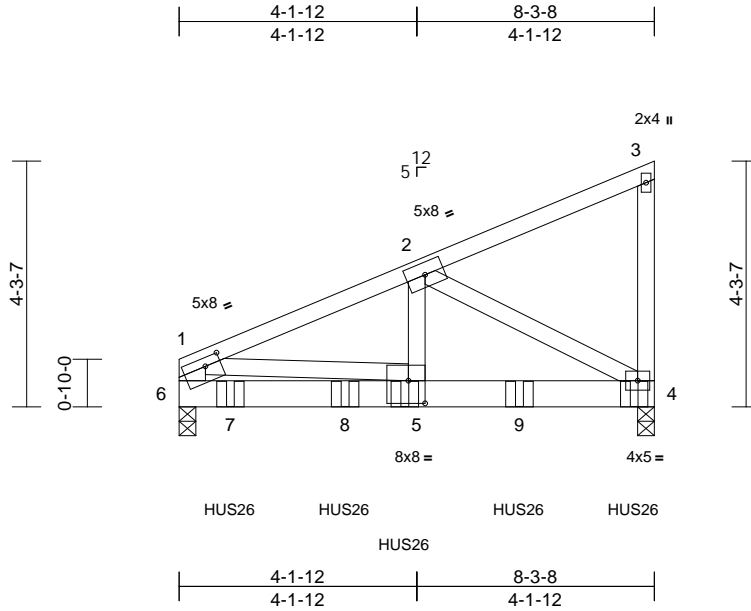

Scale = 1:40.2

Plate Offsets (X, Y): [1:0-3-4,0-1-12], [5:0-3-8,0-4-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	-0.05	5-6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.46	Vert(CT)	-0.08	5-6	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.62	Horz(CT)	0.01	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P		Wind(LL)	0.02	5-6	>999	240	Weight: 90 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SP 2400F 2.0E
 WEBS 2x4 SPF No.2 *Except* 6-1:2x6 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 5-2-4 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 4=0-3-8, (req. 0-4-2), 6=0-3-8, (req. 0-4-0)
 Max Horiz 6=165 (LC 5)
 Max Uplift 4=-175 (LC 8), 6=-135 (LC 8)
 Max Grav 4=5289 (LC 15), 6=5107 (LC 18)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-5770/158, 2-3=-89/40, 3-4=-127/43, 4-5=-3035/115
 BOT CHORD 5-6=-162/15, 4-5=-175/5233
 WEBS 2-5=-41/4853, 2-4=-5959/235, 1-5=-115/5353

NOTES
 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-4-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-5-0 oc.
 Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 3) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- WARNING: Required bearing size at joint(s) 4, 6 greater than input bearing size.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 175 lb uplift at joint 4 and 135 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Use Simpson Strong-Tie HUS26 (14-10d Girder, 6-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 0-10-12 from the left end to 7-11-4 to connect truss(es) to front face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-3=-70, 4-6=-20
 Concentrated Loads (lb)
 Vert: 4=-1845 (F), 5=-1837 (F), 7=-1840 (F), 8=-1837 (F), 9=-1837 (F)



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:53

Job Avalon -	Truss J1	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389214
-----------------	-------------	-----------------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:54
ID: ?ZIMXg1MuezcxqpwEfN9KHZNxbI-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWrCDoi7J4zJCf

Page: 1

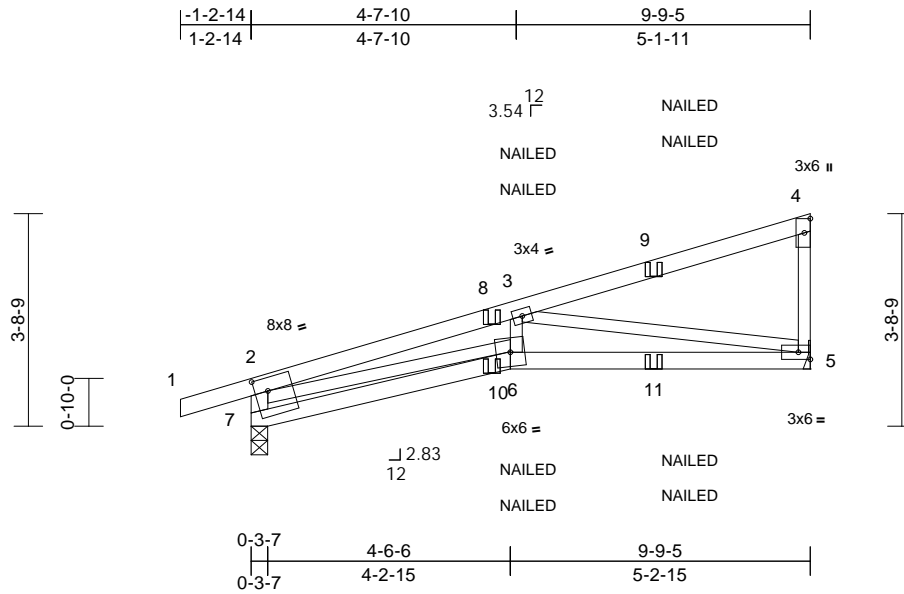

Scale = 1:40.3
Plate Offsets (X, Y): [2:0-2-12,0-2-12]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.62	Vert(LL)	-0.08	6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.65	Vert(CT)	-0.15	5-6	>744	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.92	Horz(CT)	0.05	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.07	6	>999	240	Weight: 35 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except* 7-2:2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-6-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-11-7 oc bracing.

REACTIONS (size) 5= Mechanical, 7=0-3-7
Max Horiz 7=138 (LC 5)
Max Uplift 5=-130 (LC 8), 7=-147 (LC 4)
Max Grav 5=535 (LC 1), 7=578 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-7=-571/184, 1-2=0/27, 2-3=-1565/360, 3-4=-151/32, 4-5=-199/94
BOT CHORD 6-7=-148/237, 5-6=-417/1425
WEBS 2-6=-286/1238, 3-6=0/337, 3-5=-1395/404

7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 130 lb uplift at joint 5 and 147 lb uplift at joint 7.
8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
9) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-4=-70, 6-7=-20, 5-6=-20
Concentrated Loads (lb)
Vert: 9=-97 (F=-48, B=-48), 10=-5 (F=-3, B=-3), 11=-56 (F=-28, B=-28)

NOTES
1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
4) All bearings are assumed to be SPF No.2 .
5) Refer to girder(s) for truss to truss connections.
6) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Lee's Summit, MO 64080
816-424-0200 / MiTek US, Inc.


01/29/2026 3:02:53

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389215
Avalon -	J2	Jack-Open	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:54
ID:hskacvZfZNNgvnFrLja0tzNXck-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCD0i7J4zJC?f

Page: 1

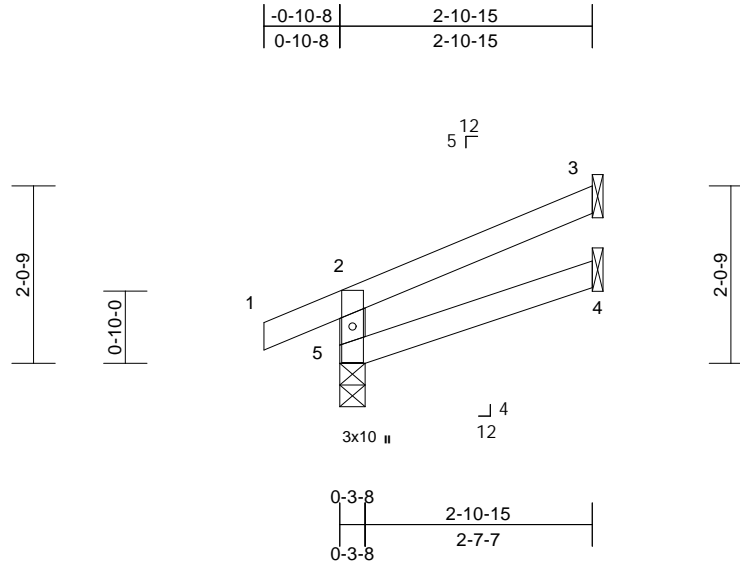

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	-0.01	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 9 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 2-10-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical, 5=0-3-8
Max Horiz 5=53 (LC 5)
Max Uplift 3=-45 (LC 8), 5=-29 (LC 8)
Max Grav 3=80 (LC 1), 4=50 (LC 3), 5=207 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-5=-181/56, 1-2=0/27, 2-3=-46/23
BOT CHORD 4-5=-18/12

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
LOAD CASE(S) Standard

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) All bearings are assumed to be SPF No.2 .
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 5 and 45 lb uplift at joint 3.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:53

Job Avalon -	Truss J3	Truss Type Jack-Open	Qty 2	Ply 1	Avalon - Contemporary Job Reference (optional)	I66389216
-----------------	-------------	-------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:55
ID:6RQisEyXslmFm9VqWTHHdWzNXch-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

Page: 1

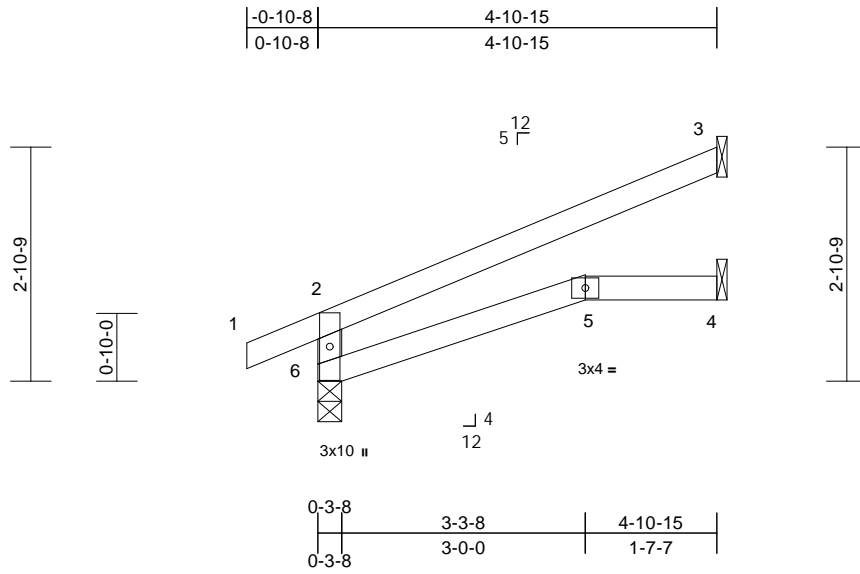

Scale = 1:28.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	-0.02	5-6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(CT)	-0.05	5-6	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.03	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.03	5-6	>999	240	Weight: 14 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 4-10-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical, 6=0-3-8
 Max Horiz 6=86 (LC 8)
 Max Uplift 3=-77 (LC 8), 6=-37 (LC 8)
 Max Grav 3=147 (LC 1), 4=88 (LC 3), 6=291 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-6=-253/82, 1-2=0/27, 2-3=-78/44
 BOT CHORD 5-6=-31/6, 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) All bearings are assumed to be SPF No.2.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 37 lb uplift at joint 6 and 77 lb uplift at joint 3.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:53

Job Avalon -	Truss J5	Truss Type Jack-Closed	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	I66389218
-----------------	-------------	---------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:55
ID:6iy8Q29BsXvqIm150X4Gp5zNXcQ-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

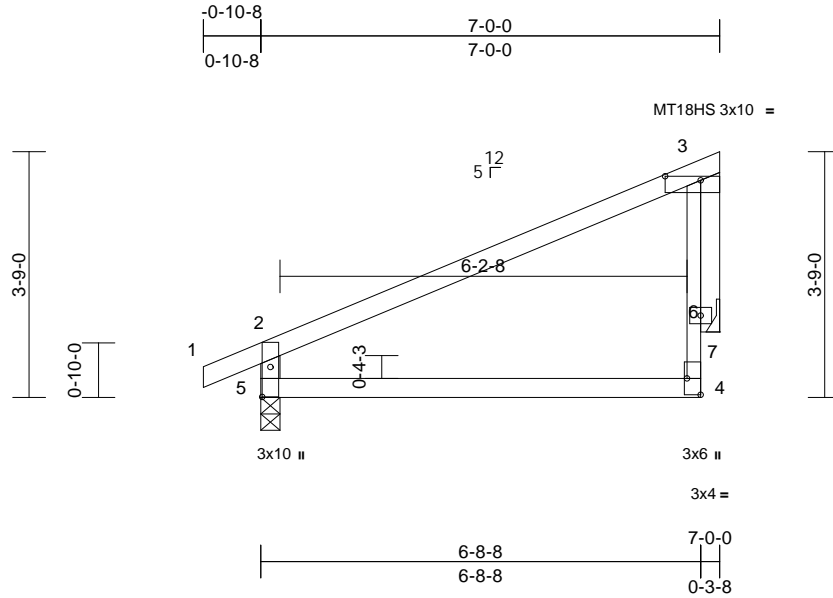

Scale = 1:35.1

Plate Offsets (X, Y): [3:0-6-8,0-0-12], [4:Edge,0-2-8], [5:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.45	Vert(LL)	-0.05	4-5	>999	360	MT18HS	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.27	Vert(CT)	-0.10	4-5	>824	240	MT20	197/144
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.02	4-5	>999	240	Weight: 23 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2 *Except* 3-4:2x3 SPF No.2
OTHERS 2x4 SPF No.2

8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 5=0-3-8, 7= Mechanical
Max Horiz 5=85 (LC 5)
Max Uplift 5=-5 (LC 8), 7=-34 (LC 8)
Max Grav 5=380 (LC 1), 7=273 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-5=-335/55, 1-2=0/27, 2-3=-223/0, 4-6=0/135, 3-6=-246/131
BOT CHORD 4-5=-19/132
WEBS 3-7=-93/46

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 5) All bearings are assumed to be SPF No.2 .
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5 lb uplift at joint 5 and 34 lb uplift at joint 7.

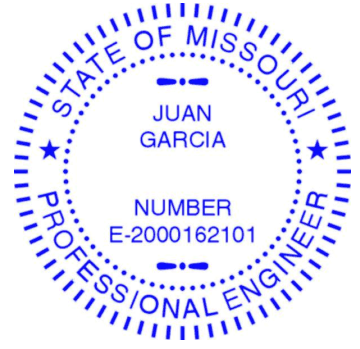

June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:53

Job Avalon -	Truss J6	Truss Type Jack-Closed	Qty 3	Ply 1	Avalon - Contemporary Job Reference (optional)	I66389219
-----------------	-------------	---------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:55
ID:6iy8Q29BsXvqImI50X4Gp5zNXcQ-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC7f

Page: 1

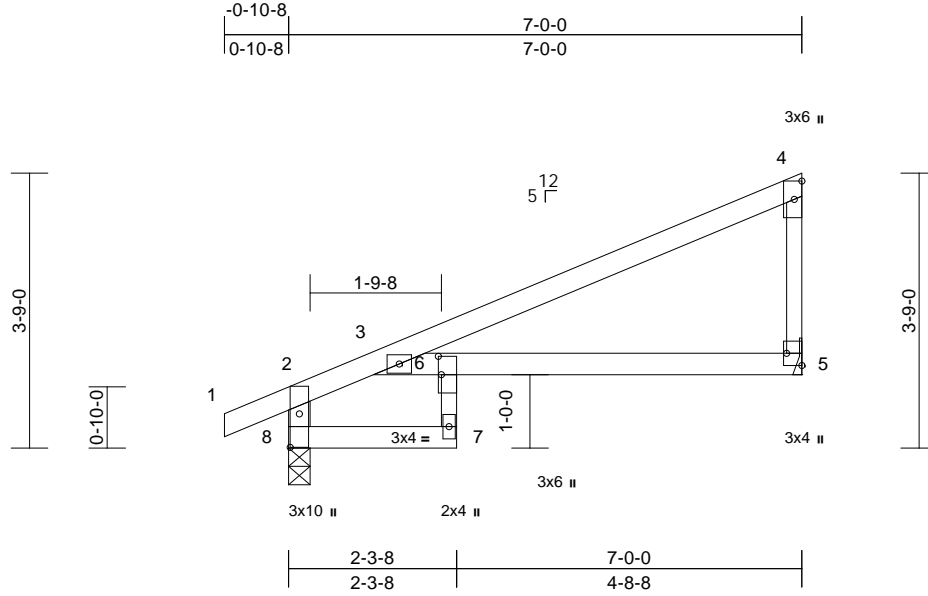

Scale = 1:31.4

Plate Offsets (X, Y): [5:Edge,0-2-8], [6:0-3-0,0-0-8], [8:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.10	5-6	>809	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.55	Vert(CT)	-0.20	5-6	>399	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.09	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.07	5-6	>999	240	Weight: 22 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 7-6:2x3 SPF No.2
 WEBS 2x4 SPF No.2 *Except* 4-5:2x3 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6'-0" oc bracing.

REACTIONS (size) 5= Mechanical, 8=0-3-8
 Max Horiz 8=106 (LC 5)
 Max Uplift 5=-26 (LC 8), 8=-14 (LC 8)
 Max Grav 5=298 (LC 1), 8=381 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-8=-375/37, 1-2=0/27, 2-3=-233/11, 3-4=-131/12, 4-5=-187/45
 BOT CHORD 7-8=-45/129, 6-7=-5/48, 3-6=-64/50, 5-6=-19/65

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-0" tall by 2'-0" wide will fit between the bottom chord and any other members.
 - 4) All bearings are assumed to be SPF No.2.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 14 lb uplift at joint 8 and 26 lb uplift at joint 5.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:53

Job Avalon -	Truss J7	Truss Type Jack-Open	Qty 2	Ply 1	Avalon - Contemporary Job Reference (optional)	I66389220
-----------------	-------------	-------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:55
ID:?ZIMXg1MuezcxqpwEfN9kHZNxbI-RfC?PsB70Hq3NSgPqnl8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

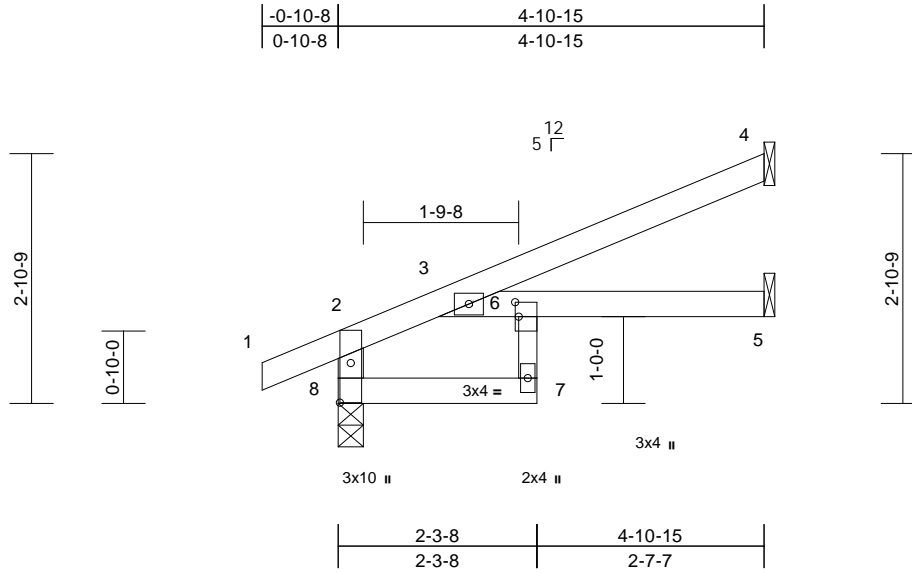

Scale = 1:26.6

Plate Offsets (X, Y): [6:0-2-0,0-0-8], [8:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.26	Vert(LL)	-0.03	5-6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.28	Vert(CT)	-0.06	5-6	>984	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.03	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.03	5-6	>999	240	Weight: 15 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 7-6:2x3 SPF No.2
 WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 4-10-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 4= Mechanical, 5= Mechanical, 8=0-3-8
 Max Horiz 8=87 (LC 8)
 Max Uplift 4=-61 (LC 8), 8=-30 (LC 8)
 Max Grav 4=133 (LC 1), 5=97 (LC 3), 8=305 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-8=-293/58, 1-2=0/27, 2-3=-153/0, 3-4=-49/41
 BOT CHORD 7-8=-46/76, 6-7=-4/46, 3-6=-76/46, 5-6=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) All bearings are assumed to be SPF No.2.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 8 and 61 lb uplift at joint 4.

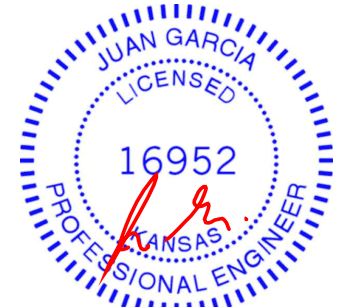

June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:53

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389221
Avalon -	J8	Jack-Open	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:55
 ID:?ZIMXg1MuezcxpwEfN9kHZNxbI-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

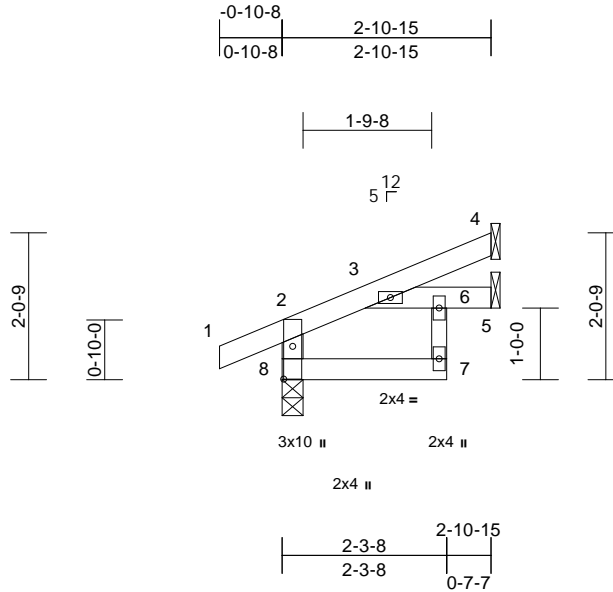

Scale = 1:32.1

Plate Offsets (X, Y): [8:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	0.00	3	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(CT)	0.00	3-6	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	3	>999	240	Weight: 10 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except* 7-6:2x3 SPF No.2
 WEBS 2x4 SPF No.2


7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
LOAD CASE(S) Standard

BRACING
 TOP CHORD Structural wood sheathing directly applied or 2-10-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 4= Mechanical, 5= Mechanical, 8=0-3-8
 Max Horiz 8=53 (LC 8)
 Max Uplift 4=-30 (LC 8), 5=-2 (LC 8), 8=-24 (LC 8)
 Max Grav 4=66 (LC 1), 5=72 (LC 3), 8=216 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-8=-196/45, 1-2=0/27, 2-3=-69/0, 3-4=-21/21
 BOT CHORD 7-8=-16/25, 6-7=0/42, 3-6=-25/16, 5-6=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) All bearings are assumed to be SPF No.2.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 24 lb uplift at joint 8, 30 lb uplift at joint 4 and 2 lb uplift at joint 5.

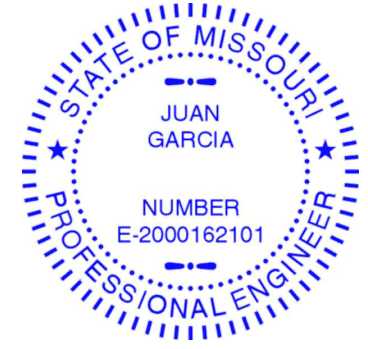

June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:53

Job Avalon -	Truss J9	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389222
-----------------	-------------	-----------------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:55
ID:Tlskl01_fy5TZ_O7oNuOHVzNXbH-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC7f

Page: 1

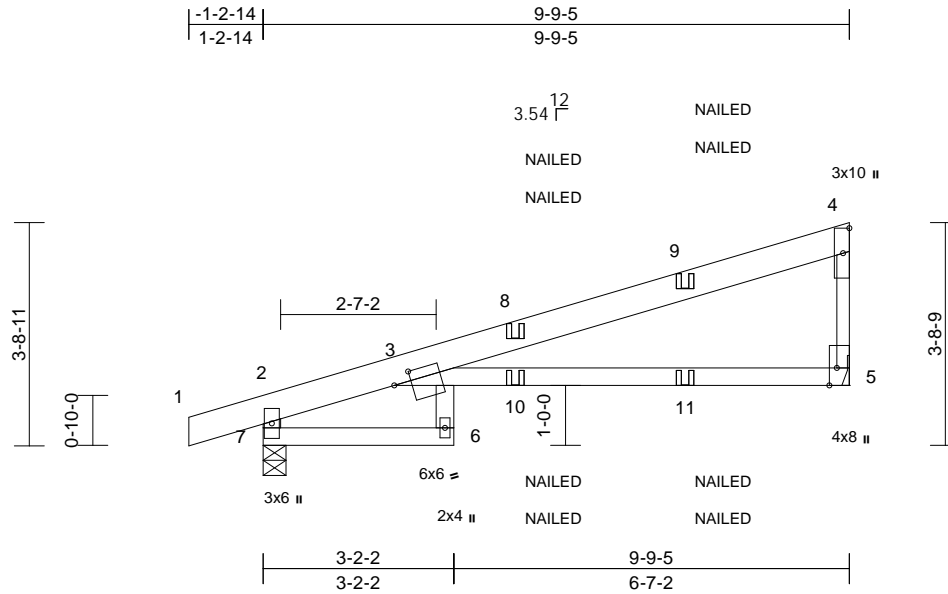

Scale = 1:38.4

Plate Offsets (X, Y): [3:0-3-7,0-1-14], [5:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.60	Vert(LL)	-0.21	6	>552	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.51	Vert(CT)	-0.44	3-5	>261	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.15	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.20	6	>558	240	Weight: 42 lb	FT = 10%

LUMBER
TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SPF 2100F 1.8E *Except* 6-3:2x4 SPF No.2
WEBS 2x4 SPF No.2 *Except* 4-5:2x3 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size) 5= Mechanical, 7=0-4-9
Max Horiz 7=134 (LC 5)
Max Uplift 5=-111 (LC 8), 7=-148 (LC 4)
Max Grav 5=568 (LC 1), 7=621 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-7=-603/170, 1-2=0/27, 2-3=-187/16,
3-4=-184/25, 4-5=-397/156
BOT CHORD 6-7=-37/0, 3-6=0/76, 3-5=-26/108

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
8) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 3-4=-70, 6-7=-20, 3-5=-20
Concentrated Loads (lb)
Vert: 9=-68 (F=-34, B=-34), 10=-50 (F=-25, B=-25), 11=-99 (F=-49, B=-49)



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:53

Job Avalon -	Truss J10	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	Avalon - Contemporary Job Reference (optional)	166389223
-----------------	--------------	-----------------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:55
ID:WRzgi7NtKUUFPrluxlQh?TzX46x-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

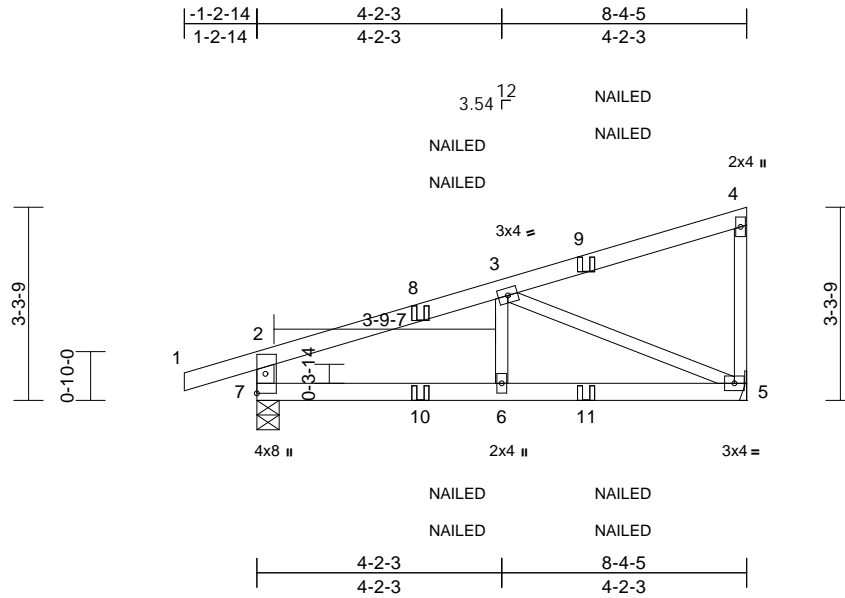

Scale = 1:39.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.46	Vert(LL)	-0.03	5-6	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.32	Vert(CT)	-0.06	5-6	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.24	Horz(CT)	0.01	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S		Wind(LL)	0.02	5-6	>999	240	Weight: 28 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except* 7-2:2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 5= Mechanical, 7=0-4-9
 Max Horiz 7=135 (LC 5)
 Max Uplift 5=-97 (LC 8), 7=-131 (LC 4)
 Max Grav 5=396 (LC 1), 7=487 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 2-7=-417/144, 1-2=0/27, 2-3=-549/103, 3-4=-107/29, 4-5=-142/61
 BOT CHORD 6-7=-131/462, 5-6=-131/462
 WEBS 3-6=0/173, 3-5=-484/144

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 131 lb uplift at joint 7 and 97 lb uplift at joint 5.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- 8) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-70, 2-4=-70, 5-7=-20
 Concentrated Loads (lb)
 Vert: 9=-30 (F=-15, B=-15), 10=3 (F=1, B=1), 11=-29 (F=-15, B=-15)



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:54


Job Avalon -	Truss J11	Truss Type Jack-Open	Qty 8	Ply 1	Avalon - Contemporary Job Reference (optional)	I66389224
-----------------	--------------	-------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:55
ID:KKpWOME_w65Da9ynnk628zX476-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

-0-10-8	1-10-15
0-10-8	1-10-15

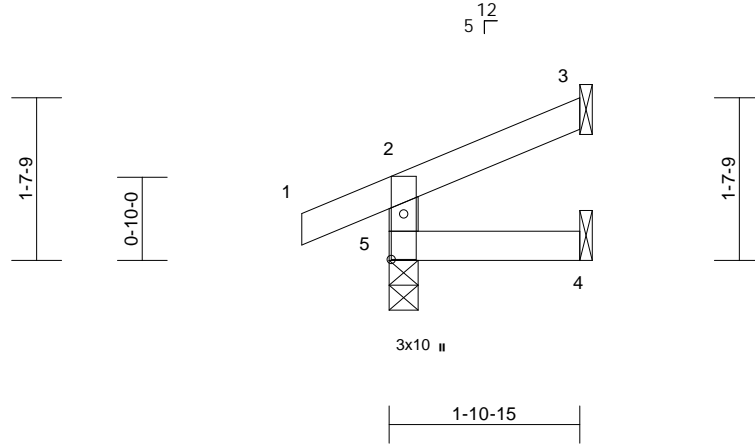

Scale = 1:23.1

Plate Offsets (X, Y): [5:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.07	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 6 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING
TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical, 5=0-3-8
Max Horiz 5=41 (LC 5)
Max Uplift 3=-29 (LC 8), 5=-32 (LC 4)
Max Grav 3=44 (LC 1), 4=32 (LC 3), 5=171 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-5=-150/47, 1-2=0/27, 2-3=-32/12
BOT CHORD 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) All bearings are assumed to be SPF No.2.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 32 lb uplift at joint 5 and 29 lb uplift at joint 3.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:54

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389225
Avalon -	J11A	Jack-Open	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:55
ID: VZthYGjTSX1WAsdGJ7L8_uz4MnY-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCdoi7J4zJC?f

Page: 1

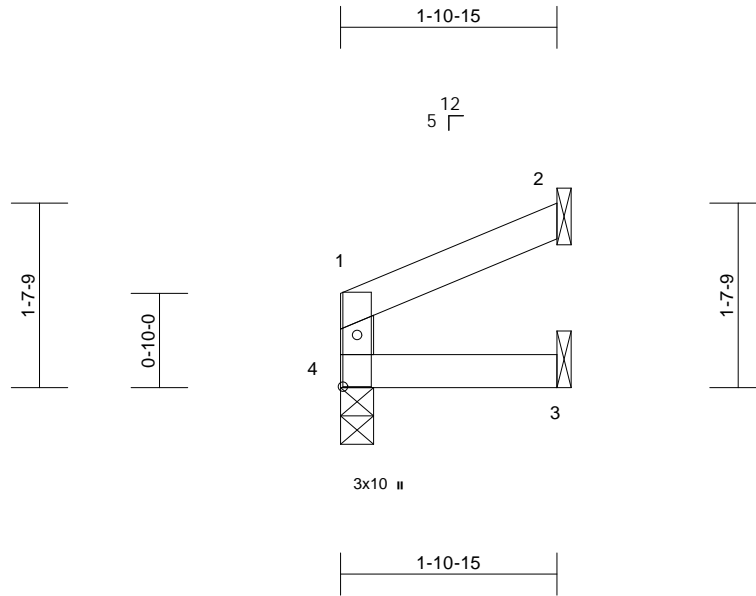

Scale = 1:20.4

Plate Offsets (X, Y): [4:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.04	Vert(LL)	0.00	3-4	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	0.00	3-4	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	3-4	>999	240	Weight: 5 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2= Mechanical, 3= Mechanical, 4=0-3-8
Max Horiz 4=32 (LC 5)
Max Uplift 2=-32 (LC 8)
Max Grav 2=57 (LC 1), 3=34 (LC 3), 4=79 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-4=-65/18, 1-2=-29/17
BOT CHORD 3-4=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 32 lb uplift at joint 2.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
P.O. Box 1000
Lee's Summit, MO 64083
816-424-0200 / MiTek-USA.com
01/29/2026 3:02:54

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389226
Avalon -	J12	Jack-Open	4	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:56
ID:KKpWOME_w65Da9ynnkk628zX476-RfC?PsB70Hq3NSgPqL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

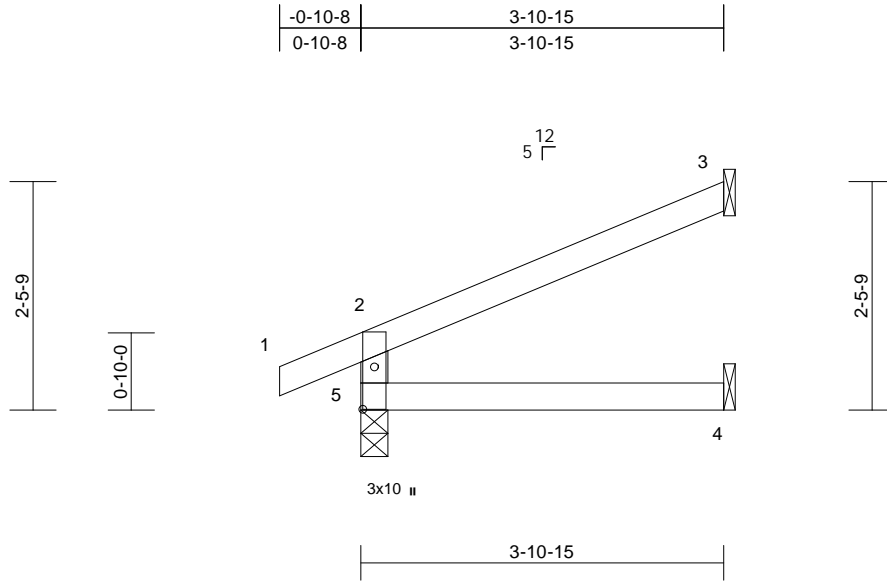

Scale = 1:24.8

Plate Offsets (X, Y): [5:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.19	Vert(LL)	-0.01	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.12	Vert(CT)	-0.02	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 11 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-10-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 3= Mechanical, 4= Mechanical, 5=0-3-8
Max Horiz 5=70 (LC 8)
Max Uplift 3=-61 (LC 8), 5=-34 (LC 8)
Max Grav 3=114 (LC 1), 4=70 (LC 3), 5=248 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-217/69, 1-2=0/27, 2-3=-62/34
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 5 and 61 lb uplift at joint 3.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Missouri, MO 64080
816-424-0200 / MiTek.US
01/29/2026 3:02:54

Job Avalon -	Truss J13	Truss Type Jack-Open	Qty 9	Ply 1	Avalon - Contemporary Job Reference (optional)	I66389227
-----------------	--------------	-------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:56
ID:KbKxyASevKEp7ml2H?X5EkzX46r-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?F

Page: 1

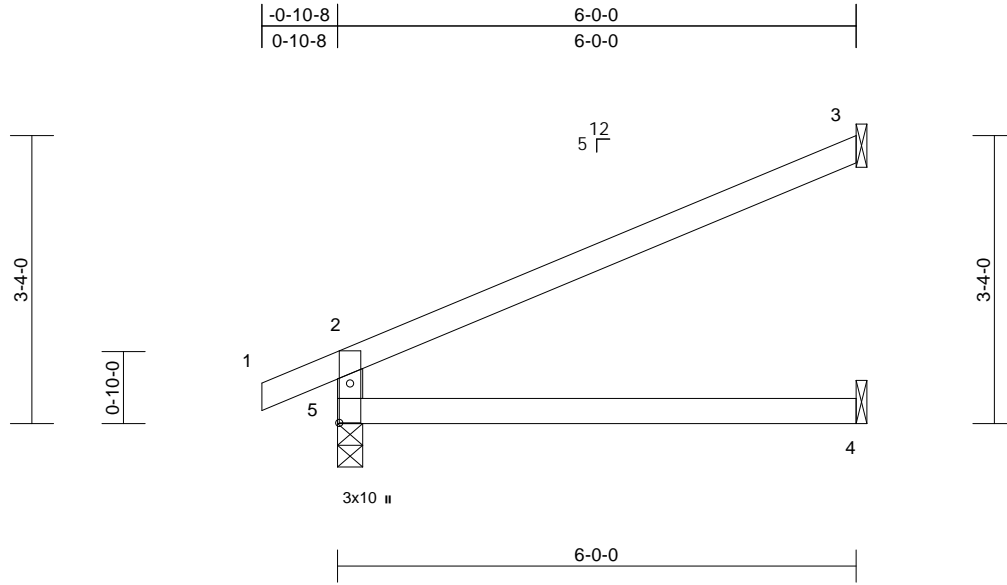

Scale = 1:26.7

Plate Offsets (X, Y): [5:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.05	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.32	Vert(CT)	-0.12	4-5	>593	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.05	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.06	4-5	>999	240	Weight: 16 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical, 5=0-3-8
Max Horiz 5=105 (LC 8)
Max Uplift 3=-92 (LC 8), 5=-43 (LC 8)
Max Grav 3=182 (LC 1), 4=109 (LC 3), 5=338 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-295/98, 1-2=0/27, 2-3=-96/55
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 43 lb uplift at joint 5 and 92 lb uplift at joint 3.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Missouri, MO 64080
816-424-0200 / MiTek-USA.com
01/29/2026 3:02:54

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389228
Avalon -	J14	Diagonal Hip Girder	3	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:56
ID: _1yVKPxmC3lzKd?jMvgMjhz4MnG-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?i

Page: 1

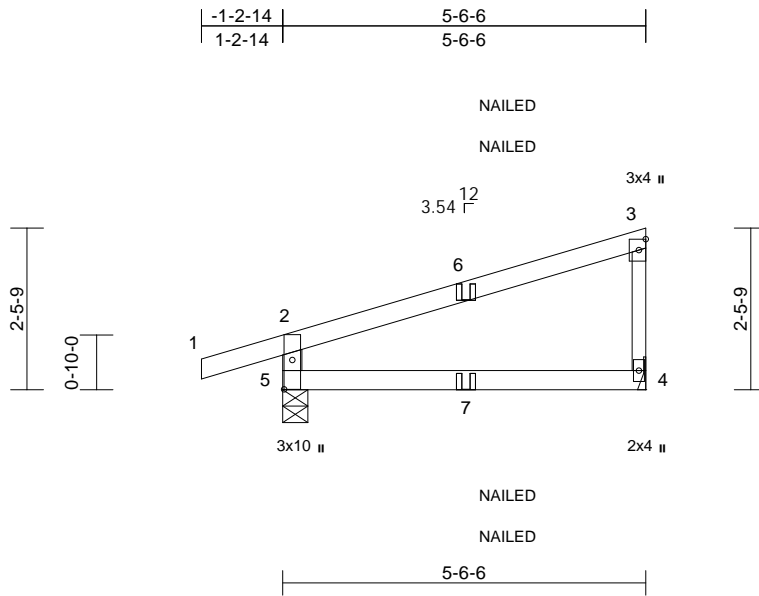

Scale = 1:35.1

Plate Offsets (X, Y): [5:0-5-6,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.40	Vert(LL)	-0.03	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.25	Vert(CT)	-0.06	4-5	>991	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 16 lb	FT = 10%

LUMBER

- TOP CHORD 2x4 SPF No.2
- BOT CHORD 2x4 SPF No.2
- WEBS 2x4 SPF No.2 *Except* 3-4:2x3 SPF No.2

BRACING

- TOP CHORD Structural wood sheathing directly applied or 5-6-6 oc purlins, except end verticals.
- BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

- (size) 4= Mechanical, 5=0-4-9
- Max Horiz 5=99 (LC 5)
- Max Uplift 4=49 (LC 8), 5=-103 (LC 4)
- Max Grav 4=224 (LC 1), 5=346 (LC 1)

FORCES

- (lb) - Maximum Compression/Maximum Tension
- TOP CHORD 2-5=-305/141, 1-2=0/27, 2-3=-128/14, 3-4=-161/72
- BOT CHORD 4-5=-26/50

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 103 lb uplift at joint 5 and 49 lb uplift at joint 4.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- 8) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=-70, 2-3=-70, 4-5=-20
Concentrated Loads (lb)
Vert: 7=3 (F=1, B=1)



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
P.O. Box 1000
Lee's Summit, MO 64086
816-424-0200 / MiTek-USA.com
01/29/2026 3:02:54

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389229
Avalon -	J15	Jack-Open	9	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:56
ID:laRW081nKWlqlrcGqapE2Nz4Mn8-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

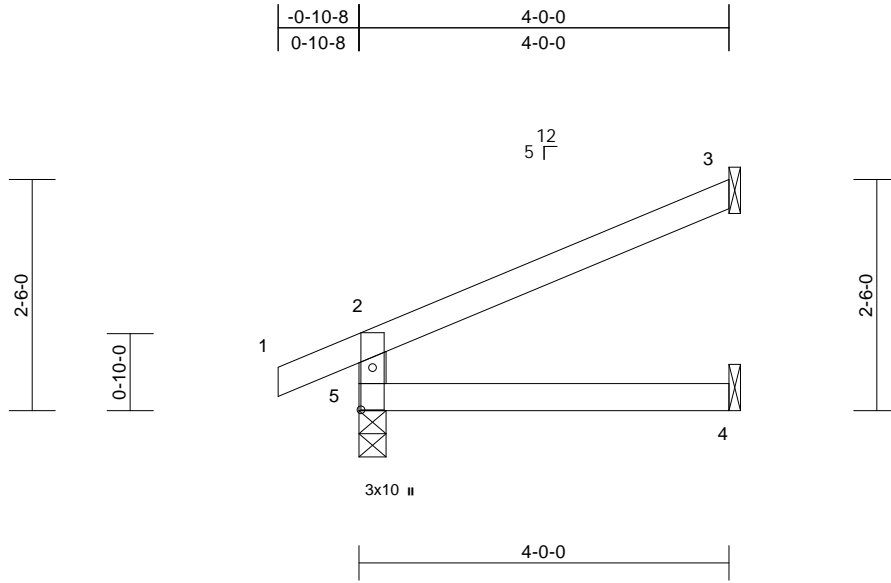

Scale = 1:24.9

Plate Offsets (X, Y): [5:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	-0.01	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.13	Vert(CT)	-0.02	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 11 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 3= Mechanical, 4= Mechanical, 5=0-3-8
Max Horiz 5=71 (LC 8)
Max Uplift 3=-62 (LC 8), 5=-34 (LC 8)
Max Grav 3=117 (LC 1), 4=71 (LC 3), 5=252 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-220/71, 1-2=0/27, 2-3=-64/35
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 34 lb uplift at joint 5 and 62 lb uplift at joint 3.



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swingley Ridge Rd
Missouri, MO 64080
816-424-0200 / MiTek.US.com
01/29/2026 3:02:54


Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389230
Avalon -	J16	Jack-Closed Girder	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:56

Page: 1

ID: _ObdAUz4BA?v1h?3rFhfcz4Mlx-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKwRCDoi7J4zJC?f

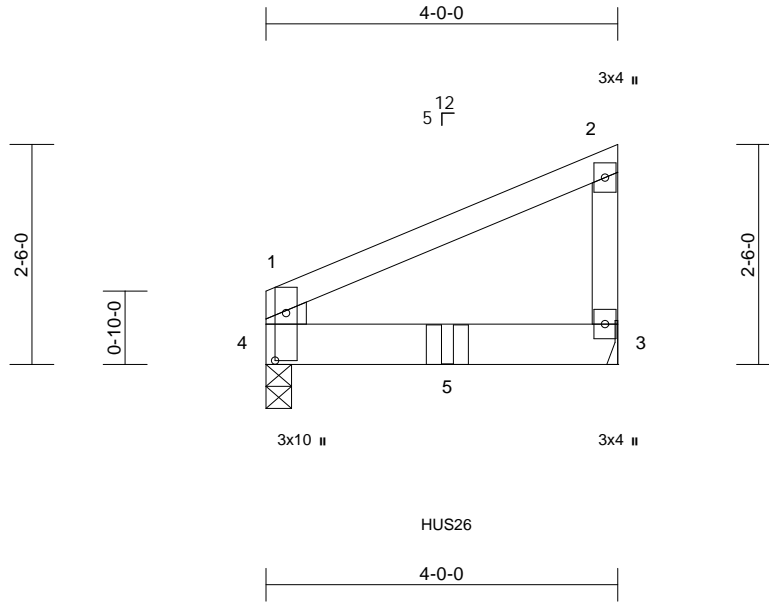

Scale = 1:26.2

Plate Offsets (X, Y): [4:0-6-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	-0.01	3-4	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.48	Vert(CT)	-0.03	3-4	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.02	3-4	>999	240	Weight: 15 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SPF No.2
 WEBS 2x6 SPF No.2 *Except* 2-3:2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 3= Mechanical, 4=0-3-8
 Max Horiz 4=87 (LC 7)
 Max Uplift 3=-120 (LC 8), 4=-99 (LC 8)
 Max Grav 3=433 (LC 1), 4=427 (LC 1)

FORCES

(lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-4=-144/54, 1-2=-120/27, 2-3=-109/54
 BOT CHORD 3-4=-40/73

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2 .
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 99 lb uplift at joint 4 and 120 lb uplift at joint 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

- 8) Use Simpson Strong-Tie HUS26 (14-10d Girder, 6-10d Truss, Single Ply Girder) or equivalent at 2-0-12 from the left end to connect truss(es) to front face of bottom chord.
- 9) Fill all nail holes where hanger is in contact with lumber.
- 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (lb/ft)
 Vert: 1-2=-70, 3-4=-20
 Concentrated Loads (lb)
 Vert: 5=-533 (F)



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:54

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389231
Avalon -	J17	Diagonal Hip Girder	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:56
ID:D1XKnIF442aHSd_juM8SmAz4Mms-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC7f

Page: 1

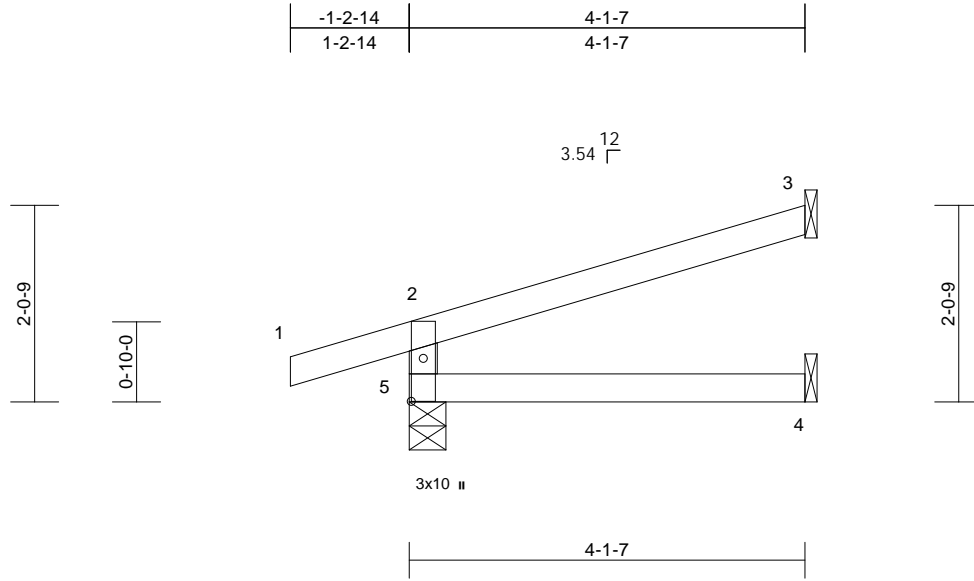

Scale = 1:24
Plate Offsets (X, Y): [5:0-5-6,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.14	Vert(LL)	-0.01	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.11	Vert(CT)	-0.02	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	NO	WB	0.00	Horz(CT)	-0.01	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.01	4-5	>999	240	Weight: 12 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 4-1-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 3= Mechanical, 4= Mechanical, 5=0-4-9
Max Horiz 5=50 (LC 12)
Max Uplift 3=-46 (LC 12), 5=-78 (LC 6)
Max Grav 3=80 (LC 1), 4=60 (LC 3), 5=178 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 2-5=-162/104, 1-2=0/27, 2-3=-30/15
BOT CHORD 4-5=0/0

- NOTES**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 4) All bearings are assumed to be SPF No.2 .
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 78 lb uplift at joint 5 and 46 lb uplift at joint 3.

- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).
- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-2=70
Trapezoidal Loads (lb/ft)
Vert: 2-3 (F=34, B=34)-to-3=-72 (F=-1, B=-1), 5=0 (F=10, B=10)-to-4=-21 (F=0, B=0)



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:54

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389232
Avalon -	J18	Jack-Open	4	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:56
ID:WNSzFiKTRCSHoh13oKm5Yez4Mml-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrcDoi7J4zJC?

Page: 1

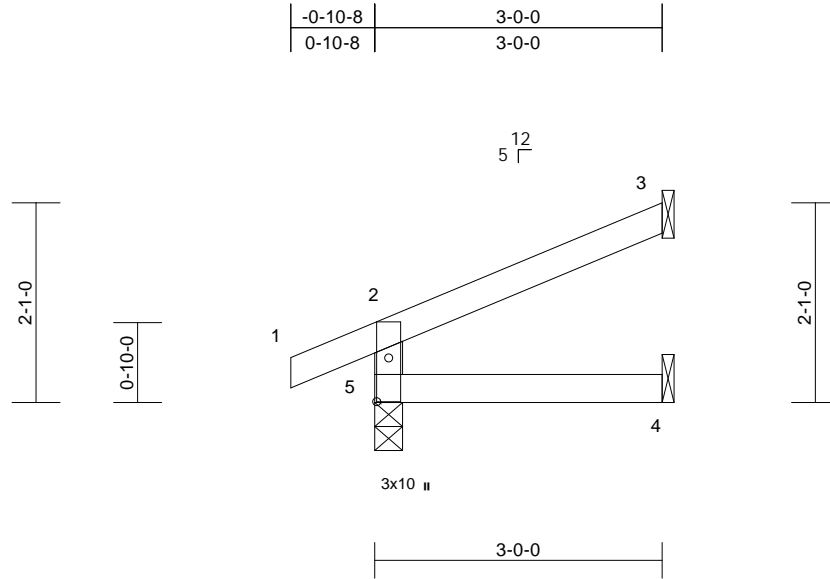

Scale = 1:24

Plate Offsets (X, Y): [5:0-5-8,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	0.00	4-5	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	-0.01	4-5	>999	240		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-R		Wind(LL)	0.00	4-5	>999	240	Weight: 9 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard

BRACING

TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS (size) 3= Mechanical, 4= Mechanical, 5=0-3-8
Max Horiz 5=54 (LC 8)
Max Uplift 3=-46 (LC 8), 5=-30 (LC 8)
Max Grav 3=83 (LC 1), 4=52 (LC 3), 5=210 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 2-5=-184/58, 1-2=0/27, 2-3=-48/24
BOT CHORD 4-5=0/0

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 4) All bearings are assumed to be SPF No.2.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 30 lb uplift at joint 5 and 46 lb uplift at joint 3.

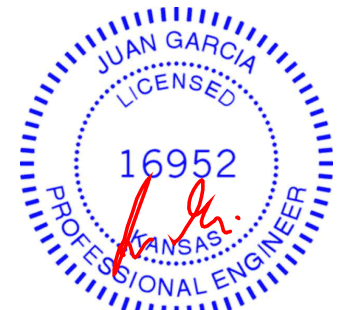

June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Missouri, MO 64080
816-424-0200 / MiTek-USA.com
01/29/2026 3:02:54

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389233
Avalon -	LAY1	Lay-In Gable	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:56
 ID:vc?jEYk40KE6tdmb4uYmKDzX4oN-RFC?PsB70Hq3NSgPqnL8w3uITXbGKWRcDoi7J4zJC?

Page: 1

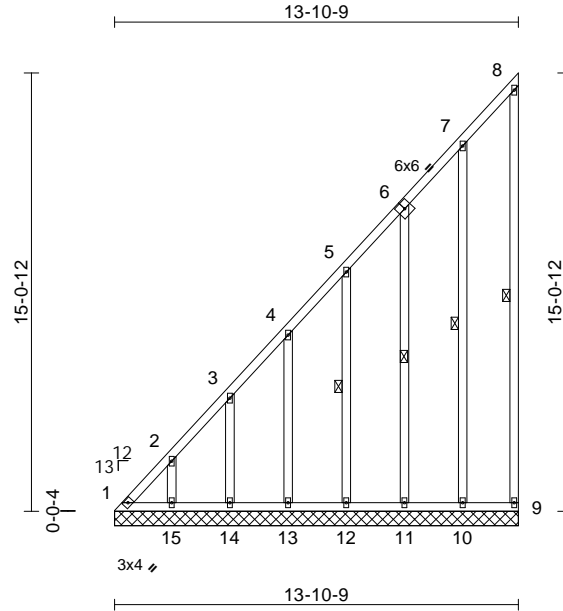

Scale = 1:79.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.12	Horiz(TL)	0.00	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 103 lb	FT = 10%

LUMBER	
TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
OTHERS	2x4 SPF No.2

BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 8-9, 5-12, 6-11, 7-10

REACTIONS (size)	
Max Horiz	1=593 (LC 8)
Max Uplift	1=195 (LC 6), 9=48 (LC 8), 10=133 (LC 8), 11=131 (LC 8), 12=122 (LC 8), 13=131 (LC 8), 14=129 (LC 8), 15=131 (LC 8)
Max Grav	1=600 (LC 8), 9=73 (LC 15), 10=214 (LC 15), 11=206 (LC 15), 12=198 (LC 15), 13=207 (LC 15), 14=205 (LC 15), 15=208 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension	
TOP CHORD	8-9=-59/55, 1-2=-832/326, 2-3=-709/278, 3-4=-578/228, 4-5=-447/179, 5-7=-321/131, 7-8=-70/36
BOT CHORD	1-15=-2/2, 14-15=-2/2, 13-14=-2/2, 12-13=-2/2, 11-12=-2/2, 10-11=0/0, 9-10=0/0
WEBS	2-15=-163/148, 3-14=-166/155, 4-13=-166/155, 5-12=-158/146, 6-11=-166/155, 7-10=-173/160

NOTES
 1) Wind: ASCE 7-16; Vult=115mph (3-second gust)
 Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 9, 195 lb uplift at joint 1, 131 lb uplift at joint 15, 129 lb uplift at joint 14, 131 lb uplift at joint 13, 122 lb uplift at joint 12, 131 lb uplift at joint 11 and 133 lb uplift at joint 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:54

Job Avalon -	Truss LAY2	Truss Type Lay-In Gable	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389234
-----------------	---------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:56
ID:oWMucifChQD4CJXzLeFLbMzX475-RfC?PsB70Hq3NSgPqnl8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

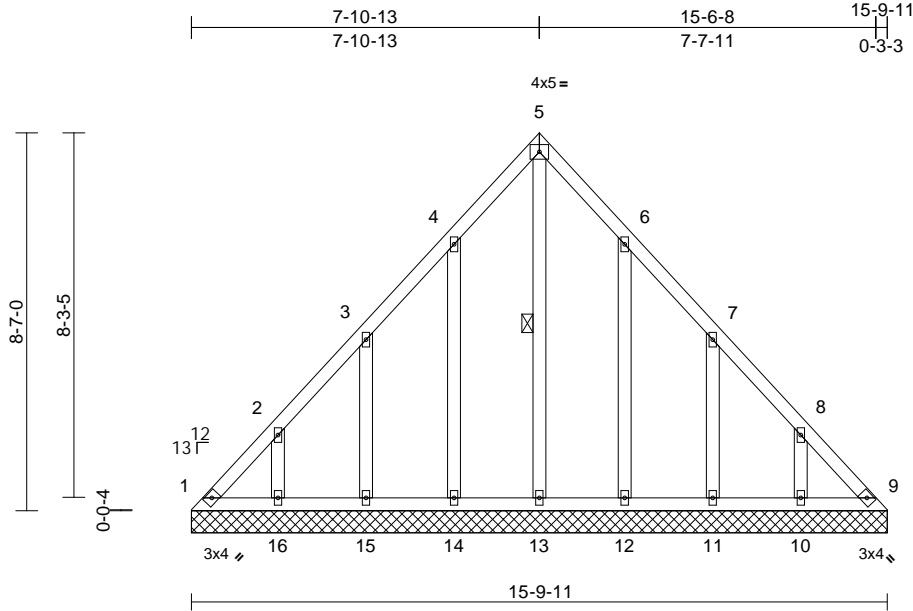

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.11	Horiz(TL)	0.01	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 78 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 5-13
REACTIONS (size) 1=15-9-11, 9=15-9-11, 10=15-9-11, 11=15-9-11, 12=15-9-11, 13=15-9-11, 14=15-9-11, 15=15-9-11, 16=15-9-11
 Max Horiz 1=220 (LC 4)
 Max Uplift 1=94 (LC 6), 9=58 (LC 7), 10=130 (LC 9), 11=132 (LC 9), 12=127 (LC 9), 14=129 (LC 8), 15=132 (LC 8), 16=131 (LC 8)
 Max Grav 1=203 (LC 8), 9=179 (LC 9), 10=208 (LC 16), 11=205 (LC 16), 12=210 (LC 16), 13=196 (LC 9), 14=212 (LC 15), 15=204 (LC 15), 16=209 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-293/188, 2-3=-169/140, 3-4=-136/102, 4-5=-108/164, 5-6=-86/142, 6-7=-99/65, 7-8=-141/91, 8-9=-260/139
 BOT CHORD 1-16=-96/203, 15-16=-96/203, 14-15=-96/203, 13-14=-96/203, 12-13=-96/203, 11-12=-96/203, 10-11=-96/203, 9-10=-96/203
 WEBS 2-16=-163/149, 3-15=-165/157, 4-14=-173/152, 8-10=-163/149, 7-11=-166/158, 6-12=-171/150, 5-13=-173/21

NOTES
 1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 94 lb uplift at joint 1, 58 lb uplift at joint 9, 131 lb uplift at joint 16, 132 lb uplift at joint 15, 129 lb uplift at joint 14, 130 lb uplift at joint 10, 132 lb uplift at joint 11 and 127 lb uplift at joint 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:54

Job Avalon -	Truss LAY3	Truss Type Lay-In Gable	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389235
-----------------	---------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:57
ID:hqKHU10DI6DNJA6Sz6CrkFz4Mgi-RfC?PsB70Hq3NSgPqnL8w3uITxBGKWrCDoi7J4zJC7f

Page: 1

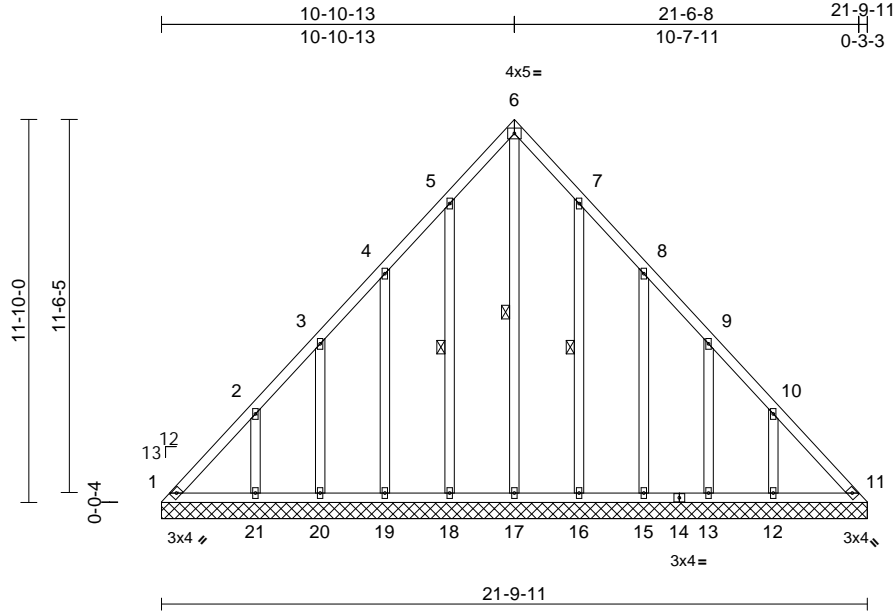

Scale = 1:71.2

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.15	Horiz(TL)	0.01	11	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 127 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

WEBS
6-17=-260/38, 5-18=-175/148,
4-19=-167/161, 3-20=-150/139,
2-21=-214/196, 7-16=-171/145,
8-15=-169/162, 9-13=-150/139,
10-12=-215/196

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 6-17, 5-18, 7-16

REACTIONS (size)
1=21-9-11, 11=21-9-11,
12=21-9-11, 13=21-9-11,
15=21-9-11, 16=21-9-11,
17=21-9-11, 18=21-9-11,
19=21-9-11, 20=21-9-11,
21=21-9-11
Max Horiz 1=-307 (LC 4)
Max Uplift 1=-121 (LC 6), 11=-70 (LC 7),
12=-176 (LC 9), 13=-114 (LC 9),
15=-139 (LC 9), 16=-121 (LC 9),
18=-124 (LC 8), 19=-137 (LC 8),
20=-114 (LC 8), 21=-176 (LC 8)
Max Grav 1=278 (LC 8), 11=245 (LC 9),
12=279 (LC 16), 13=182 (LC 16),
15=211 (LC 16), 16=211 (LC 16),
17=284 (LC 9), 18=214 (LC 15),
19=209 (LC 15), 20=182 (LC 15),
21=279 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-406/263, 2-3=-239/190, 3-4=-174/148,
4-5=-149/166, 5-6=-120/228, 6-7=-94/205,
7-8=-96/120, 8-9=-123/79, 9-10=-193/121,
10-11=-360/194
BOT CHORD 1-21=-136/289, 20-21=-136/289,
19-20=-136/289, 18-19=-136/289,
17-18=-136/289, 16-17=-136/289,
15-16=-136/289, 13-15=-136/289,
12-13=-136/289, 11-12=-136/289

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) Gable studs spaced at 2-0-0 oc.
 - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 9) All bearings are assumed to be SPF No.2.
 - 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 1, 70 lb uplift at joint 11, 124 lb uplift at joint 18, 137 lb uplift at joint 19, 114 lb uplift at joint 20, 176 lb uplift at joint 21, 121 lb uplift at joint 16, 139 lb uplift at joint 15, 114 lb uplift at joint 13 and 176 lb uplift at joint 12.
 - 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Lee's Summit, MO 64080
816-424-0200 / MiTek.US
01/29/2026 3:02:54

Job Avalon -	Truss LAY4	Truss Type Lay-In Gable	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389236
-----------------	---------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:57
ID:zzwCjMF76KBs5oIwvzhOrz4MbF-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrCDoi7J4zJC?f

Page: 1

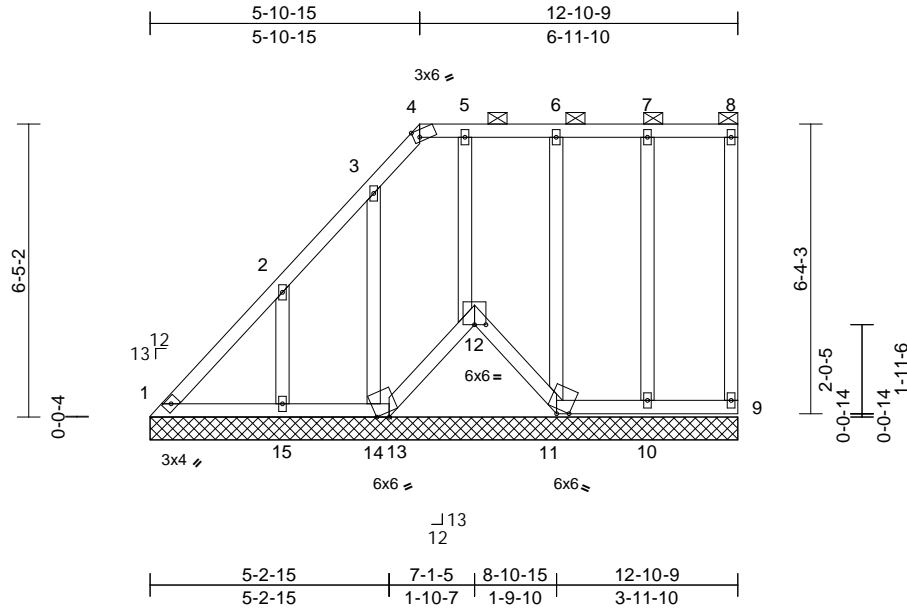

Scale = 1:50.5

Plate Offsets (X, Y): [4:0-1-10,Edge], [12:0-3-0,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.16	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.10	Horiz(TL)	0.00	9	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 68 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size)
1=12-10-9, 9=12-10-9, 10=12-10-9,
11=12-10-9, 12=12-10-9,
13=12-10-9, 14=12-10-9,
15=12-10-9
Max Horiz 1=243 (LC 5)
Max Uplift 1=60 (LC 4), 9=15 (LC 5), 10=35 (LC 4), 11=121 (LC 4), 12=242 (LC 7), 13=58 (LC 8), 14=75 (LC 8), 15=185 (LC 8)
Max Grav 1=189 (LC 16), 9=68 (LC 1), 10=190 (LC 1), 11=205 (LC 18), 12=196 (LC 15), 13=120 (LC 7), 14=155 (LC 15), 15=281 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-241/174, 2-3=-179/119, 3-4=-116/79, 4-5=-81/65, 5-6=-86/65, 6-7=-86/65, 7-8=-86/65, 8-9=-58/45
BOT CHORD 1-15=-91/66, 14-15=-91/66, 13-14=-91/66, 12-13=-149/106, 11-12=-141/104, 10-11=-87/66, 9-10=-86/65
WEBS 2-15=-214/207, 3-14=-149/94, 5-12=-143/102, 6-11=-136/78, 7-10=-147/83

NOTES

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 2-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 9) All bearings are assumed to be SPF No.2.
- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 60 lb uplift at joint 1, 15 lb uplift at joint 9, 58 lb uplift at joint 13, 242 lb uplift at joint 12, 185 lb uplift at joint 15, 75 lb uplift at joint 14, 121 lb uplift at joint 11 and 35 lb uplift at joint 10.
- 11) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 9, 12, 11, 10.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:54

Job Avalon -	Truss LAY5	Truss Type Lay-In Gable	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389237
-----------------	---------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:57
ID:jlzLNGTWqELvYzpIXORVbKNz4Mbf-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?F

Page: 1

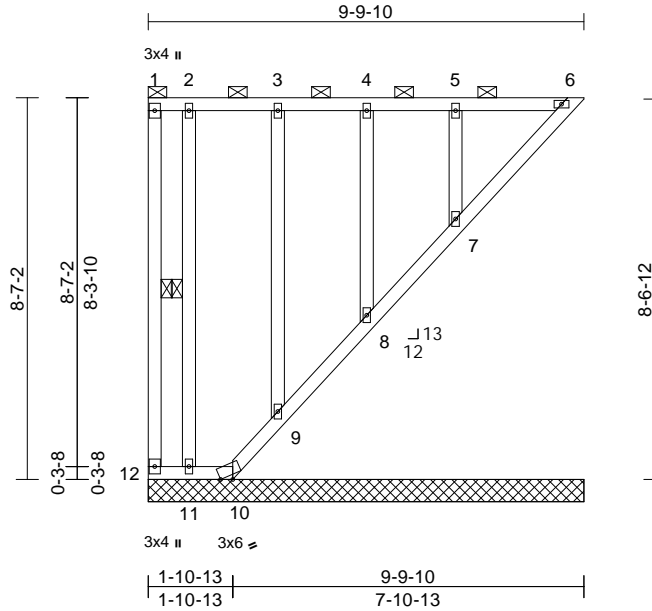

Scale = 1:51.9

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.30	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.15	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.13	Horiz(TL)	0.01	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 61 lb	FT = 10%

LUMBER	
TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
OTHERS	2x4 SPF No.2
BRACING	
TOP CHORD	2-0-0 oc purlins (6-0-0 max.): 1-6, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 6-7.
WEBS	1 Row at midpt 1-12, 2-11
REACTIONS (size)	
	6=9-9-10, 7=9-9-10, 8=9-9-10, 9=9-9-10, 10=9-9-10, 11=9-9-10, 12=9-9-10
Max Horiz	12=-236 (LC 6)
Max Uplift	6=-114 (LC 5), 7=-46 (LC 4), 8=-31 (LC 5), 9=41 (LC 5), 10=-149 (LC 6), 11=-92 (LC 5), 12=-48 (LC 6)
Max Grav	6=154 (LC 15), 7=244 (LC 1), 8=160 (LC 1), 9=187 (LC 1), 10=131 (LC 5), 11=136 (LC 15), 12=36 (LC 5)
FORCES (lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-12=-111/92, 1-2=-117/89, 2-3=-117/89, 3-4=-117/89, 4-5=-117/89, 5-6=-117/89
BOT CHORD	11-12=-89/117, 10-11=-89/117, 9-10=-139/191, 8-9=-139/187, 7-8=-139/189, 6-7=-142/190
WEBS	2-11=-102/119, 3-9=-151/68, 4-8=-125/55, 5-7=-186/74

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 48 lb uplift at joint 12, 114 lb uplift at joint 6, 149 lb uplift at joint 10, 92 lb uplift at joint 11, 41 lb uplift at joint 9, 31 lb uplift at joint 8 and 46 lb uplift at joint 7.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 6, 9, 8, 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

NOTES

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCCL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:54

Job Avalon -	Truss LAY6	Truss Type Lay-In Gable	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	I66389238
-----------------	---------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:57
ID:etku_8VdNB5RrhWZ3ZV8aOz4MmY-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

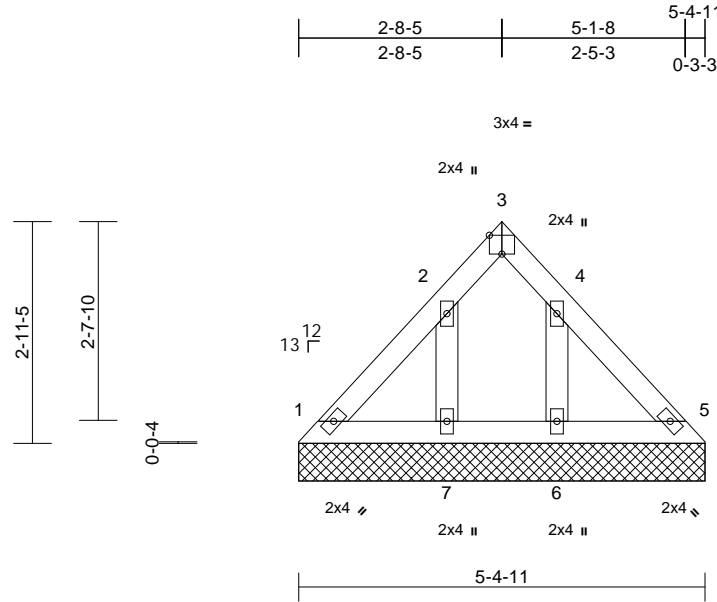

Scale = 1:30.6

Plate Offsets (X, Y): [3:Edge,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.04	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 18 lb	FT = 10%

LUMBER

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-5-2 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 1=5-4-11, 5=5-4-11, 6=5-4-11, 7=5-4-11
Max Horiz 1=-69 (LC 4)
Max Uplift 6=-96 (LC 9), 7=-98 (LC 8)
Max Grav 1=80 (LC 17), 5=79 (LC 18), 6=167 (LC 16), 7=169 (LC 15)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=-102/67, 2-3=-40/6, 3-4=-40/5, 4-5=-101/66
BOT CHORD 1-7=-37/97, 6-7=-37/97, 5-6=-37/97
WEBS 2-7=-135/118, 4-6=-133/117

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 98 lb uplift at joint 7 and 96 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swinley Ridge Rd
Lee's Summit, MO 64080
816-424-0200 / MiTek.US.com
01/29/2026 3:02:54

Job Avalon -	Truss LAY7	Truss Type Lay-In Gable	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389239
-----------------	---------------	----------------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:57
ID:kTHxjY7_ffPvOURwNzhf4Lz4MTf-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRcDoi7J4zJC?f

Page: 1

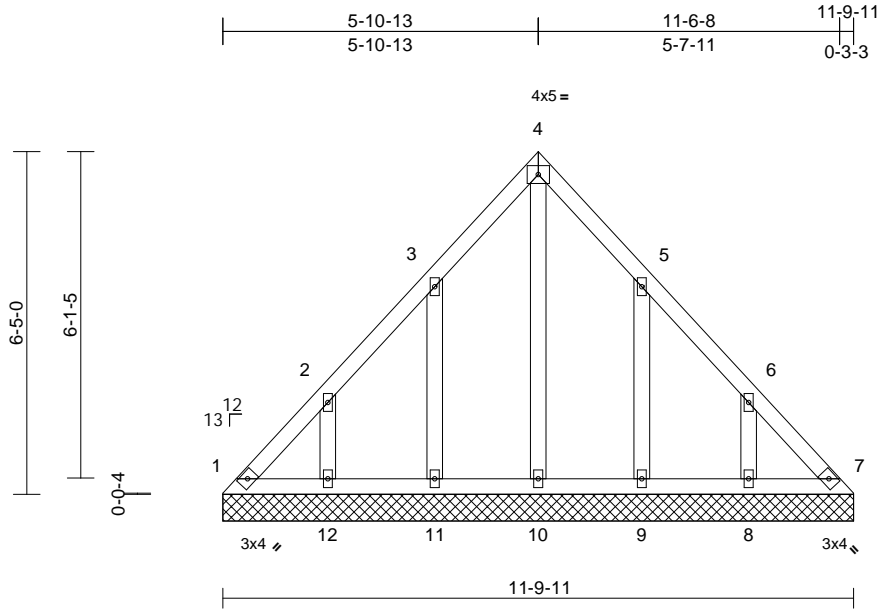

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horiz(TL)	0.00	7	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 51 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=11-9-11, 7=11-9-11, 8=11-9-11, 9=11-9-11, 10=11-9-11, 11=11-9-11, 12=11-9-11
Max Horiz 1=162 (LC 4)
Max Uplift 1=55 (LC 6), 7=28 (LC 7), 8=132 (LC 9), 9=131 (LC 9), 11=132 (LC 8), 12=132 (LC 8)
Max Grav 1=137 (LC 17), 7=124 (LC 18), 8=208 (LC 16), 9=211 (LC 16), 10=153 (LC 18), 11=213 (LC 15), 12=207 (LC 15)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-199/135, 2-3=-129/88, 3-4=-101/121, 4-5=-87/99, 5-6=-102/51, 6-7=-176/99
BOT CHORD 1-12=-69/145, 11-12=-69/145, 10-11=-69/145, 9-10=-69/145, 8-9=-69/145, 7-8=-69/145

WEBS 2-12=-161/150, 3-11=-174/157, 6-8=-162/151, 5-9=-173/156, 4-10=-114/9

NOTES
1) Unbalanced roof live loads have been considered for this design.
2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 55 lb uplift at joint 1, 28 lb uplift at joint 7, 132 lb uplift at joint 12, 132 lb uplift at joint 11, 132 lb uplift at joint 8 and 131 lb uplift at joint 9.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:55

Job Avalon -	Truss V1	Truss Type Valley	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389240
-----------------	-------------	----------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:57
ID:GjwGp2GESjMxqT69vMma7ZzX474-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC7f

Page: 1

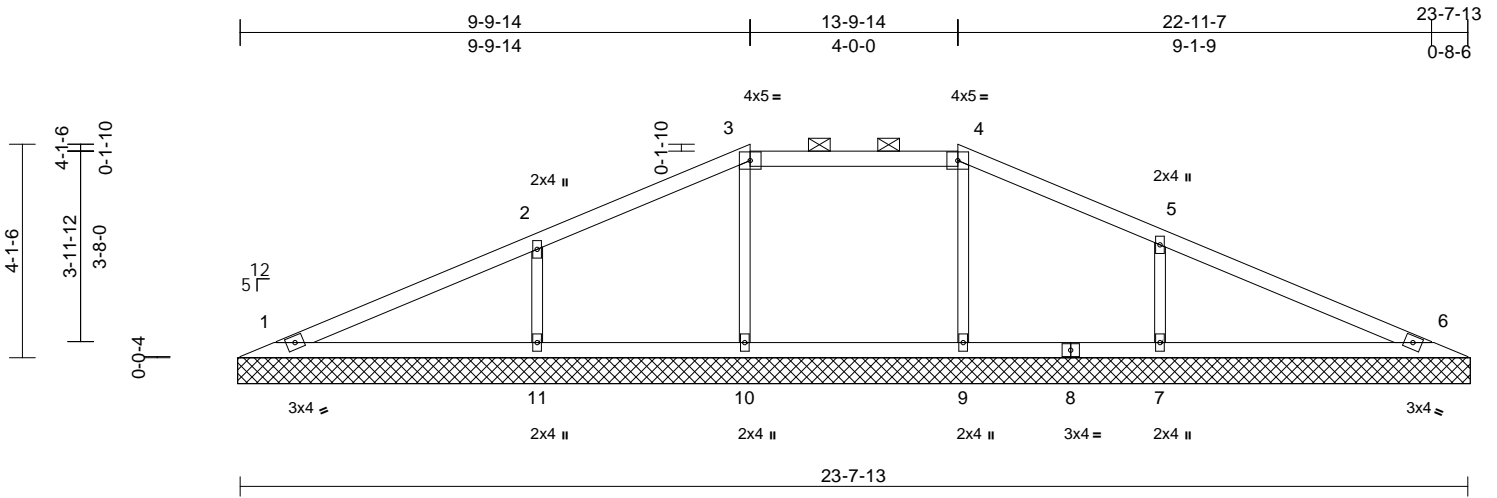

Scale = 1:44.4

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.32	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.18	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.09	Horiz(TL)	0.00	6	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 63 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=23-9-0, 6=23-9-0, 7=23-9-0, 9=23-9-0, 10=23-9-0, 11=23-9-0
Max Horiz 1=66 (LC 12)
Max Uplift 1=-12 (LC 8), 6=-27 (LC 9), 7=-139 (LC 9), 9=-15 (LC 5), 10=-18 (LC 4), 11=-138 (LC 8)
Max Grav 1=190 (LC 1), 6=199 (LC 1), 7=498 (LC 1), 9=307 (LC 22), 10=327 (LC 21), 11=490 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-89/77, 2-3=-86/98, 3-4=-27/99, 4-5=-86/87, 5-6=-69/63
BOT CHORD 1-11=-1/54, 10-11=-1/54, 9-10=0/54, 7-9=-2/55, 6-7=-2/55
WEBS 3-10=-253/66, 2-11=-374/191, 4-9=-240/60, 5-7=-378/192

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Provide adequate drainage to prevent water ponding.

- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 12 lb uplift at joint 1, 27 lb uplift at joint 6, 18 lb uplift at joint 10, 138 lb uplift at joint 11, 15 lb uplift at joint 9 and 139 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:55

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	I66389241
Avalon -	V2	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:57
ID:oWMucifChQD4CJXzLeFLbMzX475-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

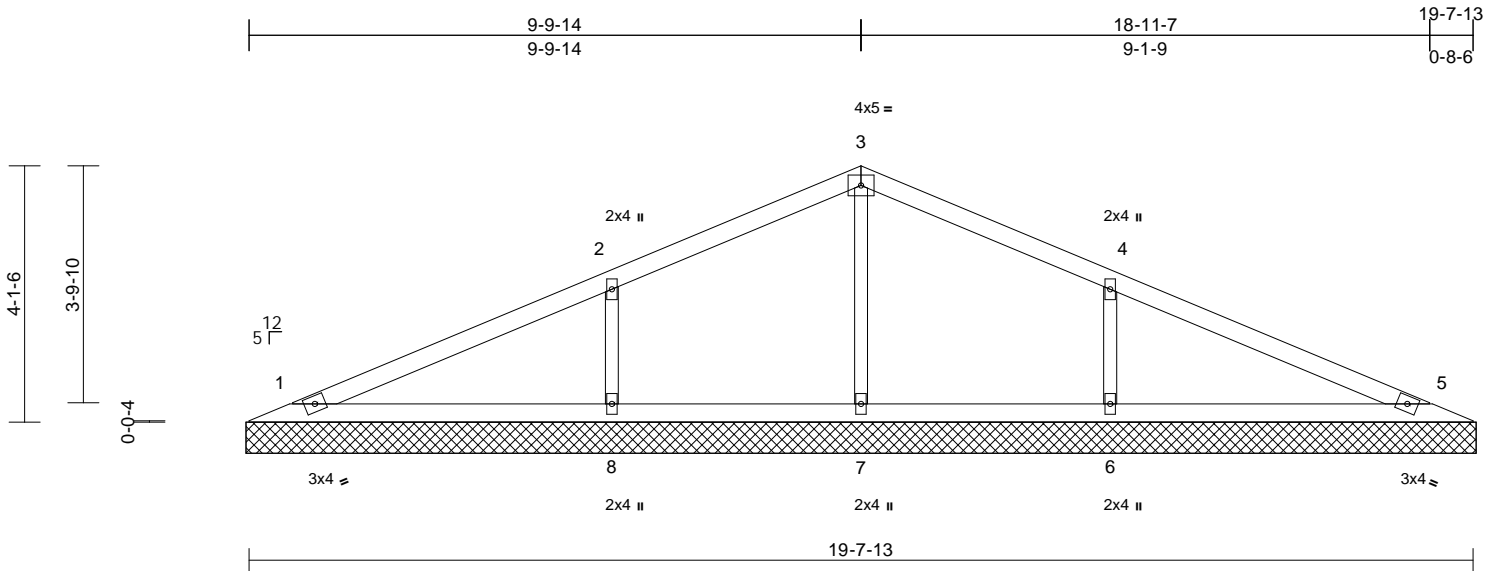

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.17	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.08	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 51 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=19-9-0, 5=19-9-0, 6=19-9-0, 7=19-9-0, 8=19-9-0
Max Horiz 1=67 (LC 12)
Max Uplift 1=-15 (LC 8), 5=-26 (LC 9), 6=-138 (LC 9), 8=-138 (LC 8)
Max Grav 1=193 (LC 1), 5=193 (LC 1), 6=508 (LC 22), 7=245 (LC 1), 8=508 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-87/79, 2-3=-90/100, 3-4=-90/90, 4-5=-67/66
BOT CHORD 1-8=-2/54, 7-8=-2/54, 6-7=-2/54, 5-6=-2/54
WEBS 3-7=-191/16, 2-8=-386/193, 4-6=-386/193

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 4-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 - 8) All bearings are assumed to be SPF No.2 .
 - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 15 lb uplift at joint 1, 26 lb uplift at joint 5, 138 lb uplift at joint 8 and 138 lb uplift at joint 6.
 - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:55

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389242
Avalon -	V3	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:57
 ID:oWwMucifChQD4CJXzLeFLbMzX475-RfC?PsB70Hq3NSgPqnl8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

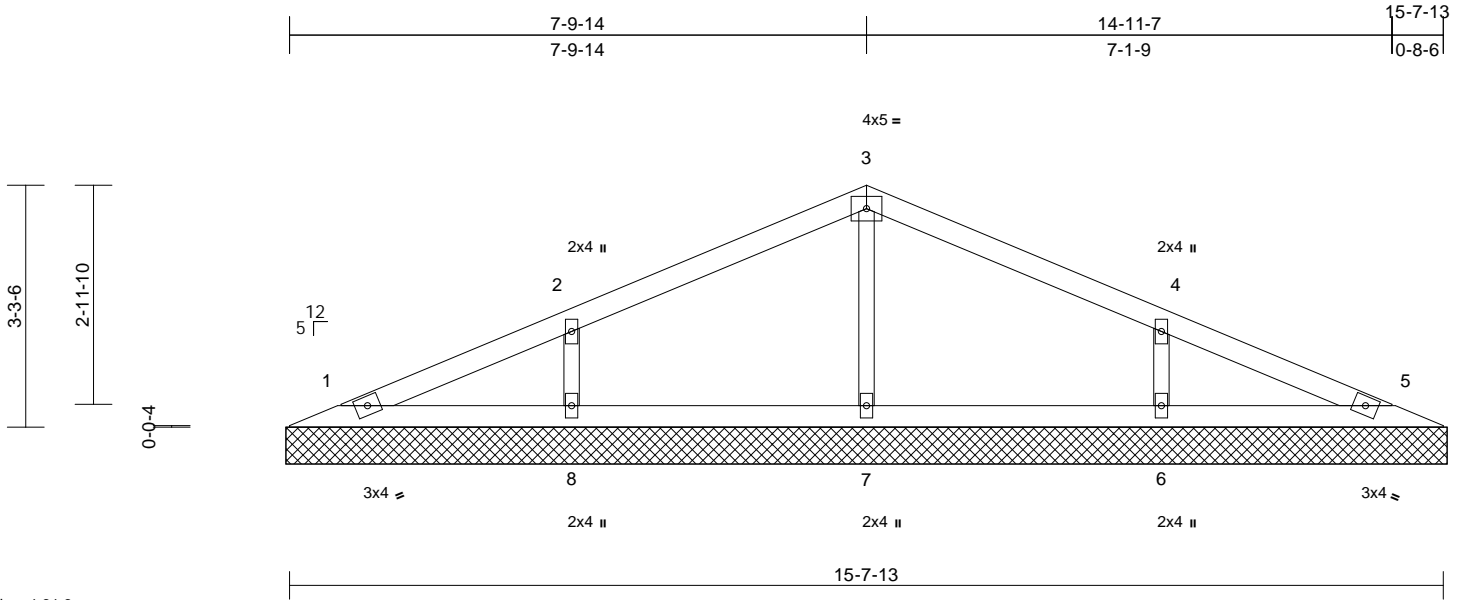

Scale = 1:31.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.06	Horiz(TL)	0.00	5	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 39 lb	FT = 10%

LUMBER
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 OTHERS 2x3 SPF No.2

BRACING
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=15-9-0, 5=15-9-0, 6=15-9-0, 7=15-9-0, 8=15-9-0
 Max Horiz 1=52 (LC 12)
 Max Uplift 1=-10 (LC 9), 5=-9 (LC 9), 6=-107 (LC 9), 8=-107 (LC 8)
 Max Grav 1=111 (LC 1), 5=111 (LC 1), 6=381 (LC 22), 7=313 (LC 1), 8=381 (LC 21)

FORCES (lb) - Maximum Compression/Maximum Tension
 TOP CHORD 1-2=-70/46, 2-3=-87/78, 3-4=-87/66, 4-5=-53/36
 BOT CHORD 1-8=0/42, 7-8=0/42, 6-7=0/42, 5-6=0/42
 WEBS 3-7=-234/42, 2-8=-298/150, 4-6=-298/150

NOTES
 1) Unbalanced roof live loads have been considered for this design.
 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 4) Gable requires continuous bottom chord bearing.
 5) Gable studs spaced at 4-0-0 oc.
 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
 8) All bearings are assumed to be SPF No.2 .
 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 10 lb uplift at joint 1, 9 lb uplift at joint 5, 107 lb uplift at joint 8 and 107 lb uplift at joint 6.
 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
 RELEASE FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 DEVELOPMENT SERVICES
 LEE'S SUMMIT, MISSOURI
 01/29/2026 3:02:55

Job Avalon -	Truss V4	Truss Type Valley	Qty 1	Ply 1	Avalon - Contemporary Job Reference (optional)	166389243
-----------------	-------------	----------------------	----------	----------	---	-----------

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:58
ID:oWMucifChQD4CJXzLeFLbMzX475-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?f

Page: 1

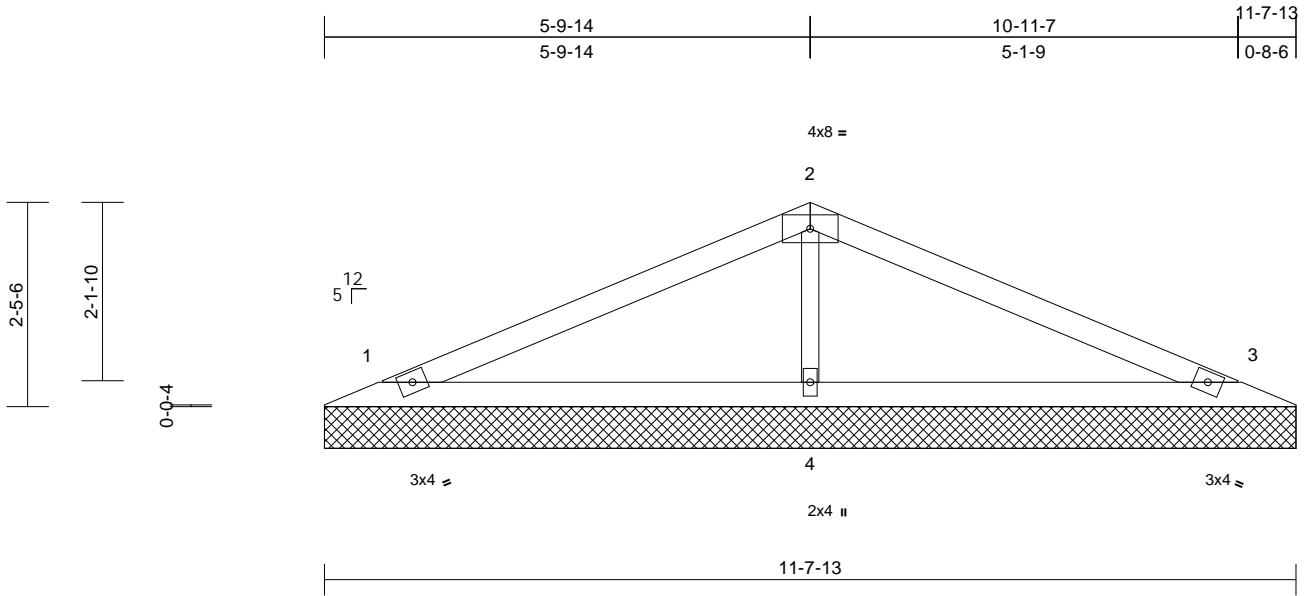

Scale = 1:27.6

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.37	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.22	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.07	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-S							Weight: 27 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=11-7-13, 3=11-7-13, 4=11-7-13
Max Horiz 1=-38 (LC 13)
Max Uplift 1=-44 (LC 8), 3=-50 (LC 9), 4=-32 (LC 8)
Max Grav 1=211 (LC 21), 3=211 (LC 22), 4=507 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-108/56, 2-3=-108/42
BOT CHORD 1-4=-2/43, 3-4=-2/43
WEBS 2-4=-353/93

- NOTES**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - Gable requires continuous bottom chord bearing.
 - Gable studs spaced at 4-0-0 oc.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- All bearings are assumed to be SPF No.2 .
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 44 lb uplift at joint 1, 50 lb uplift at joint 3 and 32 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard



June 21, 2024

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)


MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
16023 Swingley Ridge Rd
Lee's Summit, MO 64080
816-424-0200 / MiTek-USA.com
01/29/2026 3:02:55

Job	Truss	Truss Type	Qty	Ply	Avalon - Contemporary	166389244
Avalon -	V5	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

Run: 8.73 S Apr 25 2024 Print: 8.730 S Apr 25 2024 MiTek Industries, Inc. Thu Jun 20 15:24:58
ID:oWMucifChQD4CJXzLeFLbMzX475-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

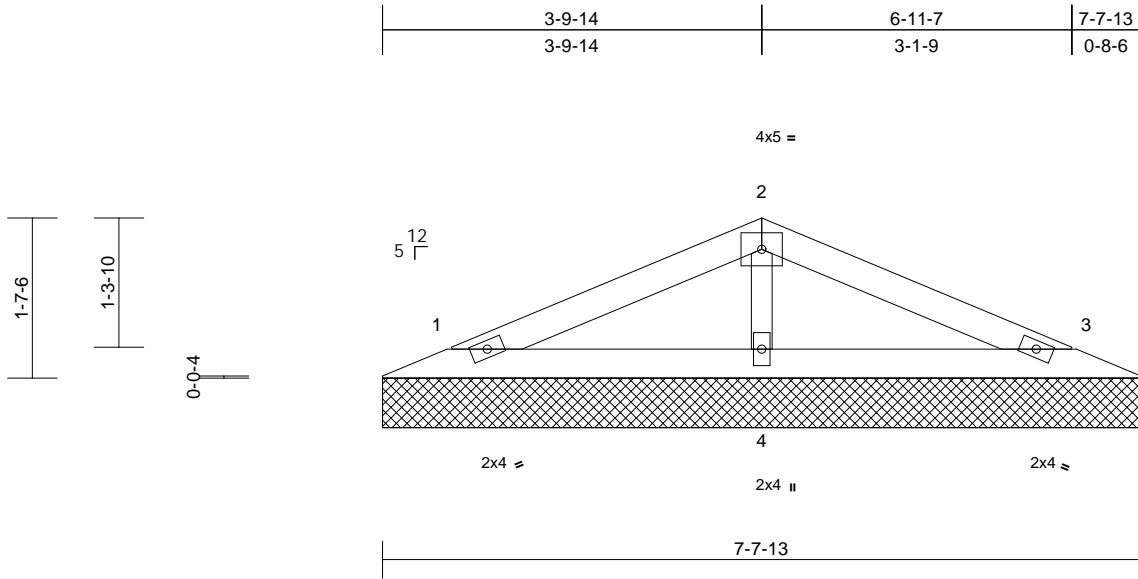

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.17	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0*	Rep Stress Incr	YES	WB	0.04	Horiz(TL)	0.00	3	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-P							Weight: 17 lb	FT = 10%

LUMBER
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 1=7-7-13, 3=7-7-13, 4=7-7-13
Max Horiz 1=-23 (LC 13)
Max Uplift 1=-33 (LC 8), 3=-37 (LC 9), 4=-7 (LC 8)
Max Grav 1=142 (LC 1), 3=142 (LC 1), 4=278 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=-57/33, 2-3=-57/23
BOT CHORD 1-4=-1/24, 3-4=-1/24
WEBS 2-4=-200/54

- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) All bearings are assumed to be SPF No.2 .
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 1, 37 lb uplift at joint 3 and 7 lb uplift at joint 4.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- LOAD CASE(S)** Standard

- NOTES**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) Gable studs spaced at 4-0-0 oc.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.



June 21, 2024




WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcsccomponents.com)

MiTek®
RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:55

Symbols

PLATE LOCATION AND ORIENTATION

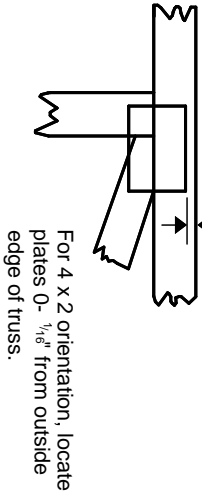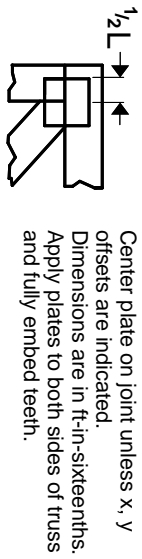

* Plate location details available in MITtek software or upon request.

PLATE SIZE


4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION




BEARING



Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

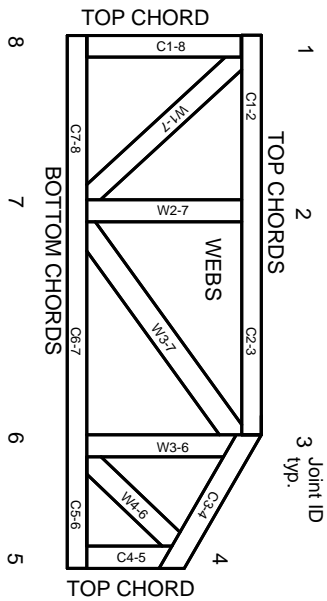

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1-1988, ESR-2-362, ESR-2-685, ESR-3-282
ESR-4-722, ESL-1-388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on Lumber values established by others.

© 2023 MITtek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/29/2026 3:02:55

