



Project	GARAGE FDT'N. - 4094 SWP2402			Sheet No.	1 of 2
Made By	Checked By			Date	8/22/14
Subject	PLAN -			Project No.	

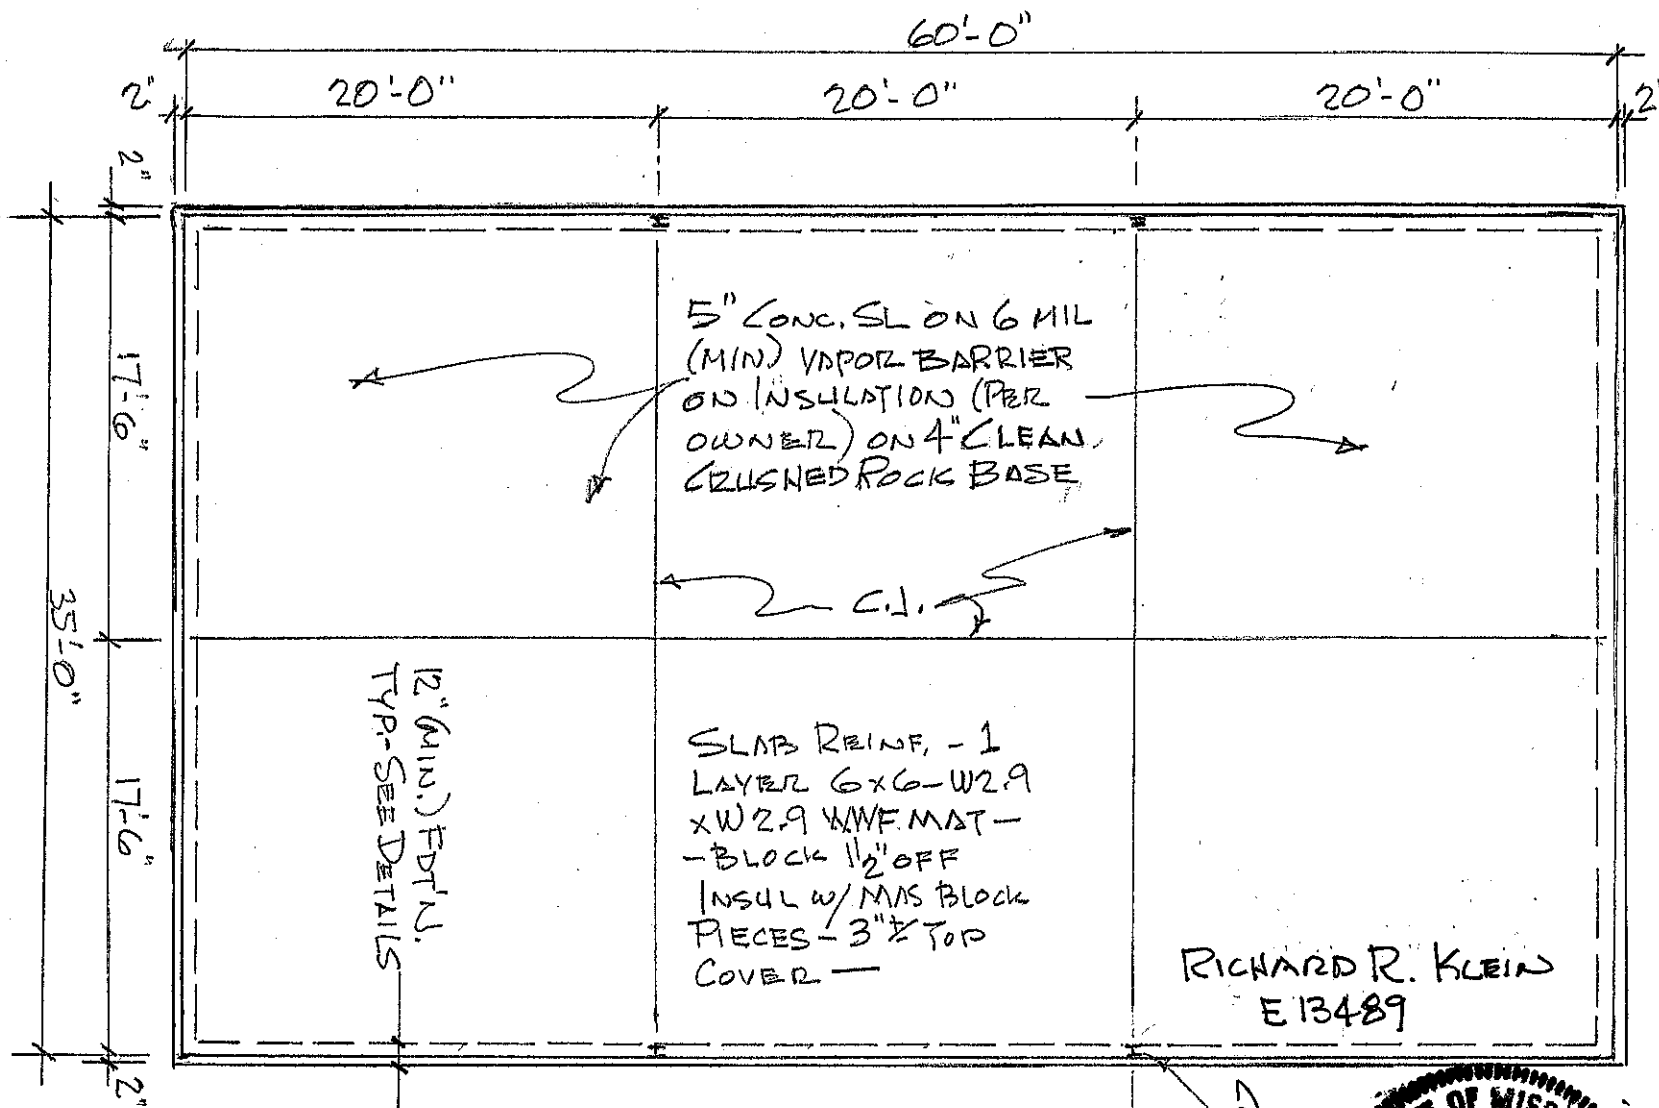

— FDT'N. PLAN —
SC 1/8" = 1'-0"



COLS & BLD'G FZ'ING PER PERMS BLD'G. MANUF'R. TYP. -

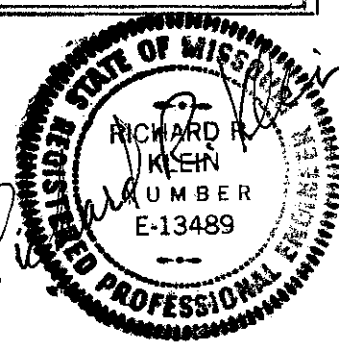


8/22/14

NOTES:

- 1500 PSF ASSUMED ALLOWABLE SOIL BEARING.
- CONCRETE 28 DAY COMP. STRENGTH FDTN. - 3500 PSI
SLAB - 4,000 PSI
- REINFORCING - ASTM A65, GR. 60
LAP 42 DIA. (MIN.) AT ANY SPLICES
- WWF - ASTM A185 w/ 6" MIN. LAPS @ SPLICES - CHAIR ON CONC. BRICKS
- ANCHOR RODS - ASTM A36 ALL THREAD - MIN. - EPOXY SET
DRILL & CLEAN HOLES PER EPOXY MANUF'R. RECOMMENDATIONS.
- EPOXY - HILTI, SIMPSON STRONG TIE OR OTHER EQUIVALENT PRODUCTS.
- CONTROL JOINTS (C.J.) - CUT 1" DEEP WITHIN 12 HOURS OF SLAB POUR - (OR HAND TOOL)

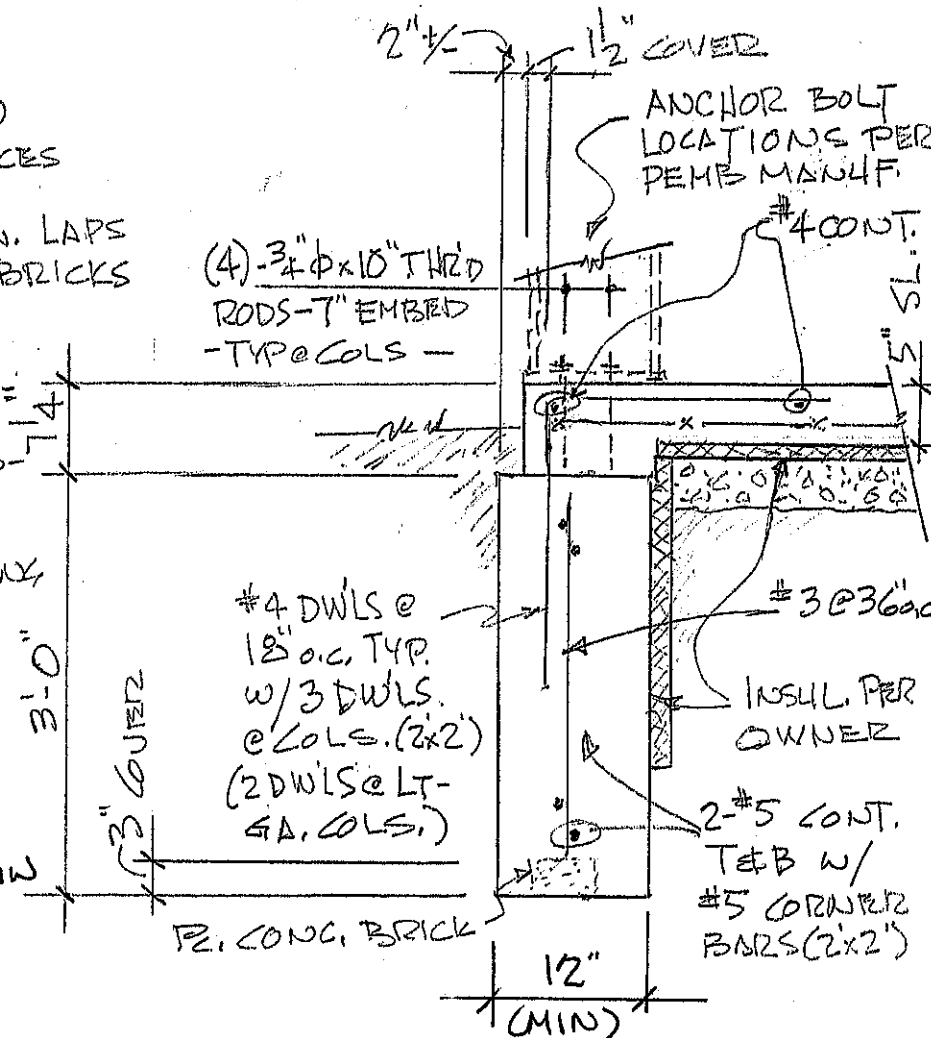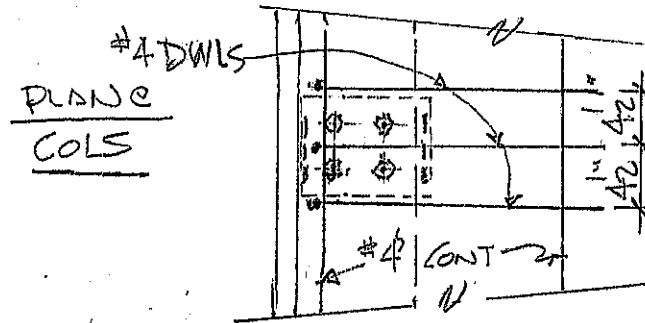

RICHARD R. KLEIN
E 13489
8/22/14

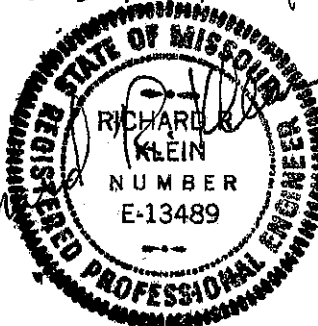

Project	GARAGE FDTN - 4094 SW PRYOR	Sheet No.	2 of 2
Made By		Date	8/22/14
Checked By		Project No.	
Subject	NOTES, DETAILS (SC34=1'-0")		