

conduit & wire size for Generator / ATS

RECEIVED

OCT 7 2015

Planning & Codes Admin

RELEASED FOR CONSTRUCTION

AS NOTED ON PLANS REVIEW
CODES ADMINISTRATION
LEE'S SUMMIT, MISSOURI

BY [Signature]
DATE 10/2/15

3/4" Gal - RT for alarms
3/4" Gal - RT for Power Supply / Break Appr
2" ATS - RT cabinet
1" outside eqpt to RT
for grounding
(2) 4" CONDUITS USING 36"
SWEEPS ON ELBOWS
GOING INTO THE CABINET

Pole

100 amp service to RT cabinet pole # 917200


Approximately 100' from cabinet

MGE service line

Locate MH in easement
48" x 48"
36" deep
Add 2" of gravel to manhole

(2) 4" CONDUITS


Verify

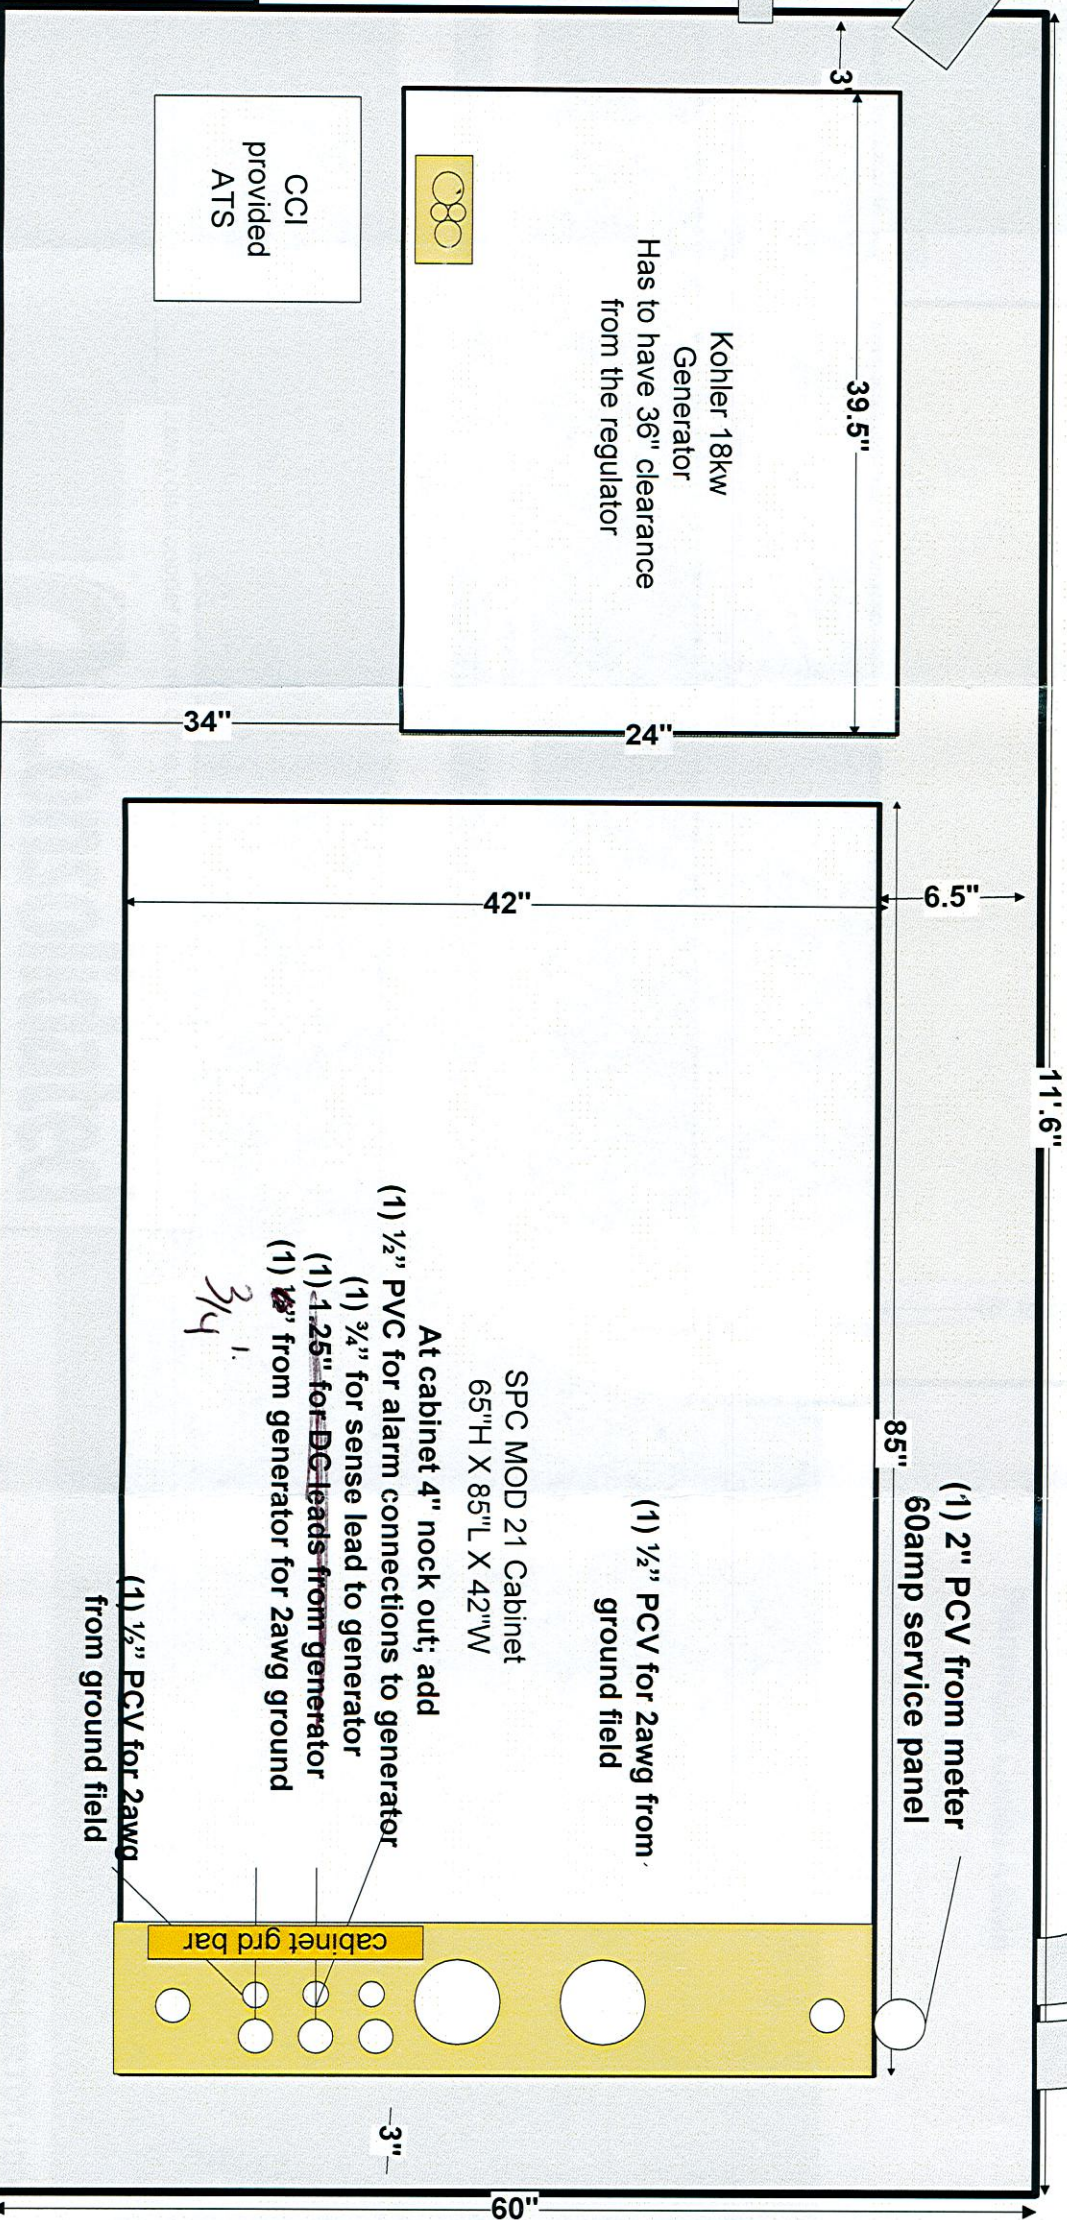


Cabinet has (1) Tellabs 1150 OLT

ISSUE: 1 Addition of JKVRT01 cabinet

DWG: JKVMO-RT01-100
SH 1 OF 3
REV. 3

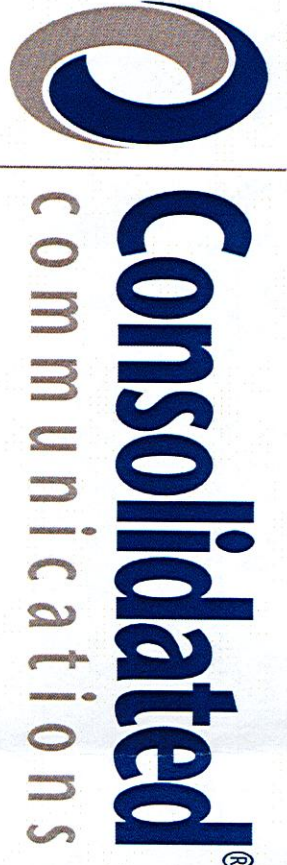


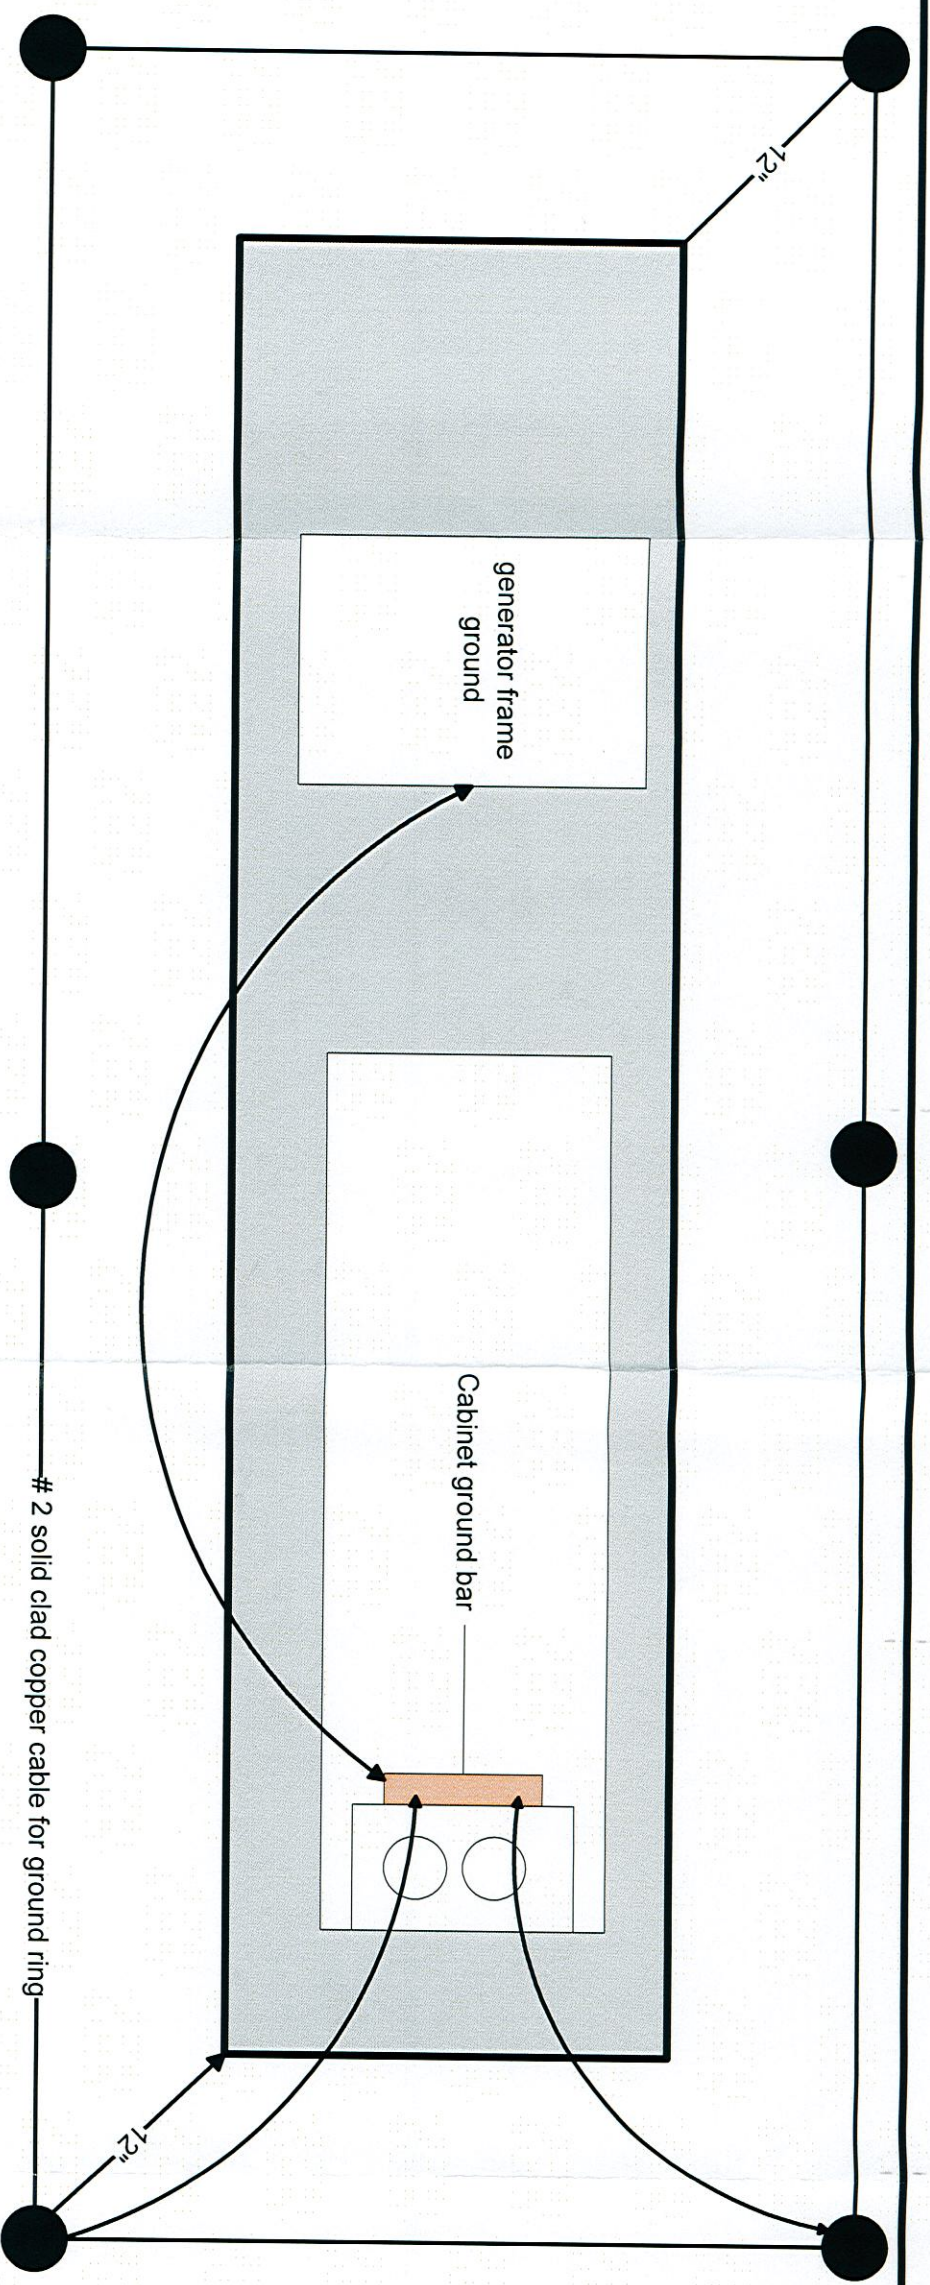

RELEASED FOR CONSTRUCTION
 AS NOTED ON PLANS REVIEW
 CODES ADMINISTRATION
 LEE'S SUMMIT, MISSOURI
 BY LF
 DATE 10/7/15

RECEIVED
 OCT 7 2015

Planning & Codes Admin

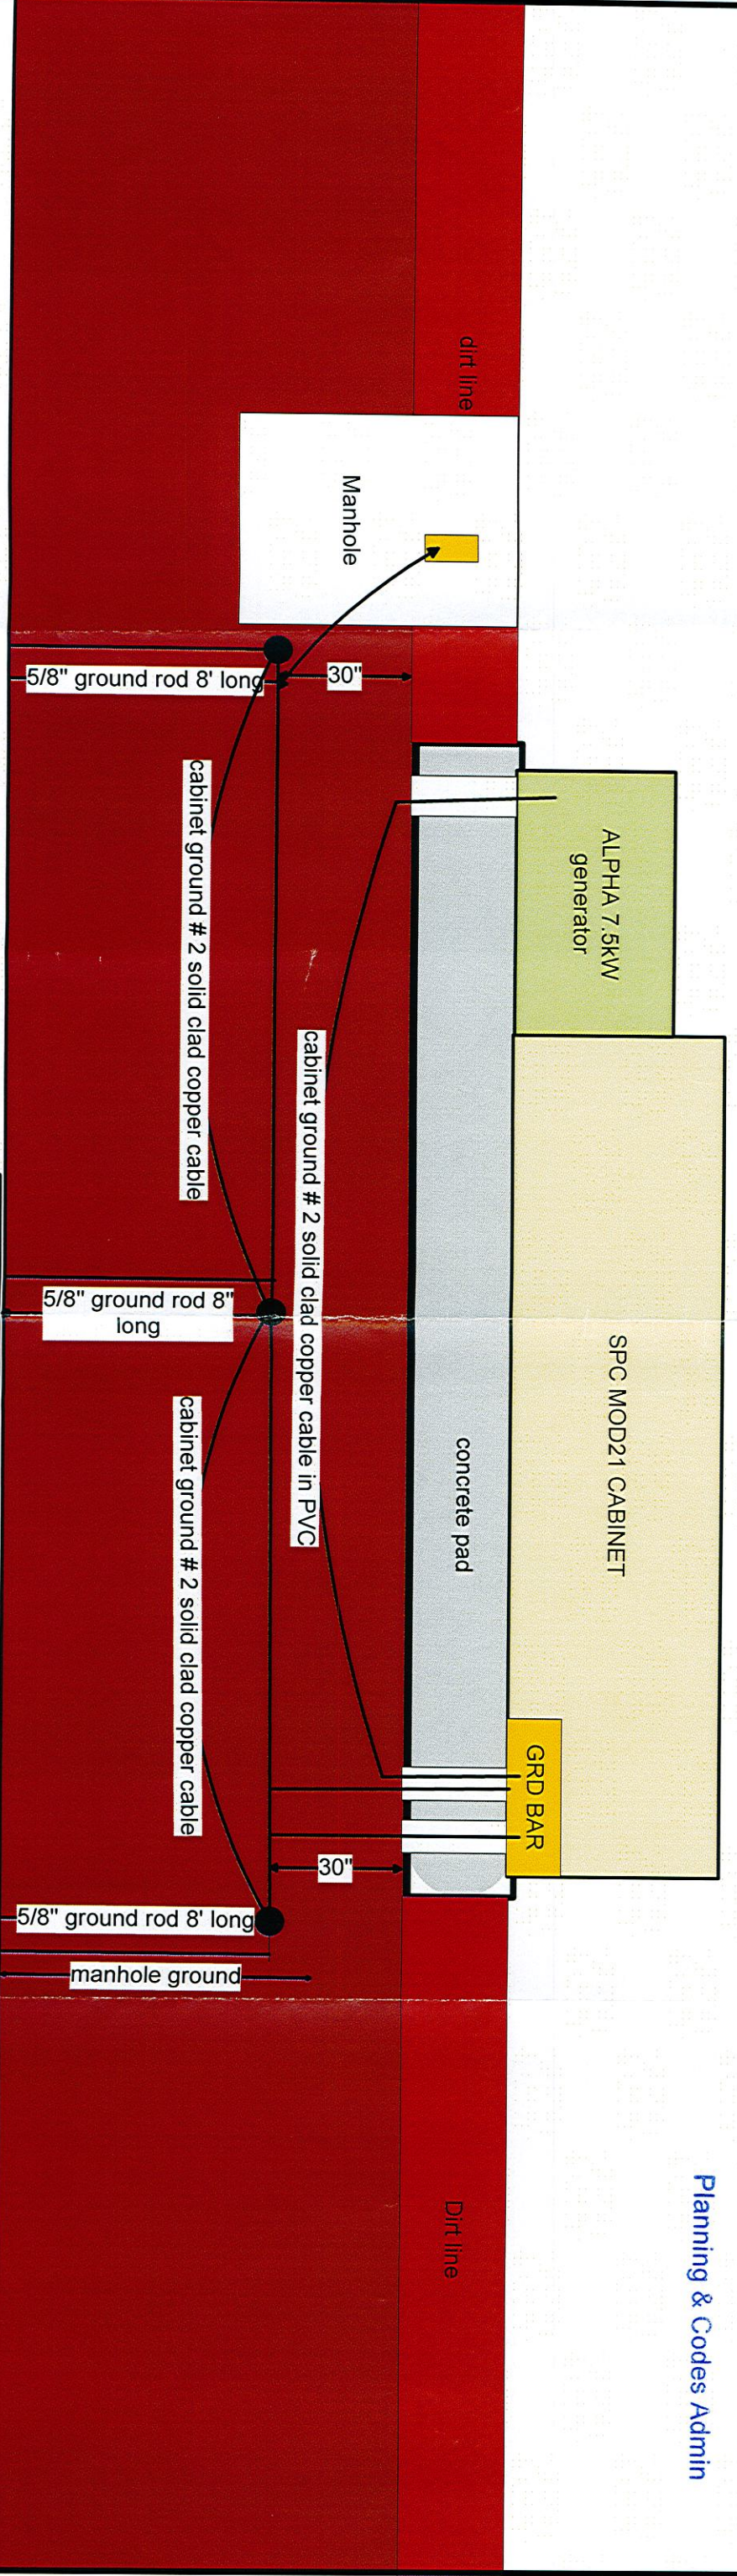

ISSUE: 1
 Addition of JKVMORT01 cabinet



DWG: RPKS-RT01-100
 SH 3 OF 3 REV. 1