
RESIDENTIAL ENGINEERING SERVICES, LLC SHOP DRAWING / SUBMITTAL REVIEW

## **APPROVED**


SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, **FABRICATION PROCESSES AND** TECHNIQUES OF CONSTRUCTION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

REVIEWED BY:
RESIDENTIAL ENGINEERING SERVICES, LLC

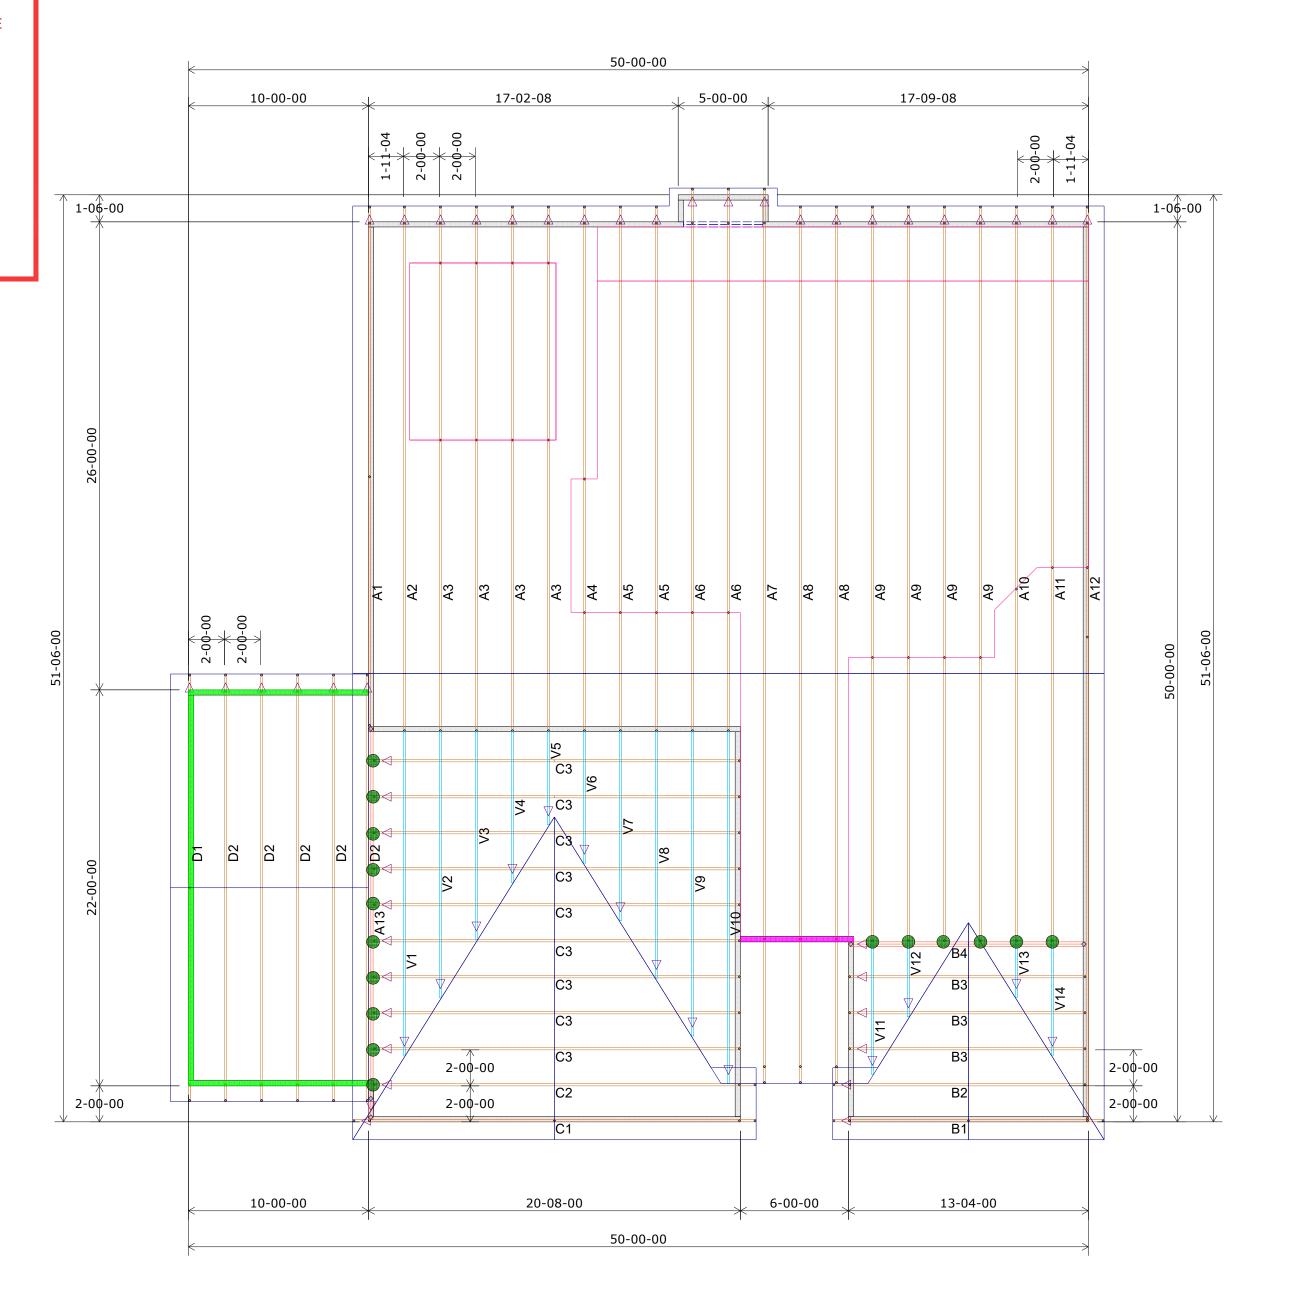

Roof Truss Layout Scale: 3/16" = 1'

	HANGER SCHEDULE	Quantity						
	LUS24	0		Creek				O.
	LUS26	0						
	HUS26	16		ney		MO		
	HHUS26-2	0		SUMMII HUMES  Lot 84 The Manor at Stoney Creek	4402 SW Amethyst Dr.			
	HGUS26-2	0	S				424	
	HGUS28-3	0	)MI	lanc	eth		746-	200
	LTHJA26	0	SUMMIT HOMES	ie M	Am	Lee's Summit	Chance 785-746-4240	Job # 400148
	TJC37	0	MIT	t Th	SW	Sun	e 7	400
	TJC57	0	JMI	ot 87	102	se's	nanc	# q
	HTS20	0	SI	Г	4	Le	C	Jo
Triangle denotes the left end of the Truss as it appears on the Engineered Drawings					ddress	State		
provided.			Customer	Job Name	Job Site Address	City,	Designer	3/20/2020



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

# of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871

