



4 LEFT SIDE ELEVATION
SCALE: 1/8" = 1'-0"

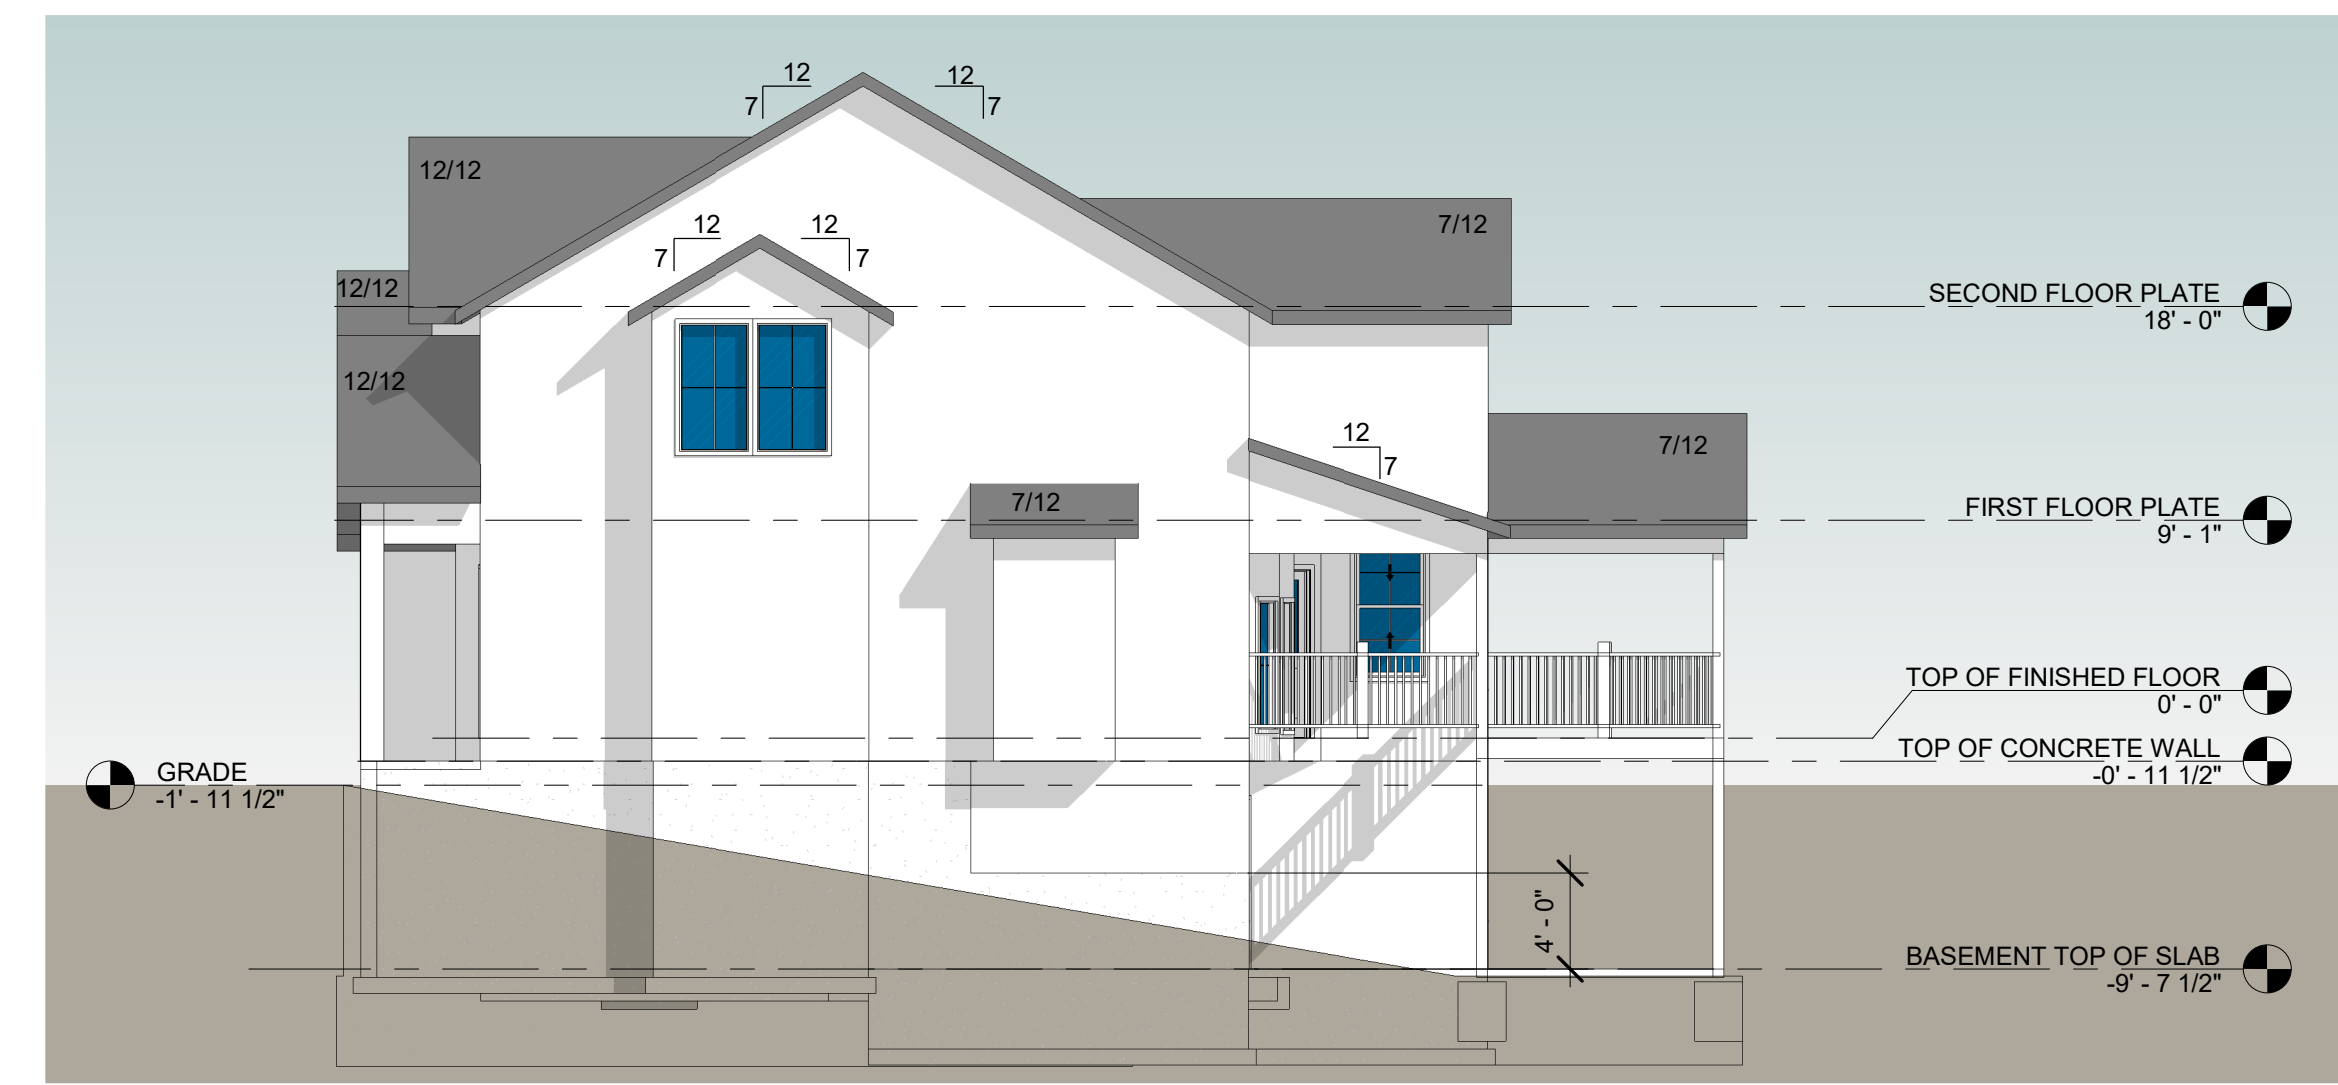


3 RIGHT SIDE ELEVATION
SCALE: 1/8" = 1'-0"

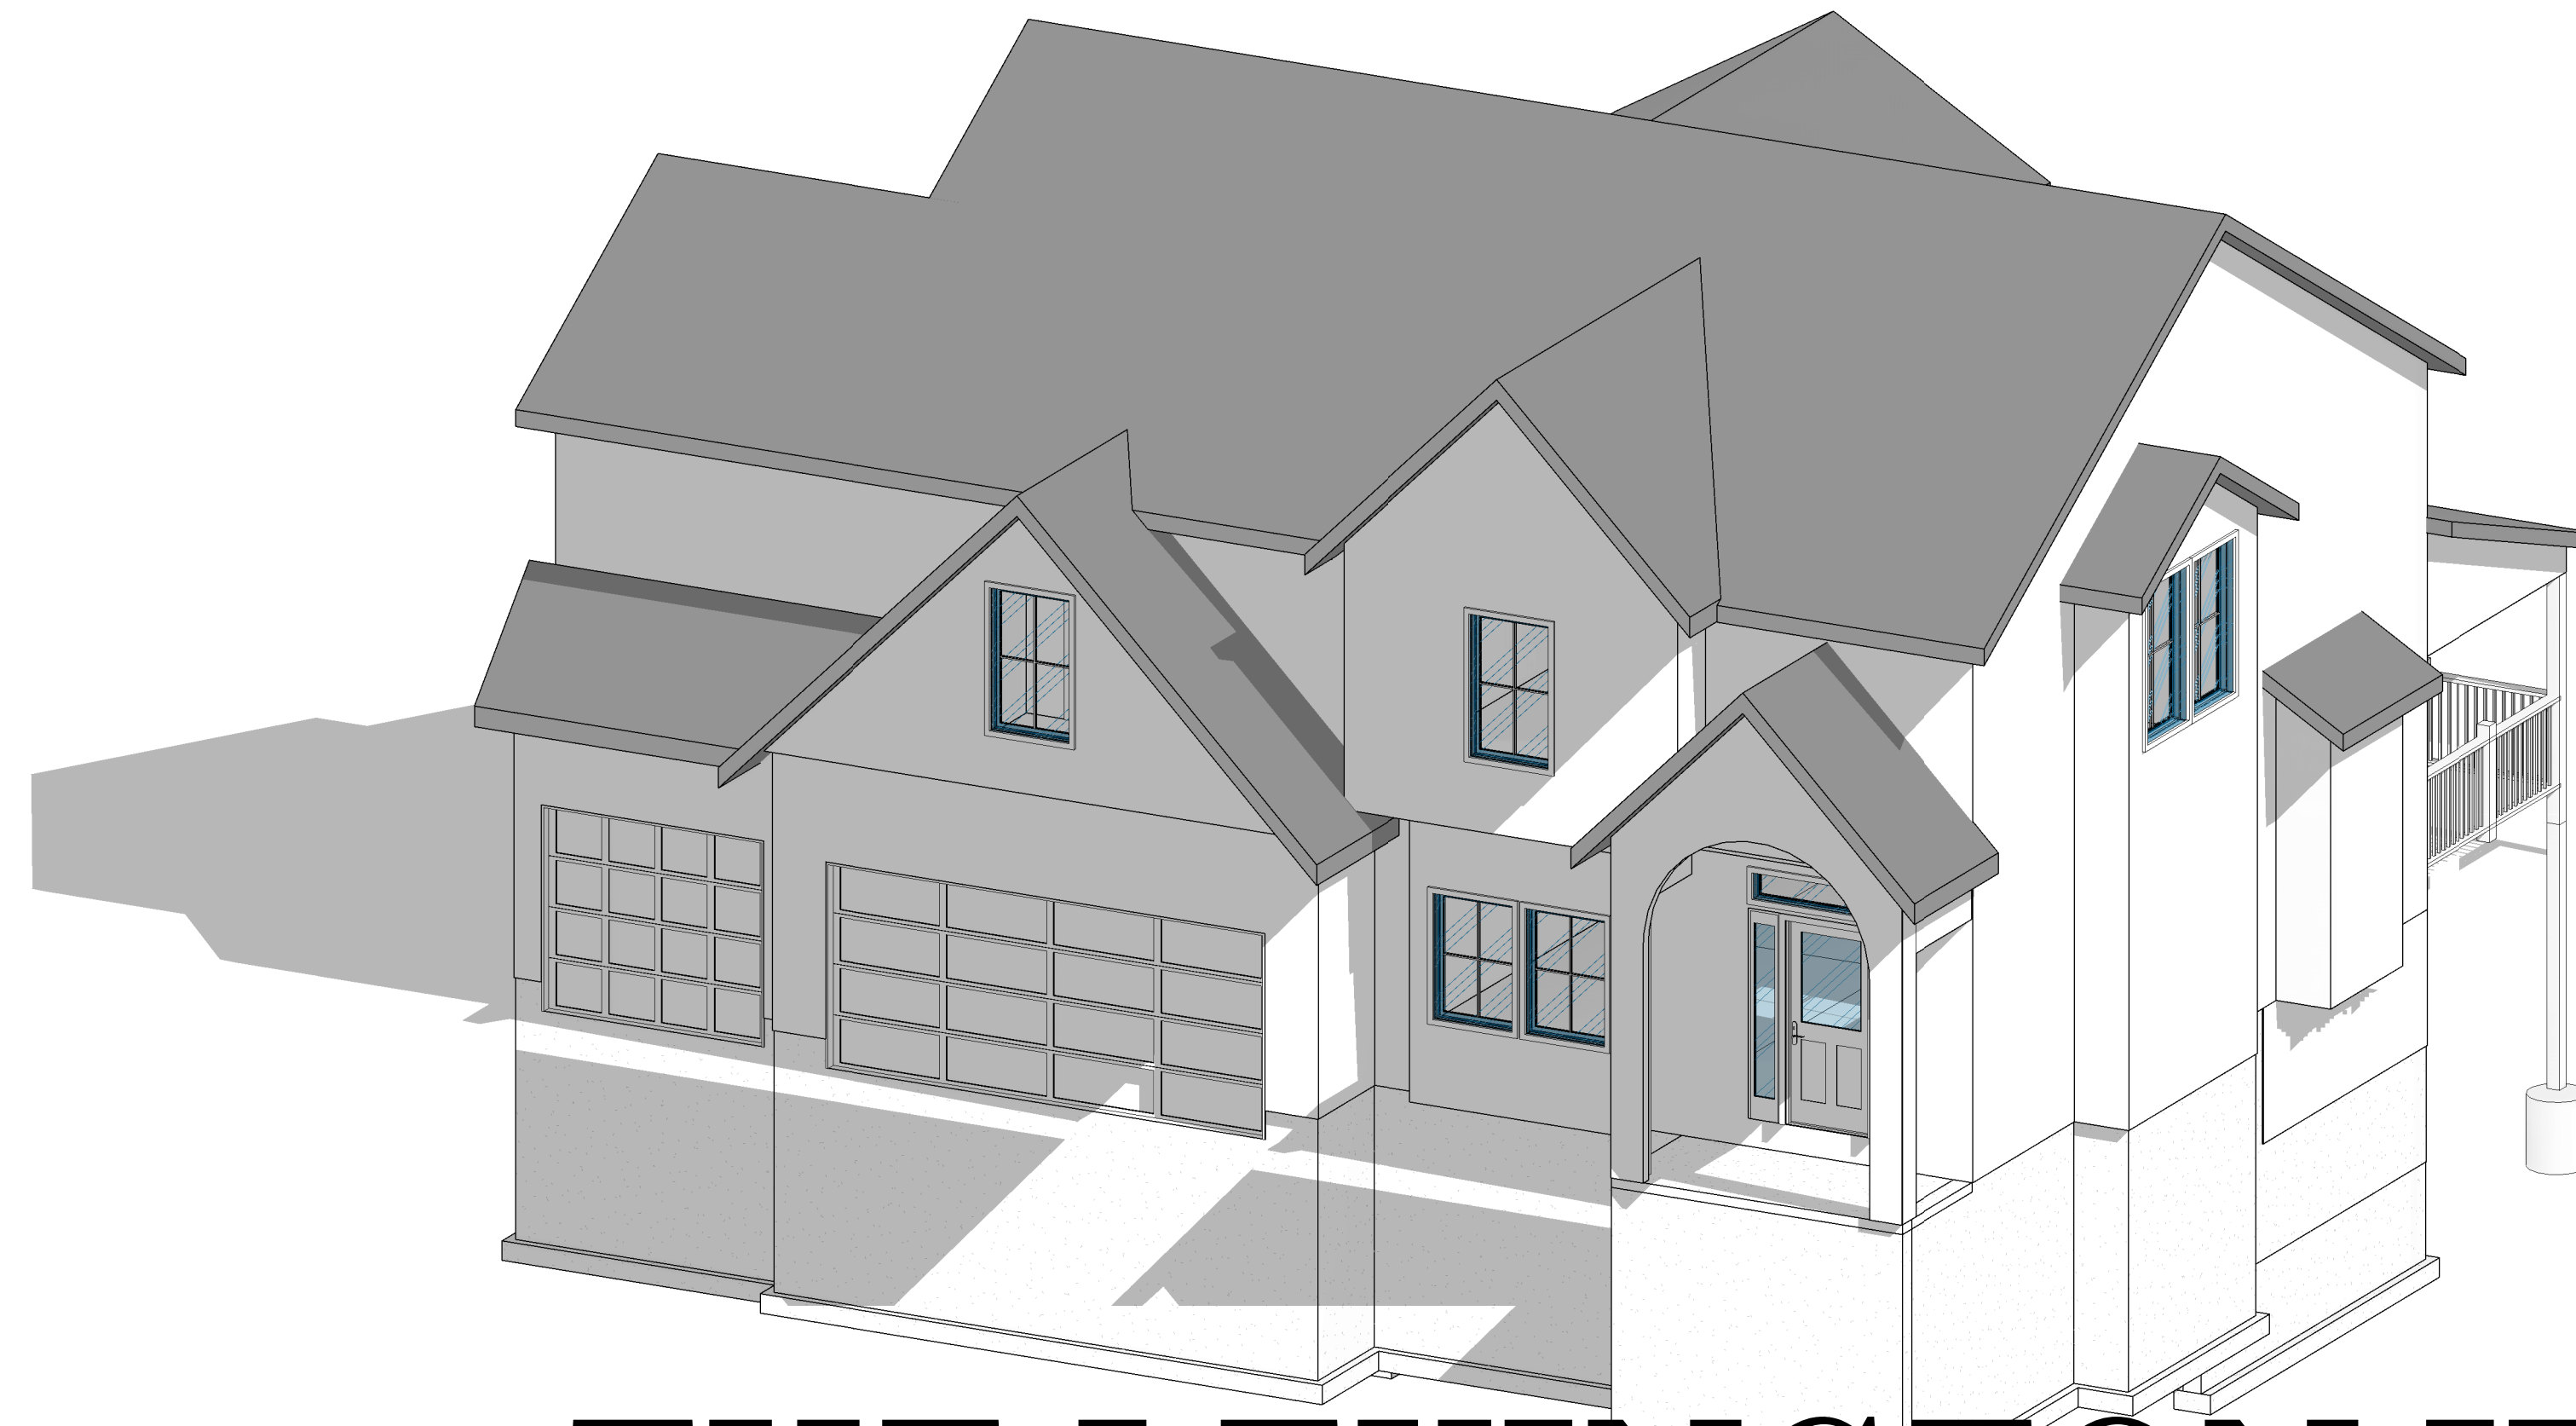


THE LEXINGTON II

2 REAR ELEVATION
SCALE: 1/8" = 1'-0"

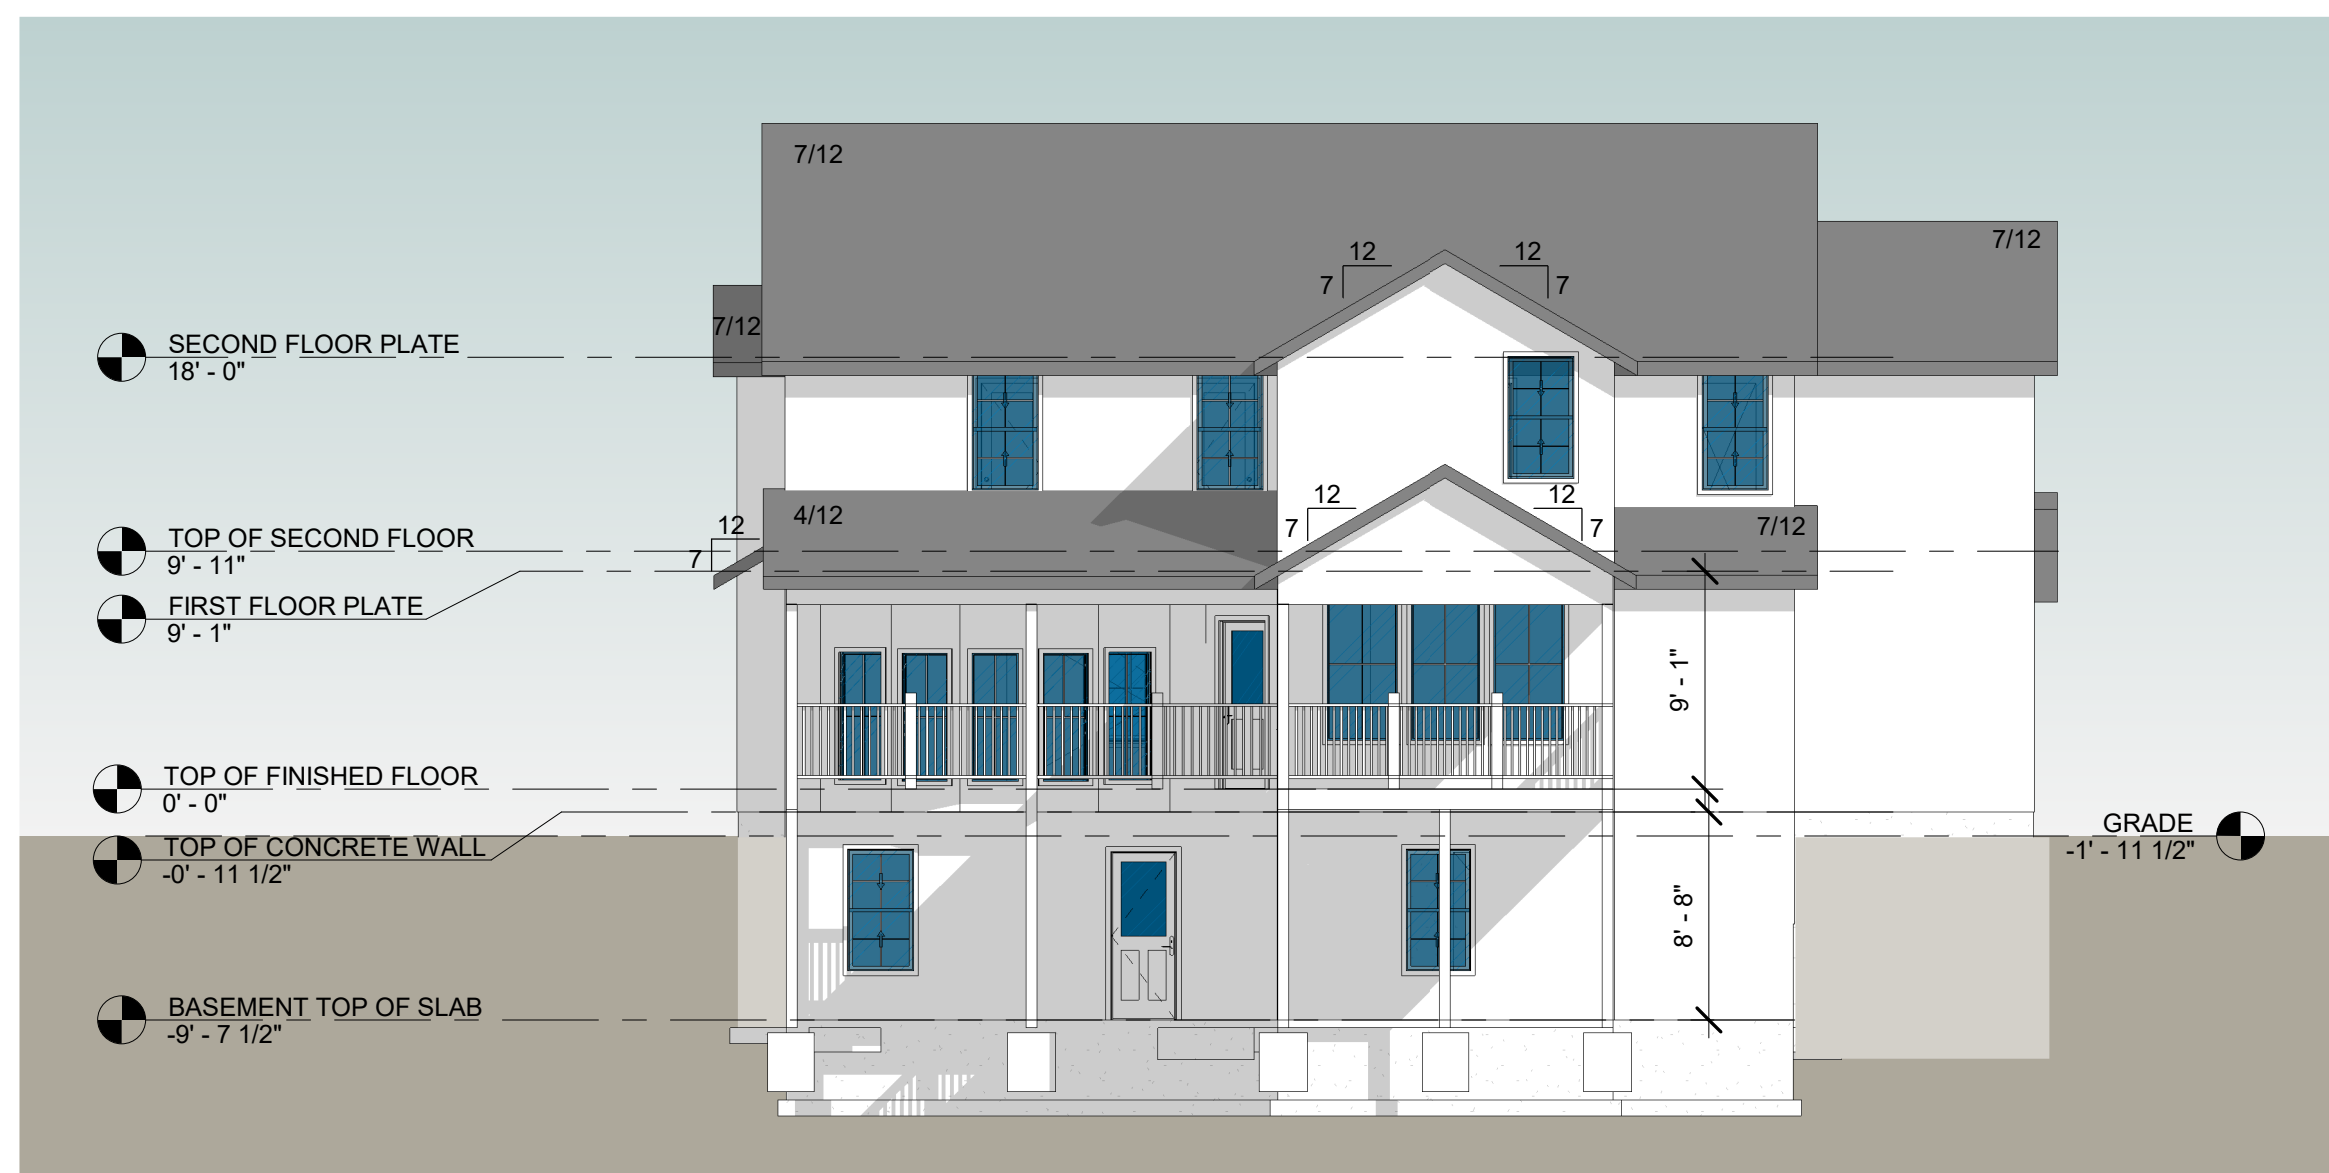

1 FRONT ELEVATION
SCALE: 1/8" = 1'-0"

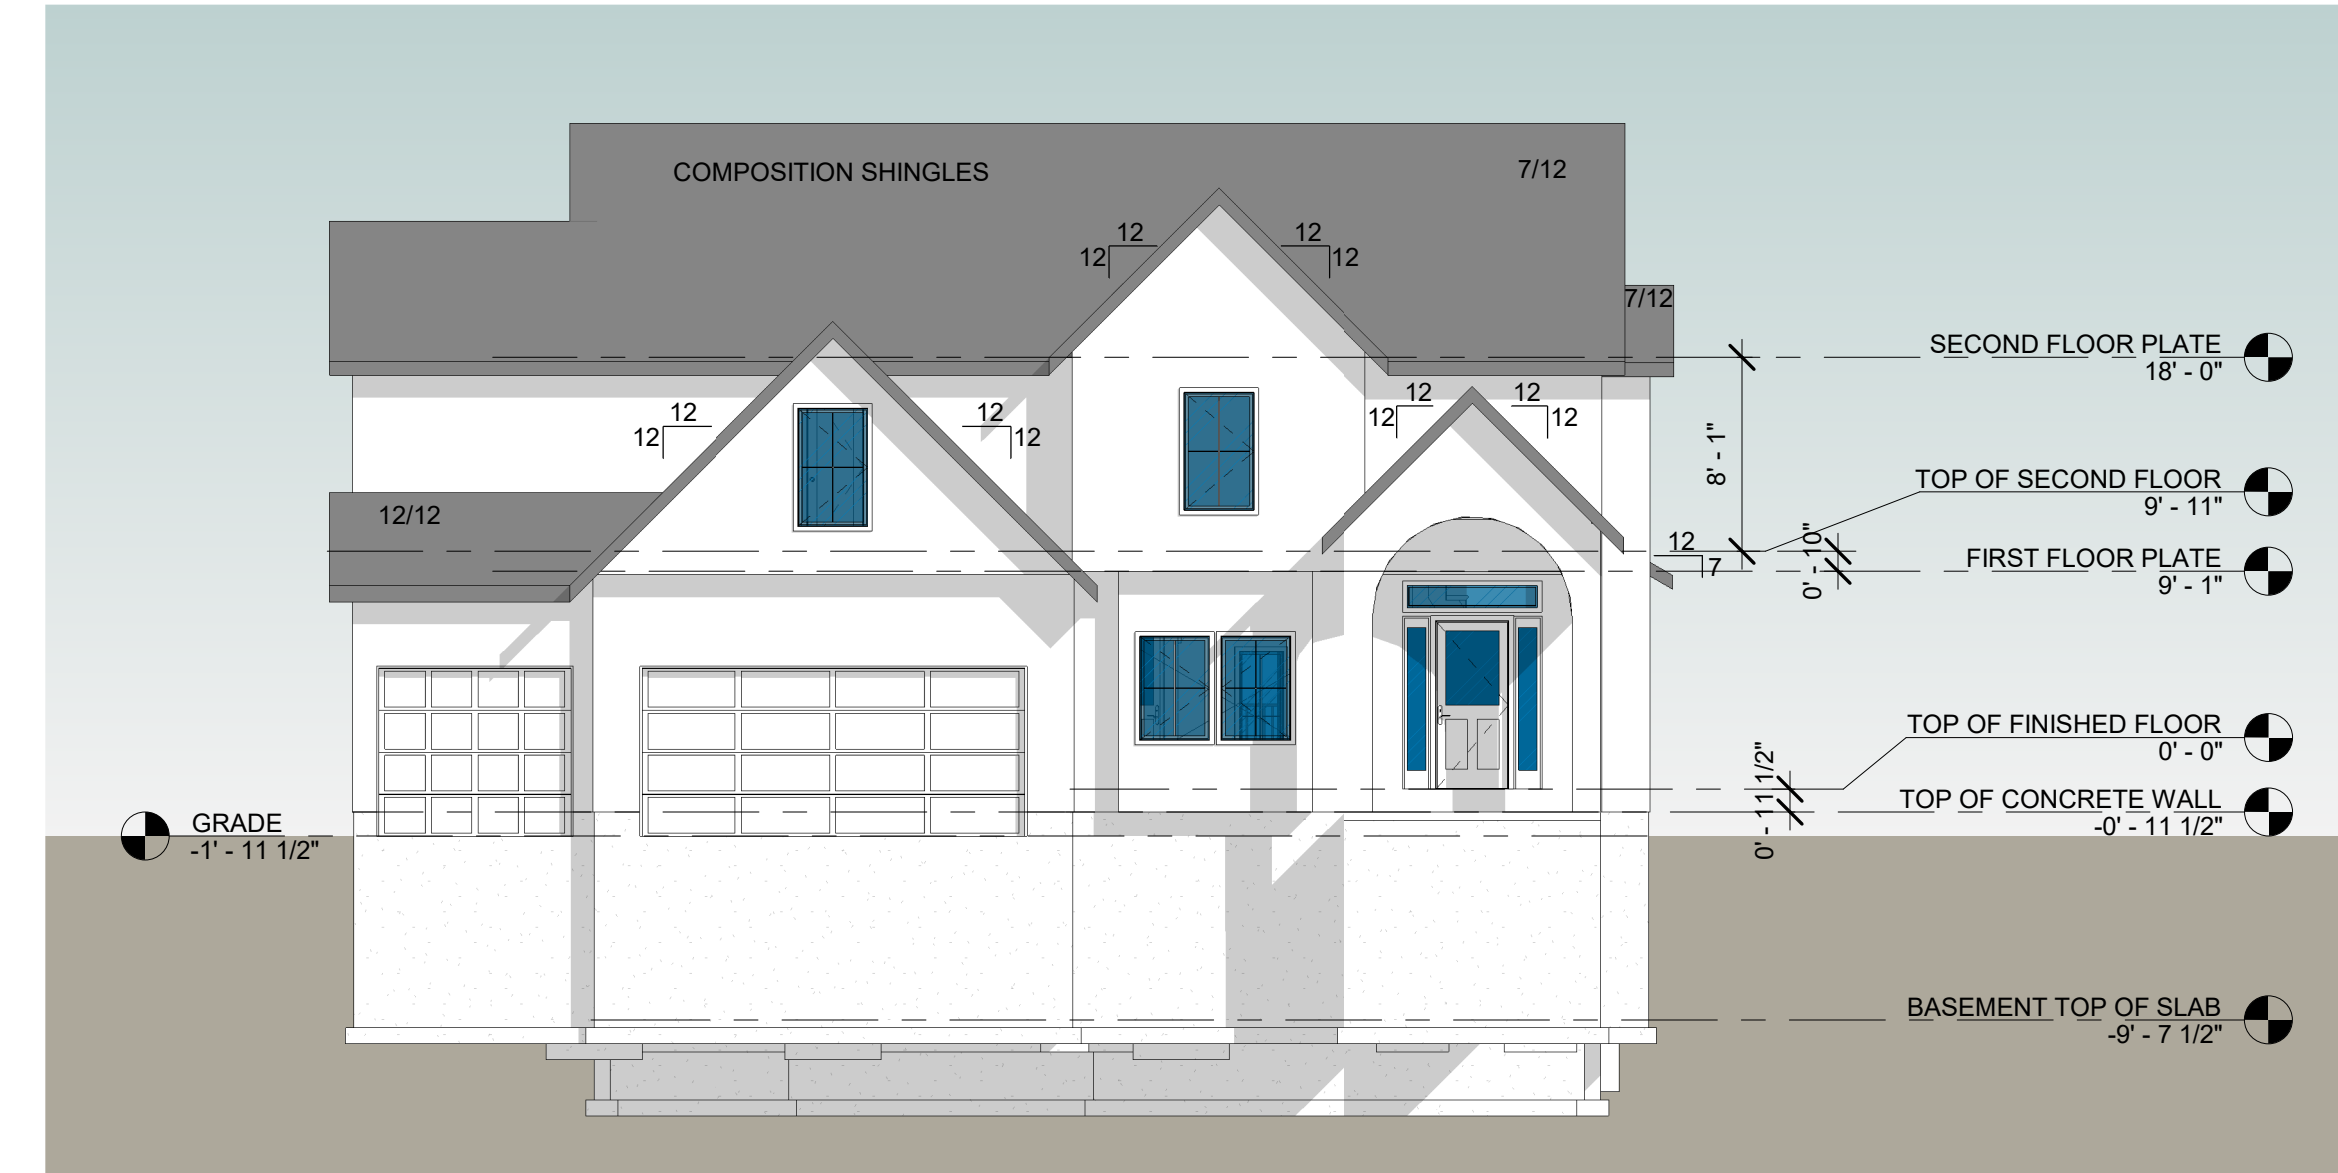

SHEET INDEX	
Sheet	Sheet Name
A100	COVER SHEET
S100	FOUNDATION PLAN
S101	FIRST FLOOR FRAMING PLAN
S102	SECOND FLOOR FRAMING PLAN
S103	ROOF FRAMING PLAN
S500	GENERAL NOTES
S501	DETAILS
S502	DETAILS
S503	DETAILS
S504	DETAILS
S505	DETAILS

SQUARE FOOTAGES	
Name	Area
FIRST FLOOR	1217 SF
SECOND FLOOR	1634 SF
GARAGE	643 SF
UNFINISHED BASEMENT	1091 SF
	4585 SF

Norton & Schmidt
 Consulting Engineers, L.L.C.
 311 East 11th Avenue
 North Kansas City, MO
 64116
 Phone: (816) 421-4232
 Fax: (816) 421-1866
 www.nortonschmidt.com

STATE OF MISSOURI
 BRANDON SCHWABAUER
 NUMBER
 PE-2015003020
 04/03/2020
 PROFESSIONAL ENGINEER

N&S JOB NUMBER: 2020-0255
 © 2020 Norton & Schmidt Consulting Engineers

PROJECT INFORMATION
 THE LEXINGTON II
 2521 SW River Trail Road
 Lee's Summit, Missouri

ISSUES & REVISIONS		
#	DATE	DESCRIPTION
	04/03/2020	PERMIT


DRAWN BY: MLR
 CHECKED BY: BSS
 ISSUED FOR:

SHEET TITLE
 COVER SHEET

SHEET NUMBER
 A100

FLOOR FRAMING PLAN NOTES

- NOTES ARE TYPICAL UNLESS NOTE NUMBER IS INSIDE OF CIRCLE. THEN THE NOTE REFERS TO A SPECIFIC LOCATION(S) MARKED ON THE PLAN.
- ALL LUMBER SHALL BE DF/L #2 OR BETTER U.N.O.
 - ALL HEADERS TO HAVE 3" MIN. END BEARING.
 - PROVIDE 3/4" TONGUE AND GROOVE WOOD STRUCTURAL PANEL SHEATHING FOR SUBFLOOR GLUED AND NAILED TO WOOD JOISTS WITH 8d NAILS AT 6"oc AT PANEL EDGES AND 12"oc AT NON-PANEL EDGES.
 - ALL EXTERIOR WALL FRAMING SHALL BE 2x4 OR 2x6 DOUG-FIR NO. 2 AT 16"oc.
 - PROVIDE 1/2" EXTERIOR GRADE PLYWOOD SHEATHING NAILED TO WOOD STUDS WITH 8d NAILS AT 6"oc AT PANEL EDGES AND 12"oc AT NON-PANEL EDGES.
 - ALL INTERIOR BEARING WALL FRAMING SHALL BE 2x4 OR 2x6 DOUG-FIR NO. 2 AT 16"oc.
 - DOUBLE FLOOR JOISTS UNDER ALL PARTITION WALLS RUNNING PARALLEL WITH JOISTS.
 - PROVIDE PROPER WALL INSULATION AS REQUIRED BY GOVERNING BUILDING CODE.
 - STAIRS SHALL HAVE A MAXIMUM RISE OF 7-3/4" AND MINIMUM TREAD OF 10". ALL RISERS AND TREADS TO BE EQUAL BETWEEN FLOORS.
 - PROVIDE WALL BRACING AS SHOWN ON PLAN.
 - PROVIDE HEADERS AS SHOWN ON PLAN, FOR HEADERS NOT MARKED REFERENCE TYPICAL BEARING WALL HEADER SCHEDULE 5/S503.

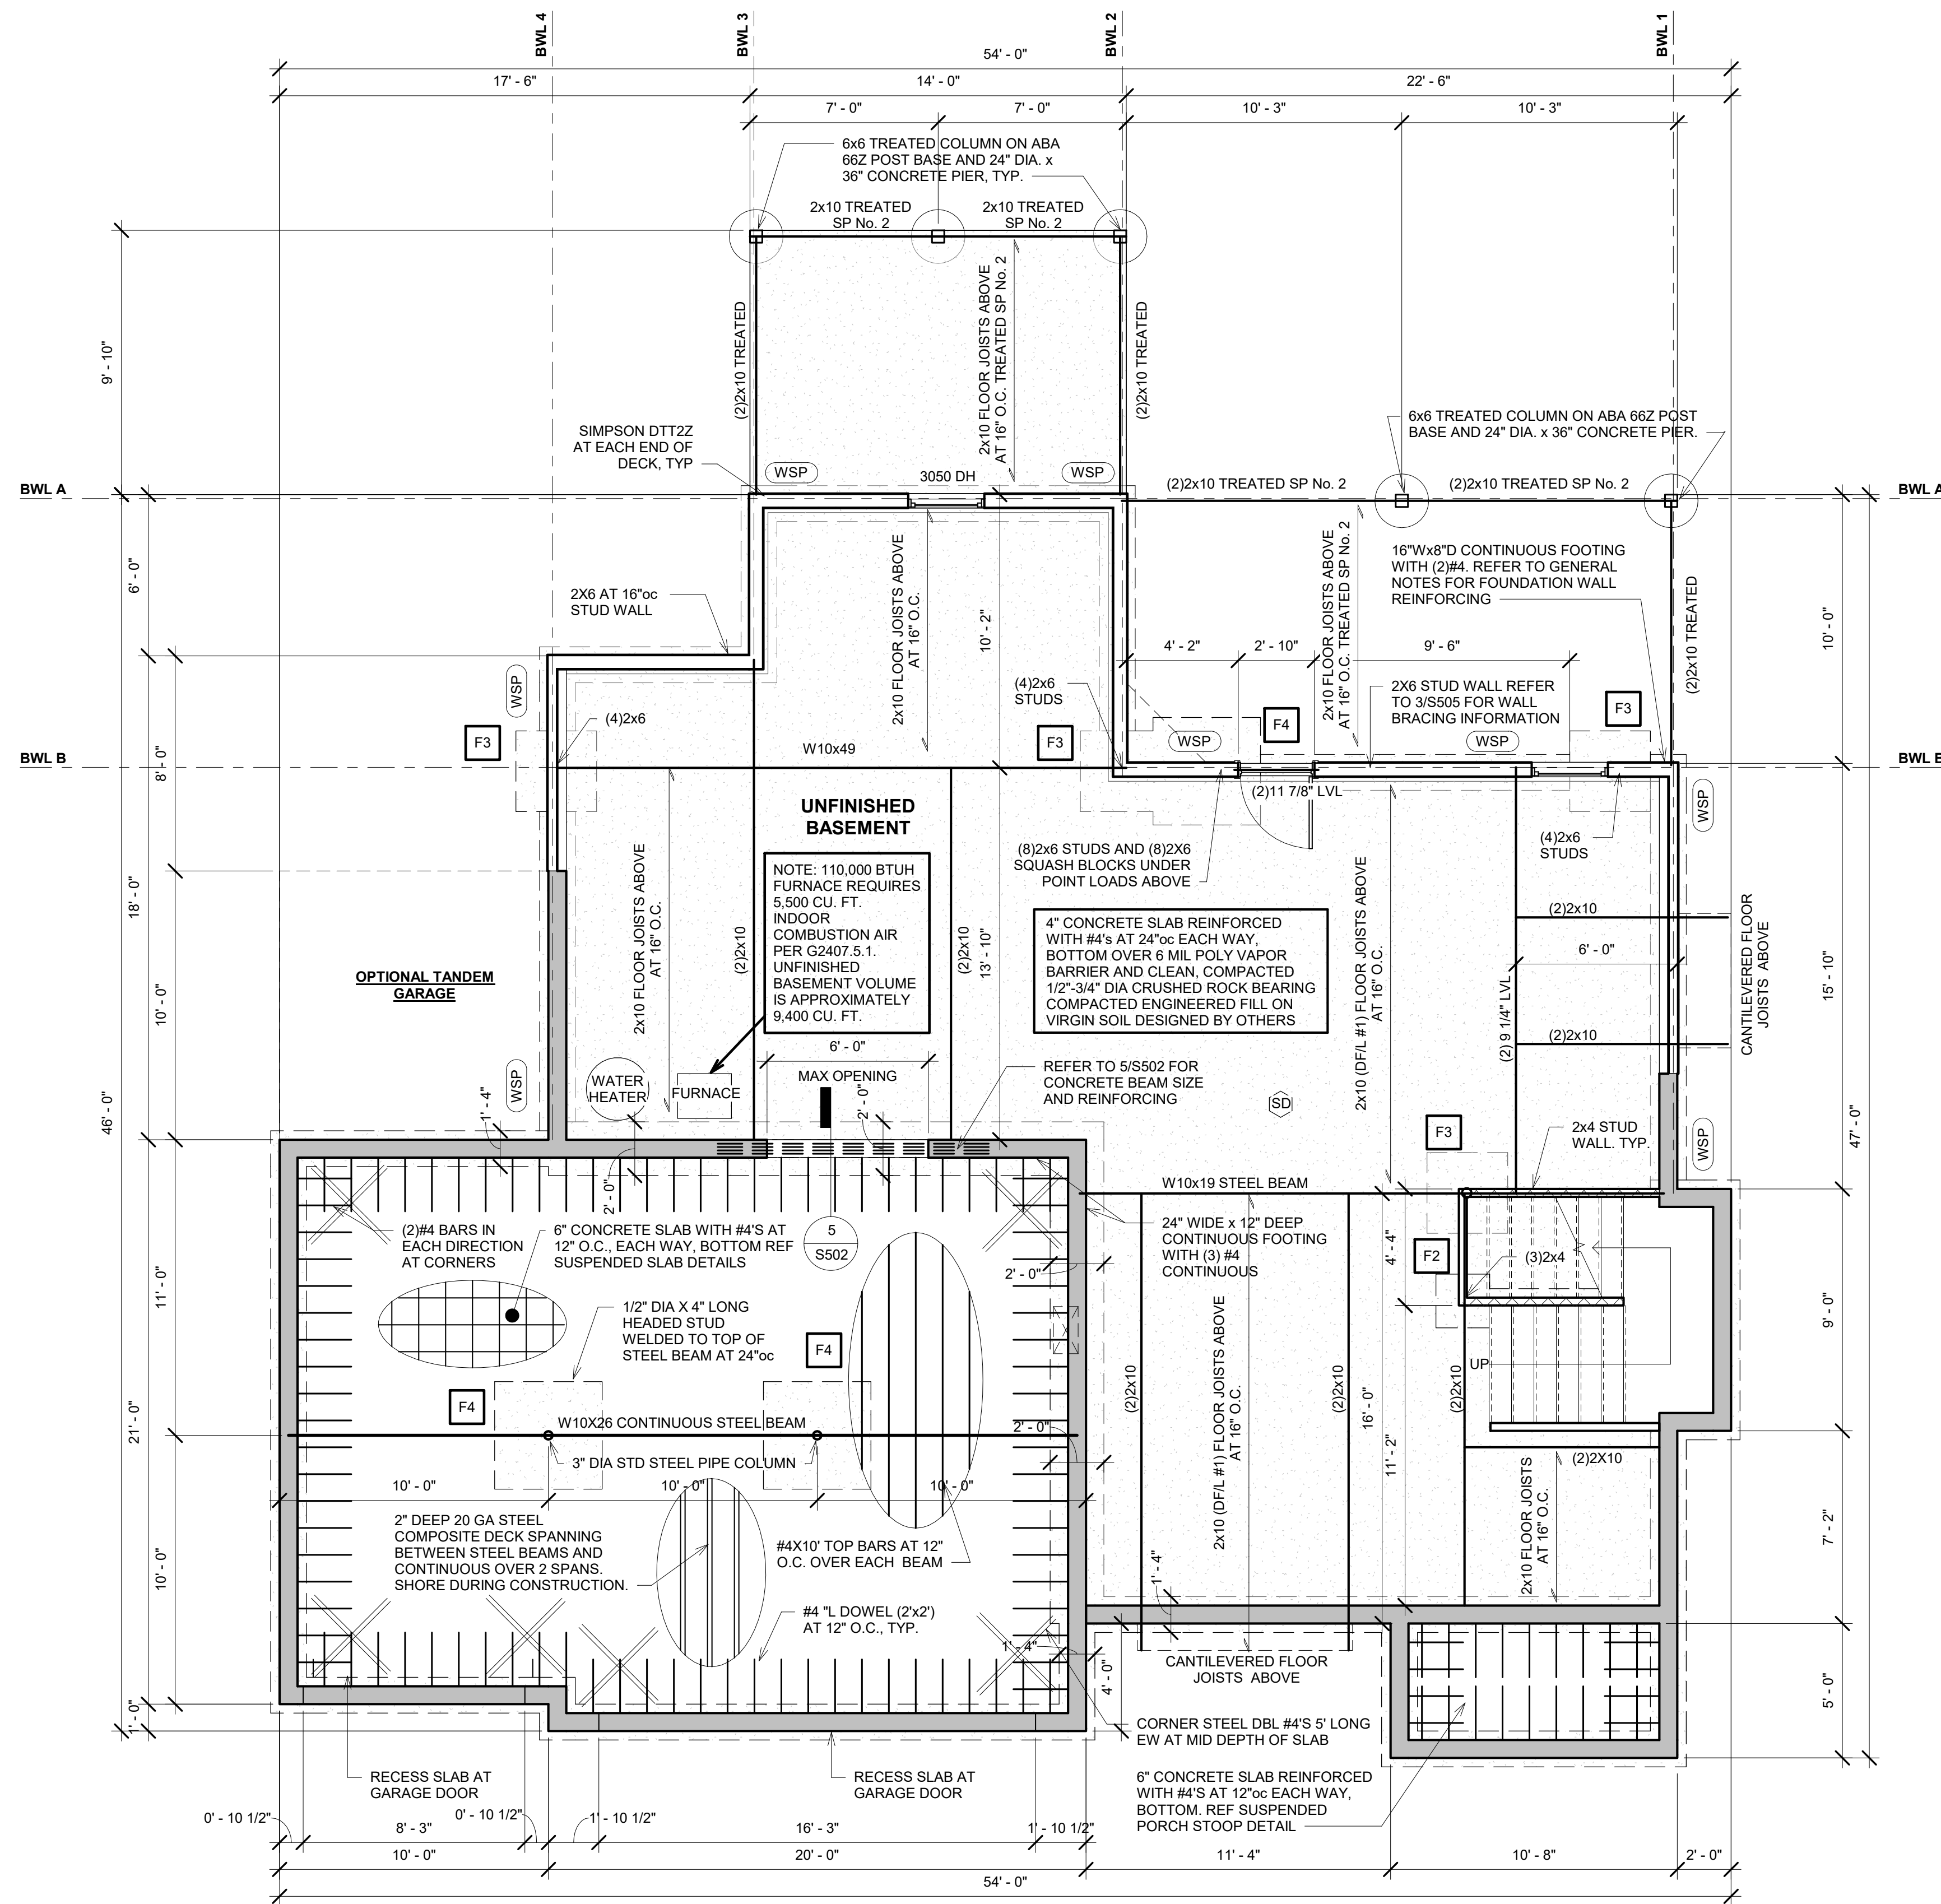

CONCRETE & REINFORCING NOTES:

- CONCRETE STRENGTH SHALL MEET THE FOLLOWING MINIMUM 28 DAY STRENGTH REQUIREMENTS (IRC R402.2):
 - 2,500 PSI FOR BASEMENT FLOOR SLABS ON UNDISTURBED GRADE.
 - 3,500 PSI FOR FOUNDATIONS, FOUNDATION WALLS, AND OTHER VERTICAL CONCRETE.
 - 3,500 PSI FOR CARPORT AND GARAGE FLOOR SLABS ON UNDISTURBED GRADE.
 - 3,500 PSI FOR STRUCTURAL FLOOR SLABS.
- CONCRETE SHALL BE 6%± AIR ENTRAINMENT FOR GARAGE SLABS AND FOR ALL LOCATIONS (FOOTINGS, WALLS, FLATWORK, ETC.) EXPOSED TO WEATHER.
- CONCRETE SHALL HAVE A SLUMP OF 4" ± 1". THE SLUMP CAN BE INCREASED THROUGH THE USE OF APPROVED ADDITIVES (NOT AIR ENTRAINMENT).
- THE REINFORCING STEEL SHALL BE ASTM A615, GRADE 40 MINIMUM UNLESS NOTED OTHERWISE ON THE DRAWINGS. ALL BARS SHALL BE LAPPED A MINIMUM OF 48 BAR DIAMETERS AND/OR CORNER BARS SHALL BE PROVIDED AT ALL FOOTING AND WALL CORNERS, AND FOOTING STEPS.
- MINIMUM CONCRETE COVER SHALL BE AS FOLLOWS (ACI 318):
 - EARTH FORMED - 3"
 - EXPOSED TO WEATHER - 1 1/2" FOR #5 BARS & SMALLER
 - NOT EXPOSED TO WEATHER - 3/4" FOR SLABS.
- NO WATER SHALL BE ADDED TO THE CONCRETE MIX AT THE SITE.
- ADDITION OF CALCIUM CHLORIDE TO CONCRETE IS NOT PERMITTED.
- NO ALUMINUM SHALL BE EMBEDDED/PLACED IN CONCRETE.
- CONCRETE PLACED IN COLD WEATHER SHALL COMPLY WITH ACI 306. CONCRETE PLACED IN HOT WEATHER SHALL COMPLY WITH ACI 305.

FOUNDATION NOTES:

- ALL FOUNDATIONS SHALL BEAR ON NATIVE, UNDISTURBED SOIL CAPABLE OF SUPPORTING 1,500 PSF UNLESS NOTED OTHERWISE, WITHOUT UNDE SETTLEMENT OR HEAVING. THE CONTRACTOR SHALL RETAIN A QUALIFIED TESTING LAB (APPROVED BY THE OWNER) TO FIELD VERIFY THE ACTUAL SOIL BEARING CAPACITY.
- ALL EXTERIOR FOOTINGS SHALL BE A MIN. OF 36" BELOW FINISHED GRADE.
- IF THE EXISTING SITE TOPOGRAPHY OR SOIL CONDITIONS VARY FROM THE CONDITIONS SHOWN ON THE DRAWINGS, IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE ARCHITECT/ENGINEER SO THAT A DESIGN THAT IS APPROPRIATE FOR THE SITE CAN BE GENERATED.
- FOOTINGS SHALL BE POURED CONTINUOUS AT FOOTING STEPS (SOLID JUMPS).
- ANY FILL THAT IS INSTALLED UNDER THE BASEMENT OR GARAGE FLOOR SLABS SHALL BE PROPERLY COMPACTED TO PREVENT SETTLEMENT OF THE FILL MATERIAL. PROPER COMPACTON IS WHERE THE SOIL IS PLACED IN 6" LIFTS AND EACH LIFT IS COMPACTED PRIOR TO INSTALLING MORE SOIL. THIS COMPACTED FILL SHALL THEN BE VERIFIED BY A QUALIFIED GEOTECHNICAL ENGINEER. AT THE CONTRACTOR'S OPTION, A PROPERLY DESIGNED STRUCTURAL SLAB MAY BE INSTALLED OVER ANY FILL THAT HAS NOT BEEN PROPERLY COMPACTED. ALL EXTERIOR SLABS SHALL BE INSTALLED ADJACENT TO THE FOUNDATION SHALL BE DOWELED INTO THE FOUNDATION WITH #4 BARS AT 12" ON CENTER (GRADE 60 STEEL) DRILLED IN 6" MINIMUM AND EPOXIED.
- CONTROL JOINTS IN THE FLOOR SLABS SHALL BE INSTALLED AS TO MINIMIZE THE AMOUNT OF RANDOM CRACKING (12" INTERVALS MAXIMUM). THESE JOINTS SHALL BE SAWCUT 1-1/4" DEEP WITH 8 HOURS OF POURING THE SLAB OR MAY BE TOOLED INTO THE SLAB WHEN POURED. SAWCUTS SHALL BE IN APPROXIMATE SQUARE PATTERNS WITH MAXIMUM ASPECT RATIO OF 1-1/2 TO 1.
- THE BUILDER SHALL BE RESPONSIBLE FOR TAKING THE APPROPRIATE STEPS TO MINIMIZE THE EFFECTS OF EXPANSIVE SOIL ON THE FOUNDATION, SLABS, AND WOOD FRAMED PORTIONS OF THE HOUSE. THIS INCLUDES ISOLATING THE FLOOR SLAB AT ALL COLUMNS, INTERIOR BEARING WALLS, AND AT THE FOUNDATION WALLS WITH TWO LAYERS OF 15# FELT. PARTITION WALLS IN THE BASEMENT SHALL NOT BE CONSTRUCTED TIGHT AGAINST THE FRAMING ABOVE.
- INSTALL CONTINUOUS DRAIN TILE (4" DIAMETER MINIMUM) AROUND THE PERIMETER OF THE ENTIRE LOWER LEVEL AND COVER THE TILE WITH FILTER FABRIC AND COURSE, CLEAN ROCK. INSTALL VERTICAL DRAINS TO PERIMETER DRAIN TILE AT ALL WINDOW WELLS. THE DRAIN TILE SHALL BE CONNECTED TO A 40 GALLON (MINIMUM) SUMP PIT WITH SUFFICIENT DEPTH FOR PROPER OPERATION, OR SHALL BE DRAINED BY GRAVITY TO DAYLIGHT AT LEAST 10' FROM THE FOUNDATION. FOUNDATION DRAINAGE SHALL ALSO BE IN ACCORDANCE WITH 2012 IRC SECTION R-406.1.
- CONCRETE BASEMENT SLABS SHALL BE A MIN. OF 4" THICK OVER A MIN. OF 4" OF 1/2" TO 3/4" CLEAN, GRADED ROCK, 1/4" O.C. OR IF SITE CONDITIONS REQUIRE OTHERWISE. MIN REINFORCING SHALL BE #4'S AT 24"oc OR EQUIVALENT.
- PROVIDE A MIN. 6-MIL POLYETHYLENE MOISTURE BARRIER OVER GRAVEL BASES 2.2. LAP JOINTS A MIN. OF 6".
- ALL FOOTING AND SLAB REINFORCEMENT SHALL BE BLOCKED OFF SUBGRADE WITH CHAIRS OR CONCRETE BRICKS.

RESIDENTIAL BASEMENT WALL NOTES:

- HORIZONTAL REBAR SPACING FOR CONCRETE FOUND WALLS SHALL BE #4'S AT 24"oc.
- VERTICAL REBAR SPACING FOR CONCRETE FOUNDATION WALLS SHALL BE PER THE TABLE BELOW:

WALL THICK	60 KSI REINFORCING		40KSI REINFORCING	
	8"	10"	8"	10"
6" OR LESS	#4 @ 36"oc	#4 @ 36"oc	#4 @ 36"oc	#4 @ 36"oc
7"	#4 @ 32"oc	#4 @ 36"oc	#4 @ 21"oc	#4 @ 36"oc
8"	#4 @ 24"oc	#4 @ 36"oc	#4 @ 16"oc	#4 @ 36"oc
9"	#4 @ 16"oc	#4 @ 20"oc	#4 @ 12"oc	#4 @ 16"oc
10"	#4 @ 12"oc	#4 @ 16"oc	#4 @ 8"oc	#4 @ 12"oc

- MINIMUM REQUIREMENT FOR VERTICAL REBAR IN PLAIN CONCRETE WALLS IS #4 BARS @ 36" O.C. (ACI 318).
 - VERTICAL BARS SHALL BE CONTINUED TO WITHIN 4" OF THE TOP OF THE WALL. REBAR SHALL BE POSITIONED AT THE TENSION FACE OF THE WALL (2" FROM THE INSIDE FACE).
 - REINFORCEMENT SHALL LAP A MINIMUM OF 24" AT ENDS, SPLICES, AND AROUND CORNERS.
 - DESIGN BY A PROFESSIONAL ENGINEER IS REQUIRED FOR WALLS OVER 10' IN HEIGHT.
- BARS SHALL LAP A MINIMUM OF 48 BAR DIAMETERS AT ENDS, SPLICES AND AROUND CORNERS. UNLESS OTHERWISE NOTED ON THESE DRAWINGS.
 - CONTINUOUS WALL FOOTINGS SHALL BE A MINIMUM OF 16" WIDE AND 8" DEEP WITH (2) #4 BARS CONTINUOUS. CONTINUOUS WALL FOOTINGS SHALL BE A MINIMUM OF 24" WIDE AND 12" DEEP WITH (2) #4 BARS CONTINUOUS FOR 12" THICK WALLS.
 - INSTALL 12"x3" x 1-1/2" LONG ANCHOR BOLTS 7" EMBEDMENT AT 3'-0" O.C. AND WITHIN 12" OF THE END OF EACH SILL MEMBER. MINIMUM SILL PLATE TO BE 2X6 PRESSURE TREATED. THE TOPS OF ALL BASEMENT (LOWER LEVEL) FOUNDATION WALLS SHALL BE CONNECTED TO THE FLOOR JOISTS. NAIL EACH FLOOR JOIST END AND END WALL BLOCKING TO THE WOOD SILL PLATE PER THE IRC NAILING SCHEDULE. WHERE FLOOR JOISTS RUN PARALLEL TO THE FOUNDATION WALLS, PROVIDE BLOCKING IN THE FIRST THREE JOIST SPACES AT 2'-0" O.C. OVER THE ENTIRE LENGTH OF THE FLOOR JOISTS.
 - WALLS SHALL BE FULL HEIGHT FROM FOOTING TO FLOOR FRAMING. NO WOOD FRAMED CRIPPLE WALLS EXCEPT AS SPECIFICALLY NOTED ON THE ARCHITECTURAL AND STRUCTURAL DRAWINGS.
 - STRAIGHT WALLS MORE THAN 5 FEET TALL AND MORE THAN 16 FEET LONG SHALL BE PROVIDED WITH EXTERIOR BRACED RETURN WALLS. REF TYP DEADMAN DETAIL.
 - FOUNDATION WALLS SHALL BE DESIGNED FOR AN EQUIVALENT FLUID PRESSURE (EFP) 60 PSF.
 - PROVIDE STEEL SHIMS IN BEAM POCKETS TO LEVEL BEAMS. BEAM POCKETS SHALL BE GROUTED SOLID WITH 4,000 PSI NON-SHRINK GROUT AFTER BEAMS ARE LOADED WITH FRAMING MEMBERS.
 - REINFORCE AROUND BEAM POCKETS BY BENDING TOP CONTINUOUS HORIZONTAL BAR BELOW BEAM POCKET OR INSTALL SEPARATE BENT BAR LAPPED AND TIED MINIMUM 24" EACH SIDE.
 - PROVIDE TWO #4 x 4'-0" LONG DIAGONAL BARS AT THE CORNERS OF ALL OPENINGS IN CONCRETE WALLS AND AT FOOTING STEPS. ALSO PROVIDE 2 ADDITIONAL #4 ON ALL SIDES OF WALL OPENINGS. BARS SHALL BE 3'-0" LONGER THAN OPEN VERTICAL OR HORIZONTAL DIMENSION.
 - FOUNDATION WALLS THAT RETAIN EARTH AND ENCLOSE INTERIOR SPACES AND FLOORS BELOW GRADE SHALL BE DAMP PROOFED FROM THE TOP OF THE FOOTING TO THE FINISHED GRADE WITH A BITUMINOUS COATING IN ACCORDANCE WITH SECTION R406.1.
 - INSULATION SHALL BE INSTALLED FOR ALL BASEMENT WALLS AS REQUIRED PER SECTION N102.1.
 - ALL SITE RETAINING WALLS GREATER THAN 4'-0" IN HEIGHT SHALL REQUIRE A DESIGN BY A PROFESSIONAL ENGINEER.
 - A CONCRETE ENCASED GROUNDING ELECTRODE CONNECTION SHALL BE PROVIDED TO THE ELECTRICAL SERVICE PER SECTION E3808.1.

FOOTING SCHEDULE

MARK	SIZE L x W x THK	REINFORCING (NO) SIZE LOCATION	TOF EL	COLUMN
F1	2'-0" x 2'-0" x 1'-0"	(4) #4 EW BOTTOM	8" BELOW TOP OF SLAB	3" STD STEEL PIPE COLUMN
F2	2'-6" x 2'-6" x 1'-0"	(4) #4 EW BOTTOM	8" BELOW TOP OF SLAB	3" STD STEEL PIPE COLUMN
F3	3'-0" x 3'-0" x 1'-0"	(6) #4 EW BOTTOM	8" BELOW TOP OF SLAB	3" STD STEEL PIPE COLUMN
F4	4'-0" x 4'-0" x 1'-4"	(8) #4 EW BOTTOM	8" BELOW TOP OF SLAB	3" STD STEEL PIPE COLUMN

1 FOUNDATION PLAN
SCALE: 1/4" = 1'-0"

Norton & Schmidt
Consulting Engineers, L.L.C.
311 East 11th Avenue
North Kansas City, MO 64116
Phone: (816) 442-4232
Fax: (816) 421-1866
www.nortonschmidt.com

STATE OF MISSOURI
BRANDON SCHWABAUER
Professional Engineer
No. PE-2015003020
Exp. 04/03/2020

NBS JOB NUMBER: 2020-0255
© 2020 Norton & Schmidt Consulting Engineers

PROJECT INFORMATION

THE LEXINGTON II
2521 SW River Trail Road
Lee's Summit, Missouri


ISSUES & REVISIONS

#	DATE	DESCRIPTION
	04/03/2020	PERMIT

DRAWN BY: MLR
CHECKED BY: BSS
ISSUED FOR:

SHEET TITLE
FOUNDATION PLAN

SHEET NUMBER
S100

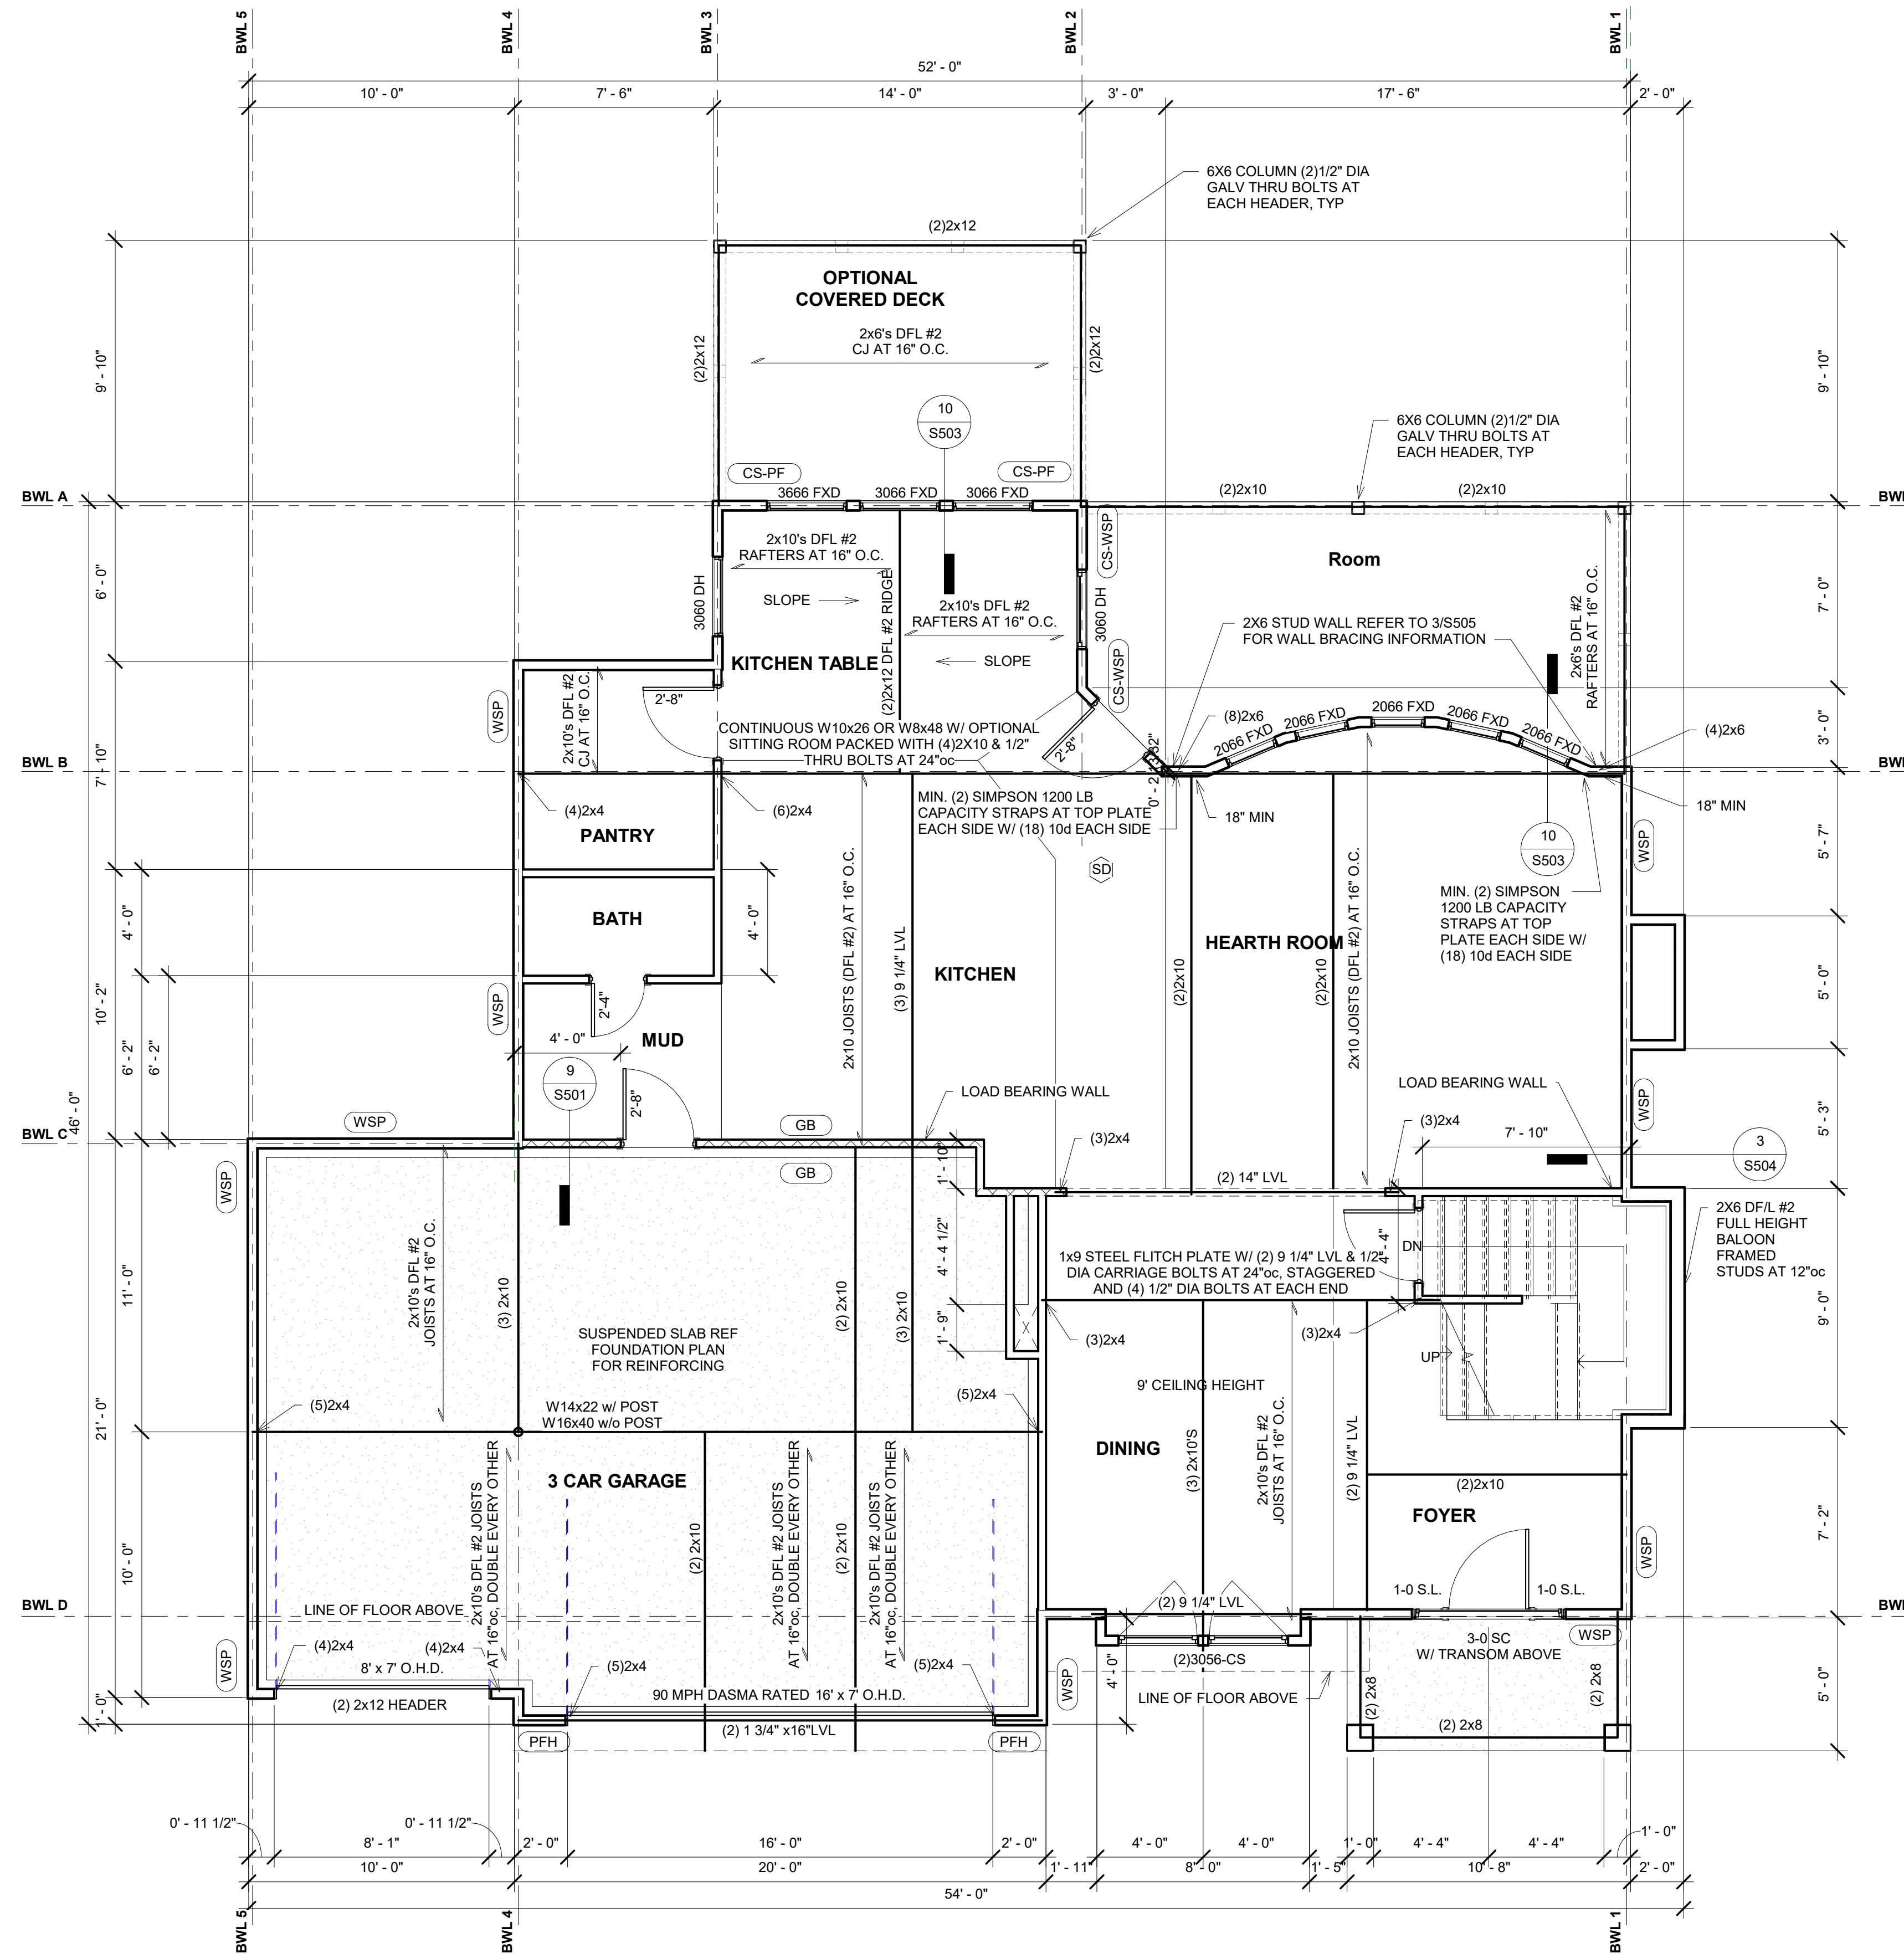

BRACED WALL METHODS

WSP - WOOD STRUCTURAL PANEL: WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 3/8" FOR 16" STUD SPACING, FASTEN WITH 6d COMMON NAILS (.131" x 2" LONG) AT 6"oc ALONG EDGES AND 12"oc AT INTERMEDIATE SUPPORTS, WHERE SHOWN ON PLANS. UNLESS OTHERWISE NOTED, PANEL WIDTH = 4'-0".

CS-WSP - CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL: WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 3/8" FOR 16" STUD SPACING, FASTEN WITH 6d COMMON NAILS (.131" x 2" LONG) AT 6"oc ALONG EDGES AND 12"oc AT INTERMEDIATE SUPPORTS, PLACED ON ALL SHEATHABLE SURFACES ON ONE SIDE OF THE BRACED WALL LINE INCLUDING AREAS ABOVE AND BELOW OPENINGS AND GABLE END WALLS.

GB - GYPSUM BOARD: 1/2" GYPSUM BOARD WITH 13 GAGE, 1 3/8" LONG, 19/64" HEAD, 0.098" DIA, 1 3/8" LONG, ANNULAR-RINGED; 6d COOLER NAIL, 0.092" DIA, 1 7/8" LONG, 1/4" HEAD; OR GYPSUM BOARD NAIL, 0.0915" DIA, 1 7/8" LONG, 19/64" HEAD; TYPE W OR TYPE S SCREWS; AT 7"oc EDGES & 7"oc FIELD


PFH - PORTAL FRAME WITH HOLD-DOWNS: REF PORTAL FRAME WITH HOLD-DOWNS DETAIL

ABW - ALTERNATE BRACED WALL: REF ALTERNATE BRACED WALL DETAIL

CS-PF - CONTINUOUSLY SHEATHED PORTAL FRAME: REF CONTINUOUSLY SHEATHED PORTAL FRAME DETAIL

HPS - HARDBOARD PANEL SIDING: HARDBOARD PANEL SIDING WITH A 7/16" THICKNESS. FASTEN WITH 0.092" DIA, 0.225" DIA HEAD NAILS WITH LENGTH TO ACCOMMODATE 1 1/2" PENETRATION INTO STUDS AT 4"oc ALONG EDGES AND 8" AT INTERMEDIATE SUPPORTS.

Norton & Schmidt
Consulting Engineers, L.L.C.
311 East 11th Avenue
North Kansas City, MO
64116
Phone: (816) 421-4232
Fax: (816) 421-1866
www.nortonschmidt.com

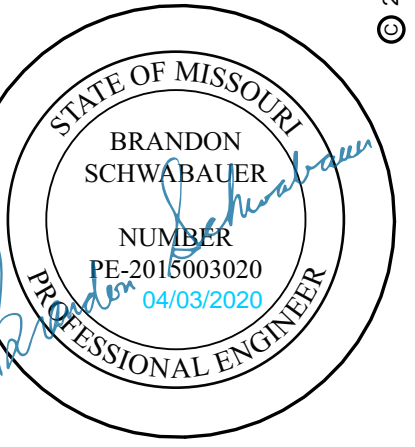

PROJECT INFORMATION

THE LEXINGTON II
2521 SW River Trail Road
Lee's Summit, Missouri

ISSUES & REVISIONS

#	DATE	DESCRIPTION
04/03/2020	PERMIT	


DRAWN BY: MLR
CHECKED BY: BSS
ISSUED FOR:

SHEET TITLE
FIRST FLOOR
FRAMING PLAN

SHEET NUMBER
S101

1 FIRST FLOOR FRAMING PLAN
SCALE: 1/4" = 1'-0"

N&S JOB NUMBER: 2020-0255
© 2020 Norton & Schmidt Consulting Engineers

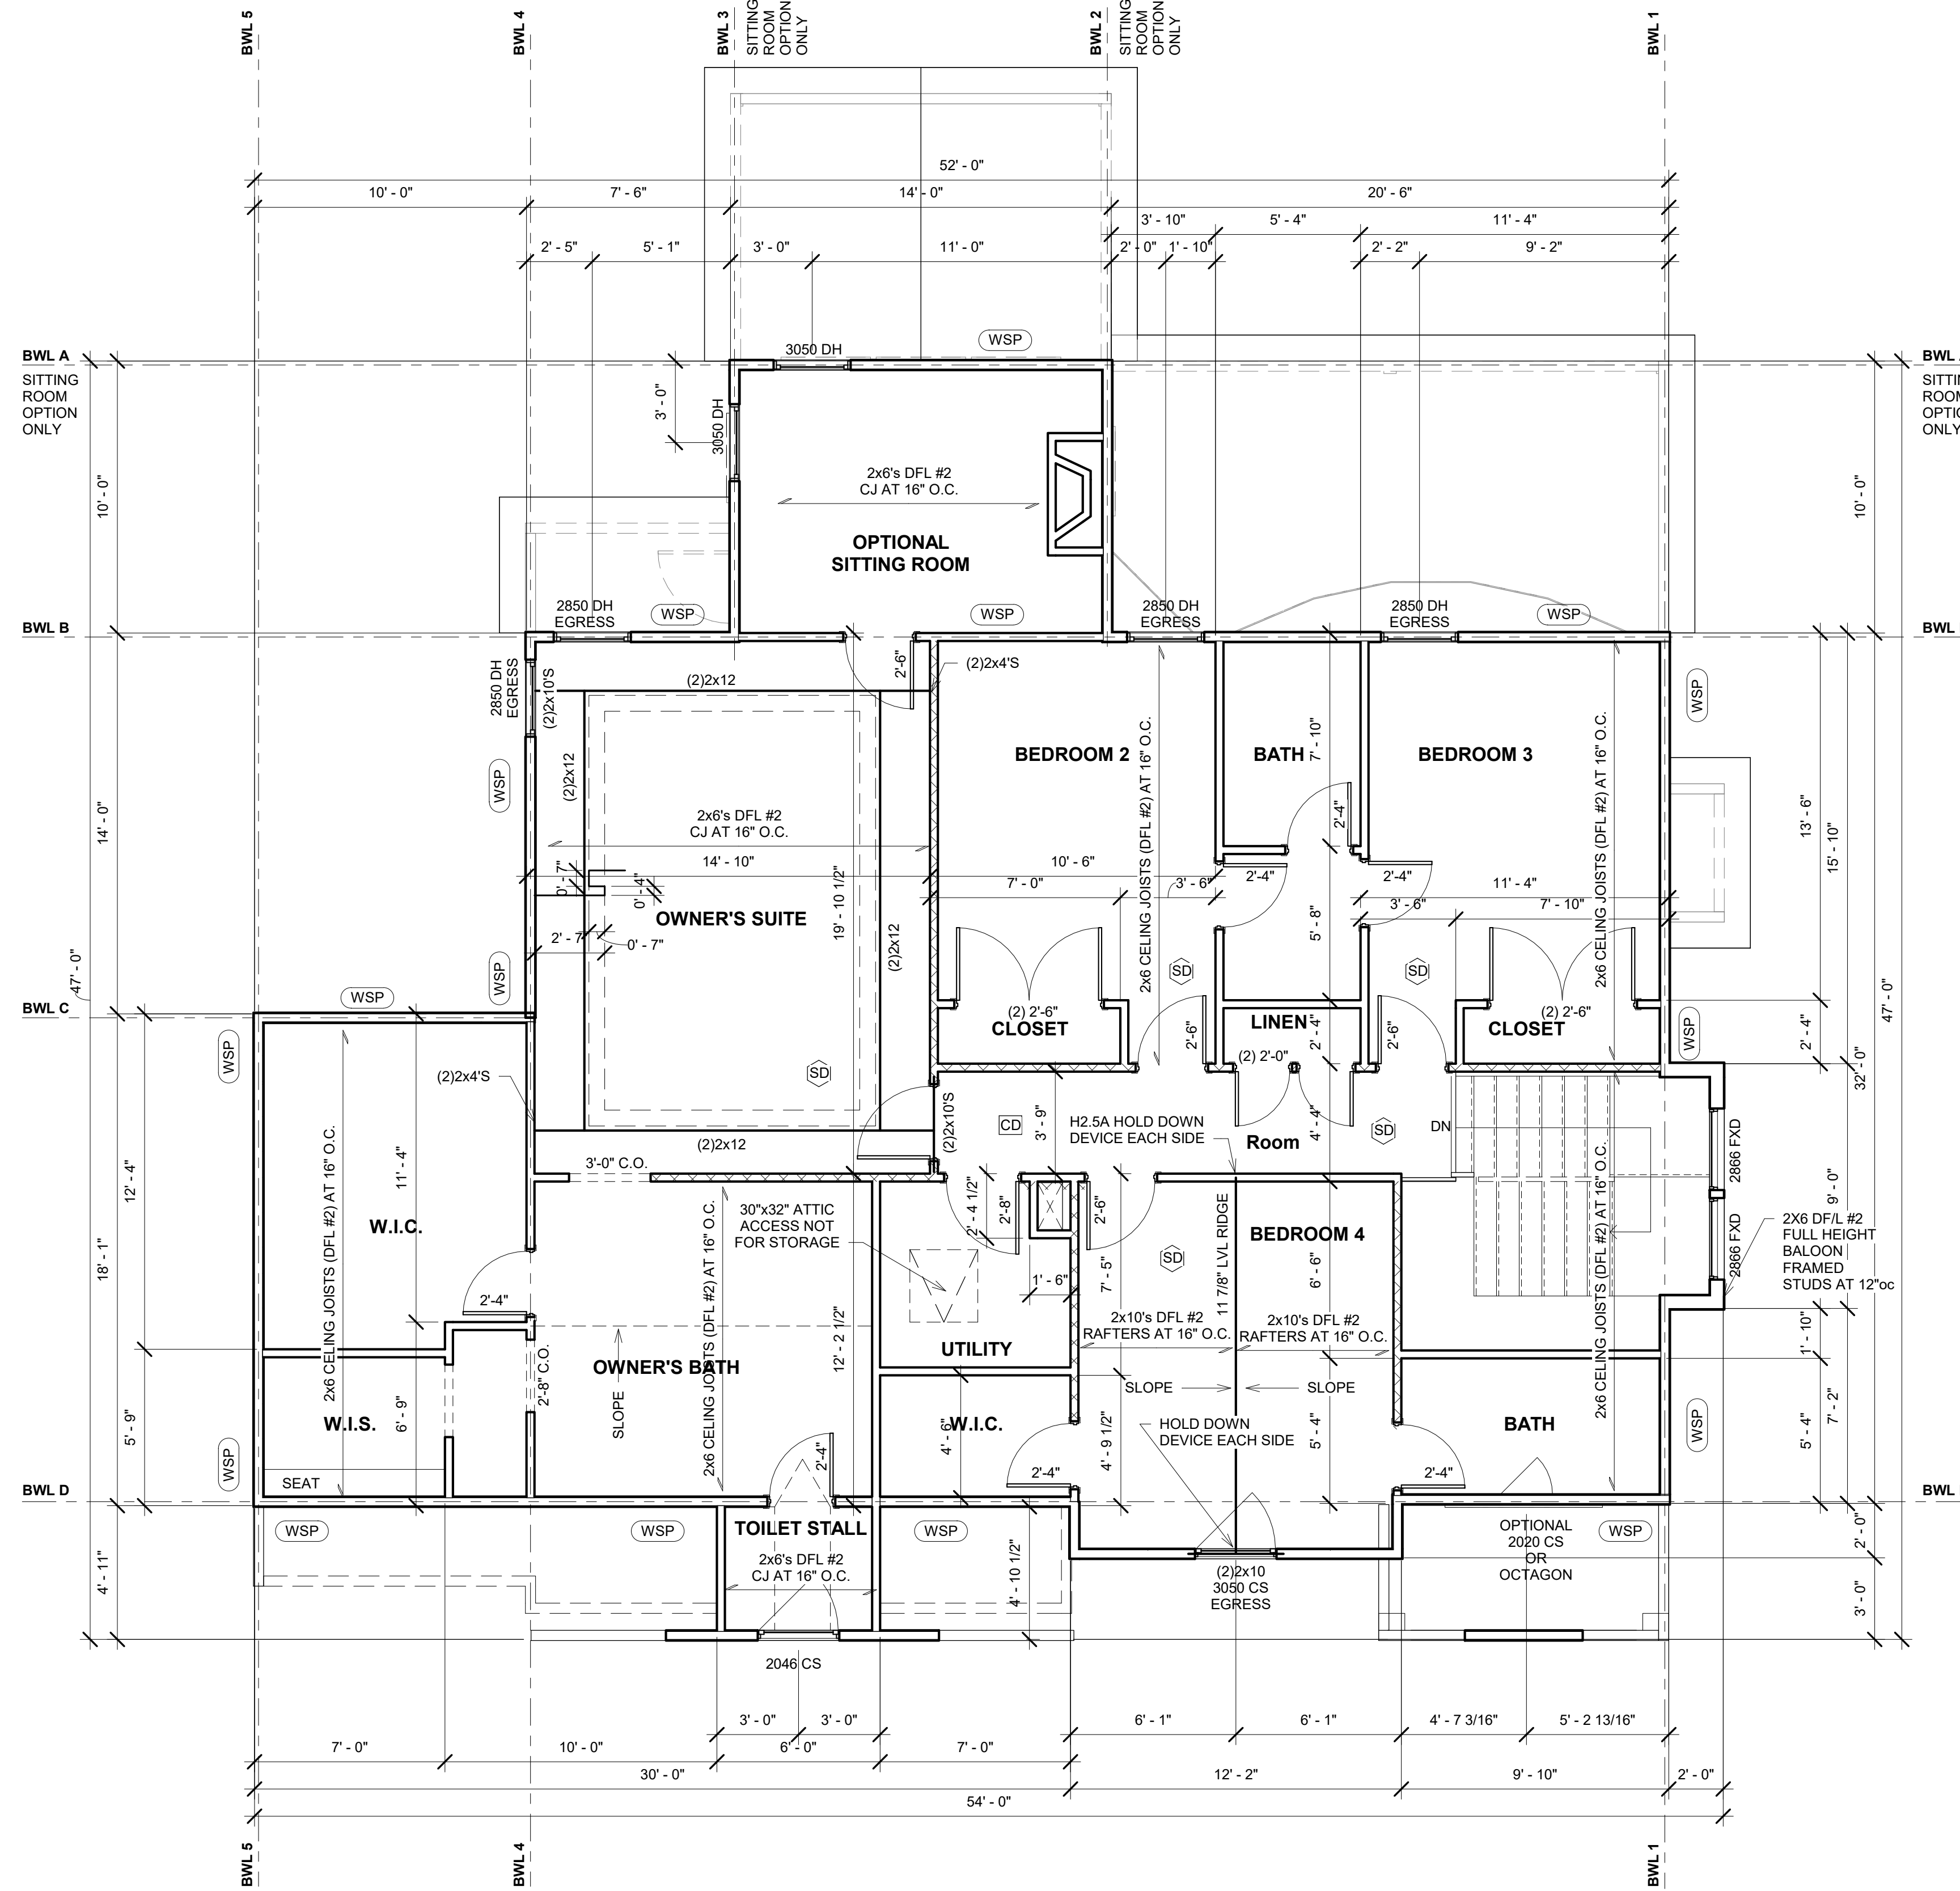

BRACED WALL METHODS

WSP - WOOD STRUCTURAL PANEL: WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 3/8" FOR 16" STUD SPACING, FASTEN WITH 6d COMMON NAILS (131"x2" LONG) AT 6"oc ALONG EDGES AND 12"oc AT INTERMEDIATE SUPPORTS, WHERE SHOWN ON PLANS. UNLESS OTHERWISE NOTED, PANEL WIDTH = 4'-0".

CS-WSP - CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL: WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 3/8" FOR 16" STUD SPACING, FASTEN WITH 6d COMMON NAILS (131"x2" LONG) AT 6"oc ALONG EDGES AND 12"oc AT INTERMEDIATE SUPPORTS, PLACED ON ALL SHEATHABLE SURFACES ON ONE SIDE OF THE BRACED WALL LINE INCLUDING AREAS ABOVE AND BELOW OPENINGS AND GABLE END WALLS.

GB - GYPSUM BOARD: 1/2" GYPSUM BOARD WITH 13 GAGE, 1 3/8" LONG, 19/64" HEAD, 0.098" DIA, 1 3/8" LONG, ANNULAR-RINGED; 6d COOLER NAIL, 0.092" DIA, 1 7/8" LONG, 11/4" HEAD; OR GYPSUM BOARD NAIL, 0.0915" DIA, 1 7/8" LONG, 19/64" HEAD; TYPE W OR TYPE S SCREWS; AT 7"oc EDGES & 7"oc FIELD.

PFH - PORTAL FRAME WITH HOLD-DOWNS: REF PORTAL FRAME WITH HOLD-DOWNS DETAIL.

ABW - ALTERNATE BRACED WALL: REF ALTERNATE BRACED WALL DETAIL.

CS-PF - CONTINUOUSLY SHEATHED PORTAL FRAME: REF CONTINUOUSLY SHEATHED PORTAL FRAME DETAIL.

HPS - HARDBOARD PANEL SIDING: HARDBOARD PANEL SIDING WITH A 7/16" THICKNESS, FASTEN WITH 0.092" DIA, 0.225" DIA HEAD NAILS WITH LENGTH TO ACCOMMODATE 1 1/2" PENETRATION INTO STUDS AT 4"oc ALONG EDGES AND 8" AT INTERMEDIATE SUPPORTS.

1 SECOND FLOOR FRAMING PLAN
SCALE: 1/4" = 1'-0"

Norton & Schmidt
Consulting Engineers, L.L.C.
311 East 11th Avenue
North Kansas City, MO
64116
Phone: (816) 421-4232
Fax: (816) 421-1868
www.nortonschmidt.com

STATE OF MISSOURI
BRANDON SCHWABAUER
NUMBER
PE-2015003020
EXPIRES 04/03/2020
PROFESSIONAL ENGINEER

N&S JOB NUMBER: 2020-0255
© 2020 Norton & Schmidt Consulting Engineers

PROJECT INFORMATION

THE LEXINGTON II
2521 SW River Trail Road
Lee's Summit, Missouri

ISSUES & REVISIONS


#	DATE	DESCRIPTION
	04/03/2020	PERMIT

DRAWN BY: MLR
CHECKED BY: BSS
ISSUED FOR:

SHEET TITLE
SECOND FLOOR FRAMING PLAN

SHEET NUMBER
S102

1 ROOF FRAMING PLAN
SCALE: 1/4" = 1'-0"

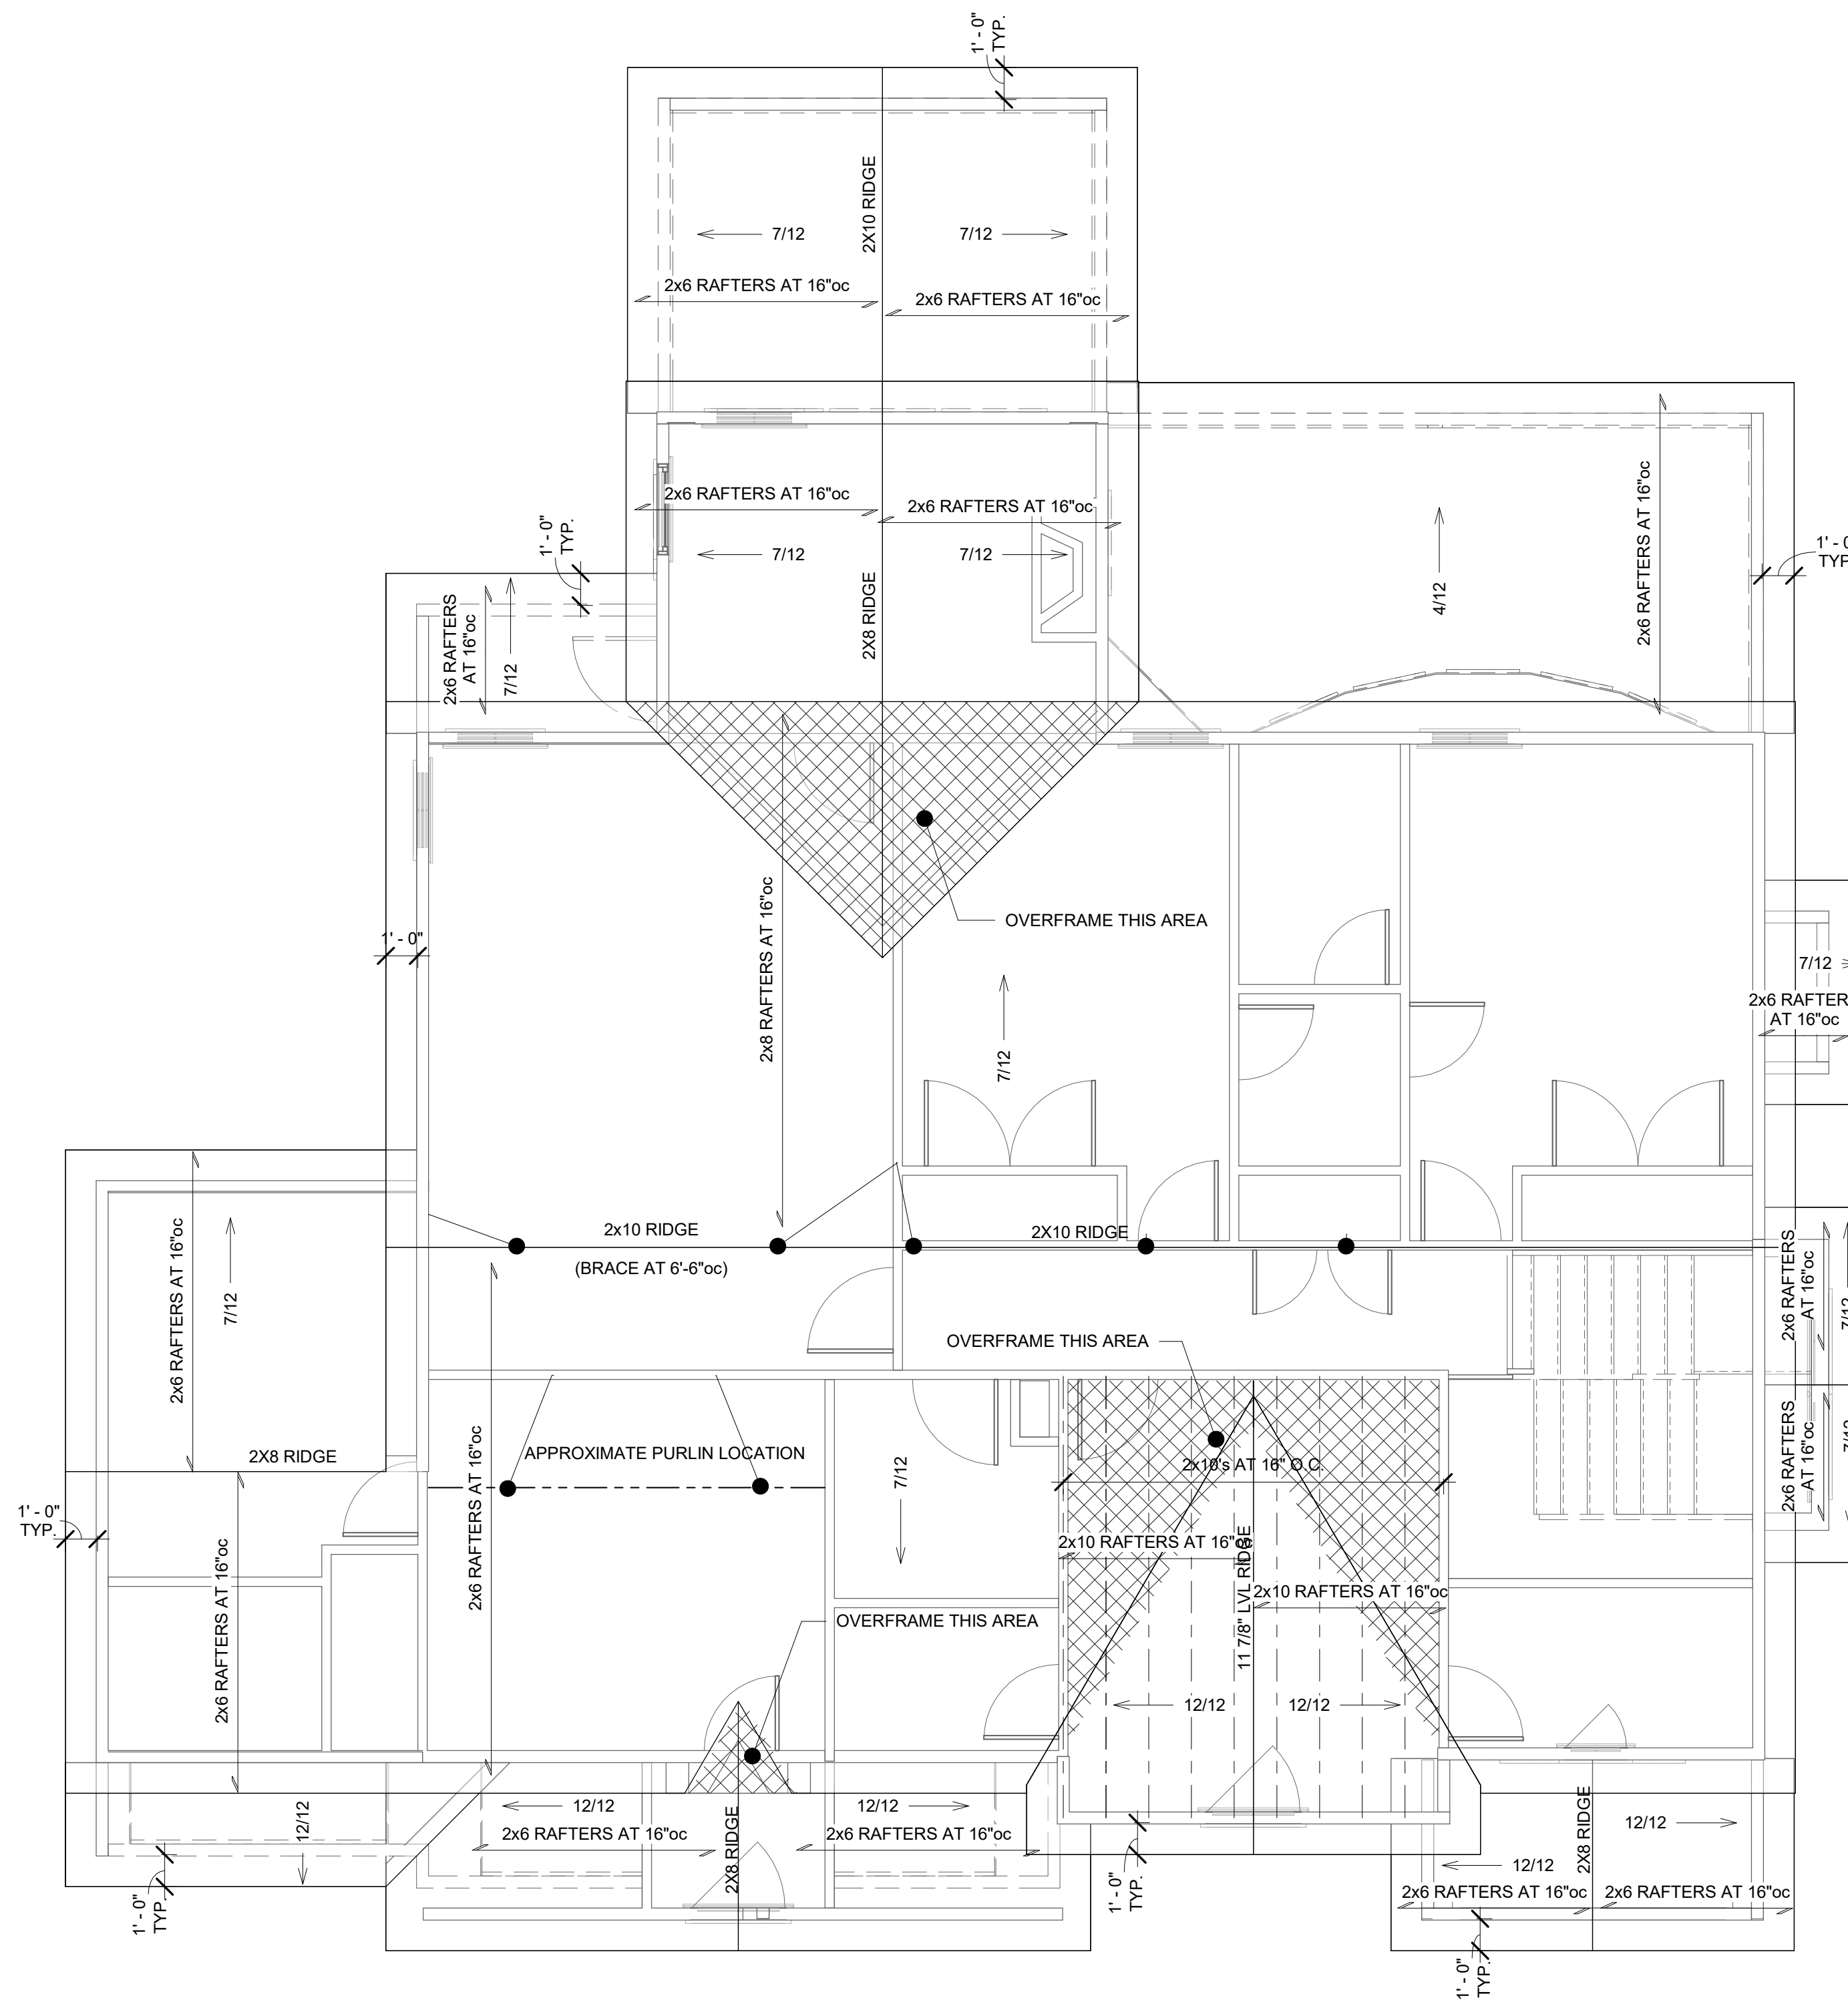

ROOF FRAMING PLAN NOTES

- NOTES ARE TYPICAL UNLESS NOTE NUMBER IS INSIDE OF CIRCLE, THEN THE NOTE REFERS TO A SPECIFIC LOCATION(S) MARKED ON THE PLAN.
1. PROVIDE 1/2" EXTERIOR GRADE PLYWOOD SHEATHING NAILED TO ROOF RAFTERS WITH 8d NAILS AT 6"oc AT PANEL EDGES AND 12"oc AT NON-PANEL EDGES.
 2. PROVIDE ADDITIONAL DEPTH TO JOISTS AS REQUIRED TO PROVIDE 1" AIR GAP TO PREVENT CONDENSATION PLUS 12" INSULATION TO PROVIDE R-38 INSULATION VALUE TO VAULTED CEILING AREA WHERE SHOWN ON PLAN WITH CROSS HATCH.
 3. ALL RIDGE MEMBERS SHALL BE 1" NOMINAL THICKNESS AND NOT LESS IN DEPTH THAN THE CUT END OF THE RAFTER. ALL VALLEY AND HIP MEMBERS SHALL BE 2" NOMINAL THICKNESS AND NOT LESS IN DEPTH THAN THE CUT END OF THE RAFTER.
 4. HIP AND VALLEY MEMBERS SHALL BE SUPPORTED AT THE RIDGE WITH A 2x6 T-BRACE TO A BEARING WALL BELOW. PROVIDE SOFFIT, RIDGE, AND GABLE END VENTS AS REQUIRED TO PROVIDE ADEQUATE VENTILATION FOR ROOF.
 5. PROVIDE PROPER FLASHING AND BUILDING PAPER UNDER SHINGLES AS REQUIRED TO PROVIDE WATER TIGHT SEAL AT ALL ROOF PENETRATIONS, RIDGES, VALLEYS, HIPS AND/OR OTHER SLOPE CHANGES.
 6. GUTTERS, DOWNSPOUTS, AND SPLASH BLOCKS SHALL BE PROVIDED TO INSURE ALL ROOF DRAINAGE IS DIRECTED 5 FEET MINIMUM FROM HOUSE BEFORE TOUCHING SOIL.
 7. ALL GABLE END WALL FRAMING SHALL BE 2x4 DOUG-FIR NO. 2 AT 16"oc.
 8. PROVIDE PROPER CEILING INSULATION AS REQUIRED BY GOVERNING BUILDING CODE.

NOTE:

- RAFTERS TO BE 2x6 DF-L No. 2 AT 16" O.C. U.N.O.
- HIP, VALLEY, AND RIDGE MEMBERS SHALL BE (1)2x8 DF-L No. 2 U.N.O.
- REF. 12/S503 FOR PURLIN BRACING

Norton & Schmidt

Consulting Engineers, L.L.C.
311 East 11th Avenue
North Kansas City, MO
64116
Phone: (816) 421-4232
Fax: (816) 421-1868
www.nortonschmidt.com



N&S JOB NUMBER: 2020-0255
© 2020 Norton & Schmidt Consulting Engineers

PROJECT INFORMATION

THE LEXINGTON II
2521 SW River Trail Road
Lee's Summit, Missouri

ISSUES & REVISIONS

#	DATE	DESCRIPTION
	04/03/2020	PERMIT

DRAWN BY: MLR
CHECKED BY: BSS
ISSUED FOR:

SHEET TITLE
ROOF FRAMING
PLAN

SHEET NUMBER
S103

GENERAL NOTES

GOVERNING BUILDING CODE: 2012 INTERNATIONAL RESIDENTIAL CODE (IRC) AND ITS APPROPRIATE SUPPLEMENTS

- DESIGN LOADS:
- ROOF DEAD LOAD: 10 PSF
- ROOF LIVE LOAD: 20 PSF
- FLOOR DEAD LOAD: 10 PSF
- FLOOR LIVE LOAD: 30 PSF
- BEDROOMS: 40 PSF
- ALL OTHER LIVING AREAS: 40 PSF
- WIND LOADS: VASD=90 MPH, EXPOSURE C
- SEISMIC LOADS: SITE CLASS 'B'
- ASSUMED ALLOWABLE SOIL BEARING PRESSURE: 1500 PSF

- GENERAL:
1. FURNISH ALL LABOR, MATERIAL AND EQUIPMENT NECESSARY TO COMPLETE THE WORK SHOWN OR INFERRED BY THESE DRAWINGS.
2. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL DIMENSIONS AND ELEVATIONS SHOWN ON THE PLANS AND FOR COORDINATING ALL DIMENSIONS AND ELEVATIONS SHOWN WITH THE EXISTING CONDITIONS.
3. THE CONTRACTOR SHALL PROVIDE ALL TEMPORARY BRACING AND SHORING AS REQUIRED DURING CONSTRUCTION TO ENSURE THE SAFETY OF ALL INDIVIDUALS INVOLVED.
4. ALL MECHANICAL, ELECTRICAL, AND PLUMBING ELEMENTS SHALL BE INSTALLED PER THE REQUIREMENTS OF THE GOVERNING BUILDING CODE AND THE LOCAL MUNICIPALITY.
5. NORTON & SCHMIDT CONSULTING ENGINEERS, L.L.C. HAS DESIGNED THE STRUCTURAL FLOOR FRAMING AND WALL BRACING SYSTEM OF THESE PLANS FOR THE CONSTRUCTION OF A RESIDENCE AT THE ADDRESS REFERENCED IN THE PLANS. NORTON & SCHMIDT CONSULTING ENGINEERS, L.L.C. WILL NOT TAKE RESPONSIBILITY FOR ANY RE-USE OF ANY PORTION OF THE DESIGN, PLANS OR SPECIFICATIONS AT ANY OTHER PROPERTY OR ADDRESS WITHOUT OUR PRIOR WRITTEN CONSENT.

BUILDER'S PLANS: THE TERM 'BUILDER'S PLANS' REFERS TO A CERTAIN LEVEL OF DEVELOPMENT OF THE DRAWINGS. AS THE NAME IMPLIES, THESE PLANS REQUIRE THAT THE CONTRACTOR POSSESSES THE NECESSARY COMPETENCE IN RESIDENTIAL CONSTRUCTION AND A THOROUGH UNDERSTANDING OF THE INTERNATIONAL RESIDENTIAL CODE (IRC), THE CONTRACTOR WARRANTS TO NORTON & SCHMIDT CONSULTING ENGINEERS, L.L.C. THAT HE POSSESSES THE PARTICULAR COMPETENCE AND SKILL IN CONSTRUCTION NECESSARY TO BUILD THIS PROJECT WITHOUT FULL ENGINEERING SERVICES, AND FOR THAT REASON THE CONTRACTOR OR HOME OWNER HAS RESTRICTED THE SCOPE OF PROFESSIONAL SERVICES. THE CONSTRUCTION DOCUMENTS PROVIDED BY THE LIMITED SERVICES SHALL BE TERMED 'BUILDER'S PLANS' IN RECOGNITION OF THE CONTRACTOR'S SOPHISTICATION. ALTHOUGH NORTON & SCHMIDT CONSULTING ENGINEERS, L.L.C. AND OUR CONSULTANTS HAVE PERFORMED THEIR SERVICES WITH DUE CARE AND DILIGENCE, WE CANNOT GUARANTEE PERFECTION. ANY AMBIGUITY OR DISCREPANCY DISCOVERED BY THE USE OF THESE PLANS SHALL BE REPORTED IMMEDIATELY TO NORTON & SCHMIDT CONSULTING ENGINEERS, L.L.C. CONSTRUCTION MAY REQUIRE THAT THE CONTRACTOR ADAPT THE 'BUILDER'S PLANS' TO THE FIELD CONDITIONS ENCOUNTERED AND MAKE LOGICAL ADJUSTMENTS IN FIT, FORM, DIMENSION AND QUANTITY. CHANGES MADE FROM THE PLANS WITHOUT THE CONSENT OF NORTON & SCHMIDT CONSULTING ENGINEERS, L.L.C. ARE UNAUTHORIZED. IT IS ALSO UNDERSTOOD THAT THE CONTRACTOR WILL BE RESPONSIBLE FOR MEETING ALL APPLICABLE BUILDING CODES INCLUDING BUT NOT LIMITED TO MECHANICAL, ELECTRICAL, AND PLUMBING CODE REQUIREMENTS (WHICH IS EXCLUDED FROM THESE PLANS). IN THE EVENT ADDITIONAL DETAIL OR GUIDANCE IS NEEDED BY THE CONTRACTOR OR HOMEOWNER FOR CONSTRUCTION OF ANY ASPECT OF THE PROJECT, NORTON & SCHMIDT CONSULTING ENGINEERS, L.L.C. OR A QUALIFIED ARCHITECT/ENGINEER SHALL IMMEDIATELY BE NOTIFIED BY US OF THESE NEEDS OR OF CHANGES TO THE PLANS SHALL RELIEVE NORTON & SCHMIDT CONSULTING ENGINEERS, L.L.C. OF ALL RESPONSIBILITIES OF THE CONSEQUENCES.

- ARCHITECTURAL NOTES:
1. WATER RESISTIVE EXTERIOR WALL COVERING, FREE FROM HOLES AND BREAKS, SHALL BE APPLIED TO STUDS OR SHEATHING OF ALL EXTERIOR WALLS. THE WALL SHALL BE INSTALLED PER MANUFACTURER'S RECOMMENDATIONS AND SHALL BE IN COMPLIANCE WITH SECTION R703.2.
2. BUILDING SHALL COMPLY WITH SECTIONS 802.3 AND 802.3.1 OF THE 2012 IRC FOR RAFTER AND CEILING JOIST CONNECTIONS.
3. 'UFER' GROUND SHALL BE PROVIDED PER IRC SECTION 3608.1
4. GUTTERS, DOWNSPOUTS, AND SPLASH BLOCKS SHALL BE PROVIDED TO INSURE ALL ROOF DRAINAGE IS DIRECTED 5 FEET MINIMUM FROM HOUSE BEFORE TOUCHING SOIL.

- STAIR NOTES:
1. MAXIMUM RISER AT STAIRWAYS IS 7 3/4" AND MINIMUM TREAD IS 10" WITH A MINIMUM 6"-8" HEADROOM, PER 2012 IRC SEC. R311.7.
2. PLACE HANDRAILS ON ALL STAIRS AND/OR LEVELS THAT EXCEED 30" ABOVE THE FLOOR OR GRADE. RAILINGS TO BE MIN. 36" HIGH AND HAVE INTERMEDIATE RAILS THAT DO NOT ALLOW THE PASSAGE OF A 4" DIAMETER SPHERE AND SHALL COMPLY W/ 2012 IRC SEC. R312.
3. ENCLOSE ACCESSIBLE SPACE BENEATH STAIRS SHALL HAVE WALLS AND THE UNDERSIDE OF THE STAIR AND LANDING PROTECTED WITH 1/2" GYPSUM BOARD ON ENCLOSURE SIDE PER SECTION R302.7.
4. STAIRWAYS CONSISTING OF 2 OR MORE RISERS SHALL HAVE A CONTINUOUS HANDRAIL ON AT LEAST ONE SIDE BETWEEN 34" AND 38" ABOVE THE STAIR NOSINGS.
5. HANDRAILS SHALL HAVE A CIRCULAR CROSS SECTION OF 1 1/4" MINIMUM TO 2" MAXIMUM OR OTHER APPROVED GRASPABLE SHAPE PER SECTION R311.7.10.11.
6. SPIRAL STAIRS SHALL BE CONSTRUCTED PER SECTION R311.7.10.11.

- EMERGENCY EGRESS NOTES:
1. ALL SLEEPING ROOMS AND BASEMENT SHALL BE PROVIDED WITH PROPER EMERGENCY ESCAPE AND RESCUE OPENINGS PER 2012 IRC SEC R310. PROVIDE (1) WINDOW IN EACH BEDROOM THAT HAS A MINIMUM OPERABLE AREA OF 5.7 SQ. FT. WITH A MINIMUM OPERABLE HEIGHT OF 24" AND WIDTH OF 21".
2. PROVIDE SMOKE ALARMS IN EACH SLEEPING ROOM, OUTSIDE OF EACH SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS AND ON EACH ADDITIONAL FLOOR, INCLUDING BASEMENTS AND STAIRWAYS. ALARMS SHALL BE INTERCONNECTED IN SUCH A MANNER THAT THE ACTIVATION OF ONE ALARM ACTIVATES ALL OTHERS AND BE HARD WIRED WITH A BATTERY BACKUP, PER 2012 IRC SEC. 5314 AND NFPA 72.
3. CARBON MONOXIDE DETECTORS SHALL BE PROVIDED PER R315.

- WINDOWS AND SAFETY GLAZING NOTES:
1. GLAZING IN HAZARDOUS LOCATIONS AS IDENTIFIED IN IRC SECTION R308.4 SHALL BE OF APPROVED SAFETY GLAZING MATERIALS. GLASS IN STORM DOORS, INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" ARCH OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR, WALLS ENCLOSING STAIRWAYS AND LANDINGS WHERE THE GLAZING IS WITHIN 60" OF THE TOP OR BOTTOM OF THE STAIR, ENCLOSURES FOR SPAS, TUBS, SHOWERS AND WHIRLPOOLS, GLAZING IN FIXED OR OPERABLE PANELS EXCEEDING 9 SQ. FT. AND WHOSE BOTTOM EDGE IS LESS THAN 18" ABOVE THE FLOOR OR WALKING SURFACE WITHIN 36".
2. ALL WINDOWS SHALL MEET THE FALL PROTECTION REQUIREMENTS OF SECTION R312.2.

- GARAGE:
1. GARAGE FLOORS SHALL SLOPE TOWARDS THE GARAGE DOORWAYS.
2. DOORS BETWEEN THE GARAGE AND THE DWELLING SHALL BE A MINIMUM 1 3/8" SOLID CORE OR HONEY COMBED STEEL DOOR OR A 20 MINUTE FIRE RATED DOOR.
3. THE GARAGE SHALL BE SEPARATED FROM THE DWELLING AND ITS UNFINISHED ATTIC AREAS BY A MINIMUM 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE, WHERE UNFINISHED ATTIC AREAS ARE PROVIDED ABOVE THE GARAGE. THE SUPPORTING COLUMNS AND BEAMS SHALL ALSO BE PROTECTED WITH 1/2" GYPSUM BOARD OR EQUIVALENT, WHERE HABITABLE SPACE OCCURS ABOVE THE GARAGE THE FLOOR/CEILING ASSEMBLY SHALL BE PROTECTED WITH A MINIMUM 5/8" TYPE X GYPSUM BOARD ON THE GARAGE CEILING, SHALL COMPLY WITH 2012 IRC SEC. R309.
4. GARAGE DOOR AND FRAME (HFRAME) FOR THE ATTACHMENT OF THE TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2X6 VERTICAL JAMBS RUNNING FROM THE FLOOR TO CEILING ATTACHED WITH 1 3/4"x12" NAILS @ 7"OC STAGGERED WITH (7) 3 1/4"x10 1/2" NAILS THRU THE JAMB INTO THE HEADER, MINIMUM 2X8 HEADER FOR ATTACHMENT FOR COUNTER BALANCE SYSTEM.
5. BUILDING SHALL COMPLY WITH THE REQUIREMENTS FOR A SELF CLOSING DOOR BETWEEN RESIDENCE AND GARAGE.
6. GARAGE DOORS SHALL MEET THE REQUIREMENTS OF DASMA 90 MPH.

- STRUCTURAL STEEL:
1. ALL STRUCTURAL STEEL SHALL CONFORM TO THE FOLLOWING:
a. STRUCTURAL STEEL _____ ASTM A992, FY = 50 KSI
b. MISCELLANEOUS STEEL _____ ASTM A36
c. HOLLOW STRUCTURAL STEEL (HSS) _____ ASTM A500, GRADE B
d. STEEL PIPE _____ ASTM A53, GRADE B (SCHED 40 MIN)
2. ALL BEAM CONNECTIONS SHALL BE DESIGNED BY THE STEEL FABRICATOR UNDER THE DIRECTION OF A REGISTERED PROFESSIONAL ENGINEER UNLESS SPECIFIC CONNECTIONS ARE SHOWN ON THE DRAWINGS. CONNECTIONS SHALL BE DESIGNED TO 50% U.L.L. OR THE REACTION PROVIDED ON THE DRAWINGS, WHICH EVER IS GREATER. CONNECTIONS SHALL BE WELDED OR BOLTED PER AISC STEEL CONSTRUCTION MANUAL 13TH EDITION. BOLTS SHALL BE ASTM A325N.
3. ALL COLUMN ANCHOR BOLTS SHALL BE ASTM F1554 GRADE 36.
4. WELDING SHALL CONFORM TO THE LATEST PUBLICATION OF APPLICABLE CODES SET FORTH BY THE AMERICAN WELDING SOCIETY. NO UNAUTHORIZED WELDS MAY BE ACCEPTED.
5. PROVIDE 30# FELT BOND BREAK AROUND ALL STEEL COLUMNS WHERE IN CONTACT WITH SLAB-ON-GRADE.
6. ALL EXTERIOR STEEL EXPOSED TO THE ELEMENTS SHALL BE HOT DIPPED GALVANIZED UNLESS NOTED OTHERWISE. ALL STRUCTURAL STEEL SHALL HAVE ONE COAT OF RUST INHIBITIVE PRIMER CONFORMING TO SPECIFICATIONS. FIELD TOUCHUP ALL UNPAINTED AREAS AND WELD AREAS.

- WOOD FRAMING NOTES:
1. LUMBER (RAFTERS, CEILING JOISTS, PURLINS AND HEADERS) SHALL BE DOUGLAS FIR LARCH #2 OR BETTER UNLESS OTHERWISE NOTED ON THE DRAWINGS. ALL LOAD BEARING WALL STUDS AND PURLIN STRUTS SHALL BE DOUGLAS FIR STUD GRADE OR BETTER.
2. GLUE LAMINATED MEMBERS MARKED 'LVL' (LAMINATED VENEER LUMBER) SHALL HAVE A MINIMUM ALLOWABLE BENDING STRESS (FB) OF 2600 PSI, A MINIMUM ALLOWABLE SHEAR STRESS (FV) OF 265 PSI, AND A MINIMUM MODULUS OF ELASTICITY (E) OF 2,000 KSI. ALL MANUFACTURER'S RECOMMENDATIONS FOR NAILING AND CONNECTIONS SHALL BE FOLLOWED.
3. FLOOR JOISTS BELOW PARTITION WALLS RUNNING PARALLEL TO THE JOIST SPAN SHALL BE DOUBLED. ALL DOUBLED MEMBERS SHALL BE NAILED TOGETHER WITH 16D NAILS 16" ON CENTER IN TWO ROWS STAGGERED OR PER MANUFACTURER SPECS.
4. SOLID BLOCKING BETWEEN FLOOR JOISTS SHALL BE INSTALLED WHERE JOISTS BEAR ON TOP OF BEAMS OR HEADERS AND BELOW POINT LOADS. ALL SOLID BLOCKING AND RIM JOIST MATERIAL SHALL BE THE SAME SIZE AND GRADE AS THE JOISTS.
5. ALL FLOOR AND CEILING JOISTS THAT BUTT INTO THE SIDE OF A HEADER OR STEEL BEAM SHALL BE ANCHORED TO THE HEADER OR STEEL BEAM WITH STANDARD JOIST HANGERS.
6. ALL SUPPORTS FOR WOOD TRUSSES, RAFTERS AND PURLINS, UNLESS SHOWN OTHERWISE ON THE DRAWINGS, SHALL BEAR ON LOAD BEARING WALLS (WALLS LOCATED DIRECTLY ABOVE A BEAM LINE OR CONTINUOUS FOOTING) ALL CONCENTRATED LOADS SHALL BE CARRIED THROUGH THE FLOOR SYSTEM THICKNESS WITH SOLID BLOCKING OR WITH 2X4 STUB COLUMNS (SQUASH BLOCKS) THAT TRANSFER THE LOAD DOWN TO THE SUPPORT WALL OR BEAM BELOW.
7. ALL NAILING NOT INDICATED ON THE DRAWINGS SHALL CONFORM TO THE NAILING SCHEDULE OF THE GOVERNING BUILDING CODE. SPACING, END DISTANCES AND EDGE DISTANCES OF NAILS AND SPIKES SHALL BE SUCH AS TO AVOID THE UNUSUAL SPLITTINGS OF THE WOOD.
8. ALL NON-LOADBEARING STUD WALLS IN THE BASEMENT SHALL BE PROVIDED WITH A 1" MINIMUM VERTICAL EXPANSION JOINT TO ALLOW FOR HEAVE IN THE FLOOR SLAB. WALLS SHALL NOT BE TIGHT BETWEEN THE SLAB AND THE FRAMING ABOVE! SHEATHING FOR HORIZONTAL DIAPHRAGMS SHALL BE EXTERIOR GRADE, CID, STRUCTURAL GROUP II OR BETTER. ROOF AND WALL FRAMING SHALL BE OF DOUGLAS FIR-LARCH OR SOUTHERN PINE. PROVIDE SOLID BLOCKING AT ALL PANEL EDGES UNLESS OTHERWISE NOTED. WHERE PANELS ARE APPLIED ON BOTH FACES OF A WALL, PANEL JOINTS SHALL BE OFFSET TO FALL ON DIFFERENT FRAMING MEMBERS.
9. ALL WOOD STRUCTURAL PANELS SHALL BE IDENTIFIED WITH THE APPROPRIATE GRADE TRADEMARK OF THE AMERICAN PLYWOOD ASSOCIATION (APA) AND SHALL MEET THE REQUIREMENTS OF PRODUCT STANDARD PS-1. WOOD STRUCTURAL PANELS SHALL BE SET WITH FACE GRAIN PERPENDICULAR TO SUPPORTING MEMBERS AND STAGGER END JOINTS 4'-0".
10. STANDARD WASHERS SHALL BE USED WITH ALL BOLTS FASTENING WOOD MEMBERS.
11. ALL SAWN LUMBER EXPOSED TO WEATHER OR IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED.
12. ROOF FRAMING - RIDGE BEAMS, VALLEY AND HIP RAFTERS SHALL HAVE A MINIMUM NOMINAL THICKNESS OF 2" AND MINIMUM DEPTH NOT LESS THAN THE END CUT OF THE RAFTERS. HIP AND VALLEY RAFTERS SHALL BE SUPPORTED AT THE RIDGE BY A 2X6 "TEE" BRACE TO A BEARING PARTITION, WHERE ROOF BRACING IS USED TO PERMIT LONGER RAFTERS SPAN, USE 2X6 "TEE" BRACES AT 4'-0" O.C. WITH CONTINUOUS 2X6 PURLIN UNDER THE RAFTERS. BRACE RAFTERS TO BEARING PARTITIONS.
13. PROVIDE CONTINUOUS STRONG BACKS FOR CEILING JOIST SPANS 12'-0" OR GREATER.
14. MAXIMUM FLOOR JOIST SPANS SHALL BE AS FOLLOWS FOR THE SIZE AND SPACING OF THE JOISTS INDICATED (40 PSF LIVE LOAD, 10 PSF DEAD LOAD):
a. 2X8S AT 16" O.C. - 12'-7"
b. 2X10S AT 16" O.C. - 15'-5"
c. 2X10S AT 12" O.C. - 16'-10"
d. 2X12S AT 16" O.C. - 17'-10"
15. CEILING JOISTS (C.J.'S) ARE DFIL #2, AT 16" O.C., WITH AN ALLOWABLE SPAN AS FOLLOWS, OR AS SHOWN ON PLANS:
a. 2X8S AT 16" O.C. - 16'-3"
c. 2X10S AT 16" O.C. - 19'-10"
d. 2X12S AT 16" O.C. - 22'-0"
16. ROOF RAFTERS (R.'S) ARE DFIL #2, WITH AN ALLOWABLE RAFTER SPAN AS FOLLOWS:
a. 2X8S AT 16" O.C. - 12'-7"
b. 2X8S AT 24" O.C. - 10'-0"
c. 2X8S AT 16" O.C. - 12'-0"
d. 2X8S AT 16" O.C. - 12'-4"
e. 2X8S AT 16" O.C. - 15'-1"
17. BRACE THE COMPRESSION FLANGE OF ALL BEAMS UNLESS NOTED OTHERWISE.
18. ALL BEAMS OR HEADERS THAT BEAR ON WOOD FRAMING SHALL BE SUPPORTED BY ANOTHER BEAM OR HEADER OR A BUILT-UP STUD COLUMN THE FULL WIDTH OF THE BEAM CONTINUOUS TO THE FOUNDATION OR OTHER STRUCTURAL FRAMING MEMBER, UN O.
19. ALL LIGHT GAGE METAL FRAMING ACCESSORIES NOTED SHALL BE AS MANUFACTURED BY 'SIMPSON STRONG TIE' OR APPROVED EQUAL, ATTACH FRAMING ACCESSORIES TO WOOD FRAMING IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
20. PROVIDE HEADERS AS SHOWN ON PLAN, FOR HEADERS NOT MARKED REFERENCE TYPICAL BEARING WALL HEADER SCHEDULE.
21. FLOOR SHEATHING SHALL BE 3/4" TONGUE & GROOVE WOOD STRUCTURAL PANEL. GLUE & NAIL TO FLOOR JOISTS WITH 8D NAILS AT 6" O.C. AT ALL PANEL EDGES AND AT 12" O.C. AT INTERMEDIATE SUPPORTS.
22. ALL EXTERIOR WOOD WALL FRAMING SHALL BE 2X6 DOUG-FIR NO. 2 AT 16" OC, UNO.
23. ALL INTERIOR BEARING WALL FRAMING SHALL BE 2X4 DOUG-FIR NO. 2 AT 16" OC, UNO.
24. WOOD TRUSSES AND THEIR CONNECTIONS SHALL BE DESIGNED BY THE TRUSS MANUFACTURER FOR THE LOADS STIPULATED ON THE DRAWINGS. SHOP DRAWINGS AND CALCULATIONS WITH AN ENGINEER'S SEAL FOR THE STATE OF MISSOURI SHALL BE SUBMITTED FOR REVIEW PRIOR TO FABRICATION. CONNECTION PLATES SHALL MEET THE REQUIREMENTS OF THE GOVERNING BUILDING CODE.
25. TEMPORARY STABILITY OF WOOD TRUSSES DURING ERECTION SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR IN CONJUNCTION WITH ALL RECOMMENDATIONS OF THE MANUFACTURER.
26. WOOD TRUSSES SHALL NOT BE FIELD CUT.

- ENERGY REQUIREMENTS:
1. THE BUILDING THERMAL ENVELOPE SHALL BE SEALED WITH AN AIR BARRIER PER 2012 IRC SEC N1102.
2. LIGHTING FIXTURES PENETRATING THE THERMAL ENVELOPE SHALL BE RATED AND SEALED TO THE GYPSUM WALLBOARD AS REQUIRED PER N1102.4.4.
3. PROGRAMMABLE THERMOSTATS SHALL BE INSTALLED AS REQUIRED PER N1103.1.1.
4. AIR HANDERS SHALL BE RATED FOR MAXIMUM 2% AIR LEAKAGE RATE PER N1103.2.2.1.
5. BUILDING CAVITIES USED AS RETURN AIR PLENUMS SHALL BE SEALED TO PREVENT LEAKAGE ACROSS THE THERMAL ENVELOPE AS REQUIRED PER N1103.2.3.
6. BUILDING CAVITIES IN A THERMAL ENVELOPE WALL SHALL NOT BE USED AS RETURN AIR PLENUMS UNLESS THE REQUIRED INSULATION BARRIER IS MAINTAINED PER M1601.1.1.
7. HOT WATER PIPES SHALL BE INSULATED AS REQUIRED PER N1103.4.
8. ALL EXHAUST FANS SHALL TERMINATE TO THE BUILDING EXTERIOR AS REQUIRED PER M1507.2.
9. MAKEUP AIR SYSTEMS SHALL BE INSTALLED FOR KITCHEN EXHAUST HOODS THAT EXCEED 400 CFM AS REQUIRED PER M1503.4.
10. AN AIR HANDLING SYSTEM SHALL NOT SERVE BOTH THE LIVING SPACE AND THE GARAGE PER M1601.6.
11. MINIMUM MECHANICAL EFFICIENCY RATING FOR AC EQUIPMENT IS 13 SEER AS REQUIRED PER 2012 IRC.
12. MINIMUM MECHANICAL EFFICIENCY RATING FOR FORCED AIR FURNACE IS 78% AS REQD PER 2012 IRC.

- INSULATION AND FENESTRATION REQUIREMENTS - IRC TABLE N1102.1.1:
FENESTRATION U<=0.35 (b)
SKYLIGHT U<=0.55 (b)
CEILING - FLAT R-49
CEILING - VAULTED R-38
WOOD FRAME WALL R-13
MASS WALL R-8R-13 (f)
FLOOR OVER UNHEATED SPACE R-19
FLOOR OVER OUTSIDE AIR R-30
DUCTS OUTSIDE OF THE CONDITIONED SPACE R-8
BASEMENT WALL R-10R-13 (c)
SLAB (R VALUE/DEPTH) R-10/2ft (d)
CRAWLSPACE WALL W/ FLOOR INSULATION R-10R-13 (c)
CRAWLSPACE WALL W/O FLOOR INSULATION R-19
a. R VALUES ARE MINIMUMS. U - FACTORS ARE MAXIMUMS. WHEN INSULATION IS INSTALLED IN A CAVITY WHICH IS LESS THAN THE LABEL OR DESIGN THICKNESS OF THE INSULATION, THE INSTALLED R-VALUE OF THE INSULATION SHALL NOT BE LESS THAN THE R-VALUE SPECIFIED IN THE TABLE.
b. THE FENESTRATION U - FACTOR EXCLUDES SKYLIGHTS.
c. THE FIRST R VALUE APPLIES TO CONTINUOUS INSULATION, THE SECOND TO FRAMING CAVITY INSULATION; EITHER INSULATION MEETS THE REQUIREMENT.
d. R - 5 SHALL BE ADDED TO THE REQUIRED SLAB EDGE R - VALUES FOR HEATED SLABS. INSULATION DEPTH SHALL BE THE DEPTH OF THE FOOTING OR 2 FEET WHICHEVER IS LESS IN ZONES 1 THROUGH 3 FOR HEATED SLABS.
e. THERE ARE NO SHRO- REQUIREMENTS IN THE MARINE ZONE.
f. BASEMENT WALL INSULATION IS NOT REQUIRED IN WARM-HUMID LOCATIONS AS DEFINED BY FIGURE N1101.10 AND TABLE N110.10.
g. OR INSULATION SUFFICIENT TO FILL THE CAVITY, R - 19 MINIMUM.
h. FIRST VALUE IS CAVITY INSULATION, SECOND IS CONTINUOUS INSULATION OR INSULATED SIDING, SO "13+5" MEANS R-13 CAVITY INSULATION PLUS R-5 CONTINUOUS INSULATION OR INSULATED SIDING. IF STRUCTURAL SHEATHING COVERS 40 PERCENT OR LESS OF THE EXTERIOR, CONTINUOUS INSULATION R-VALUE SHALL BE PERMITTED TO BE REDUCED BY NO MORE THAN R-3 IN THE LOCATIONS WHERE STRUCTURAL SHEATHING IS USED - TO MAINTAIN A CONSISTENT TOTAL SHEATHING THICKNESS.
i. THE SECOND R-VALUE APPLIES WHEN MORE THAN HALF OF THE INSULATION IS ON THE INTERIOR OF THE MASS WALL.

ABBREVIATIONS LEGEND

Table with 2 columns: Abbreviation and Meaning. Includes entries like AB ANCHOR BOLT, ACI AMERICAN CONCRETE INSTITUTE, AFF ABOVE FINISH FLOOR, etc.

SYMBOLS LEGEND

Table with 3 columns: Symbol, Description, and Meaning. Includes symbols for ELEVATION DESCRIPTION, CUT SYMBOL, SECTION CUT, ELEVATION DETAIL, BLOWUP DETAIL, WOOD STRUCTURAL PANEL, etc.

Professional Engineer information for Brandon Schwabauer, State of Missouri, License PE-2015003020, dated 04/03/2020. Includes contact info for Norton & Schmidt Consulting Engineers, L.L.C.

PROJECT INFORMATION: THE LEXINGTON II, 2521 SW River Trail Road, Lee's Summit, Missouri. Includes drawing number S500.

ISSUES & REVISIONS table with columns #, DATE, DESCRIPTION. Row 1: 04/03/2020 PERMIT.

DRAWN BY: MLR
CHECKED BY: BSS
ISSUED FOR:

SHEET TITLE
GENERAL NOTES

SHEET NUMBER
S500

PROJECT INFORMATION
 THE LEXINGTON II
 2521 SW River Trail Road
 Lee's Summit, Missouri


ISSUES & REVISIONS

#	DATE	DESCRIPTION
	04/03/2020	PERMIT


DRAWN BY: MLR
 CHECKED BY: BSS
 ISSUED FOR:

SHEET TITLE
 DETAILS


SHEET NUMBER
 S501

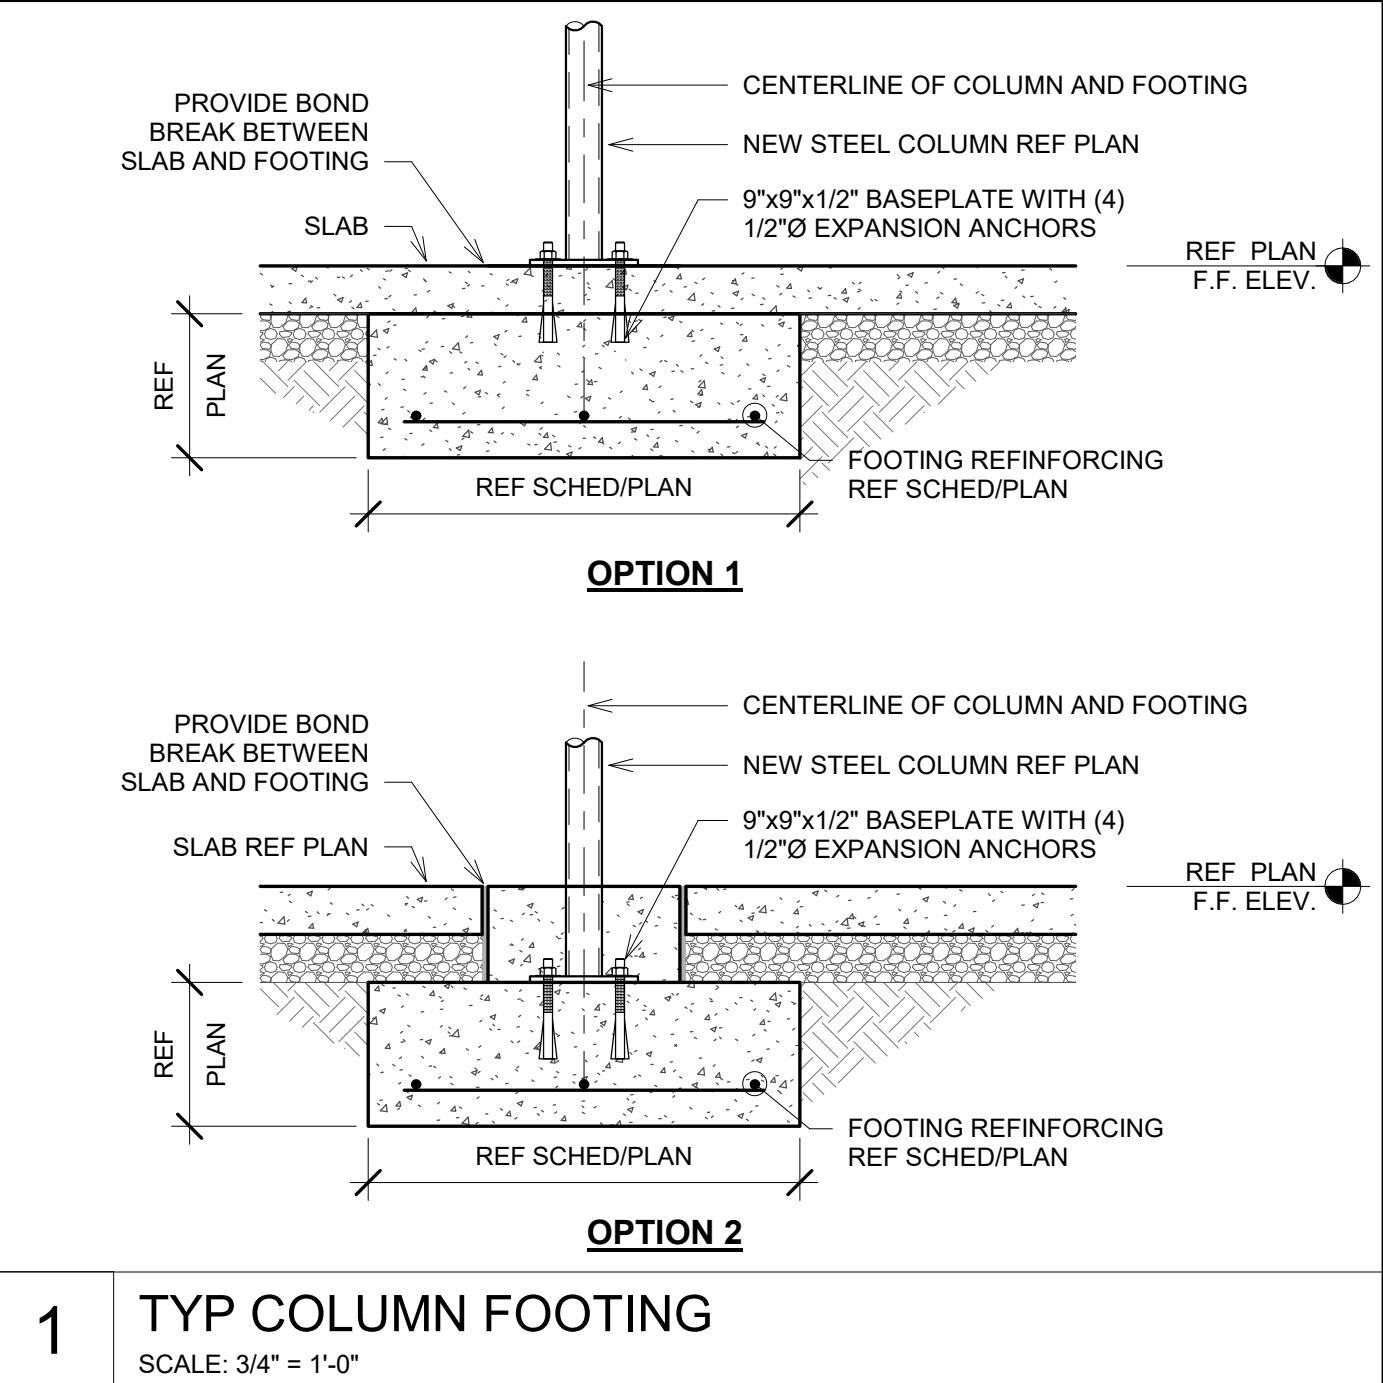


1 TYP COLUMN FOOTING
 SCALE: 3/4" = 1'-0"

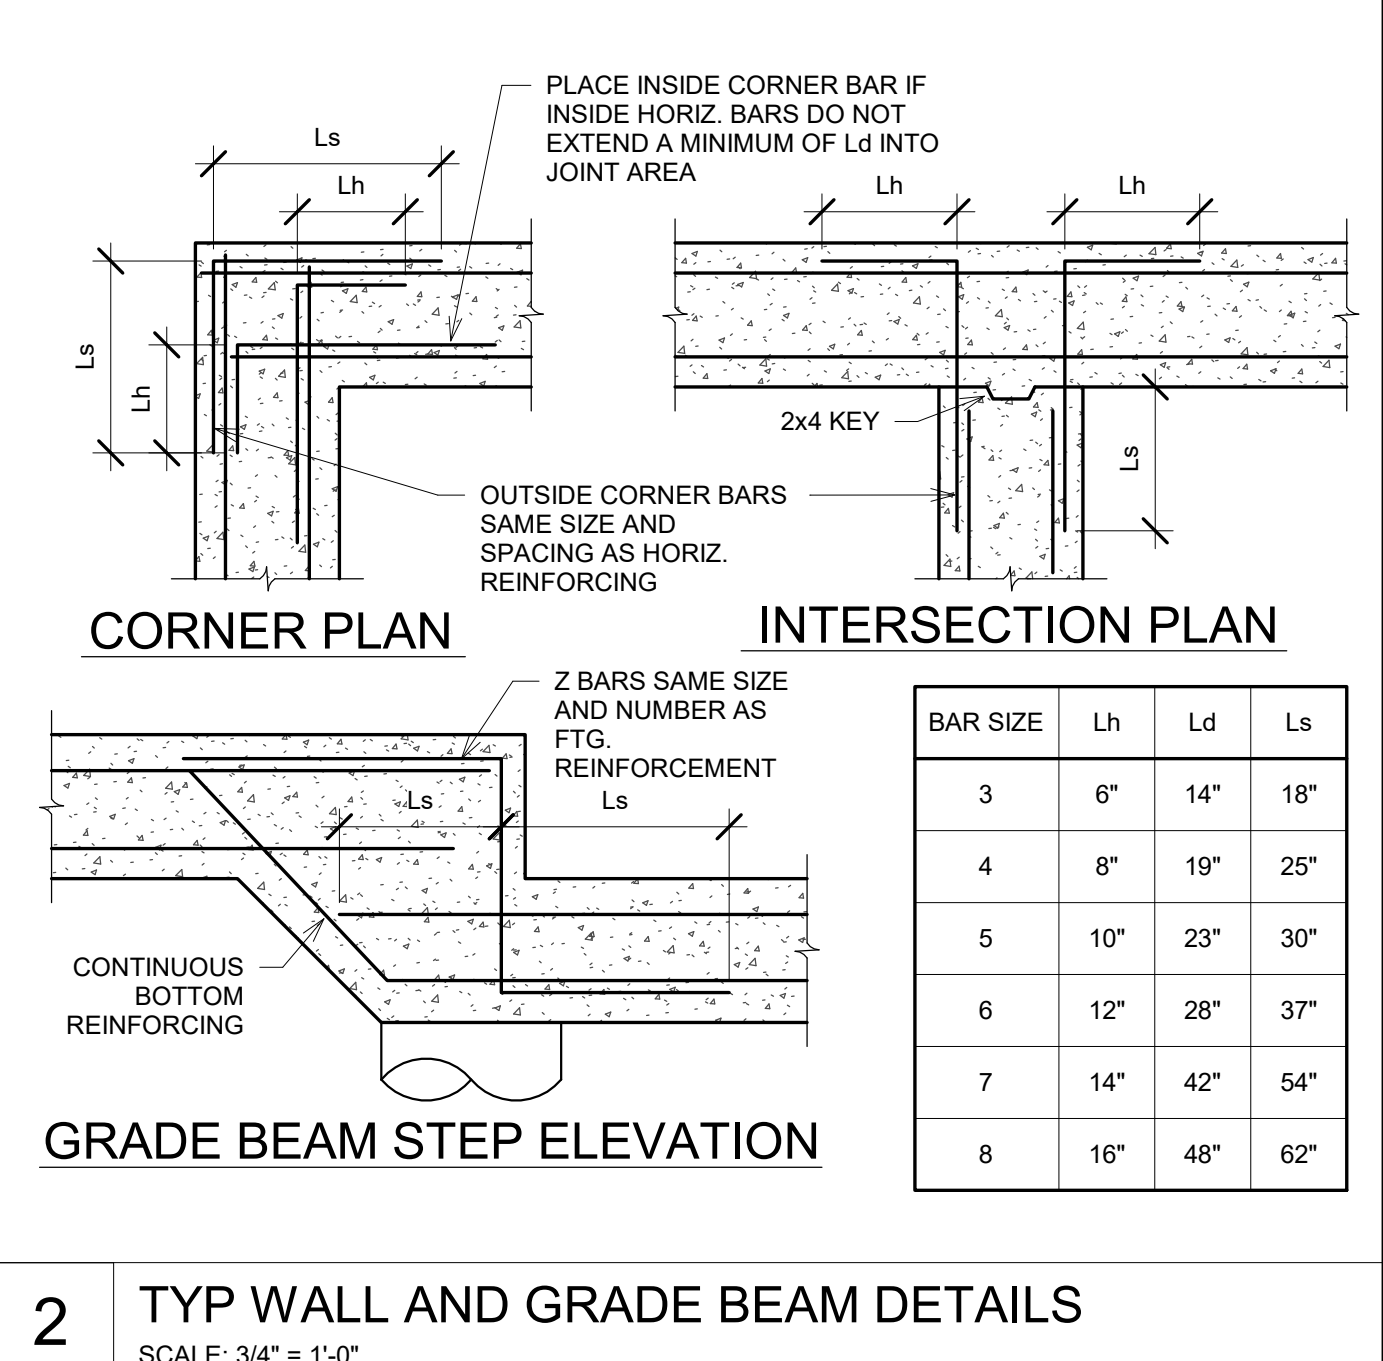


2 TYP WALL AND GRADE BEAM DETAILS
 SCALE: 3/4" = 1'-0"

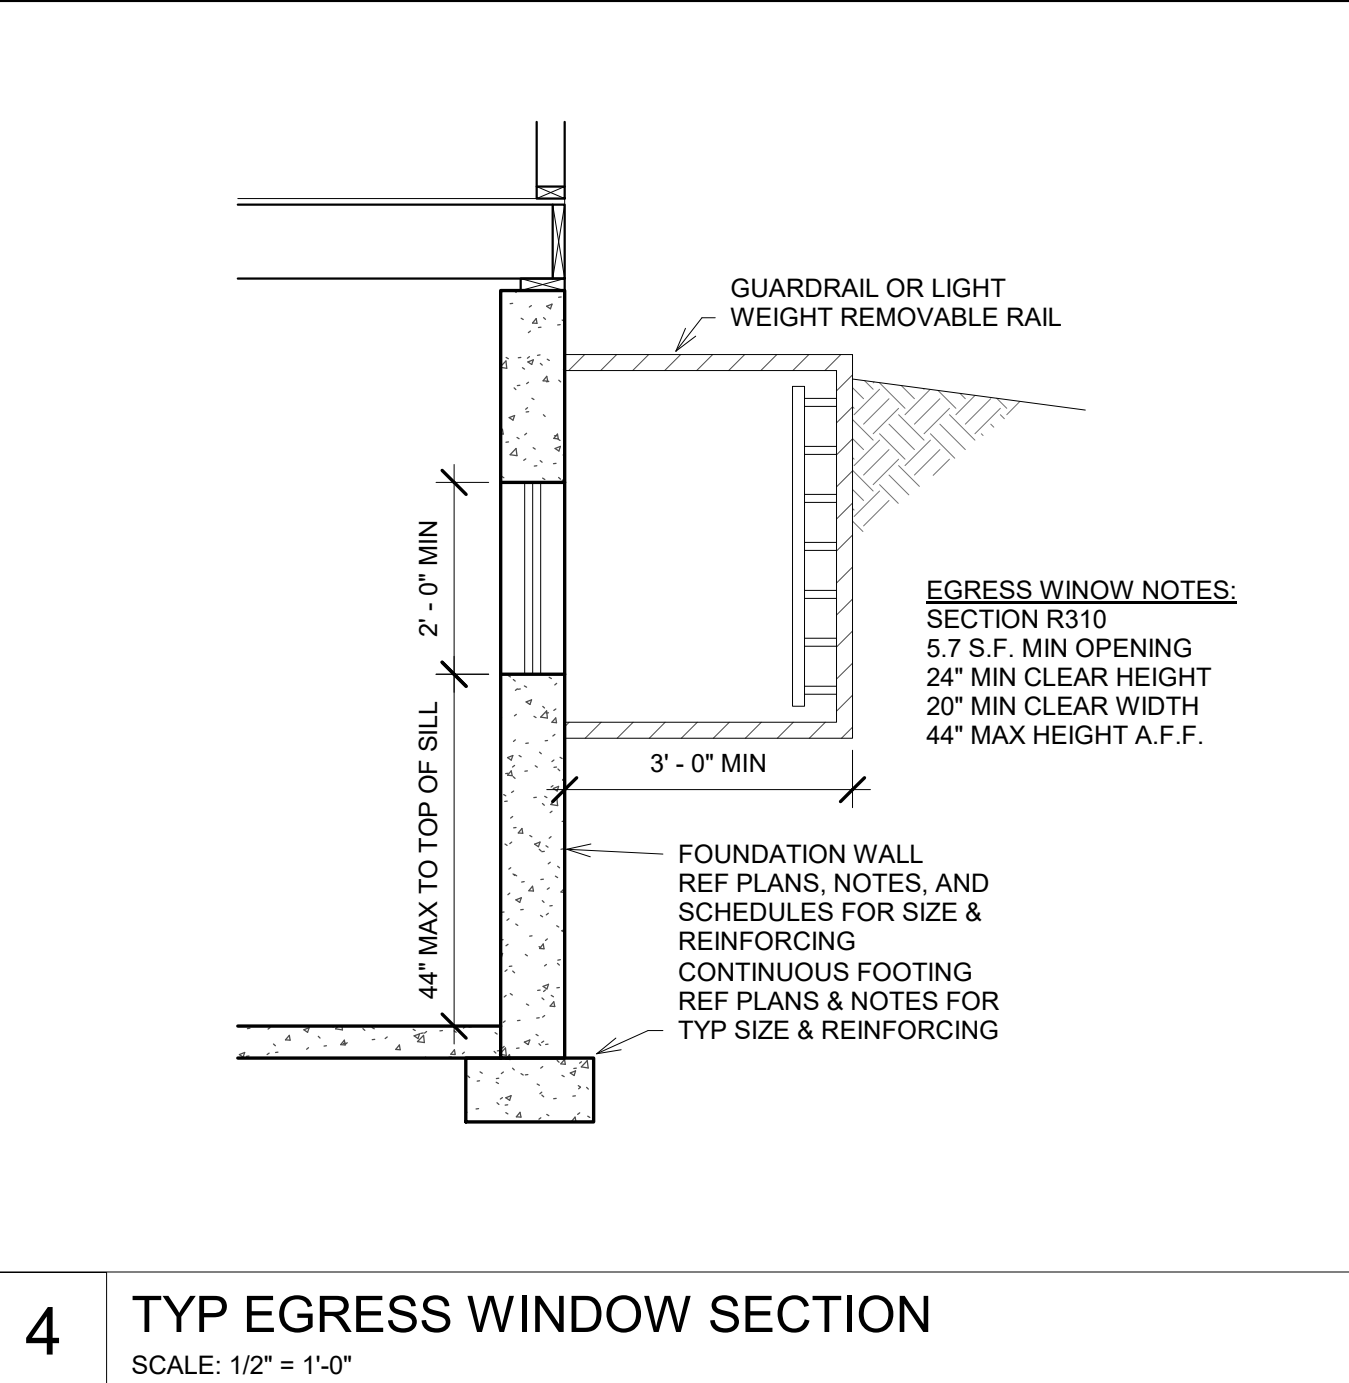


4 TYP EGRESS WINDOW SECTION
 SCALE: 1/2" = 1'-0"

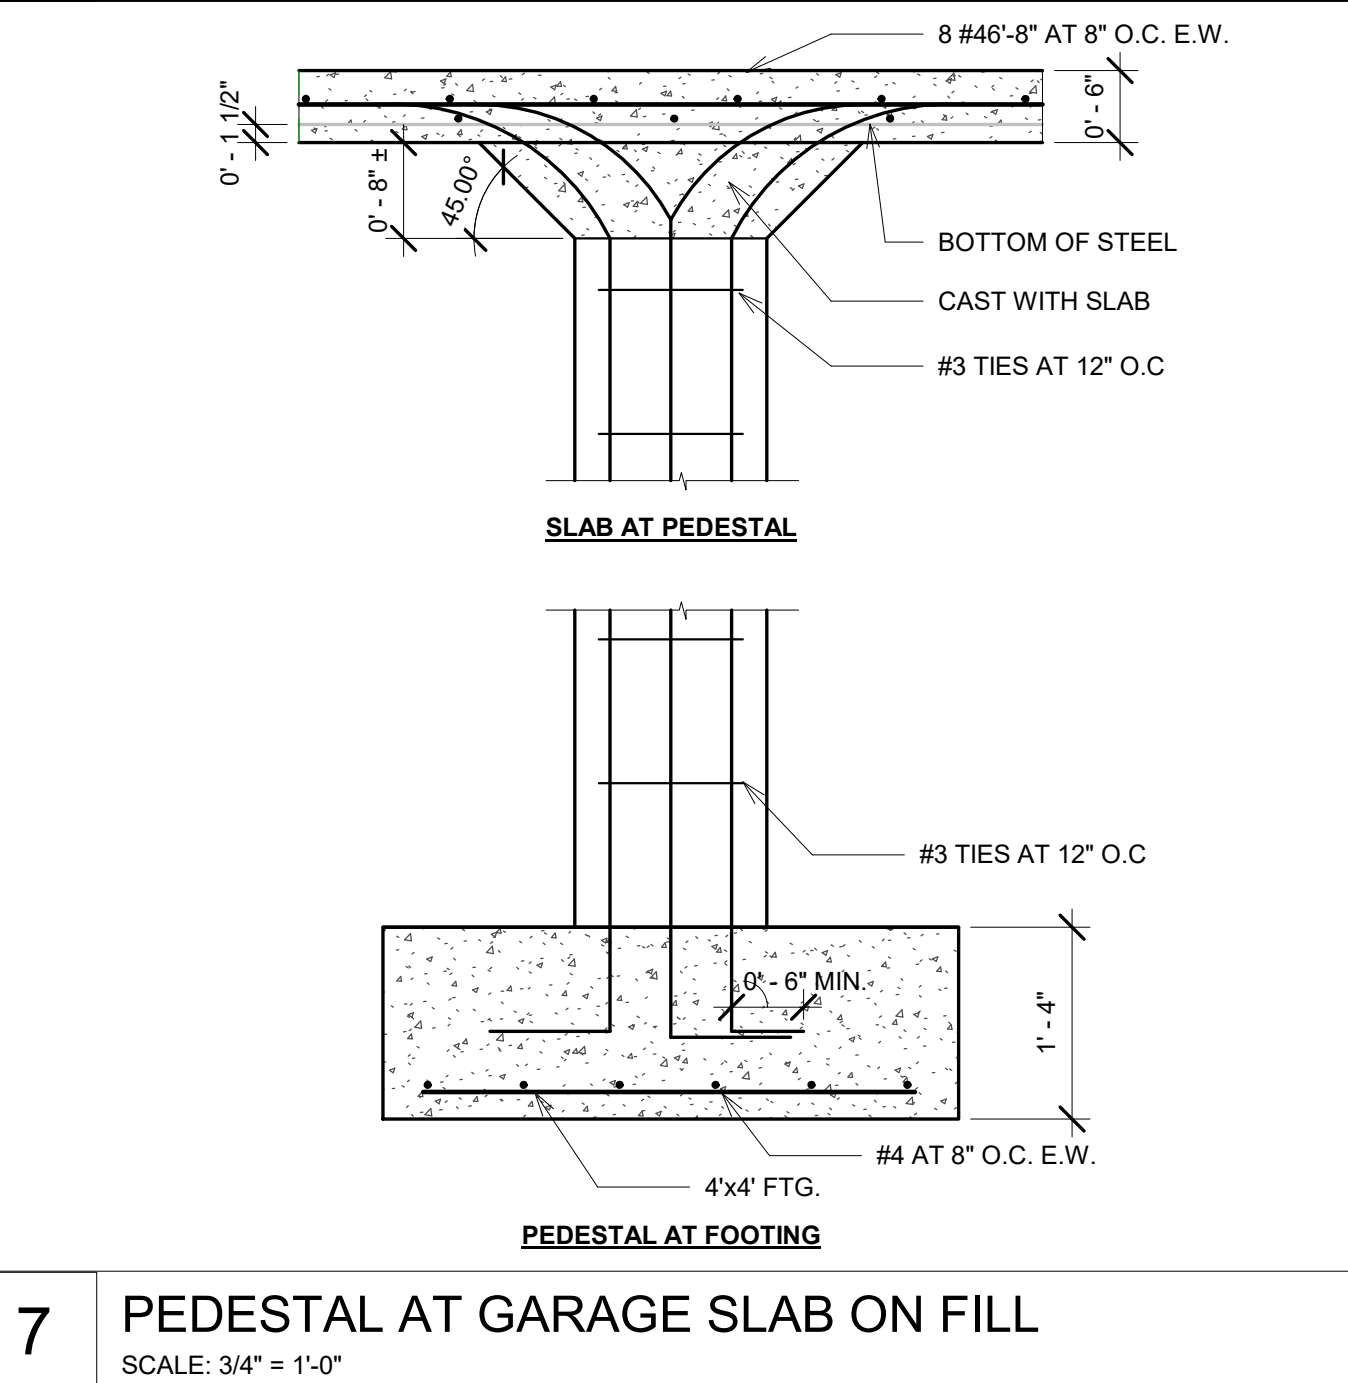


7 PEDESTAL AT GARAGE SLAB ON FILL
 SCALE: 3/4" = 1'-0"

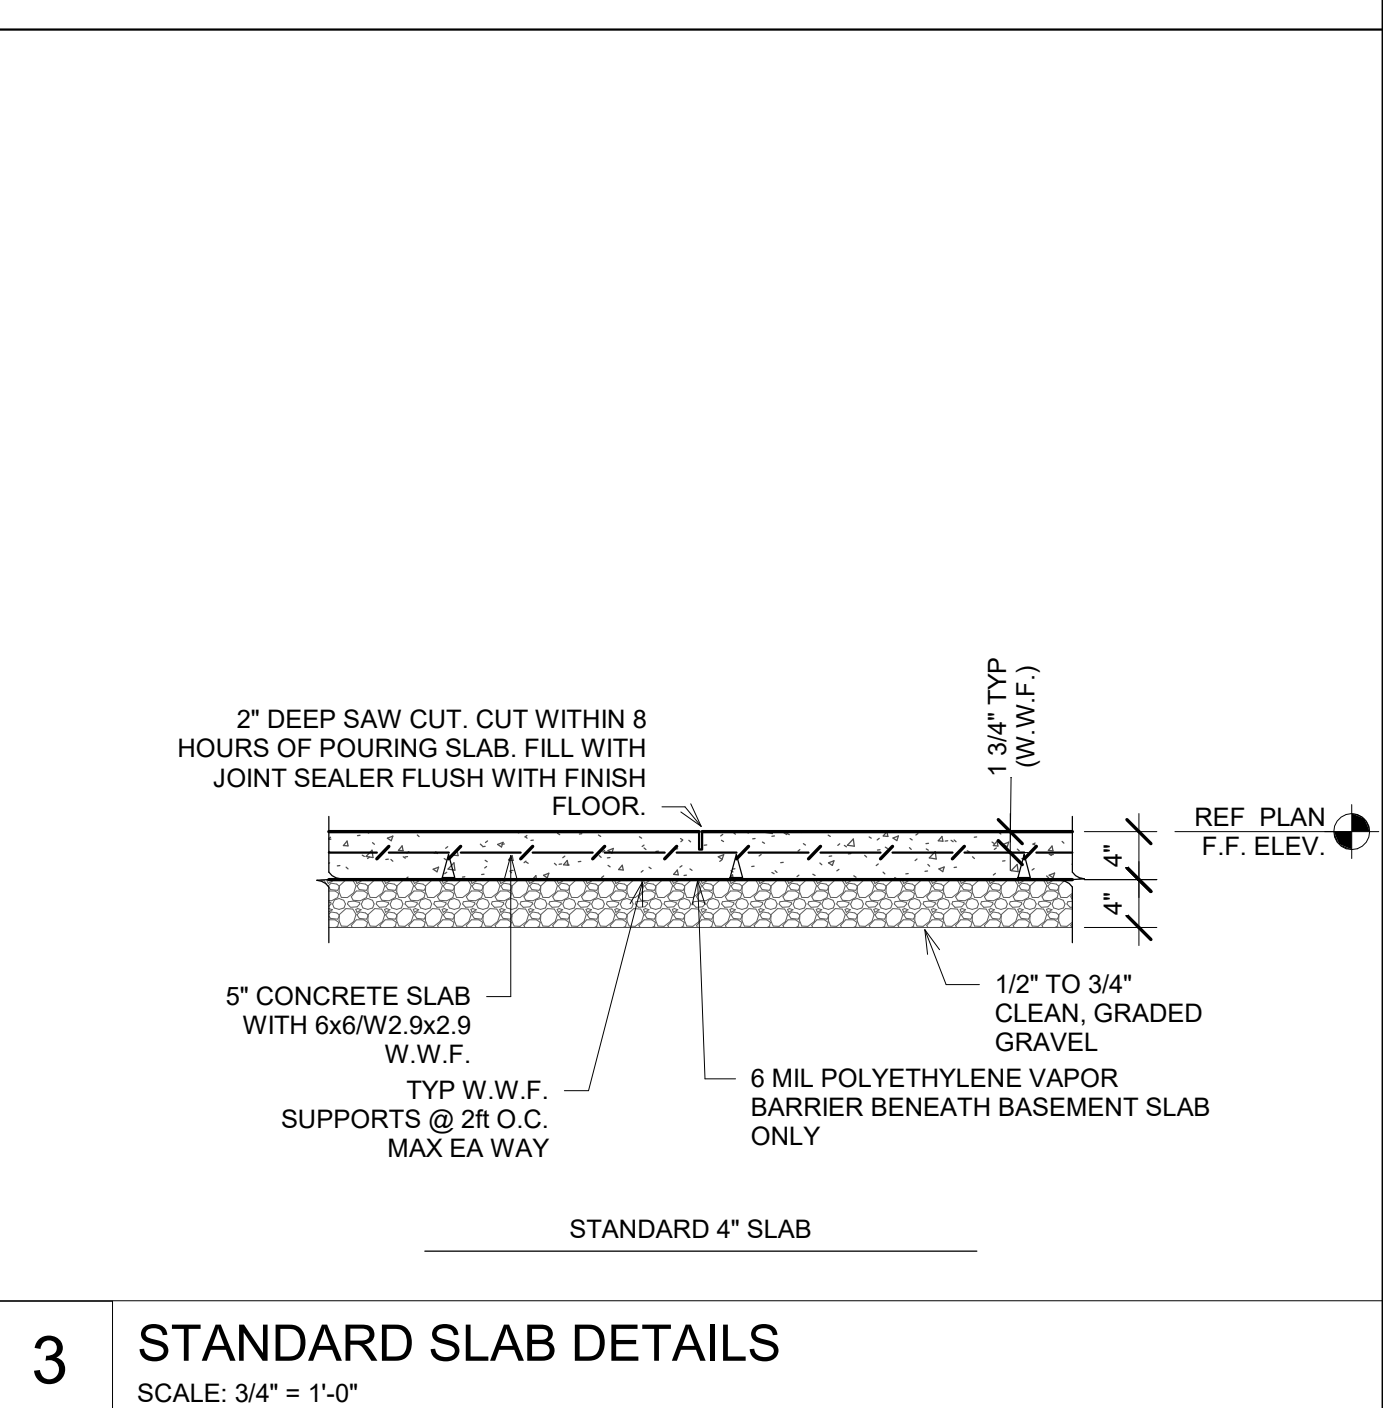


3 STANDARD SLAB DETAILS
 SCALE: 3/4" = 1'-0"

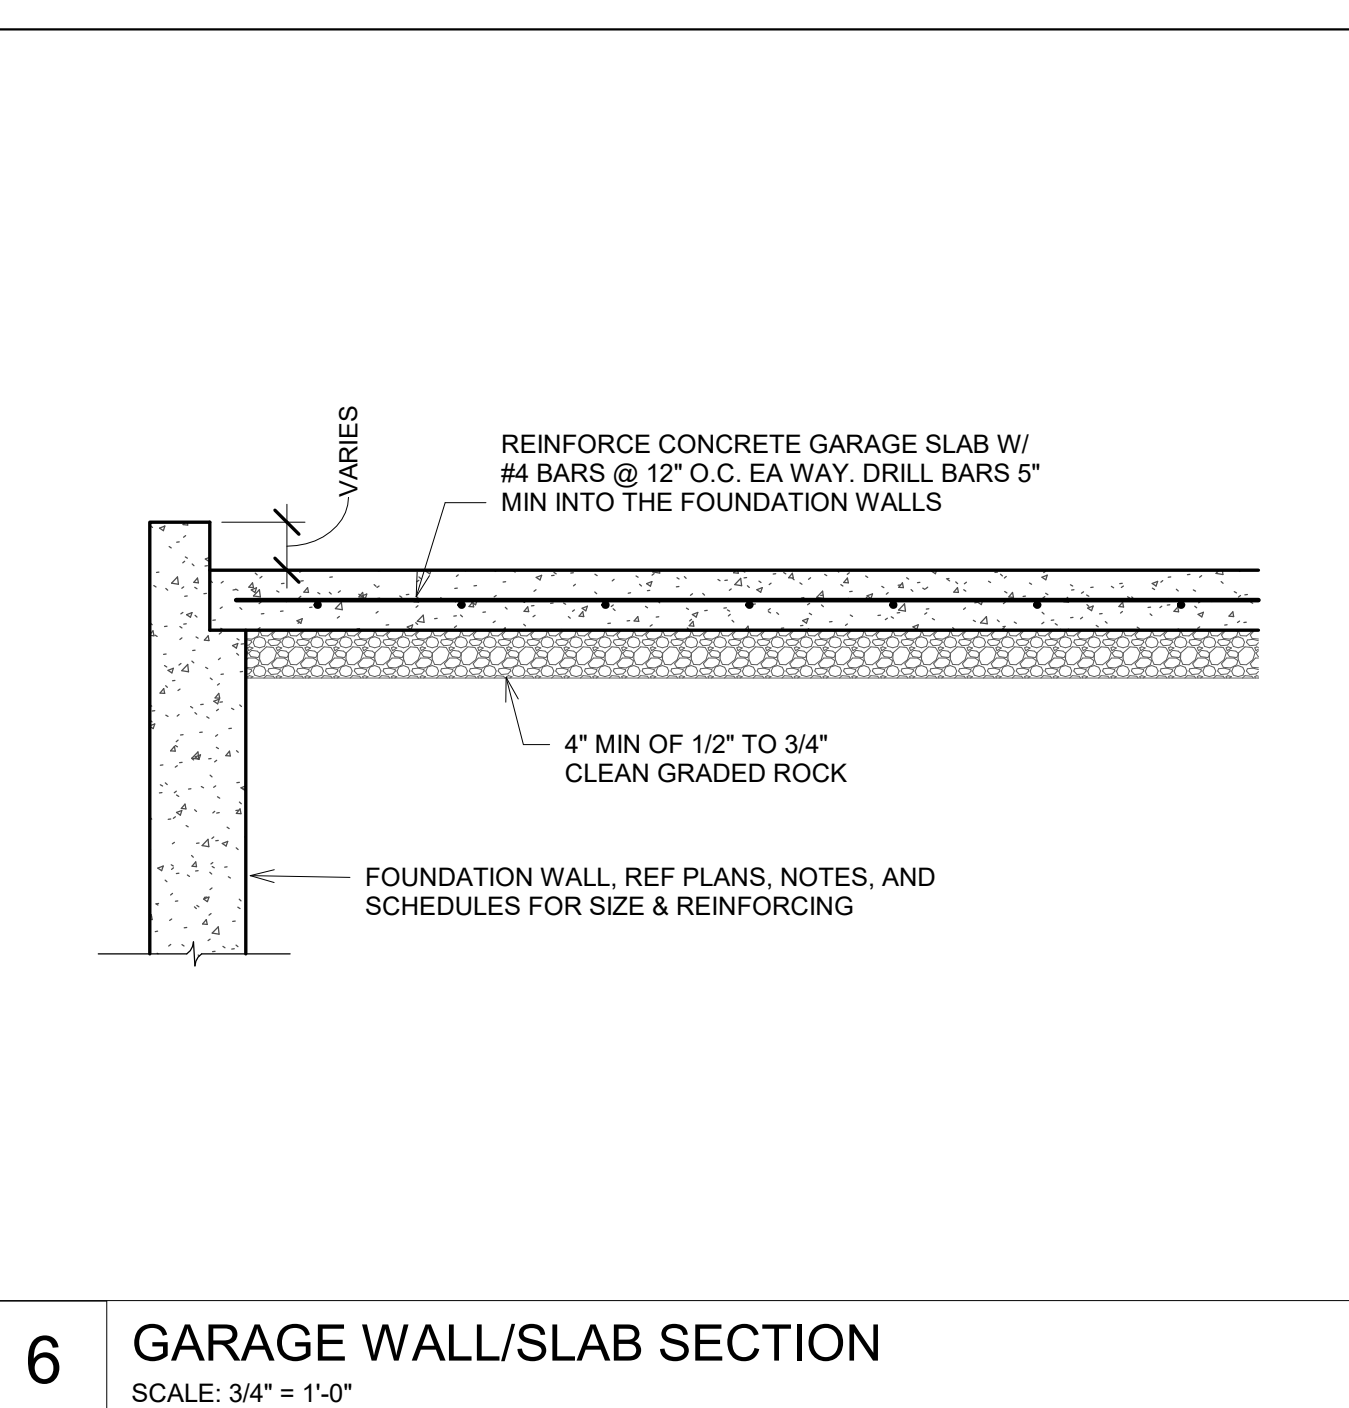


6 GARAGE WALL/SLAB SECTION
 SCALE: 3/4" = 1'-0"

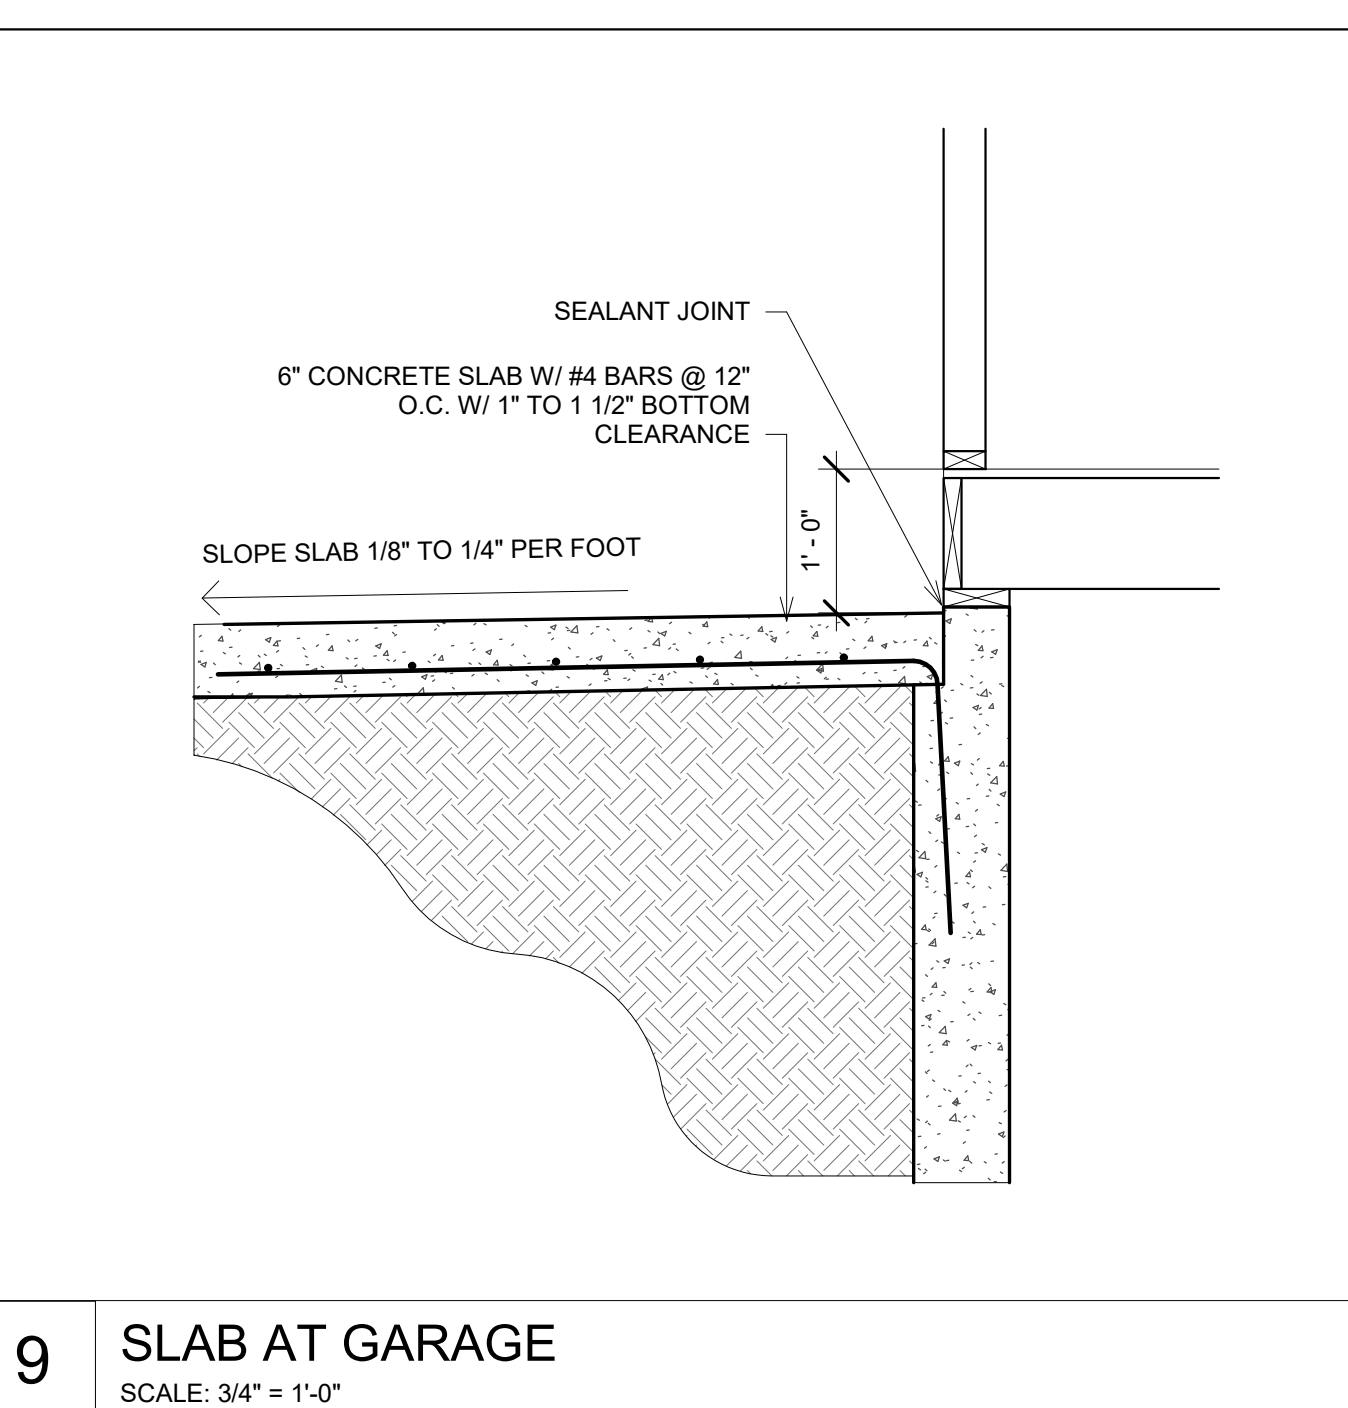


9 SLAB AT GARAGE
 SCALE: 3/4" = 1'-0"

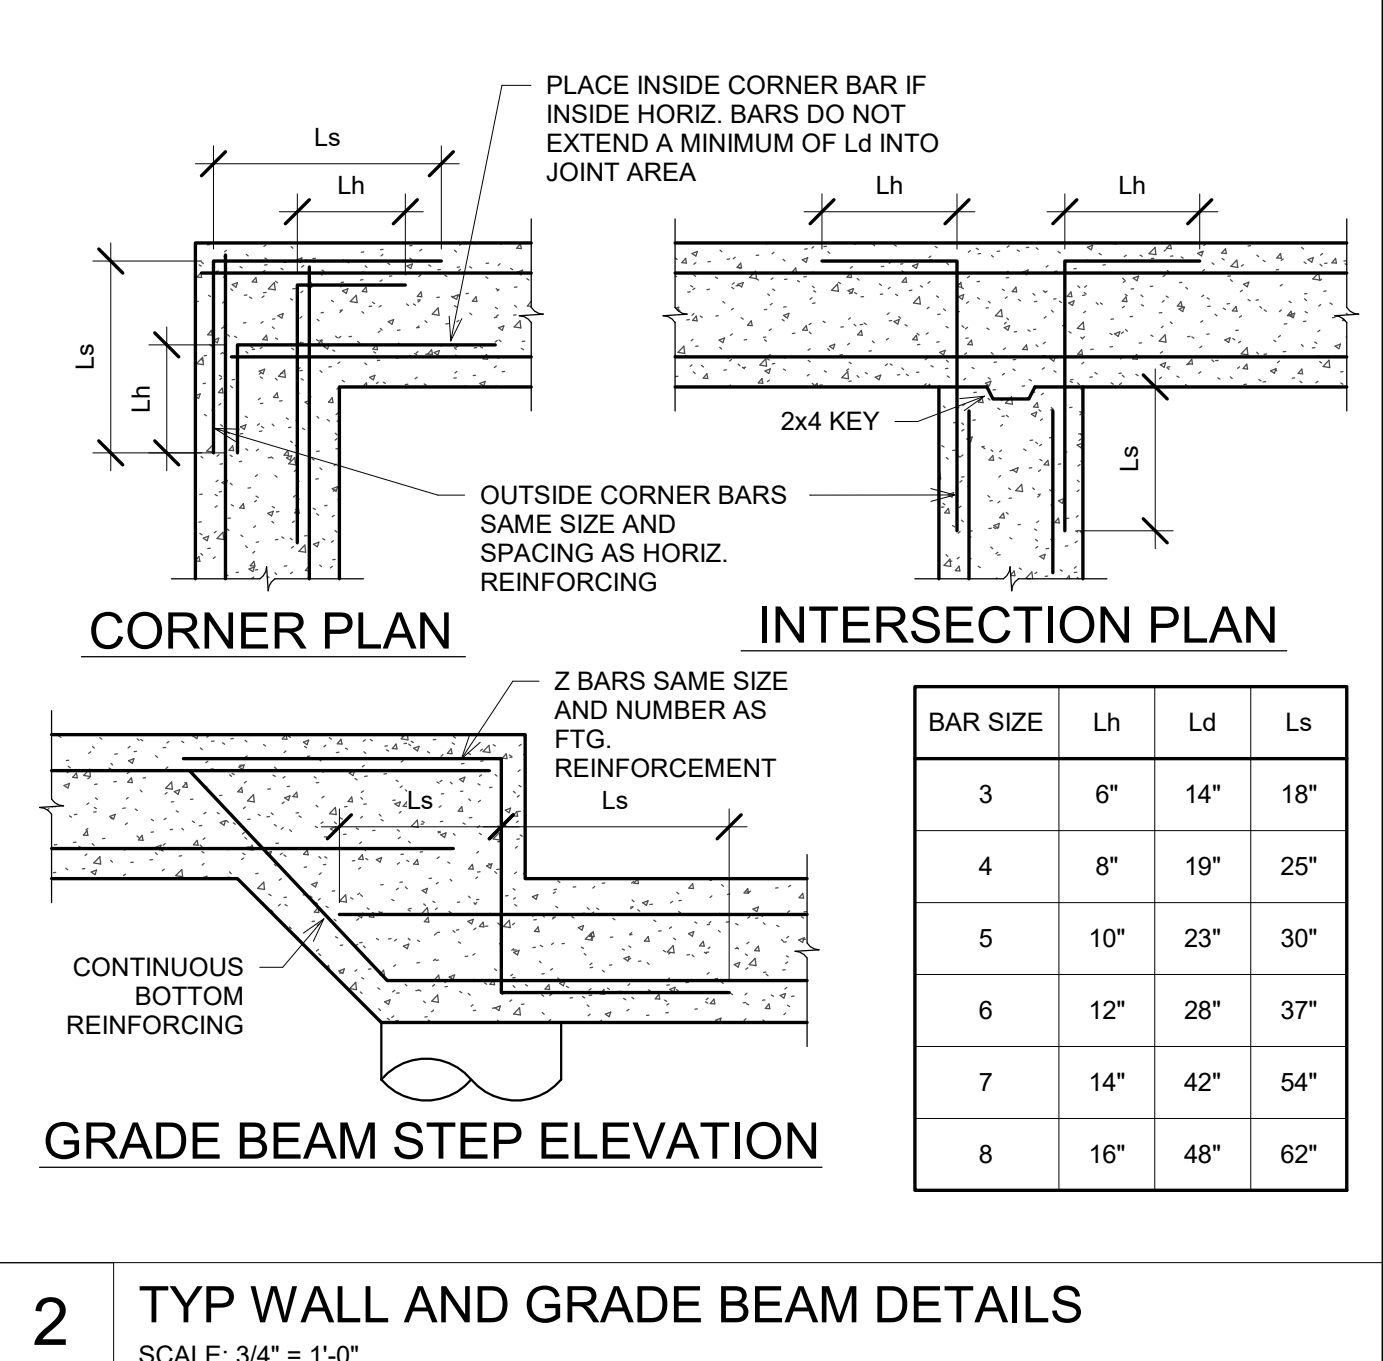

5 OVER DIG SECTION AT BASEMENT SLAB
 SCALE: 3/4" = 1'-0"

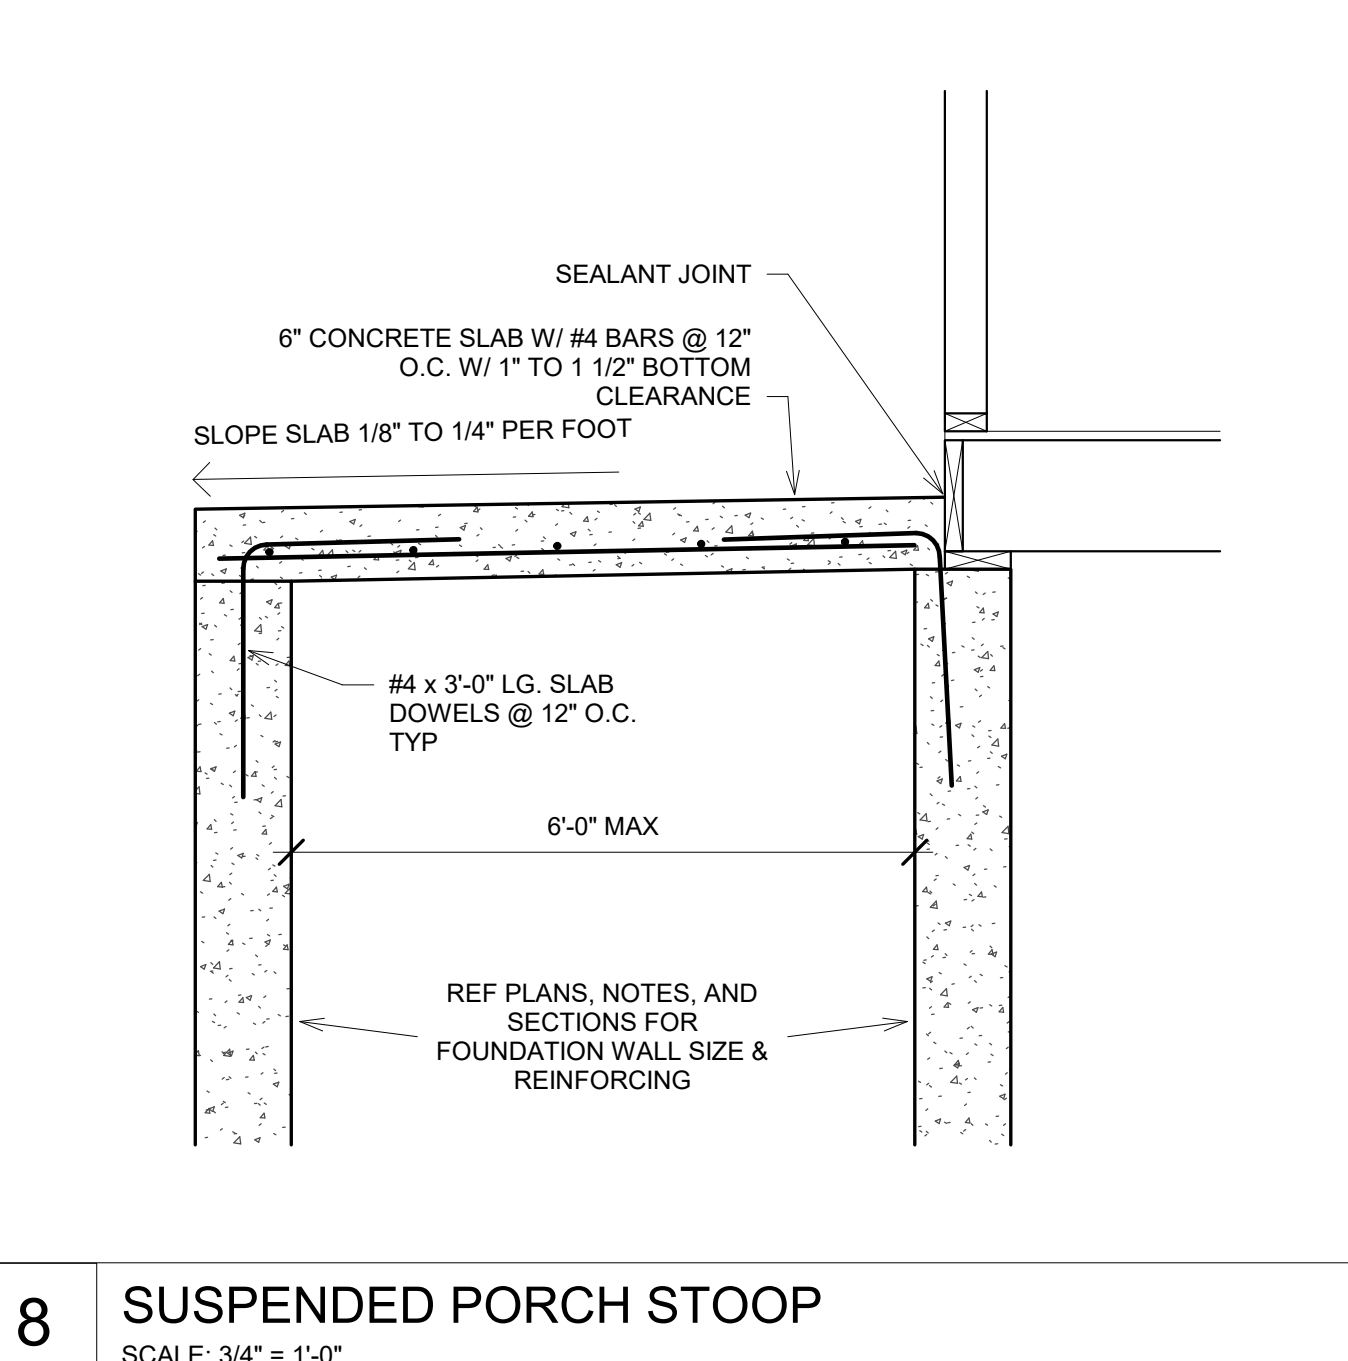

8 SUSPENDED PORCH STOOP
 SCALE: 3/4" = 1'-0"

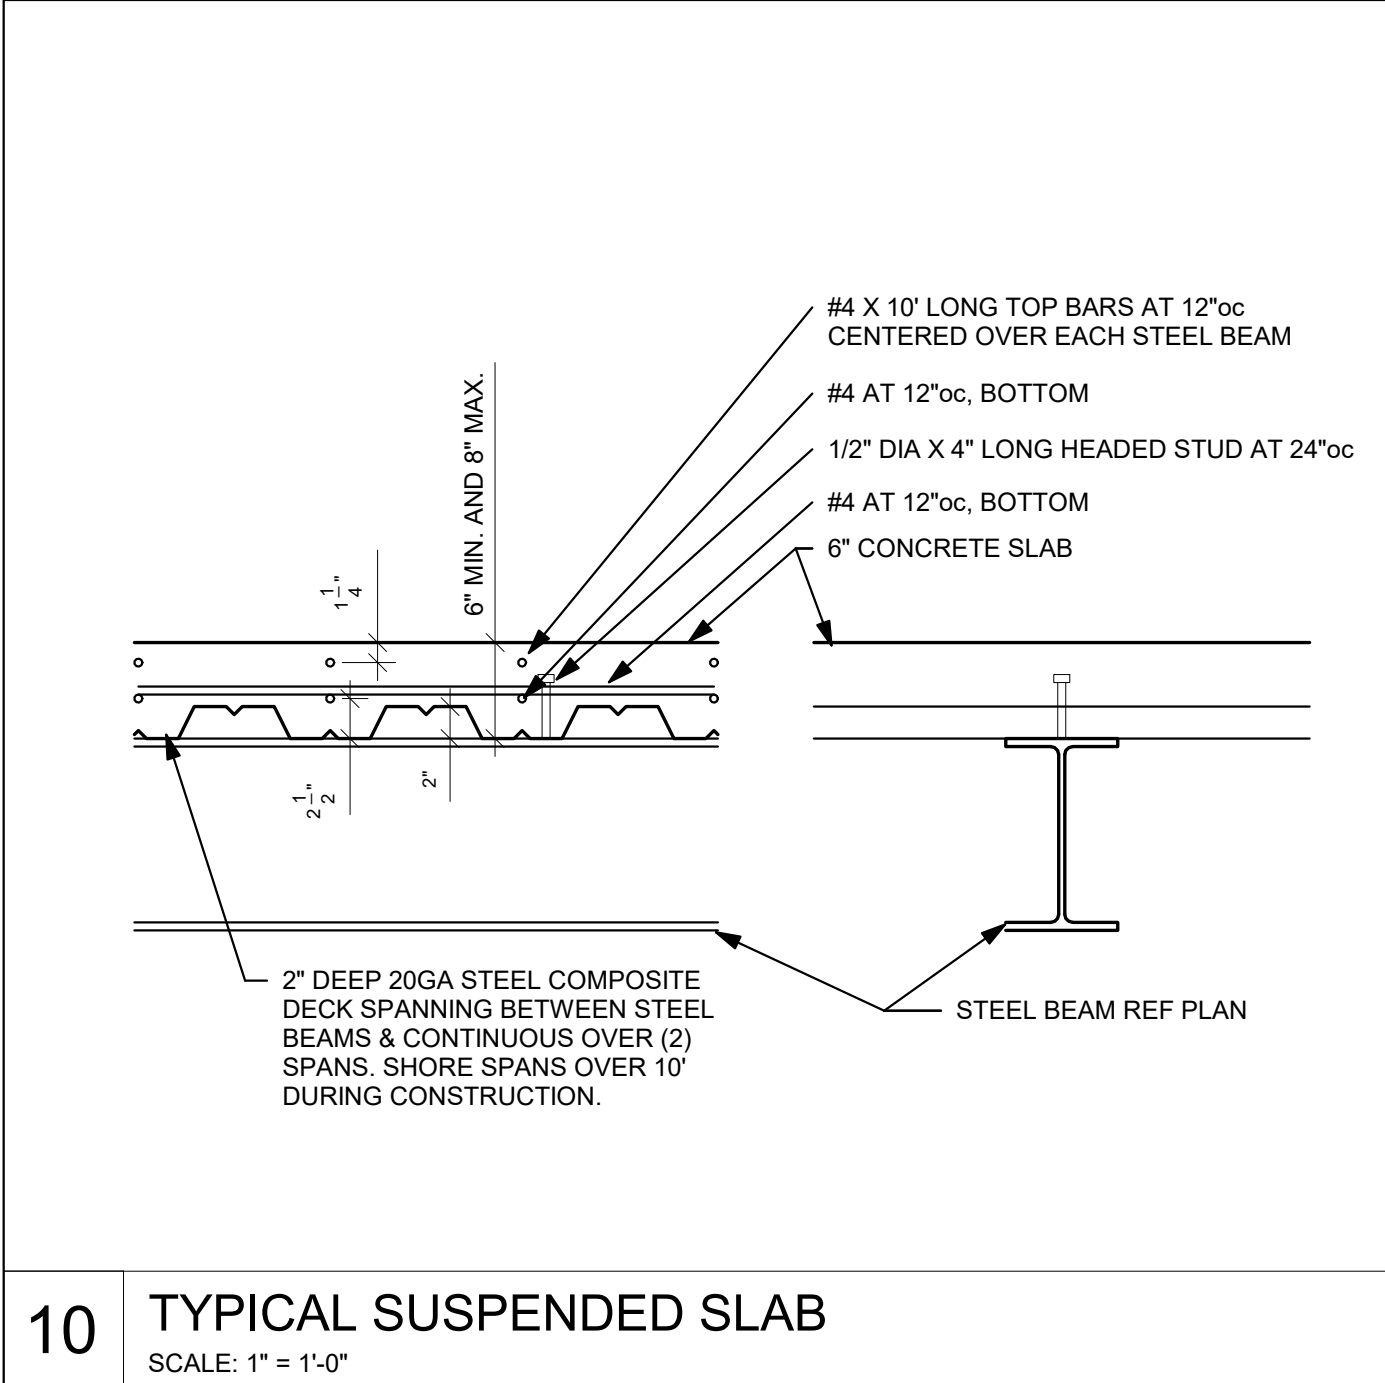

10 TYPICAL SUSPENDED SLAB
 SCALE: 1" = 1'-0"

Norton & Schmidt
Consulting Engineers, L.L.C.
311 East 11th Avenue
North Kansas City, MO
64116
Phone: (816) 421-4232
Fax: (816) 421-1868
www.nortonschmidt.com

STATE OF MISSOURI
BRANDON SCHWABAUER
NUMBER
PE-2015003020
04/03/2020
PROFESSIONAL ENGINEER

N&S JOB NUMBER: 2020-0255
© 2020 Norton & Schmidt Consulting Engineers

PROJECT INFORMATION
THE LEXINGTON II
2521 SW River Trail Road
Lee's Summit, Missouri


ISSUES & REVISIONS

#	DATE	DESCRIPTION
	04/03/2020	PERMIT


DRAWN BY: MLR
CHECKED BY: BSS
ISSUED FOR:

SHEET TITLE
DETAILS


SHEET NUMBER
S502

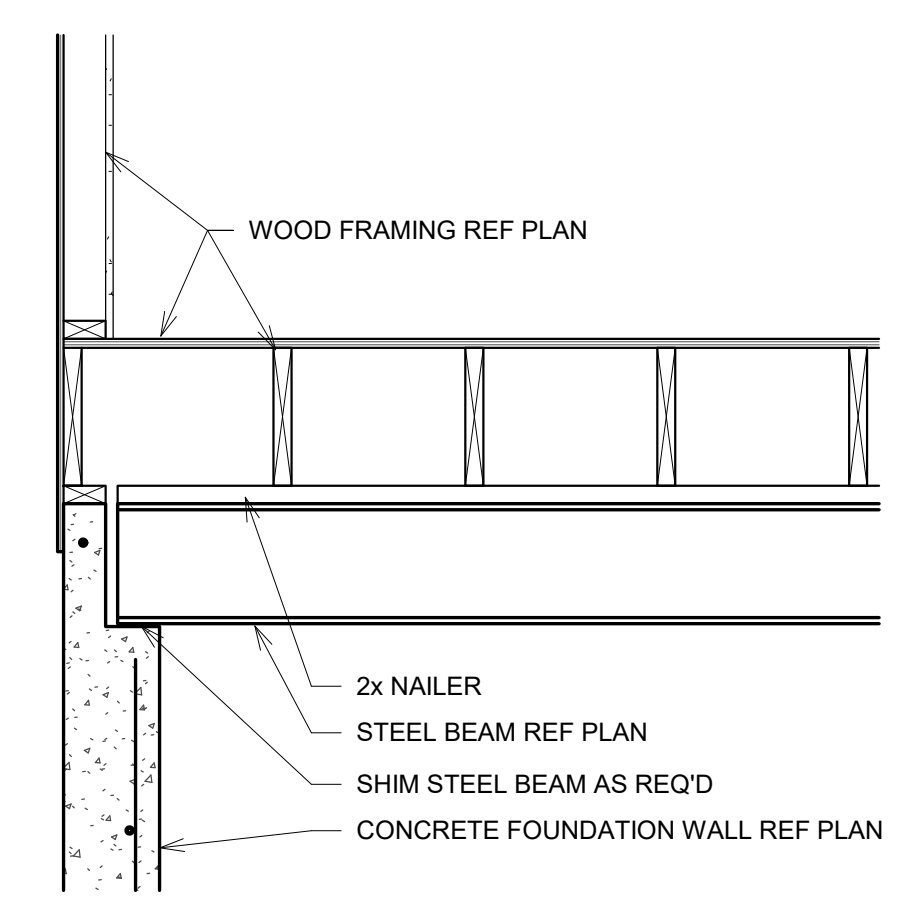


3 STL BEAM ON CONC FOUND WALL
SCALE: 3/4" = 1'-0"

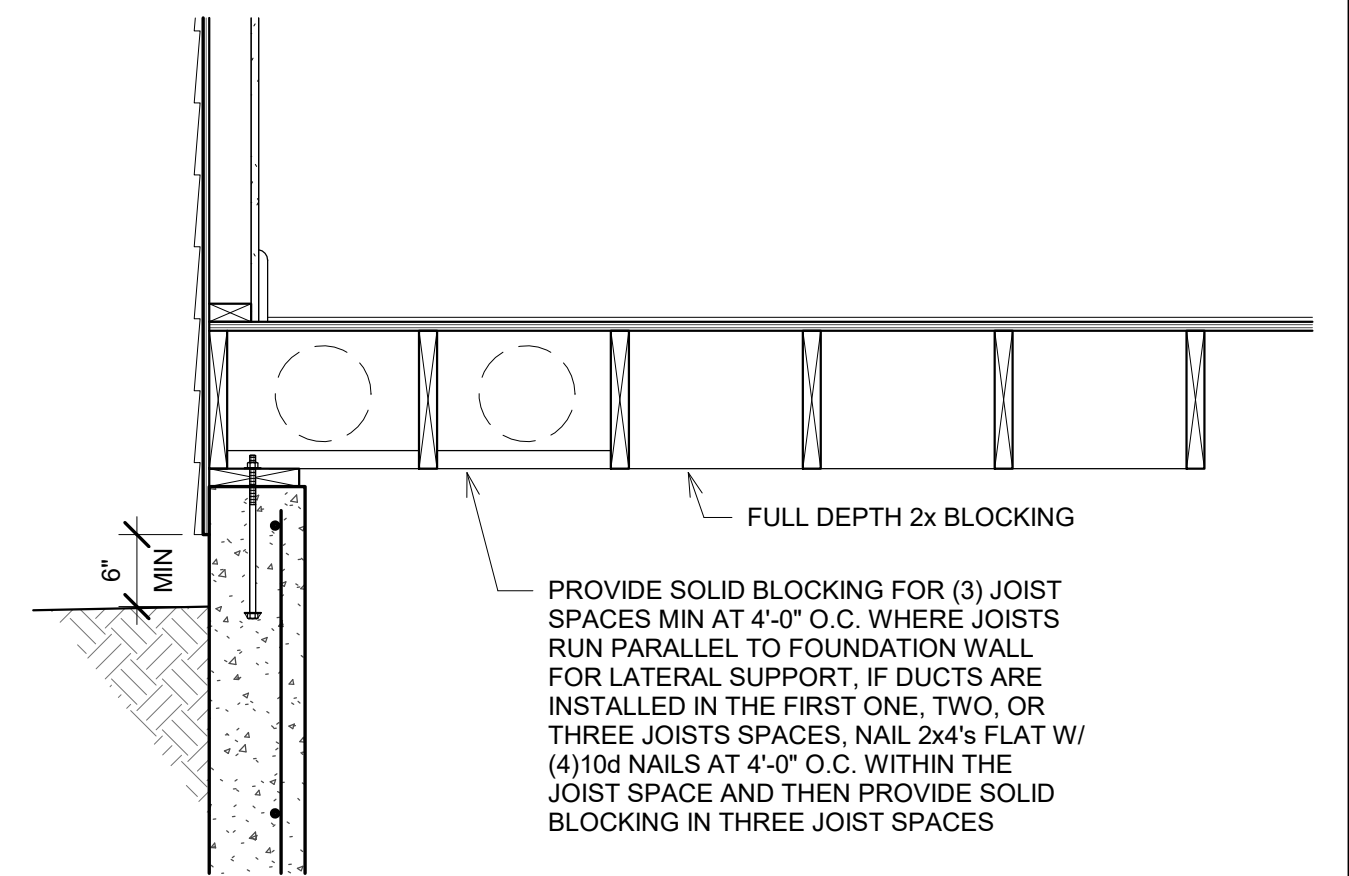


2 JOISTS PARALLEL TO WALL
SCALE: 3/4" = 1'-0"

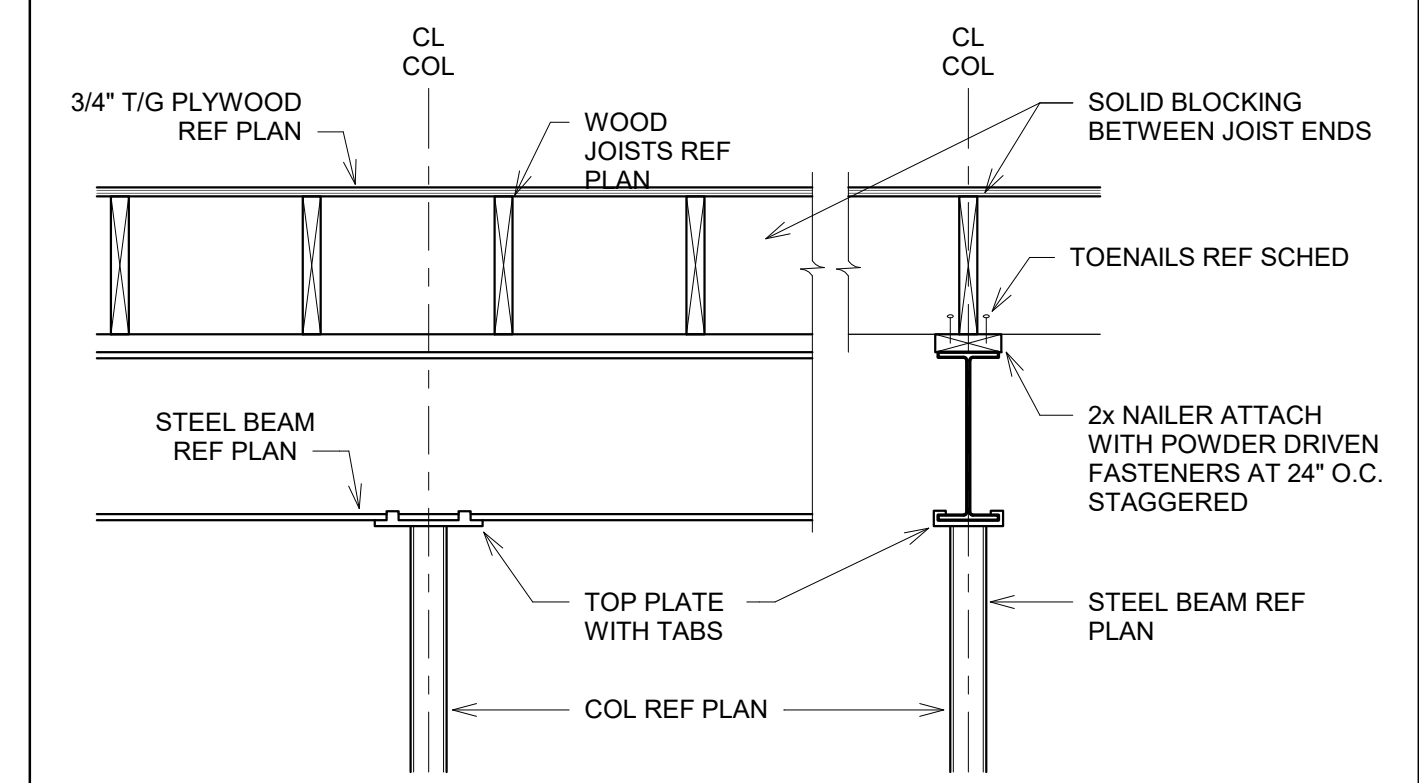

1 TYPICAL BEAM AT COLUMN
SCALE: 3/4" = 1'-0"

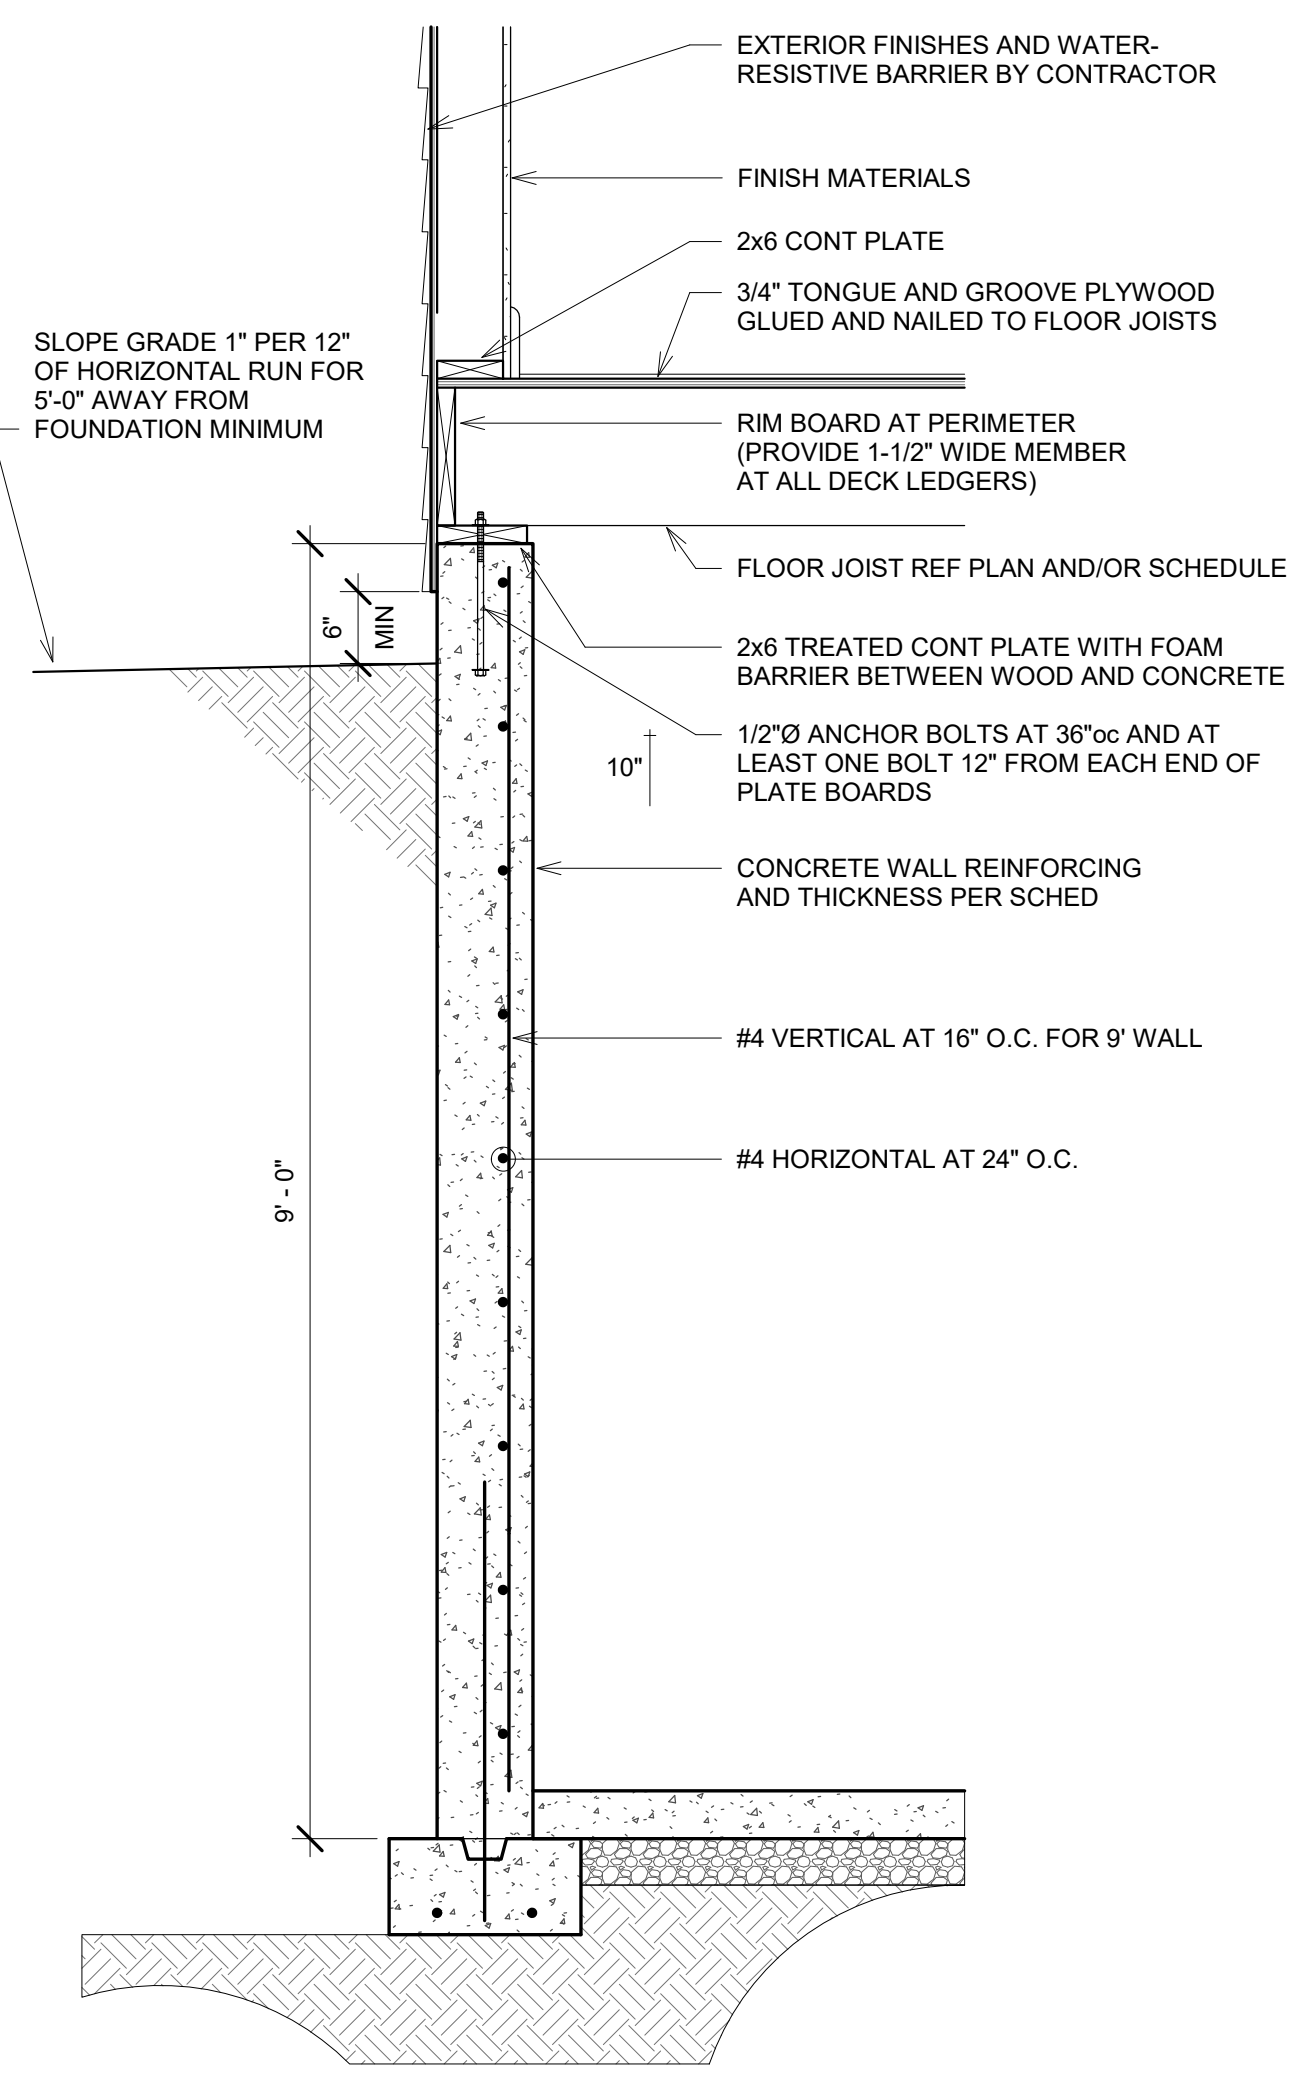

4 FULL HEIGHT BASEMENT WALL SECTION
SCALE: 3/4" = 1'-0"

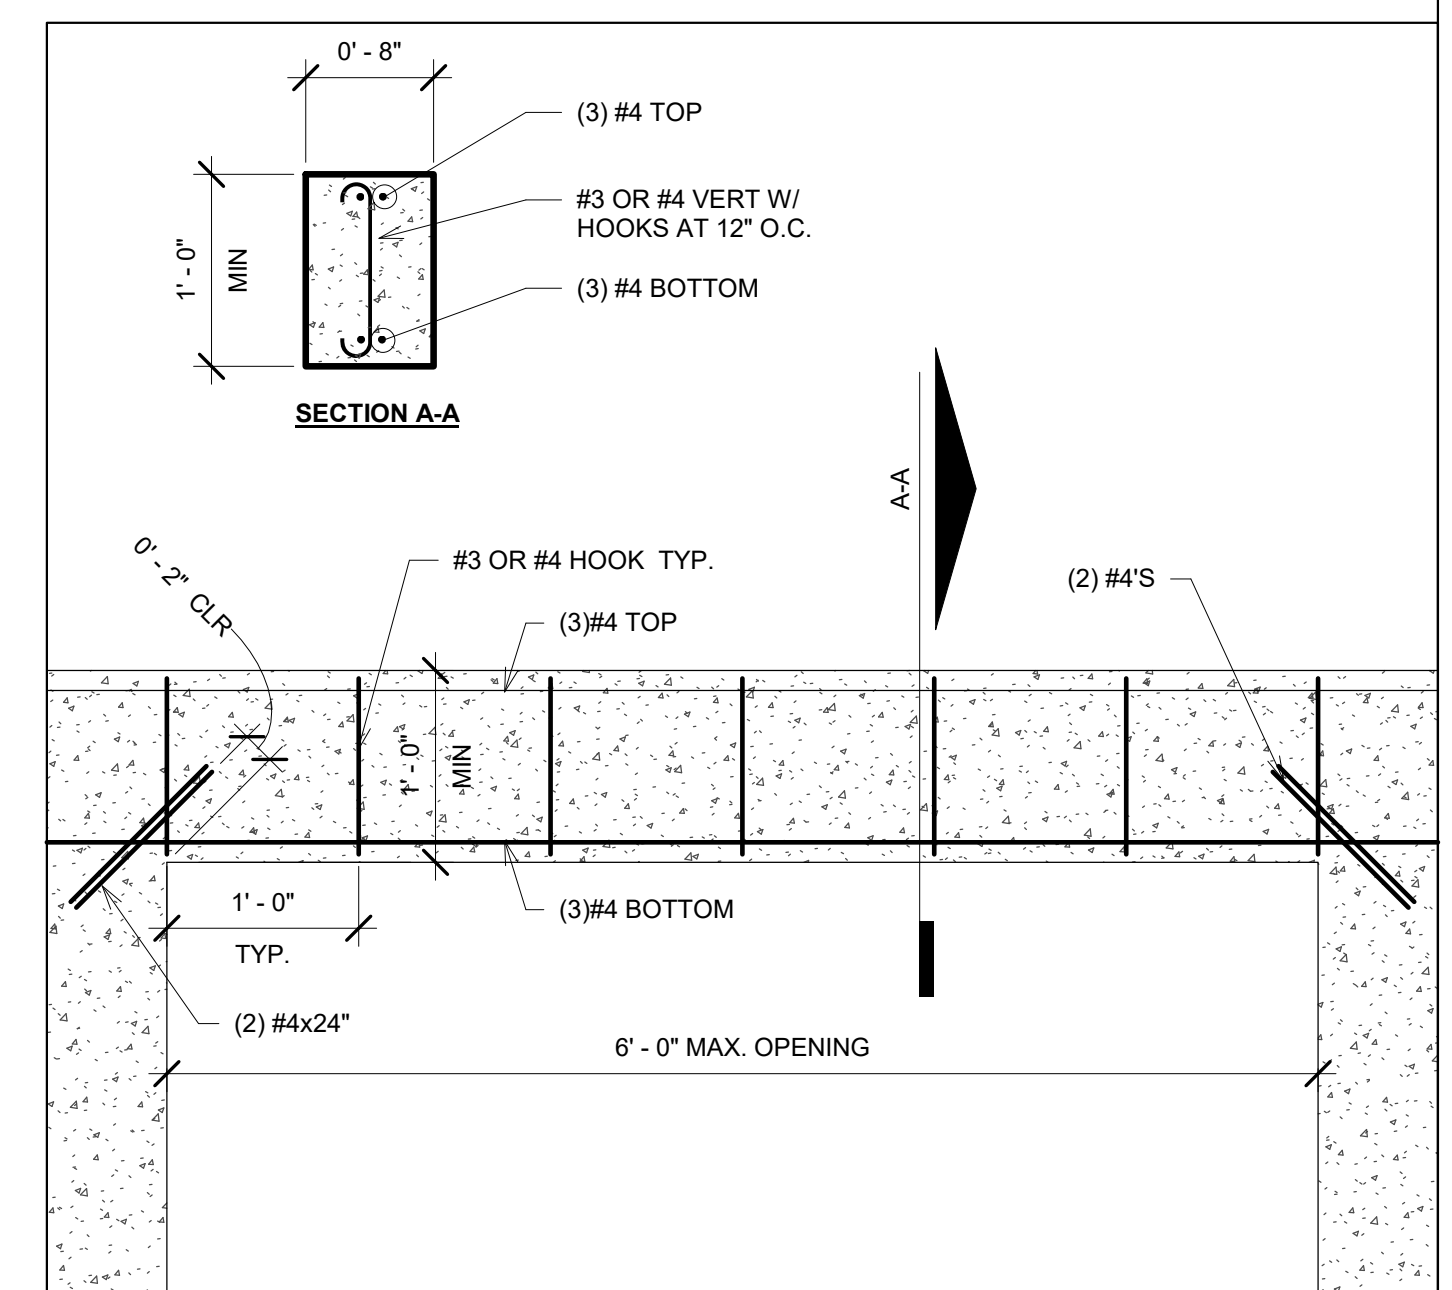

5 BASEMENT HEADER DETAIL
SCALE: 1" = 1'-0"

Blank area for notes or additional drawings.

PROJECT INFORMATION

THE LEXINGTON II
 2521 SW River Trail Road
 Lee's Summit, Missouri

ISSUES & REVISIONS

#	DATE	DESCRIPTION
04/03/2020	PERMIT	


DRAWN BY: MLR
 CHECKED BY: BSS
 ISSUED FOR:

SHEET TITLE


DETAILS

SHEET NUMBER


S503

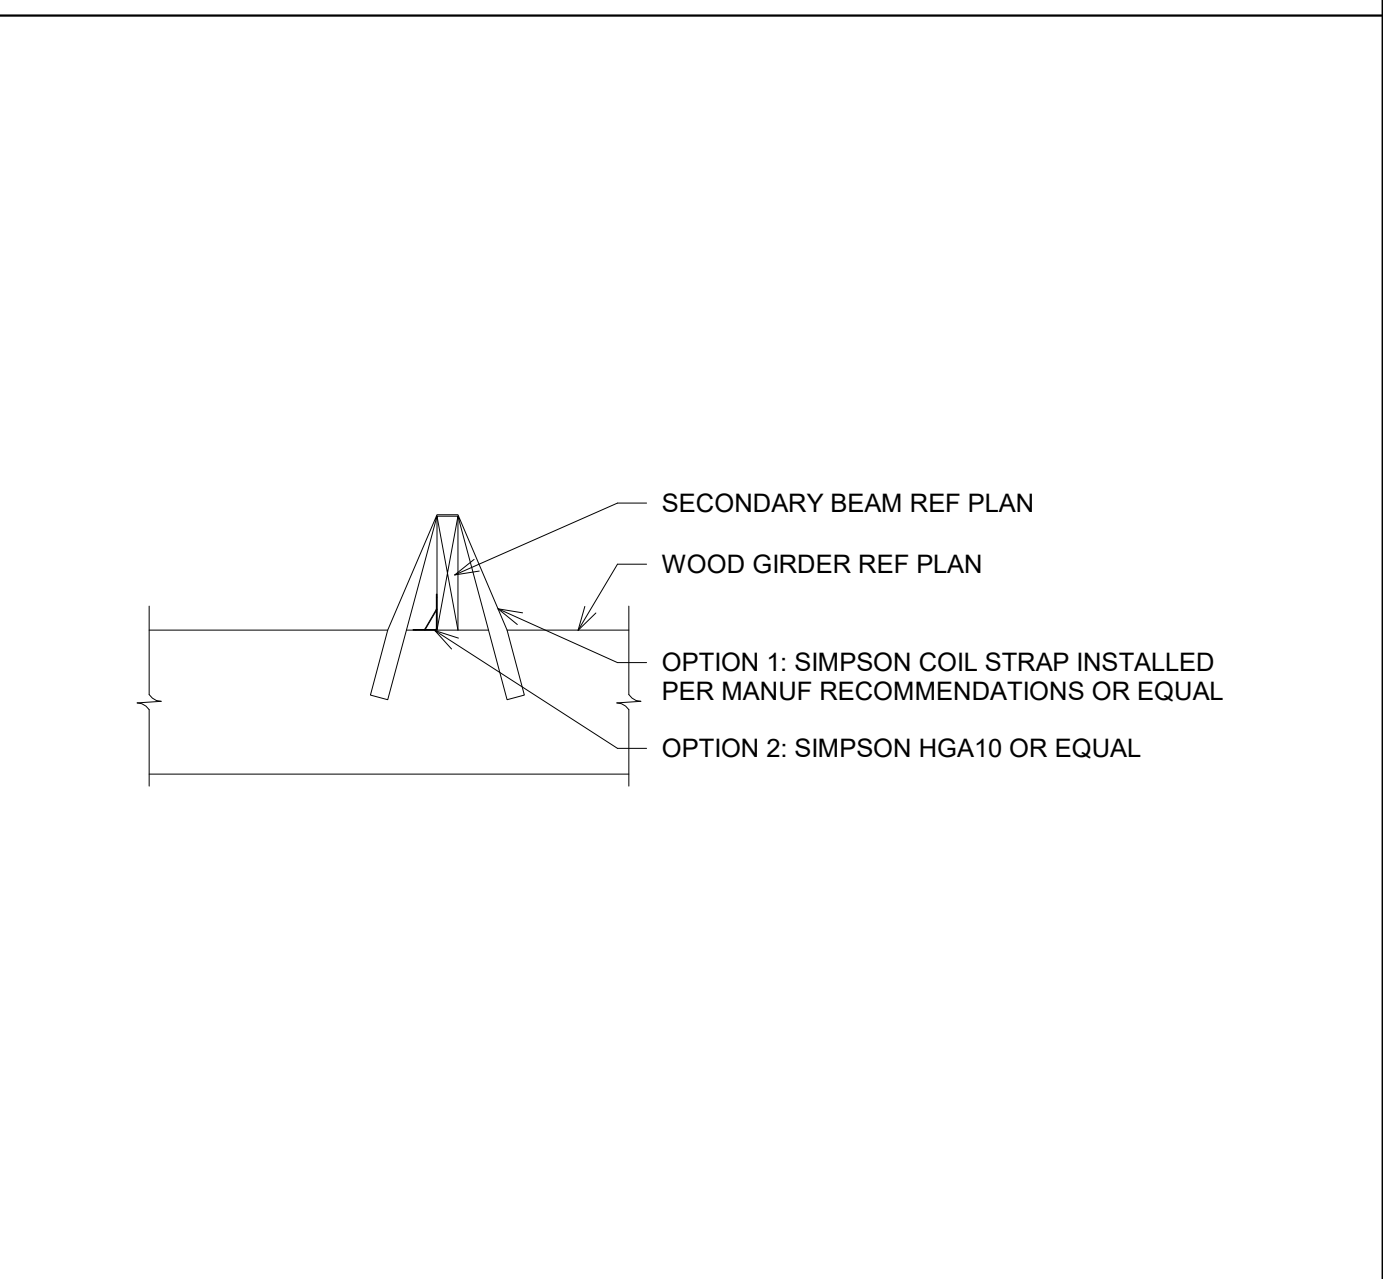


3 TYP WOOD BEAM PERP TO WOOD BEAM
 SCALE: 3/4" = 1'-0"

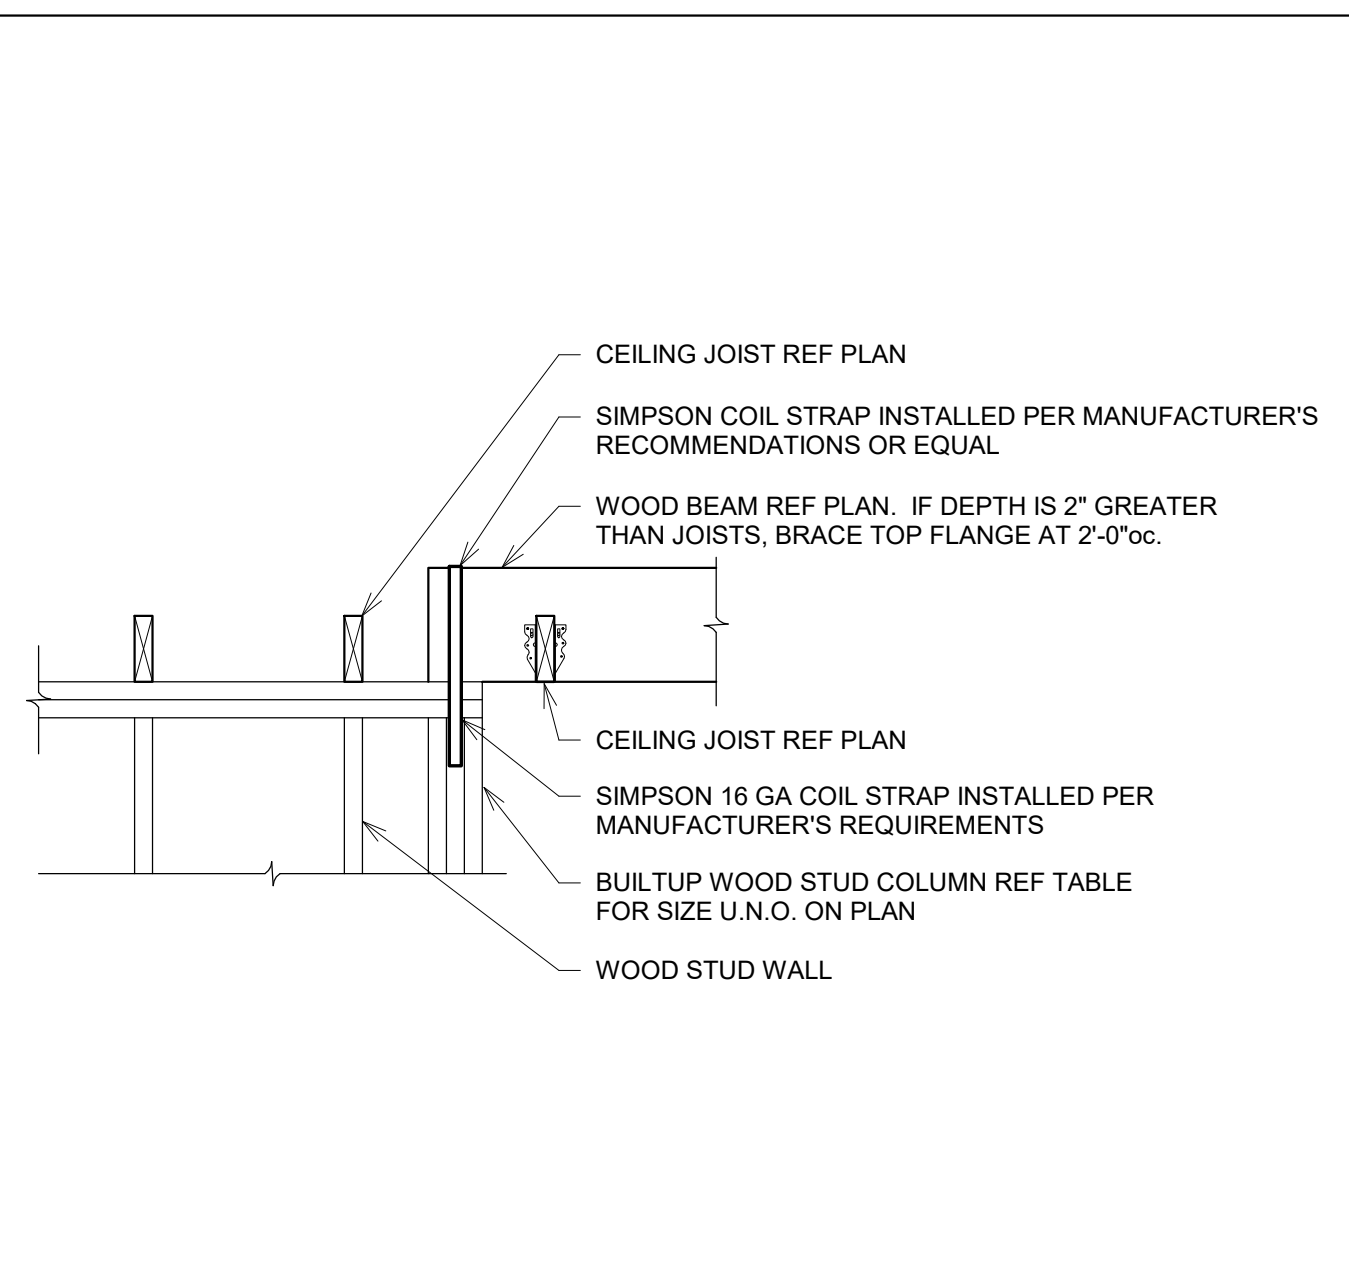


4 TYP WOOD BEAM PARALLEL TO WALL
 SCALE: 3/4" = 1'-0"

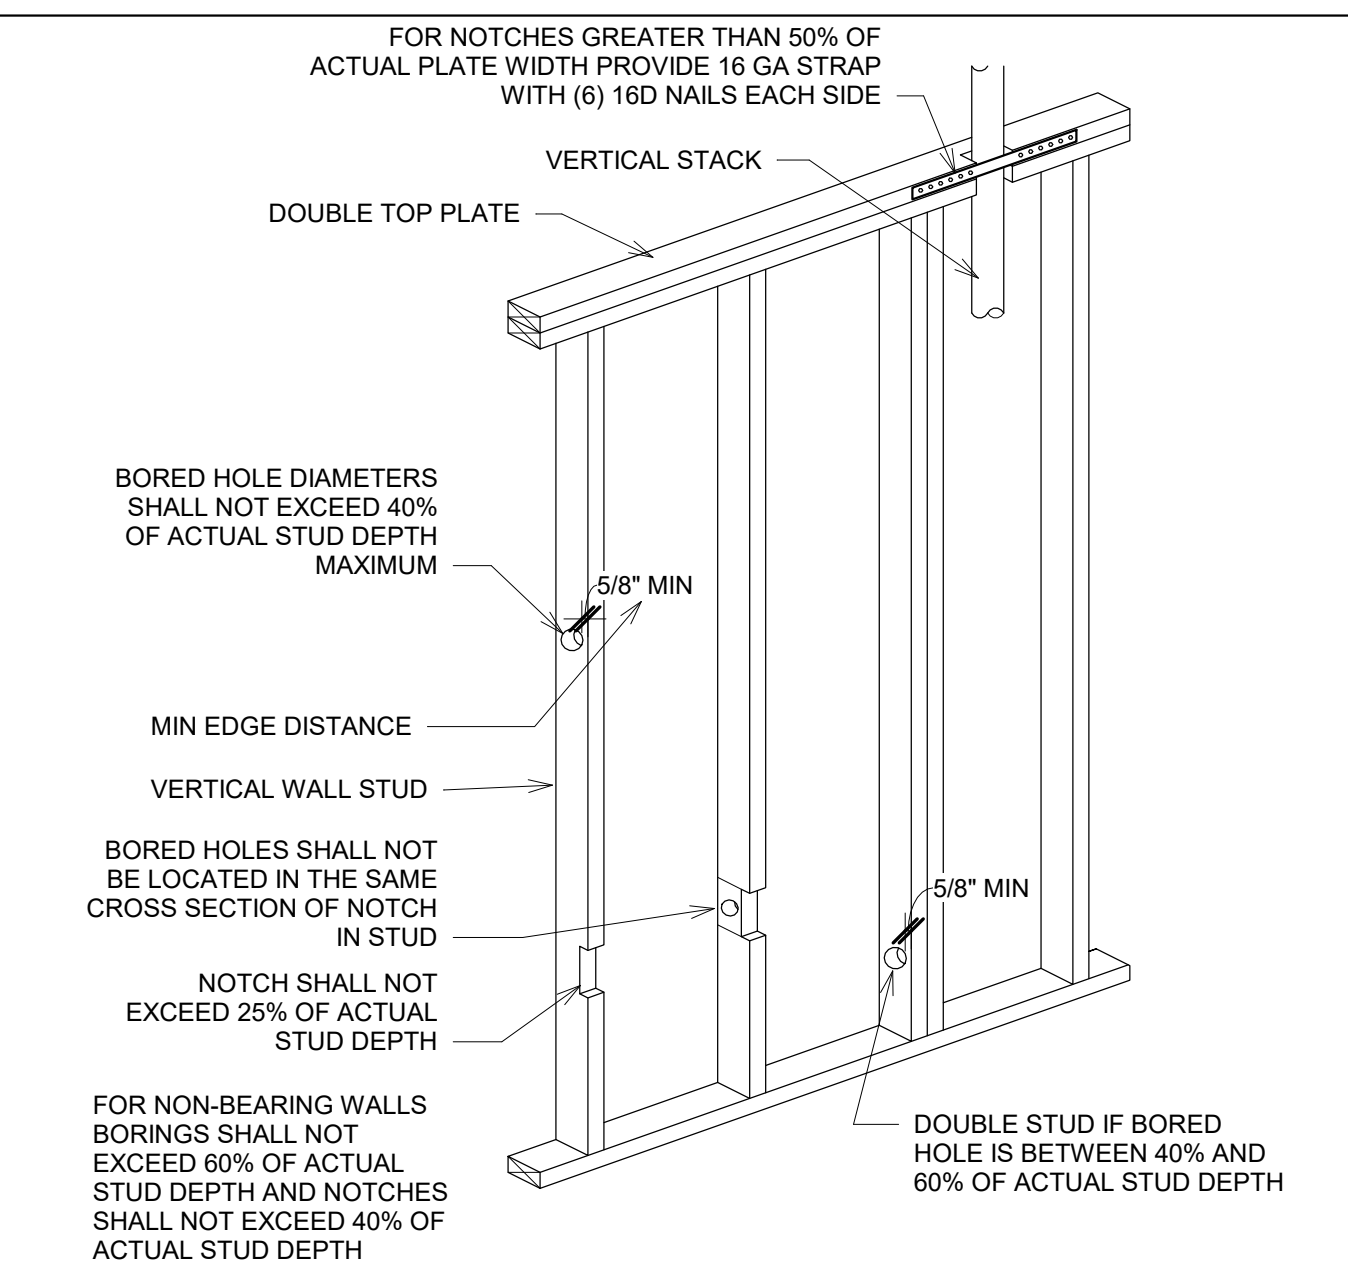


7 NOTCHING AND BORING WALLS
 SCALE: 1/2" = 1'-0"

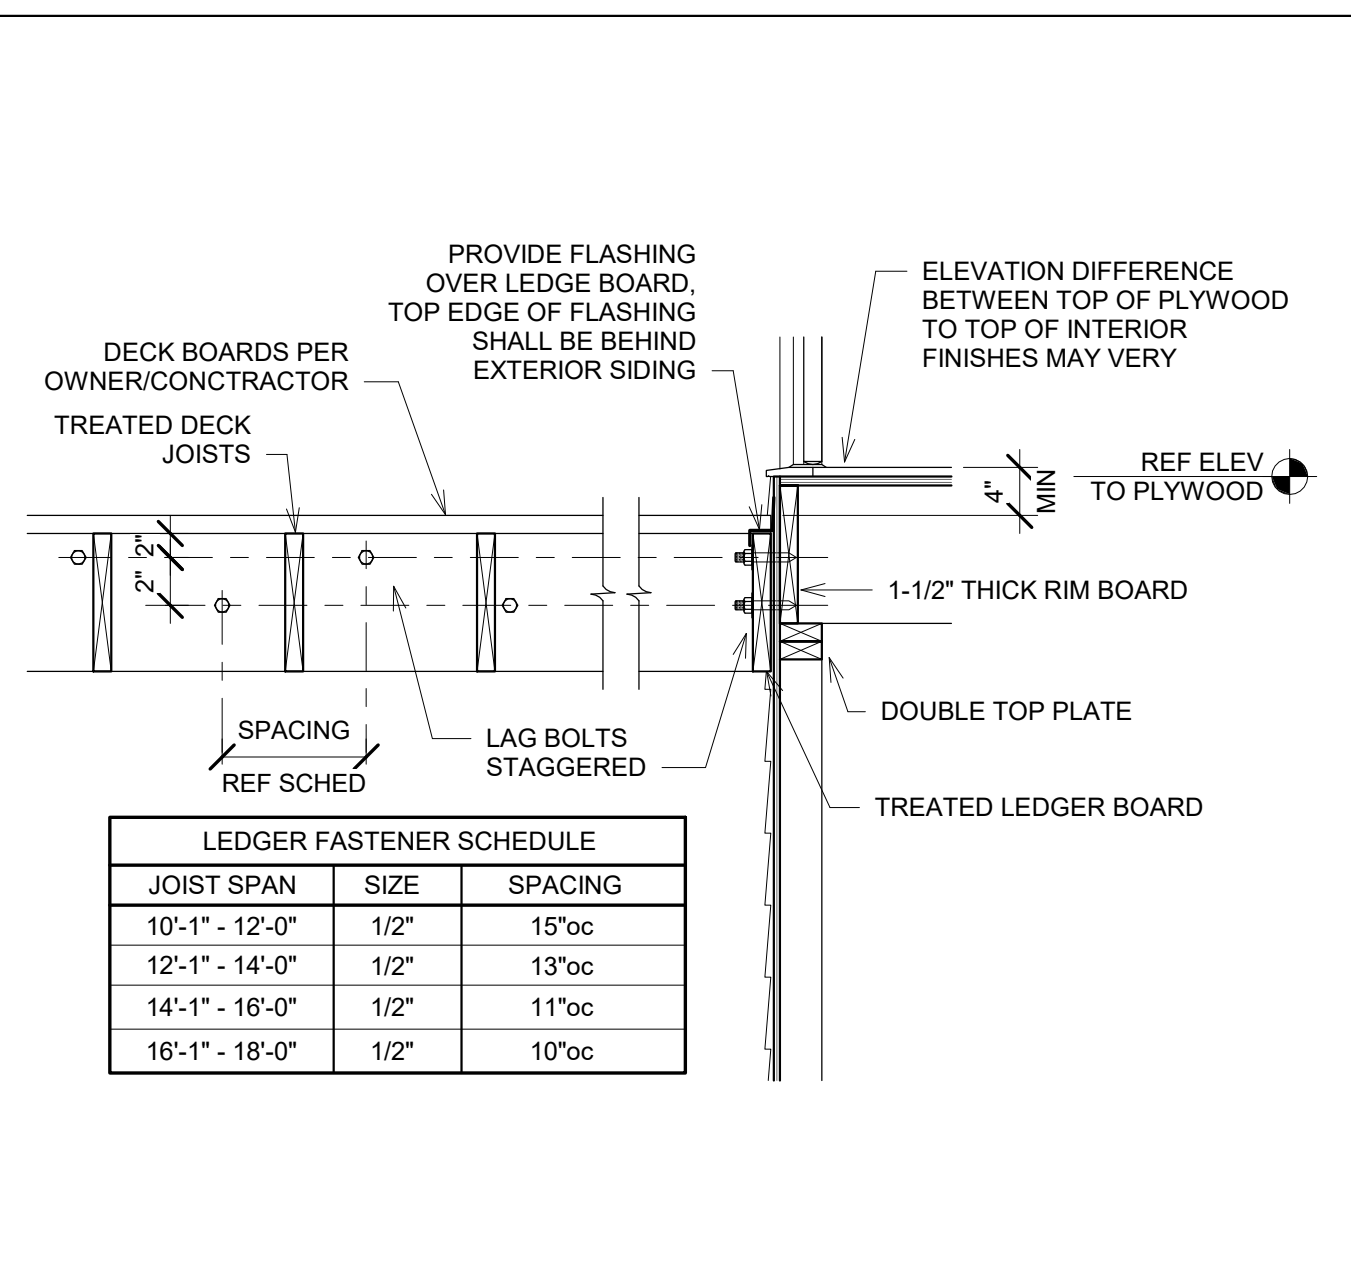


10 DECK LEDGER ATTACHMENT
 SCALE: 3/4" = 1'-0"

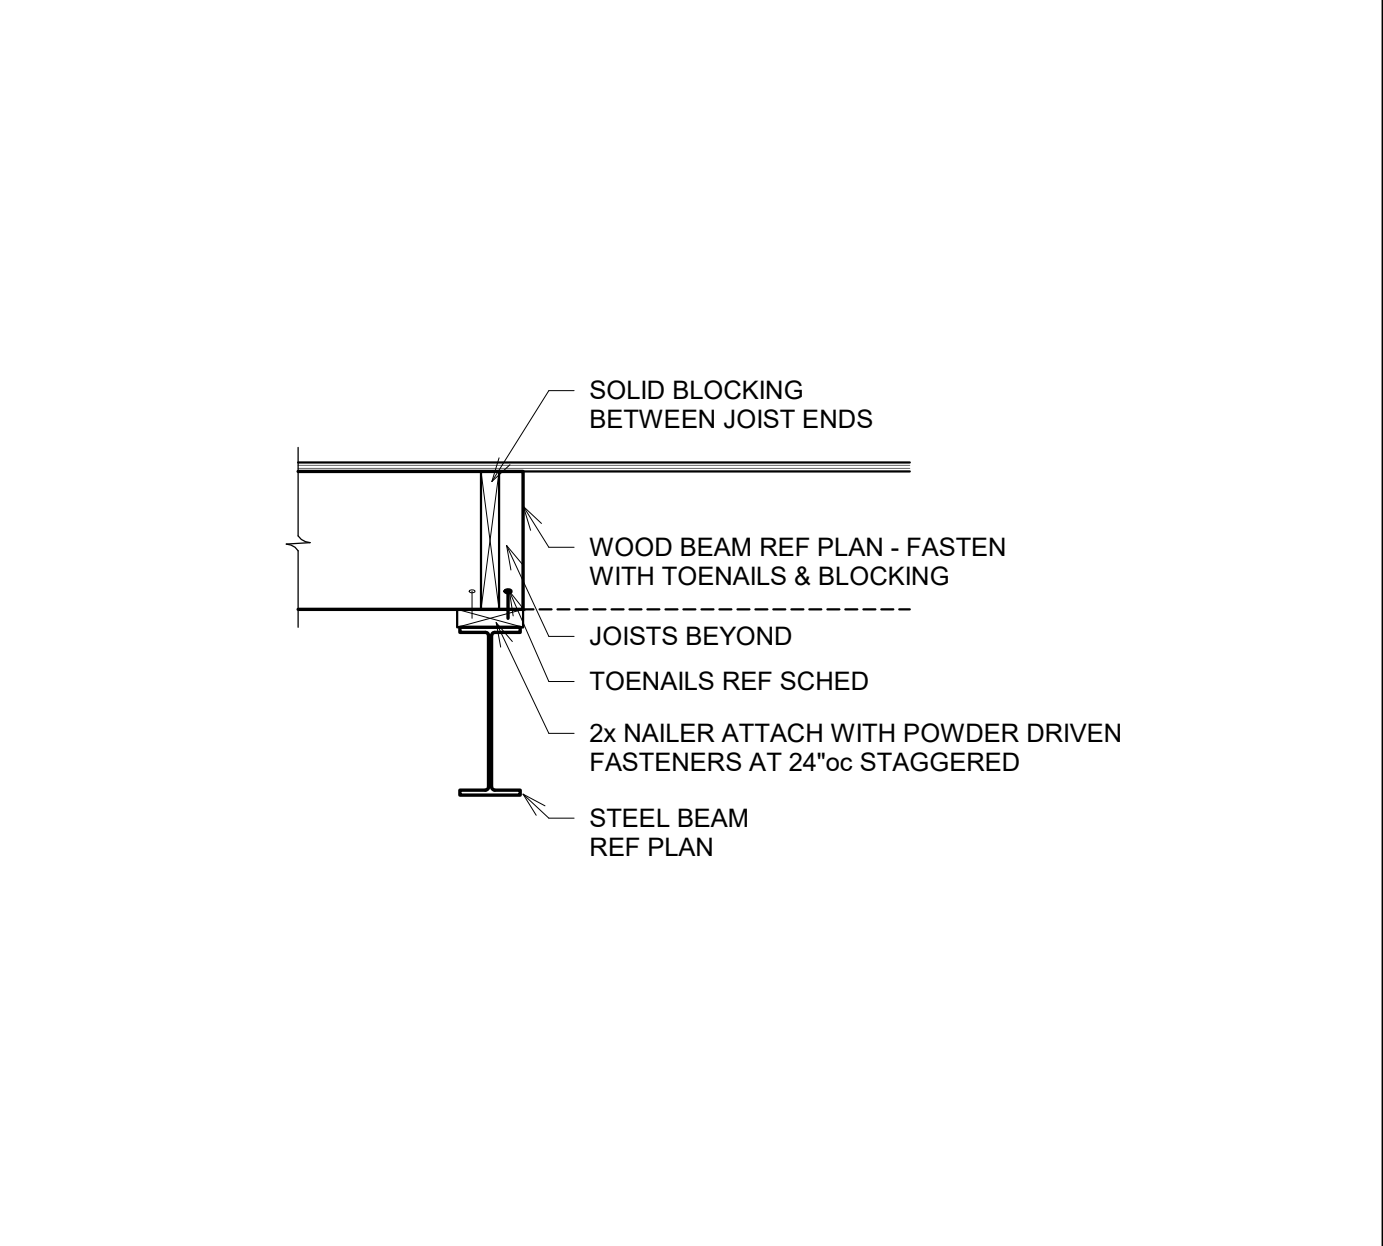


2 WOOD BEAM OVER STEEL BEAM
 SCALE: 3/4" = 1'-0"

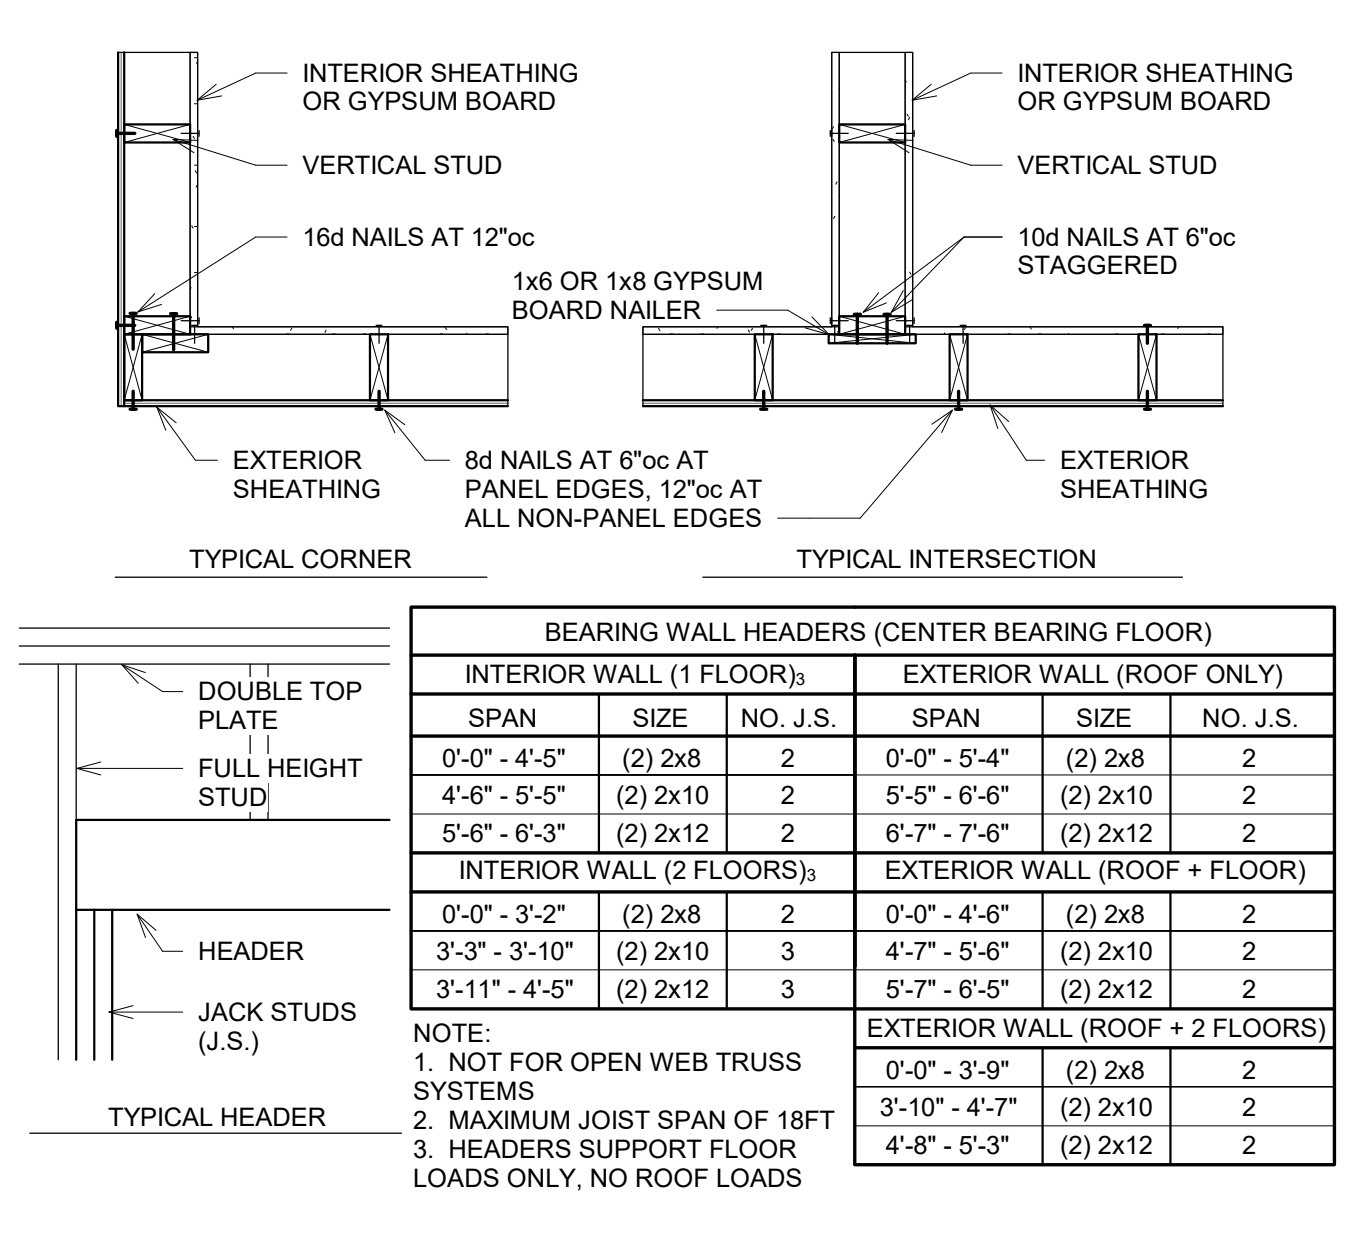


5 TYP WALL FRAMING DETAILS
 SCALE: 3/4" = 1'-0"

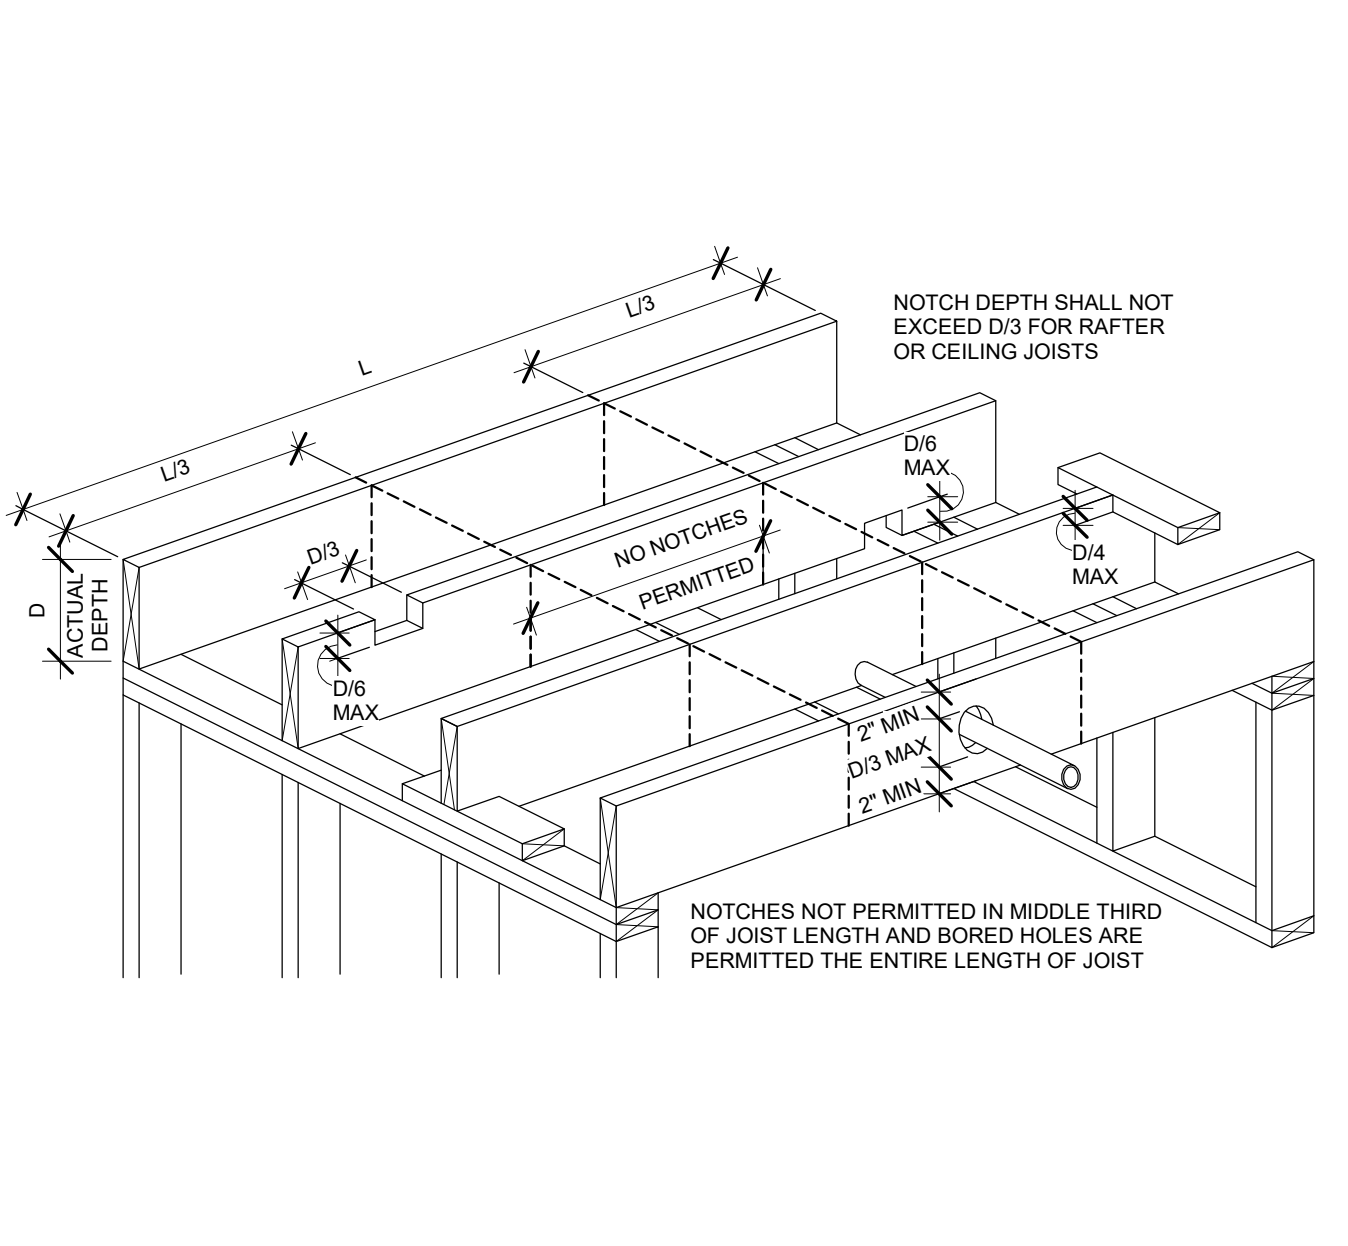


8 NOTCHING AND BORING CEILING OR FLOOR JSTS
 SCALE: 1/2" = 1'-0"

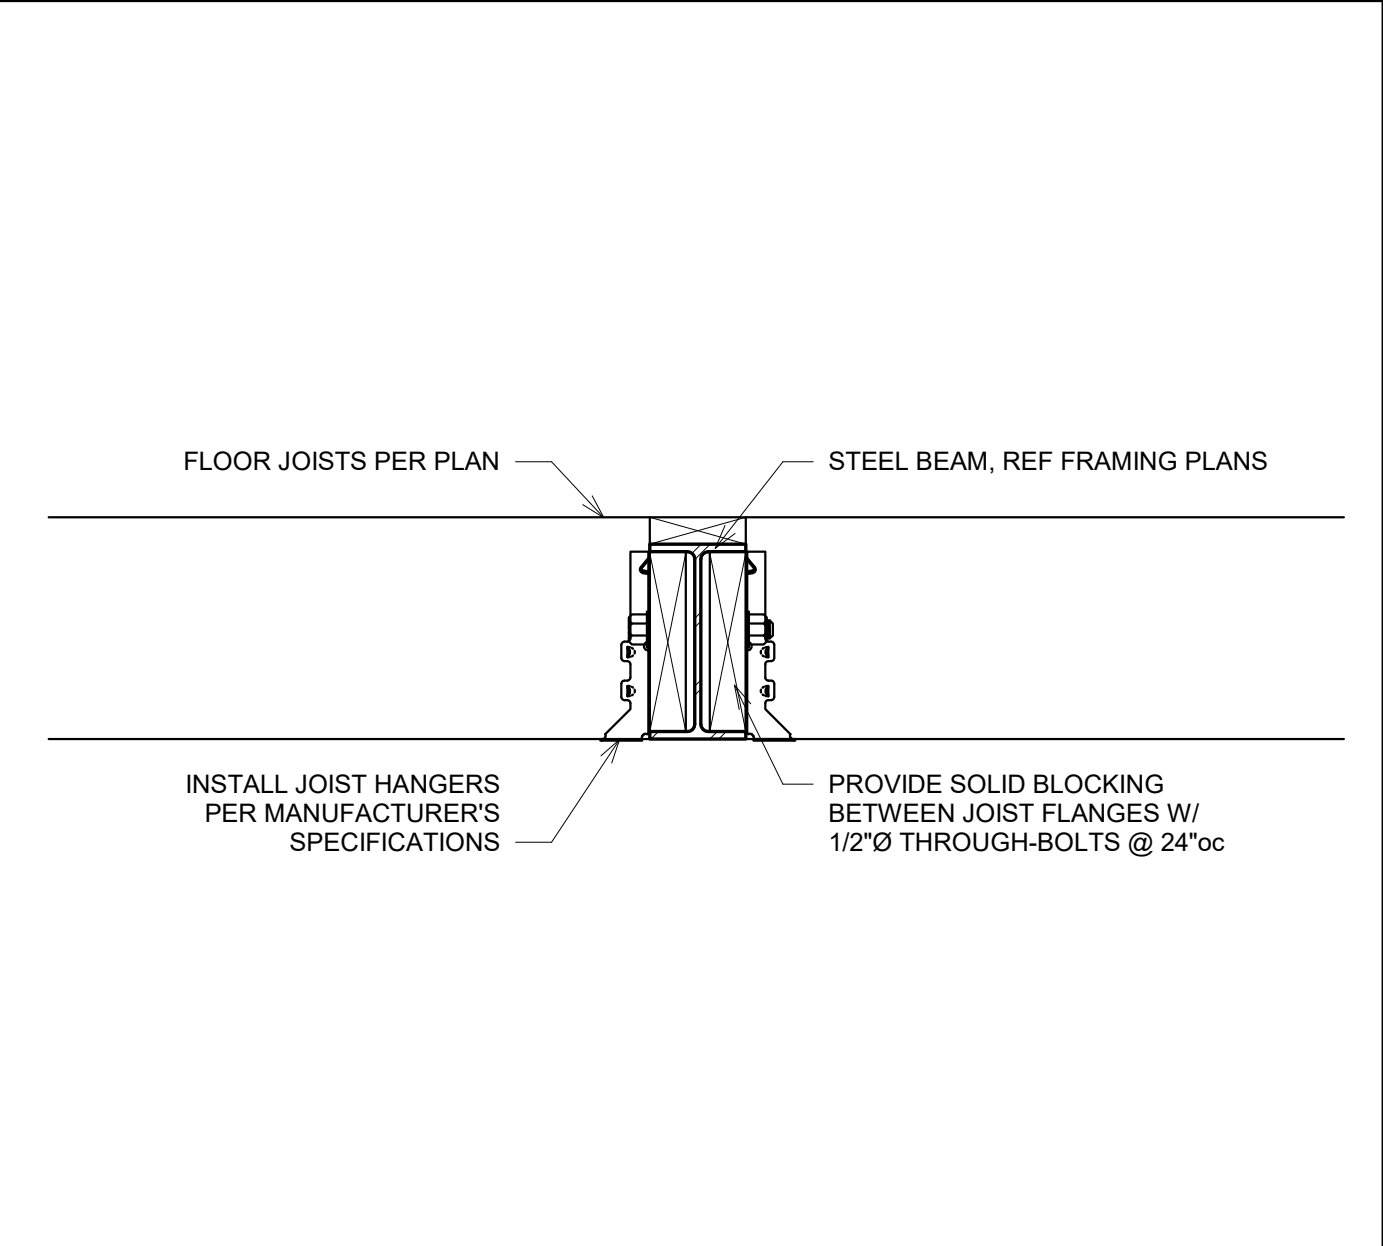


1 UPSET STEEL BEAM
 SCALE: 3/4" = 1'-0"

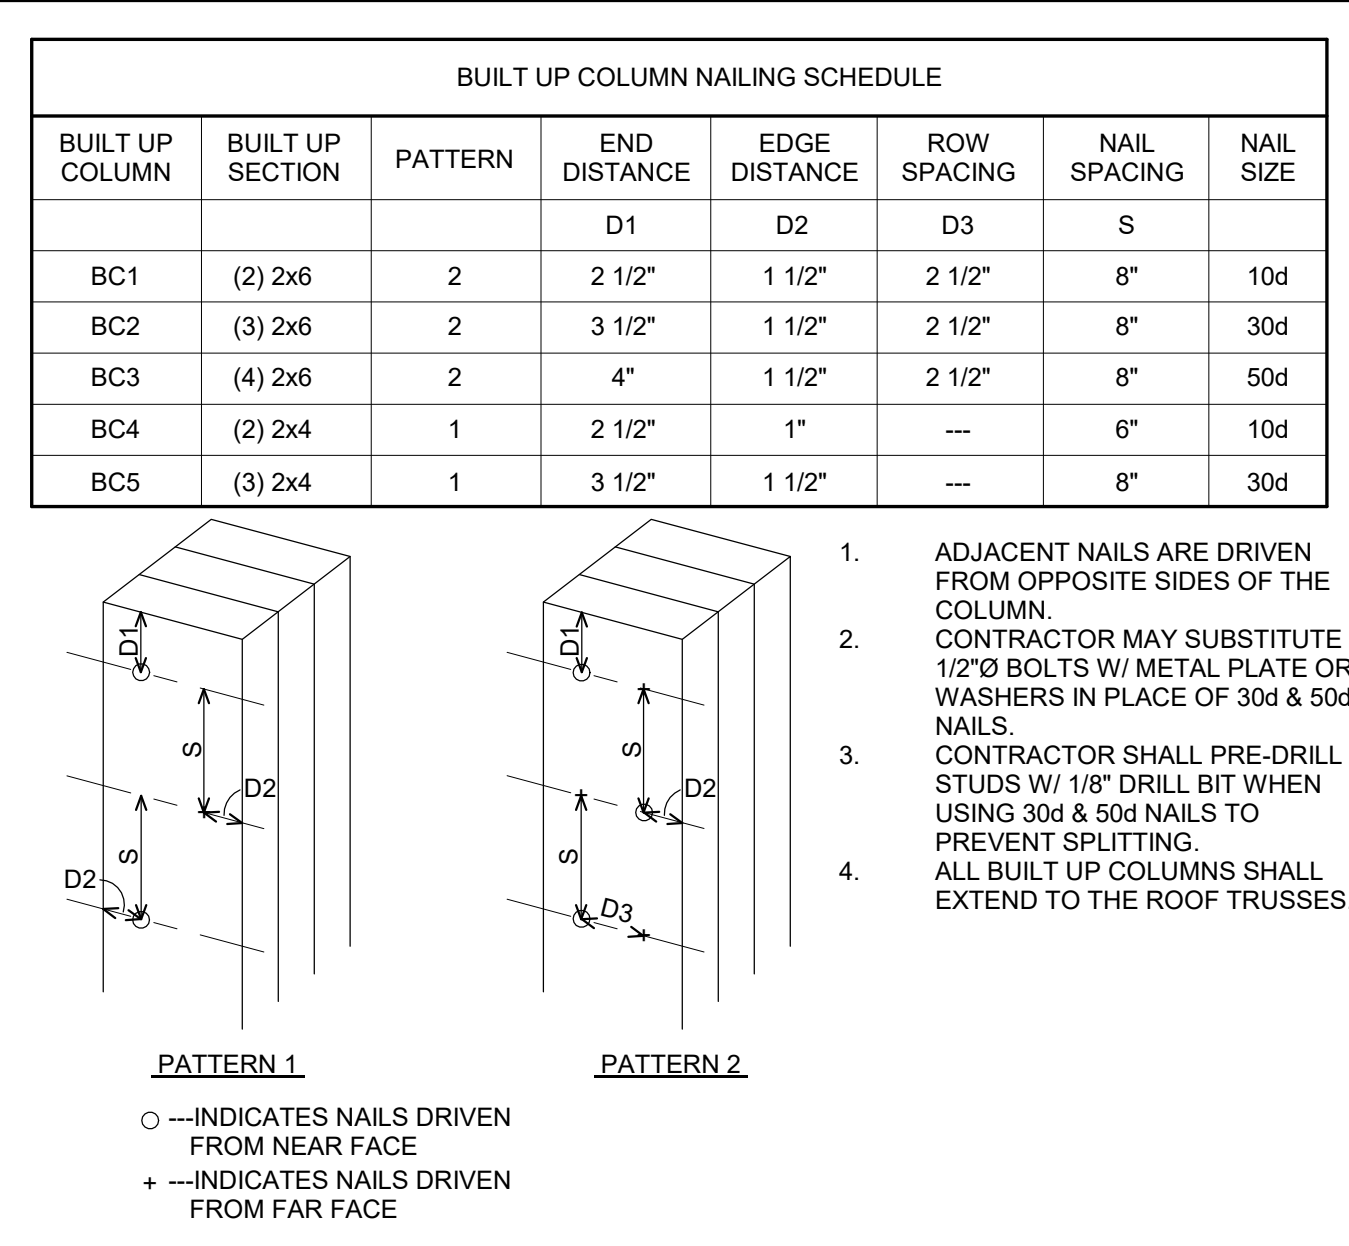


6 BUILT UP COLUMN SCHEDULE
 SCALE: 3/4" = 1'-0"

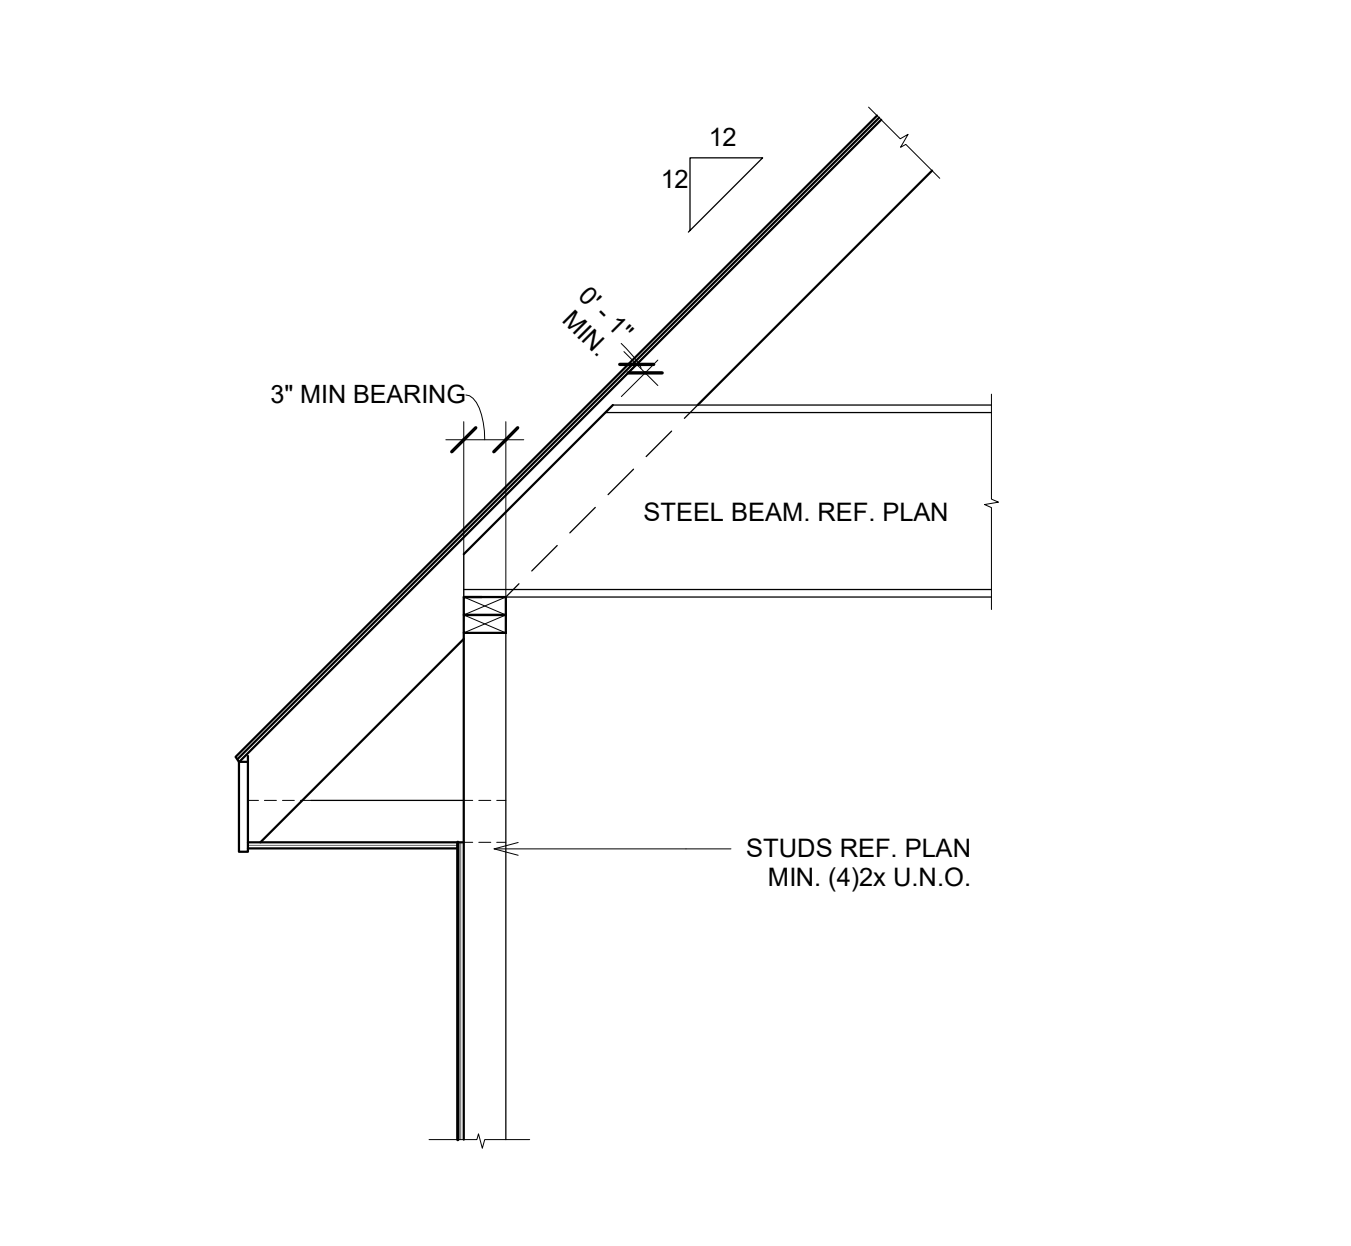

11 STEEL BEAM CLIPPED AT WOOD WALL
 SCALE: 3/4" = 1'-0"

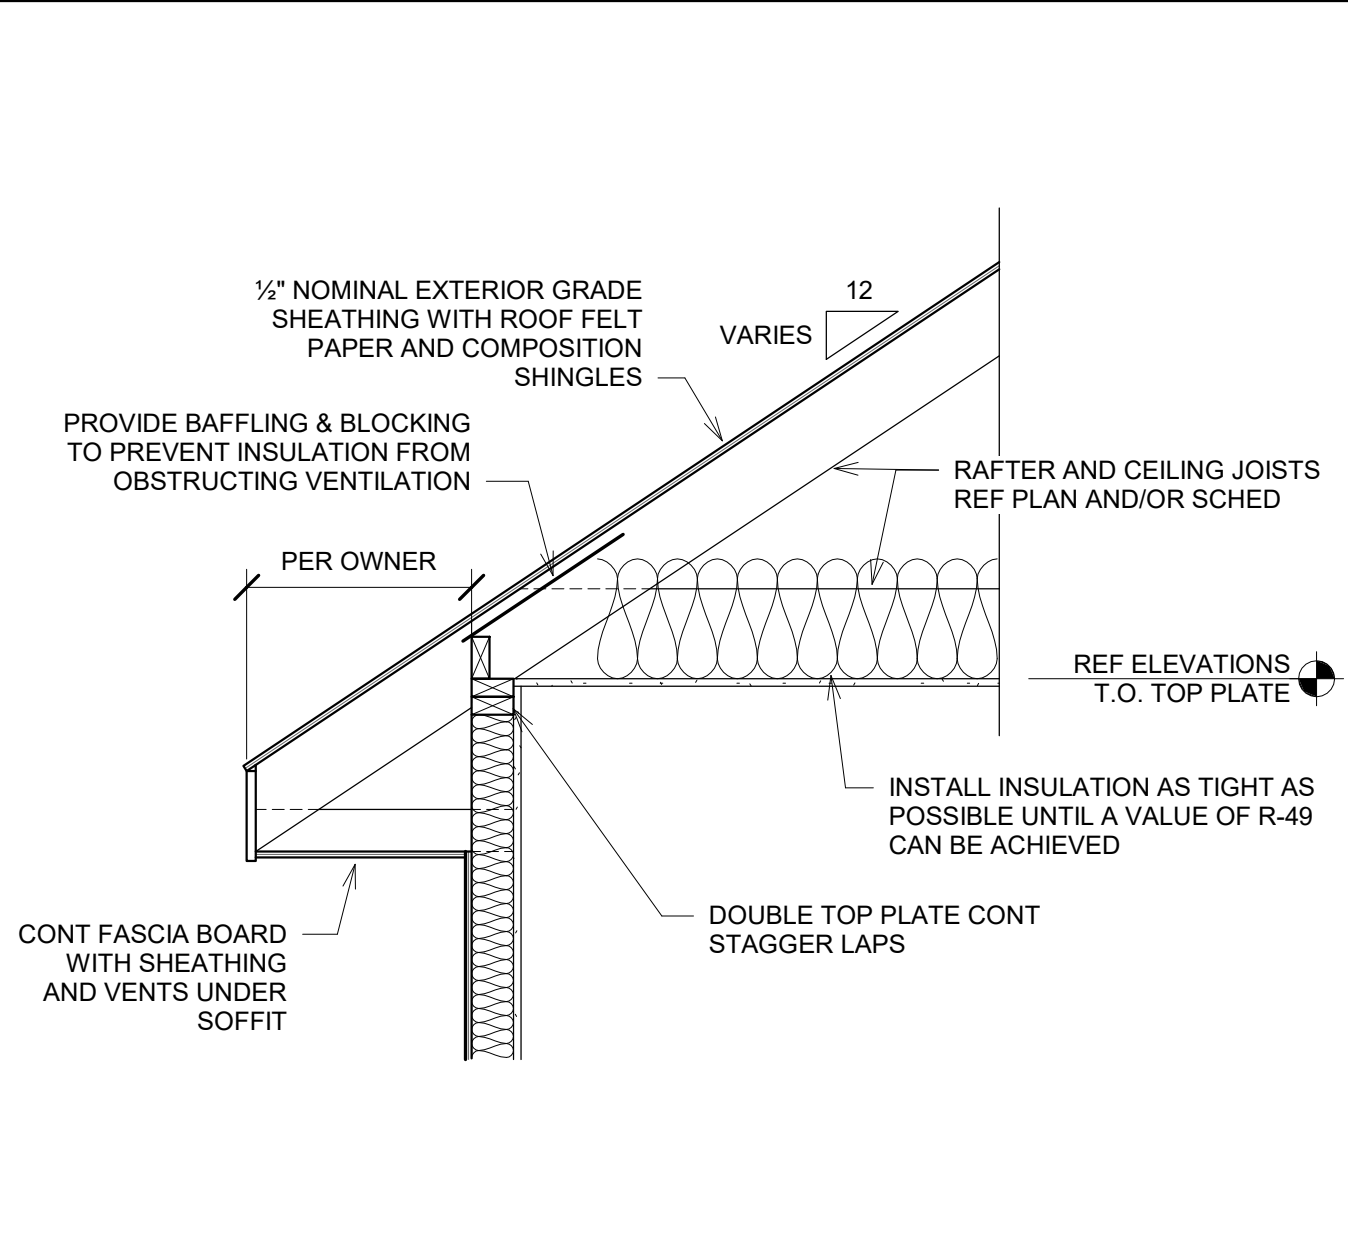

9 ROOF RAFTER BEARING
 SCALE: 3/4" = 1'-0"

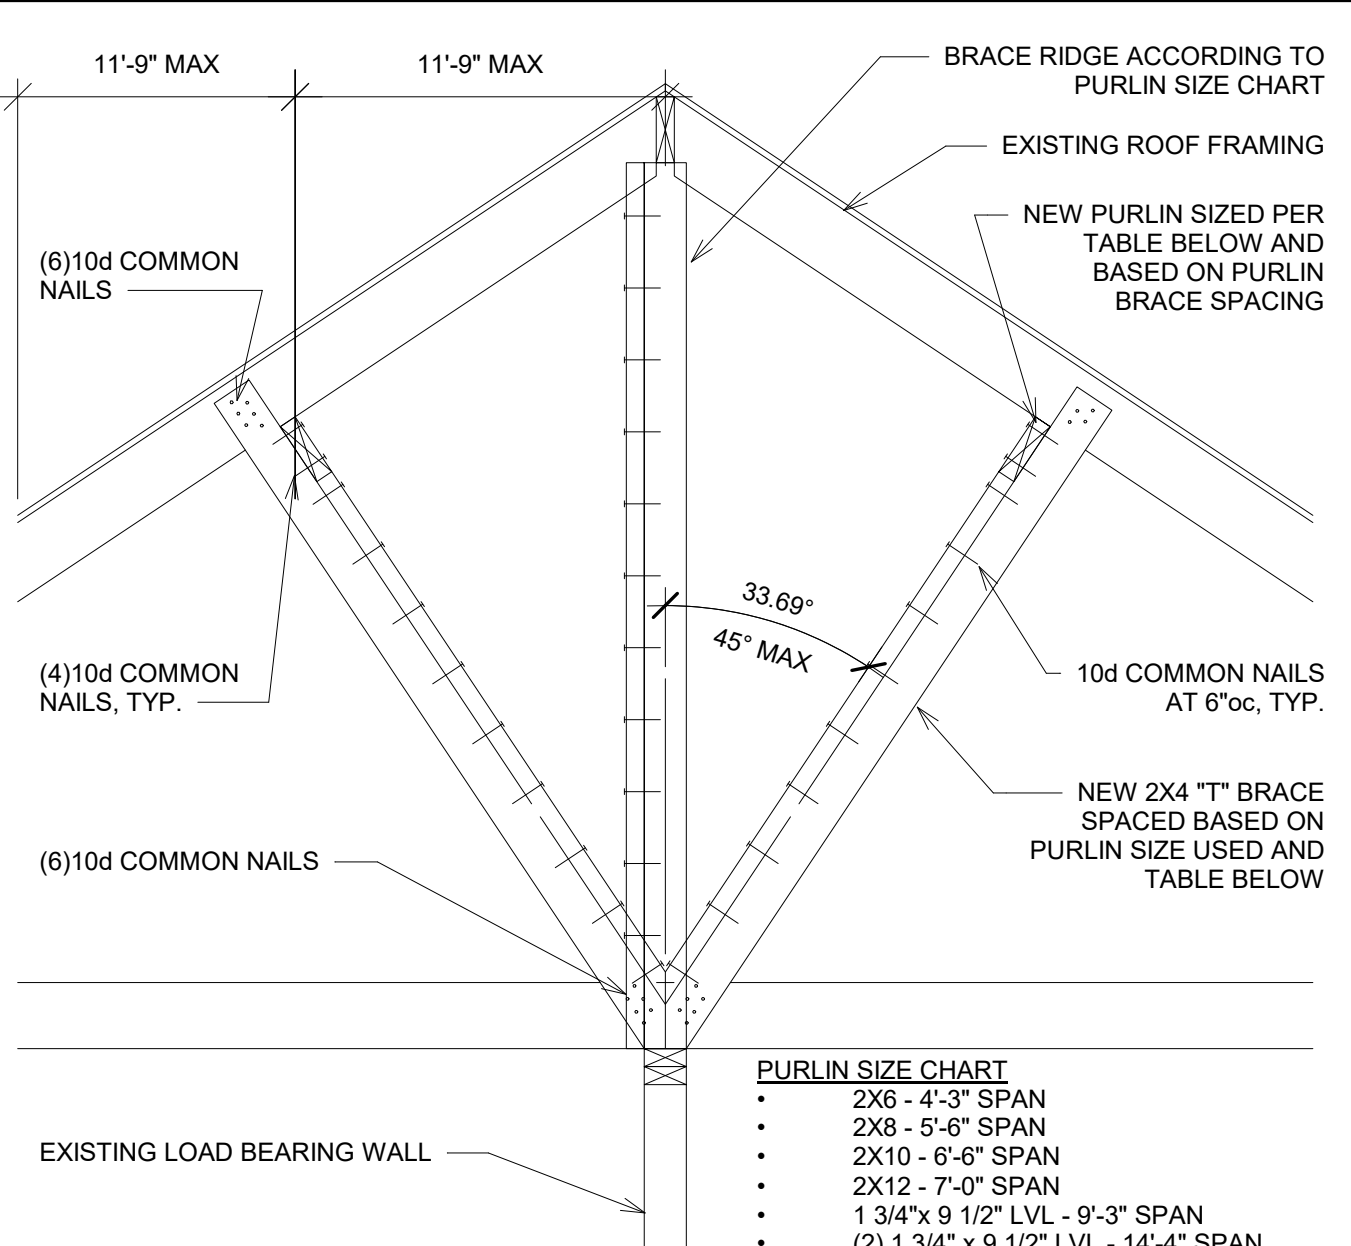

12 PURLIN DETAIL
 SCALE: 3/4" = 1'-0"

TABLE R802.5.1(9) RAFTER/CEILING JOIST HEEL JOINT CONNECTIONS (a,b,c,d,e,f,g)

RAFTER SLOPE	RAFTER SPACING	GROUND SNOW LOAD (PSF)											
		30				50				70			
		12	20	28	36	12	20	28	36	12	20	28	36
ROOF SPAN (FEET)													
REQUIRED NUMBER OF 16d COMMON NAILS(a,b) PER HEEL JOINT SPLICES (c,d,e,f)													
3:12	12	4	6	8	11	5	8	12	15	6	11	15	20
	16	5	8	11	14	6	11	15	20	8	14	20	26
4:12	12	3	5	6	8	4	6	9	11	5	8	12	15
	16	4	6	8	11	5	8	12	15	6	11	15	20
5:12	12	3	4	5	7	3	5	7	9	4	7	9	12
	16	3	5	7	9	4	7	9	12	5	9	12	16
7:12	12	3	3	4	5	3	4	5	7	3	5	7	9
	16	3	4	5	6	3	5	7	9	4	6	9	11
9:12	12	3	3	3	4	3	3	4	5	3	4	5	7
	16	3	3	4	5	3	4	5	7	3	5	7	9
12:12	12	3	3	3	3	3	3	3	4	3	3	4	5
	16	3	3	3	4	3	3	4	5	3	4	5	7

- 40d BOX NAILS SHALL BE PERMITTED TO BE SUBSTITUTED FOR 16d COMMON NAILS.
- NAILING REQUIREMENTS SHALL BE PERMITTED TO BE REDUCED 25% IF NAILS ARE CLINCHED.
- HEEL JOINT CONNECTIONS ARE NOT REQUIRED WHEN THE RIDGE IS SUPPORTED BY A LOAD-BEARING WALL, HEADER, OR RIDGE BEAM.
- WHEN INTERMEDIATE SUPPORT OF THE RAFTER IS PROVIDED BY VERTICAL STRUTS OR PURLINS TO A LOAD-BEARING WALL, THE TABULATED HEEL JOINT CONNECTION REQUIREMENTS SHALL BE PERMITTED TO BE REDUCED PROPORTIONALLY TO THE REDUCTION IN SPAN.
- EQUIVALENT NAILING PATTERNS ARE REQUIRED FOR CEILING JOISTS, THE HEEL JOINT CONNECTION REQUIREMENT SHALL BE TAKEN AS THE TABULATED HEEL JOINT CONNECTION REQUIREMENT FOR TWO-THIRDS OF THE ACTUAL RAFTER-SLOPE.
- TABULATED HEEL JOINT CONNECTION REQUIREMENTS ASSUME THAT CEILING JOISTS OR RAFTER TIES ARE LOCATED AT THE BOTTOM OF THE ATTIC SPACE. WHEN CEILING JOISTS OR RAFTER TIES ARE LOCATED HIGHER IN THE ATTIC, HEEL JOINT CONNECTION REQUIREMENTS SHALL BE INCREASED BY THE FOLLOWING FACTORS:

Hc/Hr	HEEL JOINT CONNECTION ADJUSTMENT FACTOR
1/3	1.5
1/4	1.33
1/5	1.25
1/6	1.2
1/10 OR LESS	1.11


WHERE:
Hc= HEIGHT OF CEILING JOISTS OR RAFTER TIES MEASURED VERTICALLY ABOVE THE TOP OF THE RAFTER SUPPORT WALLS.
Hr=HEIGHT OF ROOF RIDGE MEASURED VERTICALLY ABOVE THE TOP OF THE RAFTER SUPPORT WALLS.

ROOF RAFTER SCHEDULE

GRADE	MEMBER SIZE / SPACING	MAX SPAN CEILING JSTS AT TOP PLATE	MAX SPAN H/Hr=0.16	MAX SPAN H/Hr=0.20	MAX SPAN H/Hr=0.25	MAX SPAN H/Hr=0.33
#2 DF/L	2x6 / 16"oc	14'-1"	12'-8"	11'-8"	10'-8"	9'-5"
#2 DF/L	2x8 / 16"oc	18'-2"	16'-4"	15'-1"	13'-9"	12'-2"
#2 DF/L	2x10 / 16"oc	22'-3"	20'-0"	18'-5"	16'-10"	14'-10"
#2 DF/L	2x12 / 16"oc	25'-9"	23'-2"	21'-4"	19'-7"	17'-3"

SPANS ABOVE ARE FOR ROOF LIVE LOAD OF 20 PSF AND DEAD LOAD OF 10 PSF WITH CEILING ATTACHED TO RAFTERS. RE: TABLES R802.5.1(1) THROUGH R802.5.1(8) FOR ADDITIONAL RAFTER SPAN INFORMATION.

THE ROOF FRAMING ON THIS HOME UTILIZES RAFTERS SPACED AT 16" ON CENTER IN EXPOSURE B WITH A ROOF SPAN LESS THAN 42' ON IN 90 MPH WIND ZONE. THEREFORE THE UPLIFT FORCE ON THE RAFTER IS LESS THAN 200 LBS. AND CAN BE CONNECTED PER TO THE WALL FRAMING PER TABLE 602.3(1) (ON SHEET 6.0).

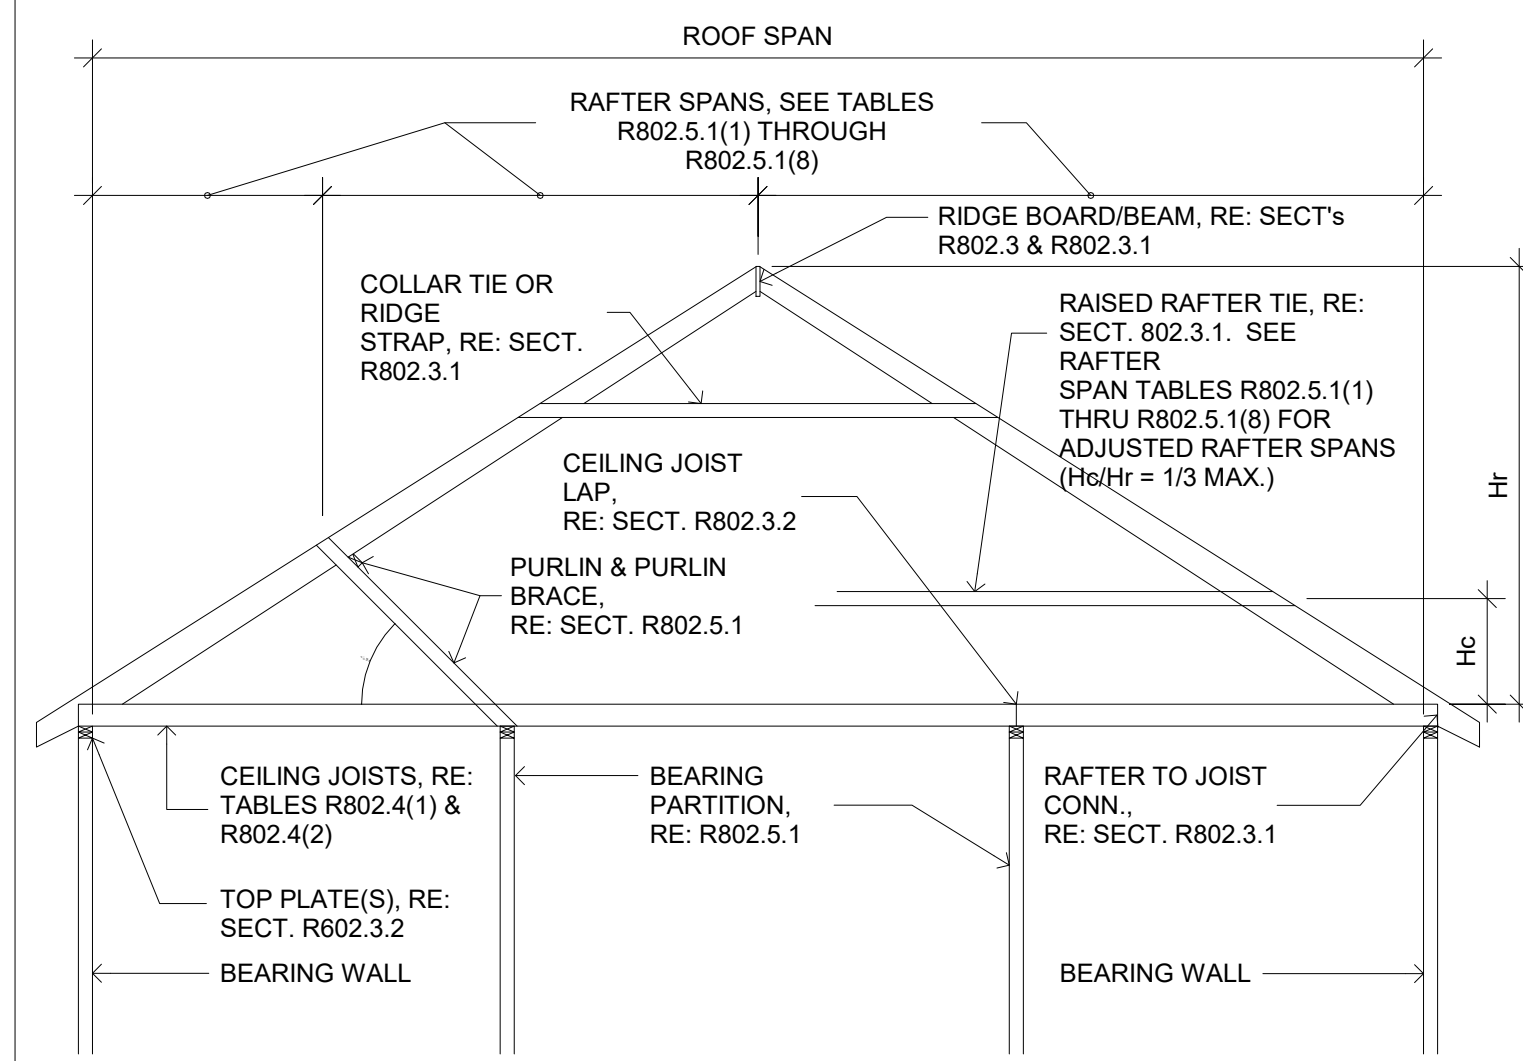

NAILING SCHEDULE IBC 2012 TABLE R602.3(1)


Description of Building Elements	Number & Type of Fastener (a,b,c)	Spacing of Fasteners
Roof		
Blocking between joists or rafters to top plate, toe nail	3 - 8d (2 1/2" x 0.113")	
Ceiling joists to plate, toe nail	3 - 8d (2 1/2" x 0.113")	
Ceiling joist not attached to parallel rafter, laps over partitions, face nail	3 - 10d (3" x 0.128")	
Collar tie to rafter, face nail, or 1 1/2" x 20 gage ridge strap	3 - 10d (3" x 0.128")	
Rafter or roof truss to plate, toe nail	3 - 16d box nails (3 1/2" x 0.135") or 3 - 10d common nails (3" x 0.148")	2 toe nails on one side and 1 toe nail on opposite side of each rafter or truss (j)
Roof rafters to ridge, valley or hip rafters: toe nail	4 - 16d (3 1/2" x 0.135") or 3 - 16d (3 1/2" x 0.135")	
face nail		
Wall		
Built-up studs	10d (3" x 0.128")	24" o.c.
Abutting studs at intersecting wall corners, face nail	16d (3 1/2" x 0.135")	12" o.c.
Built up header, two pieces with 1/2" spacer	16d (3 1/2" x 0.135")	16" o.c. along ea. edge
Continued header, two pieces	16d (3 1/2" x 0.135")	16" o.c. along ea. edge
Continuous header to stud, toe nail	4 - 8d (2 1/2" x 0.113")	
Double studs, face nail	10d (3" x 0.128")	24" o.c.
Double top plates, face nail	10d (3" x 0.128")	24" o.c.
Double top plates, minimum 24" offset of end joints, face nail in lapped area	8 - 16d (3 1/2" x 0.135")	
Sole plate to joist or blocking, face nail	16d (3 1/2" x 0.135")	16" o.c.
Sole plate to joist or blocking at braced wall panels	3 - 16d (3 1/2" x 0.135")	16" o.c.
Stud to sole plate, toe nail	3 - 8d (2 1/2" x 0.113") or 2 - 16d (3 1/2" x 0.135")	
Top or sole plate to stud, end nail	2 - 16d (3 1/2" x 0.135")	
Top plates, laps at corners and intersections, face nail	2 - 10d (3" x 0.128")	
1" brace to each stud and plate, face nail	2 - 8d (2 1/2" x 0.113") 2 staples, 1 3/4"	
1" x 6" sheathing to each bearing, face nail	2 - 8d (2 1/2" x 0.113") 2 staples, 1 3/4"	
1" x 8" sheathing to each bearing, face nail	2 - 8d (2 1/2" x 0.113") 3 staples, 1 3/4"	
Wider than 1" x 8" sheathing to each bearing, face nail	3 - 8d (2 1/2" x 0.113") 4 staples, 1 3/4"	
Floor		
Joist to sill or girder, toe nail	3 - 8d (2 1/2" x 0.113")	
Rim joist to top plate, toe nail (roof applications also)	8d (2 1/2" x 0.113")	6" o.c.
Rim joist or blocking to sill plate, toe nail	8d (2 1/2" x 0.113")	6" o.c.
1" X 6" subfloor or less to each joist, face nail	2 - 8d (2 1/2" x 0.113") 2 staples, 1 3/4"	
2" subfloor to joist or girder, blind & face nail	2 - 16d (3 1/2" x 0.135")	
2" planks (plan & beam - floor & roof)	2 - 16d (3 1/2" x 0.135")	At each bearing

(Continued)


NAILING SCHEDULE IBC 2012 TABLE R602.3(1)

Description of Building Elements	Number & Type of Fastener (a,b,c)	Spacing of Fasteners
Floor (Continued)		
Built-up girders and beams, 2-inch lumber layers	10d (3" x 0.128")	Nail ea. layer as follows: 32" o.c. at top & bott. & staggered. Two nails at ends and at ea. splice
Ledger strip supporting joists or rafters	3 - 16d (3 1/2" x 0.135")	At each joist or rafter
Other wall sheathing (h)		
1/2" structural cellululosic fiberboard sheathing	1 1/2" galvanized roofing nail 8d common (2 1/2" x 0.131") nail; staple 16 ga., 1 1/2" long	3" 6"
3/8" structural cellululosic fiberboard sheathing	1 3/4" galvanized roofing nail 8d common (2 1/2" x 0.131") nail; staple 16 ga., 1" long	3 1/2" 6"
1/2" gypsum sheathing (d)	1 1/2" galvanized roofing nail; staple galvanized, 1 1/2" long; 1 1/4" screws, Type W or S	7" 7"
5/8" gypsum sheathing (d)	1 3/4" galvanized roofing nail; staple galvanized, 1 3/4" long; 1 1/4" screws, Type W or S	7" 7"
Wood structural panels, combination subfloor underlayment to framing		
3/4" or less	6d deformed (2" x 0.120") nail or 8d common (2 1/2" x 0.131") nail	6" 12"
5/8" - 1"	8d common (2 1/2" x 0.131") nail or 8d deformed (2 1/2" x 0.120") nail	6" 12"
1 1/8" - 1 1/4"	10d common (3" x 0.148") nail or 8d deformed (2 1/2" x 0.120") nail	6" 12"


- All nails are smooth-common, box or deformed shanks except where otherwise stated. Nails used for framing and sheathing connections shall have minimum average bending yield strengths as shown: 80 ksi for shank diameter of 0.192 inch (20d common nail), 90 ksi for shank diameters larger than 0.142 inch but not larger than 0.177 inch, and 100 ksi for shank diameters of 0.142 inch or less.
- Staples are 16 gage wire and have a minimum 3/16-inch on diameter crown width.
- Nails shall be spaced at not more than 6" on center at all supports where spans are 48 inches or greater.
- Four-foot-by-8-foot or 4-foot-by-9-foot panels shall be applied vertically.
- Spacing of fasteners not included in this table shall be based on Table R602.3(2).
- For regions having basic wind speed of 110 mph or greater, 8d deformed (2 1/2" x 0.120) nails shall be used for attaching plywood and wood structural panel roof sheathing to framing within minimum 48-inch distance from gable end walls, if mean roof height is more than 25 feet, up to 35 feet maximum.
- For regions having a basic wind speed of 100 mph or less, nails for attaching wood structural panel roof sheathing to gable end wall framing shall be spaced 6 inches on center. When basic wind speed is greater than 100 mph, nails for attaching panel roof sheathing to intermediate supports shall be spaced 6 inches on center for minimum 48-inch distance from ridges, eaves and gable end walls; and 4 inches on center to gable end wall framing.
- Gypsum sheathing shall conform to ASTM C-1396 and shall be installed in accordance with GA 253. Fiberboard sheathing shall conform to ASTM C 208.
- Spacing of fasteners on floor sheathing panel edges applies to panel edges supported by framing members and required blocking and at all floor perimeters only. Spacing of fasteners on roof sheathing panel edges applies to panel edges supported by framing members and required blocking. Blocking of roof or floor sheathing panel edges perpendicular to the framing members need not be provided except as required by other provisions of this code. Floor perimeter shall be supported by framing members or solid blocking.
- Where a rafter is fastened to an adjacent parallel ceiling joist in accordance with this schedule, provide two toe nails on one side of the rafter and toe nails from the ceiling joist to top plate in accordance with this schedule. The toe nail on the opposite side of the rafter shall not be required.

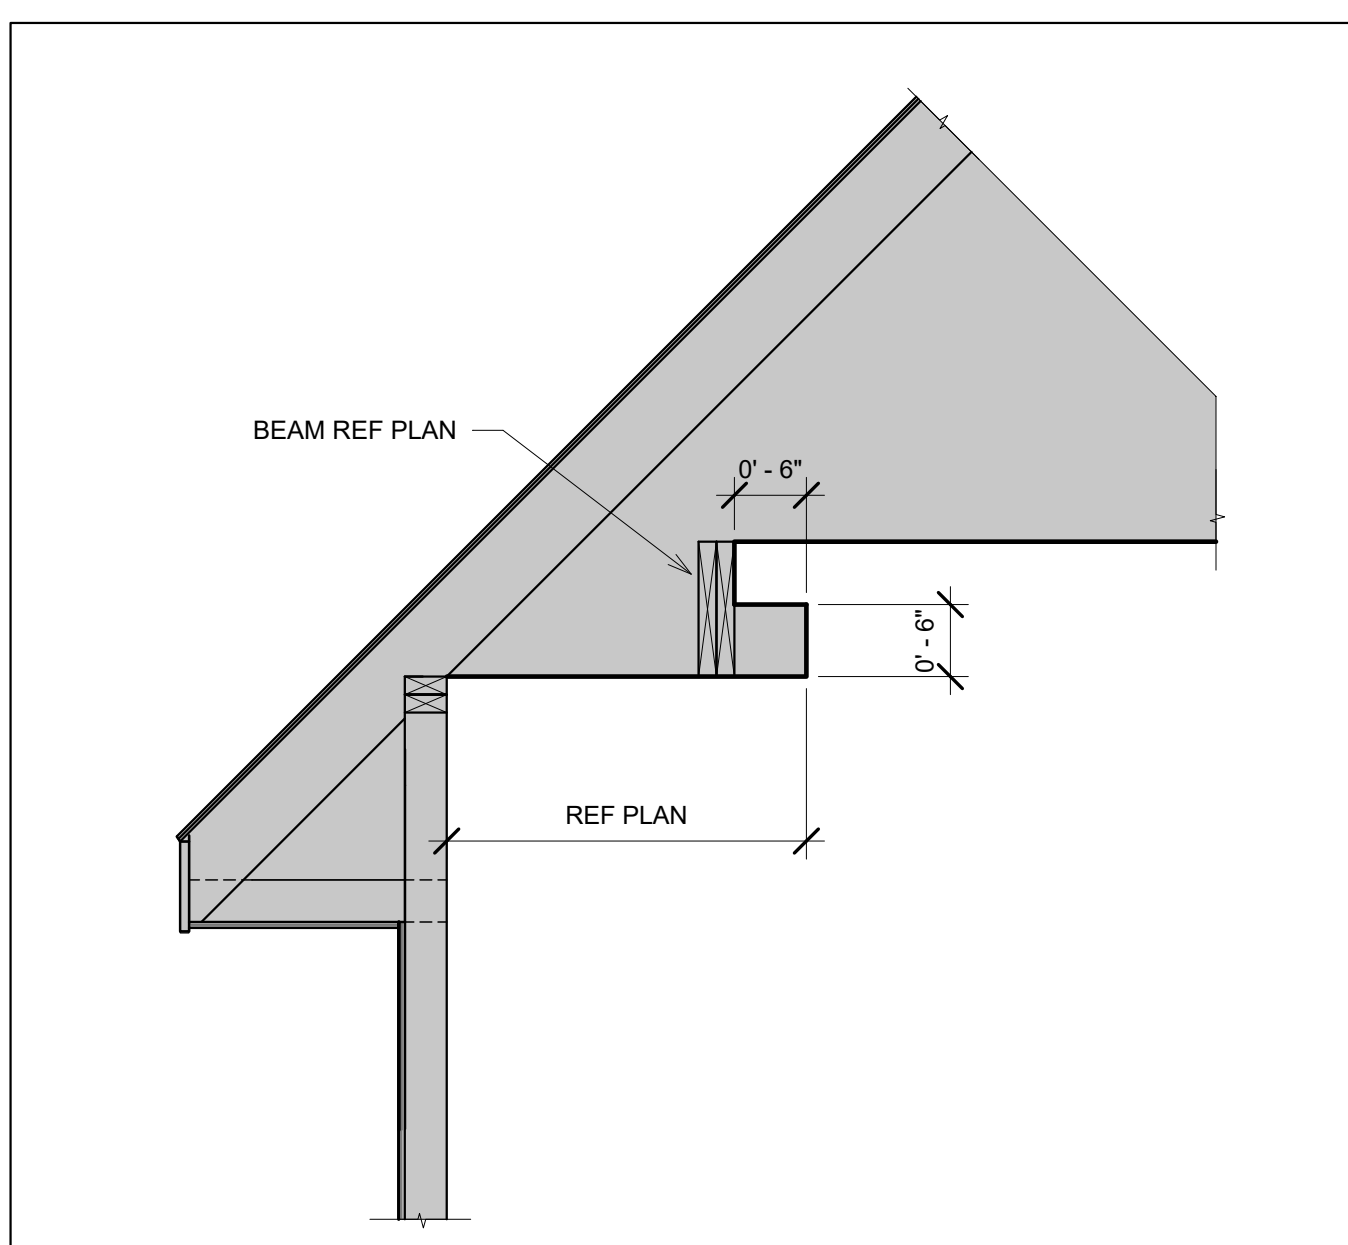

3 TRAY CEILING
SCALE: 3/4" = 1'-0"

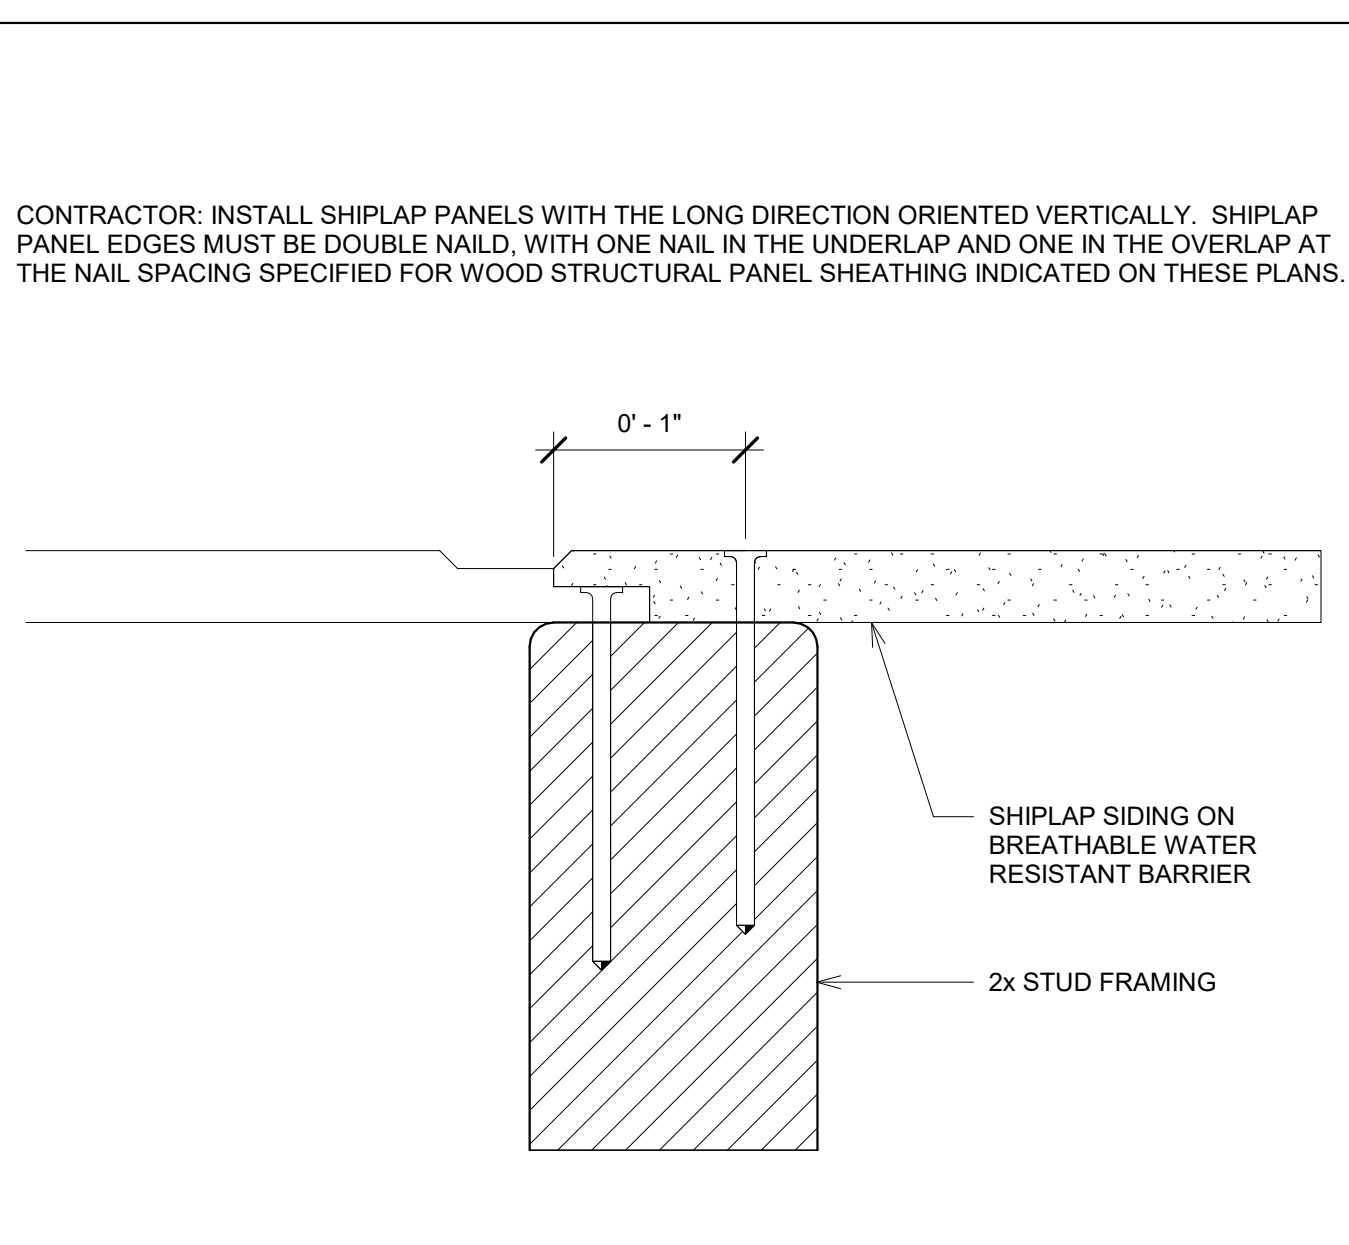

2 VERTICAL SHIPLAP SIDING PANEL JOINT
SCALE: 1/2" = 1'-0"

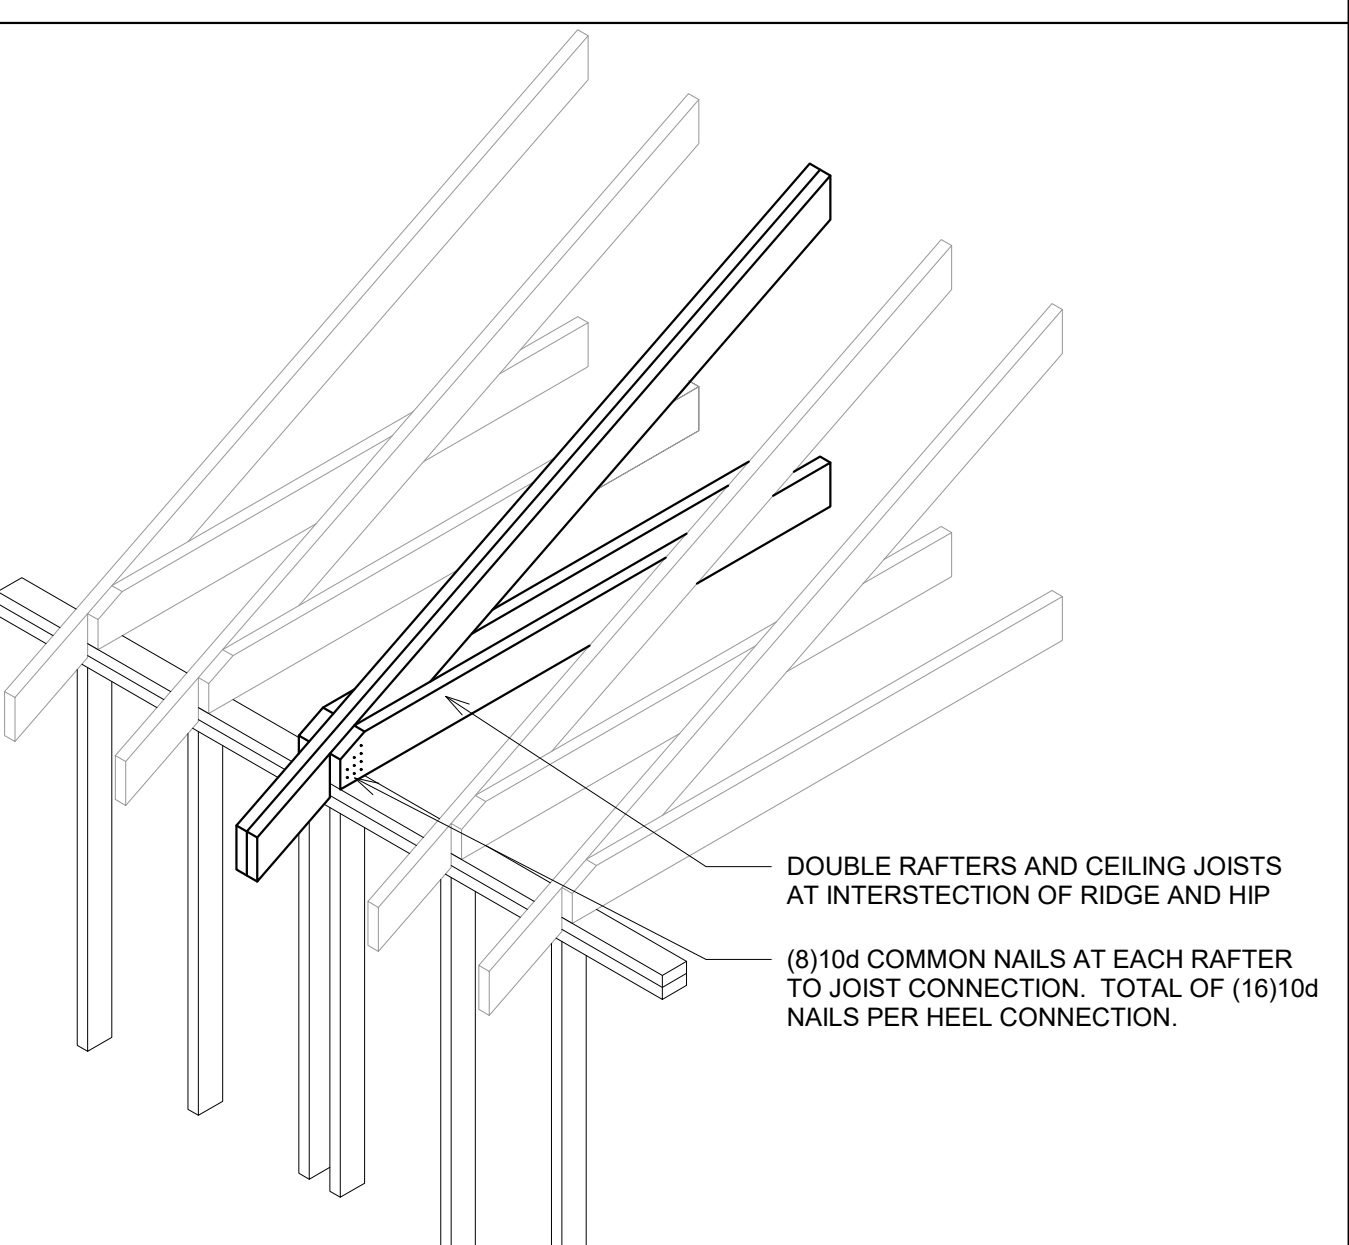

1 RAFTER/JOIST RIDGE SUPPORT
SCALE: 3/4" = 1'-0"

Norton & Schmidt
Consulting Engineers, L.L.C.
311 East 11th Avenue
North Kansas City, MO 64116
Phone: (816) 441-4232
Fax: (816) 421-1866
www.nortonschmidt.com

STATE OF MISSOURI
BRANDON SCHWABAUER
Professional Engineer
No. PE-2015003020
Exp. 04/03/2020

N&S JOB NUMBER: 2020-0255
© 2020 Norton & Schmidt Consulting Engineers

PROJECT INFORMATION

THE LEXINGTON II
2521 SW River Trail Road
Lee's Summit, Missouri

ISSUES & REVISIONS

#	DATE	DESCRIPTION
	04/03/2020	PERMIT

DRAWN BY: MLR
CHECKED BY: BSS
ISSUED FOR:

SHEET TITLE
DETAILS

SHEET NUMBER
S504

PROJECT INFORMATION
 THE LEXINGTON II
 2521 SW River Trail Road
 Lee's Summit, Missouri


ISSUES & REVISIONS

#	DATE	DESCRIPTION
	04/03/2020	PERMIT


DRAWN BY: MLR
 CHECKED BY: BSS
 ISSUED FOR:

SHEET TITLE
 DETAILS


SHEET NUMBER
 S505

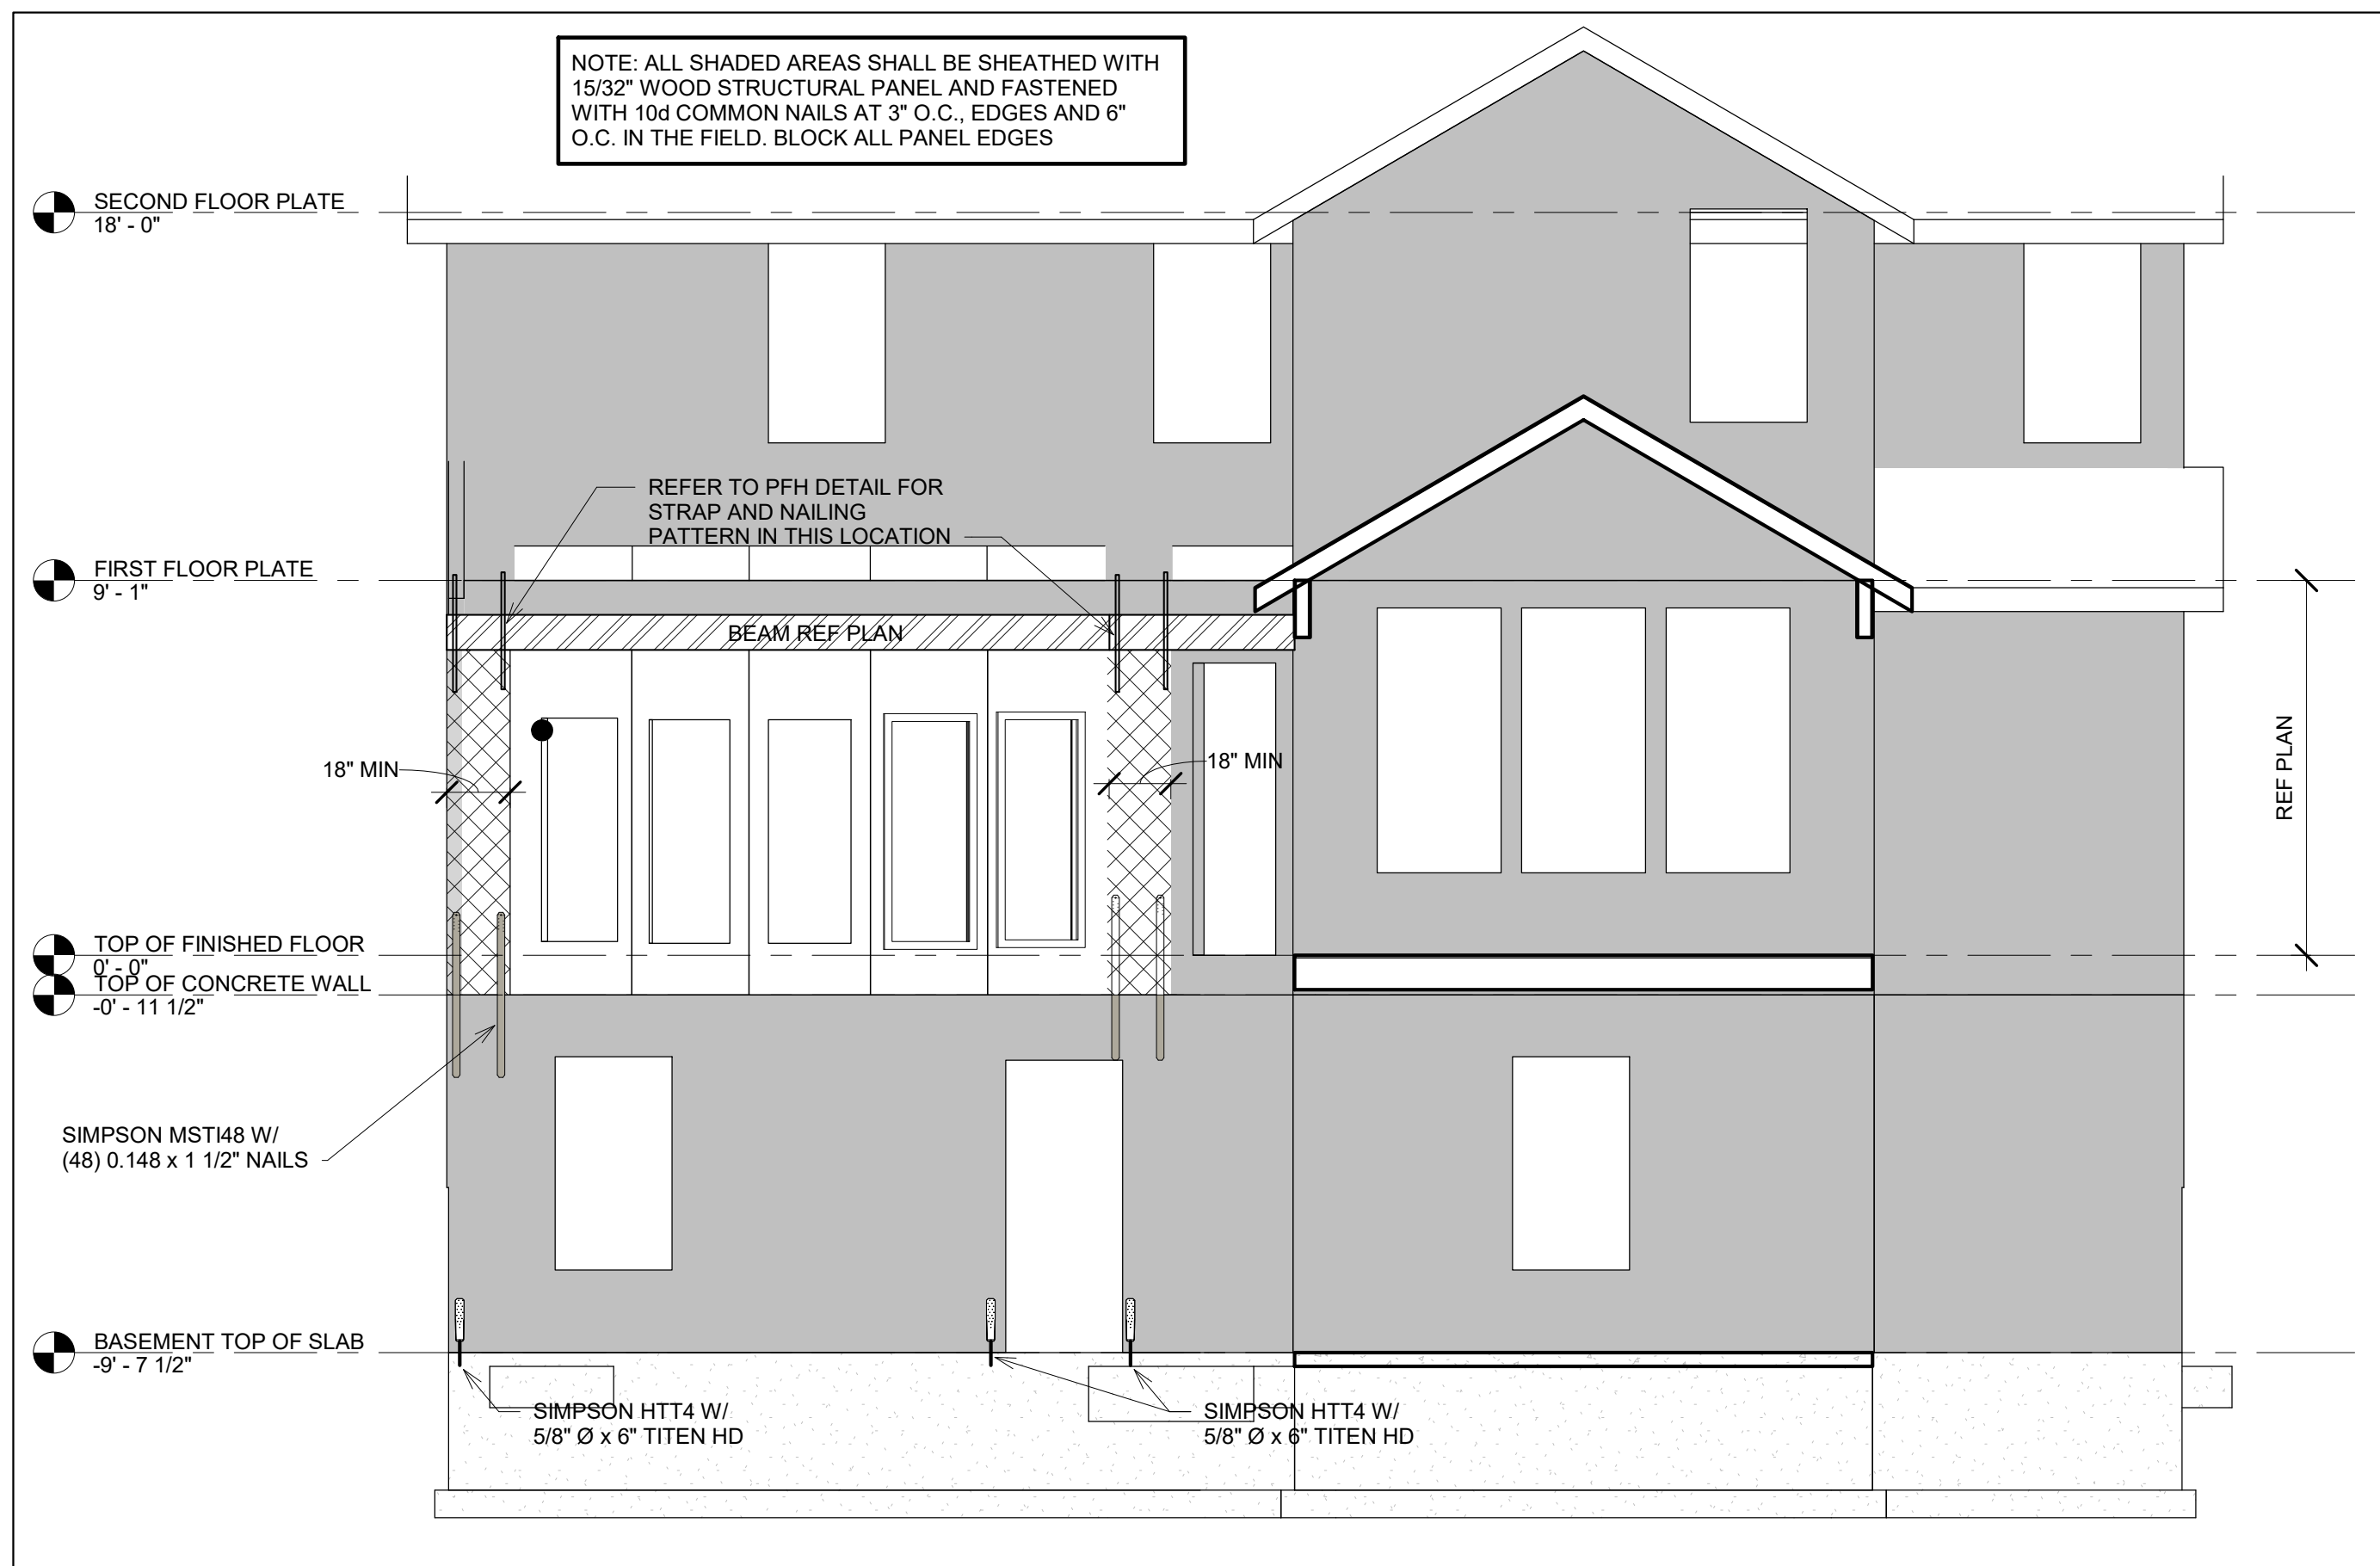


3 ENGINEERED WALL BRACING AT BACK ELEVATION
 SCALE: 1/4" = 1'-0"

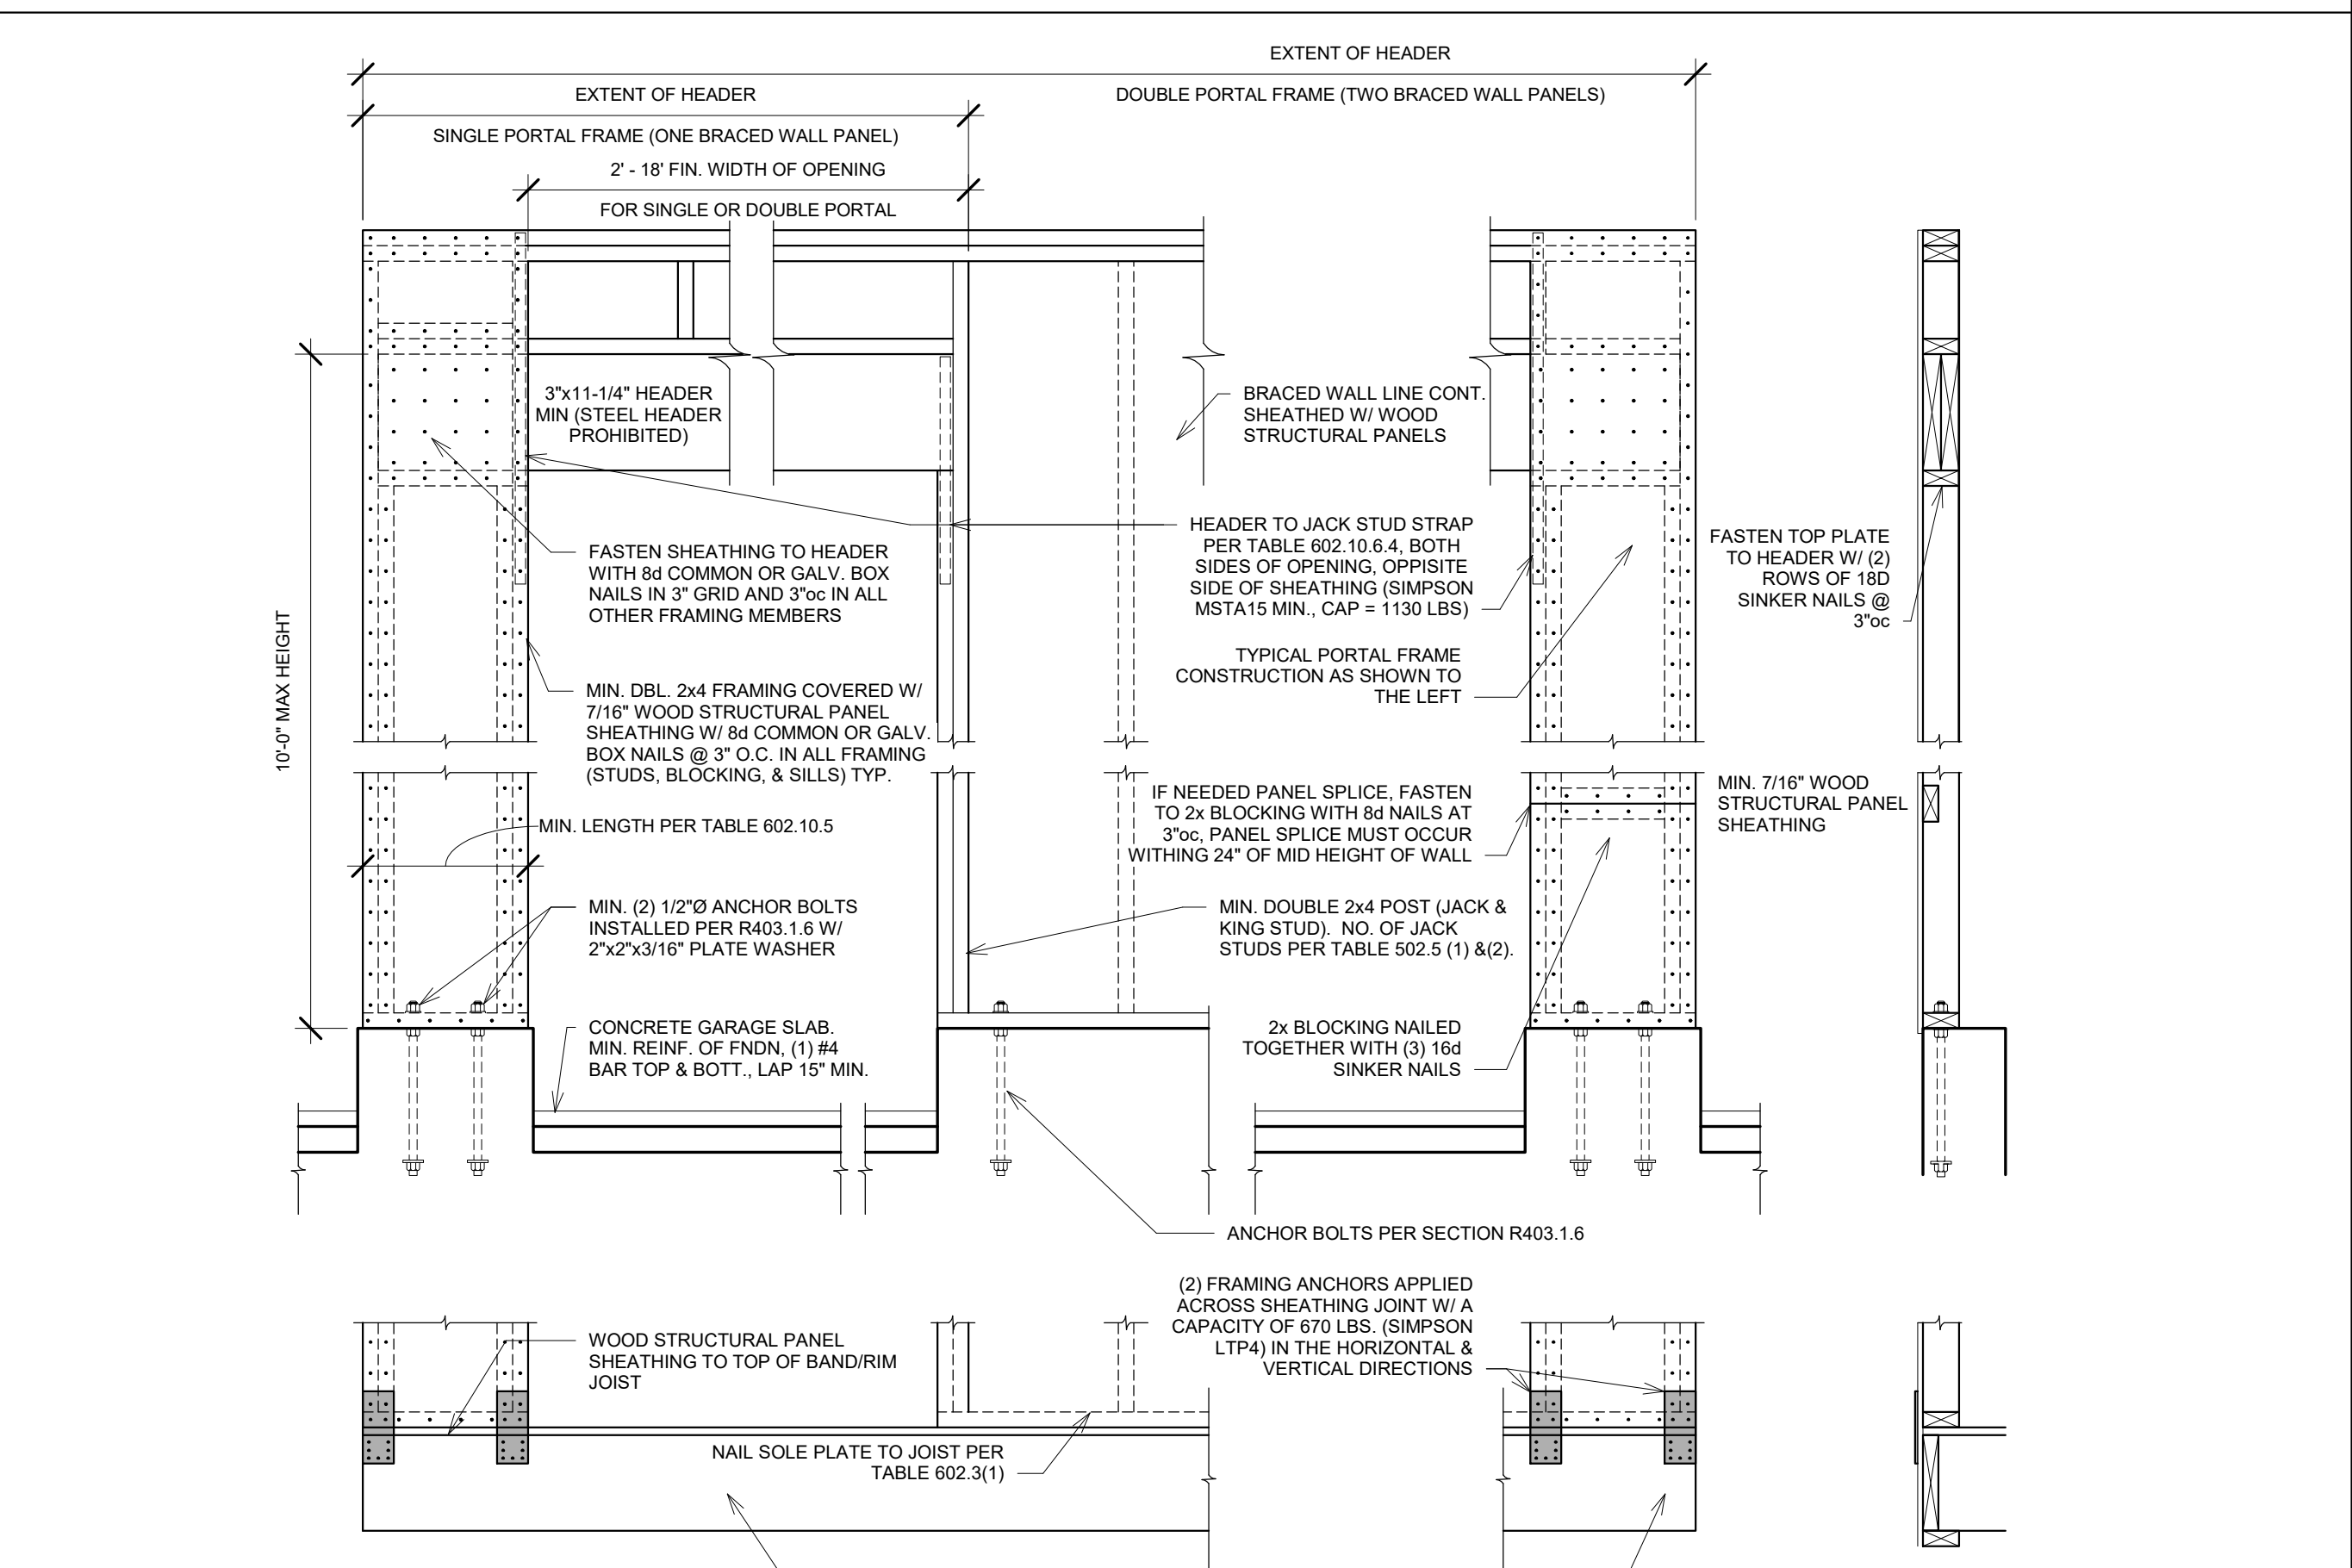

2 METHOD CS-PF (R602.10.6.4)
 SCALE: 3/4" = 1'-0"

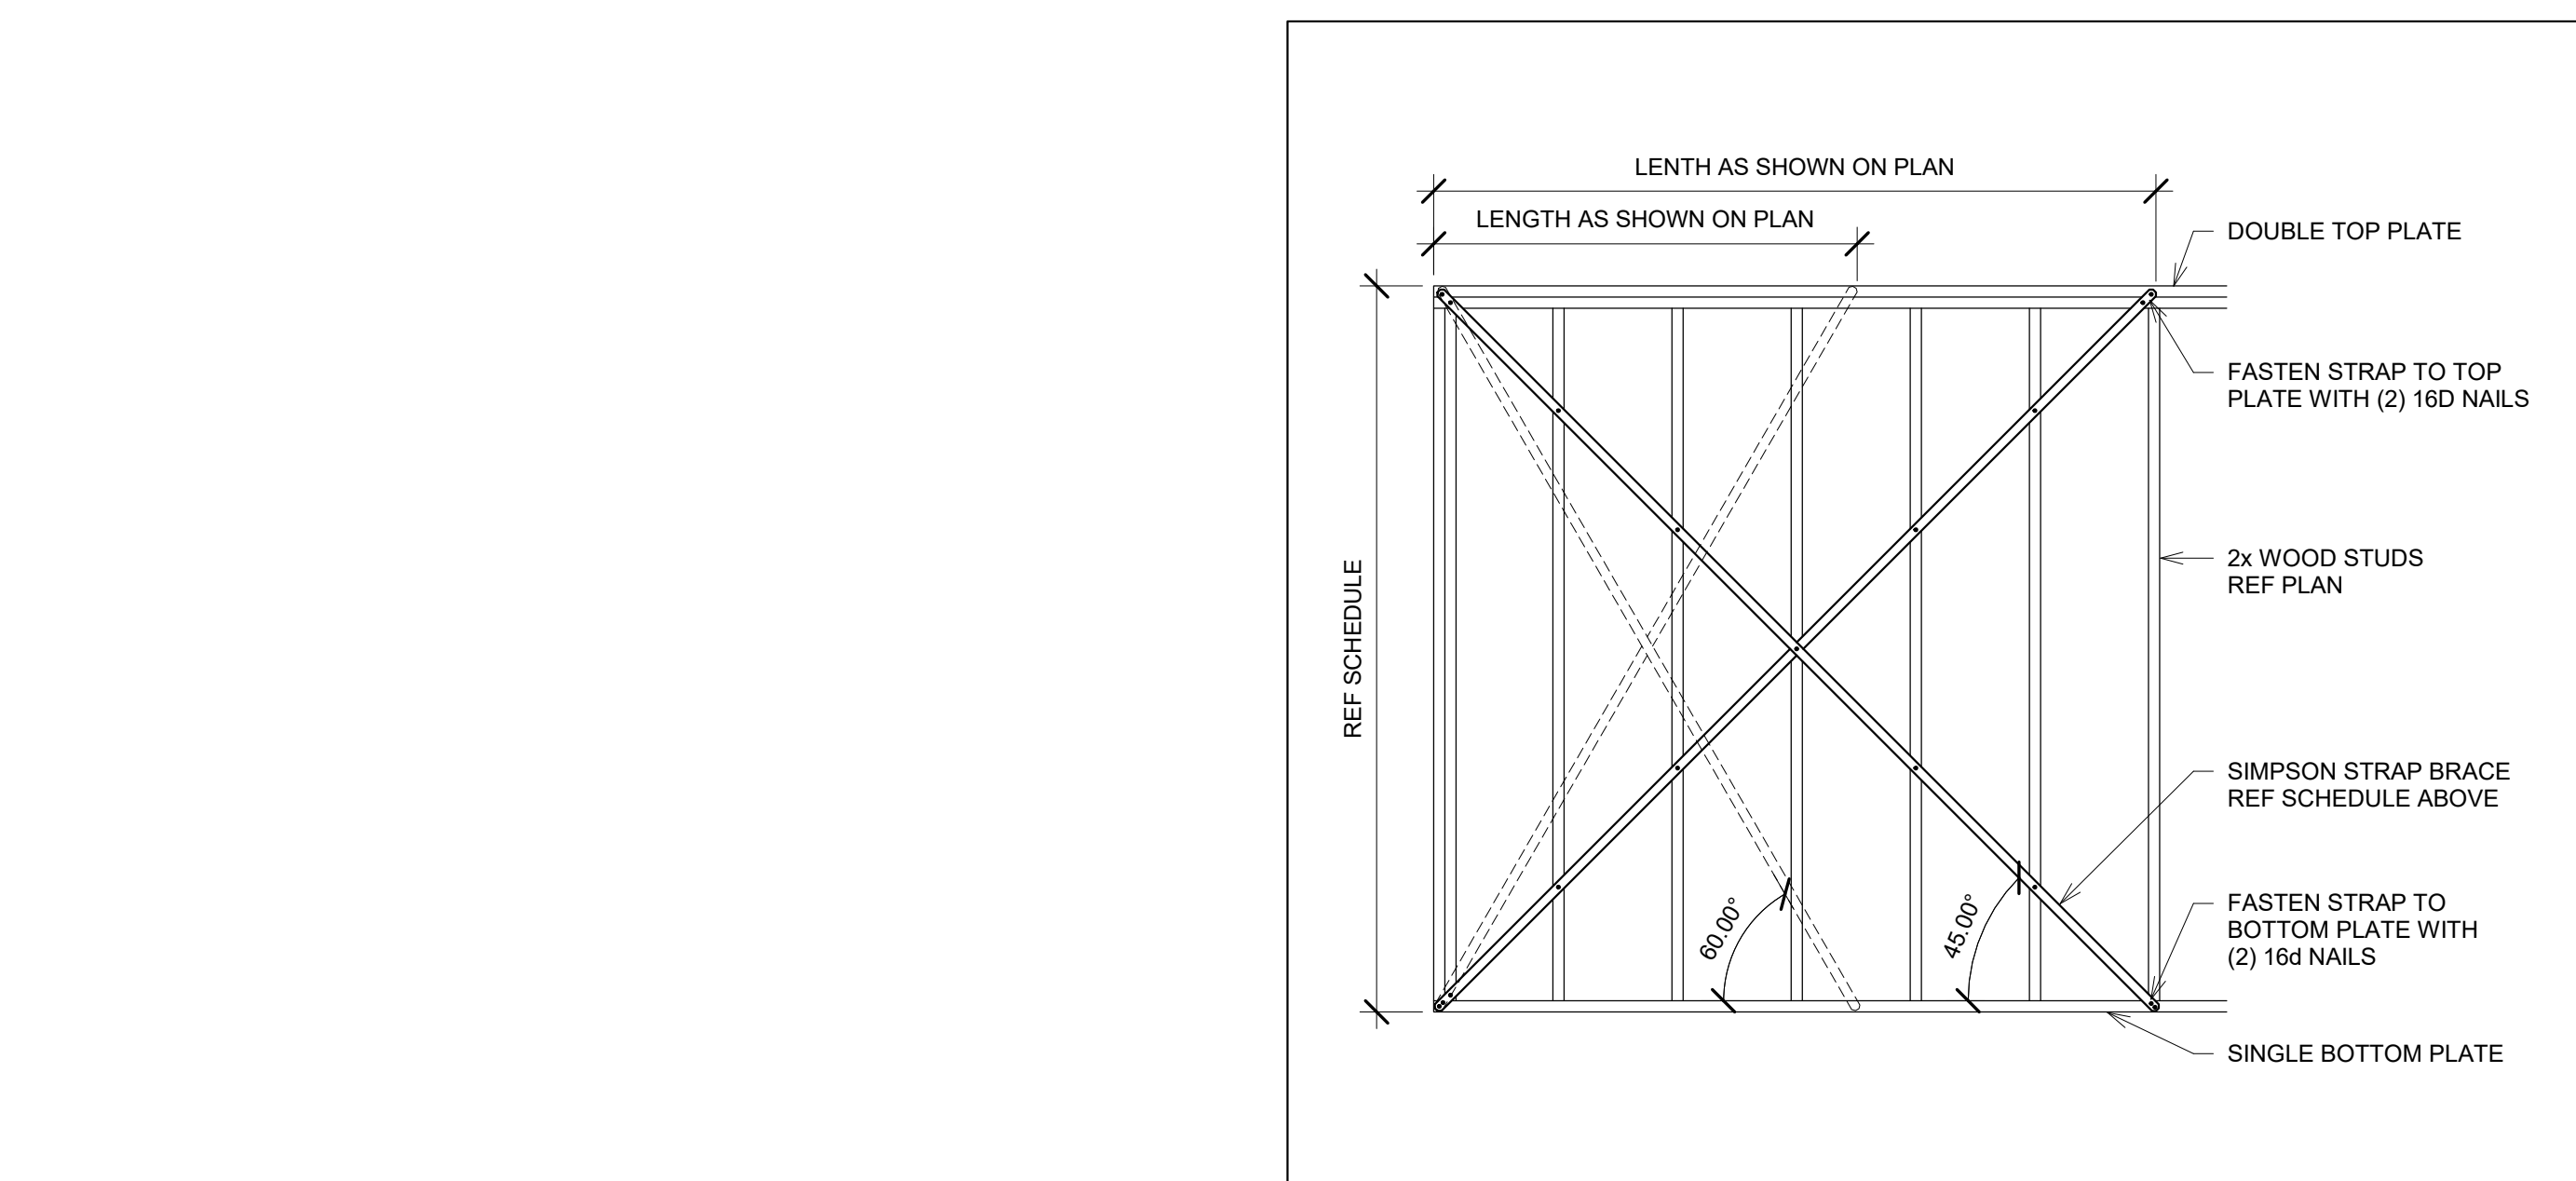

4 INTERIOR BRACED WALL (LIB)
 SCALE: 1" = 1'-0"

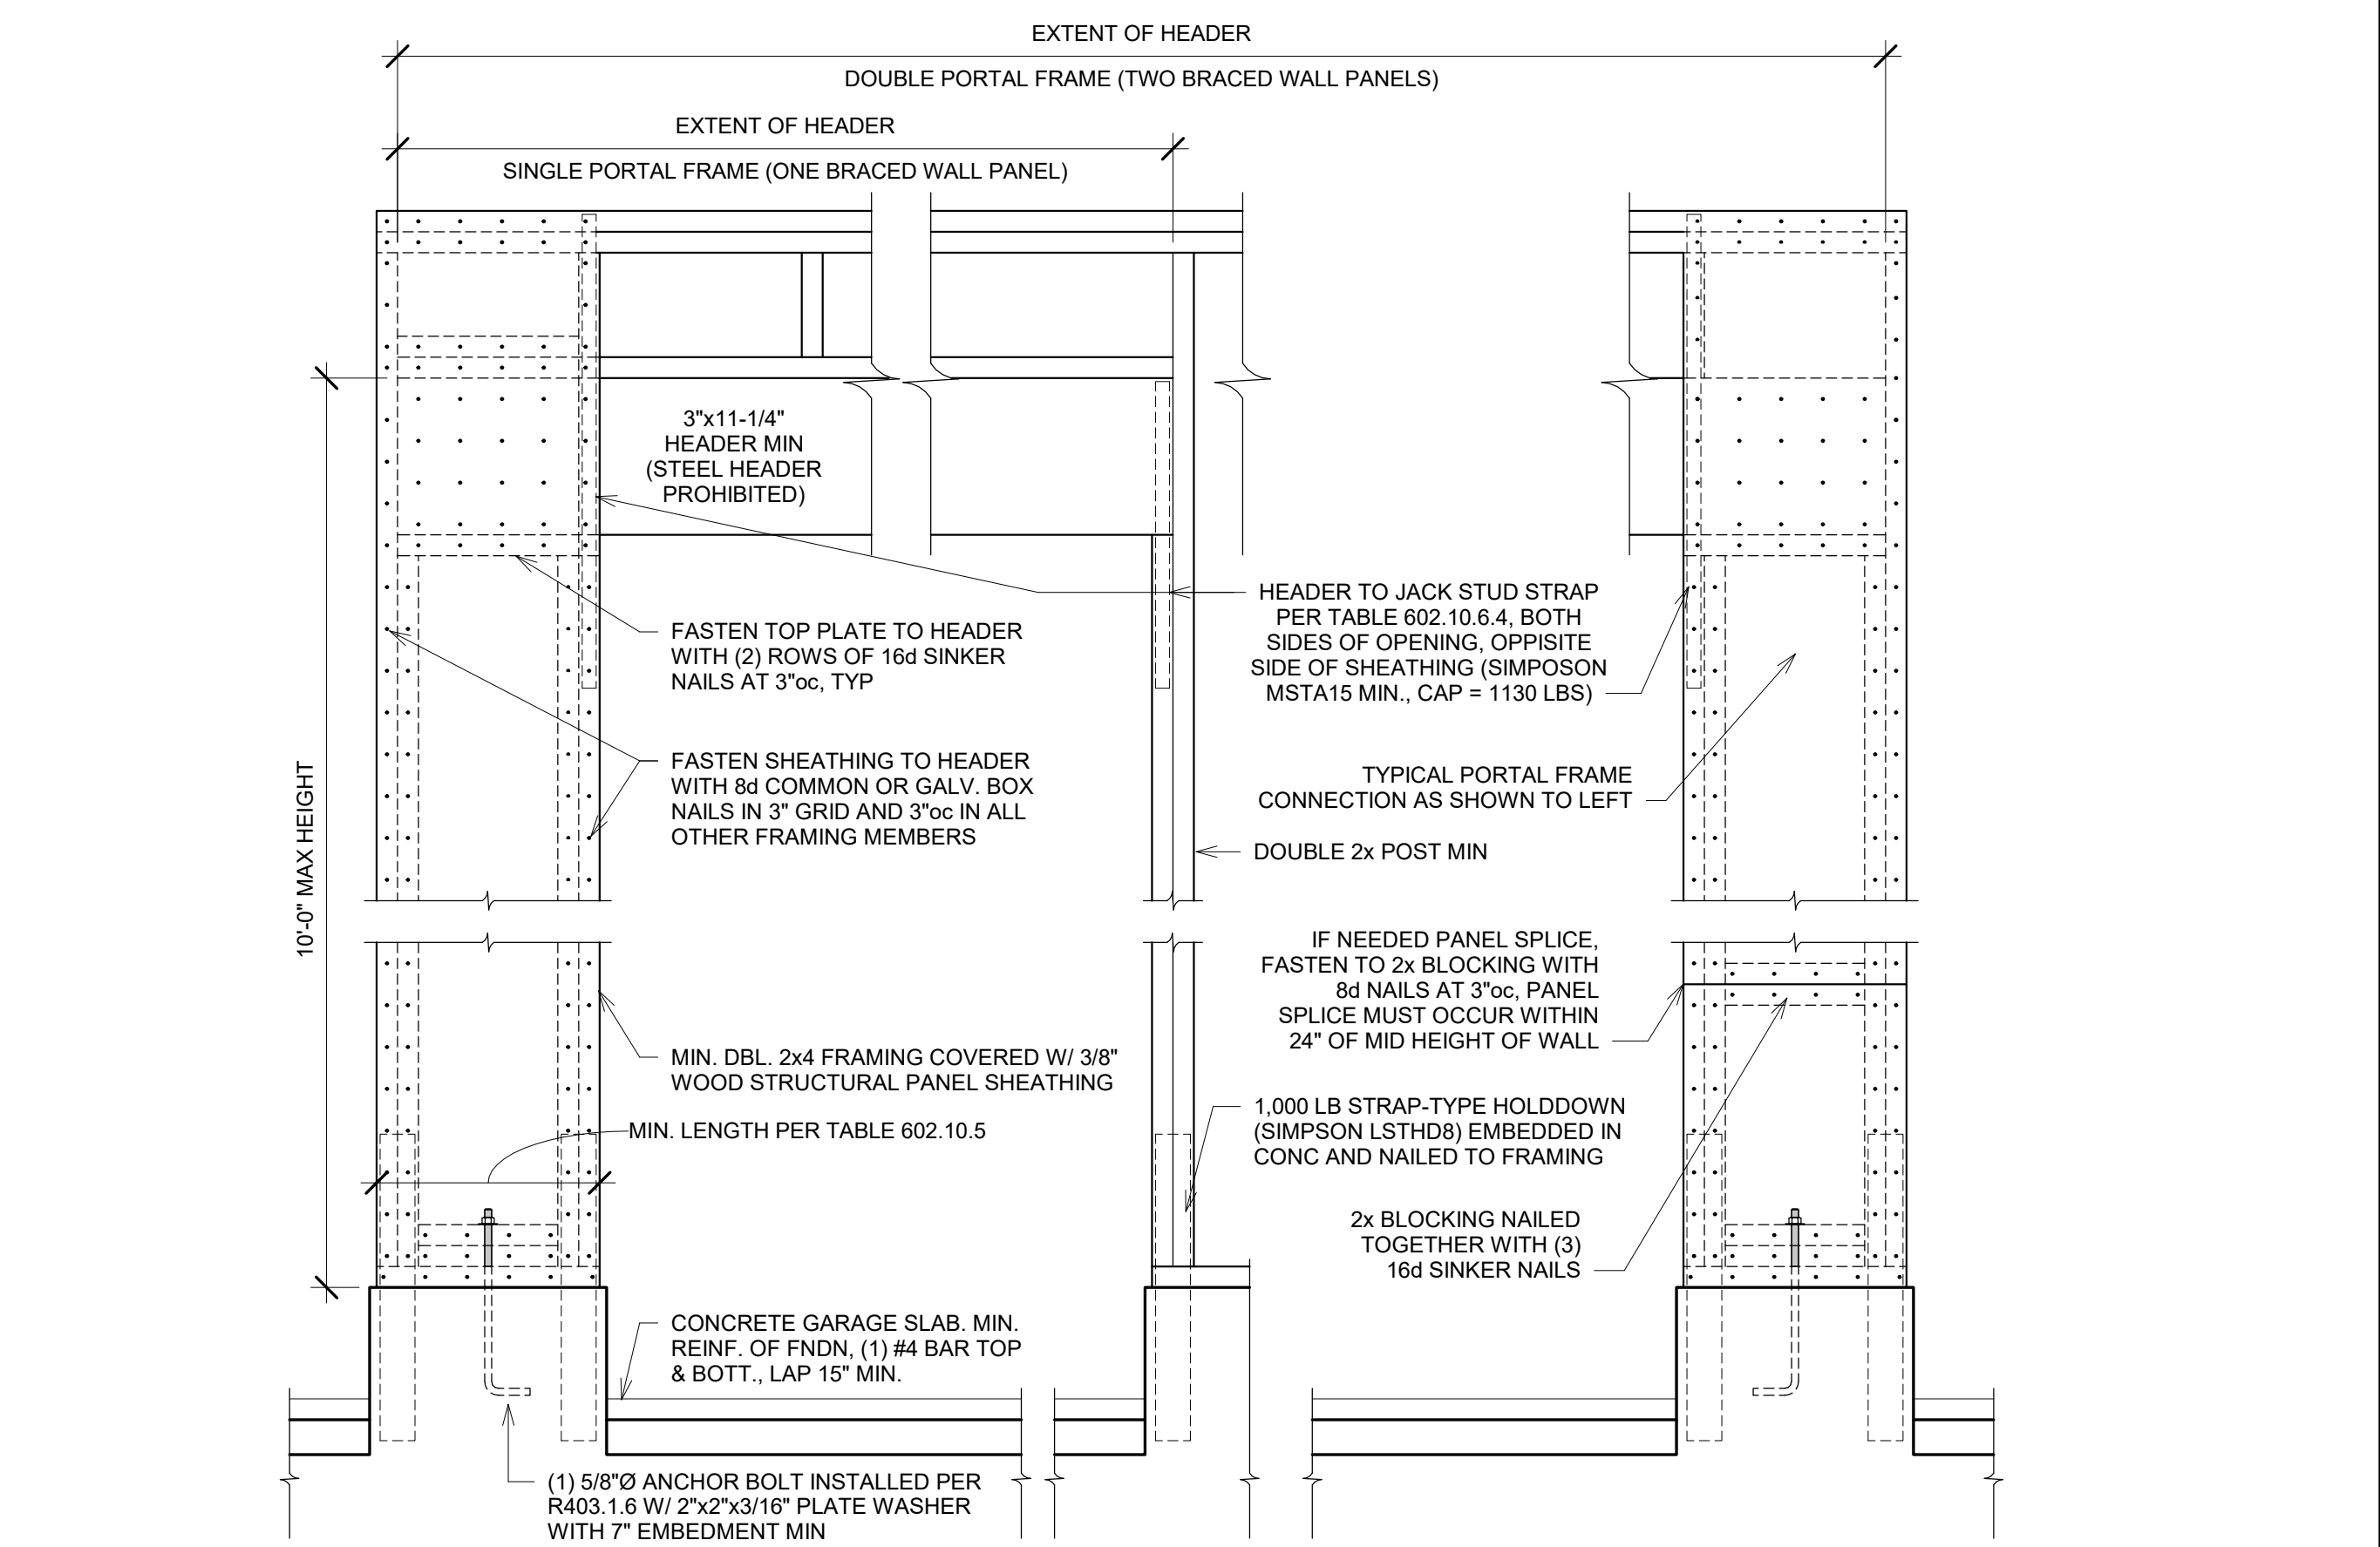

1 METHOD PFH (R602.10.6.2)
 SCALE: 1" = 1'-0"