




East Elevation

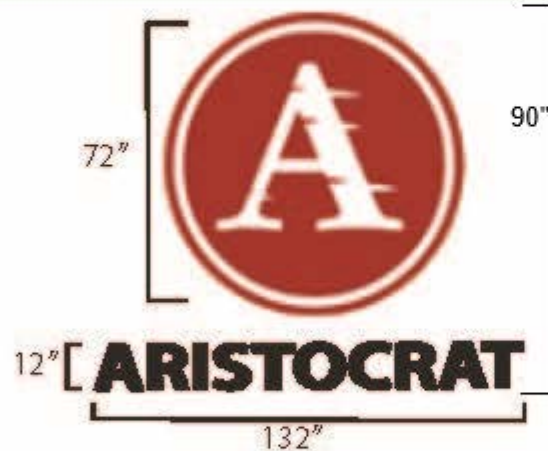

Electrical Detail:

White LEDs
 (Q) 60W Power Supplies @ 0.55 each
 Total Amps = 3.30A




General Notes:

This sign is to be installed in accordance with the requirements of Article 600 of the National Electrical Code.

- 1) Grounded and bonded per NEC 600.7/NEC 250
- 2) Existing branch circuit in compliance with NEC 600.6, not to exceed 20 amps
- 3) Sign is to be UL listed per NEC 600.3
- 4) UL disconnect switch per NEC 600.6- required per sign component before leaving manufacturer
 *For multiple signs, a disconnect is permitted but not required for each section

Specifications: Channel Letters / Logo

1. Existing Facade: TBD
2. 0.040 Aluminum letter returns pre-finished white
3. 0.125" x 1" white trim cap
4. 0.053" aluminum beads fastened to returns. (interior of sign can painted white for maximum illumination)
5. White LEDs
6. 2x16" 2447 White Plex faces
7. Waterproof disconnect switch per NEC 600-6
8. Primary electrical feed
9. Power Supplies within UL enclosure (removable lid)
10. Mounting Hardware to suit w/ 3/8" standoff finished to match facade

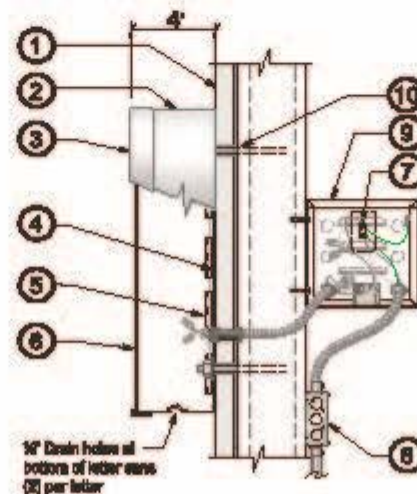

I have reviewed and hereby accept these drawings as shown. I realize that any changes after approval may alter the contract price and delivery.

CLIENT APPROVAL

DATE

This drawing is for representational purposes only and may not exactly match the colors of materials used in actual production of project.

NOTES



This design/engineering proposal is to remain Midwest Sign's exclusive property until approved and accepted through purchase by client named on drawing.

Aristocrat Pre-Owned
 Lees Summit, MO

**MIDWEST
 SIGN COMPANY**

www.midwestsigncompany.com

550 Stanley Rd. Kansas City, KS 66115