


REVIEWED BY:
RESIDENTIAL ENGINEERING SERVICES, LLC

REVIEWED BY:

RESIDENTIAL ENGINEERING SERVICES, LLC

Brad A. Huxol, P.E.

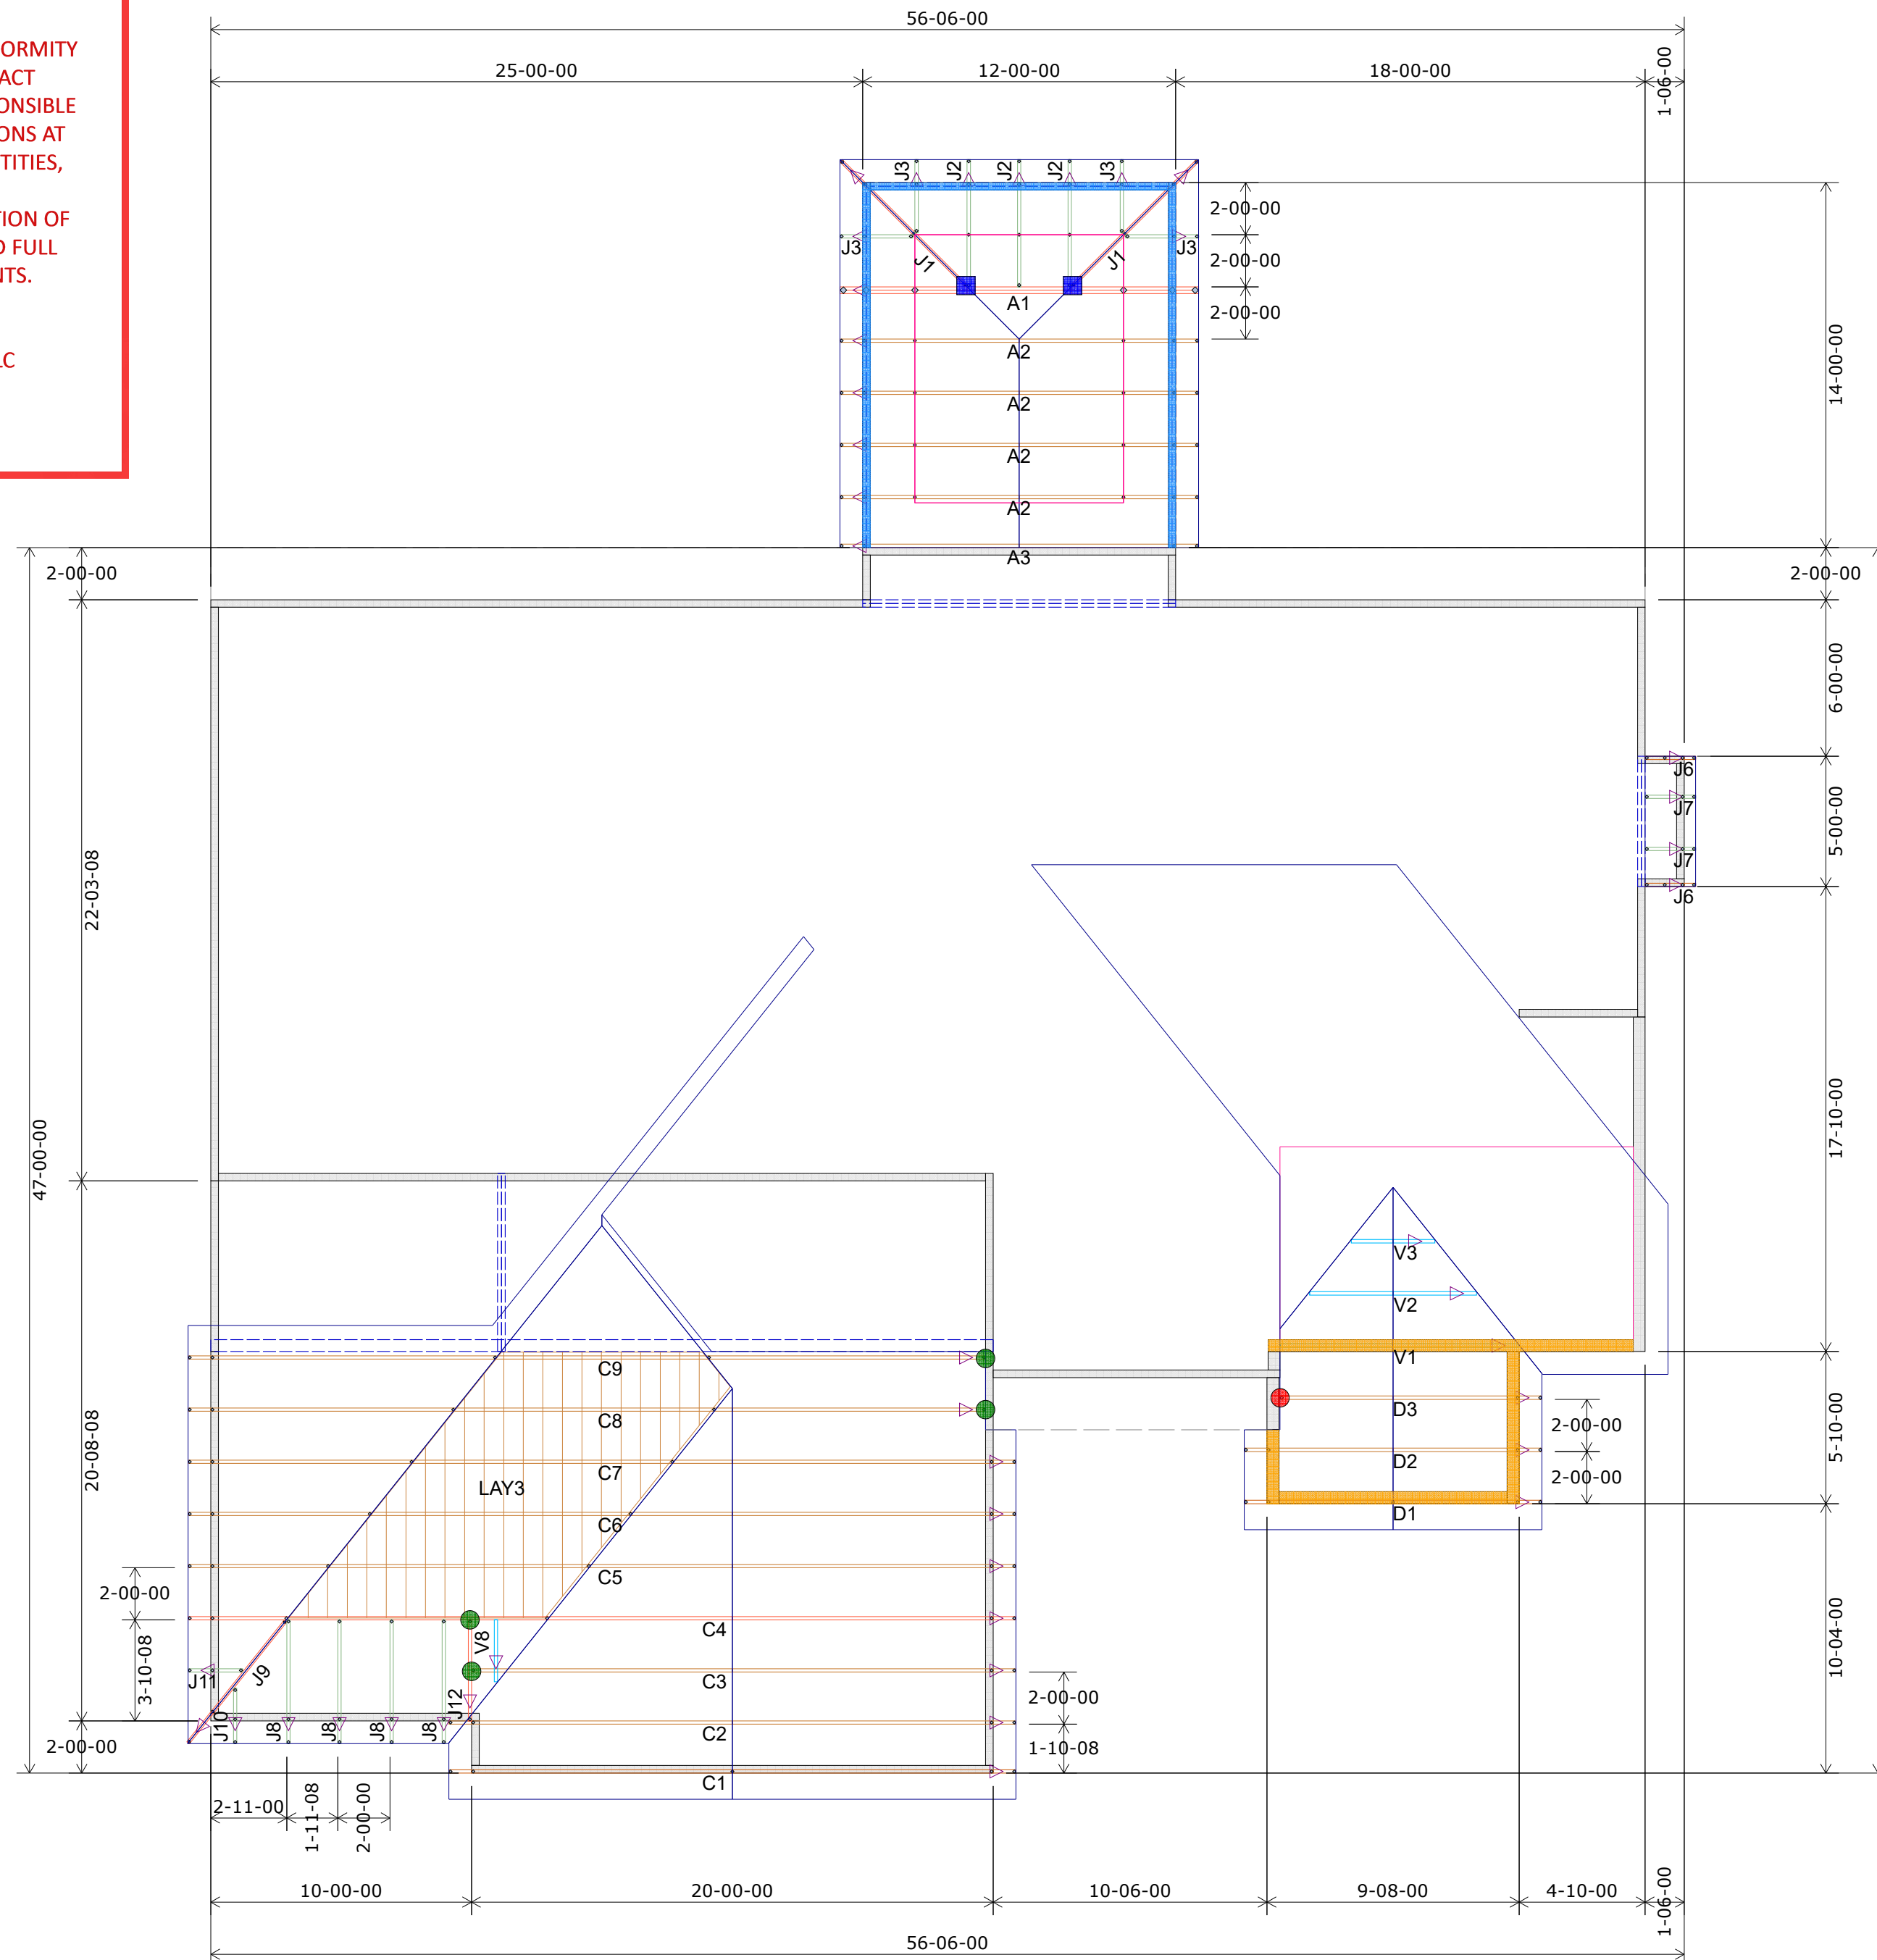


1st Floor Truss Layout

Scale: 3/16" = 1'

HANGER SCHEDULE		Quantity
●	LUS24	12
●	LUS26	0
●	HUS26	9
▲	HHUS26-2	2
▲	HGUS26-2	0
▲	HGUS28-3	0
■	LTHJA26	0
■	TJC37	2
■	TJC57	2
▲	HTS20	0

Triangle denotes the left end of the Truss as it appears on the Engineered Drawings provided.





Unless otherwise specified
by Engineer Of Record,
Wheeler Lumber, LLC
recommends an uplift
connection at each bearing
point per the following:

# of Uplift	Connector
0 - 495:	(1) H2.5A
495 - 990:	(2) H2.5A
990 - 1245:	(1) HTS20

Installation per Simpson
Strong-Tie guidelines.

For Reactions greater than
1245#, refer to EOR.

Plate Heights 9-01-02 U.N.O.

8-07-02	
13-01-02	

**RELEASE FOR
CONSTRUCTION**
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

05/14/2020

*Wheeler Lumber
1959 Old Hwy 50 NE
Waverly, KS 66871*



THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult "Bracing of wood trusses" available from the Truss Plate Institute, 583 DOnofrio Drive, Madison, WI 53719.

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.


Approved By: _____

APPROVED

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY
AND GENERAL CONFORMANCE TO CONTRACT
DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE
FOR CONFIRMING AND CORRELATING DIMENSIONS AT
JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES,
FABRICATION PROCESSES AND
TECHNIQUES OF CONSTRUCTION, COORDINATION OF
HIS OR HER WORK WITH OTHER TRADES AND FULL
COMPLIANCE WITH CONTRACT DOCUMENTS.

REVIEWED BY:
RESIDENTIAL ENGINEERING SERVICES, LLC


Brad A. Huxol, P.E.

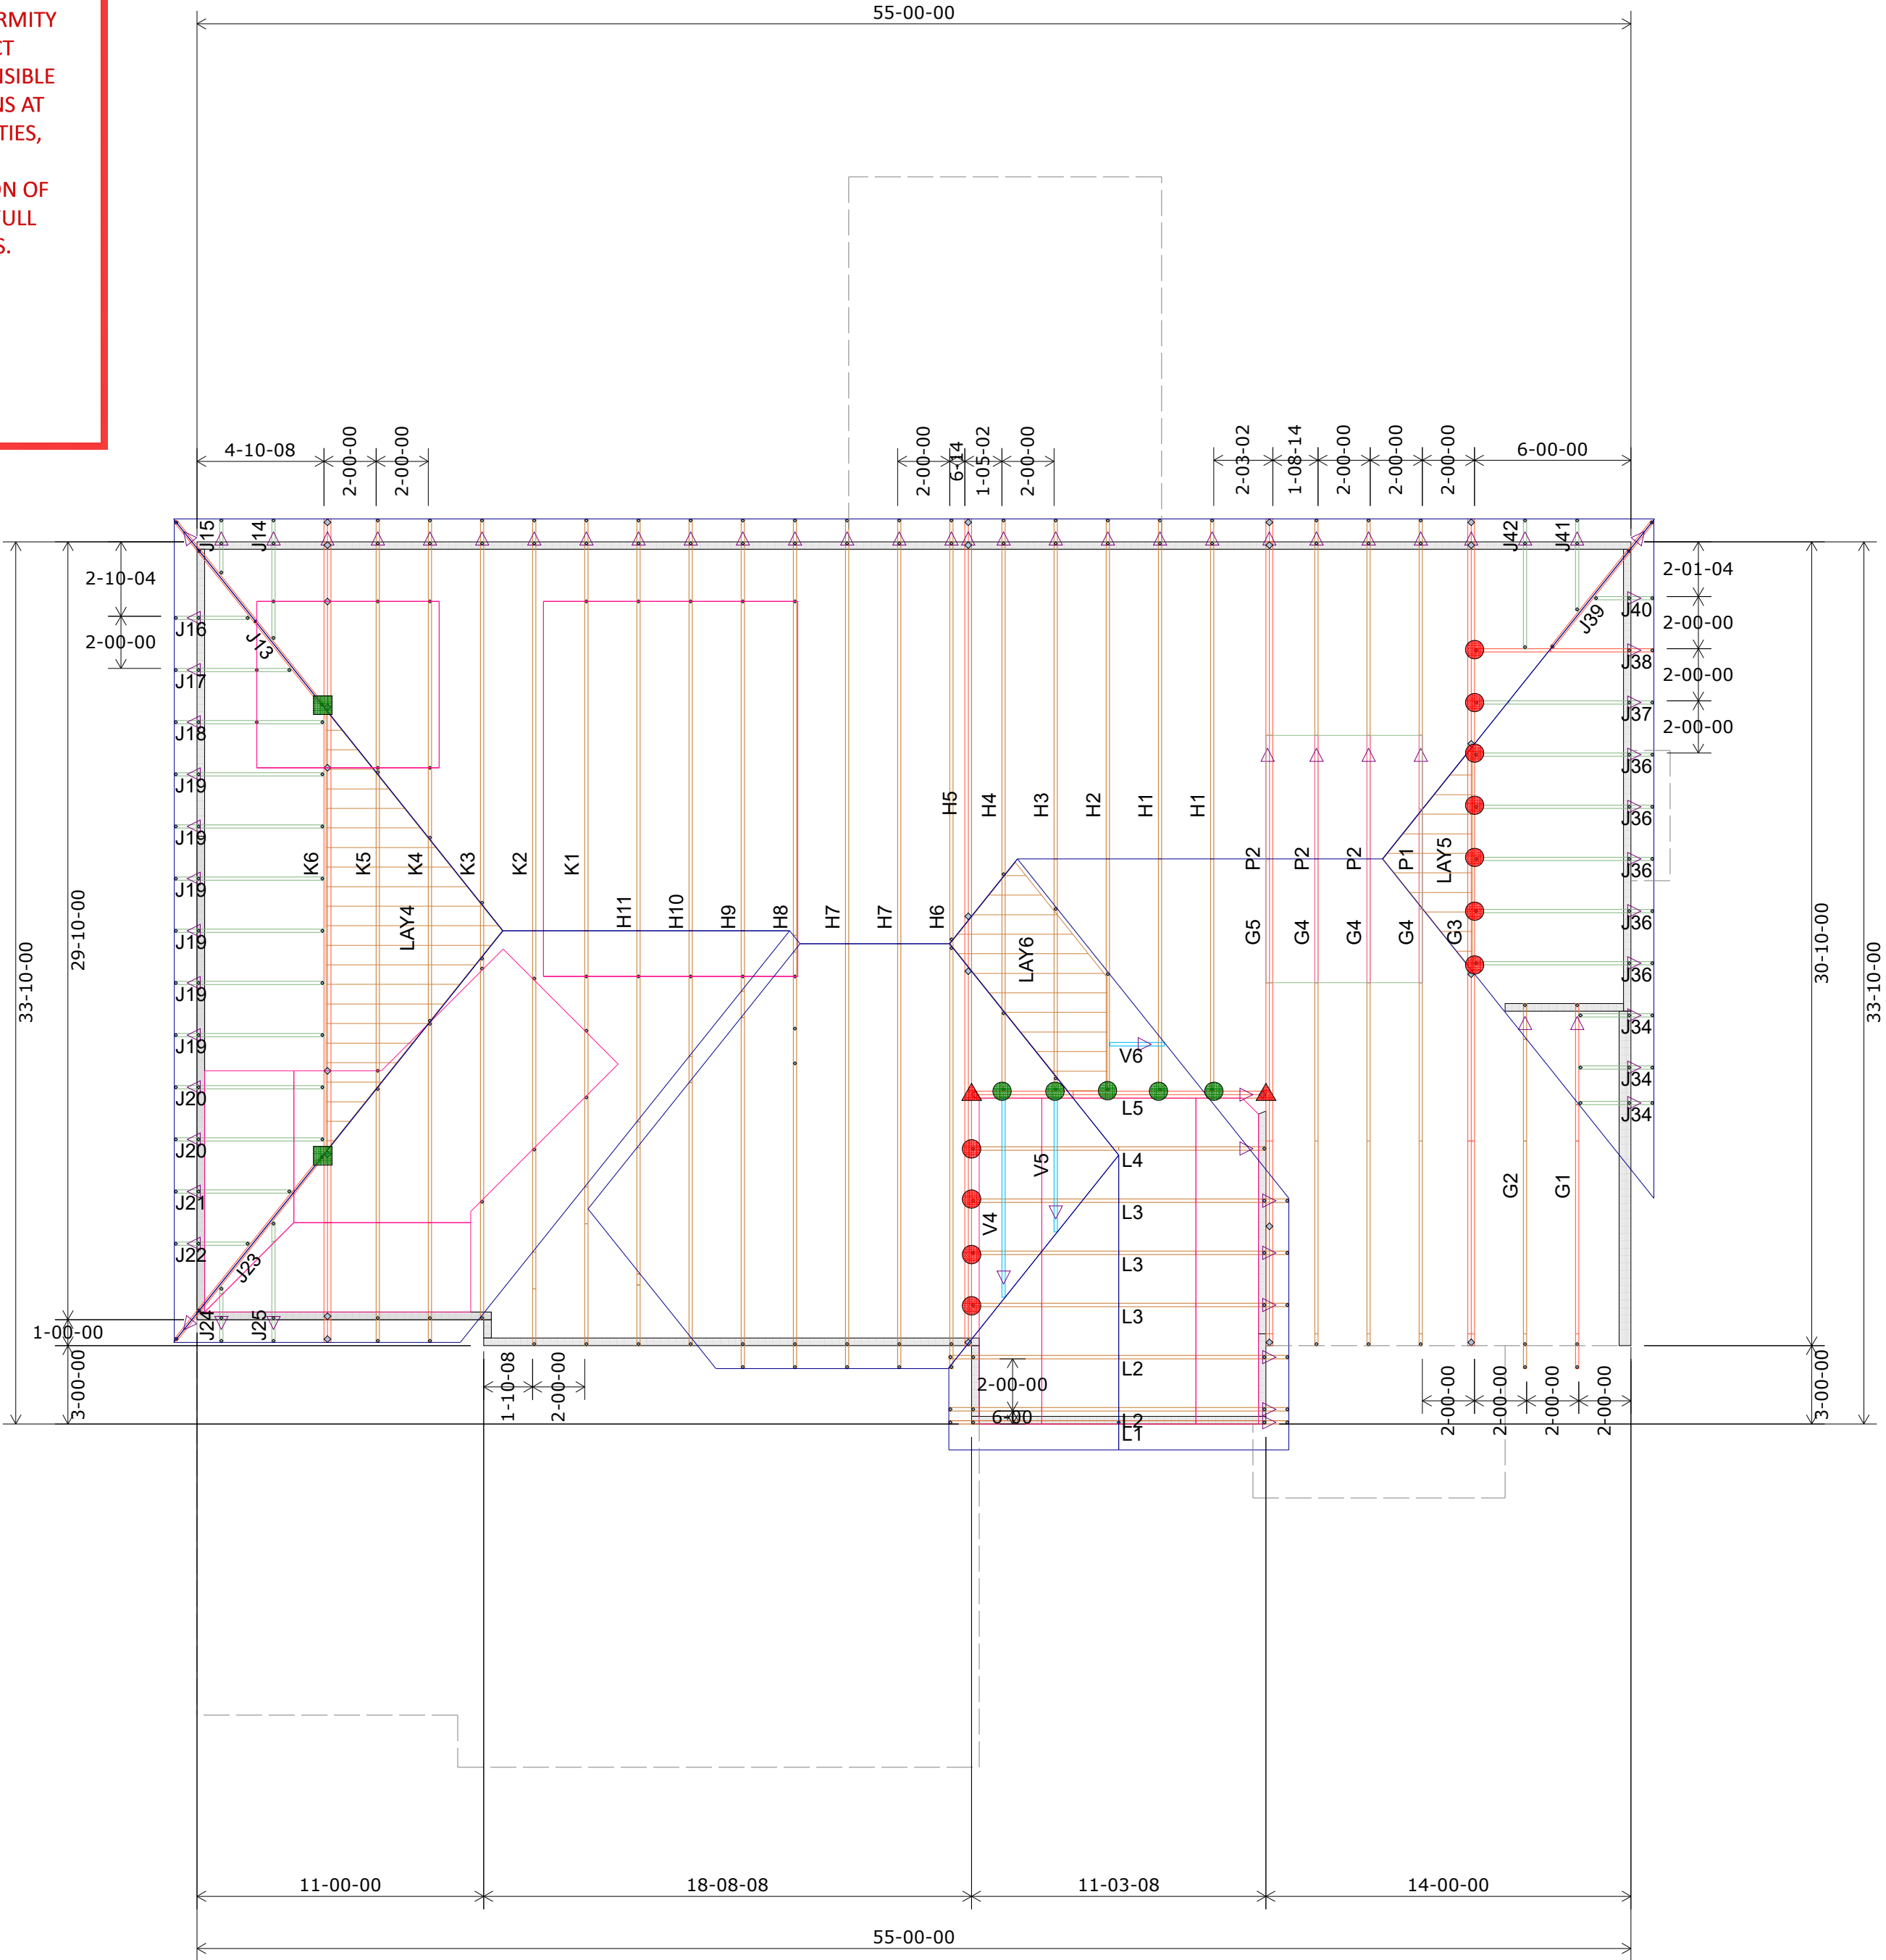

2nd Floor Truss Layout
Scale: 3/16" = 1'

HANGER SCHEDULE		Quantity
●	LUS24	12
●	LUS26	0
●	HUS26	9
▲	HHUS26-2	2
▲	HGUS26-2	0
▲	HGUS28-3	0
■	LTHJA26	0
■	TJC37	2
■	TJC57	2
▲	HTS20	0

Triangle denotes the left end of the Truss as it appears on the Engineered Drawings provided.



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

# of Uplift	Connector
0 - 495:	(1) H2.5A
495 - 990:	(2) H2.5A
990 - 1245:	(1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

Plate Heights 8-01-02 U.N.O.

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

05/14/2020

Customer		Job Name		Job Site Address		City, State		Designer		Date	
SUMMIT HOMES		Lot 83 The Reserve at Stoney Creek		1512 SW Georgetown Dr.		Lee's Summit, MO		Chance 785-746-4240		Job # 400263	

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the trusses during construction. The building designer is responsible for the overall layout and bracing of the trusses, walls and columns in the responsibility of the building designer. For general guidelines regarding bracing consult "Bracing of wood trusses" available from the Truss Plate Institute, 583 Dornifro Drive, Madison, WI 53179.	
THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.	

Wheeler Lumber
1959 Old Hwy 50 NE
Waverly, KS 66871

