

1. *The underground utilities shown herein have been plotted from available information and do not necessarily reflect the actual existence, or nonexistence, size, type, number, or locations of these or other utilities. The contractor shall be responsible for verifying the actual locations of all underground utilities, shown or not shown, and said utilities shall be located in the field prior to any grading, excavation, or construction of improvements. These provisions shall in now way absolve any party from complying with the "UNDERGROUND FACILITY SAFETY AND DAMAGE PREVENTION ACT", Chapter 319, RSMO.*
2. *Gas, Water, and other Utilities shall not conflict with the depth or horizontal location of existing and proposed sanitary and storm sewers, including building laterals.*
3. *The Contractor shall secure all required permits and notify the Public Works Inspection Department of the City of Lee's Summit (816-969-1827) at least 48 hours prior to any construction.*
4. *Prior to submittal of construction bids, the Contractor shall be required to visit the site to verify existing conditions and proposed improvements.*
5. *All construction materials and methods used shall comply with the latest editions of the City of Lee's Summit "DESIGN AND CONSTRUCTION MANUAL" as adopted by City Ordinance NO. 5813. See said Manual for standard details.*
6. *The Contractor shall be responsible for notification and coordination with all Utility Companies.*
7. *The Contractor shall notify the Engineer immediately of any discrepancies in the plans.*
8. *"Controlled Fill" indicates fill to be placed in accordance with APWA Section 2100 for grading and site preparation, with APWA Section 2200 for street construction (paving), with APWA Section 2500 for sanitary sewer construction and with APWA Section 2600 for storm sewer construction unless otherwise noted.*
9. *Where finish grade is higher than existing, fill must be brought in, properly compacted, and then the pipe shall be installed. Pipe shall not be installed until new fill has been properly compacted.*

All that part of the Southeast Quarter of Section 29, Township 47 North, Range 31 West, more particularly described as follows:

Commencing at the Southeast corner of said Southeast Quarter; thence North 02°30'29" East, along the East line of the Southeast Quarter of said Section 29, a distance of 58.62 feet; thence departing said East line, North 87°29'31" West, a distance of 40.00 feet to the North right-of-way line of Missouri State Highway N. 150, as now established, and the Point of Beginning; thence South 85°26'23" West, along the North right-of-way line of said Missouri State Highway No. 150, a distance of 142.47 feet; thence South 65°50'12" West, continuing along said North right-of-way line, a distance of 27.99 feet; thence continuing along said North right-of-way line, North 87°54'10" West, along a line 30 feet North of and parallel with the South line of said Southeast Quarter, a distance of 1436.75 feet; thence departing said North right-of-way line, North 02°32'36" East, a distance of 2613.35 feet to the North line of said Southeast Quarter; thence South 87°44'49" East, along the North line of said Southeast Quarter, a distance of 1641.53 feet to the Northeast corner of said Southeast Quarter; thence South 02°30'29" West, along the East line of said Southeast Quarter, a distance of 1081.05 feet; thence departing said East line, North 87°29'31" West, a distance of 30.00 feet; thence South 02°30'29" West, along a line 30 feet West of and parallel with the East line of said Southeast Quarter, a distance of 1302.74 feet; thence South 08°13'07" West, a distance of 100.51 feet; thence South 02°30'29" West, along a line 40 feet West of and parallel with the East line of said Southeast Quarter, a distance of 96.45 feet to the Point of Beginning. Containing 4,237,595.37 square feet or 97.28 acres, more or less.

KCPL
130 SE Hamblen Road
Lee's Summit, Mo.
816-347-4320

Missouri Gas Energy
3025 SE Clover Road
Lee's Summit, Mo.
816-537-4681

0 1000' 1500' 2000'

SCALE IN FEET


	<i>Existing Section Line</i>		<i>Proposed Right-of-Way</i>
	<i>Existing Right-of-Way Line</i>		<i>Proposed Property Line</i>
	<i>Existing Lot Line</i>		<i>Proposed Lot Line</i>
	<i>Existing Easement Line</i>		<i>Proposed Easement</i>
	<i>Existing Curb & Gutter</i>		<i>Proposed Curb & Gutter</i>
	<i>Existing Sidewalk</i>		<i>Proposed Sidewalk</i>
	<i>Existing Storm Sewer</i>		<i>Proposed Storm Sewer</i>
	<i>Existing Storm Structure</i>		<i>Proposed Storm Structure</i>
	<i>Existing Waterline</i>		<i>Proposed Fire Hydrant</i>
	<i>Existing Gas Main</i>		<i>Proposed Waterline</i>
	<i>Existing Sanitary Sewer</i>		<i>Proposed Sanitary Sewer</i>
	<i>Existing Sanitary Manhole</i>		<i>Proposed Sanitary Manhole</i>
	<i>Existing Contour Major</i>		<i>Proposed Contour Major</i>
	<i>Existing Contour Minor</i>		<i>Proposed Contour Minor</i>
			<i>Future Curb & Gutter</i>

ENGINEER
Hg CONSULT, INC.
CONTACT - KEVIN STERRETT
1411 N.E. TODD GEORGE ROAD
LEES SUMMIT, MISSOURI 64086
(816) 703-7098

#1 MODNR MONUMENT JA-45
N: 986351.65
E: 2824617.51
TOP ELEV. 1012.79

#2 MONUMENT AT THE INTERSECTION OF M150 & DOC HENRY ROAD
N: 977823.53
E: 2828220.61
TOP ELEV. 1006.04

10. STANDARD DETAILS
11. STANDARD DETAILS
12. STANDARD DETAILS

1	COVER SHEET			3/26/19	DATE	REVISION	NO.	BY	CK/APP
					3/26/19 3/8/19 11/2/18	ADDRESSED CITY COMMENTS DATED 3/26/19 ADDRESSED CITY COMMENTS DATED 12/18/18 SUBMITAL TO CITY OF LEE'S SUMMIT	3 2 1	RAM RAM RAM	RKS RKS RKS
12	COBEY CREEK								


3/25/2019
16_059-Water-GenUtil:Layout.dgn



GENERAL NOTES:

1. THIS SHEET IS FOR INFORMATIONAL PURPOSES ONLY. SEE INDIVIDUAL SHEETS FOR EXACT UTILITY LOCATIONS.



RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
05/21/2020



100 0 100
SCALE IN FEET

GENERAL UTILITY LAYOUT		COBEY CREEK		CITY OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI	
X-REF NO. XXX		DRAWING NO. XXX		DATE March 26, 2019	
JOB NO. 16.059.01		SHEET OF		12	
DATE 3/26/19		BY CK/APP		NO. 1	
REVISION		DATE		NO.	
1		11/22/18		1	
2		3/8/19		2	
3		3/26/19		3	
ADDRESS CITY COMMENTS DATED 3/20/19		ADDRESS CITY COMMENTS DATED 12/18/18		ADDRESS CITY COMMENTS DATED 12/18/18	
SUBMITTAL TO CITY OF LEE'S SUMMIT		SUBMITTAL TO CITY OF LEE'S SUMMIT		SUBMITTAL TO CITY OF LEE'S SUMMIT	
F THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.		F THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.		F THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.	
R. KEVIN STERRETT, MO E-26440		R. KEVIN STERRETT, MO E-26440		R. KEVIN STERRETT, MO E-26440	
CORPORATE LICENSE NO. E2010005873		CORPORATE LICENSE NO. E2010005873		CORPORATE LICENSE NO. E2010005873	
11010 Haskell St. Ste. 210 Kansas City, KS 66109 816-759-2285		11010 Haskell St. Ste. 210 Kansas City, KS 66109 816-759-2285		11010 Haskell St. Ste. 210 Kansas City, KS 66109 816-759-2285	
Consult Inc engineers planners		Consult Inc engineers planners		Consult Inc engineers planners	
3/26/19		3/26/19		3/26/19	
STATE OF MISSOURI		STATE OF MISSOURI		STATE OF MISSOURI	
Professional Engineer		Professional Engineer		Professional Engineer	

3/25/2019
16_059-WaterPlanProf02-Linea-02.dgn

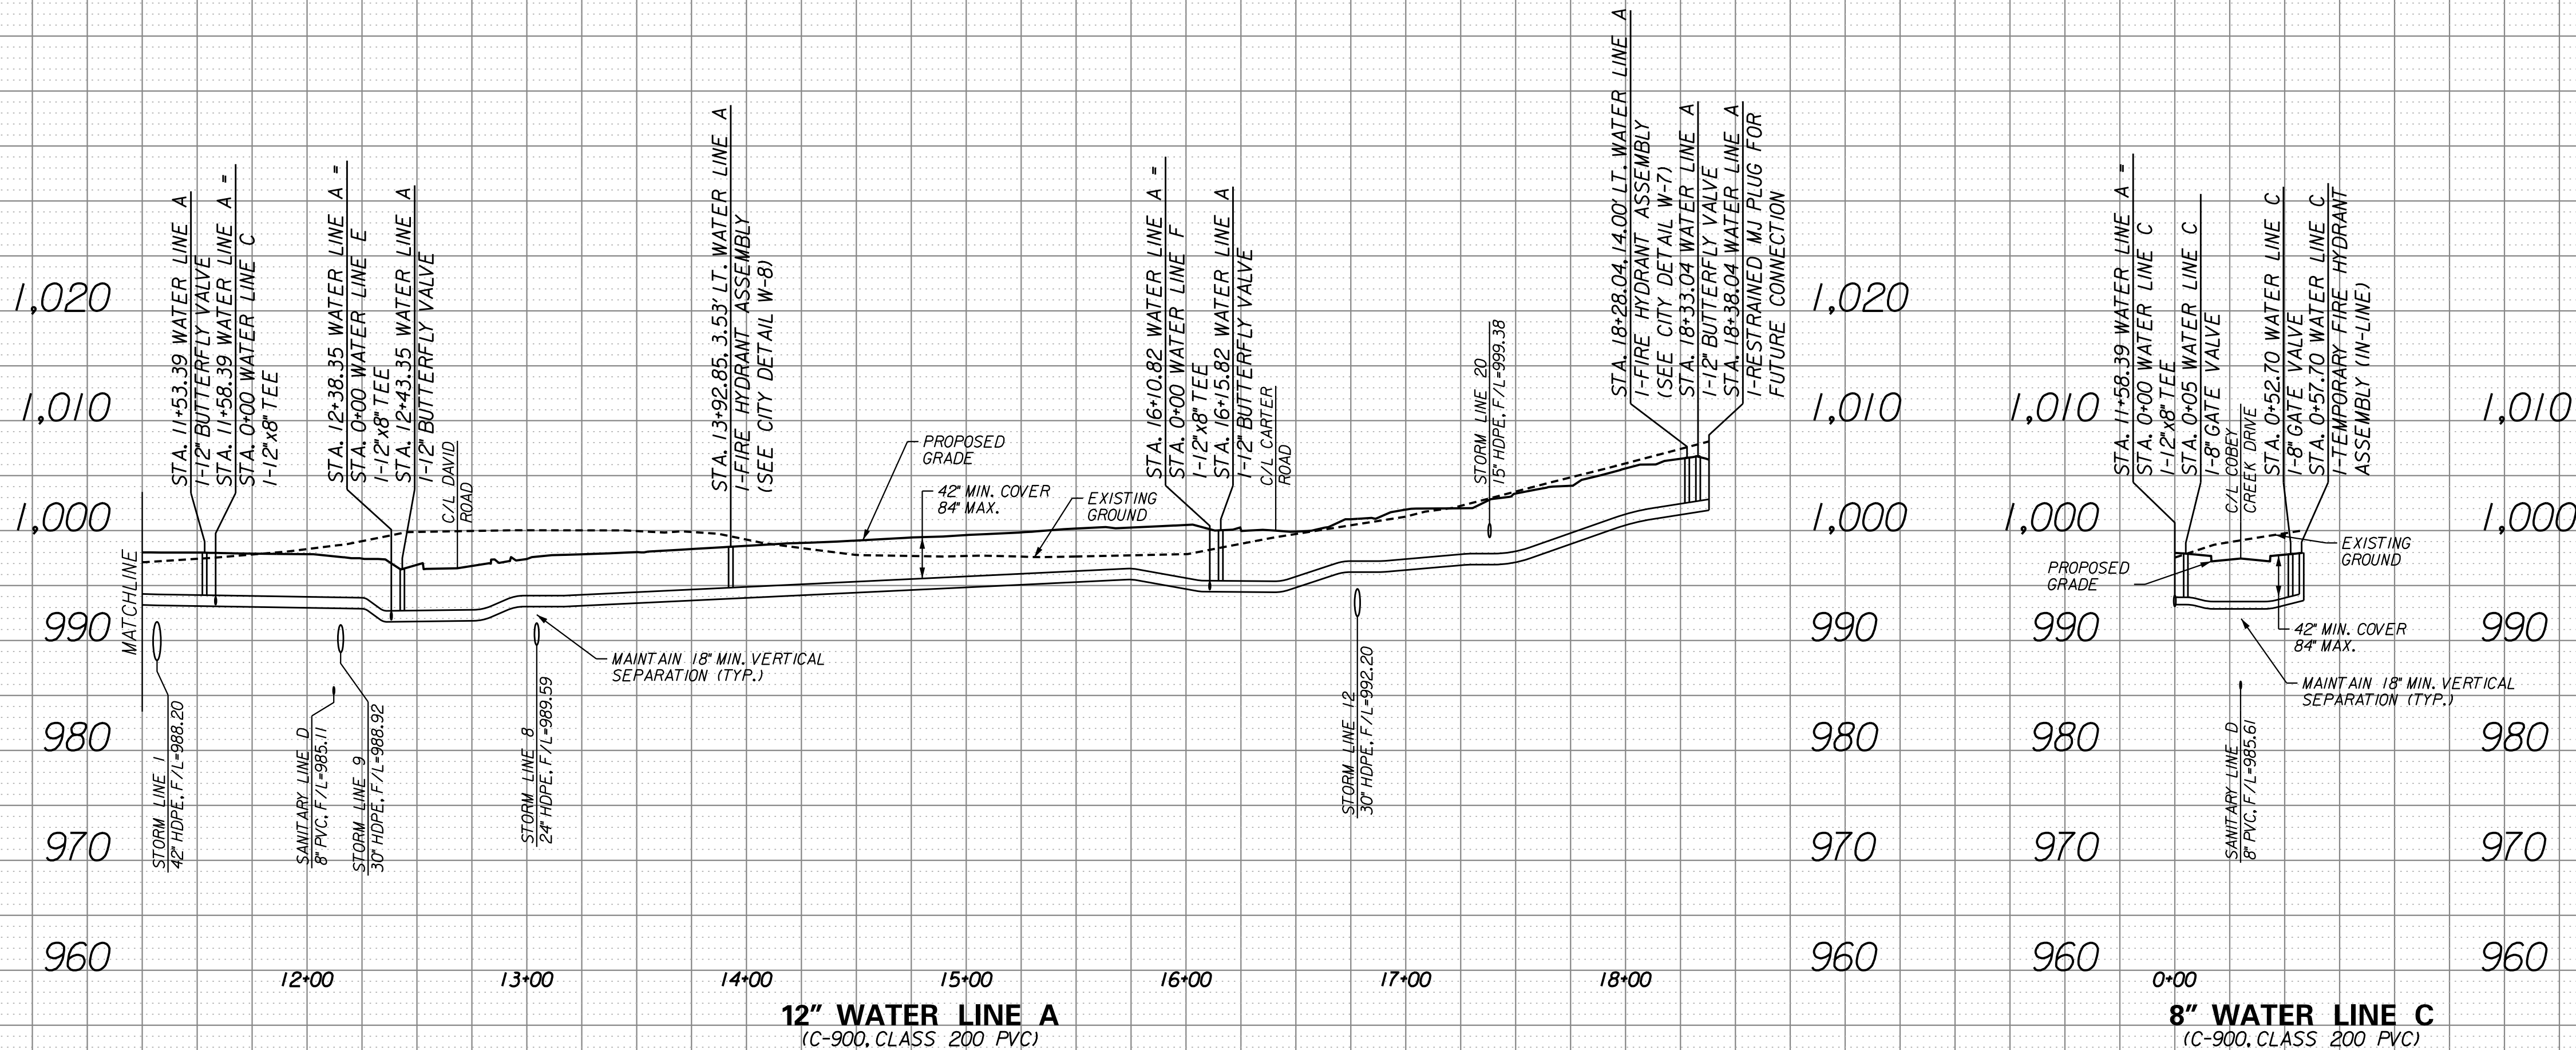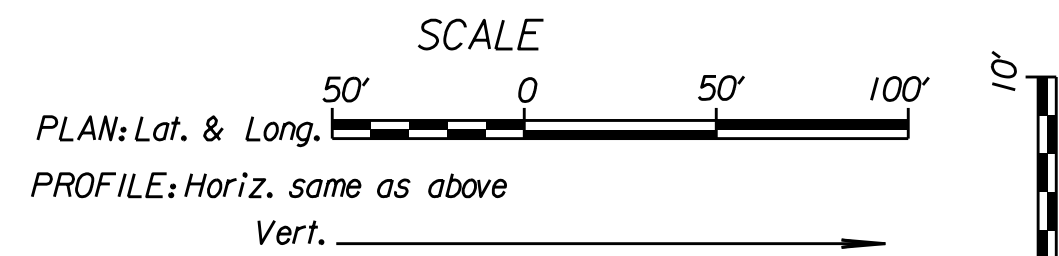

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
05/21/2020

WATER LINE A (STA. 11+25 TO STA. 18+38.04)
WATER LINE C (STA. 0+00 TO STA. 0+57.70)

COBEY CREEK

CITY OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

X-REF. NO.
XXX
DRAWING NO.
XXX
DATE
March 26, 2019
JOB NO.
16_059.01

4 SHEET 12



3/26/19

CORPORATE LICENSE NO. E2010005873

11010 Haskell St. Ste. 210 Kansas City, KS 66109 816-759-2285

CITY OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

X-REF. NO.
XXX
DRAWING NO.
XXX
DATE
March 26, 2019
JOB NO.
16_059.01

Consult Inc
engineers
planners



CORPORATE LICENSE NO. E2010005873

11010 Haskell St. Ste. 210 Kansas City, KS 66109 816-759-2285

CITY OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

X-REF. NO.
XXX
DRAWING NO.
XXX
DATE
March 26, 2019
JOB NO.
16_059.01



4 SHEET 12

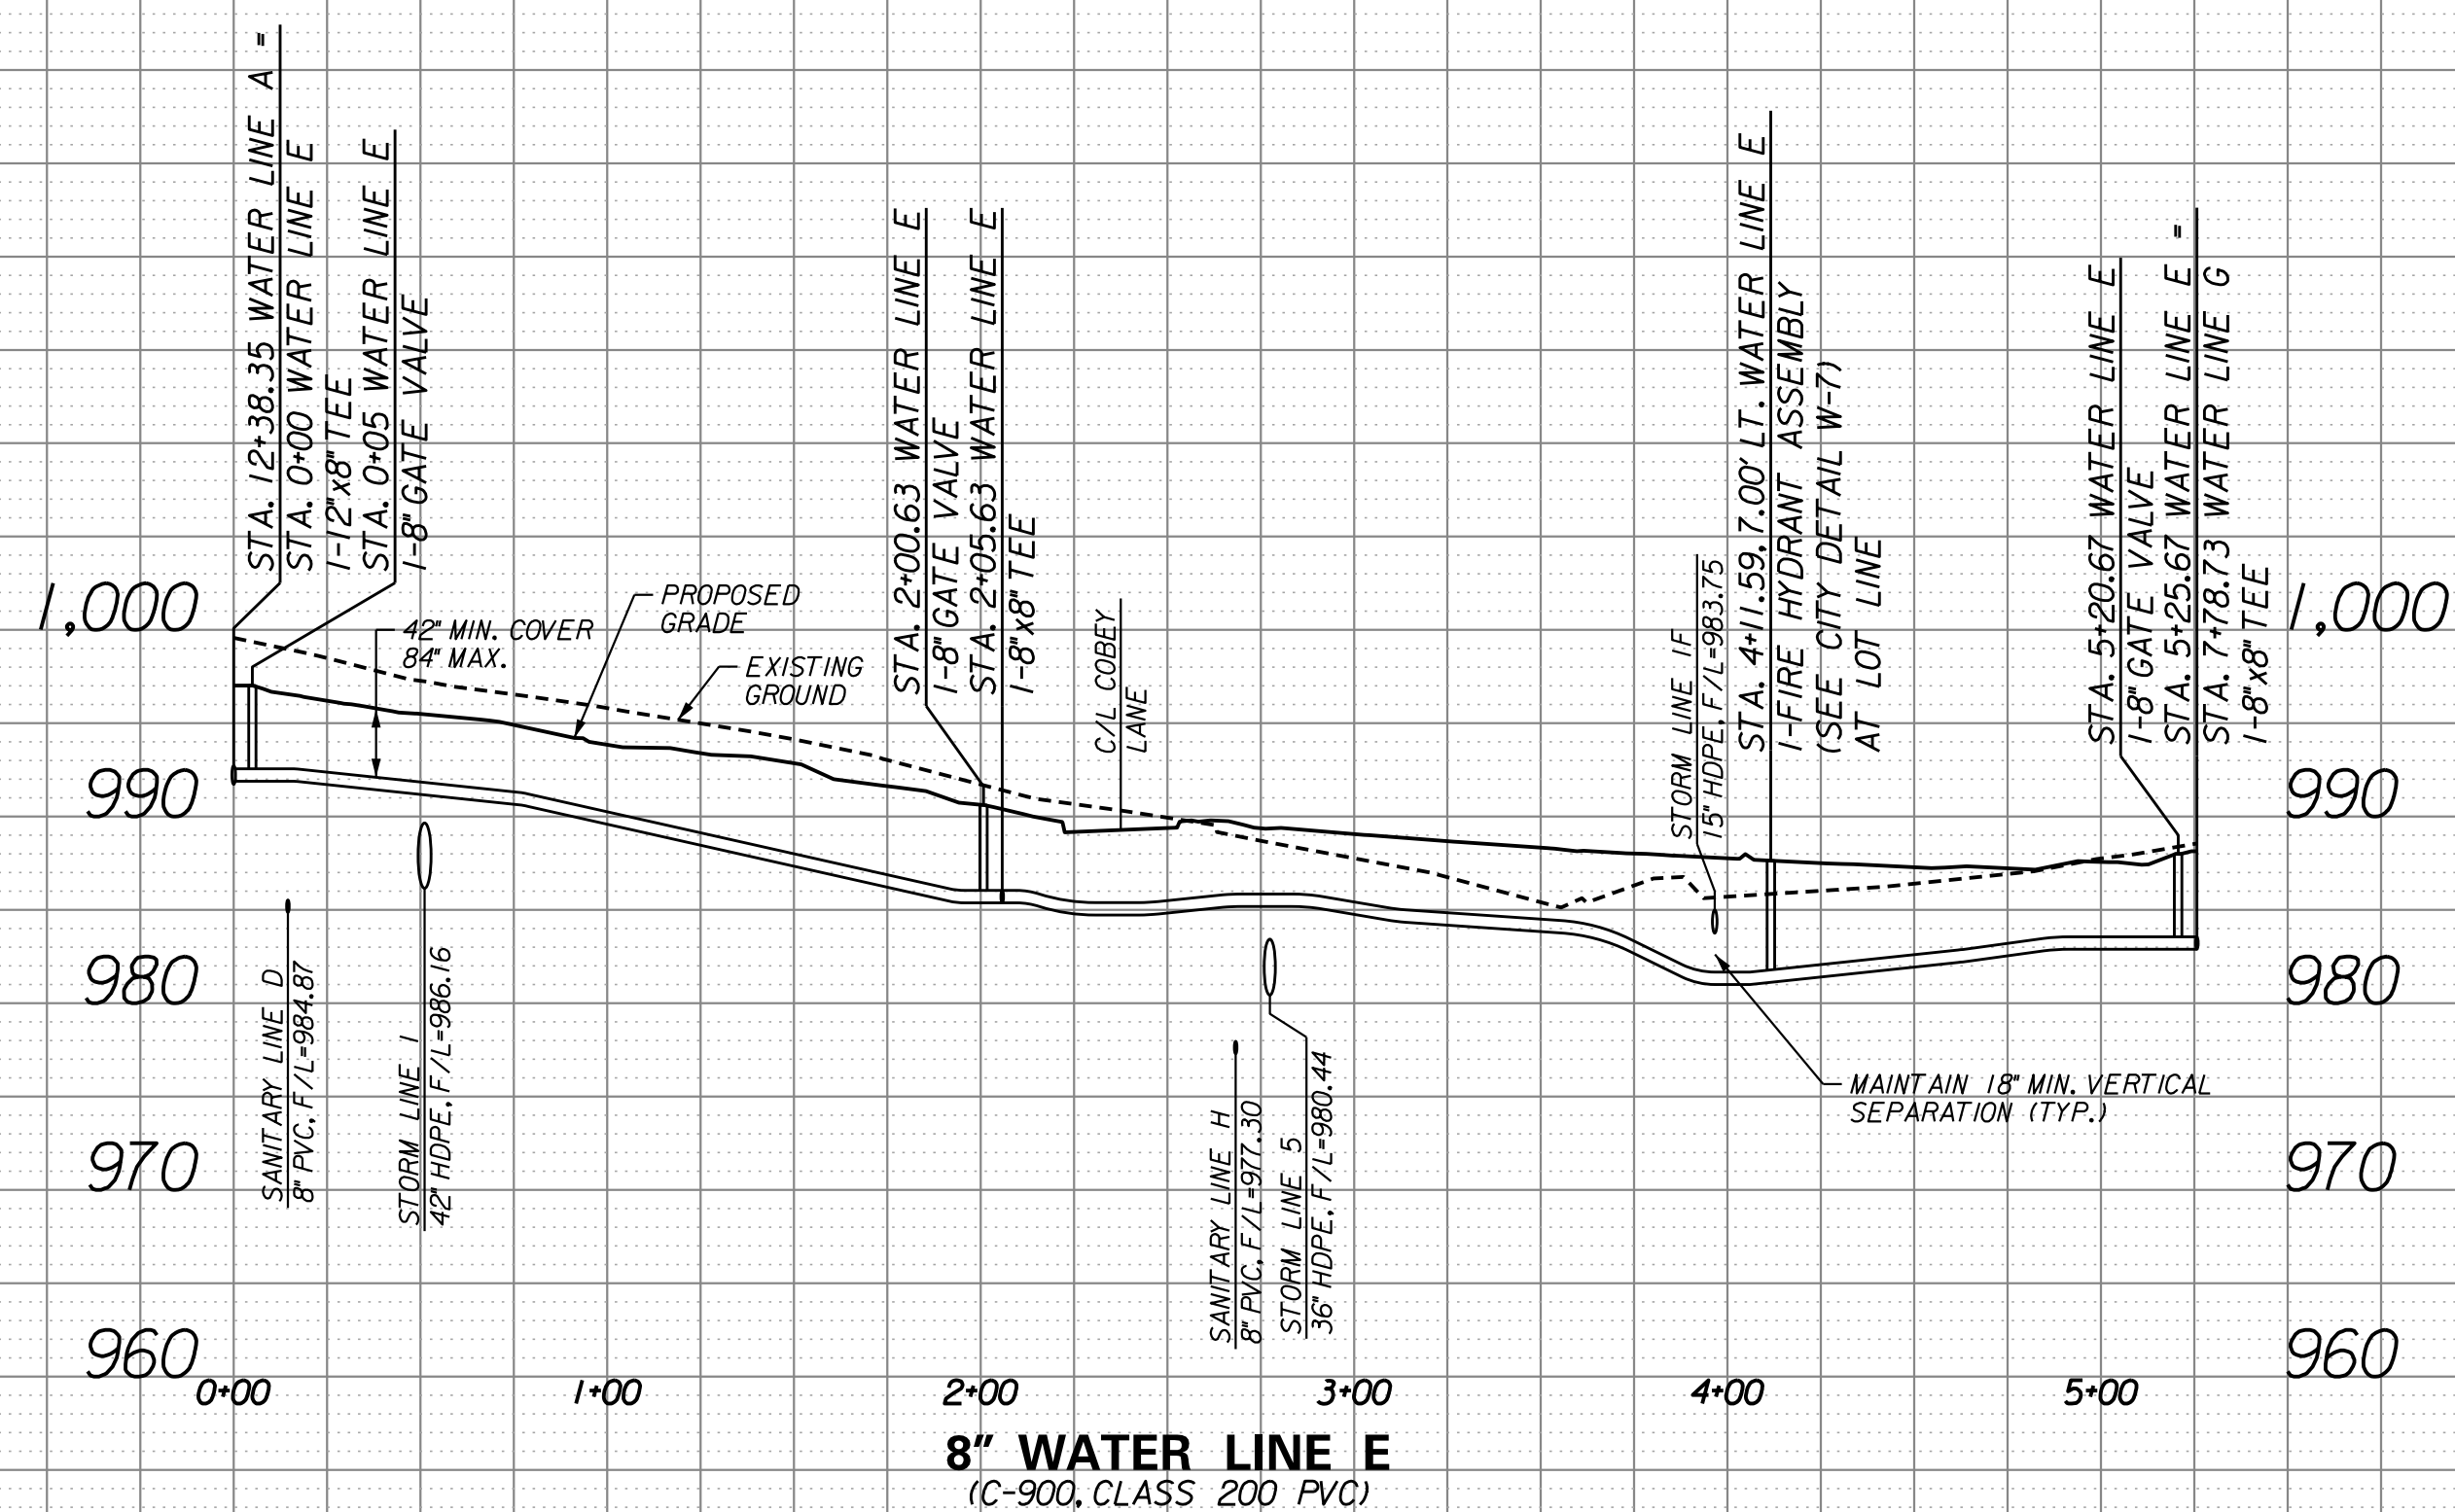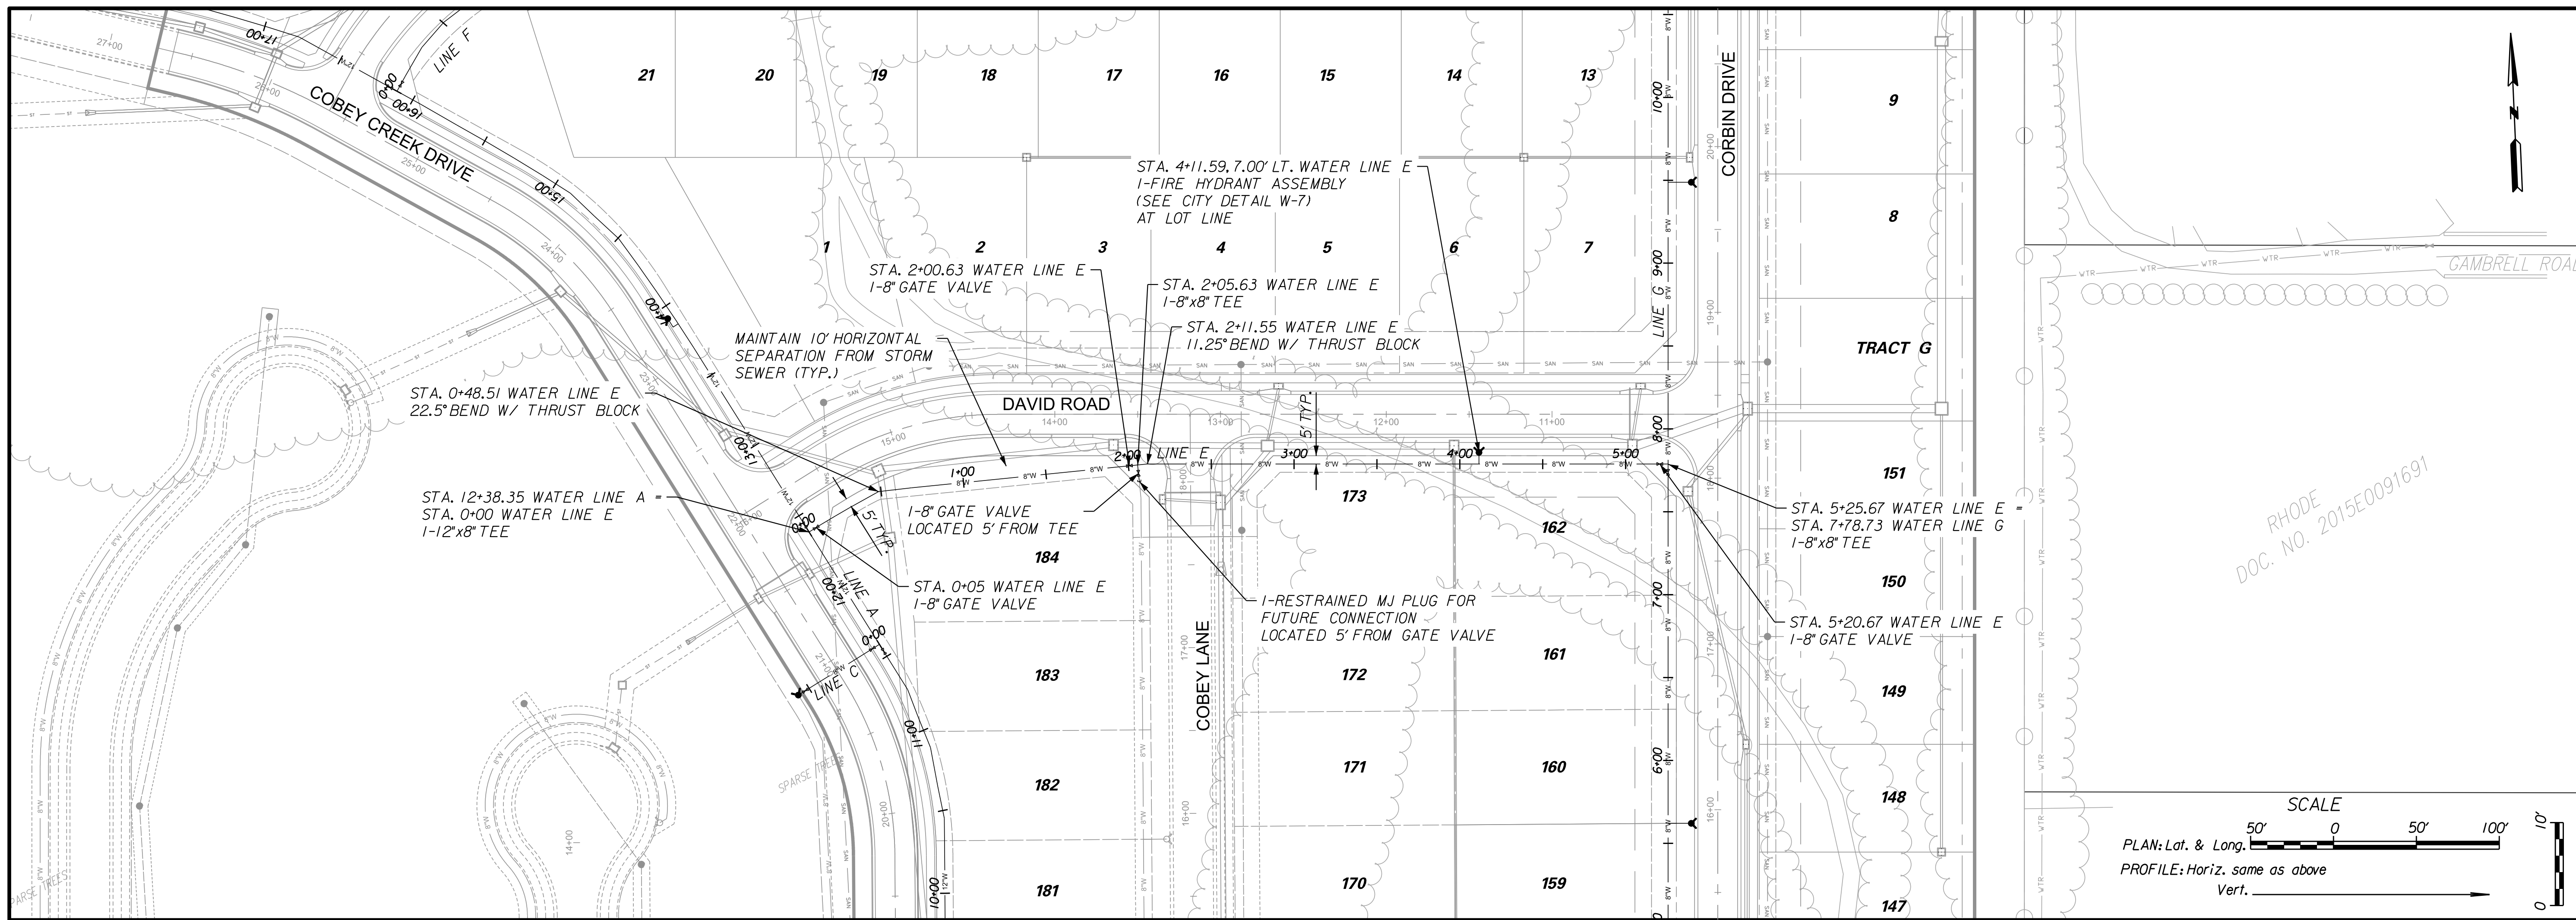

**RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
05/21/2020**

6	SHEET OF	12	WATER LINE E (STA. 0+00 TO STA. 5+25.67) COBEY CREEK	CITY OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI	11010 Haskell St., Ste. 210 Kansas City, KS 66109 816-795-2285 CORPORATE LICENSE NO. E201005973 R. KEVIN STERRETT, MO E-2640	 3/26/19		DATE 3/26/19	REVISION 1	NO.	BY
								DATE 3/26/19	REVISION 1	NO.	BY

3/25/2019
16_059-WaterPlanProf05-LineF-01.dgn

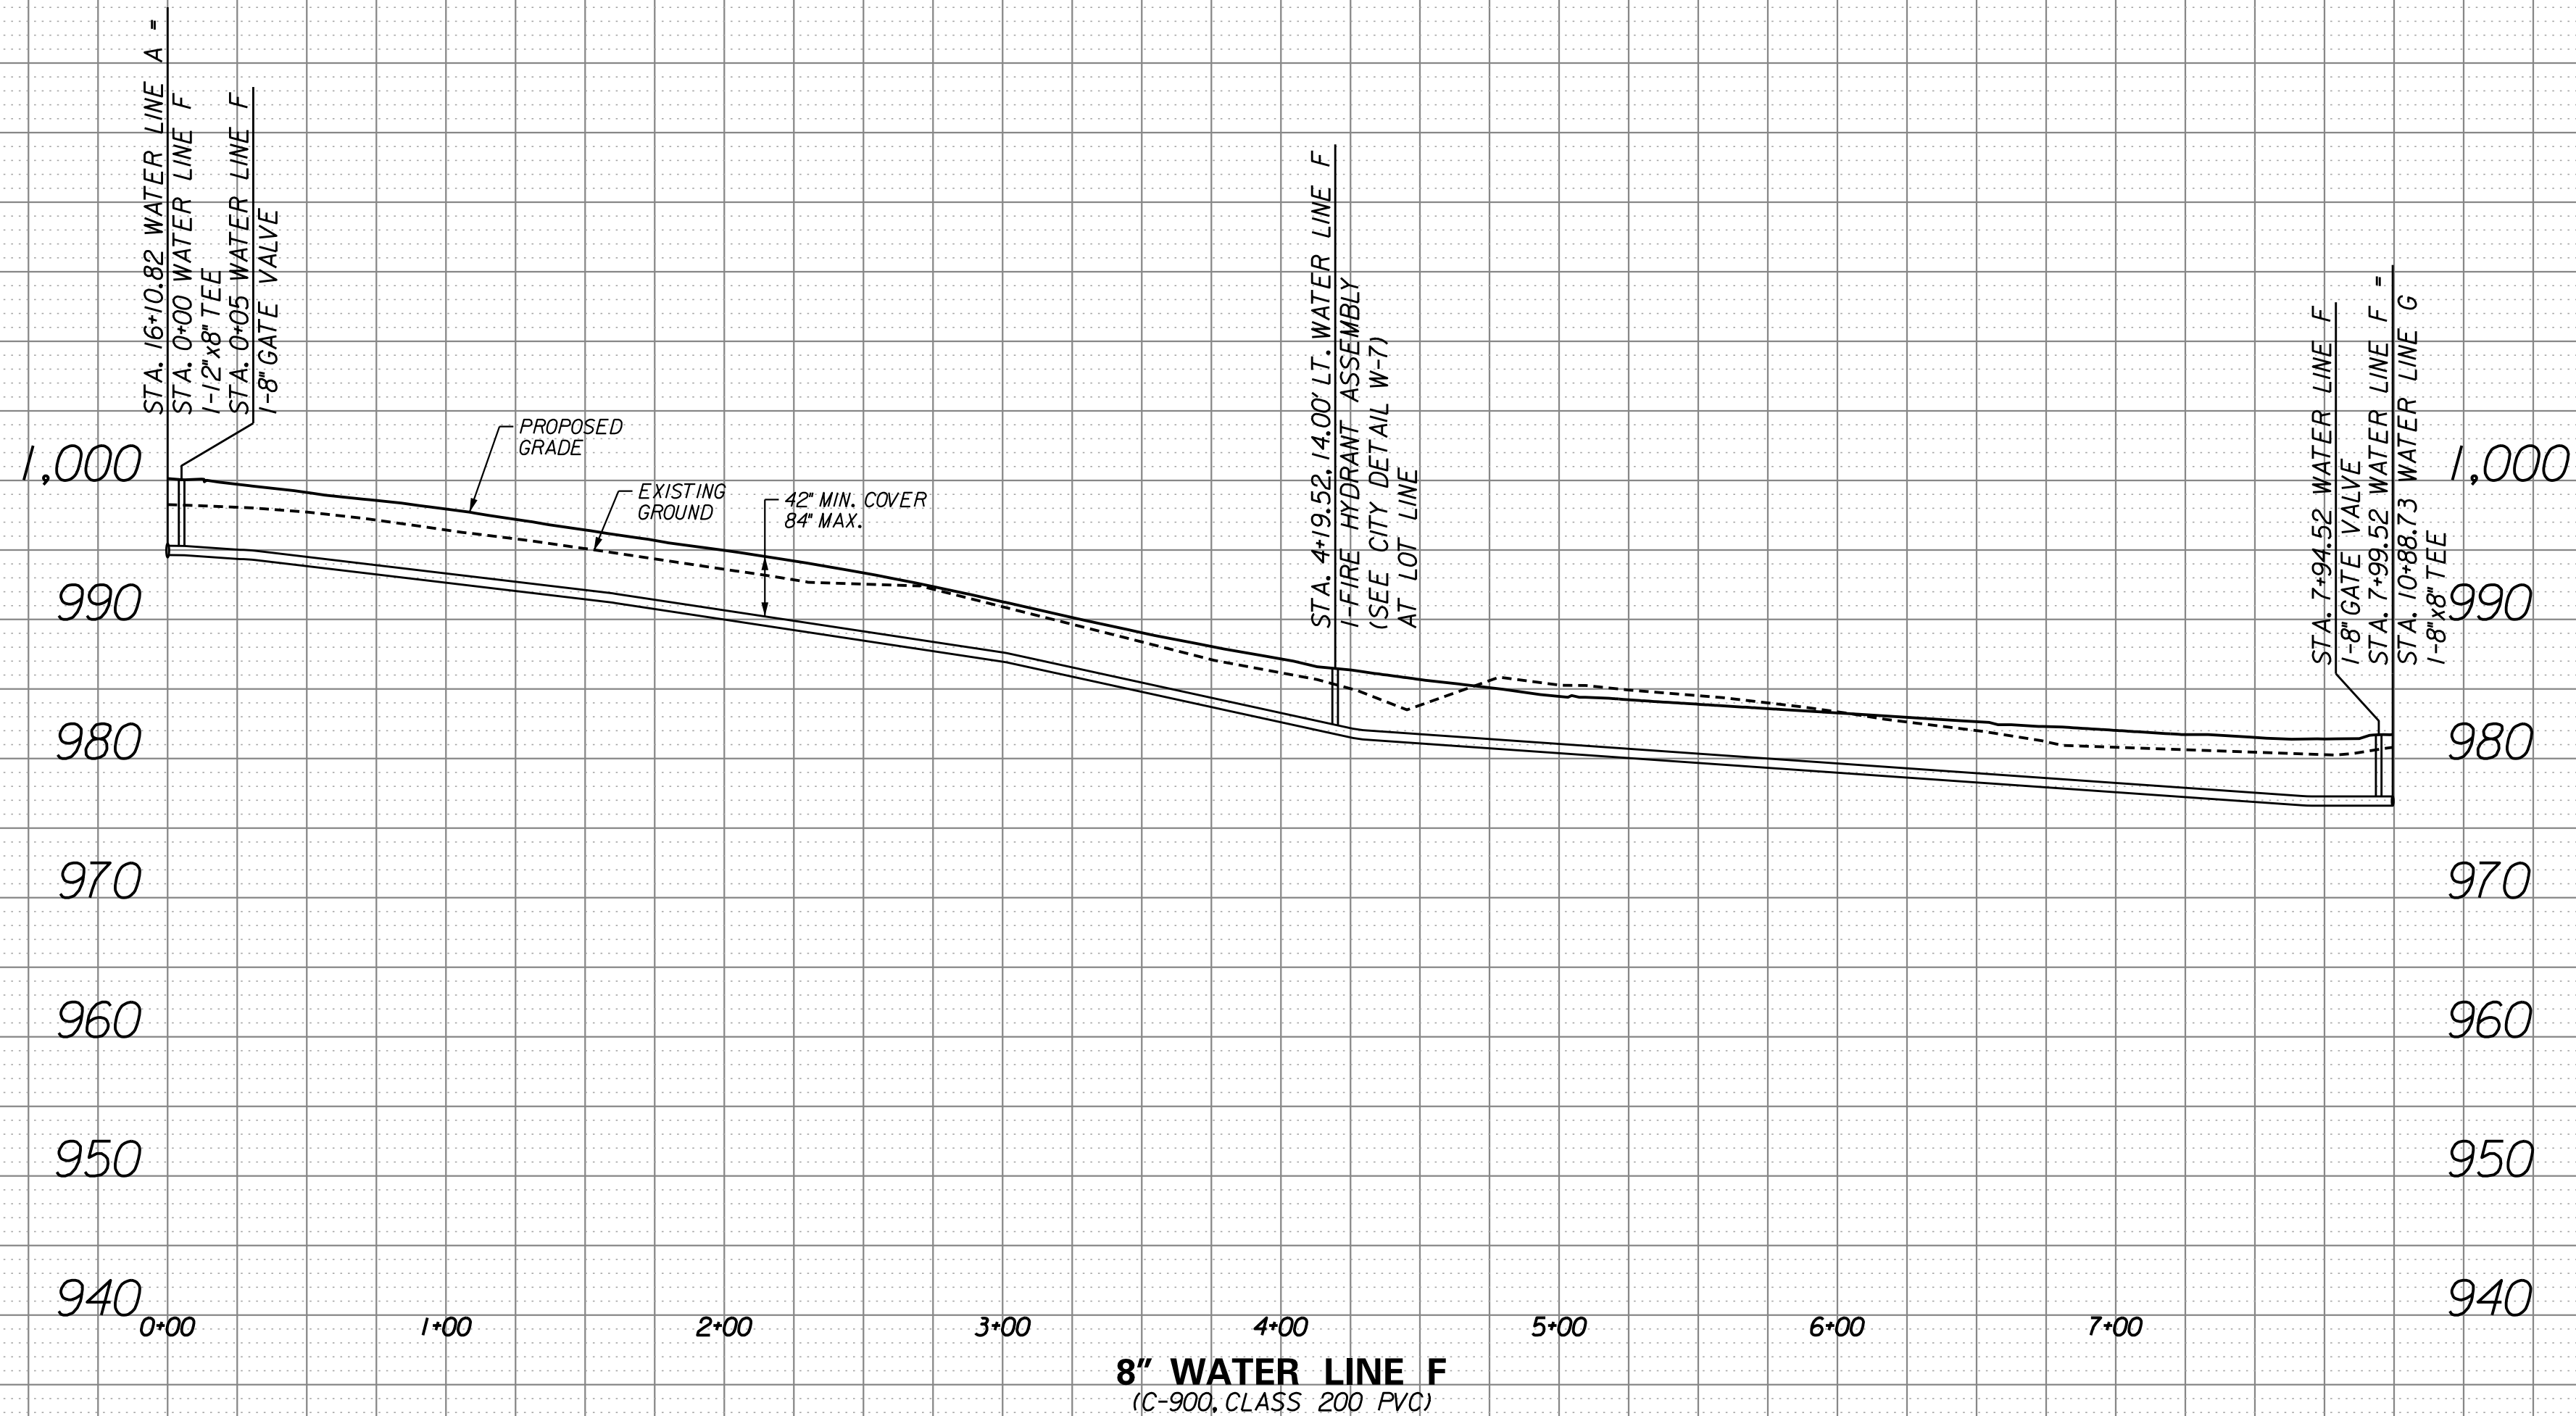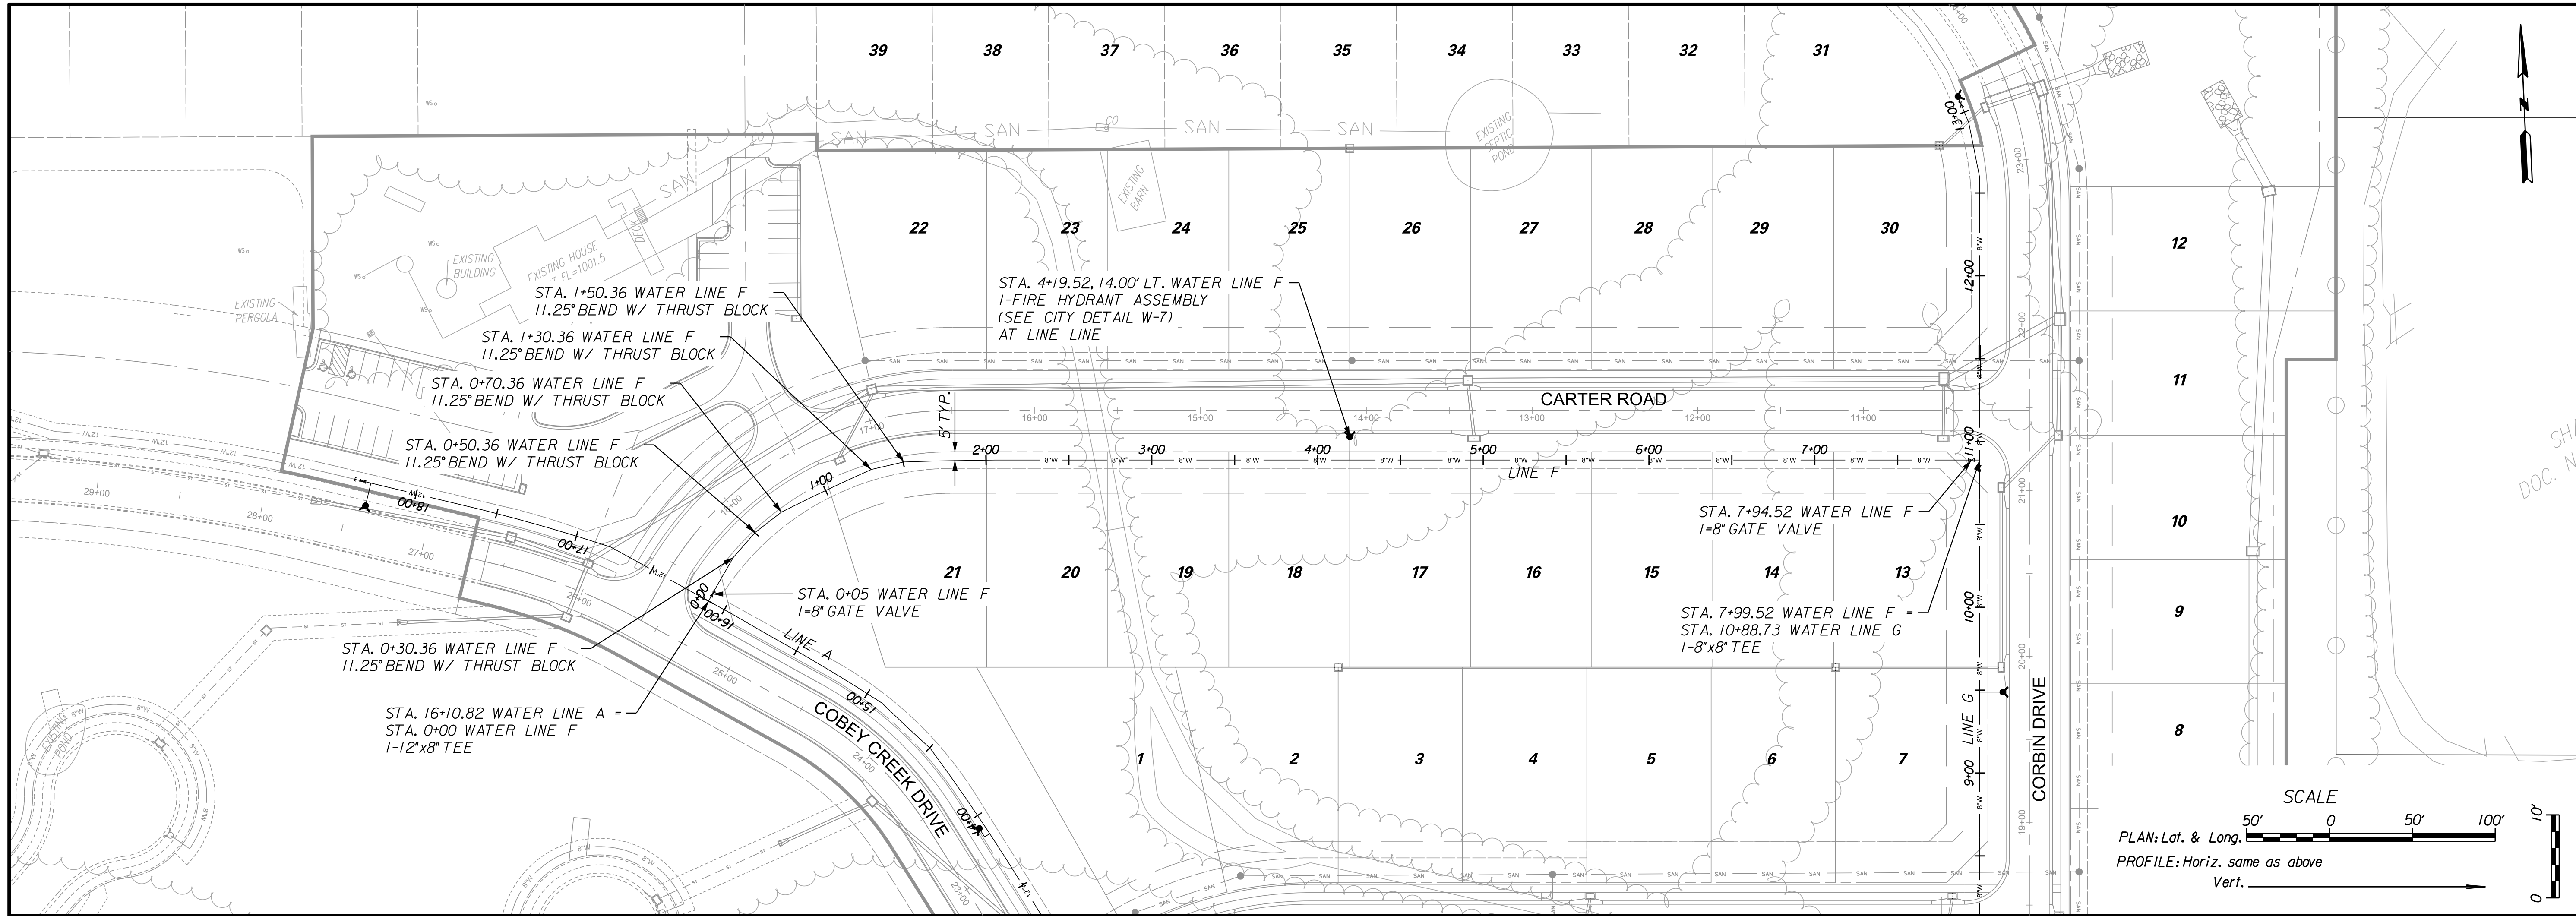

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
05/21/2020

NO.	BY	CHK/APP
1	RAM	RKS
2	RAM	RKS
3	RAM	RKS

DATE	REVISION
3/26/19	

3/26/19
ADDRESS CITY COMMENTS DATED 3/20/19
3/8/19
ADDRESS CITY COMMENTS DATED 12/18/18
11/22/18
SUBMITTAL TO CITY OF LEE'S SUMMIT

THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK. THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES.

R. KEVIN STERRETT, MO E-26440

Consult Inc engineers planners

11010 Haskell St. Ste 210 Kansas City, KS 66109 816-759-2285 CORPORATE LICENSE NO. E2010005873

WATER LINE F
(STA. 0+00 TO STA. 7+99.52)




COBEY CREEK

CITY OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

X-REF. NO. XXX
DRAWING NO. XXX
DATE March 26, 2019
JOB NO. 16_059_01

7 SHEET OF 12

3/25/2019
16.059-WaterPlanProf06-LinesG-01.dgn

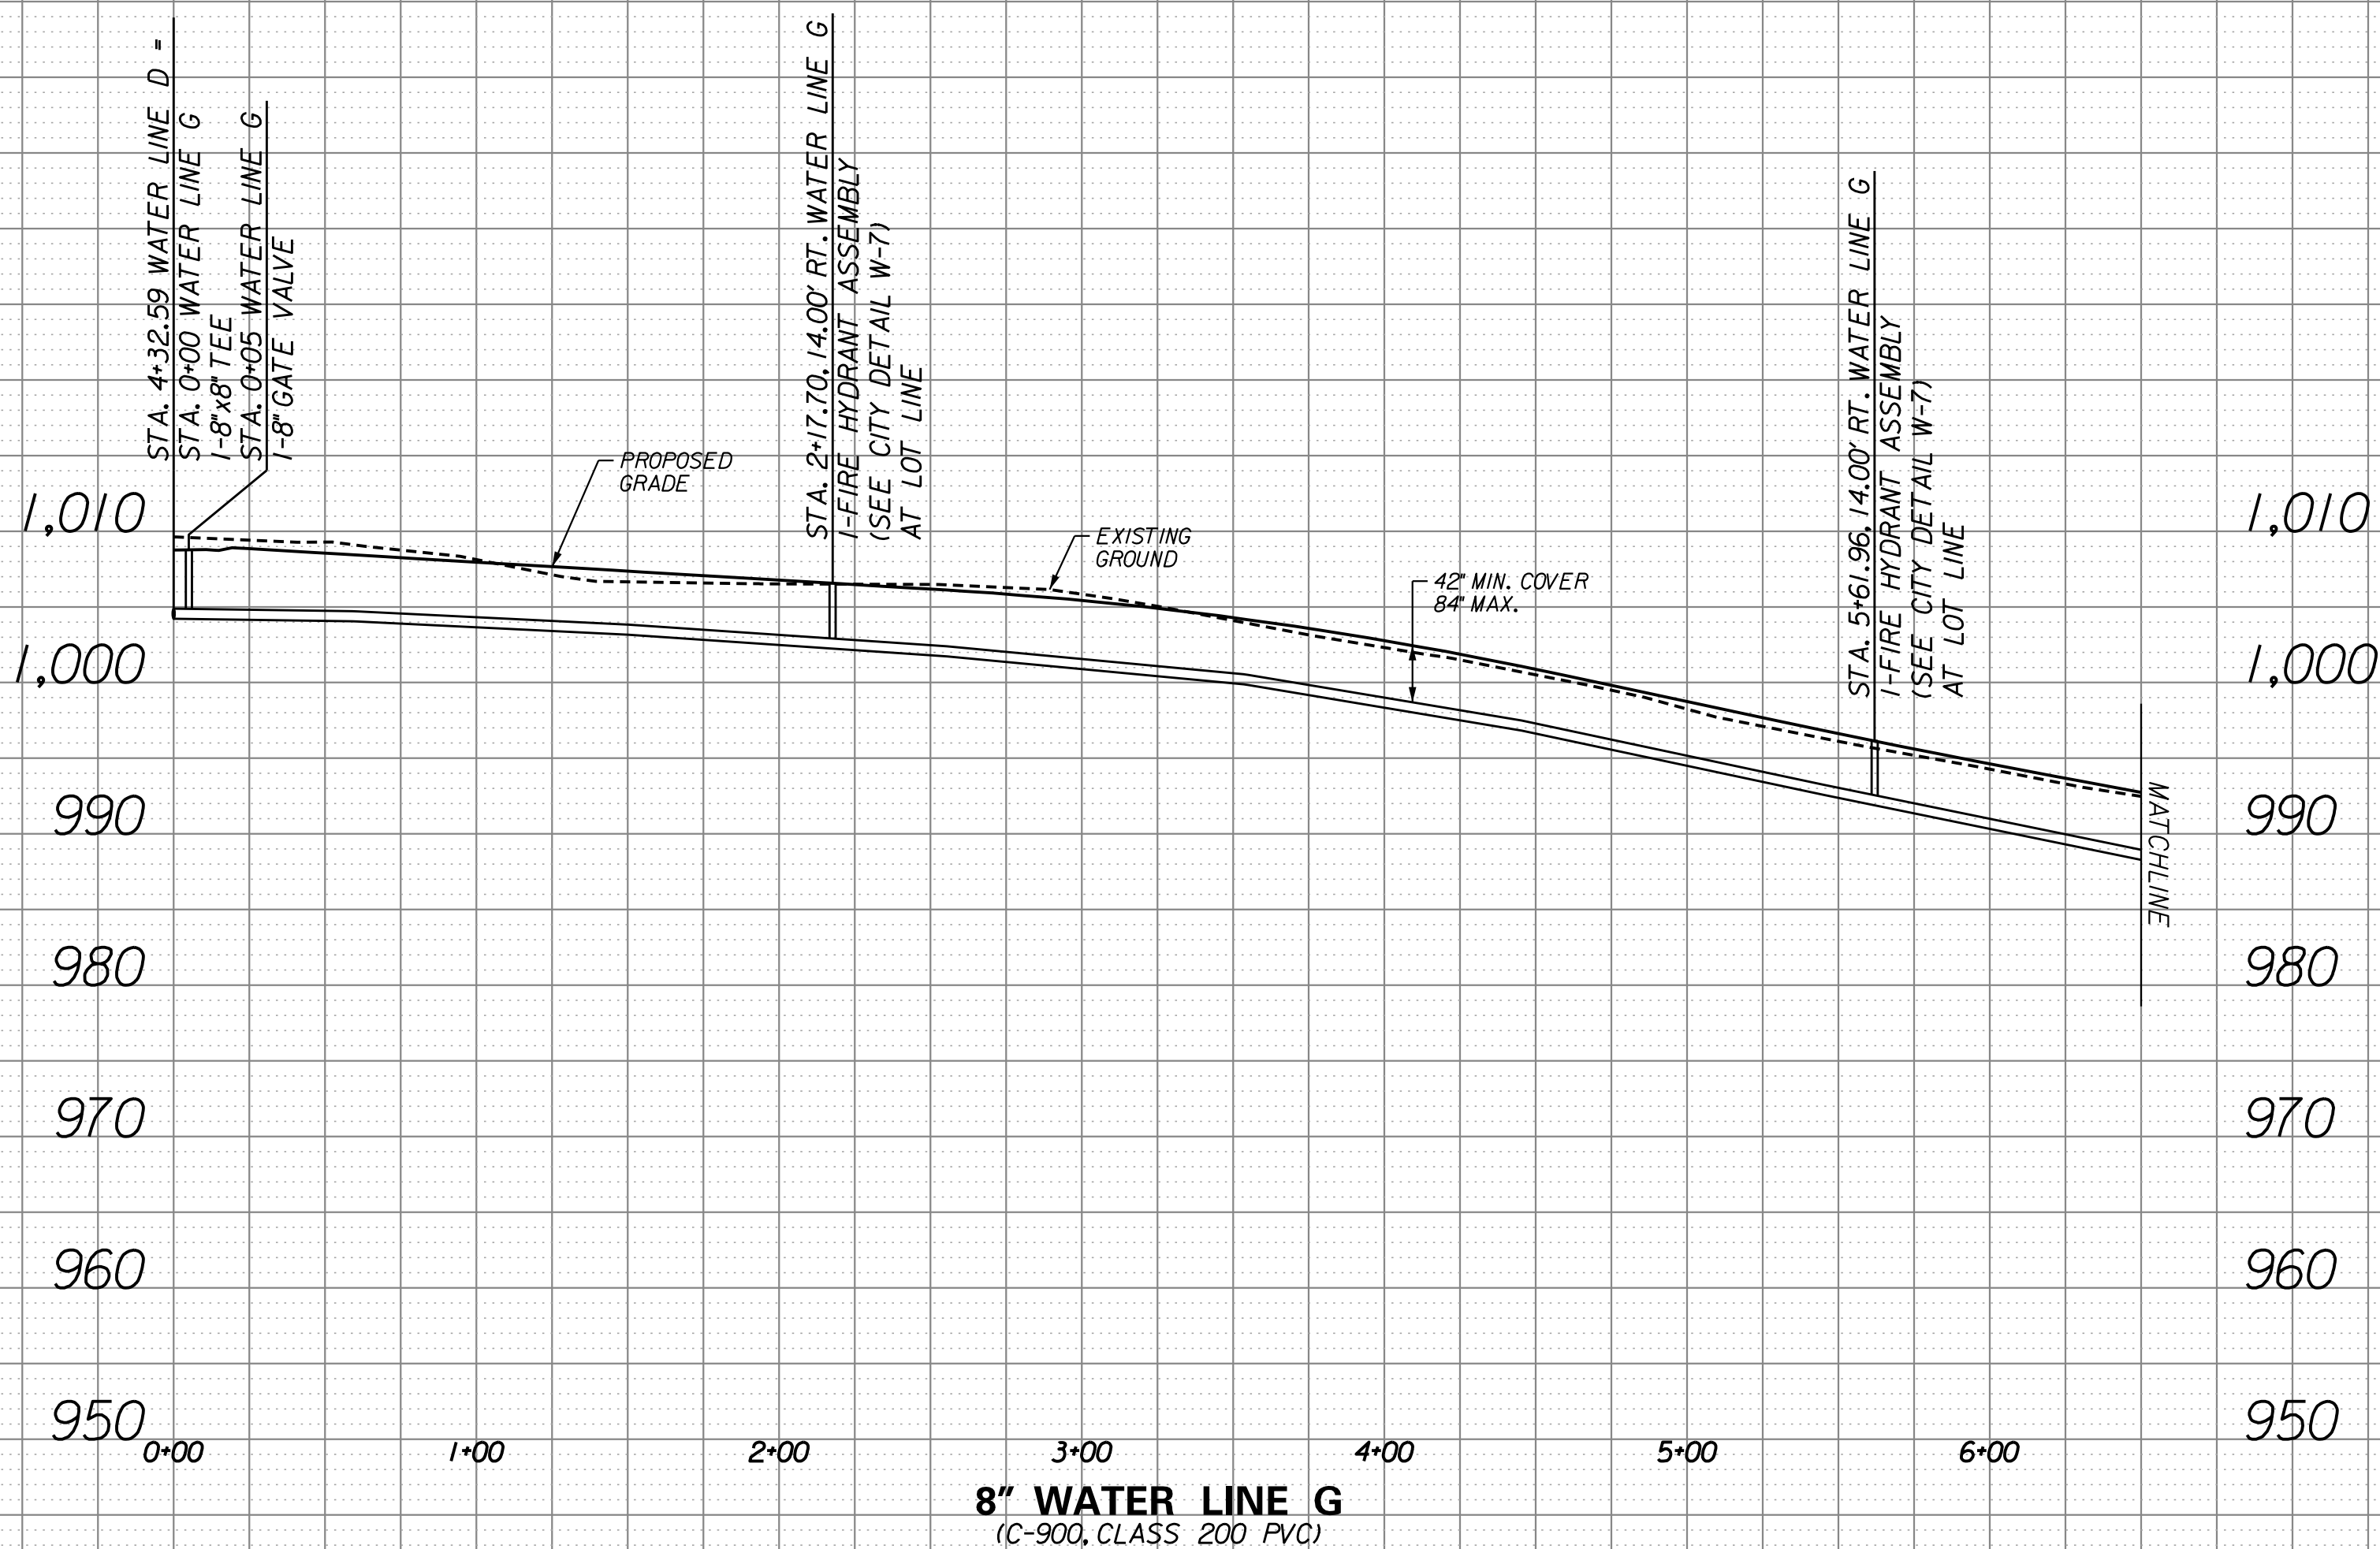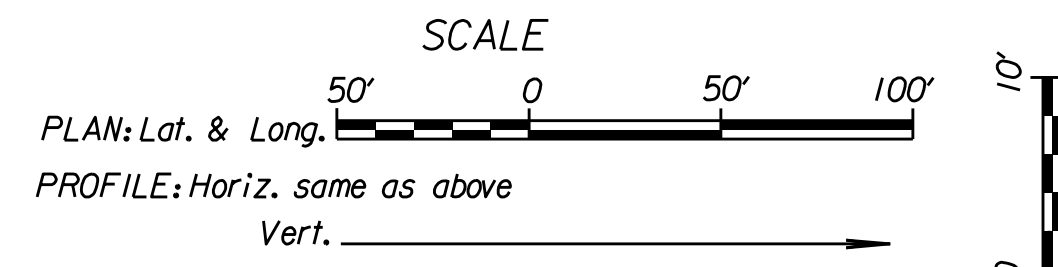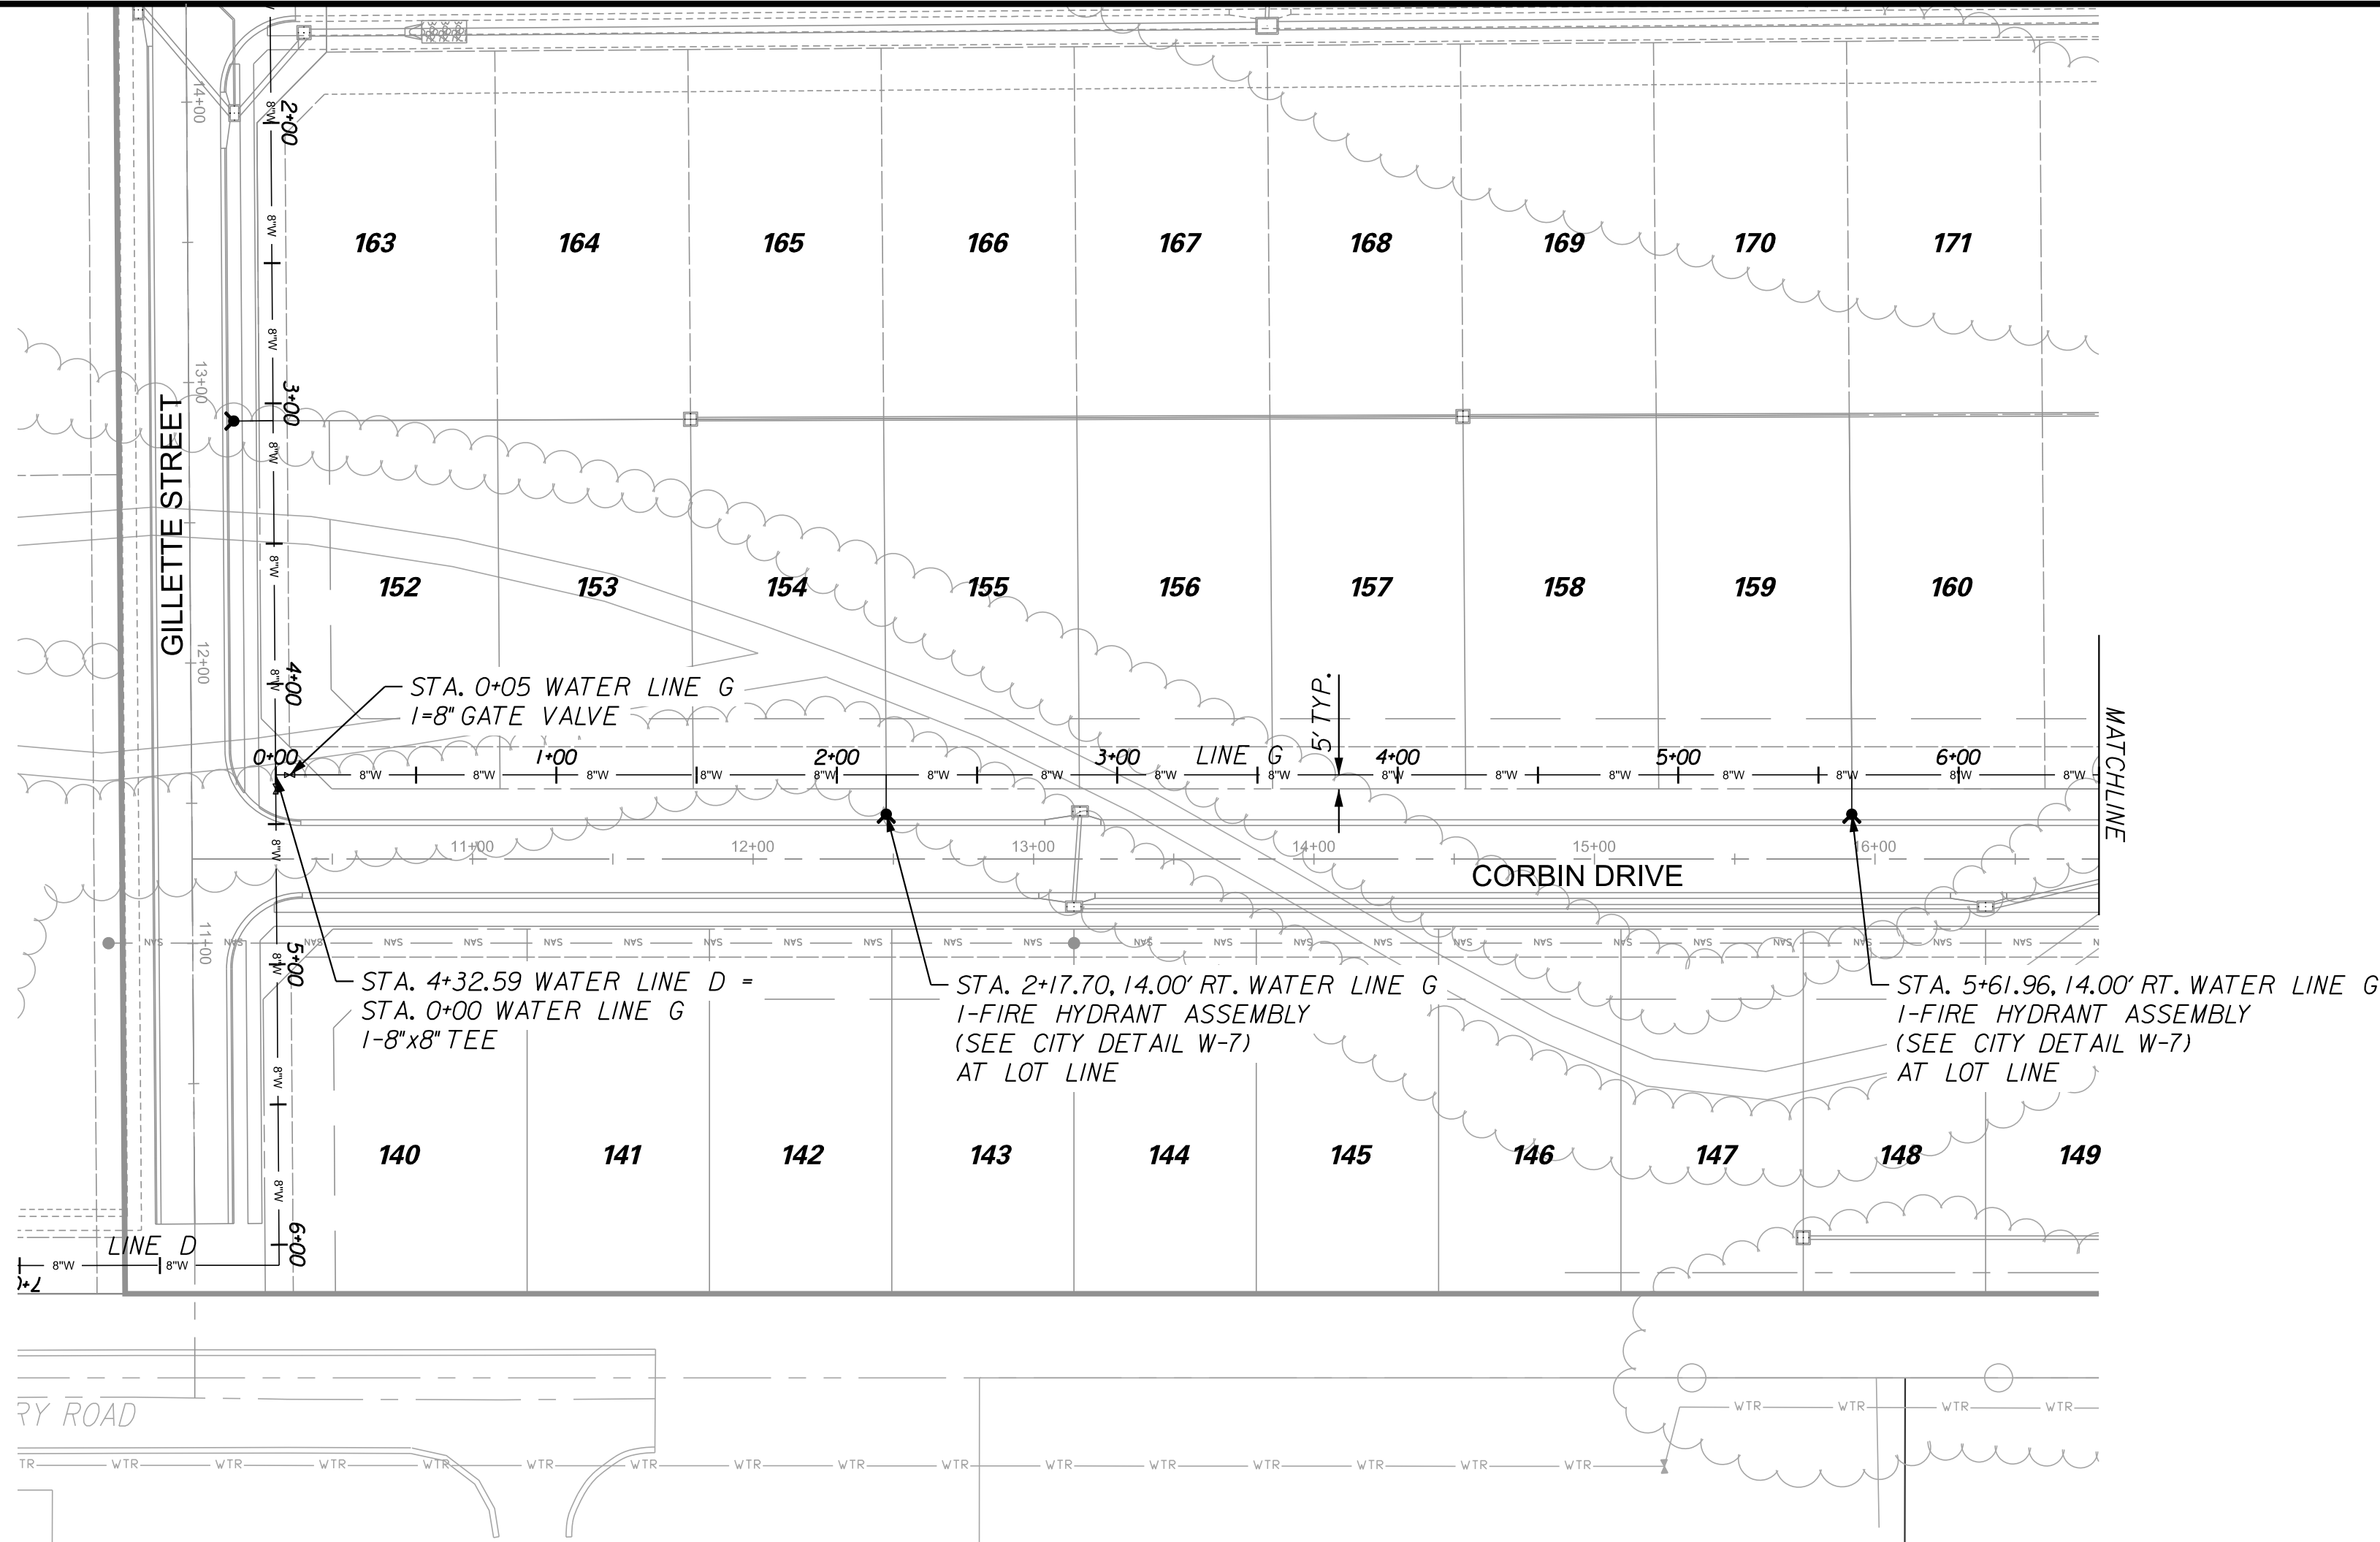

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
05/21/2020

NO.	BY	DATE	REVISION
1	RAM	11/27/18	SUBMITTAL TO CITY OF LEE'S SUMMIT
2	RAM	3/19/19	ADDRESSED CITY COMMENTS DATED 12/18/18
3	RAM	3/26/19	ADDRESSED CITY COMMENTS DATED 3/20/19

11010 Haskell St. Ste. 210 Kansas City, KS 66109 816-759-2285
CORPORATE LICENSE NO. E2010005873
R. KEVIN STERRETT, MO E-26440


Consult Inc engineers planners

WATER LINE G
(STA. 0+00 TO STA. 6+50)

COBEY CREEK



CITY OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

X-REF. NO. XXX
DRAWING NO. XXX
DATE March 26, 2019
JOB NO. 16.059.01
SHEET 8 OF 12

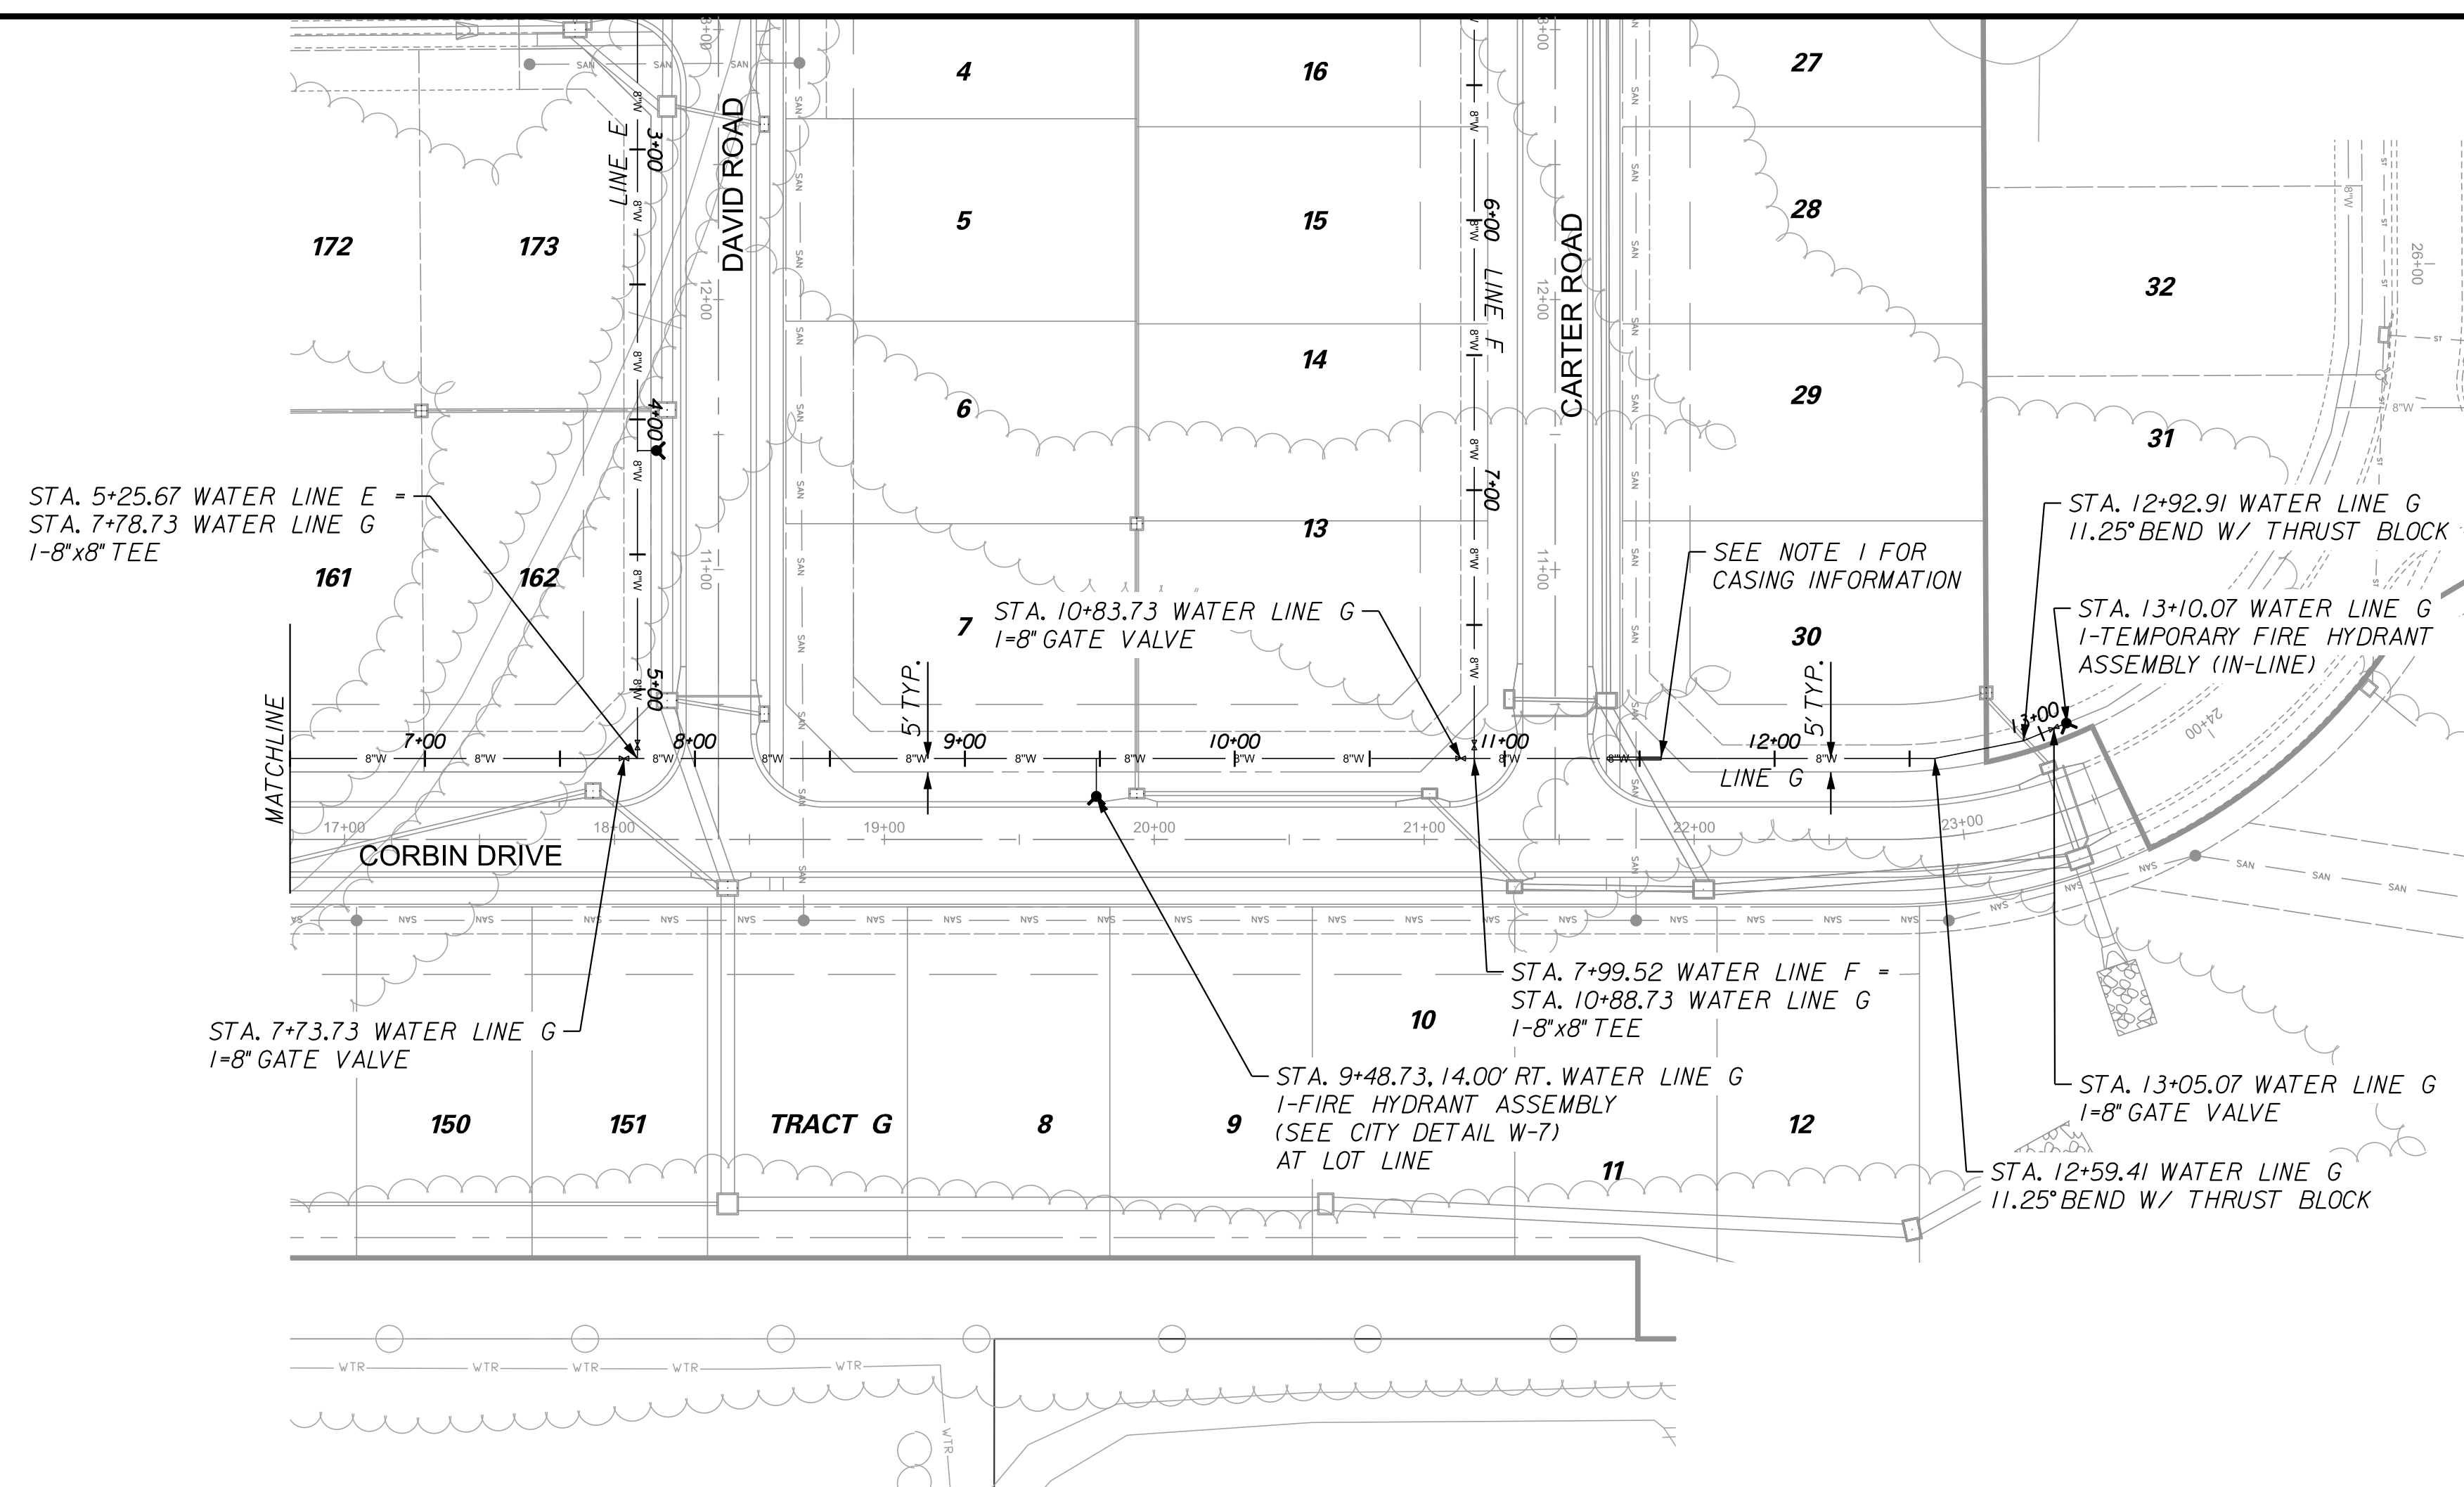


NOTES:

1. WATER LINE AT STORM LINE 12 AND SANITARY LINE C CROSSING TO BE CASED. CASING PIPE TO BEGIN AT STA. 11+38 AND END AT STA. 11+58. CASING PIPE SHALL BE MADE OF STEEL COMPLYING WITH ASTM A 139, GRADE B, WITH A MINIMUM YIELD STRENGTH OF 35,000 PSI. CASING PIPE TO BE 12" DIA. WITH MINIMUM 3/16" WALL THICKNESS. REFER TO DETAIL ON SHEET 11 FOR MORE INFORMATION.

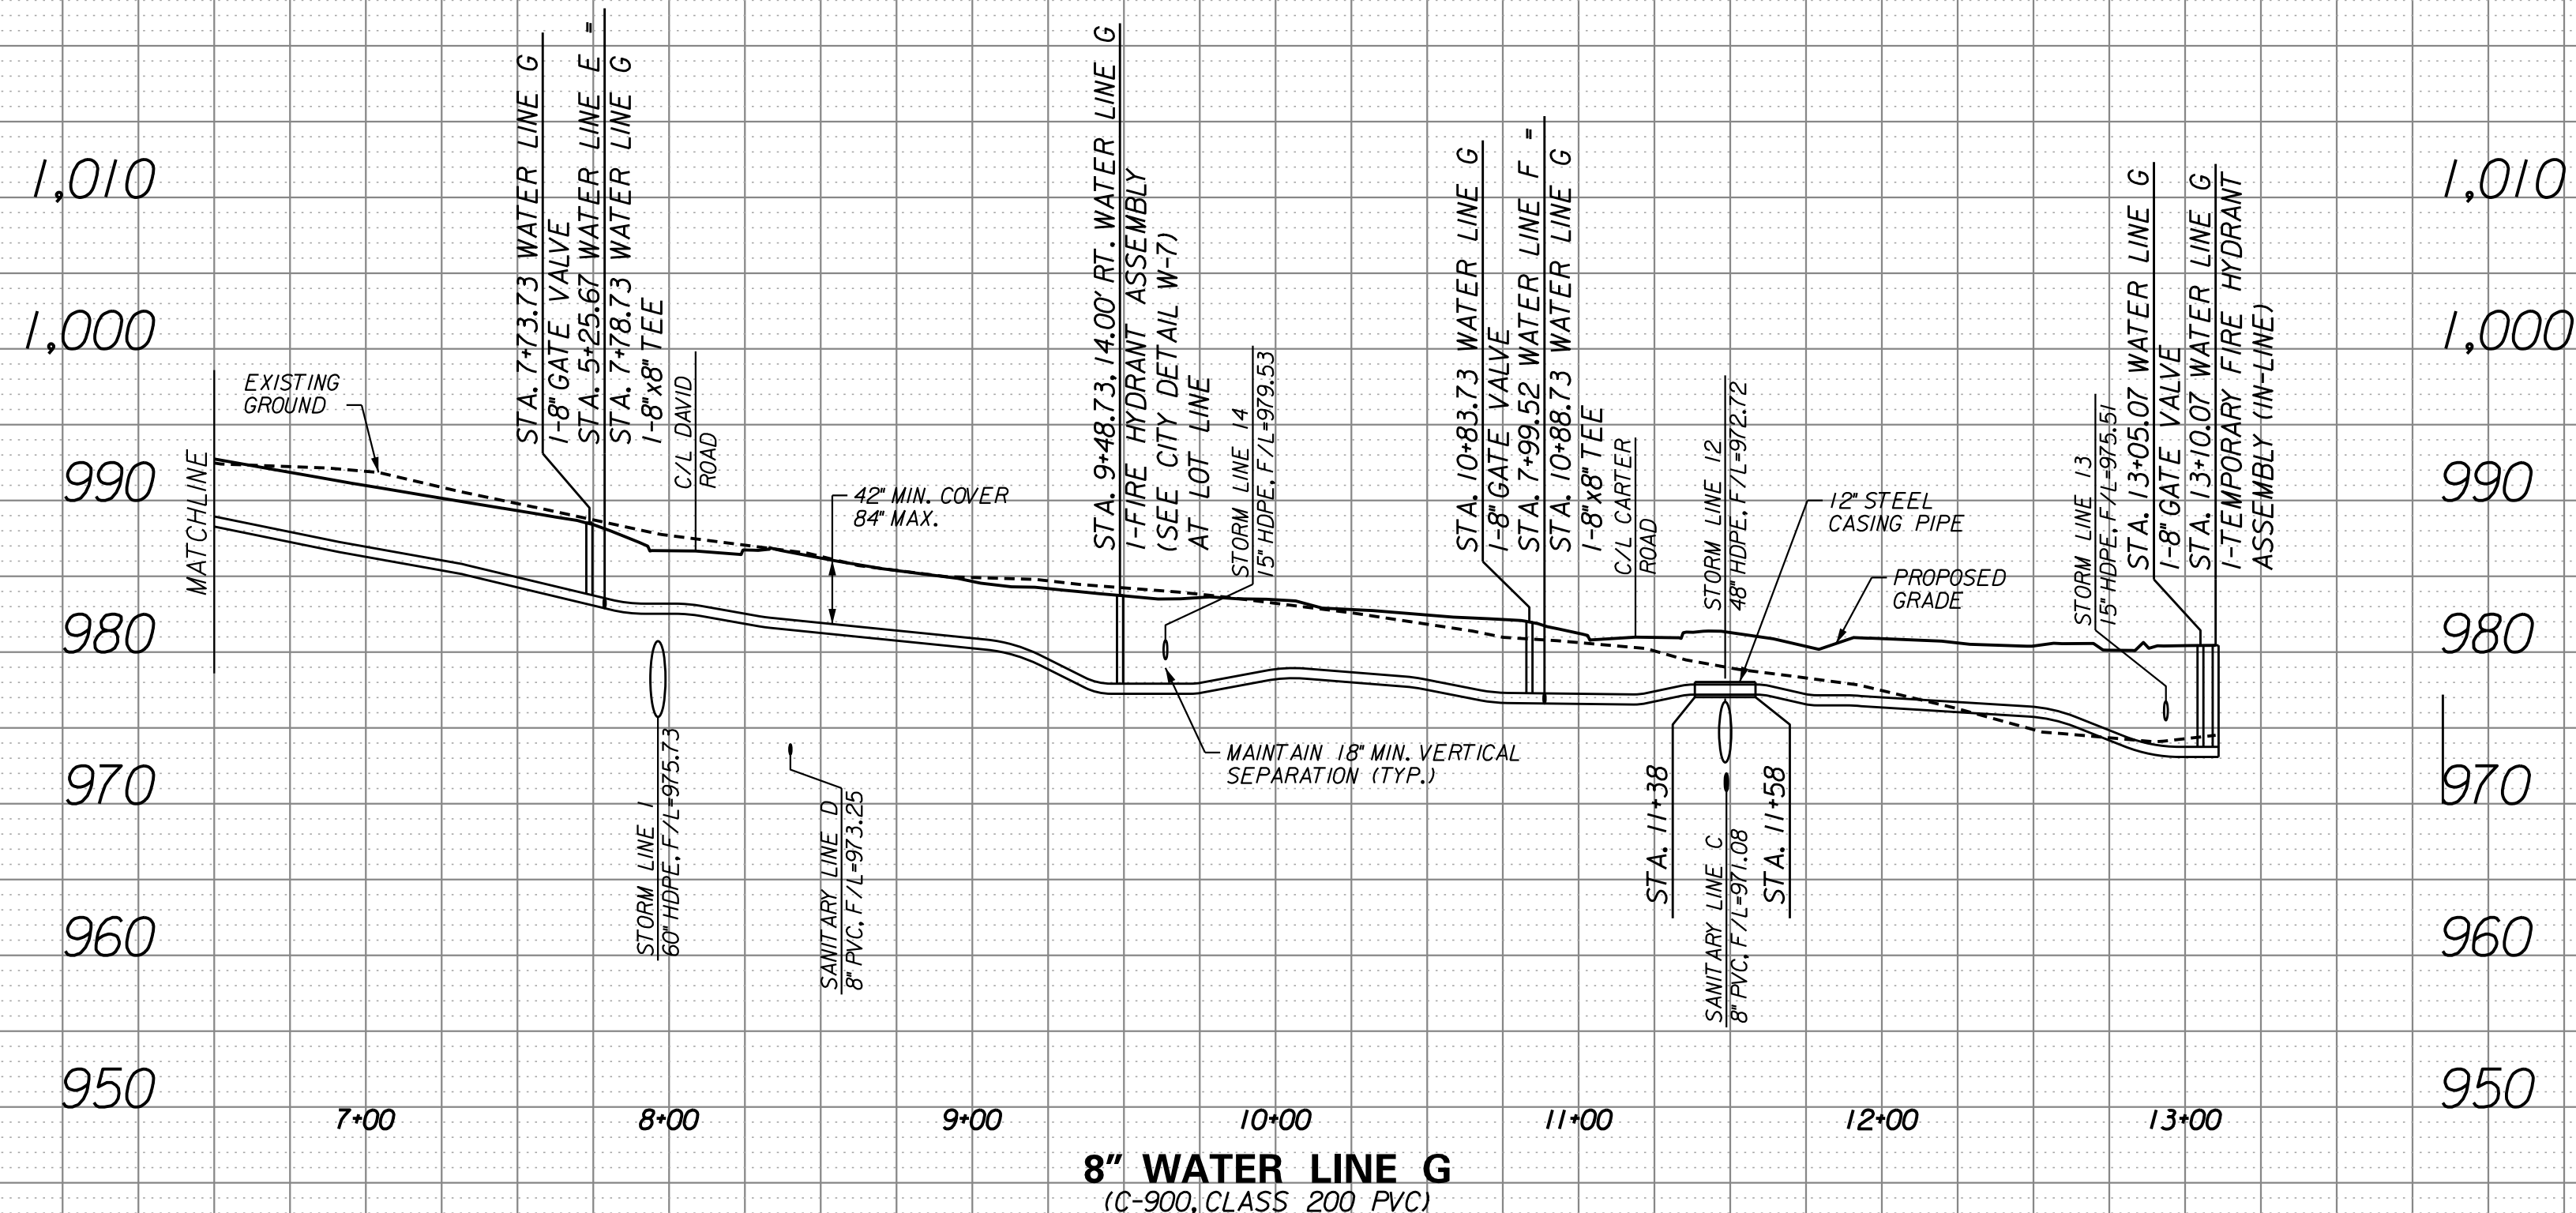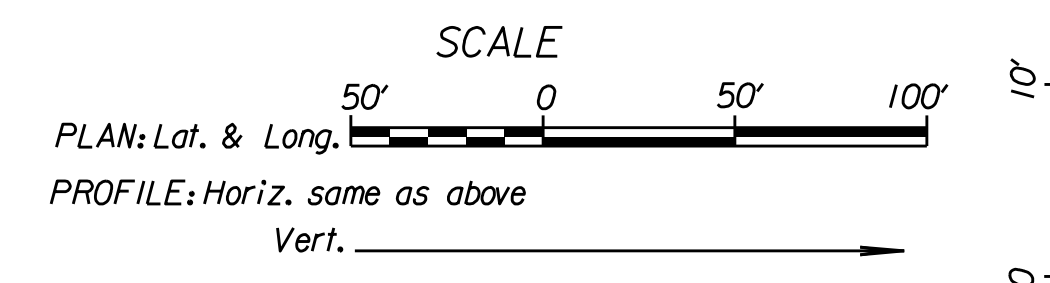

**RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI**


[illegible]

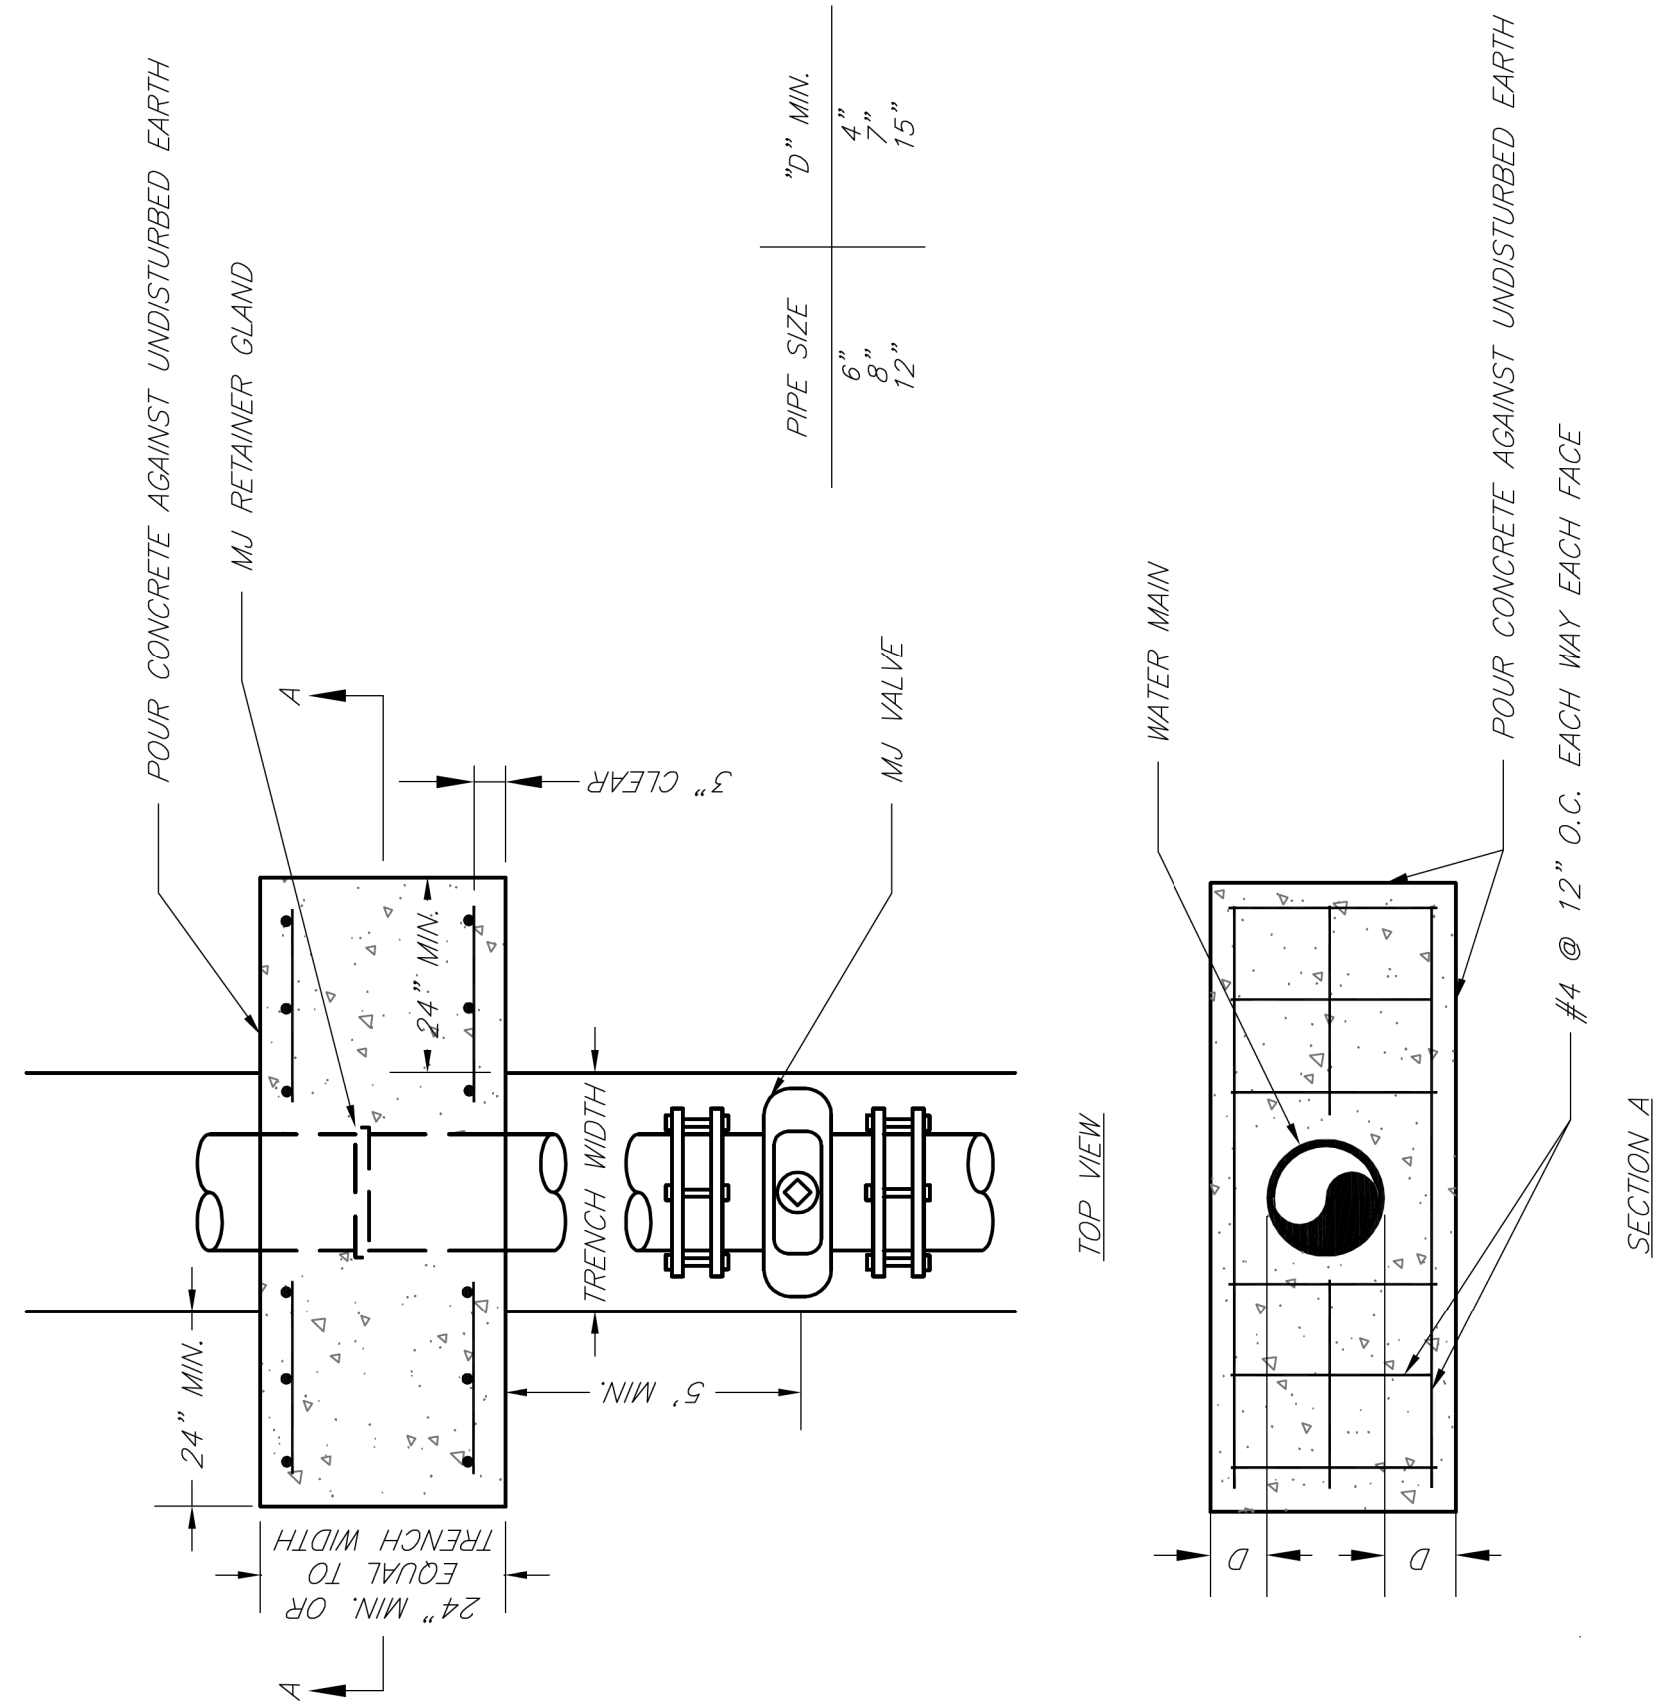

NOTE:

THIS DETAIL NOT TO BE USED FOR PIPE GREATER THAN 12"

	LEE'S SUMMIT MISSOURI PUBLIC WORKS ENGINEERING DIVISION 12035 GREEN STREET LEE'S SUMMIT, MO 64063	Date: 02/13 Drawn By: JN Checked By: DL FILE: WAF-3 Rev: 1/14
	STRADDLE BLOCK	

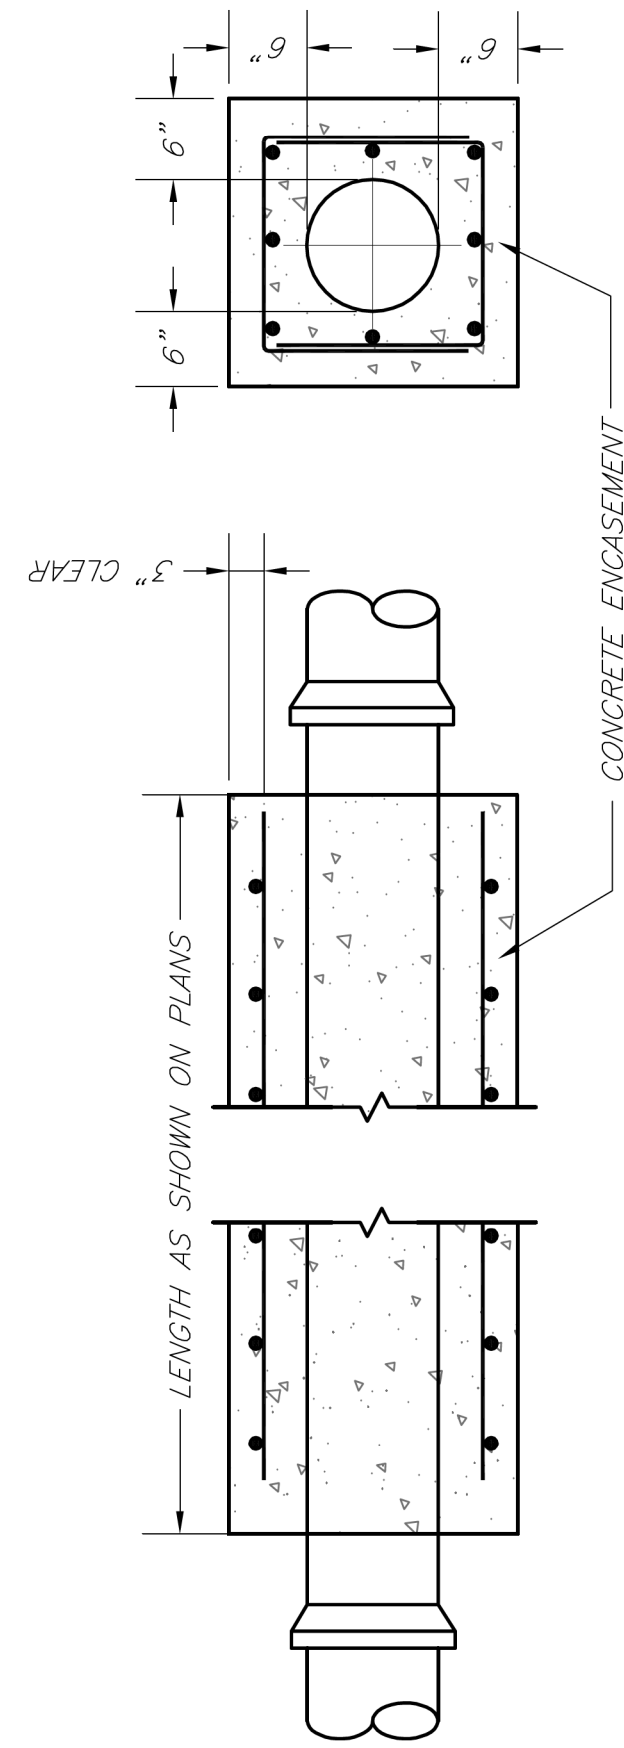

NOTES:

1. INTERMEDIATE BELLS SHALL BE ENCASED.
2. REINFORCING STEEL SHALL BE #4 @ 12" O.C. EACH WAY WITH A MINIMUM REBAR LAP OF 12".
3. THIS DETAIL IS FOR PIPES 12" AND SMALLER.

**RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
05/21/2020**

	LEE'S SUMMIT MISSOURI PUBLIC WORKS ENGINEERING DIVISION 120 S. GREEN STREET LEE'S SUMMIT, MO 64063		Date: 02/13
			Drawn By: JN
			Checked By: DL
			FILE: WAT-4
WATER PIPE ENCASEMENT		Rev: 1/14	

WATER LINE DETAILS		
	X-REF NO. XXX	
	DRAWING NO. XXX	
	DATE March 26, 2019	
	JOB NO. 16,059.01	
10	SHEET OF	12



CITY OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI

CORPORATE LICENSE No. E2010005873


R. KEVIN STERRETT, MO E-26440

IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES

IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CERTIFICATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES


DATE	REVISION	NO.	BY	EXAMPLE
3/26/19	ADDRESSED CITY COMMENTS DATED 3/20/19	3	RMS	
3/8/19	ADDRESSED CITY COMMENTS DATED 12/18/18	2	RMS	
11/21/18	SUBMITTAL TO CITY OF LEE'S SUMMIT	1	RMS	

IF THIS IS NOT A BLUE INK SEAL AND THE SIGNATURE IS NOT IN BLUE INK, THE PLAIN IS A COPY AND MAY CONTAIN UNAUTHORIZED ALTERATIONS. THE CONFIGURATION CONTAINED ON THIS DOCUMENT SHALL NOT APPLY TO ANY COPIES

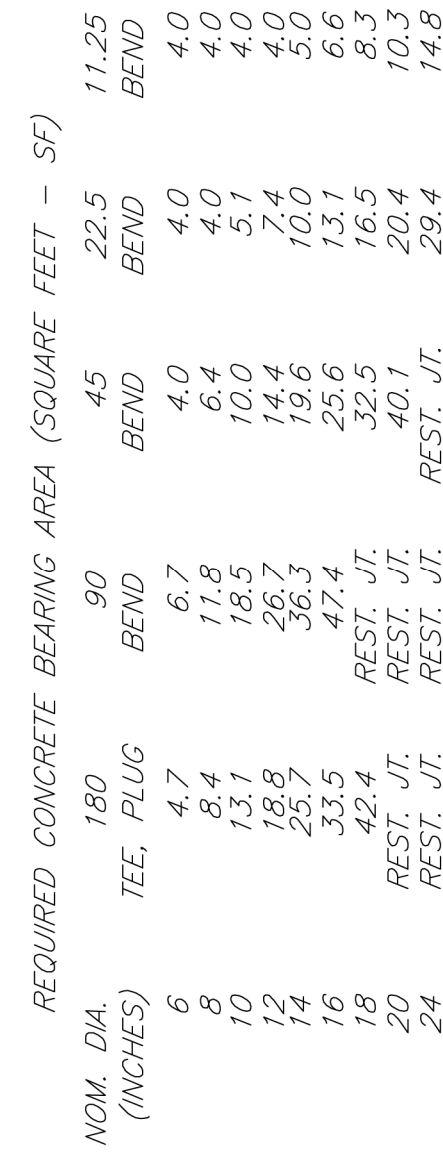

NOTES:

- NOTES:
1. ALL BENDS WITHOUT RESTRAINED JOINTS SHALL HAVE CONCRETE THRUST BLOCKS INSTALLED FOR RESTRAINT.
2. MEGA LUGS MAY BE USED ONLY IN CONJUNCTION WITH CONCRETE THRUST BLOCKING.
3. BEARING AREA MUST BE AGAINST UNDISTURBED SOIL.
4. DO NOT COVER JOINTS OR BOLTS (WHERE APPLICABLE) WITH CONCRETE.

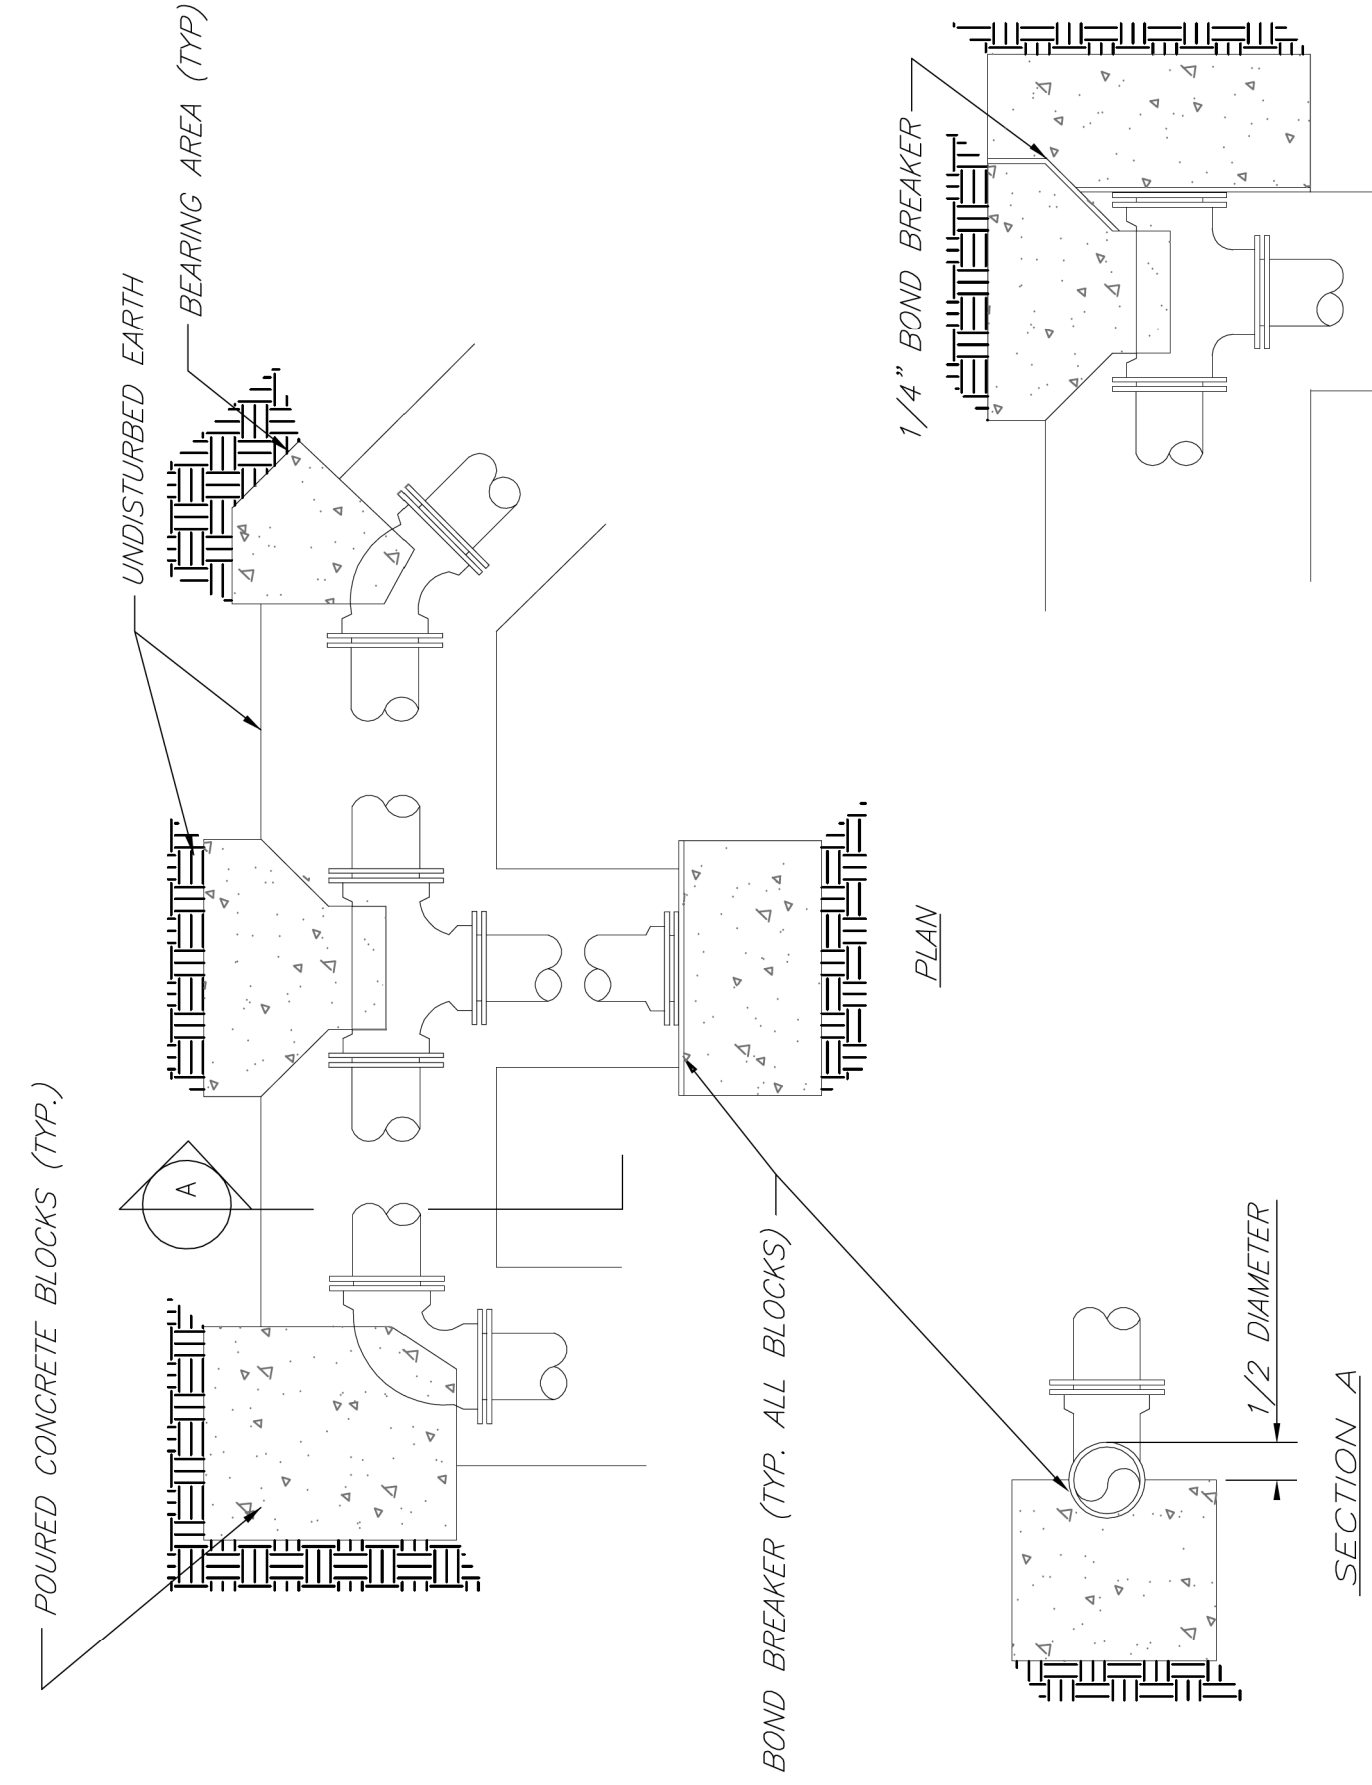


	LEE'S SUMMIT MISSOURI PUBLIC WORKS ENGINEERING DIVISION 1201 S. GREEN STREET LEE'S SUMMIT, MO 64063		Date: 02/13 Drawn By: JN Checked By: DL FILE: WA-1
	HORIZONTAL THRUST BLOCKS		Rev: 1/14 Re:


NOM. DIA. (INCHES)	REQUIRED CONCRETE VOLUME (CUBIC FEET - CF)			REQUIRED REINFORCING (LBS)		
	TIE, PLUG	BEND	BEND	NO. 4	NO. 5	NO. 6
6	180	90	45	22.5	11.25	
8	50.5	71.4	38.6	19.7	9.9	
8	89.8	126.9	68.7	35.0	17.6	
10	140.2	198.3	101.3	54.7	27.5	
12	202.0	282.6	154.6	78.8	39.6	
14	263.7	366.9	207.9	102.9	51.9	
16	325.4	451.2	261.2	127.0	63.0	
18	387.1	535.5	314.5	151.1	75.1	
20	448.8	619.8	367.8	175.2	87.1	
22	510.5	704.1	421.1	199.3	99.1	
24	572.2	788.4	474.4	223.4	111.1	

NOTES:

1. ALL BENDS WITHOUT RESTRAINED JOINTS SHALL HAVE CONCRETE THRUST BLOCKS INSTALLED FOR RESTRAINT.
2. MEGA LUGS MAY BE USED ONLY IN CONJUNCTION WITH CONCRETE THRUST BLOCKING.
3. BEARING MUST BE AGAINST UNDISTURBED SOIL.
4. DO NOT COVER JOINTS OR BOLTS (WHERE APPLICABLE) WITH CONCRETE.

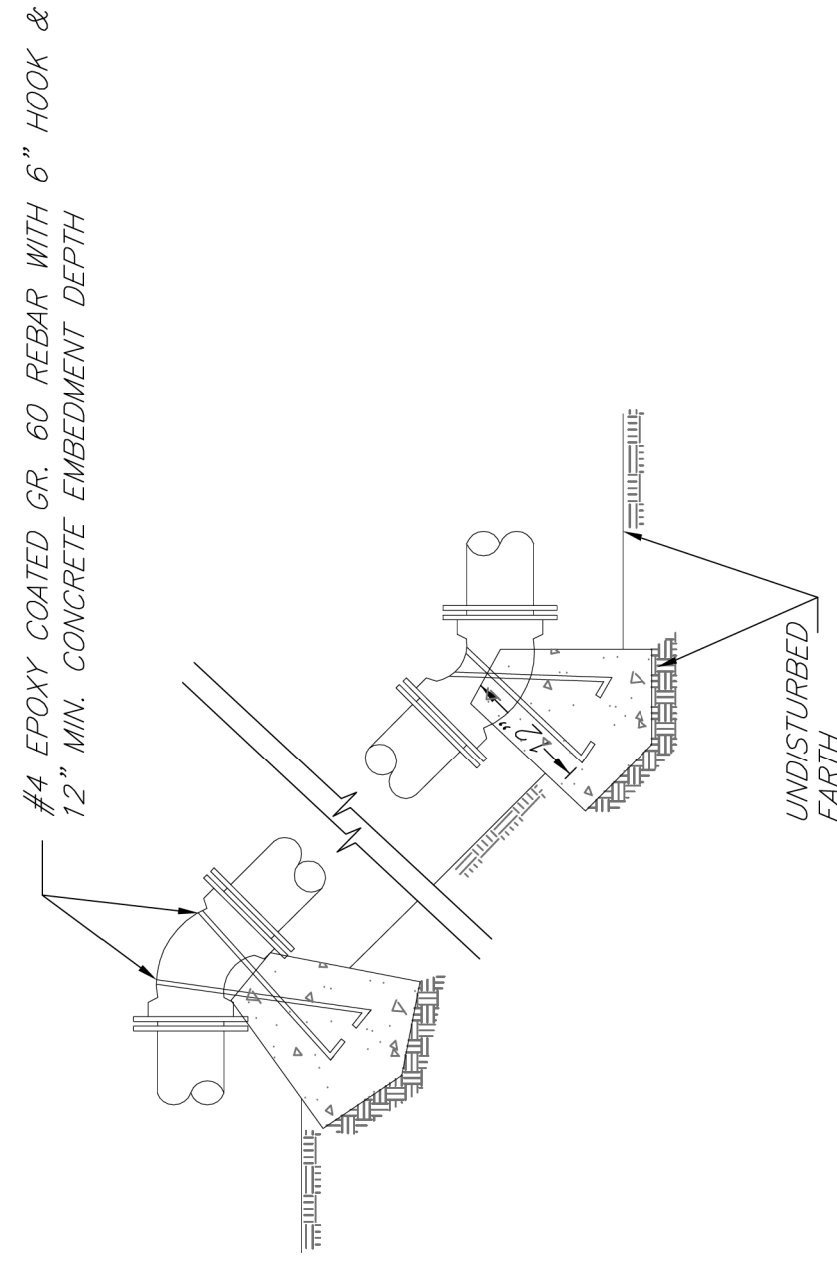

	LEE'S SUMMIT MISSOURI PUBLIC WORKS ENGINEERING DIVISION 120 S. GREEN STREET LEE'S SUMMIT, MO 64063	Date: 02/13 Drawn By: JN Checked By: DL FILE: WAT-2
	VERTICAL THRUST BLOCKS	Rev: 1/14 Rev:

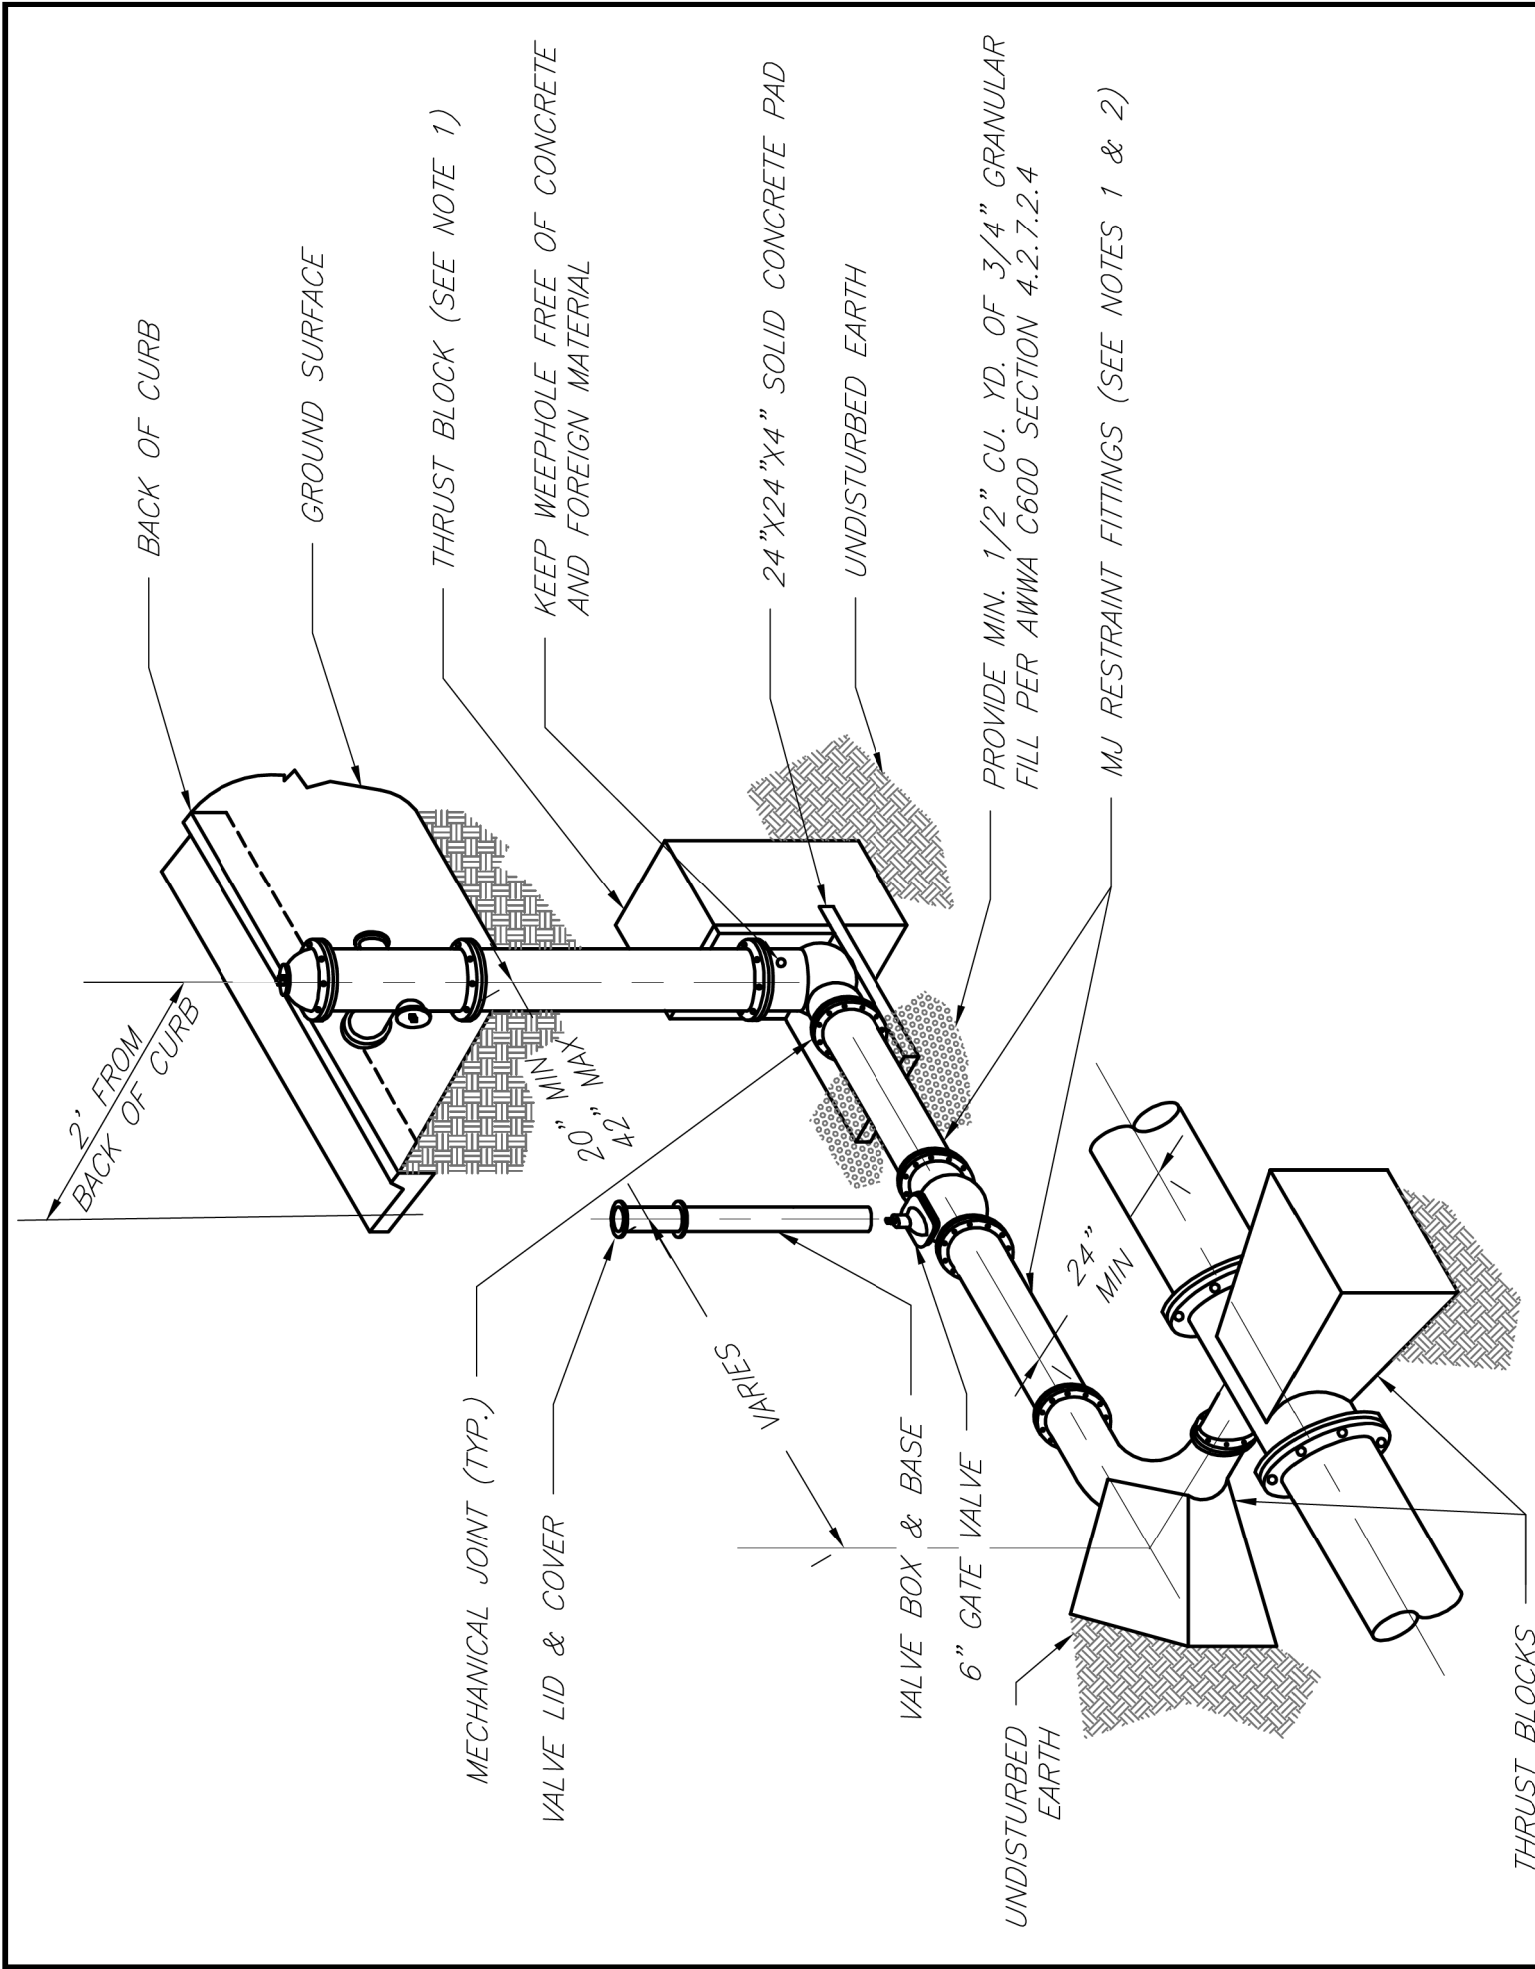


- NOTES:
1. WHEN RETAINER GLANDS ARE USED IN LIEU OF MECHANICAL JOINT (MJ) RESTRAINT FITTINGS, HORIZONTAL THRUST BLOCKS ARE REQUIRED.
 2. GATE VALVE MAY BE BOLTED DIRECTLY TO MJ RESTRAINT TEE.
 3. SEE APPROVED PRODUCTS LIST FOR WATER UTILITIES FOR FIRE HYDRANT, VALVES, VALVE BOX LID, AND COVER.
 4. BOTTOM HYDRANT FLANGE SHALL BE 2" TO 6" ABOVE FINISHED GRADE.
 5. FOR STREETS WITHOUT CURBS FIRE HYDRANTS SHALL BE PLACED WITHIN 1 FOOT OF THE R/W LINE, BUT NOT MORE THAN 10' FROM EDGE OF PAVEMENT. FIRE HYDRANT SHALL NOT BE PLACED IN BOTTOM OF DITCH.
 6. HYDRANT SHALL BE ROTATED AS DIRECTED BY INSPECTOR.

LS

LEE'S SUMMIT
MISSOURI
PUBLIC WORKS ENGINEERING DIVISION | 120 SE GREEN STREET | LEE'S SUMMIT, MO 64063

HYDRANT WITH 90 DEGREE BEND

Date: 02/13
Drawn By: JN
Checked By: DL
FILE: WAT-B
Rev: 1/14
Rev:

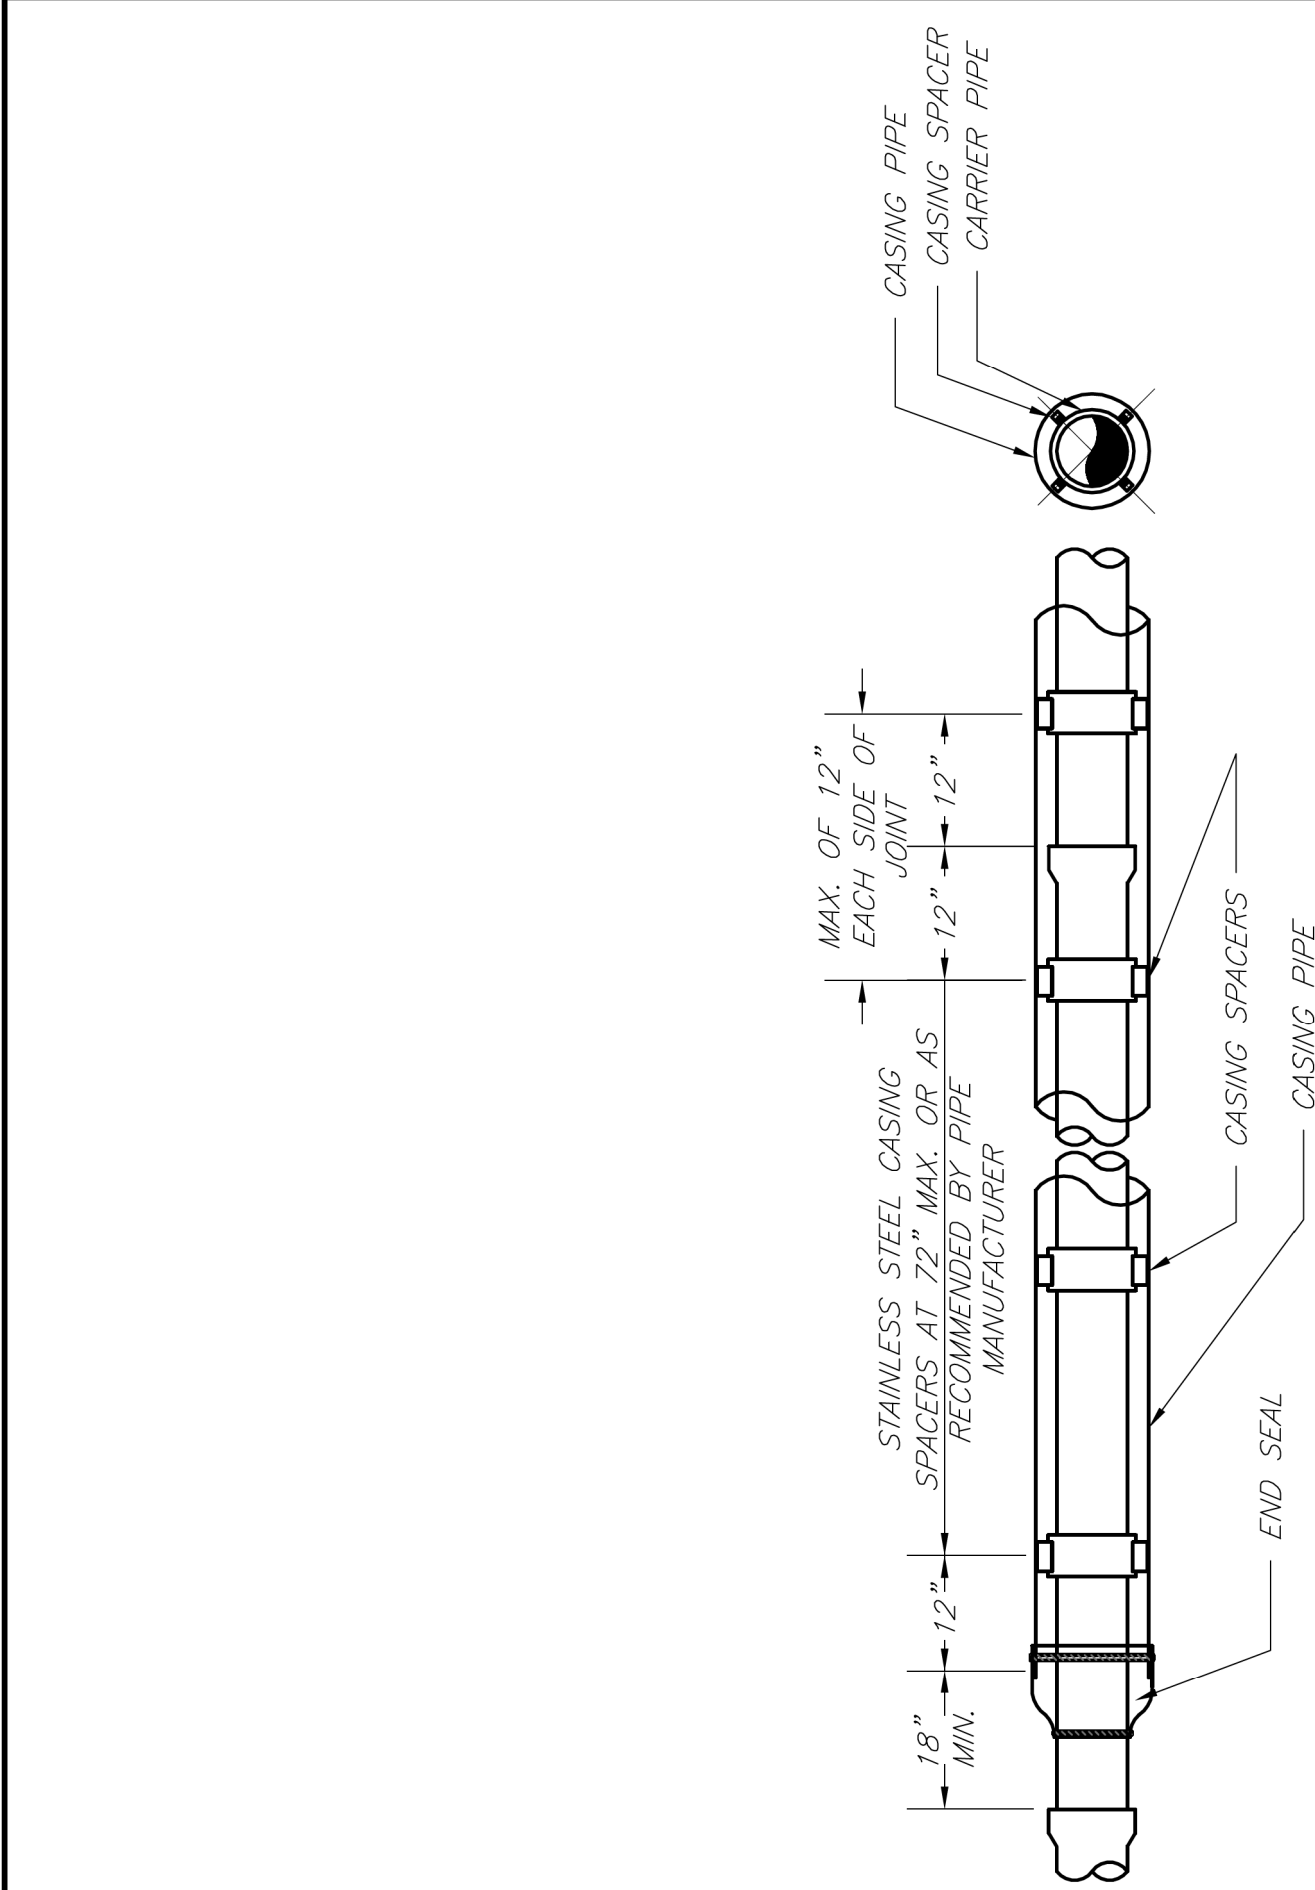


- NOTES:
1. REFER TO SPECIFICATION SECTION 3800 FOR ADDITIONAL INFORMATION.
 2. LENGTH, DIAMETER, AND WALL THICKNESS TO BE SHOWN ON CONSTRUCTION PLANS.

LS

LEE'S SUMMIT
MISSOURI
PUBLIC WORKS ENGINEERING DIVISION | 120 SE GREEN STREET | LEE'S SUMMIT, MO 64063

WATER CASING PIPE DETAIL

Date: 02/13
Drawn By: JN
Checked By: DL
FILE: WAT-S
Rev: 1/14
Rev:

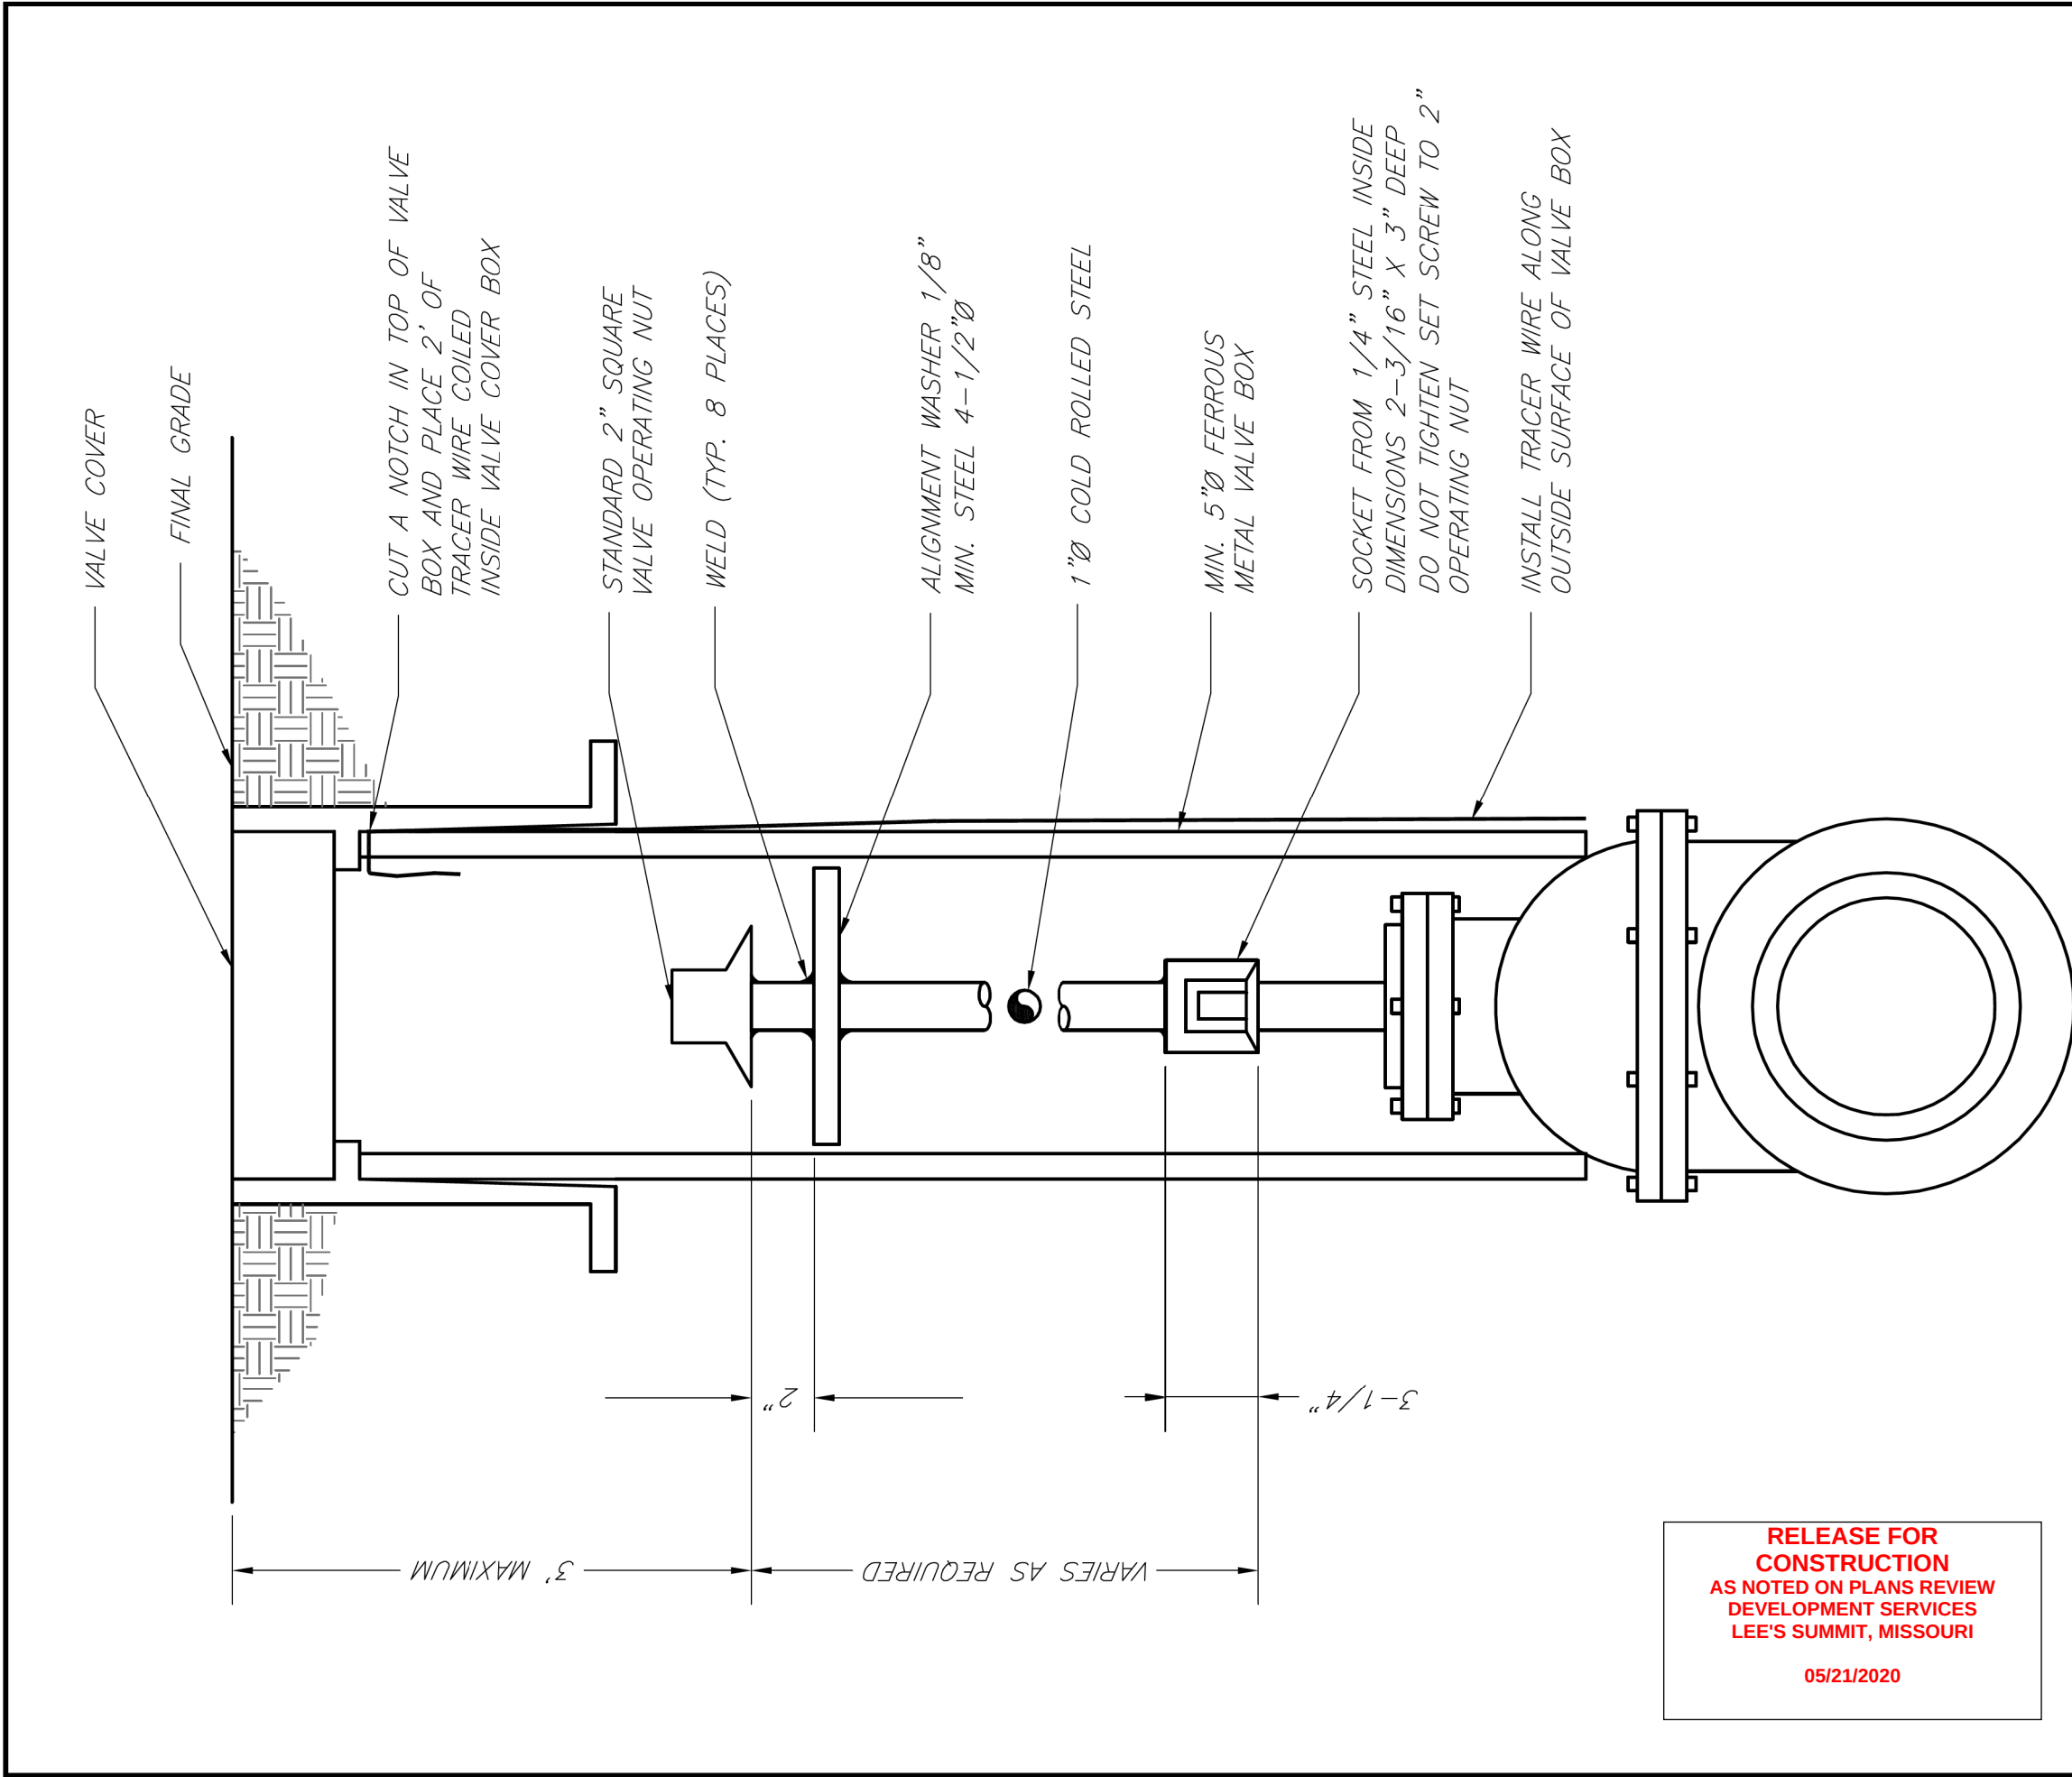


RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
05/21/2020

LS

LEE'S SUMMIT
MISSOURI
PUBLIC WORKS ENGINEERING DIVISION | 120 SE GREEN STREET | LEE'S SUMMIT, MO 64063

VALVE STEM EXTENSION AND VALVE BOX

Date: 02/13
Drawn By: JN
Checked By: DL
FILE: WAT-9
Rev: 1/14
Rev:

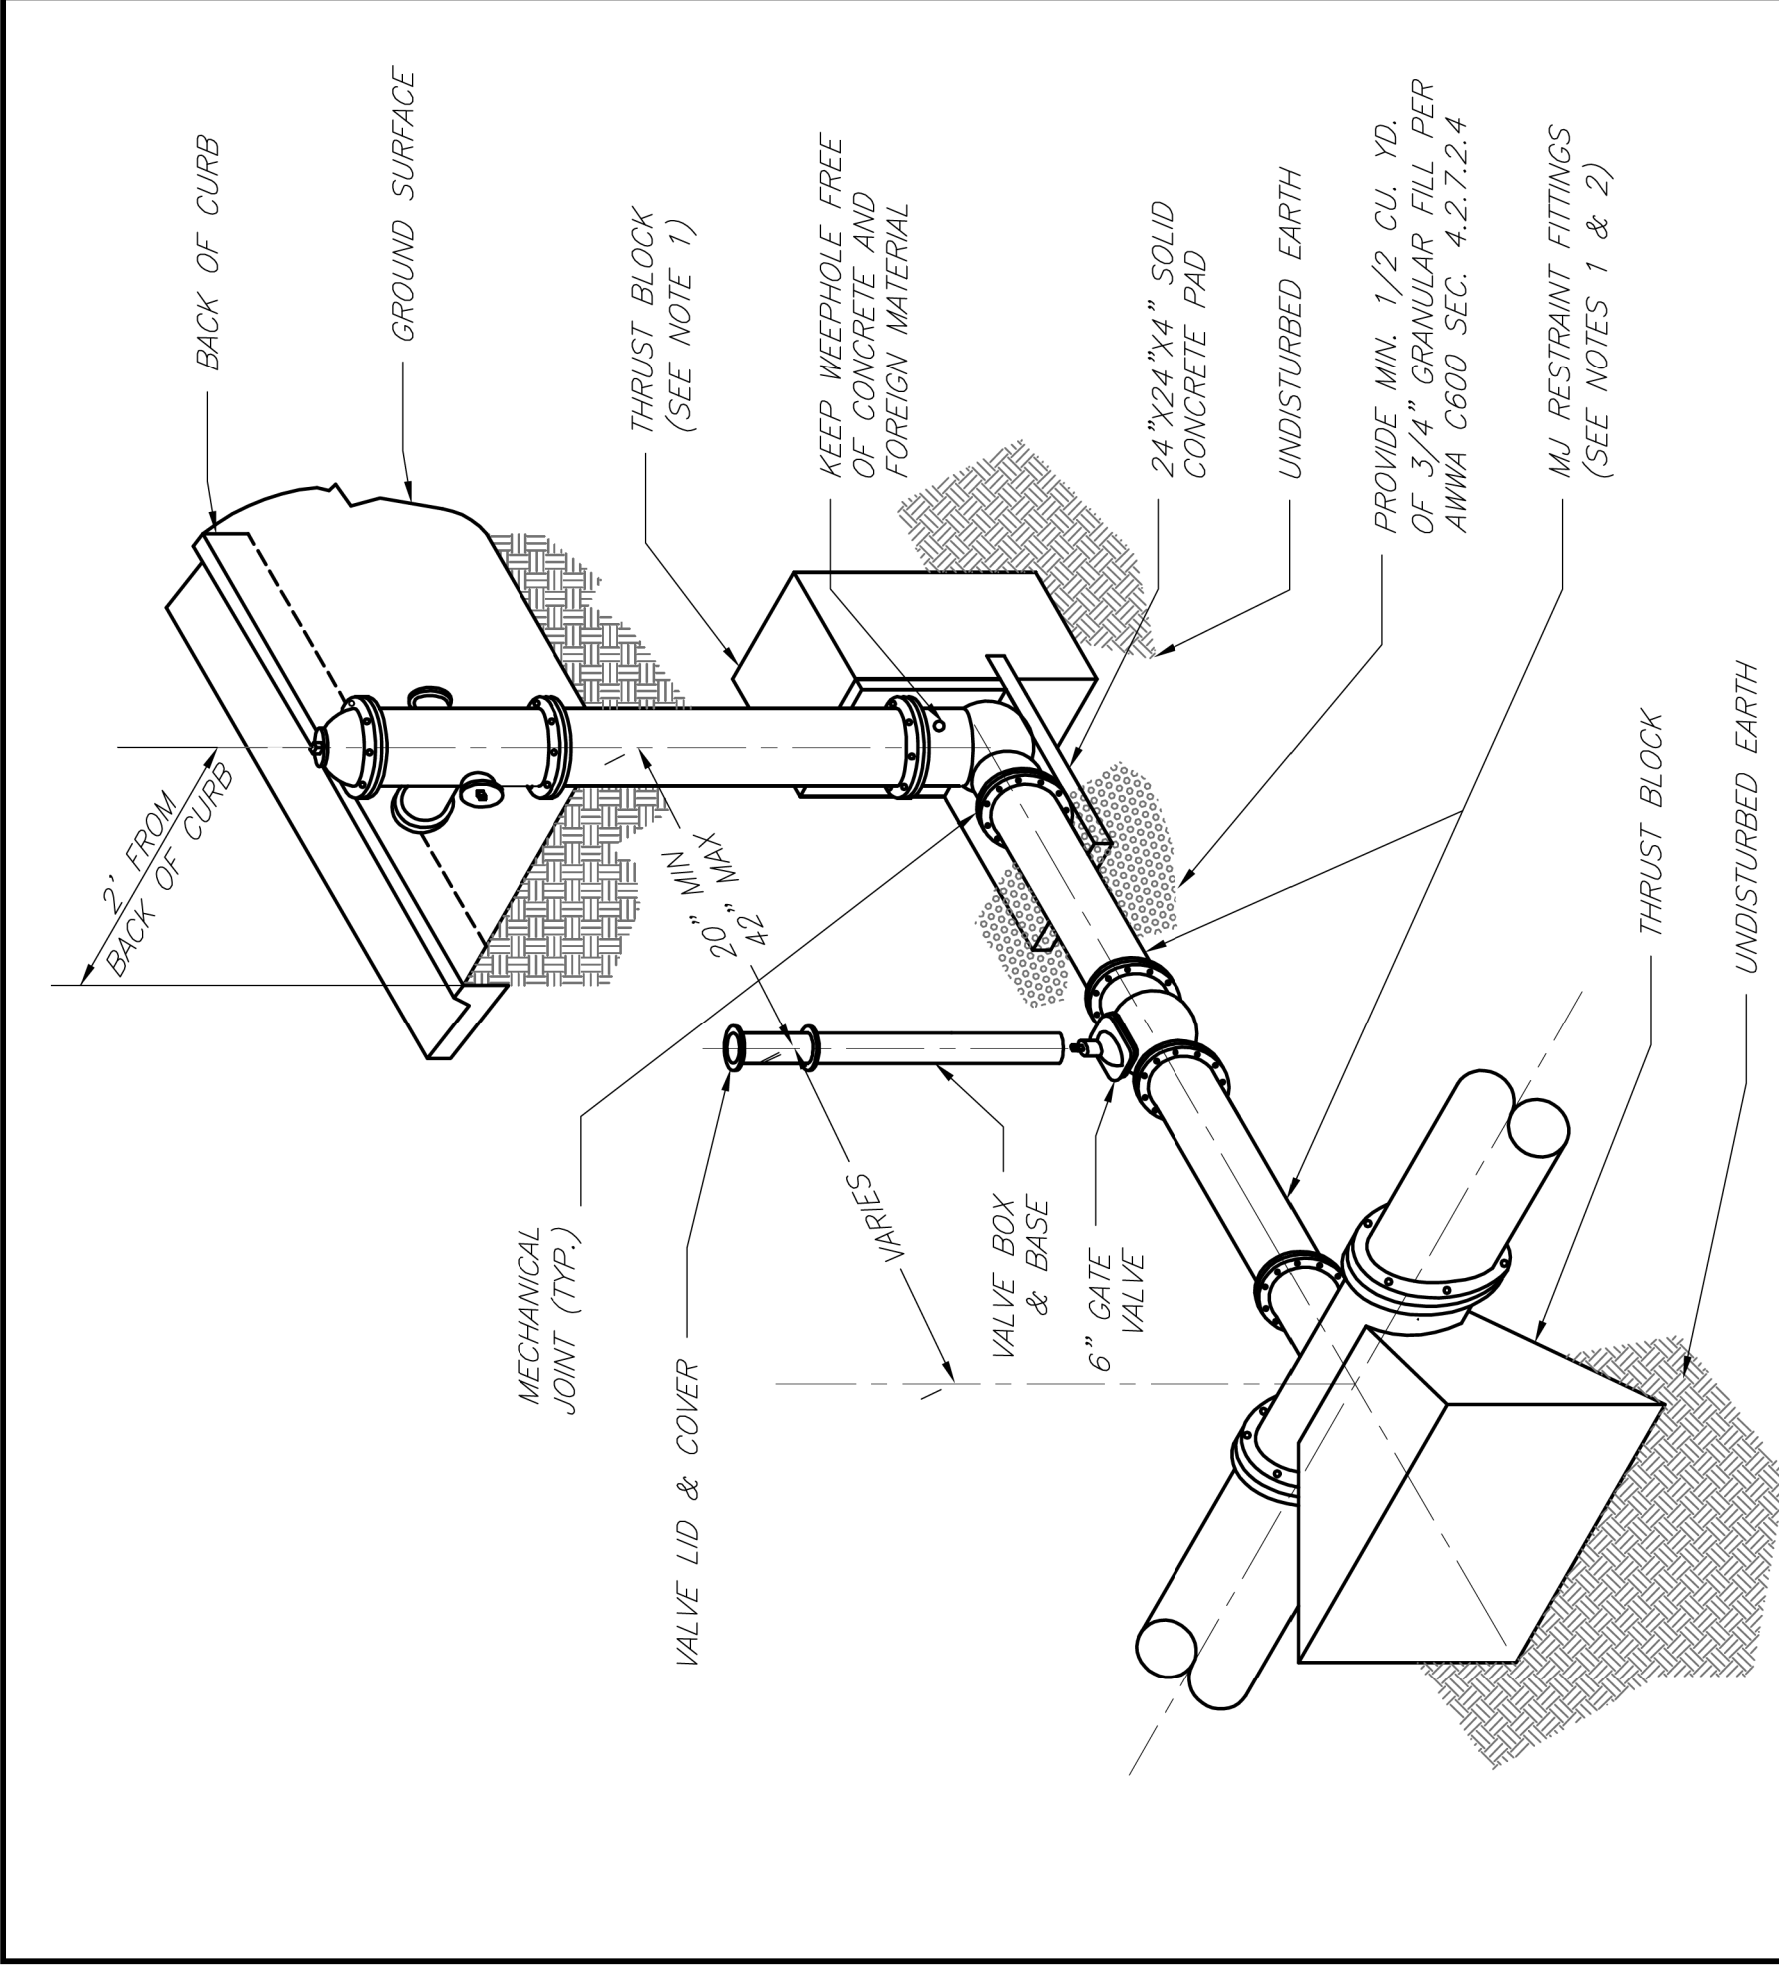


- NOTES:
1. WHEN RETAINER GLANDS ARE USED IN LIEU OF MECHANICAL JOINT (MJ) RESTRAINT FITTINGS, HORIZONTAL THRUST BLOCKS ARE REQUIRED.
 2. GATE VALVE MAY BE BOLTED DIRECTLY TO MJ RESTRAINT TEE.
 3. SEE APPROVED PRODUCTS LIST FOR WATER UTILITIES FOR FIRE HYDRANT, VALVES, VALVE BOX LID, AND COVER.
 4. BOTTOM HYDRANT FLANGE SHALL BE 2" TO 6" ABOVE FINISHED GRADE.
 5. FOR STREETS WITHOUT CURBS FIRE HYDRANTS SHALL BE PLACED WITHIN 1 FOOT OF THE R/W LINE, BUT NOT MORE THAN 10' FROM EDGE OF PAVEMENT. FIRE HYDRANT SHALL NOT BE PLACED IN BOTTOM OF DITCH.
 6. HYDRANT SHALL BE ROTATED AS DIRECTED BY INSPECTOR.

LS

LEE'S SUMMIT
MISSOURI
PUBLIC WORKS ENGINEERING DIVISION | 120 SE GREEN STREET | LEE'S SUMMIT, MO 64063

HYDRANT INSTALLATION - STRAIGHT SET

Date: 02/13
Drawn By: JN
Checked By: DL
FILE: WAT-7
Rev: 1/14
Rev:

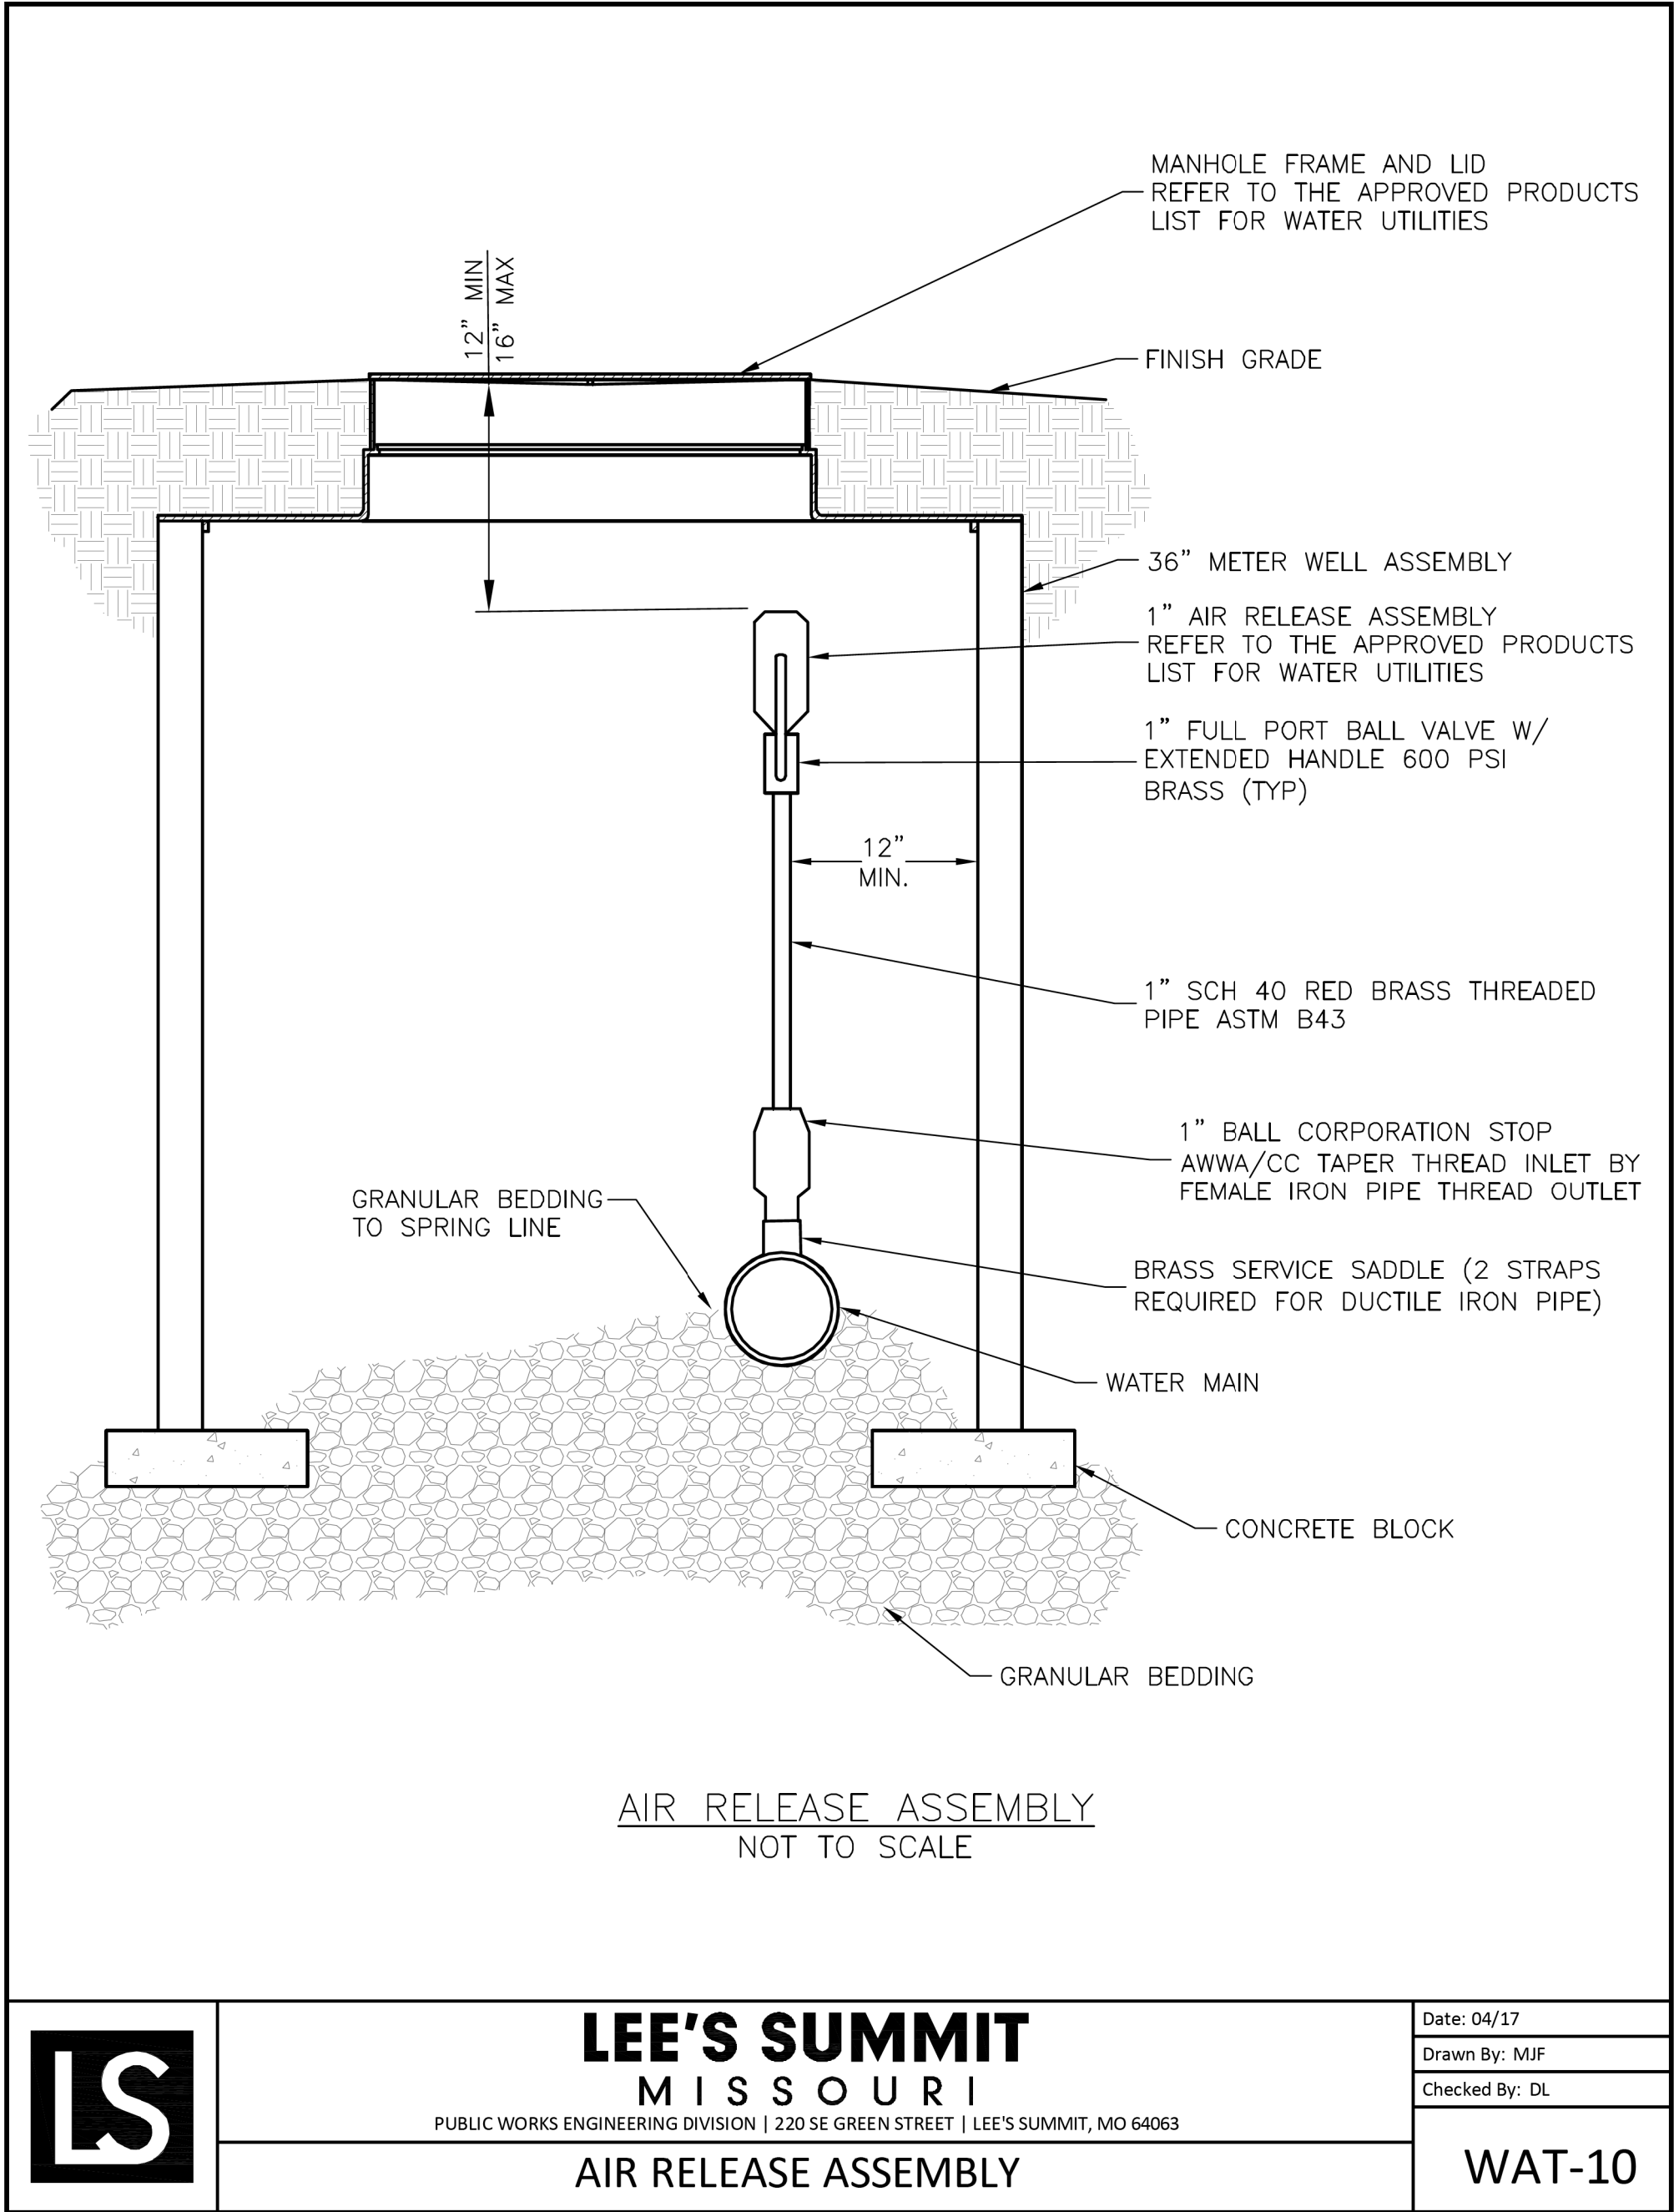

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
05/21/2020

WATER LINE DETAILS	DATE	REVISION	NO.	BY	CHK/APP
		3/26/19			
		3/26/19			
CITY OF LEE'S SUMMIT, JACKSON COUNTY, MISSOURI		3/26/19			
12		12			