


1. ELECTRICAL UTILITY SEE DETAIL 1/E301.
2. FUTURE BUILDING SIGNS MOUNT J-BOX INSIDE BUILDING AND PROVIDE 3/4" MC THROUGH WALL FOR POWER SUPPLY OF FUTURE BUILDING SIGNAGE. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH ARCHITECTURAL ELEVATIONS AND TENANT INFILL DRAWINGS.
3. DRIVE THRU WINDOW MOUNT 36" ON THE INSIDE AFF AND 42" ON THE OUTSIDE MEASURED FROM DRIVE-THRU LANE. COORDINATE LOCATION WITH GENERAL CONTRACTOR PRIOR TO INSTALLATION.
4. HOLIDAY LIGHTING PROVIDE EXTERIOR J-BOX ON ROOF-SIDE FACE OF PARAPET ABOVE ROOF FLASHING WITH 3/4" EMPTY CONDUIT DOWN INSIDE WALL TO CEILING WITH PULL STRING LABELED HOLIDAY LIGHTING.
5. FLY FAN MOUNT BOTTOM OF FIXTURE AT 7'-6" AFF. ROUTE 1/2" C CONDUIT WITH LABELED PULL STRING TO PANEL "SBA". FEEDER TO BE PROVIDED BY TENANT'S GENERAL CONTRACTOR.
6. RTU - FACTORY INSTALLED. FIELD WIRED NON-FUSED DISCONNECT AND GFI. WEATHERPROOF RECEPTACLE.
7. RETRIEVE EXISTING 4" C FOR TELE. SERVICE. EXTEND TO AND CONNECT NEW CONDUIT WITH EXISTING.
8. PATIO FAN VERIFY MOUNTING HEIGHT AND LOCATION WITH TENANT CONSTRUCTION MANAGER PRIOR TO ROUGH-IN.



ELECTRICAL INTERIOR PLAN

SCALE: 1/4" = 1'-0"

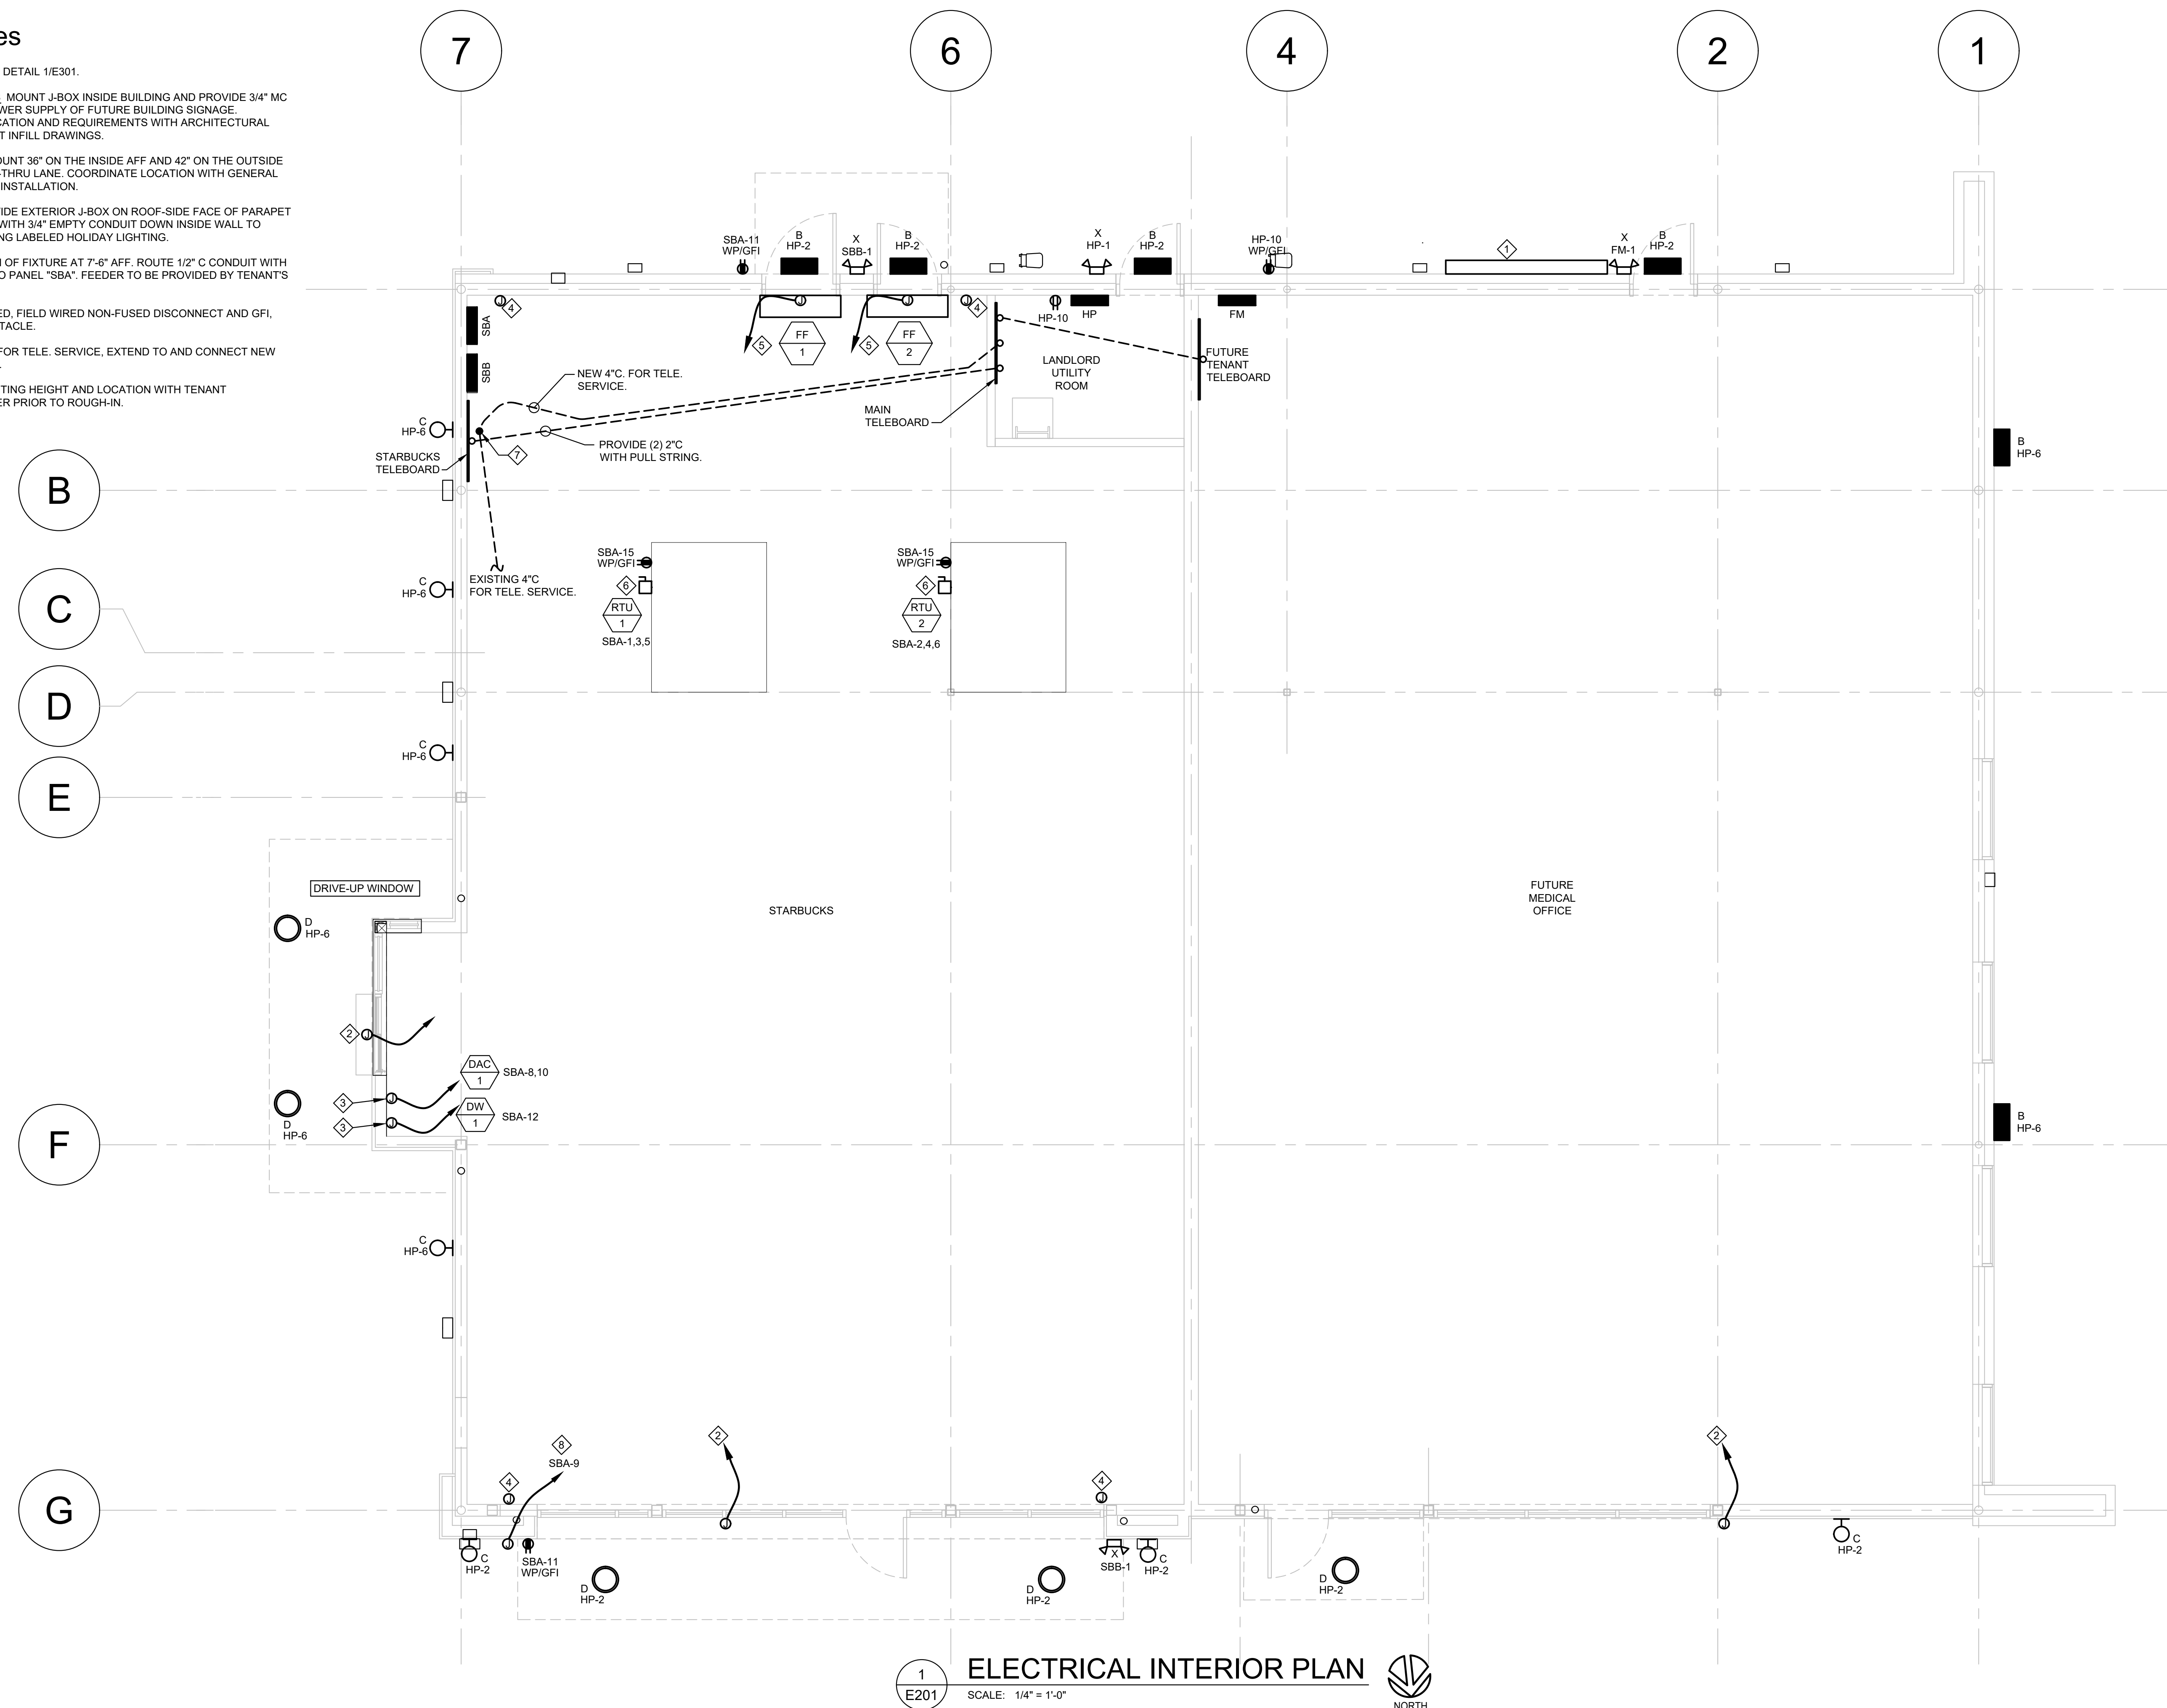

CASCO
12 Sunnen Drive, Suite 100, St. Louis, MO 63143 T: 314.821.1100


MIDLAND

Starbucks & Medical Office

155 S.W. MO-150 HWY
LEE'S SUMMIT, MO 64802

CONSTR. DOC. & REVISIONS		
No.	Description	Date
-	Owner Review	05/12/20
-	Owner Review 2	06/04/20
-		-
-		-
-		-
-		-
-		-

CASCO DIVERSIFIED
CORPORATION PROFESSIONAL
ENGINEERING CERTIFICATE OF
AUTHORITY #000613
EXP. 12/31/21

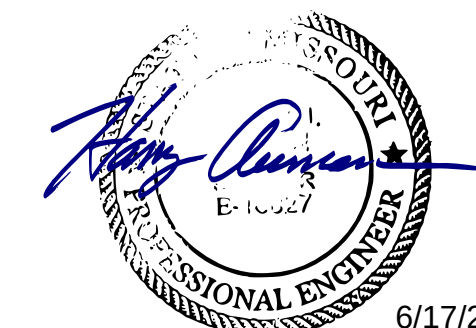

HARRY J. AUMAN
LIC. #E16827
EXP. 12/31/20

Drawn By/Checked By: EAV/DAW

Project Number	320488
----------------	--------

Permit Date	06-17-20
-------------	----------

ELECTRICAL INTERIOR PLAN

E201