
RESIDENTIAL ENGINEERING SERVICES, LLC SHOP DRAWING / SUBMITTAL REVIEW

APPROVED


SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY
AND GENERAL CONFORMANCE TO CONTRACT
DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE
FOR CONFIRING AND CORRELATING DIMENSIONS AT
JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES,
FABRICATION PROCESSES AND
TECHNIQUES OF CONSTRUCTION, COORDINATION OF
HIS OR HER WORK WITH OTHER TRADES AND FULL
COMPLIANCE WITH CONTRACT POCUMENTS.

REVIEWED BY:
RESIDENT AL ENGINEERING SERVICES, LLC

Brad A. Huxol, P.E

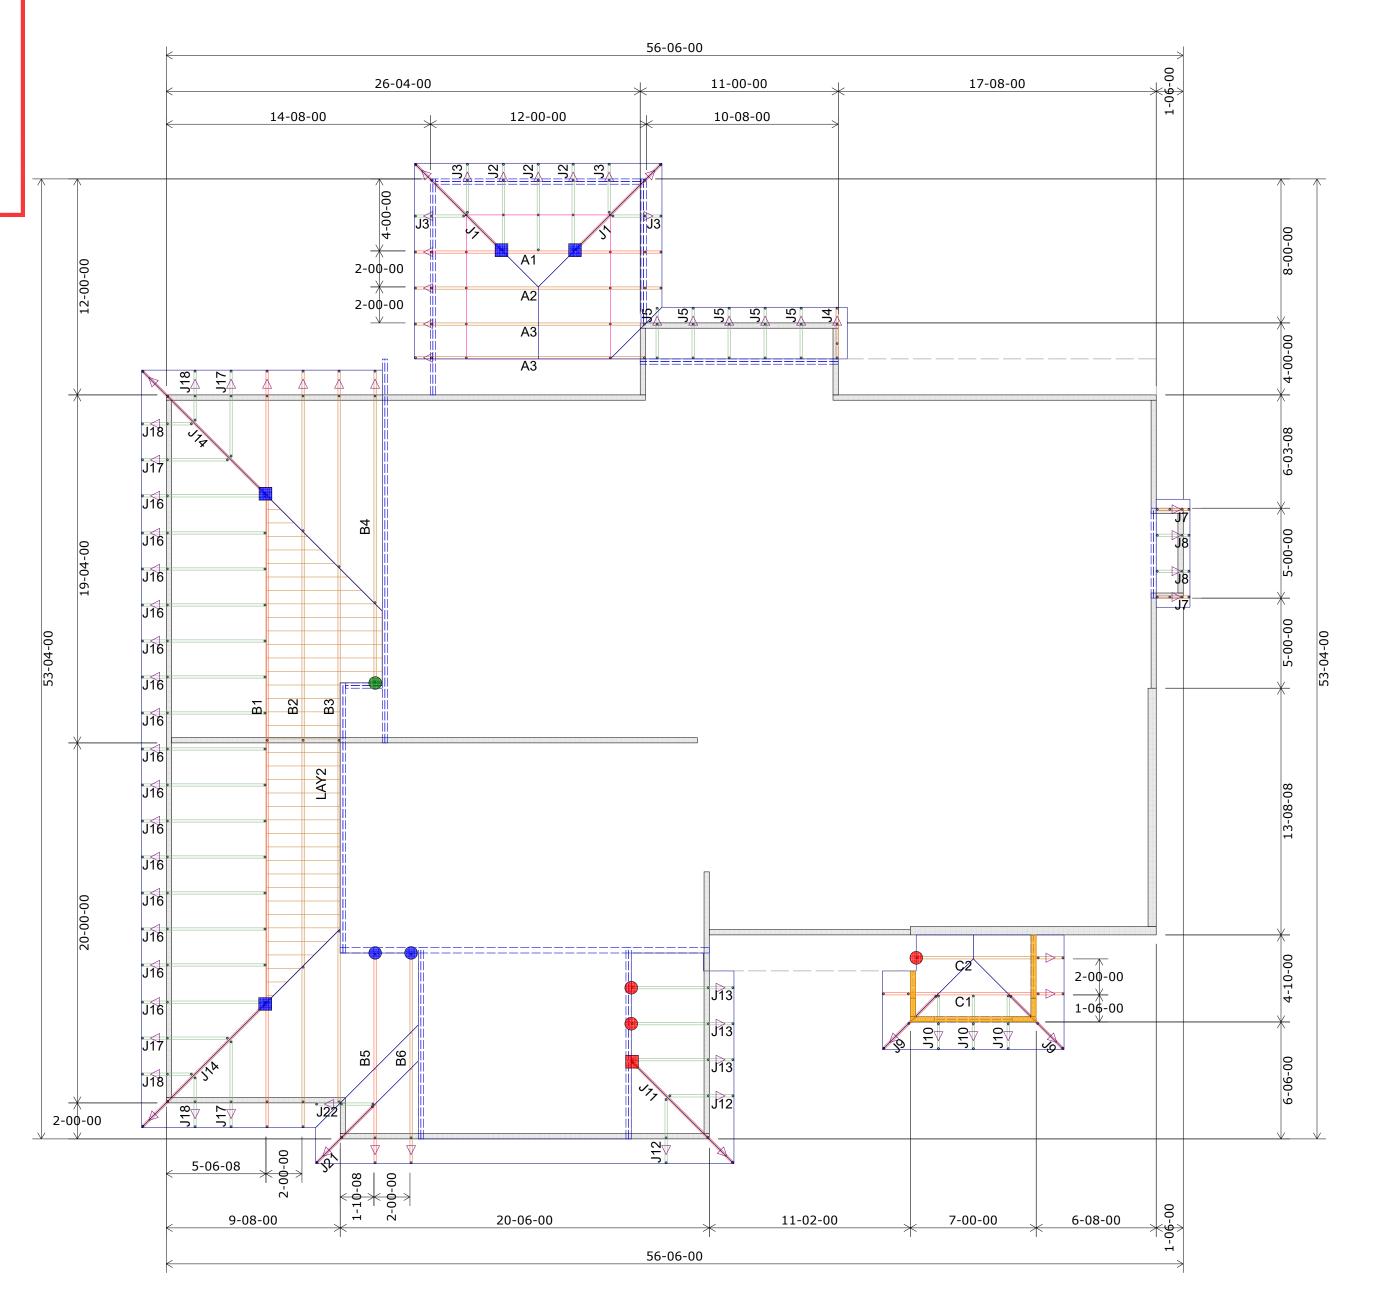

	HANGER SCHEDULE	Quantity						
	LUS24	17						
	LUS26	7						
	HUS26	3				MO		
_	HHUS26-2	2		lge			0	
_	HGUS26-3	1	S	Ric	Dr.		424	
A	HGUS28-3	0	MI	orn	ree		746-	
	LTHJA26	4	HC	ıwt	ar T	ımi	85-7	37(
	TJC37	8	SUMMIT HOMES	Lot 24 Hawthorn Ridge	1513 Sugar Tree Dr.	Lee's Summit	Chance 785-746-4240	Job # 400370
	TJC57	0	JMI	ot 24	113	se's	nanc	# q
_	HTS20	0	S	Γ	15	Le	C	Jo
Triangle denotes the left end of the Truss as it appears on the Engineered Drawings provided.		Customer	Job Name	Job Site Address	ity, State	Designer	6/25/2020	



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the trous and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult "Bracing of wood trusses" available from the Truss Plate Institute, \$83 D'Onifrio Drive; Madison, WI 53179.

Shop Drawing Approval

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871



2nd Floor = 8-1-2 U.N.O.

Plate Heights

9-01-02

13-07-02

Wall Heights: 1st Floor = 9-1-2 U.N.O.

1st Floor Truss Layout

Scale: 3/16" = 1'




APPROVED


SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION PROCESSES AND TECHNIQUES OF CONSTRUCTION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES AND FULL COMPLIANCE WITH CONTRACT POCUMENTS.

RESIDENTIAL ENGINEERING SERVICES, LLC

43-04-00

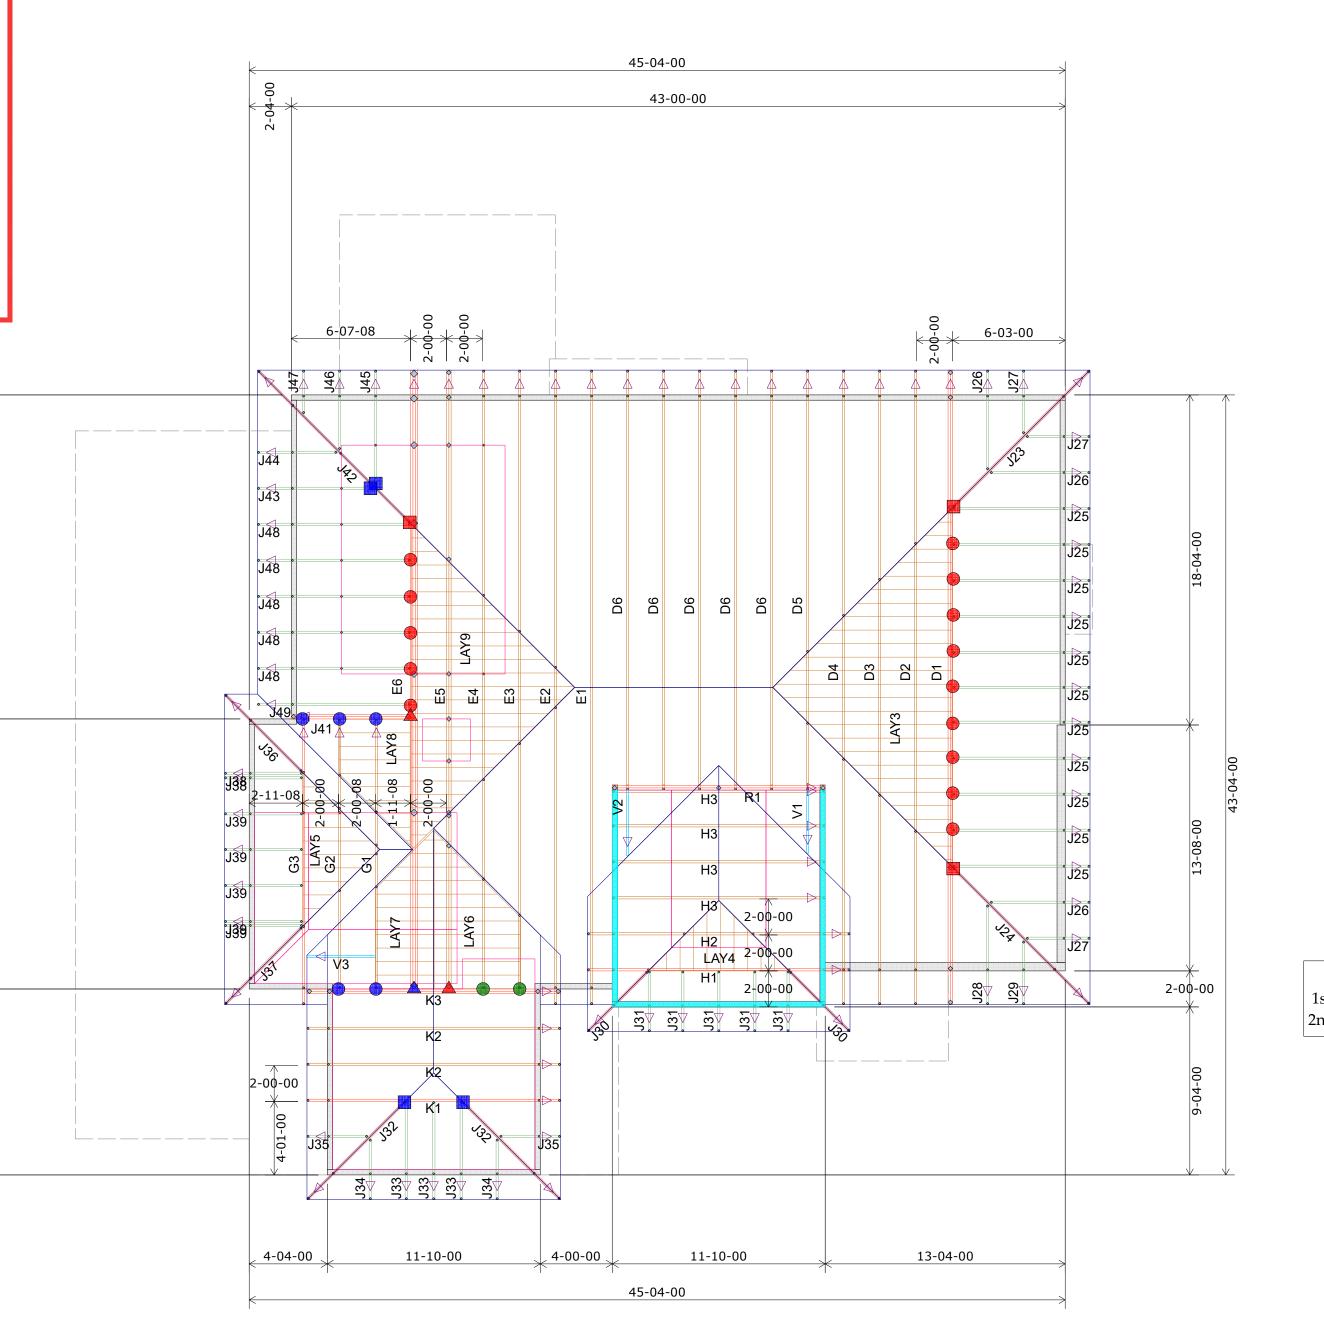

	HANGER SCHEDULE	Quantity							
	LUS24	17	SUMMIT HOMES	Lot 24 Hawthorn Ridge	Sugar Tree Dr.	MO	Chance 785-746-4240)370	
	LUS26	7							
	HUS26	3							
A	HHUS26-2	2							
A	HGUS26-3	1				Summit			
	HGUS28-3	0							
	LTHJA26	4							
	TJC37	8	MIT	t Ha	Sug	Sun	e 7	400	
	TJC57	0	SUMI	Lot 24	1513	ree's	Chanc	Job # 400370	
	HTS20	0							
of	Triangle denotes the left end of the Truss as it appears on the Engineered Drawings				ddress	State			
	provided.			Job Name	Job Site Address	City,	Designer	6/25/2020	



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wall Heights: 1st Floor = 9-1-2 U.N.O. 2nd Floor = 8-1-2 U.N.O.

> Plate Heights 9-01-02 13-07-02

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871



2nd Floor Truss Layout

Scale: 3/16'' = 1'