



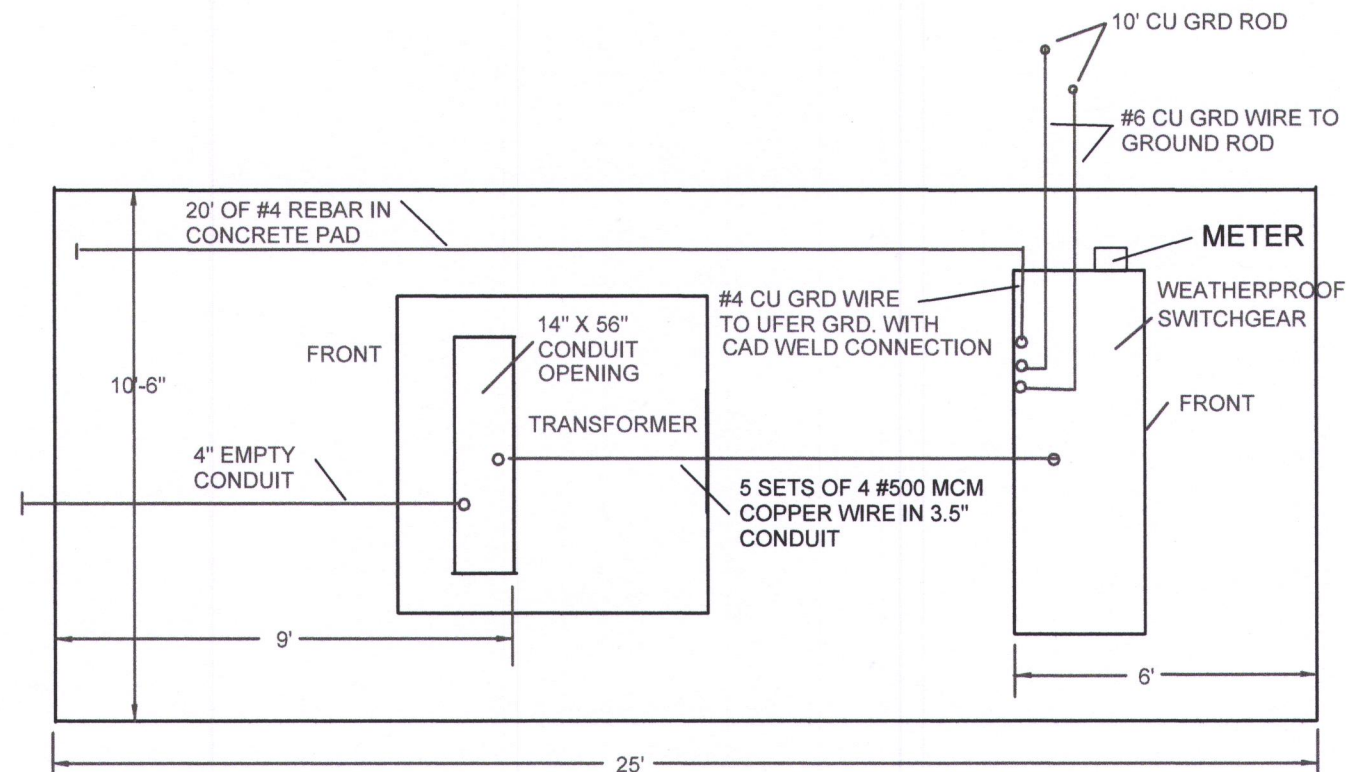

**RELEASE FOR
CONSTRUCTION**
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

07/09/2020

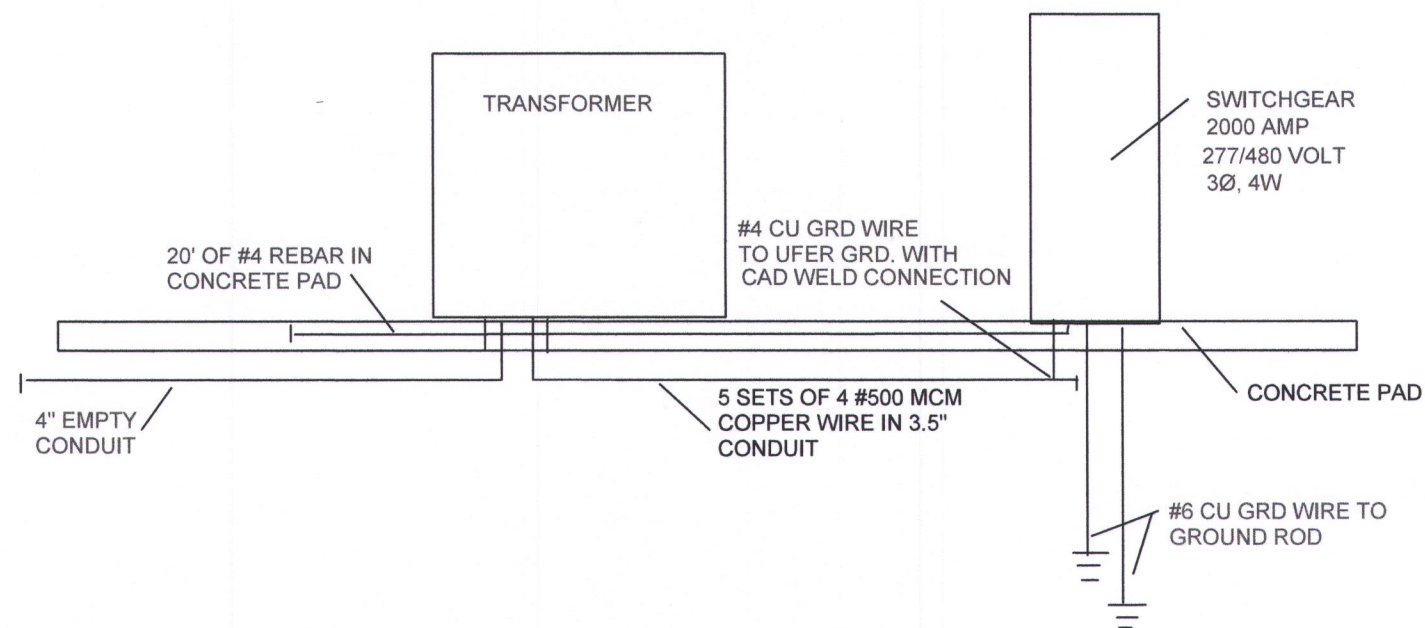

ESTIMATED AVAILABLE FAULT CURRENT
IS 38,807 AMPS.
EQUIPMENT SHALL BE RATED 65,000 AMPS

LS SUPERIOR-BOWEN
TEMPORARY ASPHALT PLANT
2250 NW QUARRY ROAD
LEES SUMMIT, MO.

EPIC ELECTRIC
801 N. CHESTNUT AVE
KANSAS CITY, MO 64120.
816-455-5555

