20300 W 207TH St
Spring Hill, KS 66083

PREMIER
BUILDING SUPPLY OF KANSAS CITY

Phone: 913.686.1812
www.premierbuildingsupply.com

Since 1923

Customer: Cardinal Crest Homes

Job Name: Jackson Residence

Address: 3202 SW Pergola Park Dr

Salesperson: Jim Anderson

Designer:

ROOF LOADING CRITERIA			Scale: 1/4" = 1'
TOP CHORD LIVE LOAD	(TCLL)	30.0 lb/ft²	
TOP CHORD DEAD LOAD	(TCDL)	10.0 lb/ft²	Date: 7/19/2020
BOTTOM CHORD LIVE LOAD	(BCLL)	0.0 lb/ft²	
BOTTOM CHORD DEAD LOAD	(BCDL)	10.0 lb/ft²	
DEFLECTION: (LIVE) 240.000 (TOTAL) 180.000			Job #: P200304
WIND SPEED: 115 mph EXP: B (Suburban Areas)			
BUILDING CODE: IRC2015			

TRUSS PLACEMENT DIAGRAM

ROOF

1 - H2.5T REQUIRED AT ALL BEARING LOCATIONS (u.n.o.)
ALL TRUSS TO TRUSS CONNECTIONS = 'NAILED' (u.n.o.)

1 - H2.5T NECESARIO EN TODO LOS PUNTOS DE APOYO (u.n.o.)
TODAS LAS CONEXIONES DE TRUSS A TRUSS = 'CLAVADAS " (u.n.o.)

TRUSS LAYOUT/SUBMITTAL REVIEW

- [ ] REVIEWED & FOUND TO BE IN CONFORMANCE WITH REFERENCED PLAN
- [ ] FURNISH AS CORRECTED
- [x] REVIEWED WITH CHANGES TO REFERENCED DRAWINGS
- [ ] REVISE AS NOTED & RESUBMIT

THIS REVIEW IS TO VERIFY GENERAL CONFORMANCE WITH THE DESIGN AND INFORMATION CONTAINED IN THE REFERENCED PLAN AND/OR CONSTRUCTION DOCUMENTS. REVIEW DOES NOT RELIEVE THE CONTRACTOR FROM COMPLIANCE WITH THE PLANS AND SPECIFICATIONS. CONTRACTOR IS RESPONSIBLE FOR ALL DIMENSIONS, MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, SAFETY AND COORDINATION OF HIS WORK TO BE PERFORMED.

HD ENGINEERING & DESIGN
11656 W. 75TH ST.,
SHAWNEE, KS 66214
P: 913-631-2222
WWW.HDENGINEERS.COM

SIGNED:

DATE: 07/31/2020

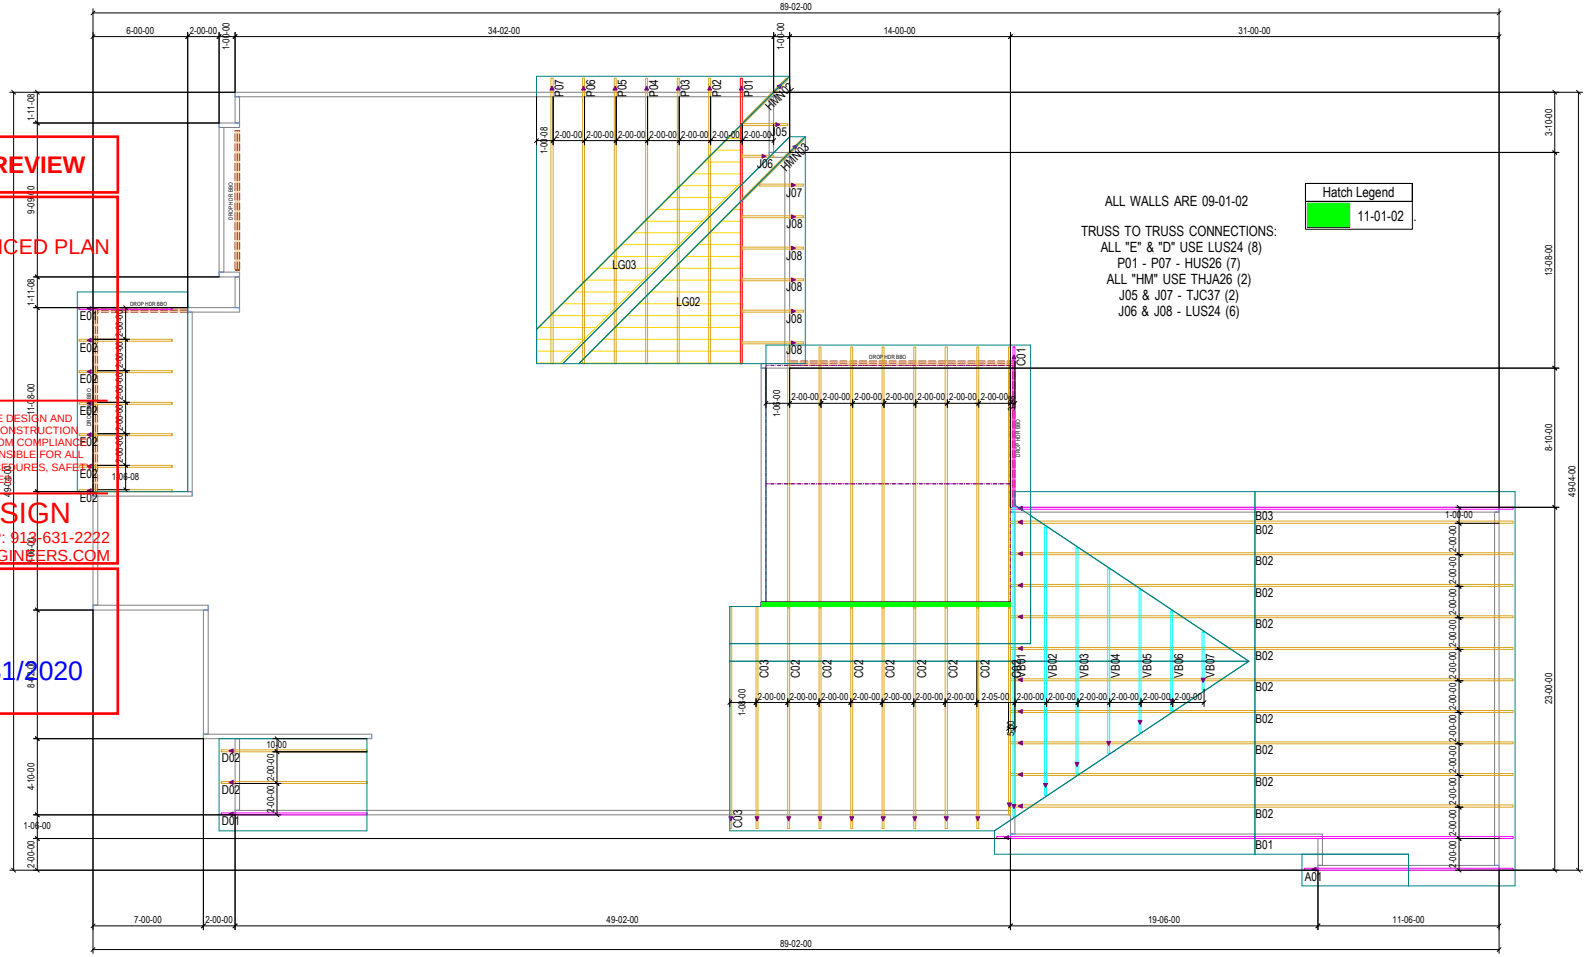

◄ - EL EXTREMO IZQUIERDO DE LOS TRUSSES (VEA LOS PERFILES)

TODAS LAS DIMENSIONES PARA LAS TRUSSES SON DE FUERA DE LA MADERA (u.n.o.)

ESTABLECER LOS TRUSSES NIVELADAS CON LA ESTRUCTURA (u.n.o.)

◄ - LEFT END OF TRUSS (SEE TRUSS PROFILES)

ALL ROOF TRUSS DIMENSIONS ARE FROM OUTSIDE EDGE OF STUD (u.n.o.)

SET ROOF TRUSSES FLUSH WITH FRAMING (u.n.o.)

WARNING: Trusses must be handled with care to prevent damage and injury.

This truss placement diagram is to be used only as an installation aid; it is not a structural diagram. These trusses are designed as individual building components to be incorporated into the building design at the the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing.

Professional advice should be sought regarding handling, installation, temporary and permanent bracing before erecting trusses. Temporary and permanent bracing is required during installation of trusses to prevent possible collapse.

For general guidance regarding bracing, consult "BCSI-08" available jointly from WTCA & TPI.

Premier Building Supply must be notified of any issues requiring a back charge prior to any work being done. Premier Building Supply reserves the right to use it's service staff in lieu of being back charged.

Kim Brennan

Digitally signed by Kim Brennan
Reason: Release for Construction
Date: 2020.08.04 10:26:56-05'00'

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

08/04/2020

20300 W 207TH St.
Spring Hill, KS 66083

PREMIER
BUILDING SUPPLY OF KANSAS CITY

Phone: 913.686.1812
www.premierbuildingsupply.com

Since 1923

Customer: Cardinal Crest Homes	
Job Name: Jackson Residence	
Address: 3202 SW Pergola Park Dr	
Salesperson: Jim Anderson	
Designer:	
ROOF LOADING CRITERIA	Scale: 1/4" = 1'
TOP CHORD LIVE LOAD (TCLL) 30.0 lb/ft²	
TOP CHORD DEAD LOAD (TCDL) 10.0 lb/ft²	
BOTTOM CHORD LIVE LOAD (BCLL) 0.0 lb/ft²	Date: 7/15/2020
BOTTOM CHORD DEAD LOAD (BCDL) 10.0 lb/ft²	
DEFLECTION: (LIVE) 240.000 (TOTAL) 180.000	Job #:
WIND SPEED: 115 mph EXP: B (Suburban Areas)	P200304
BUILDING CODE: IRC2015	
TRUSS PLACEMENT DIAGRAM	
ROOF	

1 - H2.5T REQUIRED AT ALL BEARING LOCATIONS (u.n.o.)
ALL TRUSS TO TRUSS CONNECTIONS = 'NAILED' (u.n.o.)

1 - H2.5T NECESARIO EN TODO LOS PUNTOS DE APOYO (u.n.o.)
TODAS LAS CONEXIONES DE TRUSS A TRUSS = 'CLAVADAS " (u.n.o.)

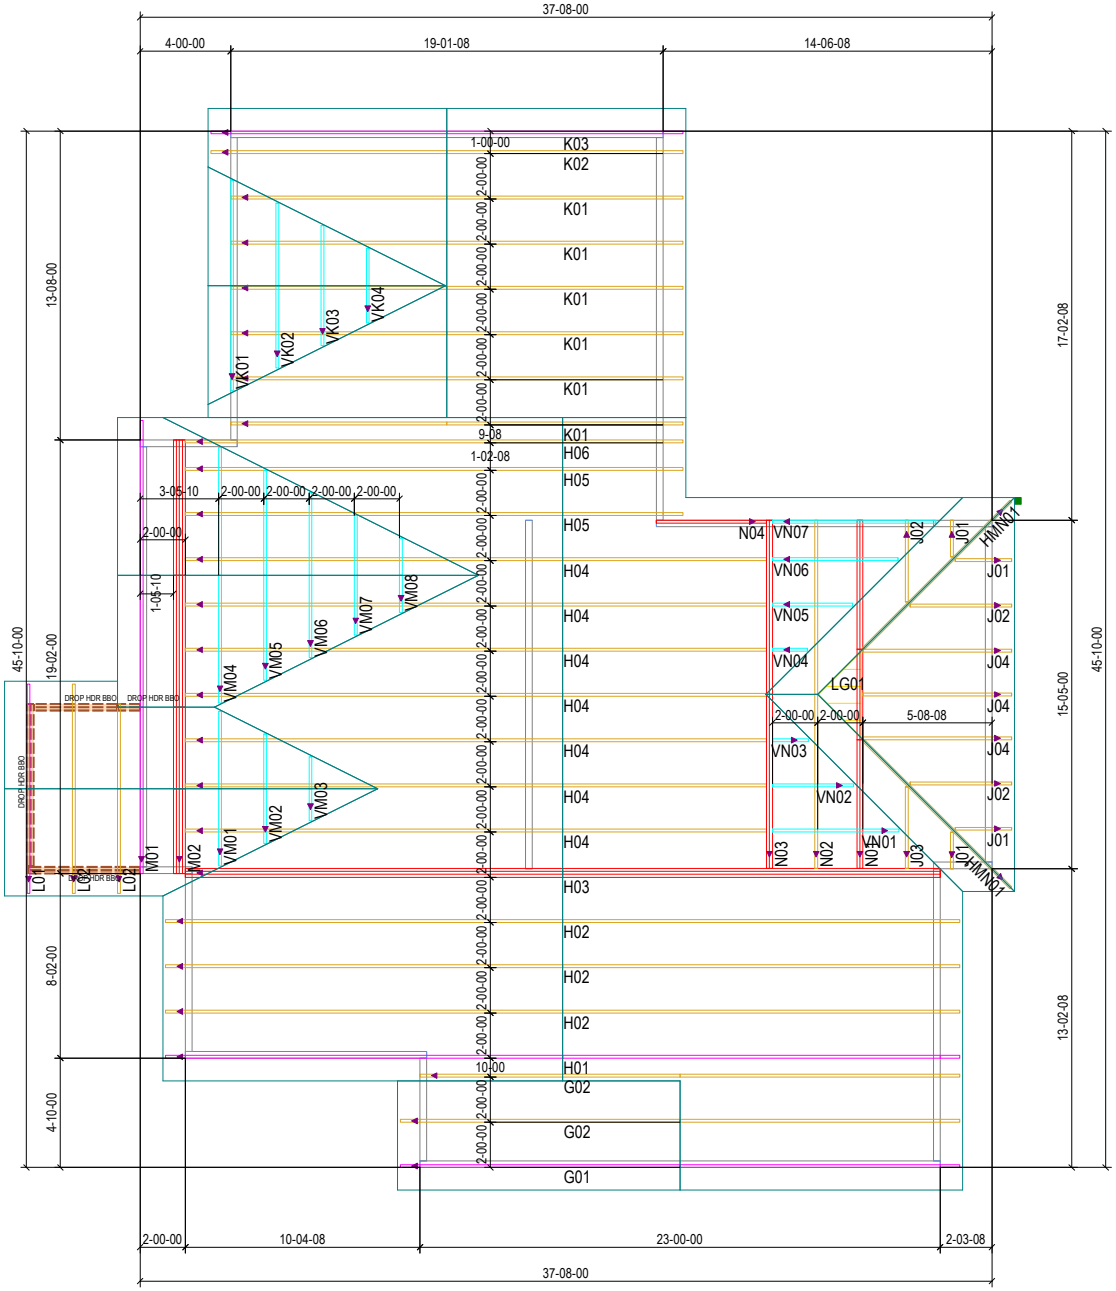

TRUSS TO TRUSS CONNECTIONS:
H04 - H06 - HUS26 (16)
J01, J02 - TJC37 (8)
J04 - LUS24 (3)
HM -THJA26 (2)
N01 & N03 - HGUS210-2 (2)
N02 - HUS26 (1)

TRUSS LAYOUT/SUBMITTAL REVIEW

- [ ] REVIEWED & FOUND TO BE IN CONFORMANCE WITH REFERENCED PLAN
- [ ] FURNISH AS CORRECTED
- [x] REVIEWED WITH CHANGES TO REFERENCED DRAWINGS
- [ ] REVISE AS NOTED & RESUBMIT

THIS REVIEW IS TO VERIFY GENERAL CONFORMANCE WITH THE DESIGN AND INFORMATION CONTAINED IN THE REFERENCED PLAN AND/OR CONSTRUCTION DOCUMENTS. REVIEW DOES NOT RELIEVE THE CONTRACTOR FROM COMPLIANCE WITH THE PLANS AND SPECIFICATIONS. CONTRACTOR IS RESPONSIBLE FOR ALL DIMENSIONS, MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, SAFETY AND COORDINATION OF HIS WORK TO BE PERFORMED.

HD ENGINEERING & DESIGN
11656 W. 75TH ST.,
SHAWNEE, KS 66214
P: 913-631-2222
WWW.HDENGINEERS.COM

SIGNED:

07/31/2020
DATE:

◀ - EL EXTREMO IZQUIERDO DE LOS TRUSSES (VEA LOS PERFILES)

TODAS LAS DIMENSIONES PARA LAS TRUSSES SON DE FUERA DE LA MADERA (u.n.o.)

ESTABLECER LOS TRUSSES NIVELADAS CON LA ESTRUCTURA (u.n.o.)

◀ - LEFT END OF TRUSS (SEE TRUSS PROFILES)

ALL ROOF TRUSS DIMENSIONS ARE FROM OUTSIDE EDGE OF STUD (u.n.o.)

SET ROOF TRUSSES FLUSH WITH FRAMING (u.n.o.)

WARNING: Trusses must be handled with care to prevent damage and injury.

This truss placement diagram is to be used only as an installation aid; it is not a structural diagram. These trusses are designed as individual building components to be incorporated into the building design at the the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing.

Professional advice should be sought regarding handling, installation, temporary and permanent bracing before erecting trusses. Temporary and permanent bracing is required during installation of trusses to prevent possible collapse.

For general guidance regarding bracing, consult "BCSI-08" available jointly from WTCA & TPI.

Premier Building Supply must be notified of any issues requiring a back charge prior to any work being done. Premier Building Supply reserves the right to use it's service staff in lieu of being back charged.

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

08/04/2020

20300 W 207TH St
Spring Hill, KS 66083

PREMIER
BUILDING SUPPLY OF KANSAS CITY

Phone: 913.686.1812
www.premierbuildingsupply.com

Since 1923

Customer:
Cardinal Crest Homes

Job Name:
Jackson Residence

Address:
3202 SW Pergola Park Dr

Salesperson:
Jim Anderson

Designer:

ROOF LOADING CRITERIA		
TOP CHORD LIVE LOAD	(TCLL)	30.0 lb/ft²
TOP CHORD DEAD LOAD	(TCDL)	10.0 lb/ft²
BOTTOM CHORD LIVE LOAD	(BCLL)	0.0 lb/ft²
BOTTOM CHORD DEAD LOAD	(BCDL)	10.0 lb/ft²

DEFLECTION: (LIVE) 240.000 (TOTAL) 180.000
WIND SPEED: 115 mph EXP: B (Suburban Areas)
BUILDING CODE: IRC2015

Scale: 1/4" = 1'

Date: 7/19/2020

Job #: P200304

TRUSS PLACEMENT DIAGRAM

ROOF

1 - H2.5T REQUIRED AT ALL BEARING LOCATIONS (u.n.o.)
ALL TRUSS TO TRUSS CONNECTIONS = 'NAILED' (u.n.o.)

1 - H2.5T NECESARIO EN TODO LOS PUNTOS DE APOYO (u.n.o.)
TODAS LAS CONEXIONES DE TRUSS A TRUSS = 'CLAVADAS " (u.n.o.)

TRUSS LAYOUT/SUBMITTAL REVIEW

- [ ] REVIEWED & FOUND TO BE IN CONFORMANCE WITH REFERENCED PLAN
- [ ] FURNISH AS CORRECTED
- [x] REVIEWED WITH CHANGES TO REFERENCED DRAWINGS
- [ ] REVISE AS NOTED & RESUBMIT

THIS REVIEW IS TO VERIFY GENERAL CONFORMANCE WITH THE DESIGN AND INFORMATION CONTAINED IN THE REFERENCED PLAN AND/OR CONSTRUCTION DOCUMENTS. REVIEW DOES NOT RELIEVE THE CONTRACTOR FROM COMPLIANCE WITH THE PLANS AND SPECIFICATIONS. CONTRACTOR IS RESPONSIBLE FOR ALL DIMENSIONS, MEANS, METHODS, TECHNIQUES, SEQUENCES, PROCEDURES, SAFETY AND COORDINATION OF HIS WORK TO BE PERFORMED.

HD ENGINEERING & DESIGN
11656 W. 75TH ST.,
SHAWNEE, KS 66214
P: 913-631-2222
WWW.HDENGINEERS.COM

SIGNED:

07/31/2020
DATE:

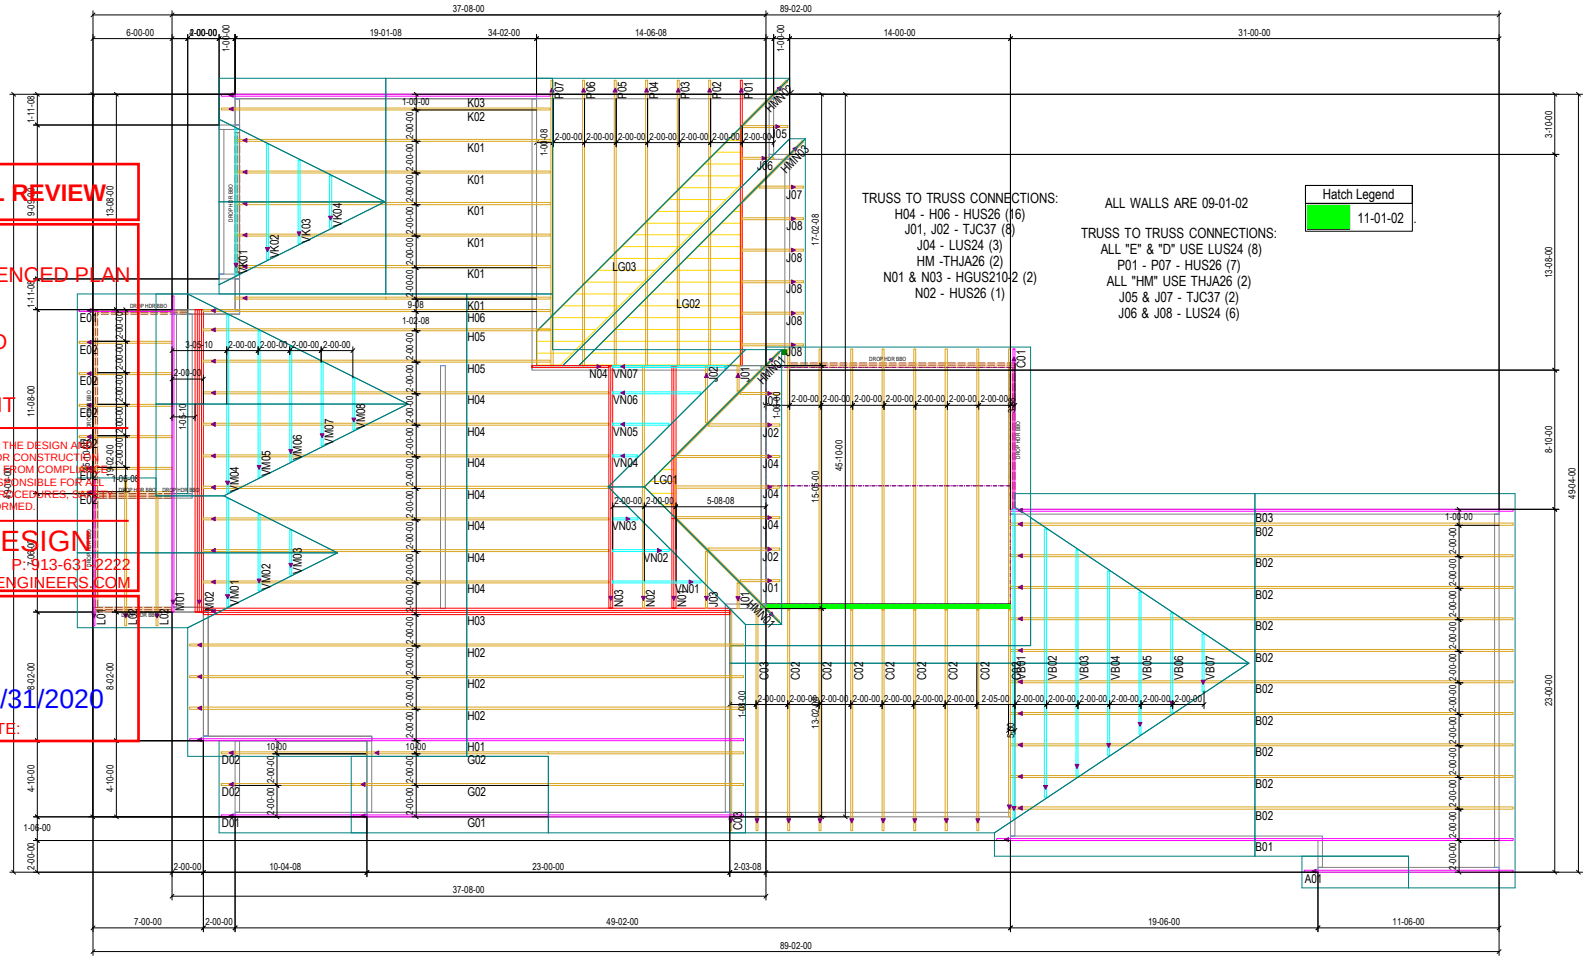

◀ - EL EXTREMO IZQUIERDO DE LOS TRUSSES (VEA LOS PERFILES)

TODAS LAS DIMENSIONES PARA LAS TRUSSES SON DE FUERA DE LA MADERA (u.n.o.)

ESTABLECER LOS TRUSSES NIVELADAS CON LA ESTRUCTURA (u.n.o.)

◀ - LEFT END OF TRUSS (SEE TRUSS PROFILES)

ALL ROOF TRUSS DIMENSIONS ARE FROM OUTSIDE EDGE OF STUD (u.n.o.)

SET ROOF TRUSSES FLUSH WITH FRAMING (u.n.o.)

WARNING: Trusses must be handled with care to prevent damage and injury.

This truss placement diagram is to be used only as an installation aid; it is not a structural diagram. These trusses are designed as individual building components to be incorporated into the building design at the the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing.

Professional advice should be sought regarding handling, installation, temporary and permanent bracing before erecting trusses. Temporary and permanent bracing is required during installation of trusses to prevent possible collapse.

For general guidance regarding bracing, consult "BCSI-08" available jointly from WTCA & TPI.

Premier Building Supply must be notified of any issues requiring a back charge prior to any work being done. Premier Building Supply reserves the right to use it's service staff in lieu of being back charged.

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

08/04/2020