


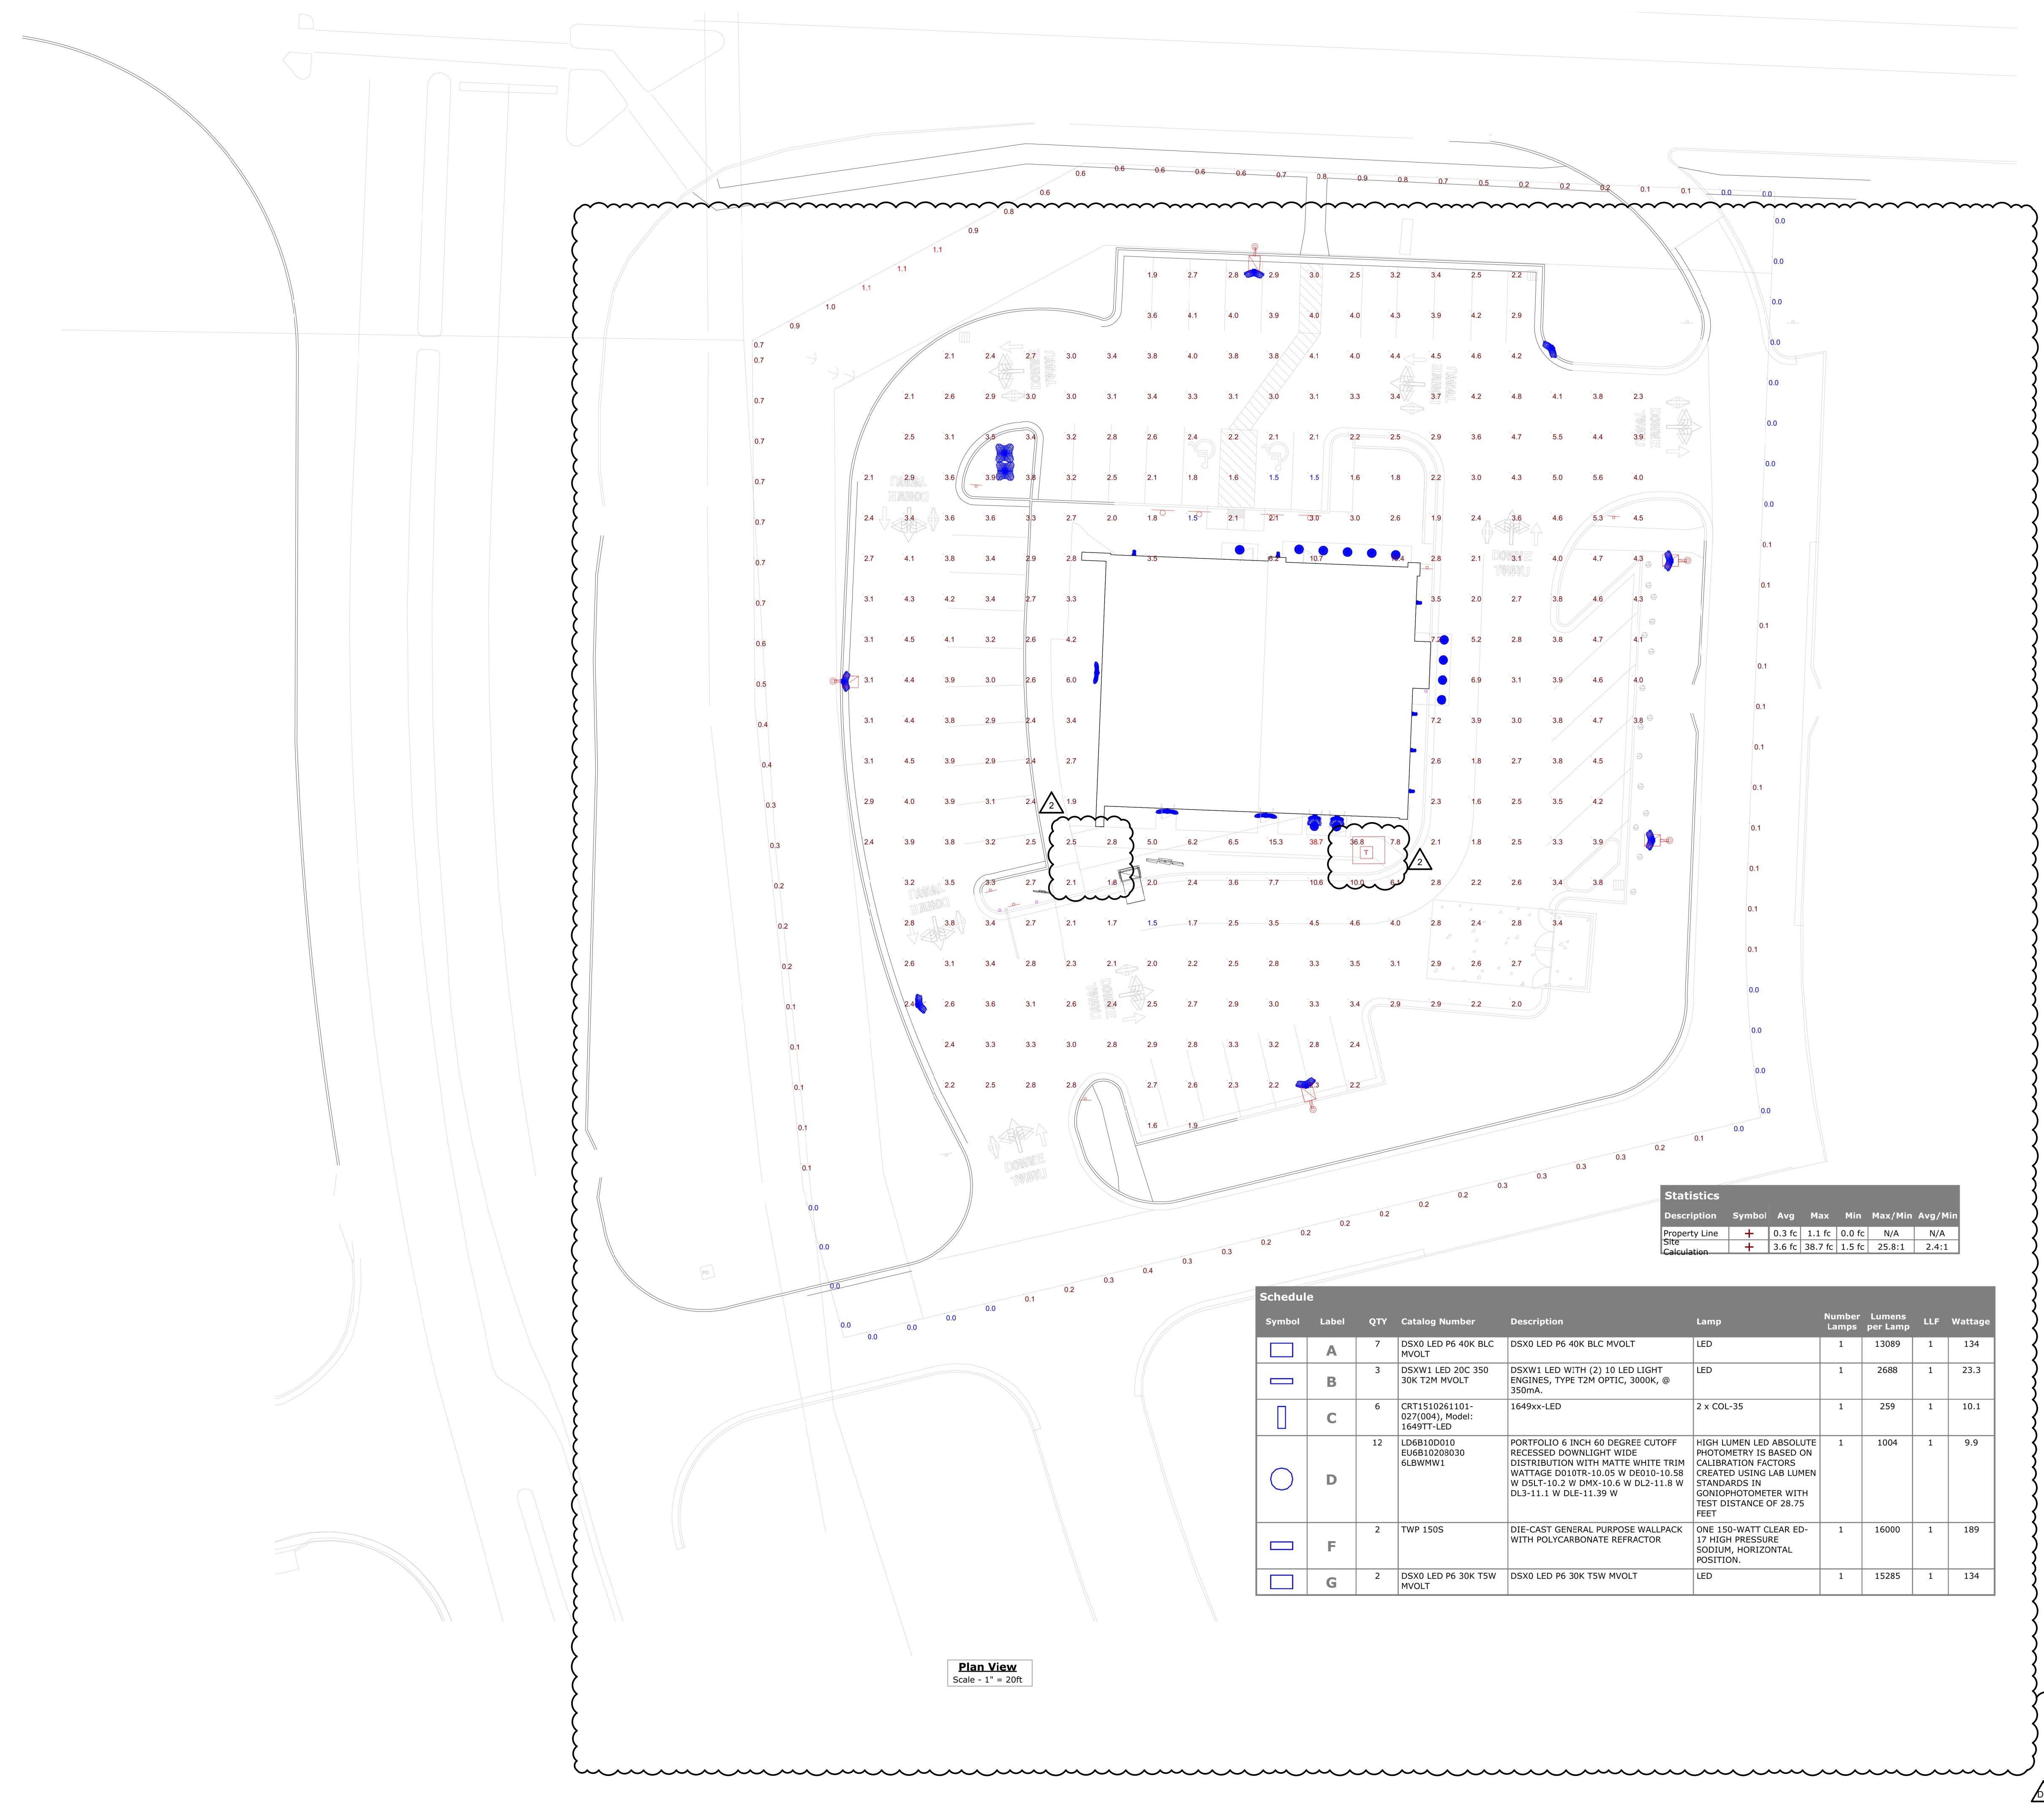

Statistics							
Description	Symbol	Avg	Max	Min	Max/Min	Avg/Min	
Property Line	+	0.3 fc	1.1 fc	0.0 fc	N/A	N/A	
Site	+	3.6 fc	38.7 fc	1.5 fc	25.8:1	2.4:1	
Calculation							

Schedule									
Symbol	Label	QTY	Catalog Number	Description	Lamp	Number Lamps	Lumens per Lamp	LLF	Wattage
	A	7	DSX0 LED P6 40K BLC MVOLT	DSX0 LED P6 40K BLC MVOLT	LED	1	13089	1	134
	B	3	DSXW1 LED 20C 350 30K T2M MVOLT	DSXW1 LED WITH (2) 10 LED LIGHT ENGINES, TYPE T2M OPTIC, 3000K, @ 350mA.	LED	1	2688	1	23.3
	C	6	CRT1510261101-027(004), Model: 1649TT-LED	1649xx-LED	2 x COL-35	1	259	1	10.1
	D	12	LD6B10D010 EU6B10208030 6LBWWW1	PORTFOLIO 6 INCH 60 DEGREE CUTOFF RECESSED DOWNLIGHT WIDE DISTRIBUTION WITH MATTE WHITE TRIM WATTAGE D010TR-10.05 W D010-10.58 W D5LT-10.2 W DMX-10.6 W DL2-11.8 W DL3-11.1 W DLE-11.39 W	HIGH LUMEN LED ABSOLUTE PHOTOMETRY IS BASED ON CALIBRATION FACTORS CREATED USING LAB LUMEN STANDARDS IN GONIOPHOTOMETER WITH TEST DISTANCE OF 28.75 FEET	1	1004	1	9.9
	F	2	TWP 150S	DIE-CAST GENERAL PURPOSE WALLPACK WITH POLYCARBONATE REFRACTOR	ONE 150-WATT CLEAR ED-17 HIGH PRESSURE SODIUM, HORIZONTAL POSITION.	1	16000	1	189
	G	2	DSX0 LED P6 30K TSW MVOLT	DSX0 LED P6 30K TSW MVOLT	LED	1	15285	1	134

CASCO

12 Summit Drive, Suite 100, St. Louis, MO 63143 T: 314.821.1100

MIDLAND

CONSTRUCTION

Starbucks & Medical Office

155 S.W. MO-150 HWY

LEE'S SUMMIT, MO 64802

CONSTR. DOC. & REVISIONS

No.	Description	Date
1	Owner Review	05/12/20
2	Owner Review 2	06/04/20
3	DEVELOPMENT PLAN RESPONSE	06/17/20
4	Owner Review 3	07/20/20
5	Owner Review 4	08/20/20
6	Owner Review 5	08/20/20
7	Owner Review 6	08/20/20

CASCO DIVERSIFIED

CORPORATION PROFESSIONAL

ENGINEERING CERTIFICATE OF

AUTHORITY #000613

EXP. 12/31/21

STATE OF MISSOURI

HARRY J. AUMAN

NUMBER E-16827

08/20/20

HARRY J. AUMAN

LIC. #E16827

EXP. 12/31/21

Drawn By/Checked By: EAV/DAW

Project Number 320488

Permit Date 06-17-20

SITE

PHOTOMETRICS

E102