



RE: 400640
Lot 27 H4

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2018/TPI2014

Design Program: MiTek 20/20 8.4

Wind Code: N/A

Wind Speed: 115 mph


Roof Load: 45.0 psf

Floor Load: N/A psf

This package includes 42 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I42923357	A1	9/28/2020	27	I42923383	J4	9/28/2020
2	I42923358	A2	9/28/2020	28	I42923384	J5	9/28/2020
3	I42923359	B1	9/28/2020	29	I42923385	R1	9/28/2020
4	I42923360	B2	9/28/2020	30	I42923386	V1	9/28/2020
5	I42923361	C1	9/28/2020	31	I42923387	V2	9/28/2020
6	I42923362	C2	9/28/2020	32	I42923388	V3	9/28/2020
7	I42923363	D1	9/28/2020	33	I42923389	V4	9/28/2020
8	I42923364	D2	9/28/2020	34	I42923390	V5	9/28/2020
9	I42923365	E1	9/28/2020	35	I42923391	V6	9/28/2020
10	I42923366	E2	9/28/2020	36	I42923392	V7	9/28/2020
11	I42923367	E3	9/28/2020	37	I42923393	V8	9/28/2020
12	I42923368	G1	9/28/2020	38	I42923394	V9	9/28/2020
13	I42923369	G2	9/28/2020	39	I42923395	V10	9/28/2020
14	I42923370	G3	9/28/2020	40	I42923396	V11	9/28/2020
15	I42923371	H1	9/28/2020	41	I42923397	V12	9/28/2020
16	I42923372	H2	9/28/2020	42	I42923398	V13	9/28/2020
17	I42923373	H3	9/28/2020				
18	I42923374	H4	9/28/2020				
19	I42923375	H5	9/28/2020				
20	I42923376	H6	9/28/2020				
21	I42923377	H7	9/28/2020				
22	I42923378	H8	9/28/2020				
23	I42923379	H9	9/28/2020				
24	I42923380	J1	9/28/2020				
25	I42923381	J2	9/28/2020				
26	I42923382	J3	9/28/2020				

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision
based on the parameters provided by Wheeler - Waverly.
Truss Design Engineer's Name: Garcia, Juan
My license renewal date for the state of Kansas is April 30, 2022.
Kansas COA: E-943

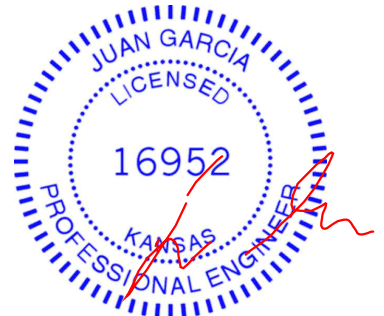

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



RE: 400640
Lot 27 H4

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2018/TPI2014

Design Program: MiTek 20/20 8.4

Wind Code: N/A

Wind Speed: 115 mph


Roof Load: 45.0 psf

Floor Load: N/A psf

This package includes 42 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I42923357	A1	9/28/2020	27	I42923383	J4	9/28/2020
2	I42923358	A2	9/28/2020	28	I42923384	J5	9/28/2020
3	I42923359	B1	9/28/2020	29	I42923385	R1	9/28/2020
4	I42923360	B2	9/28/2020	30	I42923386	V1	9/28/2020
5	I42923361	C1	9/28/2020	31	I42923387	V2	9/28/2020
6	I42923362	C2	9/28/2020	32	I42923388	V3	9/28/2020
7	I42923363	D1	9/28/2020	33	I42923389	V4	9/28/2020
8	I42923364	D2	9/28/2020	34	I42923390	V5	9/28/2020
9	I42923365	E1	9/28/2020	35	I42923391	V6	9/28/2020
10	I42923366	E2	9/28/2020	36	I42923392	V7	9/28/2020
11	I42923367	E3	9/28/2020	37	I42923393	V8	9/28/2020
12	I42923368	G1	9/28/2020	38	I42923394	V9	9/28/2020
13	I42923369	G2	9/28/2020	39	I42923395	V10	9/28/2020
14	I42923370	G3	9/28/2020	40	I42923396	V11	9/28/2020
15	I42923371	H1	9/28/2020	41	I42923397	V12	9/28/2020
16	I42923372	H2	9/28/2020	42	I42923398	V13	9/28/2020
17	I42923373	H3	9/28/2020				
18	I42923374	H4	9/28/2020				
19	I42923375	H5	9/28/2020				
20	I42923376	H6	9/28/2020				
21	I42923377	H7	9/28/2020				
22	I42923378	H8	9/28/2020				
23	I42923379	H9	9/28/2020				
24	I42923380	J1	9/28/2020				
25	I42923381	J2	9/28/2020				
26	I42923382	J3	9/28/2020				

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision
based on the parameters provided by Wheeler - Waverly.
Truss Design Engineer's Name: Garcia, Juan
My license renewal date for the state of Missouri is December 31, 2020.
Missouri COA: 001193

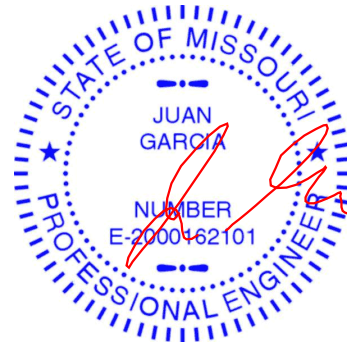

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Wheeler Lumber, Waverly, KS 66871


8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:16 2020 Page 1

ID:vBsZku21ozNPT?RizYtJMSyXqDi-d10j4veqyOpHhBrizUYZ5Z_9mUJ4UBXV_Hrvm4yapHH

-0-10-8 4-0-0 8-0-0 12-0-0 12-10-8

0-10-8 4-0-0 4-0-0 4-0-0 0-10-8

Scale = 1:22.4

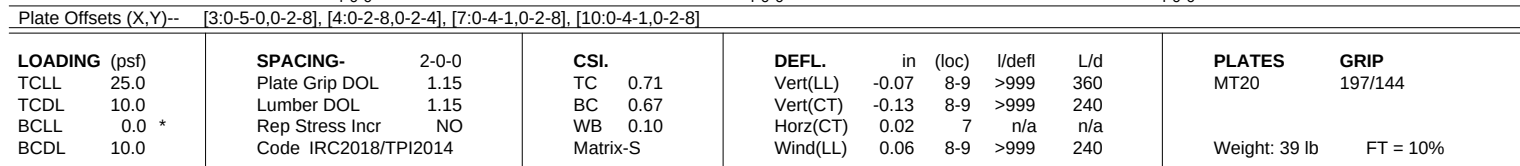

REACTIONS. (size) 10=0-3-8, 7=0-3-8
 Max Horz 10=50(LC 7)
 Max Uplift 10=-201(LC 8), 7=-201(LC 9)
 Max Grav 10=899(LC 1), 7=899(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-1231/277, 3-4=-1024/269, 4-5=-1232/276, 2-10=-806/214, 5-7=-806/213
BOT CHORD	9-10=-219/1012, 8-9=-219/1023, 7-8=-196/1013
WEBS	3-9=0/271, 4-8=-5/279

The seal of the State of Missouri is located in the top right corner. It is a circular emblem with the words "STATE OF MISSOURI" around the perimeter. In the center, there is a smaller circle containing the word "JUAN" above the word "CARLOS".

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6" tall by 2'-0" wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=201, 7=201.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 79 lb down and 74 lb up at 4'-0"-0, and 86 lb down and 74 lb up at 6'-0"-0, and 79 lb down and 74 lb up at 8'-0"-0 on top chord, and 220 lb down and 76 lb up at 4'-0"-0, and 31 lb down at 6'-0"-0, and 220 lb down and 76 lb up at 7'-11"-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 5-6=-70, 7-10=-20



September 23, 2020

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	
400640	A1	Hip Girder	1	1		I42923357
Job Reference (optional)						


LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 3=-46(F) 4=-46(F) 9=-220(F) 8=-220(F) 11=-46(F) 12=-25(F)

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923359
400640	B1	Monopitch	7	1	Job Reference (optional)	


Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:17 2020 Page 1

ID:vBszku21ozNPT?RizYtJMSyXqDi-5Da5iFeSjix8ILQVXB3oemXP6tm8DfhfDxaTIWyapHG



Scale = 1:13.9

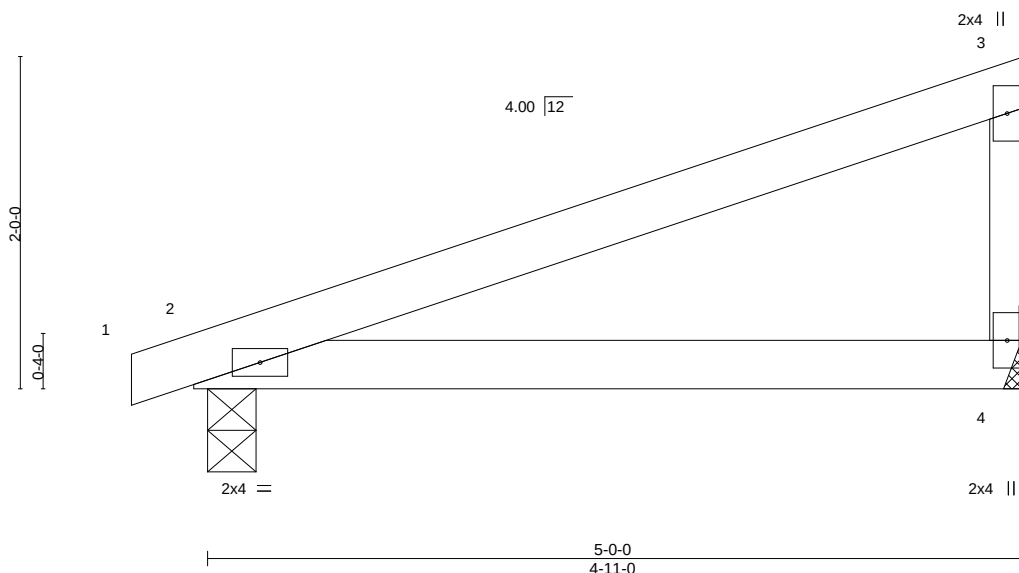

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.42	Vert(LL)	-0.03	2-4	>999	360	MT20	197/144
BCLL 10.0	Lumber DOL	1.15	BC 0.23	Vert(CT)	-0.06	2-4	>933	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	240		
									Weight: 13 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-


TOP CHORD Structural wood sheathing directly applied or 5-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 2=0-3-8
Max Horz 2=76(LC 5)
Max Uplift 4=-45(LC 8), 2=-58(LC 4)
Max Grav 4=212(LC 1), 2=252(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

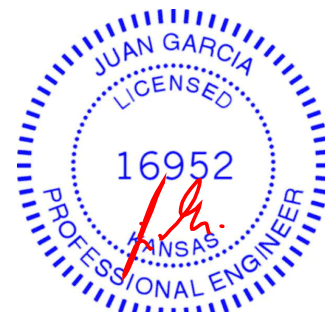

September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923360
400640	B2	Monopitch	3	1	Job Reference (optional)	


Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:18 2020 Page 1

ID:vBszku21ozNPT?RlZyTjMSyXqDi-ZP8UVaf4U03?wV?h5va1A_4VPH3Ry6XoSbK0qyyapHF

0-4-8
0-4-8
8-0-0
8-0-0

Scale = 1:18.7

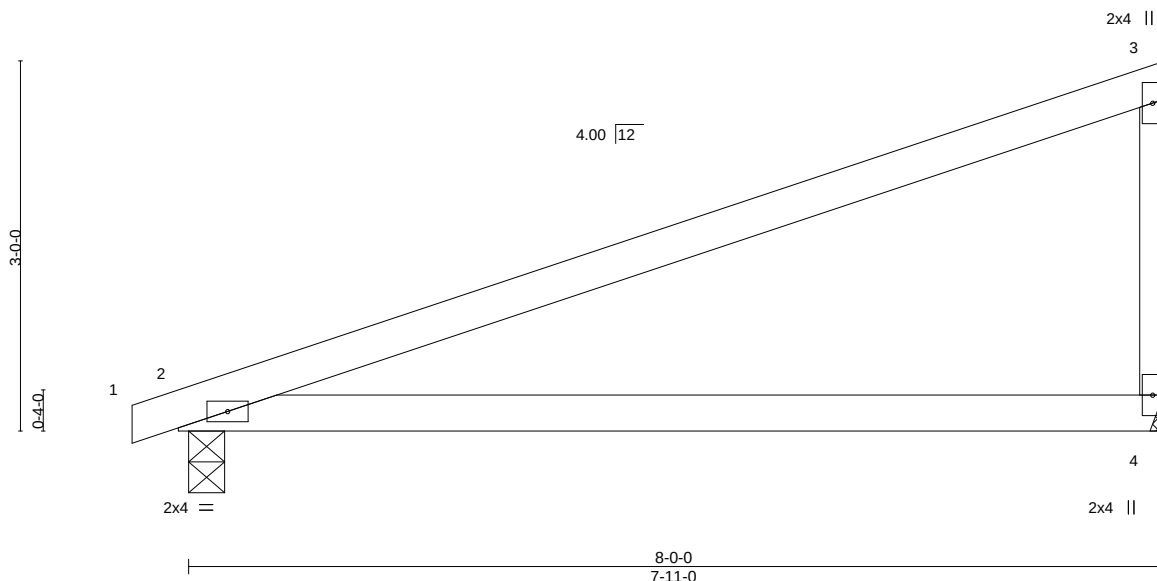

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.77	Vert(LL)	-0.17	2-4	>553	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.42	Vert(CT)	-0.34	2-4	>276	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	240	Weight: 21 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E

BOT CHORD 2x4 SPF 2100F 1.8E

WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 4=Mechanical, 2=0-3-8
Max Horz 2=121(LC 5)
Max Uplift 4=-74(LC 8), 2=-79(LC 4)
Max Grav 4=348(LC 1), 2=386(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-270/121

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

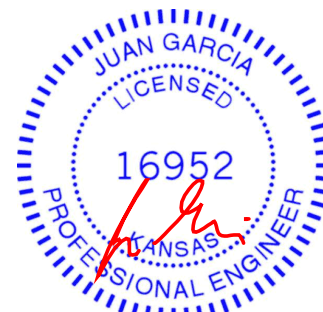

September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923361
400640	C1	GABLE	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:18 2020 Page 1

ID:vBsZku21ozNPT?RizYtJMSyXqDi-ZP8UVaf4U03?wV?h5va1A_4fwH9cy66oSbK0qyyapHF

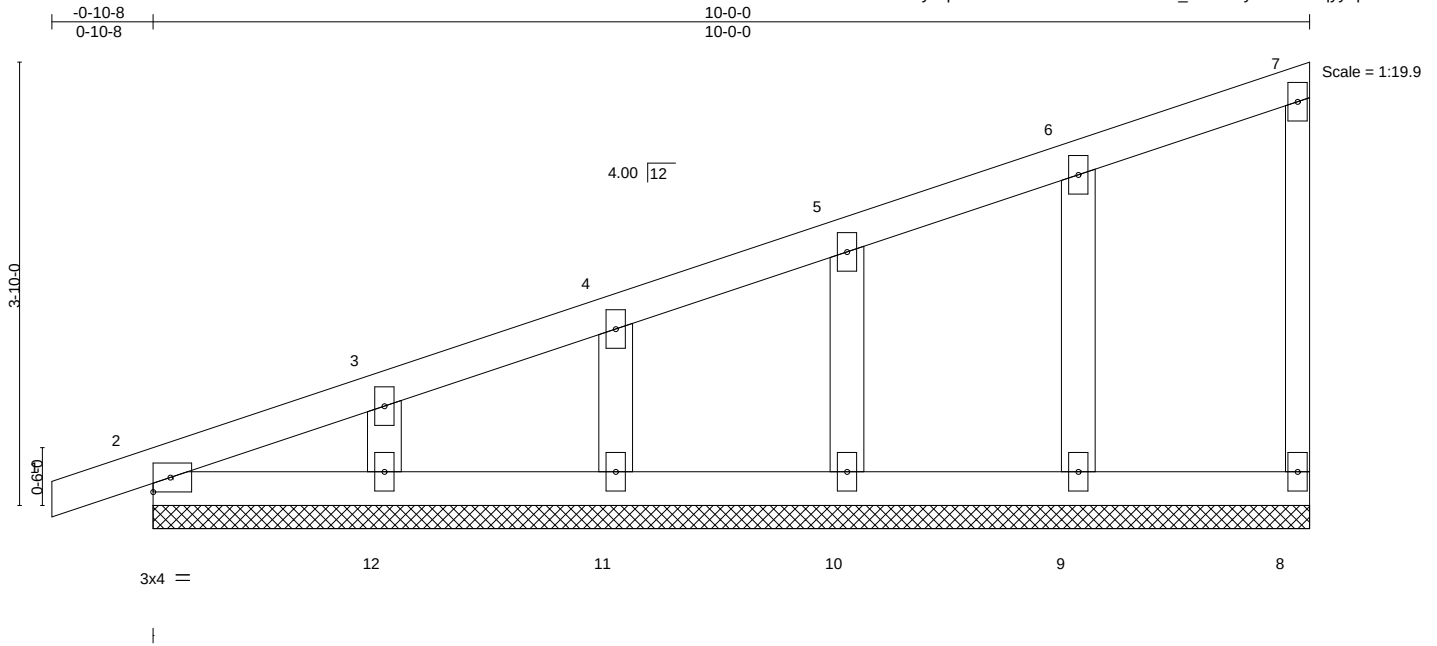

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	0.00	1	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	0.00	1	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	-0.00	8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 35 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 10-0-0.
(lb) - Max Horz 2=158(LC 5)
Max Uplift All uplift 100 lb or less at joint(s) 8, 2, 12, 11, 10, 9
Max Grav All reactions 250 lb or less at joint(s) 8, 2, 12, 11, 10, 9

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 2, 12, 11, 10, 9.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

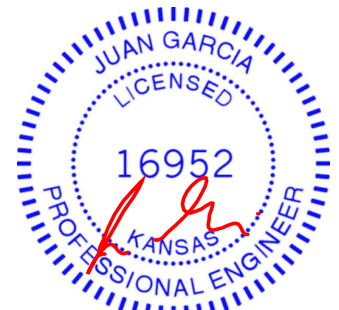

September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923362
400640	C2	Monopitch	10	1		

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:19 2020 Page 1

ID:vBszku21ozNPT?RizYtJMSyXqDi-1cisjwgiFJBsYeatfc5GjBcnRhR8hS1yhF3ZNPypaHE

Job Reference (optional)

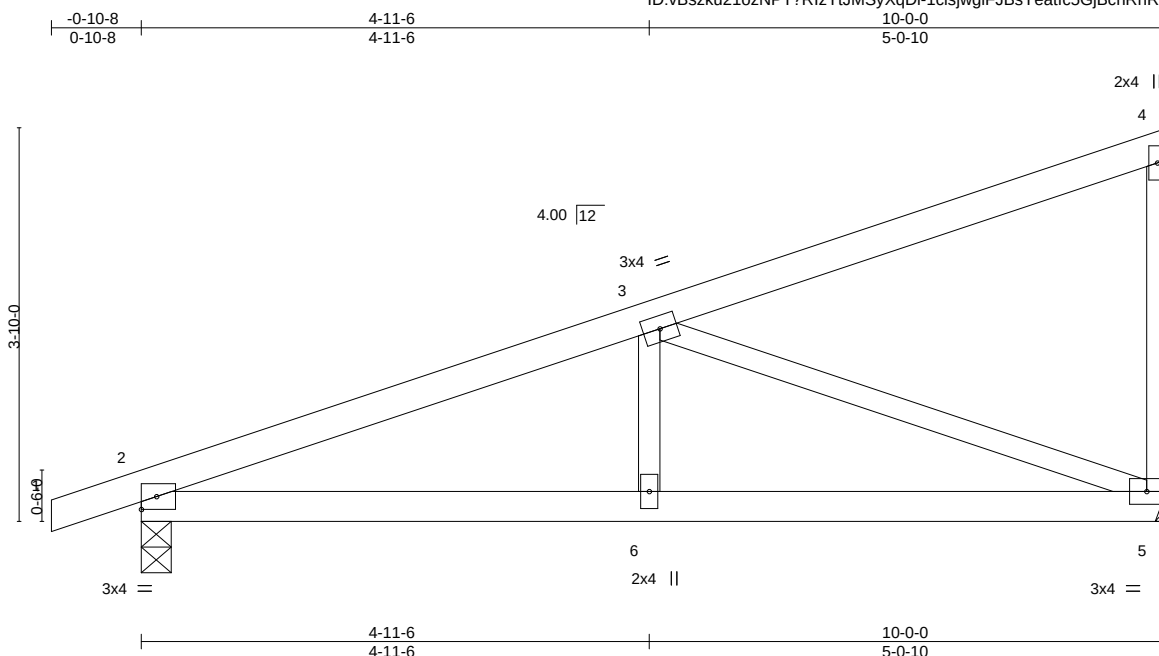

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	-0.02	2-6	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.26	Vert(CT)	-0.04	5-6	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.50	Horz(CT)	0.01	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.02	2-6	>999	240	Weight: 33 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=Mechanical, 2=0-3-8
Max Horz 2=158(LC 5)
Max Uplift 5=94(LC 8), 2=-115(LC 4)
Max Grav 5=435(LC 1), 2=514(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-782/113
BOT CHORD 2-6=-134/682, 5-6=-134/682
WEBS 3-5=-714/178

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5 except (jt=lb) 2=115.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923363
400640	D1	Common Supported Gable	1	1		


Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:20 2020 Page 1

ID:vBszku21ozNPT?RIzYtJMSyXqDi-VoGEwGhL0dJj9o93CKdVGP9?S5raQ0V5vvp7vryapHD

0-10-8	11-2-0	22-4-0	23-2-8
0-10-8	11-2-0	11-2-0	0-10-8

Scale = 1:38.6

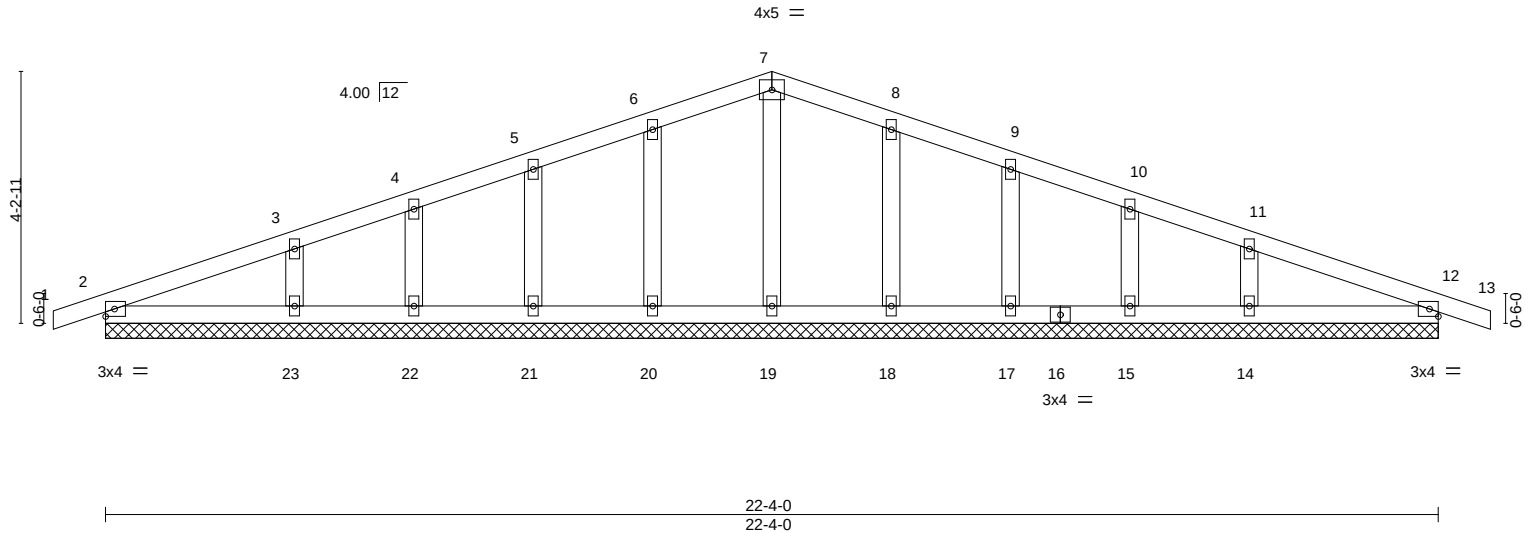

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	0.00	13	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	0.00	13	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	12	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 77 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 22-4-0.
(lb) - Max Horz 2=-71(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 2, 20, 21, 22, 23, 18, 17, 15, 14, 12
Max Grav All reactions 250 lb or less at joint(s) 2, 19, 20, 21, 22, 18, 17, 15, 12 except 23=275(LC 21),
14=275(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 20, 21, 22, 23, 18, 17, 15, 14, 12.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923364
400640	D2	Common	5	1		


Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:21 2020 Page 1

ID: vBsZku21ozNPT?RlZyYtJMSyXqDi-z_qc7chznxRanykGm18koci4IV0t9RNF8ZZgRHyapHC

0-10-8	5-3-15	11-2-0	17-0-1	22-4-0	23-2-8
0-10-8	5-3-15	5-10-1	5-10-1	5-3-15	0-10-8

Scale = 1:38.6

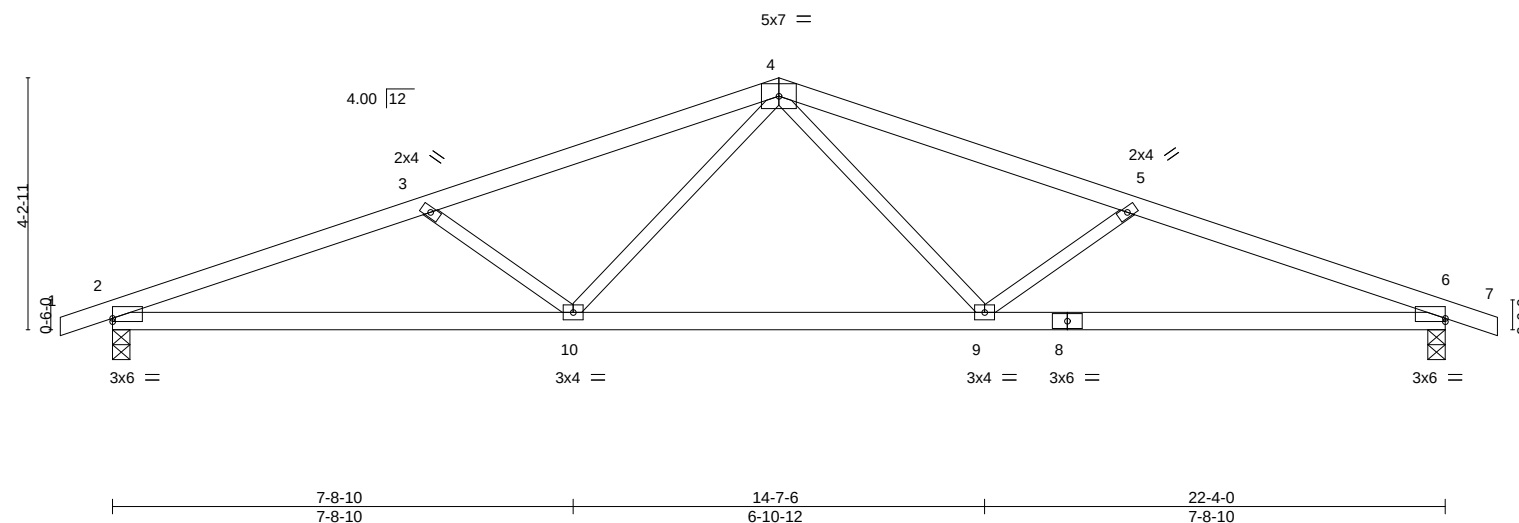

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.47	Vert(LL)	-0.12	9-10	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.69	Vert(CT)	-0.25	6-9	>999	240	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.19	Horz(CT)	0.07	6	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.08	9-10	>999	240	

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 3-7-2 oc purlins.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x3 SPF No.2	

REACTIONS. (size) 2=0-3-8, 6=0-3-8
 Max Horz 2=-71(LC 13)
 Max Uplift 2=-189(LC 4), 6=-189(LC 5)
 Max Grav 2=1063(LC 1), 6=1063(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-2232/355, 3-4=-1909/259, 4-5=-1909/260, 5-6=-2232/355
 BOT CHORD 2-10=-333/2049, 9-10=-127/1406, 6-9=-280/2049
 WEBS 4-9=-59/541, 5-9=-418/221, 4-10=-58/541, 3-10=-418/221

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=189, 6=189.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923365
400640	E1	GABLE	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:22 2020 Page 1

ID:vBszku21ozNPT?RizYtJMSyXqDi-SAN_LyibYEZQP6JSKlfzLqELAuW0uv3ONDIDzkyapHB

0-10-8 10-0-0 20-0-0 20-10-8
0-10-8 10-0-0 10-0-0 0-10-8

3x4 =

Scale = 1:45.8

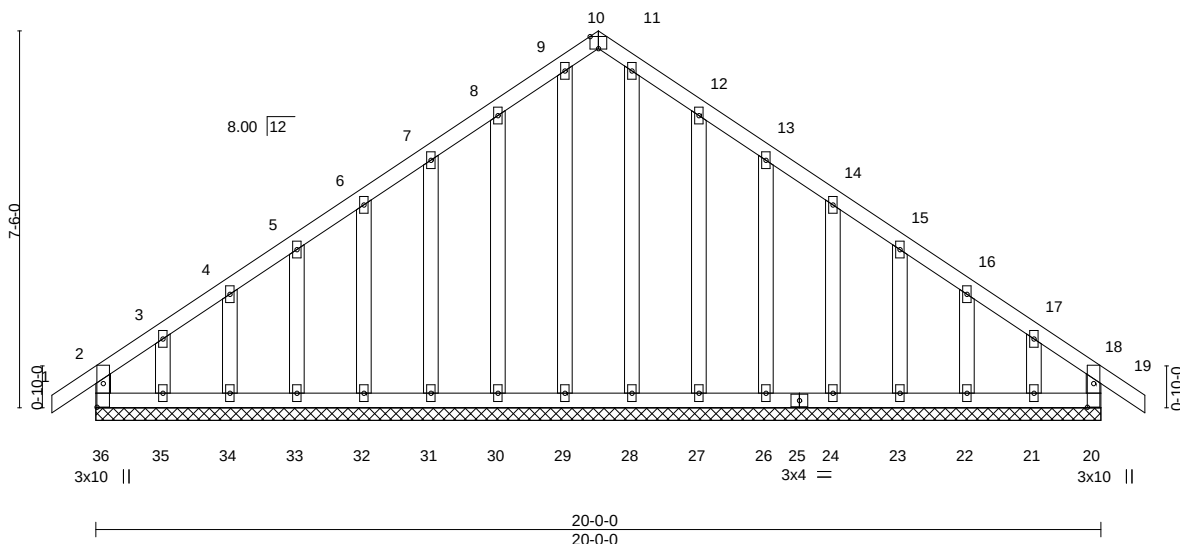


Plate Offsets (X,Y)-- [10:0-2-0,Edge], [20:0-5-10,0-1-8], [36:0-5-10,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	-0.00	19	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	-0.00	19	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.00	20	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R						Weight: 115 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

All bearings 20-0-0.
(lb) - Max Horz 36=213(LC 7)
Max Uplift All uplift 100 lb or less at joint(s) 36, 20, 34, 33, 32, 31, 30, 27, 26, 24, 23, 22 except 35=-133(LC 8), 21=-120(LC 9)
Max Grav All reactions 250 lb or less at joint(s) 36, 20, 35, 34, 33, 32, 31, 30, 29, 28, 27, 26, 24, 23, 22, 21

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 36, 20, 34, 33, 32, 31, 30, 27, 26, 24, 23, 22 except (jt=lb) 35=133, 21=120.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923366
400640	E2	Common	3	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:23 2020 Page 1

ID:vBszku21ozNPT?RizYtJMSyXqDi-wNxMYIjDJYhH0GteuSAC1nMslhUdKoXbt2nWAYapHA

0-10-8 5-2-1 10-0-0 14-10-0 20-0-0 20-10-8
0-10-8 5-2-1 4-10-0 4-10-0 5-2-1 0-10-8

4x5 =

Scale = 1:46.3

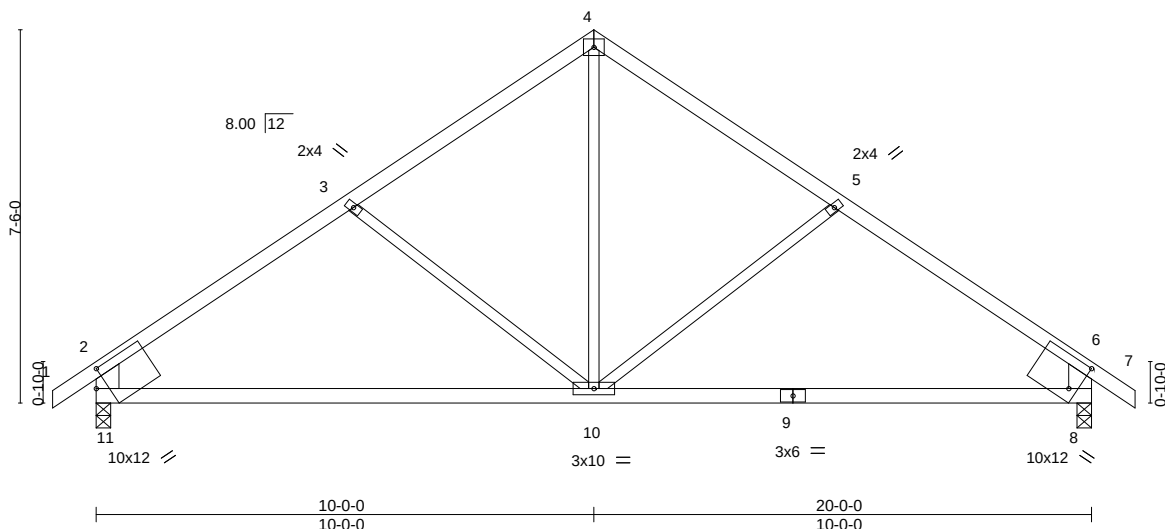


Plate Offsets (X,Y)-- [8:0-1-14,0-7-1], [11:0-2-11,0-4-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	-0.17 10-11 >999 360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.75	Vert(CT)	-0.35 10-11 >662 240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.25	Horz(CT)	0.03 8 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.05 10 >999 240	Weight: 70 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-11,6-8: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-3-10 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 8=0-3-8, 11=0-3-8
Max Horz 11=215(LC 7)
Max Uplift 8=-124(LC 9), 11=-124(LC 8)
Max Grav 8=957(LC 1), 11=957(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-1100/163, 3-4=-842/156, 4-5=-842/155, 5-6=-1100/163, 2-11=-855/174,
6-8=-855/174
BOT CHORD 10-11=-147/836, 8-10=-42/803
WEBS 4-10=-48/492, 5-10=-266/215, 3-10=-266/215

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (it=lb) 8=124, 11=124.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	
400640	E3	ROOF SPECIAL GIRDER	1	3		I42923367
Job Reference (optional)						

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:24 2020 Page 1

ID: vBsZku21ozNPT?RizYtJMSyXqDi-OZVImekr3sq8eQSR9hRQFJZci8RMfphqWnK2cyapH9



5x7 ||

Scale = 1:46.1

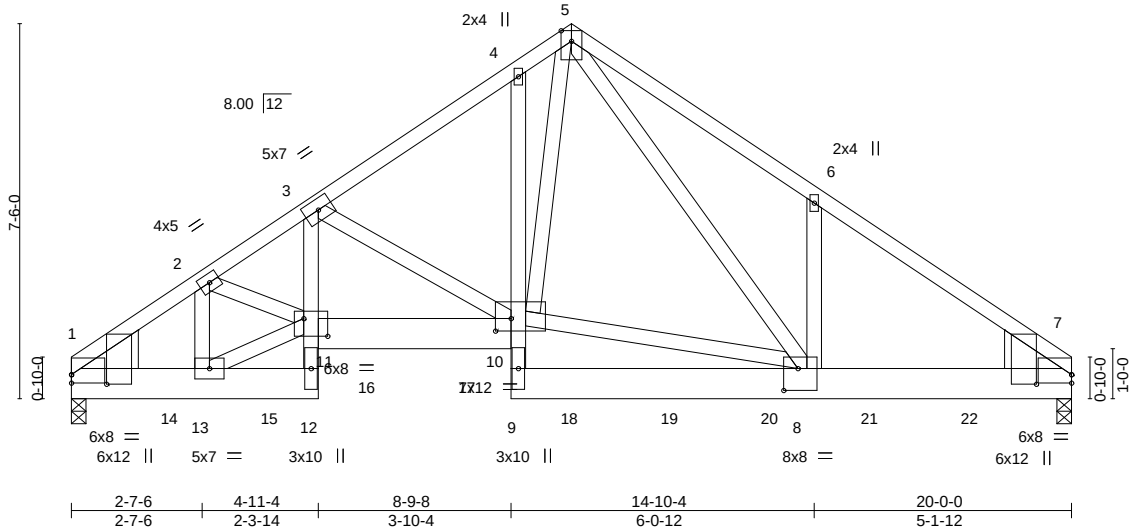


Plate Offsets (X,Y)-- [1:0-0-0,0-2-0], [1:0-2-5,0-8-7], [7:0-2-5,0-8-7], [7:Edge,0-2-0], [8:0-3-7,0-5-4], [10:0-3-12,0-3-0], [11:0-5-12,0-4-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.59	Vert(LL)	-0.12	8-9	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.32	Vert(CT)	-0.21	8-9	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.65	Horz(CT)	0.09	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.06	8-9	>999	240	Weight: 439 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x8 SP 2400F 2.0E
 WEBS 2x4 SPF No.2
 WEDGE
 Left: 2x10 SP DSS , Right: 2x10 SP DSS

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-8-10 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=0-3-8 (req. 0-3-10), 7=0-3-8 (req. 0-3-10)
 Max Horz 1=183(LC 28)
 Max Uplift 1=374(LC 8), 7=245(LC 9)
 Max Grav 1=6961(LC 1), 7=6942(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-9555/468, 2-3=-13506/629, 3-4=-8456/369, 4-5=-8208/458, 5-6=-9326/493,
 6-7=-9703/335
 BOT CHORD 1-13=-429/7224, 10-11=-542/11441, 8-9=-7/389, 7-8=-204/7671
 WEBS 11-12=-24/1261, 3-11=-248/5342, 9-10=-10/1706, 4-10=-196/305, 2-13=-3043/144,
 11-13=-477/7989, 2-11=-114/4337, 3-10=-5227/383, 8-10=-141/5361, 5-10=-377/6349,
 5-8=-288/3716, 6-8=-298/596

NOTES-

- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-5-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- WARNING: Required bearing size at joint(s) 1, 7 greater than input bearing size.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=374, 7=245.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4
400640	E3	ROOF SPECIAL GIRDER	1	3	I42923367
					Job Reference (optional)


Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:24 2020 Page 2
ID:vBszku21ozNPT?RizYtJMSyXqDi-OZVImekr3sq8eQSR9hRQFJZci8RMfphqWnK2cyapH9

NOTES-
10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1338 lb down and 188 lb up at 2-0-0, 1351 lb down and 35 lb up at 4-0-0, 1363 lb down and 44 lb up at 6-0-0, 1363 lb down and 44 lb up at 8-0-0, 1351 lb down and 35 lb up at 10-0-0, 1351 lb down and 35 lb up at 12-0-0, 1338 lb down and 36 lb up at 14-0-0, and 1338 lb down and 36 lb up at 16-0-0, and 1338 lb down and 36 lb up at 18-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-5=-70, 5-7=-70, 1-12=-20, 10-11=-20, 7-9=-20
Concentrated Loads (lb)
Vert: 14=-1338(B) 15=-1351(B) 16=-1363(B) 17=-1363(B) 18=-1351(B) 19=-1351(B) 20=-1338(B) 21=-1338(B) 22=-1338(B)

Wheeler Lumber, Waverly, KS 66871 8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:25 2020 Page 1
ID:vBsZku21ozNPT?RizYtJMSyXqDi-sl37z_ITq9y?GZ11?tCgzSsiP6Qe5E5q3AXua2yapH8
0-10-8 3-3-8 6-6-0 9-8-8 13-0-0 13-10-8
0-10-8 3-3-8 3-2-8 3-2-8 3-3-8 0-10-8
4x5 II Scale = 1:32.8

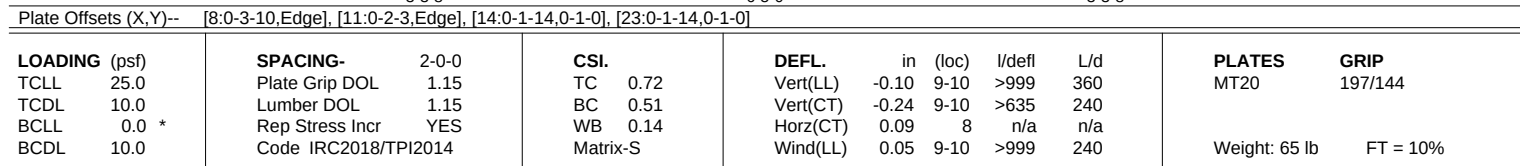


REACTIONS. (size) 11=0-3-8, 8=0-3-8
 Max Horz 11=154(LC 7)
 Max Uplift 11=-88(LC 8), 8=-88(LC 9)
 Max Grav 11=642(LC 1), 8=642(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-966/113, 3-4=-849/230, 4-5=-849/193, 5-6=-966/70, 2-11=-784/128, 6-8=-784/100
BOT CHORD	10-11=-97/776, 9-10=0/453, 8-9=-2/717
WEBS	4-9=-138/417, 4-10=-161/460

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable studs spaced at 1-4-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Bearing at joint(s) 11, 8, considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 8.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

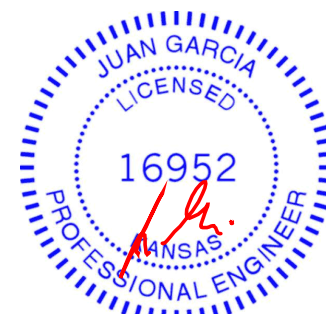

September 23, 2020



WARNING: Velly design parameters are listed on this and included with reference page MP147316v. 3/19/2020 before use. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for the building design component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601.




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923369
400640	G2	Roof Special	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:25 2020 Page 1
ID:vBszku21ozNPT?RizYtJMSyXqDi-sl37z_ITq9y?GZ11?tCgzSsiP6Qe5E5q3AXua2yapH8

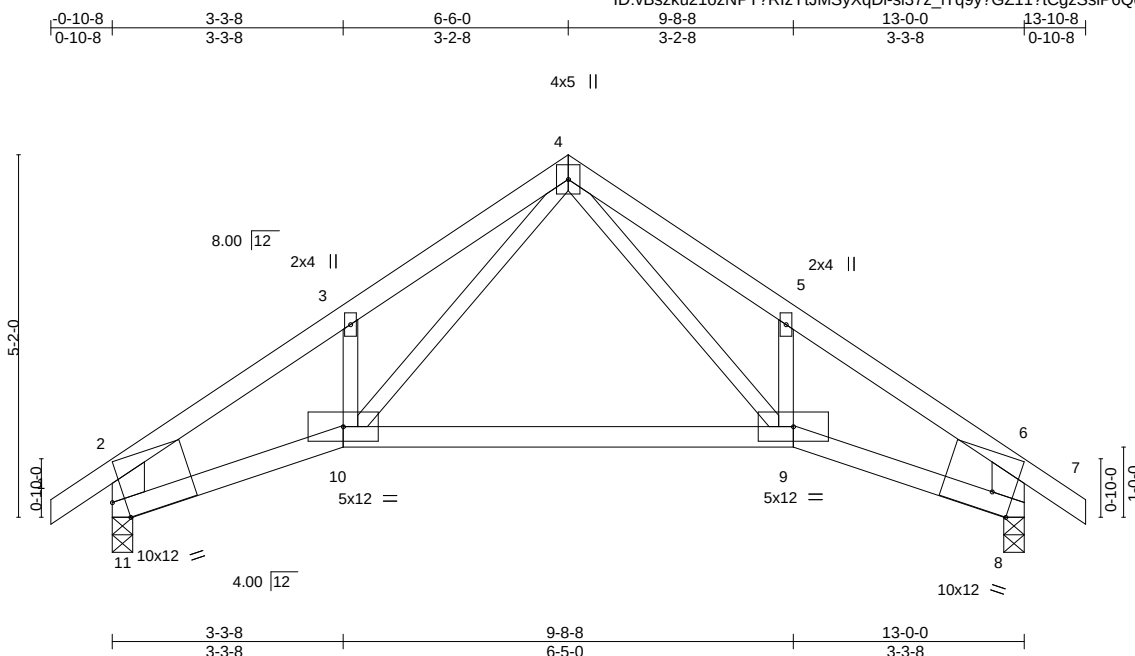

Scale = 1:32.8

Plate Offsets (X,Y)-- [8:0-3-10,Edge], [11:0-2-3,Edge]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES	GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.72	Vert(LL)	-0.10	9-10	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.51	Vert(CT)	-0.24	9-10	>635	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.09	8	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.05	9-10	>999	240	Weight: 48 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-11,6-8: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-5-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 11=0-3-8, 8=0-3-8
Max Horz 11=154(LC 7)
Max Uplift 11=-88(LC 8), 8=-88(LC 9)
Max Grav 11=642(LC 1), 8=642(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-966/113, 3-4=-849/230, 4-5=-849/193, 5-6=-966/70, 2-11=-784/128, 6-8=-784/100
BOT CHORD 10-11=-97/776, 9-10=0/453, 8-9=-2/717
WEBS 4-9=-138/417, 4-10=-161/460

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 11, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923370
400640	G3	Roof Special	4	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:26 2020 Page 1

ID:vBszku21ozNPT?RizYtJMSyXqDi-KydVBKl5bT4stjcDZajvVgPwAWkrqhE_IqGR7VyapH7

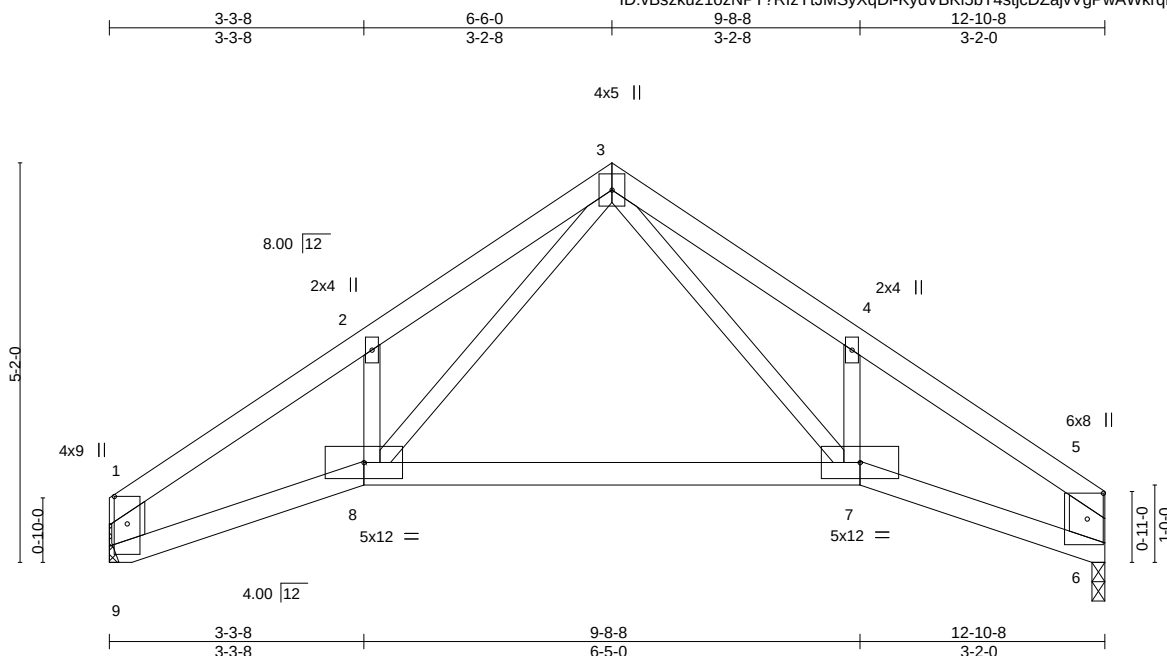

Scale = 1:29.8

Plate Offsets (X,Y)--	[1:0-4-4,0-2-0], [5:0-4-0,0-2-8]
-----------------------	----------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.53	Vert(LL)	-0.12	7-8	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.64	Vert(CT)	-0.27	7-8	>544	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.15	Horz(CT)	0.11	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.05	7-8	>999	240	Weight: 46 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
1-9,5-6: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-2-9 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 9=Mechanical, 6=0-2-0
Max Horz 9=108(LC 5)
Max Uplift 9=-2(LC 8), 6=-2(LC 9)
Max Grav 9=559(LC 1), 6=559(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-960/18, 2-3=-865/107, 3-4=-832/90, 4-5=-931/0, 1-9=-681/23, 5-6=-667/9
BOT CHORD 8-9=-22/740, 7-8=0/441, 6-7=0/692
WEBS 3-8=-77/456, 3-7=-65/392

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 6.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

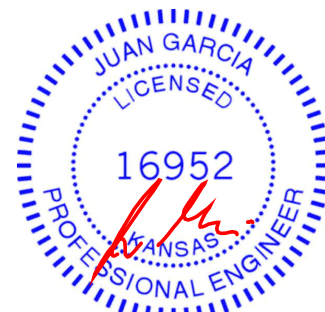

September 23,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601





16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	
400640	H1	Common Supported Gable	2	1		I42923371
Job Reference (optional)						

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:27 2020 Page 1
ID: vBsZku21ozNPT?RizYtJMSyXqDi-o8BtOfmkMnCjVtBQ7IF82txC1vDOZ8s7WU0_fxyapH6

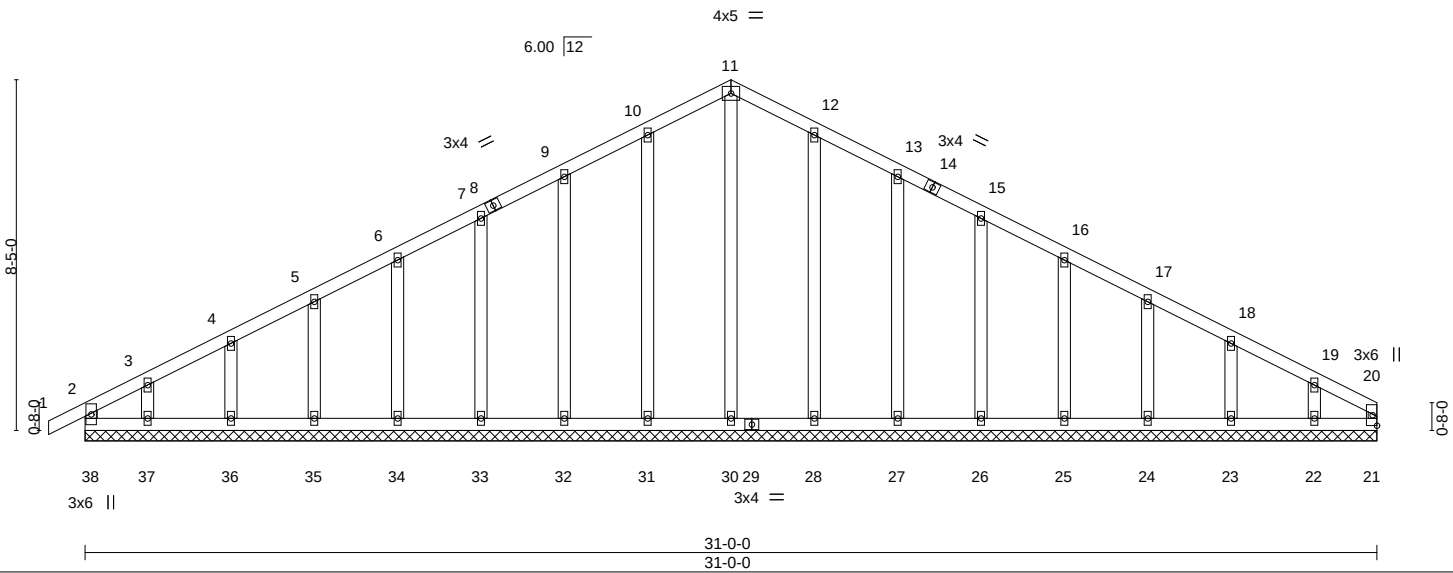

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	-0.00	1	n/r	120	MT20	197/144
BCLL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	1	n/r	120		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.19	Horz(CT)	0.01	21	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R						Weight: 147 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2 *Except*
20-21: 2x3 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 31-0-0.
(lb) - Max Horz 38=138(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 38, 31, 32, 33, 34, 35, 36, 28, 27, 26, 25, 24, 23, 22 except 37=-106(LC 8)
Max Grav All reactions 250 lb or less at joint(s) 38, 21, 30, 31, 32, 33, 34, 35, 36, 37, 28, 27, 26, 25, 24, 23, 22

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 38, 31, 32, 33, 34, 35, 36, 28, 27, 26, 25, 24, 23, 22 except (jt=lb) 37=106.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923372
400640	H2	Roof Special	1	1	Job Reference (optional)	


Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:28 2020 Page 1

ID:vBsZku21ozNPT?RlZyUJMSyXqDi-GKIFb?nM74Ka71mcg?mNa5U8rJL3IS9GI8YBNyaph5

0-10-8 7-9-10 15-6-0 18-9-0 23-2-7 31-0-0
0-10-8 7-9-10 7-8-6 3-3-0 4-5-7 7-9-9

Scale = 1:55.6

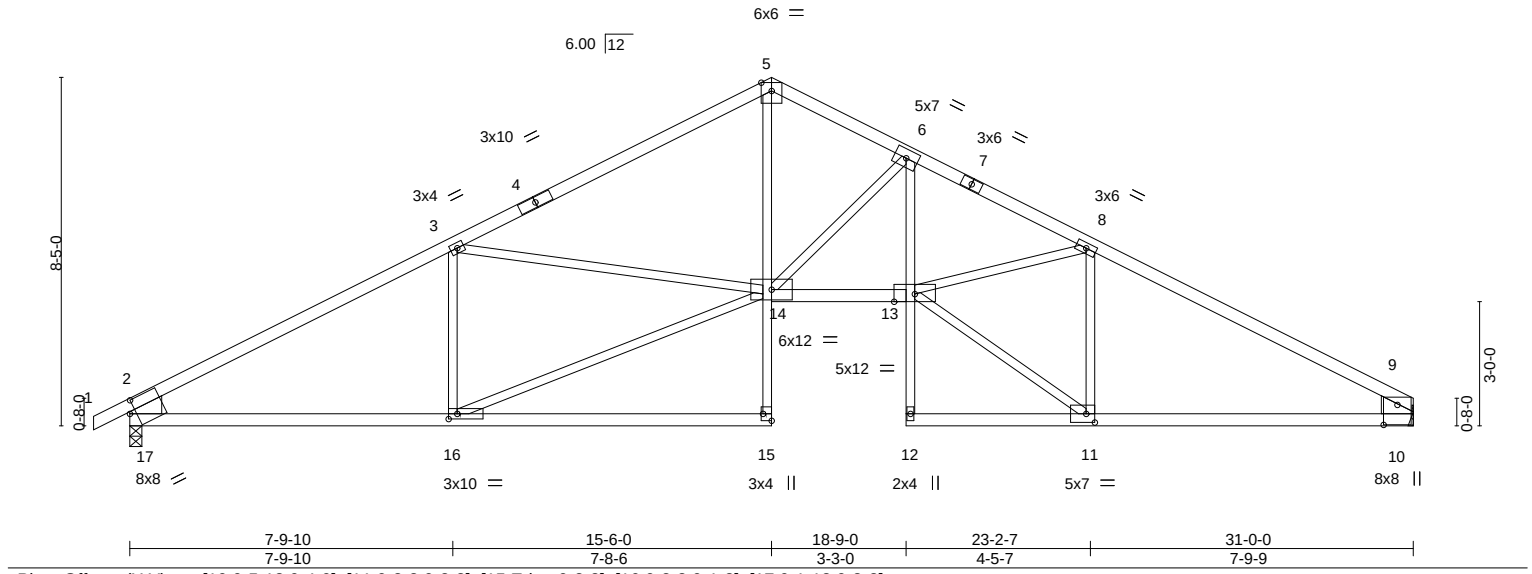

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.96	Vert(LL)	-0.35	13	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.92	Vert(CT)	-0.67	15-16	>538		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.76	Horz(CT)	0.24	10	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.20	13	>999		
								Weight: 121 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E *Except*
5-7,7-9: 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
5-15,6-12: 2x3 SPF No.2, 10-12: 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except*
2-17,9-10: 2x10 SP DSS

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
2-2-0 oc bracing: 16-17,10-11.

REACTIONS.

(size) 17=0-3-8, 10=Mechanical
Max Horz 17=137(LC 12)
Max Uplift 17=-198(LC 8), 10=-168(LC 9)
Max Grav 17=1450(LC 1), 10=1358(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2200/268, 3-5=-2418/266, 5-6=-2289/296, 6-8=-3368/300, 8-9=-2137/261,
2-17=-1341/237, 9-10=-1201/209
BOT CHORD 16-17=-274/1833, 5-14=-109/1610, 13-14=-132/2943, 6-13=-99/1179, 10-11=-151/1789
WEBS 3-16=-603/213, 14-16=-299/1946, 3-14=-30/347, 6-14=-1300/199, 11-13=-182/2172,
8-13=-49/1191, 8-11=-1270/194

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 17=198, 10=168.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923373
400640	H3	Roof Special	2	1		

Wheeler Lumber, Waverly, KS 66871, Mitek

8.410 s May 22 2020 MiTek Industries, Inc. Wed Sep 23 14:06:12 2020 Page 1
ID:vBszku21ozNPT?RizYUJMSyXqDi-WDyMezSGr9LojOLCe4RF5o1DeH4?WMk9C1Fi2yajtP

-0-10-8	2-3-8	7-9-9	13-6-0	15-6-0	23-2-7	31-0-0
0-10-8	2-3-8	5-6-1	5-8-7	2-0-0	7-8-7	7-9-9

Scale = 1:58.0

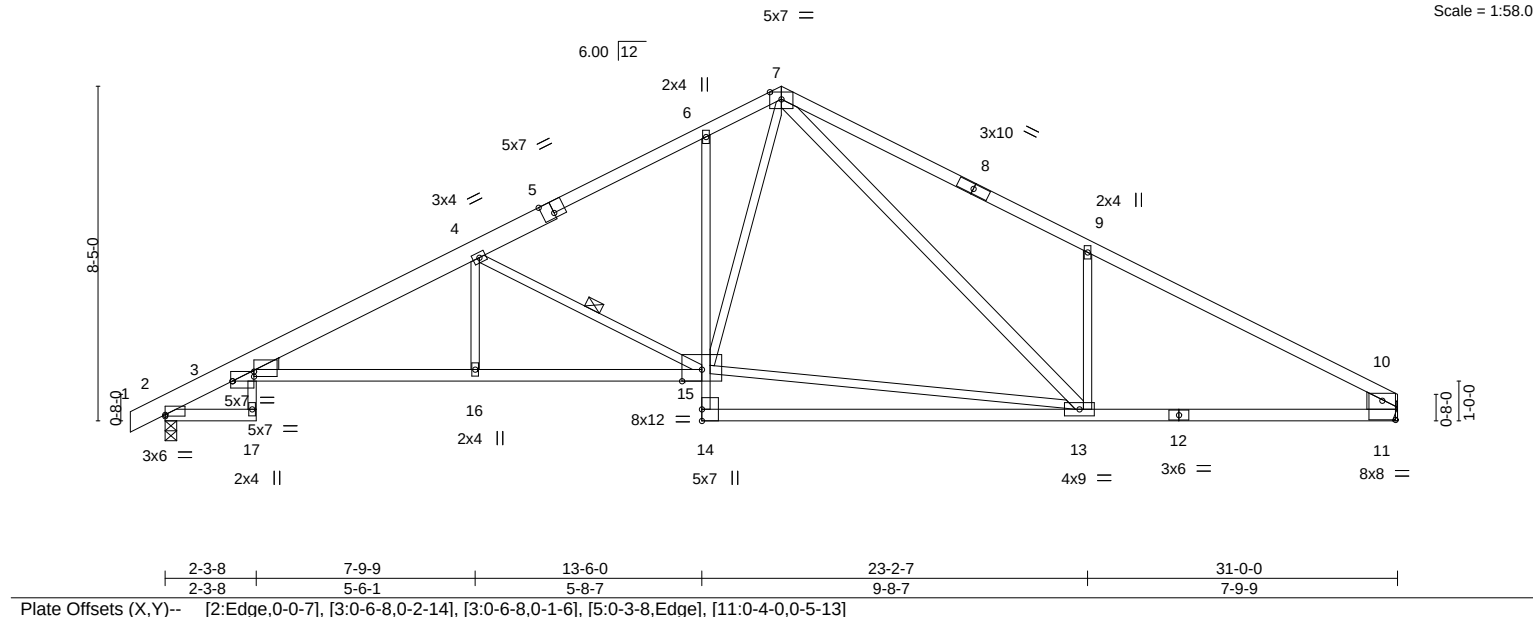

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.79	Vert(LL)	-0.34 13-14	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.72	Vert(CT)	-0.79 13-14	>462	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.49	Horz(CT)	0.34 11	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.16 3-16	>999	240	Weight: 136 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E *Except*
5-7: 2x4 SPF No.2, 1-5: 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SPF No.2 *Except*
3-17,6-14: 2x3 SPF No.2, 3-15,11-12: 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except*
7-13: 2x4 SPF No.2, 10-11: 2x10 SP DSS

WEDGE
Left: 2x4 SPF No.2

REACTIONS. (lb/size) 2=1455/0-3-8, 11=1371/Mechanical
Max Horz 2=106(LC 5)
Max Uplift 2=-21(LC 8), 11=-15(LC 9)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-809/45, 3-4=-2945/55, 4-5=-2012/31, 5-6=-1943/58, 6-7=-1824/104, 7-8=-2062/159,
8-9=-2186/122, 9-10=-2224/36, 10-11=-1235/55
BOT CHORD 3-16=-57/2687, 15-16=-57/2687, 12-13=0/1869, 11-12=0/1869
WEBS 4-16=0/304, 4-15=-1168/116, 13-15=0/1258, 7-15=-54/896, 7-13=-135/724,
9-13=-507/203

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 2 and 15 lb uplift at joint 11.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-3-12 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 2-17.
WEBS 1 Row at midpt 4-15



September 23,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Wheeler Lumber, Waverly, KS 66871. Mitek

8.410 s May 22 2020 MiTek Industries, Inc. Wed Sep 23 14:06:20 2020 Page 1
ID:vBsZku21ozNPT?RizYtJMSyXgDi-HmRNkYHzcLggFKugKDJan7Mos?ct1xv?Szg avajitH



LUMBER-
TOP CHORD 2x4 SPF No.2 *Except*
 1-5: 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SPF No.2 *Except*
 3-15: 2x3 SPF No.2, 3-12: 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except*
 8-10,16-18,13-17: 2x4 SPF No.2
WEDGE
 Left: 2x4 SPF No.2

REACTIONS. (lb/size) 10=1383/Mechanical, 2=1468/0-3-8
 Max Horz 2=162(LC 5)
 Max Uplift 10=-24(LC 9), 2=-20(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-817/0, 3-4=-2989/77, 4-5=-1877/12, 5-6=-1806/49, 6-7=-1845/61, 7-8=-2796/2
BOT CHORD	3-14=-108/2732, 13-14=-108/2732, 12-13=-44/2582, 11-12=-44/2582, 10-11=-38/2684
WEBS	4-14=0/312, 4-13=-1298/171, 6-13=0/1095, 7-13=-1141/98, 7-11=0/461, 8-11=-263/73, 8-10=-2842/29

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 24 lb uplift at joint 10 and 20 lb uplift at joint 2.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

BRACING-	
TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 8-9.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 2-15.
WEBS	1 Row at midpt 4-13, 7-13, 8-10



September 23, 2020




Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601.



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Wheeler Lumber, Waverly, KS 66871. Mitek

8.410 s May 22 2020 MiTek Industries, Inc. Wed Sep 23 14:06:27 2020 Page 1
ID:vBszku21ozNPT?RizYtJtMSvXgDi-a6M1o5dgJmEqOKMEalrYMEwbMhMI0Dtxc19YkqvaiTA



LUMBER-		BRACING-	
TOP CHORD	2x4 SPF 2100F 1.8E *Except* 5-6: 2x4 SPF No.2, 1-5: 2x6 SP 2400F 2.0E	TOP CHORD	Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD	2x4 SPF No.2 *Except* 3-18,8-13: 2x3 SPF No.2, 3-16,11-13: 2x4 SPF 2100F 1.8E	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 2-18,12-13.
WEBS	2x3 SPF No.2 *Except* 8-15,19-21,15-20: 2x4 SPF No.2, 10-11: 2x10 SP DSS	WEBS	1 Row at midpt 4-15, 8-15

WEDGE
Left: 2x4 SPF No.2

REACTIONS. (lb/size) 2=1455/0-3-8, 11=1371/Mechanical
Max Horz 2=106(LC 5)
Max Uplift 2=-21(LC 8), 11=-15(LC 9)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-809/45, 3-4=-2948/74, 4-5=-1852/11, 5-6=-1781/48, 6-7=-1689/56, 7-8=-1836/31,
8-9=-3074/49, 9-10=-1990/23, 10-11=-1143/37

BOT CHORD 3-17=-80/2693, 16-17=-79/2693, 15-16=-79/2693, 14-15=0/2829, 8-14=0/474,
11-12=0/1654

WEBS 4-17=0/299, 4-15=-1278/169, 6-15=0/1044, 8-15=-1387/152, 12-14=0/1682, 9-14=0/1187,
9-12=-796/29




NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCFL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 2 and 15 lb uplift at joint 11.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

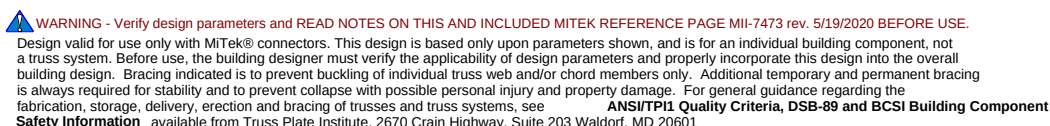

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923376
400640	H6	Common	4	1		


Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:32 2020 Page 1

ID: vBsZku21ozNPT?RizYtJMSyXqDi-96_mRNqsBJq0be3NvrqJlxfsdwmsEKHsgmjlK9yapH1

0-10-8 7-9-10 15-6-0 23-2-6 31-0-0
0-10-8 7-9-10 7-8-6 7-8-6 7-9-10

Scale = 1:55.2

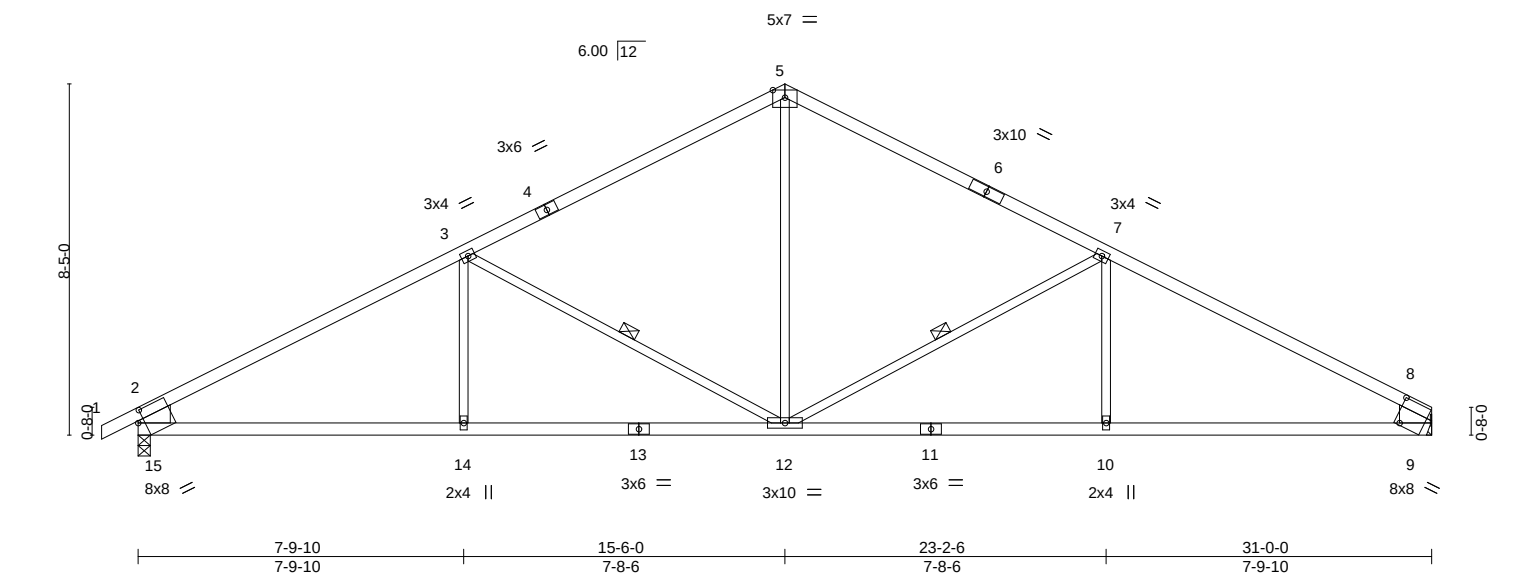

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.85	Vert(LL)	-0.26 10-12 >999	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.50 10-12 >720				
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.07 9 n/a n/a				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.11 10-12 >999				

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF 2100F 1.8E	TOP CHORD	Structural wood sheathing directly applied or 3-4-9 oc purlins, except end verticals.
BOT CHORD	2x4 SPF 2100F 1.8E *Except* 11-13: 2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x3 SPF No.2 *Except* 2-15,8-9: 2x10 SP DSS	WEBS	1 Row at midpt 7-12, 3-12

REACTIONS.	
(size)	15=0-3-8, 9=Mechanical
Max Horz	15=112(LC 7)
Max Uplift	15=-29(LC 8), 9=-16(LC 9)
Max Grav	15=1450(LC 1), 9=1358(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	2-3=-2187/43, 3-5=-1587/73, 5-7=-1589/72, 7-8=-2176/43, 2-15=-1330/74, 8-9=-1211/59
BOT CHORD	14-15=-44/1824, 12-14=-44/1824, 10-12=0/1827, 9-10=0/1827
WEBS	5-12=0/775, 7-12=-651/125, 3-12=-647/124, 3-14=0/267

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 15, 9.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923377
400640	H7	Common	3	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:33 2020 Page 1
ID: vBsZku21ozNPT?RizYtJMSyXqDi-diY8fjrUydytDoeZTYLYH8B1fK3Ezn0vQTJJsbyapH0

-0-10-8 7-9-10 15-6-0 23-2-6 31-0-0 31-10-8
0-10-8 7-9-10 7-8-6 7-8-6 7-9-10 0-10-8

Scale = 1:55.7

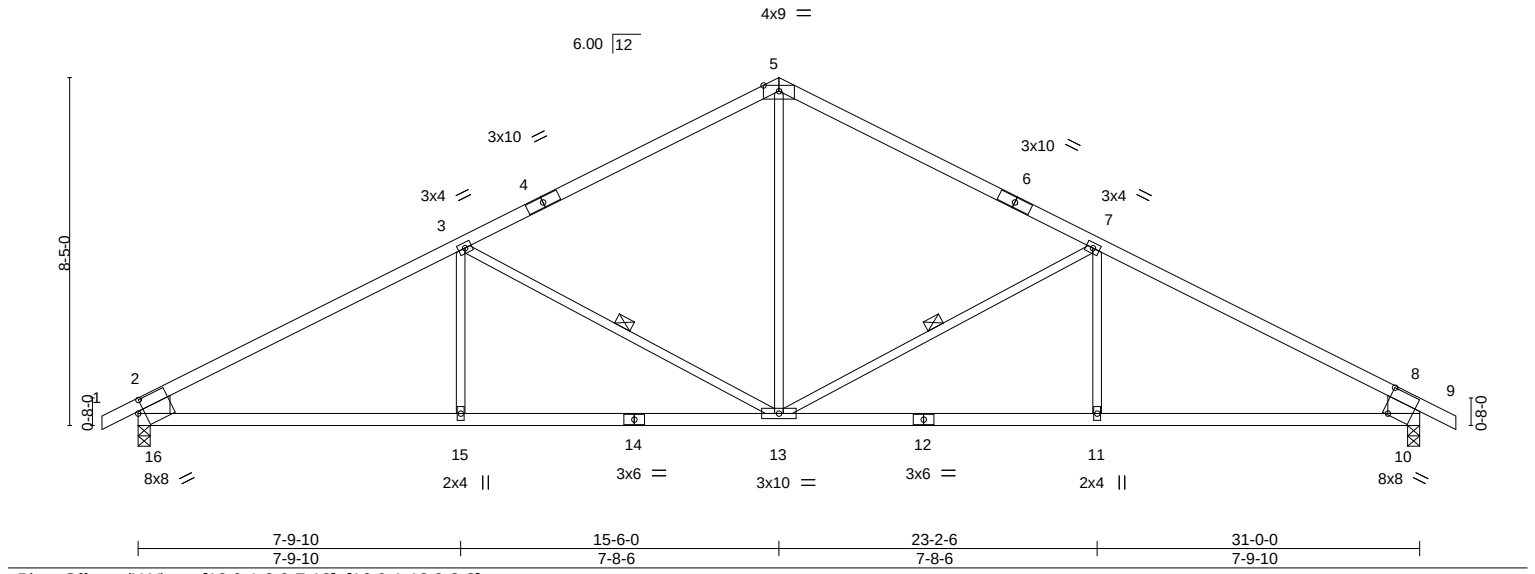

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.89	Vert(LL)	-0.22 11-13	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.92	Vert(CT)	-0.44 11-13	>820	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.47	Horz(CT)	0.09 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.13 13-15	>999	240	Weight: 108 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-16,8-10: 2x10 SP DSS

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 1 Row at midpt 7-13, 3-13

REACTIONS.

(size) 16=0-3-8, 10=0-3-8
Max Horz 16=-126(LC 6)
Max Uplift 16=-198(LC 8), 10=-198(LC 9)
Max Grav 16=1449(LC 1), 10=1449(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2187/271, 3-5=-1582/243, 5-7=-1582/243, 7-8=-2187/271, 2-16=-1336/239, 8-10=-1336/239
BOT CHORD 15-16=-265/1821, 13-15=-265/1821, 11-13=-140/1821, 10-11=-140/1821
WEBS 5-13=-48/760, 7-13=-647/250, 7-11=0/274, 3-13=-647/250, 3-15=0/274

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (it=lb) 16=198, 10=198.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923378
400640	H8	COMMON GIRDER	1	2	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:34 2020 Page 1

ID:VbSzku21ozNPT?RizYtJMSyXqDi-5U6Xs3r7jw4jryDm1GtnqMkCRkSEi9q974CsP1yapH?

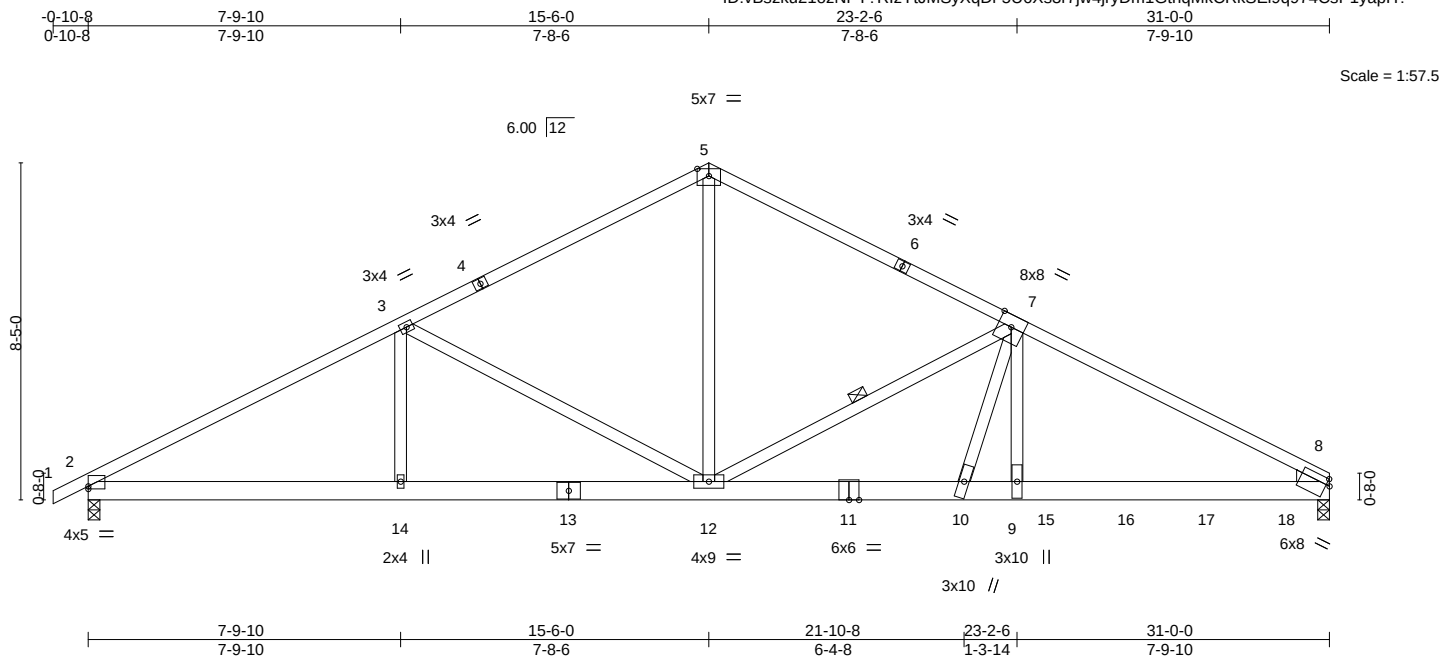


Plate Offsets (X,Y)-- [2:0-0-0,0-0-13], [8:0-1-1,0-1-14]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.89	Vert(LL)	-0.16	8-9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.67	Vert(CT)	-0.29	8-9	>999	240		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.81	Horz(CT)	0.07	8	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.09	10-12	>999	240	Weight: 311 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
1-4,6-8: 2x4 SPF 2400F 2.0E
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SPF No.2
WEDGE
Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 7-12

REACTIONS.

(size) 8=0-3-8 (req. 0-4-7), 2=0-3-8
Max Horz 2=93(LC 26)
Max Uplift 8=336(LC 9), 2=148(LC 8)
Max Grav 8=5627(LC 1), 2=2718(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-5024/291, 3-5=-4374/333, 5-7=-4375/332, 7-8=-9437/667
BOT CHORD 2-14=-264/4309, 12-14=-264/4309, 10-12=-612/8921, 9-10=-514/8271, 8-9=-513/8219
WEBS 5-12=-198/3311, 7-12=-5841/597, 7-9=-33/2873, 3-12=-686/221, 3-14=-0/308, 7-10=-313/1975

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-4-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-3-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- WARNING: Required bearing size at joint(s) 8 greater than input bearing size.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=336, 2=148.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 3353 lb down and 392 lb up at 21-10-7, 539 lb down and 22 lb up at 23-11-4, 539 lb down and 22 lb up at 25-11-4, and 539 lb down and 22 lb up at 27-11-4, and 540 lb down and 21 lb up at 29-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.



September 23,2020

Continued on page 2

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923378
400640	H8	COMMON GIRDER	1	2	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:34 2020 Page 2
ID:vBszku21ozNPT?RiZytJMSyXqDi-5U6Xs3r7jw4jryDm1GtnqMkCRkSEi9q974CsP1yapH?

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
 - Vert: 1-5=-70, 5-8=-70, 2-8=-20
- Concentrated Loads (lb)
 - Vert: 10=-3353(B) 15=-539(B) 16=-539(B) 17=-539(B) 18=-540(B)



Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923379
400640	H9	Roof Special	6	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:35 2020 Page 1

ID:vBsZku21ozNPT?RlZyYJMSyXqDi-Zhgv3OslUECaT6oybzOONZHNN8q6RgVIMkyPxTyapH_

0-10-8 7-9-10 15-6-0 22-0-0
0-10-8 7-9-10 7-8-6 6-6-0

5x7 =

Scale = 1:50.9

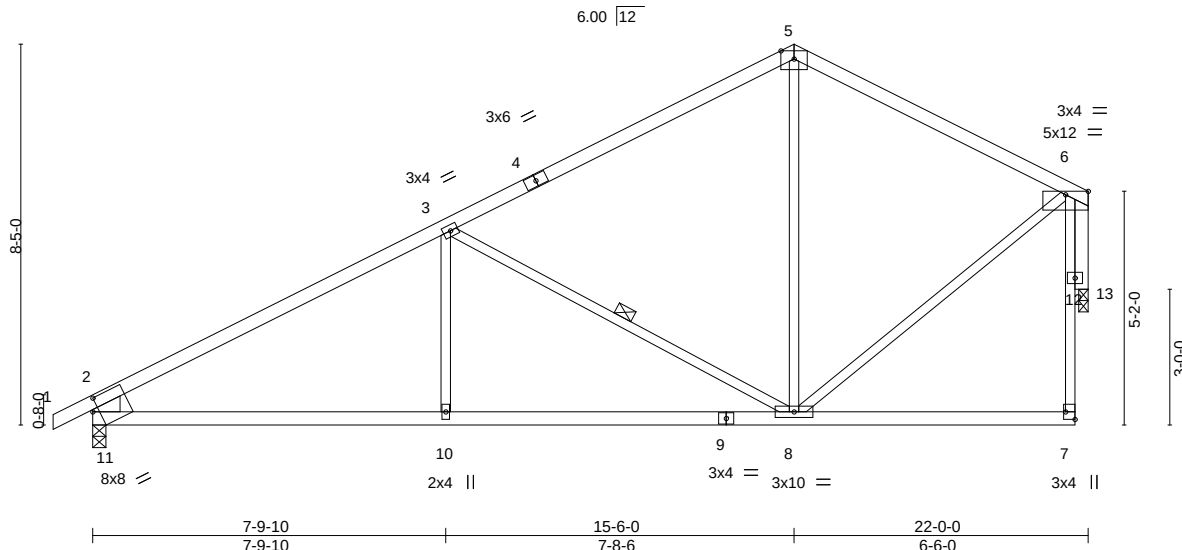


Plate Offsets (X,Y)--	[7:Edge,0-2-8], [11:0-1-10,0-3-4]
-----------------------	-----------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.88	Vert(LL)	-0.09	8-10	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.57	Vert(CT)	-0.21	8-10	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.53	Horz(CT)	0.17	13	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.05	8-10	>999	240	Weight: 84 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-11: 2x8 SP DSS
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 3-8

REACTIONS.


(size) 11=0-3-8, 13=0-2-8
Max Horz 11=223(LC 5)
Max Uplift 11=-156(LC 8), 13=-122(LC 8)
Max Grav 11=1056(LC 1), 13=943(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1465/195, 3-5=-768/129, 5-6=-705/160, 2-11=-966/201
BOT CHORD 10-11=-269/1196, 8-10=-269/1196
WEBS 3-10=0/302, 3-8=-733/262, 6-8=-93/646, 6-13=-955/124

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Bearing at joint(s) 13 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 13.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=156, 13=122.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

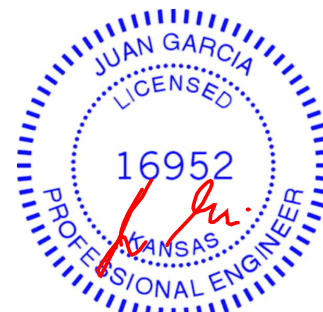

September 23,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923380
400640	J1	Diagonal Hip Girder	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:35 2020 Page 1

ID:vBszku21ozNPT?RlZyYtJMSyXqDi-Zhgv3OslUECaT6oybzO0NZHUm8v6RokIMkyPxTyapH_

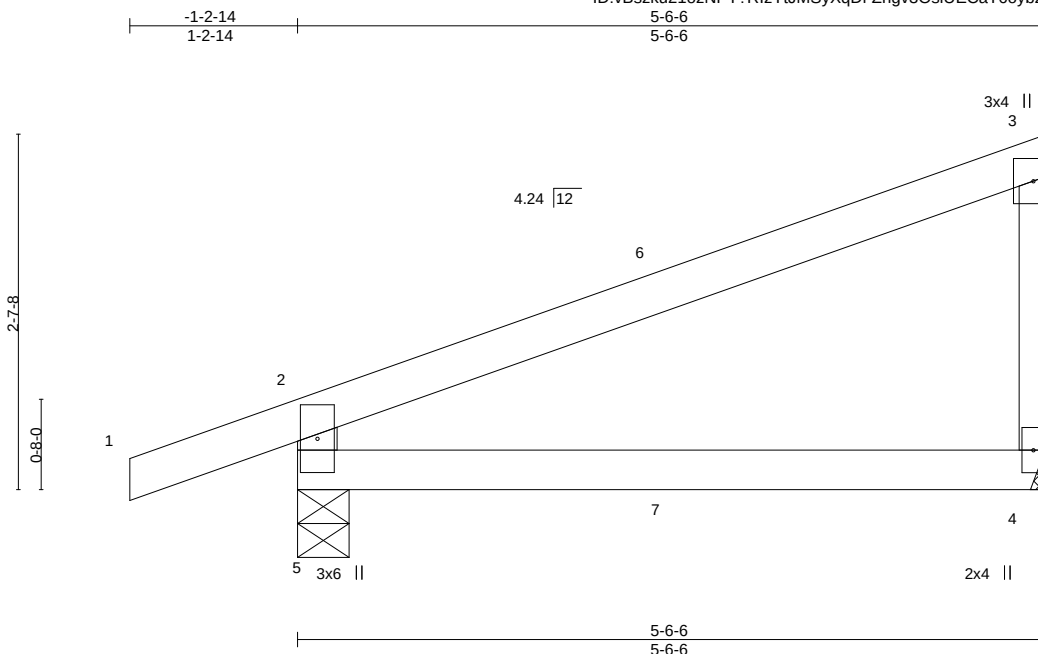

Scale = 1:17.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.41	Vert(LL)	-0.03	4-5	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.25	Vert(CT)	-0.07	4-5	>967	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.01	4-5	>999	240	Weight: 16 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2 *Except*
3-4: 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-6-6 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=0-4-9, 4=Mechanical
Max Horz 5=111(LC 5)
Max Uplift 5=101(LC 4), 4=50(LC 8)
Max Grav 5=346(LC 1), 4=224(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-306/140

NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=101.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 69 lb down and 36 lb up at 2-9-8, and 69 lb down and 36 lb up at 2-9-8 on top chord, and 3 lb down and 1 lb up at 2-9-8, and 3 lb down and 1 lb up at 2-9-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-3=-70, 4-5=-20
Concentrated Loads (lb)
Vert: 7=2(F=1, B=1)



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923381
400640	J2	Jack-Open	3	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:36 2020 Page 1

ID:vBszku21ozNPT?RlZyUjMSyXqDi-1tEHhktNFYKR4GN88hvFvnpigYHGAF_SbOhzSwyapGz

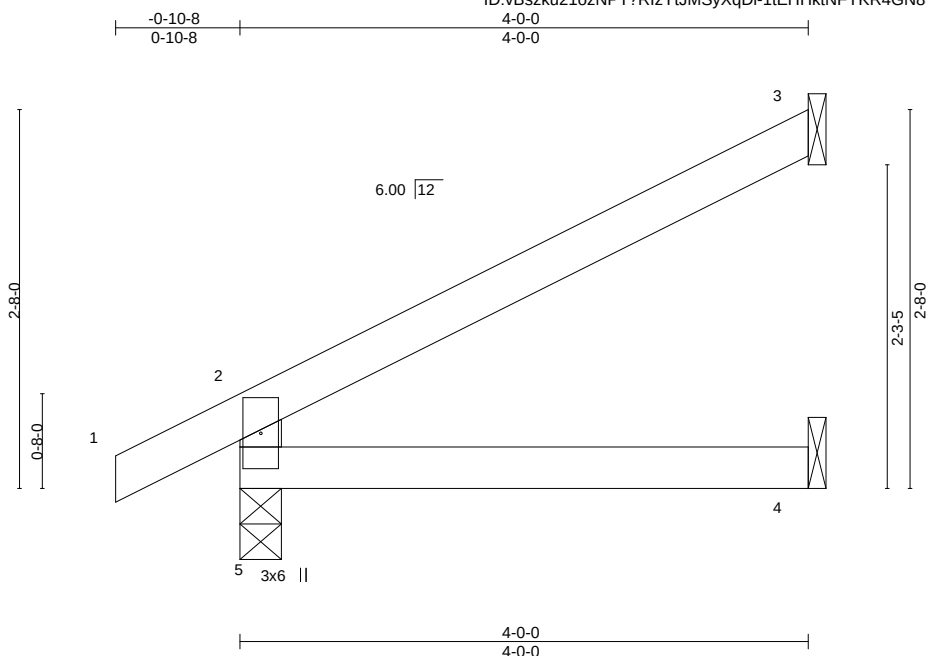

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.20	Vert(LL)	-0.01	4-5	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.13	Vert(CT)	-0.02	4-5	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.01	4-5	>999	240	Weight: 11 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-


TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=89(LC 8)
Max Uplift 5=-30(LC 8), 3=-66(LC 8)
Max Grav 5=252(LC 1), 3=116(LC 1), 4=71(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

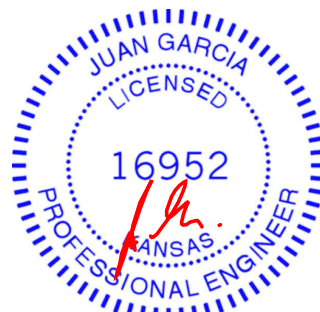

September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923383
400640	J4	Jack-Closed Supported Gable	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:37 2020 Page 1

ID:vBszku21ozNPT?RizYtJMSyXqDi-V3nfU4u?0rSliQyLiOQUS_MwBxeCviEbq2RW_MyapGy

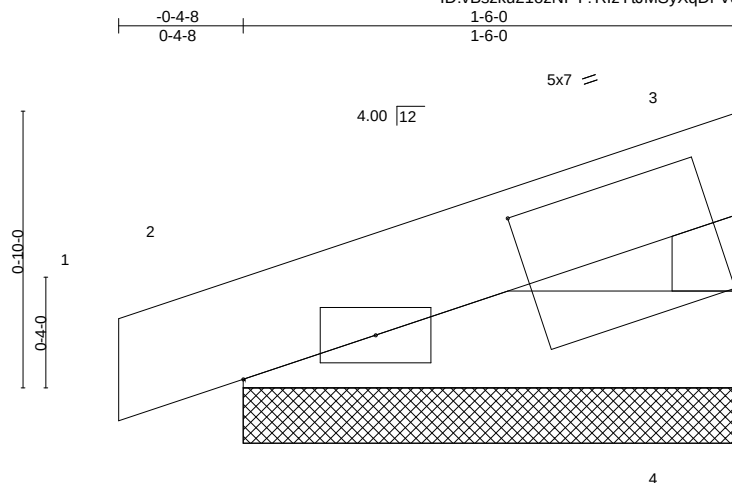

Scale = 1:6.9

2x4 =

Plate Offsets (X,Y)--		[3:0-10-14,0-2-8]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0		Plate Grip DOL	1.15	TC 0.03		Vert(LL)	-0.00 1	n/r	120	MT20	197/144
TCDL 10.0		Lumber DOL	1.15	BC 0.02		Vert(CT)	0.00 1	n/r	120		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.00		Horz(CT)	-0.00 4	n/a	n/a		
BCDL 10.0		Code IRC2018/TPI2014		Matrix-P						Weight: 4 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-6-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=1-6-0, 2=1-6-0
Max Horz 2=24(LC 5)
Max Uplift 4=-12(LC 8), 2=-28(LC 4)
Max Grav 4=59(LC 1), 2=93(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 2-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923385
400640	R1	FLAT GIRDER	1	2	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:38 2020 Page 1

ID:vBsZku21ozNPT?RizYtJMSyXqDi-FL1iQvdm9a9KZXXG6xj_Cv_ALy9e01I2IA4XoyapGx

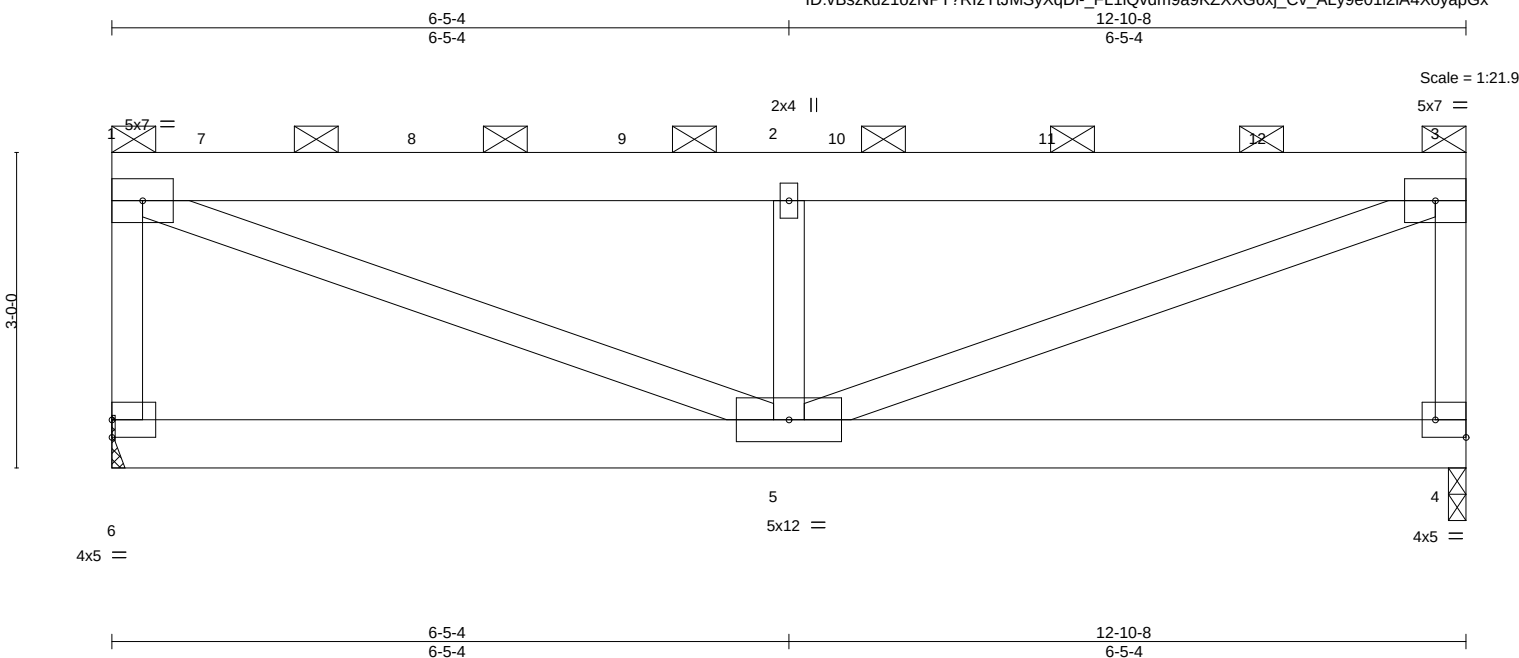


Plate Offsets (X,Y)--		[4:Edge,0-2-0]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 25.0	Plate Grip DOL	1.15	TC 0.46
TCDL 10.0	Lumber DOL	1.15	BC 0.16
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.61
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.06 5 >999 360
			Vert(CT) -0.11 5 >999 240
			Horz(CT) 0.00 4 n/a n/a
			Wind(LL) 0.04 5 >999 240
			PLATES
			MT20
			GRIP
			197/144
			Weight: 150 lb FT = 10%

LUMBER-

TOP CHORD 2x6 SP DSS
BOT CHORD 2x6 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.): 1-3, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=Mechanical, 4=0-2-0 (req. 0-2-6)
Max Horz 6=-77(LC 4)
Max Uplift 6=-372(LC 4), 4=-329(LC 5)
Max Grav 6=3373(LC 1), 4=3005(LC 1)

FORCES.


(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-6=-3245/393, 1-2=-4776/522, 2-3=-4776/522, 3-4=-2876/350
WEBS 1-5=-553/4925, 2-5=-3699/508, 3-5=-555/4937

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- WARNING: Required bearing size at joint(s) 4 greater than input bearing size.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=372, 4=329.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 879 lb down and 123 lb up at 1-0-0, 873 lb down and 125 lb up at 3-0-0, 873 lb down and 125 lb up at 5-0-0, 873 lb down and 125 lb up at 7-0-0, and 873 lb down and 125 lb up at 9-0-0, and 873 lb down and 125 lb up at 11-0-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

Continued on page 2

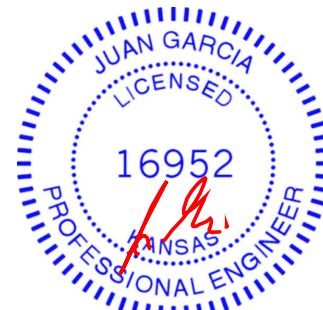

September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923385
400640	R1	FLAT GIRDER	1	2	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:38 2020 Page 2
ID:vBszku21ozNPT?RizYtJMSyXqDi-_FL1iQvdm9a9KZXXG6xj_Cv_ALy9e01I2iA4XoyapGx

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 4-6=-20
Concentrated Loads (lb)
Vert: 7=-879 8=-873 9=-873 10=-873 11=-873 12=-873

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job Reference (optional)


16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	
400640	V2	Valley	1	1		I42923387
Job Reference (optional)						

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:41 2020 Page 1

ID:vBsZku21ozNPT?RizYtJMSyXqDi-Oq1AKSxW34zkB1G6xEVQcqXZaZ_nrWDBkgPk77yapGu

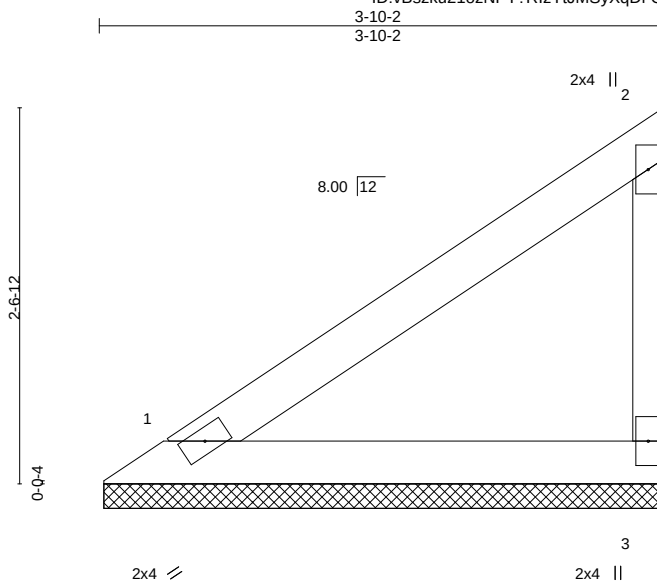

Scale = 1:15.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.19	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 11 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-10-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 1=3-9-12, 3=3-9-12
Max Horz 1=86(LC 7)
Max Uplift 1=-12(LC 8), 3=-42(LC 8)
Max Grav 1=147(LC 1), 3=157(LC 15)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

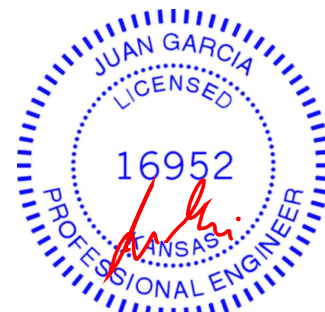

September 23,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923388
400640	V3	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:41 2020 Page 1

ID: vBsZku21ozNPT?RizYtJMSyXqDi-Oq1AKSxW34zkB1G6xEVQcXcpZ?zrWDBkgPk77yapGu

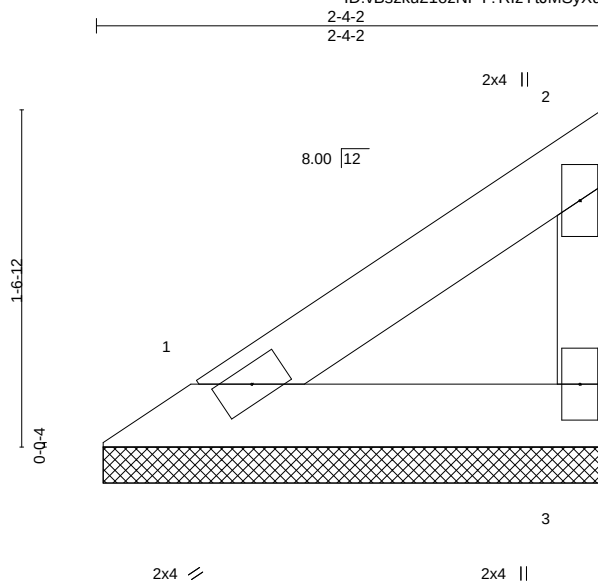

Scale = 1:10.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 6 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-4-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=2-3-12, 3=2-3-12
Max Horz 1=47(LC 5)
Max Uplift 1=-7(LC 8), 3=-23(LC 8)
Max Grav 1=79(LC 1), 3=85(LC 15)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923389
400640	V4	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:42 2020 Page 1
ID:vBsZku21ozNPT?RlZyYtJMSyXqDi-s1bYXoy8qQ05boBqIVx0f923jPyJiaXlKzK8HgZyapGt

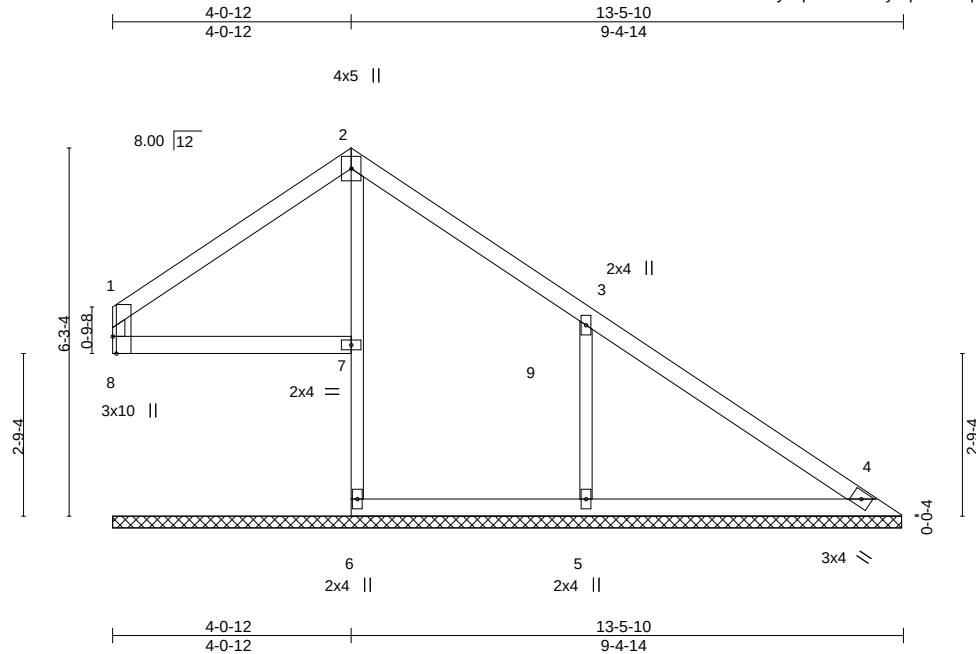

Scale = 1:39.2

Plate Offsets (X,Y)--		[8:0-3-8,Edge]	
LOADING (psf)		SPACING-	2-0-0
TCLL 25.0		Plate Grip DOL	1.15
TCDL 10.0		Lumber DOL	1.15
BCLL 0.0 *		Rep Stress Incr	YES
BCDL 10.0		Code IRC2018/TPI2014	
		CSI.	
		TC 0.32	
		BC 0.19	
		WB 0.11	
		Matrix-S	
		DEFL.	
		in (loc)	l/defl
		Vert(LL)	n/a - n/a 999
		Vert(CT)	n/a - n/a 999
		Horz(CT)	0.02 4 n/a n/a
		PLATES	GRIP
		MT20	197/144
		Weight: 41 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
2-6: 2x3 SPF No.2
WEBS 2x3 SPF No.2
OTHERS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0"-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6'-0"-0 oc bracing.

REACTIONS.

All bearings 13-5-4.
(lb) - Max Horz 8=-171(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 4, 7 except 8=-145(LC 9), 5=-191(LC 9)
Max Grav All reactions 250 lb or less at joint(s) 8, 4, 6 except 7=376(LC 18), 5=616(LC 16)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
BOT CHORD 2-7=-292/42
WEBS 3-5=-390/243

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6"-0 tall by 2'-0"-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 7 except (jt=lb) 8=145, 5=191.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:43 2020 Page 1
ID:vBsZku21ozNPT?RizYtJMSvXqDi-KD9w8vmbpHDSOLPU3fXuhFcymMfoJPKUC urC0vapGs



NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 7 except (jt=lb 8=106, 5=156.
- 8) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 8.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.




September 23, 2020

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923392
400640	V7	Valley	1	1	Job Reference (optional)	


Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:44 2020 Page 1

ID: vBsZku21ozNPT?RIzYtJMSyXqDi-oPiJyTzOM?LJ2U_hcM27ET92cm?W2rzdRedOkSyapGr



Scale = 1:21.8

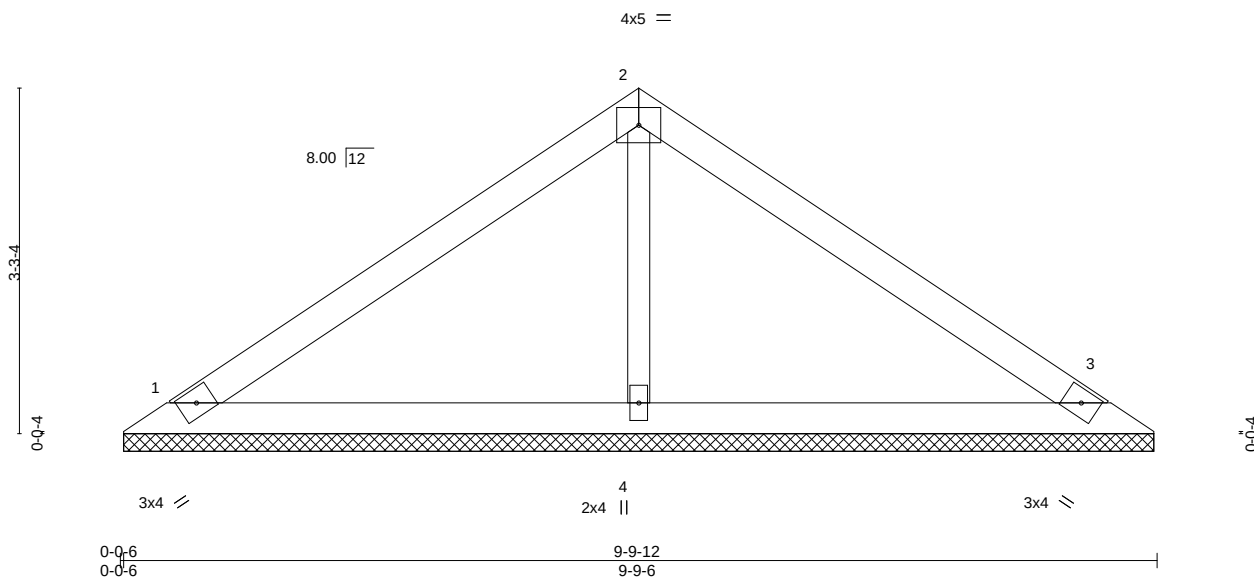

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.17	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 25 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 1=9-9-0, 3=9-9-0, 4=9-9-0
Max Horz 1=-77(LC 4)
Max Uplift 1=-39(LC 8), 3=-48(LC 9), 4=-15(LC 8)
Max Grav 1=205(LC 1), 3=205(LC 1), 4=387(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-252/64

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

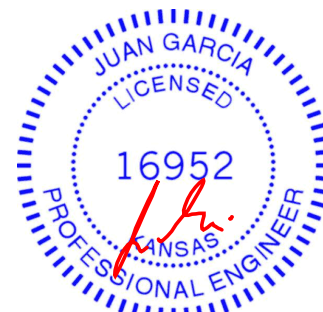

September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923393
400640	V8	Valley	1	1		


Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:45 2020 Page 1

ID:vBszku21ozNPT?RizYtJMSyXqDi-GcGhAp_07JTAfeZtA4ZMmghFBAMBnJlInfxGuyapGq

6-9-12
3-4-14

Scale = 1:16.4

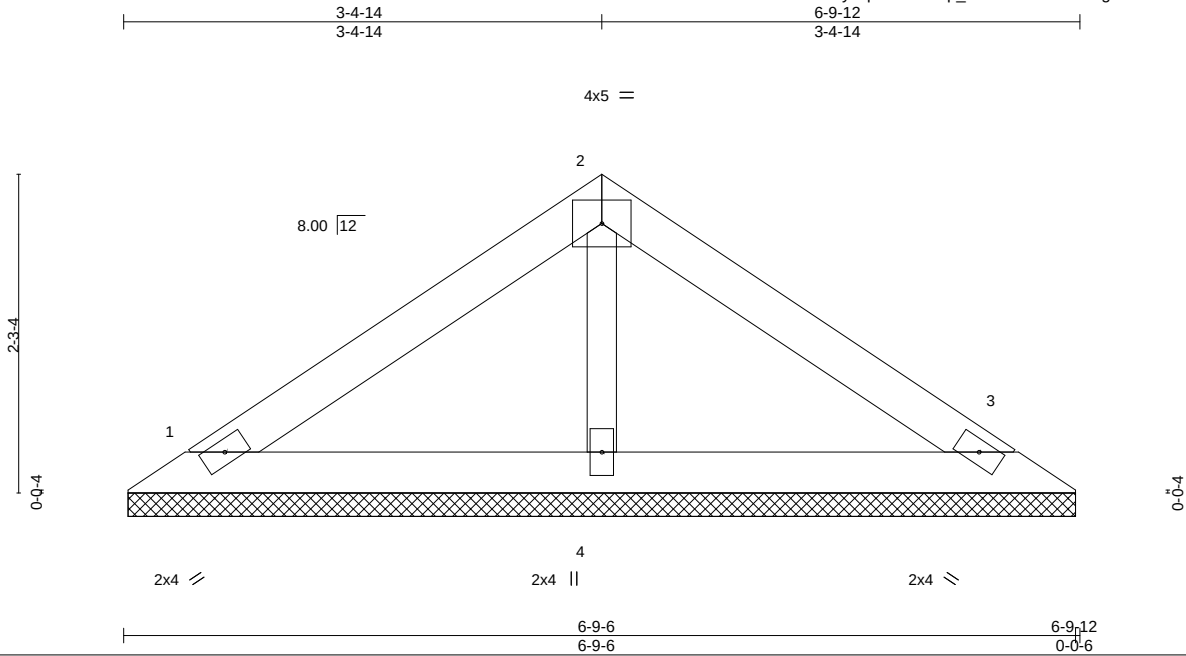

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 17 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=6-9-0, 3=6-9-0, 4=6-9-0
Max Horz 1=-51(LC 4)
Max Uplift 1=-33(LC 8), 3=-39(LC 9)
Max Grav 1=148(LC 1), 3=148(LC 1), 4=230(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:45 2020 Page 1

ID:vBszku21ozNPT?RlZyTjMSyXqDj-GcGhAp_07JTAfeZtA4ZMmqhH4AM3nJDnflNxGuyapGg



TOP CHORD	Structural wood sheathing directly applied or 3-9-12 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601.




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923395
400640	V10	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:39 2020 Page 1

ID:vBszku21ozNPT?RizYtJMSyXqDi-SSvQvmvFXTj0xj6jqpSyXPRe6lJMNcvuHMwd3FyapGw

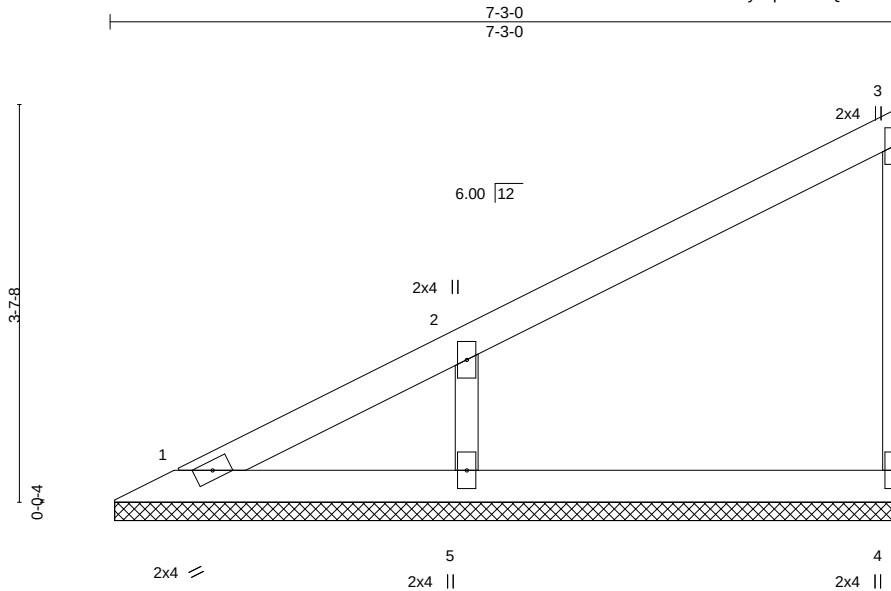

Scale = 1:21.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.19	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 20 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2
OTHERS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=7-2-8, 4=7-2-8, 5=7-2-8
Max Horz 1=136(LC 5)
Max Uplift 4=-26(LC 8), 5=-113(LC 8)
Max Grav 1=82(LC 16), 4=141(LC 1), 5=378(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-5=-294/164

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=113.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923396
400640	V11	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:40 2020 Page 1
ID:vBszku21ozNPT?RizYtJMSyXqDi-weTo76wtlmrtZthvNWzB4d_NZ9dr63z2W0fAbhyapGv

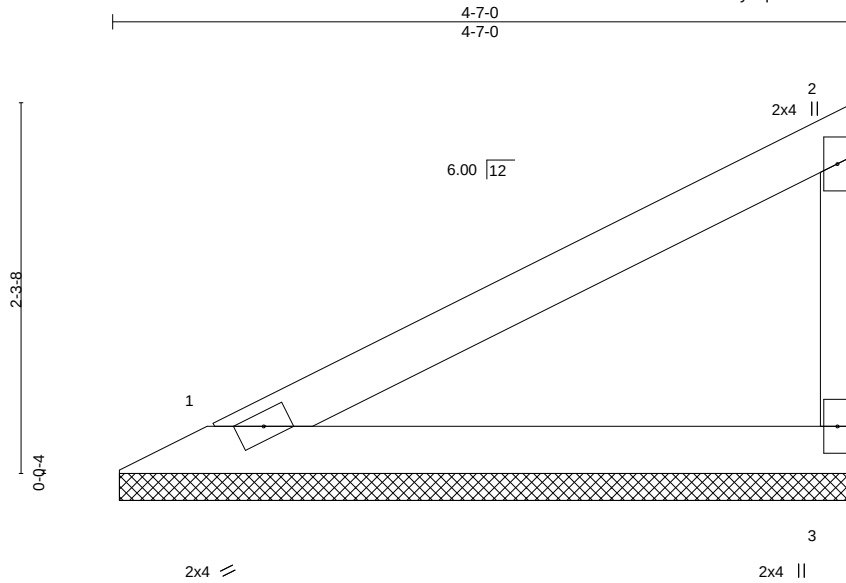

Scale = 1:14.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 12 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-7-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=4-6-8, 3=4-6-8
Max Horz 1=80(LC 5)
Max Uplift 1=-22(LC 8), 3=-42(LC 8)
Max Grav 1=173(LC 1), 3=173(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923397
400640	V12	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:40 2020 Page 1
ID:vBszku21ozNPT?RizYtJMSyXqDi-weTo76wtlmtZthvNWzB4d_Q89fF63z2W0fAbhyapGv

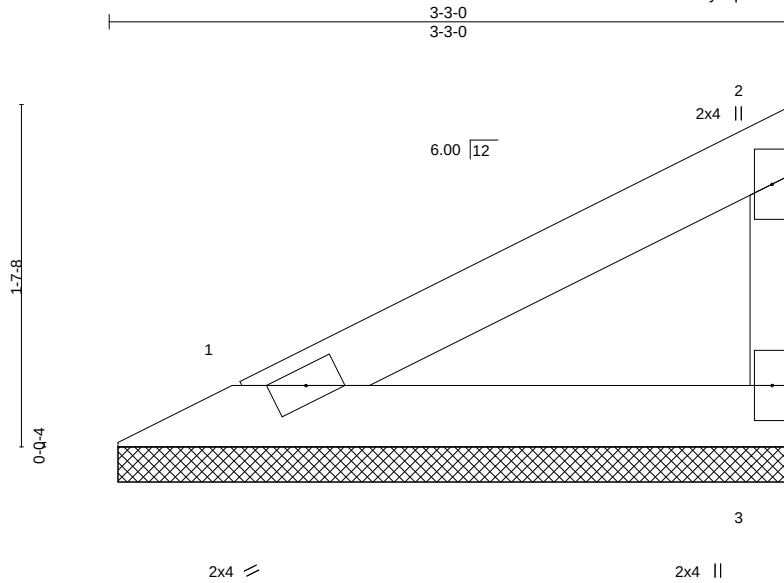

Scale = 1:10.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 8 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-3-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=3-2-8, 3=3-2-8
Max Horz 1=53(LC 5)
Max Uplift 1=-15(LC 8), 3=-28(LC 8)
Max Grav 1=113(LC 1), 3=113(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 27 H4	I42923398
400640	V13	Valley	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS 66871

8.420 s Aug 25 2020 MiTek Industries, Inc. Wed Sep 23 07:57:41 2020 Page 1

ID:vBsZku21ozNPT?RlZyUjMSyXqDi-Oq1AKSxW34zkB1G6xEVQcXUQZx_rWDBkgPk77yapGu

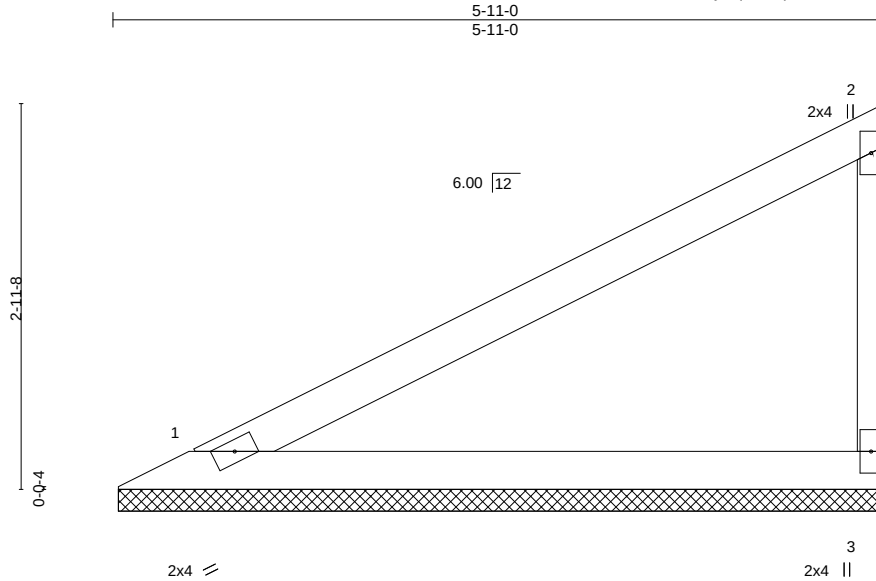

Scale = 1:17.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.52	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 15 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=5-10-8, 3=5-10-8
Max Horz 1=108(LC 5)
Max Uplift 1=30(LC 8), 3=57(LC 8)
Max Grav 1=233(LC 1), 3=233(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



September 23, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless X, Y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

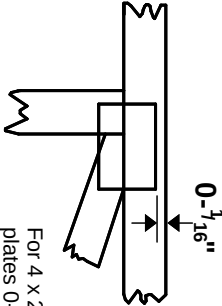

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

—
—
This symbol indicates the required direction of slots in connector plates.

*** Plate location details available in MITek 20120 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

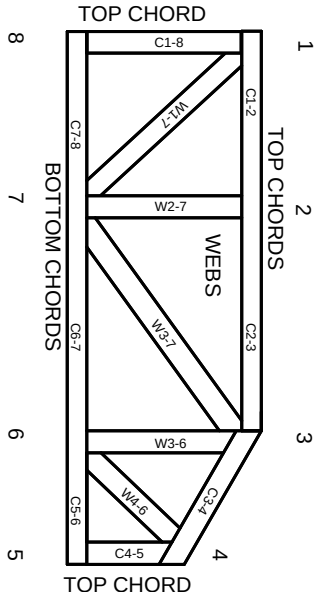

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.