

APPROVED

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY
AND GENERAL CONFORMANCE TO CONTRACT
DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE
FOR CONFIRING AND CORRELATING DIMENSIONS AT
JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES,
FABRICATION PROCESSES AND
TECHNIQUES OF CONSTRUCTION, COORDINATION OF


TECHNIQUES OF CONSTRUCTION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

RESIDENTIAL ENGINEERING SERVICES, LLC

Brad A. Huxol, P.E.

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

10/21/2020

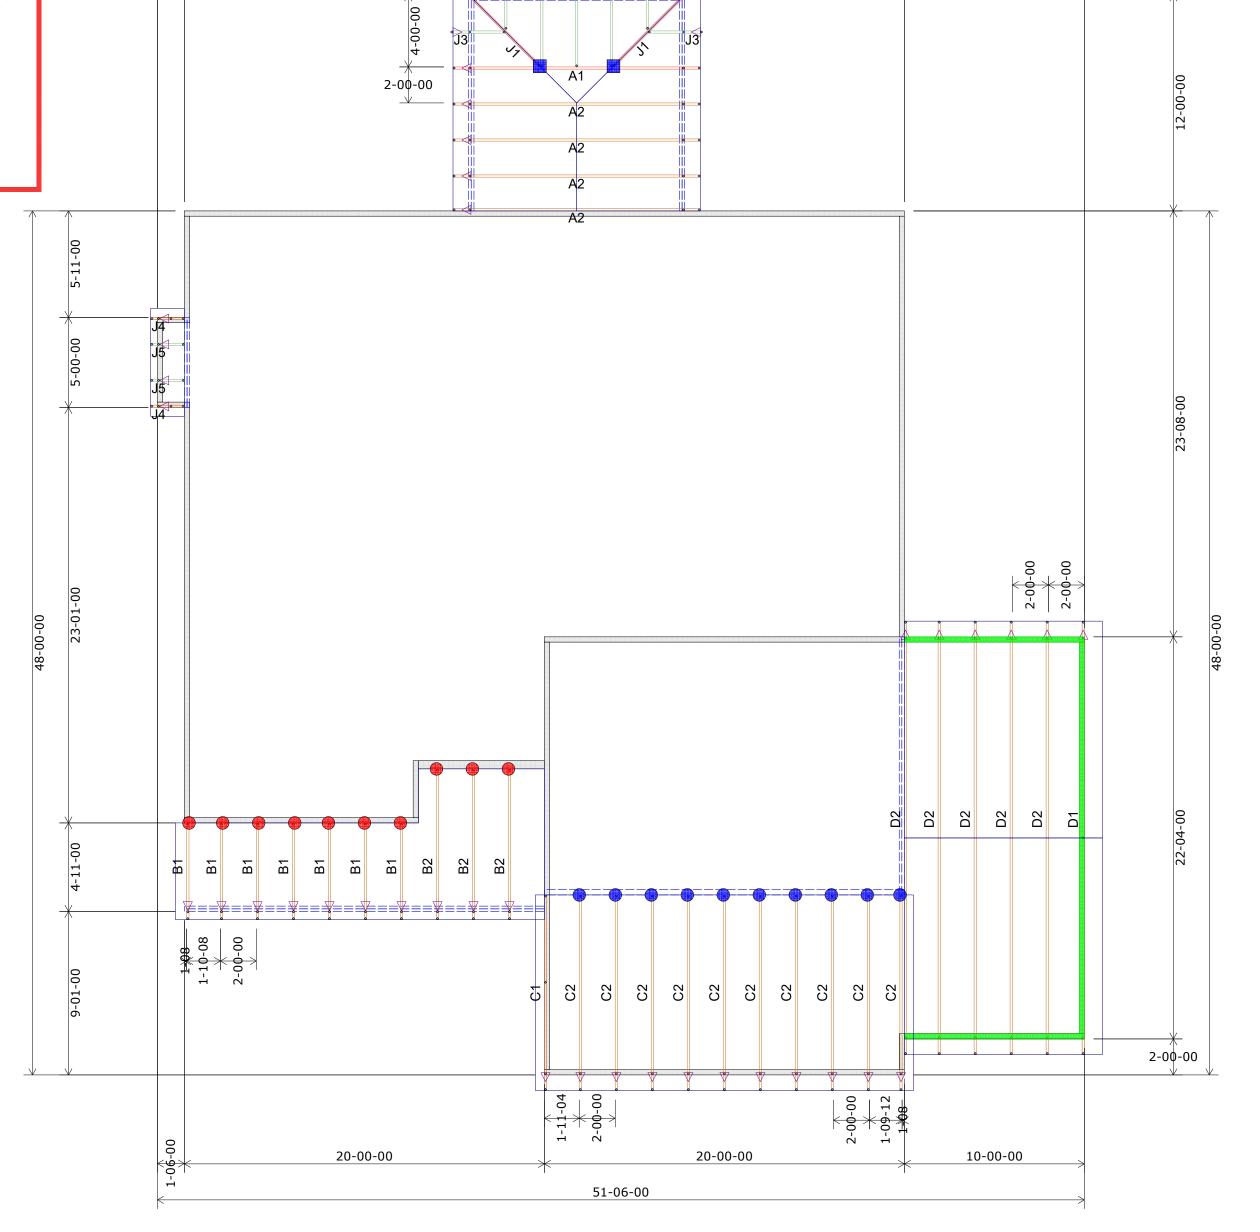

51-06-00


12-02-08

10-00-00

12-00-00

15-09-08

	HANGER SCHEDULE	Quantity				MO		
	LUS24	10						
	LUS26	14						
	HUS26	9			3016 SW Arbor Tree Dr.			
A	HHUS26-2	0		lge			0	
_	HGUS26-2	1	S	SUMMIT HOMES Lot 27 Hawthorn Ridge			424	
	HGUS28-3	0	ME				.46-	
	LTHJA26	0	НС	ıwtb	Ark	mi	85-7	940
	TJC37	2	MIT	7 Hz	SW	Summit	e 78	400
	TJC57	0	JM	ot 27	116	ree's	Chance 785-746-4240	Job # 400640
_	HTS20	0	SI	L	3(Le	Ü	Jo
Triangle denotes the left end of the Truss as it appears on the Engineered Drawings					ddress	State		
provided.		Customer	Job Name	Job Site Address	City,	Designer	9/28/2020	



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

incoporated into the building design at the specification of the building designer. See individual design sheets for each incoporated into the building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss apport structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding beacing, consult "Bracing of wood trusses" available from the Truss Plate Institute, 383 DOnifrio Drive; Madison, WI 53179.

Shop Drawing Approval

THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BULLT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.


Wall Heights 9-01-02 U.N.O. 8-01-02

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871



1st Floor Truss Layout

Scale: 3/16" = 1'

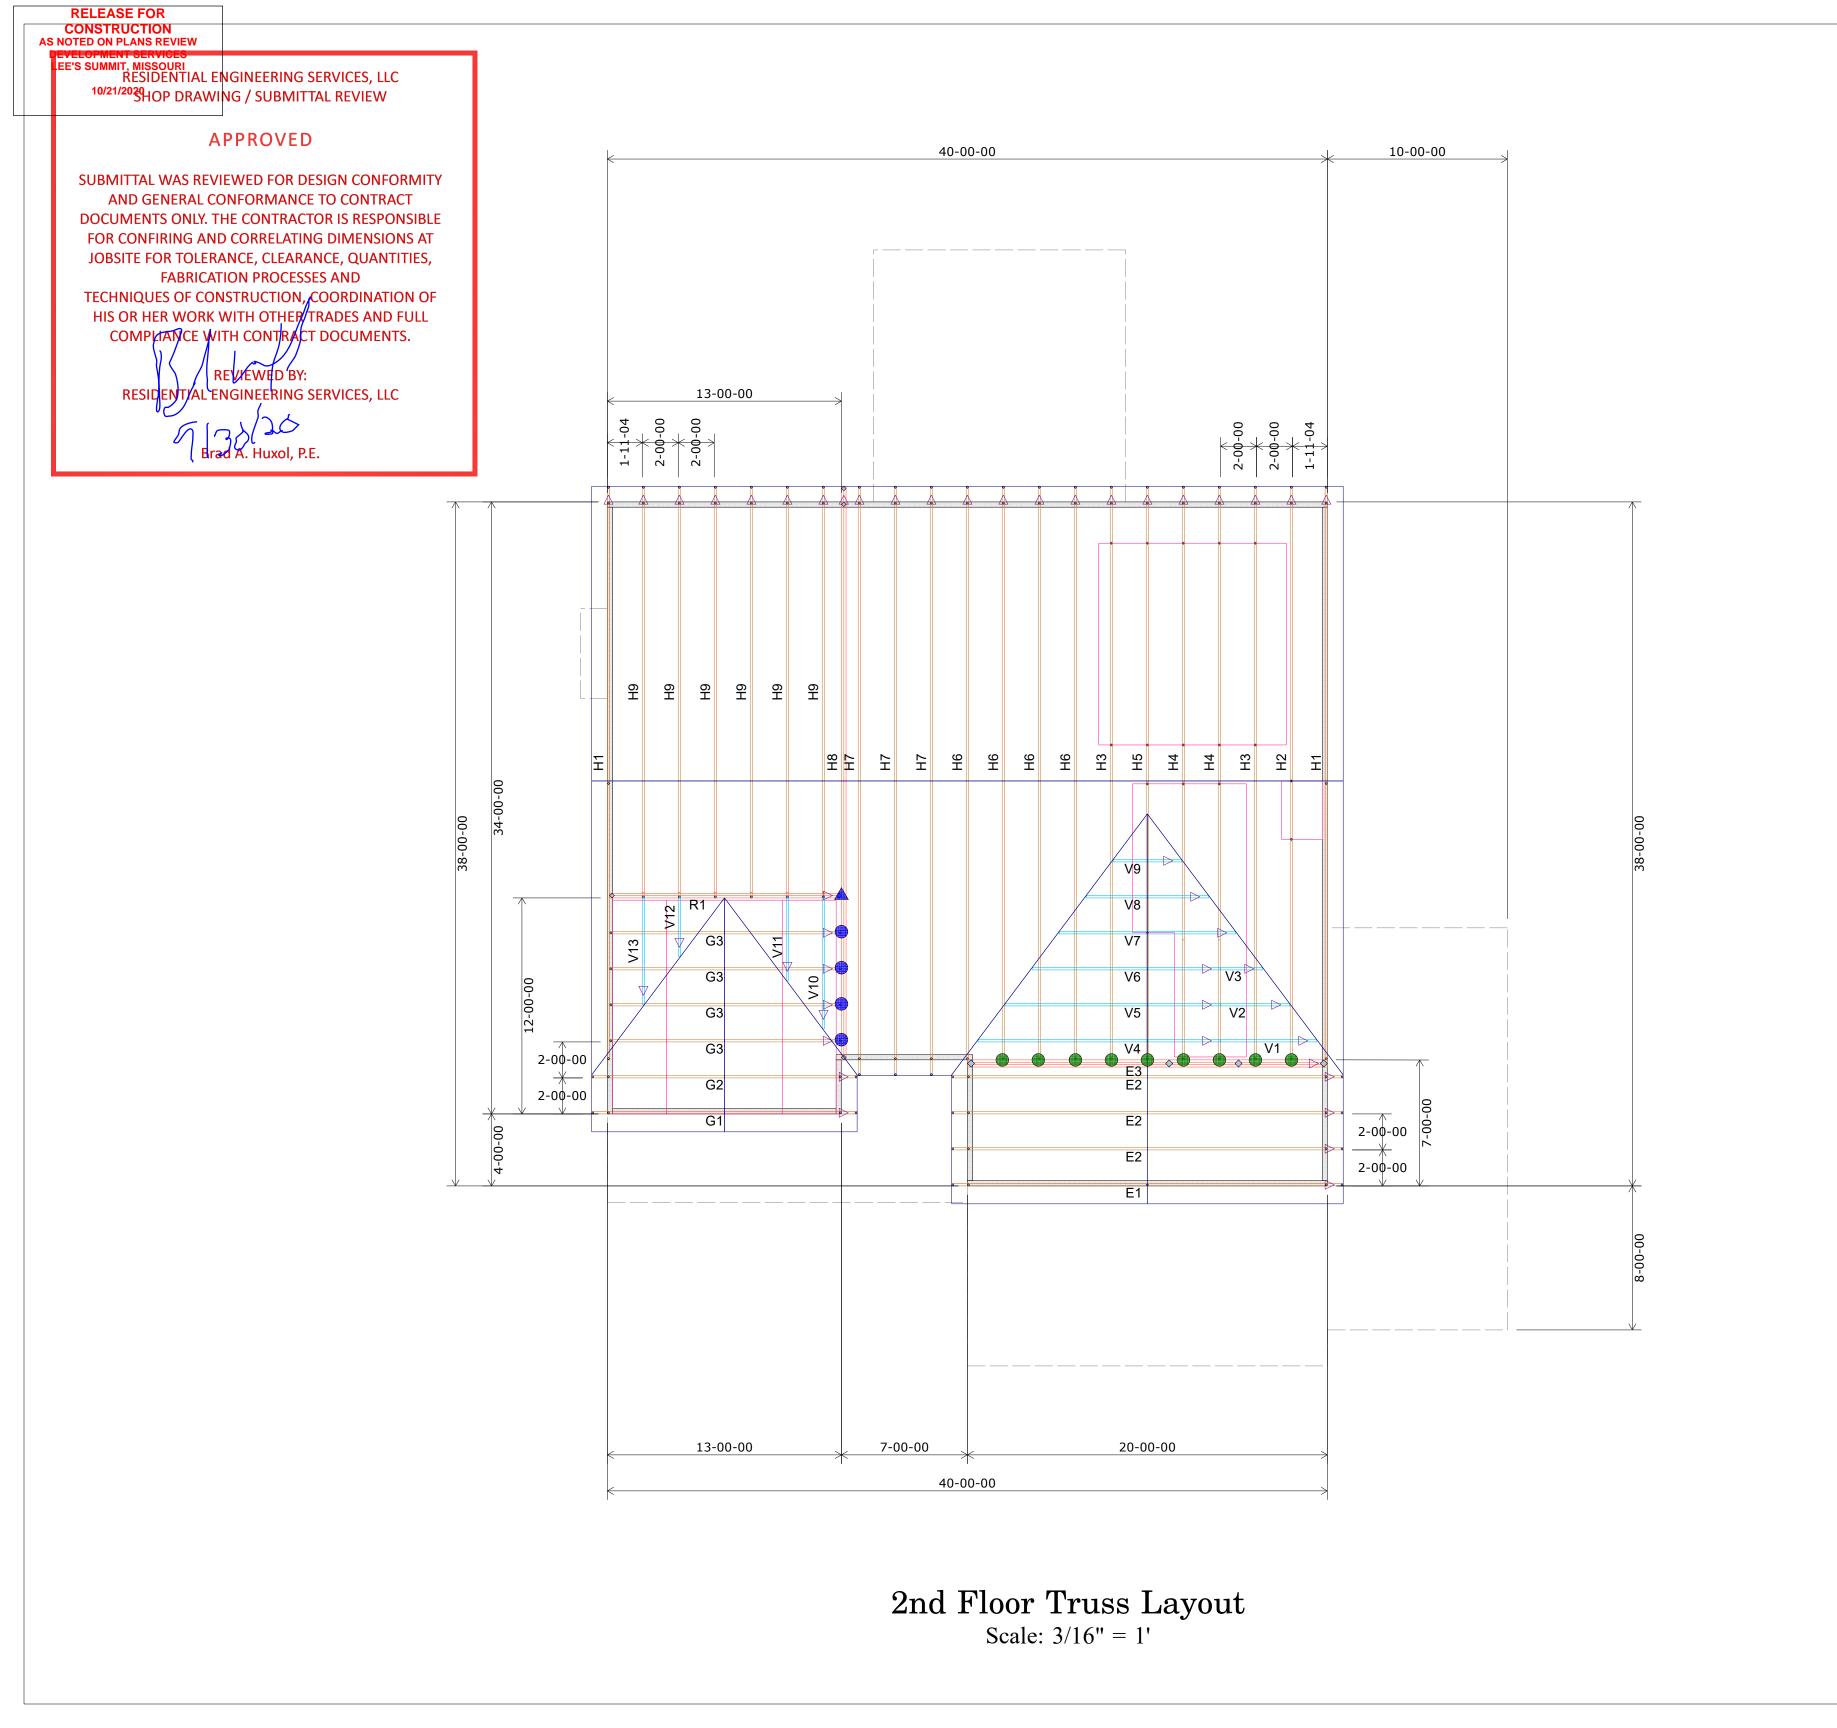

	HANGER SCHEDULE	Quantity							
	LUS24	10		Lot 27 Hawthorn Ridge	Tree Dr.	MO			
	LUS26	14							
	HUS26	9							
	HHUS26-2	0					O.		
_	HGUS26-2	1	N			Lee's Summit	Chance 785-746-4240	Job # 400640	
	HGUS28-3	0	M		or				
	LTHJA26	0	H		3016 SW Arbor Tree Dr.				
	TJC37	2	M						
	TJC57	0	M						
_	HTS20	0	S	Ľ	3(Ľ	C	Jo	
Triangle denotes the left end of the Truss as it appears on the Engineered Drawings					ldress	State			
provided.			er	ne	Ac] ,	50	
			Customer	Job Name	Job Site Address	City,	Designer	9/28/2020	



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult "Bracing o wood trusses" available from the Truss Plate Institute, 583 D'Onifrio Drive, Madison, WI 53179.	Shop Drawing Approval	THIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL B VERIEY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YO
---	-----------------------	---

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871

