



ELEVATION 'B'




ELEVATION 'A'

architects
Webster

1060 S. GREEN ROAD
CLATHE, KS 66061
PHONE: 913-390-4663
www.WebsterArchitects.com

EAGLE CREEK LOT 726
2334 SW OLD PORT ROAD
LEE'S SUMMIT, MO. 64082

BRANDON LOGAN
P.O. BOX 6423
LEE'S SUMMIT, MO 64064

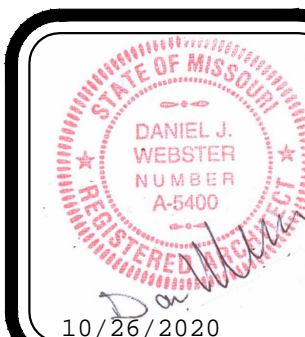

DRAWN BY: MP
DATE: 10-10-20
PROJECT NO: 15-016-03

SHEET NO.
A0

FLOOR PLAN - SYMBOL LEGEND	
DESCRIPTION	SYMBOL
INTERIOR LOAD BEARING WALL	
STONE OR BRICK VENEER	
JOIST SIZE AND DIRECTION	
HEADER/ BEAM	SIZE OF MEMBER PER SCHEDULE
HEADER/ BEAM SCHEDULE	NUMBER OF FLYS
NUMBER OF FLYS	"U" IF UPSET
CENTERLINE	
POINT LOAD	
APPROX. WINDOW FRAME SIZE IN INCHES (SEE GENERAL NOTES BELOW)	
SMOKE ALARM	
SMOKE + CARBON MONOXIDE ALARM	

HEADER / BEAM SCHEDULE		
MARK	LUMBER SIZE	MARK L.V.L. SIZE
(A)	2 x 6	(E) 3/4" x 1 1/4"
(B)	2 x 8	(F) 3/4" x 3 1/2" (NOTE 3)
(C)	2 x 10	(G) 3/4" x 11 1/8"
(D)	2 x 12	(H) 3/4" x 14"
		(I) 3/4" x 16"
		(J) 3/4" x 18"

1.) ALL HEADERS IN EXTERIOR AND IN INTERIOR LOAD BEARING WALLS ARE TO BE TYPE "C 2" UNO.
2.) HEADERS SHALL HAVE 1 KING AND 1 TRIMMER STUD UNO. BEAMS SHALL HAVE 2 BEARING STUDS BELOW EACH END UNO.
3.) FOR L.V.L. BEAMS IN 2x10 FLOORS, USE 3/4" L.V.L.

FLOOR JOIST SCHEDULE				
MARK	TYPE	SUB-TYPE	SIZE	SPACING MAX. SPAN
FJ-1	"1" JOIST (SEE NOTE)		3/4" 12"	PER MANUFACTURER
FJ-2	"1" JOIST (SEE NOTE)		11 7/8"	PER MANUFACTURER
FJ-3	"1" JOIST (SEE NOTE)		14"	PER MANUFACTURER
FJ-4	TRUSSED (SEE NOTES)		14"	PER MANUFACTURER
FJ-5	TRUSSED (SEE NOTES)		16"	PER MANUFACTURER
FJ-20	LUMBER	ACQ. TREATED	2x10	12" O.C. 16'-2"
FJ-21	LUMBER	ACQ. TREATED	2x10	16" O.C. 14'
FJ-22	LUMBER		2x8	12" O.C. 14'-2"
FJ-23	LUMBER		2x8	16" O.C. 12'-1"
FJ-24	LUMBER		2x10	12" O.C. 11'-9"
FJ-25	LUMBER		2x10	16" O.C. 15'-5"
FJ-26	LUMBER		2-2x10	16" O.C.

NOTE: DESIGN 1-JOISTS (LOADED W/ TOTAL LIVE AND DEAD LOAD) WITH A MAX. DEFLECTION OF L/360, EXCEPT BELOW BATHROOMS AND TILED AREAS WHERE THE DEFLECTION SHALL BE L/480 MAX.

CONCRETE WALL SCHEDULE				
MARK	CONCRETE WALL THICKNESS	REINFORCING HEIGHT	GRADE 40 VERTICAL HORIZONTAL	
(A)	8"	4' OR LESS	4/8" AT 36" O.C.	2 - 4/8"
(B)	8"	4' TO 6'	4/8" AT 36" O.C.	3 - 4/8"
(C)	8"	6' TO 8'	4/8" AT 16" O.C.	4 - 4/8"
(D)	8"	8' TO 10'	4/8" AT 16" O.C.	4 - 4/8"
(E)	8"	10' TO 12'	4/8" AT 12" O.C.	5 - 4/8"
(F)	10"	4'	4/8" AT 36" O.C.	2 - 4/8"
(G)	10"	8'	4/8" AT 36" O.C.	4 - 4/8"
(H)	10"	9'	4/8" AT 16" O.C.	5 - 4/8"
(I)	10"	10'	4/8" AT 12" O.C.	6 - 4/8"

COLUMN & PAD SCHEDULE				
MARK	PAD SIZE	#4 BARS REQ'D EACH WAY	COLUMN SIZE (SCHEDULE 40)	MAX. LOAD
(A)	36"x36"x12"	6	3"	13.5 K
(B)	48"x48"x16"	8	3"	24.0 K
(C)	60"x60"x18"	10	3.5"	37.5 K
(D)	72"x72"x24"	12	5"	54.0 K

PIER SCHEDULE			
MARK	PIER DIAMETER	POST (ACQ OR CEDAR UNO.)	MAX. LOAD
(F)	12"	6x6 UNO.	11 K
(G)	18"	6x6 UNO.	2.6 K
(H)	24"	6x6 UNO.	4.1 K

1.) PAD AND PIER SIZES ASSUME 1500 P.S.F. SOIL BEARING CAPACITY.
2.) 10' MAX. STEEL COLUMN HEIGHT FROM BASE PLATE TO TOP OF COLUMN. CONSULT ARCHITECT IF SITE CONDITIONS REQUIRE TALLER COLUMNS.

GENERAL NOTES:

A. WINDOW SIZES SHOWN ARE APPROXIMATE. THE BUILDER SHALL SELECT WINDOWS TO MEET BUILDING CODE REQUIREMENTS AND TO FIT IN THE AVAILABLE SPACE. OVERALL ROUGH OPENINGS FOR MULLED UNITS WILL VARY BY WINDOW/ DOOR MANUFACTURER. SEE GENERAL NOTES ON SHEET G1 FOR ADDITIONAL WINDOW REQUIREMENTS.

B. EXTERIOR FRAMED WALLS ARE 2x4 STUDS AT 16" O.C. UNLESS NOTED OTHERWISE.

C. INSTALL 1/2" ANCHOR BOLTS WITH 1" MIN. EMBEDMENT AT 3'-0" O.C. MAX. WHERE THE CONC. WALL IS FULL HEIGHT AND 6'-0" O.C. MAX. WHERE THE WALL IS PARTIAL HEIGHT OR AT WALK-OUT CONDITIONS AND WITHIN 6"-12" OF THE END OF THE SILL PLATE.

D. 1/2" MIN. GYPSUM BOARD SHALL BE APPLIED TO THE GARAGE SIDE OF THE WALL SEPARATING THE GARAGE FROM ANY LIVING AREA'S.

FOUNDATION PLAN NOTES

1. CONCRETE SLAB, CONCRETE PIER AND PAD - SEE DETAIL 3/G2


2. 16" WIDE X 8" DEEP CONCRETE FOOTING W/2-#4 BARS CONTINUOUS

3. 2x4 STUDS @ 16" O.C. WITH TREATED SILL PLATE.

NOTE:

AS AN ALTERNATE TO REBAR IN THE CONCRETE, HELIX MICRO REBAR CAN BE ADDED TO CONCRETE MIX PER MANUFACTURERS REQUIREMENTS.

SEE SHEET A2 FOR CEILING SCHEDULE

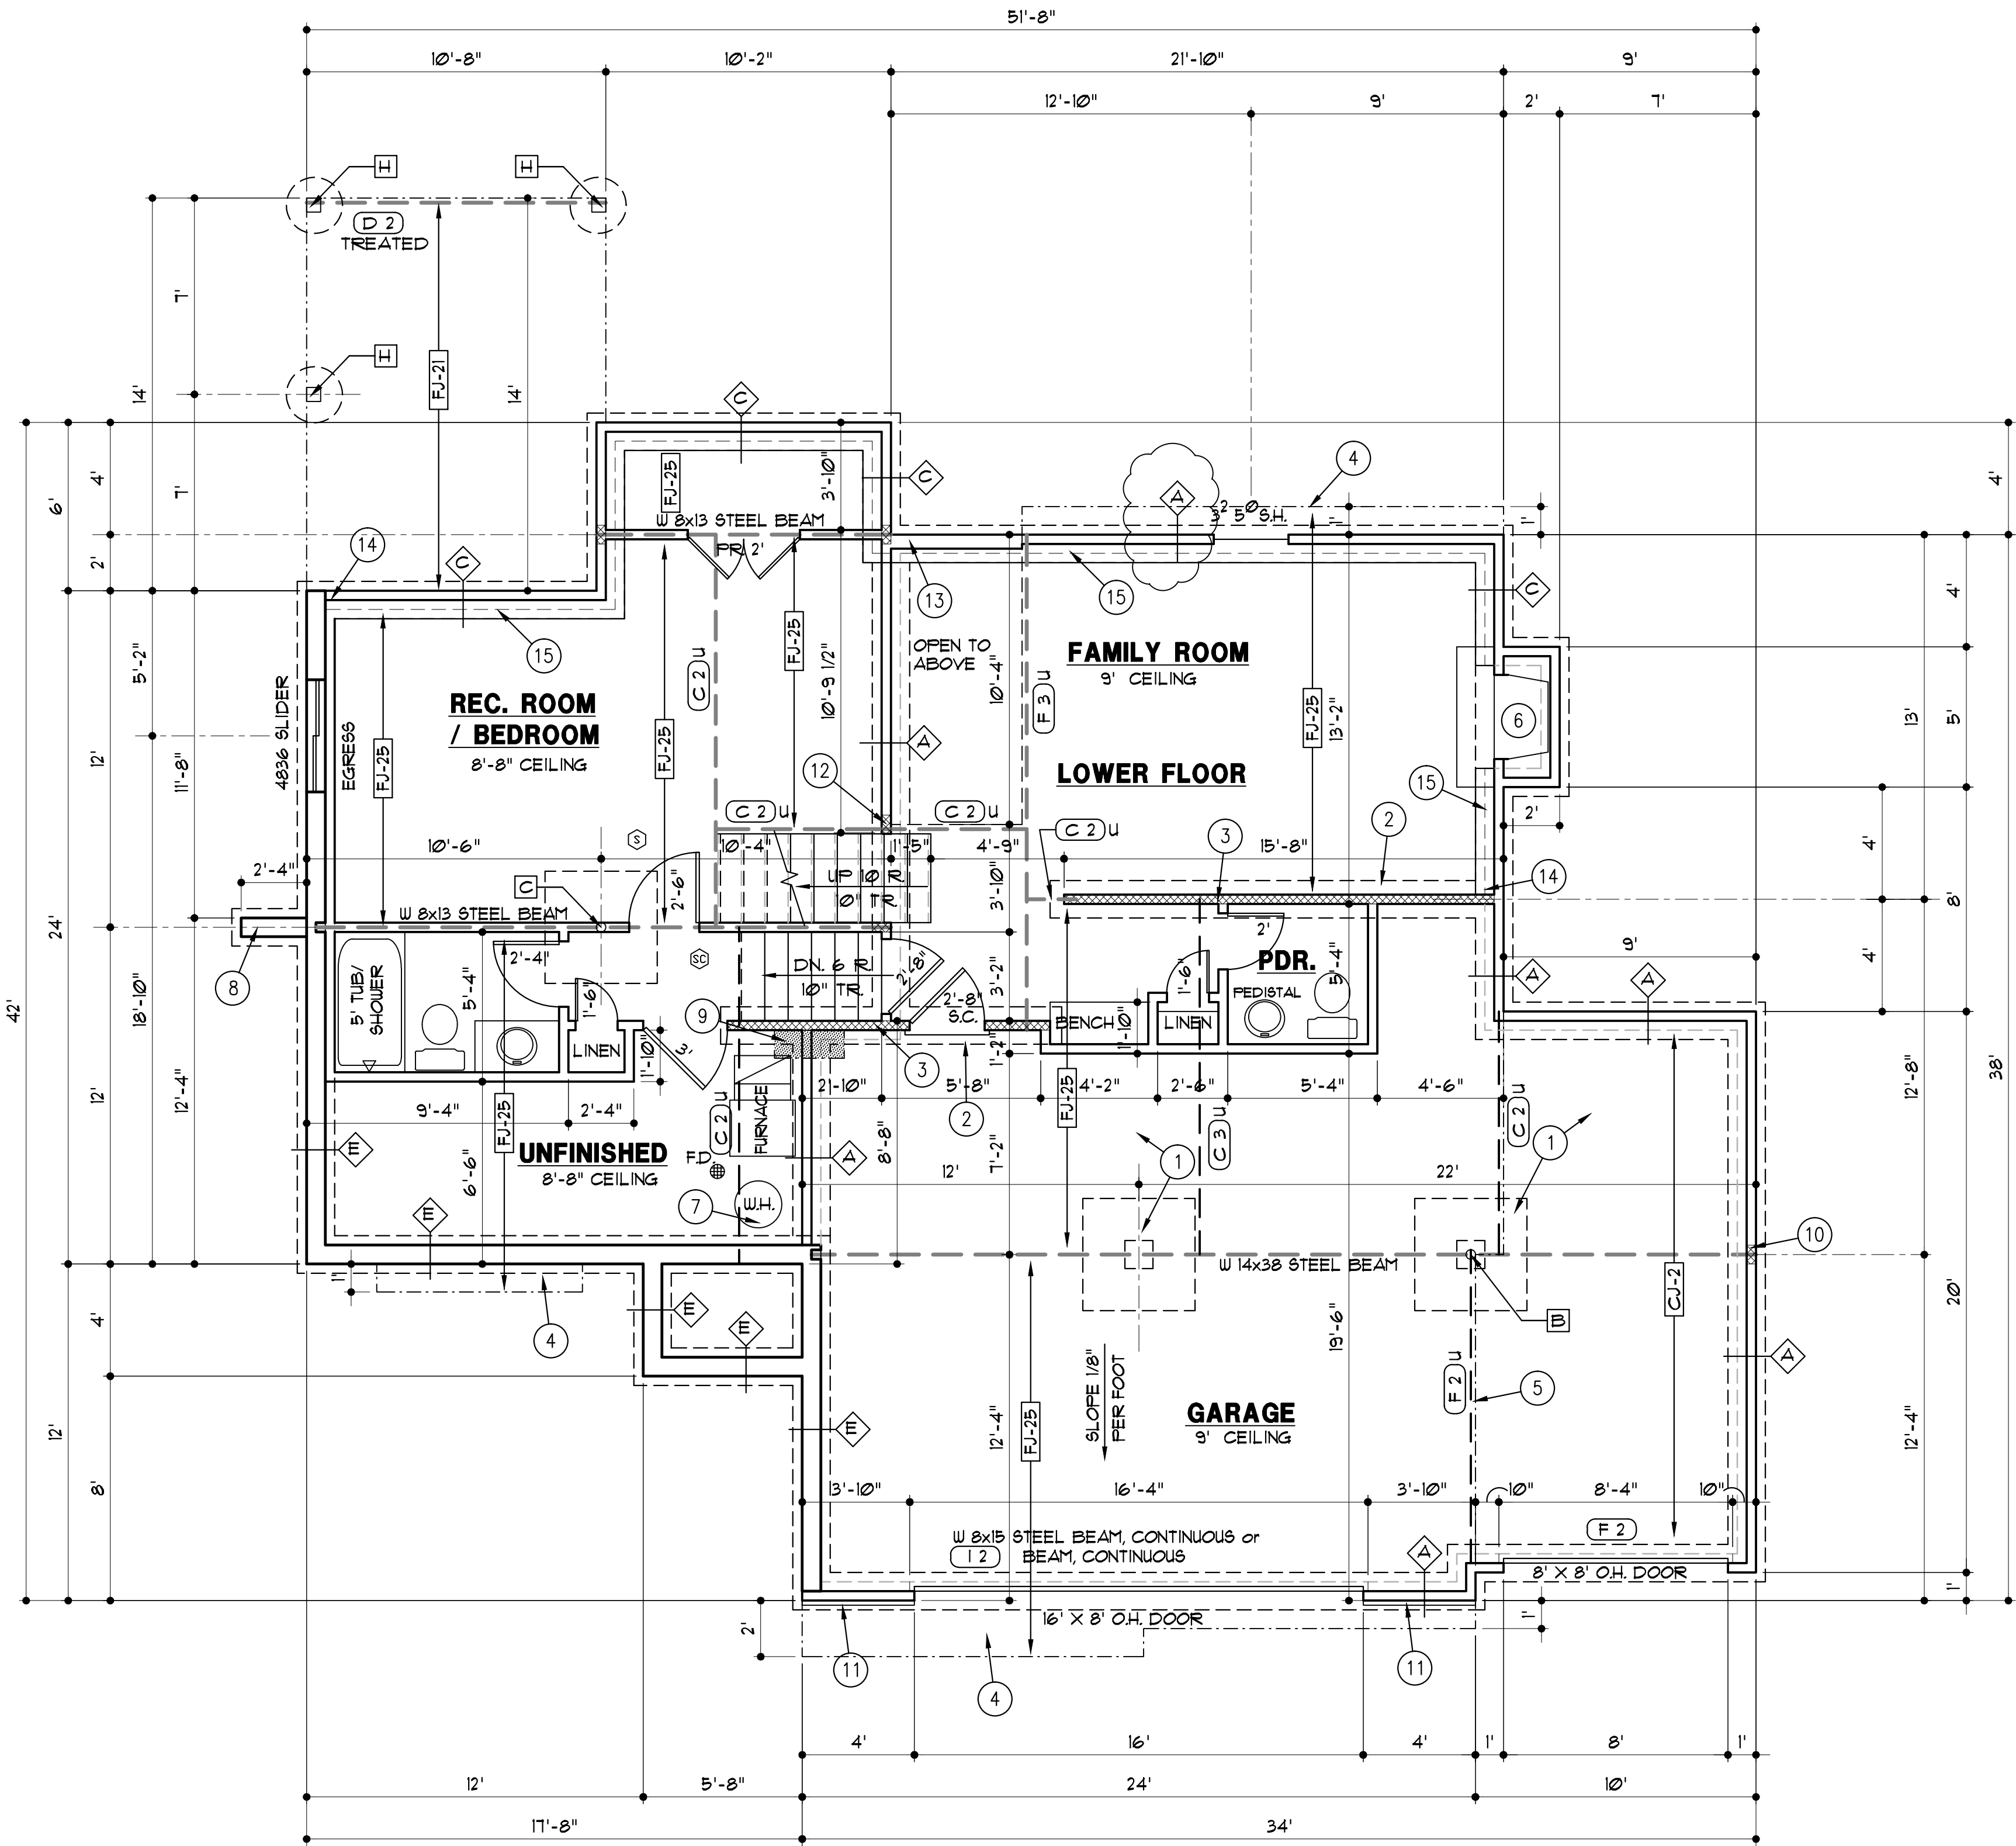


FOUNDATION PLAN
1/4" = 1'-0"

10-24-20 REVISE FOUNDATION ELEVATIONS

EAGLE CREEK LOT 726
2334 SW OLD PORT ROAD
LEE'S SUMMIT, MO. 64082

BRANDON LOGAN
P.O. BOX 6423
LEE'S SUMMIT, MO 64064

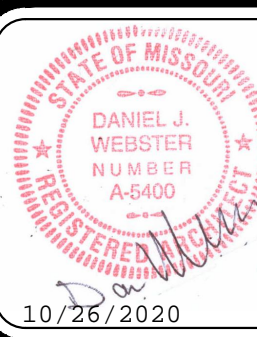

DRAWN BY: MP
DATE: 10-10-20
PROJECT NO: 15-016-03

SHEET NO.
A1

Webster architects
1060 S. GREEN ROAD
OLATHE, KS 66061
PHONE: 913-390-4663
www.WebsterArchitects.com

FLOOR PLAN - SYMBOL LEGEND	
DESCRIPTION	SYMBOL
INTERIOR LOAD BEARING WALL	
STONE OR BRICK VENEER	
JOIST SIZE AND DIRECTION	
HEADER/ BEAM	SIZE OF MEMBER PER SCHEDULE
NUMBER OF FLYS	U" IF UPSET
CENTERLINE	
POINT LOAD	
APPROX. WINDOW FRAME SIZE IN INCHES (SEE GENERAL NOTES BELOW)	
SMOKE ALARM	
SMOKE + CARBON MONOXIDE ALARM	

HEADER / BEAM SCHEDULE		
MARK	LUMBER SIZE	MARK L.V.L. SIZE
(A)	2 x 6	(E) 3/4" x 1 1/4"
(B)	2 x 8	(F) 3/4" x 3 1/2" (NOTE 3)
(C)	2 x 10	(G) 3/4" x 11 5/8"
(D)	2 x 12	(H) 3/4" x 14"
		(I) 3/4" x 16"
		(J) 3/4" x 18"

1) ALL HEADERS IN EXTERIOR AND IN INTERIOR LOAD BEARING WALLS ARE TO BE TYPE "C 2" UNO.
2) HEADERS SHALL HAVE 1 KING AND 1 TRIMMER STUD UNO. BEAMS SHALL HAVE 2 BEARING STUDS BELOW EACH END UNO.
3) FOR L.V.L. BEAMS IN 2x10 FLOORS, USE 3 1/4" L.V.L.

FLOOR JOIST SCHEDULE				
MARK	TYPE	SUB-TYPE	SIZE	SPACING MAX SPAN
FJ-1	"1" JOIST (SEE NOTE)	3 1/2"	12"	PER MANUFACTURER
FJ-2	"1" JOIST (SEE NOTE)	11 7/8"	14"	PER MANUFACTURER
FJ-3	"1" JOIST (SEE NOTE)	14"	16"	PER MANUFACTURER
FJ-4	TRUSSED (SEE NOTES)	14"	16"	PER MANUFACTURER
FJ-5	TRUSSED (SEE NOTES)	16"	16"	PER MANUFACTURER
FJ-20	LUMBER	ACQ. TREATED	2x10	12" O.C. 16'-2"
FJ-21	LUMBER	ACQ. TREATED	2x10	16" O.C. 14'
FJ-22	LUMBER		2x8	12" O.C. 14'-2"
FJ-23	LUMBER		2x8	16" O.C. 12'-1"
FJ-24	LUMBER		2x10	12" O.C. 11'-9"
FJ-25	LUMBER		2x10	16" O.C. 15'-5"
FJ-26	LUMBER		2-2x10	16" O.C.

NOTE: DESIGN I-JOISTS (LOADED W/ TOTAL LIVE AND DEAD LOAD) WITH A MAX. DEFLECTION OF L/360, EXCEPT BELOW BATHROOMS AND TILED AREAS WHERE THE DEFLECTION SHALL BE L/480 MAX.

CEILING JOISTS SCHEDULE - LIVE LOAD 10 P.S.F.				
MARK	SIZE	SPACING	MAXIMUM SPAN - DOUGLAS FIR #2	
CJ-1	2x6	12"	19'-6"	
CJ-2	2x6	16"	17'-8"	
CJ-3	2x8	12"	25'-8"	
CJ-4	2x8	16"	23'-0"	
CJ-5	2x10	12"	NA	
CJ-6	2x10	16"	NA	
CJ-7	2x4	24"	9'-10"	
CJ-8	2x6	24"	14'-10"	
CJ-9	2x8	24"	18'-9"	
CJ-10	2x10	24"	22'-11"	

SQUARE FOOTAGE TABLE	
LOCATION	AREA (S.F.)
UPPER LEVEL	1433
LOWER LEVEL	392
BASEMENT	351
TOTAL	2176
GARAGE	695
BASEMENT (UNFINISHED)	183


GENERAL NOTES:

A. WINDOW SIZES SHOWN ARE APPROXIMATE. THE BUILDER SHALL SELECT WINDOWS TO MEET BUILDING CODE REQUIREMENTS AND TO FIT IN THE AVAILABLE SPACE, WHICH MAY BE LIMITED BY SORFITS, HEADERS, CLEARANCE FOR ADJACENT ROOF FLASHING, ETC. OVERALL ROUGH OPENINGS FOR MULLED UNITS WILL VARY BY WINDOW/ DOOR MANUFACTURER. SEE GENERAL NOTES ON SHEET G1 FOR ADDITIONAL WINDOW REQUIREMENTS.

B. EXTERIOR WALLS ARE 2x4 STUDS AT 16" O.C. UNLESS OTHERWISE NOTED.

FLOOR PLAN NOTES

- 4x4 PARALLAM COLUMN BETWEEN 1ST FLOOR AND UPPER LEVEL FLOOR
- INSULATE CANTILEVERED FLOOR
- 3 STUDS FOR BEARING, SOLID BLOCKING BELOW
- TOP OF BEAM TO MATCH TOP OF MASTER BEDROOM WALL.
- 6 X 6 PRESSURE TREATED OR CEDAR POST.
- 2x6 STUDS AT 12" O.C. FOR UNINTERRUPTED 11'-8" TALL WALL
- (2) 2 x 6 UPSET BEAM (OR 3 - 2 x 4) FOR VALLEY SUPPORT.

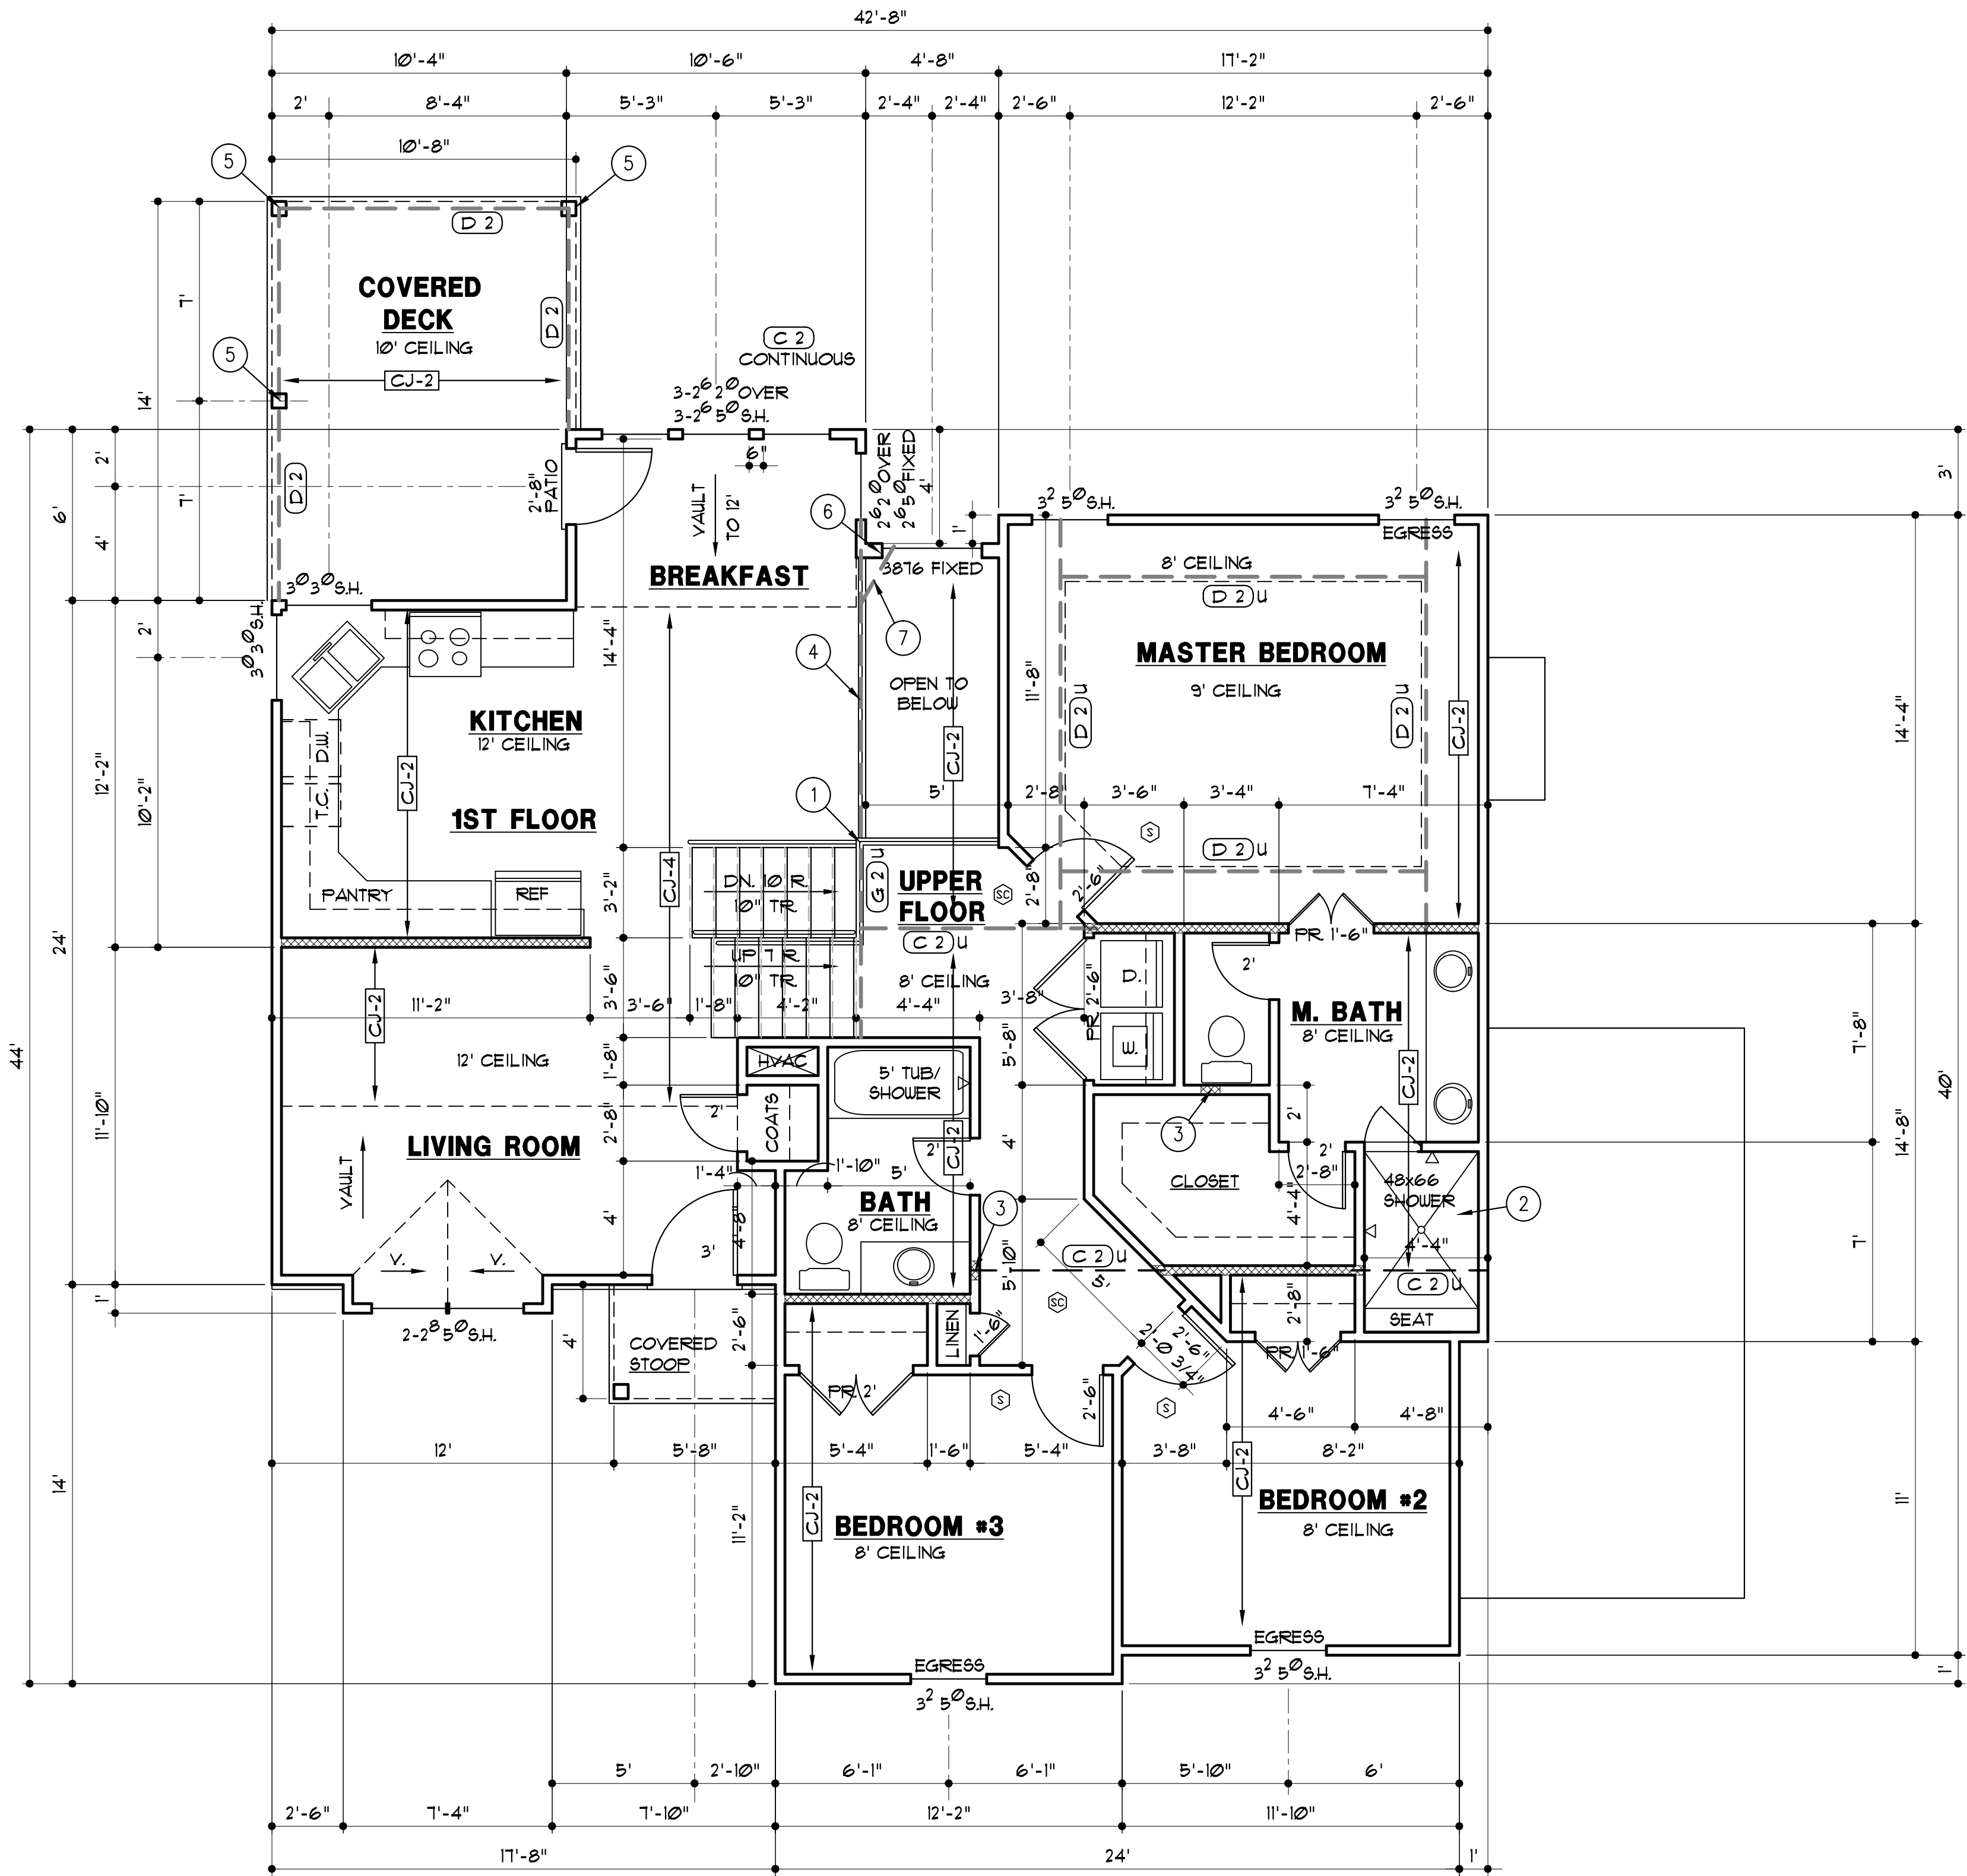

FIRST FLOOR PLAN
1/4" = 1'-0"



EAGLE CREEK LOT 726
2334 SW OLD PORT ROAD
LEE'S SUMMIT, MO. 64082

BRANDON LOGAN
P.O. BOX 6423
LEE'S SUMMIT, MO 64064



DRAWN BY: MP
DATE: 10-10-20
PROJECT NO: 15-016-03

SHEET NO.
A2

ROOF PLAN LEGEND	
DESCRIPTION	SYMBOL
RIDGES AND HIPs	
VALLEYS	
EAVES, RAKE & GABLE	
HOUSE WALLS	
FURLIN	
TOP OF FURLIN STRUT OR RIDGE POLE	O
BOT. OF FURLIN STRUT OR RIDGE POLE	
JOIST SIZE AND SPACING	RJ-X
UPLIFT VALUE	000"


ROOF RAFTER SCHEDULE				
MARK	SIZE	SPACING	MAXIMUM SPAN	
			FLAT CEILING	VAULTED CEILING
RJ-1	2x6	12"	16'-11"	14'-9"
RJ-2	2x6	16"	14'-4"	12'-9"
RJ-3	2x6	24"	11'-9"	10'-5"
RJ-4	2x8	12"	21'-0"	18'-8"
RJ-5	2x8	16"	18'-2"	16'-2"
RJ-6	2x8	24"	14'-10"	13'-2"
RJ-7	2x10	12"	25'-8"	22'-9"
RJ-8	2x10	16"	22'-5"	19'-9"
RJ-9	2x10	24"	18'-2"	16'-11"
RJ-10	2x12	16"	25'-9"	26'-5"
RJ-11	2x12	24"	18'-2"	22'-10"

GENERAL NOTES:

- A. BRACE ALL RIDGES TO BEARING WALLS OR BEAMS BELOW, AT 4' O.C. UNLESS NOTED OTHERWISE
- B. STRUTS TO BEAR ON WALLS AS INDICATED. CONTACT ARCHITECT WITH ANY PROPOSED CHANGE TO STRUT BEARING LOCATIONS. ARCHITECT MAY NEED TO VERIFY THAT BEAMS BELOW NEW STRUT LOCATION CAN SUPPORT ADDED LOADS.

ROOF PLAN NOTES

1. BEARING WALL OR BEAM BELOW
2. 2x8 FURLIN WITH 2x6 "T" BRACES AT 4' O.C. TO BEARING WALL/ BEAM BELOW
3. 2x6 "T" BRACE TO BEARING WALL OR BEAM BELOW. BRACE SHALL BE CONNECTED TO STRUCTURE AT ROOF AND CEILING WITH MINIMUM (5) 16d NAILS.
4. CUT BACK SOFFIT EAVE TO CLEAR WINDOW
5. BRACE RIDGE TO BEARING WALL WITH 2x6's AT 4' O.C.
6. 3) 2x6 STRUT
7. TIGHT BARGE
8. OVERFRAME THIS AREA
9. 4-2x6 RAFTERS
10. (3) 2x6 BEAM
11. 2x6 RAFTER TIES AT 32" O.C. INSTALLED 10'-8" FROM DECK TO BOTTOM OF TIE

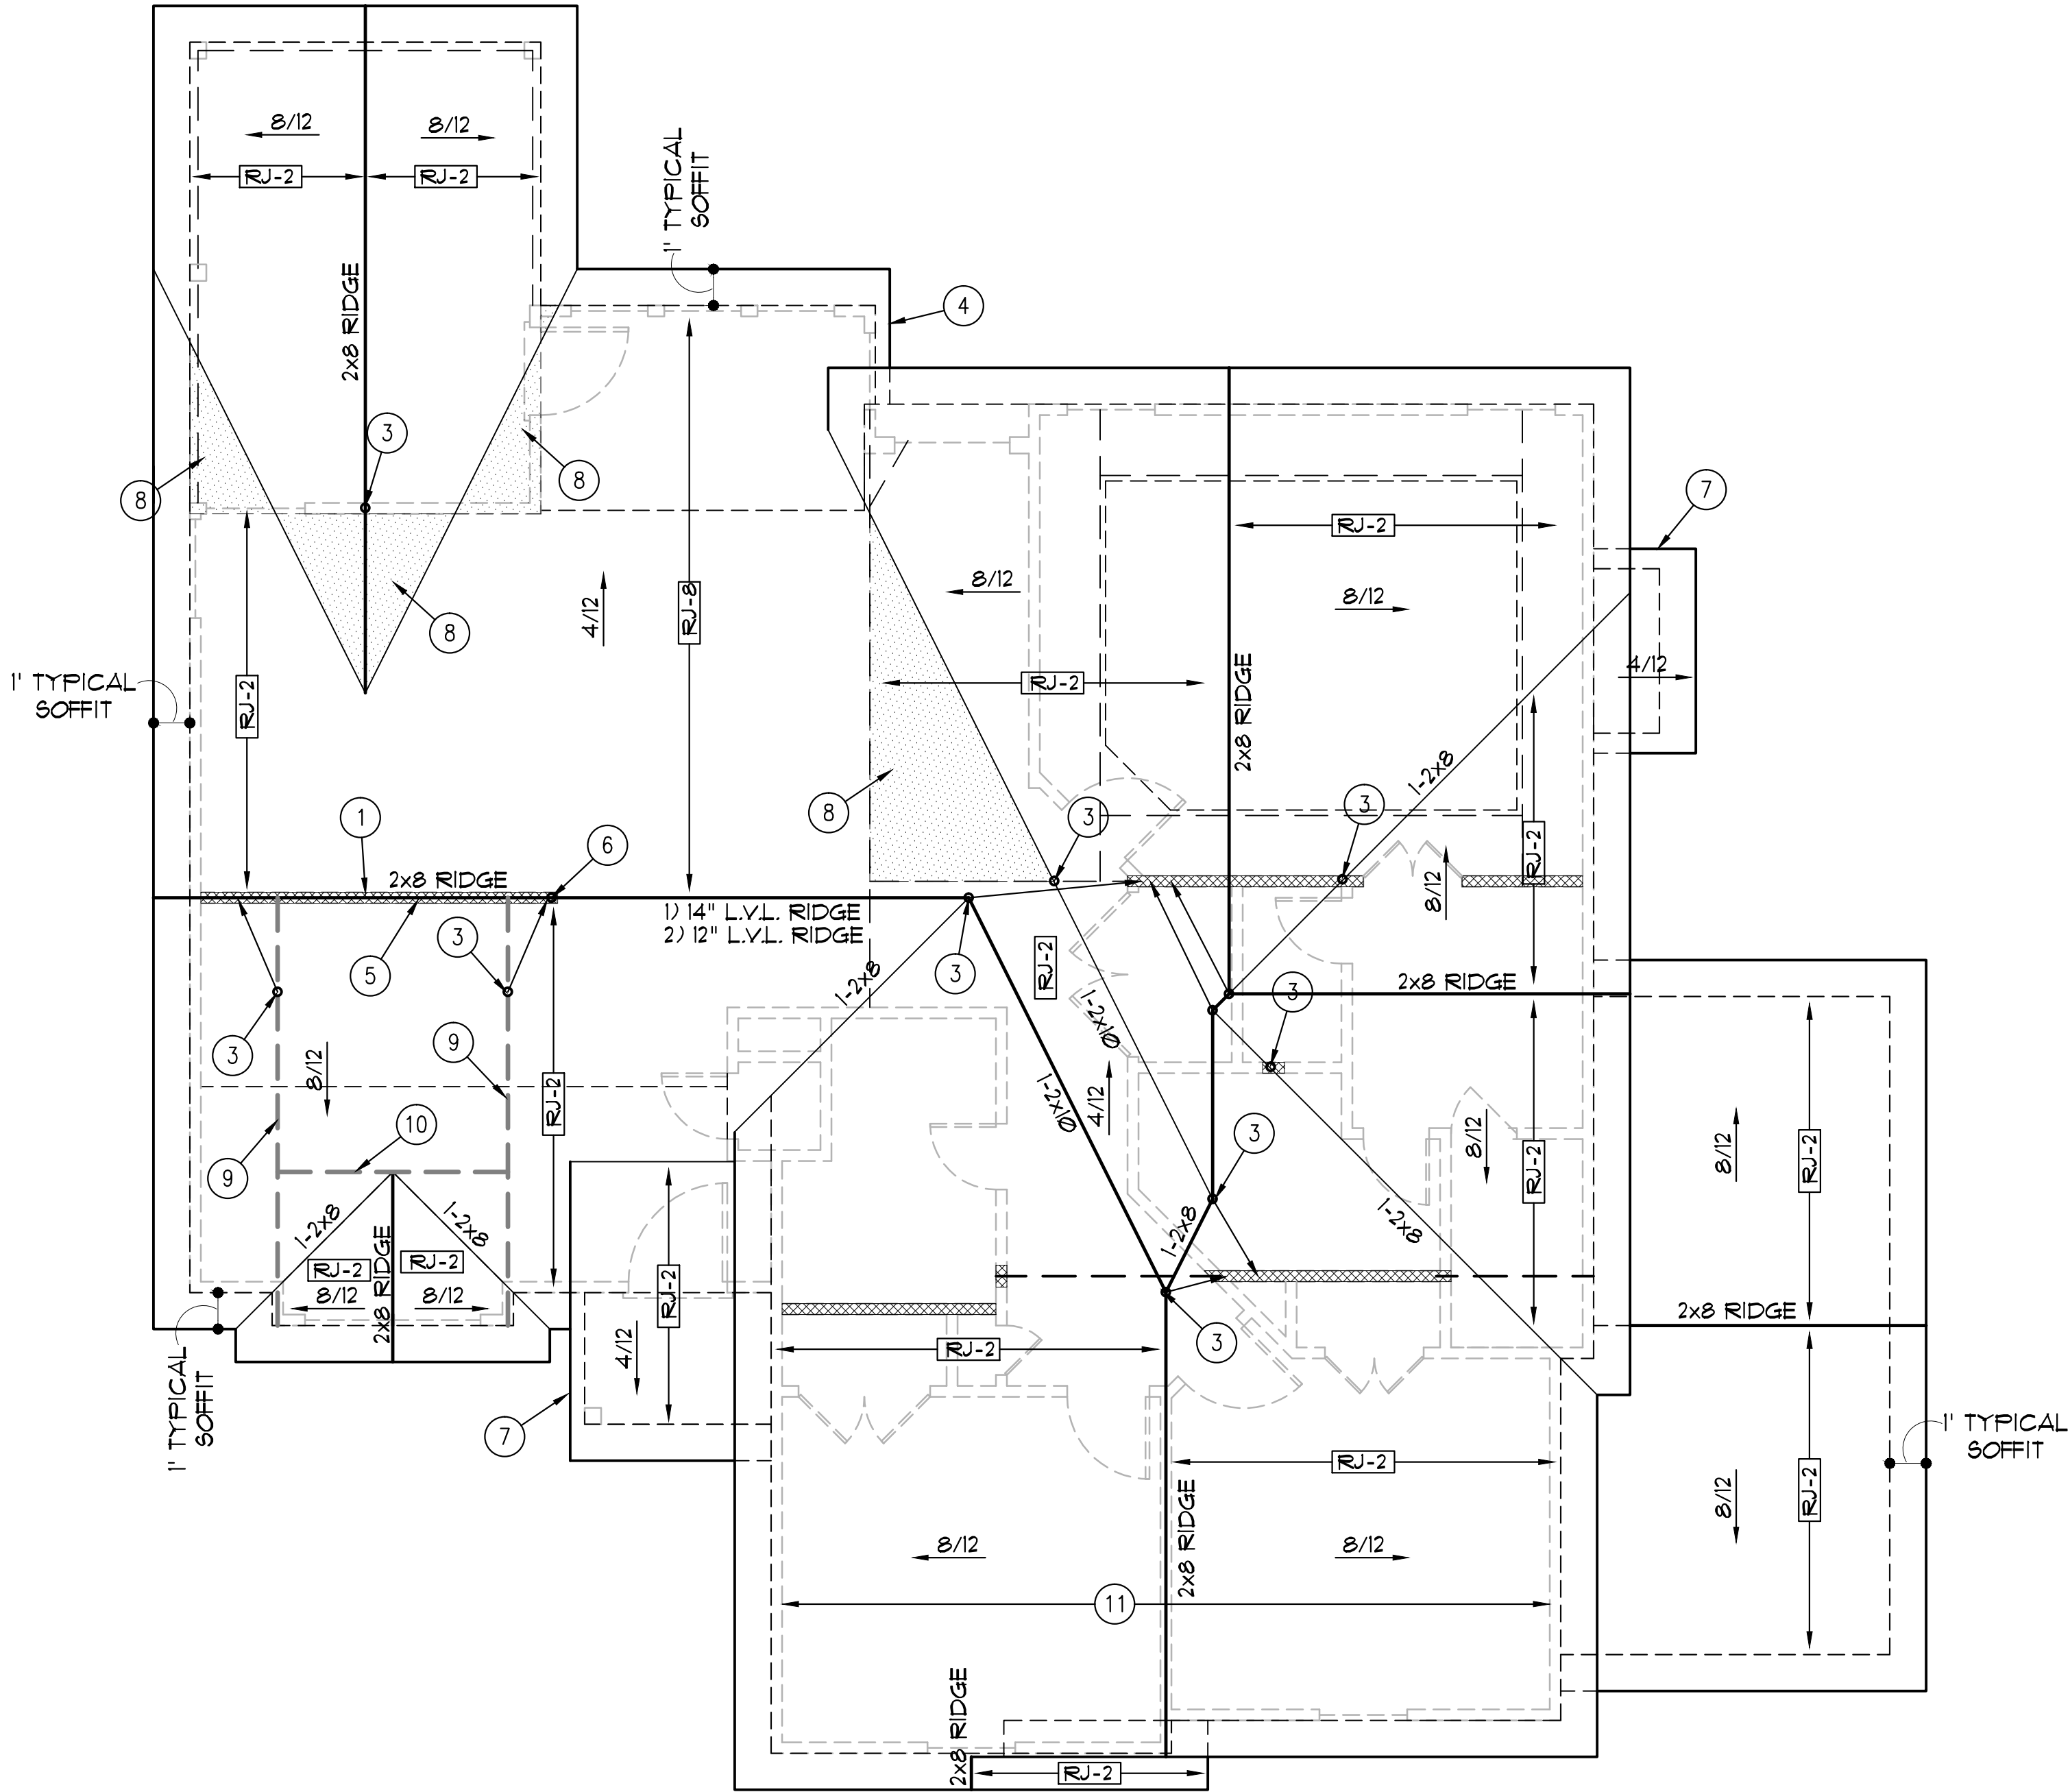

ROOF PLAN
1/4" = 1'-0"



EAGLE CREEK LOT 726
2334 SW OLD PORT ROAD
LEE'S SUMMIT, MO. 64082

BRANDON LOGAN
P.O. BOX 6423
LEE'S SUMMIT, MO 64064




DRAWN BY: MP
DATE: 10-10-20
PROJECT NO: 15-016-03

SHEET NO.
A3

ELEVATION NOTES

1. ROOFING TO BE "TIMBERLINE" SHINGLES OR EQUAL ON 1/2" FELT ON 1/16" O.S.B. SHEATHING.
2. SIDING TO BE 3/8" MIN. STRUCTURAL WOOD PANEL SIDING, "SMART PANEL" SIDING OR EQUAL, INSTALLED PER MANUFACTURER'S INSTRUCTIONS. PROVIDE 1/2" FLASHING BETWEEN VERTICAL PANELS. 1x4 SMART TRIM AT ALL CORNERS AND AROUND WINDOWS.
3. SMART LAP SIDING WITH 6" EXPOSURE AND 5/4x6 SMART TRIM AT CORNERS, DOORS AND WINDOWS
4. MANUFACTURED STONE
5. TIGHT BARGE
6. BOARD & BATTEN SHUTTERS
7. METAL EGRESS WINDOW WELL. WINDOW SET AT MAX. 44" FROM FINISH FLOOR TO SILL
8. SHAKES

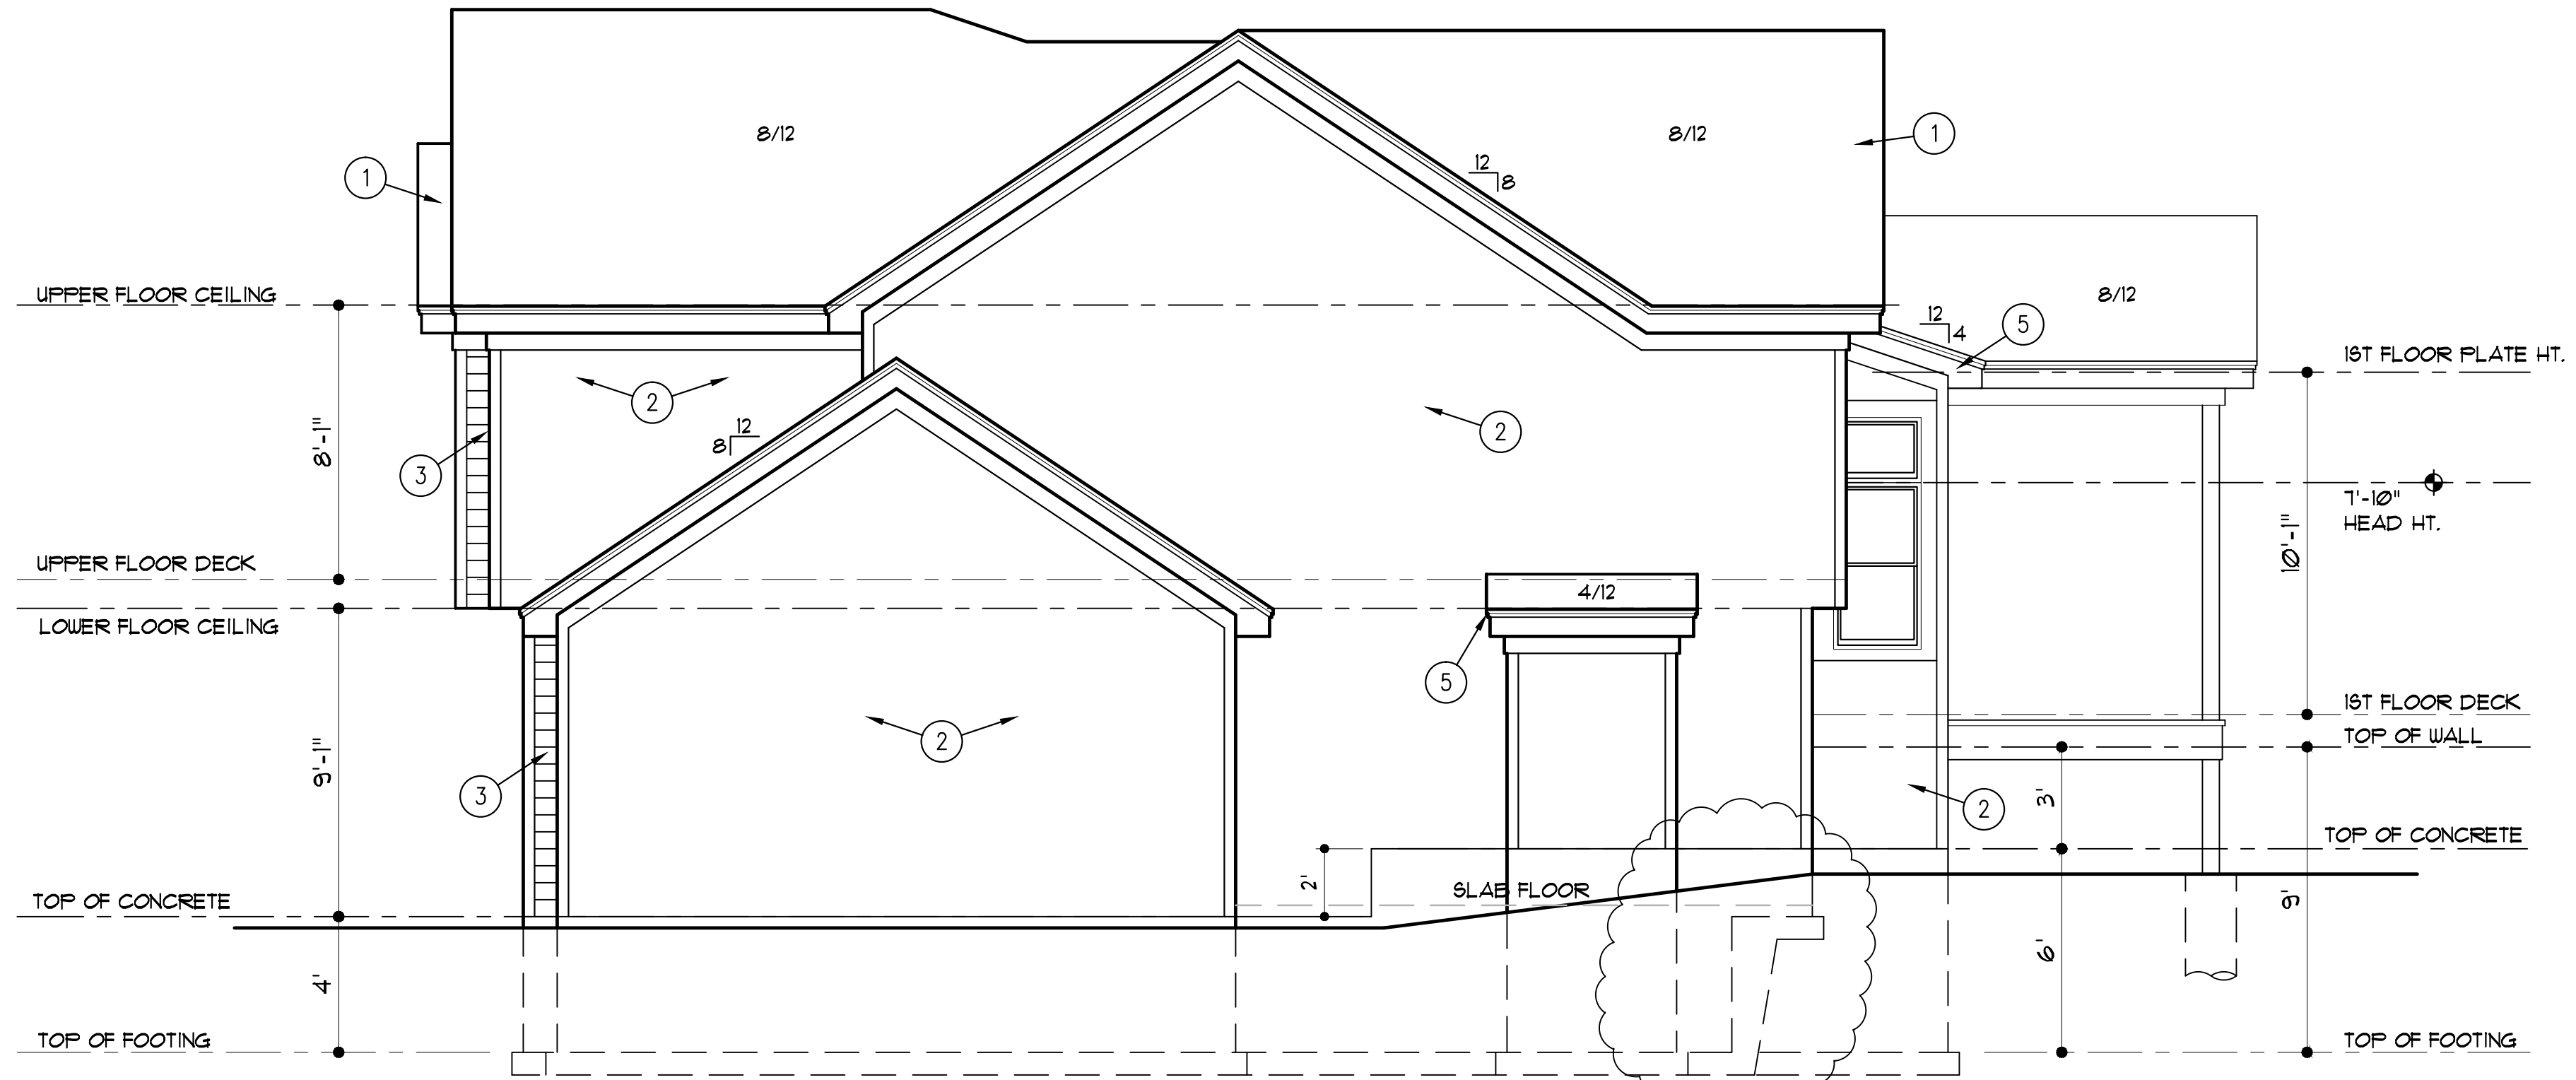

RIGHT SIDE ELEVATION 'A'

1/4" = 1'-0"




FRONT ELEVATION 'A'

1/4" = 1'-0"

10-24-20 REVISE FOUNDATION ELEVATIONS

EAGLE CREEK LOT 726
2334 SW OLD PORT ROAD
LEE'S SUMMIT, MO. 64082

BRANDON LOGAN
P.O. BOX 6423
LEE'S SUMMIT, MO 64064

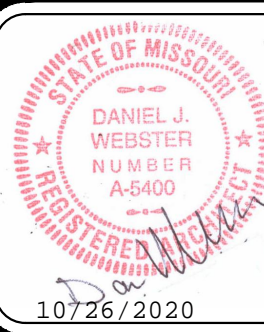


DRAWN BY: MP
DATE: 10-10-20
PROJECT NO: 15-016-03

SHEET NO.
A4A



ELEVATION NOTES

1. ROOFING TO BE "TIMBERLINE" SHINGLES OR EQUAL ON 1/2" FELT ON 1/16" O.S.B. SHEATHING.
2. SIDING TO BE 3/8" MIN. STRUCTURAL WOOD PANEL SIDING, "SMART PANEL" SIDING OR EQUAL, INSTALLED PER MANUFACTURER'S INSTRUCTIONS. PROVIDE 1/2" FLASHING BETWEEN VERTICAL PANELS. 1x4 SMART TRIM AT ALL CORNERS AND AROUND WINDOWS.
3. SMART LAP SIDING WITH 6" EXPOSURE AND 5/4x6 SMART TRIM AT CORNERS, DOORS AND WINDOWS
4. MANUFACTURED STONE
5. TIGHT BARGE
6. BOARD & BATTEN SHUTTERS
7. METAL EGRESS WINDOW WELL. WINDOW SET AT MAX. 44" FROM FINISH FLOOR TO SILL
8. SHAKES

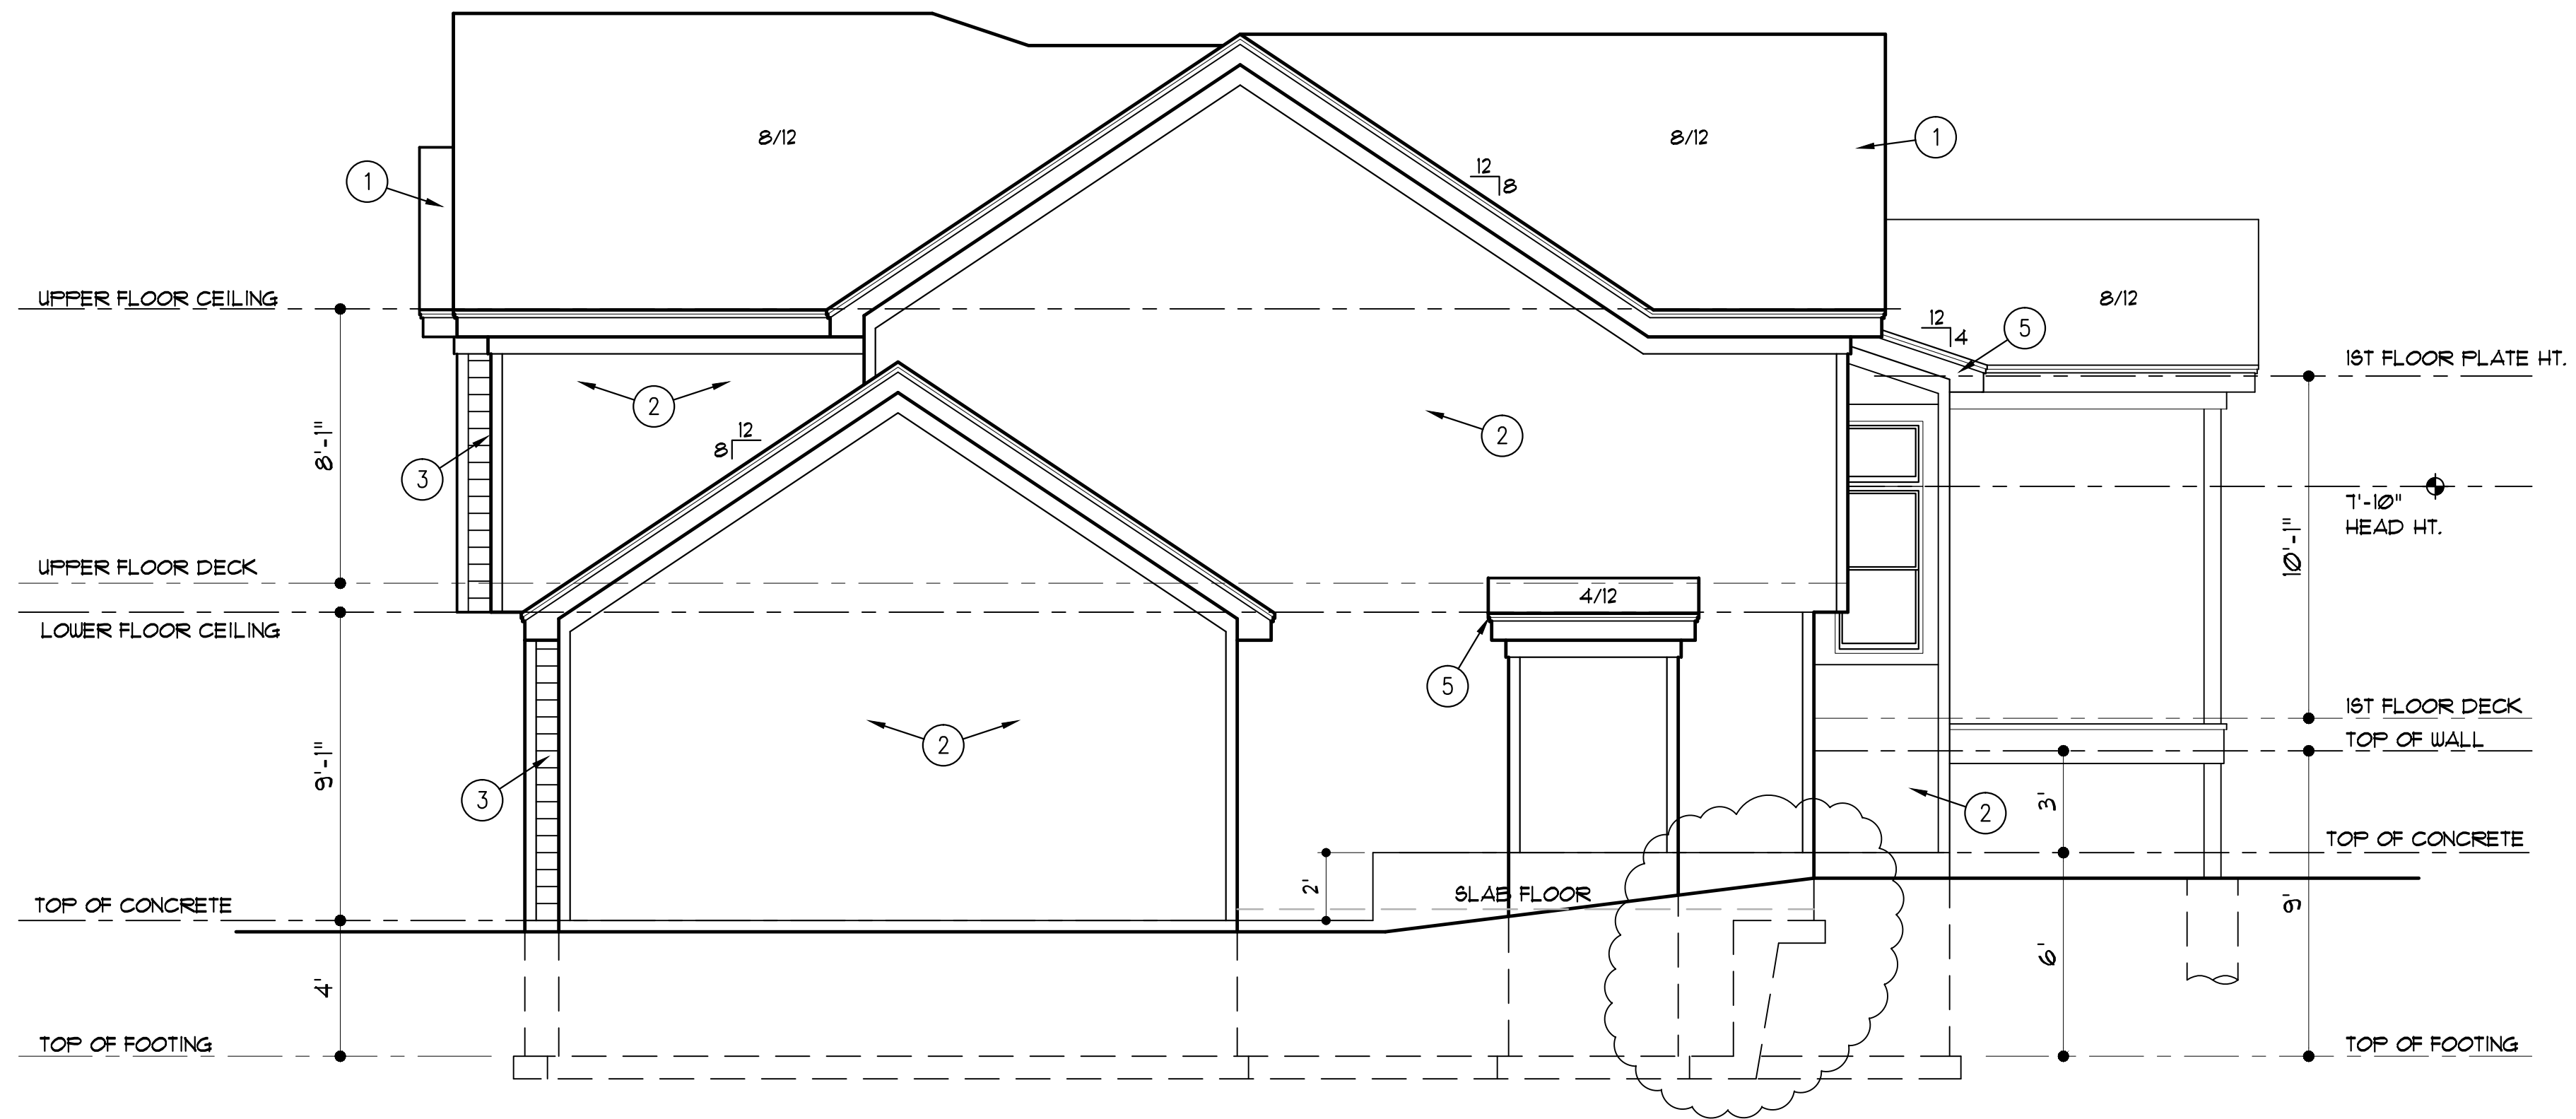

RIGHT SIDE ELEVATION 'B'

1/4" = 1'-0"




FRONT ELEVATION 'B'

1/4" = 1'-0"

10-24-20 REVISE FOUNDATION ELEVATIONS

EAGLE CREEK LOT 726
2334 SW OLD PORT ROAD
LEE'S SUMMIT, MO. 64082

BRANDON LOGAN
P.O. BOX 6423
LEE'S SUMMIT, MO 64064

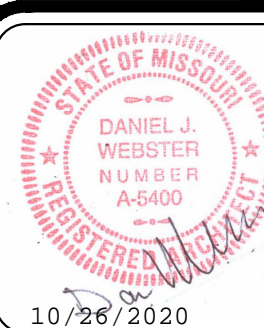


DRAWN BY: MP
DATE: 10-10-20
PROJECT NO: 15-016-03

SHEET NO.
A4B




ELEVATION NOTES

1. ROOFING TO BE "TIMBERLINE" SHINGLES OR EQUAL ON 1/2" FELT ON 1/16" O.S.B. SHEATHING.
2. SIDING TO BE 3/8" MIN. STRUCTURAL WOOD PANEL SIDING, "SMART PANEL" SIDING OR EQUAL, INSTALLED PER MANUFACTURER'S INSTRUCTIONS. PROVIDE 1/2" FLASHING BETWEEN VERTICAL PANELS. 1x4 SMART TRIM AT ALL CORNERS AND AROUND WINDOWS.
3. SMART LAP SIDING WITH 6" EXPOSURE AND 5/4x6 SMART TRIM AT CORNERS, DOORS AND WINDOWS
4. MANUFACTURED STONE
5. TIGHT BARGE
6. BOARD & BATTEN SHUTTERS
7. METAL EGRESS WINDOW WELL. WINDOW SET AT MAX. 44" FROM FINISH FLOOR TO SILL
8. SHAKES

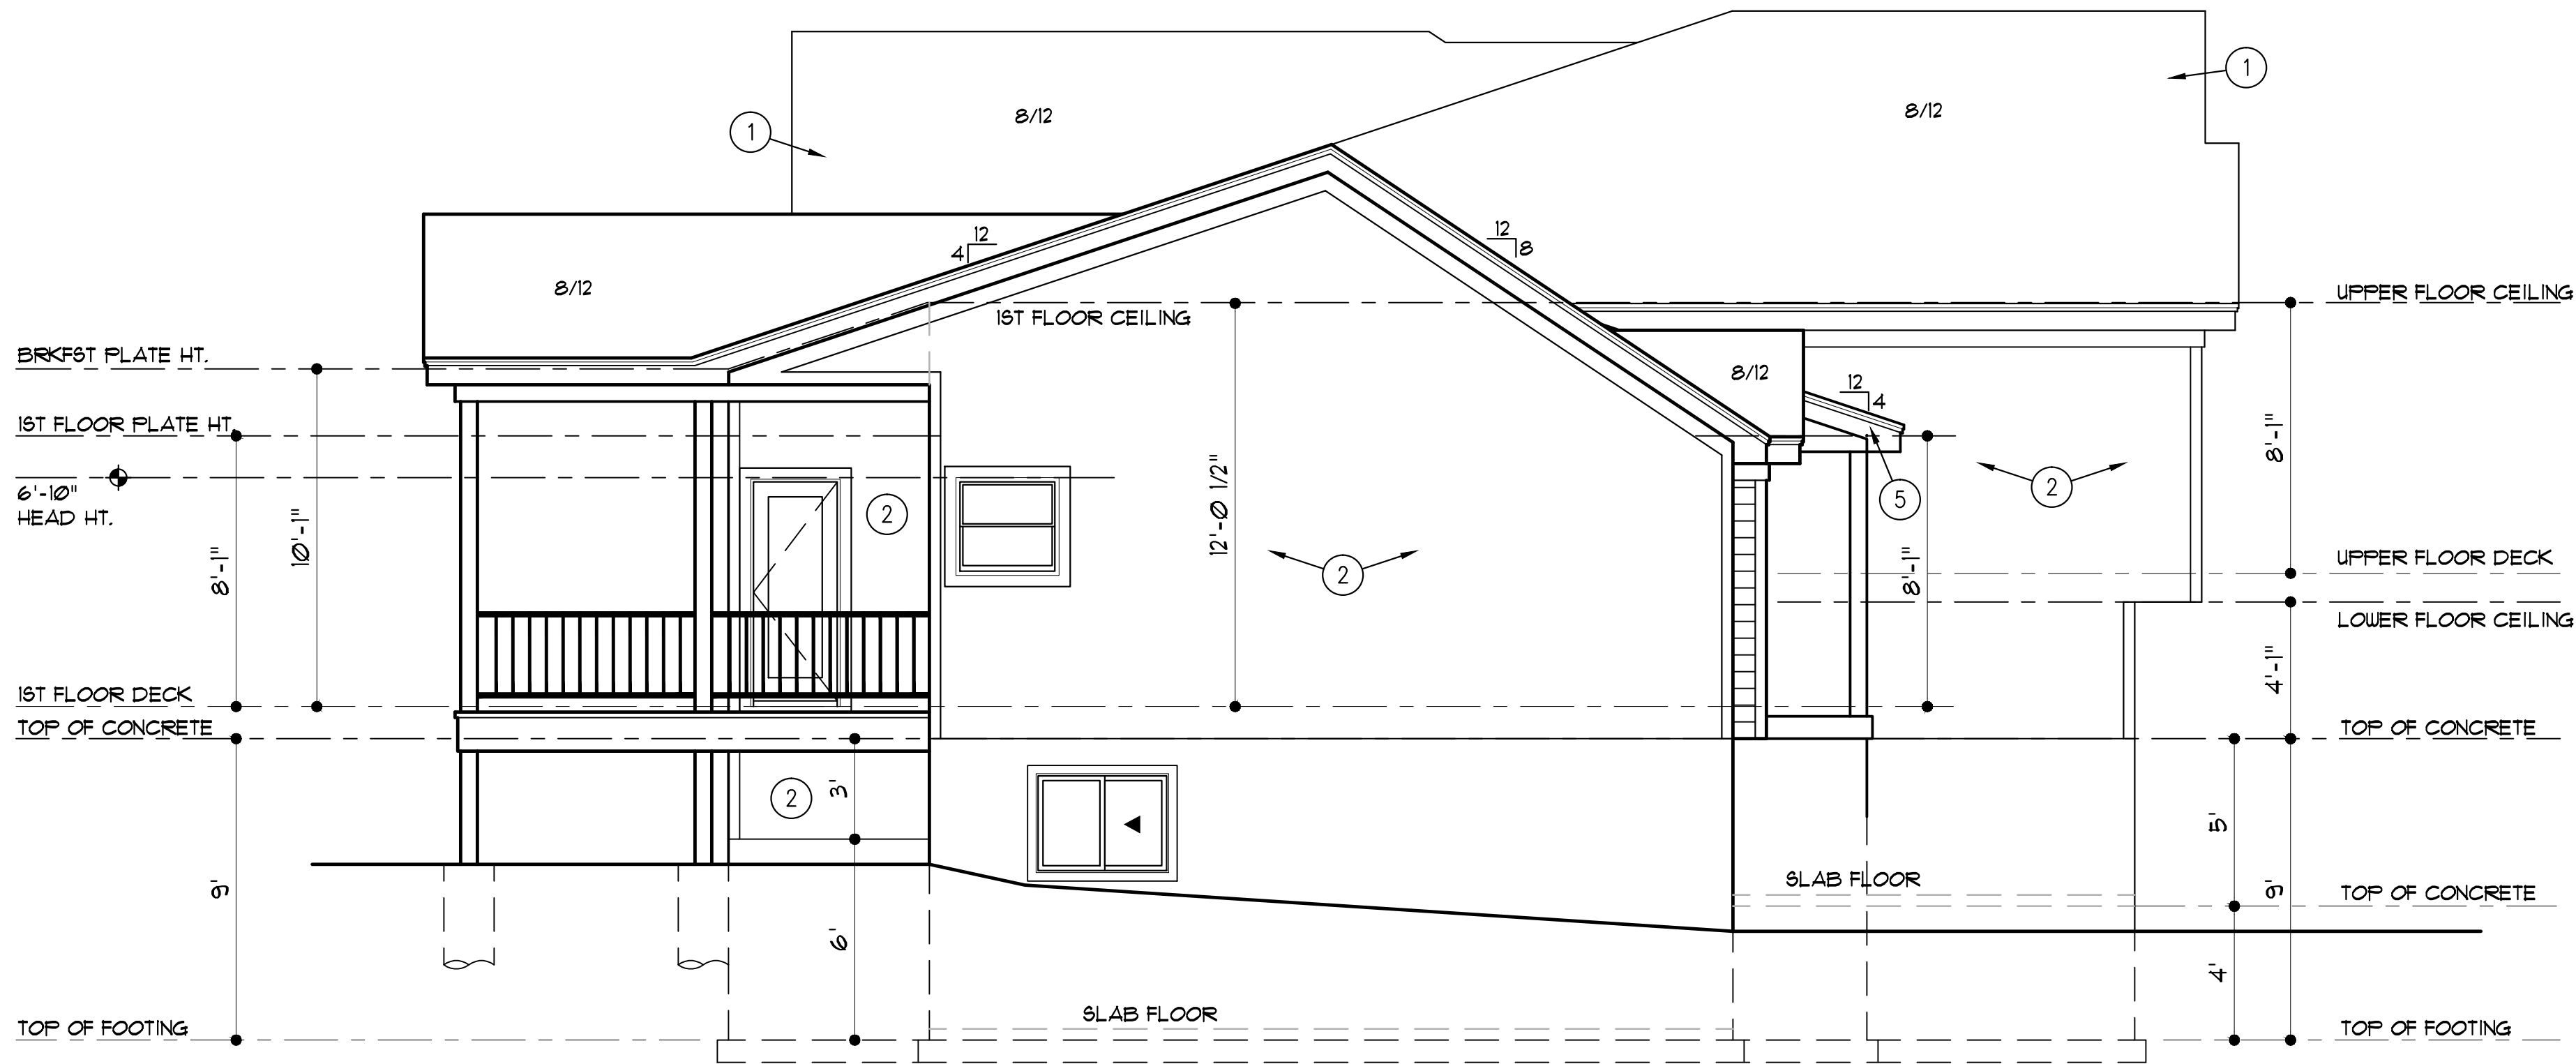

LEFT SIDE ELEVATION

1/4" = 1'-0"

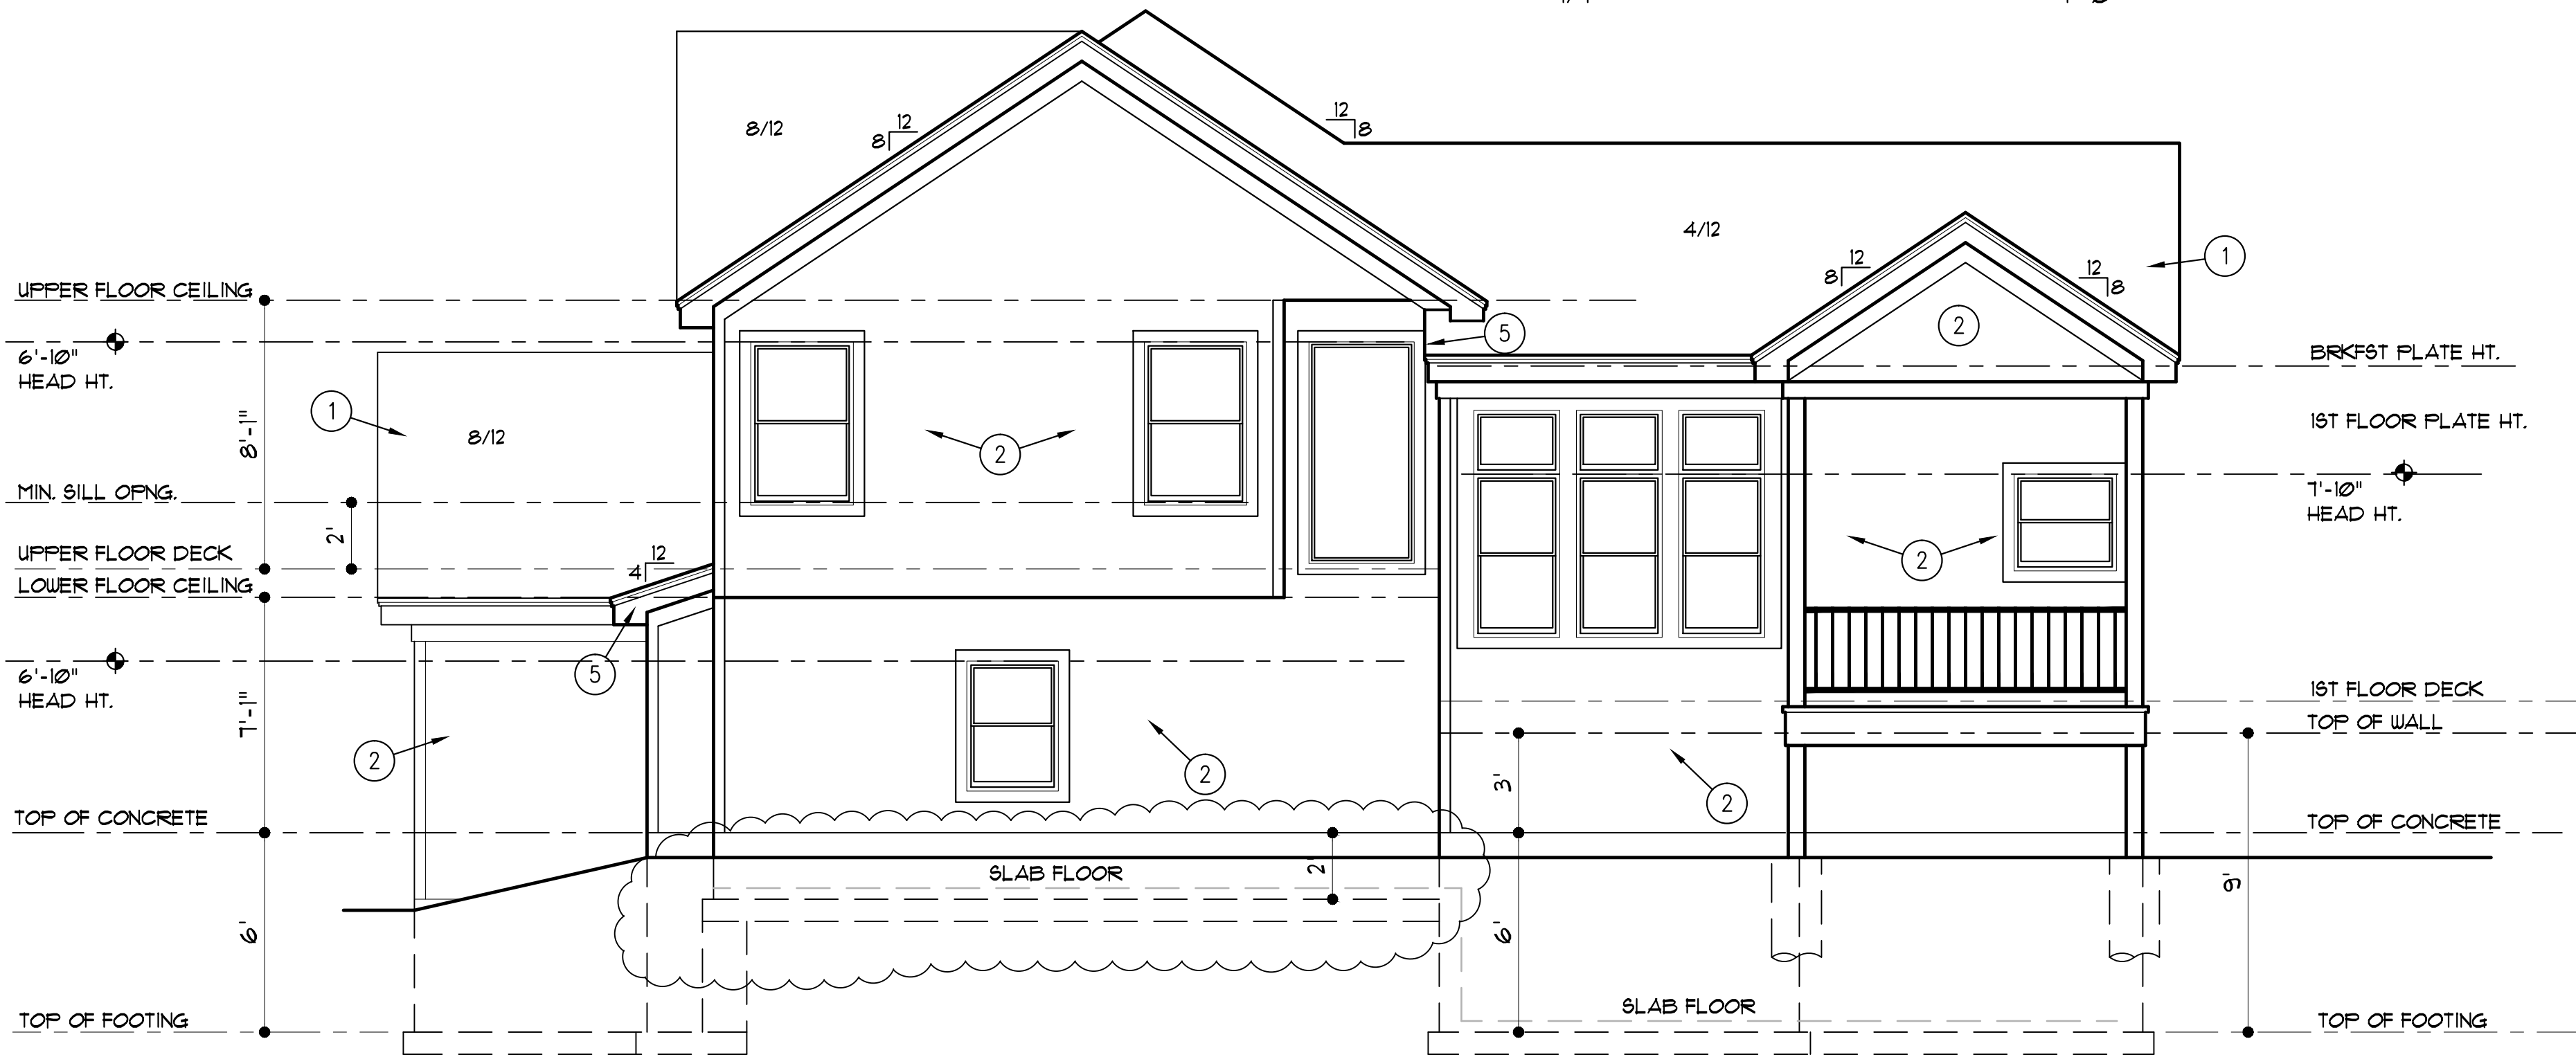


REAR ELEVATION

1/4" = 1'-0"

10-24-20 REVISE FOUNDATION ELEVATIONS

EAGLE CREEK LOT 726
2334 SW OLD PORT ROAD
LEE'S SUMMIT, MO. 64082

BRANDON LOGAN
P.O. BOX 6423
LEE'S SUMMIT, MO 64064

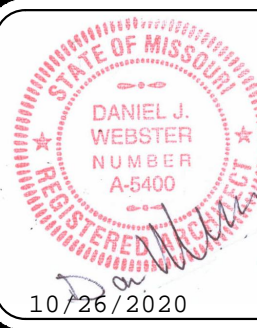

DRAWN BY: MP
DATE: 10-10-20
PROJECT NO: 15-016-03

SHEET NO. **A5**

1060 S. GREEN ROAD
CLATHE, KS 66061
PHONE: 913-390-4663
www.WebsterArchitects.com



DISCLAIMER

THESE DRAWINGS ARE CONSIDERED A "BUILDER'S SET" AND BY BEGINNING CONSTRUCTION THE CONTRACTOR WARRANTS TO THE ARCHITECT, THAT HE HAS THE COMPETENCE AND SKILL IN CONSTRUCTION NECESSARY TO BUILD THE PROJECT WITHOUT FULL ENGINEERING AND DESIGN SERVICES. THE CONTRACTOR WILL BE REQUIRED TO ADAPT THE DRAWINGS TO ACTUAL FIELD CONDITIONS AND MAKE LOGICAL ADJUSTMENTS IN FIT, FORM, DIMENSION AND QUANTITY. IN THE EVENT, ADDITIONAL DETAIL OR GUIDANCE IS NEEDED, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY WEBSTER ARCHITECTS. FAILURE TO GIVE NOTICE SHALL RELIEVE WEBSTER ARCHITECTS OF THE ALL RESPONSIBILITY FOR THE CONSEQUENCES. ALTHOUGH WEBSTER ARCHITECTS HAVE PERFORMED THEIR SERVICES WITH DUE CARE AND DILIGENCE, PERFECTION CAN'T BE GUARANTEED. IT IS UNDERSTOOD AND AGREED THAT IF WEBSTER ARCHITECTS IS NOT HIRED TO DO PROJECT OBSERVATION OR ANY OTHER CONSTRUCTION PHASE SERVICES, THAT THE CLIENT WILL PERFORM SUCH SERVICES. THE CLIENT ASSUMES ALL RESPONSIBILITY FOR INTERPRETATION OF THE CONTRACT DOCUMENTS AND FOR CONSTRUCTION OBSERVATION, AND THE CLIENT WAIVES ANY CLAIMS AGAINST WEBSTER ARCHITECTS THAT MAY BE IN ANY WAY CONNECTED THERETO. THESE DRAWINGS ARE NOT TO BE SCALED. IF A CRITICAL DIMENSION IS MISSING THE ARCHITECT SHOULD BE CONSULTED.

ABBREVIATIONS

AFF.	ABOVE FINISH FLOOR
C.C.A.	CHROMATED COPPER ARSENATE
C.J.	CONTROL JOINT
C.G.	CEILING
C.	CASED OPENING
D.	DRYER
D.H.	DOUBLE HUNG
DIA.	DIAMETER
DN.	DOWN
D.W.	DISHWASHER
E.J.	EXPANSION JOINT
E.Q.	EQUAL
F.D.	FLOOR DRAIN
G.A.	GAUGE OR GAGE
GFI	GROUND FAULT CIRCUIT INTERRUPTER
H.B.	HOSE BIB
HT.	HEIGHT
K.S.	KNEE SPACE
L.B. (*)	FOUND
L.V.L.	LAMINATED VENEER LUMBER
MAX.	MAXIMUM
MIN.	MINIMUM
MICRO.	MICROUAVE OVEN
O.C.	ON CENTER
O.H.	OVERHEAD/ OVERHANG
FR	FAIR
R.	RISER
REF.	REFRIGERATOR
RY.	ROOM
RO.	ROUGH OPENING
SF.	SQUARE FEET
SIM.	SIMILAR
SQ.	SQUARE
T.	TREAD
T.C.	TRASH COMPACTOR
T.V.	TELEVISION
TYP.	TYPICAL
W.	WASHER
W/	WITH
W.I.C.	WALK IN CLOSET
W.H.	WATER HEATER
W.U.F.	WELDED WIRE FABRIC

LOAD AND DEFLECTION LIMITATIONS

AREA	CONDITION	MIN. LOADS (PSF)	
		LIVE	DEAD
DECKS	-	40	12
CEILING JOISTS	NO STORAGE	10	10
CEILING JOISTS	STORAGE ALLOWED	20	10
FLOORS	NON-SLEEPING	40	10 (20 FOR TILED FLRS)
	SLEEPING AREAS	30	10 (20 FOR TILED FLRS)
ROOF	WOOD OR COMPOSIT.	20	10 (20 IN LEAWOOD)
	TILE OR CONCRETE	20	20
STAIRS	-	40	10
HANDRAIL GUARDRAIL	-	200# IN ANY DIRECTION	

NOTE:
- WIND SPEED 90 MPH (CATAGORY AS DEFINED BY R302.1.4)
* TILE FLOOR LOAD BASED ON THINSET METHOD.

BUILDING INSULATION SCHEDULE

OPENING MAXIMUM U-VALUE	
WINDOWS	.35
OPAQUE DOORS	.35
GLASS DOORS	.40
SKYLIGHT	.6
BUILDING COMPONENT MINIMUM R-VALUE	
CEILING	
	WITH ATTIC
	CATHEDRAL
WALL	
	EXTERIOR 2x4 or 2x6
	BASEMENT (CAVITY or CONTINUOUS)
	CRAWL SPACE
FLOORS	
	TRENCH FOOTINGS - HEATED SLAB
	TRENCH FOOTINGS
	OVER UNHEATED SPACES
	OVER OUTSIDE AIR
DUCTS IN UNHEATED SPACES - SUPPLY AND RETURN	8
DUCTS IN UNHEATED SPACES - IN FLOOR AND CEILING ASSEMBLY	6
HOT WATER SYSTEM PIPING	1" OF INSULATION
FURNACE (AFUE)	80% MINIMUM
AIR CONDITIONING (SEER)	13 MINIMUM

CODE COMPLIANCE

A. BUILDING CONSTRUCTION: REGARDLESS OF WHAT IS SHOWN ON THE PLANS, THE BUILDING SHALL COMPLY WITH THE 2018 INTERNATIONAL RESIDENTIAL CODE AND ANY OTHER CITY REQUIREMENTS.

B. FOUNDATION WALLS ARE DESIGNED TO COMPLY WITH THE JOHNSON COUNTY FOUNDATION GUIDELINES.

C. BUILDING DESIGNED FOR SEVERE CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA OF WEATHERING CONDITIONS, MODERATE DECAY CONDITIONS, 6 DEGREES FAHRENHEIT, AND 5323 HEATING DEGREE DAYS WINTER DESIGN TEMPERATURE CONDITIONS, 36 INCHES FROST LINE DEPTH CONDITIONS, AND FLOOD HAZARDS BASED UPON THE LATEST ADOPTED FIRM, AND F.B.F.M. DOCUMENTS IN ACCORDANCE WITH L.B.C. ARTICLE 4-309.

GENERAL NOTES

A. GLASS: PROVIDE SAFETY GLAZING WHERE REQUIRED BY IRC E3208 AND IN THE FOLLOWING LOCATIONS: 1. STORM DOORS, 2. INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" ARC OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR, 3. WALLS ENCLOSING STAIRWAYS AND LANDINGS WHERE THE GLAZING IS WITHIN 60" OF THE TOP OR BOTTOM OF THE STAIR, 4. ENCLOSURES FOR HOT TUBS, SAUNAS, STEAM ROOMS, SPAS, BATH TUBS, SHOWERS AND WHIRLPOLS, 5. FIXED OR OPERABLE PANELS EXCEEDING 9 SQUARE FOOT AND WHOSE BOTTOM EDGE IS LESS THAN 18" ABOVE THE FLOOR AND WALKING SURFACE WITHIN 36"

B. EXTERIOR WINDOWS AND DOORS SHALL BE DESIGNED TO RESIST WIND LOADS SPECIFIED IN IRC TABLE R302.1(4).A. EXTERIOR OVERHEAD DOORS SHALL MEET D.A.S.M.A. 90 MPH REQUIREMENTS.

C. BEDROOM EGRESS: AT LEAST ONE WINDOW FROM EACH BEDROOM AND FROM THE BASEMENT SHALL HAVE AN OPERABLE AREA OF 5.7 SQUARE FEET WITH A MINIMUM OPERABLE HEIGHT OF 24" AND A WIDTH OF 21" AND WITH THE BOTTOM OF THE OPERABLE PORTION NO MORE THAN 44" AFF. WINDOWS WHOSE SILL IS 12" OR MORE ABOVE FINISHED GRADE AND WHOSE SILL IS LESS THAN 24" ABOVE FINISHED FLOOR SHALL HAVE WINDOW GUARDS OR OPENING CONTROL DEVICES WHICH RESTRICT A 4" SPHERE FROM PASSING THRU.

D. STAIRWAYS: MAXIMUM RISE 7¼", MINIMUM RUN 10", MINIMUM HEADROOM 6'-8", MINIMUM WIDTH 36". HANDRAILS ARE REQUIRED WHEN STAIRS HAVE 4 OR MORE RISERS. HANDRAIL TO HAVE ENDS RETURNED OR TERMINATED IN A NEWEL POST OR SAFETY TERMINAL AND PLACED MINIMUM 34", MAXIMUM 38" ABOVE TREAD NOSING. THE HAND GRIP PORTION OF HANDRAIL SHALL BE NOT LESS THAN 1-1/4" NOR MORE THAN 2 5/8" IN CROSS SECTION DIMENSION. HANDRAILS PROJECTING FROM A WALL SHALL HAVE A SPACE OF NOT LESS THAN 1-1/2" BETWEEN THE WALL AND THE HANDRAIL. EXTEND ONE HANDRAIL 12" BEYOND THE TOP & BOTTOM RISER. INSTALL FIRE BLOCKING AT TOP AND BOTTOM OF STAIR RUN. THE CEILING AND WALLS OF USABLE SPACE UNDER STAIRS SHALL BE SURFACED WITH 1/2" GYPSUM BOARD, TAPED AND FINISHED.

E. GUARDRAILS: ALL UNENCLOSED FLOOR AREAS, STAIRS AND EXTERIOR DECKS OVER 30" ABOVE GRADE SHALL HAVE 36" HIGH GUARDRAILS WITH A MAXIMUM OPENING OF 4" BETWEEN BALLUSTERS. BALLUSTERS SHALL NOT CREATE A LADDER.

F. DOOR BETWEEN THE GARAGE AND DWELLING SHALL BE 1 3/8" THICK SOLID WOOD, 1 3/8" THICK MINIMUM SOLID CORE OR HONEY COMBED STEEL DOOR OR 20-MINUTE FIRE RATED, EQUIPPED WITH A SELF-CLOSING DEVICE.

G. ATTACHED GARAGE: CEILINGS AND BEAMS WITHIN THE GARAGE WILL BE COVERED WITH 5/8" TYPE "X" GYPSUM BOARD, IF SPACE ABOVE GARAGE IS LIVING SPACE.

H. BUILDER TO PROVIDE DECK OR LANDING PRIOR TO OWNER OCCUPANCY.

J. CRAWL SPACE: THE MINIMUM NET AREA OF VENTILATION OPENINGS WILL NOT BE LESS THAN 1 SQUARE FOOT FOR EACH 150 SQUARE FEET OF UNDER-FLOOR AREA. ONE SUCH VENTILATING OPENING WILL BE WITHIN 3 FEET OF EACH CORNER. AN 18"x24" MINIMUM ACCESS OPENING SHALL BE PROVIDED TO GARAGE SPACE.

K. ALL EXTERIOR DOORS, INCLUDING THE DOOR BETWEEN THE GARAGE AND THE HOUSE, SHALL INCORPORATE THE PHYSICAL SECURITY PROVISIONS OF SECTION MUNICIPAL CODE OF THE CITY IN WHICH THIS PROJECT IS LOCATED. FOR CITY OF RAYMORE SEE SECTION R324 "PHYSICAL SECURITY" OF MUNICIPAL CODE.

MECHANICAL ELECTRICAL NOTES

A. SMOKE DETECTORS: INSTALL ONE IN EACH BEDROOM, OUTSIDE OF EACH BEDROOM AREA, AT LEAST ONE ON EACH STORY INCLUDING THE BASEMENT. ALL ALARMS ARE TO BE INTERCONNECTED SO THAT ACTIVATING ONE ALARM ACTIVATES THEM ALL.

B. CARBON MONOXIDE ALARMS: IN DUELLING UNITS USING FUEL-FIRED APPLIANCES OR IN DUELLING UNITS WITH ATTACHED GARAGES, INSTALL CARBON MONOXIDE ALARMS OUTSIDE EACH SEPARATE SLEEPING AREA IN THE IMMEDIATE VICINITY OF THE BEDROOMS .

C. GROUND FAULT CIRCUIT INTERRUPTER PROTECTION (GFCI) SHALL BE INSTALLED IN RECEPTACLES IN BATHROOMS, KITCHENS, GARAGES, UNFINISHED BASEMENTS, OUTDOORS, CRAWL SPACES, AND WITHIN 6' OF ANY SINK. BATHROOM RECEPTACLES REQUIRE SEPARATE 20-AMP CIRCUIT. PROVIDE ARC-FAULT CIRCUIT INTERRUPTERS AS REQUIRED BY IRC E3902.12 OR AS REQUIRED BY MUNICIPALITY.

D. FIREPLACE: FACTORY-BUILT FIREPLACE WILL BE EQUIPPED WITH LISTED COMPONENT FOR OUTSIDE COMBUSTION AIR FED IRC 1009.5 AND SHALL BE INSTALLED ACCORDING TO THE MANUFACTURER'S INSTRUCTIONS

E. ALL BATHROOMS TO RECEIVE EXHAUST FANS-- 50 CFM DIRECTLY TO OUTSIDE. POINT OF DISCHARGE MIN. 3' FROM ANY OPENING.

MECHANICAL ELECTRICAL NOTES CONT.

F. HEAT PUMP THERMOSTATS MUST PREVENT BACK-UP LESSON ON THE PLANS, THE BUILDING SHALL COMPLY WITH THE 2018 INTERNATIONAL RESIDENTIAL CODE AND ANY OTHER CITY REQUIREMENTS.

G. DUCT SEALING MUST MEET THE REQUIREMENTS OF M 1601.31

H. ELECTRICAL CONDUCTORS SHALL BE COPPER AND THE PANEL BOX SHOULD BE 200 AMP

I. ANY DUCT PENETRATIONS OF THE WALLS OR CEILING SEPERATING THE DUELLING FROM THE GARAGE SHALL BE CONSTRUCTED OF 26 GAUGE SHEET METAL WITH NO OPENINGS IN THE GARAGE.

CONCRETE NOTES

A. CONCRETE: ALL CONCRETE SHALL BE 5-7% AIR-ENTRAINED AND HAVE A MINIMUM COMPRESSIVE STRENGTH AS LISTED BELOW AT 28 DAYS:
1. BASEMENT AND INTERIOR FLOOR SLABS: 3,000 PSI (7,500 IN LEXENX)
2. BASEMENT AND FOUNDATION WALLS: 3,000 PSI
3. PORCHES, CARPORT AND GARAGE FLOOR SLABS: 3,500 PSI

B. REINFORCING SHALL BE GRADE 40. SPICES SHALL LAP 24" MIN. UNLESS NOTED OTHERWISE.

C. FOOTINGS: FOOTINGS SHALL BEAR ON UNDISTURBED SOIL AND EXTEND A MINIMUM OF 36" BELOW FINISHED GRADE. FOOTINGS UNDER FOUNDATION WALLS SHALL HAVE A MINIMUM WIDTH OF 16" AND A MINIMUM DEPTH OF 8" AND SHALL HAVE 2 #4 BARS CONTINUOUS. TRENCH FOOTINGS SUPPORTING MORE THAN ONE FLOOR SHALL BE A MINIMUM OF 16" WIDE. FOOTINGS SHALL BE CONTINUOUS AROUND THE STRUCTURE AND FROM ONE LEVEL TO THE NEXT. MAXIMUM HORIZONTAL JUMPS FOR FOOTINGS SHALL BE 1'.

D. WALLS: HORIZONTAL BARS SHALL BE PLACED WITH THE TOP BAR WITHIN 8 INCHES OF THE TOP OF THE WALL, AND OTHER BARS EQUALLY SPACED. BARS SHALL LAP A MINIMUM 18 INCHES AT ENDS, SPICES AND AROUND CORNERS. REINFORCEMENT SHALL BE CONTINUOUS AROUND WINDOWS, DOORS AND OTHER OPENINGS WITH SPICES AS NOTED ABOVE TO MINIMIZE CRACKING AT CORNERS OF THE OPENINGS. BARS SHALL BE PLACED 2" FROM THE INSIDE FACE OF THE WALL.

E. DAMPPROOFING: DAMPPROOFING REQUIRED FOR WALLS ENCLOSING BASEMENTS OR OTHER HABITABLE SPACE. A MINIMUM OF ONE COAT OF DAMPPROOFING SHALL BE APPLIED TO EXTERIOR WALL SURFACES BELOW GRADE. SEAL TIE HOLES, VOIDS AND HONEYCOMBED AREAS WITH SEALANT BEFORE DAMPPROOFING.

F. WATERPROOFING: WATERPROOFING REQUIRED IN LIEU OF DAMPPROOFING UNDER A HIGH WATER TABLE OR OTHER SEVERE WATER CONDITIONS EXIST.

G. DRAIN TILE: INSTALL CONTINUOUS 4" DRAIN TILE AROUND THE PERIMETER OF ALL FOUNDATIONS ENCLOSING HABITABLE SPACES LOCATED BELOW GRADE. INSTALL VERTICAL DRAINS TO THE PERIMETER DRAIN TILE AT ALL WINDOW WELLS. SET DRAIN TILE ON A 2" DEEP BY 12" WIDE GRAVEL BED AND COVER TILE WITH AT LEAST 6" OF COARSE, CLEAN ROCK AND A FILTER MEMBRANE MATERIAL. CONNECT THE DRAINS TO A 20-GALLON SUMP PIT OR DRAIN BY GRAVITY TO AN OUTLET WELL AWAY FROM THE HOUSE.

H. FOUNDATION ANCHORAGE: BASEMENT FOUNDATION SILL PLATES SHALL BE BOLTED TO THE FOUNDATION WITH 1/2" ANCHOR BOLTS EMBEDDED AT LEAST 1 INCHES INTO THE CONCRETE AND SPACED NOT MORE THAN 3 FEET ON CENTER AND WITHIN 12 INCHES OF THE END OF EACH PIECE.

I. BEAM POCKETS: RECESSED 4" INTO THE WALL. THE DEPTH AND WIDTH SHALL BE SIZED TO ACCOMMODATE THE DESIGNATED BEAM.

J. FLOOR SLABS: BASEMENT FLOOR SLABS SHALL BE A MINIMUM 4 INCHES THICK AND PLACED ON A 4-INCH GRAVEL BASE. THE BASEMENT FLOOR SHALL BE ISOLATED FROM COLUMN PADS, INTERIOR COLUMNS AND INTERIOR BEARING WALLS. INTERIOR COLUMNS AND BEARING WALLS SHALL BE SUPPORTED ON A SEPARATE INTERIOR FOOTING (NOT ON TOP OF THE FLOOR SLAB). THE GARAGE FLOOR SHALL SLOPE TOWARDS THE GARAGE DOORWAYS OR SLOPE TO A TRENCH OR UN-TRAPPED DRAIN THAT DISCHARGES DIRECTLY TO THE EXTERIOR ABOVE GRADE. OPTIONAL EXISTIT IN LEAWOOD) 6 MIL. POLY VAPOR BARRIER SHOULD BE INSTALLED UNDER THE FLOOR SLAB.

GENERAL FRAMING NOTES

A. LUMBER: LUMBER IS #2 OR BETTER DOUGLAS FIR LARCH, EXCEPT FOR DECAY RESISTANT LUMBER WHICH IS SOUTHERN YELLOW PINE #2.

B. ALL EXTERIOR FRAMING LUMBER OR LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALL BE DECAY RESISTANT

C. L.V.L. HEADERS & BEAMS ARE TO HAVE A MIN. MODULUS OF ELASTICITY OF 13 x 10⁶ PSI.

D. FLOOR, CEILING AND ROOF OPENINGS: TRIMMER JOISTS SHALL BE DOUBLED WHEN THE HEADER IS SUPPORTED MORE THAN 3 FEET FROM THE TRIMMER JOIST BEARING. TRIMMER AND HEADER JOISTS SHALL BE DOUBLED WHEN THE SPAN OF THE HEADER EXCEEDS 4 FEET. THE ENDS OF HEADER RAFTERS MORE THAN 6 FEET LONG SHALL BE SUPPORTED BY FRAMING ANCHORS OR RAFTER HANGERS UNLESS BEARING ON A BEAM, PARTITION OR WALL.

E. FRAMING AROUND OPENINGS: TRIMMER AND HEADER JOISTS SHALL BE DOUBLED WHEN THE SPAN OF THE HEADER EXCEEDS 4' THE ENDS OF HEADER JOISTS MORE THAN 6 FEET LONG SHALL BE SUPPORTED BY FRAMING ANCHORS OR JOIST HANGERS UNLESS BEARING ON A BEAM, PARTITION, OR WALL.

FRAMING NOTES- FLOORS

A. BEARING: THE ENDS OF EACH JOIST SHALL NOT HAVE LESS THAN 1-1/2 INCHES OF BEARING ON WOOD OR METAL. JOISTS FRAMING INTO BEAMS SHALL BE SUPPORTED BY METAL JOIST HANGERS. JOIST FRAMING FROM OPPOSITE SIDES OF A BEAM, GIRDER OR PARTITION SHALL BE LAPPED AT LEAST 3 INCHES OR STRAPPED TOGETHER. JOISTS UNDER AND PARALLEL TO BEARING PARTITIONS SHALL BE DOUBLED.

B. LATERAL SUPPORT: JOISTS AT SUPPORTS SHALL BE SUPPORTED Laterally AT THE ENDS BY FULL-DEPTH SOLID BLOCKING NOT LESS THAN 2" NOMINAL THICKNESS OR BY ATTACHMENT TO A HEADER, BAND OR RIM JOIST OR TO AN ADJOINING STUD OR OTHERWISE PROVIDED WITH LATERAL SUPPORT TO PREVENT ROTATION. WHERE JOISTS ARE PERPENDICULAR TO BRACED WALL LINES, PROVIDE BLOCKING UNDER AND IN-LINE WITH THE BRACED WALL PANEL.

C. DECKING TO BE ¾" (MIN) PLYWOOD OR ORIENTED STRAND BOARD INSTALLED PERPENDICULAR TO JOISTS.

D. TOP OF WALL SUPPORT CONNECTIONS: WHERE JOISTS RUN PARALLEL TO FOUNDATION WALLS, SOLID BLOCKING FOR A MINIMUM OF 2 JOIST SPACES SHALL BE PROVIDED AT A MAXIMUM OF 4 FEET CENTERS, AND SHALL BE SECURELY NAILED TO THE JOISTS AND FLOORING. IF DUCTS ARE INSTALLED IN THE FIRST JOIST SPACE(S), NAIL 2 BY 4'S FLAT AT 4-FOOT CENTERS WITHIN THE JOIST SPACE(S) AND THEN PROVIDE THE SOLID BLOCKING. SECURE EACH 2 BY 4 TO THE SILL PLATE WITH FOUR 10D NAILS.

E. "I" JOISTS (IF USED) SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS.

F. PROVIDE BLOCKING OR BRIDGING AT CANTILEVERS.

G. IF REQUIRED BY CITY, PROVIDE 1/2" DRYWALL ON CEILING OF UNFINISHED SPACES FOR FLOOR FRAMING USING "I" JOISTS OR TRUSSES.

FRAMING NOTES - WALLS

A. SIZE, HEIGHT AND SPACING: UNLESS OTHERWISE NOTED, STUDS SHALL BE 2 X 4'S SPACED AT 16" O.C.

FOR EXTERIOR WALLS SUPPORTING A ROOF ONLY, 2 X 6 STUDS SPACED 16" O.C SHOULD BE USED FOR ALL WALLS 14' TO 18' TALL AND 2 X 6 STUDS SPACED 12" O.C SHOULD BE USED FOR WALLS 18' TO 20' TALL.

FOR WALLS SUPPORTING A ROOF AND A FLOOR 2 X 6 STUDS SPACED 16" O.C SHOULD BE USED FOR WALLS 12' TO 18' TALL.

STUDS SHALL BE CONTINUOUS FROM SOLE PLATE TO TOP PLATE OR CEILING DIAPHRAGM, EXCEPT FOR JACK STUDS, TRIMMER OR CRIPLE STUDS.

B. ANGLES: ANGLED WALLS ARE ASSUMED TO BE 45° UNLESS OTHERWISE NOTED.

C. FRAMING DETAILS: BEARING AND EXTERIOR WALL STUDS SHALL BE CAPPED WITH DOUBLE TOP PLATES INSTALLED TO PROVIDE OVER-LAPPING AT CORNERS AND AT INTERSECTIONS WITH OTHER PARTITIONS. END JOINTS IN DOUBLE TOP PLATES SHALL BE OFFSET AT LEAST 48 INCHES.

D. OPENINGS: UNLESS OTHERWISE NOTED, ALL HEADERS ARE TO BE TYPE "A" PER THE HEADER SCHEDULE. EACH END OF A HEADER SHALL HAVE A BEARING LENGTH OF NOT LESS THAN 1-1/2 INCHES FOR THE FULL WIDTH OF THE LINTEL. PROVIDE SOLID BLOCKING BELOW ALL STUDS SUPPORTING HEADERS AND BEAMS.

- UNLESS OTHERWISE DIMENSIONED, INTERIOR DOORS AND CASED OPENINGS ARE TO BE CENTERED IN THE WALL OR 3" FROM CORNERS AS INDICATED ON THE DRAWINGS.

E. FIRE BLOCKING OF NON-COMBUSTIBLE MATERIAL SHALL BE PROVIDED IN OPENINGS AROUND VENTS, PIPES, DUCTS, CHIMNEYS, FIREPLACES, AND LAUNDRY CHUTES AT CEILING AND FLOOR LEVELS.

F. CRIPPLE WALLS: FOUNDATION CRIPPLE WALLS SHALL BE FRAMED WITH 2 X 4 STUDS WITH A MINIMUM LENGTH OF 14" OR SHALL BE FRAMED OF SOLID BLOCKING. WHEN EXCEEDING 4' IN HEIGHT ON 2 STORY STRUCTURES, WALLS SHALL BE 2 X 6 STUDS AT 16" O.C.

G. BASEMENT NONBEARING WALLS: NON-LOAD BEARING STUD WALLS EXTENDING FROM THE FLOOR SLAB TO THE STRUCTURE ABOVE SHALL BE PROVIDED WITH A MINIMUM 1-INCH EXPANSION JOINT.

H. GARAGE DOORS AND FRAMES SHALL BE DESIGNED AND INSTALLED TO MEET A 90 mph WIND LOAD. THE H-FRAME FOR ATTACHMENT OF TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2x6 VERTICAL JAMBS RUNNING FROM FLOOR TO CEILING ATTACHES WITH 3-1/4"x120 NAILS @ 1" O.C. STAGGERED WITH 71 3-1/4"x120 NAILS THRU JAMB INTO HEADER, MINIMUM 2x8 HEADER FOR ATTACHMENT OF COUNTER BALANCE SYSTEM.

FRAMING NOTES- DECKS

A. FOR DECK LEDGER ATTACHMENT AND DECK CONSTRUCTION REFER TO IRC SECTION 501.

FRAMING NOTES- CEILING

A. BLOCKING: ROOF RAFTERS AND CEILING JOISTS SHALL BE SUPPORTED Laterally TO PREVENT ROTATION AND LATERAL DISPLACEMENT.

B. JOISTS FRAMING INTO BEAMS SHALL BE SUPPORTED BY METAL JOIST HANGERS.

FRAMING NOTES- ROOF

A. FRAMING: RAFTERS SHALL BE FRAMED DIRECTLY OPPOSITE EACH OTHER AT THE RIDGE. THERE SHALL BE A RIDGE BOARD AT LEAST 1-INCH NOMINAL THICKNESS AT ALL RIDGES AND NOT LESS IN DEPTH THAN THE CUT END OF THE RAFTER. AT ALL VALLEYS AND HIPS THERE SHALL BE A SINGLE VALLEY OR HIP RAFTER NOT LESS THAN 2-INCH NOMINAL THICKNESS AND NOT LESS IN DEPTH THAN THE CUT END OF THE RAFTER.

B. BRACING: ALL FURLINS AND HIPS, RIDGES, AND VALLEYS SHOWN TO BE SUPPORTED SHALL BE BRACED WITH A STRUT DOWN TO A BEARING WALL (WALLS LOCATED DIRECTLY ABOVE A BEAM LINE OR CONTINUOUS FOOTING). THE MINIMUM SLOPE OF THE STRUTS SHALL NOT BE LESS THAN 45° FROM THE HORIZONTAL.

C. RAFTER TIES: RAFTERS SHALL BE NAILED TO ADJACENT CEILING JOISTS TO FORM A CONTINUOUS TIE BETWEEN EXTERIOR WALLS WHEN SUCH JOISTS ARE PARALLEL TO THE RAFTERS. WHEN NOT PARALLEL, RAFTERS SHALL BE TIED TO 2"x4" MINIMUM CROSSBIES AT EACH RAFTER AND LOCATED AS CLOSE TO THE CEILING JOISTS AS POSSIBLE (RE: DETAIL 3 & 4/G/2).

D. RAFTER COLLAR TIES: PROVIDE 1x4 MIN. COLLAR TIES AT 48" O.C. (RE: DETAIL 3 & 4/G/2). AT CATHEDRAL CEILINGS PROVIDE RIDGE STRAPS.

E. VAULTED CEILINGS: FOR RAFTERS SMALLER THAN A 2 X 10, FURRING MUST BE ADDED TO THE BOTTOM OF THE RAFTER TO OBTAIN A 9 1/4" MINIMUM DEPTH.

F. FLASH AND COUNTERFLASH ROOF RIDGES AND VALLEYS, ROOF PENETRATIONS, CHANGES IN ROOF PITCHES, RAKES, CHIMNEY BASES, WINDOW AND DOOR HEADS, ETC. TO PROVIDE WEATHER TIGHT CLOSURES, ALL EXPOSED FLASHING TO BE 26 GAUGE ALUMINUM. COUNTERFLASHING SHALL BE FABRICATED FROM 40# TERNE METAL.

G. ATTIC VENTILATION: THE NET FREE VENTILATION AREA SHALL BE NOT LESS THAN 1/50 OF THE AREA OF THE SPACE VENTILATED, EXCEPT THAT THE AREA MAY BE 1/300, PROVIDED AT LEAST 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED. AT LEAST 3 FEET ABOVE EAVES OR CORNICE VENTS, WITH THE BALANCE OF THE REQUIRED VENTILATION PROVIDED BY EAVE OR CORNICE VENTS. RAFTERS SPACES ENCLOSED BY CEILINGS DIRECTLY APPLIED TO UNDERSIDE OF RAFTERS SHALL BE SIZED TO ALLOW A MINIMUM 1 INCH CLEAR VENTED AIR SPACE ABOVE THE INSULATION AND EACH SPACE BETWEEN JOISTS SHALL BE VENTED.

H. ROOF SHEATHING: SHALL BE INSTALLED PERPENDICULAR TO THE ROOF JOISTS AND THE ENDS SHALL BE STAGGERED.

PREFABRICATED WOOD TRUSSES (IF USED)

A. ROOF AND FLOOR TRUSSES SHALL BE DESIGNED IN ACCORDANCE WITH TRUSS PLATE INSTITUTE (TPI) DESIGN SPECIFICATION FOR METAL PLATE CONNECTED WOOD TRUSSES AND THE NATIONAL DESIGN SPECIFICATION FOR ANSIFORMA WOOD CONSTRUCTION. PROVIDE TEMPORARY AND PERMANENT BRACING ON ALL TRUSSES, AS REQUIRED TO PROVIDE MEMBER AND TRUSS STABILITY.

B. ROOF TRUSSES SHALL BE DESIGNED AND CONSTRUCTED FOR A MAXIMUM TOTAL LOAD DEFLECTION OF L/240, AND TO SAFELY SUPPORT THE FOLLOWING LOADS:

1. TOP CHORD:
 - a. LIVE LOAD SEE GENERAL NOTES
 - b. DEAD LOAD 15 PSF
2. BOTTOM CHORD:
 - a. LIVE LOAD 10 PSF
 - b. DEAD LOAD 10 PSF
3. WIND LOADS IN ACCORDANCE WITH THE APPROPRIATE BUILDING CODE. GABLED END TRUSSES SHALL HAVE VERTICAL MEMBERS SPACED AT 16" ON CENTER MAXIMUM.
4. TRUSSES SHALL ALSO BE DESIGNED TO SUPPORT ADDITIONAL OVERBUILD FRAMING TO FORM VALLEYS AND HIPS ON ROOFS.
5. TRUSSES SHALL BE DESIGNED TO SUPPORT DRIFTED SNOW LOADS IN ACCORDANCE WITH THE APPROPRIATE BUILDING CODE.
6. TRUSSES SHALL BE ATTACHED TO WALL ASSEMBLIES BY CONNECTIONS CAPABLE OF RESISTING UPLIFT FORCES AS SPECIFIED ON THE TRUSS DESIGN DRAWINGS PER IRC TABLE R802.11.

ENERGY REQUIREMENTS

A. THE BUILDING THERMAL ENVELOPE IS REQUIRED TO BE SEALED (IRC N102.4.1)

B. RECESSED LIGHTING SHALL BE SEALED TO PREVENT LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACES

C. DUCTS, AIR HANDLERS, FILTER BOXES AND BUILDING CAVITIES USED AS DUCTS SHALL BE SEALED (IRC SECTION N103.2)

D. PENETRATIONS IN AIR BARRIERS (HOUSE WRAP) SHALL BE TAPED AND SEALED AS REQUIRED BY AIR BARRIER MANUFACTURER, WINDOW DOOR MANUFACTURER AND ENERGY CODE.


D. FOR CITY OF OLATHE (BUILDER CHECK ONE)

☐ THE ENERGY AUDIT METHOD OF COMPLIANCE FOR THE 2009 ENERGY CODE SHALL BE FOLLOWED.


☐ THE PRESCRIPTIVE METHOD FOR COMPLIANCE WITH THE 2012 ENERGY CODE SHALL BE FOLLOWED.

FASTENING SCHEDULE


CONNECTION	NAILS	LOCATION
JOIST TO SILL OR GIRDER	3-8d 3 - 3" x 0.131"	TOENAIL
BRIDGING TO JOIST	2-8d 2 - 3" x 0.131"	TOENAIL
SOLE PLATE TO JOIST OR BLOCKING	6d at 16" o.c. 3-3" x 0.131 at 8" o.c.	FACE NAIL
SOLE PLATE TO JOIST / BLOCKING AT BRACED WALL PANELS	3-16d at 16" o.c. 4 - 3" x 0.131 at 16" o.c.	FACE NAIL
TOP PLATE TO STUD	2-16d 3 - 3" x 0.131"	END NAIL
STUD TO SOLE PLATE	4-8d 4 - 3" x 0.131"	TOENAIL
	2-16d 3 - 3" x 0.131"	FACE NAIL
DOUBLE STUDS	16d at 24" o.c. 3" x 0.131 at 8" o.c.	FACE NAIL
DOUBLE TOP PLATES	16d at 24" o.c. 3" x 0.131 at 12" o.c.	FACE NAIL
	8-16d 12-3" x 0.131	LAP SPICE
BLOCKING BETWEEN JOISTS AND RAFTERS TO TOP PLATE	3-8d 3-3" x 0.131 at 12" o.c.	TOENAIL
RIM JOIST TO TOP PLATE	8d at 6" o.c. 3" x 0.131 at 6" o.c.	TOENAIL
TOP PLATE, LAPS AND INTERSECTIONS	2 - 16d 3 - 3" x 0.131"	FACE NAIL
CONTINUOUS HEADER, 2 PIECES.	16d at 16" o.c. 3" x 0.131 at 12" o.c.	FACE NAIL
CEILING JOISTS TO TOP PLATE	3-8d 5 - 3" x 0.131	TOENAIL
CONTINUOUS HEADER TO STUD	4-8d 6 - 3" x 0.131	TOENAIL
CEILING JOISTS, LAPS OVER PARTITIONS	3-16d 4 - 3" x 0.131	FACE NAIL
CEILING JOISTS TO PARALLEL RAFTERS/ RAFTER TIES TO RAFTERS	RE: IRC TABLE R802.5.1 (3)	FACE NAIL
RAFTER TO PLATE	3-8d 3 - 3" x 0.131"	TOENAIL
1" DIAGONAL BRACE TO EACH STUD AND PLATE	2-8d 2 - 3" x 0.131"	FACE NAIL
BUILT UP CORNER STUDS	16d at 24" o.c. 3" x 0.131" at 16" o.c.	FACE NAIL
BUILT UP BEAMS, STAGGER NAILS ON OPPOSITE SIDES	16d at 32" o.c. 3" x 0.131" at 24" o.c.	FACE NAIL
BUILT UP BEAMS AT ENDS AND SPICES	2-20d 2 - 3" x 0.131"	FACE NAIL
COLLAR TIE TO RAFTER	3-10d 4 - 3" x 0.131"	FACE NAIL
JACK RAFTER TO HIP	3-10d 4 - 3" x 0.131"	TOE NAIL
	2-16d 3 - 3" x 0.131"	FACE NAIL
ROOF RAFTER TO 2 x RIDGE BEAM	2-16d 3 - 3" x 0.131"	TOE NAIL FACE NAIL
JOIST TO BAND JOIST	3-16d 4 - 3" x 0.131"	FACE NAIL
LEDGER STRIP	3-16d 4 - 3" x 0.131"	FACE NAIL
3/4" OR LESS WOOD STRUCTURAL PANEL WALL, SUBFLOOR, 4 ROOF SHEATHING	6d at 12" o.c. 6d at 6" o.c. 2/38" x 0.131 at 8" o.c. 2/38" x 0.131 at 4" o.c.	INTERMEDIATE EDGES
1/8" TO 1" WOOD STRUCTURAL PANEL WALL, SUBFLOOR, 4 ROOF SHEATHING	10d at 12" o.c. 8d at 6" o.c. 2/12" x 0.131 at 8" o.c. 2/38" x 0.131 at 4" o.c.	INTERMEDIATE EDGES
1/8" TO 1 1/4" WOOD STRUCTURAL PANEL WALL, SUBFLOOR, 4 ROOF SHEATHING	8d at 12" o.c. 10d at 6" o.c. 3" x 0.148 at 8" o.c. 3" x 0.148 at 4" o.c.	INTERMEDIATE EDGES
HARDBOARD SIDING	8d at 6" o.c. 8d at 12" o.c.	INTERMEDIATE EDGES
1/2" GYPSUM SHEATHING	6d at 8" o.c. 8d at 4" o.c.	INTERMEDIATE EDGES
5/8" GYPSUM SHEATHING	8d at 8" o.c. 8d at 4" o.c.	INTERMEDIATE EDGES
WOOD / JOISTS AT EACH END AND BEARING POINT	8d each side	FACE NAIL

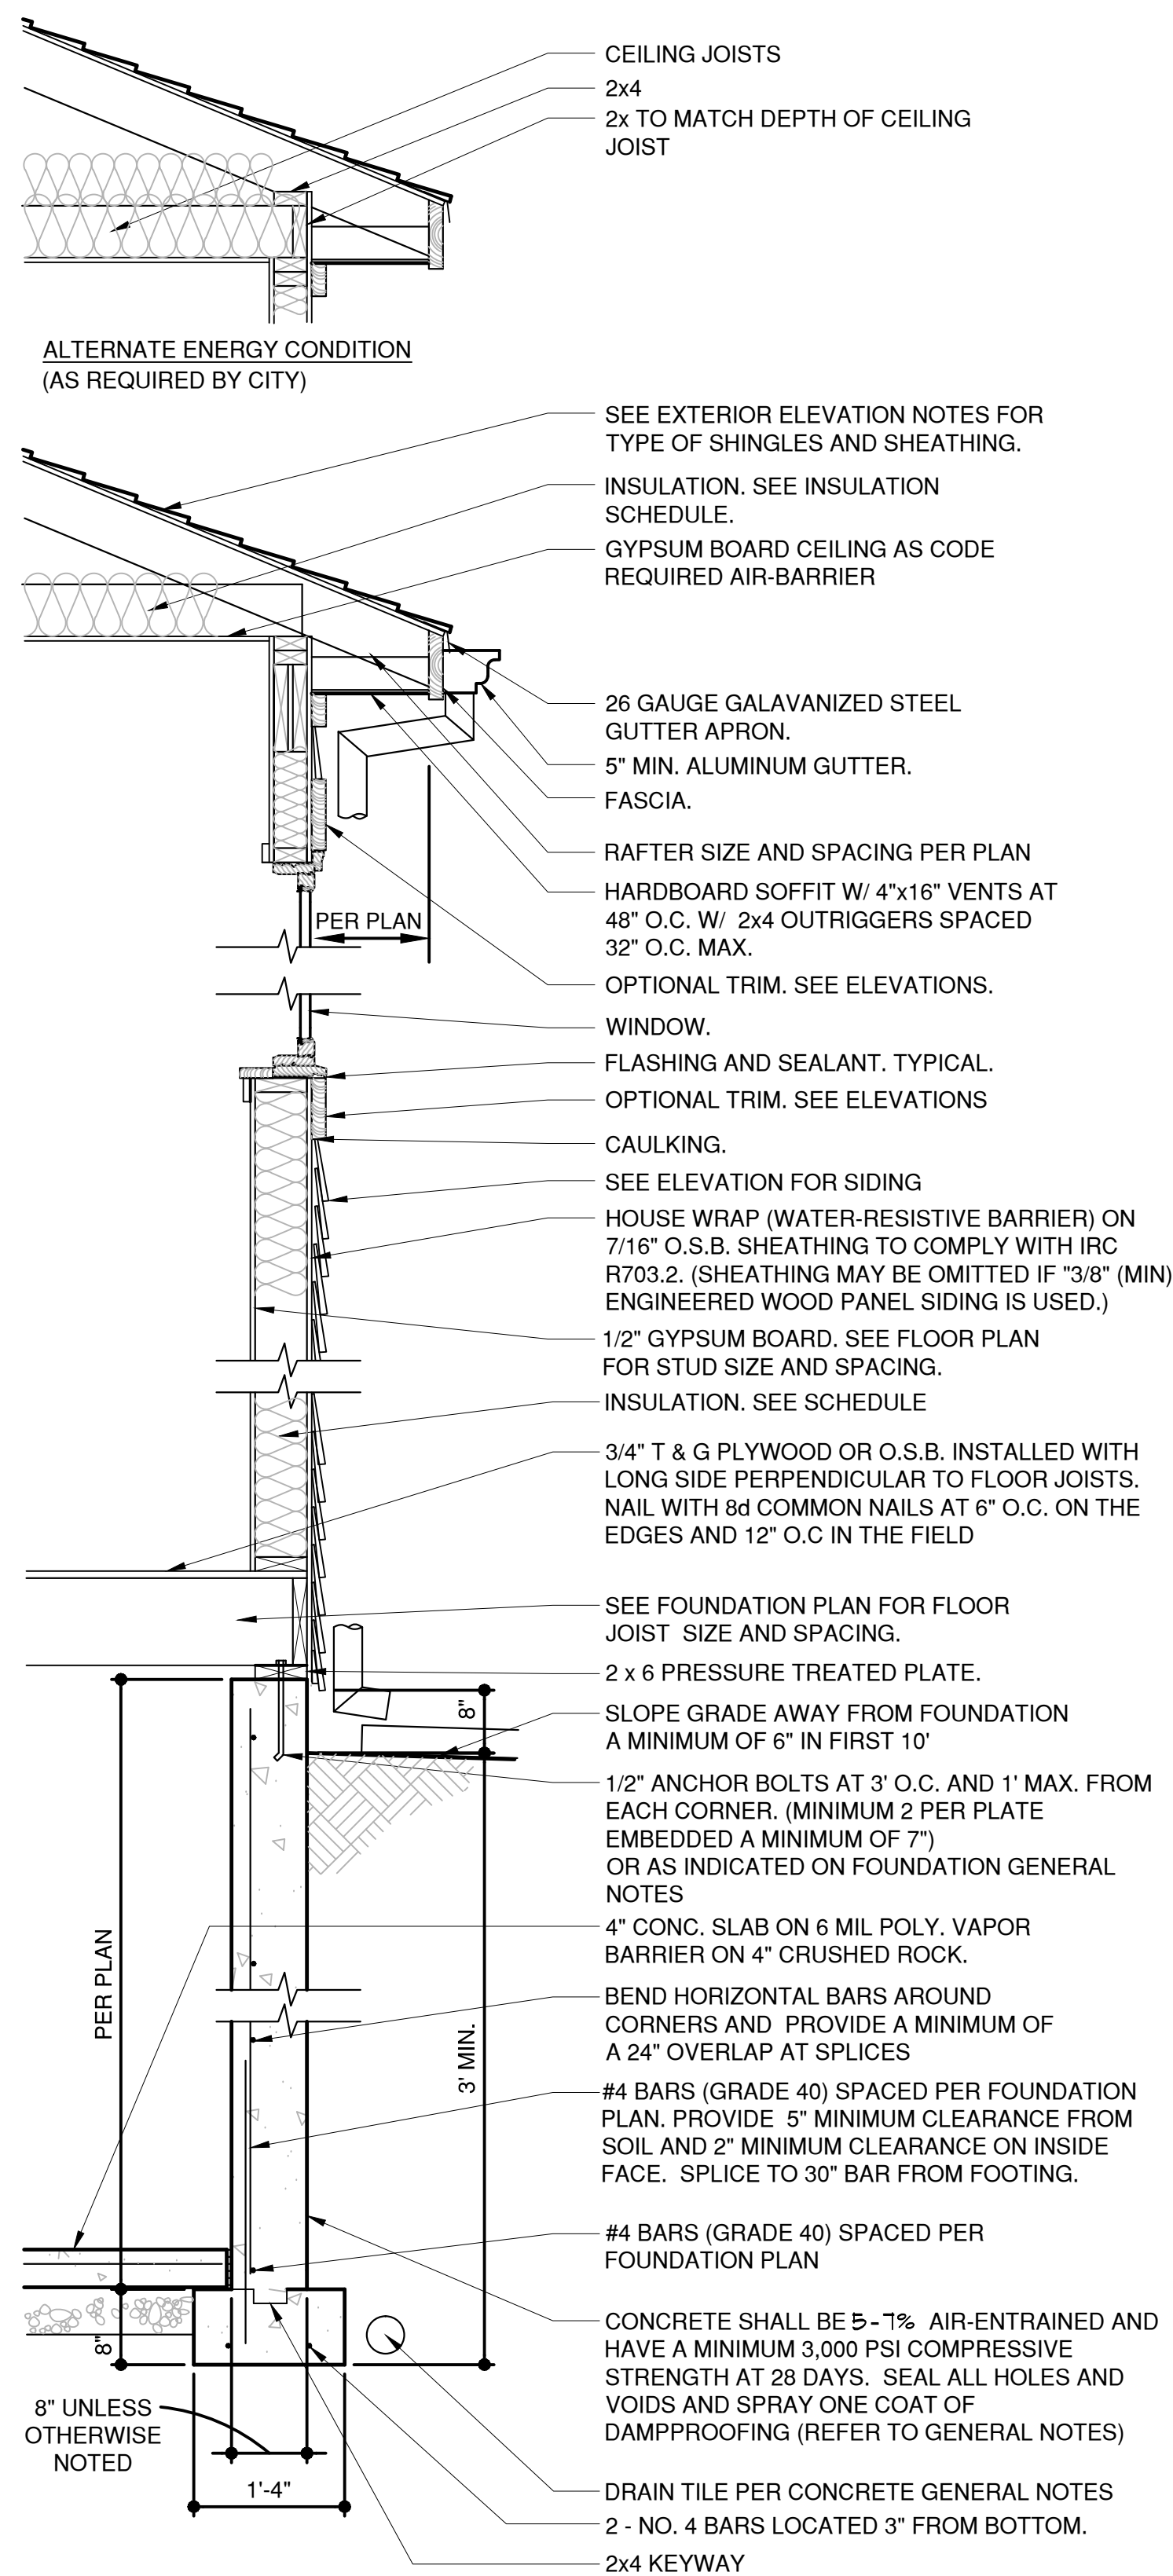


1 WALL SECTION
3/4"=1'-0"
A-DTW-06062-19

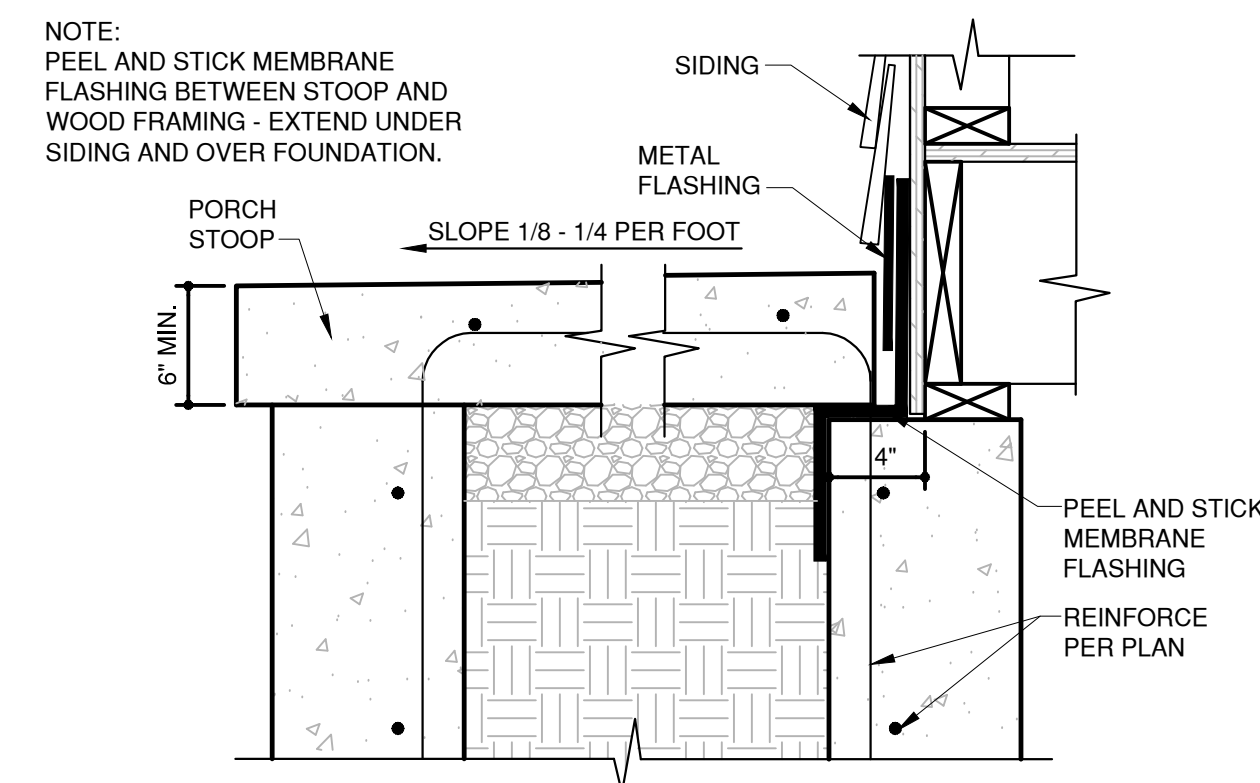


5 STOOP DETAIL
1 1/2"=1'-0"
A-DTV-03300-35B

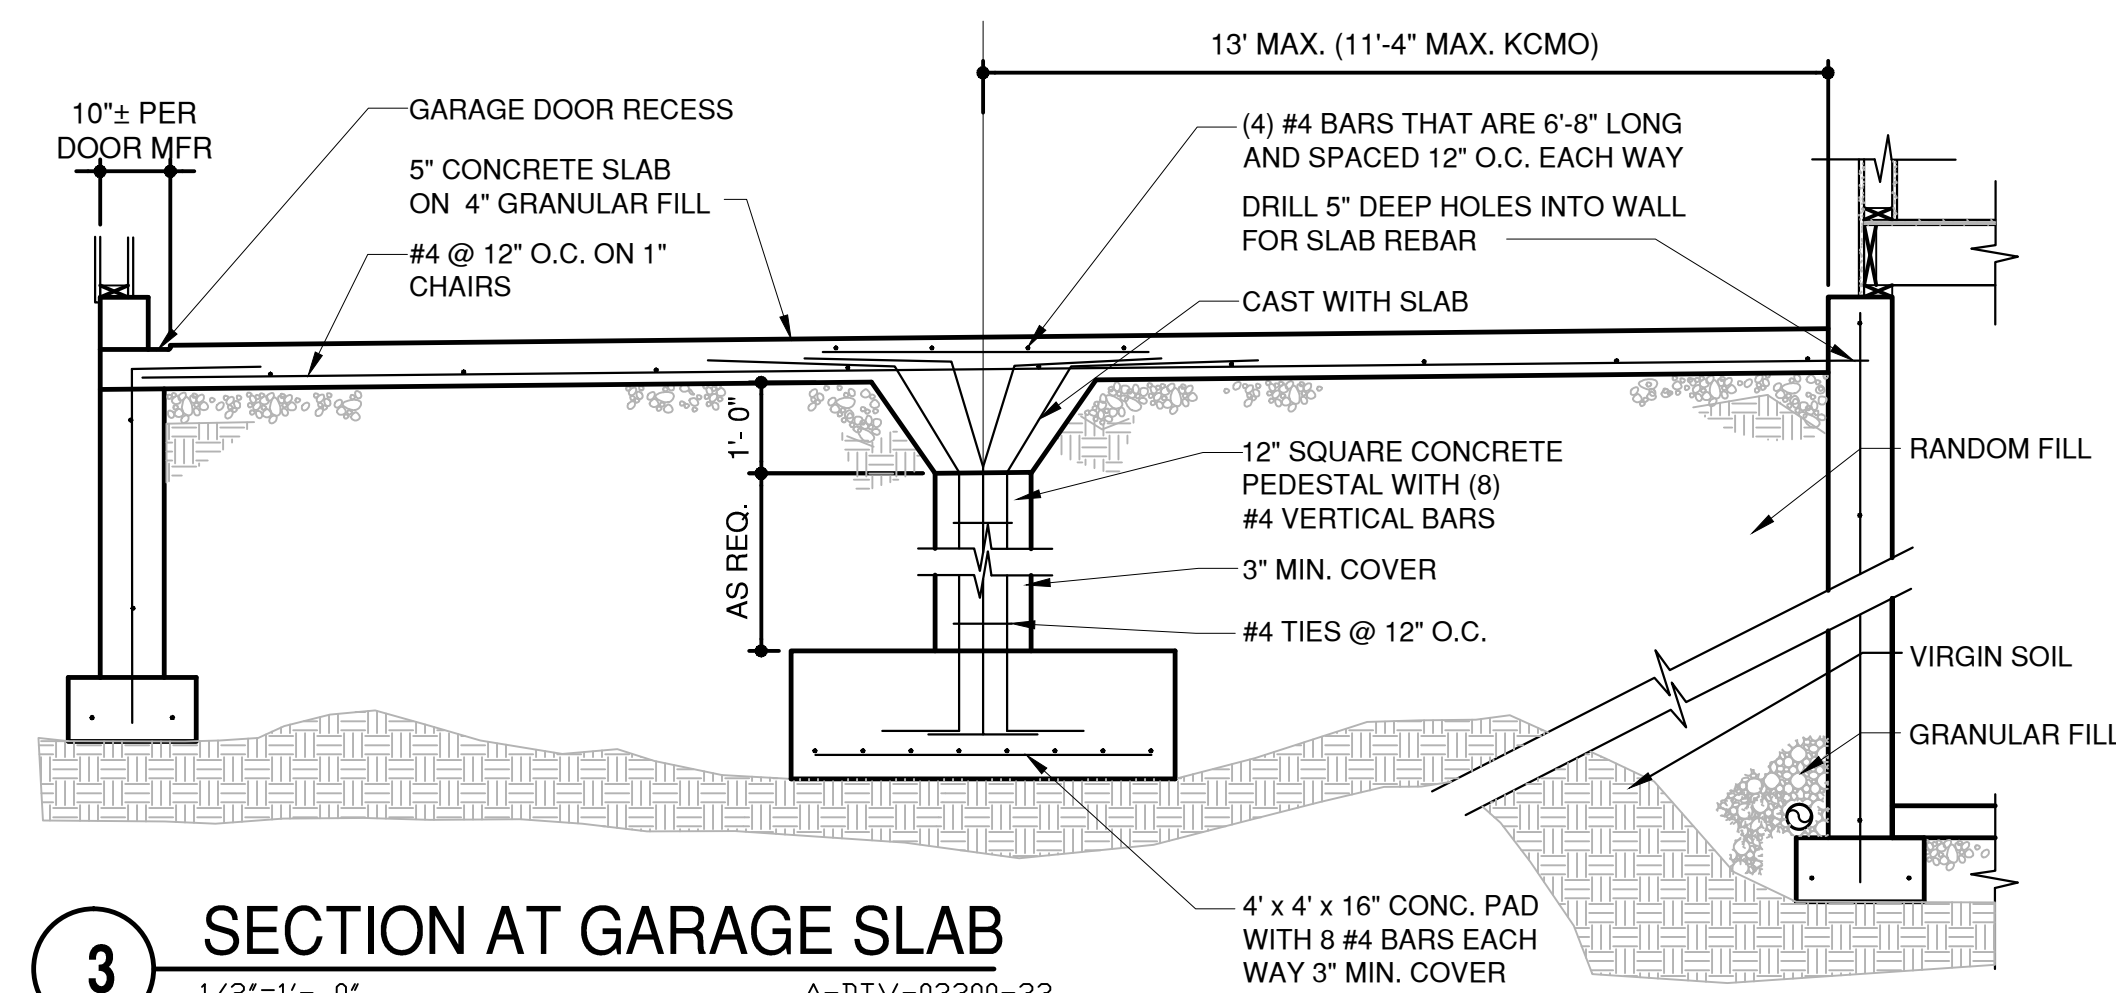


3 SECTION AT GARAGE SLAB
1/2"=1'-0"
A-DTV-03300-33

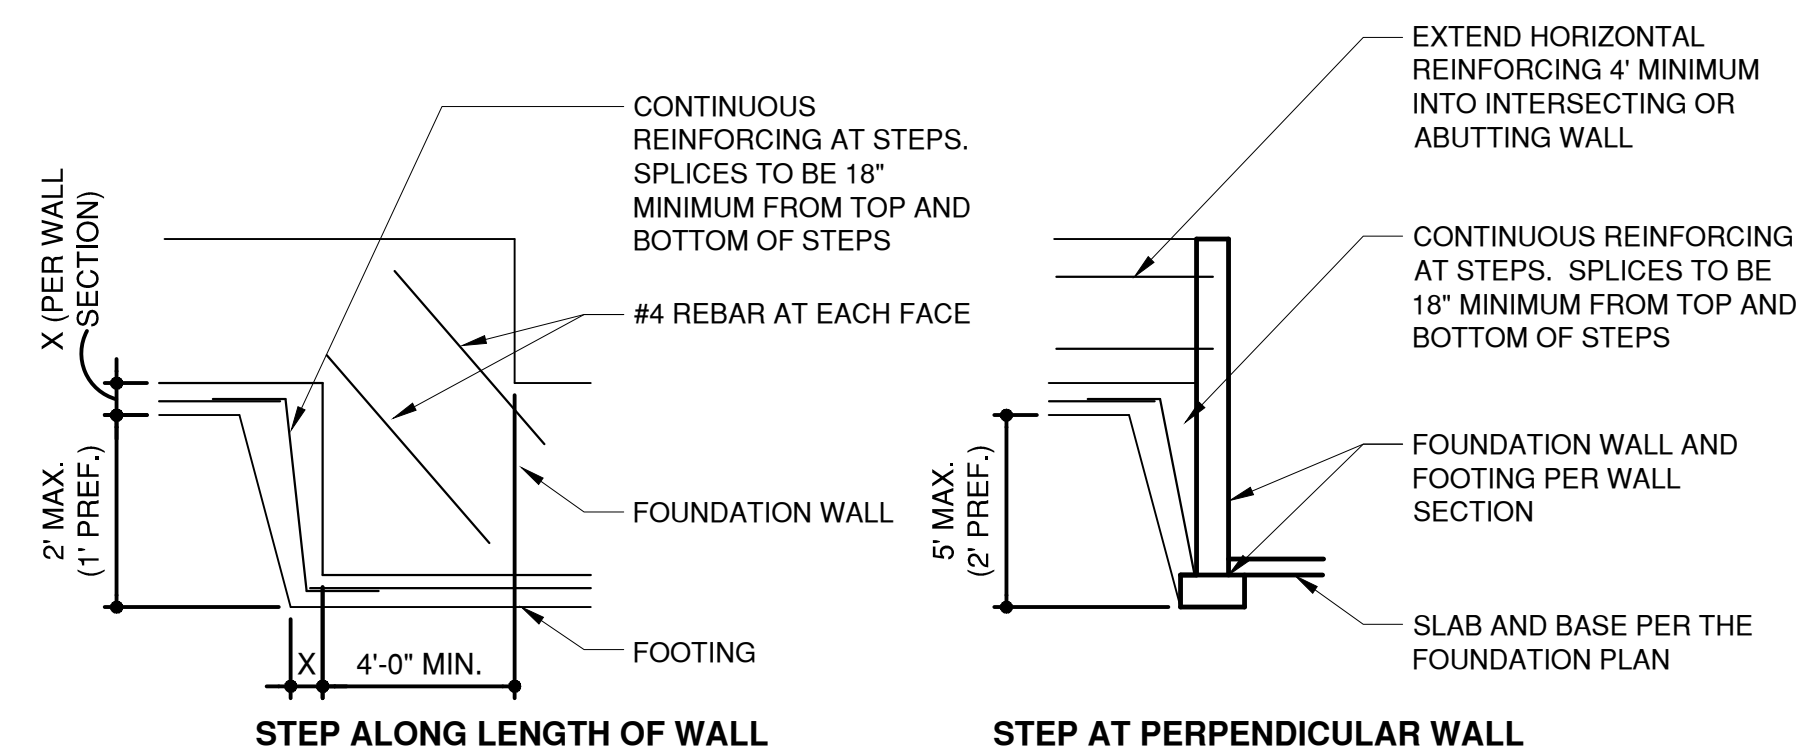

2 ELEVATION AT FOUNDATION STEP
1/4"=1'-0"
A-DTE-03300-01

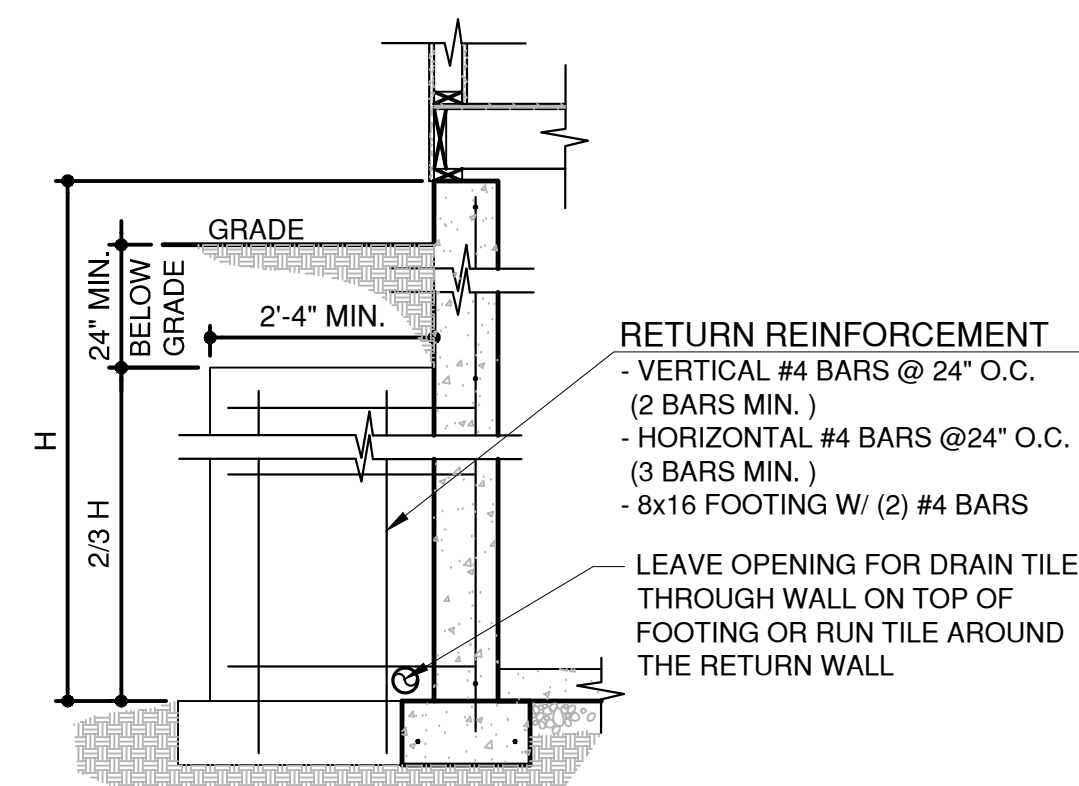

8 RETURN WALL DETAIL
1/2"=1'-0"
A-DTV-03300-34

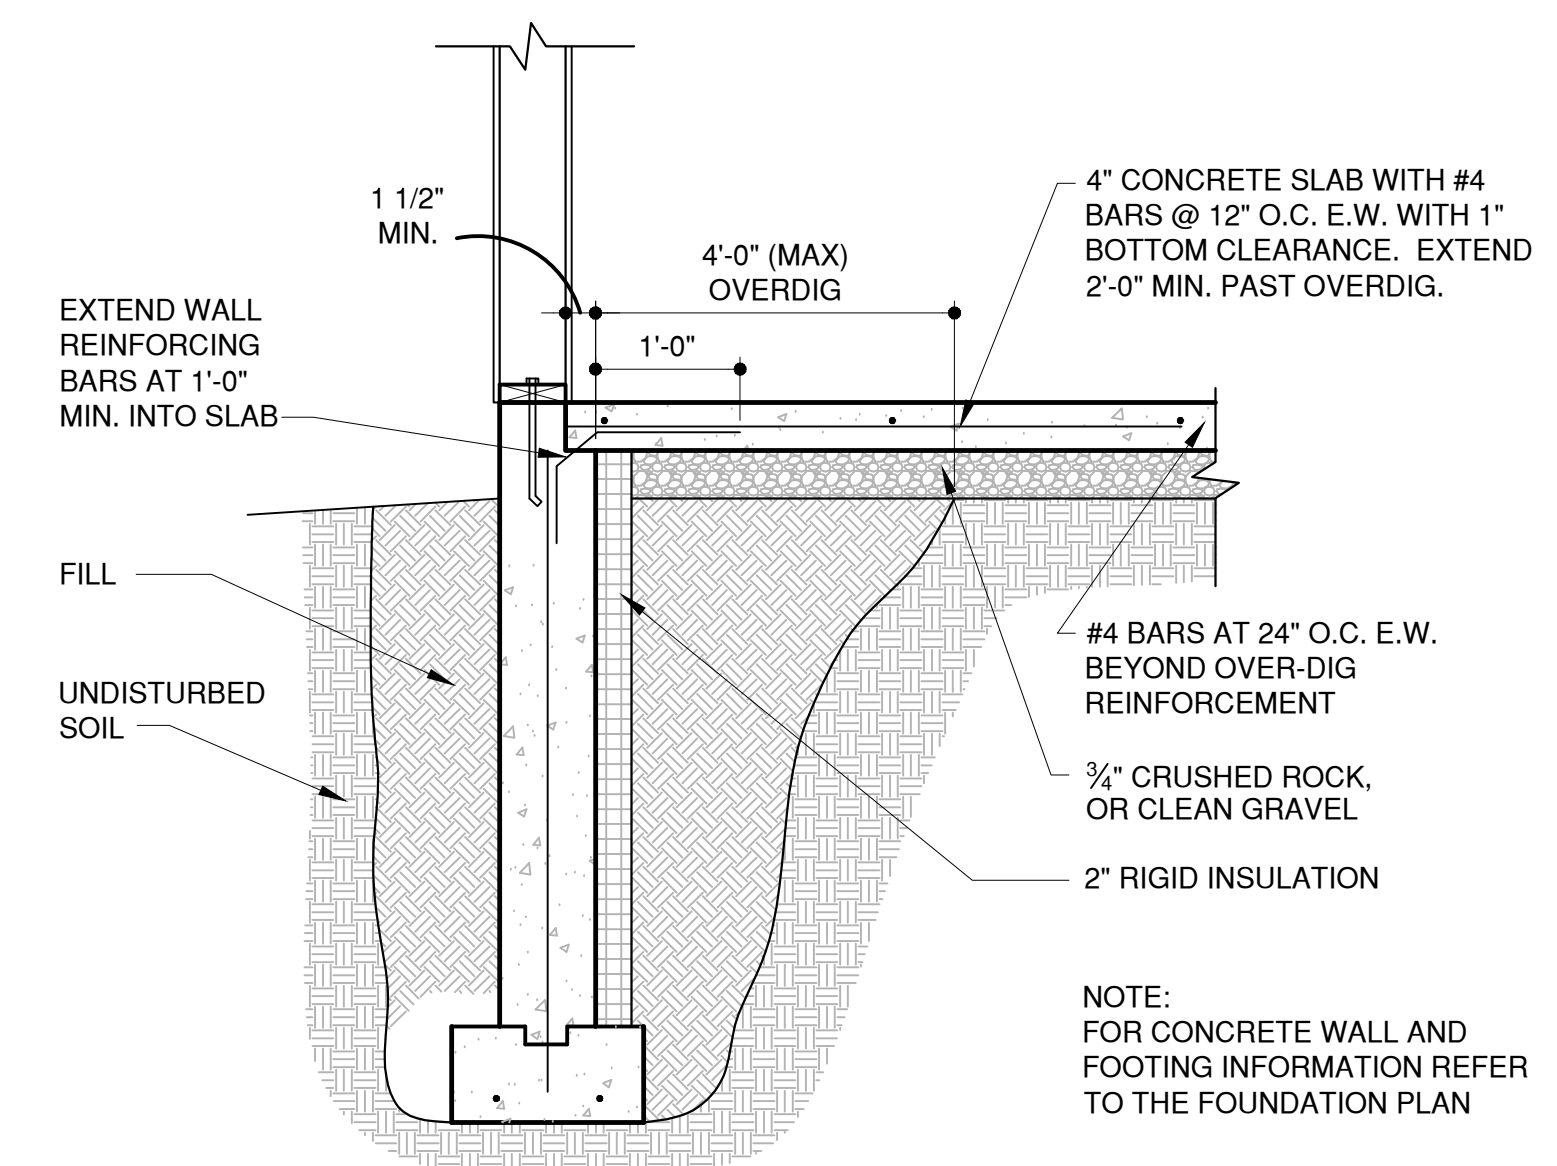






10 WALKOUT WALL DETAIL
3/4"=1'-0"
A-DTW-06062-29

TABLE R602.10.6.4
TENSION STRAP CAPACITY REQUIRED FOR RESISTING WIND PRESSURES
PERPENDICULAR TO METHOD PFH, PFG, AND CS-PF BRACED WALL PANELS



5-6-14

MINIMUM WALL STUD FRAMING NORMAL SIZE AND GRADE	MAXIMUM PONY WALL HEIGHT (feet)	MAXIMUM TOTAL WALL HEIGHT (feet)	MAXIMUM OPENING WIDTH (feet)	TENSION STRAP CAPACITY REQUIRED (pounds) a,b		NO. OF 8d COMMON NAILS REQUIRED AT FLAT 2x6	
				BASIC WIND SPEED (mph)		BASIC WIND SPEED (mph)	
				90	90	90	90
				EXPOSURE B	EXPOSURE C	EXPOSURE B	EXPOSURE C
2 x 4 NO. 2 GRADE	0	10	18	1,000	1,000	8	8
	1	10	9	1,000	1,000	8	8
			16	1,000	2,325	8	16
			18	1,200	2,725	8	18
	2	10	9	1,000	1,550	8	10
			16	2,025	3,900	14	26
			18	2,400	DR	16	DR
	2	12	9	1,200	2,750	8	12
			16	3,200	DR	22	DR
			18	3,850	DR	26	DR
	4	12	9	2,350	DR	16	DR
			16	DR	DR	DR	DR
2 x 6 STUD GRADE	2	12	9	1,000	1,750	8	12
			16	2,050	3,550	14	24
			18	2,450	4,100	14	28
	4	12	9	1,500	2,775	16	18
			16	3,150	DR	10	DR
			18	3,675	DR	14	DR

a. DR = DESIGN REQUIRED
b. STRAP SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

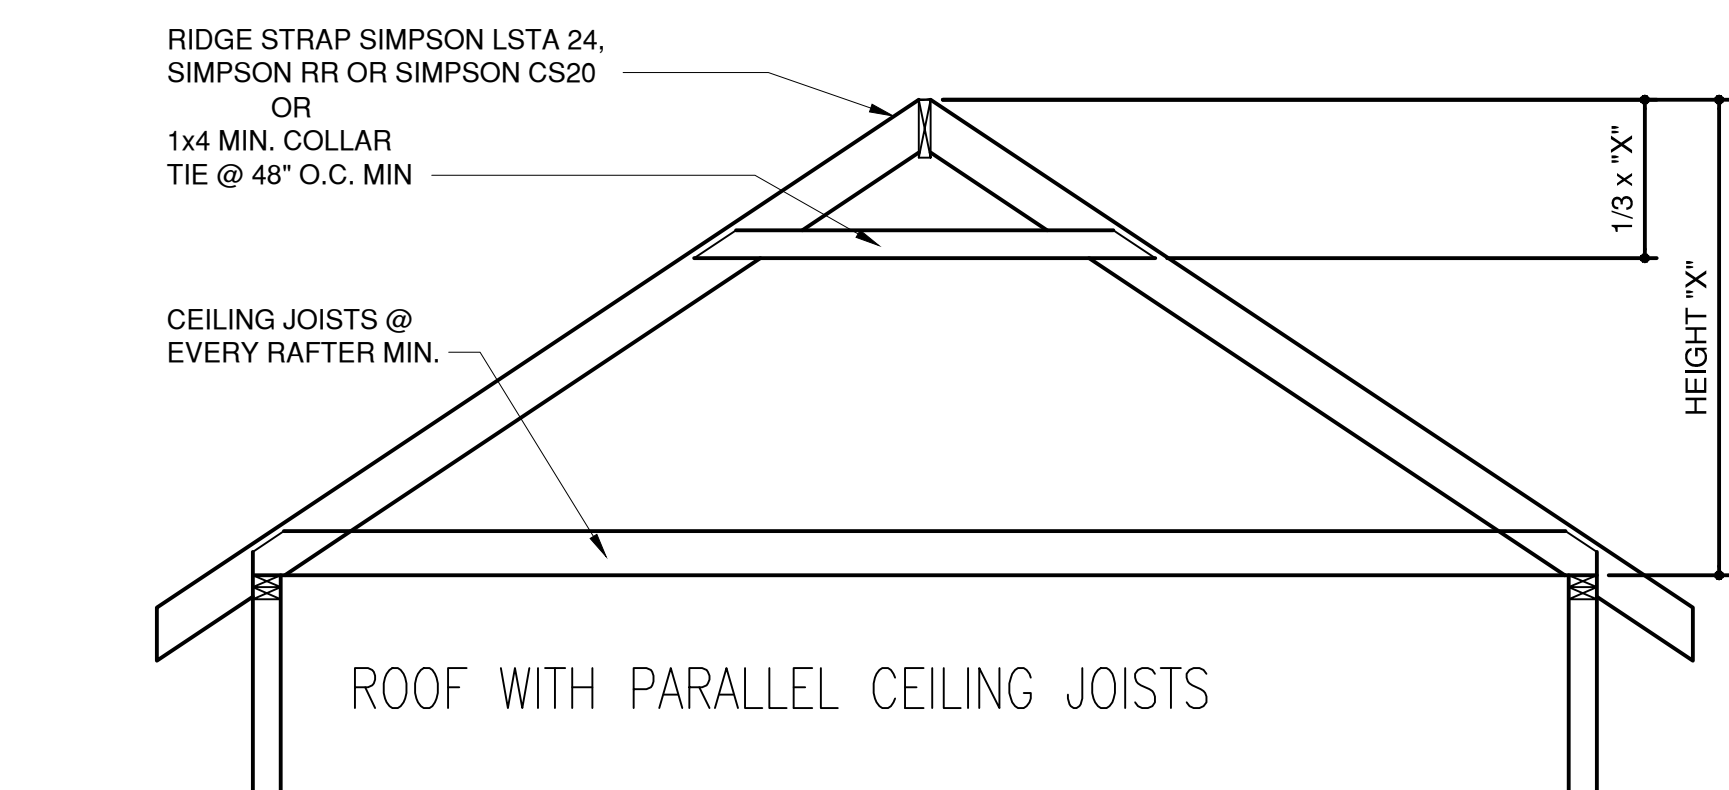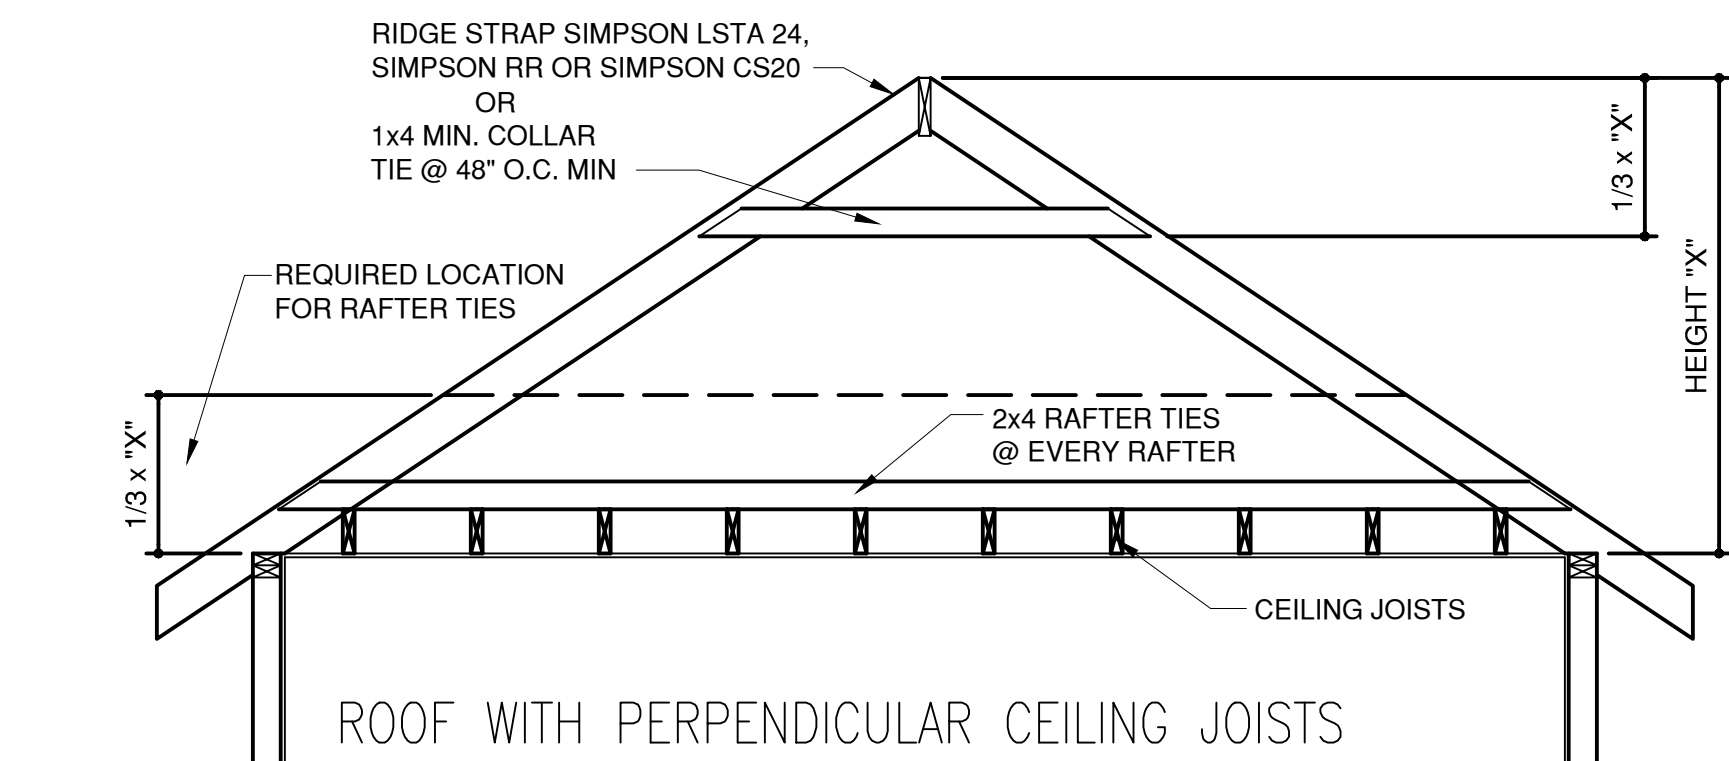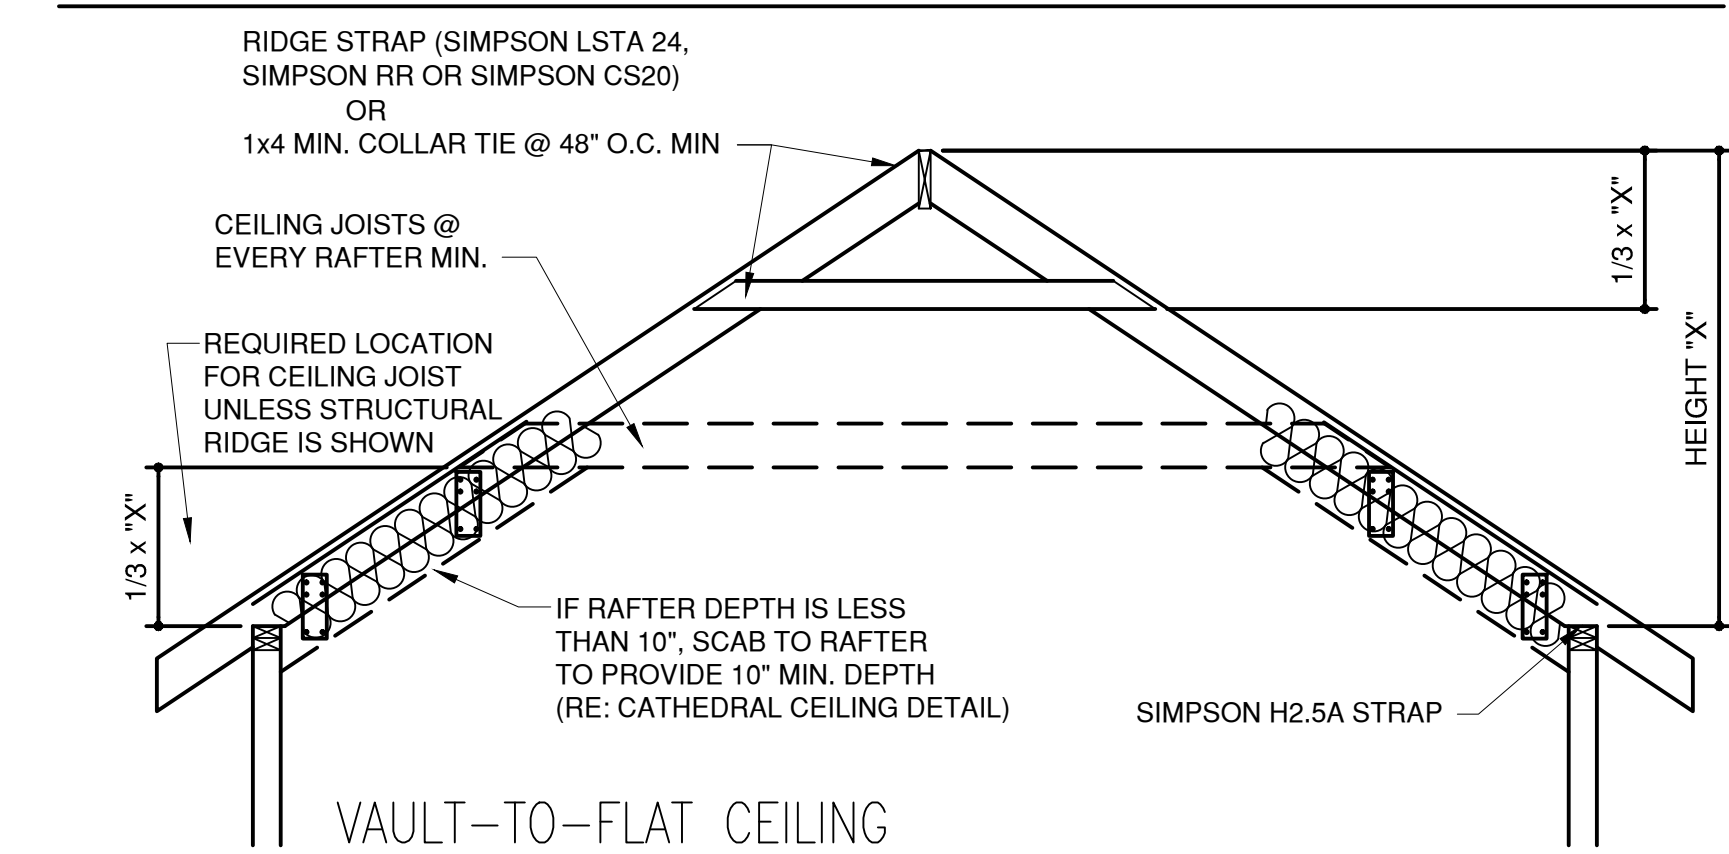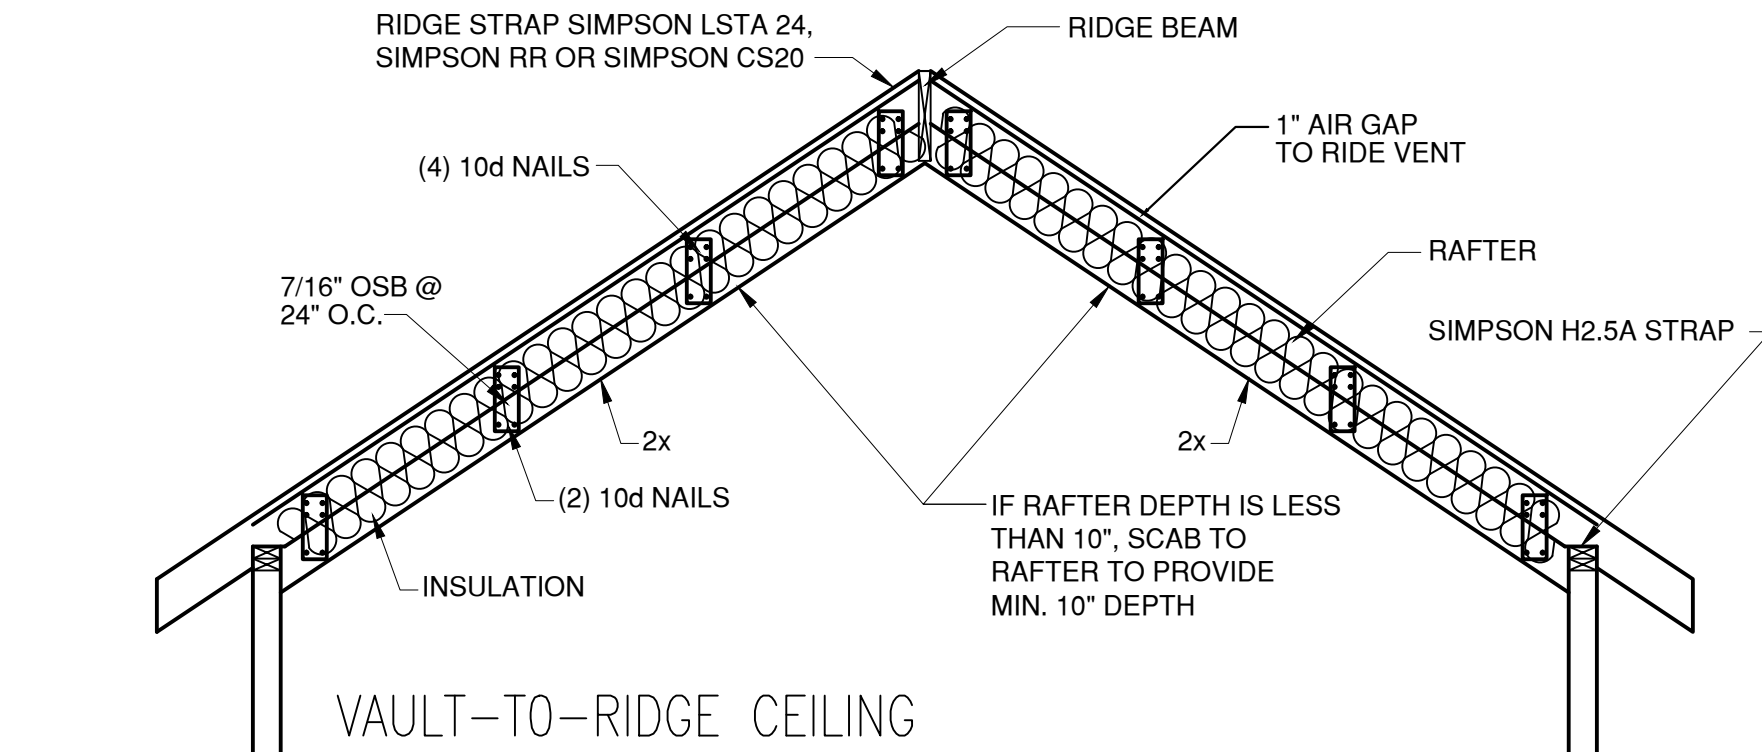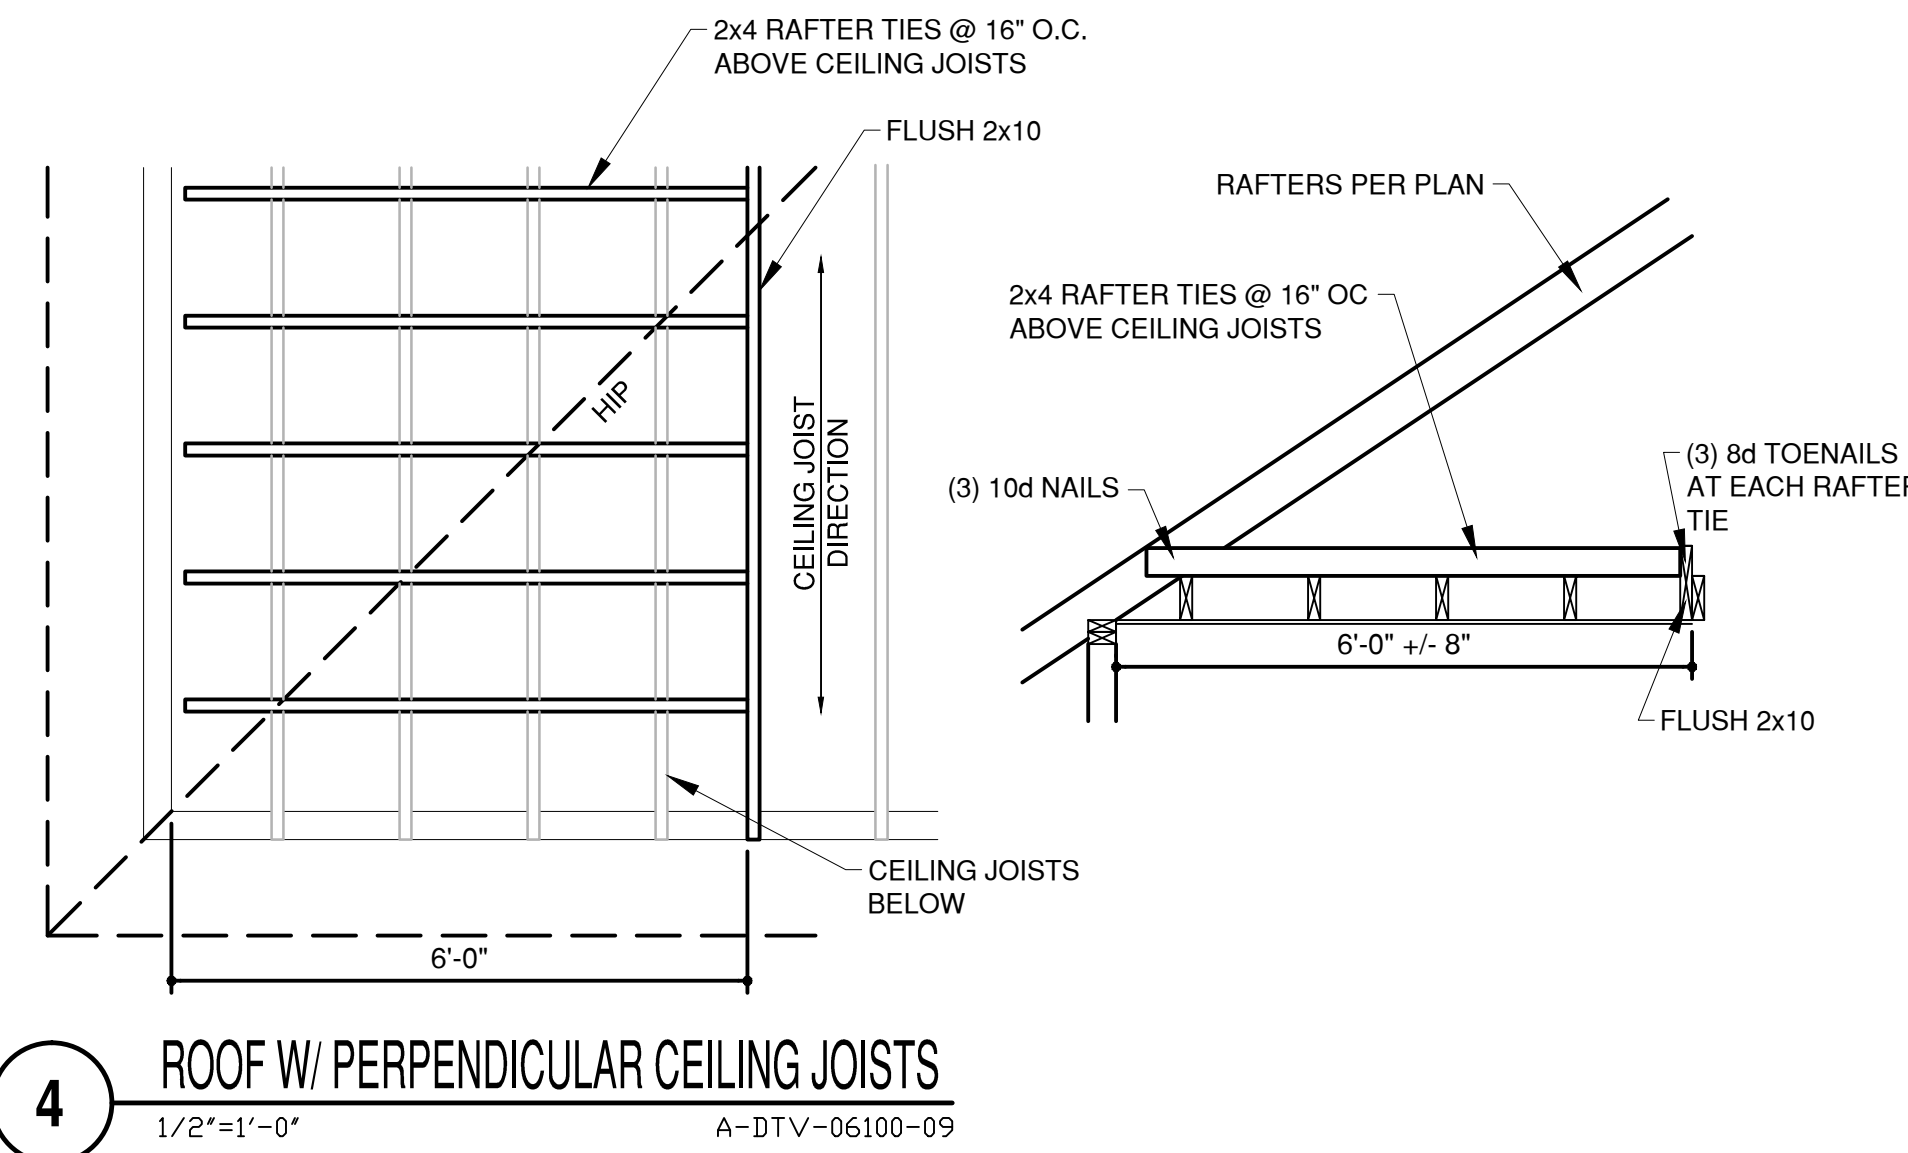

NOTE:
ROOF FRAMING TO COMPLY WITH SECTIONS
R802, R802.3, R802.3.1 AND R802.11

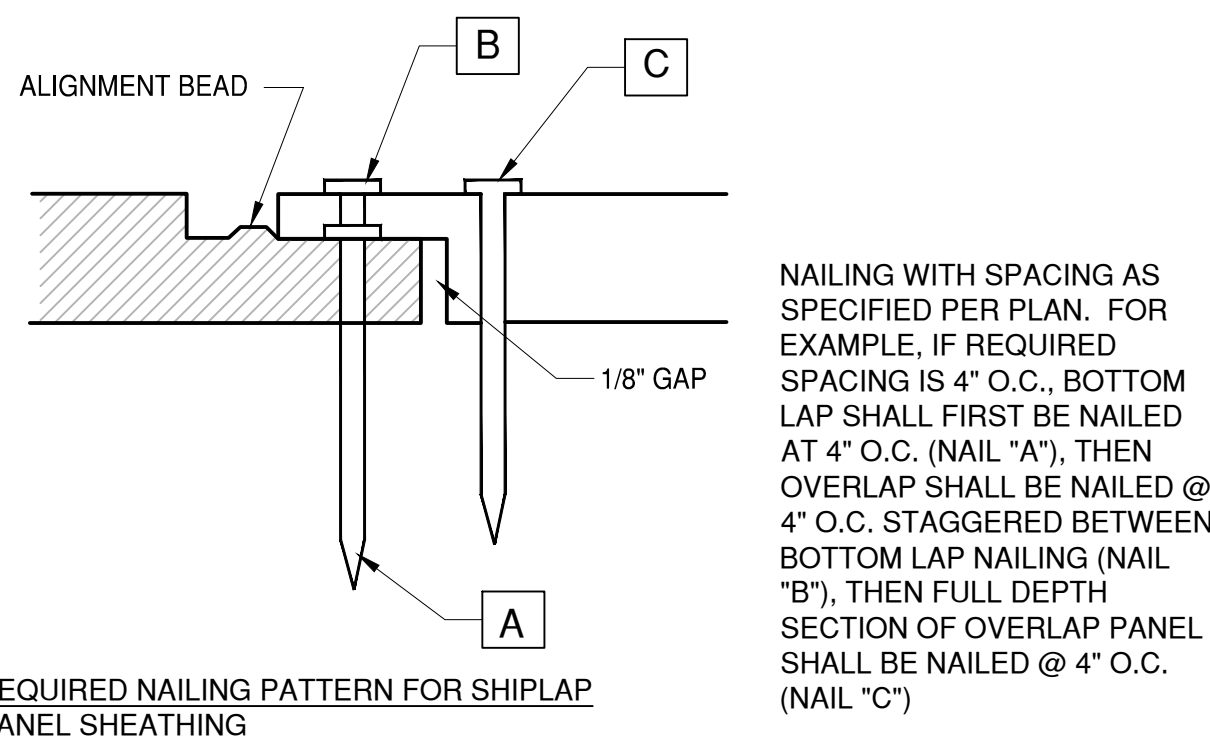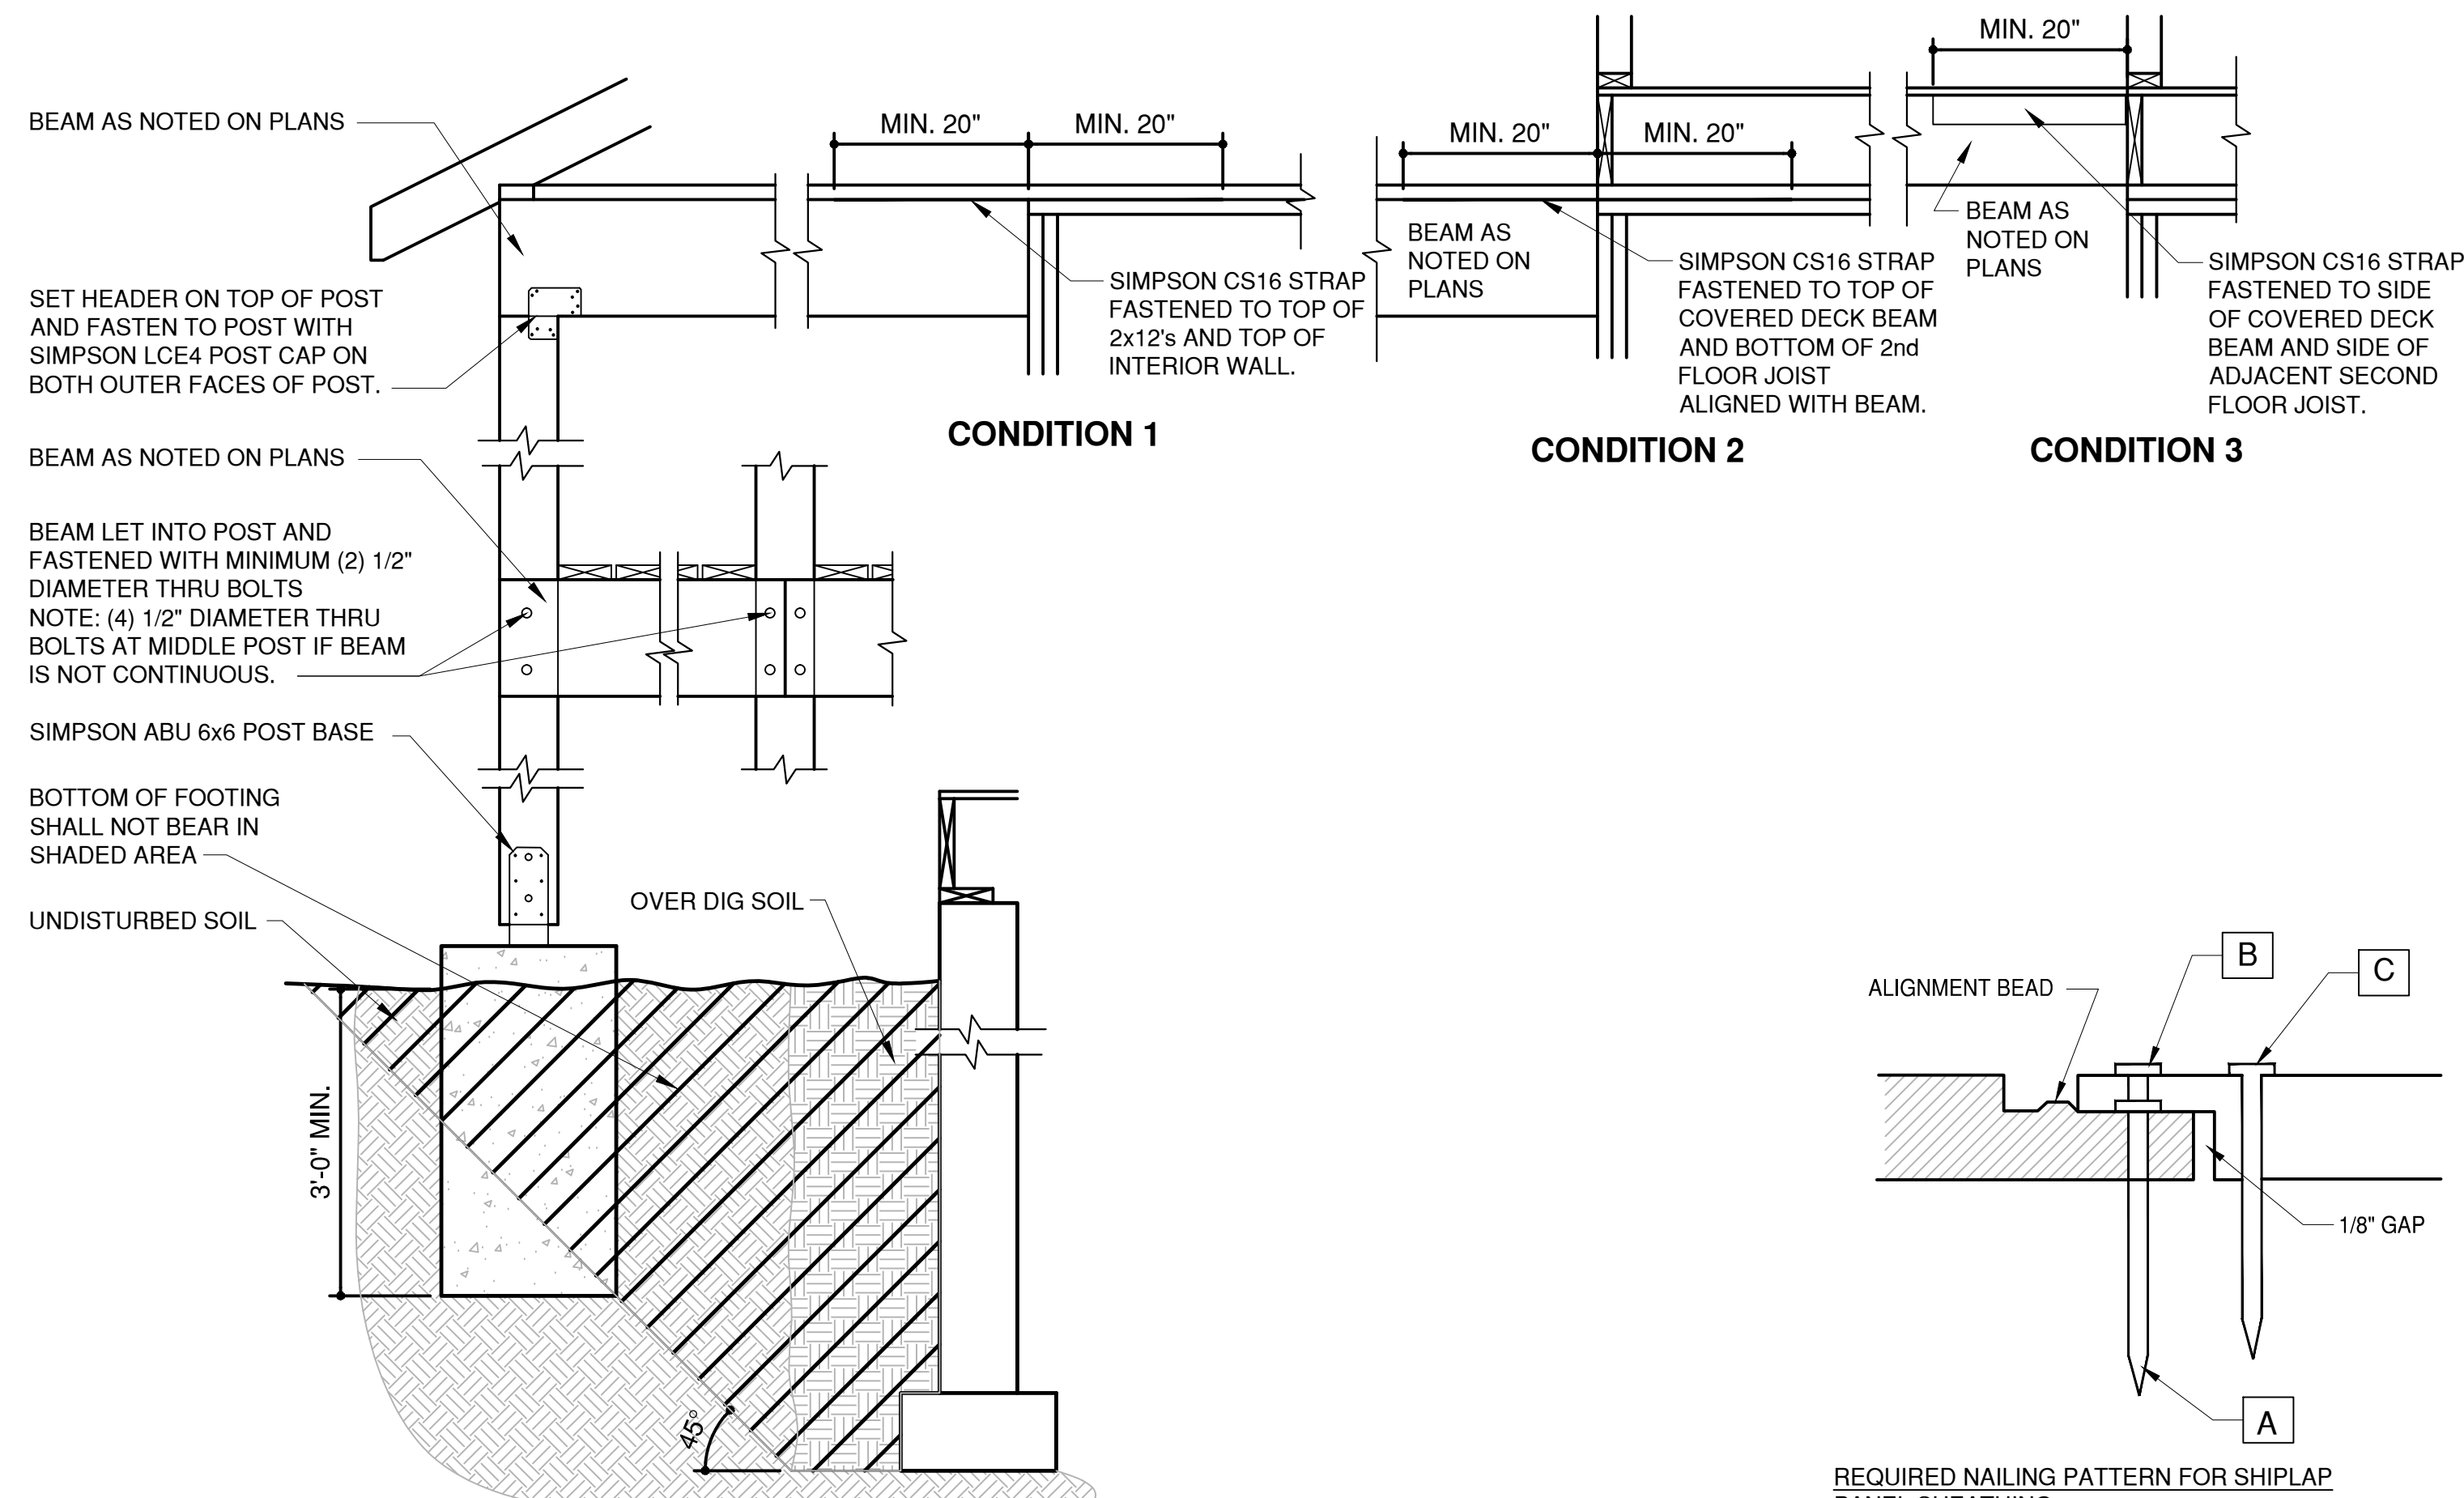

NAILING WITH SPACING AS SPECIFIED PER PLAN. FOR EXAMPLE, IF REQUIRED SPACING IS 4\"/>

1 COVERED PORCH DETAIL
3/4\"/>

2 SHEATHING NAILING DETAIL
1/2\"/>

3 ROOF FRAMING DETAIL
1/2\"/>

1060 S. GREEN ROAD
OLATHE, KS 66061
PHONE: 913-390-4663
www.WebsterArchitects.com

EAGLE CREEK LOT 726
2334 SW OLD PORT ROAD
LEE'S SUMMIT, MO. 64082



BRANDON LOGAN
P.O. BOX 6423
LEE'S SUMMIT, MO 64064

STATE OF MISSOURI
DANIEL J. WEBSTER
REGISTERED ARCHITECT
A-6400
10/26/2020

DRAWN BY: MP
DATE: 10-10-20
PROJECT NO: 15-016-03


SHEET NO.
G3

BRACED WALL SCHEDULE				8-18-20
METHOD NUMBER	DESCRIPTION	MINIMUM LENGTH	FASTENERS	
LIB	LET-IN-BRACING: METAL STRAPS TO FORM "X" OR "V" INSTALLED PER MANUFACTURED (SIMPSON: WB126C, TWB12, WB143C) (USP: RWB114, WBT12)	AS REQUIRED TO ALLOW BRACE TO BE CONTINUOUS FROM PLATE TO PLATE AND AT AN ANGLE BETWEEN 45° TO 60° FROM HORIZONTAL	PER MANUFACTURER'S REQUIREMENTS	
WSP	WOOD STRUCTURAL PANEL- 3/8" THICK (MIN.) FOR STUDS AT 16" O.C. (APA EXP. I- PLYWOOD/ O.S.B./ ETC.)	MIN. 48"	6d COMMON NAILS, 6" O.C. AT EDGES AND 12" O.C. AT INTERMEDIATES	
CS-WSP	CONTINUOUS SHEATHING- WOOD STRUCTURAL PANEL: 5/16" THICK (MIN.) (APA EXP. I- PLYWOOD/ O.S.B.)	CONTINUOUS ON ALL EXTERIOR WALLS	6d COMMON NAILS, 8d COMMON NAILS - 6" O.C. AT EDGES AND 12" O.C. AT INTERMEDIATES	
GB	GYPSUM BOARD: 1/2" THICK MIN.	96" IF GYP. BOARD 1 SIDE 48" IF GYP. BOARD 2 SIDES (STUDS AT 16" O.C. MAX. FOR 48" LONG PANELS)	6d NAILS OR 1-1/4" SCREWS (TYPE W OR S)- 7" O.C. AT EDGES AND 7" O.C. AT INTERMEDIATES (CAN SUBSTITUTE COOLER NAILS)	
PFH/PFG	PORTAL FRAME GARAGE: WITH HOLD-DOWNS	SEE DETAIL 1/G3 FOR MIN. WALL LENGTH	PER DETAIL 1/G3	
CS-PF	CONTINUOUS SHEATHING- PORTAL FRAME	SEE DETAIL 1/G3 FOR MIN. WALL LENGTH	PER DETAIL 1/G3	
NOTES: A. SEE XXX ON BRACED WALL PLAN FOR BRACED WALL METHOD.				

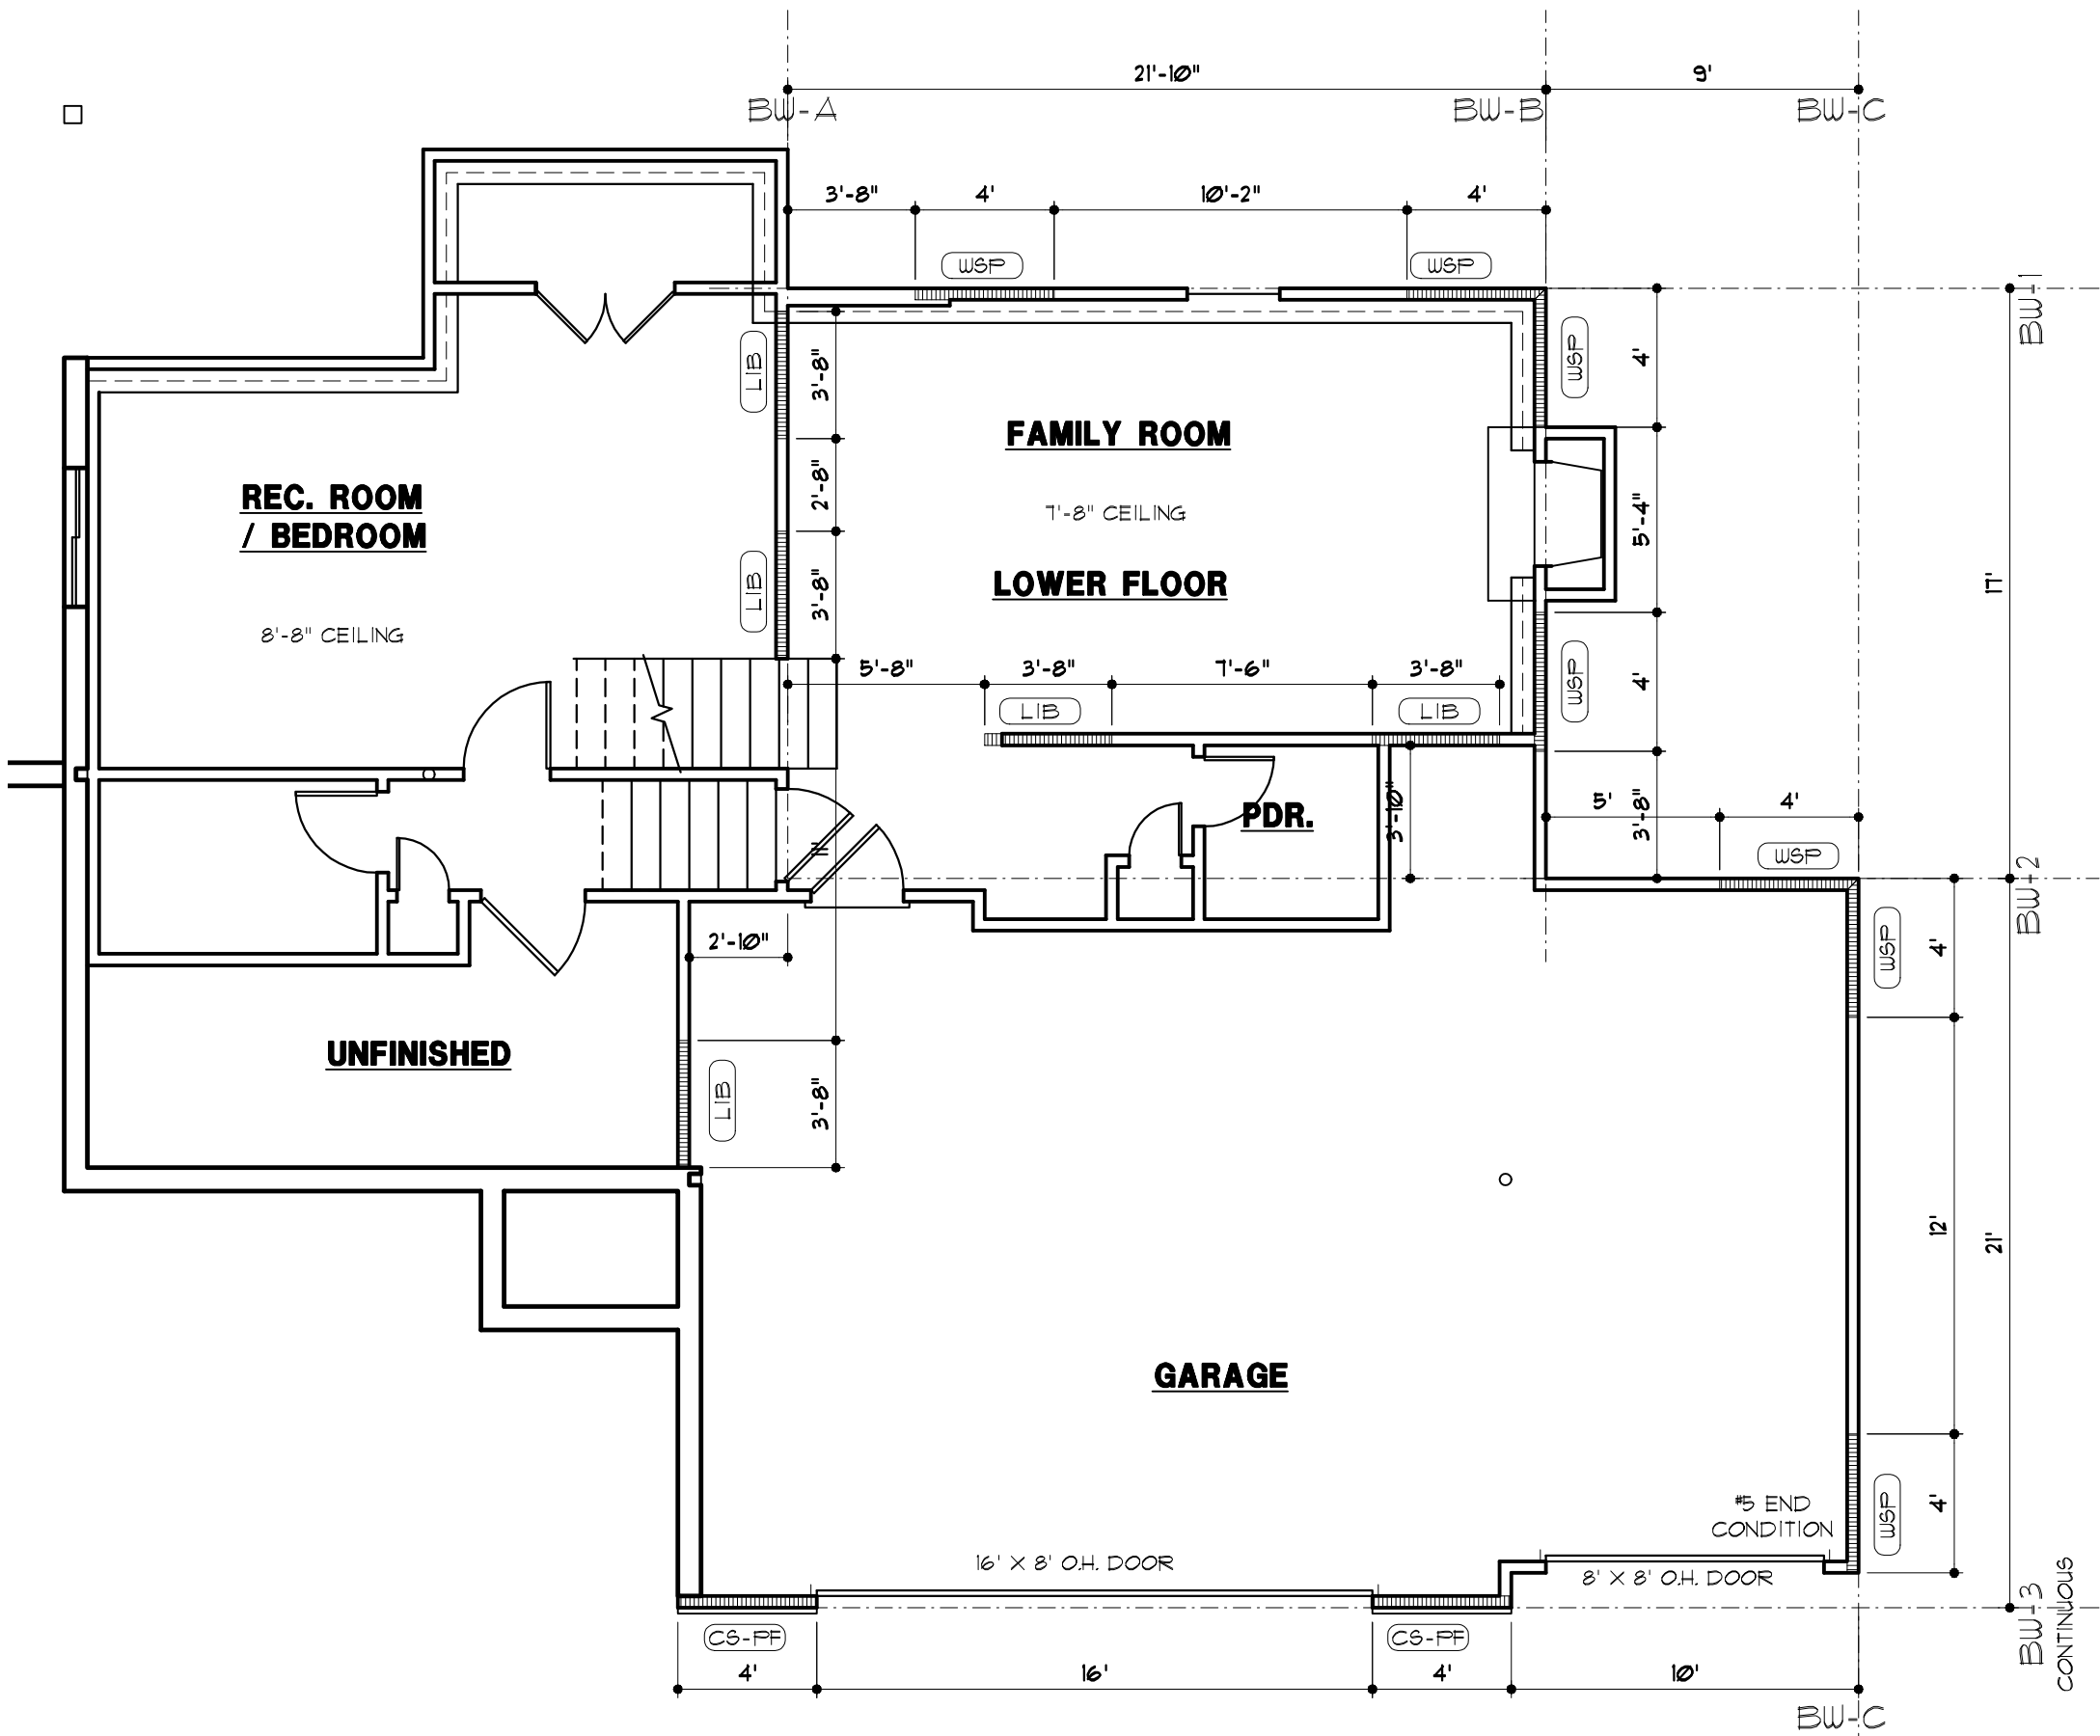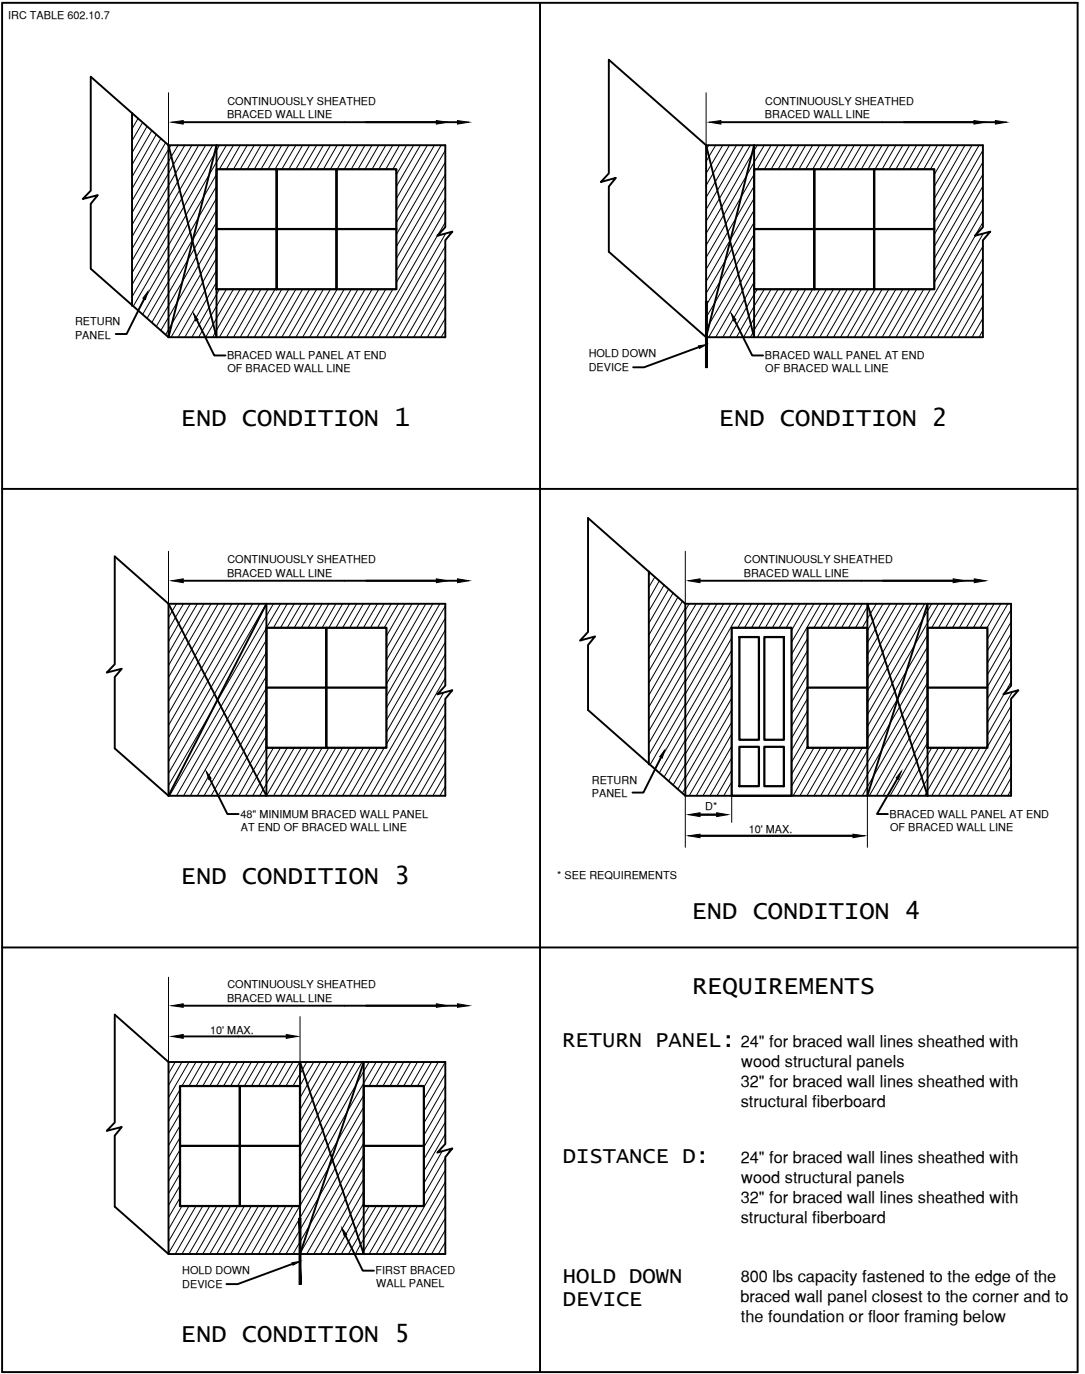


LOWER FLOOR DIAGRAM

3/16" = 1'-0"

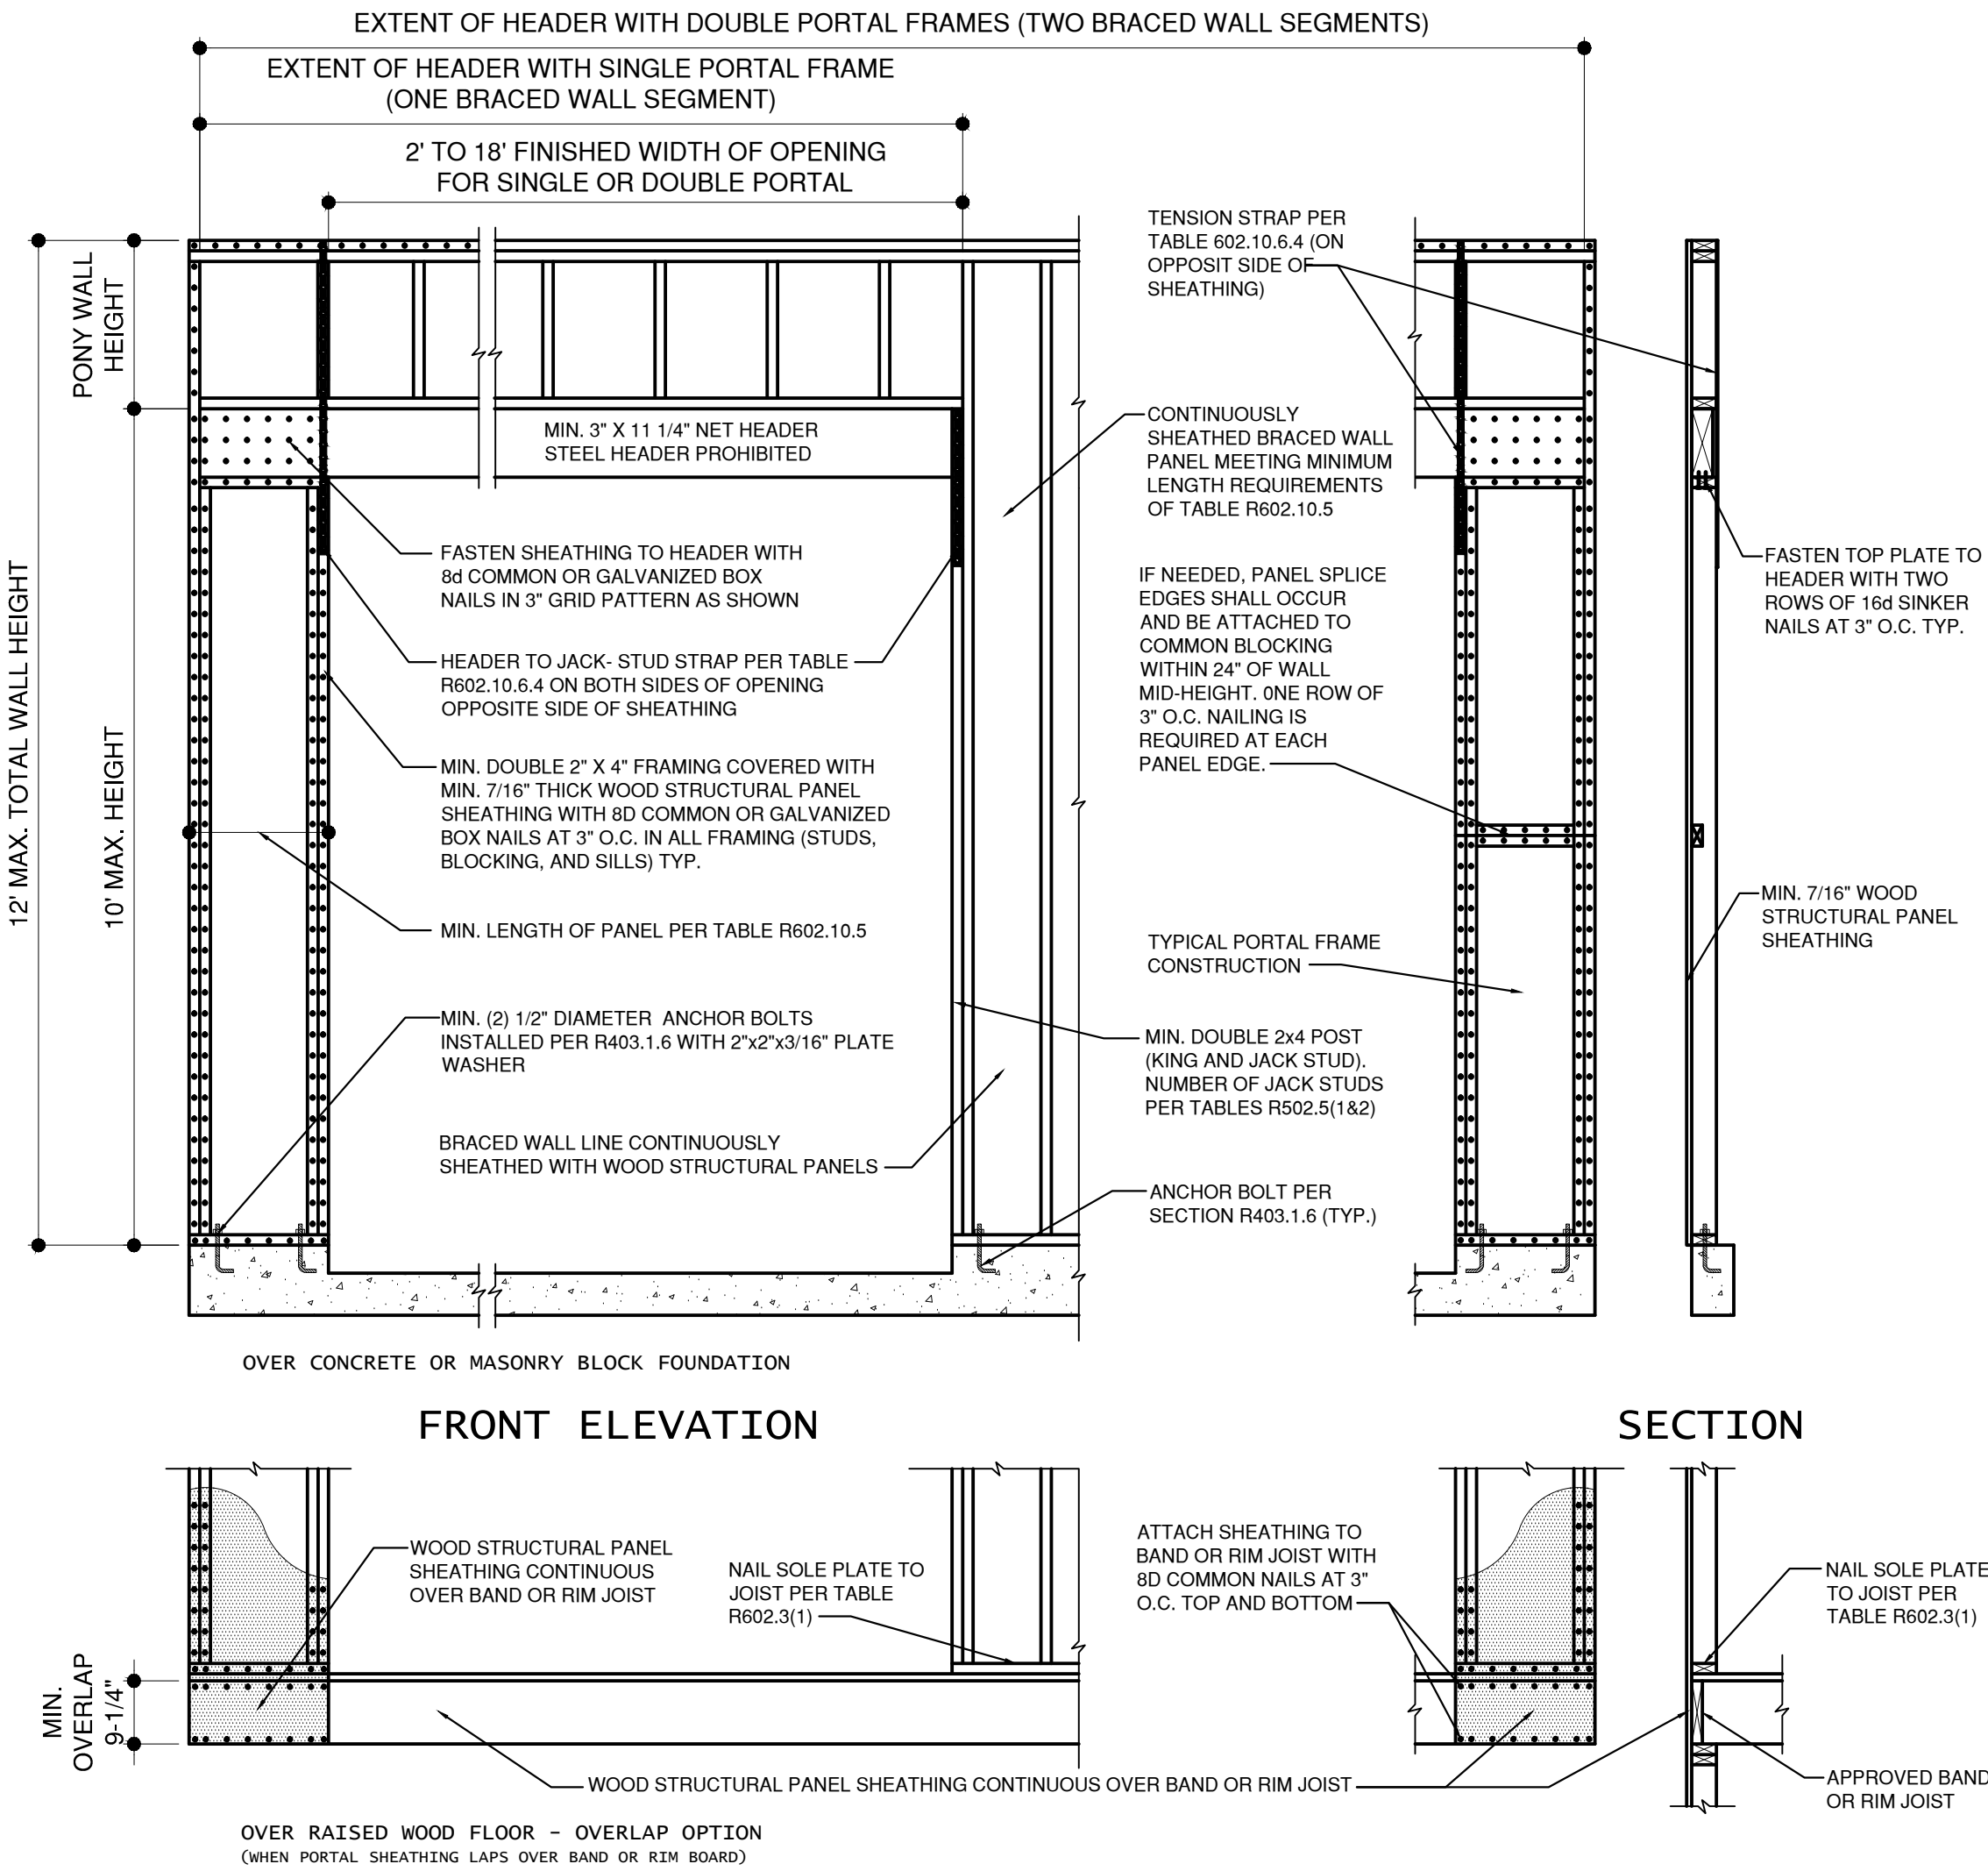

1 METHOD CS-PF BRACED WALL

1/2" = 1'-0" A-DTE-06100-25 PF

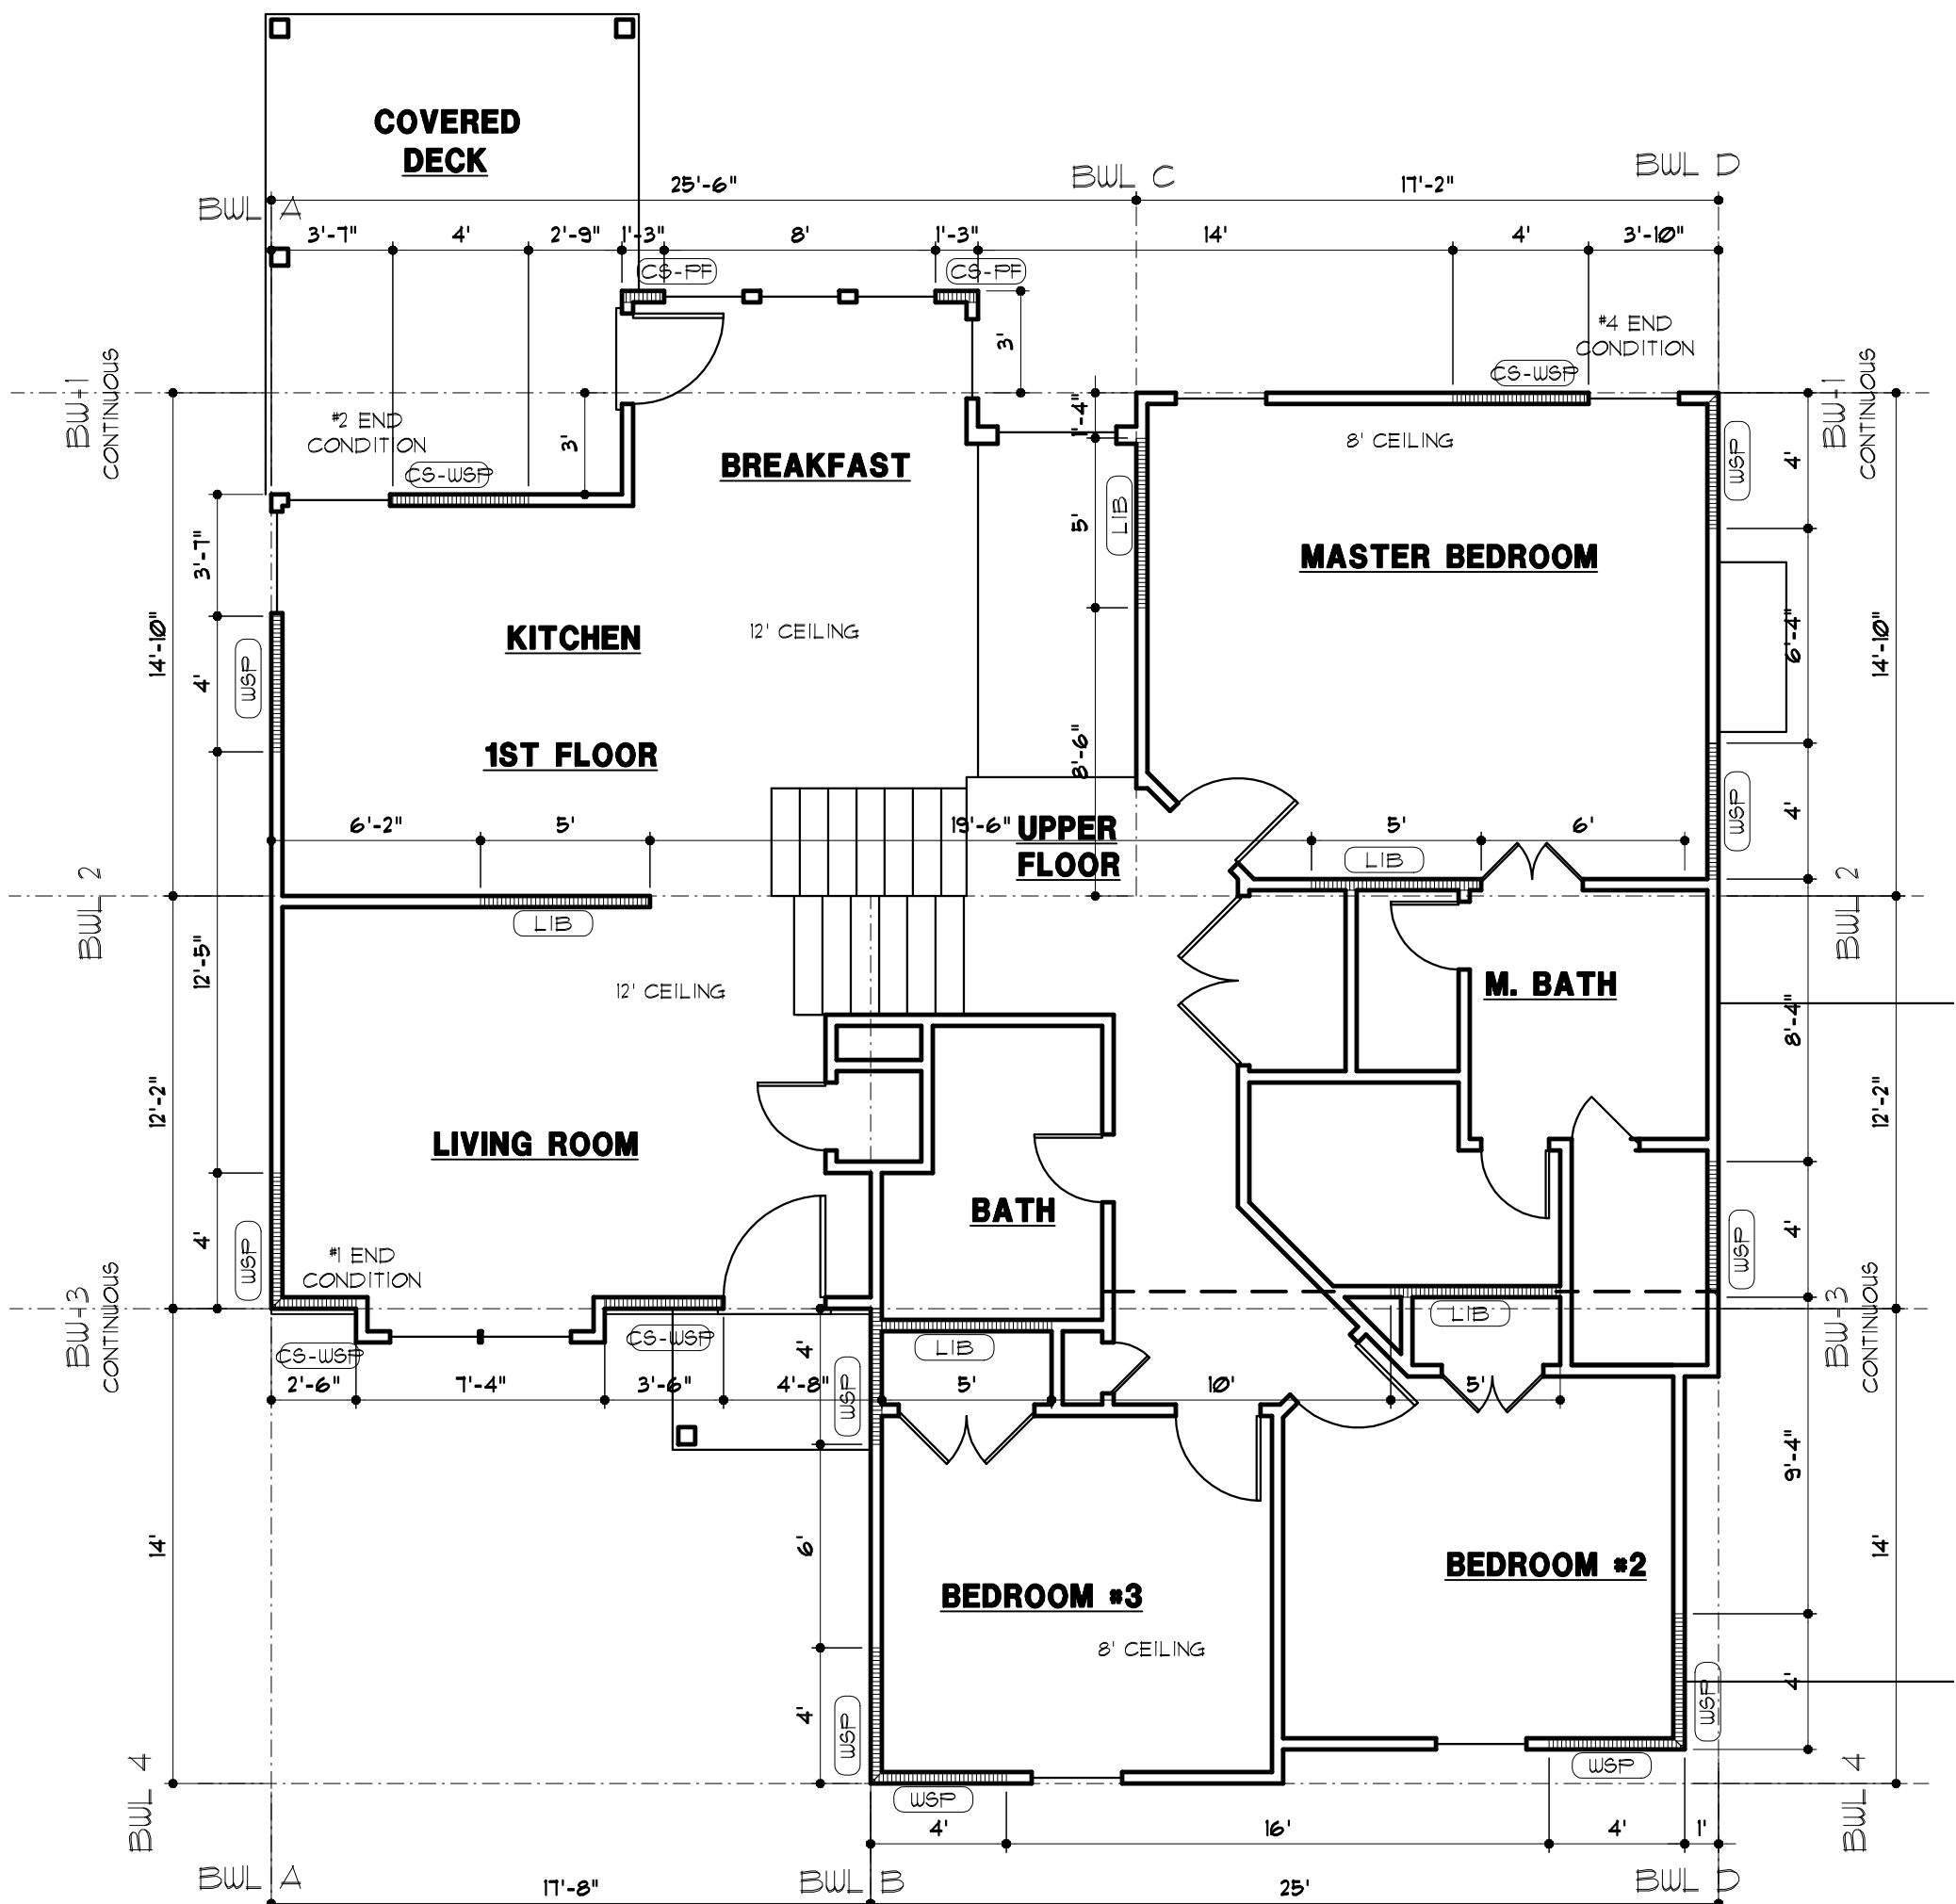


FIRST FLOOR DIAGRAM

3/16" = 1'-0"

EAGLE CREEK LOT 726
2334 SW OLD PORT ROAD
LEE'S SUMMIT, MO. 64082

BRANDON LOGAN
P.O. BOX 6423
LEE'S SUMMIT, MO 64064

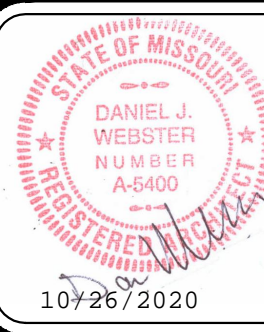

DRAWN BY: MP
DATE: 10-10-20
PROJECT NO: 15-016-03

SHEET NO.
G4

architects
Webster
1080 S. GREEN ROAD
CLATHE, KS 66061
PHONE: 913-390-4663
www.WebsterArchitects.com