RESIDENTIAL ENGINEERING SERVICES, LLC SHOP DRAWING / SUBMITTAL REVIEW


## **APPROVED**

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION PROCESSES AND TECHNIQUES OF CONSTRUCTION, COORDINATION OF HIS OR HER WORK WITH OTHER/TRADES AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

RESIDENTIAL ENGINEERING SERVICES, LLC

**RELEASE FOR** CONSTRUCTION **AS NOTED ON PLANS REVIEW** DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

10/26/2020

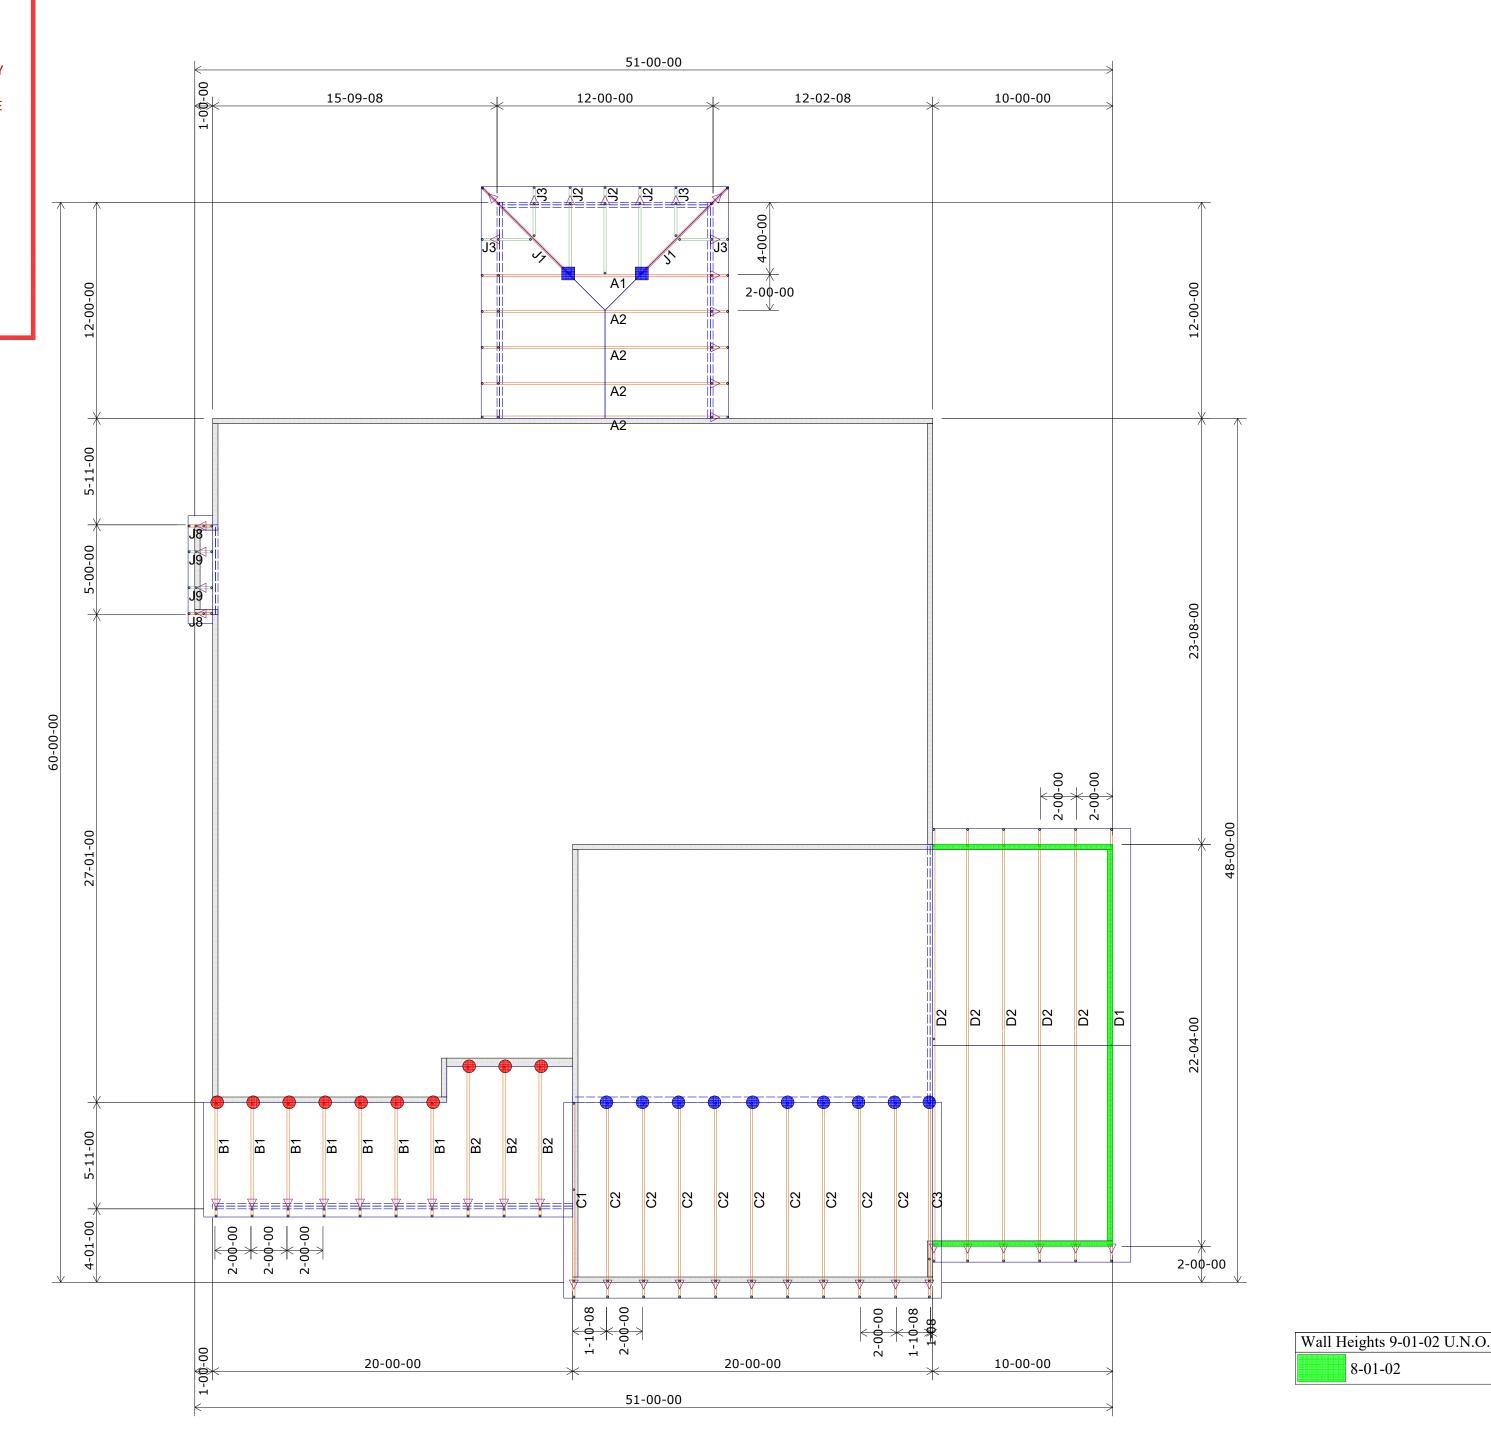

**HANGER** Quantity SCHEDULE LUS24 10 LUS26 14 HUS26 9 Lot 33 Hawthorn Ridge ▲ HHUS26-2 0 ▲ HGUS26-2 ▲ HGUS28-3 0 LTHJA26 0 2 TJC37 TJC57 0 △ HTS20 0 Triangle denotes the left end of the Truss as it appears on the Engineered Drawings Job Name provided.

Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

# of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

8-01-02


HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wh<sub>е</sub> 1959 ( Wave



1st Floor Truss Layout

Scale: 3/16" = 1'

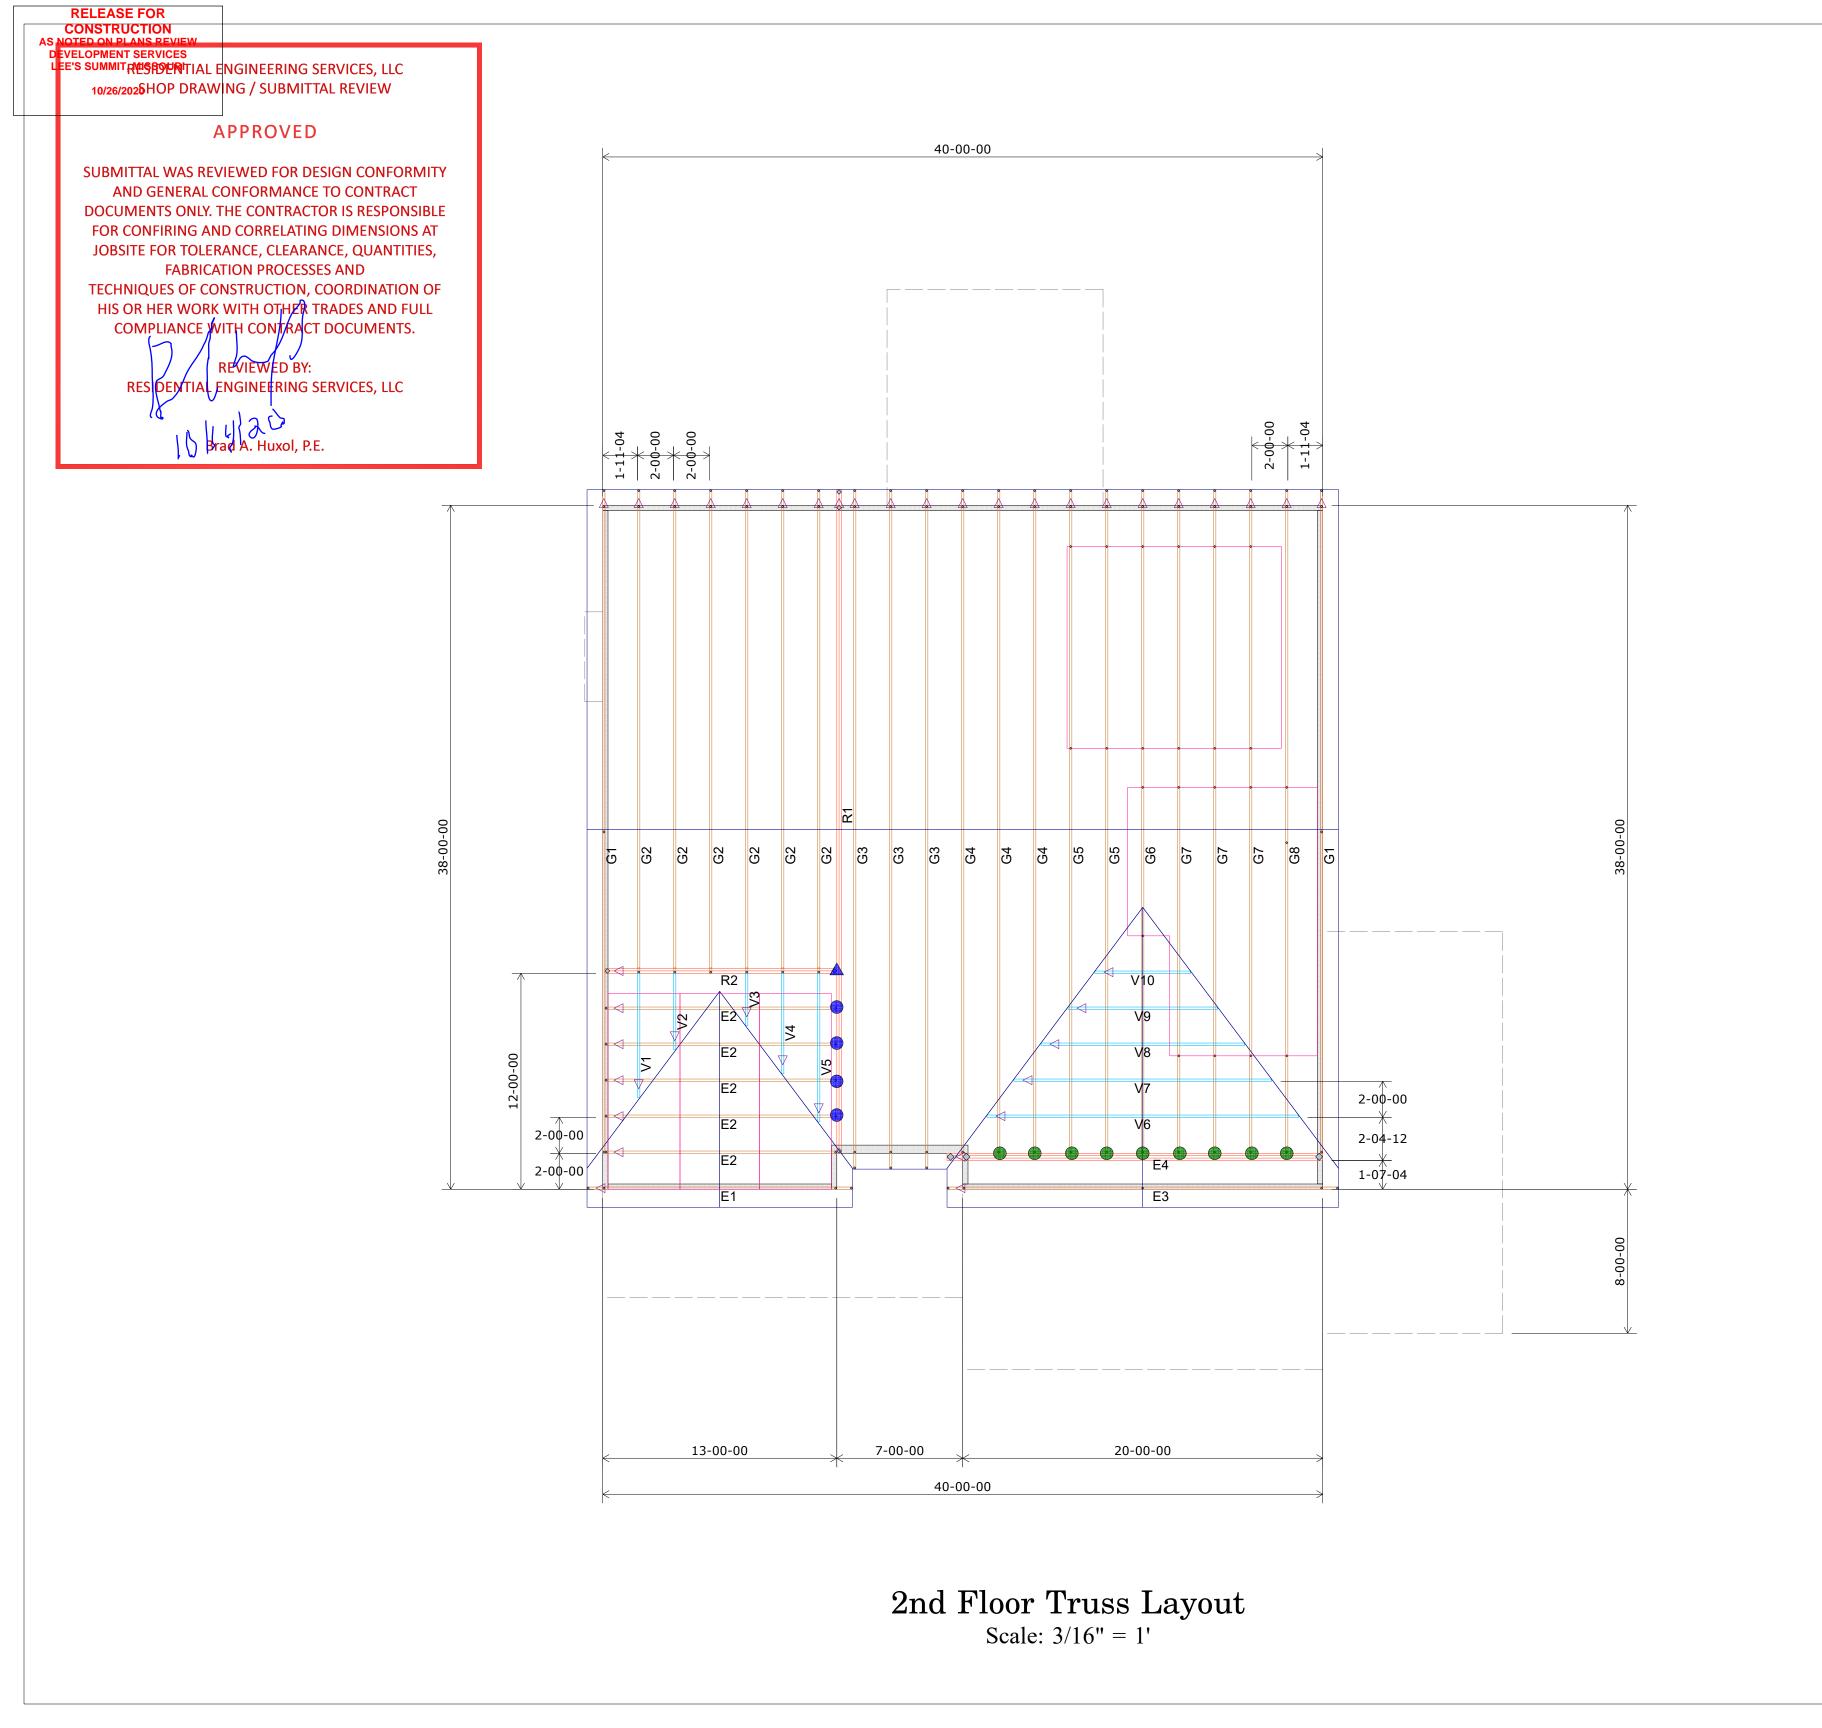

									,
	HANGER SCHEDULE	Quantity		Lot 33 Hawthorn Ridge	1504 SW Sugar Tree Dr.	MO			
	LUS24	10							
	LUS26	14							
	HUS26	9					Chance 785-746-4240		
_	HHUS26-2	0							
_	HGUS26-2	1							
	HGUS28-3	0	ME	lorn	gar		746-	٥,	
	LTHJA26	0	H	ıwt	Sug	ımi	85-7	2690	
	TJC37	2	MIT	3 Hz	SW	Sun	e 7	400	
	TJC57	0	SUMMIT HOMES	ot 33	505	Lee's Summit	nanc	Job # 400692	
	HTS20	0	S	ĭ	15	Le	C	Jo	
Triangle denotes the left end of the Truss as it appears on the Engineered Drawings					Job Site Address	State			
provided.			la la	ne	Ac			02	
			ome	Nan	Site		gne	/202	
			Customer	Job Name	Job §	City,	Designer	10/6/2020	



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

# of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult "Bracing of wood trusses" available from the Truss Plate Institute, 583 D'Onifrio Drive; Madison, WI 53179.

Shop Drawing Approval

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871

