


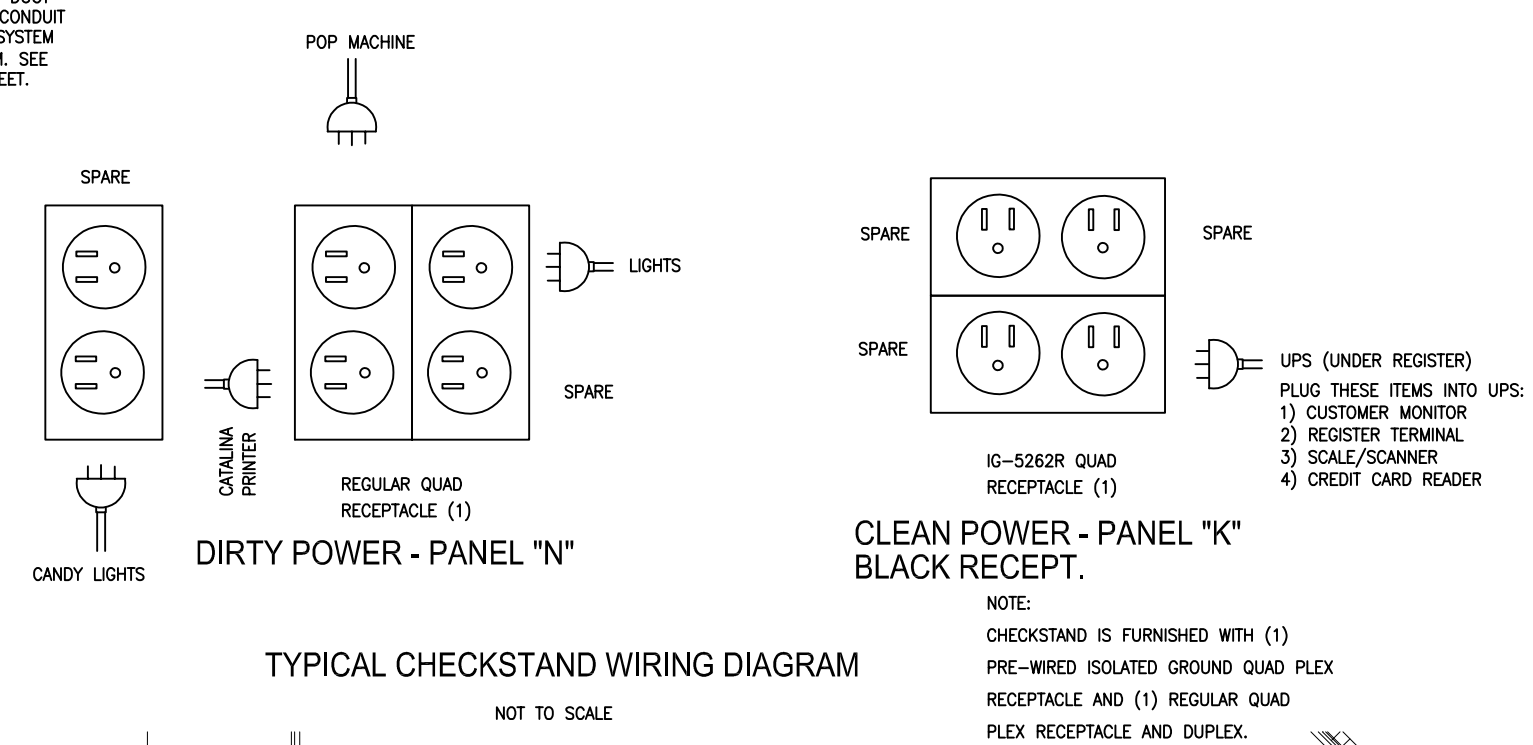



- ## NOTES:
1. ALL STUD-UPS SHALL BE OF METAL CONDUIT. PVC IS NOT ACHIEVABLE UNDERGROUND.
 2. SEE SHEET E.1.1 FOR ALL ELECTRICAL PANEL DIRECTIONS.
 3. SEE SHEET E.3 FOR ALL ELECTRICAL SYMBOLS AND NOTES.
 4. ELECTRICIAN TO PROVIDE (2) WIRE EACH FOR EACH CLEAN CIRCUIT: (1) POWER, (1) NEUTRAL, AND (1) GROUNDING.
 5. ELECTRICIAN TO PROVIDE #12 WIRE FOR ALL RUNS 200 FEET OR LESS FROM PANEL "A" TO REGISTER LOCATION. DISTANCES GREATER THAN 200' REQUIRE #10 WIRE.
 6. ALL WIRING TO BE PER N.E.C.
 7. ELECTRICIAN IS RESPONSIBLE FOR SIZING ALL CONDUIT FOR THE POWER.
 8. THE ELECTRICAL CONTRACTOR SHALL SUBMIT TO HY-VEE A PARTIAL AS-BUILT DRAWING, ALONG WITH HIS PAYMENT REQUEST, FOR ALL UNDERGROUND ELECTRICAL WORK. THE CONTRACTOR SHALL PROVIDE LOCATION INFORMATION, CONDUIT SIZE AND LOCATIONS ALONG WITH APPROXIMATE DEPTHS OF ALL UNDERGROUND WORK. THE CONTRACTOR SHALL SUBMIT A FINAL AND COMPLETE AS-BUILT DRAWING WITH ALL DEPTHS REQUIRED WHEN ALL UNDERGROUND WORK HAS BEEN COMPLETED AND APPROVED BY HY-VEE.
 9. CONTRACTOR TO VERIFY ALL DIMENSIONS FOR ROUGH-IN WORK WITH OWNER BEFORE CONSTRUCTION.

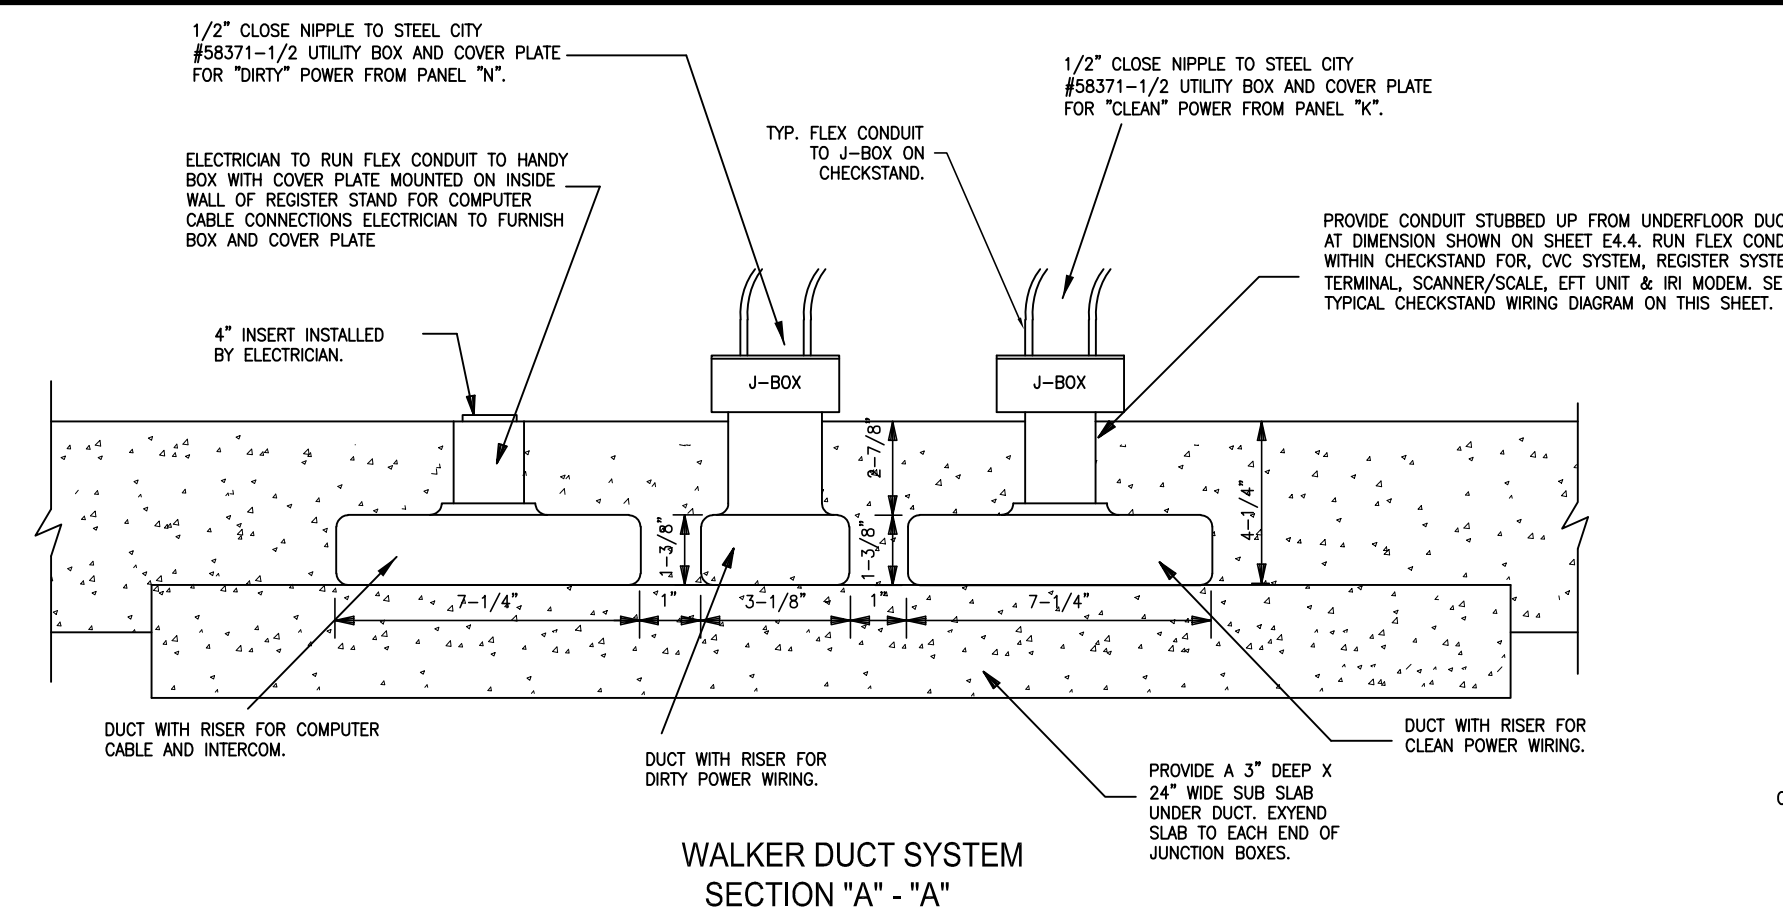

LOCATION: **LEES SUMMIT #2, MO**

Hy-Vee®
EMPLOYEE OWNED

HY-VEE INC.
5420 WESTOWN PARKWAY
LEES SUMMIT, MO 64066
TELEPHONE: (915) 267-2600
FAX: (915) 267-2935

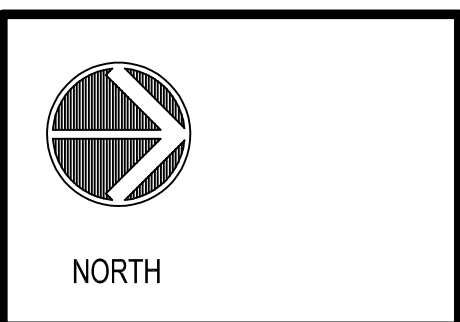

REGISTER
SYSTEMS
PLAN

DRAWN:	DATE:
MAB	JUNE 2019
SCALE:	JOB NUMBER:
3/32" = 1'0"	
SHEET:	

E4.4