



LEE'S SUMMIT
GRID: 1103

94°24'28"W 38°51'24"N NAD83

Maximo WO #: 21284808

THE ROUTE OF THE GAS SERVICE
MUST BE BROUGHT TO GRADE AND
CLEARED OF BUILDING MATERIAL
BY THE CUSTOMER PRIOR TO
INSTALLATION.



GRANULAR BACKFILL, IF REQUIRED,
IS TO BE PROVIDED BY THE
CUSTOMER. IN WHICH CASE, SPIRE
WILL NOT BE RESPONSIBLE FOR
THE DISPOSAL OF EXCESS SPOIL
FROM THE DITCH.

SPIRE TO ONLY PATCH THAT
PAVEMENT REMOVED FOR THE
INSTALLATION OF THE GAS
SERVICE.

PIPE SYSTEM
PRESSURE SYS - C-017 - IP
MINOP -
MOP - 55 PSIG
MAOP - 55 PSIG
DESIGNED MAOP - 58 PSIG
TEST PRESSURE - 100 PSIG

CUSTOMER APPROVAL SIGNATURE:

GAS METER MUST COMPLY WITH
REQUIREMENTS SHOWN BELOW

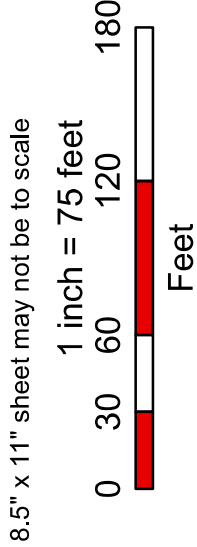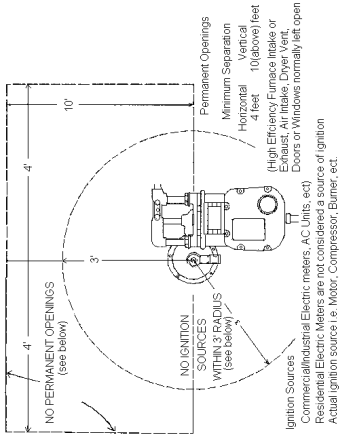

DESIGNER:

KND

REVISION DATE(S):

DATE:

8/6/2020



Missouri West

MANOR HOMES OF ARBORWALK
OUTDOOR KITCHEN

1318 SW MANOR LAKE DR

TOTAL LOAD: 250 CFH



1 Tie in to Existing 4" PLIP Main
4" x 1" PL Service Tee
Install a 775 Series EFV
Lycall/Lyco Stock #202716

2 250 Diaphragm Meter

A Install 415' of 1" PLIP service

Source: Esri, Maxar, GeoEye, Earthstar Geographics, CNES/Airbus DS,