



The Jevon and Julie McBride Residence  
 211 NW Carson Drive  
 Lee's Summit, Missouri 64081



**FRONT ELEVATION**  
 SCALE 1/4"=1'-0"

SQUARE FOOTAGE CALCS	
MAIN FLOOR (LIVING):	3174 SF
LOWER LEVEL (LIVING):	2333 SF
GROSS LIVING:	5507 SF
GARAGE:	1120 SF
FRONT PORCH:	245 SF
REAR COVERED LANAI:	419 SF
REAR COVERED BALCONY:	59 SF



**REAR ELEVATION**  
 SCALE 1/4"=1'-0"

RELEASE FOR CONSTRUCTION  
 AS NOTED ON PLANS REVIEW  
 DEVELOPMENT SERVICES  
 LEE'S SUMMIT, MISSOURI  
 12/15/2020



STRUCTURAL REVIEW  
 HD# 40620

HD ENGINEERING & DESIGN, INC.  
 1668 W. 20TH STREET  
 SHAWNEE, KS 66204  
 WWW.HDENGINEERS.COM  
 913.631.2822  
 SERVICE@HDENGINEERS.COM



**CDG**  
 Castrop Design Group  
 Christopher C. Castrop  
 Architectural Design and Consulting  
 4318 West 54th Street  
 Roland Park, Kansas 66205  
 913.515.7664  
 castropdesigngroup@live.com

No.	Description	Date
1	City Permit Review	12/4/20


CONSTRUCTION DOCUMENTS

Project Number: GALE 04  
 Date: 2020 Sept 22  
 Drawn By: MGS  
 Checked By: CDG

**A 101**  
 Scale: 1/4" = 1'-0"



**RIGHT ELEVATION**  
SCALE 1/4"=1'-0"

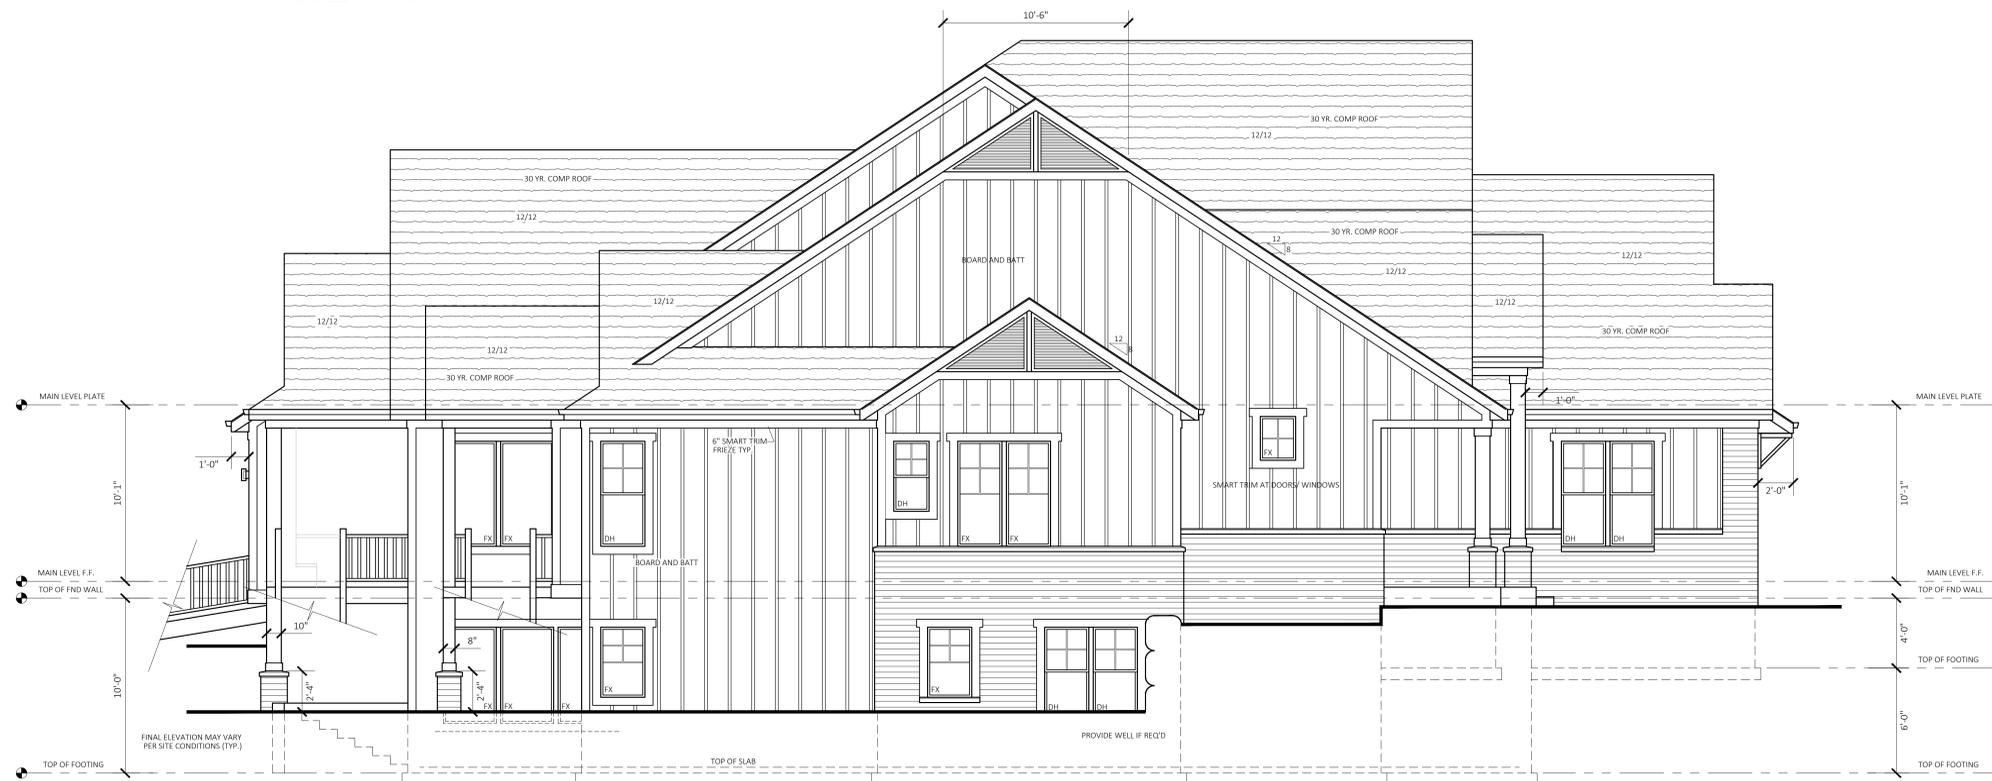

**LEFT ELEVATION**  
SCALE 1/4"=1'-0"

SEALED FOR STRUCTURAL REVIEW



The Jevon and Julie McBride Residence  
211 NW Carson Drive  
Lee's Summit, Missouri 64081




**CDG**  
Castrop Design Group  
Christopher C. Castrop  
Architectural Design and Consulting  
4318 West 54th Street  
Roland Park, Kansas 66205  
913.515.7664  
castropdesigngroup@live.com



STRUCTURAL REVIEW  
HDR: 40620

THIS DOCUMENT CONTAINS  
CONFIDENTIAL INFORMATION  
AND IS NOT TO BE REPRODUCED,  
DISCLOSED, COPIED, OR  
DISTRIBUTED IN ANY MANNER  
WITHOUT THE WRITTEN  
CONSENT OF HD ENGINEERING &  
DESIGN, INC. VIOLATION OF  
THIS AGREEMENT MAY RESULT IN  
LITIGATION AND PENALTIES.

**HD ENGINEERING & DESIGN, INC.**  
1638 W. 107TH STREET  
DOWNEY, MO 64014  
WWW.HDENGINEERS.COM  
913.631.2222  
SERVICES@HDENGINEERS.COM




No.	Description	Date
1	City Permit Review	12/4/20

CONSTRUCTION DOCUMENTS

Project Number: **GALE 04**  
Date: **2020 Sept 22**  
Drawn By: **MGS**  
Checked By: **CDG**

**A 102**  
Scale: **AS NOTED ON PLANS REVIEW**  
12/15/2020

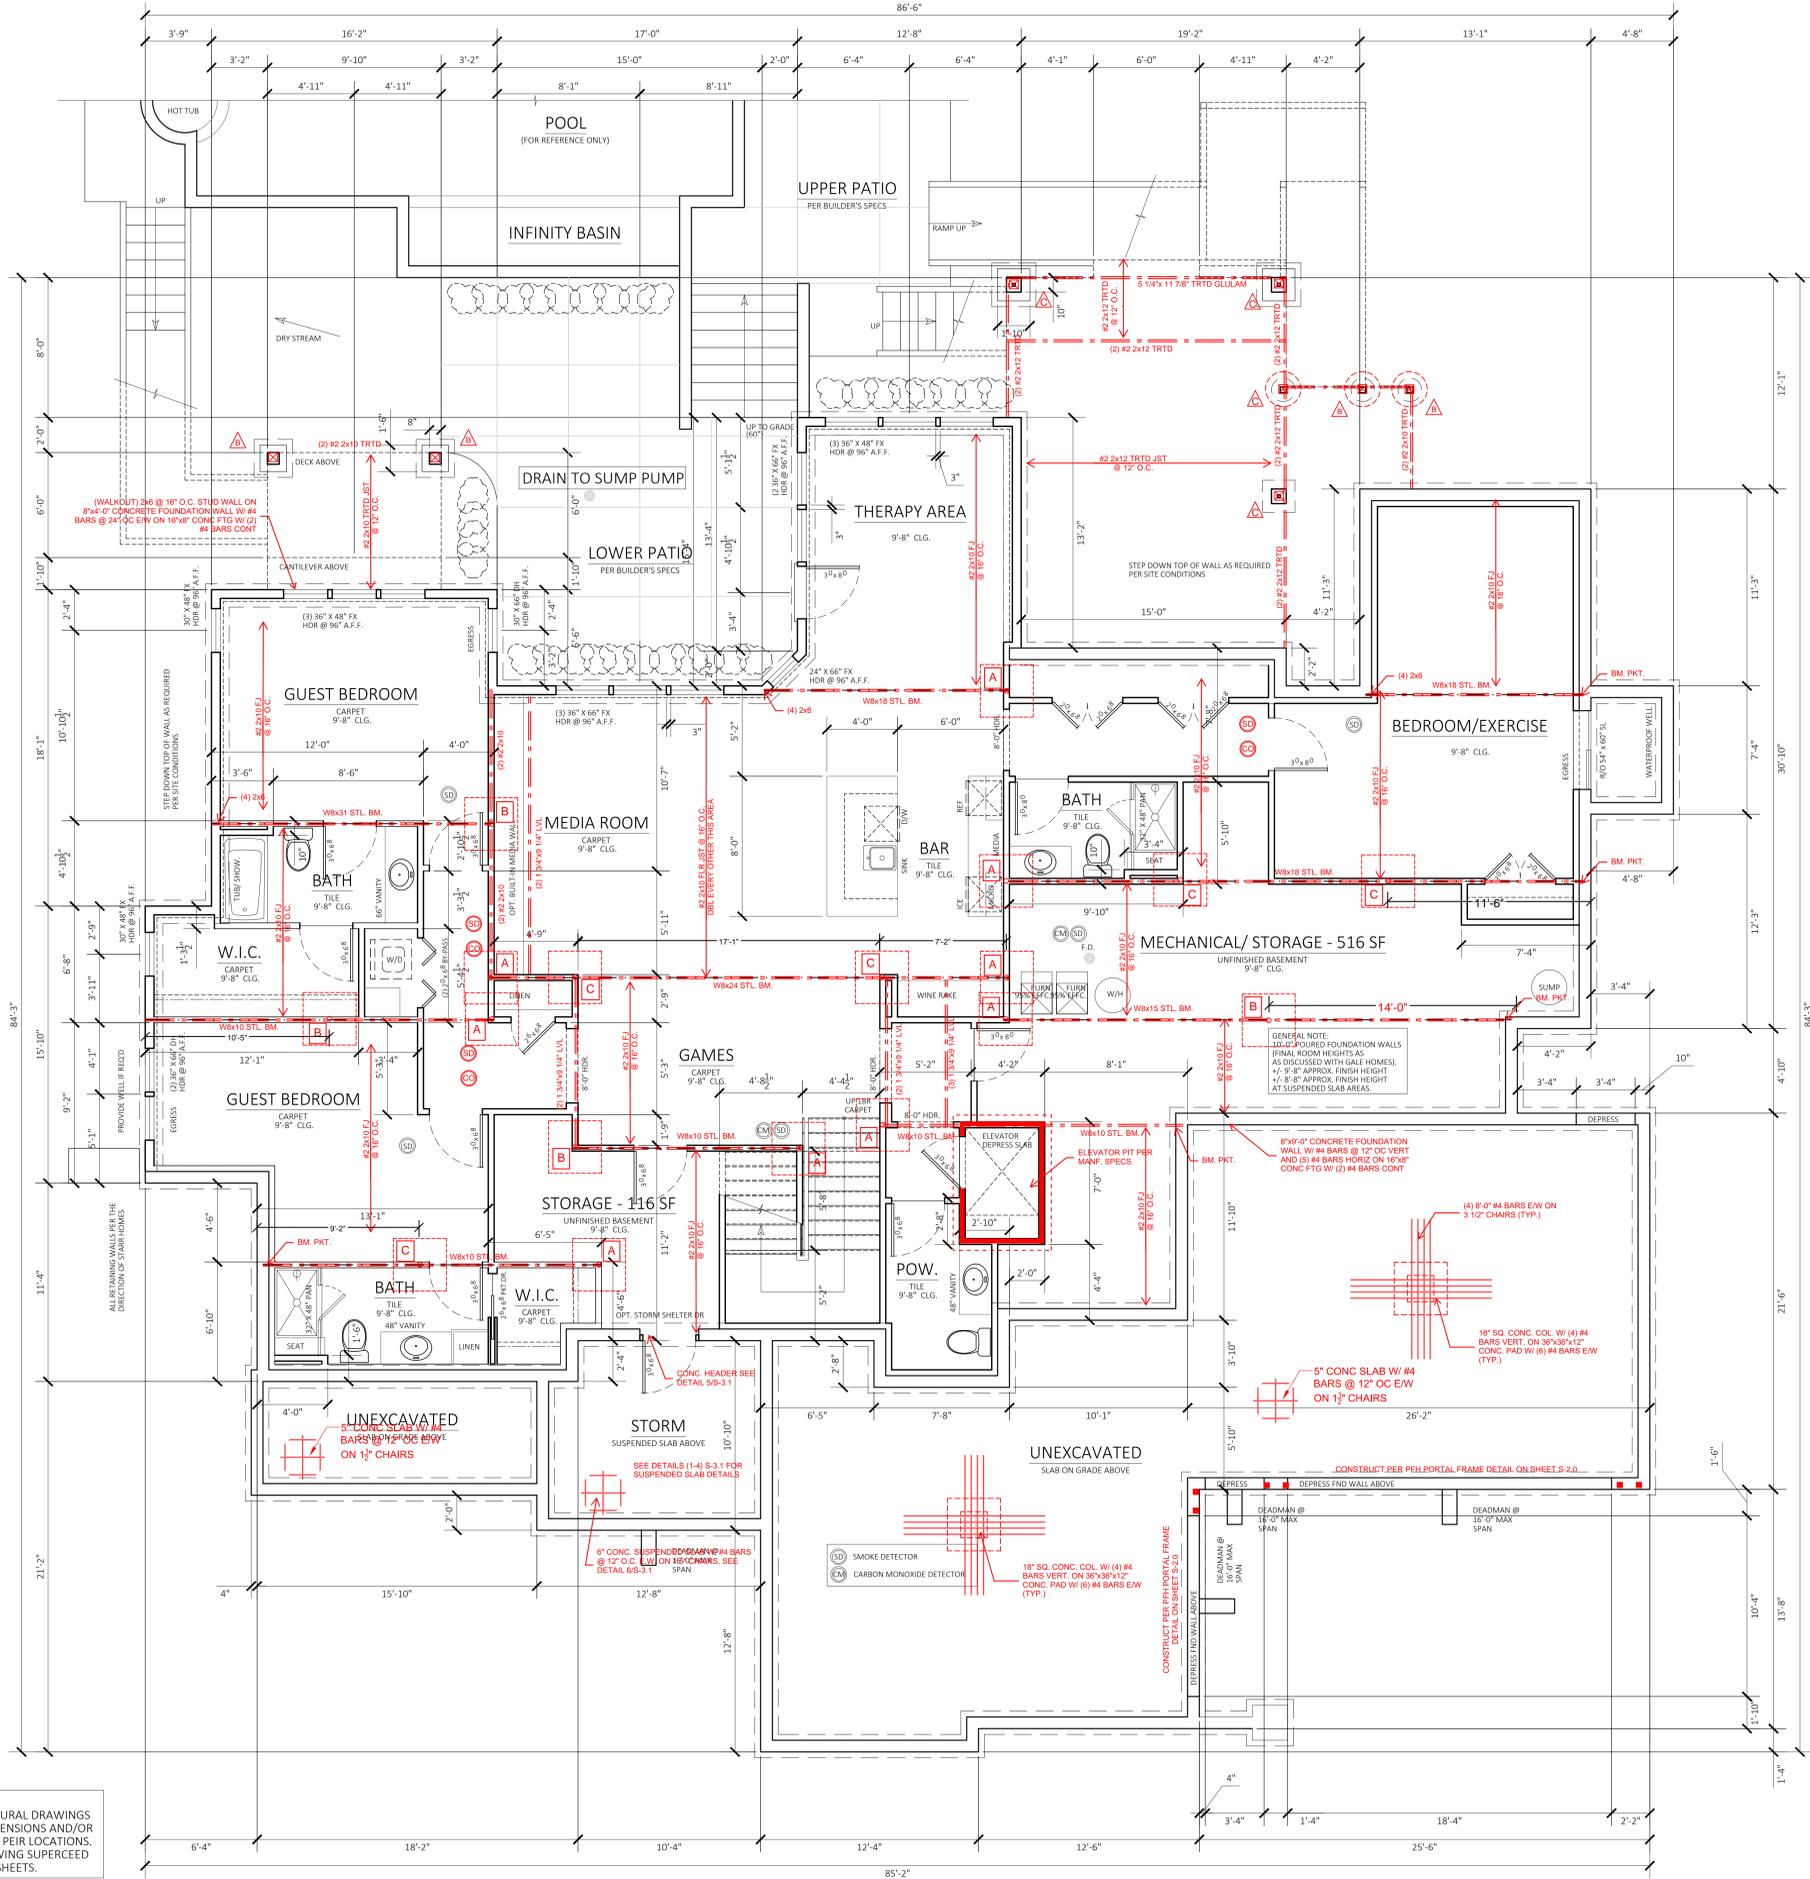

- DECK PIER SCHEDULE**
- MIN. 6X6 TRTD/CDR POST ON 12" CONC PIER WITH USP PAU 66 BASE OR = (1177# MAX)
  - MIN. 6X6 TRTD/CDR POST ON 16" CONC PIER WITH USP PAU 66 BASE OR = (2050# MAX)
  - MIN. 6X6 TRTD/CDR POST ON 18" CONC PIER WITH USP PAU 66 BASE OR = (2649# MAX)
  - MIN. 6X6 TRTD/CDR POST ON 24" CONC PIER WITH USP PAU 66 BASE OR = (4708# MAX)
  - MIN. 6X6 TRTD/CDR POST ON 30" CONC PIER WITH USP PAU 66 BASE OR = (7303# MAX)
  - MIN. 6X6 TRTD/CDR POST ON 36" CONC PIER WITH USP PAU 66 BASE OR = (1,0620# MAX)
- PIERS TO TERMINATE ON ORIGINAL SOIL OF 1500 PPF MINIMUM BEARING.  
PIERS TO TERMINATE AT A POINT 36" MINIMUM BELOW FINISH GRADE.  
POST ARE NOT TO EXCEED AN UNBRACED LENGTH OF 12' WITHOUT CONTACTING HD ENGINEERING FOR GUIDANCE.


- COLUMN PAD SCHEDULE**
- A 3' SCH. 40 STL. COL. ON 30"x30"x12" CONC. PAD W/ (6) #4 BARS E.W. (8.4K MAX.)
  - B 3' SCH. 40 STL. COL. ON 36"x36"x12" CONC. PAD W/ (6) #4 BARS E.W. (13.9K MAX.)
  - C 3' 1/2" SCH. 40 STL. COL. ON 42"x42"x14" CONC. PAD W/ (7) #4 BARS E.W. (18.4K MAX.)
  - D 3' 1/2" SCH. 40 STL. COL. ON 48"x48"x16" CONC. PAD W/ (8) #4 BARS E.W. (24K MAX.)
  - E 3' 1/2" SCH. 40 STL. COL. ON 54"x54"x16" CONC. PAD W/ (9) #4 BARS E.W. (30.4K MAX.)
  - F 3' 1/2" SCH. 40 STL. COL. ON 60"x60"x18" CONC. PAD W/ (10) #4 BARS E.W. (37.5K MAX.)

**NOTES**

- COLUMN AND PIER PAD SIZES SHOWN ARE FOR MAX. COLUMN HEIGHT OF 10'-0" TALL.
- COLUMN AND PIER PAD SIZES SHOWN ARE BASED ON AN ASSUMED 1500 PPF. THIS IS THE CAPACITY REQUIRED BY ALL UNDERLINED GENERAL NOTES ON S-1 FOR MORE DETAILS.
- ALL STEEL COLUMNS SHALL BE ISOLATED FROM SLABS WITH APPROVED ISOLATION DEVICE OR JOINT.

**GENERAL NOTES**



- WINDOW SHALL HAVE FALL PROTECTION PER IRC 312.2.4
- HOUSE WILL BE PROVIDED WITH A "UFEE" ROUGH PER IRC SECTION 3008.1.5
- OVERHEAD GARAGE DOORS MUST MEET DASHA REQUIREMENTS SEE DETAIL SHEET S-1.0
- ALL HEADERS NOT LABELED SHALL BE MIN (2) #2 X10 DFL
- 3/8" ILL. JOIST UNDER ISLAND
- SOILS IN THIS AREA COMMONLY HAVE A VERY HIGH SHRINK SWELL CAPACITY. OUR FIRM RECOMMENDS ALL SITES BE EVALUATED BY A GEOTECHNICAL FIRM PRIOR TO PLACEMENT OF FOUNDATIONS
- PROVIDE CARBON MONOXIDE AND SMOKE DETECTORS PER IRC REQUIREMENTS
- JANY PORTION OF THESE PRINTS ISSUED WITHOUT A MIN. OF S-1.0 - S-4.0 SHALL NOT BE CONSIDERED A COMPLETE SET OF CONSTRUCTION DOCUMENTS
- INSTALL W8x15 STEEL BEAM MIN. UNDER ALL I.F.P. WALLS/BEARINGS (THAT WILL RECEIVE ROCK) UNLESS NOTED AS A LARGER BEAM ANY STONE OVER 2" DEEP. NOTIFY ENG. TO VERIFY LOADS
- FOUNDATION SHALL BE CONSTRUCTED PER JOHNSON COUNTY RESIDENTIAL FOUNDATION GUIDELINE. SEE ATTACHED -ICE AND WATER SHIELD AS REQUIRED PER IRC



**BRACED WALLS:**  
SEE CALCULATIONS ON SHEET S-2.0, PER ASCE7-10 REQUIREMENTS AS ALLOWED BY IRC 2018 R301.1

ALL EXTERIOR WALLS SHALL BE SHEATHED PER ANY ONE OF THE FOLLOWING OPTIONS:  
7/16" APA-RATED PLYWOOD/SHEATHING WITH 8d NAILS @ 6" O.C. AT EDGES AND @ 12" O.C. IN THE FIELD  
7/16" SHIPLAP PANEL SHEATHING (I.E. LP SMARTSIDE OR EQUIVALENT) WITH 8d NAILS @ 6" O.C. AT EDGES AND @ 12" O.C. IN THE FIELD  
3/8" SHIPLAP SHEATHING (I.E. LP SMARTSIDE OR EQUIVALENT) WITH 8d NAILS @ 4" O.C. AT EDGES AND @ 12" O.C. IN THE FIELD

INTERIOR BRACED WALL LOCATIONS ONLY SHOWN WHEN REQUIRED BY ADDITIONAL BRACING SECTION OF CALCULATIONS ON SHEET S-2.0




**GENERAL NOTE:**  
REFER TO STRUCTURAL DRAWINGS TO CONFIRM DIMENSIONS AND/OR WALL THICKNESS, PIER LOCATIONS. STRUCTURAL DRAWING SUPERCEED ARCHITECTURAL SHEETS.

**WALKOUT FOUNDATION PLAN - 2,333 SF**  
SCALE 1/4"=1'-0"

SEALED FOR STRUCTURAL REVIEW



The Jevon and Julie McBride Residence  
211 NW Carson Drive  
Lee's Summit, Missouri 64081



**CDG**  
Castrop Design Group  
Christopher C. Castrop  
Architectural Design and Consulting  
438 West 54th Street  
Roland Park, Kansas 66205  
913.515.7664  
castropdesigngroup@live.com



STRUCTURAL REVIEW  
HDR: 40620

**HD ENGINEERING & DESIGN, INC.**  
1658 W. 20TH STREET  
DOWNEY, MO 64014  
WWW.HDENGINEERS.COM  
913.831.2222  
SERVICES@HDENGINEERS.COM

No.	Description	Date
1	City Permit Review	12/4/20

CONSTRUCTION DOCUMENTS

Project Number: **GALE 04**  
Date: **2020 Sept 22**  
Drawn By: **MGS**  
Checked By: **CDG**

**A 103**  
SCALE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DATE: 12/15/2020  
LEE'S SUMMIT, MISSOURI

SEALED FOR STRUCTURAL REVIEW



The Jevon and Julie McBride Residence  
211 NW Carson Drive  
Lee's Summit, Missouri 64081



Christopher C. Castrop  
Architectural Design and Consulting  
4318 West 54th Street  
Roland Park, Kansas 66205  
913.515.7664  
castropdesigngroup@live.com



STRUCTURAL REVIEW HDR: 40620

HD ENGINEERING & DESIGN, INC.  
1650 W. 20TH STREET  
DOWNEY, MO 64244  
WWW.HDENGINEERS.COM  
913.831.2222  
SERVICES@HDENGINEERS.COM


No.	Description	Date
1	City Permit Review	12/4/20

CONSTRUCTION DOCUMENTS

Project Number: GALE 04  
Date: 2020 Sept 22  
Drawn By: MGS  
Checked By: CDG


**A 104**  
SCALE FOR CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPER'S USE ONLY  
LEE'S SUMMIT, MISSOURI

12/15/2020

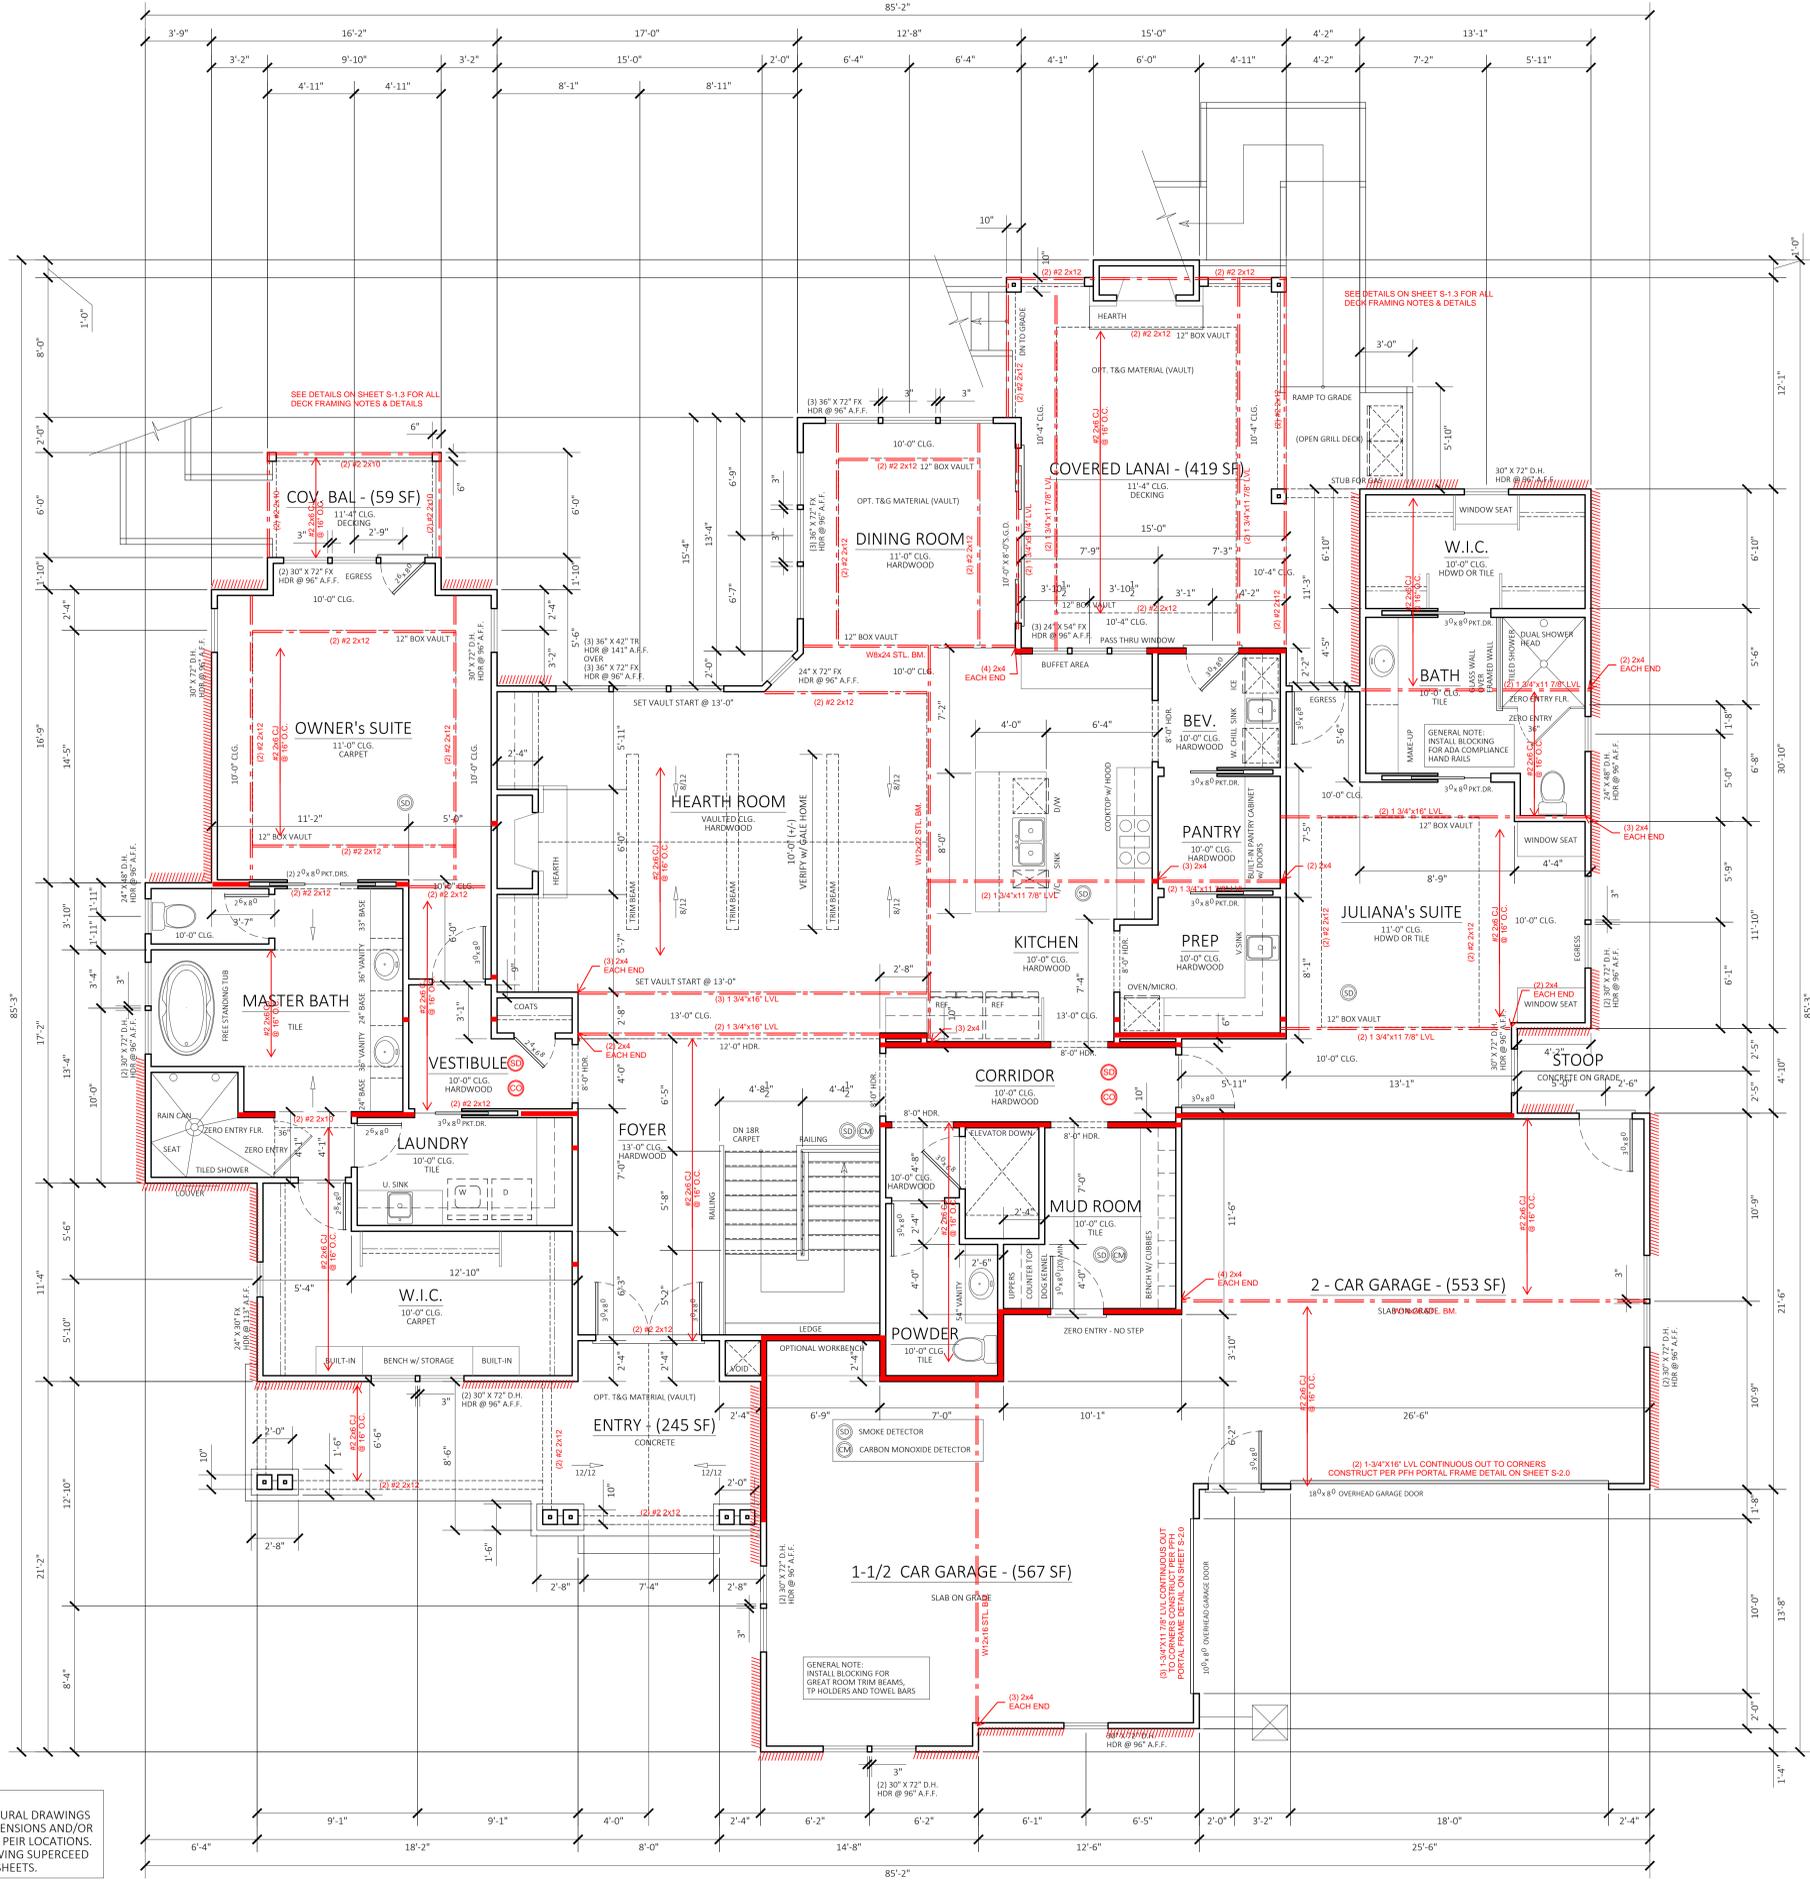


- - - LOAD BEARING WALL
- - - LOAD BEARING BEAM
- ⊙ - SMOKE DETECTOR
- ⊙ - CARBON MONOXIDE SENSOR

**GENERAL NOTES:**  
- WINDOW SHALL HAVE FALL PROTECTION PER IRC 312.2.4  
- HOUSE WILL BE PROVIDED WITH A "WIER" GROUND PER IRC SECTION 3608.1.5  
- OVERHEAD GARAGE DOORS MUST MEET DASHA REQUIREMENTS SEE DETAIL SHEET S-1.0  
- ALL HEADERS NOT LABELED SHALL BE MIN (2) #2-2X12 DFL  
- SOIL ALL SET UNDER ISLAND  
- SOLS IN THIS AREA COMMONLY HAVE A VERY HIGH SHRINK SWELL CAPACITY. OUR FIRM RECOMMENDS ALL SITES BE EVALUATED BY A GEOTECHNICAL FIRM PRIOR TO PLACEMENT OF FOUNDATIONS  
- PROVIDE CARBON MONOXIDE AND SMOKE DETECTORS PER IRC REQUIREMENTS  
- ANY PORTION OF THESE PRINTS ISSUED WITHOUT A MIN. OF 5-10-5-4.0 SHALL NOT BE CONSIDERED A COMPLETE SET OF CONSTRUCTION DOCUMENTS  
- INSTALL WOODS STEEL BEAM MIN UNDER ALL F.P. WALLS/HEARTHES (THAT WILL RECEIVE ROCK) UNLESS NOTED AS A LARGER BEAM ANY STONE OVER 2" DEEP NOTIFY ENG. TO VERIFY LOADS  
- FOUNDATION SHALL BE CONSTRUCTED PER JOHNSON COUNTY RESIDENTIAL FOUNDATION GUIDELINE. SEE ATTACHED ICE AND WATER SHIELD AS REQUIRED PER IRC.



**BRACED WALLS:**  
SEE CALCULATIONS ON SHEET S-2.0. PER ASC7-10 REQUIREMENTS AS ALLOWED BY IRC 2018 R301.2.1  
ALL EXTERIOR WALLS SHALL BE SHEATHED PER ANY ONE OF THE FOLLOWING OPTIONS:  
- 7/16" APA-RATED PLYWOODS WITH 6d NAILS @ 6" O.C. AT EDGES AND @ 12" O.C. IN THE FIELD  
- 7/16" SHIP-LAP PANEL SHEATHING (I.E. LP SMARTSIDE OR EQUIVALENT) WITH 6d NAILS @ 6" O.C. AT EDGES AND @ 12" O.C. IN THE FIELD  
- 3/8" SHIP-LAP PANEL SHEATHING (I.E. LP SMARTSIDE OR EQUIVALENT) WITH 6d NAILS @ 4" O.C. AT EDGES AND @ 12" O.C. IN THE FIELD  
INTERIOR BRACED WALL LOCATIONS ONLY SHOWN WHEN REQUIRED BY ADDITIONAL BRACING SECTION OF CALCULATIONS ON SHEET S-2.0



**GENERAL NOTE:**  
REFER TO STRUCTURAL DRAWINGS TO CONFIRM DIMENSIONS AND/OR WALL THICKNESS, PER LOCATIONS. STRUCTURAL DRAWING SUPERCEED ARCHITECTURAL SHEETS.


FIRST FLOOR PLAN NOTES

**MAIN LEVEL FLOOR PLAN - 3,174 SF**  
SCALE 1/4"=1'-0"

SEALED FOR STRUCTURAL REVIEW



The Jevon and Julie McBride Residence  
211 NW Carson Drive  
Lee's Summit, Missouri 64081

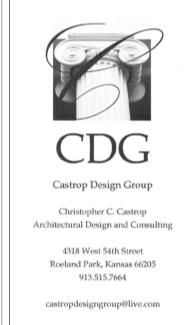

No.	Description	Date
1	City Permit Review	12/4/20

CONSTRUCTION DOCUMENTS

Project Number: GALE 04  
Date: 2020 Sept 22  
Drawn By: MGS  
Checked By: CDG

**A 105**  
Scale: AS NOTED ON PLANS REVIEW DATE: 12/15/2020

**NOTES**  
ROOF DESIGNED FOR LIGHT ROOF COVERING 30PSF TOTAL LOAD [10PSF DL, 20PSF LL (SL)]  
RAFTERS (DOUG-FIR, OR EQUAL); SEE SPAN CHARTS BELOW

CODE MINIMUM	RAFTERS	SPACING	MAX HORIZONTAL CLEARSPAN
	#2-2x6	@24" O.C.	11'-1"
	#2-2x6	@18" O.C.	14'-1"
	#2-2x8	@24" O.C.	15'-1"
	#2-2x8	@18" O.C.	18'-0"
	#2-2x10	@24" O.C.	18'-0"
	#2-2x10	@18" O.C.	22'-8"

NOTE: CODE MINIMUM L/240 DEFLECTION

GREATER THAN CODE	RAFTERS	SPACING	MAX HORIZONTAL CLEARSPAN
	#2-2x6	@24" O.C.	8'-6"
	#2-2x6	@18" O.C.	9'-6"
	#2-2x8	@24" O.C.	11'-3"
	#2-2x8	@18" O.C.	12'-0"
	#2-2x10	@24" O.C.	14'-3"
	#2-2x10	@18" O.C.	16'-3"

DEFLECTION = L/360 LIVE LOAD, L/240 TOTAL LOAD  
VAULTS TO BE 2x10 DEPTH


ALL RIDGES, HIP, AND VALLEYS NOT MARKED SHALL BE (1) NOMINAL SIZE, LARGER THAN THE INTERSECTING RAFTERS

PURLINS ARE 2x6 MIN.  
PURLIN STRUTS ARE AT 4'-0" O.C.  
PURLIN STRUTS SHALL BE INSTALLED AT NOT LESS THAN A 45 DEGREE ANGLE WITH THE HORIZONTAL  
ALL PURLIN STRUTS SHALL HAVE A MAXIMUM UNBRACED LENGTH OF 8'-0"  
PURLIN STRUTS SHALL BE CONSTRUCTED IN A "T" CONFIGURATION AND PER THE FOLLOWING CHART

PURLIN STRUT	MAX PURLIN STRUT LENGTH
(2) 2x4	8'-0"
(1) 2x4 & (1) 2x6	12'-0"
(1) 2x6 & (1) 2x6	20'-0"
(2) 2x6 & (1) 2x6	30'-0"
CONSULT ARCH/ENGR.	>30'-0"

SEE DETAILS 1, 5, 6, 7, 11, 12, 13, & 14 ON S-1.2 FOR ROOF FRAMING AND INSULATION OPTIONS

- PURLIN
- LOAD BEARING WALL
- LOAD BEARING BEAM/GIRDER PER PLAN

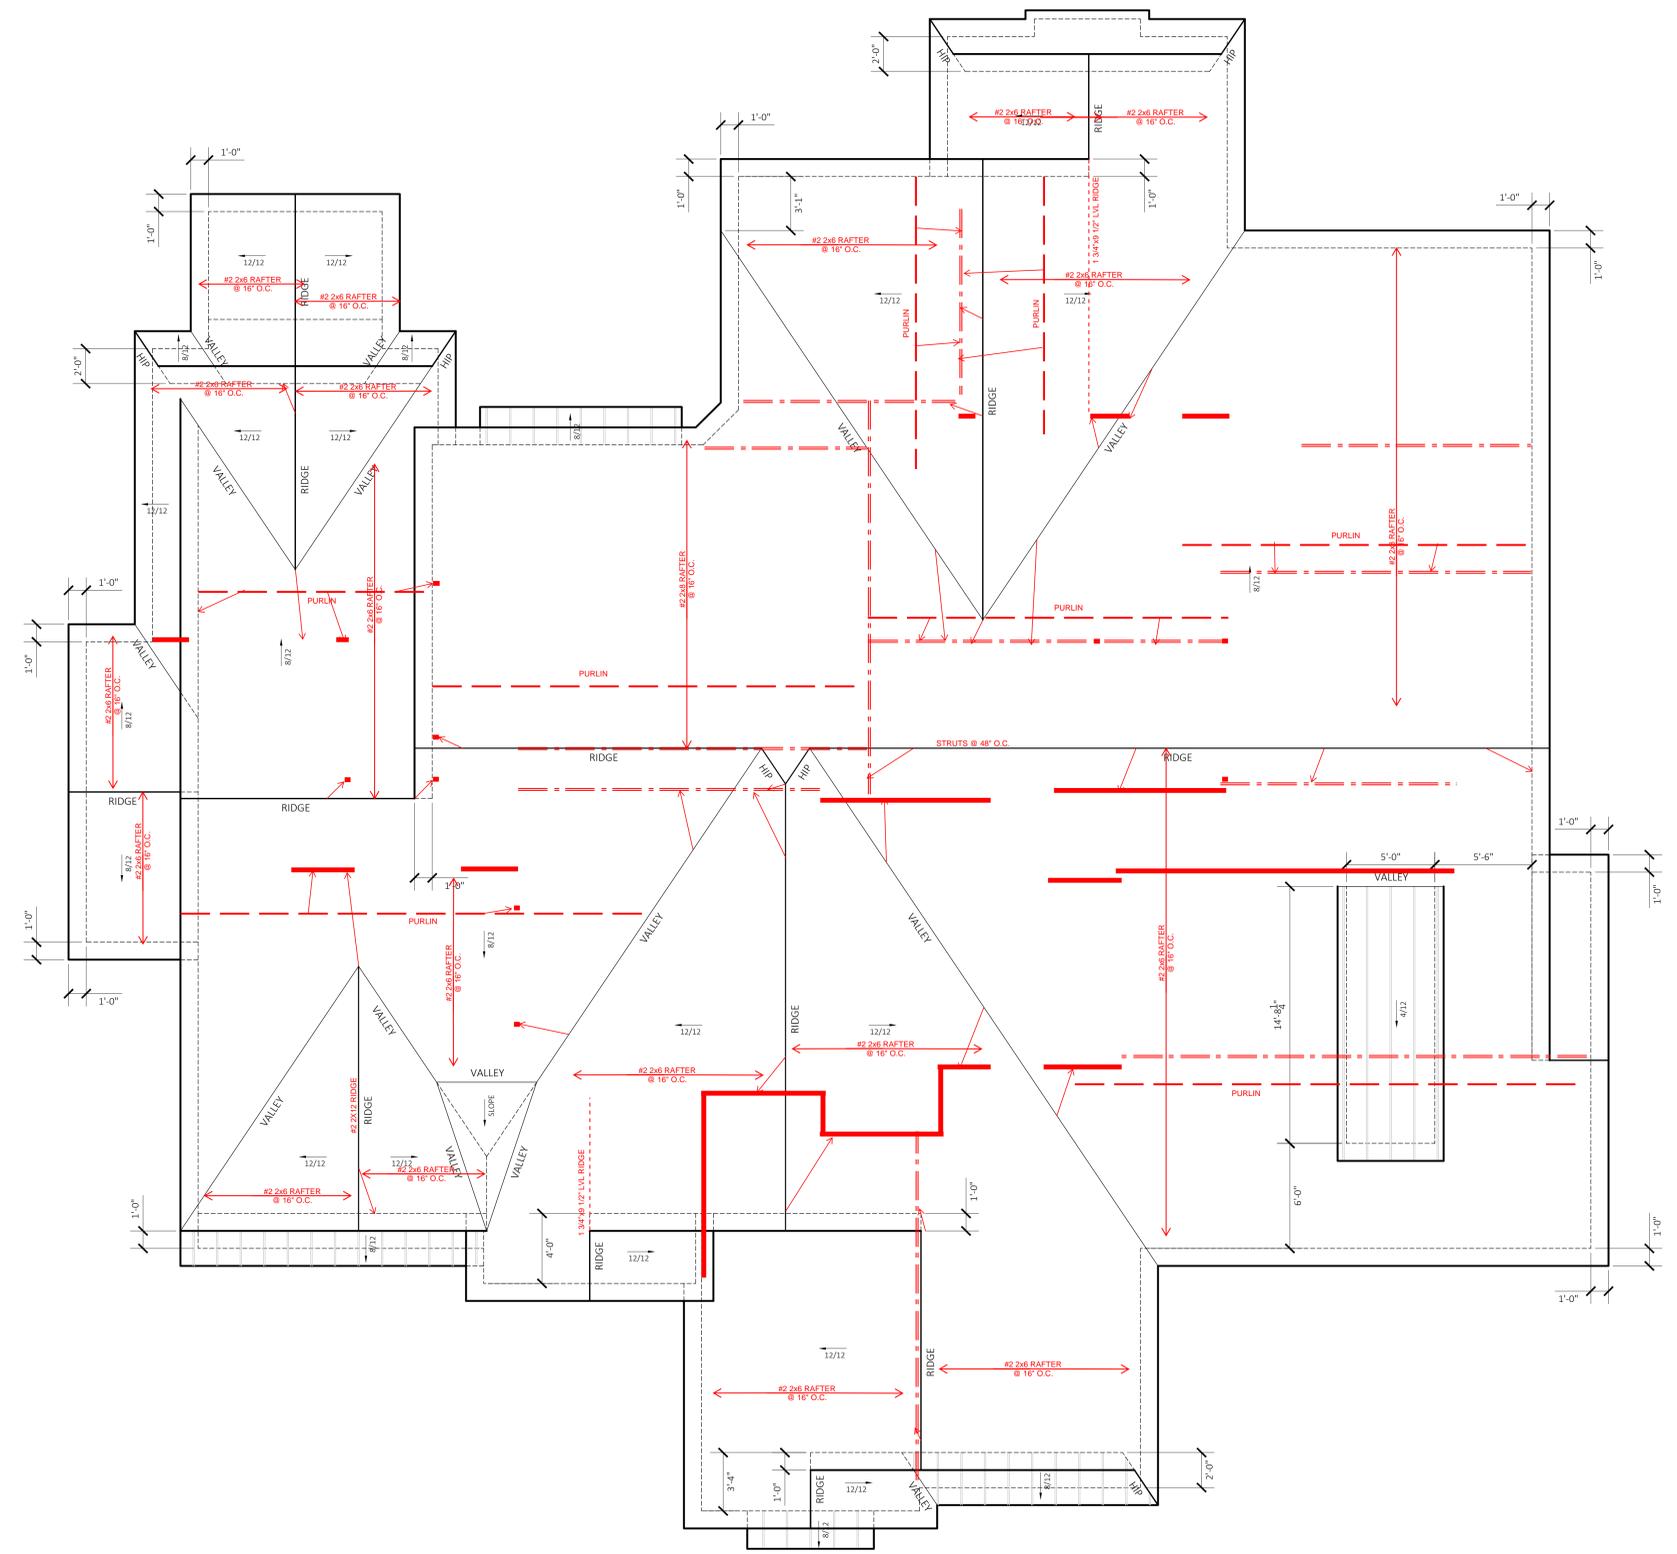

**ROOF PLAN**  
SCALE 1/4"=1'-0"

STATE OF MISSOURI  
CHRIS SAATHOFF  
0008001845  
12/10/2020  
REGISTERED PROFESSIONAL ENGINEER

STRUCTURAL REVIEW  
HDR: 40620

HD ENGINEERING & DESIGN, INC.  
1638 W. 107TH STREET  
DOWNEY, MO 64244  
WWW.HDENGINERS.COM  
913.631.2222  
SERVICES@HENGINEERS.COM



## TABLE R602.3(1) FASTENER SCHEDULE FOR STRUCTURAL MEMBERS

ITEM	DESCRIPTION OF BUILDING ELEMENTS	NUMBER AND TYPE OF FASTENER <sup>a,b,c</sup>	SPACING OF FASTENERS
<b>ROOF</b>			
1	BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE, TOE NAIL	4-8D BOX (2 1/2" X 0.113") 3-8D (2 1/2" X 0.113") 3-10D (3" X 0.128") 3-3" X 0.131" NAILS	TOE NAIL
2	CEILING JOISTS TO PLATE, TOE NAIL	4-10D BOX (3" X 0.128") 3-16D COMMON (3 1/2" X 0.162") 4-3" X 0.131" NAILS	PER JOIST, TOE NAIL
3	CEILING JOISTS NOT ATTACHED TO PARALLEL RAFTER, LAPS OVER PARTITIONS (SEE SECTION R802.5.2 AND TABLE R802.52)	4-10D BOX (3" X 0.128") 3-16D COMMON (3 1/2" X 0.162") 4-3" X 0.131" NAILS	FACE NAIL
4	CEILING JOIST ATTACHED TO PARALLEL RAFTER (HEEL JOINT) SEE SECTION R802.5.2 AND TABLE R802.5.2)	TABLE R802.5.2	FACE NAIL
5	COLLAR TIE TO RAFTER, FACE NAIL OR 1 1/4" X 20GA. RIDGE STRAP TO RAFTER	4-10D BOX (3" X 0.128") 3-10D COMMON (3" X 0.148") 4-3" X 0.131" NAILS	FACE NAILS EACH RAFTER
6	RAFTER OR ROOF TRUSS TO PLATE	3-16D BOX NAILS (3 1/2" X 0.162") 3-10D COMMON NAILS (3" X 0.148") 4-10D BOX (3" X 0.128") 4-3" X 0.131" NAILS	2 TOE NAILS ON ONE SIDE AND 1 TOE NAIL ON OPPOSITE SIDE OF EACH RAFTER OR TRUSS <sup>1</sup>
7	ROOF RAFTERS TO RIDGE, VALLEY OR HIP RAFTERS OR ROOF RAFTER TO MINIMUM 2" RIDGE BEAM	4-16D (3 1/2" X 0.135"); OR 3-10D COMMON (3" X 0.148") 4-10D BOX (3" X 0.128"); OR 4-3" X 0.131" NAILS	TOE NAIL
		3-16D (3 1/2" X 0.135"); OR 2-16D COMMON (3 1/2" X 0.162") 3-10D BOX (3" X 0.128"); OR 3-3" X 0.131" NAILS	
<b>WALL</b>			
8	STUD TO STUD (NOT BRACED WALL PANELS)	16D (3 1/2" X 0.162") 10D BOX (3" X 0.128"); OR 3" X 0.131" NAILS	24" OC FACE NAIL 16" OC FACE NAIL
9	STUD TO STUD AND ABUTTING STUDS AT INTERSECTING WALL CORNERS (AT BRACED WALL PANELS)	16D BOX (3 1/2" X 0.135"); OR 3" X 0.131" NAILS 16D COMMON (3 1/2" X 0.162")	12" OC FACE NAIL 16" OC FACE NAIL
10	BUILT-UP HEADER (2" TO 2" HEADER WITH 1/2" SPACER)	16D COMMON (3 1/2" X 0.162") 16D BOX (3 1/2" X 0.135")	16" OC EACH EDGE FACE NAIL 12" OC EACH EDGE FACE NAIL
11	CONTINUOUS HEADER TO STUD	5-8D BOX (2 1/2" X 0.113") or 4-8D COMMON (2 1/2" X 0.131") 4-10D BOX (3" X 0.128")	TOE NAIL
12	TOP PLATE TO TOP PLATE	16D COMMON (3 1/2" X 0.162") 10D BOX (3" X 0.128") OR 3" X 0.131" NAILS	16" OC FACE NAIL 12" OC FACE NAIL
13	DOUBLE TOP PLATE SPLICE	8-16D COMMON (3 1/2" X 0.162"); or 12-16D BOX (3 1/2" X 0.135"); or 12-10D BOX (3" X 0.128"); or 12-3" X 0.131" NAILS	FACE NAIL ON EACH SIDE OF END JOINT (MINIMUM 24" LAP SPLICE LENGTH EACH SIDE OF END JOINT)
14	BOTTOM PLATE TO JOIST, RIM JOIST, BAND JOIST OR BLOCKING (NOT AT BRACED WALL PANELS)	16D COMMON (3 1/2" X 0.162") 16D BOX (3 1/2" X 0.135"); OR 3" X 0.131" NAILS	16" OC FACE NAIL 12" OC FACE NAIL
15	BOTTOM PLATE TO JOIST, RIM JOIST, BAND JOIST OR BLOCKING (NOT AT BRACED WALL PANELS)	3-16D BOX (3 1/2" X 0.135"); or 2-16D COMMON (3 1/2" X 0.162"); or 3-3" X 0.131" NAILS	3, 2, OR 4 EACH 16" OC FACE NAIL
16	TOP OR BOTTOM PLATE TO STUD	4-8D BOX (2 1/2" X 0.113"); or 3-16D BOX (3 1/2" X 0.135"); or 4-8D COMMON (2 1/2" X 0.131"); or 4-10D BOX (3" X 0.128"); or 3-3" X 0.131" NAILS	TOE NAIL
17	TOP PLATES, LAPS AT CORNERS AND INTERSECTIONS	3-16D BOX (3 1/2" X 0.135"); or 2-16D COMMON (3 1/2" X 0.162"); or 3-10D BOX (3" X 0.128"); or 3-3" X 0.131" NAILS	END NAIL
18	1" BRAVE TO EACH STUD AND PLATE	3-10D BOX (3" X 0.128"); or 2-16D COMMON (3 1/2" X 0.162"); or 3-3" X 0.131" NAILS	FACE NAIL
19	1" X 6" SHEATHING TO EACH BEARING	3-8D BOX (2 1/2" X 0.113"); or 2-8D COMMON (2 1/2" X 0.131"); or 2-10D BOX (3" X 0.128"); or 2 STAPLES 1" CROWN, 16GA., 1 3/4" LONG	FACE NAIL
20	1" X 6" AND WIDER SHEATHING TO EACH BEARING	3-8D BOX (2 1/2" X 0.113"); or 3-8D COMMON (2 1/2" X 0.131"); or 3-10D BOX (3" X 0.128"); or 3 STAPLES, 1" CROWN, 16GA., 1 3/4" LONG WIDER THAN 1" X 8" 4-8D BOX (2 1/2" X 0.113"); or 3-8D COMMON (2 1/2" X 0.131"); or 3-10D BOX (3" X 0.128"); or 4 STAPLES, 1" CROWN, 16GA., 1 3/4" LONG	FACE NAIL
<b>FLOOR</b>			
21	JOIST TO SILL, TOP PLATE OR GIRDER	4-8D BOX (2 1/2" X 0.113"); or 3-8D COMMON (2 1/2" X 0.131"); or 3-10D BOX (3" X 0.128"); or 3-3" X 0.131" NAILS	TOE NAIL
22	RIM JOIST, BAND JOIST OR BLOCKING TO SILL OR TOP PLATE (ROOF APPLICATIONS ALSO)	8D BOX (2 1/2" X 0.113") 8D COMMON (2 1/2" X 0.131"); or 10D BOX (3" X 0.128") or 3-3" X 0.131" NAILS	4" OC TOE NAIL 6" OC TOE NAIL
23	1" X 6" SUBFLOOR OR LESS TO EACH JOIST	3-8D BOX (2 1/2" X 0.113"); or 2-8D COMMON (2 1/2" X 0.131"); or 2-10D BOX (3" X 0.128"); or 2 STAPLES, 1" CROWN, 16GA., 1 3/4" LONG	FACE NAIL
24	2" SUBFLOOR TO JOIST OR GIRDER	3-16D BOX (3 1/2" X 0.135"); or 2-16D COMMON (3 1/2" X 0.162")	BLIND AND FACE NAIL
25	2" PLANKS (PLANK & BEAM-FLOOR AND ROOF)	3-16D BOX (3 1/2" X 0.135"); or 2-16D COMMON (3 1/2" X 0.162")	AT EACH BEARING, FACE NAIL
26	BAND OR RIM JOIST TO JOIST	3-16D COMMON (3 1/2" X 0.162"); or 4-10D BOX (3" X 0.128"); or 4-3" X 0.131" NAILS; or 4-3" X 14GA. STAPLES, 7/16" CROWN	END NAIL
27	BUILT-UP GIRDERS AND BEAMS, 2-INCH LUMBER LAYERS	20D COMMON (4" X 0.192"); or 10D BOX (3" X 0.128"); or 3" X 0.131" NAILS AND: 2-20D COMMON (4" X 0.192"); or 3-10D BOX (3" X 0.128); or 3-3" X 0.131" NAILS	NAIL EACH LAYER AS FOLLOWS: 32" OC AT TIP AND BOTTOM AND STAGGERED 24" OC FACE NAIL AT TOP AND BOTTOM STAGGERED ON OPPOSITE SIDES FACE NAIL AT END AND AT EACH SPLICE
28	LEDGER STRIP SUPPORTING JOISTS OR RAFTERS	4-16D BOX (3 1/2" X 0.135"); or 3-26D COMMON (3 1/2" X 0.162"); or 4-10D BOX (3" X 0.128"); or 4-3" X 0.131" NAILS	AT EACH JOIST OR RAFTER, FACE NAIL
29	BRIDGING OR BLOCKING TO JOIST	2-10D BOX (3" X 0.128"); or 2-8D COMMON (2 1/2" X 0.131"); or 2-3" X 0.131" NAILS	EACH END, TOE NAIL

a. ALL NAILS ARE SMOOTH-CROWN, BOX OR DEFORMED SHANKS EXCEPT WHERE OTHERWISE STATED. NAILS USED FOR FRAMING AND SHEATHING CONNECTIONS SHALL HAVE MINIMUM AVERAGE BENDING YIELD STRENGTHS AS SHOWN: 80 KSI FOR SHANK DIAMETER OF 0.192 INCH (200 COMMON), 100 KSI FOR SHANK DIAMETERS LARGER THAN 0.192 INCH BUT NOT LARGER THAN 0.171 INCH, AND 100 KSI FOR SHANK DIAMETER OF 0.142 INCH OR LESS.  
b. STAPLES ARE 16 GAGE WIRE AND HAVE A MINIMUM 7/16" INCH ON DIAMETER CROWN WIDTH.  
c. NAILS SHALL BE SPACED AT NOT MORE THAN 6 INCHES ON CENTER AT ALL SUPPORTS WHERE SPANS ARE 48 INCHES OR GREATER.  
d. FOURFOOT BY SIXFOOT OR FOURFOOT BY EIGHTFOOT PANELS SHALL BE APPLIED VERTICALLY.  
e. SPACING OF FASTENERS NOT INCLUDED IN THIS TABLE SHALL BE BASED ON TABLE R602.3(2).  
f. FOR REGIONS HAVING BASIC WIND SPEED OF 110 MPH OR GREATER, 40 REFORMED (2 1/2" X 0.120) NAILS SHALL BE USED FOR ATTACHING PLYWOOD AND WOOD STRUCTURAL PANEL ROOF SHEATHING TO FRAMING WITHIN MINIMUM 48-INCHES DISTANCE FROM GABLE END WALLS, IF MEAN ROOF HEIGHT IS MORE THAN 25 FEET. UP TO 35 FEET MAXIMUM.  
g. FOR REGIONS HAVING BASIC WIND SPEED OF 110 MPH OR LESS, NAILS FOR ATTACHING WOOD STRUCTURAL PANEL ROOF SHEATHING TO GABLE END WALL FRAMING SHALL BE SPACED 6 INCHES ON CENTER, WHEN BASIC WIND SPEED IS GREATER THAN 100 MPH, NAILS FOR ATTACHING PANEL ROOF SHEATHING TO INTERMEDIATE SUPPORTS SHALL BE SPACED 6 INCHES ON CENTER FOR MINIMUM 48-INCH DISTANCE FROM RIDGES, EAVES AND GABLE END WALLS, AND 4 INCHES ON CENTER TO GABLE END WALL FRAMING.  
h. GYPSUM SHEATHING SHALL CONFORM TO ASTM C 1396 AND SHALL BE INSTALLED IN ACCORDANCE WITH GA 253. FIBERGLASS SHEATHING SHALL CONFORM TO ASTM C 208.  
i. SPACING OF FASTENERS ON FLOOR SHEATHING PANEL EDGES SUPPORTED BY FRAMING MEMBERS AND REQUIRE BLOCKING AND AT ALL FLOOR PERIMETERS ONLY. SPACING OF FASTENERS ON ROOF SHEATHING PANEL EDGES APPLIES TO PANEL EDGES SUPPORTED BY FRAMING MEMBERS AND REQUIRE BLOCKING, BLOCKING OF ROOF OR FLOOR SHEATHING PANEL EDGES PERPENDICULAR TO THE FRAMING MEMBERS NEED NOT BE PROVIDED EXCEPT AS REQUIRED BY OTHER PROVISIONS OF THIS CODE. FLOOR PERIMETER SHALL BE SUPPORTED BY FRAMING MEMBERS OR SOLID BLOCKING.  
j. WHERE A RAFTER IS FASTENED TO AN ADJACENT PARALLEL CEILING JOIST IN ACCORDANCE WITH THIS SCHEDULE, PROVIDE TWO TOE NAILS ON ONE SIDE OF THE RAFTER AND TWO NAILS FROM CEILING JOIST TO TOP PLATE IN ACCORDANCE WITH THIS SCHEDULE. THE TOE NAIL ON THE OPPOSITE SIDE OF THE RAFTER SHALL NOT BE REQUIRED.

## CONTINUED TABLE R602.3(1) FASTENER SCHEDULE FOR STRUCTURAL MEMBERS

ITEM	DESCRIPTION OF BUILDING ELEMENTS	NUMBER AND TYPE OF FASTENER <sup>a,b,c</sup>	SPACING OF FASTENERS	
			EDGES (INCHES) <sup>d</sup>	INTERMEDIATE SUPPORTS (INCHES)
<b>WOOD STRUCTURAL PANELS, SUBFLOOR, ROOF AND INTERIOR WALL SHEATHING TO FRAMING AND PARTICLEBOARD WALL SHEATHING TO WALL FRAMING (SEE TABLE R602.3(3) FOR WOOD STRUCTURAL PANEL EXTERIOR WALL SHEATHING TO WALL FRAMING)</b>				
30	3/8" - 1/2"	6D COMMON (2 1/2" X 0.113" NAIL (SUBFLOOR, WALL) ; 8D COMMON (2 1/2" X 0.131" NAIL (ROOF); or RRSR-01 (2 3/8" X 0.113" NAIL (ROOF) )	6	12 <sup>e</sup>
31	19/32" - 1"	8D COMMON NAIL (2 1/2" X 0.131; or RRSR-01; 2 3/8" X 0.113" NAIL ROOF )	6	12 <sup>e</sup>
32	1 1/8" - 1 1/4"	10D COMMON NAIL (3" X 0.148) NAIL; or 8D (2 1/2" X 0.131") DEFORMED NAIL	6	12
<b>OTHER WALL SHEATHING<sup>g</sup></b>				
33	1/2" STRUCTURAL CELLULOSE FIBERBOARD SHEATHING	1 1/2" GALVANIZED ROOF NAIL, 7/16" HEAD DIAMETER, OR 1 1/4" LONG 16GA. STAPLE WITH 7/16" OR 1" CROWN	3	6
34	25/32" STRUCTURAL CELLULOSE FIBERBOARD SHEATHING	1 3/4" GALVANIZED ROOF NAIL, 7/16" HEAD DIAMETER, OR 1 1/2" LONG 16GA. STAPLE WITH 7/16" OR 1" CROWN	3	6
35	1/2" GYPSUM SHEATHING <sup>h</sup>	1 1/2" GALVANIZED ROOF NAIL, STAPLE GALVANIZED, 1 1/2" LONG, 1 1/4" SCREWS, TYPE W or S	7	7
36	5/8" GYPSUM SHEATHING <sup>h</sup>	1 3/4" GALVANIZED ROOF NAIL, STAPLE GALVANIZED, 1 5/8" LONG, 1 5/8" SCREWS, TYPE W or S	7	7
<b>WOOD STRUCTURAL PANELS, COMBINATION SUBFLOOR UNDERLAYMENT TO FRAMING</b>				
37	3/4" AND LESS	6D DEFORMED (2" X 0.120") NAIL OR 8D COMMON (2 1/2" X 0.131") NAIL	6	12
38	7/8" - 1"	8D COMMON (2 1/2" X 0.131") NAIL OR 8D DEFORMED (2 1/2" X 0.120") NAIL	6	12
39	1 1/8" - 1 1/4"	10D COMMON (3" X 0.148") NAIL OR 8D DEFORMED (2 1/2" X 0.120") NAIL	6	12

For Sl: 1 inch = 25.4mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s; 1 ksi = 6.895 MPa.

## TABLE R 602.3(5) SIZE, HEIGHT, AND SPACING OF WOOD STUDS

STUD SIZE (IN)	BEARING WALLS					NON-BEARING WALLS	
	LATERALLY UNSUPPORTED STUD HEIGHT <sup>a</sup> (feet)	MAXIMUM SPACING WHERE SUPPORTING A ROOF-CEILING ASSEMBLY OR A HABITABLE ATTIC ASSEMBLY, ONLY (inches)	MAXIMUM SPACING WHERE SUPPORTING ONE FLOOR, PLUS A ROOF-CEILING ASSEMBLY OR A HABITABLE ATTIC ASSEMBLY (inches)	MAXIMUM SPACING WHERE SUPPORTING TWO FLOORS, PLUS A ROOF-CEILING ASSEMBLY OR A HABITABLE ATTIC ASSEMBLY (inches)	MAXIMUM SPACING WHERE SUPPORTING ONE FLOOR HEIGHT (inches)	LATERALLY UNSUPPORTED STUD HEIGHT <sup>a</sup> (feet)	LATERALLY UNSUPPORTED STUD HEIGHT (feet)
2x3 <sup>b</sup>	---	---	---	---	---	10	16
2x4	10	24 <sub>c</sub>	16 <sub>c</sub>	---	24	14	24
3x4	10	24	24	16	24	14	24
2x5	10	24	24	---	24	16	24
2x6	10	24	24	16	24	20	24

FOR SL: 1 INCH = 25.4mm, 1 FOOT = 304.8mm  
a. LISTED HEIGHTS ARE DISTANCES BETWEEN POINTS OF LATERAL SUPPORT PLACED PERPENDICULAR TO THE PLANE OF THE WALL. BEARING WALL SHALL BE SHEATHED ON NOT LESS THAN ONE SIDE OR BRIDGING SHALL BE INSTALLED NOT GREATER THAN 2 FEET APART MEASURED VERTICALLY FROM EITHER END OF THE STUD. INCREASES IN UNSUPPORTED HEIGHT ARE PERMITTED WHERE IN COMPLIANCE WITH EXCEPTION 2 OF SECTION R602.3.1 OR DESIGNED IN ACCORDANCE WITH ACCEPTED ENGINEERING PRACTICES.  
b. SHALL NOT BE USED IN EXTERIOR WALLS.  
c. A HABITABLE ATTIC ASSEMBLY SUPPORTED BY 2X4 STUDS IS LIMITED TO A ROOF SPAN OF 32 FEET. WHERE THE ROOF SPAN EXCEEDS 32 FEET, THE WALL STUDS SHALL BE INCREASED TO 2X6 OR THE STUDS SHALL BE DESIGNED IN ACCORDANCE WITH ACCEPTED ENGINEERING PRACTICE.

## MINIMUM MECHANICAL EQUIPMENT EFFICIENCY VALUES BY COMPONENT, PER IRC2018 N1103.6.1

FAN LOCATION	AIR FLOW RATE MINIMUM (CFM)	MINIMUM EFFICACY CFM/WATT	AIR FLOW RATE MAXIMUM (CFM)
HRV OR ERV	ANY	1.2 CFM/WATT	ANY
RANGE HOOD	ANY	2.8 CFM/WATT	ANY
IN-LINE FAN	ANY	2.8 CFM/WATT	ANY
BATHROOM UTILITY FAN	10	1.4 CFM/WATT	<90
BATHROOM UTILITY FAN	90	2.8 CFM/WATT	ANY

## MINIMUM INSULATION & FENSTRATION VALUES BY COMPONENT, PER IRC2018 N1102.1.2

VALUES BELOW ARE PER 2018 IECC. ACTUAL VALUES MAY VARY BASED ON ALTERNATE ENERGY COMPLIANCE PATH CHOSEN (IN JURISDICTIONS WHERE ALTERNATIVE PATHS ARE AVAILABLE)

CLIMATE ZONE	FENSTRATION U-FACTOR	SKYLIGHT U-FACTOR	GLAZED SHGC FENSTRATION	INSULATED METAL DOOR U-VALUE	INSULATED WOOD DOOR U-VALUE	CEILING R-VALUE	WOOD FRAMED WALL R-VALUE	FLOOR R-VALUE	BASEMENT WALL R-VALUE	SLAB R-VALUE & DEPTH	CRAWL SPACE WALL R-VALUE	DUCTWORK OVER OUTSIDE R-VALUE	DUCTWORK (ALL OTHER) R-VALUE
4 EXCEPT MARINE	0.32	0.55	0.40	0.60	0.50	49	20 OR 13 CAV. +5	19	10 CONTINUOUS OR 13 CAVITY	R-10, 2 FT.	10 CONTINUOUS OR 13 CAVITY	8	6

NOTES: 1) BUILDING THERMAL ENVELOPE IS REQUIRED TO BE SEALED WITH AN AIR BARRIER AS PER N1102.4.1 OF THE 2018 IRC  
2) RECESSED LIGHTING SHALL BE SEALED TO PREVENT LEAKAGE BETWEEN THE CONDITIONED SPACE AND UNCONDITIONED SPACE  
3) ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES USED AS DUCTS SHALL BE SEALED AS PER N1103.2 OF THE 2018 IRC

**BUILDER'S PLANS:** THE TERM "BUILDER'S PLANS" REFERS TO A CERTAIN LEVEL OF DEVELOPMENT OF THE DRAWINGS. AS THE NAME IMPLIES, THESE PLANS REQUIRE THAT THE CONTRACTOR POSSESSES COMPETENCE IN RESIDENTIAL CONSTRUCTION AND A THOROUGH UNDERSTANDING OF THE INTERNATIONAL RESIDENTIAL CODE (IRC). THE CONTRACTOR WARRANTS TO HD ENGINEERING & DESIGN THAT HE POSSESSES THE PARTICULAR COMPETENCE AND SKILL IN CONSTRUCTION NECESSARY TO BUILD THIS PROJECT WITHOUT FULL ENGINEERING AND DESIGN SERVICES, AND FOR THAT REASON THE CONTRACTOR OR HOME OWNER HAS RESTRICTED THE SCOPE OF PROFESSIONAL SERVICES. THE CONSTRUCTION DOCUMENTS PROVIDED BY THE LIMITED SERVICES SHALL BE TERMED "BUILDER'S PLANS" IN RECOGNITION OF THE CONTRACTOR'S SOPHISTICATION. ALTHOUGH HD ENGINEERING & DESIGN HAVE PERFORMED THEIR SERVICES WITH DUE CARE AND DILIGENCE, WE CANNOT GUARANTEE PERFECTION. ANY AMBIGUITY OR DISCREPANCY DISCOVERED BY THE USE OF THESE PLANS SHALL BE REPORTED IMMEDIATELY TO HD ENGINEERING. CONSTRUCTION MAY REQUIRE THAT THE CONTRACTOR ADAPT THE "BUILDER'S PLANS" TO THE FIELD CONDITIONS ENCOUNTERED AND MAKE LOGICAL ADJUSTMENTS IN FIT, FORM, DIMENSION AND QUANTITY. CHANGES MADE FROM THE PLANS WITHOUT THE CONSENT OF HD ENGINEERING & DESIGN ARE UNAUTHORIZED. IT IS ALSO UNDERSTOOD THAT THE CONTRACTOR WILL BE RESPONSIBLE FOR MEETING ALL APPLICABLE BUILDING CODES INCLUDING BUT NOT LIMITED TO MECHANICAL, ELECTRICAL AND PLUMBING CODE REQUIREMENTS (WHICH IS EXCLUDED FROM THESE PLANS). IN THE EVENT ADDITIONAL DETAIL OR GUIDANCE IS NEEDED BY THE CONTRACTOR OR HOMEOWNER FOR CONSTRUCTION OF ANY ASPECT OF THE PROJECT, HD ENGINEERING & DESIGN OR A QUALIFIED ENGINEER SHALL IMMEDIATELY BE RETAINED. FAILURE TO NOTIFY US OF THESE NEEDS OR OF CHANGES TO THE PLANS SHALL RELIEVE HD ENGINEERING & DESIGN OF ALL RESPONSIBILITIES OF THE CONSEQUENCES.

## DESIGN LOADS (PSF)

THE DWELLING SHALL COMPLY WITH THE FOLLOWING LOAD CONDITIONS

AREA	MIN DEAD LOAD	MIN LIVE LOAD
EXTERIOR BALCONIES	10	60
DECKS, STAIRS	10	40
CEILING JOISTS / ATTICS NO STORAGE - SCUTTLE ACCESS ONLY ROOF SLOPE 3:12 OR LESS	10	10
CEILING JOISTS / ATTICS NO STORAGE - SCUTTLE ACCESS ONLY ROOF SLOPE OVER 3:12	10	10
CEILING JOISTS / ATTICS WITH STORAGE - DOOR PULL DOWN LADDER ACCESS	10	20
ROOMS: NON-SLEEPING	10	40
ROOMS: SLEEPING	10	30
ROOF: LIGHT ROOF COVERING	10	20
ROOF: HEAVY ROOF COVERING / CONCRETE / TILE / SLATE	20	20
GUARDRAILS, HANDRAILS	20# LL NORMAL	

HEAVY ROOF COVERING MATERIAL (TILE, CONCRETE, SLATE, ETC.) SHALL NOT BE USED UNLESS 20 PSF DEAD LOAD AND HEAVY ROOF IS NOTED ON THE ROOF PLAN. IF HEAVY ROOFING IS TO BE USED AND NOT NOTED ON THE ROOF PLAN NOTIFY ENGINEER PRIOR TO ANY CONSTRUCTION, INCLUDING FOUNDATION AND SITE WORK. IF THE PLAN HAS BEEN DESIGNED FOR HEAVY ROOF LOADS IT WILL BE NOTED IN THE ROOF NOTES ON THE ROOF PLAN.

## COLUMN SCHEDULE

BASED ON FOOTING SIZE (ASSUME 1500 PSF SOIL)

PAD SIZE	REINFORCEMENT	COL. MIN.	COL. TYPE	MAX. LOAD
24x24x12	(4) #4 BARS E/W	3"	SCH40	6K
30x30x12	(5) #4 BARS E/W	3"	SCH40	9.4K
36x36x12	(6) #4 BARS E/W	3"	SCH40	13.5K
42x42x14	(7) #4 BARS E/W	3 1/2"	SCH40	18.4K
48x48x16	(8) #4 BARS E/W	3 1/2"	SCH40	24.0K
54x54x16	(9) #4 BARS E/W	3 1/2"	SCH40	30.4K
60x60x18	(10) #4 BARS E/W	3 1/2"	SCH40	37.5K

COLUMN CONNECTION TO STEEL BEAMS SHALL BE WITH A CLIP POST CAP WITH ALL FOUR TAB EARS BENT AROUND THE BOTTOM FLANGE OF THE BEAM. FOR A BEARING PLATE, FOUR HOLES SHALL BE DRILLED IN THE BOTTOM FLANGE OF THE STEEL BEAM TO MATCH THE HOLE PATTERN OF THE PLATE. 1/2" X 2" BOLTS SHOULD THEN BE INSTALLED WITH A FLAT WASHER, LOCK WASHER, AND A NUT IN EACH OF THE HOLES. THE POST CAP MAY BE WELDED TO THE STEEL BEAM IN ACCORDANCE WITH AWS D1.1-92 AS AN ALTERNATIVE, AND WOULD NEED TO BE INSPECTED BY AN AWS-CERTIFIED INSPECTOR.

## ENGINEERED LUMBER

MIN. DESIGN REQUIREMENTS

	F <sub>x</sub> (psi)	E (psi)	F <sub>y</sub> (psi)
LVL	2600	1.8x10	285
GLULAM	2400	1.8x10	190
PARALAM	2600	2.0x10	290

**HD ENGINEERING & DESIGN, INC**  
 11666 W. 75TH STREET  
 SHAWNEE, KS 66214  
 WWW.HDENGINEERS.COM  
 913.651.2222  
 SERVICE@HDENGINEERS.COM



**CASTROP DESIGN GROUP**  
 LOT 1442 THE JEVON & JULIE MCBRIDE RESIDENCE  
 211 NW CARSON DRIVE, LEE'S SUMMIT, MO

STRUCTURAL DETAILS & NOTES


HD#: 40620  
 DATE: 12/14/2020  
 CHECKED BY: CLS

NO.	ISSUE/REVISION	Revision Date


GENERAL NOTES

# S-1.1

RELEASE FOR  
 CONSTRUCTION  
 AS NOTED ON PLANS REVIEW  
 DEVELOPMENT SERVICES  
 LEE'S SUMMIT, MISSOURI  
 12/15/2020

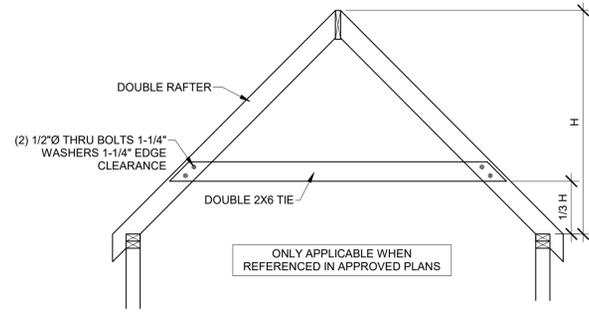


**11 HIP SUPPORT FRAME**  
3/8" = 1'-0"

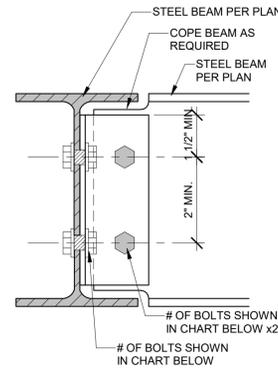


**10 BEAM TO GIRDER CONNECTION**  
3" = 1'-0"

BEAM CONNECTION SCHEDULE	
BEAM SIZE	# OF BOLT IN CONNECTION
W8, W10	2
W12, W14	3
W16, W18	4

NOTES:  
1. NUMBER OF BOLTS DETERMINED BY SMALLER OF TWO BEAMS BEING CONNECTED  
2. ALL BOLTS, 3/4" DIAMETER A325-N, UNO  
3. FULL PERIMETER 1/4" FILLET WELD MAY BE SUBSTITUTED FOR EITHER OR BOTH BOLTED CONNECTIONS

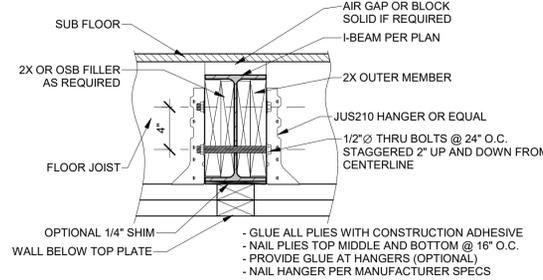


**8 UPSET STEEL BEAM DETAIL**  
1 1/2" = 1'-0"

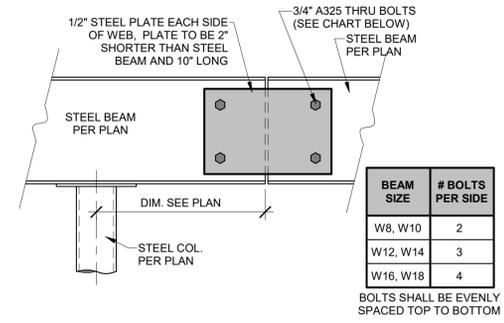


**9 STEEL BEAM SPLICE DETAIL**  
1 1/2" = 1'-0"

BEAM SIZE	# BOLTS PER SIDE
W8, W10	2
W12, W14	3
W16, W18	4


BOLTS SHALL BE EVENLY SPACED TOP TO BOTTOM

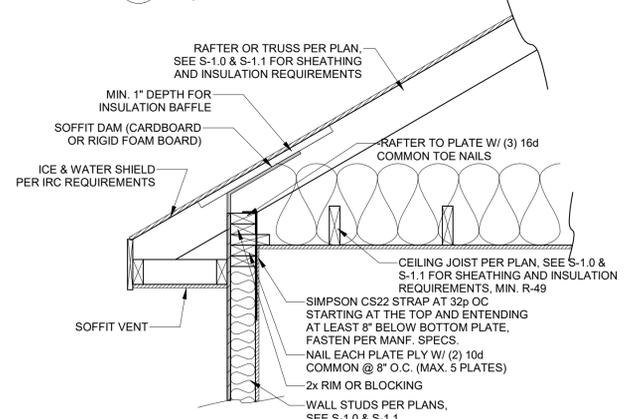


**7 OPTION 4 RAFTER BEARING**  
1" = 1'-0"

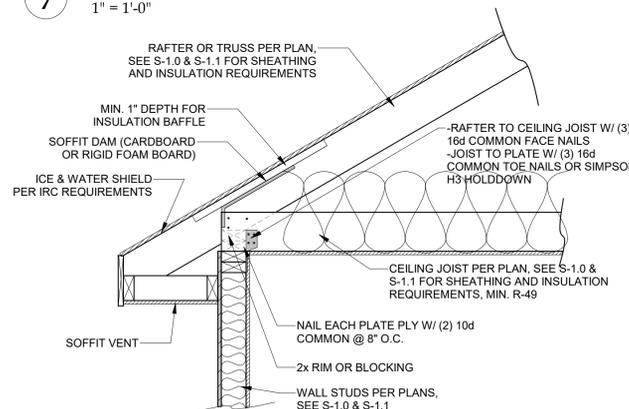

**6 OPTION 3 RAFTER BEARING**  
1" = 1'-0"

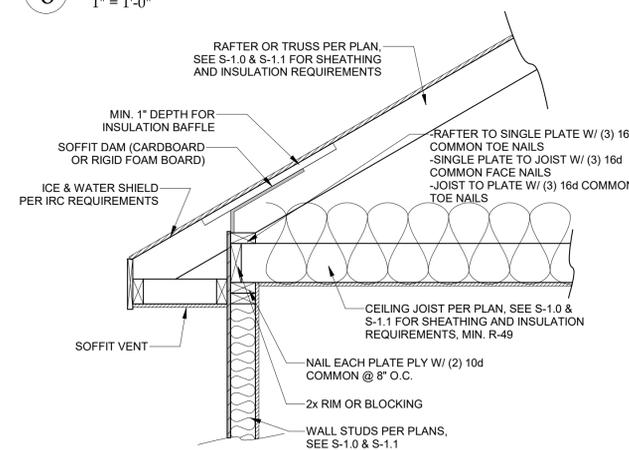

**5 OPTION 2 RAFTER BEARING**  
1" = 1'-0"  
THIS OPTION NOT AVAILABLE IN KC, MO

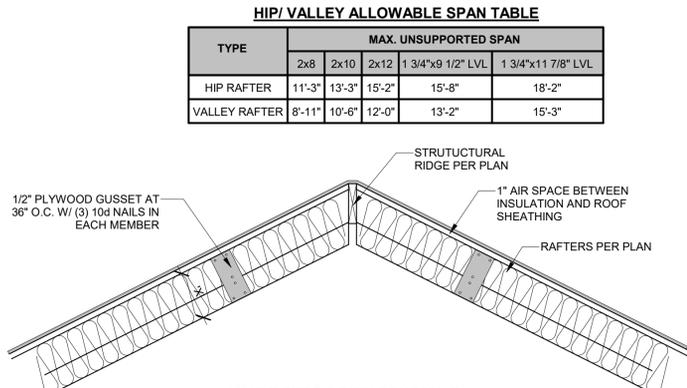


**14 VAULTED RAFTER INSULATION**  
3/4" = 1'-0"


TYPE	HIP/VALLEY ALLOWABLE SPAN TABLE				
	2x8	2x10	2x12	1 3/4"x9 1/2" LVL	1 3/4"x11 7/8" LVL
HIP RAFTER	11'-3"	13'-3"	15'-2"	15'-8"	18'-2"
VALLEY RAFTER	8'-11"	10'-6"	12'-0"	13'-2"	15'-3"

RAFTER SIZE	VAULT FURR DOWN SCHEDULE	
	R-30C INSULATION (X = 9 1/4")	R-38C INSULATION (X = 11 1/4")
2x6	2x6	2x8
2x8	2x4	2x6
2x10	NOT REQUIRED	2x4
2x12	NOT REQUIRED	2x2


NOTES:  
1. ALL VAULTS SHALL BE FURRED DOWN WITH 2x FRAMING TO THE REQUIRED DEPTH OF INSULATION, PLUS 1" AIR SPACE.  
2. R-38C REQUIRED = 11" WITH AIR SPACE.  
3. ALL VAULTED RAFTERS SHALL BE MIN. #2 2x6 DFL @ 16" O.C. OR PER ROOF PLAN.

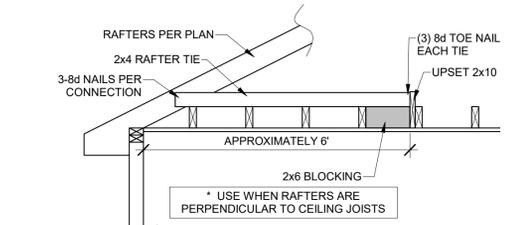


**12 RAFTER TIE CONNECTION**  
1/2" = 1'-0"

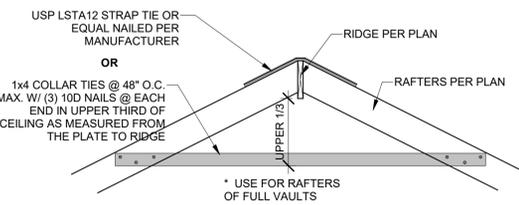


**13 RIDGE SUPPORT**  
1/2" = 1'-0"

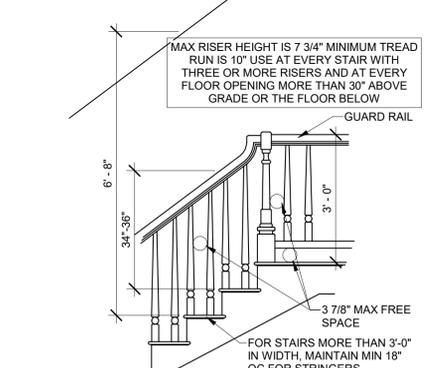


**4 STAIR/RAIL DETAIL**  
1/2" = 1'-0"

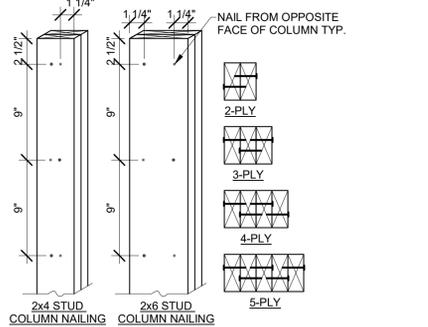

**3 BUILT-UP STUD COLUMN**  
1 1/2" = 1'-0"

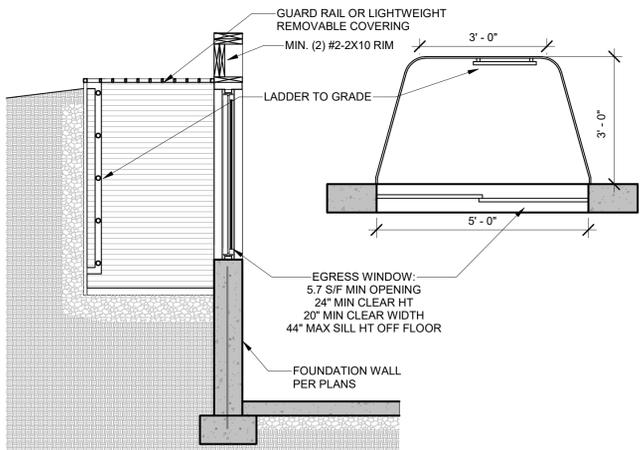

**2 EGRESS WINDOW SECTION**  
1/2" = 1'-0"

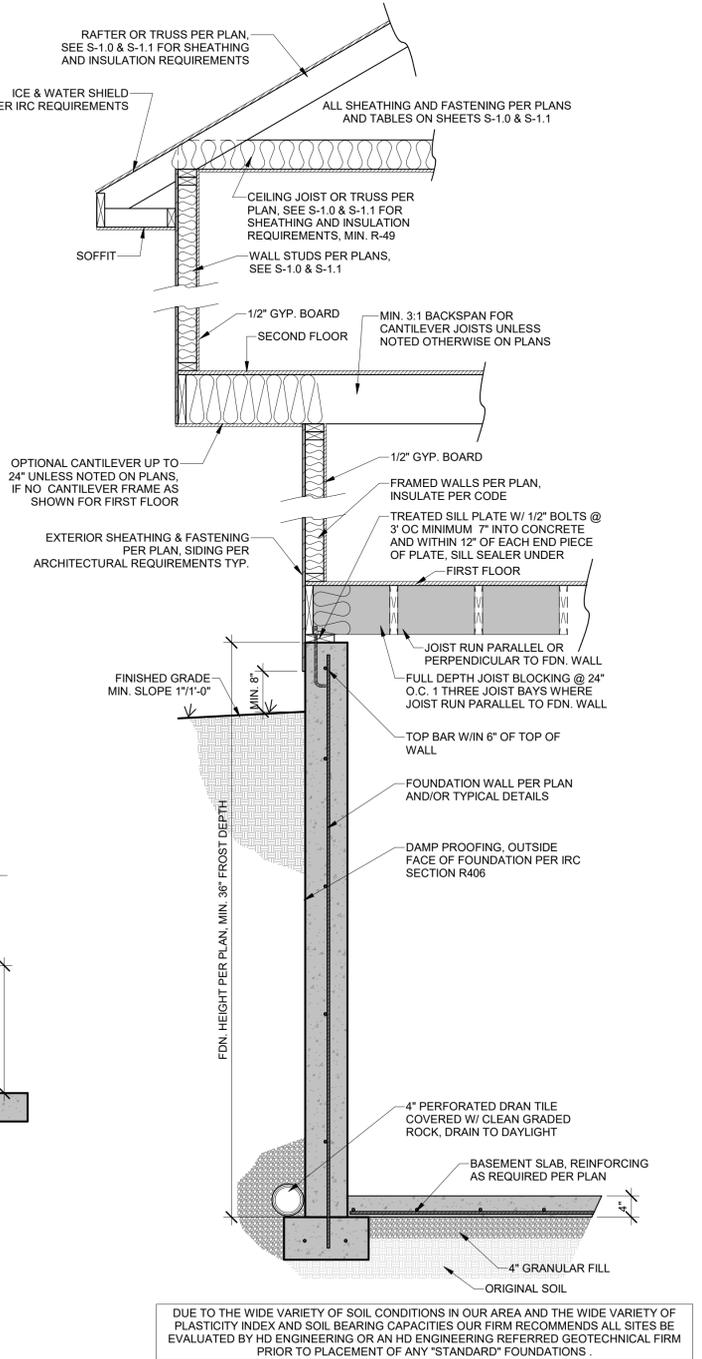

**1 TYPICAL WALL SECTION**  
3/4" = 1'-0"

DUE TO THE WIDE VARIETY OF SOIL CONDITIONS IN OUR AREA AND THE WIDE VARIETY OF PLASTICITY INDEX AND SOIL BEARING CAPACITIES OUR FIRM RECOMMENDS ALL SITES BE EVALUATED BY HD ENGINEERING OR AN HD ENGINEERING REFERRED GEOTECHNICAL FIRM PRIOR TO PLACEMENT OF ANY "STANDARD" FOUNDATIONS.

**HD ENGINEERING & DESIGN, INC**  
11666 W. 75TH STREET  
SHAWNEE, KS 66214  
WWW.HDENGINEERS.COM  
913.631.2222  
SERVICE@HDENGINEERS.COM



**CASTROP DESIGN GROUP**  
LOT 1442 THE JEVON & JULIE MCBRIDE RESIDENCE  
211 NW CARSON DRIVE, LEE'S SUMMIT, MO

HD#: 40620

DATE: 12/14/2020  
CHECKED BY: CLS

NO.	ISSUE/REVISION	Revision Date

FRAMING SECTIONS

**S-1.2**

RELEASE FOR  
CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
12/15/2020



**CASTROP DESIGN GROUP**  
 LOT 1442 THE JEVON & JULIE MCBRIDE RESIDENCE  
 211 NW CARSON DRIVE, LEE'S SUMMIT, MO


STRUCTURAL DETAILS & NOTES

HD#: 40620  
 DATE: 12/14/2020  
 CHECKED BY: CLS


NO.	ISSUE/REVISION	Revision Date

DECK DETAILS


**S-1.3**

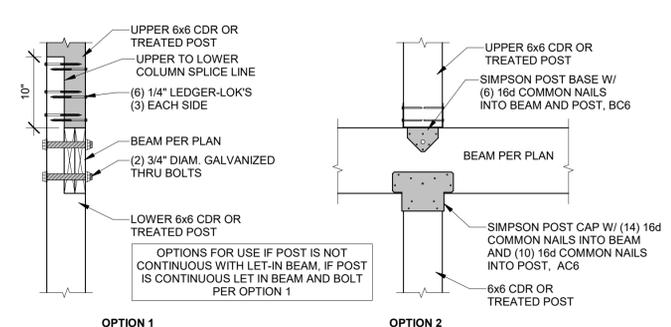


**6 DECK LEVEL INTERIOR BEAM TO COLUMN**  
 1" = 1'-0"

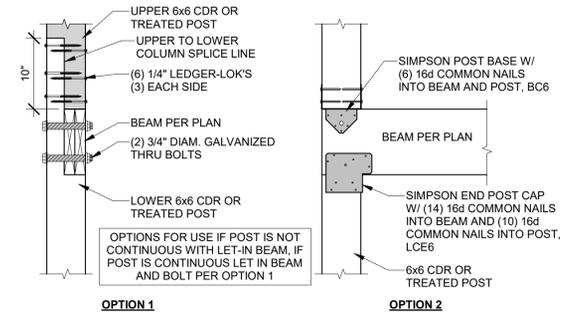


**5 DECK LEVEL EXTERIOR BEAM TO COLUMN**  
 1" = 1'-0"

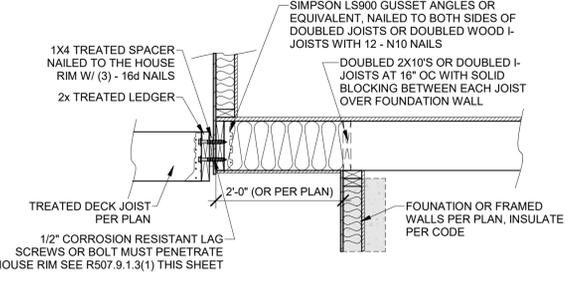


**4 DECK LEDGER TO CANTILEVER**  
 3/4" = 1'-0"

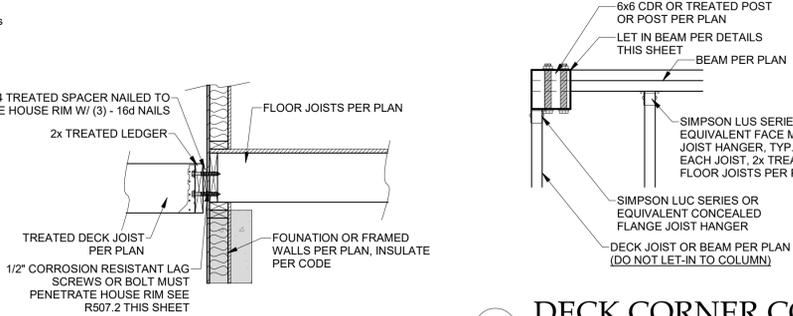


**2 DECK LEDGER ATTACHMENT**  
 3/4" = 1'-0"

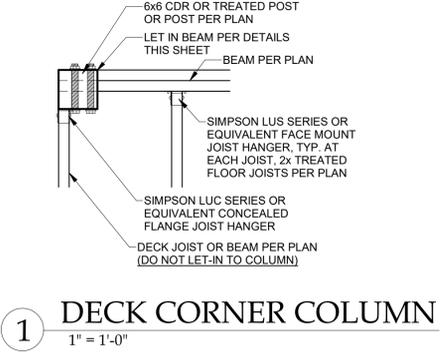


**1 DECK CORNER COLUMN**  
 1" = 1'-0"

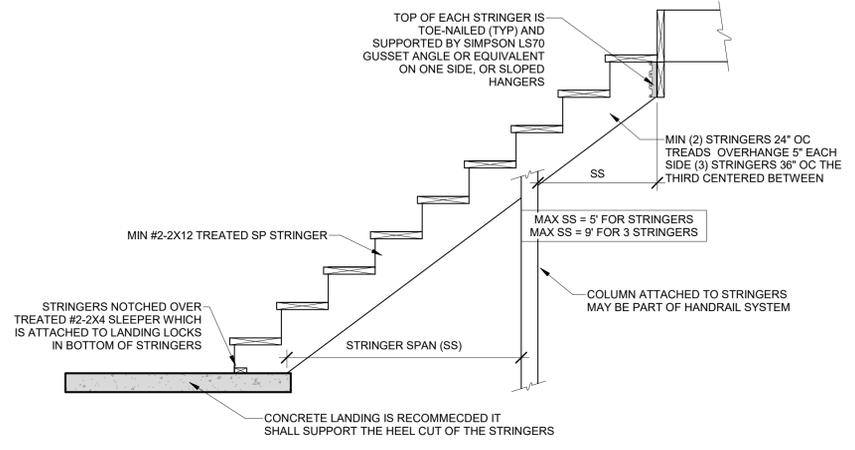

**9 STAIR STRINGER DETAIL**  
 1/2" = 1'-0"

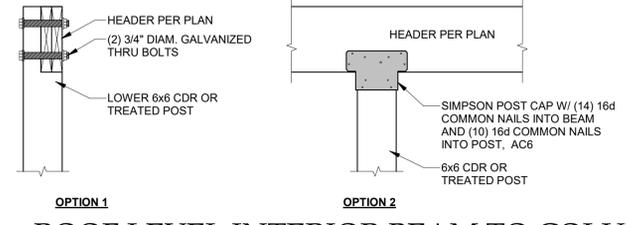

**7 ROOF LEVEL INTERIOR BEAM TO COLUMN**  
 1" = 1'-0"

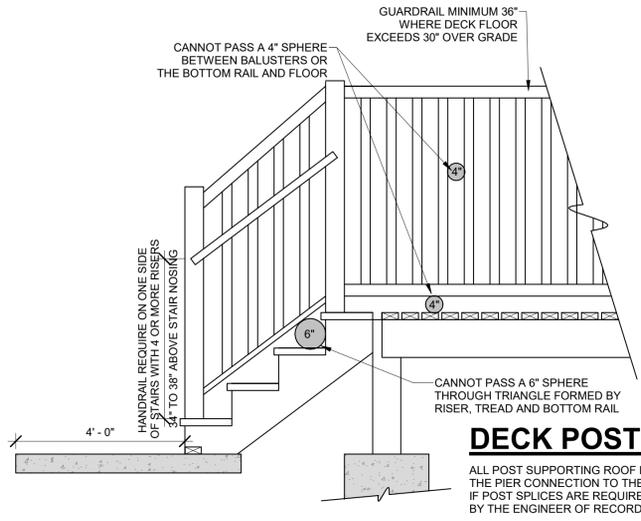

**8 GUARD RAIL**  
 1/2" = 1'-0"

**DECK POST NOTE**

ALL POST SUPPORTING ROOF LOADS SHALL BE CONTINUOUS FROM THE PIER CONNECTION TO THE ROOF SUPPORTING STRUCTURE. IF POST SPLICES ARE REQUIRED THE SPLICE SHALL BE ENGINEERED BY THE ENGINEER OF RECORD FOR THE PROJECT

**TABLE IRC2018 R507.9.1.3(1) DECK LEDGER CONNECTION TO BAND JOIST**  
 (DECK LIVE LOAD = 40 PSF, DECK HEAD LOAD = 10 PSF, SNOW LOAD ≤ 40 PSF)

JOIST SPAN	6' AND LESS	6'-1" TO 8'	8'-1" TO 10'	10'-1" TO 12'	12'-1" TO 14'	14'-1" TO 16'	16'-1" TO 18'
CONNECTION DETAILS	ON-CENTER SPACING OF FASTENERS <sup>a, b</sup>						
1/2" LAG SCREW WITH 15/32" MAX. SHEATHING <sup>c, d</sup>	30	23	18	15	13	11	10
1/2" DIAM. BOLT WITH 15/32" MAX. SHEATHING <sup>d</sup>	36	36	34	29	24	21	19
1/2" DIAM. BOLT WITH 15/32" MAX. SHEATHING & 1/2" STACKED WASHERS <sup>e</sup>	36	36	29	24	21	18	16

For SI: 1 inch = 25.4mm, 1 foot = 304.8mm, 1 pound per square foot = 0.0479 kPa  
 a. Ledges shall be flashed in accordance with Section R703.4 to prevent water from contacting the house band joist.  
 b. Snow load shall not be assumed to act concurrently with live load.  
 c. The tip of the lag screw shall fully extend beyond the inside face of the band joist.  
 d. Sheathing shall be wood structural panel or solid sawn lumber.  
 e. Sheathing shall be permitted to be wood structural panel, gypsum board, fiberboard lumber or foam sheathing. Up to 1/2" thickness of stacked washers shall be permitted to substitute for you to 1/2" of allowable sheathing thickness where combined with wood structural panel or lumbers sheathing.

**TABLE IRC2018 R507.9.1.3(2) PLACEMENT OF LAG SCREWS AND BOLT IN DECK LEDGERS AND BAND JOISTS**

MINIMUM END AND EDGE DISTANCES AND SPACING BETWEEN ROWS				
	TOP EDGE	BOTTOM EDGE	ENDS	ROW SPACING
LEDGER <sup>a</sup>	2 inches <sup>d</sup>	3/4 inches	2 inches <sup>b</sup>	1 5/8 inches <sup>b</sup>
BAND JOIST <sup>c</sup>	3/4 inches	2 inches	2 inches	1 5/8 inches <sup>b</sup>

For SI: 1 inch = 25.4mm.  
 a. Lag screws or bolts shall be staggered from the top to the bottom along the horizontal run of the deck ledger in accordance with Figure R507.9.1.3(1)  
 b. Maximum: 5 inches  
 c. For engineered rim joists, the manufacturer's recommendations shall govern.  
 d. The minimum distances from bottom row of lag screws or bolts to the top of the ledger shall be in accordance with Figure R507.9.1.3(1)

RESIDENTIAL SEISMIC & WIND ANALYSIS			
DETERMINE WEIGHT OF HOUSE:		INPUT	
LOCATION	DEAD LOAD (psf)	AREA (ft <sup>2</sup> )	WEIGHT (lbs.)
ROOF	10	5120	51200
CEILING	10	5017	50170
FIRST FLOOR	10	3174	31740
FIRST FLOOR EXT. WALL DL	WALL LENGTH (ft)	WALL HEIGHT (ft)	WALL UNIT WT. (psf)
	338.82	10	33882
FIRST FLOOR INT. PARTITION WALL DL	DEAD LOAD (psf)	AREA (ft <sup>2</sup> )	WEIGHT (lbs.)
	8	3174	18044

PROJECTED AREAS (WIND DESIGN PER 115 MPH 3-SECOND GUST, EXPOSURE C AND MEAN ROOF HEIGHT = 30 FT ASSUMED)					
FRONT-TO-BACK			SIDE-TO-SIDE		
AREA	LOAD	AREA	LOAD	AREA	LOAD
SLOPED ROOF	1015	8627	SLOPED ROOF	776	6602
VERT. ROOF	772	8643	CUMULATIVE VERT. ROOF	216	2688
1ST	936.76	11634	1ST	926.75	11521
PRESSURE (PSF) - PER ASCE CH. 6		PRESSURE (PSF) - PER ASCE CH. 6		2x (FIG. 28.8-1, ASCE7)	
SLOPED ROOF	ZONE B	11.3	11.3	2x (FIG. 28.8-1, ASCE7)	18.85
WALL/VERT. ROOF	ZONE A	14.2	14.2		
MEAN ROOF HT., ft	20				

a) If there is a walkout wall to be sheathed, determine tributary wind area and enter here. If no walkout, enter 0 for area.  
 $q_{w0} = 0.00256K_z K_{d} K_{x} V^2$  (ASCE7-10 Velocity Pressure)  
 $q_{w0} = 0.00256K_z K_{d} K_{x} V^2$  (Design Velocity Pressure for ASD analysis under ASCE7-10 and IRC/IBC 2012)

1ST FLOOR TRIBUTARY WEIGHT		118311
S <sub>s</sub> (SITE GROUND MOTION - %g - FROM ASCE7 SEISMIC MAP)		12.0%
F <sub>s</sub> (FROM ASCE7 TABLE 11.4-1)		1.6
S <sub>ds</sub> (F 2.3 * S <sub>s</sub> * F <sub>s</sub> )		0.128
R (FROM ASCE7 TABLE 12.2-1)		6.5

SEISMIC SHEAR			
From ASCE7 (Eq. 12.8-1)			V = 1.2 * S <sub>ds</sub> * W / R (lbs.)
LOCATION	1ST FLOOR		2796

Sheathing Location	Min. Sheathing Schedule	Fastening Schedule	Allowable Shear (kLF)	Code Reference
Exterior (Option #4)	7/16" APA Rated Plywood/OSB or shiplap panel sheathing, or 3/8" shiplap panel sheathing with tighter nail spacing	8d Common Nails w/ 1-3/8" penetration @ 6" O.C. Edges, 12" O.C. Field for 7/16" APA-rated plywood/OSB or shiplap panel sheathing OR @ 4" O.C. Edges, 12" O.C. Field for 3/8" shiplap panel sheathing	220	AF&PA SDPWS Table 4.3A
Exterior (Option #5)	7/16" APA Rated Plywood/OSB or shiplap panel sheathing, or 3/8" shiplap panel sheathing with tighter nail spacing	8d Common Nails w/ 1-3/8" penetration @ 4" O.C. Edges, 12" O.C. Field for 7/16" APA-rated plywood/OSB or shiplap panel sheathing OR @ 3" O.C. Edges, 12" O.C. Field for 3/8" shiplap panel sheathing	320	AF&PA SDPWS Table 4.3A
Exterior (Option #6)	7/16" APA Rated Plywood/OSB or shiplap panel sheathing, or 3/8" shiplap panel sheathing with tighter nail spacing and double studs at each panel edge	8d Common Nails w/ 1-3/8" penetration @ 3" O.C. Edges, 12" O.C. Field	410	AF&PA SDPWS Table 4.3A
Interior	1/2" Gypsum Board	No. 6 - 1/2" Type W or S Screws @ 8" O.C. Edges, 12" O.C. Field	60	per IBC, Table 2306.4.4
Interior	16 Ga. Simpson/USP Type WB Steel X-Brace (or equal)	(3) 16d @ end studs & (1) 8d @ intermediate studs (per manufacturer specifications - see detail on sheet S3)	325	

EXTERIOR SHEATHING OPTION FOR FIRST FLOOR		4
WIDTH OF 1ST STORY (FT.)	85.16	
DEPTH OF 1ST STORY (FT.)	84.25	
BACK WALL OF GARAGE (FT.)	22.5	
GAR. WALL: 1-F-B, 2-S-S	2	

EXTERIOR STRUCTURAL WALL LENGTHS (ft.) & RESISTANCES								
SEISMIC				WIND				
FRONT-TO-BACK	RESISTANCE (lbs.)	SIDE-TO-SIDE	RESISTANCE (lbs.)	FRONT-TO-BACK	RESISTANCE (lbs.)	SIDE-TO-SIDE	RESISTANCE (lbs.)	
1ST FLOOR	109.32	30610	115.5	32340	109.32	42853	115.5	45276

ADDITIONAL RESISTANCE REQUIRED		Anchor Bolt Spacing (in.)		16d Nail Spacing req'd at bottom plate (in.)	
SEISMIC	WIND	diameter (in.)	1st Floor F-B	1st Floor F-B	1st Floor S-S
0	0	0.5	16	16	22
0	0	144			
0	0	104.5			
0	0	147.6			


RESISTANCE REQUIRED IN ADDITION TO RESISTANCE PROVIDED BY EXTERIOR WALLS**							
1ST FLOOR FRONT-TO-BACK	ADDITIONAL RESISTANCE REQUIRED (POUNDS)	PORTAL FRAMES OR PERF. SHEAR WALL RESISTANCE	INTERIOR X-BRACES (325#BRACE)	INTERIOR WALL LENGTH W/ 1/2" GYPSUM BOARD PER TABLE (FT)	INT. WALL LENGTH SHEATHED W/ OSB (TOTAL LENGTH, ONE SIDE, FT.)	RESISTANCE PROVIDED BY ADDITIONAL METHODS (POUNDS)	OK?
1ST FLOOR FRONT-TO-BACK	0	0	0	0	0	0	YES
1ST FLOOR SIDE-TO-SIDE	0	0	0	0	0	0	YES

WIND UPLIFT ANALYSIS							
ROOF PITCH (MAX)	X/12	DEGREES	PITCH OF 6 OR LESS: EOH -13.3, E-7.2, G-5.2	ASCE 7			
OVERHANG	LENGTH (FT.)	PRESSURE (PSF)	LINEAL FT. OF OH	UPLIFT PER FT. (LBS)			
		-1.08	340.82	-1.08			
	TOTAL AREA (FT <sup>2</sup> )	ZONE E AREA (FT <sup>2</sup> )	ZONE G AREA (FT <sup>2</sup> )	PRESSURE ZN. E (PSF)	TOTAL FORCE (LBS)	FORCE PER LINEAL FT. @ PERIMETER (LBS)	
	7174.73	-1068.29	8243.02	-1.08	-6.36	-1814	-5.4


NOTE FOR CONSTRUCTION: THE CONTINUOUS STRUCTURAL PANEL SHEATHING BRACING METHOD REQUIRES USE OF THE ABOVE TABLE FOR SHEATHING OF THE ENTIRE STRUCTURE. IN ADDITION, FRAMING MEMBERS SHALL BE @ 16" O.C. MAX UNBLOCKED, AND W/ SHEATHING APPLIED DIRECTLY TO FRAMING MEMBERS.

NOTE FOR DESIGN: ALL WALLS USED IN THE CALCULATION OF THE RESISTANCE FOR THIS STRUCTURE SHALL HAVE A MINIMUM UNINTERRUPTED HEIGHT OF 8'-0" AND LENGTH OF 2'-8". ALLOWABLE RESISTANCES HAVE BEEN #IFT AND INCREASED BY 40% FOR WIND LOADS, PER VALUES IN 2012 IBC SECTION 2306 AND AF&PA SDPWS TABLE 4.3A. FOR EXAMPLE, 7/16" APA-RATED SHEATHING WITH 8d @ 6" & 12" HAS A SEISMIC SHEAR VALUE OF 22 A WIND SHEAR VALUE OF 335#/FT. 40% GREATER THAN THAT OF SEISMIC.


NOTE: SOIL SITE CLASS ASSUMED TO BE CLASS D. IF SITE CONDITIONS ARE DETERMINED TO BE CLASS E OR F, CONSULT ENGINEER BEFORE PROCEEDING WITH CONSTRUCTION.

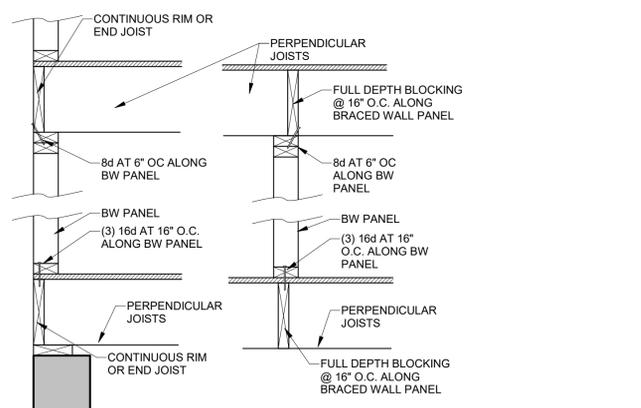

3 BRACED WALL PANEL CONNECTIONS  
1" = 1'-0"

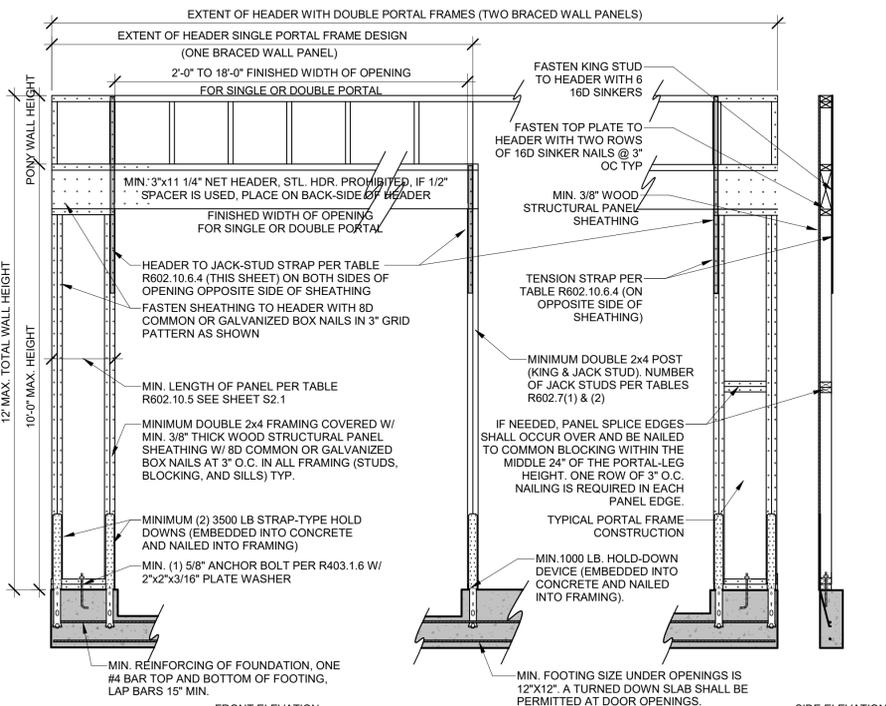

1 PFH PORTAL FRAME W/ HOLD DOWNS (R602.10.6.2)  
1/2" = 1'-0"

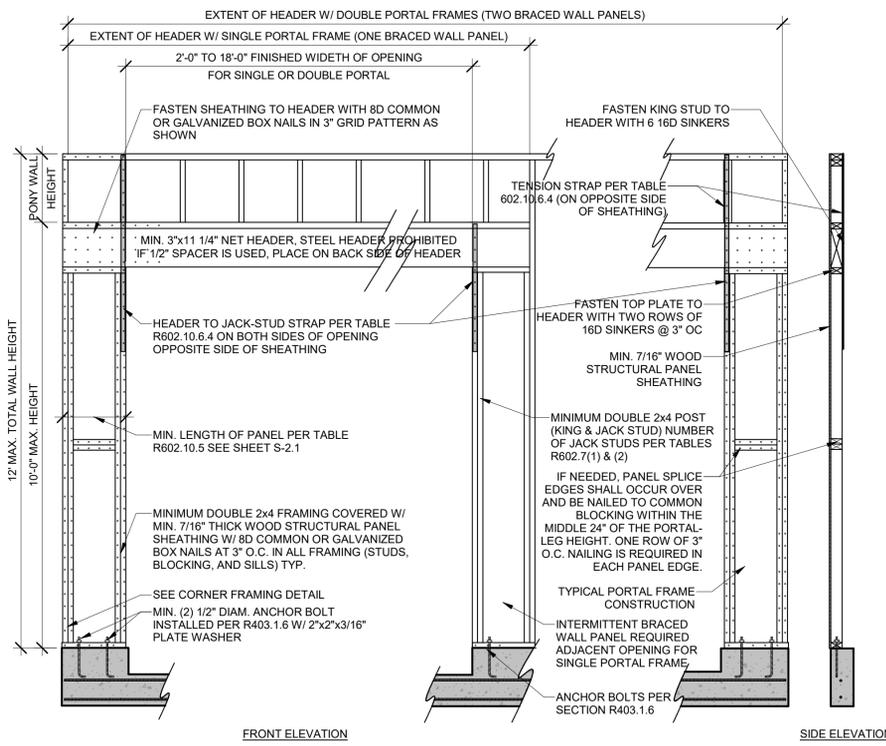

2 PFG PORTAL FRAME W/OUT HOLD DOWNS (R602.10.6.3)  
1/2" = 1'-0"

HD ENGINEERING & DESIGN, INC  
11656 W. 75TH STREET  
SHAWNEE, KS 66214  
WWW.HDENGINEERS.COM  
913.631.2222  
SERVICE@HDENGINEERS.COM



CASTROP DESIGN GROUP  
LOT 1442 THE JEVON & JULIE MCBRIDE RESIDENCE  
211 NW CARSON DRIVE, LEE'S SUMMIT, MO  
STRUCTURAL DETAILS & NOTES

HD#: 40620  
DATE: 12/14/2020  
CHECKED BY: CLS


NO.	ISSUE/REVISION	Revision Date

BRACED WALL NOTES & DETAILS

S-2.0

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
12/15/2020

## TENSION STRAP CAPACITY REQUIRED FOR RESISTING WIND PRESSURES PERPENDICULAR TO METHOD PFH, PFG AND CS-PF BRACED WALL PANELS IRC2018 TABLE R602.10.6.4

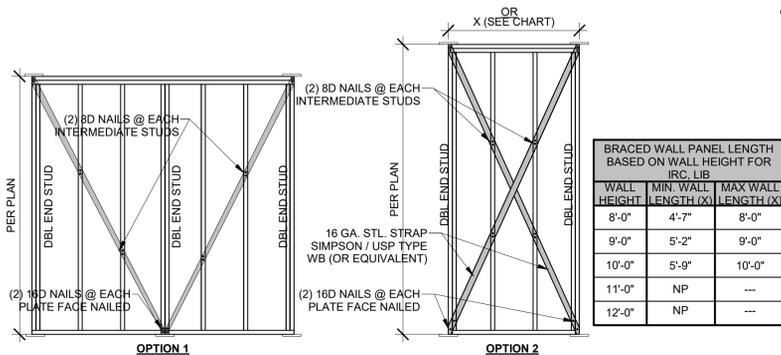

**6 LIB BRACING**  
3/8" = 1'-0"

FOR IRC CODE PRESCRIPTIVE METHOD  
**TABLE R602.10.5 MINIMUM LENGTH OF BRACED WALL PANELS**

METHOD (SEE TABLE R602.10.4)	MINIMUM LENGTH (INCHES) <sup>a</sup>					CONTRIBUTING LENGTH (INCHES)	
	WALL HEIGHT						
	8 FEET	9 FEET	10 FEET	11 FEET	12 FEET		
DWB,WSP,SFB,PBS,PCP,HPS,BV-WSP	48	48	48	53	58	ACTUAL <sup>b</sup>	
GB	48	48	48	53	58	DOUBLE SIDED = ACTUAL SINGLE SIDED = .5xACTUAL	
LIB	55	62	69	NP	NP	ACTUAL <sup>b</sup>	
ABW	SDC A, B, AND C ULTIMATE DESIGN WIND SPEED <140	28	32	34	38	42	48
	SDC D, D <sub>1</sub> ULTIMATE DESIGN WIND SPEED <140	32	32	34	NP	NP	
PFH	SUPPORTING ROOF ONLY	16	16	16	NOTE C	NOTE C	48
	SPTNG. ONE STORY & ROOF	24	24	24	NOTE C	NOTE C	
PFG	24	27	30	NOTE D	NOTE D	1.5 x ACTUAL <sup>b</sup>	
CS-G	24	27	30	33	36	ACTUAL <sup>b</sup>	
CS-PF	16	18	20	NOTE E	NOTE E	ACTUAL <sup>b</sup>	
CS-WSP, CS-SFB	ADJACENT CLEAR OPENING HEIGHT (INCHES)					ACTUAL <sup>b</sup>	
	≤64	24	27	30	33		36
	68	26	27	30	33		36
	72	27	27	30	33		36
	76	30	29	30	33		36
	80	32	30	30	33		36
	84	35	32	32	33		36
	88	38	35	33	33		36
	92	43	37	35	35		36
	96	48	41	38	36		36
	100	-	44	40	38		38
	104	-	49	43	40		39
	108	-	54	46	43		41
	112	-	-	50	45		43
	116	-	-	55	48		45
	120	-	-	60	52		48
124	-	-	-	56	51		
128	-	-	-	61	54		
132	-	-	-	66	58		
136	-	-	-	-	62		
140	-	-	-	-	66		
144	-	-	-	-	72		

<sup>a</sup> LINEAR INTERPOLATION SHALL BE PERMITTED  
<sup>b</sup> USE THE ACTUAL LENGTH WHEN IT IS GREATER THAN OR EQUAL TO THE MINIMUM LENGTH  
<sup>c</sup> MAX. HEADER HEIGHT FOR PFH IS 10' IN ACCORDANCE WITH R602.10.6.2. WALL HEIGHT MAY BE INCREASED TO 12' WITH PONY WALL.  
<sup>d</sup> MAX. OPENING HEIGHT FOR PFH IS 10' IN ACCORDANCE WITH R602.10.6.3. WALL HEIGHT MAY BE INCREASED TO 12' WITH PONY WALL.  
<sup>e</sup> MAX. OPENING HEIGHT FOR CS-PF IS 10' IN ACCORDANCE WITH R602.10.6.4. WALL HEIGHT MAY BE INCREASED TO 12' WITH PONY WALL.

**BRACED WALL PRESCRIPTIVE METHOD:**  
CONTINUOUS EXTERIOR SHEATHING (CS-WSP) PER WSP METHOD (BELOW) UNLESS OTHERWISE NOTED ON THE PLAN

**EXTERIOR BRACED WALL METHOD: (SEE ON THIS SHEET)**

WOOD STRUCTURAL PANEL SHEATHING WITH A THICKNESS NOT LESS THAN 3/8" WITH MINIMUM SPAN RATING OF 24/0 FOR 16" O.C. STUD SPACING WITH 8d COMMON NAILS @ 6" O.C. EDGES AND 12" O.C. FIELD OR SHEATHING THICKNESS NOT LESS THAN 7/16" WITH MINIMUM SPAN RATING OF 24/16 FOR 24" O.C. SPACING WITH 8d COMMON NAILS @ 6" O.C. EDGES AND 12" O.C. IN FIELD (NOTE: FRAMING MEMBERS 16" O.C. MAX. UNBLOCKED, AND W/ SHEATHING APPLIED DIRECTLY TO FRAMING MEMBERS).

**INTERIOR BRACED WALLS (SEE ON THIS SHEET)**

**GB METHOD:**  
1/2" MINIMUM GYPSUM BOARD OVER STUDS SPACED @ 24" MAXIMUM FASTENED W/ #6- 1 1/4" TYPE "W" OR "S" DRYWALL SCREWS @ 7" O.C. EDGES AND FIELD (MIN. 4'-0" SECTION FOR BOTH SIDES)  
OR




**LIB METHOD:**  
1x4 WOOD FASTENED W/ (3) 8d COMMON NAILS OR SIMPSON / USP 16 GA. TYPE WB (OR EQUIVALENT) STL. X-BRACE(S) @ 45° TO 60° ANGLES, MAXIMUM 16" O.C. STUDS FASTENED PER MANUF. SPECS.

MINIMUM WALL STUD FRAMING NOMINAL SIZE & GRADE	MAX. PONY WALL HEIGHT (FEET)	MAX. TOTAL WALL HEIGHT (FEET)	MAX. OPENING WIDTH (FEET)	TENSION STRAP CAPACITY REQUIRED (POUNDS) <sup>a</sup>	
				ULTIMATE DESIGN WIND SPEED V (MPH)	
				115	115
				EXPOSURE B	EXPOSURE C
2X4 NO. 2 GRADE	0	10	18	1,000	1,000
			9	1,000	1,000
			16	1,025	2,500
			18	1,275	2,850
			9	1,000	1,875
			16	2,175	4,125
	2	10	18	2,500	DR
			9	1,500	3,175
			16	3,375	DR
			18	3,975	DR
			9	2,750	DR
			12	3,775	DR
2X6 STUD GRADE	2	12	9	1,000	2,025
			16	2,150	3,675
			18	2,550	DR
			9	1,750	3,125
			16	2,400	DR
			18	3,800	DR
	4	12	9	1,500	3,175
			16	3,375	DR
			18	3,975	DR
			9	2,750	DR
			12	3,775	DR
			18	3,800	DR

<sup>a</sup> DR = DESIGN REQUIRED  
<sup>b</sup> STRAP SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.


### END WALL CONDITIONS

FOR CONTINUOUSLY SHEATHED BRACED WALL LINES

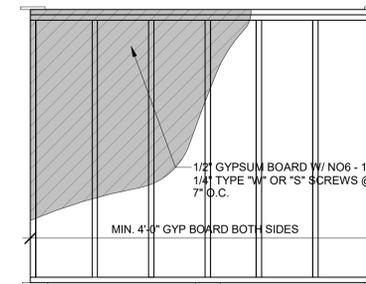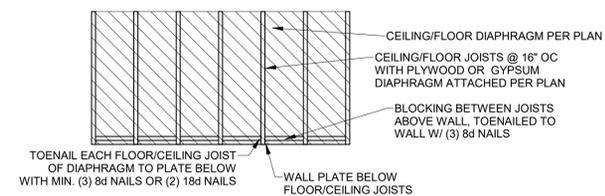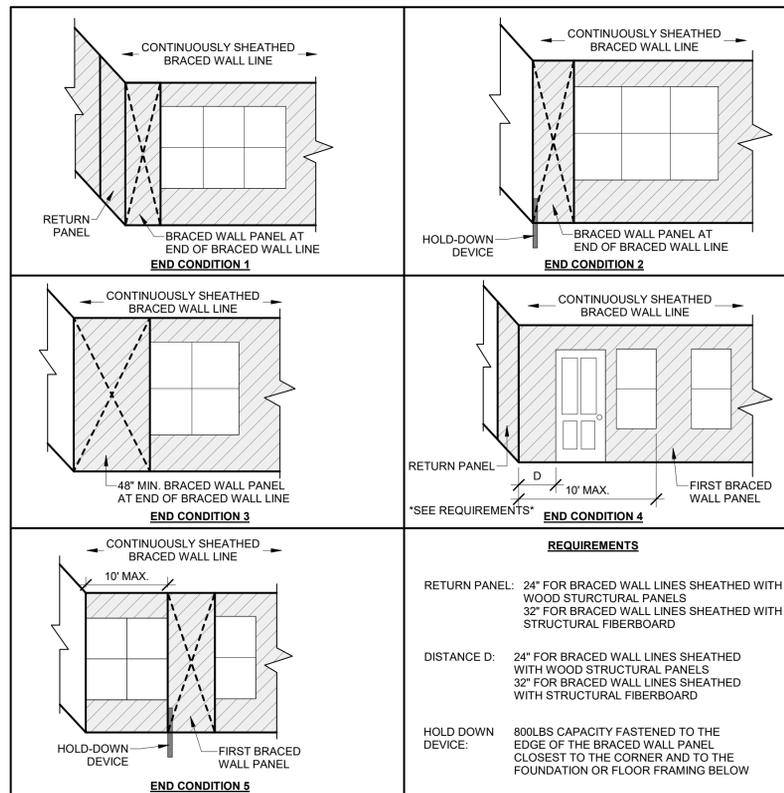


### FRONT ELEVATION

EXTENT OF HEADER WITH DOUBLE PORTAL FRAMES (TWO BRACED WALL PANELS)

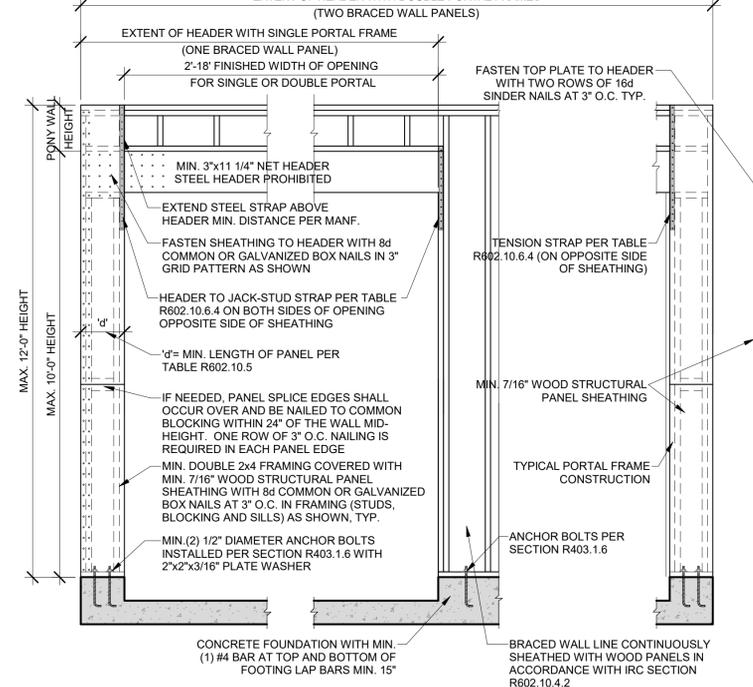


### OVER CONCRETE OR MASONRY BLOCK FOUNDATION

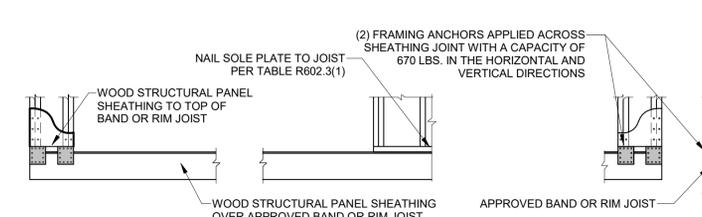

### OVER RAISED WOOD FLOOR - FRAMING ANCHOR OPTION

(WHEN PORTAL SHEATHING DOES NOT LAP OVER BAND OR RIM JOIST)


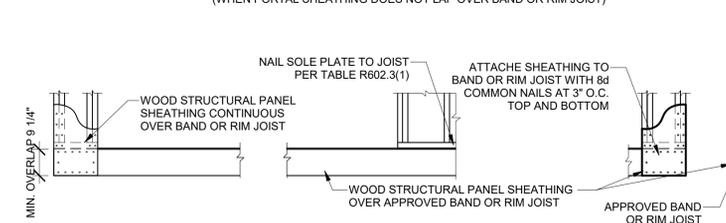


### OVER RAISED WOOD FLOOR - OVERLAP OPTION

(WHEN PORTAL SHEATHING LAPS OVER BAND OR RIM JOIST)

**4 CS-PF**  
1/2" = 1'-0"

**HD ENGINEERING & DESIGN, INC**  
 11666 W. 75TH STREET  
 SHAWNEE, KS 66214  
 WWW.HDENGINEERS.COM  
 913.631.2222  
 SERVICE@HDENGINEERS.COM



**CASTROP DESIGN GROUP**  
 LOT 1442 THE JEVON & JULIE MCBRIDE RESIDENCE  
 211 NW CARSON DRIVE, LEE'S SUMMIT, MO  
 STRUCTURAL DETAILS & NOTES


HD#: 40620

DATE: 12/14/2020  
 CHECKED BY: CLS



NO.	ISSUE/REVISION	Revision Date

BRACED WALLS NOTES & DETAILS


S-2.1

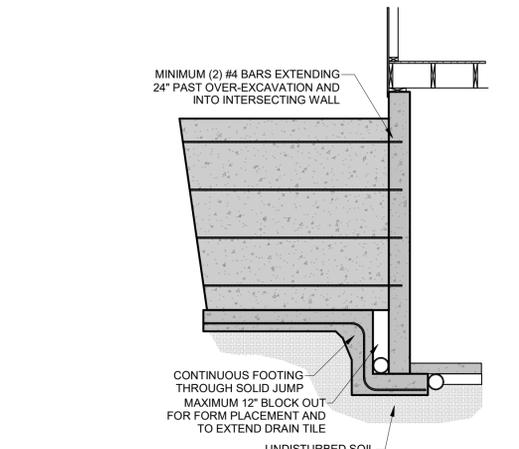


**1 SOLID FOOTING JUMP DETAIL**  
3/8" = 1'-0"

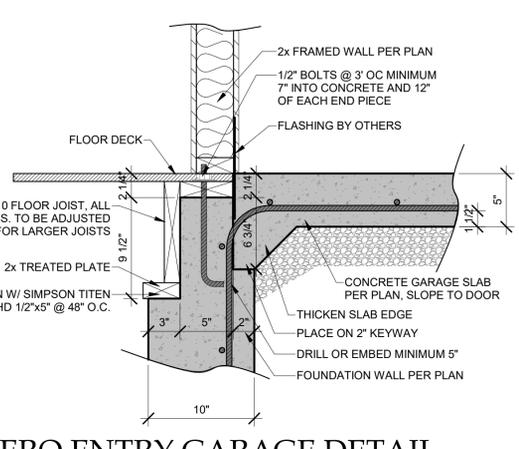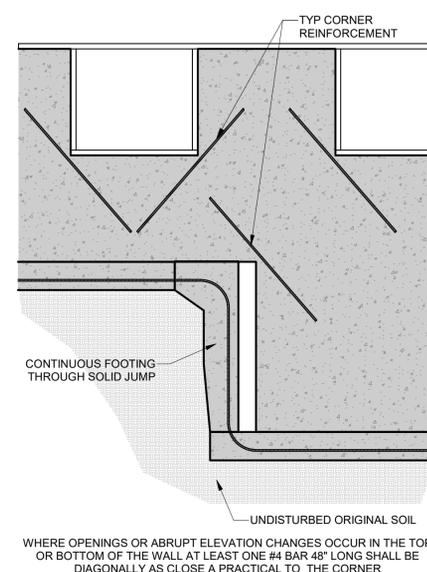


**6 ZERO ENTRY GARAGE DETAIL**  
1 1/2" = 1'-0"

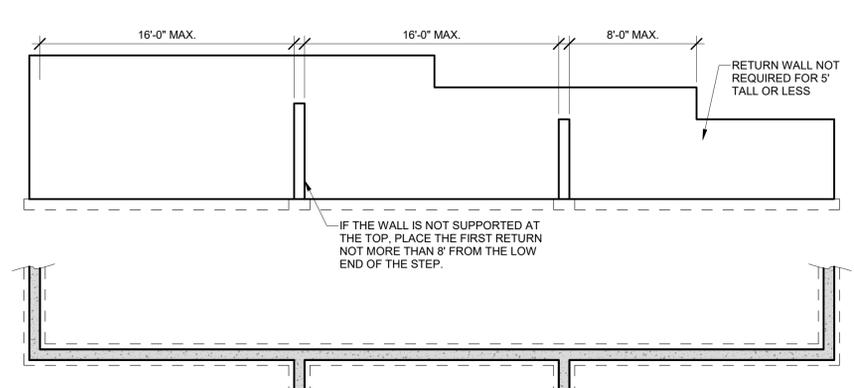

**4 RETURN WALL PLACEMENT**  
3/16" = 1'-0"

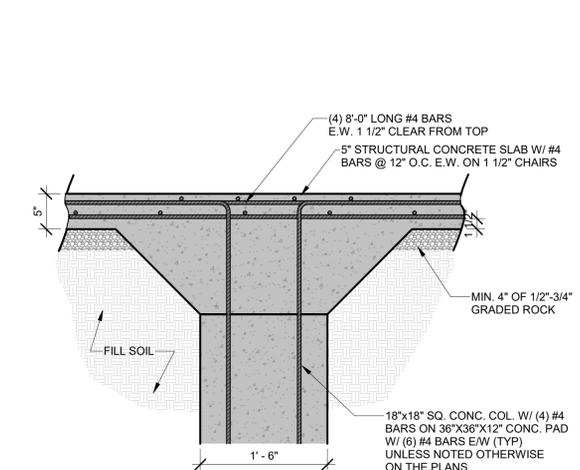


**3 GARAGE SLAB COLUMN DETAIL**  
1" = 1'-0"

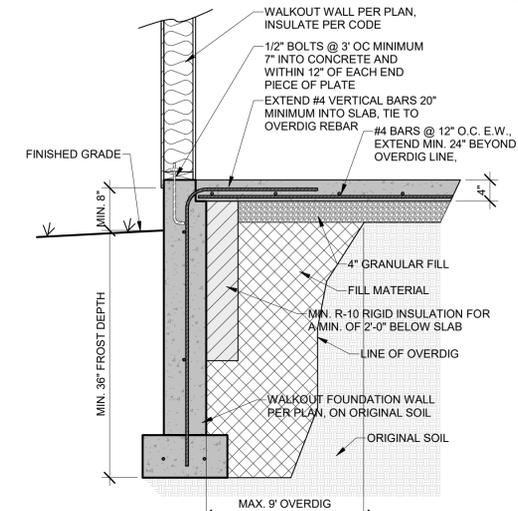


**10 WALKOUT DETAIL**  
3/4" = 1'-0"


**9 REINFORCEMENT AT CORNERS AND STEPS**  
1/2" = 1'-0"

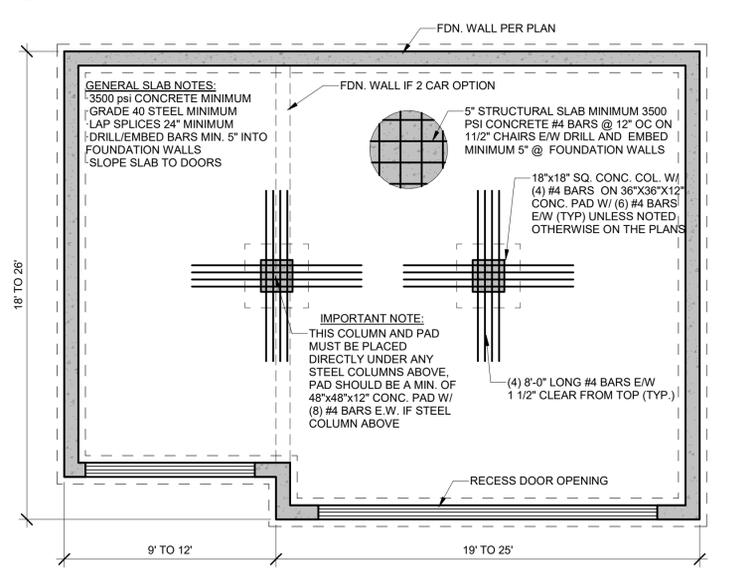

**5 TYPICAL GARAGE SLAB**  
1/4" = 1'-0"

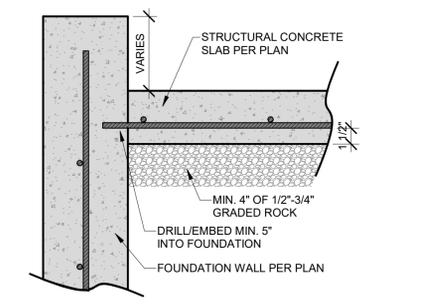

**8 STRUCTURAL SLAB/ WALL**  
1 1/2" = 1'-0"

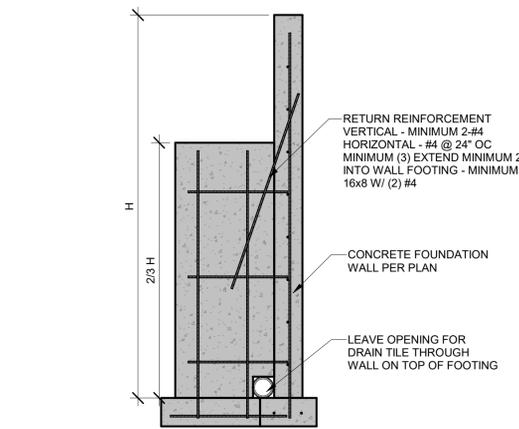


**2 RETURN WALL DETAIL**  
1/2" = 1'-0"

CONCRETE STRENGTH	VERTICAL REINFORCEMENT SPACING*				
	8" THICK WALL		10" THICK WALL		
3000 PSI/ 40 KSI	16	12	24	16	12
3500 PSI/ 40 KSI	16	12	24	24	12
3000 PSI/ 60 KSI	24	16	24	20	16
3500 PSI/ 60 KSI	24	16	24	24	16

HORIZONTAL REINFORCEMENT**	VERTICAL REINFORCEMENT SPACING*				
	8" THICK WALL		10" THICK WALL		
ONE BAR 12" FROM TOP OF WALL; MAX. SPACING 24" O.C.	4-#4	5-#4	4-#4	5-#4	6-#4

\* CONCRETE SHALL HAVE AIR ENTRAINMENT OF 5-7%.  
 \* MINIMUM REQUIREMENT FOR VERTICAL REBAR IN PLAIN CONCRETE WALLS IS #4 @ 36" ON CENTER (ACI 332).  
 \* VERTICAL BARS SHALL BE CONTINUED UP TO WITHIN 8" OF THE TOP OF THE WALL.  
 \* REBAR SHALL BE POSITIONED AT THE TENSION FACE OF THE WALL (2" FROM THE INSIDE FACE).  
 \* REINFORCEMENT SHALL LAP A MINIMUM OF 24 INCHES AT ENDS, SPLICES, AND AROUND CORNERS.  
 \*\* #4 BARS @ 24" ON CENTER.  
 \*\* #4 BAR WITHIN 12" OF TOP AND BOTTOM OF WALL.  
 \*\* MINIMUM GRADE 40 (40ksi) STEEL (PER ACI 332).  
 \*\* HORIZONTAL REINFORCEMENT SHALL BE INSTALLED ON THE COMPRESSION SIDE (SOIL SIDE) OF THE VERTICAL REINFORCEMENT

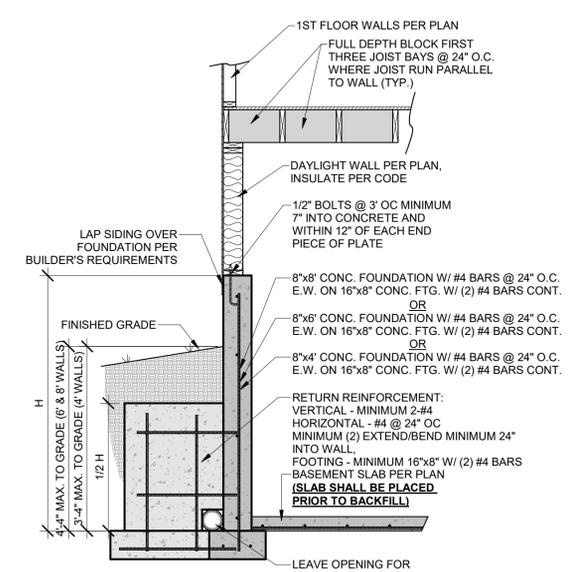

**7 UNRESTRAINED FOUNDATION WALL**  
1/2" = 1'-0"

THIS DOCUMENT CONTAINS COPYRIGHTED MATERIAL AND CONFIDENTIAL INFORMATION BELONGING TO HD ENGINEERING UNAUTHORIZED USE, DISCLOSURE, REPRODUCTION, OR DUPLICATION OF ANY OF THE INFORMATION CONTAINED HEREIN MAY RESULT IN LIABILITY UNDER APPLICABLE LAW.

**HD ENGINEERING & DESIGN, INC.**  
 11666 W. 75TH STREET  
 SHAWNEE, KS 66214  
 WWW.HDENGINEERS.COM  
 913.631.2222  
 SERVICE@HDENGINEERS.COM

**CASTROP DESIGN GROUP**  
 LOT 1442 THE JEVON & JULIE MCBRIDE RESIDENCE  
 211 NW CARSON DRIVE, LEE'S SUMMIT, MO

STRUCTURAL DETAILS & NOTES


HD#: 40620  
 DATE: 12/14/2020  
 CHECKED BY: CLS

NO.	ISSUE/REVISION	Revision Date

CONCRETE DETAILS


**S-3.0**

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI  
 12/15/2020

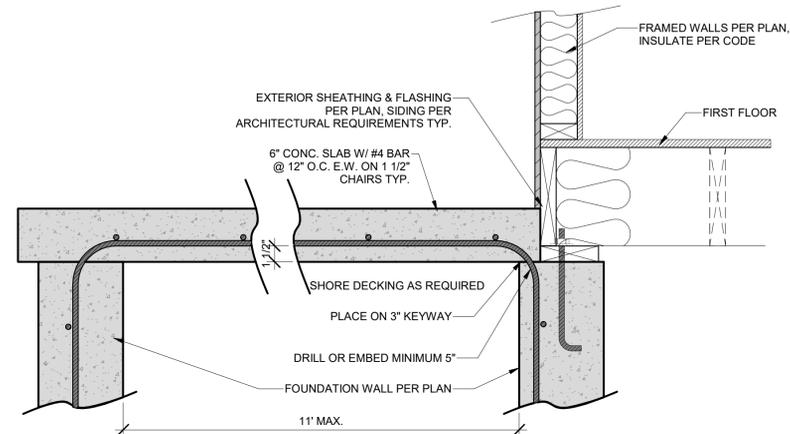


FOR SUSPENDED SLABS A MAXIMUM OF 10' ABOVE FLOOR BELOW. TEMPORARY SHORING WALLS SHALL BE PLACED AT A MAXIMUM OF 4' O.C. / #2-2X4 STUDS AT 16\"/>


**6** SUSPENDED PORCH STOOP SLAB  
1 1/2" = 1'-0"

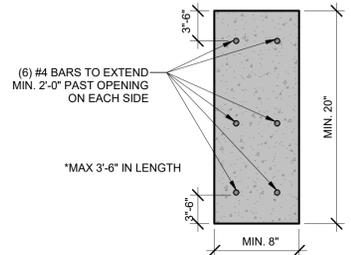


**5** CONCRETE HEADER DETAIL  
1 1/2" = 1'-0"

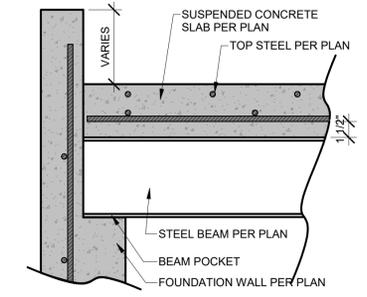


**1** SUSPENDED SLAB BEAM/WALL CONNECTION  
1 1/2" = 1'-0"

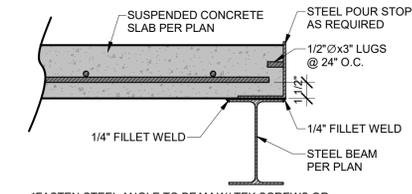

**2** SUSPENDED SLAB POUR STOP  
1 1/2" = 1'-0"

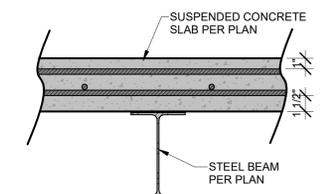

**3** SUSPENDED SLAB/STEELBEAM CROSS SECTION  
1 1/2" = 1'-0"

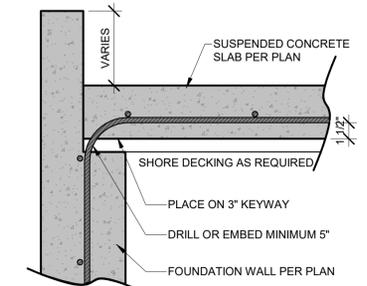


**4** SUSPENDED SLAB/WALL CONNECTION  
1 1/2" = 1'-0"

**IMPORTANT NOTE:**  
FOR SUSPENDED SLABS A MAXIMUM OF 10' ABOVE FLOOR BELOW. TEMPORARY SHORING WALLS SHALL BE PLACED AT A MAXIMUM OF 4' O.C. / #2-2X4 STUDS AT 16\"/>

THIS DOCUMENT CONTAINS COPYRIGHTED MATERIAL AND CONFIDENTIAL INFORMATION BELONGING TO HD ENGINEERING. UNAUTHORIZED USE, DISCLOSURE, REPRODUCTION, OR DUPLICATION OF ANY OF THE INFORMATION CONTAINED HEREIN MAY RESULT IN LIABILITY UNDER APPLICABLE LAW.

**HD ENGINEERING & DESIGN, INC**  
11656 W. 75TH STREET  
SHAWNEE, KS 66214  
WWW.HDENGINEERS.COM  
913.631.2222  
SERVICE@HDENGINEERS.COM



**CASTROP DESIGN GROUP**  
LOT 1442 THE JEVON & JULIE MCBRIDE RESIDENCE  
211 NW CARSON DRIVE, LEE'S SUMMIT, MO

STRUCTURAL DETAILS & NOTES


HD#: 40620  
DATE: 12/14/2020  
CHECKED BY: CLS

NO.	ISSUE/REVISION	Revision Date


SUSPENDED SLAB DETAILS

**S-3.1**


RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI  
12/15/2020

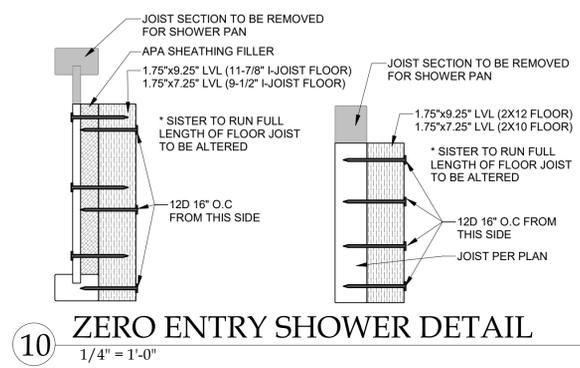


10 ZERO ENTRY SHOWER DETAIL  
1/4" = 1'-0"

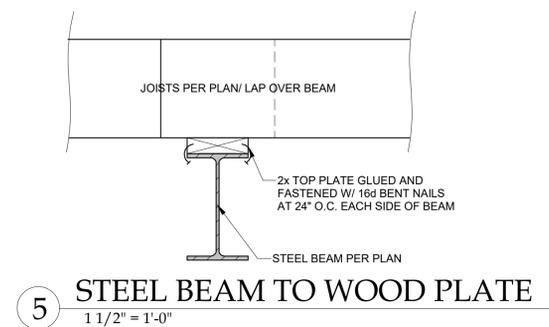


5 STEEL BEAM TO WOOD PLATE  
1 1/2" = 1'-0"

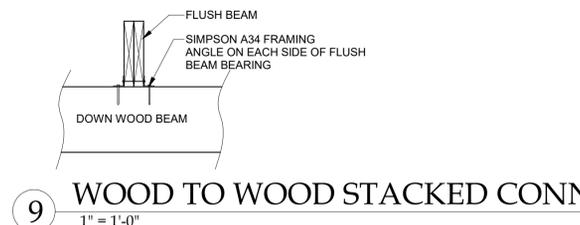


9 WOOD TO WOOD STACKED CONNECTION  
1" = 1'-0"

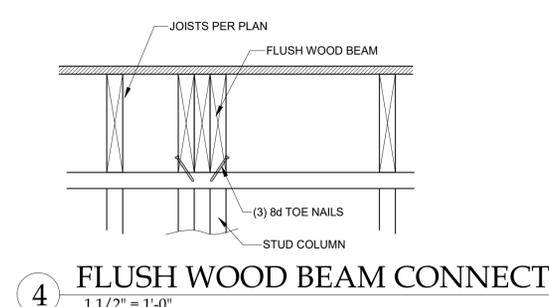


4 FLUSH WOOD BEAM CONNECTION  
1 1/2" = 1'-0"

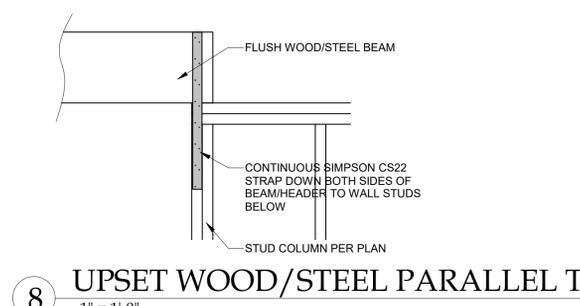


8 UPSET WOOD/STEEL PARALLEL TO WALL  
1" = 1'-0"

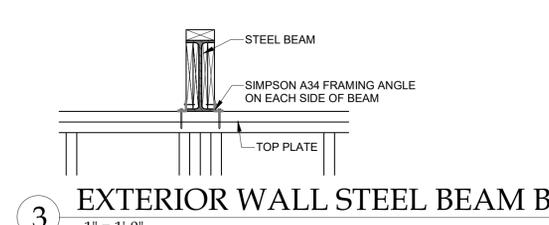


3 EXTERIOR WALL STEEL BEAM BEARING  
1" = 1'-0"

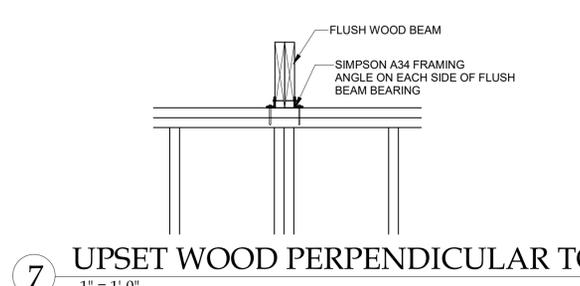


7 UPSET WOOD PERPENDICULAR TO WALL  
1" = 1'-0"

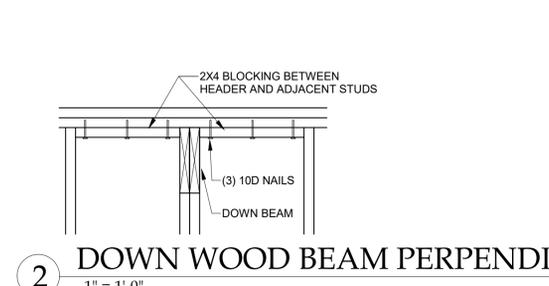


2 DOWN WOOD BEAM PERPENDICULAR  
1" = 1'-0"

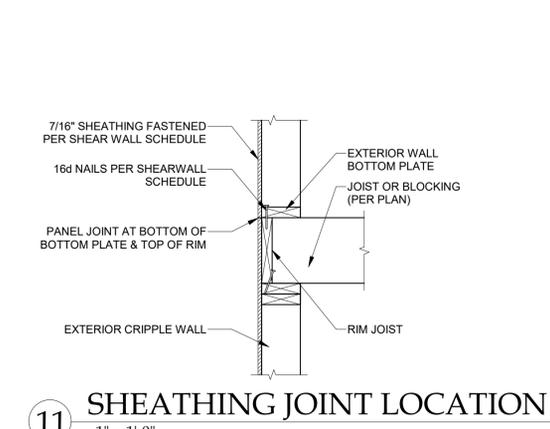

11 SHEATHING JOINT LOCATION  
1" = 1'-0"

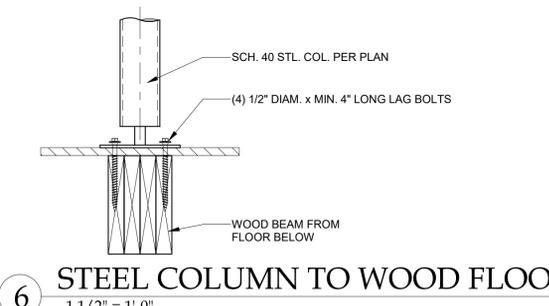

6 STEEL COLUMN TO WOOD FLOOR  
1 1/2" = 1'-0"

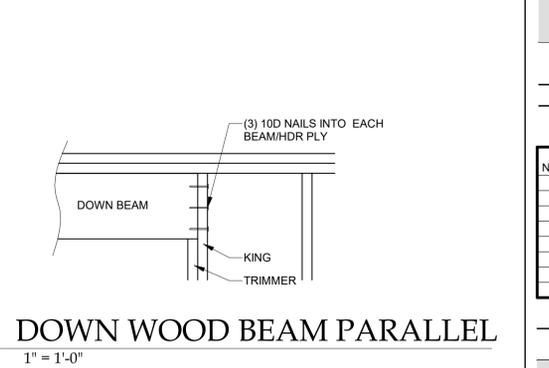

1 DOWN WOOD BEAM PARALLEL  
1" = 1'-0"

THIS DOCUMENT CONTAINS COPYRIGHTED MATERIAL AND CONFIDENTIAL INFORMATION BELONGING TO HD ENGINEERING UNAUTHORIZED USE, DISCLOSURE, REPRODUCTION OR DUPLICATION OF ANY OF THE INFORMATION CONTAINED HEREIN MAY RESULT IN LIABILITY UNDER APPLICABLE LAW.

HD ENGINEERING & DESIGN, INC  
11666 W. 75TH STREET  
SHAWNEE, KS 66214  
WWW.HDENGINEERS.COM  
913.631.2222  
SERVICE@HDENGINEERS.COM



**CASTROP DESIGN GROUP**  
LOT 1442 THE JEVON & JULIE MCBRIDE RESIDENCE  
211 NW CARSON DRIVE, LEE'S SUMMIT, MO

STRUCTURAL DETAILS & NOTES

HD#: 40620  
DATE: 12/14/2020  
CHECKED BY: CLS

NO.	ISSUE/REVISION	Revision Date

GENERAL DETAILS

**S-4.0**

RELEASE FOR REVIEW  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
12/15/2020