

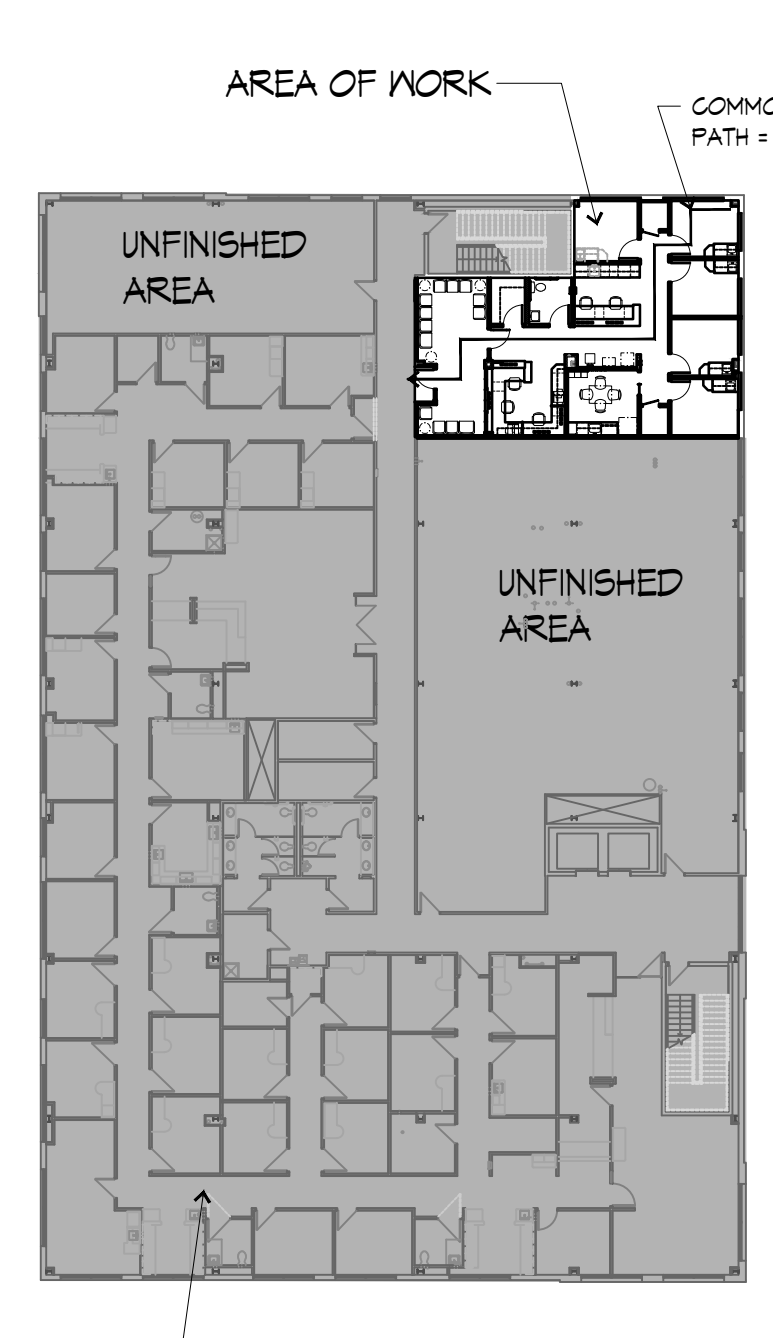


Suite 2302

GENERAL NOTES	CODE NOTES	KEY PLAN	AREA MAP
<p>1. MAINTAIN ACCESS TO EXISTING WALKWAYS, CORRIDORS, AND OTHER ADJACENT OCCUPIED OR USED FACILITIES. DO NOT CLOSE OR OBSTRUCT WALKWAYS, CORRIDORS, OR OTHER OCCUPIED OR USED FACILITIES WITHOUT PERMISSION FROM OWNER.</p> <p>2. DEFINITIONS:</p> <p>2.1. REMOVE AND DISCARD: DETACH ITEMS FROM EXISTING CONSTRUCTION AND LEGALLY DISPOSE OF THEM OFF-SITE.</p> <p>2.2. REMOVE AND SALVAGE: DETACH ITEMS FROM EXISTING CONSTRUCTION AND TURN OVER TO OWNER UNDAMAGED.</p> <p>2.3. RELOCATE: DETACH ITEMS FROM EXISTING CONSTRUCTION, MOVE ITEMS INTACT AND UNDAMAGED, AND REINSTALL THEM WHERE INDICATED.</p> <p>2.4. EXISTING TO REMAIN: EXISTING ITEMS OF CONSTRUCTION THAT ARE NOT TO BE REMOVED, BUT ARE TO REMAIN IN PLACE AND BE UNDAMAGED.</p> <p>2.5. REMOVE AND RECLAIM: DETACH ITEMS FROM EXISTING CONSTRUCTION, AT CONTRACTOR'S OPTION ITEM MAY BE REUSED AS PART OF NEW WORK. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO INVENTORY ITEMS TO DETERMINE IF ITEMS WILL FUNCTION AND APPEAR LIKE THE NEW ITEMS SPECIFIED AND CALLED OUT ON THESE DOCUMENTS. IF ITEMS ARE REUSED, CONTRACTOR IS TO CLEAN, REPAIR, OR OTHERWISE BRING ITEMS TO LIKE NEW CONDITION. MODIFY REUSED ITEMS AS REQUIRED AND SUPPLEMENT WITH MATERIALS, AND INCIDENTALS NECESSARY TO EXECUTE A COMPLETE WORKMANLIKE JOB. IF CONTRACTOR CHOOSES TO NOT REUSE ITEM, LEGALLY DISPOSE OF ITEM OFF-SITE AND REPLACE WITH NEW TO MATCH EXISTING.</p> <p>2.6. PROVIDE: THE MEANING OF THE WORD "PROVIDED" INCLUDES, BUT IS NOT LIMITED TO, FURNISHED, DELIVERED, INSTALLED, FINISHED, MADE FULLY OPERABLE AND COMPLETE, UNLESS SPECIFICALLY NOTED OTHERWISE. ALL WORK DESCRIBED IN THESE DOCUMENTS IS TO BE PROVIDED BY THE CONTRACTOR.</p> <p>3. CONTRACTOR IS TO INCLUDE AS PART OF HIS SCOPE ALL CUTTING AND PATCHING REQUIRED THROUGH CAREFUL EVALUATION OF THE EXISTING SITE AND THE CONSTRUCTION DOCUMENTS. CONTRACTOR SHALL COORDINATE THE CUTTING AND PATCHING OF EXISTING CONSTRUCTION NECESSARY TO PERMIT INSTALLATION OR PERFORMANCE OF THE WORK INDICATED IN THESE CONSTRUCTION DOCUMENTS. SAW-CUT CONC. SLAB AS REQUIRED FOR UTILITIES, FOR EQUIPMENT AND SINKS. VERIFY ROUTE AND TRENCH DEPTH IN FIELD. PATCH BACK WITH MATCHING SLAB THICKNESS OVER SAME MATERIAL, COMPACT UNDERLYING MATERIALS TO MEET BEST PRACTICES. DOWEL NEW TO EXISTING WITH #4 REBAR AT 30" OC.</p> <p>4. WHERE WALLS, CASEWORK, FINISHES, EQUIPMENT OR OTHER ITEMS AND CONSTRUCTIONS HAVE BEEN REMOVED EXPOSING UNDERLYING WALL AND/OR FLOOR SURFACES, SUCH SURFACES ARE TO BE PATCHED AND REPAIRED AS REQUIRED TO ACCEPT NEW FINISHES. ALL HOLES, DAMAGES, DEFECTS, ETC. IN EXISTING SURFACES ARE TO BE PATCHED TO MATCH EXISTING CONDITIONS.</p> <p>5. EXISTING CONDITIONS SHOWN ON THESE DRAWINGS ARE BASED UPON BASE BUILDING OR OTHER CONSTRUCTION DOCUMENTS MADE AVAILABLE TO THE DESIGNER BY THE BUILDING MANAGEMENT. ALL AS-BUILT ARCHITECTURAL CONDITIONS HAVE NOT BEEN FIELD VERIFIED AND MAY VARY FROM THOSE SHOWN.</p> <p>6. PRIOR TO BID: FIELD VERIFY ALL EXISTING CONSTRUCTION TO REMAIN AND INCLUDE COSTS FOR REPAIR AND RECONITION OF ALL EXISTING</p> <p>7. THE GENERAL CONTRACTOR SHALL, IN THE BIDDING PROCESS, REQUIRE THAT MECHANICAL AND ELECTRICAL SUBCONTRACTORS MAKE A THOROUGH FIELD INSPECTION OF AS-BUILT CONDITIONS OF EXISTING SYSTEMS. AFTER SUCH FIELD VERIFICATION HAS BEEN COMPLETED, THE GENERAL CONTRACTOR AND SUBCONTRACTORS SHALL PROVIDE IN THEIR BIDS, ANY MODIFICATIONS TO THE EXISTING SYSTEMS WHICH MAY BE REQUIRED TO ACCOMMODATE THE PROPOSED REQUIREMENTS FOR THIS TENANT. IF A DETERMINATION OF SUCH MODIFICATIONS CANNOT BE MADE, THE GENERAL CONTRACTOR SHALL NOTIFY THE TENANT, AND AT THE DIRECTION OF THE TENANT, PROVIDE AN AGREED UPON ALLOWANCE TO COVER SUCH WORK.</p> <p>8. COMMENCING WORK BY A CONTRACTOR OR SUBCONTRACTOR CONSTITUTES ACCEPTANCE OF THE UNDERLYING CONDITIONS AND SURFACES. PRIOR TO PROCEEDING WITH THE WORK, PREPARE EXISTING AND NEW UNDERLYING CONDITIONS AND SUBSTRATE TO COMPLY WITH THE CONTRACT DOCUMENTS, INDUSTRY STANDARDS AND MANUFACTURER'S RECOMMENDATION.</p> <p>9. FIELD VERIFY ALL ROUGH OPENINGS AND WALL WIDTHS PRIOR TO ORDERING OR FABRICATION OF MATERIALS.</p> <p>10. DIMENSIONS ARE NOMINAL AND TO THE FACE OF PARTITIONS</p> <p>11. CLEAN-UP OF RUBBISH AND DEBRIS RESULTING FROM DEMOLITION AND NEW WORK SHALL BE COLLECTED REGULARLY FROM PROJECT SITE AND LEGALLY DISPOSED</p> <p>12. ALL WEATHER EXPOSED SURFACES SHALL HAVE A WEATHER RESISTIVE BARRIER TO PROTECT THE INTERIOR WALL COVERING AND EXTERIOR OPENINGS SHALL BE FLASHED IN SUCH A MANNER AS TO MAKE THEM WEATHERPROOF</p> <p>13. CONTRACTORS ARE RESPONSIBLE FOR ALL MATERIALS AND QUANTITIES SHOWN IN THESE DRAWINGS GRAPHICALLY AS WELL AS THOSE CALLED FOR BY NOTE</p> <p>14. THE CONTRACTOR SHALL OBTAIN ALL NECESSARY PERMITS TO COMPLETE THE PROPOSED WORK AND SHALL COMPLY WITH ALL LOCAL, STATE, AND FEDERAL REGULATIONS</p> <p>15. THE TENANT OR THE TENANT'S DESIGNATED REPRESENTATIVE WILL PROVIDE SERVICES IN CONNECTION WITH ADMINISTRATION OF THE CONTRACT</p> <p>16. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL LOCAL LAWS, ORDINANCES, RULES AND REGULATIONS OF THE GOVERNING AGENCIES HAVING JURISDICTION</p> <p>17. THE CONTRACTOR MUST TAKE ADEQUATE CARE TO PROTECT ALL AREAS OF THE BUILDING WHERE THE WORK OF THIS PROJECT IS LOCATED AS WELL AS</p> <p>THE AREAS ADJACENT TO THE AREA OF THE WORK OF THIS PROJECT SO AS TO PREVENT DAMAGE TO LIFE OR PROPERTY AS A RESULT OF THIS CONSTRUCTION PROJECT</p> <p>18. ONLY MATERIALS THAT ARE NEW, UNUSED, FREE FROM DEFECTS, AND THE BEST OF THEIR RESPECTIVE KINDS SHALL BE USED. THE BASIS OF QUALITY SHALL BE THE LATEST STANDARDS OF ASTM, AIA OR ASHRA</p> <p>19. THE CONTRACTOR SHALL COORDINATE HIS WORK WITH ALL OTHER TRADES INCLUDING THOSE OF THE TENANT WHO MAY BE ENGAGED UNDER A SEPARATE CONTRACT</p> <p>20. INSTALL ALL WORK IN SUCH A MANNER AS TO BE READILY ACCESSIBLE FOR OPERATION, MAINTENANCE AND/OR REPAIRS</p> <p>21. ALL WORK AND EQUIPMENT SHALL BE CLEANED TO THE SATISFACTION OF THE TENANT BEFORE BEING TURNED OVER FOR USE</p> <p>22. A COPY OF THE LATEST SET OF CONSTRUCTION DOCUMENTS SHALL BE KEPT AT THE JOB SITE AT ALL TIMES</p> <p>23. THE CONTRACTOR AND EACH SUBCONTRACTOR SHALL KEEP ACCURATE RECORDS OF ANY MODIFICATION OR DEVIATIONS FROM THE CONTRACT DRAWINGS</p> <p>24. PROJECT CLOSE OUT DOCUMENTS SHALL BE PROVIDED TO THE TENANT. AS-BUILT DRAWINGS, WARRANTY/MAINTENANCE MANUALS AND TESTING AND SUPERVISION AS REQUIRED. PRESERVE ALL PRINTED INSTRUCTIONS AND WARRANTIES THAT ARE PROVIDED WITH EQUIPMENT OR MATERIALS USED, AND DELIVER SAID PRINTED MATTER TO THE TENANT AT THE TIME OF SUBSTANTIAL COMPLETION. IF REQUESTED BY THE TENANT, INSTRUCT THE MANAGEMENT IN THE PROPER USE AND MAINTENANCE OF ALL ITEMS OF WORK PROVIDED.</p> <p>25. PROVIDE WORK IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATION, EXCEPT IN THE CASE WHERE THE CONTRACT DOCUMENTS ARE MORE STRINGENT. PROVIDE ANY MISCELLANEOUS ITEMS OR MATERIALS NOT SPECIFICALLY NOTED, BUT REQUIRED FOR PROPER INSTALLATION OF THE WORK.</p> <p>26. ALL WORK SHALL BE WARRANTED BY THE CONTRACTOR TO BE SATISFACTORY, IN MATERIALS AND WORKMANSHIP, FOR A MINIMUM PERIOD OF ON (1) YEAR, OR FOR THE PERIOD OF WARRANTY CUSTOMARY, SPECIFIED FOR, THE TRADE, CRAFT OR PRODUCT, WHICHEVER IS LONGER.</p> <p>27. SUBMIT REQUESTS FOR SUBSTITUTIONS OF SPECIFIED ITEMS IN WRITING, ACCOMPANIED BY THE ALTERNATIVE PRODUCT INFORMATION TO THE TENANT. SUBSTITUTIONS MAY BE CONSIDERED ONLY IF THEY DO NOT SACRIFICE QUALITY, APPEARANCE AND FUNCTION. ACCEPTANCE OF SUBSTITUTIONS IS AT THE SOLE DISCRETION OF THE TENANT.</p>	<p>A. TENANT FINISH</p> <p>B. ALL CONSTRUCTION FOR THIS PROJECT SHALL CONFORM TO THE FOLLOWING BUILDING CODES AND REQUIREMENTS ADOPTED AND AS AMENDED BY THE CITY OF LEES SUMMIT, MISSOURI:</p> <p>B.1. 2018 International Building Code</p> <p>B.2. 2018 International Plumbing Code</p> <p>B.3. 2018 International Mechanical Code</p> <p>B.4. 2018 International Fuel Gas Code</p> <p>B.5. 2018 International Residential Code</p> <p>B.6. 2018 International Fire Code</p> <p>B.7. 2011 National Electrical Code</p> <p>B.8. ICC/ANSI A117.1-2009, Accessible and Usable Buildings and Facilities</p> <p>C. OCCUPANCY GROUP: B</p> <p>D. CONSTRUCTION TYPE: IB</p> <p>E. FULLY-SPRINKLED FIRE ALARM PROVIDED</p> <p>F. SQUARE FOOTAGE TENANT INFILL = 1,560 SF</p> <p>G. OCCUPANT LOAD = 1,560 / 150 = 10.45 ± 11 OCC</p> <p>H. SPACES WITH ONE EXIT OR EXIT ACCESS DOORWAY (TABLE 1006.2.1):</p> <p>H.1. OCCUPANCY B = MAXIMUM OCCUPANT LOAD 49</p> <p>H.2. COMMON PATH OF EGRESS TRAVEL IN GROUP B OCCUPANCY WITH SPRINKLER SYSTEM HAS AN OCCUPANT LOAD OF <49, THE LENGTH OF COMMON EGRESS TRAVEL SHALL NOT BE MORE THAN 100 FEET.</p> <p>DRAWING INDEX</p> <p>G8 COVER SHEET, GENERAL NOTES AND CODE NOTES</p> <p>A1 ARCHITECTURAL SPECIFICATIONS</p> <p>A2 FLOOR PLAN AND FINISH SCHEDULE</p> <p>A3 CEILING PLAN, CASEWORK DETAILS AND DOOR SCHEDULE</p> <p>A4 INTERIOR ELEVATIONS, EQUIPMENT AND ACCESSORIES SCHEDULE</p> <p>MP1 MECHANICAL AND PLUMBING SPECIFICATIONS AND SYMBOLS</p> <p>M1 MECHANICAL PLAN</p> <p>M11 WASTE AND VENT PLAN</p> <p>P2 WATER PLAN</p> <p>E1 ELECTRICAL SPECIFICATIONS AND SYMBOLS</p> <p>E2 ELECTRICAL LIGHTING PLAN</p> <p>E3 ELECTRICAL POWER PLAN</p> <p>E4 ELECTRICAL SCHEDULES AND DETAILS</p>		

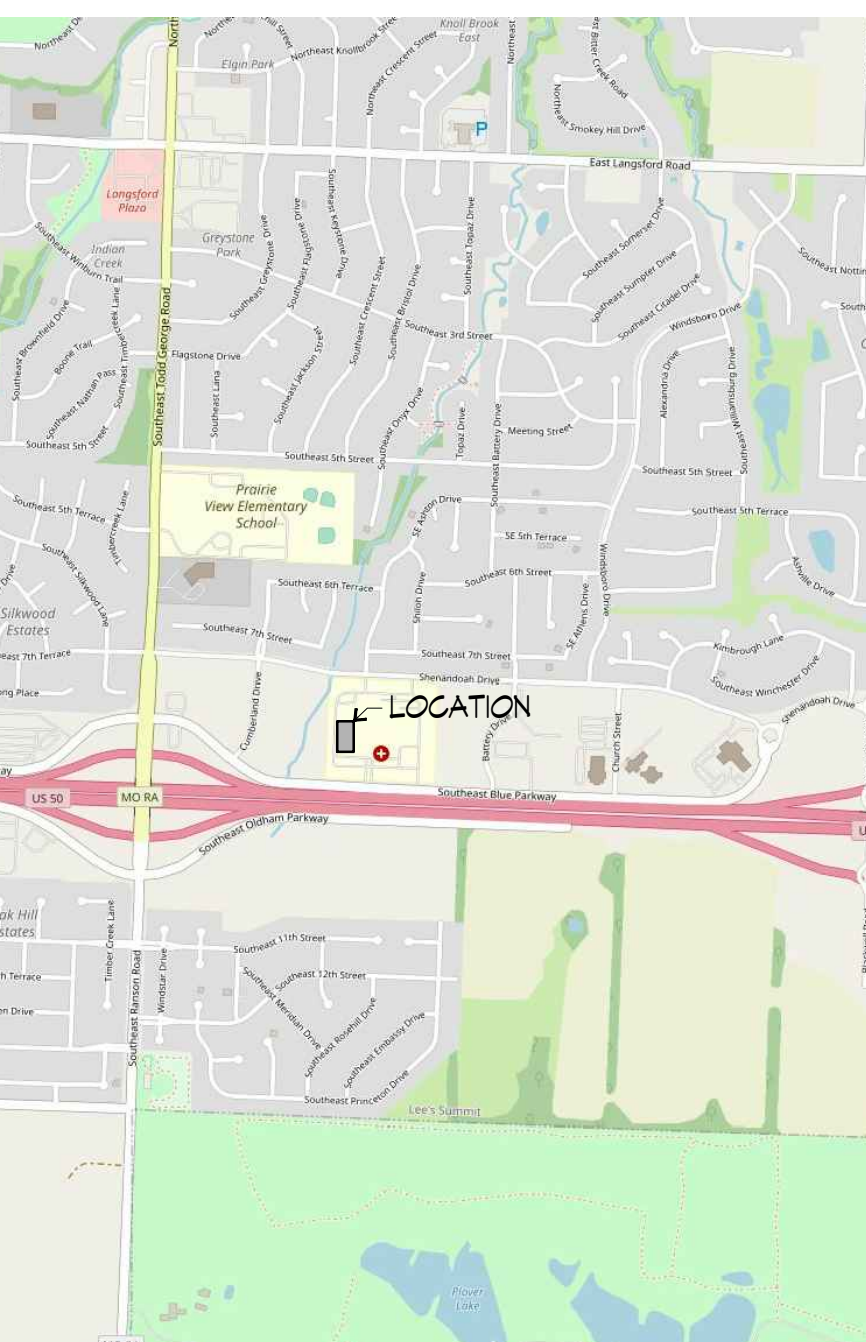

CS




1. FURR-OUT AROUND THE STRUCTURAL COLUMNS AND MECHANICAL CHASES AS REQUIRED. MINIMIZE DEPTH OF FURRING.
2. PROVIDE SOLID BLOCKING FOR DOORS, WINDOWS, TOILET PARTITION, ACCESSORIES, HANDRAILS, LAVATORY BRACES, CASEWORK, SHELVING ETC. AS REQUIRED BY MANUFACTURER AND ALL WORK DONE BY CARPENTRY AND MILLWORK TRADES. ALL WOOD REQUIRED BY BUILDING CODES SHALL MEET ALL REQUIREMENTS TO THE CODE OF UNDERSKRIBERS LABORATORIES, INC. VERIFY THE DEPTH OF WALLS PRIOR TO INSTALLING RECESSED FIXTURES.
3. ALL EXPOSED EDGES AND /OR CORNER ON ALL GYPSUM WALL BOARD CONSTRUCTION SHALL HAVE A METAL CORNER TRIM, TAPED AND SPACKLED.
4. ALL NEW GYPSUM BOARD PARTITIONS TO BE PROPERLY PREPARED, PATCHED, SPACKLED AND SANDED, ETC., TO PROVIDE A SMOOTH FINISH AND AS REQUIRED TO RECEIVE NEW FINISHES.
5. ALL OPENINGS IN GYPSUM BOARD PARTITIONS SHALL BE DOUBLE STUDDED.
6. WHERE INDICATED BY PLAN NOTE #3 PROVIDE 6" STUDS IN LIEU OF SIZED INDICATED BY WALL TYPE.
7. IN THE FOLLOWING ROOMS PROVIDE MOISTURE/MOLD RESISTANT GYPSUM BOARD IN LIEU OF THE STANDARD GYPSUM BOARD INDICATED IN WALL TYPES BELOW: TOILET 302.05

- ### FLOOR PLAN NOTES

-

12-18-2020

**GUY GRONBERG
ARCHITECTS, P.C.**



Lee's Summit Medical Center, MOB


Suite 2302

1980 SE Blue Parkway, Lee's Summit, MO 64063

This drawing has been provided as an Instrument of service by the architect, or under his supervision and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990 all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Architect. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Architect is strictly prohibited.

[illegible]

A2

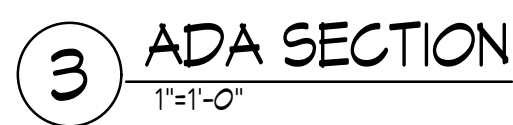

The diagrams illustrate four different door frame and pocket door configurations:

- A KD DRYWALL METAL FRAME - PAINT**: Shows a standard door frame with a width of 36" and a height of 80". The door is labeled "PER. SCHED." (Permitted Schedule).
- B METAL CASED OPENING POCKET DOOR FRAME - PAINT**: Shows a pocket door frame with a width of 36" and a height of 80". The door is labeled "PER. SCHED." (Permitted Schedule).
- C FULLY WELDED METAL FRAME - PAINT**: Shows a fully welded metal frame with a width of 48" and a height of 80". The door is labeled "PER. SCHED." (Permitted Schedule).
- D CLEAR ANODIZED ALUMINUM INTERIOR STOREFRONT FRAME TO MATCH BUILDING STANDARD**: Shows a clear anodized aluminum interior storefront frame with a width of 54" and a height of 80". The door is labeled "PER. SCHED." (Permitted Schedule).

HARDWARE SET 01	HARDWARE SET 04
EACH TO HAVE:	EACH TO HAVE:
1EA HINGE 112HD 315AN IVE	3EA HINGE 55B11H 4.5 X 4.5 652 IVE
1EA CLASSRM NTDLTD RHO 626 SCH	1EA MORTISE PRV14C L946 SAT 626 SCH
1EA SURFACE CLOSER 4040XN-EDA 650 LCN	1EA SURFACE CLOSER 4040XN 650 LCN
1EA WALL STOP MS406/407 CCV 630 IVE	1EA KICK PLATE 8400 10" X 2" 12IN 630 IVE
1EA GASKETING 4805BK PSA BK EZR	1EA MORTISE DOOR BOTTOM 225S IVE
1EA ELECTRIC STRIKE 6211 F5E 630 VON	1EA WALL STOP MS406/407 CCV 630 IVE
NOTE: CARD ACCESS AND/OR DOOR OPERATOR BY FUTURE TENDANT IF DESIRED. POWER SUPPLY TO BE STUBBED ABOVE CEILING FOR FUTURE CONNECTION.	1EA GASKETING 4805BK PSA BK EZR
	HARDWARE SET 05
	EACH TO HAVE:
	3EA HINGE 55B11H 4.5 X 4.5 652 IVE
	1EA PASSAGE SET ND10S RHO 626 SCH
	1EA SURFACE CLOSER 4040XN 650 LCN
	1EA KICK PLATE 8400 10" X 2" 12IN 630 IVE
	2EA SILencer SR64 GRAY IVE
HARDWARE SET 02	
EACH TO HAVE:	
3EA HINGE 55B11H 4.5 X 4.5 652 IVE	
1EA PASSAGE SET ND10S RHO 626 SCH	
1EA SURFACE CLOSER 4040XN 650 LCN	
1EA KICK PLATE 8400 10" X 2" 12IN 630 IVE	
1EA WALL STOP MS406/407 CCV 630 IVE	
	HN SET 06 (rocket)
	1EA 10TB25 1634D RGR
	1SET POCKET DOOR SYSTEM 200PD SERIES JOHNSON HDN

DOOR #	DOOR OR OPNG SIZE	FRAME	DOOR	HRDN	LOCK
01	3'-0" x T-0" x 1-3/4"	D	3	01	GLASSRM
03	3'-0" x T-0" x 1-3/4"	C	2	02	PASSAGE
04	3'-0" x T-0" x 1-3/4"	A	1	03	ENTRANCE
05	3'-0" x T-0" x 1-3/4"	A	1	04	PRIVACY
07	3'-0" x T-0" x 1-3/4"	A	1	04	ENTRANCE
08	3'-0" x T-0" x 1-3/4"	A	1	05	PASSAGE
09	3'-0" x T-0" x 1-3/4"	A	1	05	PASSAGE
10	3'-0" x T-0" x 1-3/4"	A	1	05	PASSAGE
12	3'-0" x T-0" x 1-3/4"	A	1	05	PASSAGE
13	3'-0" x T-0" x 1-3/4"	A	1	05	PASSAGE
14	3'-0" x T-0" x 1-3/4"	A	1	05	PASSAGE
15	3'-6" x T-0" x 1-3/4"	B	1	06	NONE

1 FLUSH SOLID CORE LAMINATE DOOR WITH MATCHING EDGE TO MATCH BUILDING STANDARD (WILSONART 7997-30 EBONY RECON)


2 FLUSH SOLID CORE LAMINATE DOOR WITH MATCHING EDGE TO MATCH BUILDING STANDARD (WILSONART 7997-30 EBONY RECON)

3 CLEAR ANODIZED ALUMINUM INTERIOR DOOR TO MATCH BUILDING STANDARD

6Z-1 1/4" CLEAR TEMPERED SAFETY GLASS WITH APPLIED WINDOW FILM.

6Z-2 1/4" CLEAR TEMPERED SAFETY GLASS WITH APPLIED WINDOW FILM. BASIS OF DESIGN FILM BE SOLYX SX-3131 ECO DUSTE INSTALLED WITH 1" CLEAR BOARDER AT PERIMETER OF EACH GLASS PANE. VERIFY FINAL SELECTION WITH OWNER

1. FINISH HARDWARE TO MEET REQUIREMENTS OF ANSI/BHMA A156 STANDARDS FOR GRADE 2. PROVIDE PRODUCTS AS MANUFACTURED BY ALLEGION / SCHLAGE OR APPROVED EQUAL.
2. THE CONTRACTOR SHALL VERIFY LOCK/LATCH FUNCTIONS AND ALL KEYING REQUIREMENTS WITH OWNER PRIOR TO INSTALLATION.
3. HARDWARE FINISHES AND LEVER STYLES ARE TO MATCH EXISTING HARDWARE IN SAME AREA.
4. HARDWARE MOUNTING HEIGHTS BY THE DOOR AND HARDWARE INSTITUTE "RECOMMENDED" LOCATIONS FOR BUILDERS HARDWARE; ALL DOOR HARDWARE IS TO COMPLY WITH THE AMERICANS WITH DISABILITIES ACT GUIDELINES AND HAVE LEVER HANDLES.
5. DOOR FRAME FLOOR ANCHOR CLIPS SHALL BE SECURED WITH NOT LESS THAN 2 SUITABLE FASTENERS. DOOR JAMB ANCHOR CLIPS SHALL BE BOLTED OR SCREWED TO STUDS: THREE PER JAMB.



LOS ANGELES MEDICAL CENTER, MOD

Suite 2302


1980 3L Blue Parkway, Lee's Summit, MO 64003

understand of service by the architect, or
under his supervision and is intended for
use on this project only. Pursuant to the
Architect's Office Copy Right Protection Act,
the Architect hereby grants the owner the
right to use the drawings, specifications,
and designs, including the overall form,
arrangement and composition of space and
elements appearing herein, constitute
the original, copyright-work of the
Designer/Architect. Any reproduction, use,
or disclosure of information contained herein
without prior written consent of the Architect
is strictly prohibited.

© COPYRIGHT 2020 GUY
GRONBERG ARCHITECTS, P.C.

	NEW	DATE	DESCRIPTION
DATE: 12-18-2020			
PROJECT# 20046			

A3





Suite 2302

1980 SE Blue Parkway, Lee's Summit, MO 64063

[illegible][illegible]

DATE: 12-18-2020
PROJECT# 20046

(A4)



CONTRACTOR IS TO COORDINATE ELECTRICAL AND LOW-VOLTAGE HOOK-UP REQUIREMENTS AND IS PROVIDE AND INSTALL BLOCKING FOR ALL MOUNTED ITEMS REGARDLESS OF WHO IS TO DO THE FINAL INSTALLATION. SEE DESCRIPTION FOR INSTALLATION REQUIREMENTS. MOUNTING LOCATIONS INDICATED ON THESE DRAWINGS REPRESENT APPROXIMATE LOCATIONS. PRECISE MOUNTING LOCATIONS ARE TO BE VERIFIED IN FIELD WITH OWNER PRIOR TO INSTALLATION.

ITEM	DESCRIPTION
<u>EQ.MEG</u>	MEDICAL EQUIPMENT: MISCELLANEOUS FURNISHED AND INSTALLED BY OWNERS VENDOR. CONTRACTOR IS TO COORDINATE AND PROVIDE HOOK UP REQUIREMENTS.
<u>EQ.MWV</u>	MICROWAVE: FURNISHED AND INSTALLED BY OWNER.
<u>EQ.PC</u>	COMPUTER: FURNISHED AND INSTALLED BY OWNER.
<u>EQ.PRT</u>	PRINTER: FURNISHED AND INSTALLED BY OWNER.
<u>EQ.REF</u>	REFRIGERATOR: FURNISHED BY OWNER AND INSTALLED BY CONTRACTOR.
<u>EQ.TC</u>	TRASH CAN: FURNISHED AND INSTALLED BY OWNER.
<u>EQ.TV</u>	FLAT SCREEN TV / MONITOR: SCREEN AND MOUNT TO BE FURNISHED BY OWNER AND INSTALLED BY CONTRACTOR.
<u>EQ.UOR</u>	UNDER COUNTER REFRIGERATOR: FURNISHED BY OWNER AND INSTALLED BY CONTRACTOR.

TO BE FURNISHED AND INSTALLED BY CASEWORK OR COUNTERTOP SUPPLIER

CMB1	BACKET FOR 24"DP COUNTER - A AND M HARDWARE INC. 18"X18" STANDARD STEEL WORK STATION BRACKET - BLACK
CMB2	CONCEALED FLAT BRACKET - A AND M HARDWARE INC. CFLAT18(20) STEEL BRACKET - BLACK
CMB3	ECLIPSE SUPPORT BRACKET - RAKS EG-0812 SILVER POWDER COAT
CMPD	PENCIL DRAWER - 3"X 24"V LAM GLAD DRAWER WITH BALL BEARING OVEREXTENSION SLIDES

TO BE FURNISHED AND INSTALLED BY CONTRACTOR. COORDINATE AND PROVIDE BLOCKING.

TA-36	36" GRAB BAR, 1-1/2" DIAMETER, WITH CONCEALED MOUNTING - BOBBICK BR-8906 - 1/2" FROM BACK CORNER AT 2-1/2" AFF
TA-42	42" GRAB BAR, 1-1/2" DIAMETER, WITH CONCEALED MOUNTING - BOBBICK BR-8906 - MOUNT 12" FROM BACK CORNER AT 2-1/2" AFF
TA-10	18" VERTICAL GRAB BAR, 1-1/2" DIAMETER, WITH CONCEALED MOUNTING - BOBBICK BR-8906 - MOUNT 9-4" FROM BACK CORNER WITH CENTER OF BOTTOM MOUNT AT 9-4" AFF
TA-M1	MIRROR, 40" TALL X 20" WIDE X 1/2" TEMPERED MIRROR, SEALED EDGES BEHIND MIRROR INSTALL 18"X36" PLYWOOD BACKER BOARD WITH THICKNESS TO MATCH WALL TILE. SECURE MIRROR TO BOARD WITH

TA SPT	SPECIMEN PASS THROUGH: BOBRICK B-50516
--------	--


EQ.TP	TOILET PAPER DISPENSER: TO MATCH BUILDING STANDARD.
TA.TS	TOILET ROOM SIGN - PROVIDE ON WALL ADJACENT TO LATCH SIDE OF DOOR MATTE FINISH TOILET ROOM SIGN 60" A.F.F. WITH RAISED CONTRASTING LETTERS 3/4" TO 2" TALL WITHOUT SERIFS AND BRAILLE. COLORS TO MATCH BUILDING STANDARD.

TO BE FURNISHED AND INSTALLED BY CONTRACTOR AS PART OF WORK

G2.01	SLIDING DOOR WITH FIXED SIDE/LITE PANEL. PASS THRU WINDOW TO BE CR LAURENCE OVERHEAD SHUTTER. PROVIDE 1/2" CLEAR ANODIZED, COMPLETE WITH ALL ACCESSORIES, BUMPERS, STRIKES AND GUIDES ECT. PROVIDE PUSH BOTTOM LOCK. PROVIDE 1/4" CLEAR TEMPERED GLASS.
G2.02	FIXED GLASS PANEL WINDOW TO BE CR LAURENCE SLANT ANODIZED SHARYN D244 OVERHEAD TRACK, D26 FIXED LITE INSERT, AND D631 BOTTOM RAIL WITH PSB125 SETTING BLOCKS. PROVIDE 1/4" CLEAR TEMPERED GLASS SECURED WITH SILICONE SEALANT.




ADD ALTERNATE #1
AT TOILET ROOM 302.03, TL3 AND
TL4 AS SHOWN IS TO BE INCLUDED
AS PART OF ADD ALTERNATE #1.
BASE BID IS TO PROVIDE TL2 WALL
BASE AND EPOXY PAINT PT2



DIFFUSER, REGISTER AND GRILLE SCHEDULE							
MARK	MANUFACTURER	MODEL	FACE TYPE	MOUNTING TYPE	FACE SIZE (IN.)	MAX NC	NOTES
SUPPLY							
CSD-1	TITUS	OMNI	PLAQUE FACE	LAY-IN	24x24	25	A,B,C
CSD-2	TITUS	OMNI	PLAQUE FACE	SURFACE	12x12	25	A,B,C
RETURN							
CRG-1	TITUS	PAR	PERFORATED	LAY-IN	12x24	25	A,B,C,D,E
CRG-2	TITUS	PAR	PERFORATED	LAY-IN	24x24	25	A,B,C,D,E
EXHAUST							
CEG-1	TITUS	PAR	PERFORATED	SURFACE	12x12	25	A,B,C,D
NOTES:							
A. NECK SIZE SHOWN ON DRAWINGS.							
B. BAKED ENAMEL FINISH, WHITE							
C. FRAME TYPE TO MATCH CEILING CONSTRUCTION, COORDINATE WITH ARCHITECTURAL REFLECTED CEILING PLAN.							
D. PAINT THE INSIDE OF CANS FLAT BLACK.							
E. PROVIDE TITUS FLEXABOOT.							


- A. DRAWINGS ARE DIAGRAMMATIC ONLY AND REPRESENT THE GENERAL SCOPE OF WORK. REVIEW THE GENERAL NOTES, SPECIFICATIONS AND PLANS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT, ENGINEER AND/OR OWNER OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
- B. COORDINATE INSTALLATION OF MECHANICAL AND PLUMBING SYSTEMS WITH OTHER TRADES TO ENSURE A NEAT AND ORDERLY INSTALLATION AND AVOID CONFLICTS. INSTALL DUCTWORK AND PIPING AS TIGHT TO STRUCTURE AS POSSIBLE. COORDINATE INSTALLATION OF DUCTWORK AND PIPING TO AVOID CONFLICTS WITH ELECTRICAL PANELS, LIGHTING FIXTURES, ETC. VERIFY DUCT SPACE AVAILABLE ABOVE ALL CEILINGS PRIOR TO ANY FABRICATION OF INSTALLATION.
- C. NEW MECHANICAL EQUIPMENT, DUCTWORK AND PIPING ARE SHOWN AT APPROXIMATE LOCATIONS. FIELD MEASURE FINAL DUCTWORK AND PIPING LOCATIONS PRIOR TO FABRICATION AND MAKE ADJUSTMENTS AS REQUIRED TO FIT THE DUCTWORK AND PIPING WITHIN THE AVAILABLE SPACE. VERIFY THAT FINAL EQUIPMENT LOCATIONS MEET MANUFACTURER'S RECOMMENDATIONS REGARDING SERVICE CLEARANCE AROUND EQUIPMENT.
- D. BRANCH DUCTWORK SHALL BE THE SAME SIZE AS NECK SIZE SHOWN UNLESS OTHERWISE NOTED.
- E. REFER TO SPECIFICATIONS FOR DUCTWORK AND PIPING INSULATION REQUIREMENTS. DUCT SIZES ON MECHANICAL PLANS ARE INDICATED CLEAR INSIDE AIRFLOW DIMENSIONS. INCREASE SHEET METAL SIZES ACCORDINGLY TO ACCOUNT FOR THICKNESS OF DUCT LINER.
- F. THE ELECTRICAL SYSTEM DESIGN IS BASED IN PART ON THE SPECIFIED HVAC EQUIPMENT. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE THE ELECTRICAL REQUIREMENTS OF THE HVAC EQUIPMENT BEFORE FURNISHED. ANY ADDITIONAL ELECTRICAL SYSTEM DUE TO HVAC EQUIPMENT OTHER THAN THE SPECIFIED EQUIPMENT BEING FURNISHED SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.

1. CONNECT NEW EXHAUST TAP TO EXISTING EXHAUST DUCTWORK WITH DAMPER. BALANCE TO CFM SHOWN.
2. PROVIDE 40x16 TRANSFER DUCT ABOVE DROP CEILING. TURN UP ON BOTH SIDES OF THE WALL. LINE INSIDE OF DUCT WITH 1/2" ACOUSTIC LINER PER SPECIFICATIONS.
3. EXISTING FAN POWERED TERMINAL UNIT. PROVIDE NEW SUPPLY AND RETURN DUCTWORK AS SHOWN.
4. PROVIDE NEW VAV TERMINAL UNIT AS SCHEDULED. MECHANICAL CONTRACTOR SHALL INCLUDE ALL COSTS AND COORDINATION EFFORTS TO CONNECT NEW VAV BOX TO EXISTING BUILDING AUTOMATION SYSTEM.
5. RELOCATE EXISTING THERMOSTAT. MOUNT AT 54" AFF.
6. EXISTING TRANSFER DUCT TO REMAIN.

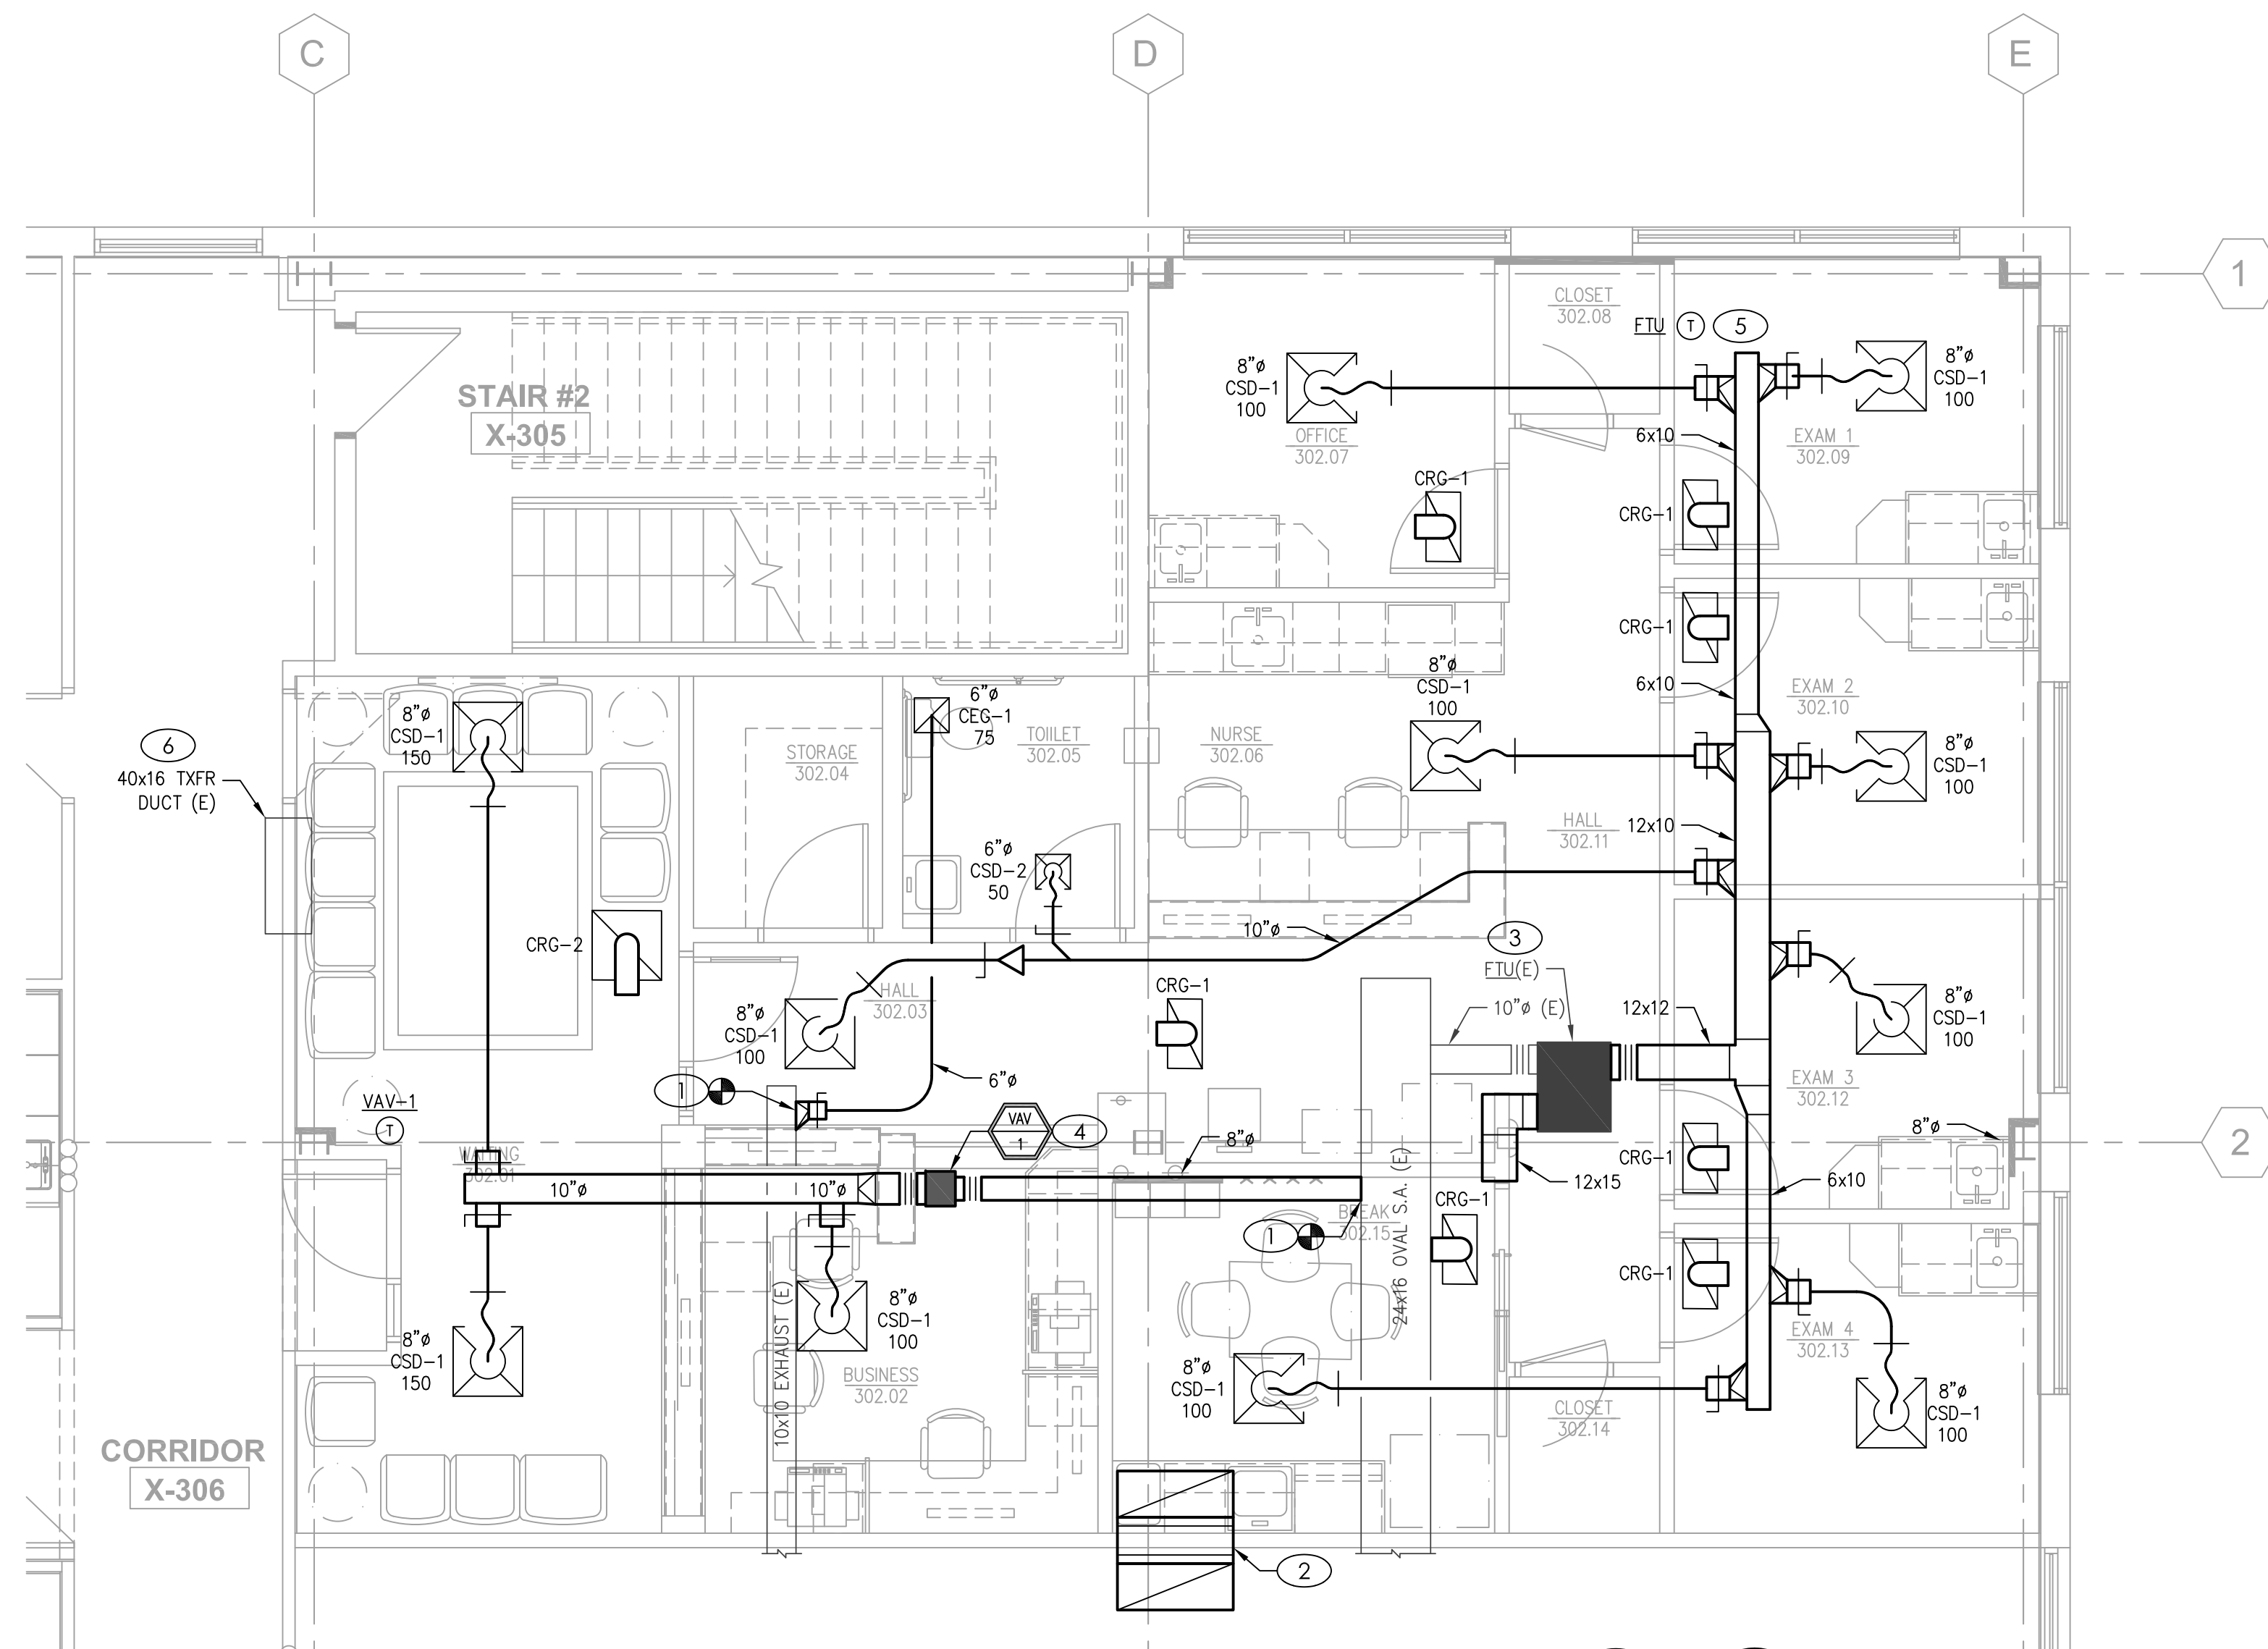

SCALE : 1/4" = 1'-0"

[illegible]

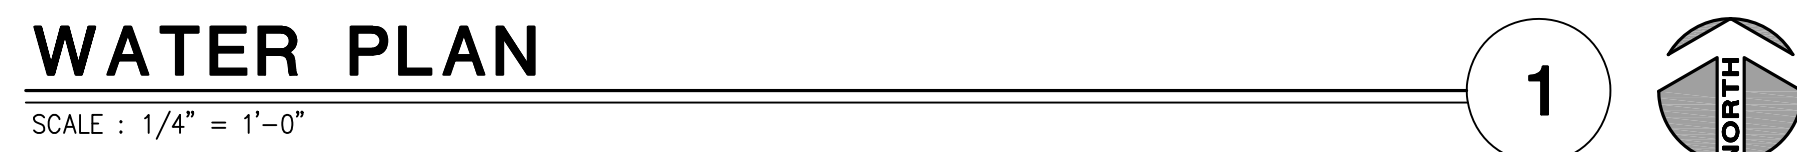


- A. DRAWINGS ARE DIAGRAMMATIC ONLY AND REPRESENT THE GENERAL SCOPE OF WORK. REVIEW THE GENERAL NOTES, SPECIFICATIONS AND PLANS FOR ADDITIONAL REQUIREMENTS THAT MAY NOT BE SPECIFICALLY CALLED OUT IN THIS PORTION OF THE CONSTRUCTION DOCUMENTS. NOTIFY ARCHITECT, ENGINEER AND/OR OWNER OF CONFLICTS OR DISCREPANCIES PRIOR TO SUBMISSION OF BID.
- B. COORDINATE INSTALLATION OF MECHANICAL AND PLUMBING SYSTEMS WITH OTHER TRADES TO ENSURE A NEAT AND ORDERLY INSTALLATION AND AVOID CONFLICTS. INSTALL DUCTWORK AND PIPING AS TIGHT TO STRUCTURE AS POSSIBLE. COORDINATE INSTALLATION OF DUCTWORK AND PIPING TO AVOID CONFLICTS WITH ELECTRICAL PANELS, LIGHTING FIXTURES, ETC. VERIFY DUCT SPACE AVAILABLE ABOVE ALL CEILINGS PRIOR TO ANY FABRICATION OF INSTALLATION.
- C. NEW MECHANICAL EQUIPMENT, DUCTWORK AND PIPING ARE SHOWN AT APPROXIMATE LOCATIONS. FIELD MEASURE FINAL DUCTWORK AND PIPING LOCATIONS PRIOR TO FABRICATION AND MAKE ADJUSTMENTS AS REQUIRED TO FIT THE DUCTWORK AND PIPING WITHIN THE AVAILABLE SPACE. VERIFY THAT FINAL EQUIPMENT LOCATIONS MEET MANUFACTURER'S RECOMMENDATIONS REGARDING SERVICE CLEARANCE AROUND EQUIPMENT.
- D. OVERHEAD HANGERS AND SUPPORTS FOR EQUIPMENT, DUCTWORK AND PIPING SHALL BE FASTENED TO BUILDING JOISTS OR BEAMS. DO NOT ATTACH HANGERS AND SUPPORTS TO THE ABOVE FLOOR SLAB OR ROOF.
- E. PROVIDE THE GC WITH A COPY OF THE INSPECTION REPORTS AND APPROVAL CERTIFICATES FROM LOCAL AND STATE INSPECTIONS.
- F. EXACT LOCATION AND ELEVATIONS OF ALL EXISTING UTILITIES SHALL BE VERIFIED PRIOR TO ANY INSTALLATION OR CONNECTIONS THEREOF. ALL CONNECTIONS TO EXISTING UTILITIES (IE: WATER, SEWER & GAS) SHALL BE MADE WITH APPROVAL OF THE ADMINISTRATIVE AUTHORITY AND THE RESPECTIVE UTILITY COMPANY.
- G. REFER TO PLUMBING FIXTURE SCHEDULE FOR MINIMUM BRANCH WASTE AND VENT PIPE SIZING.

1. CONNECT NEW 1-1/2" CW PIPING TO EXISTING 1-1/2" DOMESTIC WATER TAP IN TENANT SPACE.
2. WATER HEATER LOCATED ABOVE CEILING. ROUTE 3/4" HW & 3/4" CW TO WATER HEATER. PROVIDE 3/4" T&P RELIEF AND 3/4" CONTAINMENT PAN DRAINS FROM WATER HEATER TO FLOOR DRAIN IN RESTROOM. DISCHARGE WITH AIR GAP. SEE WATER HEATER DETAIL ON THIS SHEET FOR ADDITIONAL REQUIRED COMPONENTS AND INSTALLATION INSTRUCTIONS.
3. PROVIDE 1/2" HW & 1/2" CW DOWN IN WALL TO LAV. PROVIDE THERMOSTATIC MIXING VALVE FOR FIXTURE EQUAL TO LEONARD MODEL 170. SET HW SUPPLY WATER TEMPERATURE TO 110F.
4. 1/2" CW DOWN IN WALL TO WATER CLOSET.
5. 1/2" HW AND 1/2" CW DOWN IN WALL TO SINK.
6. 1/2" CW DOWN IN WALL TO ICE MAKER BOX.
7. 3/4" HW AND 3/4" CW DOWN TO BACK-TO-BACK FIXTURES. PROVIDE 1/2" HW AND 1/2" CW TO EACH FIXTURE.
8. 1/2" HW AND 1/2" CW DOWN TO FUTURE SINK LOCATION. CAP PIPES AND CONCEAL IN WALL.
9. 1/2" CW DOWN TO TRAP PRIMER THEN CONTINUED TO CONNECTION AT FLOOR DRAIN. WATTS LFT300 TRAP PRIMER, OR EQUAL. PROVIDE ACCESS PANEL.

[illegible]



MO COA NO. 2012006786
KS COA NO. E-2818
1901 NW BLUE PARKWAY,
UNITY VILLAGE, MO 64065
rd FLOOR UNITY VILLAGE TOWER
phone: (816) 272-5289
email: jsmothers@iscngineers.com

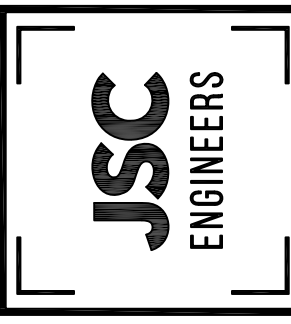

Lee's Summit Medical Center, MOB
Suite 2302
1980 SF Blue Parkway, Lee's Summit, MO 64063

This drawing has been provided as an instrument of service by the architect, or under his supervision and is intended for use on this project only. Pursuant to the Architectural Works Copyright Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Architect. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Architect is strictly prohibited.

© COPYRIGHT 2020 GUY

REV#	DATE	DESCRIPTION


DATE: 12-18-2020

PROJECT# 20-271

E2


- A. DRAWINGS ARE DIAGRAMMATIC AND SHALL NOT BE SCALED. REFER TO ARCHITECTURAL PLANS OR FIELD MEASUREMENTS FOR DIMENSIONS.
- B. ALL WORK SHALL COMPLY WITH THE LATEST ADOPTED EDITION OF THE NATIONAL ELECTRICAL CODE (NFPA 70) AND ALL LOCAL BUILDING CODES AND AMENDMENTS.
- C. ALL ROOF AND WALL PENETRATIONS SHALL BE COORDINATED WITH THE GENERAL CONTRACTOR. PROVIDE ALL REQUIRED SLEEVES, FLASHINGS, CURBS, REINFORCED ANGLES, SUPPORTING FRAMES, ETC. UNLESS THEY ARE SPECIFICALLY CALLED OUT TO BE FURNISHED BY OTHERS.
- D. COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRED TO PROPERLY INSTALL ALL SYSTEMS AS INTENDED, WITHIN THE CONFINES OF THE SPACE AVAILABLE, AND WITHOUT INTERFERENCES.
- E. THIS CONTRACTOR SHALL PERFORM ALL WORK INDICATED AND/OR AS REQUIRED FOR THE PROPER INSTALLATION AND OPERATION OF THE ELECTRICAL SYSTEMS.
- F. PROVIDE CONSTANT UNSWITCHED HOT LEG TO ALL LIGHTS WITH EMERGENCY BATTERY PACKS AND ALL OUTDOOR SCONCES.
- G. THE ELECTRICAL SYSTEM DESIGN IS BASED IN PART ON THE SPECIFIED HVAC EQUIPMENT. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE THE EXACT LOCATIONS AND ELECTRICAL REQUIREMENTS OF ALL HVAC EQUIPMENT BEING FURNISHED. ANY CHANGES TO THE ELECTRICAL SYSTEM DUE TO HVAC EQUIPMENT SUBSTITUTION SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.
- H. ALL WIRING SHALL BE IN APPROVED RACEWAY.
- I. WIRE SIZE SHALL BE MINIMUM #12 AWG, THWN SOLID COPPER UNLESS OTHERWISE NOTED. FROM GROUND, WIRE WHERE REQUIRED BY CODE, INCREASE WIRE SIZE TO COMPENSATE FOR VOLTAGE DROP WHERE TOTAL LENGTH OF ANY BRANCH EXCEEDS 100 FEET.
- J. MAXIMUM NUMBER OF UNGROUNDED WIRES IN ANY CONDUIT SHALL BE THREE. ADDITIONAL WIRES ARE ACCEPTABLE IF WIRE SIZE IS INCREASED TO ALLOW FOR OPERATING PER CODE. PROVIDE ADDITIONAL WIRES FOR SWITCHING AS REQUIRED.
- K. FIRE ALARM, AUDIO/VIDEO AND SURVEILLANCE SYSTEMS BY OTHERS.
- J. ALL CIRCUIT NUMBERS SHOWN NEXT TO DEVICES ARE ASSOCIATED WITH THE HOMERUN GROUND AT A NEARBY DEVICE AND SHALL TERMINATE AT THE DESIGNATED PANELBOARD CIRCUIT BREAKER.
- K. EC TO PROVIDE AND INSTALL RECEPTABLES, CAPS, AND CORDS AS REQUIRED. CAPS AND CORDS ARE TO BE INSTALLED ACCORDING TO THE MANUFACTURER'S INSTRUCTIONS.
- L. ALL ELECTRICAL WIRING, CONDUITS, AND CABLING IN PATIENT CARE AREAS (INCLUDING, BUT NOT LIMITED TO, "EXAM" AND "OFFICE" ROOMS) ARE TO BE MEDICAL GRADE PER NEC REQUIREMENTS.
- M. ELECTRICAL PANELBOARDS EXIST ROUGHLY 50' SOUTH OF SOUTHEAST CORNER OF SCOPE AREA ON OPPOSITE SIDE OF CORRIDOR X-306 IN ELEC (COMMUNICATIONS) 309 ROOM.


1. CEILING MOUNTED OCCUPANCY SENSOR – WATTSTOPPER DT-300 SERIES OR PRE-BID APPROVED EQUIP. INSTALL AND MAKE ALL CONNECTIONS PER MANUFACTURER'S RECOMMENDATIONS TO MAKE COMPLETE SYSTEM ACCORDING TO DESIGN INTENT.
2. LIGHTING CONTROLS POWER PACK – WATTSTOPPER BZ-150 OR PRE-BID APPROVED EQUIP. INSTALL AND MAKE ALL CONNECTIONS PER MANUFACTURER'S RECOMMENDATIONS TO MAKE COMPLETE SYSTEM ACCORDING TO DESIGN INTENT.
3. WALL SWITCH OCCUPANCY SENSOR – WATTSTOPPER PW-100 SERIES OR PRE-BID APPROVED EQUIP. INSTALL AND MAKE ALL CONNECTIONS PER MANUFACTURER'S RECOMMENDATIONS TO MAKE COMPLETE SYSTEM ACCORDING TO DESIGN INTENT.
4. UNDERCABINET LIGHT FIXTURES, PROVIDE DRIVERS AS NECESSARY, INSTALL AND MAKE ALL CONNECTIONS PER MANUFACTURER'S RECOMMENDATIONS TO MAKE COMPLETE SYSTEM ACCORDING TO DESIGN INTENT. COORDINATE EXACT SIZE, LOCATION, AND MOUNTING STYLE WITH ARCHITECT PRIOR TO CONSTRUCTION.

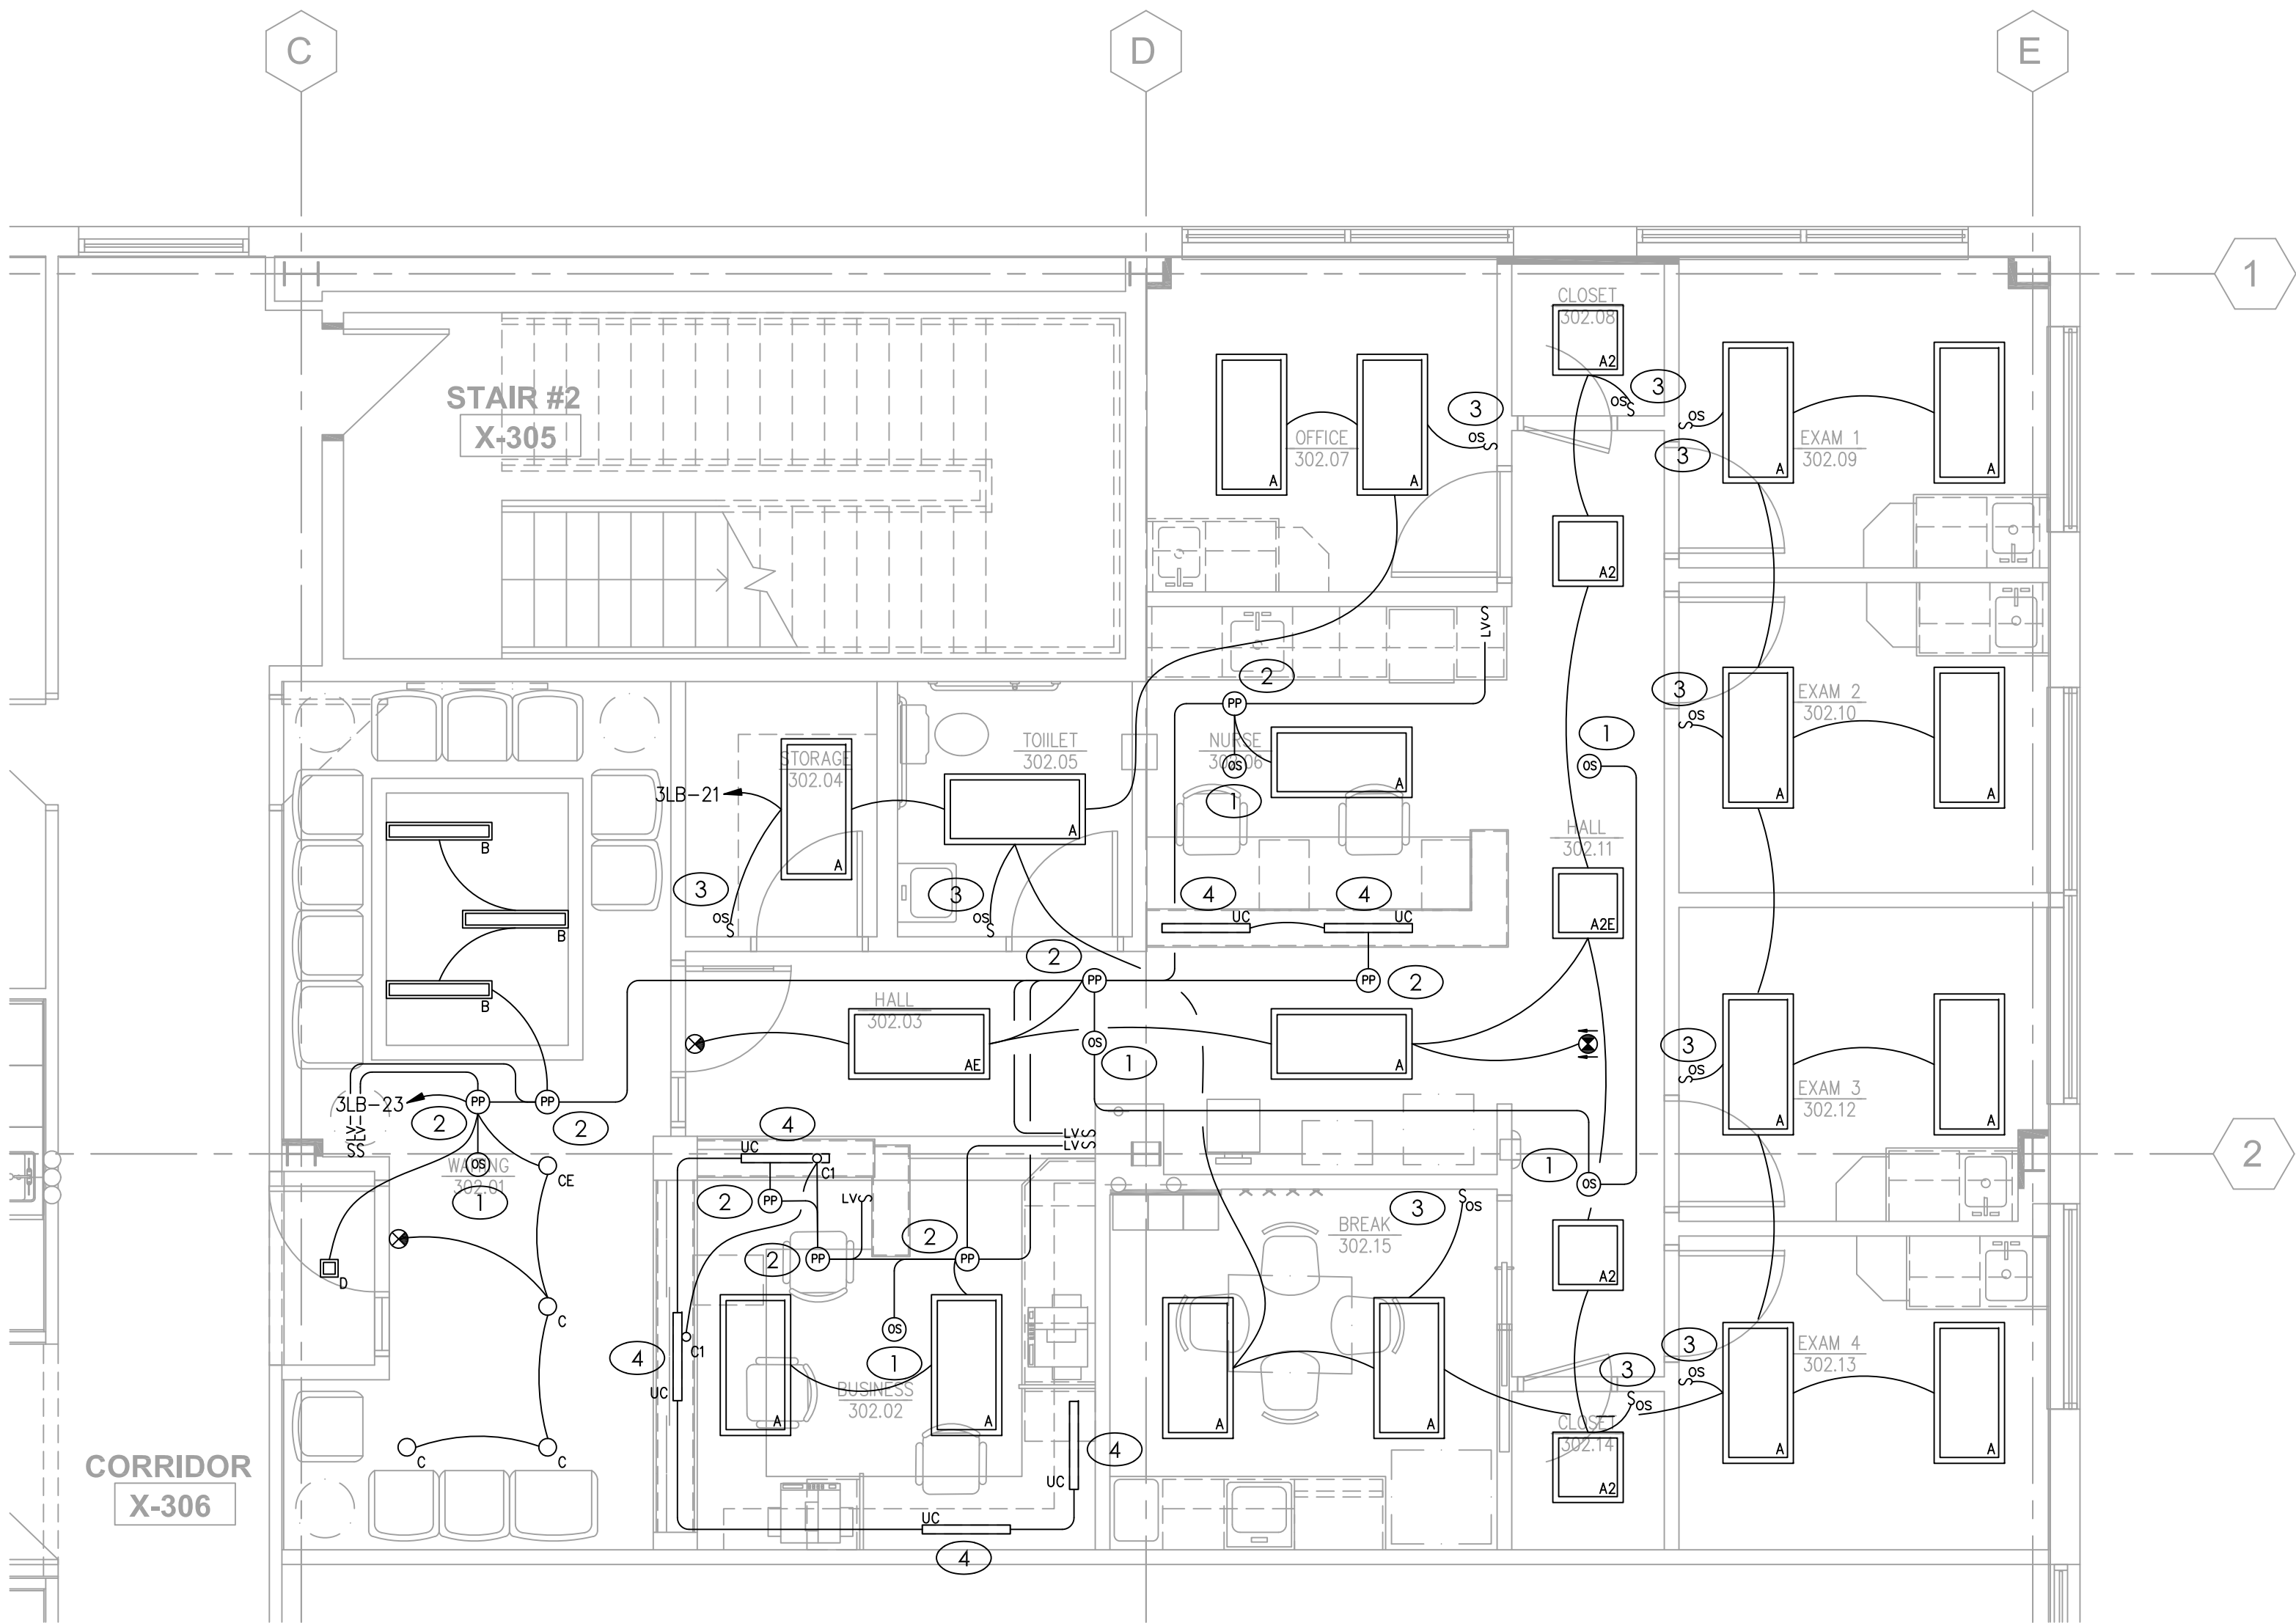



SCALE : $1/4" = 1'-0"$

1



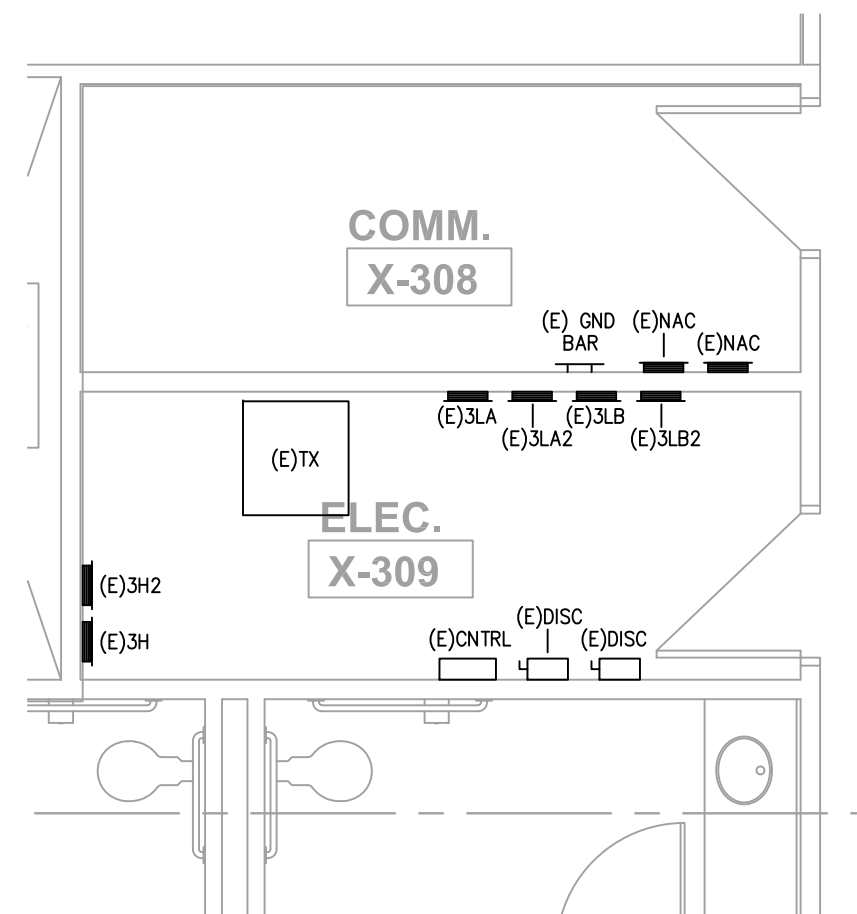


2

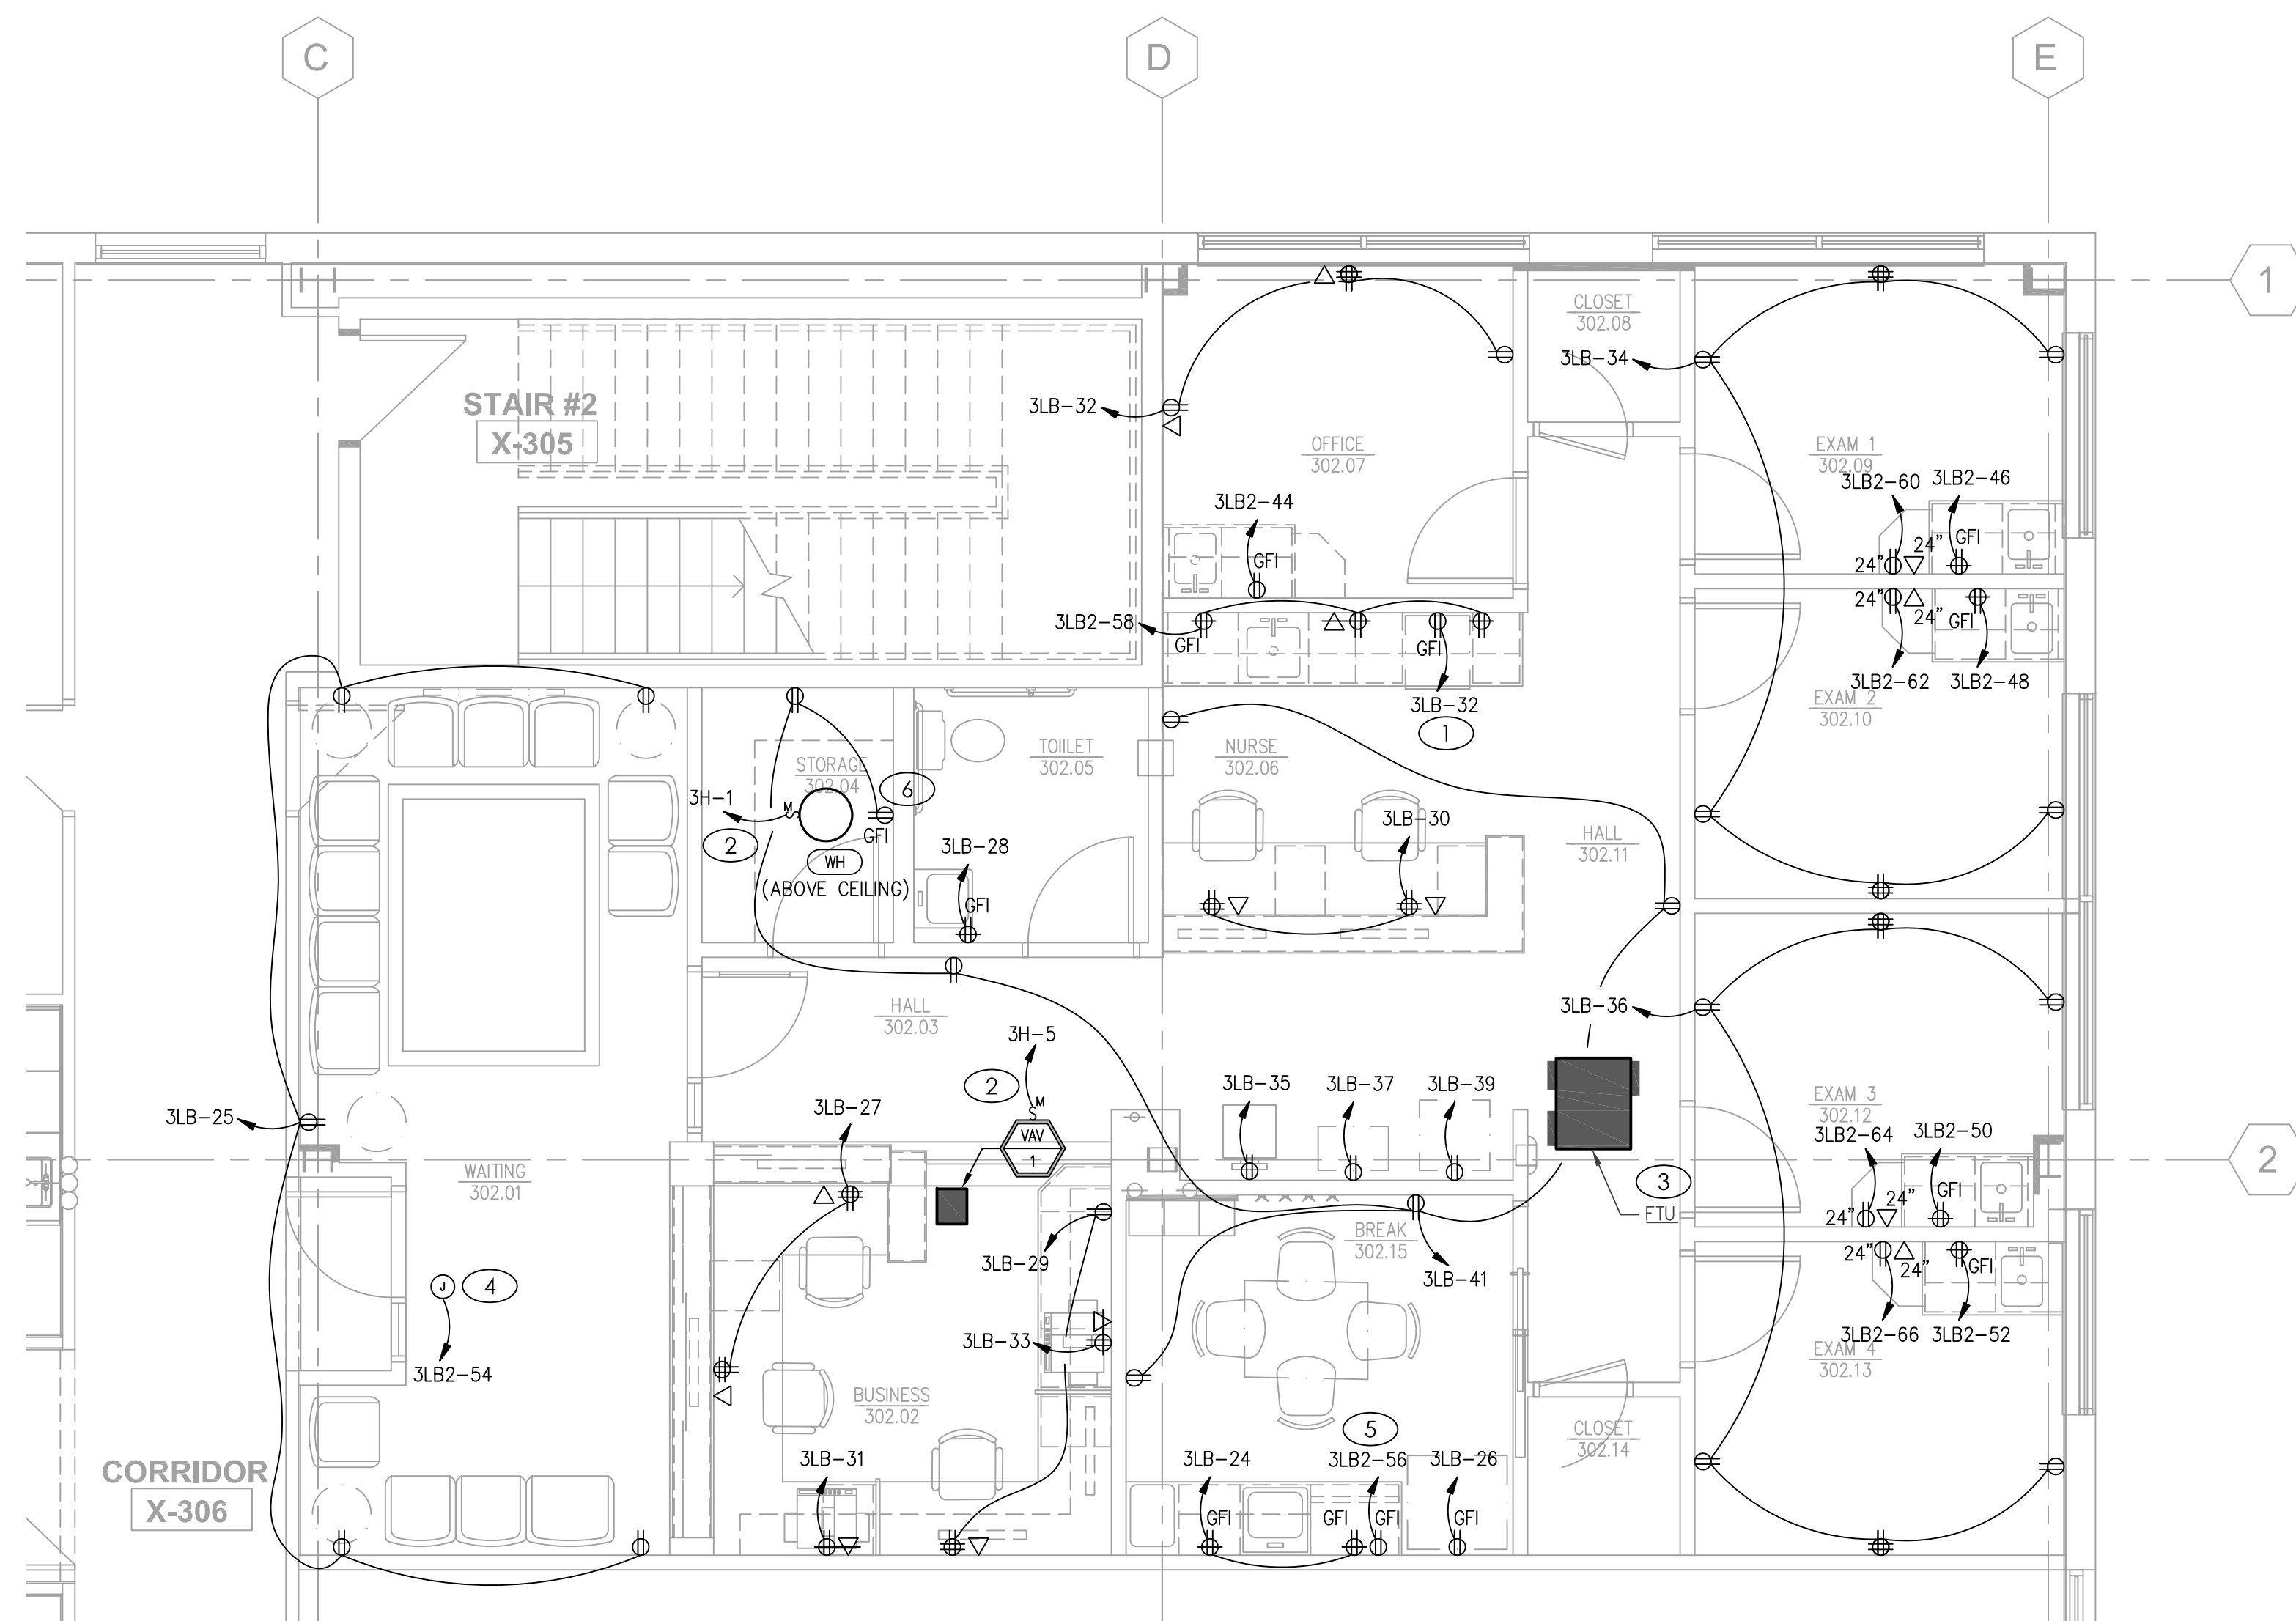

1




- B. DRAWINGS ARE DIAGRAMMATIC AND SHALL NOT BE SCALED. REFER TO ARCHITECTURAL PLANS OR FIELD MEASUREMENTS FOR DIMENSIONS.
- B. ALL WORK SHALL COMPLY WITH THE LATEST ADOPTED EDITION OF THE NATIONAL ELECTRICAL CODE (NFPA 70) AND ALL LOCAL BUILDING CODES AND AMENDMENTS.
- C. ALL ROOF AND WALL PENETRATIONS SHALL BE COORDINATED WITH THE GENERAL CONTRACTOR. PROVIDE ALL REQUIRED SLEEVES, FLASHINGS, CURBS, REINFORCED ANGLES, SUPPORTING FRAMES, ETC. UNLESS THEY ARE SPECIFICALLY CALLED OUT TO BE FURNISHED BY OTHERS.
- D. COORDINATE ALL WORK WITH OTHER TRADES AND EXISTING CONDITIONS AS REQUIRED TO PROPERLY INSTALL ALL SYSTEMS AS INTENDED, WITHIN THE CONFINES OF THE SPACE AVAILABLE, AND WITHOUT INTERFERENCES.
- E. THIS CONTRACTOR SHALL PERFORM ALL WORK INDICATED AND/OR AS REQUIRED FOR THE PROPER INSTALLATION AND OPERATION OF THE ELECTRICAL SYSTEMS.
- F. PROVIDE CONSTANT UNSWITCHED HOT LEG TO ALL LIGHTS WITH EMERGENCY BATTERY PACKS AND ALL OUTDOOR SCENES.
- G. THE ELECTRICAL SYSTEM DESIGN IS BASED IN PART ON THE SPECIFIED HVAC EQUIPMENT. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO COORDINATE THE EXACT LOCATIONS AND ELECTRICAL REQUIREMENTS OF ALL HVAC EQUIPMENT BEING FURNISHED. ANY CHANGES TO THE ELECTRICAL SYSTEM DUE TO HVAC EQUIPMENT SUBSTITUTIONS SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.
- H. ALL WIRING SHALL BE IN APPROVED RACEWAY.
- I. WIRE SIZE SHALL BE MINIMUM #12 AWG, THWN SOLID COPPER UNLESS OTHERWISE NOTED. PROVIDE GROUND WIRE WHERE REQUIRED BY CODE. INCREASE WIRE SIZE TO COMPENSATE FOR VOLTAGE DROP WHERE TOTAL LENGTH OF ANY BRANCH EXCEEDS 100 FEET.
- J. MAXIMUM NUMBER OF UNGROUNDED WIRES IN ANY CONDUIT SHALL BE THREE. ADDITIONAL WIRES ARE ACCEPTABLE IF WIRE SIZE IS INCREASED TO ALLOW FOR DERATING PER CODE. PROVIDE ADDITIONAL WIRES FOR SWITCHING AS REQUIRED.
- K. FIRE ALARM, AUDIO/VIDEO AND SURVEILLANCE SYSTEMS BY OTHERS.
- J. ALL CIRCUIT NUMBERS SHOWN NEXT TO DEVICES ARE ASSOCIATED WITH THE HOMERUN SHOWN AT A NEARBY DEVICE AND SHALL TERMINATE AT THE DESIGNATED PANELBOARD CIRCUIT BREAKER.
- K. EC TO PROVIDE AND INSTALL RECEPTACLES, CAPS, AND CORDS AS REQUIRED. CAPS AND CORDS ARE TO BE INSTALLED ACCORDING TO THE MANUFACTURER'S INSTRUCTIONS.
- L. ALL ELECTRICAL WIRING, CONDUITS, AND CABLEING IN PATIENT CARE AREAS (INCLUDING, BUT NOT LIMITED TO, "EXAM" AND "OFFICE" ROOMS) ARE TO BE MEDICAL GRADE PER NEC REQUIREMENTS.
- M. ELECTRICAL PANELBOARDS EXIST ROUGHLY 50' SOUTH OF SOUTHEAST CORNER OF SCOPE AREA ON OPPOSITE SIDE OF CORRIDOR X-306 IN ELEC (COMMUNICATIONS) 309 ROOM.

1. RECEPTACLE FOR UNDERCOUNTER REFRIGERATOR. COORDINATE EXACT LOCATION WITH ARCHITECT PRIOR TO CONSTRUCTION.
2. MAKE CONNECTION TO DIVISION 22/23 EQUIPMENT PER MANUFACTURER'S RECOMMENDATIONS AND NEC REQUIREMENTS. COORDINATE ELECTRICAL CONNECTION WITH DIVISION 22/23 CONTRACTOR PRIOR TO CONSTRUCTION.
3. EXISTING FAN-POWERED VAV UNIT TO REMAIN. CONFIRM ALL ELECTRICAL CONNECTIONS ARE MADE PER MANUFACTURER'S RECOMMENDATIONS AND NEC REQUIREMENTS.
4. JUNCTION BOX ABOVE CEILING FOR CONNECTION TO FUTURE DOOR OPERATOR AND/OR ELECTRIC STRIKE. COORDINATE EXACT LOCATION WITH ARCHITECT PRIOR TO CONSTRUCTION.
5. RECEPTACLE TO BE MOUNTED IN CLOSED CABINET ABOVE MICROWAVE SHELF. COORDINATE EXACT LOCATION WITH ARCHITECT PRIOR TO CONSTRUCTION.
6. RECEPTACLE TO BE MOUNTED TO STRUCTURE ABOVE CEILING IN PLENUM SPACE ADJACENT TO WATER HEATER TO SERVE DIVISION 22 SENSOR EQUIPMENT. COORDINATE EXACT LOCATION OF RECEPTACLE WITH DIVISION 22 CONTRACTOR PRIOR TO CONSTRUCTION.



MO COA NO. 2012006786
KS COA NO. E-2818
1901 NW BLUE PARKWAY,
UNITY VILLAGE, MO 64065
rd FLOOR UNITY VILLAGE TOWER
phone: (816) 272-5289
email: jsmothers@scengineers.com

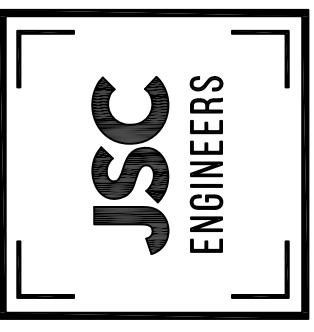

Lee's Summit Medical Center, MOB
Suite 2302
1980 SE Blue Parkway, Lee's Summit, MO 64063

This drawing has been provided as an instrument of service by the architect, or under his supervision and is intended for use on this project only. Pursuant to the provisions of the Copyright Act of 1976, all drawings, specifications, notes and designs, including the overall form, arrangement and composition of scenes and elements appearing herein, constitute the original, copyrighted work of the Designer/Architect. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Architect is strictly prohibited.

©COPYRIGHT 2020 GUY GRONBERG ARCHITECTS, P.C.

REV#	DATE	DESCRIPTION

DATE: 12-18-2020
PROJECT # 20-271

E3


FIXTURE TYPE	MANUFACTURER		VOLT AMPS	MOUNTING	LAMP TYPE	REMARKS	VOLT
	NAME	CATALOG NUMBER					
A	LITHONIA	2BLT4-60L-ADP-EZ1-LP840	48	GRID	INCLUDED 4000K LED	2' X 4' DIMMABLE LED TROFFER - VOLUMETRIC RECESSED	MVOLT
AE	LITHONIA	2BLT4-60L-ADP-EZ1-LP840-EL14LSD	48	GRID	INCLUDED 4000K LED	2' X 4' DIMMABLE LED TROFFER - VOLUMETRIC RECESSED - WITH EMERGENCY BATTERY PACK OPTION	MVOLT
A2	LITHONIA	2BLT2-40L-ADP-EZ1-LP840	32	GRID	INCLUDED 4000K LED	2' X 2' DIMMABLE LED TROFFER - VOLUMETRIC RECESSED	MVOLT
A2E	LITHONIA	2BLT2-40L-ADP-EZ1-LP840-EL14LSD	32	GRID	INCLUDED 4000K LED	2' X 2' DIMMABLE LED TROFFER - VOLUMETRIC RECESSED - WITH EMERGENCY BATTERY PACK OPTION	MVOLT
B	MARK ARCHITECTURAL	SLOT 4 RECESSED	8/FT	FLANGED - RECESSED	INCLUDED 4000K LED	4" WIDE RECESSED LINEAR FIXTURE - FLUSH LENS - 800 LMF - 3' LENGTH - BLACK FINISH	MVOLT
C	LITHONIA	LDN6-40/154-06-AR-LSS-MVOLT-EZ1	17.5	RECESSED	INCLUDED 4000K LED	6" LED DOWNLIGHT	120
CE	LITHONIA	LDN6-40/154-06-AR-LSS-MVOLT-EZ1-ELSD	17.5	RECESSED	INCLUDED 4000K LED	6" LED DOWNLIGHT WITH EMERGENCY BATTERY OPTION	120
C1	LITHONIA	LDN3-40/05-LO3-AR-LSS-MVOLT-UGZ	6.27	RECESSED	INCLUDED 4000K LED	6" LED DOWNLIGHT	120
D	LITHONIA	LDN4SQ-40/10-LS4-AR-LSS-MVOLT-EZ1	10.6	RECESSED	INCLUDED 4000K LED	4" SQUARE LED DOWNLIGHT	120
UC	LITHONIA	UCEL UNDERCABINET	10.2	SURFACE	INCLUDED 3000K LED	24" [2' NOMINAL] LED UNDERCABINET FIXTURE - ORDER WITH ROCKER SWITCH "SWR" OPTION	120
ⓧ	LITHONIA	LQM	5	WALL	INCLUDED LED	LED RED LETTER EXIT SIGN LUMINAIRE WITH 90 MIN EMERGENCY BATTERY PACK	120
ⓧ	LITHONIA	LQM - DOUBLE SIDED	5	SURFACE	LED INCLUDED	LED RED LETTER EXIT SIGN LUMINAIRE WITH 90 MIN EMERGENCY BATTERY PACK - DOUBLE SIDED	120

SCALE : NO SCALE

4

PANELBOARD NOTES
DESCRIPTION IN ITALICS = EXISTING LABELED LOAD TO REMAIN

PANELBOARD NOTES
DESCRIPTION IN ITALICS = EXISTING LABELED LOAD TO REMAIN.

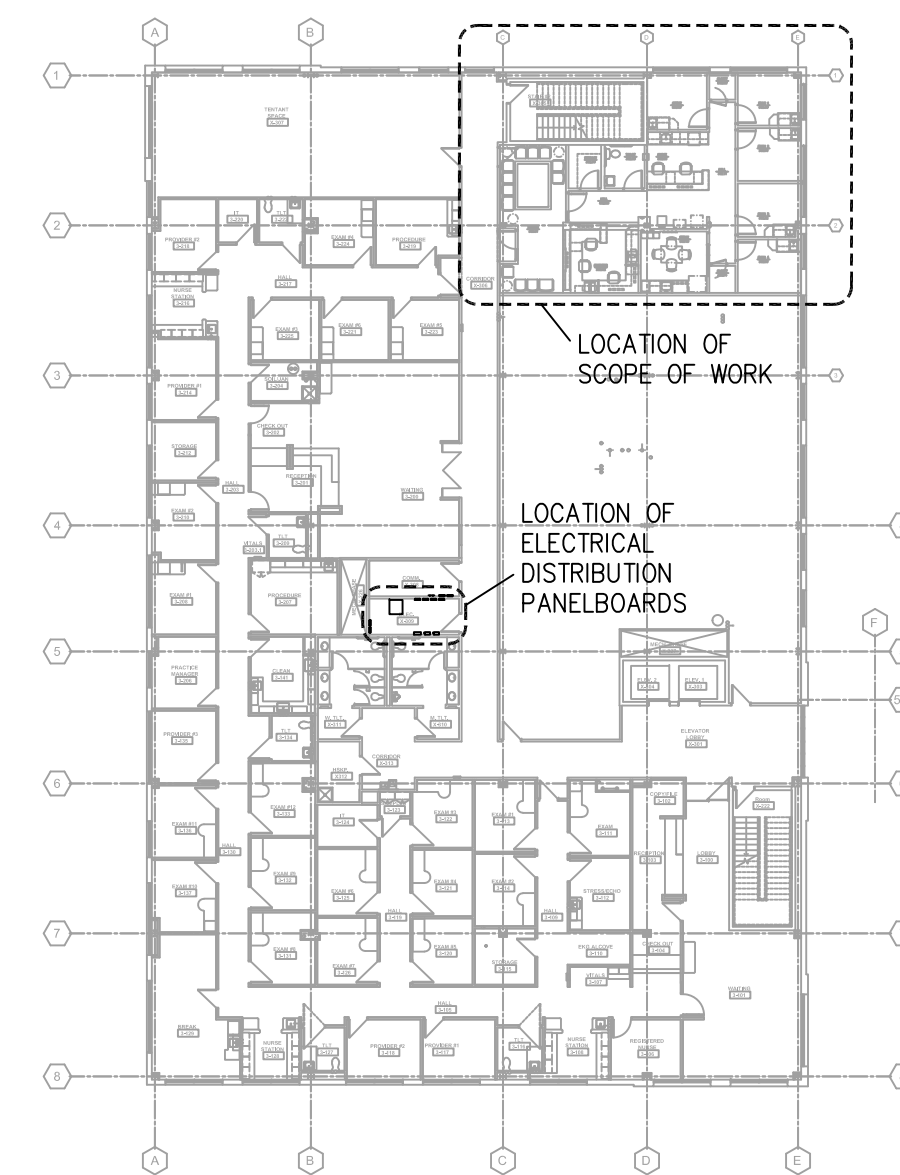

SCALE : 1/32" = 1'-0"

3

ELECTRIC SERVICE SINGLE LINE DIAGRAM IS EXISTING TO REMAIN. NO MODIFICATIONS ARE BEING MADE TO THE SEQUENCE OF ELECTRICAL SERVICE DISTRIBUTION EQUIPMENT IN THIS SCOPE.

2

SCALE : NO SCALE

1