RESIDENTIAL ENGINEERING SERVICES, LLC SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY
AND GENERAL CONFORMANCE TO CONTRACT
DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE
FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

STATUS:


APPROVED

12.22.2020

REVIEWED BY:

BH

ENGINEER, RESIDENTIAL ENGINEERING SERVICES, LLC

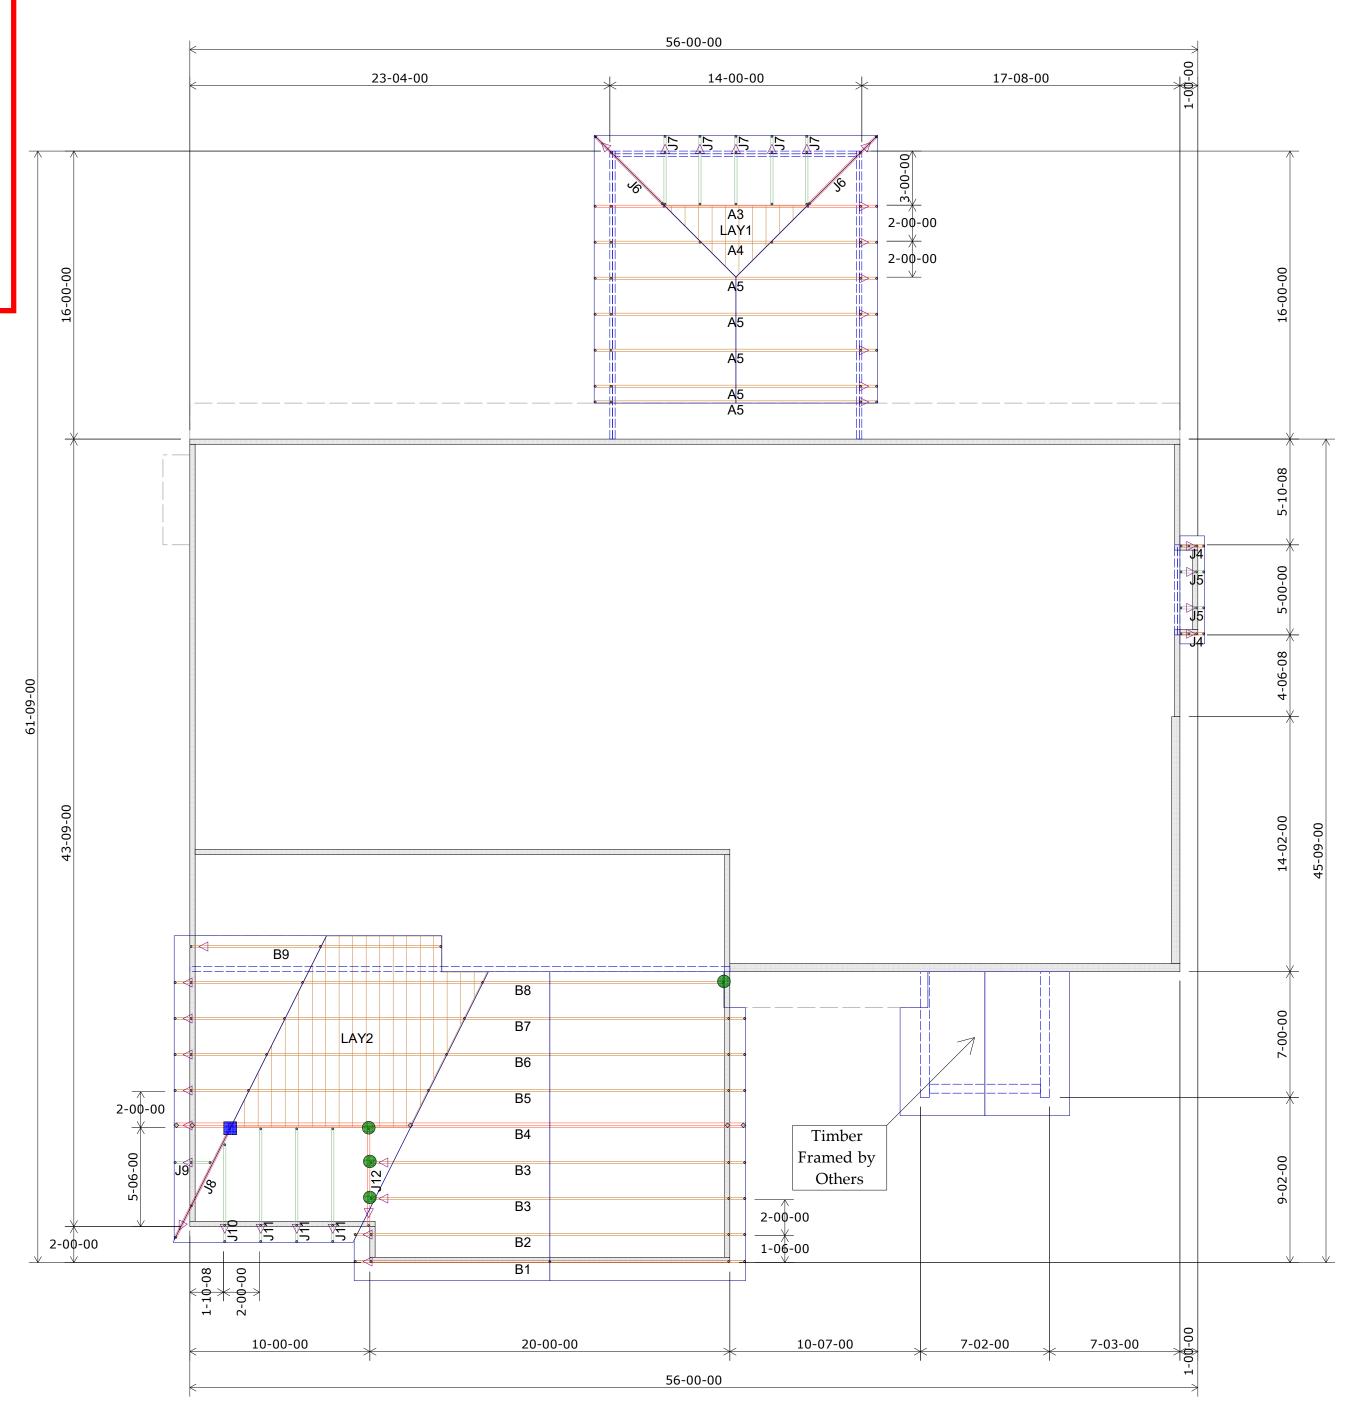

1st Floor Truss Layout Scale: 3/16" = 1'

	HANGER SCHEDULE	Quantity							
	LUS24	0				МО			
	LUS26	0							
	HUS26	9							
A	HHUS26-2	0	SUMMIT HOMES Lot 73 Woodside Ridge) Dr		0			
A	HGUS26-2	0		Rid	345 NW Ambersham		424		
	HGUS28-3	0)MI)MI 			746-		
	LTHJA26	0	НС	poo	√m	ımi	85-7		
	TJC37	1	MIT	3 W.	W	Sun	e 78		
	TJC57	4	SUMMIT HOMES	ot 73	15 N	Lee's Summit	Chance 785-746-4240	# q	
<u> </u>	HTS20	0	SI	Ľ	34	Le	Ü	Job	
of	Triangle denotes the left end of the Truss as it appears on the Engineered Drawings				ddress	State			
	provided.			Job Name	Job Site Address	City,	Designer	12/2/2020	



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871

