

LEE'S SUMMIT HONDA PHOTOVOLTAIC SYSTEM

149.48 kW DC
100 kW AC

SYSTEM DESCRIPTION	
INVERTER	(5) FRONIUS SYMO ADVANCED 20.0-3
MODULES	(404) BOVIET SOLAR BVM6612M 370
RACKING	UNIRAC RM10
TILT	10°



SHEET INDEX	
T1	TITLE PAGE
G1	GENERAL NOTES
E1	SITE LAYOUT
E2	ELECTRICAL LAYOUT
E3	SINGLE LINE DIAGRAM
E4	NEC REQUIRED LABELS
S1	RACKING LAYOUT
D1	DATASHEETS

APPROVALS

THE FOLLOWING PARTIES HEREBY APPROVE AND ACCEPT THESE DOCUMENTS AND AUTHORIZE THE CONTRACTOR TO PROCEED WITH THE CONSTRUCTION DESCRIBED HEREIN. ALL DOCUMENTS ARE SUBJECT TO REVIEW BY THE LOCAL BUILDING DEPARTMENT AND MAY IMPOSE CHANGES OR SITE MODIFICATIONS.

ARTISUN SOLAR: _____ DATE: _____

CONTRACTOR /
LEAD INSTALLER: _____ DATE: _____

Artisun Solar

12916 5TH ST
GRANDVIEW, MO 64030
PH: (913) 396-3880

PROJECT NAME
LEE'S SUMMIT HONDA -
149.48kWdc

SITE LOCATION
401 NE COLBERN RD
LEE'S SUMMIT, MO

DESIGNER
SOLAR EXPRESS, LLC
5658 LACY RD
FITCHBURG, WI 53711
PHONE: 920-912-2508
CERTIFICATE OF AUTHORITY: E-2019000337

ENGINEER'S STAMP



12/10/2020

Nate Kautzer

DRAWING ISSUE

12/10/2020

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI

01/19/2021

REVISION













DOCUMENT TITLE
TITLE PAGE

DRAWN BY NJK

SHEET

0 1/2 1

T1

ABBREVIATIONS	SYMBOLS LEGEND	SYSTEM NOTES	GENERAL NOTES
<div><div>A</div><div>AMPERE</div><div>AC</div><div>ALTERNATING CURRENT</div><div>AFCI</div><div>ARC-FAULT CIRCUIT INTERRUPTER</div><div>AHJ</div><div>AUTHORITY HAVING JURISDICTION</div><div>AIC</div><div>AMERAGE INTERRUPTION CAPACITY</div><div>ATS</div><div>AUTOMATIC TRANSFER SWITCH</div><div>AWG</div><div>AMERICAN WIRE GAUGE</div><div>CB-#</div><div>COMBINER BOX</div><div>DAS</div><div>DATA AQUISITION SYSTEM</div><div>DC</div><div>DIRECT CURRENT</div><div>DWG</div><div>DRAWING</div><div>EMT</div><div>ELECTRICAL METALLIC TUBE</div><div>GFCI</div><div>GROUND FAULT CIRCUIT INTERRUPTER</div><div>GFP</div><div>GROUND FAULT PROTECTION</div><div>GND</div><div>GROUND</div><div>GEC</div><div>GROUNDING ELECTRODE CONDUCTOR</div><div>IBC</div><div>INTERNATIONAL BUILDING CODE</div><div>IFC</div><div>INTERNATIONAL FIRE CODE</div><div>KW</div><div>KILOWATT</div><div>MCB</div><div>MAIN CIRCUIT BREAKER</div><div>MDP</div><div>MAIN DISTRIBUTION PANEL</div><div>MLO</div><div>MAIN LUG ONLY</div><div>MTS</div><div>MANUAL TRANSFER SWITCH</div><div>N</div><div>NEUTRAL</div><div>NEC</div><div>NATIONAL ELECTRICAL CODE</div><div>NTS</div><div>NOT TO SCALE</div><div>OC</div><div>ON CENTER</div><div>OCPD</div><div>OVERCURRENT PROTECTION DEVICE</div><div>P</div><div>POLE</div><div>PH</div><div>PHASE</div><div>POC</div><div>POINT OF CONNECTION</div><div>PV</div><div>PHOTOVOLTAIC</div><div>RMC</div><div>RIGID METALLIC CONDUIT</div><div>SC</div><div>SOURCE CIRCUIT</div><div>TYP</div><div>TYPICAL</div><div>UL</div><div>UNDERWRITERS LABORATORY</div><div>V</div><div>VOLT OR VOLTAGE</div><div>W</div><div>WATT</div><div>XFMR</div><div>TRANSFORMER</div></div>	<div><div><div></div><div>ELECTRICAL BREAKER</div></div><div><div></div><div>ELECTRICAL DISCONNECT SWITCH</div></div><div><div></div><div>ELECTRICAL FUSE</div></div><div><div></div><div>ELECTRICAL FUSED DISCONNECT SWITCH</div></div><div><div></div><div>METER</div></div><div><div></div><div>SYSTEM OR EQUIPMENT GROUND</div></div><div><div></div><div>CONDUIT DOWN</div></div><div><div></div><div>CONTINUATION OF CONDUIT</div></div><div><div></div><div>PHOTOVOLTAIC (PV) MODULE</div></div><div><div></div><div>DC/AC INVERTER</div></div><div><div></div><div>POWER TRANSFORMER</div></div><div><div></div><div>CONNECTED CONDUCTOR</div></div></div>	<div><div>1. SOLAR ARRAY CONSISTS OF PV MODULES, CONNECTED IN SERIES.</div><div>2. ARRAYS HAVE BEEN PLACED TO MINIMIZE OR ELIMINATE SHADING IMPACT FROM ADJACENT STRUCTURES AND/OR OBSTRUCTIONS.</div><div>3. ALL ARRAY LAYOUTS ADHERE TO 2015 IFC LOCAL AHJ REQUIREMENTS FOR SETBACKS AND PATHWAYS.</div><div>4. MINIMUM 3 FOOT CLEARANCE PROVIDED FOR ALL ROOF TOP HVAC UNITS AND SERVICEABLE EQUIPMENT. MINIMUM 4 FOOT SETBACK TO ROOF EDGE.</div><div>5. INVERTERS SHALL BE TRANSFORMERLESS STRING INVERTERS, LOCATION PER PLAN.</div></div>	<div><div>1. ALL ELECTRICAL WORK SHALL BE PERFORMED BY A QUALIFIED LICENSED ELECTRICIAN AND/OR APPRENTICES WORKING UNDER THE DIRECT SUPERVISION OF THE LICENSED CONTRACTOR.</div><div>2. ALL WORK CARRIED OUT SHALL COMPLY WITH THE SPECIFICATIONS, APPLICABLE MUNICIPAL AND UTILITY COMPANY SPECIFICATIONS AND LOCAL JURISDICTIONAL CODES, ORDINANCES, AND APPLICABLE REGULATIONS.</div><div>3. PRIOR TO COMMENCEMENT OF ANY WORK, THE CONTRACTOR SHALL NOTIFY THE ENGINEER OF AN DISCREPANCIES NOTED AMONG SITE CONDITIONS, MANUFACTURER RECOMMENDATIONS, OR AUTHORITY HAVING JURISDICTION. IF THE SPECIFIED EQUIPMENT CANNOT BE INSTALLED AS SHOWN ON THESE DRAWINGS, THE CONTRACTOR SHALL SUBMIT TO THE ENGINEER OF RECORD A WRITTEN "RFI"(REQUEST FOR INFORMATION) PROPOSING AN ALTERNATIVE OR SEEKING CLARIFICATION.</div><div>4. THE CONTRACTOR SHALL MAINTAIN IN GOOD CONDITION ONE COMPLETE SET OF PLANS WITH ALL REVISIONS, ADDENDA, AND CHANGE ORDERS ON THE PREMISES AT ALL TIMES.</div><div>5. UNLESS NOTED OTHERWISE, THE WORK SHALL INCLUDE FURNISHING MATERIALS, EQUIPMENT, ACCESSORIES, AND LABOR NECESSARY TO COMPLETE ALL INSTALLATIONS AS INDICATED ON THE DRAWINGS.</div><div>6. ALL MATERIALS FURNISHED AND INSTALLED SHALL BE IN STRICT ACCORDANCE WITH ALL APPLICABLE CODES, REGULATIONS, AND ORDINANCES. CONTRACTOR SHALL ISSUE ALL APPROPRIATE NOTICES AND COMPLY WITH ALL LAWS, ORDINANCES, RULES, REGULATIONS, AND LAWFUL ORDERS OF ANY PUBLIC AUTHORITY REGARDING THE PERFORMANCE OF WORK.</div><div>7. THE CONTRACTOR SHALL INSTALL ALL EQUIPMENT AND MATERIALS IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS UNLESS SPECIFICALLY STATED OTHERWISE.</div><div>8. CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY OF WORK AREA, ADJACENT AREAS AND BUILDING OCCUPANTS THAT ARE LIKELY TO BE AFFECTED BY THE WORK UNDER THIS CONTRACT. WORK SHALL CONFORM TO ALL OSHA REQUIREMENTS AND THE LOCAL JURISDICTION.</div><div>9. FALL ARREST PROTECTION PER OSHA REQUIREMENTS SHALL BE PROVIDED FOR ALL ROOF WORK.</div><div>10. WHEN INSTALLING IN FIRE RATED AREAS, SEAL ALL PENETRATIONS WITH UL LISTED MATERIALS APPROVED BY LOCAL JURISDICTION. CONTRACTOR SHALL KEEP AREA CLEAN, HAZARD FREE, AND DISPOSE OF ALL DEBRIS.</div><div>11. CONTRACTOR SHALL LEAVE PREMISES IN A CLEAN CONDITION. ALL DEBRIS AND OTHER REFUSE SHALL BE REMOVED FROM THE SITE AND DISPOSED OF IN A LAWFUL MANNER.</div><div>12. THE CONTRACTOR SHALL PROTECT EXISTING IMPROVEMENTS, PAVEMENTS, CURBS, LANDSCAPING AND STRUCTURES NOT PART OF THE SCOPE OF WORK AS IDENTIFIED IN THESE PLANS.</div><div>13. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SECURITY OF THE SITE FOR THE DURATION OF CONSTRUCTION UNTIL JOB COMPLETION.</div><div>14. DUE TO THE FACT THAT PV MODULES ARE ENERGIZED WHENEVER THEY ARE EXPOSED TO LIGHT, CONTRACTOR SHALL DISABLE THE ARRAY DURING INSTALLATION AND SERVICE BY SHORT CIRCUITING, OPEN CIRCUITING, OR COVERING ARRAY WITH AN OPAQUE COVER ACCORDING TO MANUFACTURER'S INSTRUCTION.</div><div>15. CONSTRUCTION LOADING ON THE ROOF, SUCH AS MATERIAL STAGED ON THE ROOF, SHALL BE LIMITED TO 20 PSF. CONCENTRATED LOADING SHALL BE AVOIDED TO PREVENT LOCALIZED DAMAGE TO THE ROOF.</div></div>
	<div>APPLICABLE CODES</div> <div>NATIONAL ELECTRIC CODE (NEC), 2017* INTERNATIONAL BUILDING CODE (IBC), 2018* INTERNATIONAL FIRE CODE (IFC), 2018*</div> <div>CONSTRUCTION TYPE: TYPE 2 OCCUPANCY TYPE: B</div> <div>*INCLUDES ALL LOCAL AND STATE AMENDMENTS</div>	<div>SITE INFORMATION</div>	
		<div>UTILITY COMPANY: KCPL</div> <div>METER NUMBER: 18603186</div>	

ELECTRICAL NOTES

1.

THE PV ELECTRIC SYSTEM IS INTENDED TO BE OPERATED IN PARALLEL WITH THE UTILITY ELECTRICAL SERVICE AND WILL BE CONNECTED TO THE EXISTING FACILITY POWER SYSTEM AT A SINGLE POC. THIS CONNECTION SHALL BE IN COMPLIANCE WITH NEC 705.12.
2.

ALL INVERTERS AND PANELBOARDS SHALL BE SECURED FROM UNAUTHORIZED ACCESS BY LOCK OR LOCATION.
3.

CONDUITS AND CABLES SHALL BE BOTTOM ENTRY ONLY TO ANY ENCLOSURE.
4.

FEEDERS SHALL MAINTAIN PHASE RELATIONSHIP THROUGHOUT THE SYSTEM. PHASES SHALL MATCH BUS OR CABLE ARRANGEMENTS IN EQUIPMENT TO WHICH THE FEEDERS ARE CONNECTED. COLOR CODING SHALL BE AS FOLLOWS:

	208/120 VAC	480/277 VAC		1000VDC
PHASE A	BLACK	BROWN	POSITIVE	RED
PHASE B	RED	ORANGE	NEGATIVE	BLACK
PHASE C	BLUE	YELLOW	GROUNDING CONDUCTOR	WHITE
GROUNDING CONDUCTOR	WHITE	WHITE	GROUND	GREEN
GROUND	GREEN	GREEN		
5.

PV STRING HOME RUNS MUST BE LABELED AT ALL TERMINATIONS. UNLESS NOTED OTHERWISE, THE WORK SHALL INCLUDE FURNISHING MATERIALS, EQUIPMENT, ACCESSORIES, AND LABOR NECESSARY TO COMPLETE ALL INSTALLATIONS AS INDICATED ON THE DRAWINGS.
6.

SUPPORT CONDUCTORS IN VERTICAL CONDUIT IN ACCORDANCE WITH THE REQUIREMENTS OF NEC 300.19.

GROUNDING NOTES

1.

ONLY ONE CONNECTION TO AC CIRCUITS WILL BE USED FOR SYSTEM GROUNDING (NEC 690.42).
2.

RACKING AND STRUCTURAL COMPONENTS MUST BE ELECTRICALLY BONDED TOGETHER BY AN ACCEPTABLE MEANS. RACKING SYSTEM SHALL BE LISTED TO UL2703.
3.

MODULES SHALL BE GROUNDED WITH EQUIPMENT GROUNDING CONDUCTORS BONDED TO A LOCATION APPROVED BY THE MANUFACTURER WITH A MEANS OF BONDING LISTED FOR THIS PURPOSE.
4.

A GROUNDING ELECTRODE SYSTEM IN ACCORDANCE WITH NEC 690.47 AND NEC 250.50 THROUGH NEC 250.166 SHALL BE PROVIDED. THE GROUNDING ELECTRODE SYSTEM OF THE BUILDING MAY BE USED AND BONDED TO AT THE SERVICE ENTRANCE.
5.

PV SYSTEM SHALL BE GROUNDED IN ACCORDANCE WITH NEC 250.21 AND ALL METAL PARTS OR MODULE FRAMES ACCORDING TO NEC 690.43.
6.


ALL CONDUIT BETWEEN THE UTILITY AC DISCONNECT AND THE POC SHALL HAVE GROUNDED BUSHINGS AT BOTH ENDS.

12916 5TH ST
GRANDVIEW, MO 64030
PH: (913) 396-3880

PROJECT NAME
LEE'S SUMMIT HONDA -
149.48kWdc

SITE LOCATION
401 NE COLBERN RD
LEE'S SUMMIT, MO

DESIGNER
SOLAR EXPRESS, LLC
5658 LACY RD
FITCHBURG, WI 53711
PHONE: 920-912-2568
CERTIFICATE OF AUTHORITY: E-2019000337

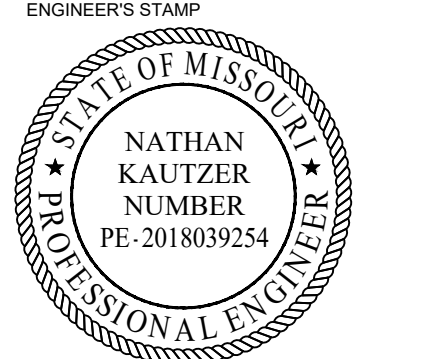

12/10/2020

DRAWING ISSUE

12/10/2020

RELEASE FOR CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/19/2021

REVISION


DOCUMENT TITLE
NOTES

DRAWN BY NJK

SHEET

0 1/2 1

G1

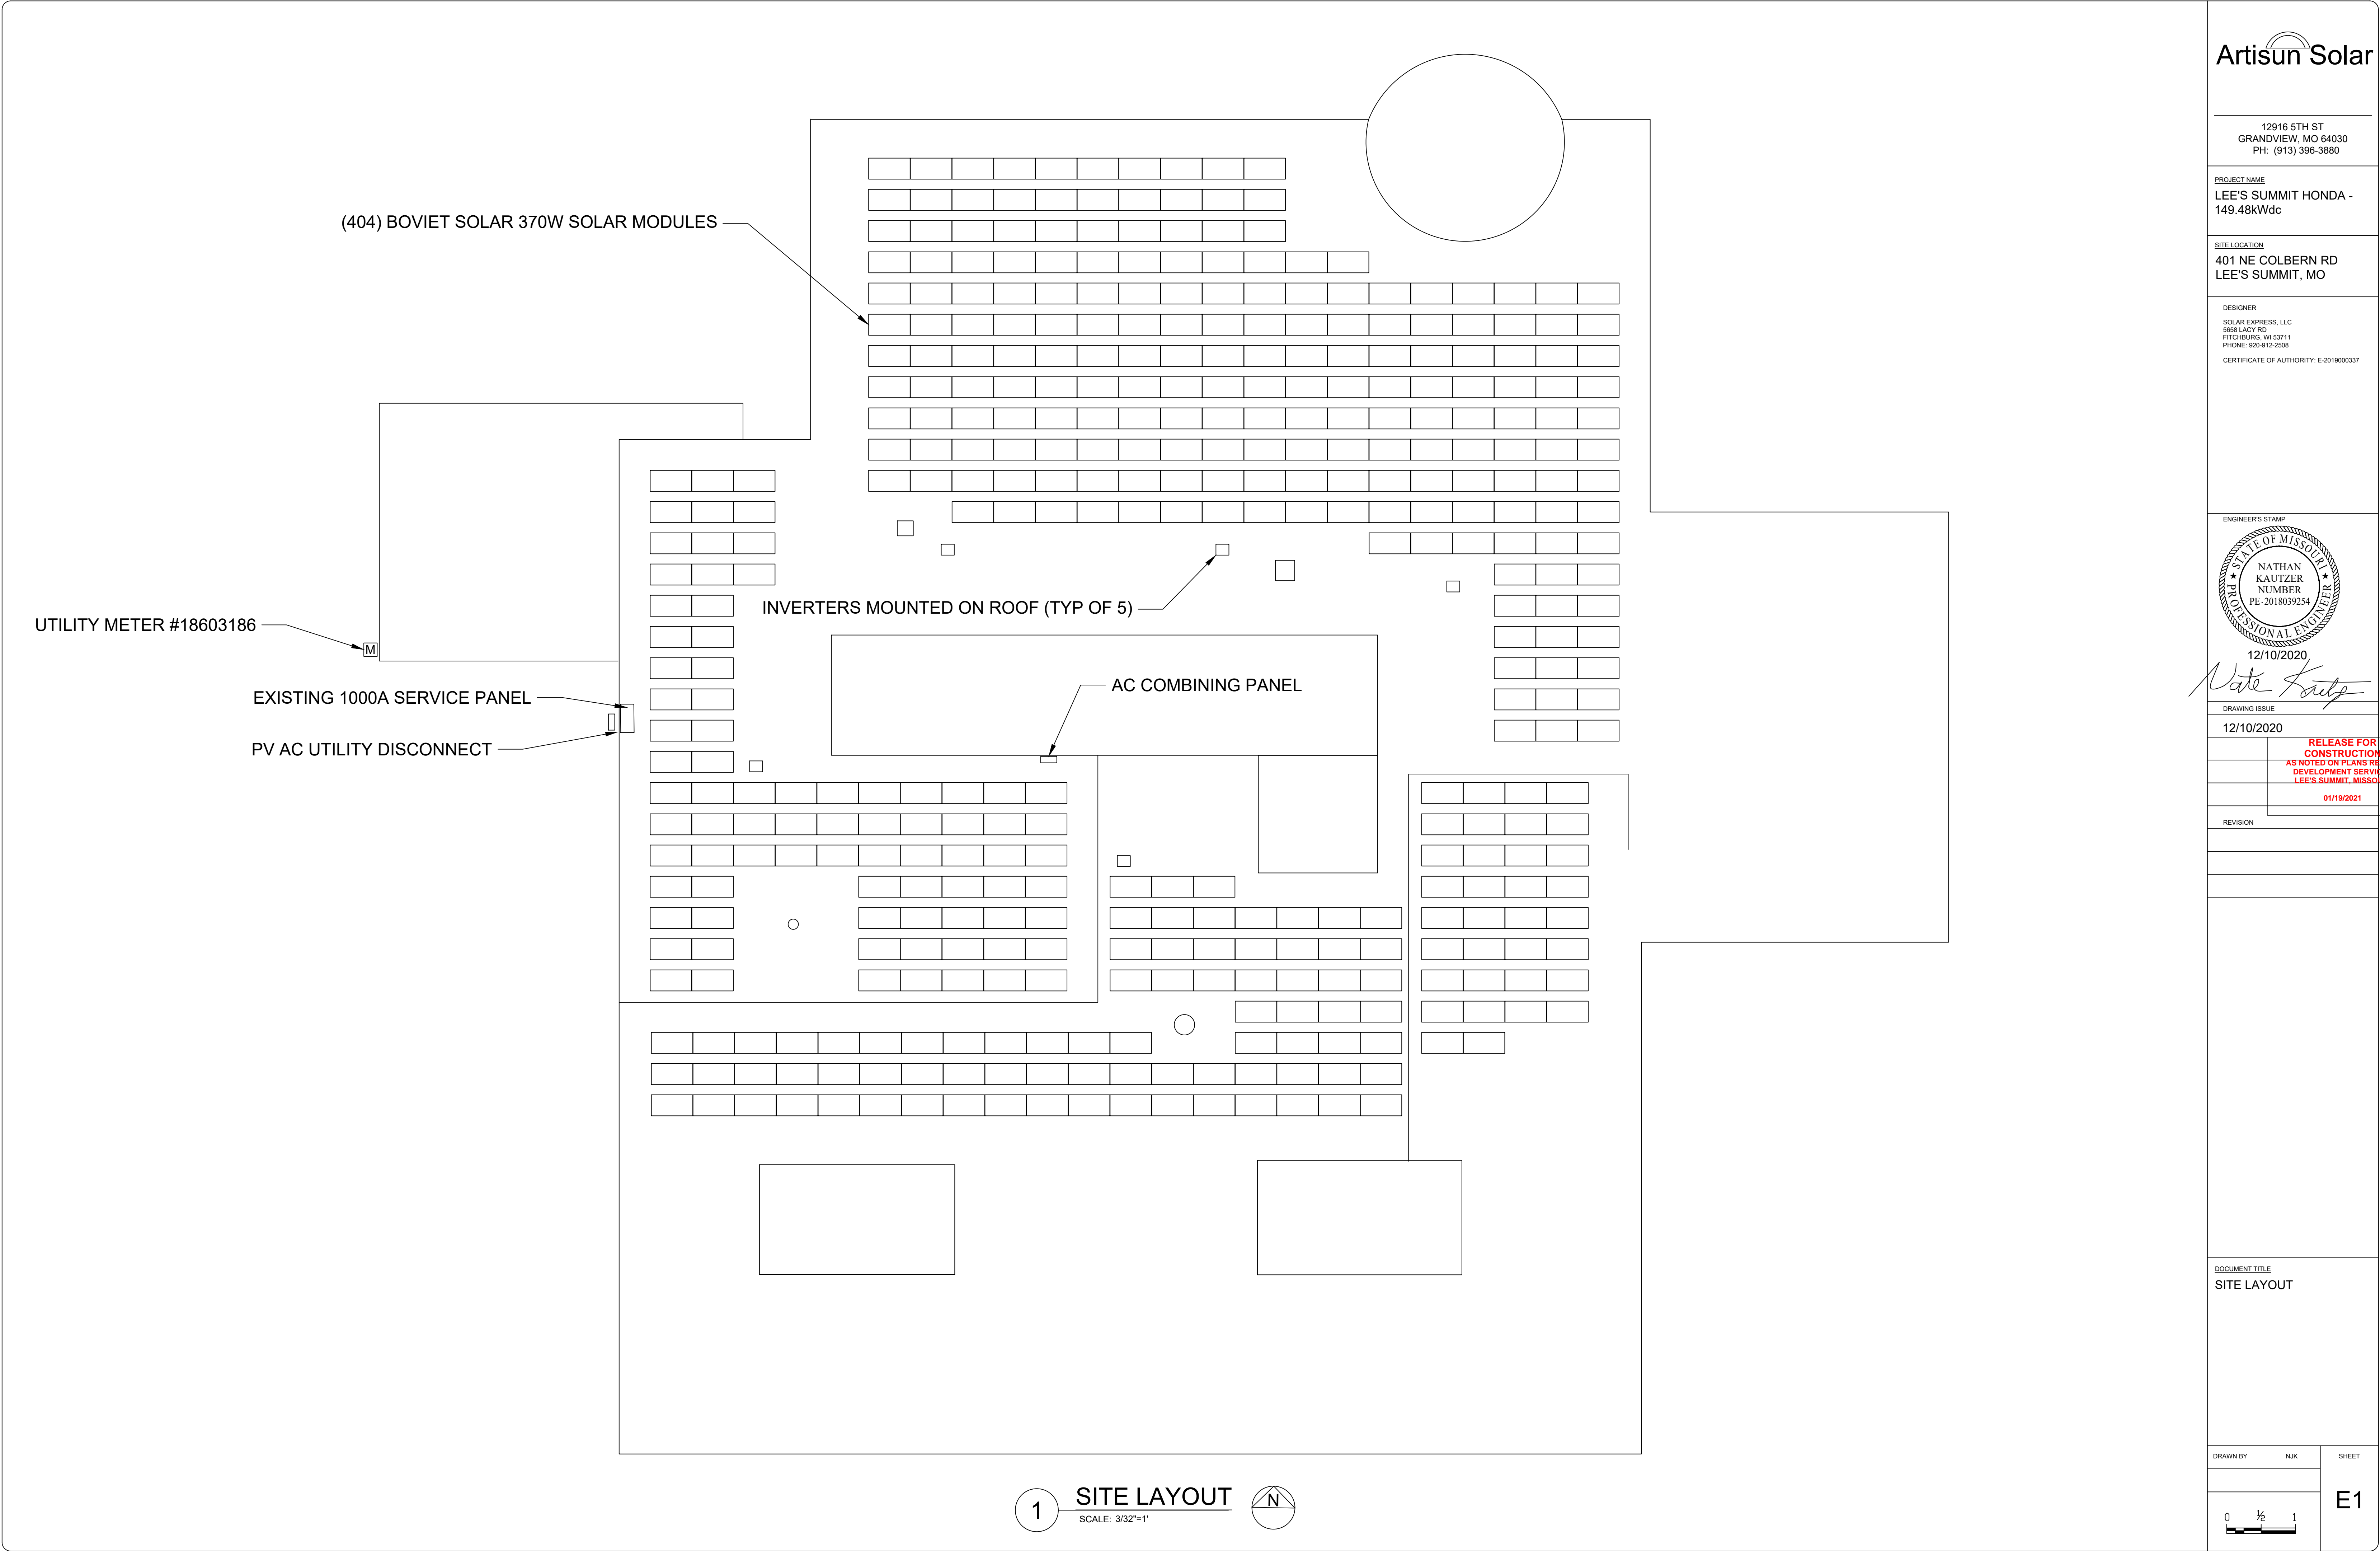


Artisun Solar

12916 5TH ST
GRANDVIEW, MO 64030
PH: (913) 396-3880

PROJECT NAME
LEE'S SUMMIT HONDA -
149.48kWdc

SITE LOCATION
401 NE COLBERN RD
LEE'S SUMMIT, MO

DESIGNER
SOLAR EXPRESS, LLC
5658 LACY RD
FITCHBURG, WI 53711
PHONE: 920-912-2508
CERTIFICATE OF AUTHORITY: E-2019000337

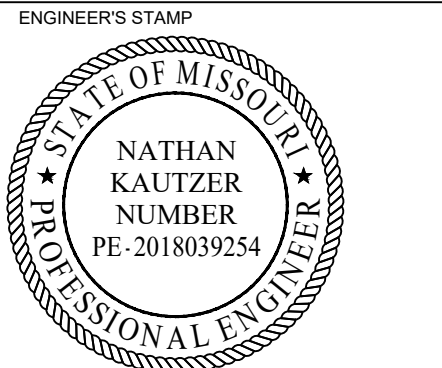

12/10/2020
Nate Kautzer

DRAWING ISSUE
12/10/2020


RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/19/2021

REVISION


DOCUMENT TITLE
SITE LAYOUT

DRAWN BY NJK SHEET


0 1/2 1
E1

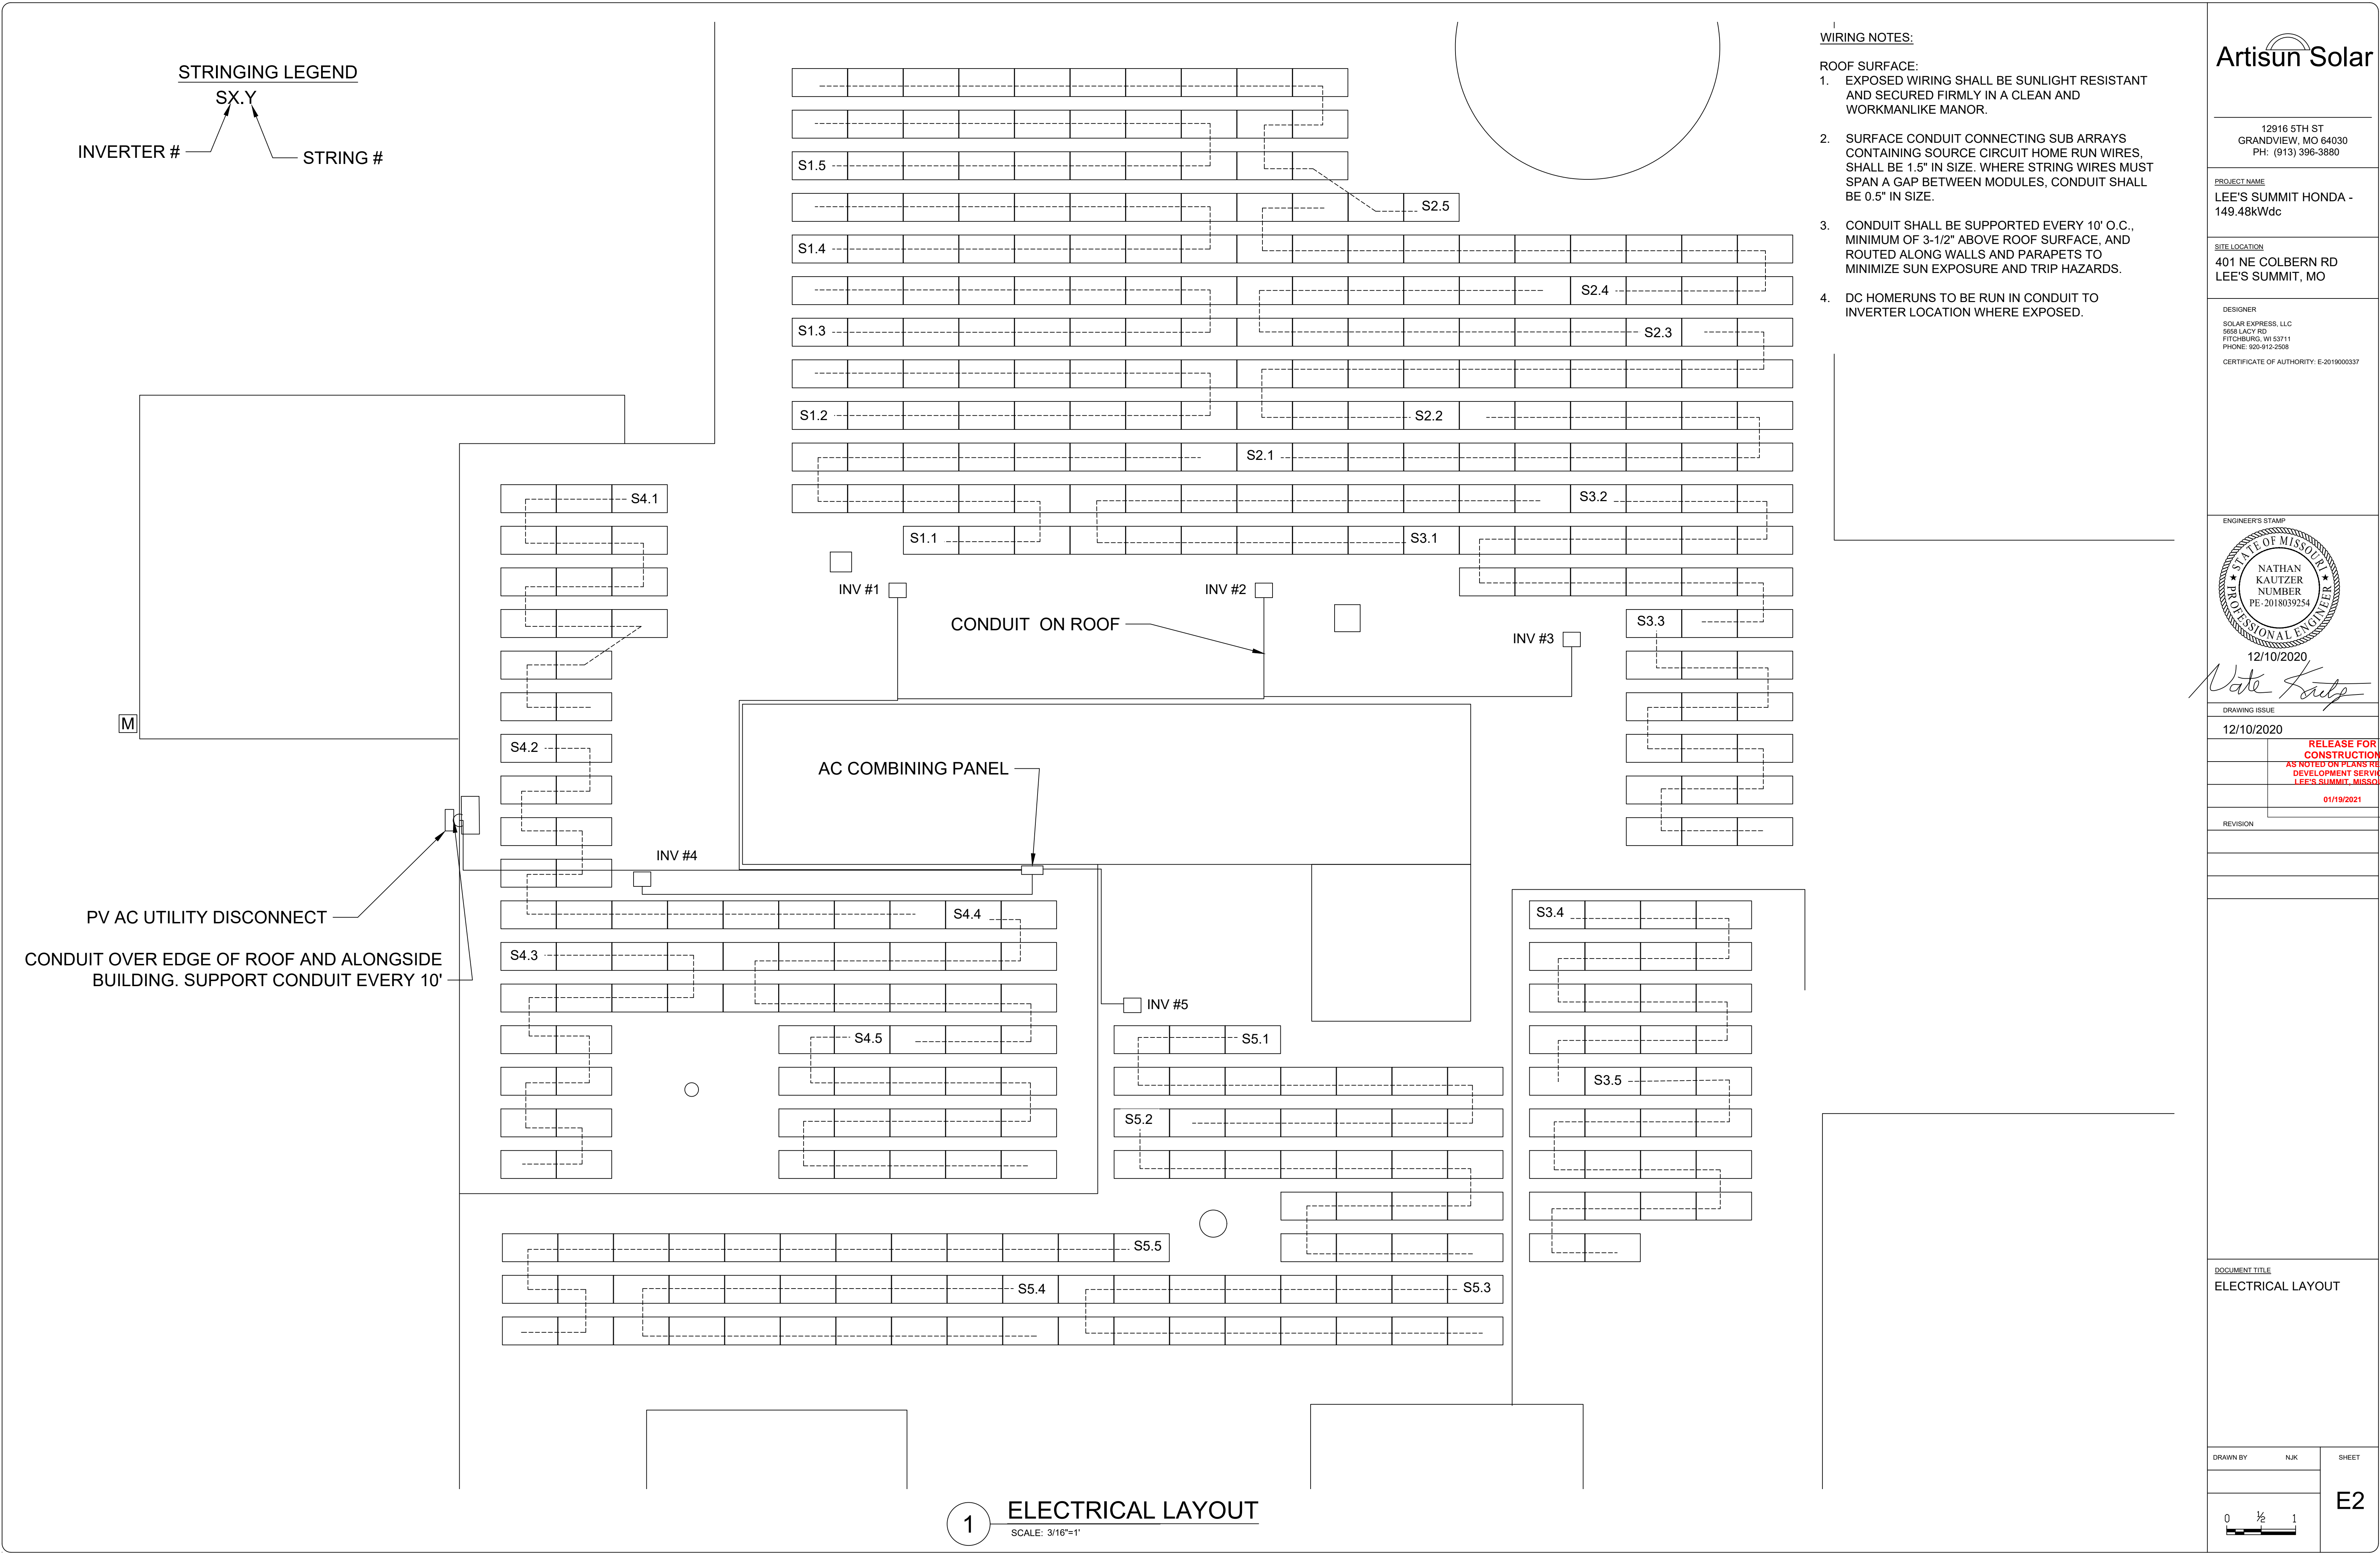

TYPICAL OF INVERTERS 1, 2, 5
INVERTER #X:
MPPT1: 3 STRINGS OF 16 MODULES IN SERIES
MPPT2: 2 STRINGS OF 16 MODULES IN SERIES

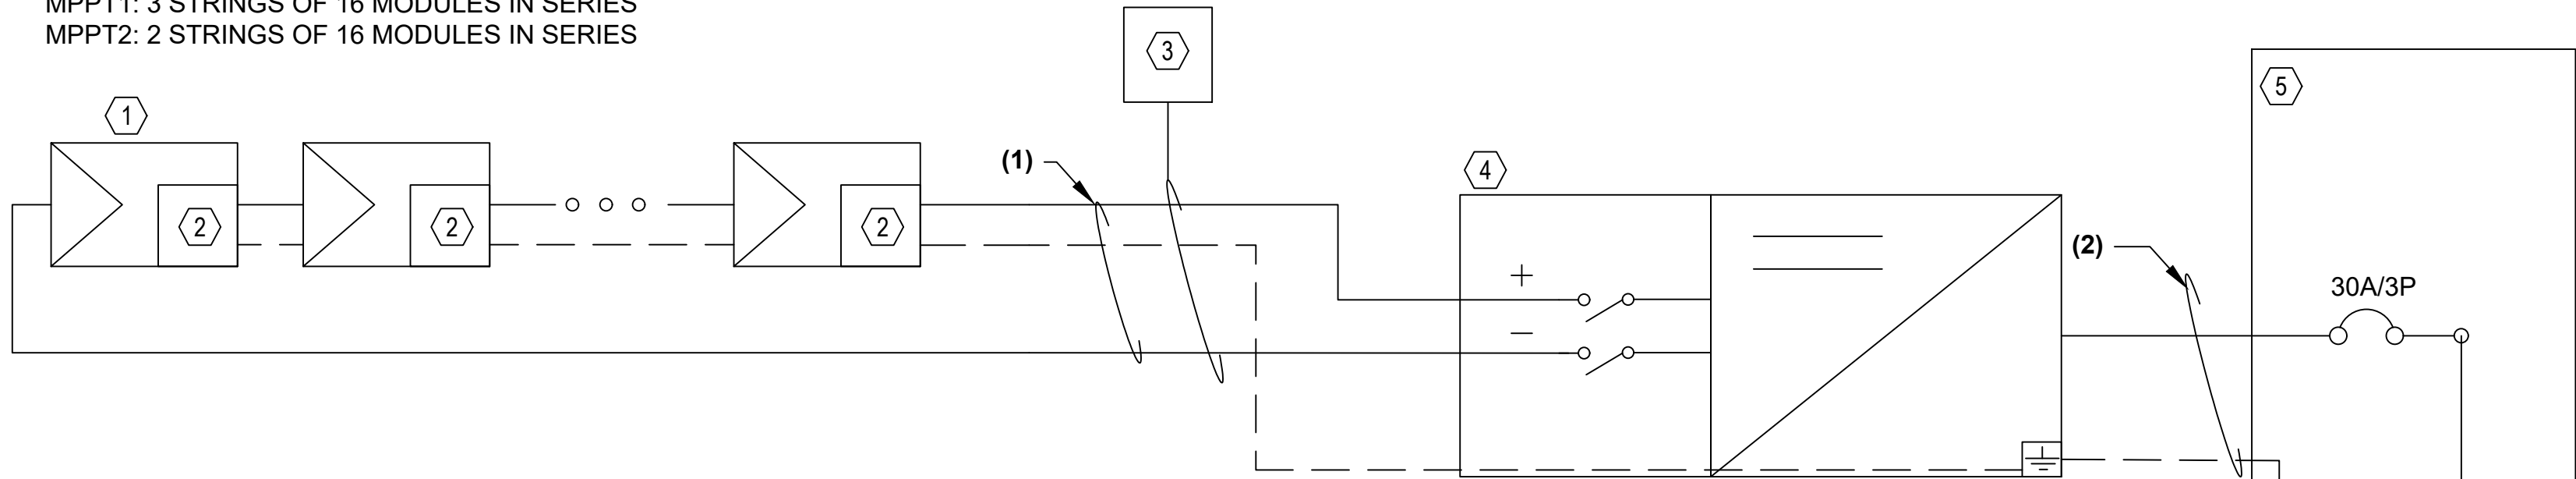

TYPICAL OF INVERTERS 3-4
INVERTER #X:
MPPT1: 3 STRINGS OF 16 MODULES IN SERIES
MPPT2: 2 STRINGS OF 17 MODULES IN SERIES

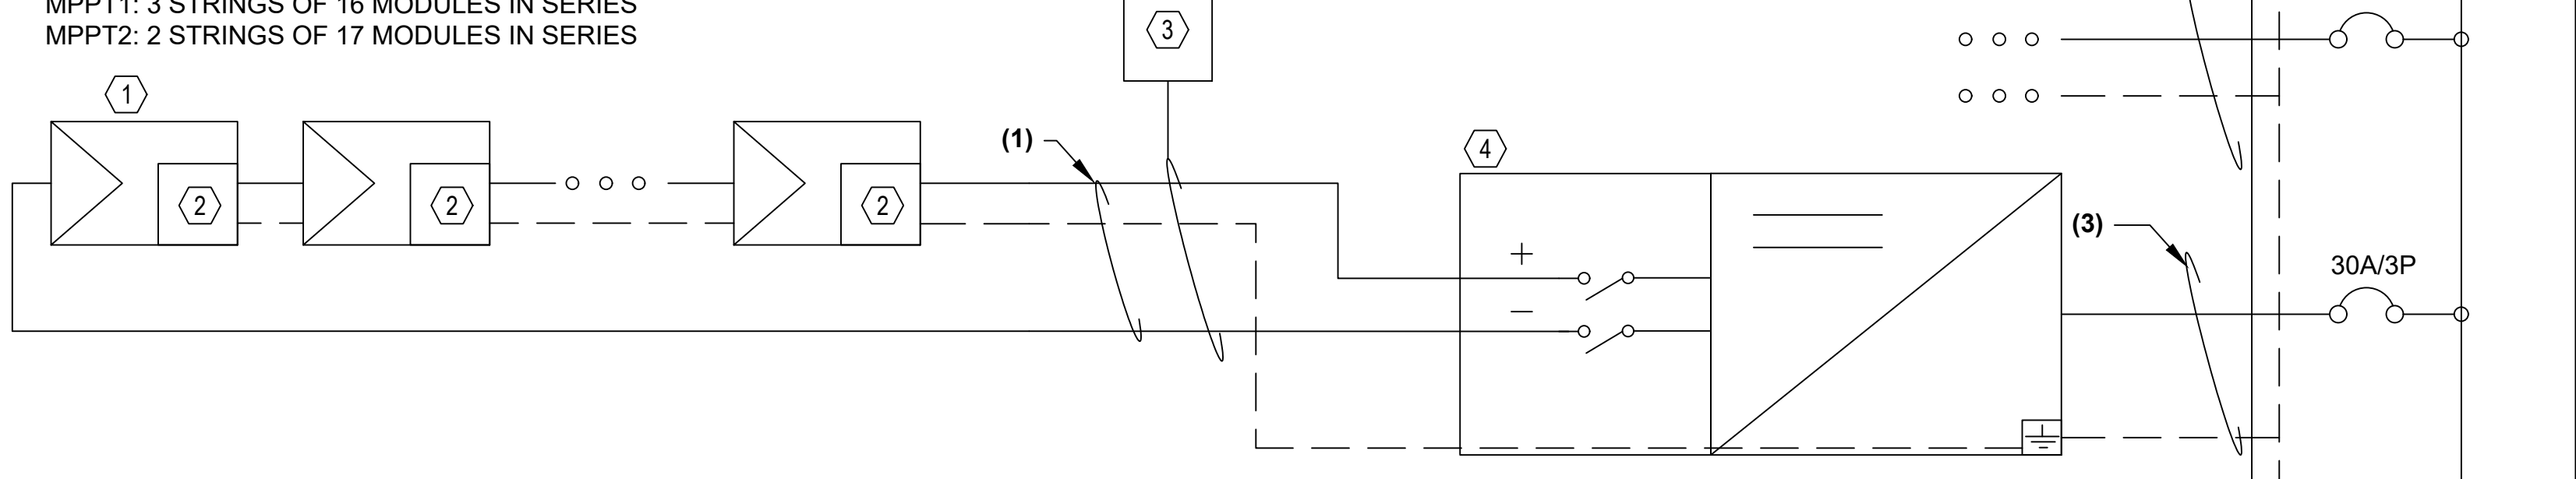

SITE CONDITIONS:		
ASHRAE MAX AVG. TEMP:	34°C	
ASHRAE EXTREME MIN TEMP	-20°C	
PV MODULE OUTPUT		
VOC:	47.7 Vdc	
TEMP. COEFFICIENT OF Voc	-0.31 %/°C	
ISC	9.89 Adc	
VMP	39.02 Vdc	
IMP	9.5 Adc	
INVERTER DETAILS		
RATED POWER OUTPUT (kW)		20
OUTPUT VOLTAGE (V)		480
OUTPUT CURRENT (A)		24
SOURCE CIRCUIT DETAILS		
MODULES PER STRING	16	17
TEMPERATURE ADJUSTED VOC	870	924
SHORT CIRCUIT CURRENT	9.89	


#	PV EQUIPMENT LIST		
ID	QTY	DESCRIPTION	
1	404	BOVIET SOLAR BVM6612M 370, 370W SOLAR MODULE	
2	404	APSMART RSF-S-PLC MODULE MPLE FOR RAPID SHUTDOWN	
3	5	APSMART TRANSMITTER-PLC	
4	5	FRONIUS SYMO ADVANCED 20.0-3, 20.0 kW INVERTER, MPPT'S WITH MORE THAN 2 STRINGS SHALL INCLUDE 15A, 1000V RATED DC FUSES FOR EACH STRING	
5	1	AC COMBINING PANEL, 200A, 3P, 4W, WITH (5) 30A CIRCUIT BREAKERS	
6	1	PV UTILITY AC DISCONNECT, 200AF, 480V, 3 PHASE, NEMA 3R, LOCKABLE	
7	1	POINT OF INTERCONNECTION AT LOAD SIDE CONNECTION OF EXISTING 1000A MDP VIA NEW 150A CIRCUIT BREAKER. SOLAR CIRCUIT BREAKER TO BE PLACED AT OPPOSITE END FROM MAIN BREAKER PER NEC 705.12.	
8	1	EXISTING 1000A, 480V DISTRIBUTION PANEL.	
9	1	EXISTING BILLING METER TO BE SWAPPED AFTER UTILITY INSPECTION	

WIRE AND CONDUIT SCHEDULE					
ID	CONDUCTOR	EGC	CONDUIT	ESTIMATED LENGTH	VOLTAGE DROP %
1	#12 AWG PV WIRE	#6 AWG	-	75'	0.5
2	#10 AWG THWN-2	#6 AWG	1.25"	150'	1.7
3	#10 AWG THWN-2	#6 AWG	1"	100'	1.3
4	1/0 AWG THWN-2	#6 AWG	1.5"	10'	0.1

- ALL EXPOSED SOURCE CIRCUIT CONDUCTORS SHALL BE **1000V** RATED **PV-WIRE** SUITABLE FOR USE WITH TRANSFORMERLESS INVERTERS, NO EXCEPTIONS.
- ALL CONDUIT TO BE EMT, UNLESS OTHERWISE SPECIFIED BY LOCAL AHJ.
- ALL CONDUIT SIZES ARE BASED ON THE MINIMUM PER NEC CODE REQUIREMENTS
- WIRE AMPACITY IS BASED ON NUMBER OF WIRES PER CONDUIT AND HEIGHT ABOVE ROOF. IF CONDUITS ARE INSTALLED DIFFERENTLY THAN SHOWN ABOVE WIRE SIZES MAY BE AFFECTED.
- ALL CONDUCTORS ARE COPPER 90° C RATED UNLESS OTHERWISE NOTED.

SHEET NOTES

- SOLAR MODULES INCLUDE #12 AWG OUTDOOR RATED QUICK CONNECTS WITH MULTI CONTACT CONNECTORS FOR MODULE INTERCONNECTION. DO NOT REMOVE THE QUICK CONNECTS, OTHERWISE THE MODULE WARRANTY AND THE UL LISTING MAY BE INVALIDATED.
- PV MODULES STRUNG IN SERIES. MODULE AND RACKING GROUNDING ACCOMPLISHED VIA #6 CONTINUOUS CU CONDUCTOR.
- CAT 5E COMMUNICATION WIRES FROM INVERTERS SHALL BE INSTALLED IN SEPARATE CONDUIT AND ROUTED TO CLIENT'S NETWORK ROUTER.

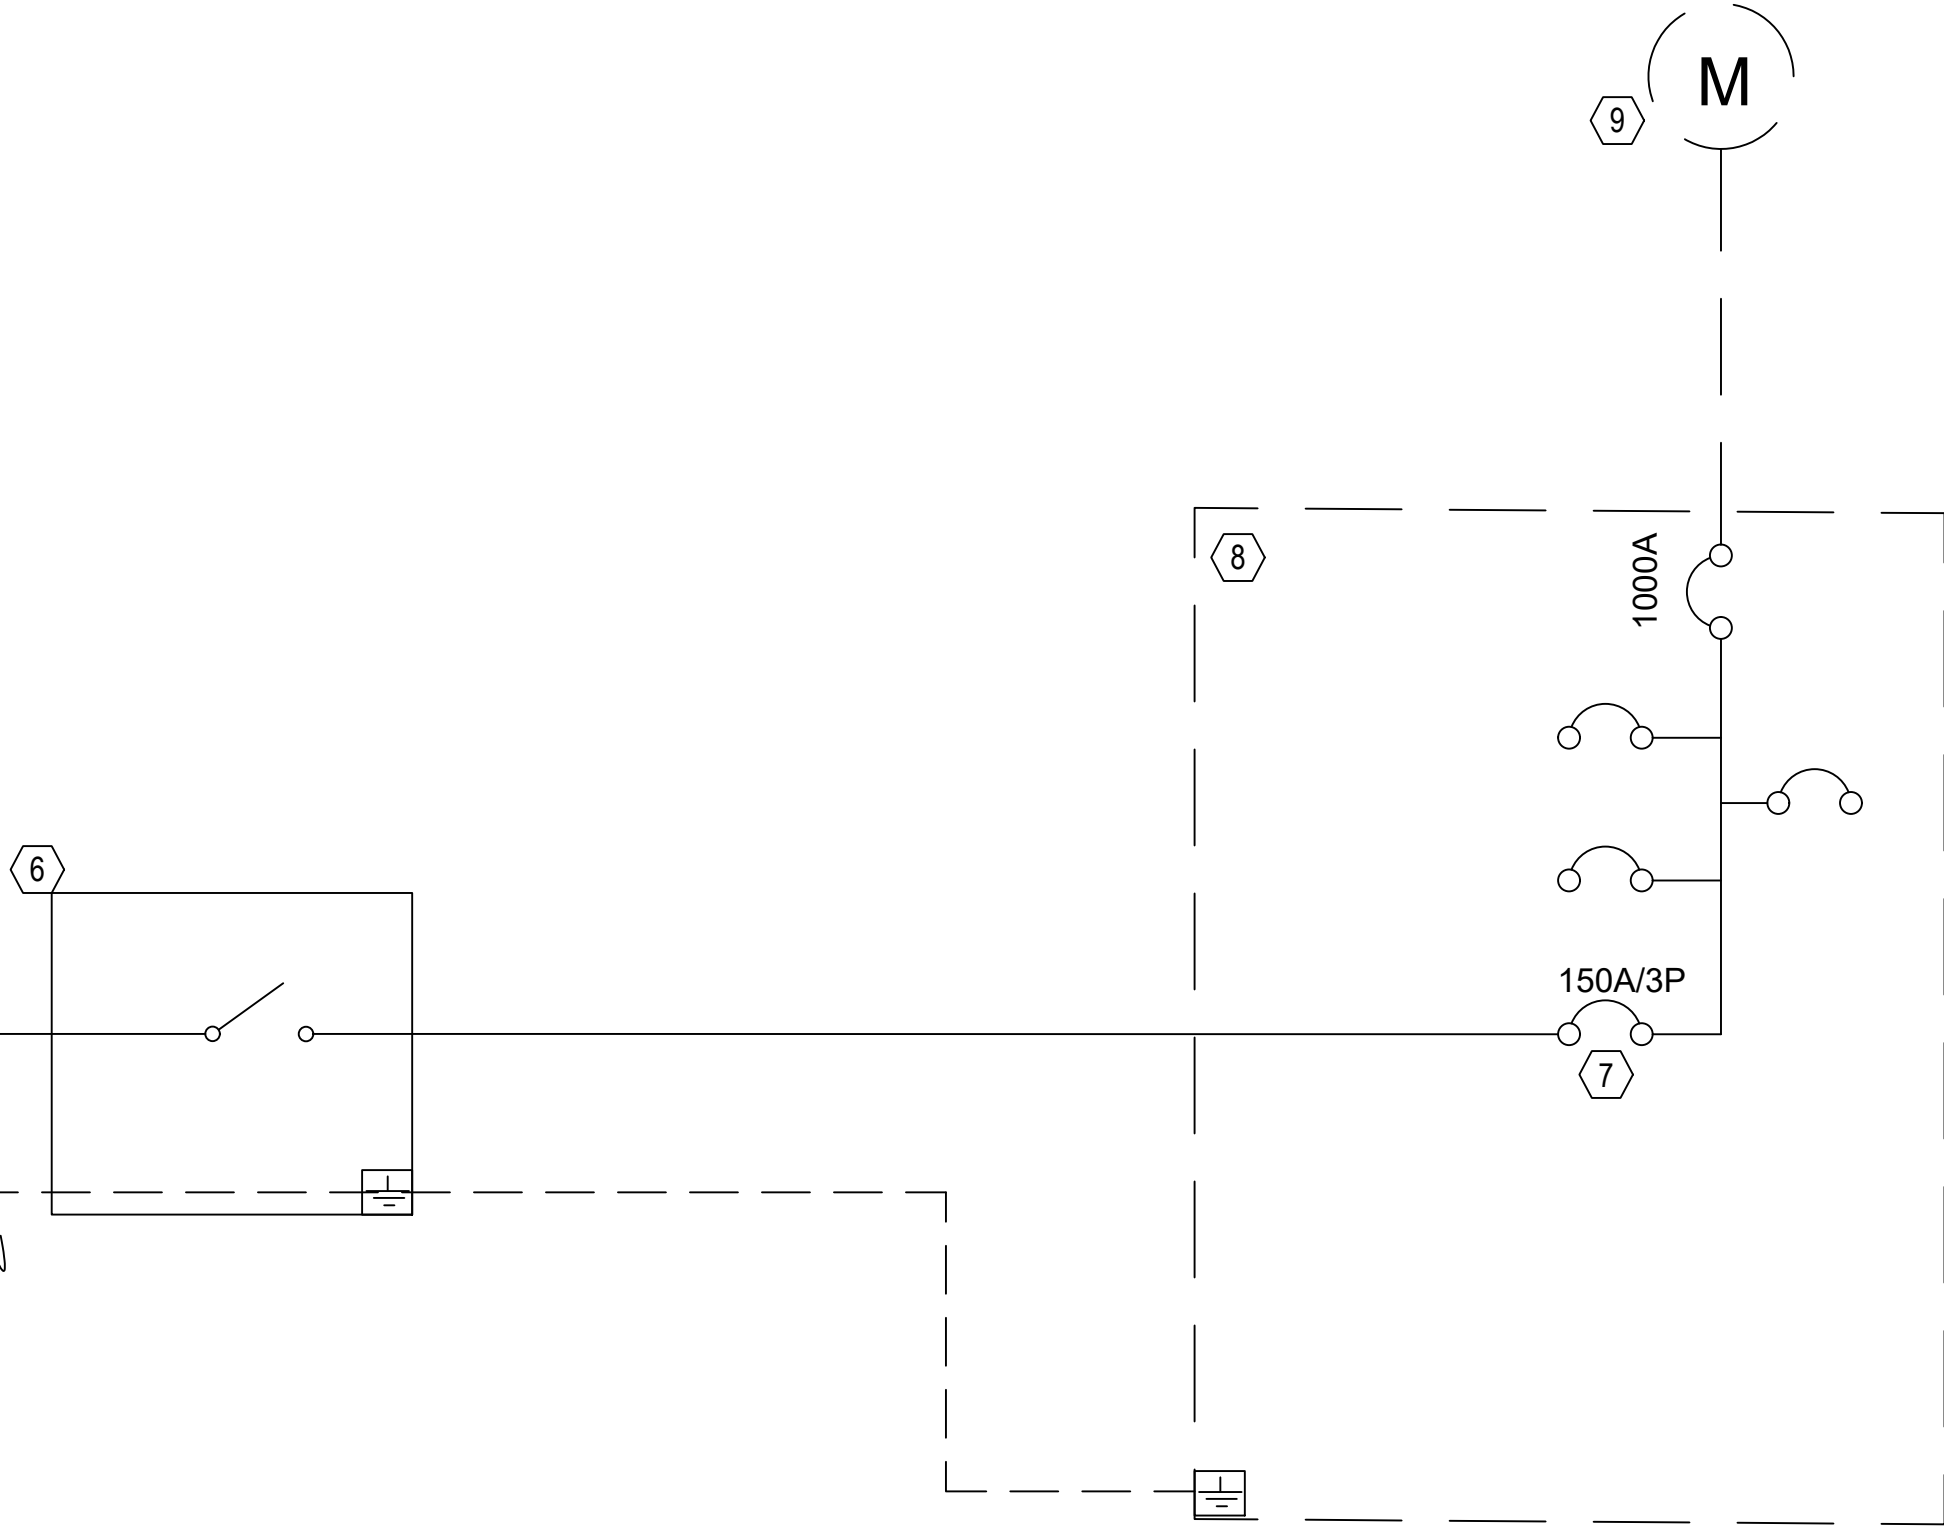

Artisun Solar

12916 5TH ST
GRANDVIEW, MO 64030
PH: (913) 396-3880

PROJECT NAME

LEE'S SUMMIT HONDA -
149.48kWdc

SITE LOCATION

401 NE COLBERN RD
LEE'S SUMMIT, MO

DESIGNER

SOLAR EXPRESS, LLC
5658 LACY RD
FITZBURG, WI 53711
PHONE: 620-812-2508

CERTIFICATE OF AUTHORITY: E-2019000337

ENGINEER'S STAMP



12/10/2020

DRAWING ISSUE

12/10/2020

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/19/2021

REVISION

DOCUMENT TITLE

SINGLE LINE DIAGRAM

DRAWN BY NJK

SHEET

0 1/2 1

E3


ALL LABEL MATERIAL SHALL BE WEATHER RESISTANT AND SUITABLE FOR THE ENVIRONMENT. LETTERS SHALL BE CAPITALIZED WITH A MIN. HEIGHT OF 3/8" (9.5MM) WHITE ON RED BACKGROUND. NOT ALL LABLES WILL BE APPLICABLE TO EVERY PROJECT

12916 5TH ST
GRANDVIEW, MO 64030
PH: (913) 396-3880

PROJECT NAME
LEE'S SUMMIT HONDA -
149.48kWdc

SITE LOCATION
401 NE COLBERN RD
LEE'S SUMMIT, MO

DESIGNER
SOLAR EXPRESS, LLC
5658 LACY RD
FITCHBURG, WI 53711
PHONE: 920-912-2508
CERTIFICATE OF AUTHORITY: E-2019000337

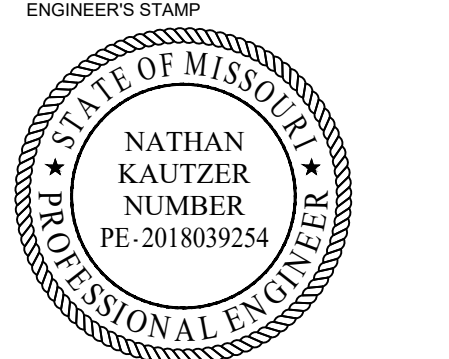

12/10/2020
Nate Kautzer

DRAWING ISSUE
12/10/2020

RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/19/2021

REVISION

DOCUMENT TITLE
NEC REQUIRED LABELS

DRAWN BY NJK SHEET

0 1/2 1
E4

INCLUDE THE FOLLOWING LABELS ON ALL CONDUIT
CONTAINING DC CONDUCTORS

PLACE EVERY 10' AND AFTER EACH BEND ON CONDUIT
PVLABELS.COM PLACARD 02-329

CAUTION: SOLAR CIRCUIT

INCLUDE THE FOLLOWING LABELS ON ALL SERVICEABLE
EQUIPMENT

PVLABELS.COM LABEL 05-580



INCLUDE THE FOLLOWING LABELS ON ALL ROOFTOP DC
JUNCTION BOXES


PVLABELS.COM PLACARD 03-102




INCLUDE THE FOLLOWING LABELS ON INVERTERS

PVLABELS.COM PLACARD 03-110

INVERTER #1/2/5

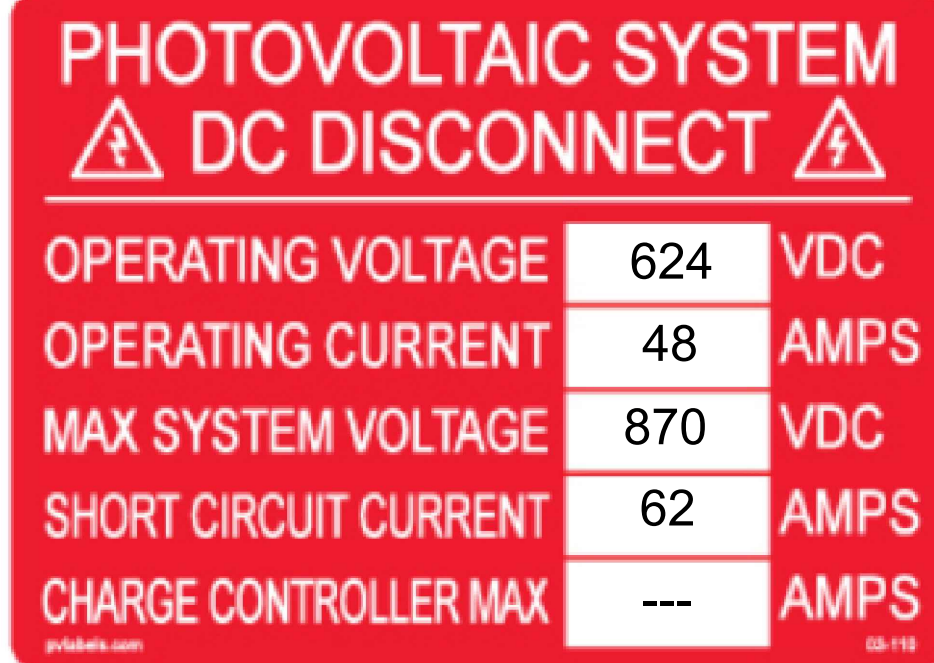

INVERTER #3/4

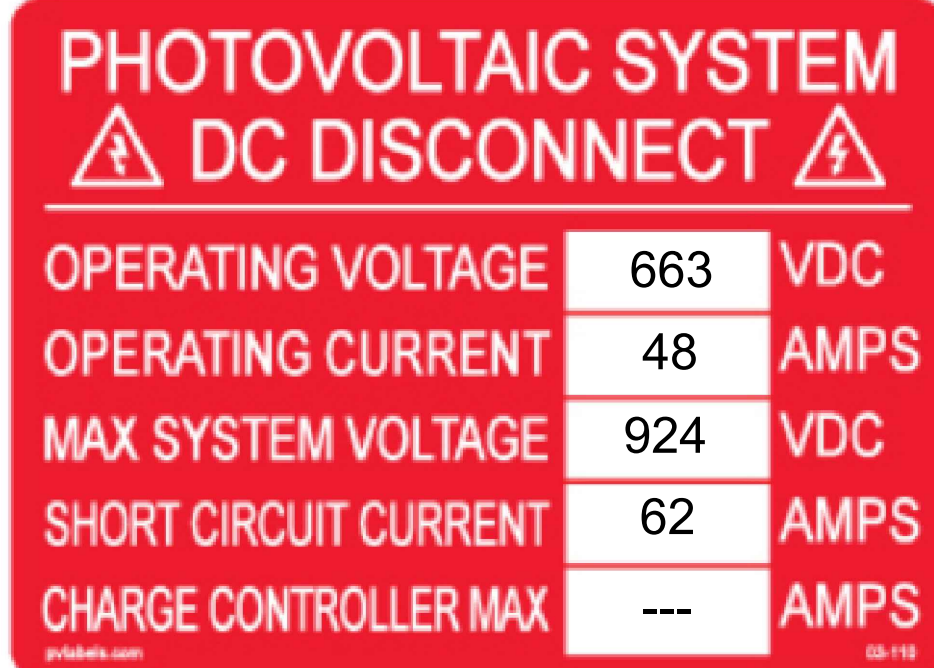

INCLUDE THE FOLLOWING LABELS ON POINT OF
INTERCONNECTION EQUIPMENT

PVLABELS.COM PLACARD 03-211



PVLABELS.COM PLACARD 03-344



PVLABELS.COM PLACARD 03-326




INCLUDE THE FOLLOWING LABELS ON AC DISCONNECTS

PVLABELS.COM PLACARD 03-116



PVLABELS.COM PLACARD 02-316

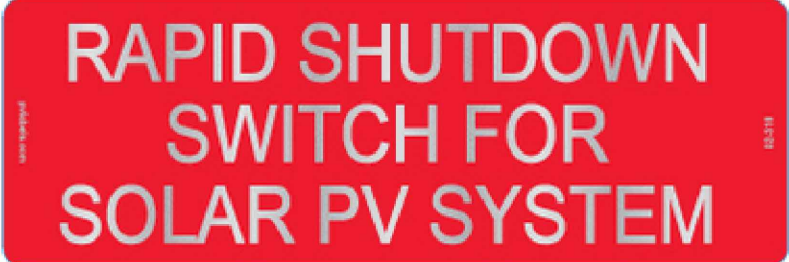



INCLUDE THE FOLLOWING LABELS ON UTILITY METER

PVLABELS.COM PLACARD 03-211



A SITE DIRECTORY PLAQUE SHALL BE LOCATED ON OR BESIDE THE
BI-DIRECTIONAL UTILITY BILLING METER PER NEC ARTICLE 705.10

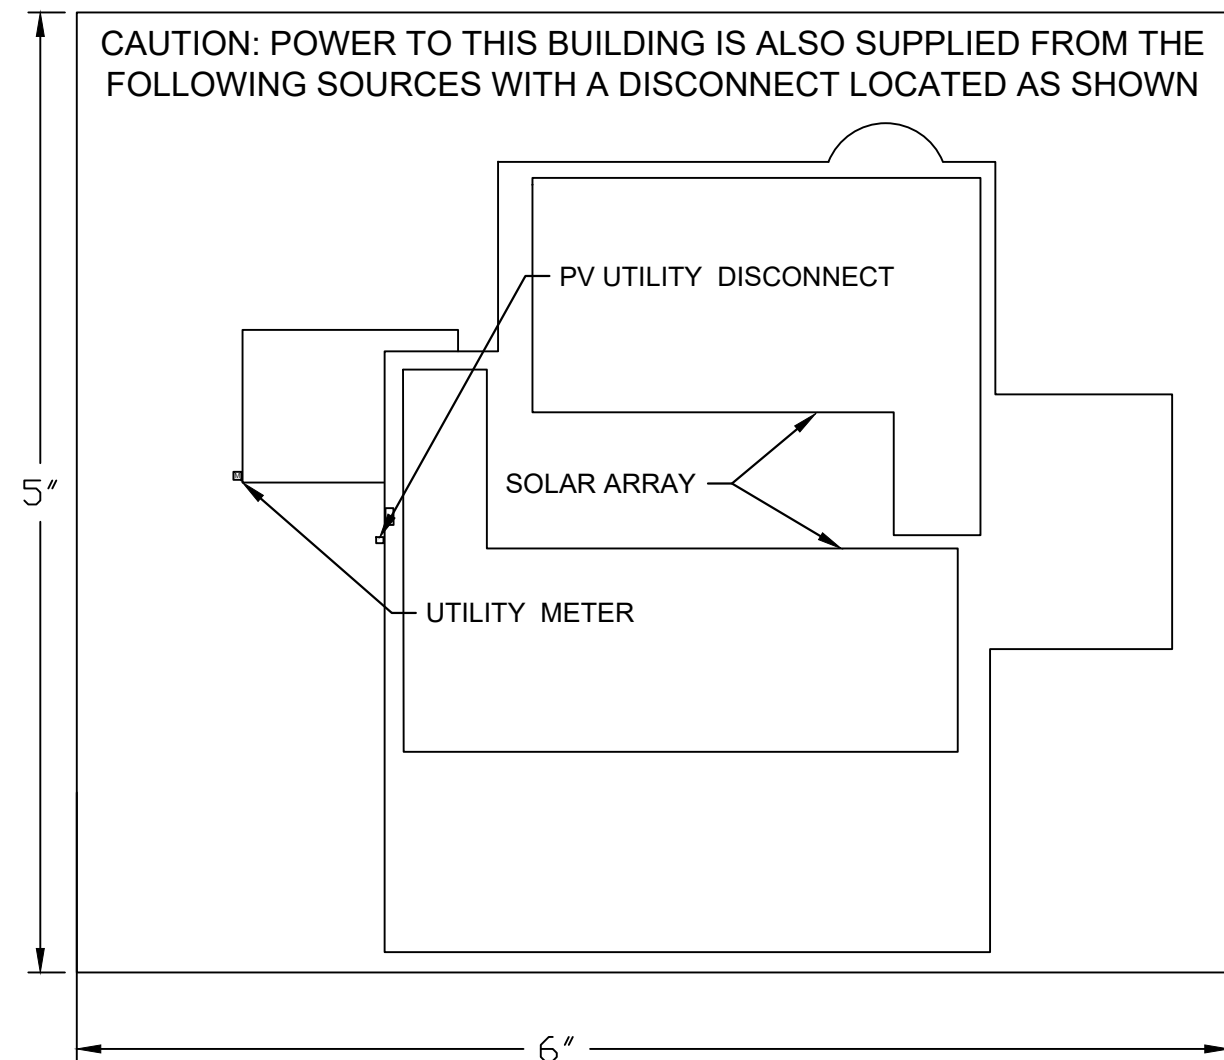

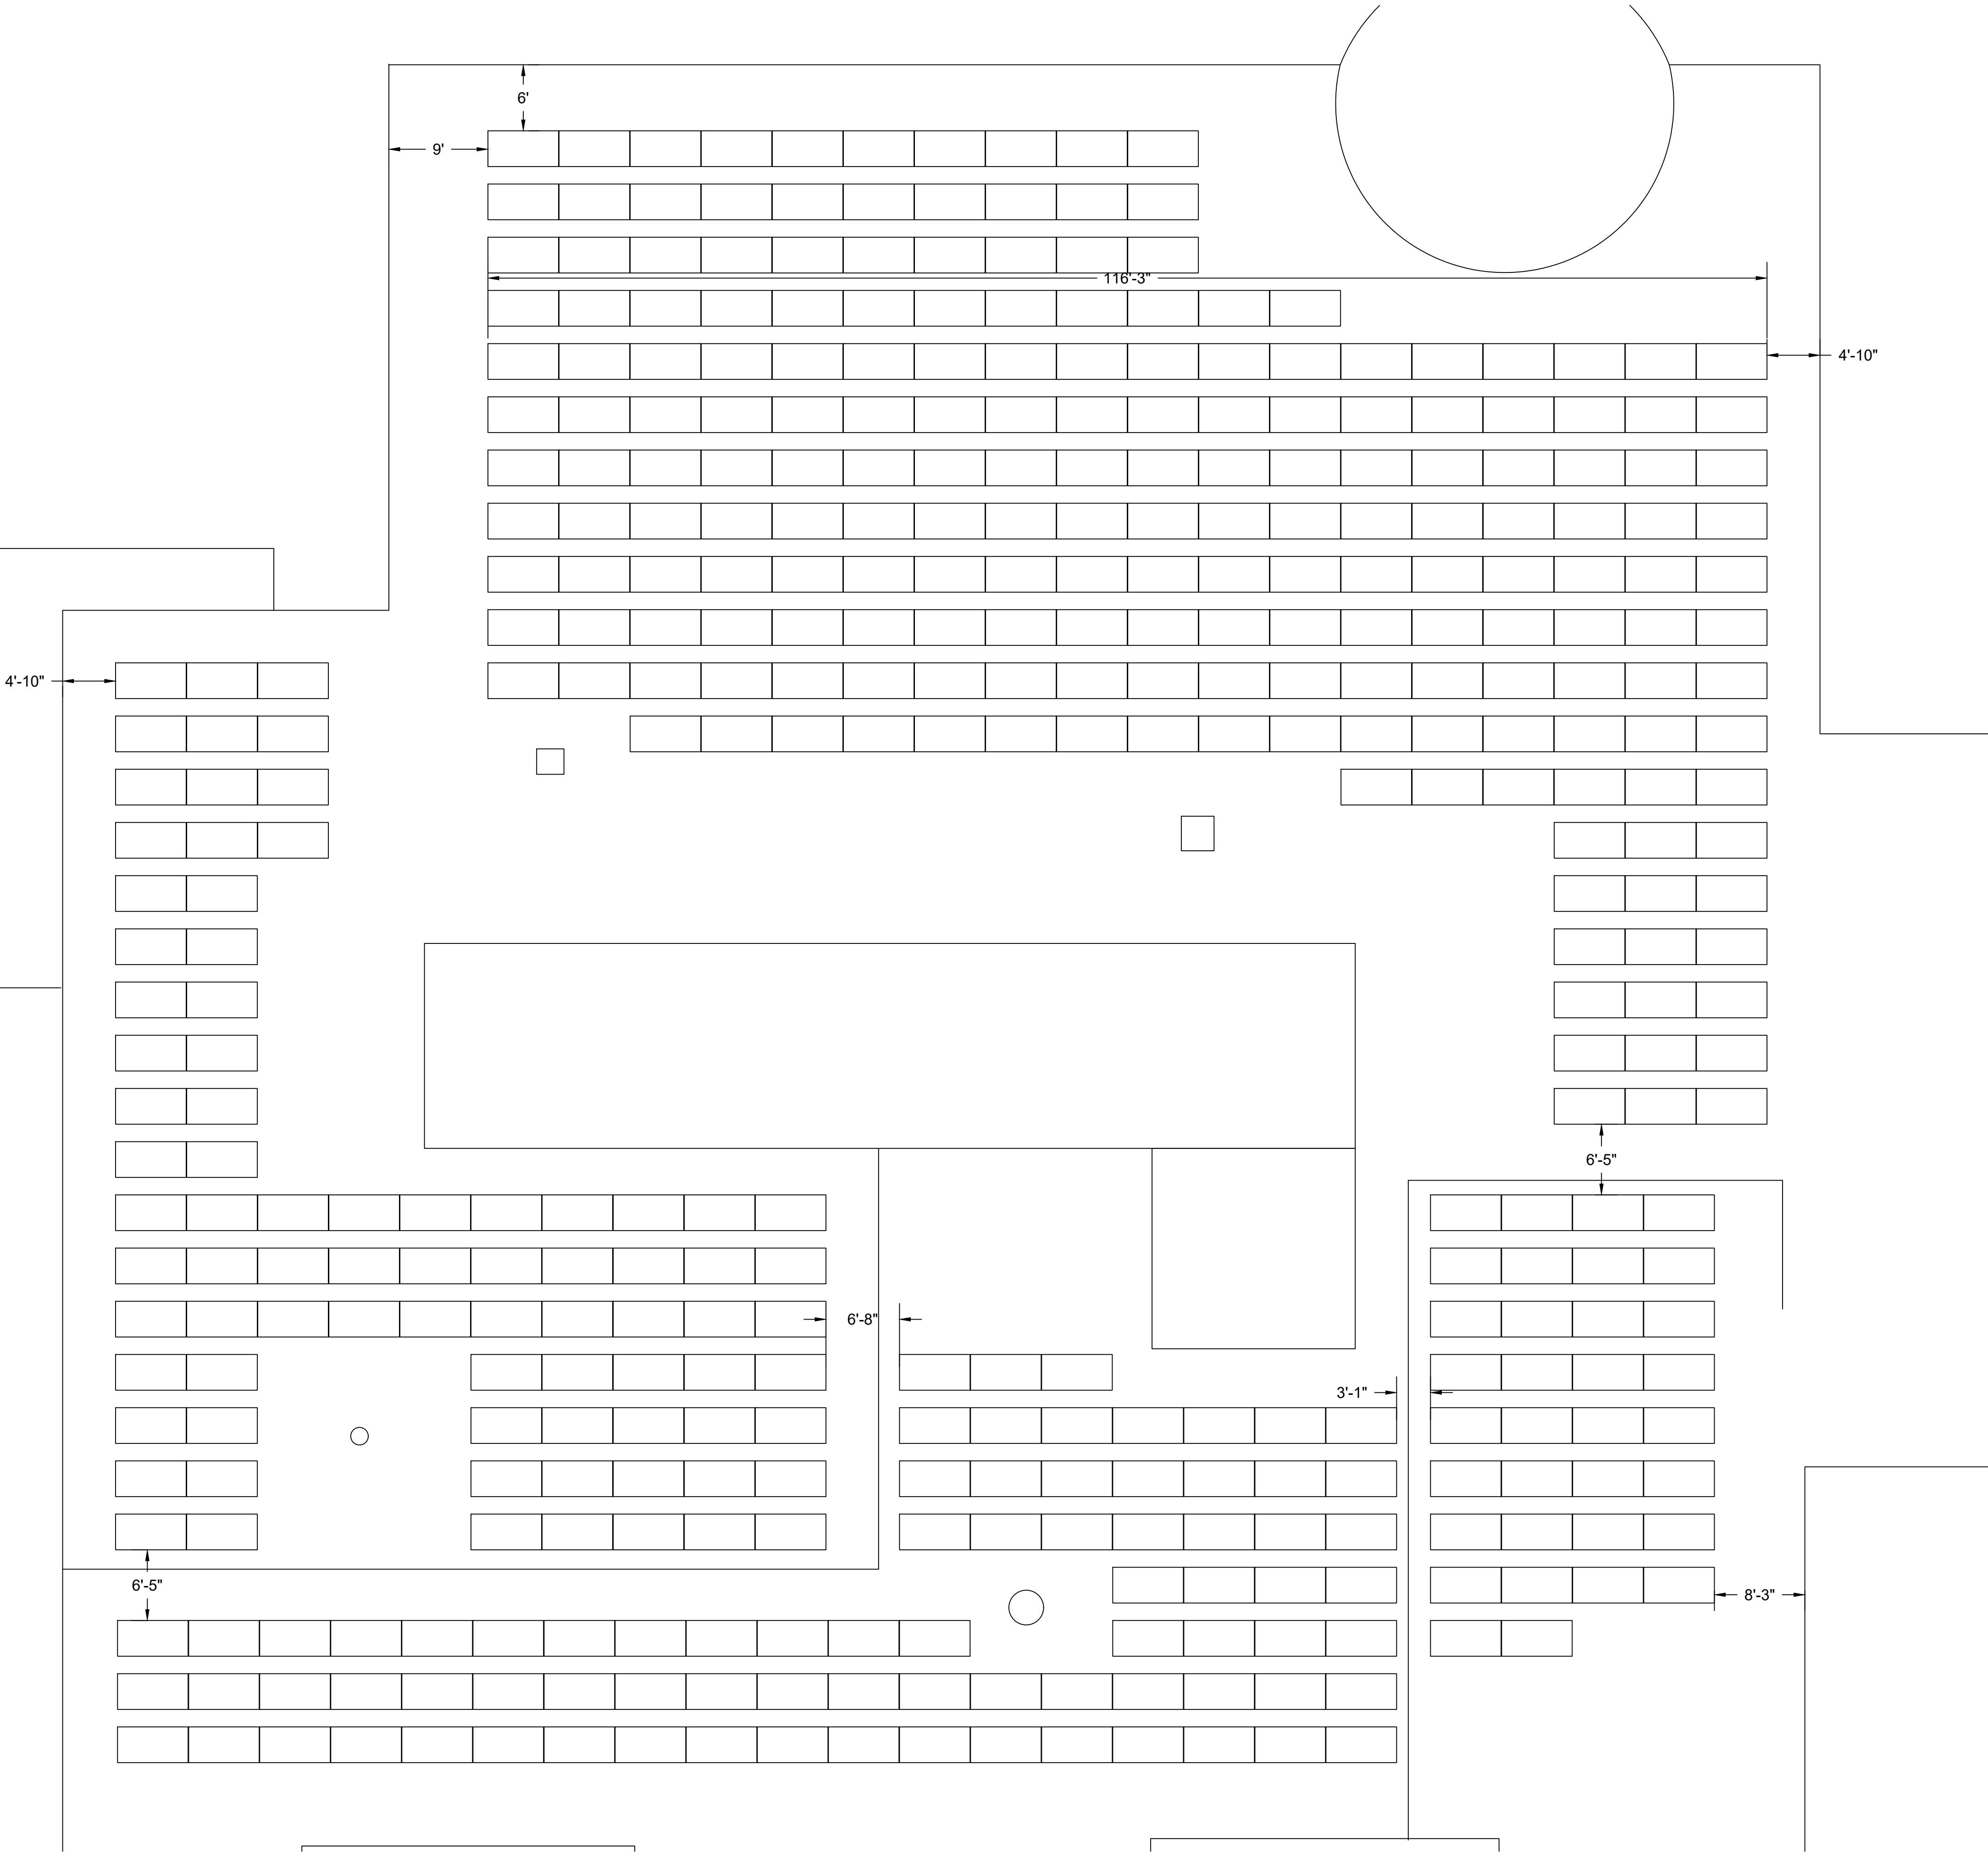




1 RACKING LAYOUT
SCALE: 3/16"=1'

Electrical Characteristics STC					
	BVM6612M-365	BVM6612M-370	BVM6612M-375	BVM6612M-380	BVM6612M-385
Maximum Power (Pmax)	365W	370W	375W	380W	385W
Maximum Power Current (Imp)	9.40A	9.50A	9.58A	9.66A	9.74A
Maximum Power Voltage (Vmp)	38.90V	39.02V	39.22V	39.41V	39.60V
Short Circuit Current (Isc)	9.79A	9.89A	9.96A	10.04A	10.11A
Open Circuit Voltage (Voc)	47.6V	47.7V	48.00V	48.30V	48.50V
Module Efficiency	18.8%	19.1%	19.3%	19.6%	19.8%
Power Tolerance	0~+5W	0~+5W	0~+5W	0~+5W	0~+5W
STC: AM1.5, Irradiance 1000W/m², 25°C					

Electrical Characteristics NOCT					
	BVM6612M-365	BVM6612M-370	BVM6612M-375	BVM6612M-380	BVM6612M-385
Maximum Power (Pmax)	269W	273W	277W	281W	284W
Maximum Power Current (Imp)	7.50A	7.57A	7.64A	7.71A	7.77A
Maximum Power Voltage (Vmp)	35.9V	36.1V	36.3V	36.5V	36.6V
Short Circuit Current (Isc)	7.98A	8.05A	8.12A	8.19A	8.26A
Open Circuit Voltage (Voc)	44.0V	44.3V	44.6V	44.9V	45.2V
NOCT: AM1.5, Irradiance 800W/m², 20°C, Wind speed 1m/s					

Mechanical Characteristics		Thermal Characteristics	
Solar Cell	Monocrystalline 6.14 x 6.14 inch, 72 (6 x 12) pcs. in series	Pmax Temperature Coefficient	-0.40%/K
Glass	High transparency, low iron, AR coated tempered glass 3.2 mm (0.13 inch)	Voc Temperature Coefficient	-0.31%/K
Frame	Anodized aluminum alloy	Isc Temperature Coefficient	+0.06%/K
Junction Box	IP67 rated, with 3 bypass diode	NOCT	113±3.6°F
Output Cable	4 mm² (EU)/12 AWG (US), 43.30/47.244 inch		
Connector	MC4 compatible		
Dimension	77.01 x 39.06 x 1.38 inch		
Weight	49.61 lb		

Maximum Ratings		Packing Information	
Operating Temperature	-40°F~185°F	Pieces per pallet	30
Maximum Series Fuse Rating	20A	Pallets per container (40HQ)	24
Maximum System Voltage	1000/1500V DC	Pieces per container (40HQ)	720
		Pallet weight/size	1620.4 lb/78.35 x 43.31 x 45.08 inch

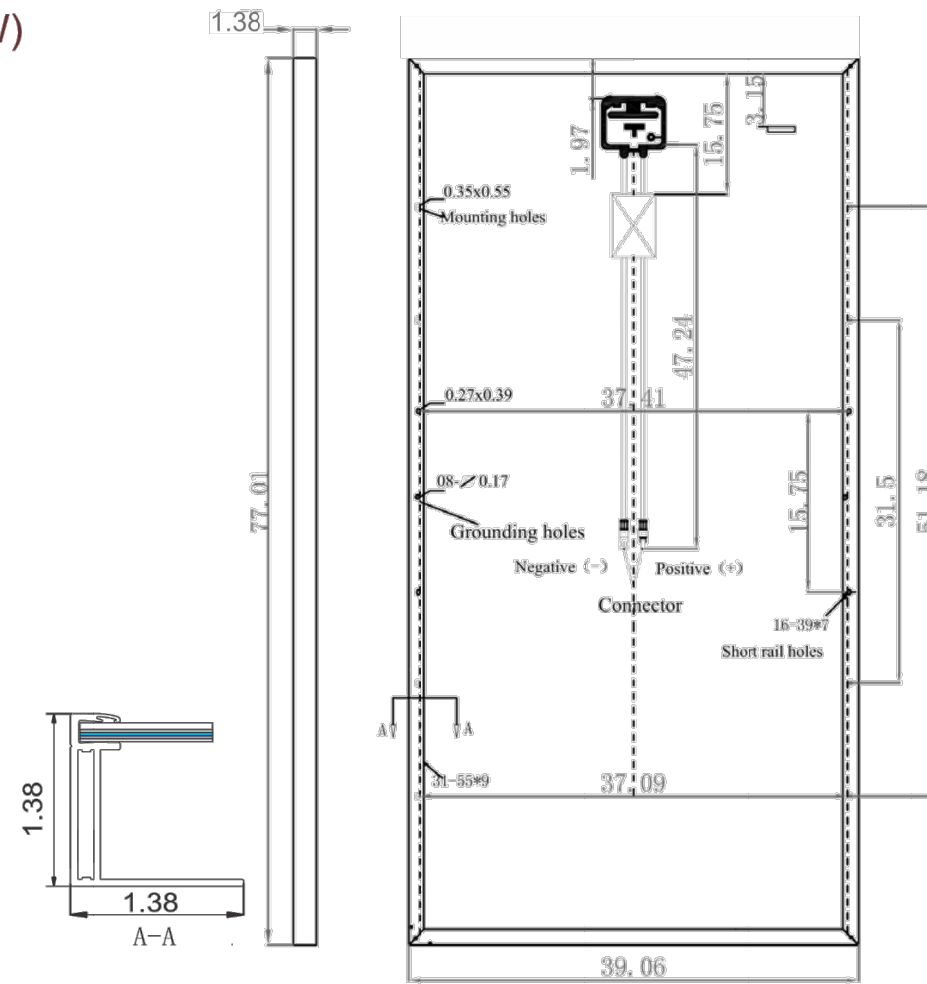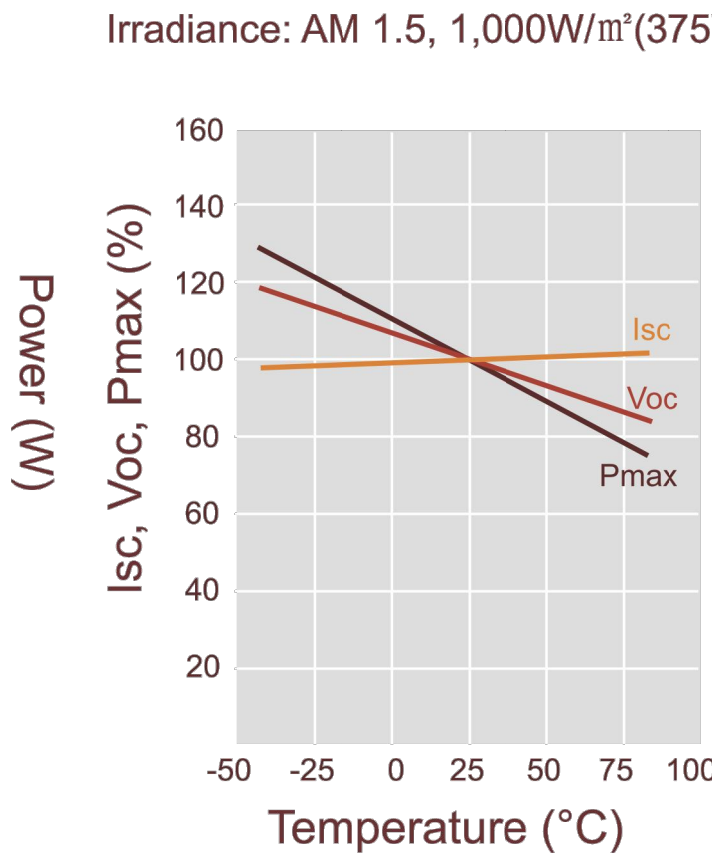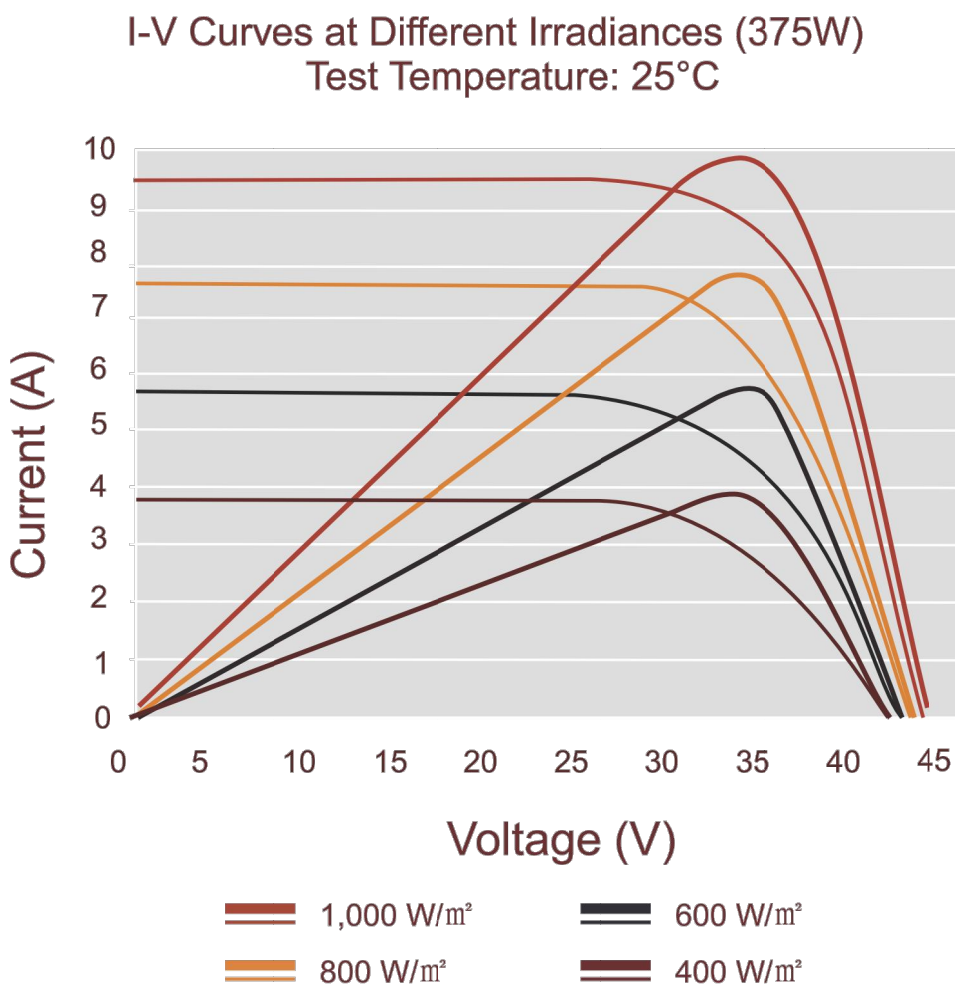

TECHNICAL DATA (10.0-3 208/240, 12.0-3 208/240, 10.0-3 480, 12.5-3 480, 15.0-3 208)

GENERAL DATA	STANDARD WITH ALL FRONIUS SYMO MODELS
Dimensions (width x height x depth)	20.1 x 28.5 x 8.9 inches
Protection Class	NEMA 4X
Night time consumption	< 1 W
Interface topology	Transformerless
Cooling	Variable speed fan
Installation	Indoor and outdoor installation
Ambient operating temperature range	-40°F ~ +140°F (-40 ~ +60 °C)
Permitted humidity	0 ~ 100 % (non-condensing)
Elevation	2000 m (6562 ft) with a max. input voltage of 1000 V / 3400 m (11155 ft) with a max. input voltage of 850 V
DC connection terminals	6x DC+ and 6x DC- screw terminals for copper (solid, stranded), for aluminum (solid / stranded)
AC connection terminals	Screw terminals 14.6 AWG
Certificates and compliance with standards	UL 1741 2010 Second Edition (incl. UL1741 Supplement SA 2016-09 for California Rule 21 and Hawaiian Electric Code Rule 14H), UL1741B for functions: AFCI, RCMI and isolation monitoring; IEEE 1547-2003, IEEE 1547-2014, IEEE 1547-2018, ANSI/IEEE C62.41, FCC Part 15 A & B, NEC 2017 Article 690, C22.2 No. 107.3.16, UL1699B Issue 2-2013, CSA T11.1-M-07 Issue 1-2013

GENERAL DATA	SYMO 10.0-3 208-240	SYMO 12.0-3 208-240	SYMO 10.0-3 480	SYMO 12.5-3 480	SYMO 15.0-3 208
Weight	91.9 lbs.		76.7 lbs.		78.3 lbs.

PROTECTIVE DEVICES	STANDARD WITH ALL FRONIUS SYMO MODELS
DC reverse polarity protection	Yes
Anti-islanding	Internal; in accordance with UL 1741 2010, IEEE 1547-2003 and NEC
Over temperature protection	Output power derating / Active cooling
AFCI	Yes
Rapid shutdown compliant	Yes (according to NEC 2014)
Ground Fault Protection with Isolation Monitor	Yes
Interruption	Yes
DC disconnect	Yes

INTERFACES	AVAILABLE WITH ALL FRONIUS SYMO MODELS
USB (A socket)	Datalogging and inverter update possible via USB
2x RS422 (RJ45 socket)	Fronius Solar-Net interface protocol
AVAILABLE WITH THE FRONIUS DATAMANAGER 2.0 CARD (ONLY ONE CARD REQUIRED FOR UP TO 100 INVERTERS)	
Wi-Fi/Ethernet/Serial/ Datalogger and webserver	Wireless standard 802.11 b/g/n / Fronius Solarweb, SunSpec Modbus TCP / JSON / SunSpec Modbus RTU
6 inputs and 4 digital I/Os	Load management; signaling; multipurpose I/O

TECHNICAL DATA (15.0-3 480, 17.5-3 480, 20.0-3 480, 22.7-3 480, 24.0-3 480)

INPUT DATA	SYMO 15.0-3 480	SYMO 17.5-3 480	SYMO 20.0-3 480	SYMO 22.7-3 480	SYMO 24.0-3 480		
Recommended PV power (kWp)	12.0 ~ 19.5	14.0 ~ 23.0	16.0 ~ 26.0	18.0 ~ 29.5	19.0 ~ 31.0		
Max. usable input current (MPPT 1/MPPT 2)	33.0 A / 25.0 A						
Max. usable input current total (MPPT 1 + MPPT 2)	51 A						
Max. array short circuit current (MPPT 1/MPPT 2)	49.5 A / 37.5 A						
Nominal input voltage	480 V	685 V	695 V	710 V	720 V		
Operating voltage range	200-1000 V						
DC starting voltage	203 V						
MPPT voltage range	350-800 V	400-900 V	420-900 V	500-900 V			
Max. input voltage	1000 V						
Admissible conductor size DC	AWG 14 - AWG 6 copper direct; AWG 6 aluminum direct; AWG 4 - AWG 2 copper or aluminum with input combiner						
Integrated DC string fuse holders	NA						
Max. field input terminal rating	33A						
Number of MPPT	2						

TECHNICAL DATA (15.0-3 480, 17.5-3 480, 20.0-3 480, 22.7-3 480, 24.0-3 480)

OUTPUT DATA	SYMO 15.0-3 480	SYMO 17.5-3 480	SYMO 20.0-3 480	SYMO 22.7-3 480	SYMO 24.0-3 480
Max. output power	480 V	14995 VA	17495 VA	19995 VA	22727 VA
Output configuration	480 V Output 3-W				
Frequency range (adjustable)	45.65 Hz				
Nominal operating frequency	50 Hz				
Admissible conductor size (AC)	AWG 14 - AWG 6				
Total harmonic distortion	<1.5 %				
Power factor range	>0.9				
Max. continuous output current	480 V	18.0 A	21.0 A	24.0 A	26.0 A
OC/PO/AC breaker size	480 V	25 A	30 A	35 A	40 A
Max. efficiency	97.5 %				
CEC efficiency	480 V	97.0 %	97.5 %	97.5 %	97.5 %

TECHNICAL DATA (15.0-3 480, 17.5-3 480, 20.0-3 480, 22.7-3 480, 24.0-3 480)

GENERAL DATA	STANDARD WITH ALL FRONIUS SYMO MODELS
Dimensions (width x height x depth)	20.1 x 28.5 x 8.9 inches
Protection Class	NEMA 4X
Night time consumption	< 1 W
Interface topology	Transformerless
Cooling	Variable speed fan
Installation	Indoor and outdoor installation
Ambient operating temperature range	-40°F ~ +140°F (-40 ~ +60 °C)
Permitted humidity	0 ~ 100 % (non-condensing)
Elevation	2000 m (6562 ft) with a max. input voltage of 1000 V / 3400 m (11155 ft) with a max. input voltage of 850 V
DC connection terminals	6x DC+ and 6x DC- screw terminals for copper (solid, stranded), for aluminum (solid / stranded)
AC connection terminals	Screw terminals 14.6 AWG
Certificates and compliance with standards	UL 1741 2010 Second Edition (incl. UL1741 Supplement SA 2016-09 for California Rule 21 and Hawaiian Electric Code Rule 14H), UL1741B for functions: AFCI, RCMI and isolation monitoring; IEEE 1547-2003, IEEE 1547-2014, IEEE 1547-2018, ANSI/IEEE C62.41, FCC Part 15 A & B, NEC 2017 Article 690, C22.2 No. 107.3.16, UL1699B Issue 2-2013, CSA T11.1-M-07 Issue 1-2013

GENERAL DATA	SYMO 15.0-3 480	SYMO 17.5-3 480	SYMO 20.0-3 480	SYMO 22.7-3 480	SYMO 24.0-3 480
Weight	95.7 lbs.				

PROTECTIVE DEVICES	STANDARD WITH ALL FRONIUS SYMO MODELS
DC reverse polarity protection	Yes
Anti-islanding	Internal; in accordance with UL 1741 2010, IEEE 1547-2003 and NEC
Over temperature protection	Output power derating/Active cooling
AFCI	Yes
Rapid shutdown compliant	Yes (according to NEC 2014)
Ground Fault Protection with Isolation Monitor	Yes
Interruption	Yes
DC disconnect	Yes

INTERFACES	AVAILABLE WITH ALL FRONIUS SYMO MODELS
USB (A socket)	Datalogging and inverter update possible via USB
2x RS422 (RJ45 socket)	Fronius Solar-Net interface protocol
AVAILABLE WITH THE FRONIUS DATAMANAGER 2.0 CARD (ONLY ONE CARD REQUIRED FOR UP TO 100 INVERTERS)	
Wi-Fi/Ethernet/Serial/ Datalogger and webserver	Wireless standard 802.11 b/g/n / Fronius Solarweb, SunSpec Modbus TCP / JSON / SunSpec Modbus RTU
6 inputs and 4 digital I/Os	Load management; signaling; multipurpose I/O

**N: FOR SENSING PURPOSES - NO CURRENT CARRYING CONDUCTOR.

Artisun Solar

12916 5TH ST
GRANDVIEW, MO 64030
PH: (913) 396-3880

PROJECT NAME
LEE'S SUMMIT HONDA -
149.48kWdc

SITE LOCATION
401 NE COLBERN RD
LEE'S SUMMIT, MO

DESIGNER
SOLAR EXPRESS, LLC
5658 LACY RD
FITCHBURG, WI 53711
PHONE: 920-912-2508
CERTIFICATE OF AUTHORITY: E-2019000337

ENGINEER'S STAMP



12/10/2020

DRAWING ISSUE
12/10/2020

RELEASE FOR
CONSTRUCTION
ASTNOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
01/19/2021

REVISION

DOCUMENT TITLE
DATASHEETS

DRAWN BY NJK

SHEET

0 1/2 1

D1