



MiTek USA, Inc.  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017  
314-434-1200

Re: 2523941

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Valley Center).

Pages or sheets covered by this seal: I43385000 thru I43385096

My license renewal date for the state of Missouri is December 31, 2021.

Missouri COA: Engineering 001193



October 28, 2020

Johnson, Andrew ,Engineer

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	143385000
2523941	A1	HIP GIRDER	1	3	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:44 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-CmErEjrAh0Tcxk7RRyODn7zZu??SbZVx1\_iftdyP7bv

0-11-0	2-4-12	7-3-4	11-7-5	15-9-11	20-0-0	24-2-5	26-0-0	28-0-0	28-4-11	32-8-12	37-8-8	40-0-0	40-11-9
0-11-0	2-4-12	4-10-8	4-4-1	4-2-5	4-2-5	4-2-5	1-9-11	2-0-0	0-4-11	4-4-1	4-11-12	2-3-8	0-11-0

Scale = 1:73.1

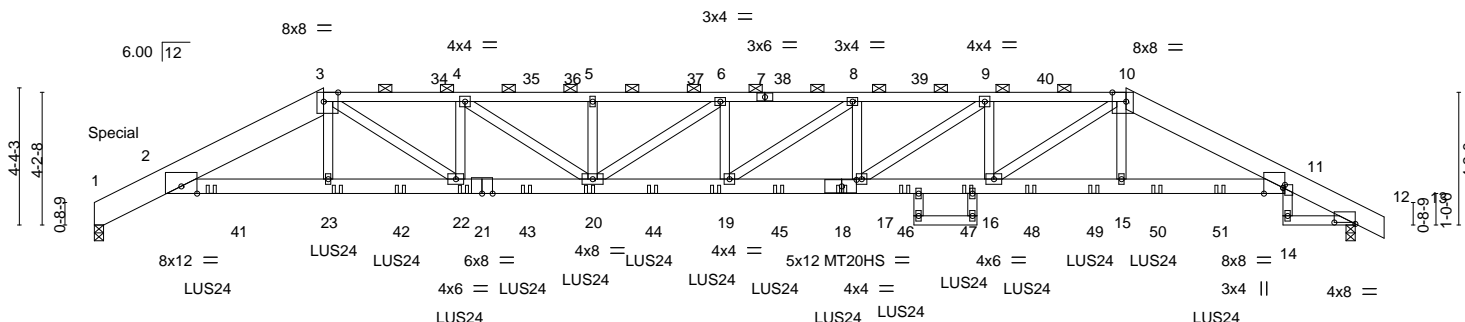

2-4-12	7-3-4	11-7-5	15-9-11	20-0-0	24-2-5	26-0-0	28-0-0	28-4-11	32-8-12	37-8-8	40-0-0
2-4-12	4-10-8	4-4-1	4-2-5	4-2-5	4-2-5	1-9-11	2-0-0	0-4-11	4-4-1	4-11-12	2-3-8

Plate Offsets (X,Y)-- [3:0-5-8,Edge], [10:0-5-4,Edge], [11:0-7-5,Edge], [11:0-1-2,0-0-11], [12:0-8-0,0-0-9], [18:0-5-10,0-2-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.83	in (loc) l/defl L/d	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 1.00	Vert(LL) -0.70 19 >685 240	MT20HS	148/108
TCDL 10.0	Lumber DOL 1.15	WB 0.40	Vert(CT) -1.16 19 >412 180		
BCLL 0.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.45 12 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 641 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except
1-3: 2x10 SP 2400F 2.0E, 10-13: 2x8 SP 2400F 2.0E	2-0-0 oc purlins (4-0-12 max.): 3-10.
BOT CHORD 2x4 SPF No.2 *Except*	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
2-21: 2x6 SPF No.2, 11-18,18-21: 2x6 SPF 2100F 1.8E	
WEBS 2x4 SPF No.2	

**REACTIONS.** (size) 1=0-3-8, 12=0-3-8  
Max Horz 1=-84(LC 56)  
Max Uplift 1=-626(LC 12), 12=-623(LC 12)  
Max Grav 1=4846(LC 34), 12=4499(LC 34)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-2162/317, 2-3=-11198/1343, 3-4=-14664/1758, 4-5=-17123/2041, 5-6=-17123/2041, 6-8=-18065/2158, 8-9=-17329/2077, 9-10=-14750/1789, 10-11=-11712/1459, 11-12=-2272/337  
BOT CHORD 2-23=-1168/10488, 22-23=-1173/10545, 20-22=-1637/14664, 19-20=-2036/18065, 17-19=-1955/17329, 16-17=-1667/14750, 15-16=-1286/11027, 11-15=-1276/10944, 11-14=-48/443  
WEBS 3-23=-103/1113, 3-22=-554/4920, 4-22=-2015/256, 4-20=-341/2968, 5-20=-350/66, 6-20=-1137/141, 6-19=-118/439, 10-15=-189/1487, 8-17=-869/121, 10-16=-456/4446, 9-16=-2058/255, 9-17=-348/3113, 8-19=-98/888

- NOTES-**
- 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x10 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-7-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=38ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0 Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - Provide adequate drainage to prevent water ponding.
  - On all plates use 120 plates unless otherwise indicated.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	A1	HIP GIRDER	1	3	I43385000

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:45 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-gyoDS3soSKbTZuid?fvSKKWkePLhK0l5FeRCP3yP7bu

- NOTES-**
- 10) All plates are 2x4 MT20 unless otherwise indicated.
  - 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 12) Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=626, 12=623.
  - 14) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 15) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 16) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 4-0-0 oc max. starting at 3-8-8 from the left end to 35-8-8 to connect truss(es) to front face of bottom chord.
  - 17) Fill all nail holes where hanger is in contact with lumber.
  - 18) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 594 lb down and 136 lb up at 1-8-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

- LOAD CASE(S)** Standard
- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
  - Uniform Loads (plf)
    - Vert: 1-29=-73, 3-29=-51, 3-10=-61, 10-11=-51, 11-13=-51, 11-28=-20, 14-31=-20
  - Concentrated Loads (lb)
    - Vert: 18=-334(F) 23=-338(F) 22=-334(F) 20=-334(F) 19=-334(F) 28=-594(F) 41=-292(F) 42=-338(F) 43=-334(F) 44=-334(F) 45=-334(F) 46=-339(F) 47=-339(F) 48=-339(F) 49=-300(F) 50=-298(F) 51=-404(F)

Job	Truss	Truss Type	Qty	Ply	143385001
2523941	A2	Hip	1	1	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:52 2020 Page 1

ID:VPVqvFnP0P0b1j2ZrI0qezdKbx-zljtwSxBpUTUvykzvdX66pJwHDkHTBb7sDe499yP7bn

2-4-12	9-3-4	16-5-11	23-6-5	26-2-0	28-0-0	30-8-12	37-8-8	40-0-0	40-11-0
2-4-12	6-10-8	7-2-7	7-0-11	2-7-11	1-10-0	2-8-12	6-11-12	2-3-8	0-11-0

Scale = 1:72.3

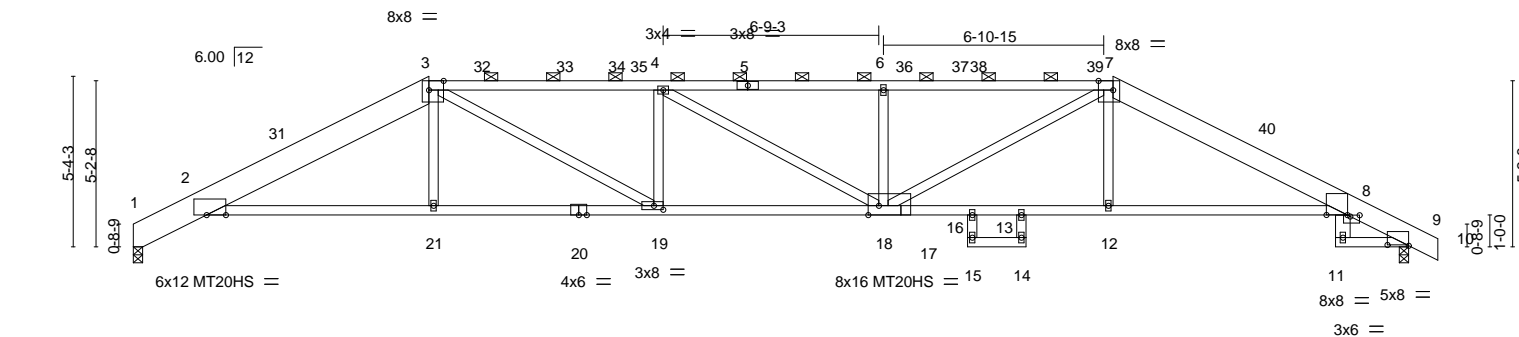

2-4-12	9-3-4	16-5-11	23-6-5	26-2-0	28-0-0	30-8-12	37-8-8	40-0-0
2-4-12	6-10-8	7-2-7	7-0-11	2-7-11	1-10-0	2-8-12	6-11-12	2-3-8

Plate Offsets (X,Y)-- [2:0-7-4,Edge], [3:0-5-8,Edge], [7:0-5-8,Edge], [8:0-7-14,0-0-1], [8:0-3-8,0-0-8], [9:0-8-0,0-0-5], [17:0-0-0,0-1-12], [17:0-4-0,Edge], [18:0-1-12,0-0-0], [19:0-3-8,0-0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.87	in (loc) l/defl L/d	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 1.00	Vert(LL) -0.51 18-19 >938 240	MT20HS	148/108
TCDL 10.0	Lumber DOL 1.15	WB 0.40	Vert(CT) -0.95 18-19 >504 180		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.48 9 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 194 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF 1650F 1.5E \*Except\*  
1-3: 2x10 SP 2400F 2.0E, 7-10: 2x8 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
8-11: 2x6 SPF No.2, 8-17,17-20: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (2-2-0 max.): 3-7.  
BOT CHORD Rigid ceiling directly applied. Except:  
2-2-0 oc bracing: 2-21

#### REACTIONS.

(size) 1=0-3-8, 9=0-3-8  
Max Horz 1=96(LC 14)  
Max Uplift 1=138(LC 16), 9=170(LC 16)  
Max Grav 1=1810(LC 2), 9=1866(LC 2)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-801/122, 2-3=-3639/410, 3-4=-4754/534, 4-6=-4754/528, 6-7=-4754/528,  
7-8=-3706/411, 8-9=-765/131  
BOT CHORD 2-21=-259/3330, 19-21=-257/3336, 18-19=-376/4754, 16-18=-262/3381, 13-16=-274/3326,  
12-13=-262/3381, 8-12=-264/3373  
WEBS 3-21=0/294, 7-12=0/323, 3-19=-136/1613, 4-19=-633/126, 6-18=-623/127,  
7-18=-131/1564

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 2-10-9, Interior(1) 2-10-9 to 9-3-4, Exterior(2R) 9-3-4 to 13-6-3, Interior(1) 13-6-3 to 30-8-12, Exterior(2R) 30-8-12 to 34-11-11, Interior(1) 34-11-11 to 40-11-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- All plates are 2x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb)

Continued on page 2



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	A2	Hip	1	1	I43385001
Job Reference (optional)					


- NOTES-**
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 13) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Job	Truss	Truss Type	Qty	Ply	143385002
2523941	A3	Hip	1	1	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:54 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIOeqzdKbx-whqdK8zRL5kC8GuM12aaBEOIL1Qdx\_IQKX7BE2yP7bl



Scale = 1:72.0

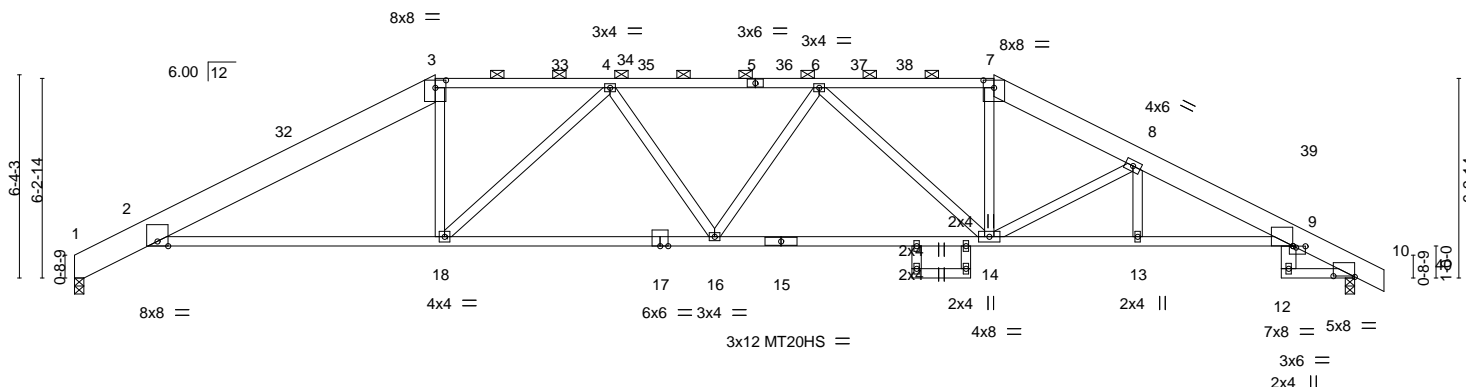

2-4-12	11-3-4	20-0-0	23-3-3	26-2-0	28-0-0	33-2-10	37-8-8	40-0-0
2-4-12	8-10-8	8-8-12	3-3-3	2-10-13	1-10-0	4-5-14	4-5-14	2-3-8

Plate Offsets (X,Y)-- [3:0-4-0,0-2-13], [7:0-4-0,0-2-13], [9:0-2-Edge], [9:0-3-8,0-0-8], [10:0-8-0,0-0-5]

LOADING (psf)	SPACING-	CSI.	DEFL.		PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.77	in (loc) l/defl L/d		MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.95	Vert(LL) -0.38 14-16 >999 240		MT20HS	148/108
TCDL 10.0	Lumber DOL 1.15	WB 0.86	Vert(CT) -0.76 14-16 >628 180			
BCLL 0.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.45 10 n/a n/a			
BCDL 10.0	Code IRC2018/TPI2014				Weight: 209 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2 \*Except\*  
1-3: 2x10 SP 2400F 2.0E, 7-11: 2x8 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
2-17,9-15: 2x4 SPF 1650F 1.5E, 9-12: 2x6 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (2-2-0 max.): 3-7.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 1=0-3-8, 10=0-3-8  
Max Horz 1=-116(LC 14)  
Max Uplift 1=-138(LC 16), 10=-170(LC 16)  
Max Grav 1=1810(LC 2), 10=1866(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-801/123, 2-3=-3330/373, 3-4=-3003/392, 4-6=-3603/445, 6-7=-2990/396,  
7-8=-3417/414, 8-9=-4263/485, 9-10=-765/131  
BOT CHORD 2-18=-204/2982, 16-18=-282/3545, 14-16=-281/3552, 13-14=-370/3977, 9-13=-370/3977  
WEBS 3-18=-5/816, 7-14=-100/1243, 4-18=-914/107, 6-14=-931/109, 8-14=-1245/190

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 2-10-9, Interior(1) 2-10-9 to 11-3-4, Exterior(2R) 11-3-4 to 15-6-3, Interior(1) 15-6-3 to 28-8-12, Exterior(2R) 28-8-12 to 33-2-10, Interior(1) 33-2-10 to 40-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=138, 10=170.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28,2020

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**MiTek**  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	I43385002  Job Reference (optional)
2523941	A3	Hip	1	1	

- NOTES-**
- 12) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Job	Truss	Truss Type	Qty	Ply	
2523941	A4	Hip	1	1	143385003

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:55 2020 Page 1
ID:VPVqvFnP0P0b1j2tZrlQqezdKbx-OtO?YT\_35Ps2mQTYbl5pkRwR9RILgUMZZBskmUyP7bk

2-4-12
13-3-4
20-1-12
26-2-0
26-8-12
33-2-10
40-0-0
40-11-0
2-4-12
10-10-8
6-10-8
6-0-4
0-6-12
6-5-14
6-9-6
0-11-0

Scale = 1:70.8

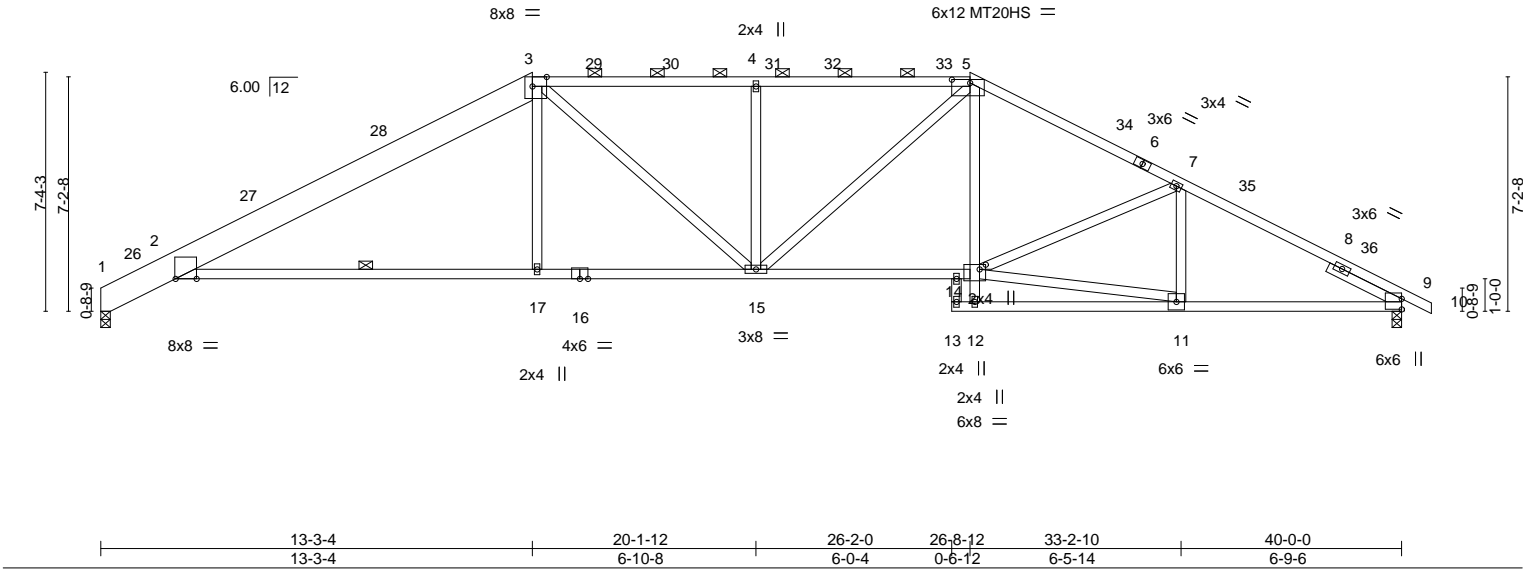


Plate Offsets (X,Y)--		[2:0-7-12,Edge], [3:0-5-4,Edge], [5:0-6-12,0-1-4], [14:0-2-4,0-1-12]	
<b>LOADING</b> (psf)		<b>SPACING-</b>	<b>CSL.</b>
TCLL (roof)	25.0	2-0-0	TC 0.89
Snow (Pf/Pg)	20.4/20.0	Plate Grip DOL 1.15	BC 0.98
TCDL	10.0	Lumber DOL 1.15	WB 0.65
BCLL	0.0	Rep Stress Incr YES	Matrix-AS
BCDL	10.0	Code IRC2018/TPI2014	
		<b>DEFL.</b>	<b>PLATES</b>
		in (loc) l/defl L/d	MT20 197/144
		Vert(LL) -0.36 17-21 >999 240	MT20HS 148/108
		Vert(CT) -0.83 17-21 >578 180	
		Horz(CT) 0.33 9 n/a n/a	
			Weight: 199 lb FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2 *Except* 1-3: 2x10 SP 2400F 2.0E	TOP CHORD	Structural wood sheathing directly applied, except 2-0-0 oc purlins (2-2-0 max.): 3-5.
BOT CHORD	2x4 SPF No.2 *Except* 2-16: 2x4 SPF 1650F 1.5E	BOT CHORD	Rigid ceiling directly applied. Except: 10-0-0 oc bracing: 2-17
WEBS	2x4 SPF No.2		
SLIDER	Right 2x4 SPF No.2 2-6-0		

<b>REACTIONS.</b>	
(size)	1=0-3-8, 9=0-3-8
Max Horz	1=-133(LC 14)
Max Uplift	1=-136(LC 16), 9=-170(LC 16)
Max Grav	1=1814(LC 2), 9=1867(LC 2)
<b>FORCES.</b> (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	1-2=-802/117, 2-3=-3102/362, 3-4=-3085/422, 4-5=-3087/423, 5-7=-3097/393, 7-9=-3102/362
BOT CHORD	2-17=-176/2759, 15-17=-174/2764, 14-15=-179/2708, 9-11=-246/2692
WEBS	3-17=0/372, 3-15=-51/611, 4-15=-650/127, 5-15=-54/686, 7-11=-315/100, 5-14=-18/599, 11-14=-246/2646, 7-14=-227/253

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 2-10-9, Interior(1) 2-10-9 to 13-3-4, Exterior(2R) 13-3-4 to 17-6-3, Interior(1) 17-6-3 to 26-8-12, Exterior(2R) 26-8-12 to 30-11-11, Interior(1) 30-11-11 to 40-11-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=136, 9=170.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and Contradictory to standard ANSI/TPI 1.



October 28,2020



Job	Truss	Truss Type	Qty	Ply	
2523941	A4	Hip	1	1	I43385003
Job Reference (optional)					

- NOTES-**
- 12) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Job	Truss	Truss Type	Qty	Ply	
2523941	A5	Hip	1	1	143385004

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:58 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-oS48AV0yOKEdtB7GueWM4Y\_kepXtr??F95ONpyP7bh

2-4-12	8-9-10	15-3-4	20-0-0	24-8-12	25-8-8	29-7-8	31-2-6	36-4-0	40-0-0	40-11-0
2-4-12	6-4-14	6-5-10	4-8-12	4-8-12	0-11-12	3-11-0	1-6-14	5-1-10	3-8-0	0-11-0

Scale = 1:74.4

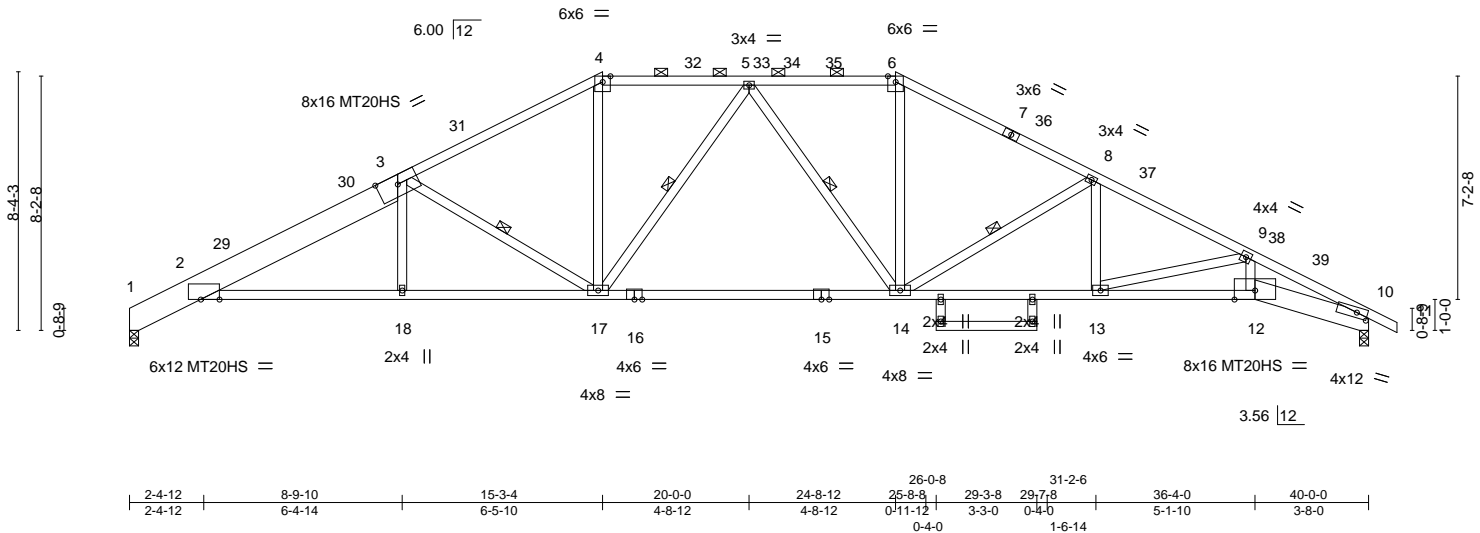


Plate Offsets (X,Y)-- [2:0-7-4,Edge], [10:0-4-3,0-2-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL 1.15		TC 0.68	Vert(LL) -0.31	14-17	>999	240	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL 1.15		BC 0.88	Vert(CT) -0.74	14-17	>650	180	MT20HS	148/108
TCDL 10.0	Rep Stress Incr YES		WB 0.59	Horz(CT) 0.35	10	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS						
BCDL 10.0								Weight: 201 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 1-3: 2x10 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (3-6-10 max.): 4-6.
BOT CHORD 2x4 SPF 1650F 1.5E *Except* 10-12: 2x8 SP 2400F 2.0E, 15-16: 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 3-17, 5-17, 5-14, 8-14
OTHERS 2x4 SPF No.2	

**REACTIONS.** (size) 1=0-3-8, 10=0-3-8  
Max Horz 1=-153(LC 14)  
Max Uplift 1=-138(LC 16), 10=-173(LC 16)  
Max Grav 1=1810(LC 2), 10=1859(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-801/118, 2-3=-3637/427, 3-4=-2860/385, 4-5=-2450/375, 5-6=-2456/379,  
6-8=-2860/385, 8-9=-3727/445, 9-10=-5269/553  
BOT CHORD 2-18=-286/3322, 17-18=-285/3327, 14-17=-167/2584, 13-14=-291/3301, 12-13=-438/4547,  
10-12=-450/4707  
WEBS 3-17=-1134/182, 4-17=-61/862, 5-17=-426/62, 5-14=-420/61, 6-14=-57/856,  
9-13=-1291/151, 9-12=-39/851, 8-13=-0/468, 8-14=-1101/176

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 2-10-9, Interior(1) 2-10-9 to 15-3-4, Exterior(2R) 15-3-4 to 19-6-3, Interior(1) 19-6-3 to 24-8-12, Exterior(2R) 24-8-12 to 28-11-11, Interior(1) 28-11-11 to 40-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 1, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=138, 10=173.

Continued on page 2



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	I43385004
2523941	A5	Hip	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:58 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-oS48AV0yOKEddtB7GueWM4Y\_kepXtr??F95ONpyP7bh

NOTES-

- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 12) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Job	Truss	Truss Type	Qty	Ply	
2523941	A6	Hip	1	1	143385005


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:00 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-krCubB1CwxULSBLWNJg\_RVeHvSTPLosliTaVRiyP7bf

2-4-12	9-8-6	17-3-4	22-8-12	25-8-8	29-6-6	29-7-8	36-4-0	40-0-0	40-11-0
2-4-12	7-3-10	7-6-14	5-5-8	2-11-12	3-9-14	0-1-2	6-8-8	3-8-0	0-11-0

Scale = 1:76.0

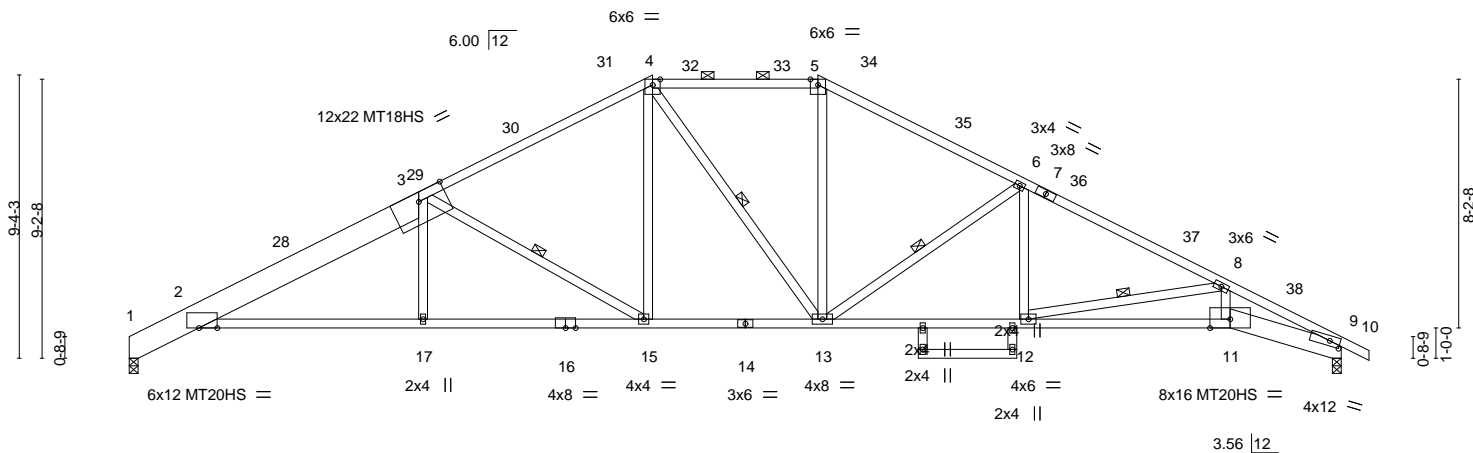

2-4-12	9-8-6	17-3-4	22-8-12	25-8-8	29-6-6	29-7-8	36-4-0	40-0-0
2-4-12	7-3-10	7-6-14	5-5-8	2-11-12	3-9-14	0-1-2	6-8-8	3-8-0

Plate Offsets (X,Y)-- [2:0-7-4,Edge], [9:0-4-3,0-2-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL 1.15		TC 0.89	Vert(LL) -0.32	11-12	>999	240	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL 1.15		BC 0.92	Vert(CT) -0.61	11-12	>790	180	MT20HS	148/108
TCDL 10.0	Rep Stress Incr YES		WB 0.44	Horz(CT) 0.37	9	n/a	n/a	MT18HS	197/144
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS						
BCDL 10.0								Weight: 204 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2 \*Except\*  
1-3: 2x10 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
9-11: 2x8 SP 2400F 2.0E, 11-14: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (3-7-1 max.): 4-5.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 3-15, 4-13, 6-13, 8-12

**REACTIONS.** (size) 9=0-3-8, 1=0-3-8  
Max Horz 1=-172(LC 14)  
Max Uplift 9=-173(LC 16), 1=-138(LC 16)  
Max Grav 9=1859(LC 2), 1=1810(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-801/118, 2-3=-3691/417, 3-4=-2685/380, 4-5=-2239/380, 5-6=-2660/383,  
6-8=-3643/423, 8-9=-5416/564  
BOT CHORD 2-17=-269/3361, 15-17=-267/3367, 13-15=-103/2241, 12-13=-254/3202, 11-12=-454/4702,  
9-11=-463/4864  
WEBS 3-17=0/312, 3-15=-1270/192, 4-15=-37/744, 5-13=-53/777, 6-13=-1156/174,  
8-12=-1577/203, 8-11=-28/883, 6-12=0/511

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 2-10-9, Interior(1) 2-10-9 to 17-3-4, Exterior(2R) 17-3-4 to 21-6-3, Interior(1) 21-6-3 to 22-8-12, Exterior(2R) 22-8-12 to 26-11-11, Interior(1) 26-11-11 to 40-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCCL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 9, 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=173, 1=138.



October 28, 2020

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


**MiTek**  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	A6	Hip	1	1	I43385005
Job Reference (optional)					

- NOTES-**
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 12) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

8.240 s Mar. 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:03 2020 Page 1

ID:VPVayEnP0P0b1j2tZrldQezdKbx-9Qt1DD45Dsswif443BEh37GomflJWY8ckQBn921vP7hc



**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


**TOP CHORD**  
1-2=-818/115, 2-3=-3666/366, 3-4=-3771/466, 4-5=-2541/365, 5-6=-2195/349,  
6-7=-2642/356, 7-9=-3704/393, 9-10=-5560/538

**BOT CHORD**  
2-18=-207/3312, 16-18=-134/2685, 14-16=-60/2209, 13-14=-220/3266, 12-13=-435/4823,  
10-12=-442/4992

**WEBS**  
3-18=-761/175, 4-18=-126/1127, 4-16=-886/168, 5-16=-146/957, 6-14=-68/724,  
7-14=-124/189, 7-13=0/550, 9-13=-1692/218, 9-12=-19/919, 6-16=-317/275

October 28.2020

Continued on page 2

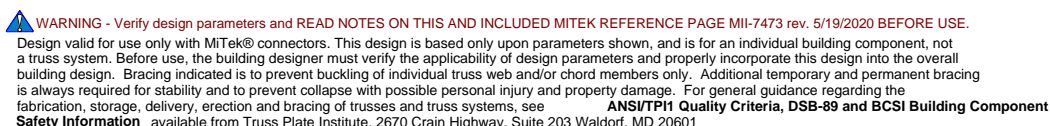

Job	Truss	Truss Type	Qty	Ply	I43385006
2523941	A7	HIP	1	1	

- NOTES-**
- 12) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Job	Truss	Truss Type	Qty	Ply	
2523941	A8	ROOF SPECIAL	1	1	143385007

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:04 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-dcRPRY5j\_A\_nLofHc8lwbLo2p3rXHUgud5YjaTyP7bb

2-4-12	8-9-10	15-0-0	20-0-0	25-0-0	31-2-6	36-4-0	40-0-0	40-11-0
2-4-12	6-4-14	6-2-6	5-0-0	5-0-0	6-2-6	5-1-10	3-8-0	0-11-0

Scale = 1:72.9

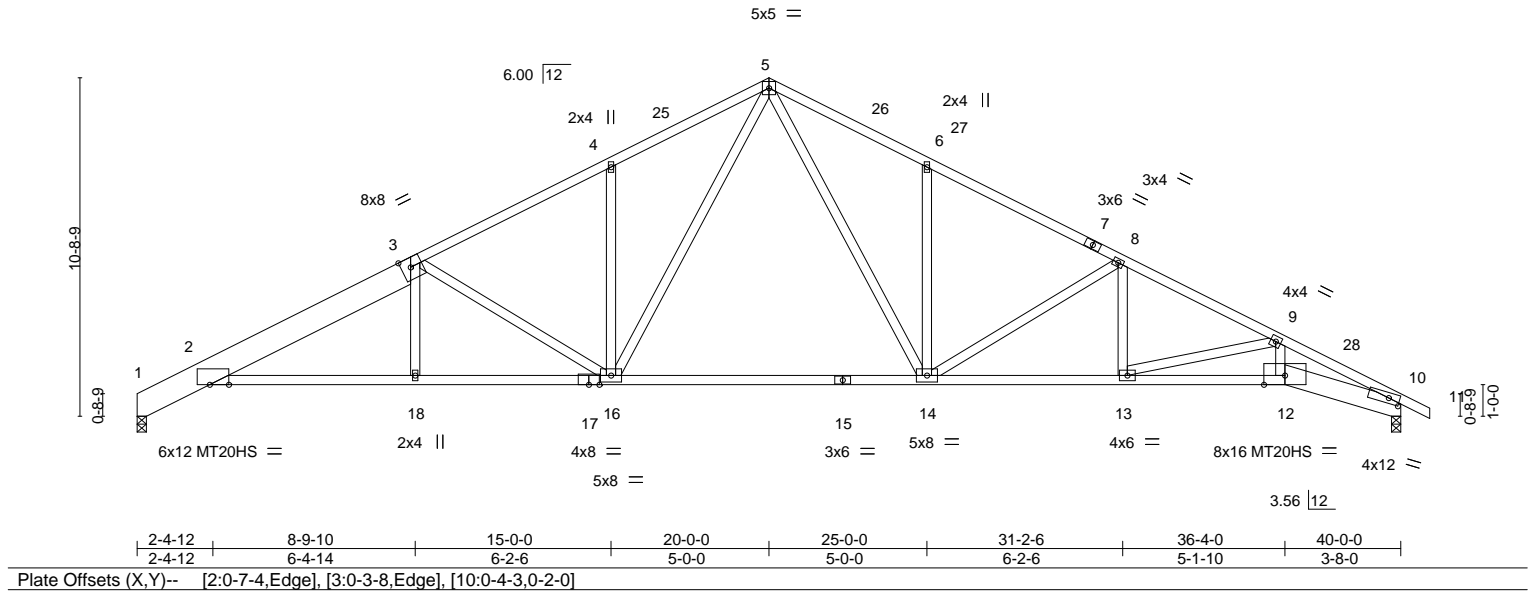


Plate Offsets (X,Y)-- [2:0-7-4,Edge], [3:0-3-8,Edge], [10:0-4-3,0-2-0]									
<b>LOADING</b> (psf)		<b>SPACING-</b>		<b>CSI.</b>		<b>DEFL.</b>		<b>PLATES</b>	
TCLL (roof)	25.0	2-0-0		TC	0.58	in (loc)	l/defl	MT20	197/144
Snow (Pf/Pg)	15.4/20.0	Plate Grip DOL	1.15	BC	0.91	Vert(LL)	-0.33 14-16	MT20HS	148/108
TCDL	10.0	Lumber DOL	1.15	WB	0.90	Vert(CT)	-0.78 14-16		
BCLL	0.0	Rep Stress Incr	YES	Matrix-AS		Horz(CT)	0.34 10		
BCDL	10.0	Code IRC2018/TPI2014					n/a		
								Weight: 201 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2 *Except* 1-3: 2x10 SP 2400F 2.0E	TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	2x4 SPF No.2 *Except* 10-12: 2x8 SP 2400F 2.0E, 12-15: 2x4 SPF 1650F 1.5E	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SPF No.2		

<b>REACTIONS.</b>	
(size)	10=0-3-8, 1=0-3-8
Max Horz	1=199(LC 14)
Max Uplift	10=173(LC 16), 1=138(LC 16)
Max Grav	10=1859(LC 2), 1=1810(LC 2)

<b>FORCES.</b> (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD	1-2=-801/121, 2-3=-3626/409, 3-4=-2864/376, 4-5=-2840/462, 5-6=-2850/461, 6-8=-2867/373, 8-9=-3727/423, 9-10=-5269/525
BOT CHORD	2-18=-262/3309, 16-18=-260/3314, 14-16=-45/1900, 13-14=-261/3301, 12-13=-413/4546, 10-12=-424/4707
WEBS	3-16=-985/162, 4-16=-404/154, 5-16=-178/1205, 5-14=-180/1224, 6-14=-410/155, 8-14=-970/156, 8-13=-4/464, 9-13=-1287/157, 9-12=-33/853

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 2-10-9, Interior(1) 2-10-9 to 20-0-0, Exterior(2R) 20-0-0 to 23-0-0, Interior(1) 23-0-0 to 40-11-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 10, 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 10=173, 1=138.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:06 2020 Page 1

Job Reference (optional)

ID:VPVqyFnP0P0b1j2tZrIOgezdkbx-Z?Z9sE6zWnEva6ofkZnOhmuLysW IVMB4P1pfLyP7bZ

Scale = 1:76.7

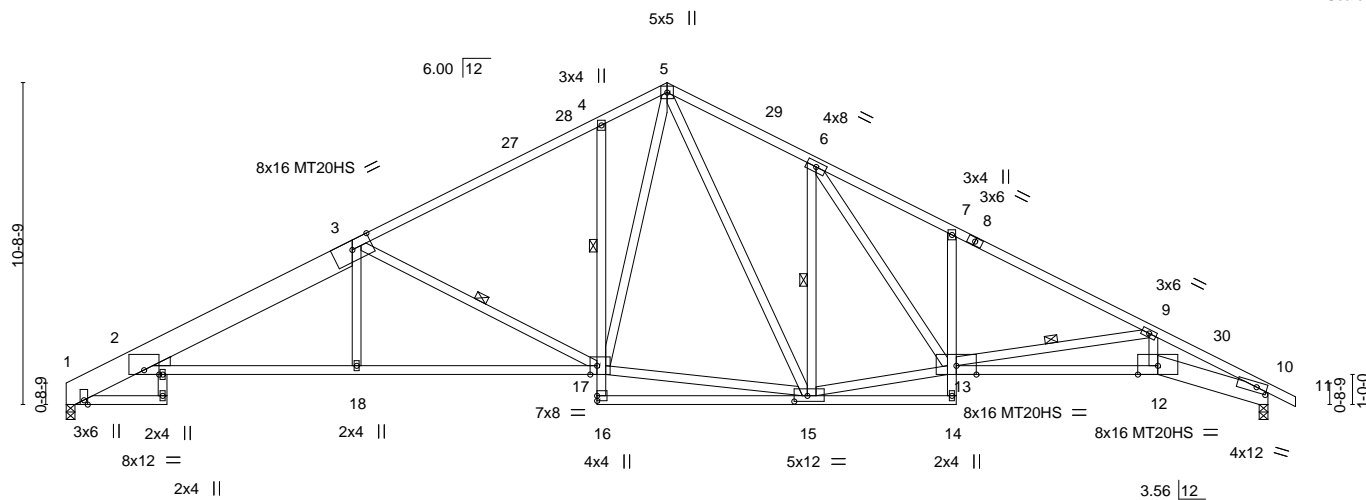

	3-4-4	3-9-12	9-8-0	17-8-0	24-9-12	29-7-8	36-4-0	40-0-0
Plate Offsets (X,Y)--	3-4-4	0-5-8	5-10-4	8-0-0	7-1-12	4-9-12	6-8-8	3-8-0
	[10:0-4-3-0-2-0-1] [15:0-5-4-0-2-4-1] [17:0-2-12-Edgae]							

[illegible]

**LUMBER-**

TOP CHORD	2x4 SPF No.2 "Except" 1-3: 2x10 SP 2400F 2.0E
BOT CHORD	2x4 SPF No.2 "Except" 12-13: 2x4 SPF 1650F 1.5E, 10-12: 2x8 SP 2400F 2.0E
WEBS	2x4 SPF No.2
WEDGE	
Left: 2x4 SP No.3	

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied.
BOT CHORD	Rigid ceiling directly applied. Except:
	1 Row at midpt 4-17
WEBS	1 Row at midpt 3-17, 6-15, 9-13

**REACTIONS.**

(size) 1=0-3-8, 10=0-3-8  
 Max Horz 1=-199(LC 14)  
 Max Uplift 1=-138(LC 16), 10=-173(LC 16)  
 Max Gray 1=1810(LC 2), 10=1859(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-801/121, 2-3=-3561/403, 3-4=-2558/366, 4-5=-2443/434, 5-6=-2444/441,  
6-7=-3423/482, 7-9=-3481/403, 9-10=-5368/536

BOT CHORD 2-18=-250/3234, 17-18=-448/3241, 4-17=-401/165, 7-13=-417/140, 12-13=-431/4645,  
10-12=-438/4811

WEBS 3-18=0/340, 3-17=-1207/188, 5-17=-21/7335, 5-17=-196/1336, 5-15=-169/771,  
6-15=-1176/231, 13-15=-81/2051, 6-13=-184/1540, 9-13=-1620/210, 9-12=-18/897

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 1-1-12 to 2-10-9, Interior(1) 2-10-9 to 20-0-0, Exterior(2R) 20-0-0 to 23-0-0, Interior(1) 23-0-0 to 40-11-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TALL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 6) All plates are MT20 plates unless otherwise indicated.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) Bearing at joint(s) 1, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=138, 10=173.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28.2020

Continued on page 2



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI-1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203, Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	I43385008
2523941	A9	Roof Special	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:06 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-Z?Z9sE6zWnEVa6ofkZnOhmuLysW\_IVMB4P1pfLyP7bZ

NOTES-

- 11) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	A10	ROOF SPECIAL	1	1	143385009


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:46 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-99MbFPtQDejKB1HpZMQhtY3wRoh33SREUIBmxWyP7bt

4-6-4	9-8-0	17-8-0	20-0-0	24-7-0	29-2-0	33-5-14	36-4-0	40-0-0	40-11-0
4-6-4	5-1-12	8-0-0	2-4-0	4-7-0	4-7-0	4-3-14	2-10-1	3-8-0	0-11-0

Scale = 1:74.2

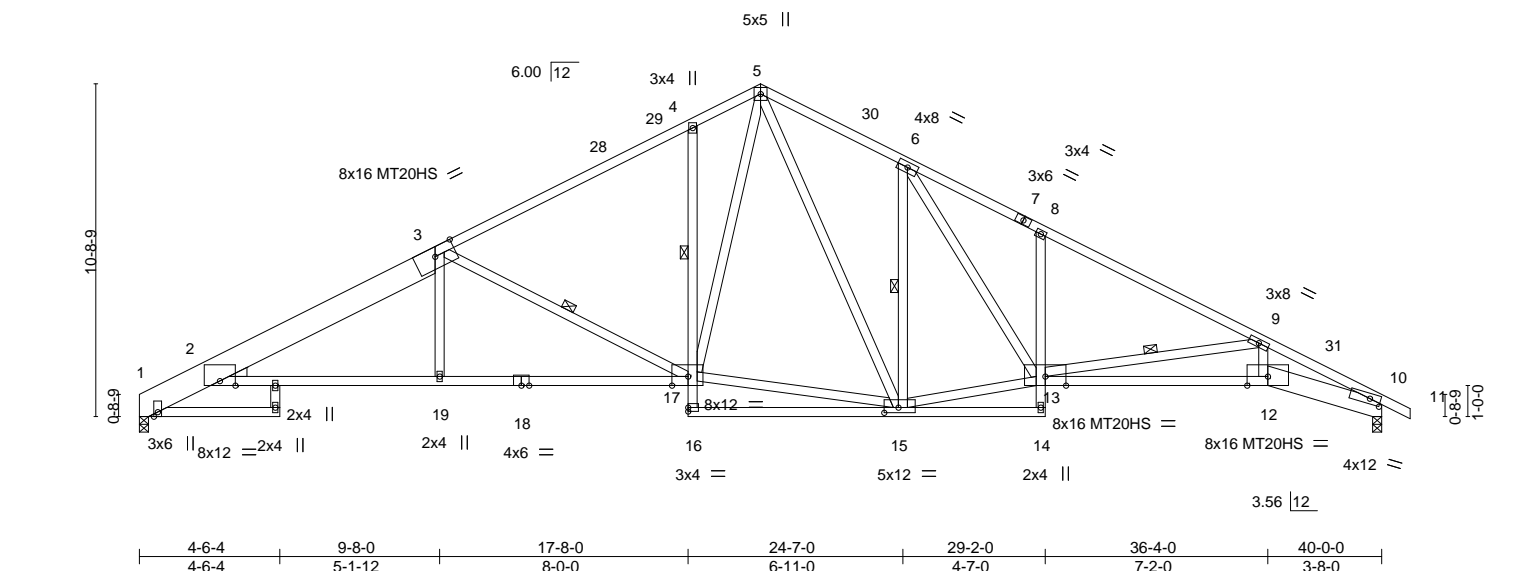

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.76	in (loc) l/defl L/d	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.93	Vert(LL) -0.34 12-13 >999	MT20HS	148/108
TCDL 10.0	Lumber DOL 1.15	WB 0.50	Vert(CT) -0.67 12-13 >712		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.36 10 n/a		
BCDL 10.0	Code IRC2018/TPI2014				
				Weight: 235 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
1-3: 2x10 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
12-13: 2x4 SPF 1650F 1.5E, 10-12: 2x8 SP 2400F 2.0E  
WEBS 2x4 SPF No.2  
WEDGE  
Left: 2x4 SP No.3

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied. Except:  
1 Row at midpt 4-17  
WEBS 1 Row at midpt 3-17, 6-15, 9-13

#### REACTIONS.

(size) 1=0-3-8, 10=0-3-8  
Max Horz 1=199(LC 14)  
Max Uplift 1=138(LC 16), 10=173(LC 16)  
Max Grav 1=1810(LC 2), 10=1859(LC 2)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-801/121, 2-3=-3561/403, 3-4=-2558/366, 4-5=-2444/434, 5-6=-2415/437,  
6-8=-3360/479, 8-9=-3424/399, 9-10=-5394/539  
BOT CHORD 2-19=-250/3234, 17-19=-248/3241, 4-17=-402/166, 8-13=-432/145, 12-13=-436/4672,  
10-12=-442/4839  
WEBS 3-19=0/339, 3-17=-1207/188, 15-17=-19/1739, 5-17=-197/1346, 5-15=-168/753,  
6-15=-1197/228, 13-15=-72/2049, 6-13=-184/1547, 9-13=-1702/223, 9-12=-13/904

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 2-10-9, Interior(1) 2-10-9 to 20-0-0, Exterior(2R) 20-0-0 to 23-0-0, Interior(1) 23-0-0 to 40-11-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.0; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 1, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=138, 10=173.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

Continued on page 2



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	I43385009
2523941	A10	ROOF SPECIAL	1	1	

**NOTES-**

11) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

Job	Truss	Truss Type	Qty	Ply	
2523941	A11	ROOF SPECIAL	1	1	I43385010


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:48 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-5XTM44uglFz2QLQCgnTAyz8GVcNmXLUXxbgs0OyP7br

4-6-4	9-8-0	17-8-0	20-0-0	26-6-13	33-1-11	40-0-0	40-11-0
4-6-4	5-1-12	8-0-0	2-4-0	6-6-13	6-6-13	6-10-5	0-11-0

Scale = 1:77.3

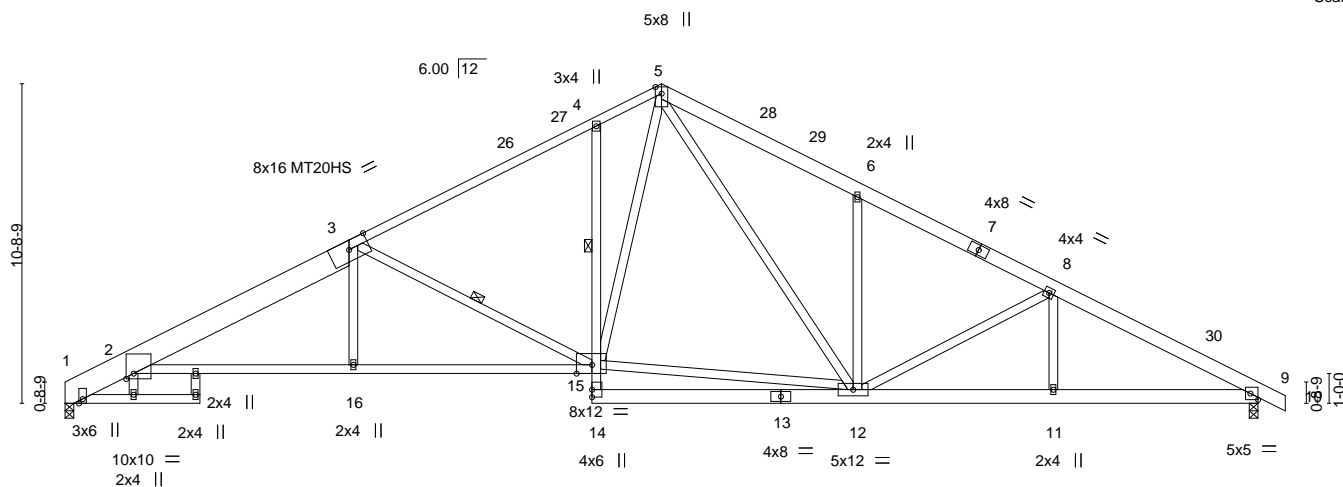

2-3-9	4-6-4	9-8-0	17-8-0	26-6-13	33-1-11	40-0-0
2-3-9	2-2-11	5-1-12	8-0-0	8-10-13	6-6-13	6-10-5

Plate Offsets (X,Y)-- [2:0-3-0,0-2-3], [9:Edge,0-2-8], [15:0-6-4,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.73	Vert(LL) -0.24	15-16	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.91	Vert(CT) -0.52	15-16	>921	180	MT20HS	148/108
TCDL 10.0	Lumber DOL 1.15	WB 0.53	Horz(CT) 0.24	9	n/a	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 240 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x6 SPF No.2 \*Except\*  
3-5: 2x4 SPF No.2, 1-3: 2x10 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
17-18: 2x4 SP 2400F 2.0E, 13-14,9-13: 2x6 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied. Except:  
1 Row at midpt 4-15  
WEBS 1 Row at midpt 3-15

**REACTIONS.** (size) 1=0-3-8, 9=0-3-8  
Max Horz 1=-200(LC 14)  
Max Uplift 1=-138(LC 16), 9=-173(LC 16)  
Max Grav 1=1810(LC 2), 9=1859(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-801/124, 2-3=-3562/403, 3-4=-2557/366, 4-5=-2437/433, 5-6=-2757/477,  
6-8=-2721/362, 8-9=-3249/368  
BOT CHORD 2-16=-247/3235, 15-16=-244/3241, 4-15=-398/164, 11-12=-240/2806, 9-11=-240/2806  
WEBS 3-16=0/341, 3-15=-1209/188, 12-15=-21/1629, 5-15=-187/1270, 5-12=-198/990,  
6-12=-538/189, 8-12=-554/112

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=5ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 2-10-9, Interior(1) 2-10-9 to 20-0-0, Exterior(2R) 20-0-0 to 23-0-0, Interior(1) 23-0-0 to 40-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCCL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=138, 9=173.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	
2523941	A12	Roof Special	2	1	143385011


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:38:49 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-Zk1kHqVlWZ5v2V?OEV\_PUAhPB0idGn2hAFPQYqyP7bq

0-11-0	5-10-0	11-4-8	17-8-0	20-0-0	26-6-13	33-1-11	40-0-0	40-11-0
0-11-0	5-10-0	5-6-8	6-3-8	2-4-0	6-6-13	6-6-13	6-10-5	0-11-0

Scale = 1:76.0

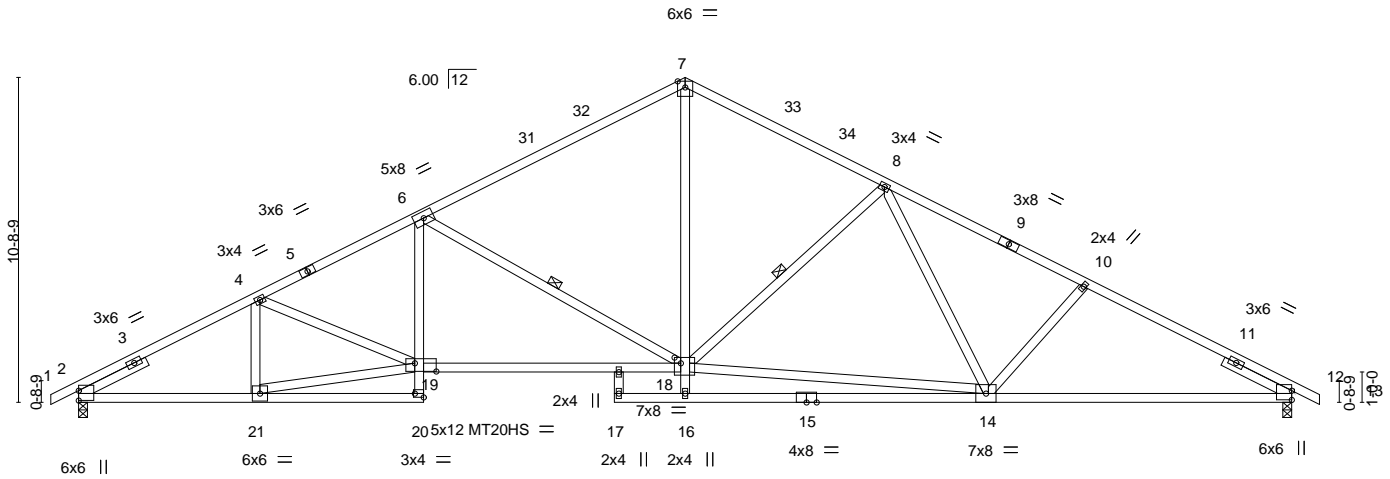



Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
2523941	B1	Monopitch	2	1	I43385012

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:07 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-1B7Y3a7bH5MLCGNsIHdDzQa0G?dU?uKJ3nNBoyP7bY

-0-11-0 5-10-0 11-4-8 17-11-8  
0-11-0 5-10-0 5-6-8 6-7-0

Scale = 1:52.9

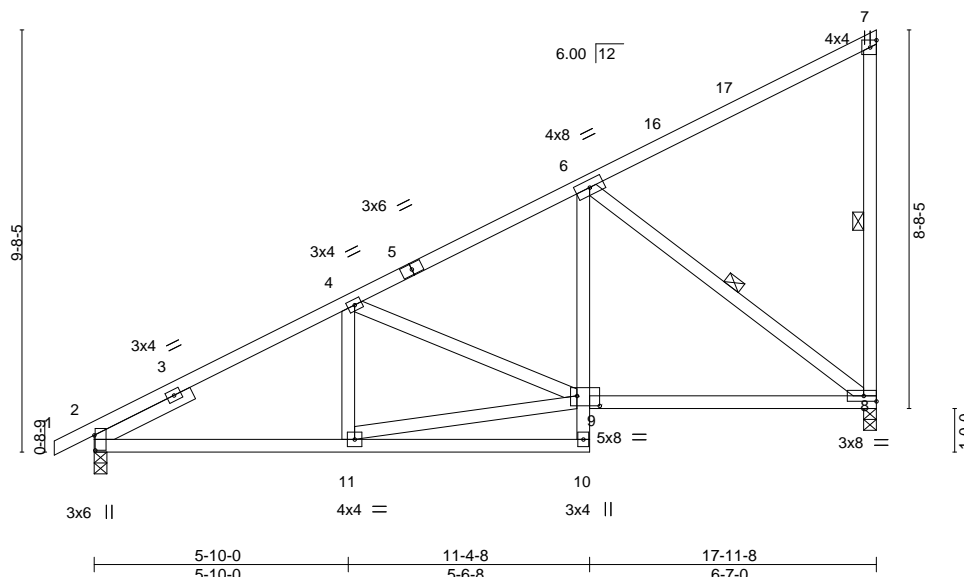


Plate Offsets (X,Y)-- [2:0-4-2,0-0-4], [9:0-6-4,0-2-12]

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>2-0-0</b>	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.45	Vert(LL)	-0.06	8-9	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.37	Vert(CT)	-0.13	8-9	>999	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.29	Horz(CT)	0.03	8	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL 10.0									Weight: 88 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 7-8, 6-8

**REACTIONS.** (size) 8=0-3-8, 2=0-3-8  
Max Horz 2=309(LC 13)  
Max Uplift 8=83(LC 13), 2=81(LC 16)  
Max Grav 8=800(LC 2), 2=867(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1107/214, 4-6=-866/196  
BOT CHORD 2-11=-394/990, 6-9=-51/453, 8-9=-307/729  
WEBS 9-11=-345/948, 4-9=-307/125, 6-8=-897/282

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 17-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - 3) Unbalanced snow loads have been considered for this design.
  - 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 2.
  - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	B2	Half Hip	1	1	I43385013

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:08 2020 Page 1

ID:VPVqvFnP0P0b1j2tZr1OqezdKbx-VNhwHw8D2OUcQqY2r\_qsmBzn9gKhDKkUYjWwjEyP7bX

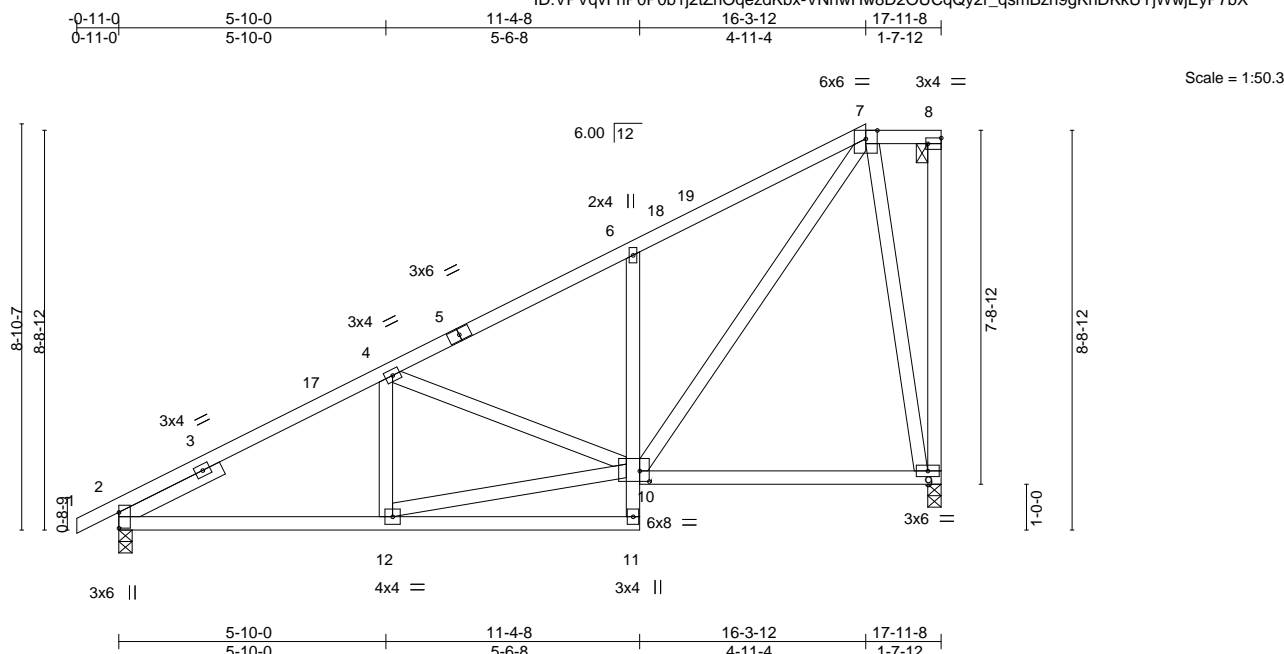


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [8:Edge,0-1-8], [10:0-2-8,0-2-12]

<b>LOADING</b> (psf)	<b>SPACING</b>	<b>CSI</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof) 25.0	2-0-0	TC 0.36	in (loc) l/def L/d	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.38	Vert(LL) -0.06 9-10 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.83	Vert(CT) -0.14 9-10 >999 180		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.02 9 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 96 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 7-8.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 9=0-3-8, 2=0-3-8  
Max Horz 2=278(LC 13)  
Max Uplift 9=82(LC 13), 2=83(LC 16)  
Max Grav 9=851(LC 36), 2=867(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1255/154, 4-6=-994/149, 6-7=-1004/231  
BOT CHORD 2-12=-297/1087, 6-10=-493/154  
WEBS 10-12=-266/1054, 4-10=-322/91, 7-10=-201/1128, 7-9=-832/321

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 16-3-12, Exterior(2E) 16-3-12 to 17-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	B3	Half Hip	1	1	I43385014

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:10 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-Smoghc9UZ0lw3j6RzPsKrb28nU1dhGMm?0?1o7yP7bV

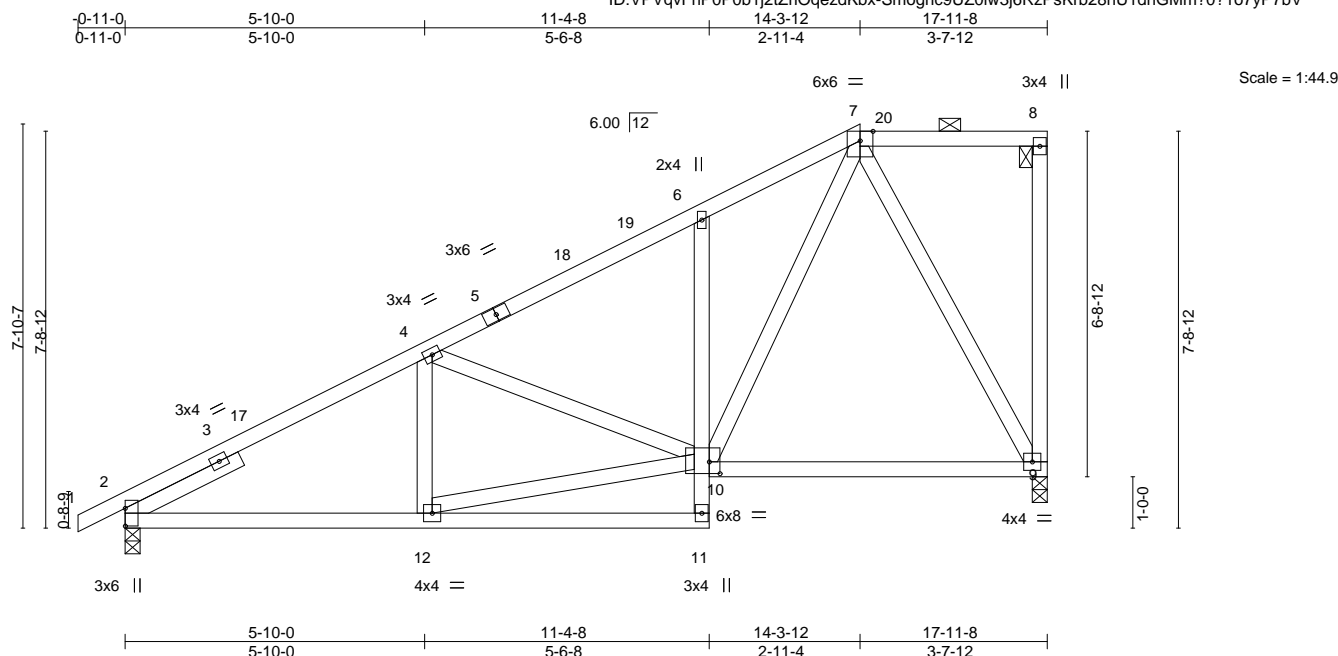


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [10:0-2-8,0-2-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.06	9-10	>999	240	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.35	Vert(CT)	-0.13	9-10	>999	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.70	Horz(CT)	0.02	9	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL 10.0									Weight: 92 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 7-8.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 9=0-3-8, 2=0-3-8  
Max Horz 2=243(LC 13)  
Max Uplift 9=83(LC 13), 2=85(LC 16)  
Max Grav 9=800(LC 2), 2=898(LC 36)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1312/158, 4-6=-972/152, 6-7=-927/208  
BOT CHORD 2-12=-303/1127, 6-10=-384/131, 9-10=-172/360  
WEBS 10-12=-280/1110, 4-10=-382/94, 7-10=-163/953, 7-9=-739/240

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 14-3-12, Exterior(2E) 14-3-12 to 17-9-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	B4	Half Hip	1	1	I43385015

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:11 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-wyM2vyA6KJtnhthdX6NZOpbFytN1QhgwEglaKZyP7bU

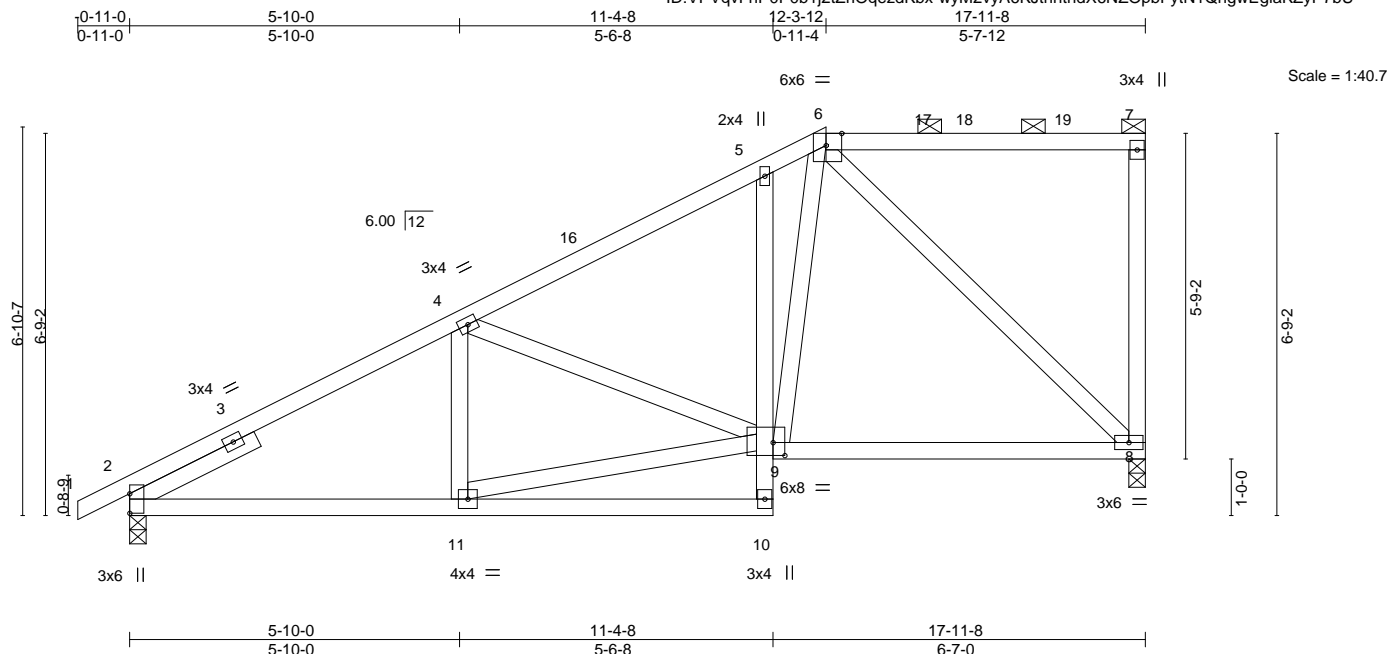


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [6:0-3-5,Edge], [9:0-2-8,0-2-12]									
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.45	Vert(LL)	-0.06 8-9 >999 240	MT20	197/144
Snow (Pf/Pg)	20.4/20.0	Lumber DOL	1.15	BC	0.34	Vert(CT)	-0.13 8-9 >999 180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.82	Horz(CT)	0.03 8 n/a n/a		
BCLL	0.0	Code IRC2018/TPI2014		Matrix-AS					
BCDL	10.0							Weight: 90 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 8=0-3-8, 2=0-3-8  
Max Horz 2=209(LC 13)  
Max Uplift 8=85(LC 13), 2=87(LC 16)  
Max Grav 8=800(LC 2), 2=939(LC 36)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1164/166, 4-5=-908/161, 5-6=-817/183  
BOT CHORD 2-11=-302/1110, 5-9=-285/97, 8-9=-209/573  
WEBS 9-11=-284/1099, 4-9=-429/93, 6-9=-121/789, 6-8=-774/219

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 12-3-12, Exterior(2R) 12-3-12 to 16-6-11, Interior(1) 16-6-11 to 17-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	143385016
2523941	B5	Half Hip	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:12 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-O9wR6lBk5d?el1Gp4quow08LYHg29Gx3TKU8s?yP7bT

0-11-0	5-3-10	10-3-12	11-4-8	17-11-8
0-11-0	5-3-10	5-0-2	1-0-12	6-7-0

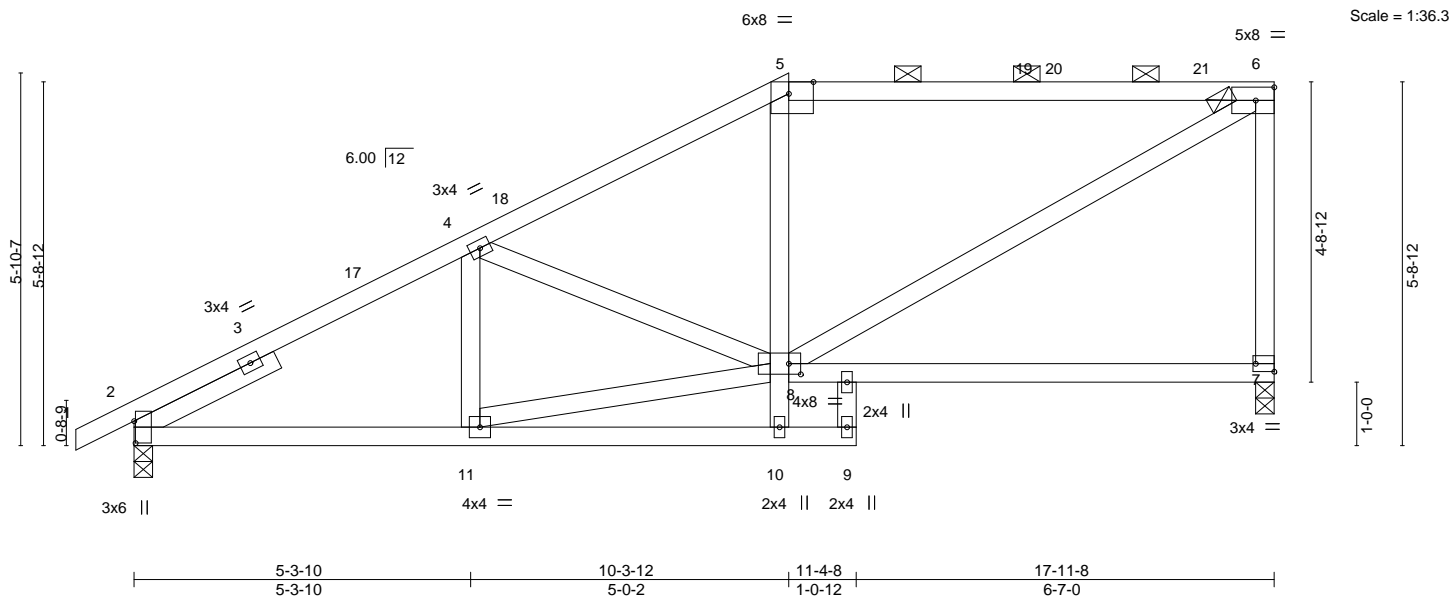


Plate Offsets (X,Y)-- [2:0-4-2,0-0-4], [5:0-4-10,Edge], [7:Edge,0-1-8], [8:0-2-4,0-2-0]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>	<b>GRIP</b>
TCLL (roof) 25.0		Plate Grip DOL 1.15		TC 0.78		Vert(LL) -0.14 7-8 >999 240		MT20	197/144
Snow (Pf/Pg) 20.4/20.0		Lumber DOL 1.15		BC 0.48		Vert(CT) -0.28 7-8 >755 180			
TCDL 10.0		Rep Stress Incr YES		WB 0.31		Horz(CT) 0.02 7 n/a n/a			
BCLL 0.0		Code IRC2018/TPI2014		Matrix-AS					
BCDL 10.0								Weight: 83 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
5-6: 2x4 SPF 1650F 1.5E	2-0-0 oc purlins (5-0-8 max.): 5-6.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 2-6-0	

**REACTIONS.** (size) 7=0-3-8, 2=0-3-8  
Max Horz 2=173(LC 13)  
Max Uplift 7=64(LC 16), 2=85(LC 16)  
Max Grav 7=813(LC 2), 2=956(LC 36)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1200/165, 4-5=-997/177, 5-6=-846/184, 6-7=-725/205  
BOT CHORD 2-11=-294/1073  
WEBS 6-8=-228/905, 8-11=-297/1059, 4-8=-343/64

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 10-3-12, Exterior(2R) 10-3-12 to 14-6-11, Interior(1) 14-6-11 to 17-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 2523941	Truss C1	Truss Type Common	Qty 3	Ply 1	Job Reference (optional) I43385017
----------------	-------------	----------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:14 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-KX2BXzC\_dEFMYLQCCFWG?RDoy5PVdELMwezFxuyP7bR

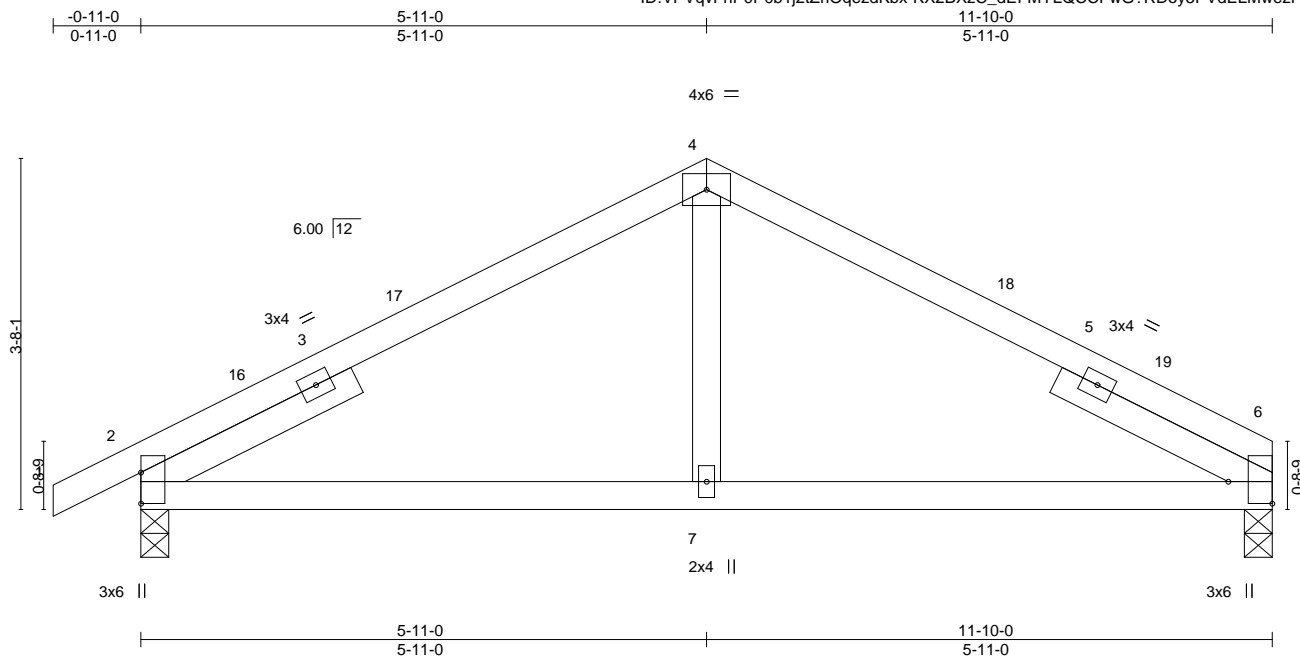

Scale: 1/2"=1'

Plate Offsets (X,Y)-- [2:Edge,0-0-0], [6:Edge,0-5-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.04	7-10	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.29	Vert(CT)	-0.06	7-10	>999	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.02	2	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 39 lb	FT = 20%
BCDL 10.0										

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 6=0-3-8, 2=0-3-8  
Max Horz 2=63(LC 15)  
Max Uplift 6=42(LC 16), 2=72(LC 16)  
Max Grav 6=530(LC 2), 2=599(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-608/236, 4-6=-607/240  
BOT CHORD 2-7=-128/535, 6-7=-128/535

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 5-11-0, Exterior(2R) 5-11-0 to 8-11-0, Interior(1) 8-11-0 to 11-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	143385018
2523941	C2	Hip Girder	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:15 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-okcZJDCOYND9V\_OmySVYflwmVdeMfFV9ljoTKyP7bQ



Scale = 1:21.9

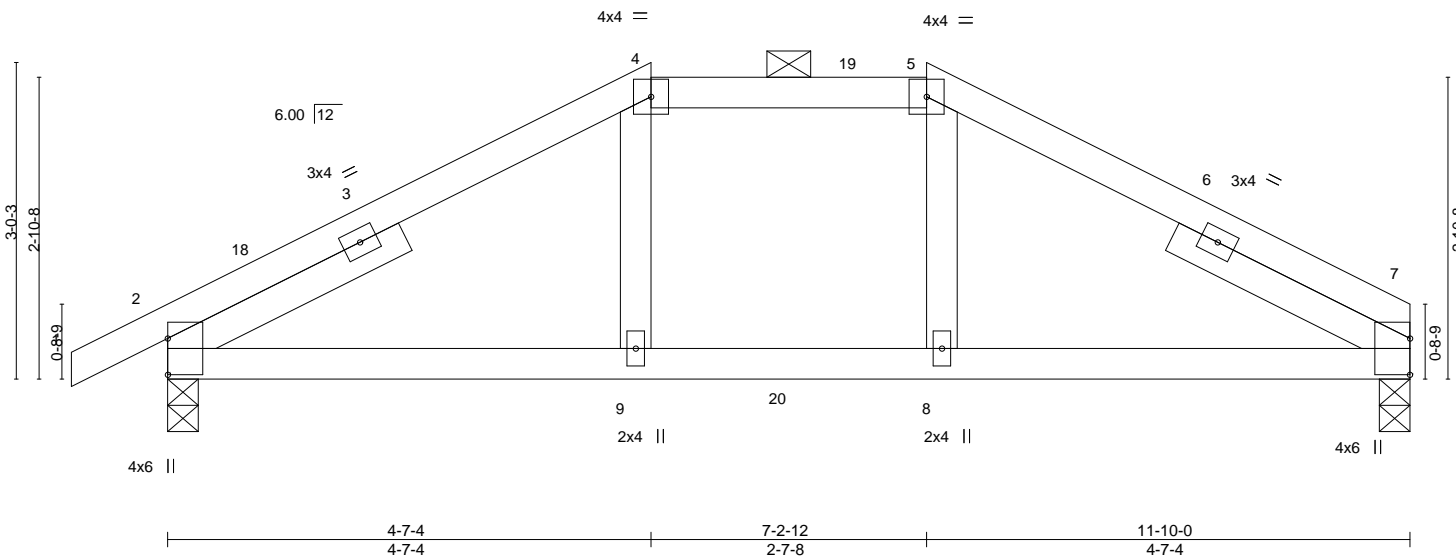


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [7:Edge,0-0-0]									
<b>LOADING</b> (psf)		<b>SPACING-</b>		<b>CSI.</b>		<b>DEFL.</b>		<b>PLATES</b>	
TCLL (roof)	25.0	2-0-0		TC	0.53	in (loc)	l/defl	MT20	GRIP
Snow (Pf/Pg)	20.4/20.0	Plate Grip DOL	1.15	BC	0.81	8-9	>999		197/144
TCDL	10.0	Lumber DOL	1.15	WB	0.14	8-9	>999		
BCLL	0.0	Rep Stress Incr	NO	Matrix-MS		7	n/a		
BCDL	10.0	Code IRC2018/TPI2014						Weight: 41 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 4-0-1 oc purlins, except 2-0-0 oc purlins (4-10-11 max.): 4-5.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 7=0-3-8, 2=0-3-8  
Max Horz 2=49(LC 57)  
Max Uplift 7=-139(LC 12), 2=-168(LC 12)  
Max Grav 7=1048(LC 35), 2=1135(LC 35)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1627/263, 4-5=-1381/245, 5-7=-1625/261  
BOT CHORD 2-9=-187/1412, 8-9=-183/1381, 7-8=-187/1412  
WEBS 4-9=-72/578, 5-8=-72/575

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0 Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=139, 2=168.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 344 lb down and 84 lb up at 4-7-4, and 297 lb down and 68 lb up at 5-11-0, and 344 lb down and 84 lb up at 7-2-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard



October 28,2020

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	I43385018
2523941	C2	Hip Girder	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:16 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-GwAxyfEE9sV4neZaJgzk4sI5Wuzt56VfOySL?myP7bP

**LOAD CASE(S)** Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-51, 4-5=-61, 5-7=-51, 10-14=-20  
Concentrated Loads (lb)  
Vert: 9=-344 8=-344 20=-297

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	143385019
2523941	D1	Hip Girder	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:17 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-k6jJ9?Ftw9dxPo8ntNUzd4rAIPqqXhoccCvYDyP7bO



Scale = 1:22.9

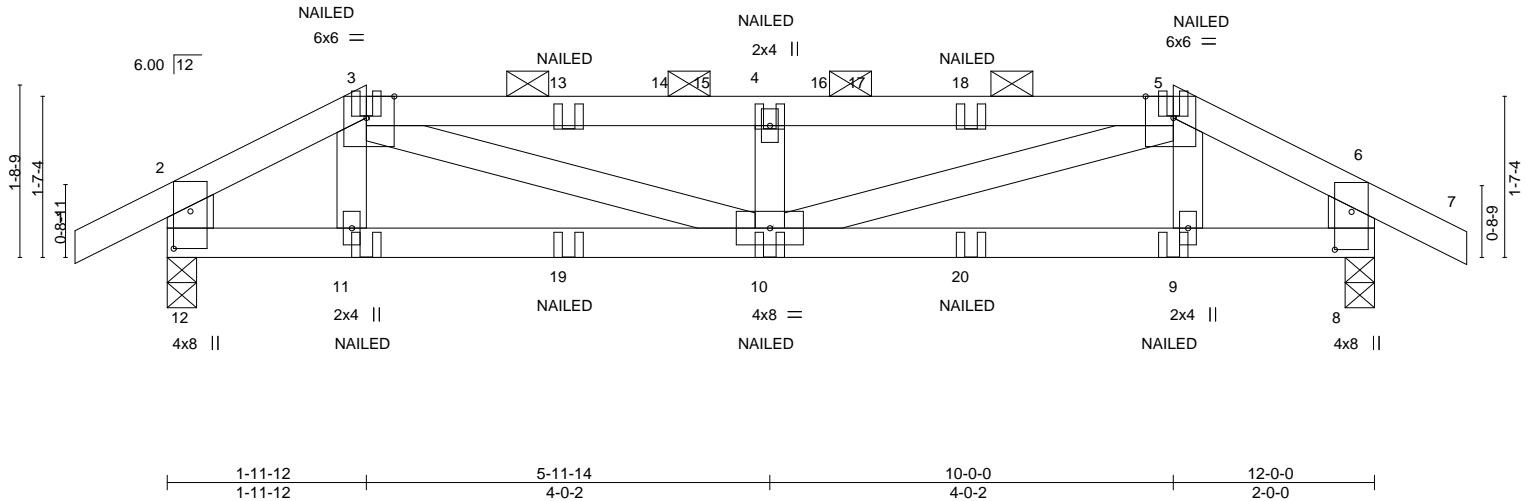


Plate Offsets (X,Y)-- [3:0-3-5,Edge], [5:0-3-5,Edge], [8:0-4-8,0-2-0], [12:0-4-7,0-2-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.41	Vert(LL)	-0.06	10	>999	240	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.45	Vert(CT)	-0.09	10	>999	180		
TCDL 10.0	Rep Stress Incr	NO	WB 0.21	Horz(CT)	0.01	8	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-MS							
BCDL 10.0									Weight: 45 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2 \*Except\*  
2-12,6-8: 2x6 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (4-7-15 max.): 3-5.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 12=0-3-8, 8=0-3-8  
Max Horz 12=-44(LC 10)  
Max Uplift 12=-80(LC 12), 8=-80(LC 12)  
Max Grav 12=601(LC 2), 8=601(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-701/54, 3-4=-1404/116, 4-5=-1404/116, 5-6=-708/54, 2-12=-487/75, 6-8=-489/75  
BOT CHORD 11-12=-30/588, 10-11=-34/594, 9-10=-27/600, 8-9=-23/594  
WEBS 3-10=-73/853, 4-10=-437/82, 5-10=-73/846

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0 Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-51, 2-3=-51, 3-5=-61, 5-6=-51, 6-7=-51, 8-12=-20



October 28,2020

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	I43385019
2523941	D1	Hip Girder	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:18 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-DJHiNLFVhTlo0yzr5?CAHNTwik3Z\_xyrGxS4fyP7bN

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 11=-5(F) 10=0(F) 9=-5(F) 19=0(F) 20=0(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	143385020
2523941	D2	Hip	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:19 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrlOqezdKbx-hVr4ahG7Sntfe6l9?oWRiVwgK67OIUv54wh?c5yP7bM



Scale = 1:22.9

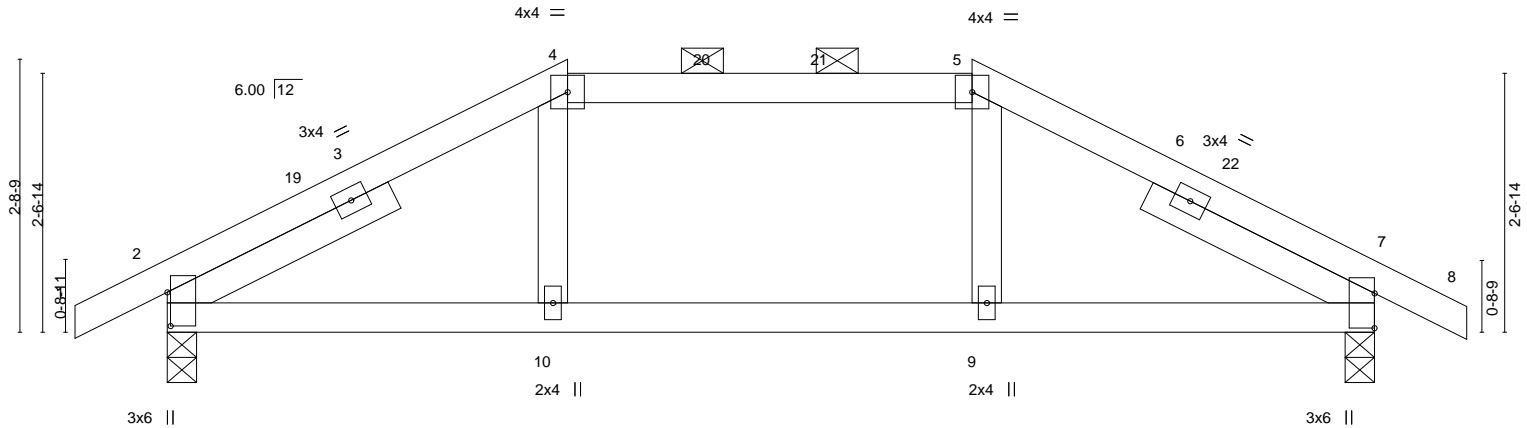


Plate Offsets (X,Y)--	[2:0-4-0,0-0-6], [7:Edge,0-0-0]
-----------------------	---------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	25.0		TC	0.30					MT20	197/144
Snow (Pf/Pg)	20.4/20.0		BC	0.25						
TCDL	10.0		WB	0.03						
BCLL	0.0		Matrix-AS							
BCDL	10.0									

LUMBER-	BRACING-
TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
SLIDER	Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

REACTIONS.	(size)	2=0-3-8, 7=0-3-8
Max Horz	2=45(LC 14)	
Max Uplift	2=72(LC 16), 7=72(LC 16)	
Max Grav	2=608(LC 39), 7=608(LC 39)	

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-4=-673/232, 4-5=-628/231, 5-7=-672/231
BOT CHORD	2-10=-123/633, 9-10=-124/628, 7-9=-122/632

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 3-11-12, Exterior(2E) 3-11-12 to 8-0-0, Exterior(2R) 8-0-0 to 12-0-0, Interior(1) 12-0-0 to 12-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCCL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 7.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	D3	Common	3	1	
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:20 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-9hPS01HID4?VGtMYV1gFITqNWSz1xqFlaQZ8XyP7bL

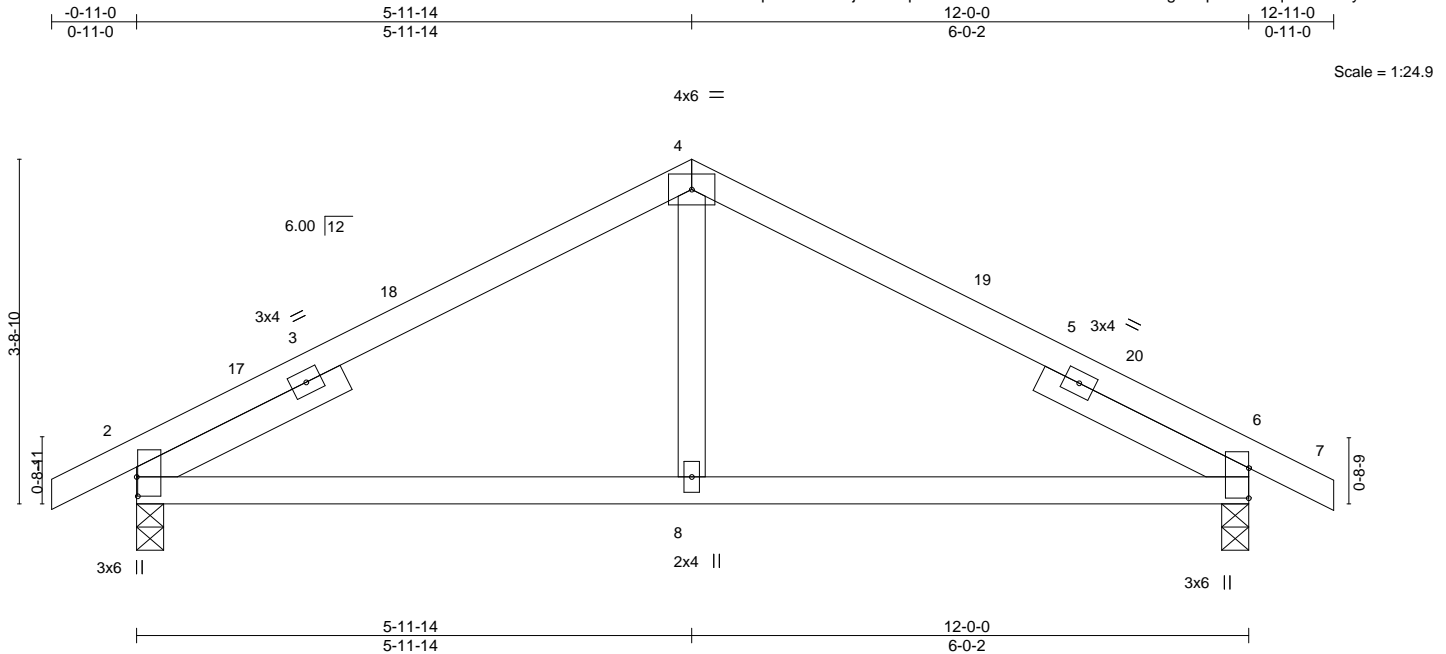


Plate Offsets (X,Y)-- [2:0-2-8,0-0-2], [6:Edge,0-0-0]

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof) 25.0	2-0-0	TC 0.35	Vert(LL)	-0.04	8-15	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.29	Vert(CT)	-0.06	8-15	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.06	Horz(CT)	0.02	2	n/a	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS							
BCDL 10.0	Code IRC2018/TPI2014								
								Weight: 41 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 2=0-3-8, 6=0-3-8  
Max Horz 2=-66(LC 14)  
Max Uplift 2=-72(LC 16), 6=-72(LC 16)  
Max Grav 2=604(LC 2), 6=604(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-609/235, 4-6=-608/235  
BOT CHORD 2-8=-93/536, 6-8=-93/536

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 5-11-14, Exterior(2R) 5-11-14 to 8-11-14, Interior(1) 8-11-14 to 12-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCCL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2523941	Truss JA1	Truss Type Jack-Closed	Qty 1	Ply 1	143385022
----------------	--------------	---------------------------	----------	----------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:21 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrlQqezdKbx-duzq?MIN\_07MtQSY6DZvnw?0ivkZmOROXEA6h\_yP7bK

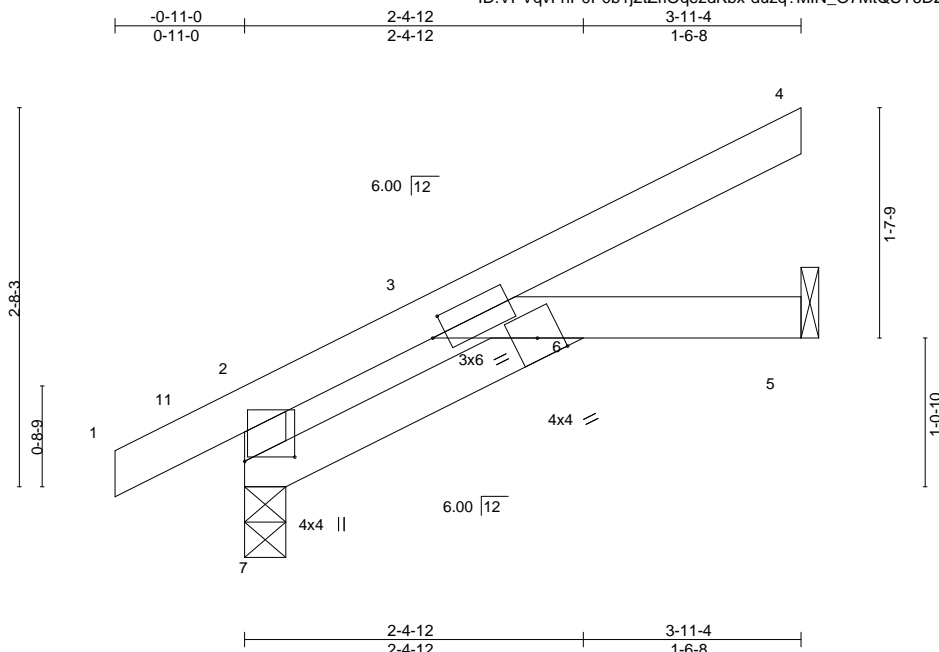

Scale = 1:16.3

Plate Offsets (X,Y)--		[2:0-0-14,0-1-12], [3:0-1-3,0-1-8], [7:0-0-14,0-1-12], [7:0-0-6,0-4-4]	
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0
TCLL (roof)	25.0	Plate Grip DOL	1.15
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15
TCDL	10.0	Rep Stress Incr	YES
BCLL	0.0	Code	IRC2018/TPI2014
BCDL	10.0		
		<b>CSI.</b>	
		TC	0.31
		BC	0.52
		WB	0.03
		Matrix-MP	
		<b>DEFL.</b>	
		in (loc)	l/defl
		Vert(LL)	0.04 6 >999
		Vert(CT)	-0.06 6 >794
		Horz(CT)	0.03 5 n/a
			L/d
			240
			180
			n/a
		<b>PLATES</b>	<b>GRIP</b>
		MT20	197/144
		Weight: 13 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-11-4 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 7=0-3-8, 5=Mechanical  
Max Horz 7=90(LC 16)  
Max Uplift 7=23(LC 16), 5=58(LC 16)  
Max Grav 7=264(LC 2), 5=171(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 1-10-15, Interior(1) 1-10-15 to 3-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 5.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JA2	Jack-Closed	1	1	I43385023

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:29 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-OQSh6OO5r8Ere34uin6cLPT8XHe0TZNU6XzWyP7bC

-0-11-0 3-2-3  
0-11-0 3-2-3

Scale = 1:14.4

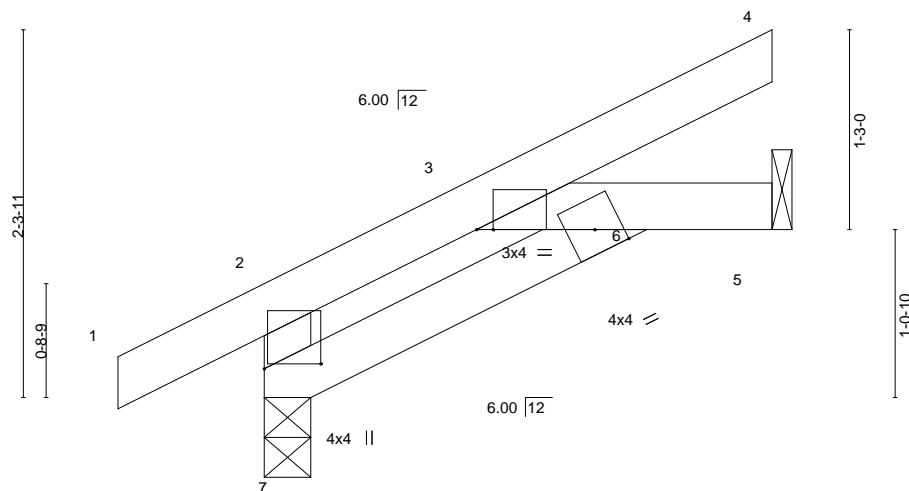


Plate Offsets (X,Y)-- [2:0-0-14,0-1-12], [3:0-1-4,Edge], [7:0-0-14,0-1-12], [7:0-0-6,0-4-4]

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.13	Vert(LL)	-0.01	10	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.28	Vert(CT)	-0.02	10	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.01	5	n/a	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-MP							
BCDL 10.0	Code IRC2018/TPI2014							Weight: 11 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-2-3 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 7=0-3-8, 5=Mechanical  
Max Horz 7=74(LC 16)  
Max Uplift 7=23(LC 16), 5=42(LC 16)  
Max Grav 7=249(LC 21), 5=146(LC 21)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 1-10-15, Interior(1) 1-10-15 to 3-2-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 5.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017






Job 2523941	Truss JA4	Truss Type Monopitch	Qty 1	Ply 1	143385025
----------------	--------------	-------------------------	----------	----------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:31 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-Kpac5nPfdSOy4yDTiJkFB1QnZxGo6wQsqobe1PyP7bA

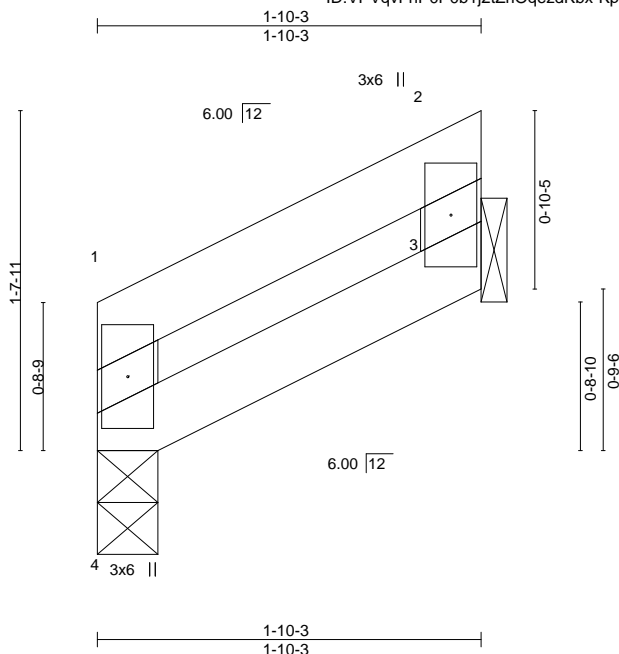

Scale = 1:11.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.03	Vert(LL)	-0.00	4	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	4	>999	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-MR							
BCDL 10.0									Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-10-3 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 4=0-3-8, 3=Mechanical  
Max Horz 4=33(LC 13)  
Max Uplift 3=16(LC 13)  
Max Grav 4=70(LC 2), 3=73(LC 27)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JA5	Half Hip Girder	1	1	I43385026

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:32 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-o?7\_J7QHOMWoi6ofF1FukEznFLPzRkT03SKBZryP7b9



Scale = 1:17.1

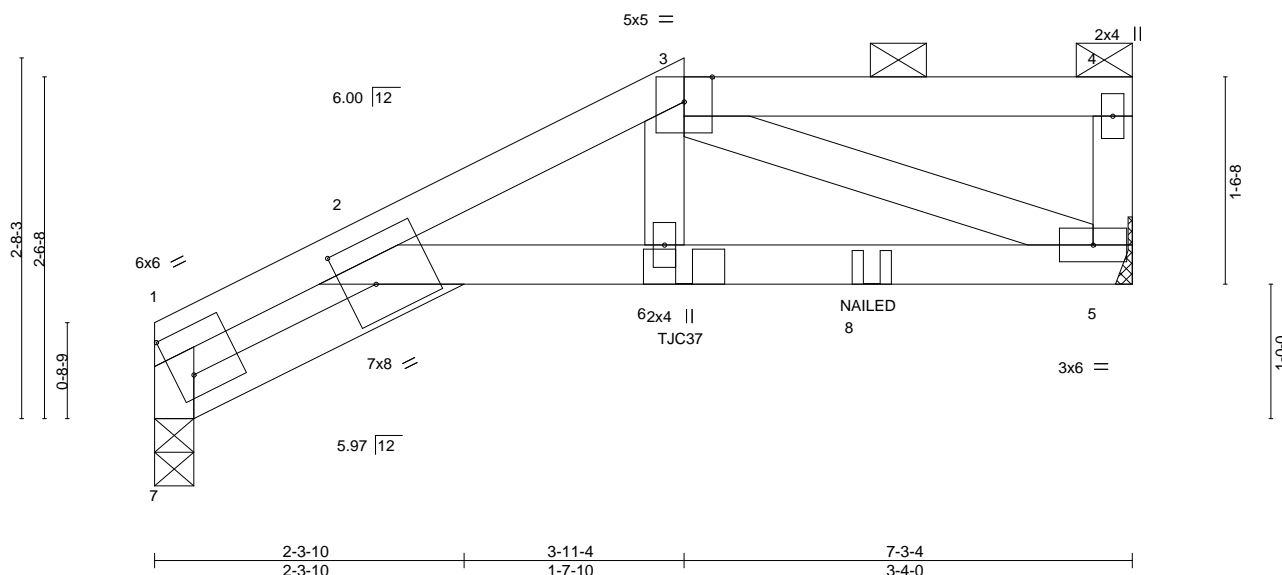


Plate Offsets (X,Y)-- [1:0-1-15,0-0-0], [1:0-1-11,0-4-1], [2:0-2-14,0-4-0], [7:0-0-14,0-1-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.74	in (loc) l/defl L/d	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.88	Vert(LL) -0.09 2-6 >971 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.24	Vert(CT) -0.14 2-6 >588 180		
BCLL 0.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.12 5 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 25 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2 \*Except\*  
2-5: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-4-5 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 5=Mechanical, 7=0-3-8  
Max Horz 7=63(LC 9)  
Max Uplift 5=132(LC 9), 7=82(LC 12)  
Max Grav 5=598(LC 30), 7=529(LC 31)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-7=-484/100, 1-2=-456/102, 2-3=-1180/264  
BOT CHORD 2-6=-257/1074, 5-6=-245/1025  
WEBS 3-6=-134/618, 3-5=-1041/238

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7 except (jt=lb) 5=132.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie TJC37 (6 nail 90-150) or equivalent at 3-11-4 from the left end to connect truss(es) to back face of bottom chord, skewed 45.0 deg.to the right, sloping 0.0 deg. down.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).



October 28,2020

#### LOAD CASE(S)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	I43385026
2523941	JA5	Half Hip Girder	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:32 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-o?7\_J7QHOMWoi6ofF1FukEznFLPZrKt03SKBZryP7b9

**LOAD CASE(S)** Standard  
1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-51, 2-3=-51, 3-4=-61, 2-7=-20, 2-5=-20  
Concentrated Loads (lb)  
Vert: 6=-333(B) 8=-146(B)

Job	Truss	Truss Type	Qty	Ply	
2523941	JA6	Half Hip Girder	1	1	
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:33 2020 Page 1
					ID:VPVqvFnP0P0b1j2tZrIQezdKbx-GBhNWTRv94efKGMprkmjHSV2EltzapM9l64l6HyP7b8
					Job Reference (optional)

Scale = 1:15.7

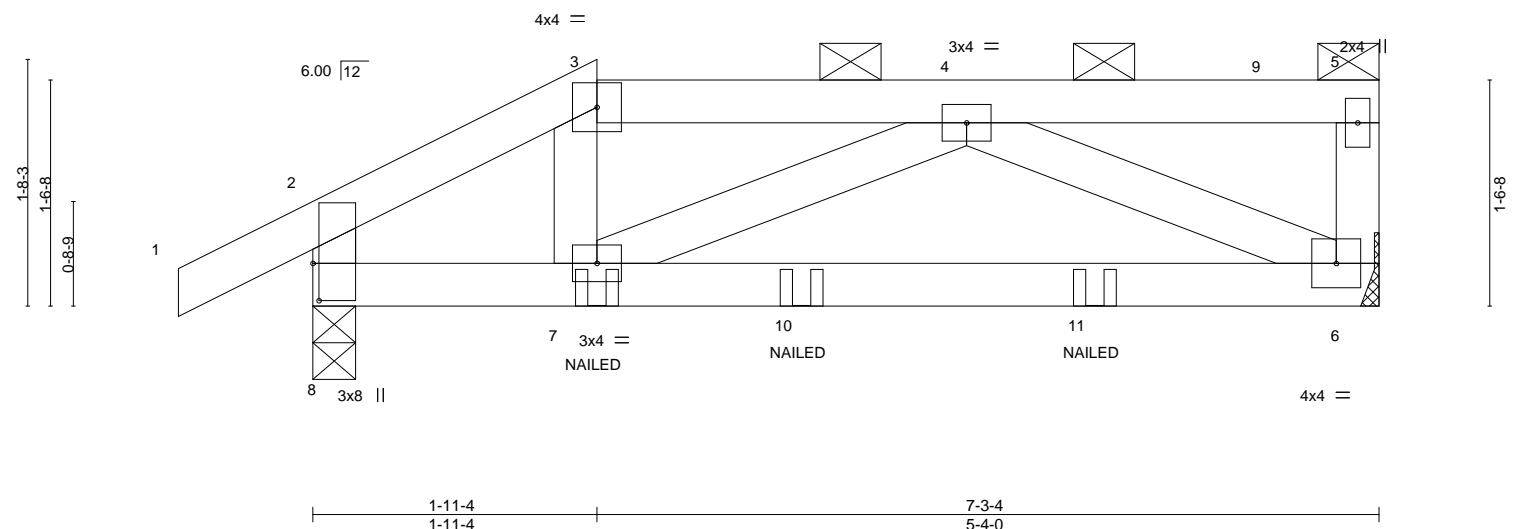


Plate Offsets (X,Y)-- [2:0-0-14,0-1-12], [8:0-3-1,0-0-8], [8:0-0-0,0-1-12]									
<b>LOADING</b> (psf)		<b>SPACING-</b>		<b>CSI.</b>		<b>DEFL.</b>		<b>PLATES</b>	
TCLL (roof)	25.0	2-0-0		TC	0.34	in (loc)	l/defl	MT20	GRIP
Snow (Pf/Pg)	20.4/20.0	Plate Grip DOL	1.15	BC	0.36	0.05 6-7	>999		197/144
TCDL	10.0	Lumber DOL	1.15	WB	0.10	-0.07 6-7	>999		
BCLL	0.0	Rep Stress Incr	NO	Matrix-MS		0.01 6	n/a		
BCDL	10.0	Code IRC2018/TPI2014						Weight: 27 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-5.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SPF No.2		

**REACTIONS.** (size) 6=Mechanical, 8=0-3-8  
Max Horz 8=51(LC 11)  
Max Uplift 6=122(LC 9), 8=146(LC 12)  
Max Grav 6=424(LC 31), 8=474(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-551/200, 3-4=-436/165, 2-8=-432/159  
BOT CHORD 7-8=-190/456, 6-7=-172/544  
WEBS 4-6=-528/150

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=122, 8=146.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15



October 28, 2020

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**MiTek**  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	I43385027
2523941	JA6	Half Hip Girder	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:33 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-GBhNWTRv94efKGMrpkmjHSV2EltzapM9l64l6HyP7b8

**LOAD CASE(S)** Standard  
Uniform Loads (plf)  
Vert: 1-2=-51, 2-3=-51, 3-5=-61, 6-8=-20  
Concentrated Loads (lb)  
Vert: 7=-70(F) 10=-40(F) 11=-40(F)

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 2523941	Truss JA7	Truss Type Jack-Closed	Qty 7	Ply 1	143385028
----------------	--------------	---------------------------	----------	----------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:34 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-IOFlkpSXwNmWxQx2NSHypf2At9CtJHpIWlplekyP7b7

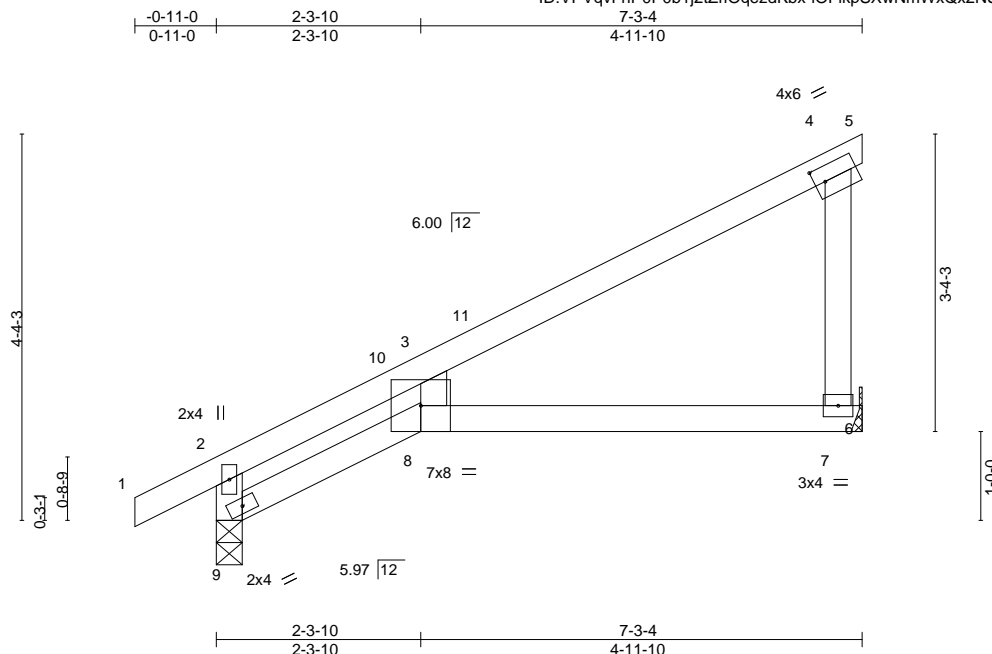

Scale = 1:25.9

Plate Offsets (X,Y)-- [3:0-1-12,0-0-14], [4:0-1-7,0-2-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.54	Vert(LL)	0.12	8	>684	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.44	Vert(CT)	-0.19	7-8	>440	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.09	7	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL 10.0									Weight: 23 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 7=Mechanical, 9=0-3-8  
Max Horz 9=131(LC 13)  
Max Uplift 7=-38(LC 13), 9=-50(LC 16)  
Max Grav 7=354(LC 21), 9=388(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-9=-329/123

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 7-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 9.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JA8	Half Hip	1	1	I43385029

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:35 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-Dap7x9T9hhuNZZWEx9pBMtaL3ZXX2ivSIPZsAAyP7b6

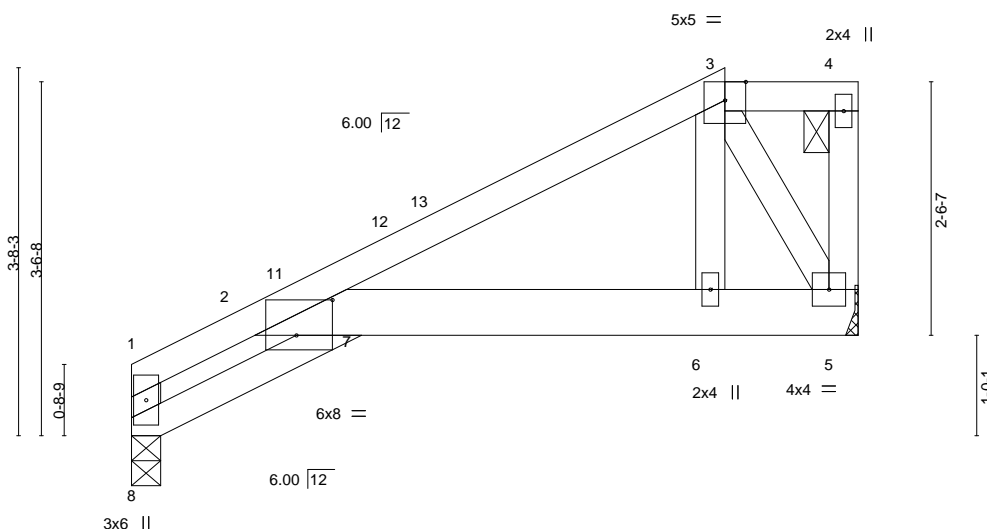

Scale = 1:23.1




Plate Offsets (X,Y)-- [2:0-5-8,0-2-12], [7:0-4-5,0-4-4], [7:0-3-15,0-0-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.57	Vert(LL)	-0.06	7	>999	240	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.48	Vert(CT)	-0.09	7	>899	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.10	Horz(CT)	0.05	5	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL 10.0									Weight: 30 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2 \*Except\*  
2-5: 2x6 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 3-4.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 8=0-3-8, 5=Mechanical  
Max Horz 8=97(LC 13)  
Max Uplift 8=-20(LC 16), 5=-36(LC 13)  
Max Grav 8=369(LC 35), 5=314(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-8=-347/170, 2-3=-365/111  
BOT CHORD 2-7=0/259, 6-7=-174/259  
WEBS 3-5=-495/290, 3-6=-185/392

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 5-11-4, Exterior(2E) 5-11-4 to 7-1-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JA9	Jack-Closed	3	1	I43385030

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:36 2020 Page 1

ID:VPVqvFnP0P0b1j2ZrOqezdKbx-hmNV9VTnS?0EBj5QUtKQu47RMMywn9Qb\_3lPjcyP7b5



Scale = 1:27.0

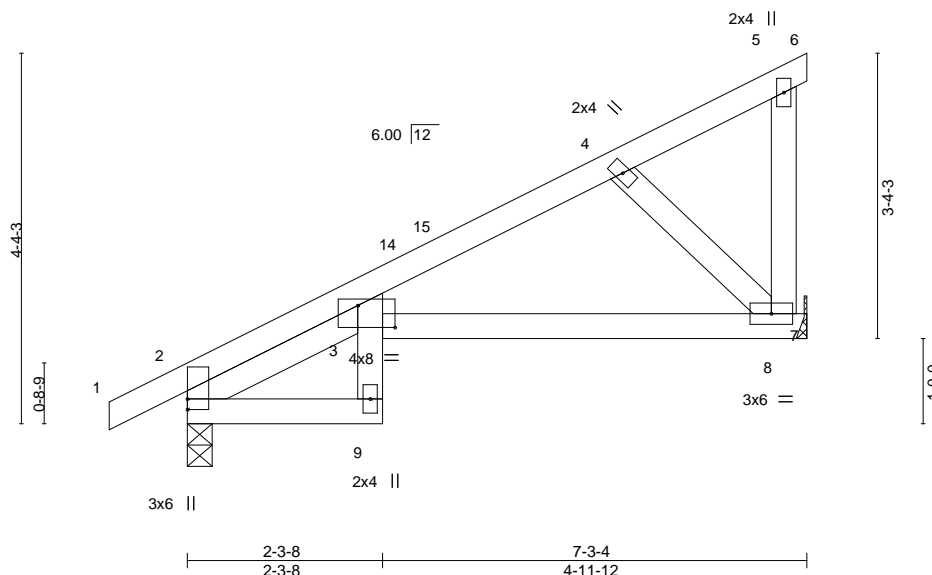


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [3:0-5-4,0-3-1]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.86	Vert(LL)	0.16	9	>536	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.27	Vert(CT)	-0.24	9	>348	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.19	8	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL 10.0									Weight: 29 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-3-6

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 8=Mechanical, 2=0-3-8  
Max Horz 2=122(LC 13)  
Max Uplift 8=36(LC 13), 2=-46(LC 16)  
Max Grav 8=359(LC 21), 2=383(LC 2)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-11=-617/342, 3-4=-331/117  
BOT CHORD 3-8=-287/348  
WEBS 4-8=-472/346

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-12, Interior(1) 2-1-12 to 7-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCDL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 2.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JA10	Half Hip Girder	1	1	I43385031

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:22 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-54XCDiI?liFDVZ1kgw48K7YAuJ5VVqUXmuvgDQyP7bJ

-0-11-0	2-3-8	5-11-4	7-3-4
0-11-0	2-3-8	3-7-12	1-4-0

5x5 =

2x4 ||

Scale = 1:22.2

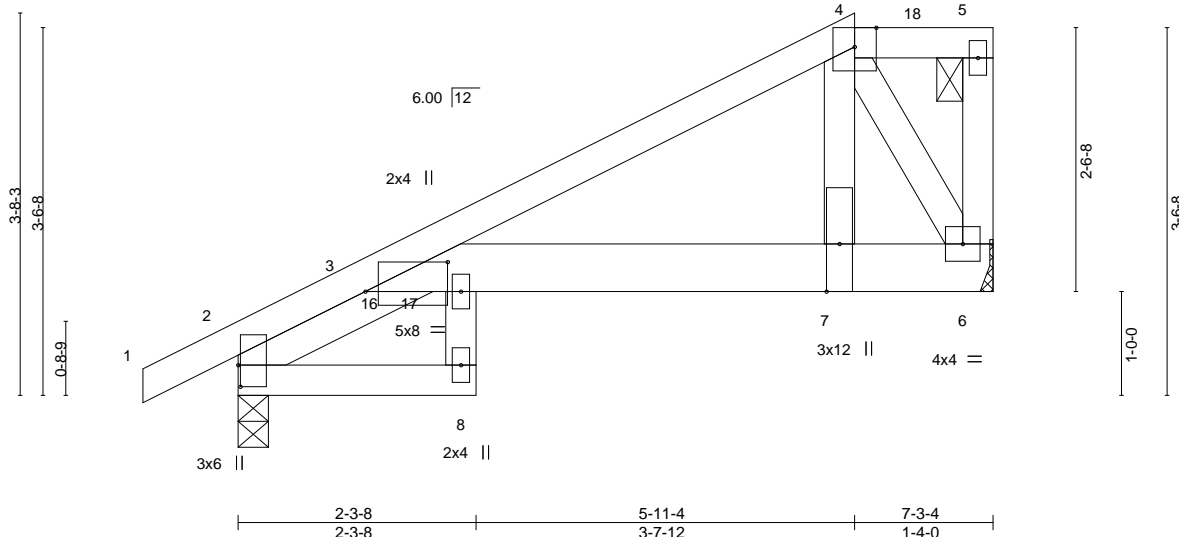


Plate Offsets (X,Y)-- [2:0-2-8,0-0-4], [3:0-9-8,0-3-7]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.05	8	>999	240	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.48	Vert(CT)	-0.10	8	>856	180		
TCDL 10.0	Rep Stress Incr	NO	WB 0.11	Horz(CT)	0.04	6	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL 10.0									Weight: 34 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2 \*Except\*  
3-6: 2x6 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 1-11-15

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals, and  
2-0-0 oc purlins (6-0-0 max.): 4-5.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 6=Mechanical, 2=0-3-8  
Max Horz 2=96(LC 13)  
Max Uplift 6=32(LC 13), 2=43(LC 16)  
Max Grav 6=322(LC 2), 2=478(LC 36)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 3-10=-866/335, 3-4=-356/105  
BOT CHORD 3-7=-174/278  
WEBS 4-7=-198/445, 4-6=-528/290

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 5-11-4, Exterior(2E) 5-11-4 to 7-1-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JA11	Half Hip Girder	1	1	I43385032

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:23 2020 Page 1

ID:VPVqvFnP0P0b1j2tZr1OqezdKbx-ZG5bQ2JdV?N47jcwEebNtL5MdjTqEHfh?YfDlsyP7bl



Scale = 1:17.2

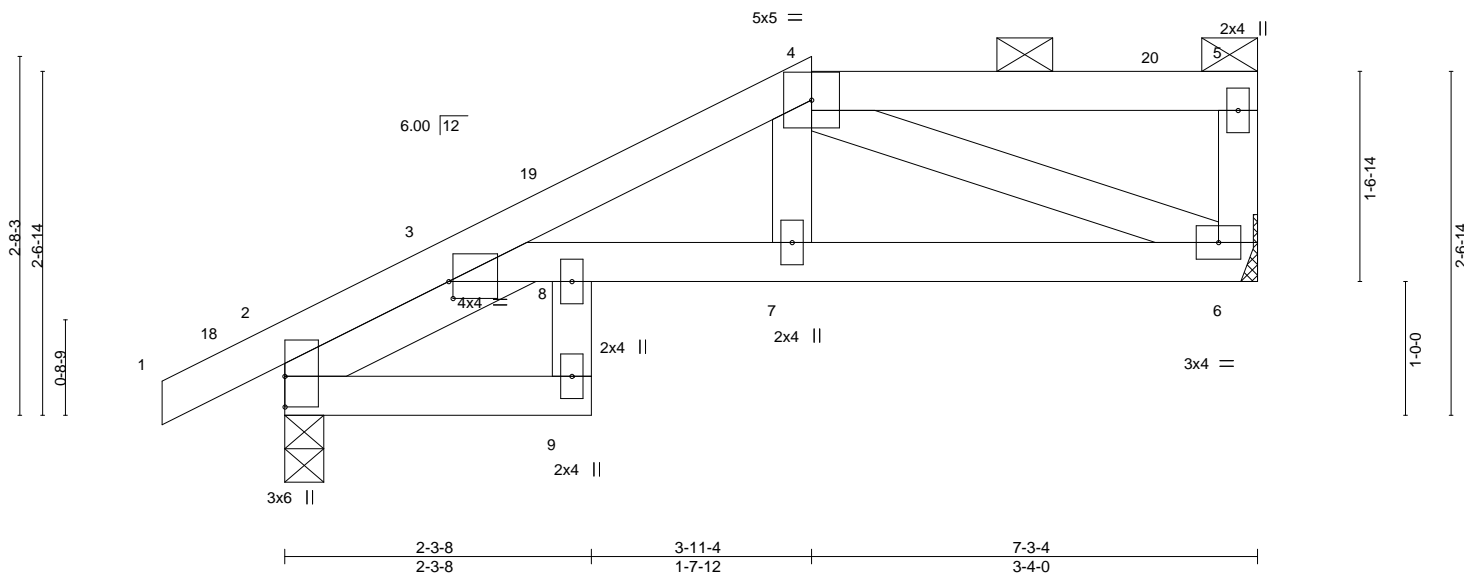


Plate Offsets (X,Y)-- [2:Edge,0-0-0], [3:0-0-6,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	-0.03	16	>999	240	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.34	Vert(CT)	-0.06	16	>999	180		
TCDL 10.0	Rep Stress Incr	NO	WB 0.11	Horz(CT)	0.03	6	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL 10.0									Weight: 29 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 1-11-15

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 6=Mechanical, 2=0-3-8  
Max Horz 2=63(LC 13)  
Max Uplift 6=-35(LC 13), 2=-52(LC 16)  
Max Grav 6=318(LC 35), 2=427(LC 36)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 3-11=-638/375, 3-4=-504/233  
BOT CHORD 3-8=-468/278, 7-8=-278/468, 6-7=-273/451  
WEBS 4-6=-488/280

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 3-11-4, Exterior(2E) 3-11-4 to 7-1-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2523941	Truss JA12	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Job Reference (optional)
----------------	---------------	-----------------------------------	----------	----------	--------------------------

I43385033

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

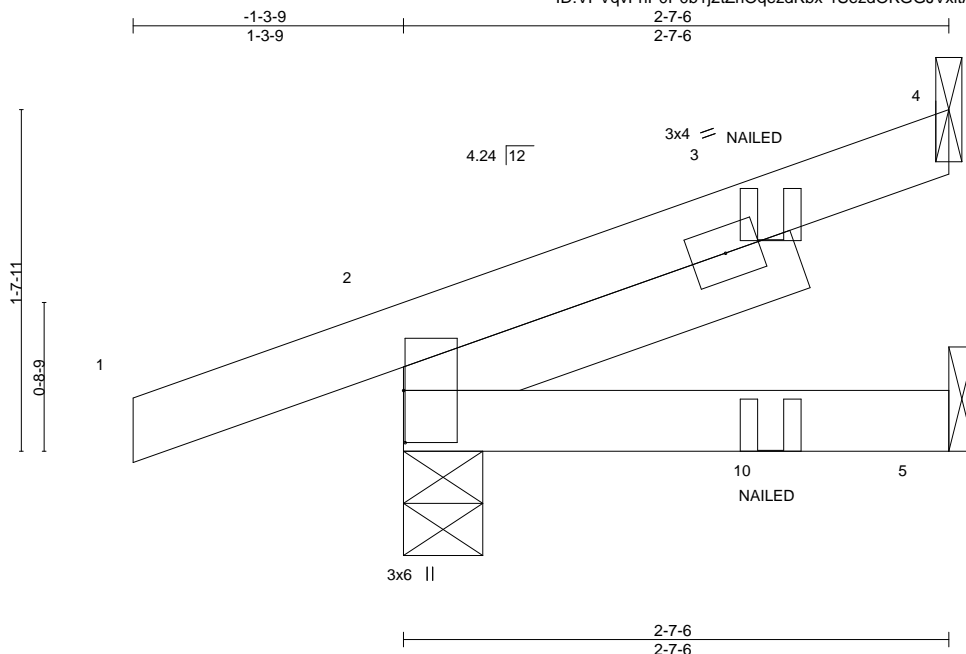8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:24 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-1SezdOKGGJVxltA7nL6cPYdYi7pBzlhqDCOmHJyP7bH

Scale = 1:11.0

Plate Offsets (X,Y)-- [2:0-3-0,0-0-1]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.20	Vert(LL)	-0.01	5-8	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.34	Vert(CT)	-0.02	5-8	>999	180		
TCDL 10.0	Rep Stress Incr	NO	WB 0.00	Horz(CT)	0.01	2	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-MP							
BCDL 10.0									Weight: 10 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 2-0-0

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 2-7-6 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 2=0-4-9, 5=Mechanical  
 Max Horz 2=56(LC 12)  
 Max Uplift 2=58(LC 12), 5=38(LC 12)  
 Max Grav 2=235(LC 17), 5=98(LC 17)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-198/338

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-4=-51, 5-6=-20  
 Concentrated Loads (lb)  
 Vert: 10=1(F)



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017




Job 2523941	Truss JA13	Truss Type Jack-Open	Qty 1	Ply 1	143385034
----------------	---------------	-------------------------	----------	----------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:25 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-VfCLrkLu1deoM1JL3drymAJXDMiCx\_Ss8KqlyP7bG

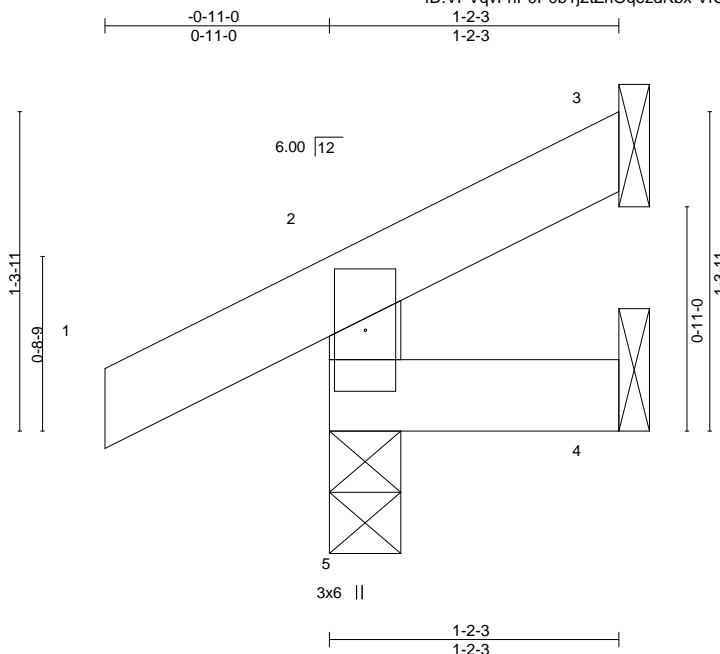

Scale = 1:9.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	0.00	5	>999	240	MT20
Snow (Pt/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	0.00	5	>999	180	197/144
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a	
BCLL 0.0	Code IRC2018/TP12014		Matrix-MR						
BCDL 10.0									

Weight: 4 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-2-3 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=48(LC 16)  
Max Uplift 5=35(LC 16), 3=9(LC 20), 4=1(LC 13)  
Max Grav 5=159(LC 2), 3=11(LC 28), 4=16(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3, 4.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss JA14	Truss Type Jack-Closed	Qty 1	Ply 1	Job Reference (optional) I43385035
----------------	---------------	---------------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:26 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-\_rmj24MWowmf\_BKVvm84UzjuswX8RfA7hWttMByP7bF

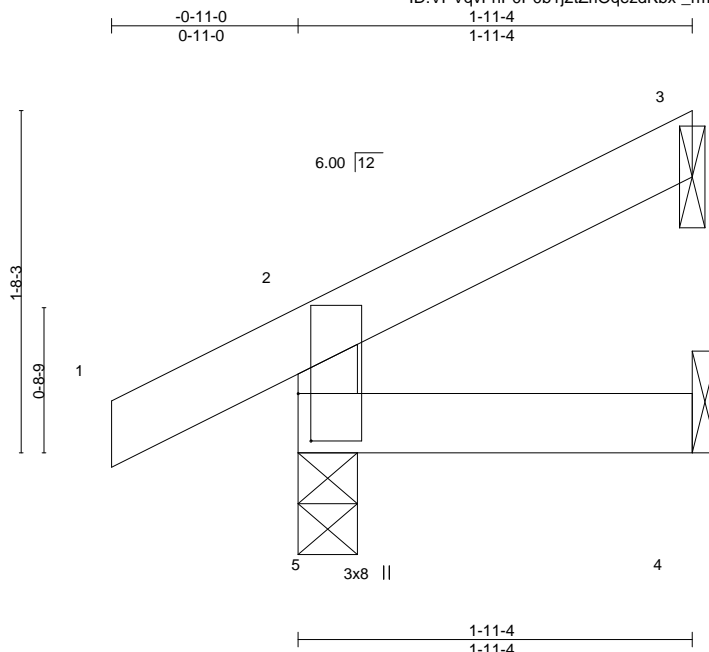

Scale = 1:11.3

Plate Offsets (X,Y)-- [2:0-0-14,0-1-12], [5:0-2-13,0-0-12], [5:0-0-0,0-1-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.22	in (loc) l/defl L/d	MT20	197/144
Snow (Pf/Pg) 0.0/20.0	Plate Grip DOL 1.15	BC 0.18	Vert(LL) 0.01 4-5 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Vert(CT) -0.00 4-5 >999 180		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR	Horz(CT) 0.00 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-11-4 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 5=0-3-8, 4=Mechanical  
Max Horz 5=78(LC 16)  
Max Uplift 5=-75(LC 16), 4=-53(LC 16)  
Max Grav 5=182(LC 21), 4=60(LC 21)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=0.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss JA15	Truss Type Jack-Closed	Qty 1	Ply 1	Job Reference (optional) I43385036
----------------	---------------	---------------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:27 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-S1K5GQM8ZEuWcLviTufJ1BF2cKtNA6QHvAdRudyP7bE

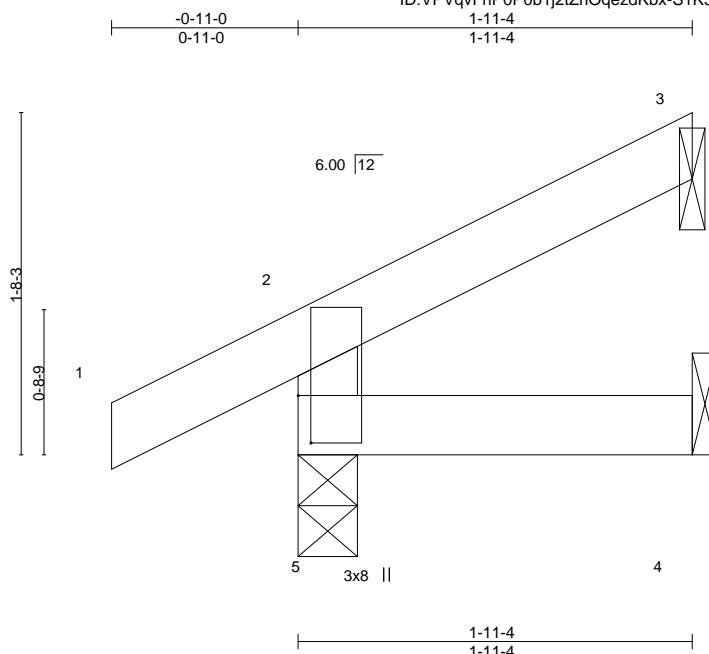

Scale = 1:11.3

Plate Offsets (X,Y)-- [2:0-0-14,0-1-12], [5:0-2-13,0-0-12], [5:0-0-0,0-1-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.22	in (loc) l/defl L/d	MT20	197/144
Snow (Pf/Pg) 0.0/20.0	Plate Grip DOL 1.15	BC 0.18	Vert(LL) 0.01 4-5 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Vert(CT) -0.00 4-5 >999 180		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR	Horz(CT) 0.00 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 6 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 1-11-4 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 4=Mechanical  
Max Horz 5=78(LC 16)  
Max Uplift 5=-75(LC 16), 4=-53(LC 16)  
Max Grav 5=182(LC 21), 4=60(LC 21)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=0.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2523941	Truss JA16	Truss Type Jack-Closed	Qty 3	Ply 1	143385037
----------------	---------------	---------------------------	----------	----------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:27 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-S1K5GQM8ZEuWclviTUFJ1BFzQKoxA64HvAdRudyP7bE

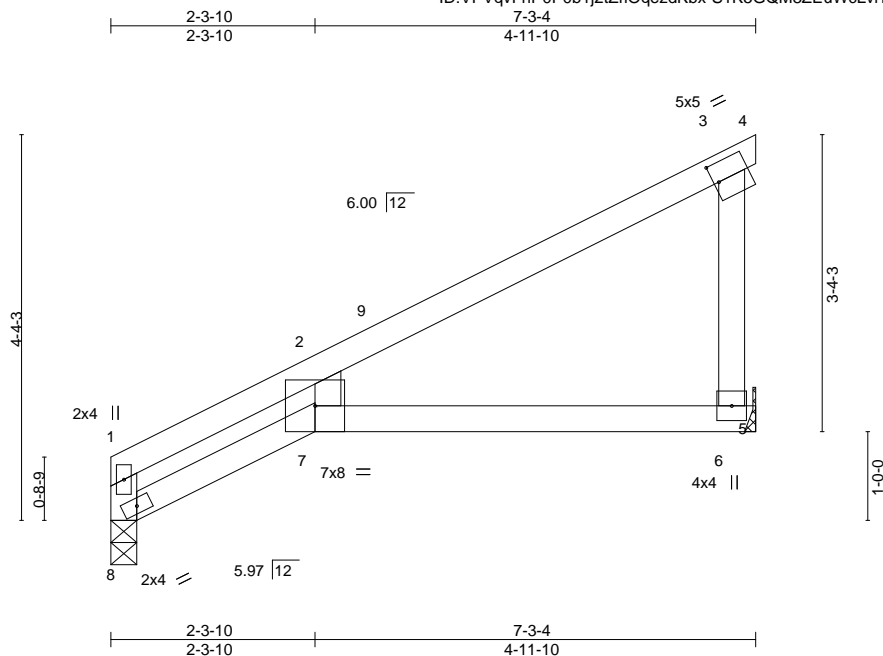

Scale = 1:26.0

Plate Offsets (X,Y)-- [2:0-1-12,0-0-14], [3:0-0-11,0-2-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.55	Vert(LL)	0.12	7	>675	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.46	Vert(CT)	-0.19	6-7	>423	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.09	6	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL 10.0									Weight: 22 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 6=Mechanical, 8=0-3-8  
Max Horz 8=123(LC 13)  
Max Uplift 6=38(LC 13), 8=16(LC 16)  
Max Grav 6=358(LC 20), 8=308(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior (2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 7-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	
2523941	JA17	Jack-Open	1	1	I43385038

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:28 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-wEuUTmNmKX0NDVUu0BBYaOoFZkF4vZgQ8qM\_Q4yP7bD

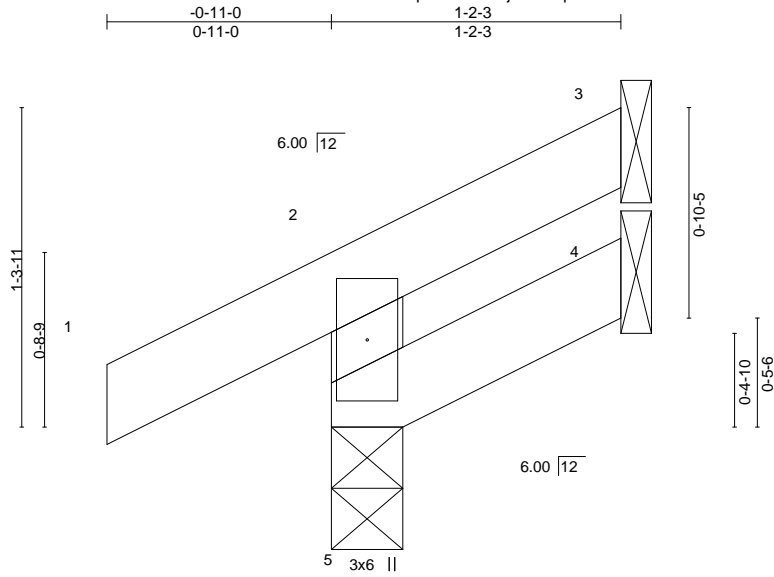

Scale = 1:9.4

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.08	Vert(LL)	0.00	5	>999	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT)	0.00	5	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 5 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-2-3 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=49(LC 16)  
Max Uplift 5=33(LC 16), 3=-9(LC 20), 4=-2(LC 13)  
Max Grav 5=159(LC 2), 3=11(LC 28), 4=16(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3, 4.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JC1	Jack-Open	2	1	I43385039

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:37 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-9zxtMrUPC185otgd2arfRlgoDMJhWdvIDj2yF2yP7b4

0-11-0 2-6-3  
0-11-0 2-6-3

Scale = 1:12.8

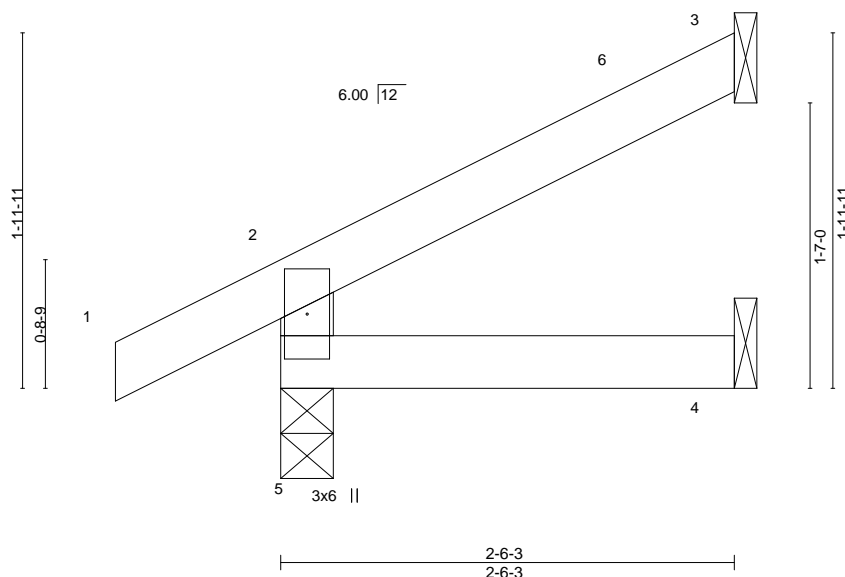

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.08	Vert(LL)	-0.00	4-5	>999	240	MT20
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.05	Vert(CT)	-0.00	4-5	>999	180	197/144
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a	
BCLL 0.0	Rep Stress Incr YES	Matrix-MR						
BCDL 10.0	Code IRC2018/TPI2014							
							Weight: 8 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-3 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=65(LC 16)  
Max Uplift 5=30(LC 16), 3=-23(LC 16)  
Max Grav 5=206(LC 21), 3=69(LC 21), 4=42(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 2-5-7 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	
2523941	JC2	Diagonal Hip Girder	2	1	I43385040

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:38 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-d9VGZAV2zcGyQ1FpCHMu\_VCrvmZXF4VuRNnWnVyP7b3

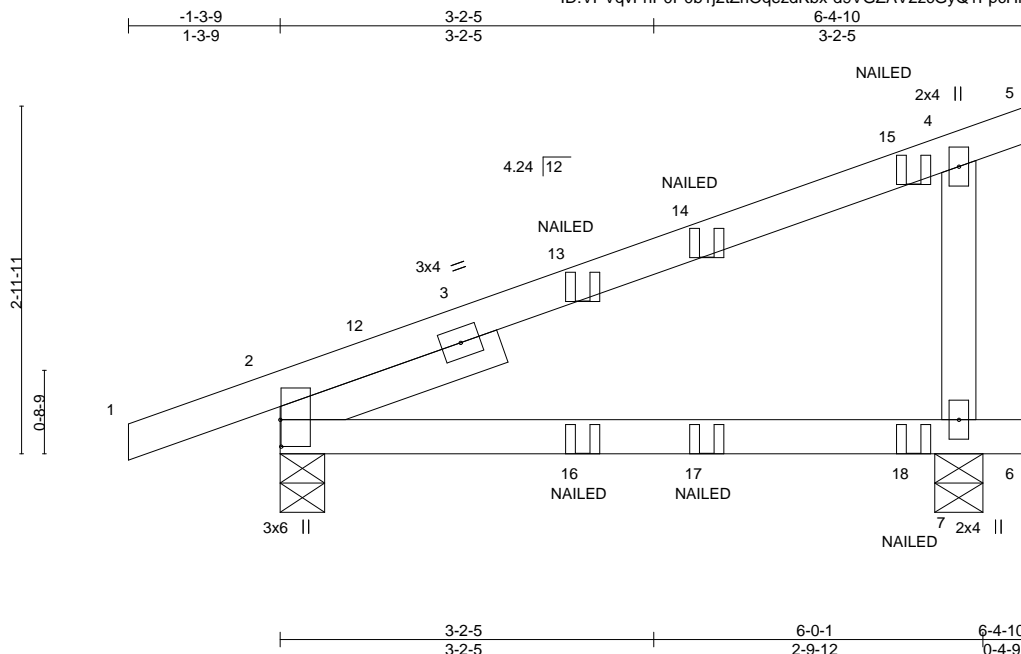

Scale = 1:19.7

Plate Offsets (X,Y)-- [2:0-2-12,0-0-1]

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>2-0-0</b>	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.60	Vert(LL)	-0.07	7-10	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.40	Vert(CT)	-0.13	7-10	>544	180		
TCDL 10.0	Rep Stress Incr	NO	WB 0.04	Horz(CT)	0.03	2	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-MP							
BCDL 10.0									Weight: 21 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 2=0-4-9, 7=0-4-15  
Max Horz 2=85(LC 12)  
Max Uplift 2=-46(LC 12), 7=-56(LC 12)  
Max Grav 2=361(LC 2), 7=372(LC 17)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-273/63  
WEBS 4-7=-263/77

- NOTES-**
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 7.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
  - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-5=-51, 6-8=-20  
Concentrated Loads (lb)  
Vert: 14=-5(B) 15=-60(F) 16=0(F) 17=-1(B) 18=-18(F)



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JC3	Jack-Open	2	1	I43385041

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:39 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-5L2enWWgkwOp2Bq?A?i7Wjl8IA?Y\_XO2g1X3JxyP7b2



Scale = 1:10.9

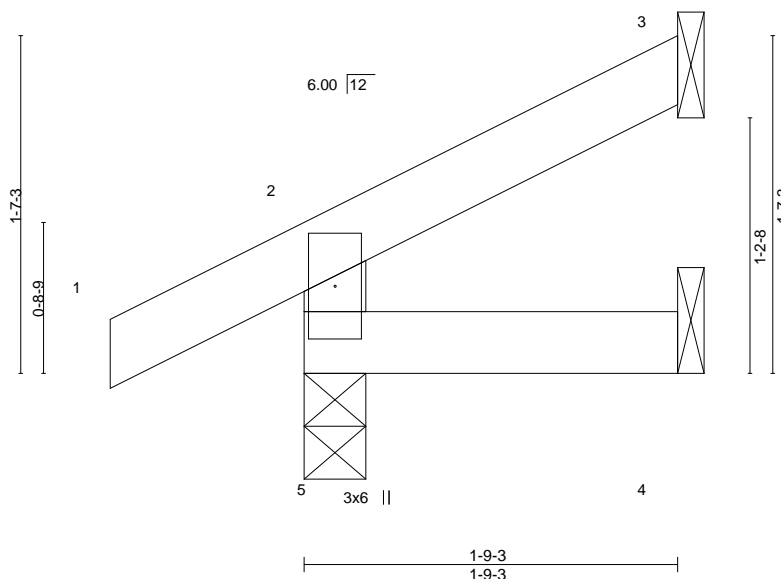

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.08	Vert(LL)	-0.00	5	>999	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	-0.00	5	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-9-3 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=56(LC 16)  
Max Uplift 5=32(LC 16), 3=-14(LC 16)  
Max Grav 5=175(LC 21), 3=38(LC 21), 4=28(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	
2523941	JC5	Diagonal Hip Girder	1	1	I43385043

Builders First Source, Valley Center, KS 67147

8.240 s Apr 4 2020 MiTek Industries, Inc. Wed Oct 28 09:31:57 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-hx5m?2ChUYFY0TpXFUJxkl8lYfNN15hMJUT2PoyOwWW

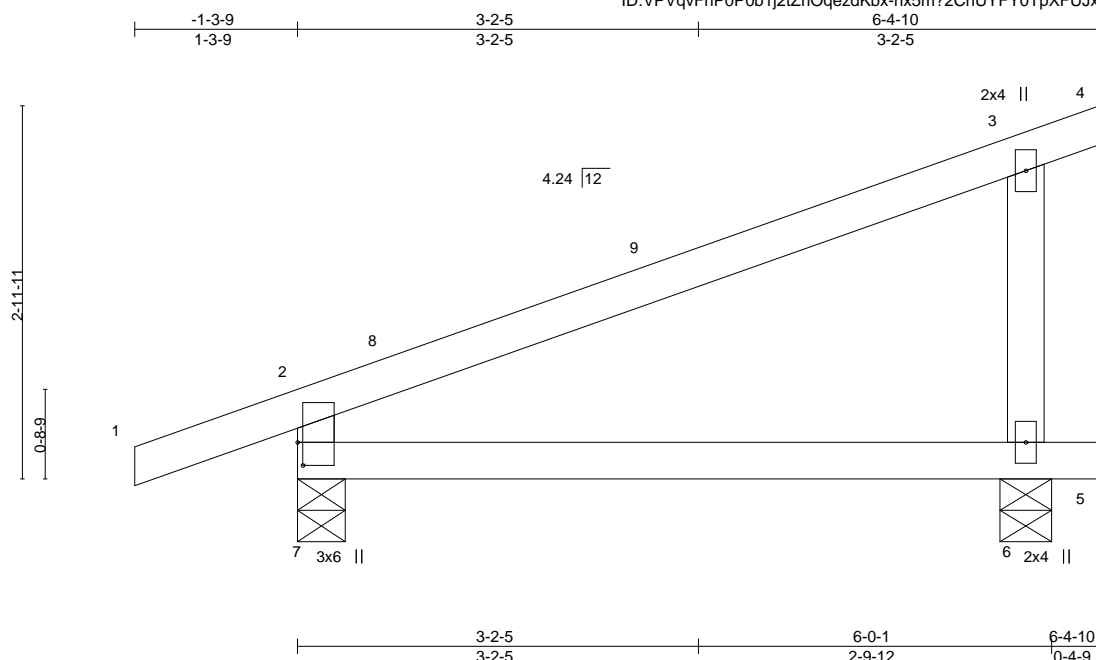

Scale = 1:18.4

Plate Offsets (X,Y)-- [2:0-0-10,0-1-12], [7:0-2-3,0-0-8], [7:0-0-0,0-1-12]

LOADING (psf)	SPACING-	CSL	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.54	Vert(LL)	-0.05	6-7	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.32	Vert(CT)	-0.10	6-7	>679	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.04	Horz(CT)	0.00		n/a	n/a		
BCLL 0.0	Rep Stress Incr NO	Matrix-AS							
BCDL 10.0	Code IRC2018/TPI2014							Weight: 19 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(lb/size) 7=281/0-4-9, 6=234/0-4-15  
Max Horz 7=96(LC 16)  
Max Uplift 7=-50(LC 16), 6=-48(LC 16)  
Max Grav 7=366(LC 2), 6=317(LC 21)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-7=-316/235

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner(3) -1-3-9 to 2-11-6, Exterior(2R) 2-11-6 to 6-4-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 7 and 48 lb uplift at joint 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss JD1	Truss Type Jack-Open	Qty 2	Ply 1	Job Reference (optional) I43385044
----------------	--------------	-------------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:41 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-1kAOCCXwGXfXHU\_OHQvbb8qUizhoSRuK7L0AOqyP7b0

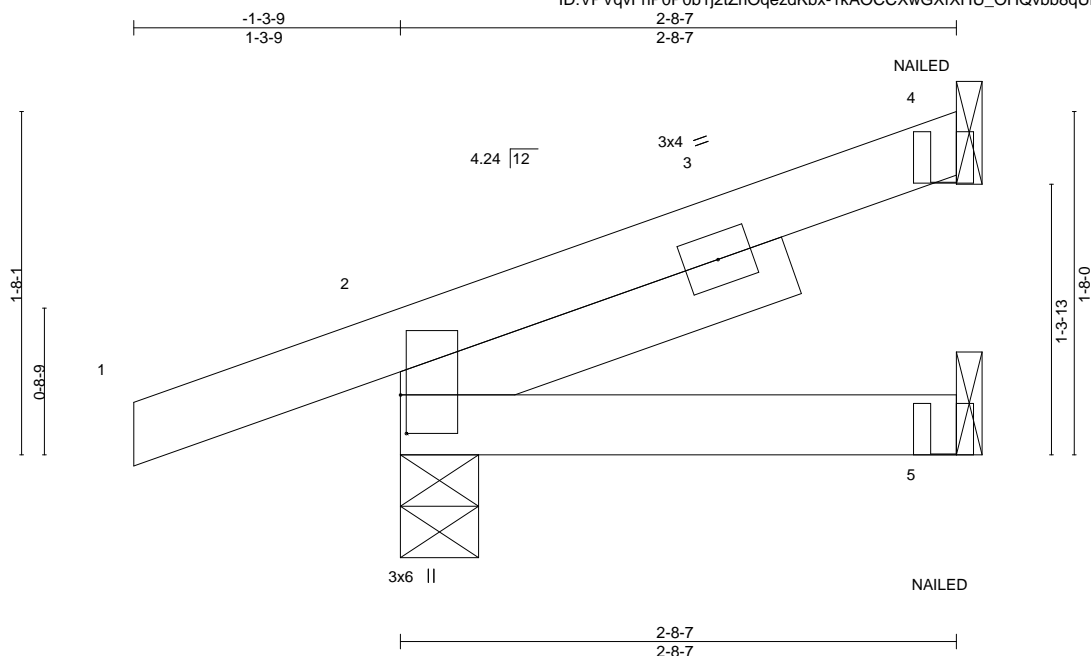


Plate Offsets (X,Y)-- [2:0-2-4,0-0-5]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	-0.00	8	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	5-8	>999	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-MP							
BCDL 10.0									Weight: 10 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 2-8-7 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 4=Mechanical, 2=0-4-9, 5=Mechanical  
Max Horz 2=45(LC 16)  
Max Uplift 4=-20(LC 16), 2=-49(LC 16)  
Max Grav 4=72(LC 21), 2=239(LC 21), 5=45(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-51, 5-6=-20  
Concentrated Loads (lb)  
Vert: 4=-9(B) 5=-1(B)



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JD2	Jack-Open	2	1	I43385045

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:42 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-WwkmPYYY1mOveZar7Rq8LNf?N1CBu8UM?ljwGyP7b?

-0-11-0 1-10-5  
0-11-0 1-10-5

Scale = 1:11.1

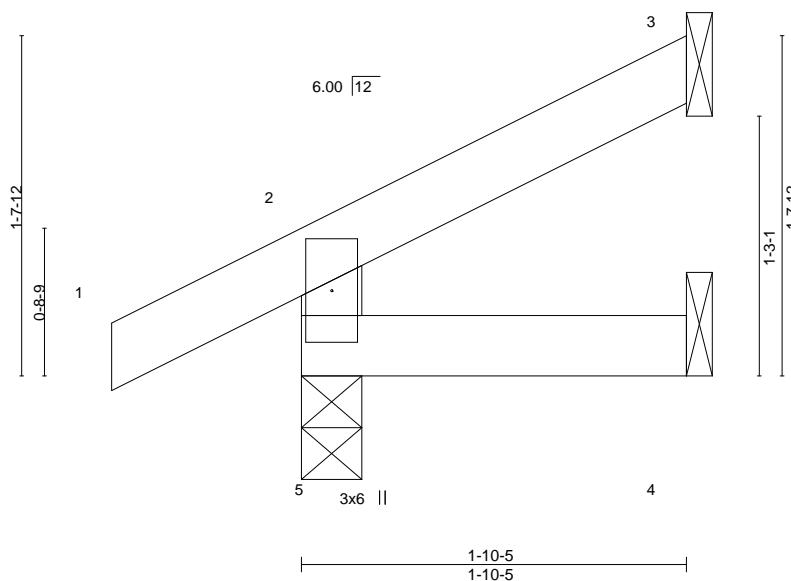

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.08	Vert(LL)	-0.00	5	>999	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	-0.00	5	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-10-5 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=57(LC 16)  
Max Uplift 5=32(LC 16), 3=-15(LC 16)  
Max Grav 5=179(LC 21), 3=42(LC 21), 4=30(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2523941	Truss JD3	Truss Type Jack-Open	Qty 3	Ply 1	143385046
----------------	--------------	-------------------------	----------	----------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:43 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-6l9duZAo8vFWo7mPry3hZwpknNNwLOdbfVHSiyP7b\_

-0-11-0  
0-11-0

2-0-0  
2-0-0

Scale = 1:11.5

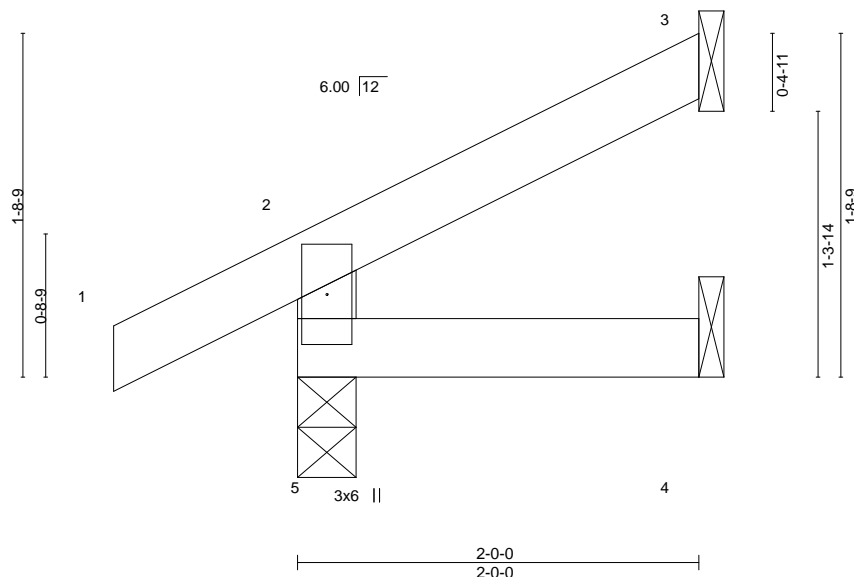

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	-0.00	5	>999	240	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	4-5	>999	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 6 lb	FT = 20%
BCDL 10.0										

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=59(LC 16)  
Max Uplift 5=31(LC 16), 3=-17(LC 16)  
Max Grav 5=185(LC 21), 3=49(LC 21), 4=33(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2523941	Truss JM1	Truss Type Jack-Open	Qty 2	Ply 1	143385047
----------------	--------------	-------------------------	----------	----------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:43 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-\_6l9duZAo8vFWo7mPry3hZwpXnNzwLOdbfVHSiyP7b\_

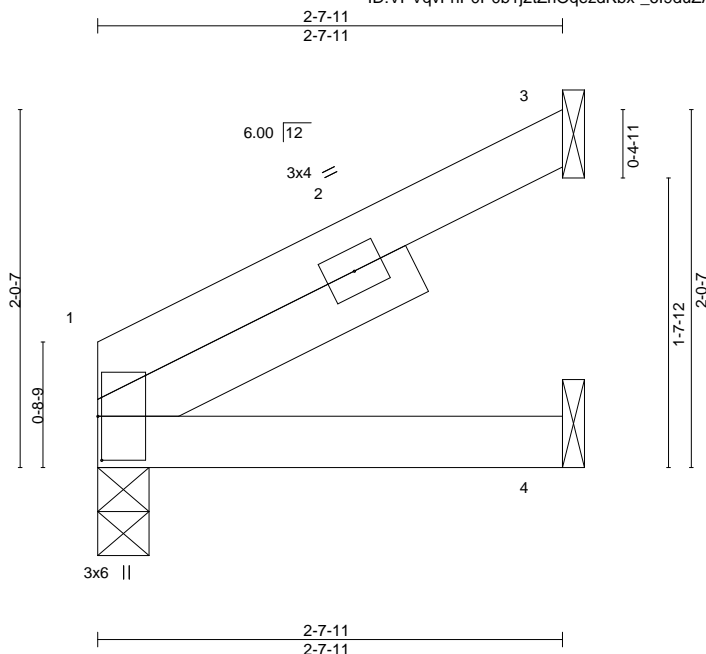

Scale = 1:13.1

Plate Offsets (X,Y)-- [1:0-3-0,0-0-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	-0.00	7	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	-0.00	4-7	>999	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	1	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 9 lb	FT = 20%
BCDL 10.0										

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 2-7-11 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 1=36(LC 16)  
Max Uplift 3=26(LC 16)  
Max Grav 1=118(LC 20), 3=83(LC 20), 4=44(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss JM2	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Job Reference (optional) I43385048
----------------	--------------	-----------------------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:51 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrOqezdKbx-lfnAldfBvcv6U1JtW5x?FF13?zVozppRvRijEyP7as

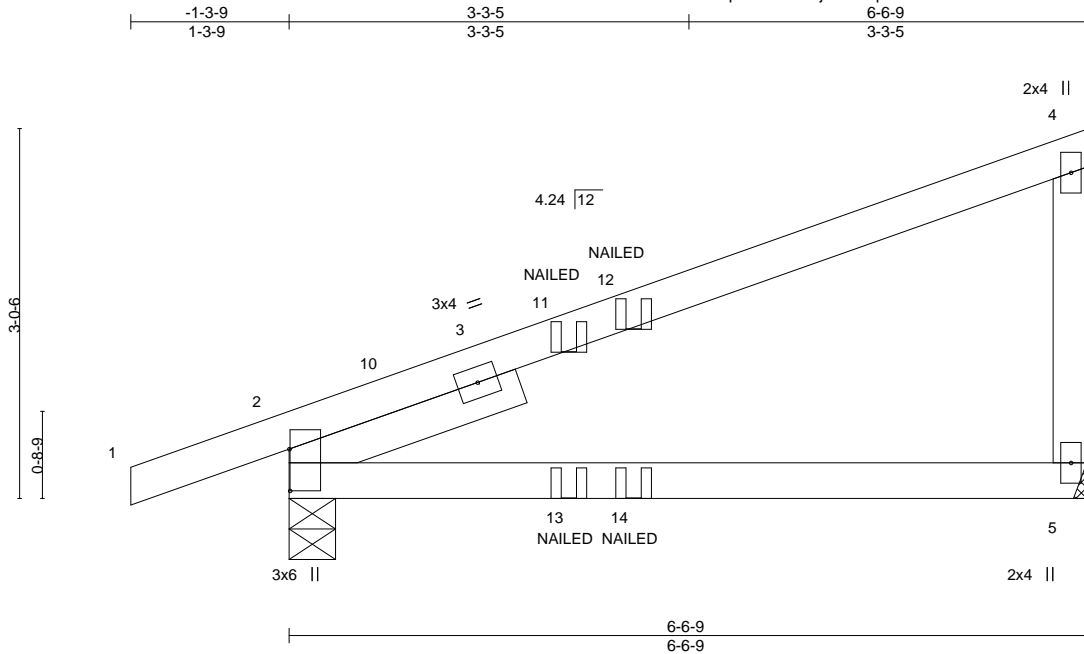

Scale = 1:18.9

Plate Offsets (X,Y)-- [2:0-4-2,0-0-1]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.76	Vert(LL)	-0.11	5-8	>718	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.53	Vert(CT)	-0.20	5-8	>384	180		
TCDL 10.0	Rep Stress Incr	NO	WB 0.04	Horz(CT)	0.05	2	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-MP							
BCDL 10.0									Weight: 22 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-4-9, 5=Mechanical  
Max Horz 2=82(LC 12)  
Max Uplift 2=54(LC 12), 5=37(LC 12)  
Max Grav 2=396(LC 2), 5=302(LC 17)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-319/55

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-51, 5-6=-20  
Concentrated Loads (lb)  
Vert: 11=-12(B) 12=-20(F) 13=-11(B) 14=-4(F)



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss JM3	Truss Type Jack-Open	Qty 1	Ply 1	Job Reference (optional) I43385049
----------------	--------------	-------------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:52 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-DrLYWzggqv1z5BJVQEcAYSoMUPRaXQcyfZAFGhyP7ar

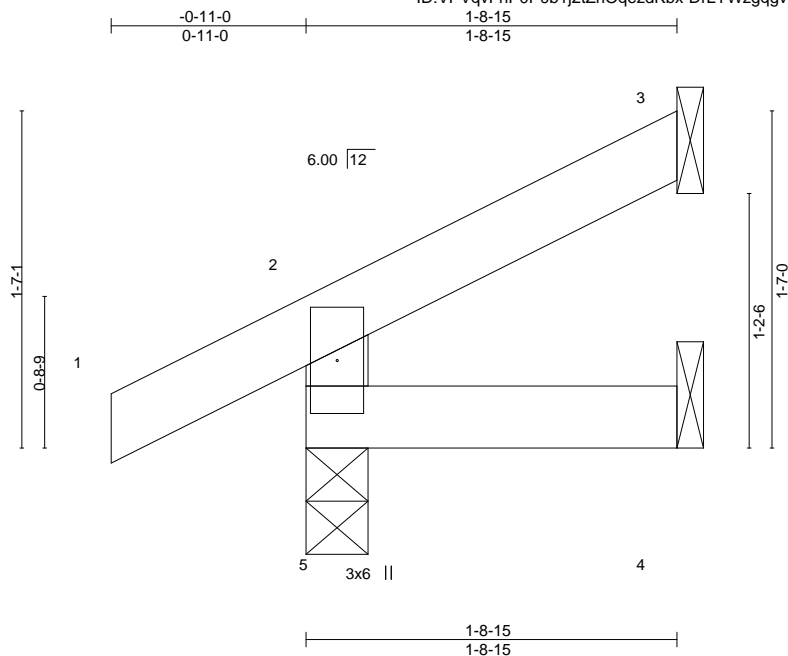

Scale = 1:10.8

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.08	Vert(LL)	-0.00	5	>999	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	-0.00	5	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-8-15 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=55(LC 16)  
Max Uplift 5=32(LC 16), 3=-14(LC 16)  
Max Grav 5=175(LC 21), 3=37(LC 28), 4=28(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JM4	Jack-Open	4	1	
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:52 2020 Page 1
					ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-DrLYWzgqgv1z5BJVQEcAYSoM2PQqXQcyfZAFGhyP7ar
					Job Reference (optional)

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:52 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-DrLYWzgqgv1z5BJVQEcAYSoM2PQqXQcyfZAFGhyP7ar

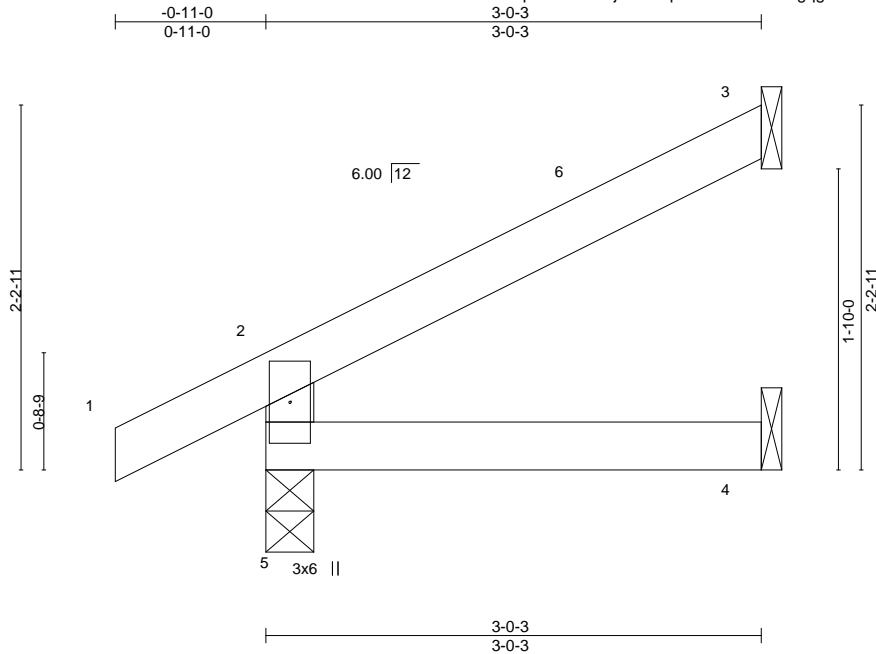

Scale = 1:14.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.11	Vert(LL)	-0.00	4-5	>999	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.07	Vert(CT)	-0.01	4-5	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 9 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-0-3 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=72(LC 16)  
Max Uplift 5=30(LC 16), 3=-28(LC 16)  
Max Grav 5=231(LC 21), 3=89(LC 21), 4=52(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 2-11-7 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28,2020


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JM5	Jack-Open	3	1	
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:53 2020 Page 1
					ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-h2vwJhSRD9qjKuh_x7P4gKTRpIMGss5uDwpo7yP7aq
					Job Reference (optional)

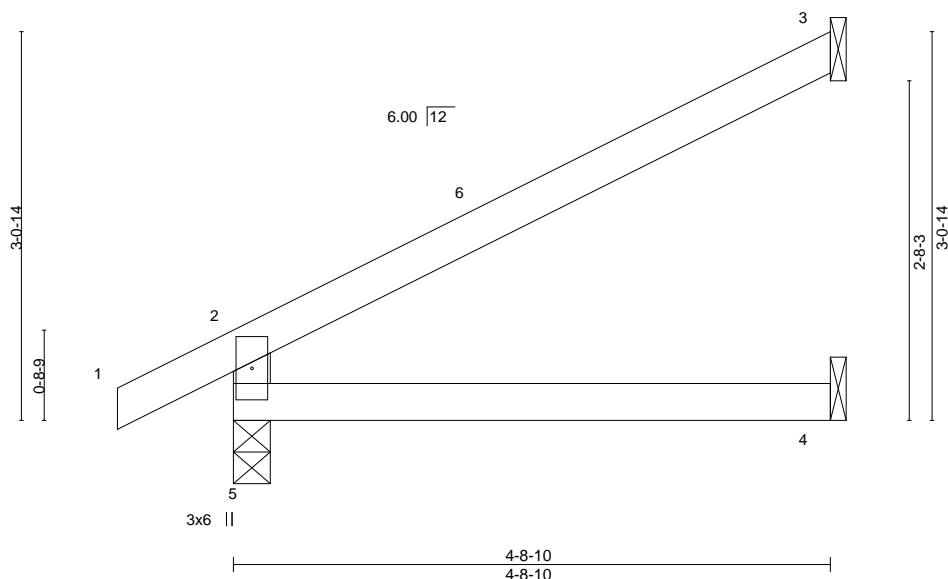

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.32	Vert(LL)	-0.02	4-5	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.18	Vert(CT)	-0.04	4-5	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.02	3	n/a	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS							
BCDL 10.0	Code IRC2018/TPI2014							Weight: 13 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=96(LC 16)  
Max Uplift 5=29(LC 16), 3=45(LC 16)  
Max Grav 5=286(LC 2), 3=162(LC 21), 4=84(LC 7)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-251/154

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 4-7-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	
2523941	JM6	Roof Special	1	1	
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:54 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZr1OqezdKbx-9ESJwfh4CXHhLUTuYeedttfAD4f?JpF7tfMKZyP7ap

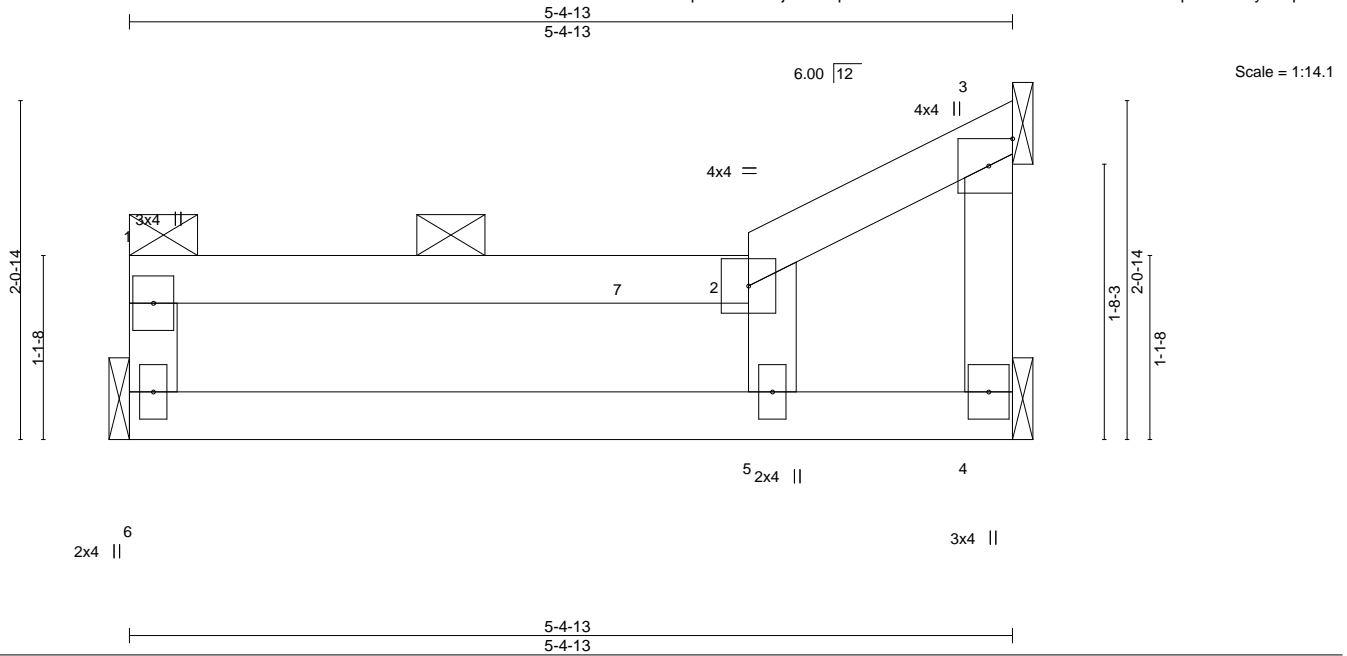

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL (roof)	25.0	2-0-0		TC	0.26	in (loc)	I/defl	L/d	MT20	197/144	
Snow (Pt/Pg)	20.4/20.0	Plate Grip DOL	1.15	BC	0.24	Vert(LL)	-0.03 5-6 >999	240			
TCDL	10.0	Lumber DOL	1.15	WB	0.02	Vert(CT)	-0.05 5-6 >999	180			
BCLL	0.0	Rep Stress Incr	YES	Matrix-AS		Horz(CT)	-0.01 3 n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014							Weight: 16 lb	FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 1-2.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 6=Mechanical, 4=Mechanical, 3=Mechanical  
Max Horz 6=57(LC 13)  
Max Uplift 6=24(LC 12), 4=16(LC 13), 3=6(LC 13)  
Max Grav 6=262(LC 34), 4=175(LC 34), 3=84(LC 35)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 5-3-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- 3) Unbalanced snow loads have been considered for this design.
- 4) Provide adequate drainage to prevent water ponding.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 4, 3.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 11) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss JM7	Truss Type Flat	Qty 1	Ply 1	Job Reference (optional) I43385053
----------------	--------------	--------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:55 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-dQ0h8?iizqPYze246MAAtA5QtNdSakmMOMXPvt0yP7ao

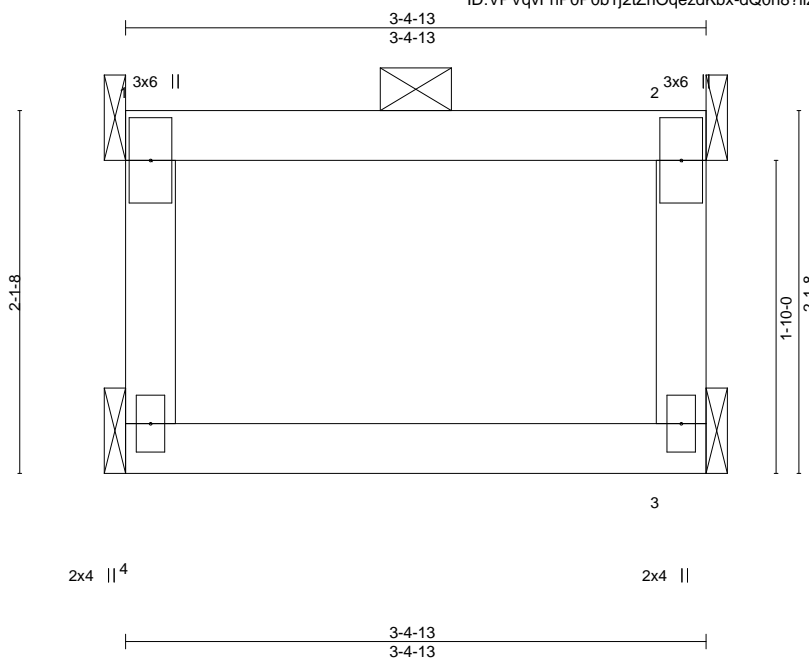

Scale = 1:13.5

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.10	Vert(LL)	-0.00	3-4	>999	MT20	197/144
Snow (Pt/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.07	Vert(CT)	-0.00	3-4	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.01	1	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 11 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD 2-0-0 oc purlins: 1-2, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

**REACTIONS.** All bearings Mechanical.  
(lb) - Max Horz 4=-59(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 2  
Max Grav All reactions 250 lb or less at joint(s) 4, 1, 3, 2

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 5) Refer to girder(s) for truss to truss connections.
  - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 2.
  - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 9) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss JM8	Truss Type Flat	Qty 1	Ply 1	Job Reference (optional) I43385054
----------------	--------------	--------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:56 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-5ca3LKjKk8XPaodGf3h6ily1U0n7TDcYaB8TPSyP7an

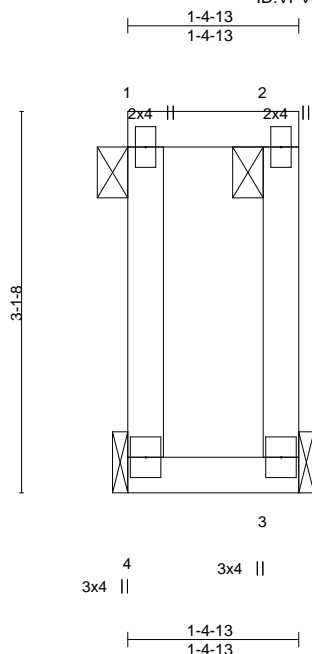

Scale = 1:18.9

LOADING (psf)	SPACING-	CSL.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.14	Vert(LL) -0.00	4	>999	240	MT20	197/144
Snow (Pt/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.11	Vert(CT) -0.00	4	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT) 0.00	3	n/a	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 9 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD 2-0-0 oc purlins: 1-2, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

**REACTIONS.** (size) 4=Mechanical, 3=Mechanical  
Max Horz 4=-92(LC 10)  
Max Uplift 4=-123(LC 10), 3=-123(LC 11)  
Max Grav 4=140(LC 13), 3=140(LC 12)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 4=123, 3=123.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	
2523941	JM9	Jack-Open	2	1	I43385055

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:57 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-Zp8RZgkyVSgFCyCTDnCLFWV9oQ5yCgOhpqu0xuyP7am



Scale = 1:20.3

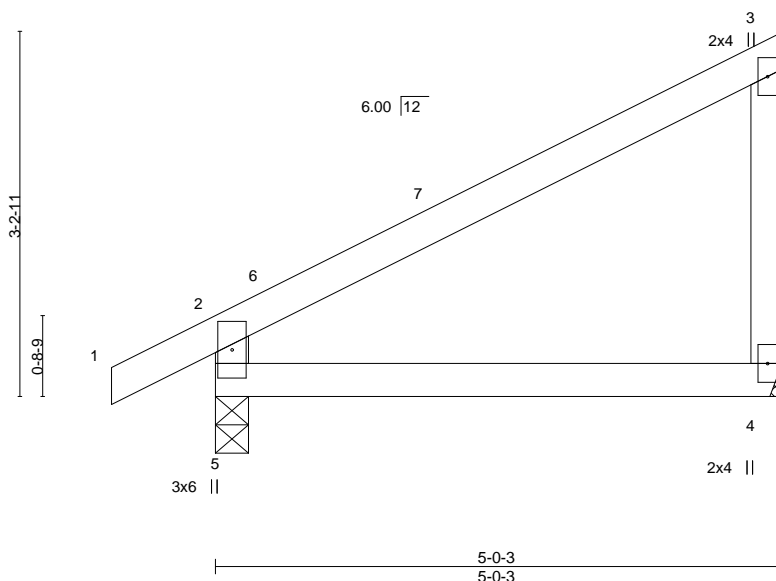

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.36	Vert(LL)	-0.02	4-5	>999	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.20	Vert(CT)	-0.05	4-5	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00		n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 17 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 5=0-3-8, 4=Mechanical  
Max Horz 5=99(LC 16)  
Max Uplift 5=29(LC 16), 4=38(LC 16)  
Max Grav 5=296(LC 21), 4=229(LC 21)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-259/155

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 4-10-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	143385056
2523941	JM10	Jack-Open	5	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:44 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-SJsXqEaoZS158yizyYtIDmSrbBcxfoKnqJEq\_8yP7az



Scale = 1:23.7

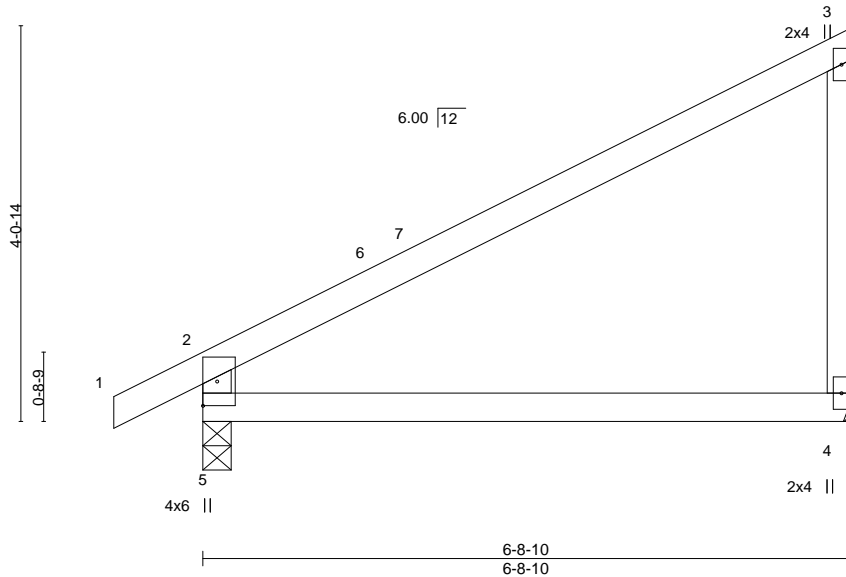


Plate Offsets (X,Y)-- [2:0-0-14,0-1-12], [5:0-0-0,0-1-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.65	Vert(LL)	-0.08	4-5	>995	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.40	Vert(CT)	-0.17	4-5	>443	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00		n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL 10.0									Weight: 22 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 5=0-3-8, 4=Mechanical  
Max Horz 5=122(LC 16)  
Max Uplift 5=-28(LC 16), 4=-51(LC 16)  
Max Grav 5=370(LC 2), 4=309(LC 21)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-317/165

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 6-6-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	JM11	Diagonal Hip Girder	2	1	I43385057
Job Reference (optional)					

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:45 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrLOqezdKbx-wVQv2aaRkm9ym6H9WF\_Xm\_?5gbyuOBzw2z\_OWbyP7ay

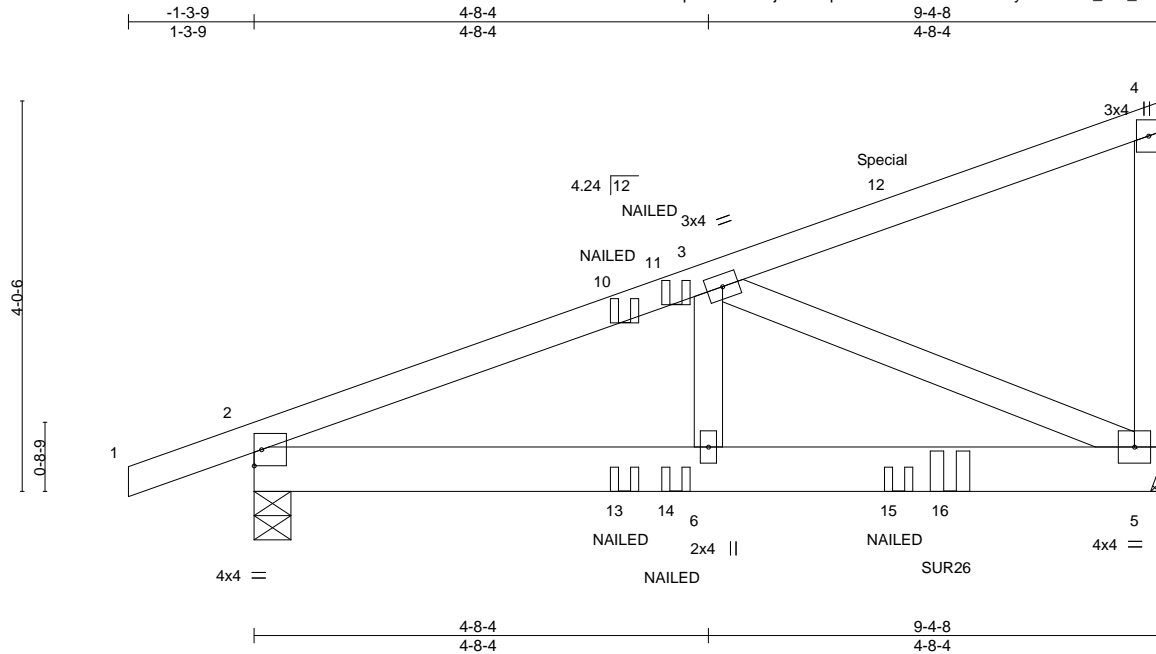

Scale: 1/2"=1'

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.37	Vert(LL)	-0.02	MT20		197/144	
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.41	Vert(CT)	-0.04				
TCDL	10.0	Rep Stress Incr	NO	WB	0.31	Horz(CT)	0.01				
BCLL	0.0	Code IRC2018/TPI2014		Matrix-MS							
BCDL	10.0										
								Weight: 41 lb		FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x6 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-4-9, 5=Mechanical  
Max Horz 2=128(LC 11)  
Max Uplift 2=90(LC 12), 5=91(LC 9)  
Max Grav 2=581(LC 2), 5=643(LC 17)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-807/98  
BOT CHORD 2-6=-129/718, 5-6=-129/718  
WEBS 3-5=-749/118

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Use Simpson Strong-Tie SUR26 (6-10dx1 1/2 Girder, 6-10dx1 1/2 Truss, Single Ply Girder) or equivalent at 7-2-3 from the left end to connect truss(es) to back face of bottom chord, skewed 45.0 deg.to the right, sloping 0.0 deg. down.
- Fill all nail holes where hanger is in contact with lumber.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 119 lb down and 76 lb up at 6-7-13 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-51, 5-7=-20



October 28, 2020

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	I43385057
2523941	JM11	Diagonal Hip Girder	2	1	

**LOAD CASE(S)**
Standard
Concentrated Loads (lb)
Vert: 10=-12(F) 11=-20(B) 12=-89(F) 13=-11(F) 14=-4(B) 15=-37(F) 16=-201(B)


Job	Truss	Truss Type	Qty	Ply	
2523941	JM12	Jack-Open	1	1	I43385058

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:46 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-Oh\_HFWb353HpNGsL4zVmlBYHD\_L\_7i73Hdjx21yP7ax

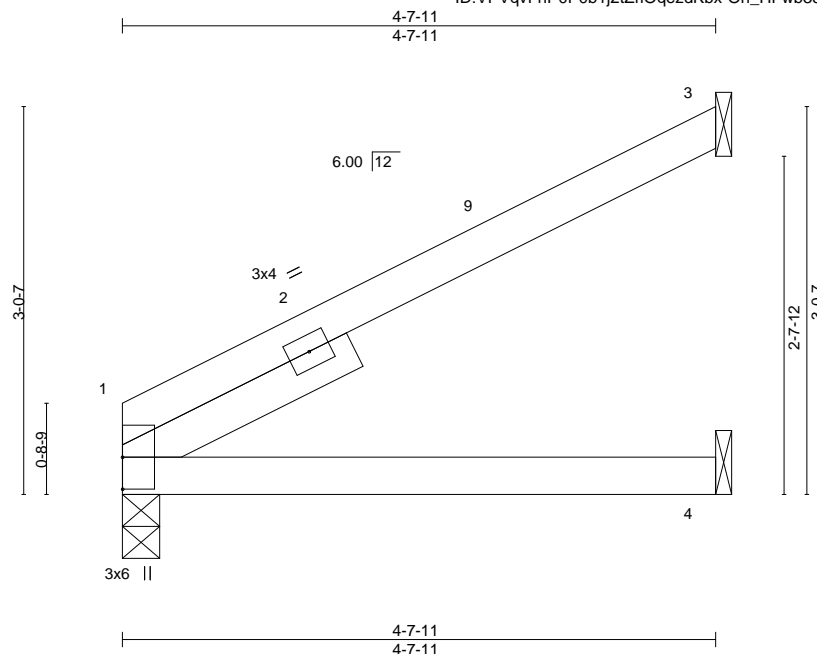

Scale = 1:18.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.32	Vert(LL)	-0.03	4-7	>999	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.23	Vert(CT)	-0.05	4-7	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	0.02	1	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 14 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 1=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 1=63(LC 16)  
Max Uplift 3=44(LC 16)  
Max Grav 1=225(LC 20), 3=160(LC 20), 4=82(LC 7)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 4-6-15 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss JM13	Truss Type Jack-Open	Qty 1	Ply 1	Job Reference (optional) I43385059
----------------	---------------	-------------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:47 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-suXfSFchsNPg?PRYeg0?rP4VjOkHs9NDWHTUaTyP7aw

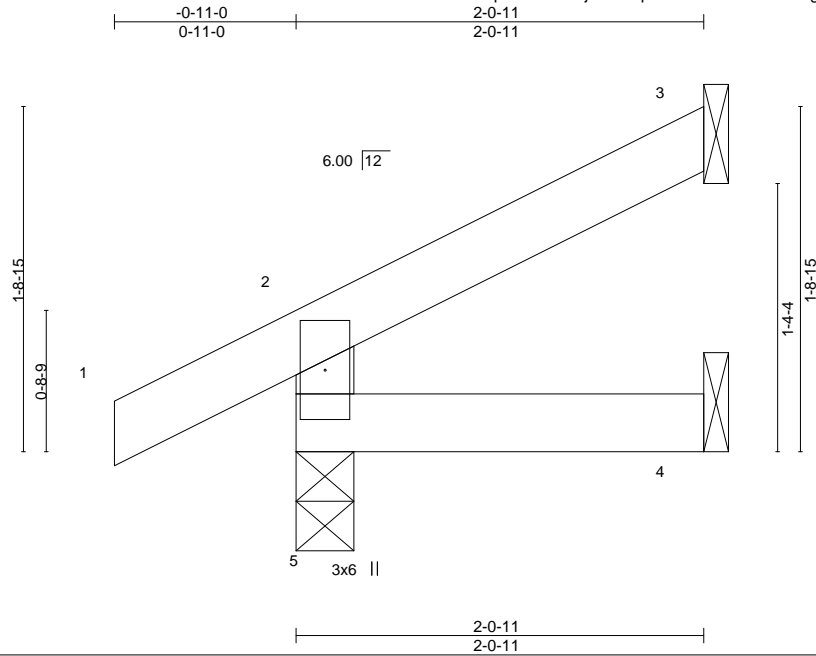

Scale = 1:11.6

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.08	Vert(LL)	-0.00	5	>999	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	-0.00	4-5	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-MR						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-11 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=59(LC 16)  
Max Uplift 5=31(LC 16), 3=-17(LC 16)  
Max Grav 5=185(LC 21), 3=49(LC 21), 4=33(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	
2523941	JM14	Diagonal Hip Girder	1	1	I43385060

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:48 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-K452gbdJdhXXdZ0kBOYENcdZLo0Xbc7MkxC27wyP7av



Scale = 1:18.7

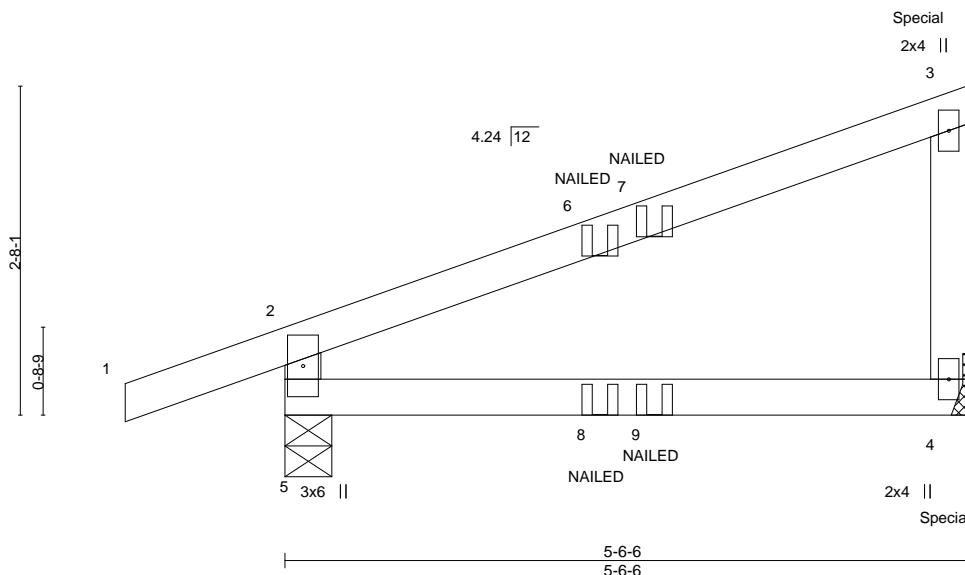

<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in	(loc)	I/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.04	4-5	>999	240	MT20	197/144
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.29	Vert(CT)	-0.08	4-5	>784	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.03	Horz(CT)	0.00		n/a	n/a		
BCLL	0.0	Code IRC2018/TPI2014		Matrix-MS							Weight: 17 lb	FT = 20%
BCDL	10.0											

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-6-6 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 5=0-4-9, 4=Mechanical  
Max Horz 5=83(LC 12)  
Max Uplift 5=54(LC 12), 4=39(LC 12)  
Max Grav 5=349(LC 2), 4=291(LC 17)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-305/82

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 69 lb down and 45 lb up at 5-4-10 on top chord, and 24 lb down at 5-4-10 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-51, 2-3=-51, 4-5=-20  
Concentrated Loads (lb)  
Vert: 3=-53(B) 4=-16(B) 8=0(B) 9=0(F)



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss JM15	Truss Type Jack-Open	Qty 2	Ply 1	143385061
----------------	---------------	-------------------------	----------	----------	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:49 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrlOqezdKbx-oGfQtxdxO\_fOEjwL53TwqAp8CODK3tWzbybfMyP7au

-0-11-0 4-0-0  
0-11-0 4-0-0

Scale = 1:16.5

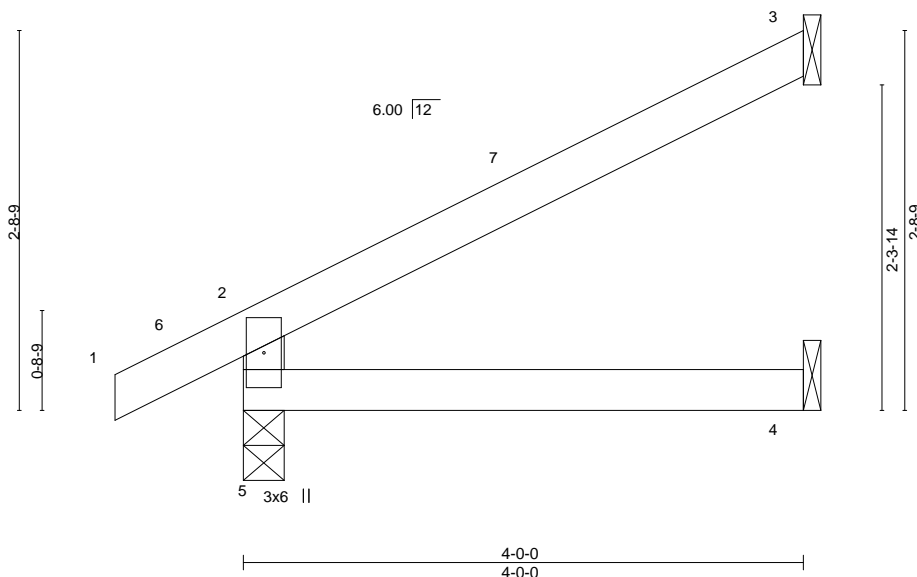

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.21	Vert(LL)	-0.01	4-5	>999	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.13	Vert(CT)	-0.02	4-5	>999		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.01	3	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 11 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=86(LC 16)  
Max Uplift 5=29(LC 16), 3=38(LC 16)  
Max Grav 5=284(LC 21), 3=132(LC 21), 4=71(LC 7)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-253/143

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 3-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
2523941	JM16	Half Hip	1	2	

I43385062

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:50 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-HTDo5HeZ9InFstA7JpaiT1ivcdB3V?fCFh8BoyP7at

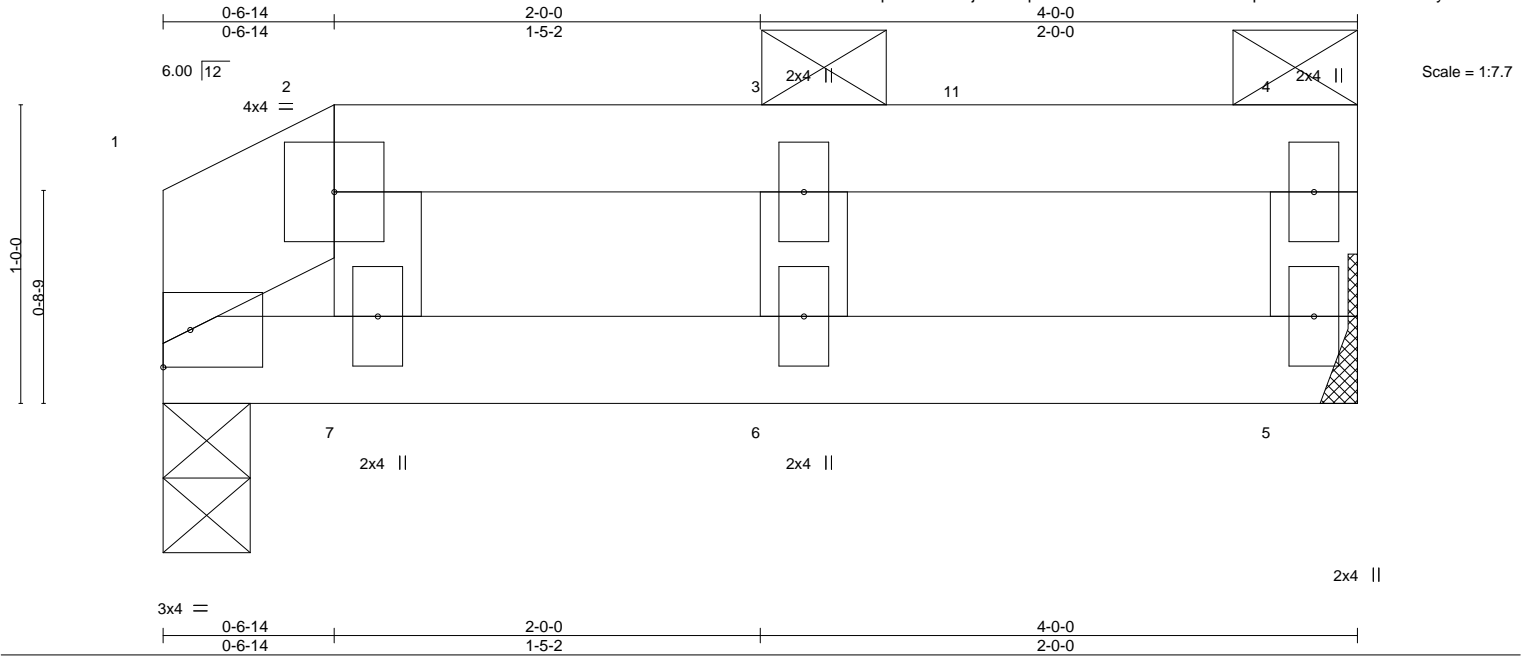

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.55	Vert(LL) -0.05	6	>980	240	MT20	197/144
Snow (Pt/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.53	Vert(CT) -0.08	6-7	>553	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.07	Horz(CT) 0.02	1	n/a	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 23 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x6 SPF No.2 \*Except\*  
2-4: 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 2-4.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 1=0-3-8, 5=Mechanical  
Max Horz 1=22(LC 15)  
Max Uplift 1=49(LC 16), 5=64(LC 13)  
Max Grav 1=605(LC 2), 5=727(LC 34)


**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 4-5=-408/92  
WEBS 3-6=-55/594, 2-7=-553/149

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 973 lb down and 90 lb up at 2-2-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

#### LOAD CASE(S)

Standard

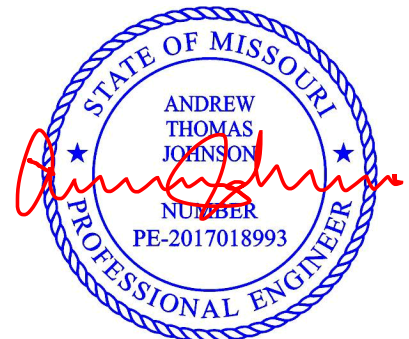

October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	I43385062
2523941	JM16	Half Hip	1	2	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:50 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-HTDo5HeZ9InFstA7JpaiT1ivcdB3V?fCFh8BoyP7at

**LOAD CASE(S)** Standard  
1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-51, 2-4=-61, 5-8=-20  
Concentrated Loads (lb)  
Vert: 6=-938

Job 2523941	Truss JP1	Truss Type Jack-Open Girder	Qty 2	Ply 1	Job Reference (optional)	I43385063
----------------	--------------	--------------------------------	----------	----------	--------------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:39:58 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-2?ipm0kaGlo6q6nfnUjanj1NVqTox75r2UdaTKyP7al

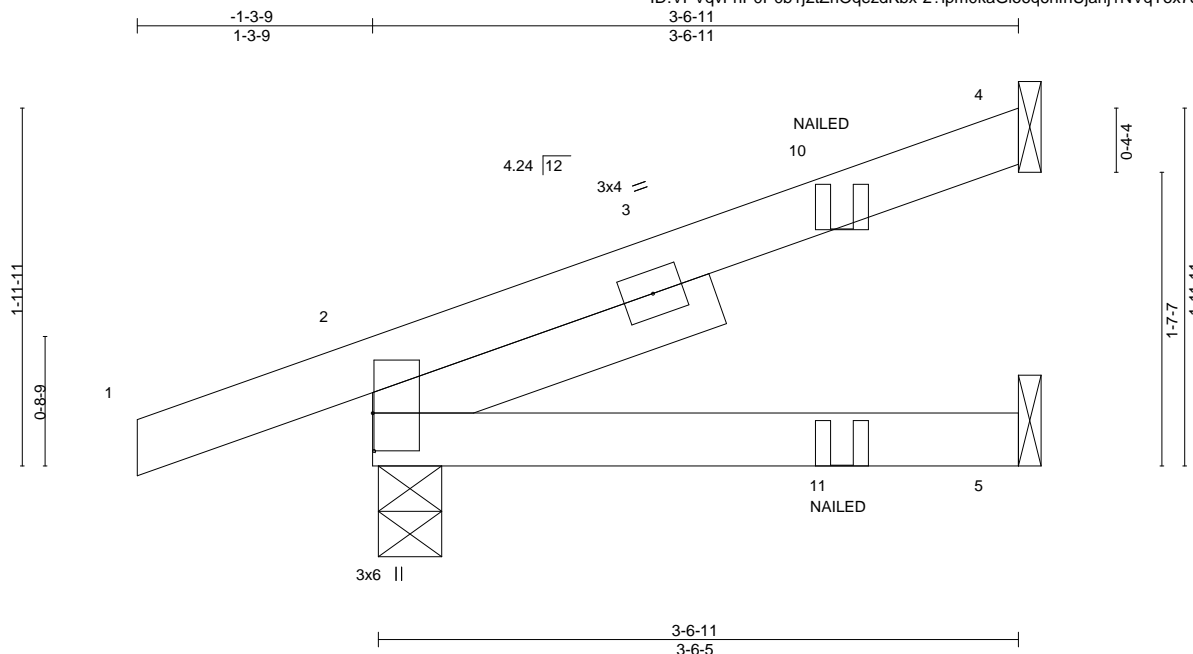


Plate Offsets (X,Y)-- [2:0-2-8,0-0-1]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	-0.01	5-8	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	-0.01	5-8	>999	180		
TCDL 10.0	Rep Stress Incr	NO	WB 0.00	Horz(CT)	0.00	2	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-MP							
BCDL 10.0									Weight: 12 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-0-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 3-6-11 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 4=Mechanical, 2=0-4-3, 5=Mechanical  
Max Horz 2=54(LC 12)  
Max Uplift 4=24(LC 12), 2=48(LC 12)  
Max Grav 4=105(LC 17), 2=280(LC 17), 5=59(LC 7)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-51, 5-6=-20  
Concentrated Loads (lb)  
Vert: 11=0(B)




October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

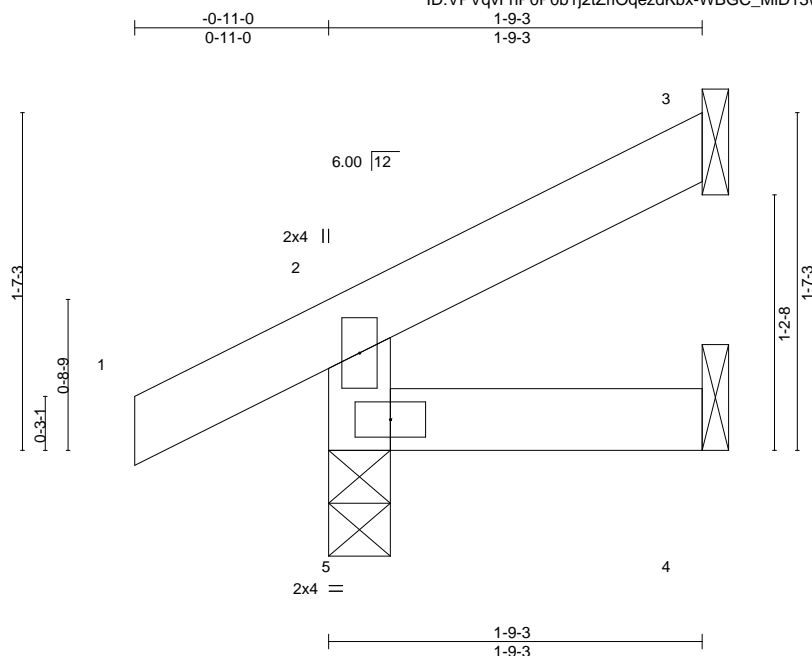[illegible]

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

<b>BRACING-</b>	
<b>TOP CHORD</b>	Structural wood sheathing directly applied or 1-9-3 oc purlins, except end verticals.
<b>BOT CHORD</b>	Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
 Max Horz 5=56(LC 16)  
 Max Uplift 3=-14(LC 16), 5=-32(LC 16)  
 Max Grav 3=38(LC 21), 4=28(LC 7), 5=175(LC 21)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCDL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	LG1	GABLE	1	1	I43385065

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:01 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-SaOyO2nTZgAhZVESdGHPMfvT1WY8UAHkSSE4fyP7ai



Scale = 1:41.8

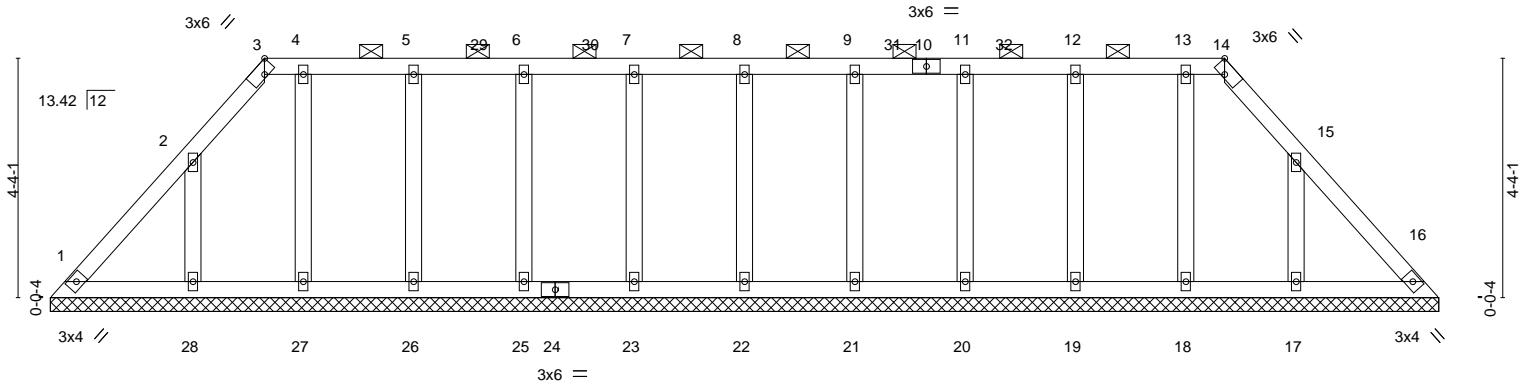


Plate Offsets (X,Y)-- [3:0-2-10,Edge], [14:0-2-10,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	16	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-S							
BCDL 10.0									Weight: 105 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 3-14.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** All bearings 25-2-1.  
(lb) - Max Horz 1=-104(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 22, 23, 25, 26, 28, 21, 20, 19, 17  
Max Grav All reactions 250 lb or less at joint(s) 1, 16, 22, 23, 25, 26, 27, 21, 20, 19, 18, 17 except 28=252(LC 23)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=25ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-3-15 to 3-3-15, Interior(1) 3-3-15 to 3-10-9, Exterior(2R) 3-10-9 to 8-1-8, Interior(1) 8-1-8 to 21-3-7, Exterior(2E) 21-3-7 to 24-10-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 22, 23, 25, 26, 28, 21, 20, 19, 17.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	
2523941	LG2	GABLE	1	1	I43385066

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:10 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-hJQMH7u6RRIPGyizU0xOHFXRwgaZIXicoMXCueyP7aZ

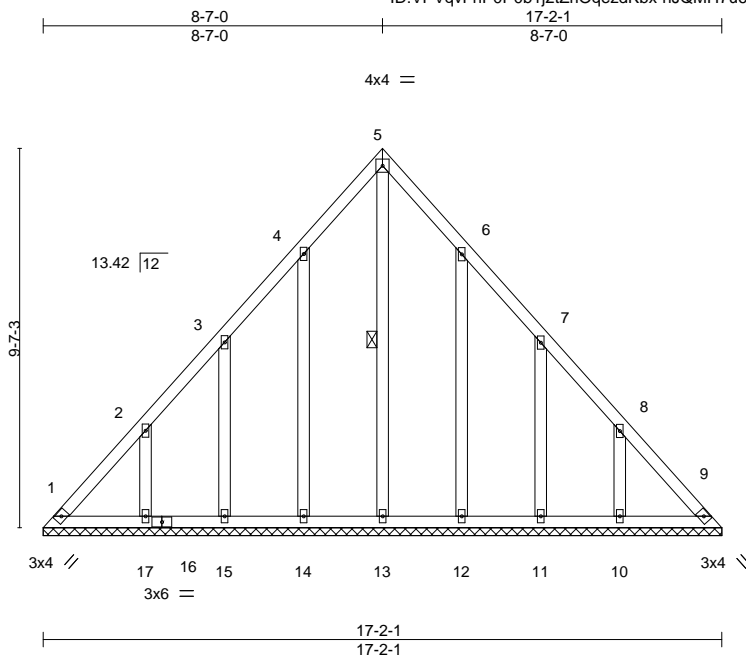

Scale = 1:58.3

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.08	in (loc) l/defl L/d	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.04	Vert(LL) n/a - n/a 999		
TCDL 10.0	Lumber DOL 1.15	WB 0.15	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.00 9 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 89 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 5-13

#### REACTIONS.

All bearings 17-2-1.  
(lb) - Max Horz 1=235(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 15, 14, 12, 11 except 17=102(LC 14), 10=102(LC 14)  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 15, 14, 13, 12, 11 except 17=256(LC 23), 10=256(LC 24)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-3-15 to 3-3-15, Interior(1) 3-3-15 to 8-7-0, Exterior(2R) 8-7-0 to 11-7-0, Interior(1) 11-7-0 to 16-10-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 15, 14, 12, 11 except (jt=lb) 17=102, 10=102.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	LG3	GABLE	1	1	I43385067

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:13 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-5u6Uw8w?kMh\_7PQX98U5uu9xGtcKyvN2UKmsVzyP7aW

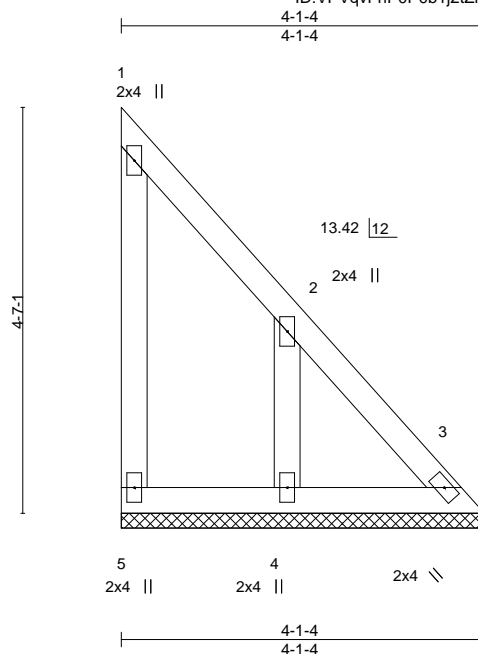

Scale = 1:26.1

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.14	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.04	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00	3	n/a	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-P						Weight: 18 lb	FT = 20%
BCDL 10.0	Code IRC2018/TPI2014								

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-1-4 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS. (size) 5=4-1-4, 3=4-1-4, 4=4-1-4

Max Horz 5=-142(LC 10)  
 Max Uplift 5=-49(LC 10), 3=-32(LC 13), 4=-94(LC 14)  
 Max Grav 5=78(LC 24), 3=121(LC 23), 4=235(LC 24)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-260/267

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	143385068
2523941	LG4	GABLE	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:14 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-a4gt7UxdVgprkZ?kjr?KR5i5IHvEhMWBj\_VQ1PyP7aV

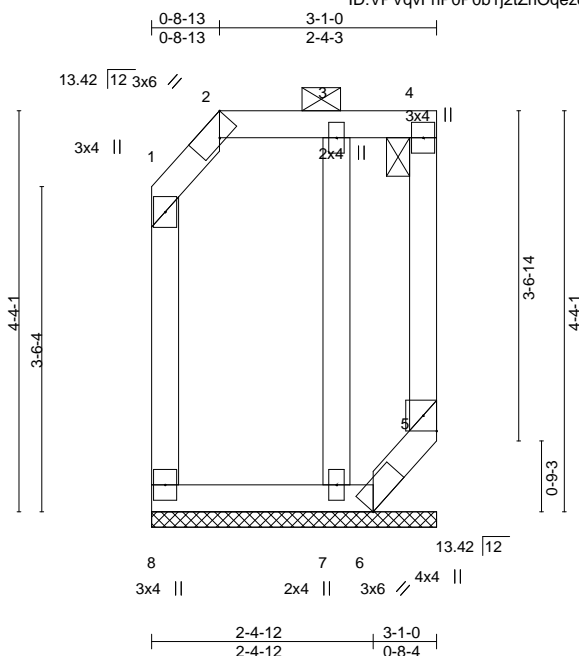

Scale = 1:24.9

Plate Offsets (X,Y)-- [2:0-2-10,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.25	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.25	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	5	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-R							
BCDL 10.0									Weight: 20 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-1-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 2-4.  
BOT CHORD Rigid ceiling directly applied or 8-8-3 oc bracing.

#### REACTIONS.

All bearings 3-1-0.  
(lb) - Max Horz 8=123(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 8 except 5=291(LC 11), 6=316(LC 12), 7=137(LC 11)  
Max Grav All reactions 250 lb or less at joint(s) 8, 7 except 5=271(LC 12), 6=338(LC 11)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

BOT CHORD 5-6=-418/432

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 5=291, 6=316, 7=137.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

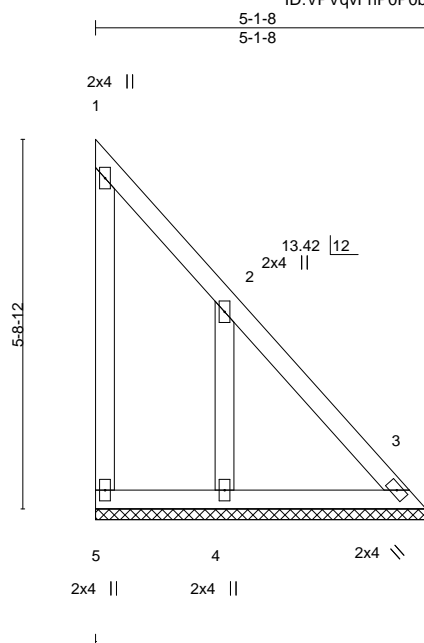

Scale = 1:35.7

[illegible]

**LUMBER-**

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2
OTHERS	2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied or 5-1-8 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

### REACTIONS.

(size) 5=5-1-8, 3=5-1-8, 4=5-1-8  
 Max Horz 5=-182(LC 10)  
 Max Uplift 5=-64(LC 12), 3=-27(LC 13), 4=-124(LC 14)  
 Max Grav 5=71(LC 24), 3=167(LC 23), 4=312(LC 24)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-322/334  
BOT CHORD 4-5=-250/257, 3-4=-250/257  
WEBS 2-4=-292/216

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCdL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 4-4-11, Interior(1) 4-4-11 to 4-9-10 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TcLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3 except (jt=lb) 4=124.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building Component Safety Information** available from Truss Plate Institute, 2672 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss LG6	Truss Type GABLE	Qty 1	Ply 1	143385070
----------------	--------------	---------------------	----------	----------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:18 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-SrvNzs\_7ZvJHDAJVyh4Gbxsm8uF1dAXnecTdBAyP7aR

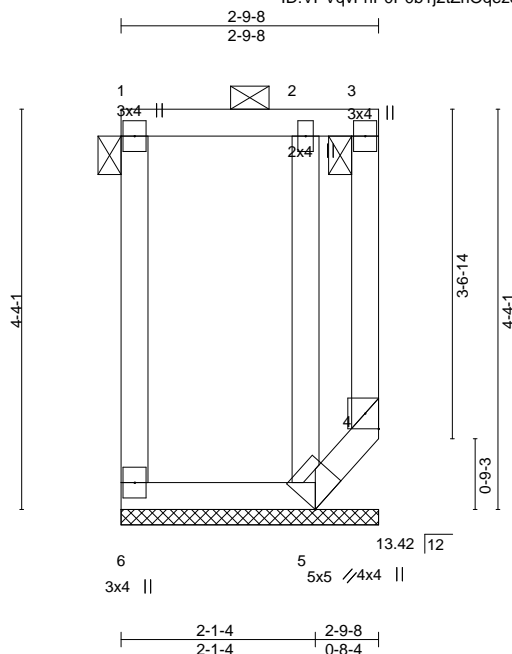

Scale = 1:25.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.26	Vert(LL)	n/a	-	n/a	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.26	Vert(CT)	n/a	-	n/a		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00	4	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-R						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 19 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

**BRACING-**  
TOP CHORD 2-0-0 oc purlins: 1-3, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** (size) 6=2-9-8, 4=2-9-8, 5=2-9-8  
Max Horz 6=-126(LC 12)  
Max Uplift 6=-76(LC 10), 4=-248(LC 13), 5=-190(LC 10)  
Max Grav 6=118(LC 24), 4=241(LC 10), 5=265(LC 24)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
BOT CHORD 4-5=-405/408

- NOTES-**
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Provide adequate drainage to prevent water ponding.
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6 except (jt=lb) 4=248, 5=190.
  - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 4.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	143385071
2523941	LG7	GABLE	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:18 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-SrvNzs\_7ZvJHDAJVyh4GbxslruJJdAMnecTdBAyP7aR

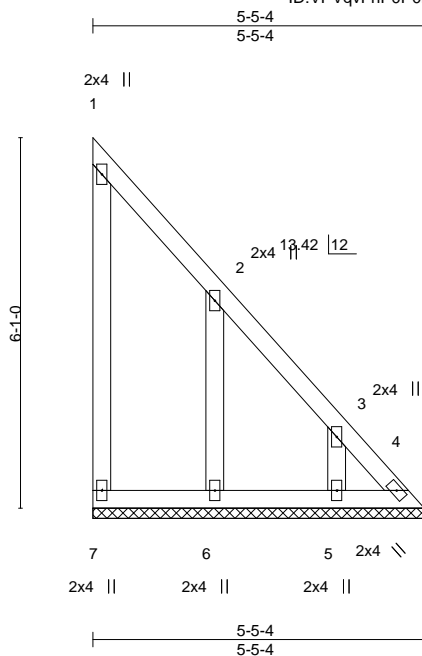

Scale = 1:37.8

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.27	in (loc) l/defl L/d	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.05	Vert(LL) n/a - n/a 999		
TCDL 10.0	Lumber DOL 1.15	WB 0.04	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	Matrix-P	Horz(CT) 0.00 4 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 26 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-5-4 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 5-5-4.  
(lb) - Max Horz 7=-194(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 7, 4, 6, 5  
Max Grav All reactions 250 lb or less at joint(s) 7, 4, 6, 5

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-291/296, 3-4=-391/391  
BOT CHORD 6-7=-265/274, 5-6=-265/274, 4-5=-265/274

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 4-4-11, Interior(1) 4-4-11 to 5-1-6 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 4, 6, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	LG8	GABLE	1	1	I43385072

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:20 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-OE18OY?O4WZ?SUSu366kgMy3KizY51M45vykF3yP7aP

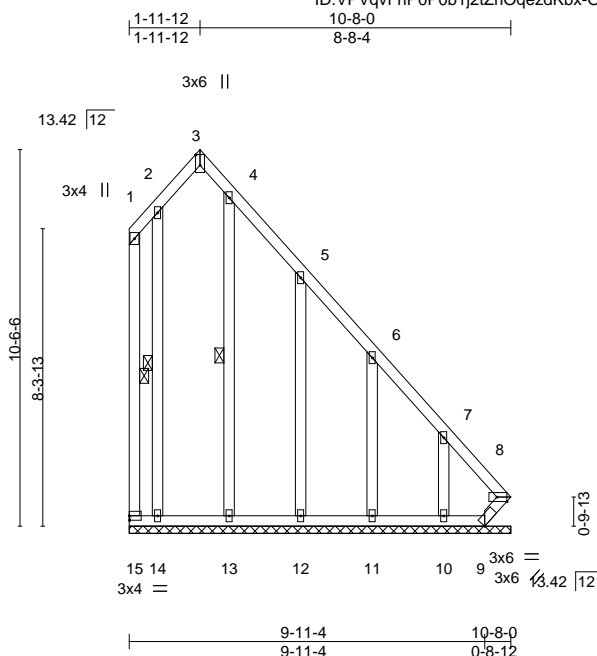

Scale: 3/16"=1'

Plate Offsets (X,Y)-- [3:Edge,0-1-8], [8:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.40	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr	YES	WB 0.20	Horz(CT)	0.00	8	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-S							
BCDL 10.0									Weight: 76 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:  
9-11-5 oc bracing: 14-15  
6-0-0 oc bracing: 8-9.  
WEBS 1 Row at midpt 1-15, 2-14, 4-13

**REACTIONS.** All bearings 10-8-0.  
(lb) - Max Horz 15=-329(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 11, 10 except 15=-115(LC 14), 8=-430(LC 13), 9=-291(LC 10), 13=-172(LC 12), 12=-134(LC 14)  
Max Grav All reactions 250 lb or less at joint(s) 15, 14, 12, 11, 10 except 8=545(LC 10), 9=264(LC 13), 13=263(LC 24)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-15=-366/397, 1-2=-356/392, 4-5=-265/255, 5-6=-269/259, 6-7=-364/368, 7-8=-475/471  
BOT CHORD 14-15=-329/340, 13-14=-329/340, 12-13=-329/340, 11-12=-329/340, 10-11=-329/340, 9-10=-329/340, 8-9=-539/549  
WEBS 2-14=-313/241, 4-13=-253/203

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 1-11-12, Exterior(2R) 1-11-12 to 4-9-8, Interior(1) 4-9-8 to 10-5-11 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 10 except (jt=lb) 15=115, 8=430, 9=291, 13=172, 12=134.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	LG9	GABLE	1	1	143385073

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:21 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-sQbWbt00rqhs4e14dpdzDaUEF5JuqVVDKZiHnVyP7aO

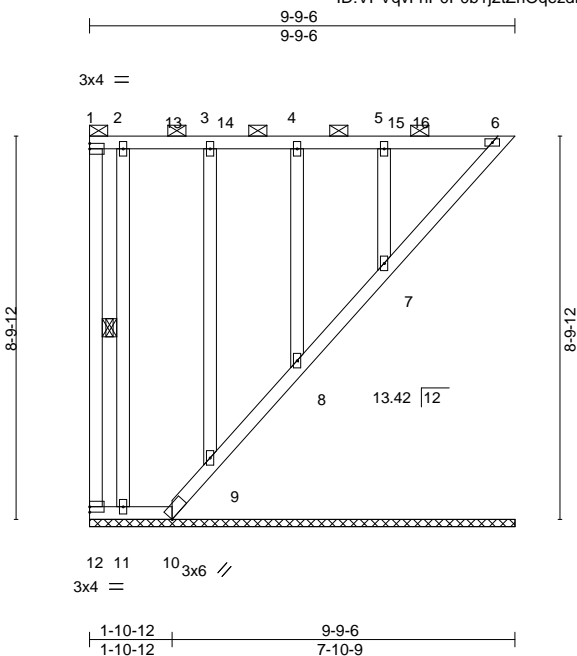

Scale = 1:53.0

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.39	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pt/Pg) 20.4/20.0	Lumber DOL 1.15	BC 0.18	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr YES	WB 0.15	Horz(CT)	0.00	6	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014	Matrix-S						Weight: 62 lb	FT = 20%
BCDL 10.0									

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.): 1-6, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
WEBS 1 Row at midpt 1-12, 2-11

#### REACTIONS.

All bearings 9-9-6.  
(lb) - Max Horz 12=-215(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 12, 9, 8, 7 except 6=-115(LC 14), 10=-135(LC 12), 11=-103(LC 14)  
Max Grav All reactions 250 lb or less at joint(s) 12, 6, 10, 11, 9, 8 except 7=251(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Corner(3) 0-1-12 to 3-1-12, Exterior(2) 3-1-12 to 6-5-7, Corner(3) 6-5-7 to 9-5-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 12, 9, 8, 7 except (jt=lb) 6=115, 10=135, 11=103.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 6, 9, 8, 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2523941	Truss LG10	Truss Type GABLE	Qty 1	Ply 1	Job Reference (optional) I43385074
----------------	---------------	---------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:03 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrOqezdKbx-OzVipkoj5lQPwfca1JlUnlEVrBfcNOaBmLK9YyP7ag

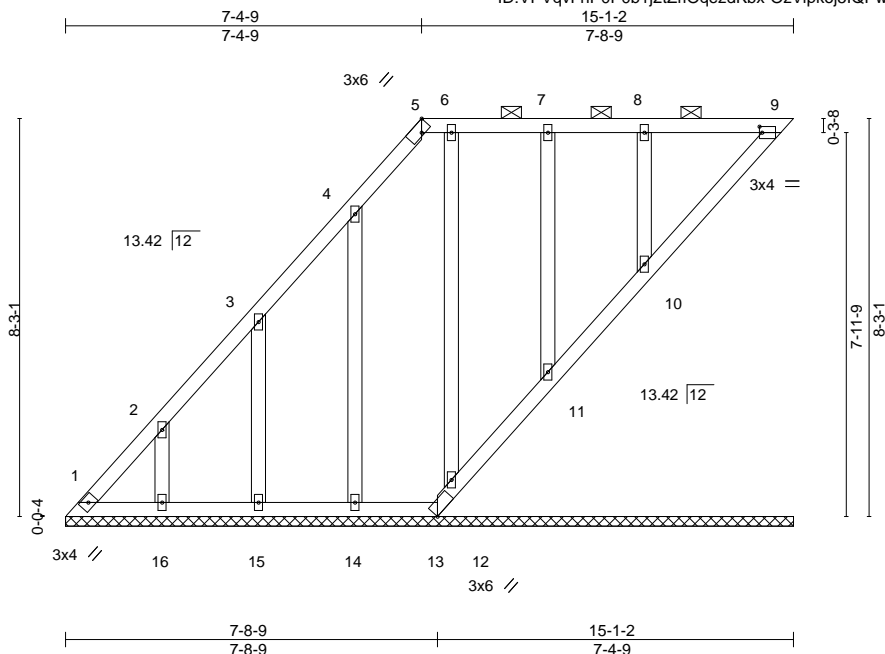


Plate Offsets (X,Y)-- [5:0-2-10,Edge], [9:0-0-10,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr	YES	WB 0.13	Horz(CT)	-0.00	9	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-S						Weight: 73 lb	FT = 20%
BCDL 10.0										

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-9.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 15-1-2.  
(lb) - Max Horz 1=223(LC 14)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 13, 16, 15, 14, 12, 11, 10  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 13, 16, 15, 14, 12, 11 except 10=263(LC 2)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=290/262

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-3-15 to 3-3-15, Interior(1) 3-3-15 to 7-4-9, Exterior(2R) 7-4-9 to 10-4-9, Interior(1) 10-4-9 to 14-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 13, 16, 15, 14, 12, 11, 10.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 9, 12, 11, 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2523941	Truss LG11	Truss Type GABLE	Qty 1	Ply 1	Job Reference (optional) I43385075
----------------	---------------	---------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:05 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-KLdTEPqzcvg79Ap?hSLDaCqaGftS4HCsf4qRDRyP7ae

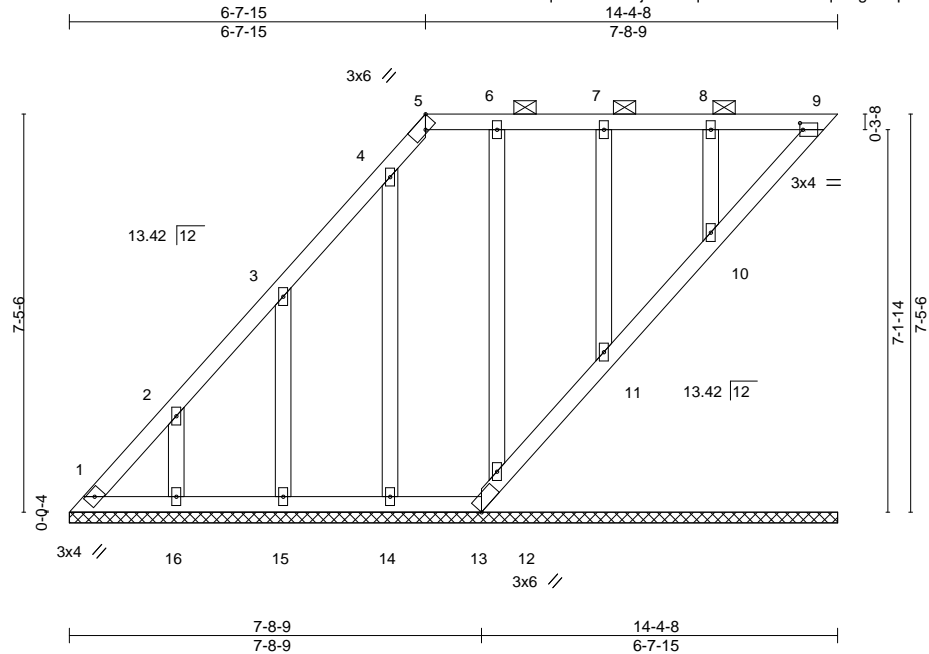

Scale = 1:43.1

Plate Offsets (X,Y)-- [5:0-2-10,Edge], [9:0-0-10,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr	YES	WB 0.10	Horz(CT)	-0.00	9	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-S							
BCDL 10.0									Weight: 68 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-9.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 14-4-8.  
(lb) - Max Horz 1=200(LC 14)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 13, 16, 15, 14, 12, 11, 10  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 13, 16, 15, 14, 12, 11, 10


#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-269/243

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-3-15 to 3-3-15, Interior(1) 3-3-15 to 6-7-15, Exterior(2R) 6-7-15 to 9-7-15, Interior(1) 9-7-15 to 14-1-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 13, 16, 15, 14, 12, 11, 10.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 9, 12, 11, 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

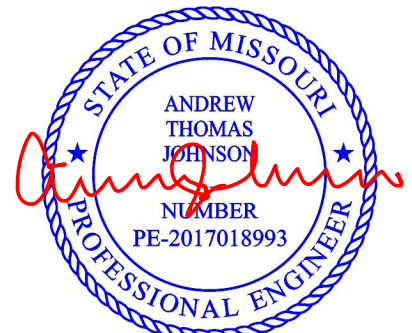

October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss LG12	Truss Type GABLE	Qty 1	Ply 1	143385076
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:07 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZr1OqezdKbx-HkIDf5rE8WwrPUzOptNhfvdwtSZ1YCt96OJYJyP7ac

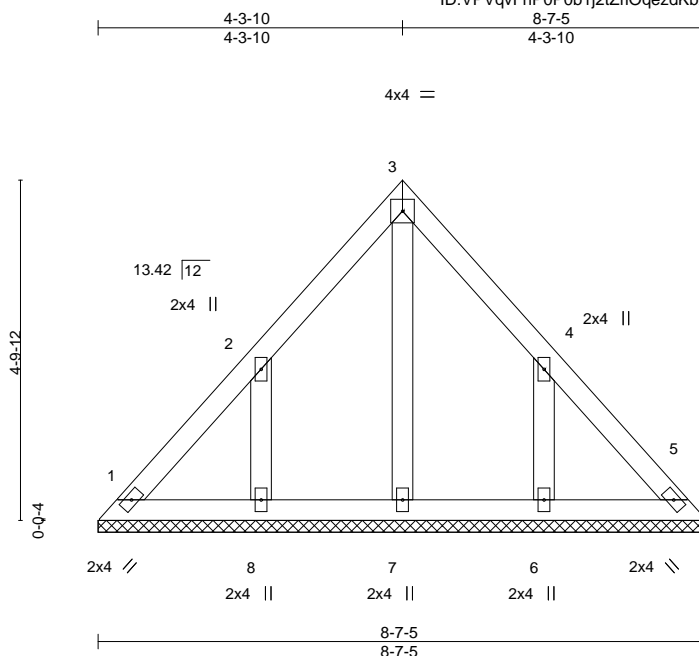

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.07	Vert(LL)	n/a	-	n/a	MT20	197/144
Snow (Pt/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00	5	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-P					Weight: 33 lb	FT = 20%
BCDL 10.0	Code IRC2018/TPI2014							

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 8-7-5.  
(lb) - Max Horz 1=-113(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 1 except 8=-104(LC 14), 6=-104(LC 14)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=253(LC 23), 6=253(LC 24)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-3-15 to 3-3-15, Interior(1) 3-3-15 to 4-3-10, Exterior(2R) 4-3-10 to 7-3-10, Interior(1) 7-3-10 to 8-3-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=104, 6=104.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss LG14	Truss Type GABLE	Qty 1	Ply 1	143385077
----------------	---------------	---------------------	----------	----------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:09 2020 Page 1


ID:VPVqvFnP0P0b1j2tZnIOeqzdKbx-D7s\_4ntUg8AYeo7mwlQ9k2?HXGEa06QSaiofMCyP7aa

3-10-6  
3-10-6

7-8-13  
3-10-6

4x4 =

Scale = 1:29.6

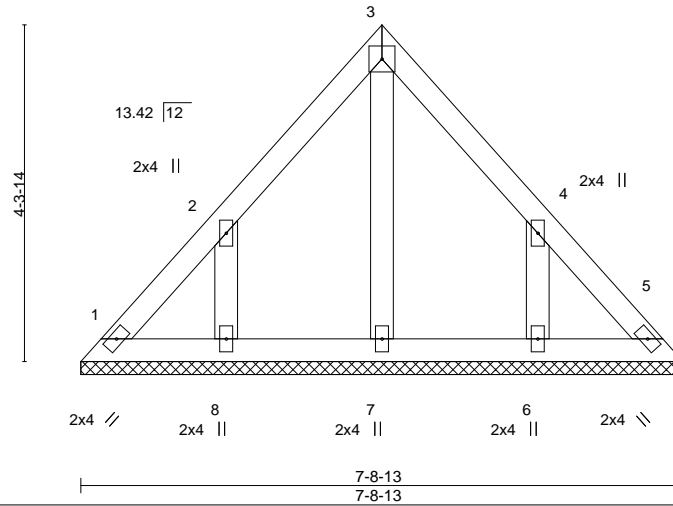

LOADING (psf)	SPACING-	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.02	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Lumber DOL 1.15	WB 0.03	Horz(CT)	0.00	5	n/a	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-P							
BCDL 10.0	Code IRC2018/TPI2014							Weight: 29 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 7-8-13.  
(lb) - Max Horz 1=101(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 8, 6  
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7, 8, 6

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-3-15 to 3-3-15, Interior(1) 3-3-15 to 3-10-6, Exterior(2R) 3-10-6 to 6-10-6, Interior(1) 6-10-6 to 7-4-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 8, 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	143385078
2523941	M1	Common Supported Gable	1	1	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:22 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-Ld9upD1ec7piocGBX9Cmn1PAVYfZpZNZDRrKxyP7aN

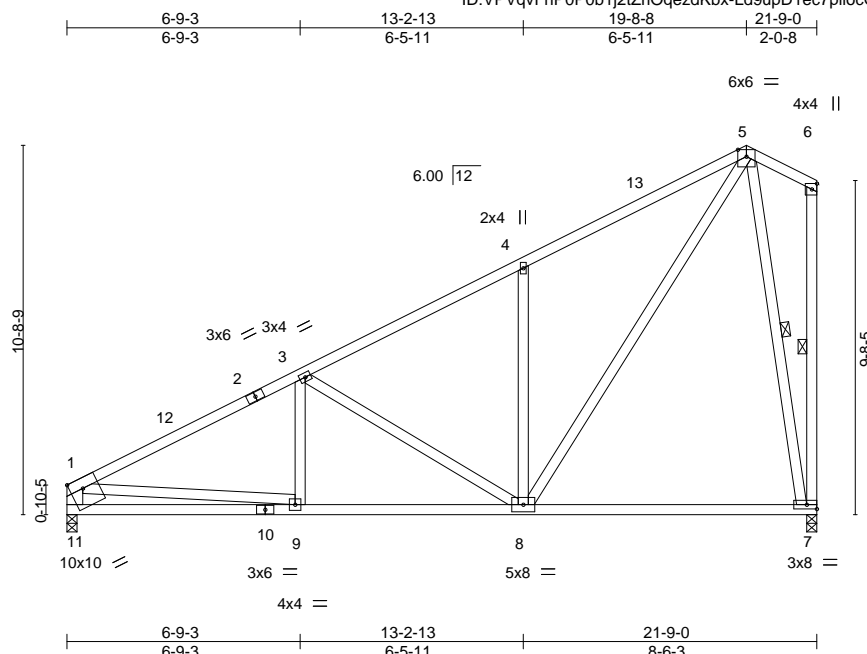

Scale = 1:66.8

Plate Offsets (X,Y)-- [11:0-2-7,0-1-4], [11:Edge,0-3-8]

<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.45	-0.14	7-8	>999	240	MT20	197/144
Snow (Pf/Pg)	15.4/20.0	Lumber DOL	1.15	BC	0.53	-0.29	7-8	>896	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.74	0.02	7	n/a	n/a		
BCLL	0.0	Code IRC2018/TPI2014		Matrix-AS							
BCDL	10.0									Weight: 117 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2 \*Except\*  
1-11: 2x6 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 6-7, 5-7

**REACTIONS.** (size) 11=0-3-8, 7=0-3-8  
Max Horz 11=346(LC 15)  
Max Uplift 11=68(LC 16), 7=88(LC 16)  
Max Grav 11=962(LC 2), 7=962(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-3=-1422/227, 3-4=-923/213, 4-5=-933/339, 1-11=-893/172  
BOT CHORD 9-11=-506/540, 8-9=-436/1184  
WEBS 3-8=-526/177, 4-8=-478/207, 5-8=-277/1080, 5-7=-886/410, 1-9=-48/803

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-2-12 to 3-2-12, Interior(1) 3-2-12 to 19-8-8, Exterior(2E) 19-8-8 to 21-7-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.0; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 7.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	143385079
2523941	M2	Hip	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:23 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-ppjG0Z2GNRxxZKxBSIEgRI?az1vsqILBWotBOsOyP7aM

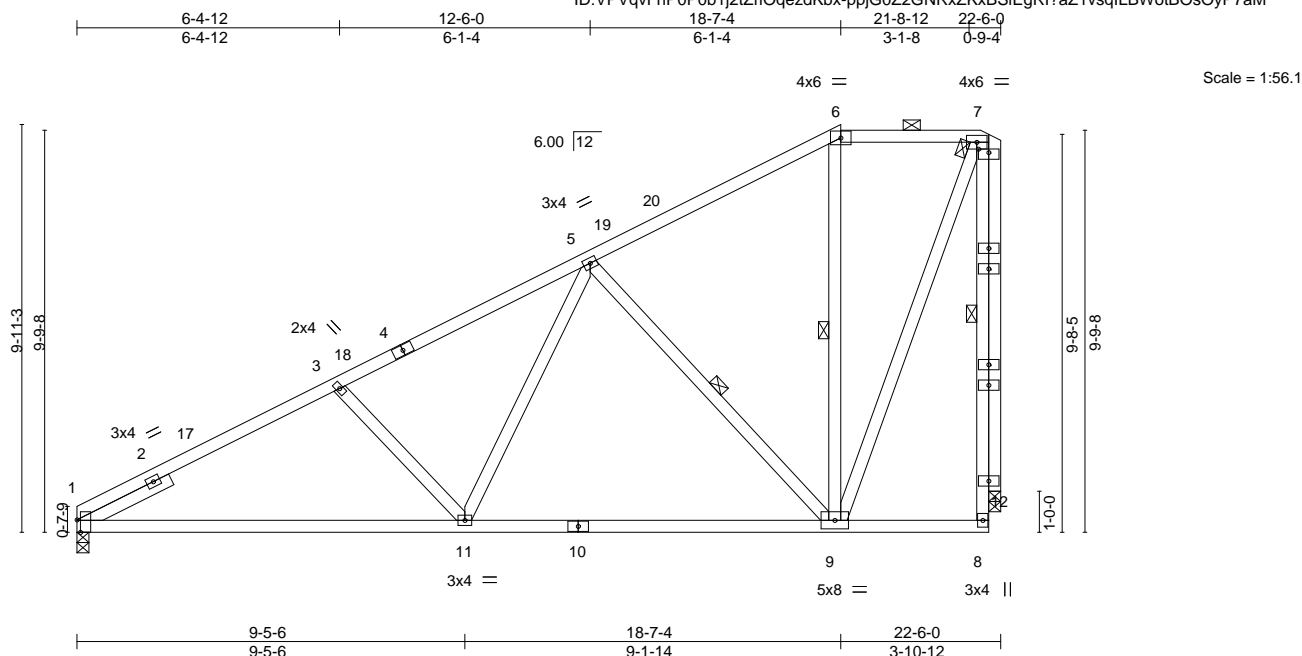


Plate Offsets (X,Y)-- [1:0-3-10,Edge], [7:0-3-0,0-1-0]									
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.50	Vert(LL)	-0.12 9-11	>999	240
Snow (Pf/Pg)	20.4/20.0	Lumber DOL	1.15	BC	0.67	Vert(CT)	-0.25 9-11	>999	180
TCDL	10.0	Rep Stress Incr	YES	WB	0.39	Horz(CT)	0.03 12	n/a	n/a
BCLL	0.0	Code IRC2018/TPI2014		Matrix-AS					
BCDL	10.0								
								<b>PLATES</b>	<b>GRIP</b>
								MT20	197/144
								Weight: 121 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 5-9, 6-9, 7-8

**REACTIONS.** (size) 1=0-3-8, 12=0-3-8  
Max Horz 1=329(LC 15)  
Max Uplift 1=70(LC 16), 12=101(LC 13)  
Max Grav 1=993(LC 2), 12=993(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-3=-1541/209, 3-5=-1373/206, 5-6=-523/174, 6-7=-353/180, 7-12=-980/202  
BOT CHORD 1-11=-383/1369, 9-11=-279/933  
WEBS 3-11=-384/136, 5-11=-30/528, 5-9=-867/178, 7-9=-217/992

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 18-7-4, Exterior(2E) 18-7-4 to 22-0-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - Provide adequate drainage to prevent water ponding.
  - All plates are 3x6 MT20 unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 12=101.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	
2523941	M3	Roof Special Girder	1	2	143385080

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:27 2020 Page 1
ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-haynsx5nRgR?oZVE\_4kNTrkBbWDgE236iV9c?9yP7al

0-11-0
4-0-0
7-1-12
10-3-8
12-0-0
16-9-12
21-7-8
26-5-4
32-4-0

0-11-0
4-0-0
3-1-12
3-1-12
1-8-8
4-9-12
4-9-12
4-9-12
5-10-12

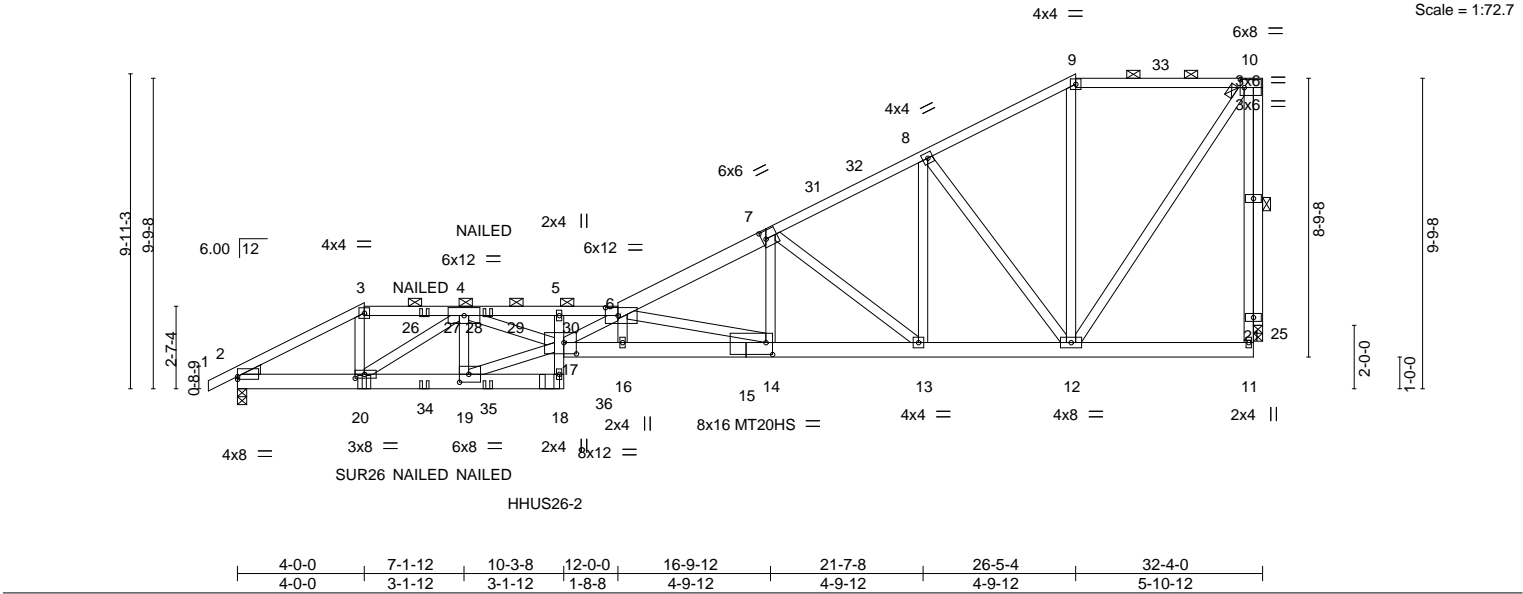


Plate Offsets (X,Y)-- [2:0-0-0,0-1-1], [6:0-4-12,0-3-0], [7:0-1-8,0-3-0], [10:0-1-8,0-3-0], [15:0-0-0,0-2-12], [15:0-2-8,0-4-8], [17:0-4-12,0-4-4], [19:0-3-8,0-3-0], [20:0-3-8,0-1-8]															
LOADING (psf)		SPACING--		2-0-0		CSI.		DEFL.		in (loc) l/defl L/d		PLATES		GRIP	
TCLL (roof) 25.0		Plate Grip DOL		1.15		TC 0.72		Vert(LL)		-0.49 16 >789		240		MT20 197/144	
Snow (Pf/Pg) 20.4/20.0		Lumber DOL		1.15		BC 0.74		Vert(CT)		-0.87 16 >444		180		MT20HS 148/108	
TCDL 10.0		Rep Stress Incr		NO		WB 0.85		Horz(CT)		0.12 25 n/a		n/a			
BCLL 0.0		Code IRC2018/TPI2014				Matrix-MS									
BCDL 10.0														Weight: 383 lb FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied or 5-11-14 oc purlins, except end verticals, and 2-0-0 oc purlins (3-4-15 max.): 3-6, 9-10.
3-6: 2x4 SPF 1650F 1.5E, 6-7: 2x6 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
BOT CHORD 2x6 SPF 2100F 1.8E *Except*	WEBS 1 Row at midpt 10-25
2-18: 2x6 SPF No.2	
WEBS 2x4 SPF No.2 *Except*	
5-18: 2x4 SPF 1650F 1.5E	
OTHERS 2x4 SPF No.2	
WEDGE	
Left: 2x4 SP No.3	

**REACTIONS.** (size) 2=0-3-8, 25=0-3-8  
Max Horz 2=254(LC 12)  
Max Uplift 2=228(LC 12), 25=188(LC 12)  
Max Grav 2=2350(LC 38), 25=1692(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-3=-3923/357, 3-4=-3345/327, 4-5=-12315/1113, 5-6=-12863/1166, 6-7=-5099/371, 7-8=-2589/188, 8-9=-1260/112, 9-10=-1038/120  
BOT CHORD 2-20=-515/3445, 19-20=-692/5887, 18-19=-76/767, 16-17=-1218/12346, 14-16=-1204/12245, 13-14=-478/4588, 12-13=-236/2228  
WEBS 17-18=-64/747, 3-20=-107/1583, 4-20=-3070/222, 4-19=-1291/217, 17-19=-647/5372, 4-17=-647/6900, 6-17=-423/984, 6-16=-853/119, 6-14=-8102/756, 7-14=-181/2485, 7-13=-2931/301, 8-13=-132/1718, 8-12=-1961/223, 10-12=-198/1755, 10-25=-1693/188

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-8-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs

Continued on page 2



October 28,2020

Job	Truss	Truss Type	Qty	Ply	I43385080
2523941	M3	Roof Special Girder	1	2	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:27 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrlOqezdKbx-haynsx5nRgR?oZVE\_4kNTrkBbWDgE236iV9c?9yP7al

- NOTES-**
- 8) Provide adequate drainage to prevent water ponding.
  - 9) All plates are MT20 plates unless otherwise indicated.
  - 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 11) Bearing at joint(s) 25 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - 12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=228, 25=188.
  - 13) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 15) Use Simpson Strong-Tie SUR26 (6-10d Girder, 6-10dx1 1/2 Truss) or equivalent at 4-0-0 from the left end to connect truss(es) to back face of bottom chord, skewed 45.0 deg.to the right, sloping 0.0 deg. down.
  - 16) Use Simpson Strong-Tie HHUS26-2 (14-10d Girder, 4-10d Truss) or equivalent at 9-10-2 from the left end to connect truss(es) to back face of bottom chord.
  - 17) Fill all nail holes where hanger is in contact with lumber.
  - 18) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

- LOAD CASE(S)** Standard
- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
    - Uniform Loads (plf)
      - Vert: 1-3=-51, 3-6=-61, 6-9=-51, 9-10=-61, 18-22=-20, 11-17=-20
    - Concentrated Loads (lb)
      - Vert: 20=-263(B) 27=-71(B) 29=-71(B) 34=-25(B) 35=-25(B) 36=-707(B)



Job	Truss	Truss Type	Qty	Ply	I43385081
2523941	M4	Roof Special	1	1	
Job Reference (optional)					

- NOTES-**
- 11) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 12) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Job	Truss	Truss Type	Qty	Ply	
2523941	M5	Roof Special	1	1	I43385082

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:31 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-aLCIhI8HVuyRHAo?DwpJdhvsx7XEArJhd77p8wyP7aE

-0-11-0	4-2-10	8-1-12	10-3-8	16-1-12	22-5-4	27-2-14	32-4-0
0-11-0	4-2-10	3-11-2	2-1-12	5-10-4	6-3-8	4-9-10	5-1-2

Scale = 1:65.9

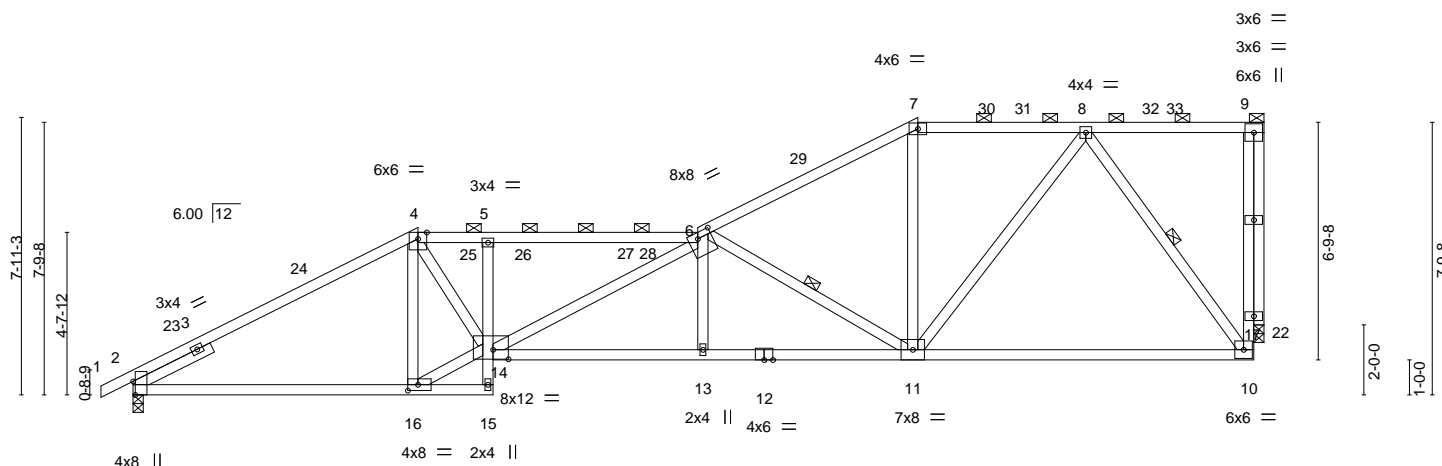


Plate Offsets (X,Y)--	8-1-12	10-3-8	16-1-12	22-5-4	32-4-0
	8-1-12	2-1-12	5-10-4	6-3-8	9-10-12

<b>LOADING</b> (psf)	<b>SPACING</b>	<b>CSI</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof) 25.0	2-0-0	TC 0.76	in (loc) l/defl L/d	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.95	Vert(LL) -0.24 10-11 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.89	Vert(CT) -0.52 10-11 >742 180		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.12 22 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 153 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (2-6-5 max.): 4-6, 7-9.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
OTHERS 2x4 SPF No.2	WEBS 1 Row at midpt 6-11, 8-10
SLIDER Left 2x4 SPF No.2 2-6-0	

**REACTIONS.** (size) 2=0-3-8, 22=0-3-8  
Max Horz 2=197(LC 16)  
Max Uplift 2=-122(LC 16), 22=-138(LC 16)  
Max Grav 2=1513(LC 2), 22=1421(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-2268/272, 4-5=-2986/393, 5-6=-3054/405, 6-7=-1853/219, 7-8=-1562/234,  
10-17=-161/1270, 9-17=-161/1270  
BOT CHORD 2-16=-403/2037, 5-14=-552/75, 13-14=-528/3465, 11-13=-526/3469, 10-11=-158/935  
WEBS 4-16=-803/206, 14-16=-398/2147, 4-14=-220/1869, 6-14=-493/3, 6-11=-2172/321,  
7-11=0/456, 8-11=-146/1032, 8-10=-1448/244, 9-22=-1424/193

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 8-1-12, Exterior(2R) 8-1-12 to 11-1-12, Interior(1) 11-1-12 to 22-5-4, Exterior(2R) 22-5-4 to 25-5-4, Interior(1) 25-5-4 to 31-10-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCCL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
  - Unbalanced snow loads have been considered for this design.
  - This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 22 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=122, 22=138.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheathing be applied directly to the bottom chord.



October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	I43385082
2523941	M5	Roof Special	1	1	

**NOTES-**  
 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:34 2020 Page 1  
 ID:VPVqFnP0P0b1j2ZrIQezdKbx\_wtQKKAAnpK?8eXau2M0fJXOyLaLNDU8J5LTiFYp7Ab  
 -0-11-0 5-2-10 10-1-12 18-1-12 21-2-0 21-10-12 26-11-10 32-4-0  
 0-11-0 5-2-10 4-11-2 8-0-0 3-0-4 0-8-12 5-0-14 5-4-6  
 Scale = 1:61.7

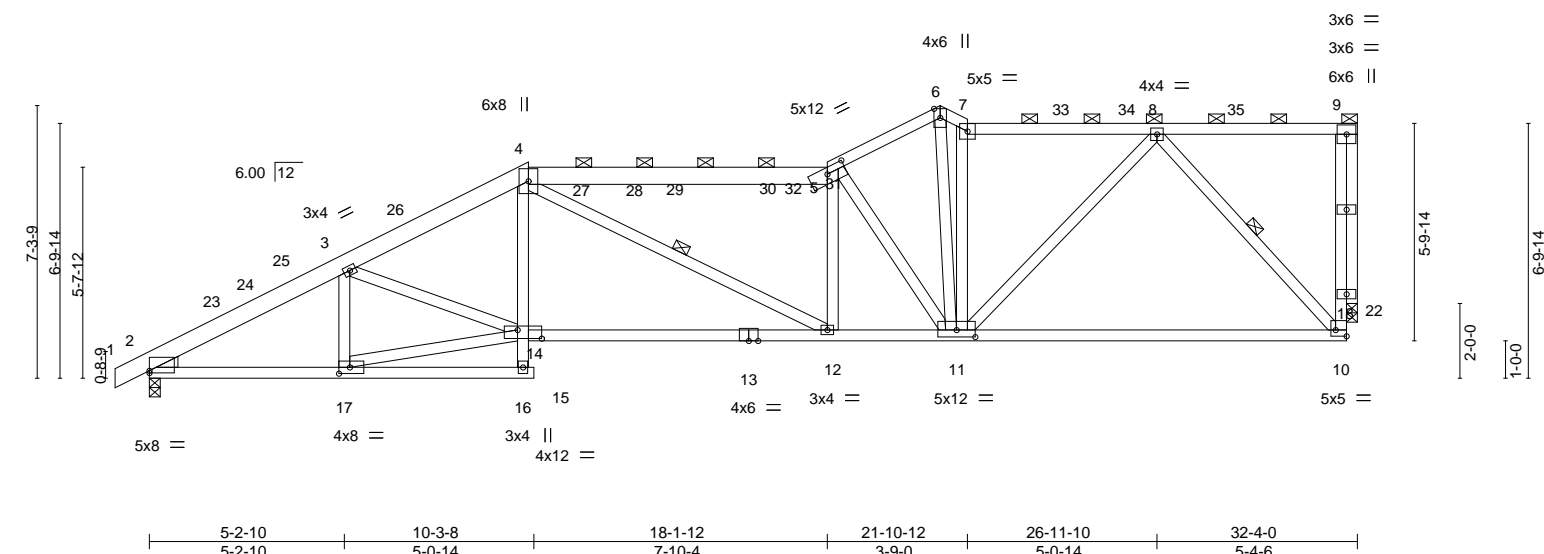


Plate Offsets (X,Y)-- [2:0-0-0,0-0-11], [5:0-6-0,0-2-0], [10:Edge,0-2-0], [11:0-6-0,0-2-4], [14:0-7-12,0-2-12], [17:0-3-8,0-2-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL (roof)	25.0	Plate Grip DOL	1.15	TC	0.65	Vert(LL)	-0.30 10-11 >999 240	MT20	197/144
Snow (Pf/Pg)	20.4/20.0	Lumber DOL	1.15	BC	0.86	Vert(CT)	-0.63 10-11 >610 180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.80	Horz(CT)	0.09 22 n/a n/a		
BCLL	0.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 172 lb	FT = 20%
BCDL	10.0								

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2 *Except* 1-4,4-5: 2x6 SPF No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-5-2 max.): 4-5, 7-9.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied. Except: 10-0-0 oc bracing: 14-16
WEBS	2x4 SPF No.2	WEBS	1 Row at midpt 4-12, 8-10
OTHERS	2x4 SPF No.2		
WEDGE			
Left:	2x4 SP No.3		

**REACTIONS.** (size) 2=0-3-8, 22=0-3-8  
 Max Horz 2=172(LC 16)  
 Max Uplift 2=-127(LC 16), 22=-132(LC 16)  
 Max Grav 2=1517(LC 2), 22=1473(LC 43)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-251/1273, 3-4=-2693/366, 4-5=-2645/348, 5-6=-1969/263, 6-7=-2034/293,  
7-8=-1881/267, 10-18=-155/1288, 9-18=-155/1288

BOT CHORD 2-17=-420/2131, 4-14=-22/546, 12-14=-434/2421, 11-12=-412/2640, 10-11=-190/1175


WEBS 3-17=-388/130, 4-17=-381/2057, 3-14=-14/439, 4-12=-17/334, 5-11=-151/251,  
6-11=-195/1723, 7-11=-1090/162, 8-11=-129/1038, 8-10=-1588/261, 9-22=-1477/188

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 10-0-0, Exterior(2R) 10-0-0 to 13-0-0, Interior(1) 13-0-0 to 21-2-0, Exterior(2E) 21-2-0 to 21-10-12, Interior(1) 21-10-12 to 31-10-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) Bearing at joint(s) 22 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=127, 22=132.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and conforms to standard ANSI/TPI 1.



October 28, 2020

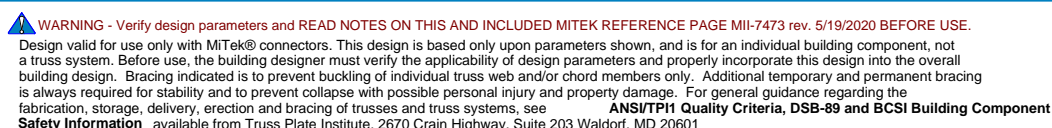

Job	Truss	Truss Type	Qty	Ply	I43385083
2523941	M6	Roof Special	1	1	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:34 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-\_wtQKKAAnpK?8eXau2M0FJXOyLaLNDU8J5LTIFyP7aB

- NOTES-**
- 11) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - 12) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Job	Truss	Truss Type	Qty	Ply	
2523941	M6A	Roof Special	1	1	I43385084


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:37 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdkbx-PVZZyMD24kia?5G9ZAwjty9ujYdracHa03a8MayP7a8

-0-11-0	5-3-8	10-3-8	10-8-12	18-8-12	21-2-0	23-10-12	27-11-10	32-4-0
0-11-0	5-3-8	5-0-0	0-5-4	8-0-0	2-5-4	2-8-12	4-0-14	4-4-6

Scale = 1:60.6

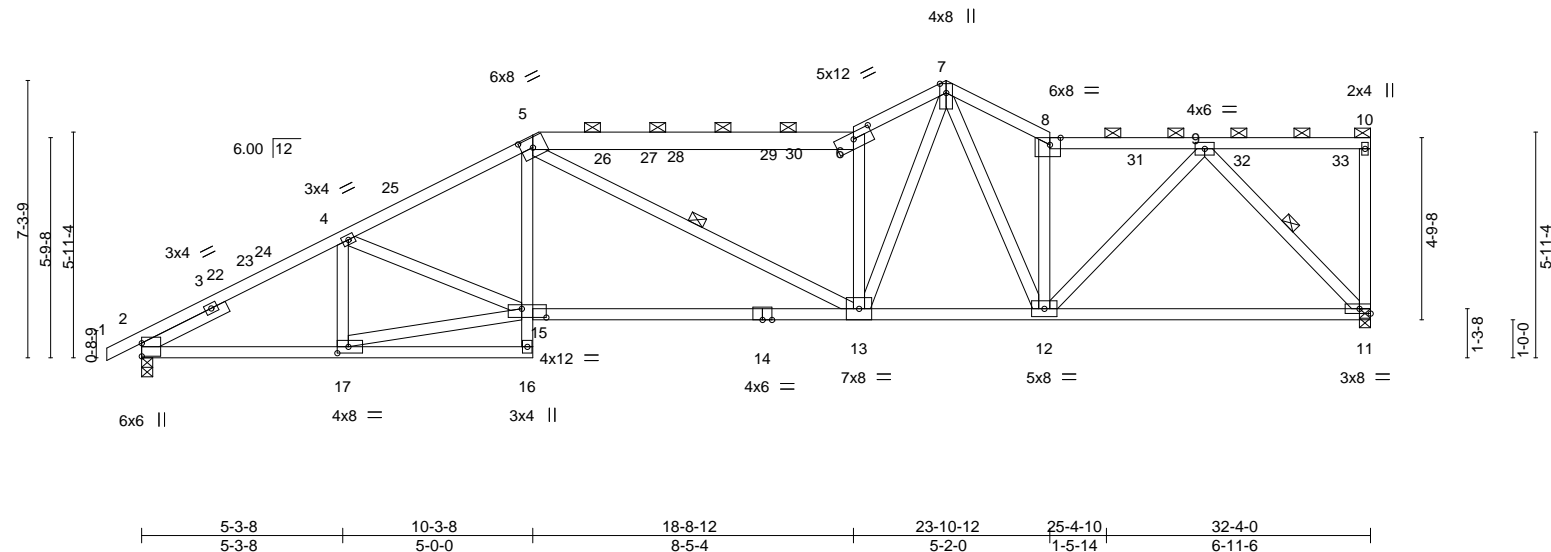

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.74	Vert(LL)	-0.20 13-15	>999	240	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.75	Vert(CT)	-0.47 13-15	>818	180		
TCDL 10.0	Rep Stress Incr	YES	WB 0.67	Horz(CT)	0.11 11	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-AS						
BCDL 10.0								Weight: 159 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
5-6: 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-2-4 max.): 5-6, 8-10.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 5-13, 9-11

#### REACTIONS.

(size) 2=0-3-8, 11=0-3-8  
Max Horz 2=197(LC 15)  
Max Uplift 2=143(LC 16), 11=120(LC 16)  
Max Grav 2=1514(LC 2), 11=1448(LC 2)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2400/309, 4-5=-2588/364, 5-6=-2462/357, 6-7=-2773/429, 7-8=-2259/355, 8-9=-2006/290  
BOT CHORD 2-17=-444/2080, 5-15=-29/544, 13-15=-453/2317, 12-13=-305/1764, 11-12=-221/1186  
WEBS 4-17=-385/132, 15-17=-400/2007, 4-15=-6/346, 5-13=-79/251, 6-13=-1613/294, 7-13=-272/1791, 9-12=-142/1197, 9-11=-1691/277, 8-12=-1206/219, 7-12=-90/546

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=32ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-3-13, Interior(1) 2-3-13 to 10-1-12, Exterior(2R) 10-1-12 to 13-4-9, Interior(1) 13-4-9 to 21-2-0, Exterior(2E) 21-2-0 to 23-10-12, Interior(1) 23-10-12 to 32-2-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=143, 11=120.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	M7	Roof Special	1	1	I43385085
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:40 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrOqezdKbx-p4EiaNFxNf49sZ\_kEJTQUanNVmffnvU0i1ooyvyP7a5

-0-11-0	4-6-2	8-8-12	10-3-8	16-8-12	20-8-12	21-7-4	25-10-12	32-4-0
0-11-0	4-6-2	4-2-10	1-6-12	6-5-4	4-0-0	0-10-8	4-3-8	6-5-4

Scale = 1:61.8

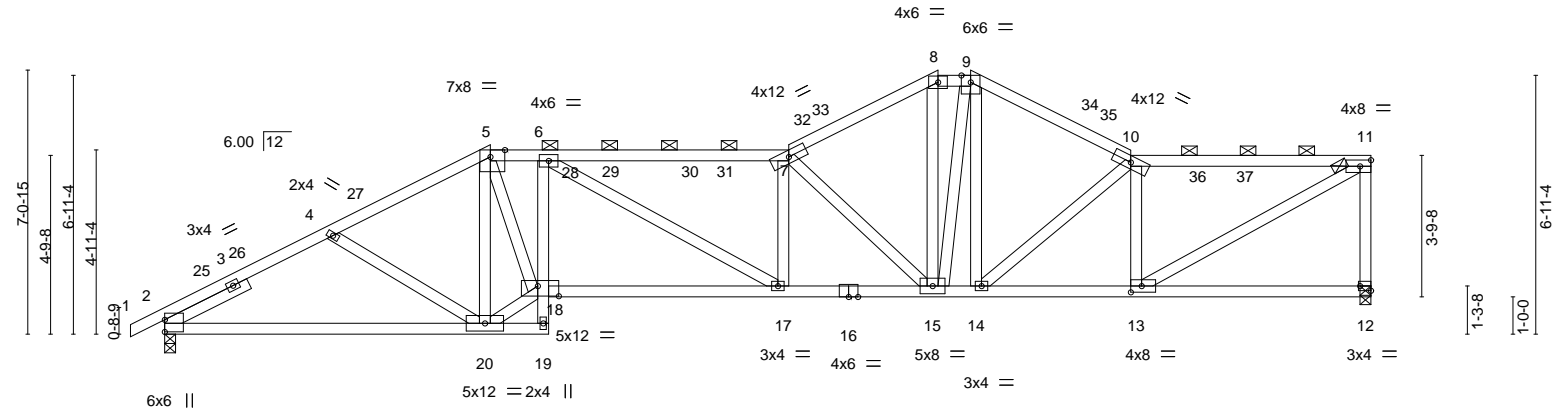

Job	Truss	Truss Type	Qty	Ply	
2523941	M8	Roof Special	1	1	I43385086

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:42 2020 Page 1

ID:VPVqVFnP0P0b1j2ZrIOqezdKbx-ITMS?3GBvHKt5s86MkWua?sn6ZGbFq3J9LHv1nyP7a3

-0-11-0	6-8-12	10-3-8	14-8-12	18-8-12	23-7-4	27-10-12	31-3-8	32-4-0
0-11-0	6-8-12	3-6-12	4-5-4	4-0-0	4-10-8	4-3-8	3-4-12	1-0-8

Scale = 1:61.1

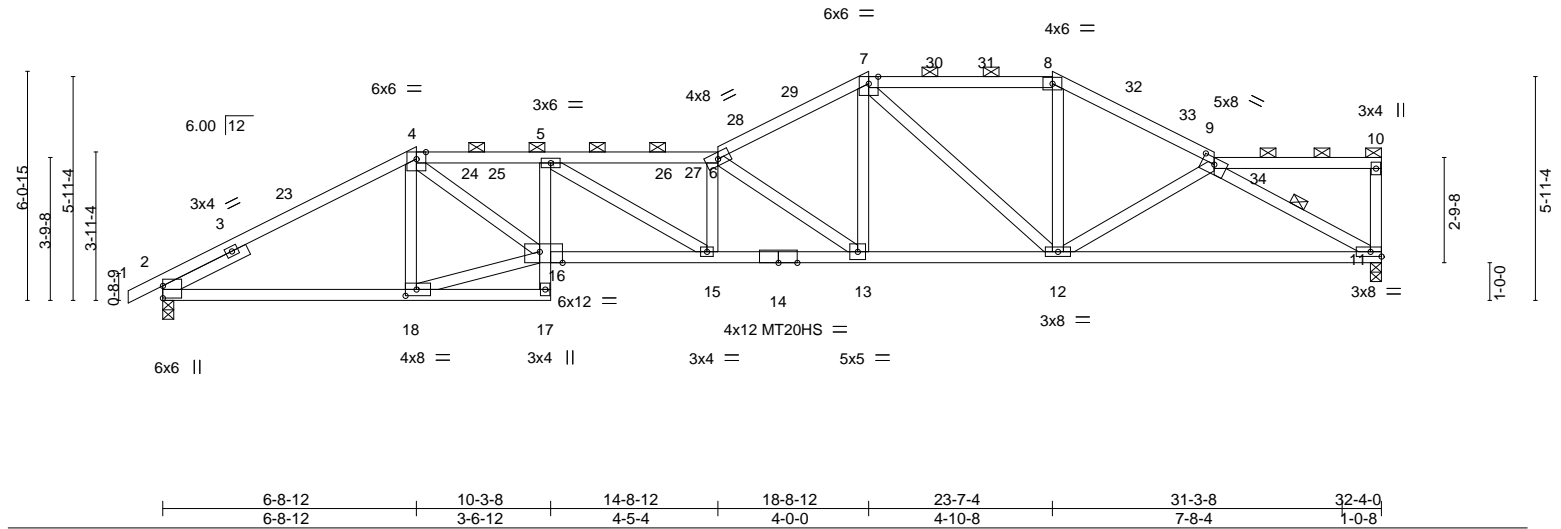


Plate Offsets (X,Y)-- [9:0-4-0,0-2-0], [16:0-7-4,Edge], [18:0-3-8,0-2-0]																			
<b>LOADING</b> (psf)		<b>SPACING-</b>		<b>2-0-0</b>		<b>CSI.</b>		<b>DEFL.</b>		<b>in (loc)</b>		<b>l/defl</b>		<b>L/d</b>		<b>PLATES</b>		<b>GRIP</b>	
TCLL (roof) 25.0		Plate Grip DOL 1.15		TC 0.64				Vert(LL) -0.31 15		>999		240				MT20		197/144	
Snow (Pf/Pg) 20.4/20.0		Lumber DOL 1.15		BC 0.97				Vert(CT) -0.56 15-16		>688		180				MT20HS		148/108	
TCDL 10.0		Rep Stress Incr YES		WB 0.89				Horz(CT) 0.18 11		n/a		n/a							
BCLL 0.0		Code IRC2018/TPI2014		Matrix-AS												Weight: 141 lb		FT = 20%	
BCDL 10.0																			

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (2-4-3 max.): 4-6, 7-8, 9-10.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x4 SPF No.2 2-6-0	WEBS 1 Row at midpt 9-11

**REACTIONS.** (size) 11=0-3-8, 2=0-3-8  
Max Horz 2=144(LC 15)  
Max Uplift 11=118(LC 16), 2=144(LC 16)  
Max Grav 11=1448(LC 2), 2=1514(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-2404/359, 4-5=-3806/573, 5-6=-4286/636, 6-7=-2824/453, 7-8=-1966/358, 8-9=-2282/364  
BOT CHORD 2-18=-392/2086, 5-16=-696/129, 15-16=-641/3880, 13-15=-693/4293, 12-13=-405/2434, 11-12=-356/2095  
WEBS 4-18=-507/144, 16-18=-376/1985, 4-16=-290/2154, 5-15=-57/484, 6-13=-2219/346, 7-13=-172/1353, 7-12=-734/130, 8-12=-48/659, 9-11=-2359/397

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=31ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-11-0 to 2-2-9, Interior(1) 2-2-9 to 6-8-12, Exterior(2R) 6-8-12 to 10-1-12, Interior(1) 10-1-12 to 18-8-12, Exterior(2R) 18-8-12 to 21-10-5, Interior(1) 21-10-5 to 23-7-4, Exterior(2R) 23-7-4 to 26-8-13, Interior(1) 26-8-13 to 32-2-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=118, 2=144.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




October 28,2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**MiTek**  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017

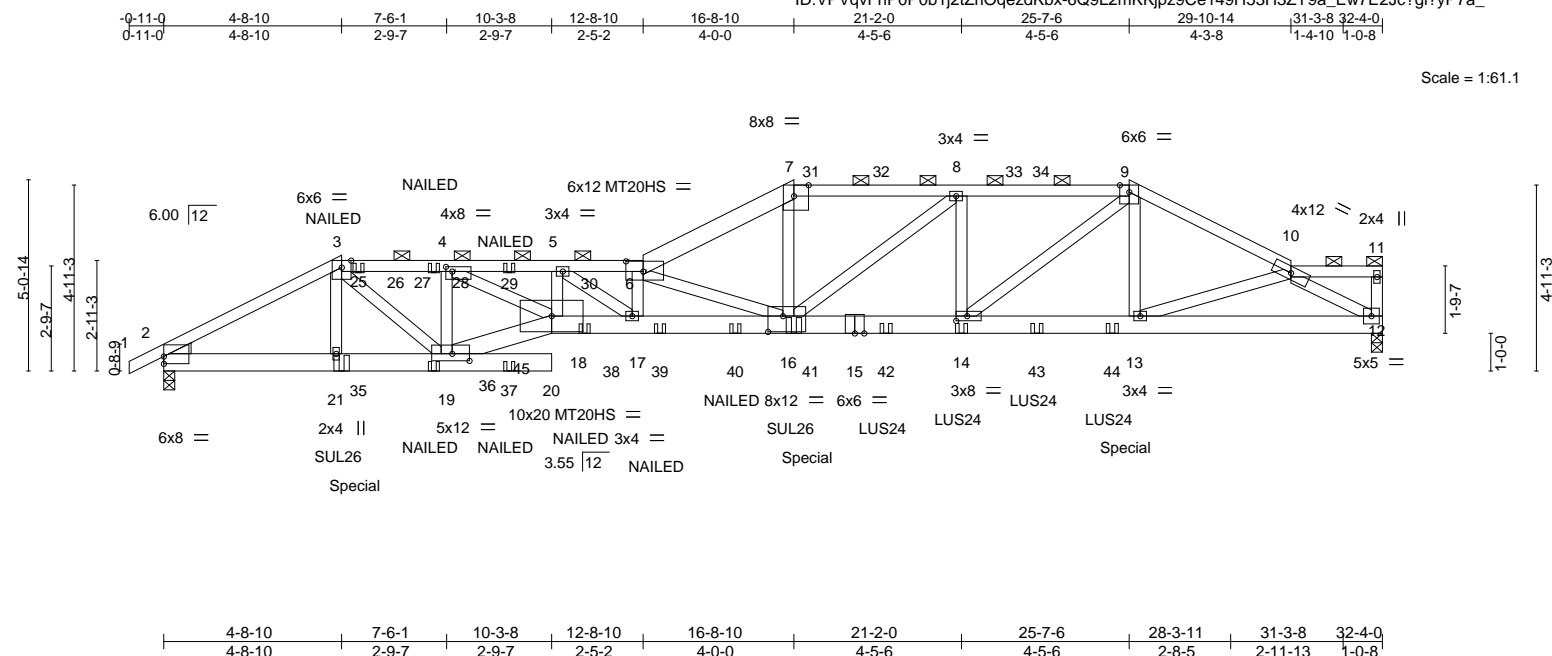

[illegible]

**LUMBER-**

TOP CHORD	2x4 SPF No.2 *Except* 3-6: 2x4 SPF 1650F 1.5E, 6-7: 2x6 SPF No.2
BOT CHORD	2x6 SPF No.2 *Except* 2-20,15-18: 2x6 SPF 2100F 1.8E
WEBS	2x4 SPF No.2 *Except* 4-18: 2x4 SPF 1650F 1.5E

WEDGE

Left: 2x4 SP No.3

## REACTIONS.

(size) 12=0-3-8, 2=0-3-8  
Max Horz 2=106(LC 11)  
Max Uplift 12=-530(LC 12), 2=-469(LC 12)  
Max Grav 12=3346(LC 41), 2=2982(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-5344/829, 3-4=-7551/1170, 4-5=-14754/2361, 5-6=-15968/2675, 6-7=-9621/1681,  
7-8=-8450/1499, 8-9=-7789/1341, 9-10=-6300/1058

BOT CHORD 2-21=-743/4756, 19-21=-727/4774, 17-18=-2350/14855, 16-17=-2665/16090,  
14-16=-1248/7786, 13-14=-869/5589, 12-13=-817/4958, 18-19=-1194/7963

WEBS 3-21=-3167/71, 3-19=-556/3799, 4-19=-4638/797, 7-16=-671/3987, 8-16=-202/955,  
4-18=-1019/209, 5-14=-488/2830, 9-13=-105/904, 10-13=-127/746, 10-12=-581/952,  
8-14=-863/8258, 9-18=-1086/270, 6-17=-1316/279, 6-16=-8064/1326, 5-17=-358/1420

**NOTES-**

- 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-4-0 oc, 2x6 - 2 rows staggered at 0-7-0 oc.  
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Unbalanced roof live loads have been considered for this design.
- 4) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=4.2psf; h=15ft; B=45ft; L=31ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 5) TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- 6) Unbalanced snow loads have been considered for this design.
- 7) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- 8) Provide adequate drainage to prevent water ponding.



October 28, 2020



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCS1 Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	I43385087
2523941	M9	Roof Special Girder	1	2	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:48 2020 Page 2  
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-adjjG6LyU750pnbGi\_clpG6jv\_KTfZUCYGkCDRyP7Zz

NOTES-

- 9) All plates are MT20 plates unless otherwise indicated.
- 10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 11) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=530, 2=469.
- 12) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 13) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 14) Use Simpson Strong-Tie SUL26 (6-10d Girder, 6-10dx1 1/2 Truss) or equivalent at 4-8-10 from the left end to connect truss(es) to front face of bottom chord, skewed 45.0 deg.to the left, sloping 0.0 deg. down.
- 15) Use Simpson Strong-Tie SUL26 (6-10d Girder, 6-10dx1 1/2 Truss) or equivalent at 16-8-10 from the left end to connect truss(es) to front face of bottom chord, skewed 45.0 deg.to the left, sloping 0.0 deg. down.
- 16) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 19-2-0 from the left end to 25-2-0 to connect truss(es) to front face of bottom chord.
- 17) Fill all nail holes where hanger is in contact with lumber.
- 18) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 19) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 44 lb down at 5-2-0, and 289 lb down and 71 lb up at 17-2-0, and 615 lb down and 119 lb up at 25-7-6 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
  - Uniform Loads (plf)
    - Vert: 1-3=-51, 3-6=-61, 6-7=-51, 7-9=-61, 9-10=-51, 10-11=-61, 19-22=-20, 19-20=-20, 12-18=-20, 18-19=-20
  - Concentrated Loads (lb)
    - Vert: 21=-273(F) 16=-615(F) 14=-289(F) 13=-615(F) 25=-104(F) 28=-101(F) 29=-101(F) 35=-36(F) 36=-36(F) 37=-36(F) 38=-155(F) 39=-11(F) 40=-25(F) 41=-289(F) 42=-289(F) 43=-289(F) 44=-289(F)

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	P1	Hip Girder	1	1	I43385088

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:49 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-2pH5TSMaFQDtRxASGi8YMuf5rOtMOBTLmwUlmtyP7Zy



Scale = 1:16.4

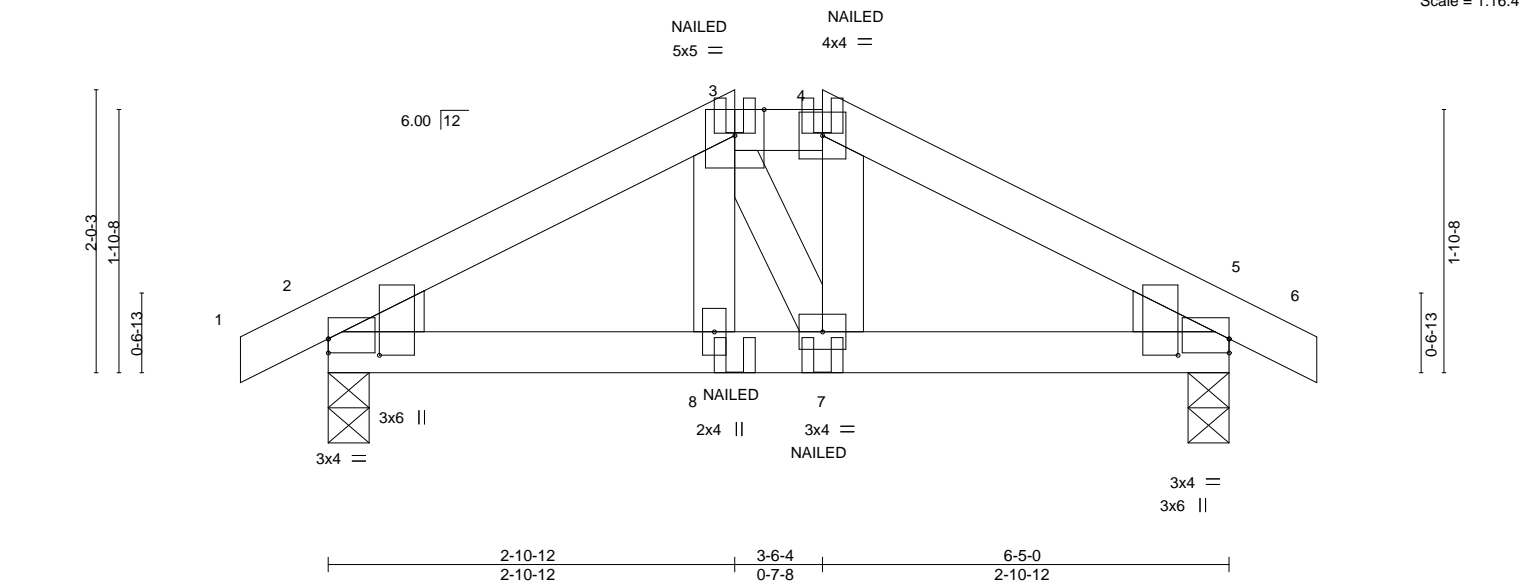


Plate Offsets (X,Y)--		[2:0-0-0,0-1-3], [2:0-1-6,0-4-6], [5:0-0-0,0-1-3], [5:0-1-6,0-4-6]	
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0
TCLL (roof)	25.0	Plate Grip DOL	1.15
Snow (Pf/Pg)	20.4/20.0	Lumber DOL	1.15
TCDL	10.0	Rep Stress Incr	NO
BCLL	0.0	Code IRC2018/TPI2014	
BCDL	10.0		
		<b>CSI.</b>	
		TC	0.09
		BC	0.13
		WB	0.02
		Matrix-MP	
		<b>DEFL.</b>	
		Vert(LL)	-0.00 8 >999 240
		Vert(CT)	-0.01 8-11 >999 180
		Horz(CT)	0.00 5 n/a n/a
		<b>PLATES</b>	MT20
		<b>GRIP</b>	197/144
		Weight:	23 lb
		FT =	20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 WEDGE  
 Left: 2x4 SPF No.2, Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 3-4.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-3-8, 5=0-3-8  
 Max Horz 2=32(LC 11)  
 Max Uplift 2=42(LC 12), 5=42(LC 12)  
 Max Grav 2=400(LC 35), 5=400(LC 35)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-416/36, 3-4=-331/43, 4-5=-417/36  
 BOT CHORD 2-8=-2/335, 7-8=-2/330, 5-7=0/336

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- TCCL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0 Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S)

- Standard  
 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-3=-51, 3-4=-61, 4-6=-51, 9-12=-20



October 28, 2020

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	I43385088
2523941	P1	Hip Girder	1	1	

**LOAD CASE(S)**
Standard


Concentrated Loads (lb)

Vert: 3=-30(B) 4=-30(B) 7=-14(B) 8=-14(B)

Job 2523941	Truss P2	Truss Type Common	Qty 3	Ply 1	Job Reference (optional) I43385089
----------------	-------------	----------------------	----------	----------	---------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:50 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-W?rUhoNC0kLk35IfqPfnuhBFVoCo7ezU?aDJIKyP7Zx



Scale = 1:17.0

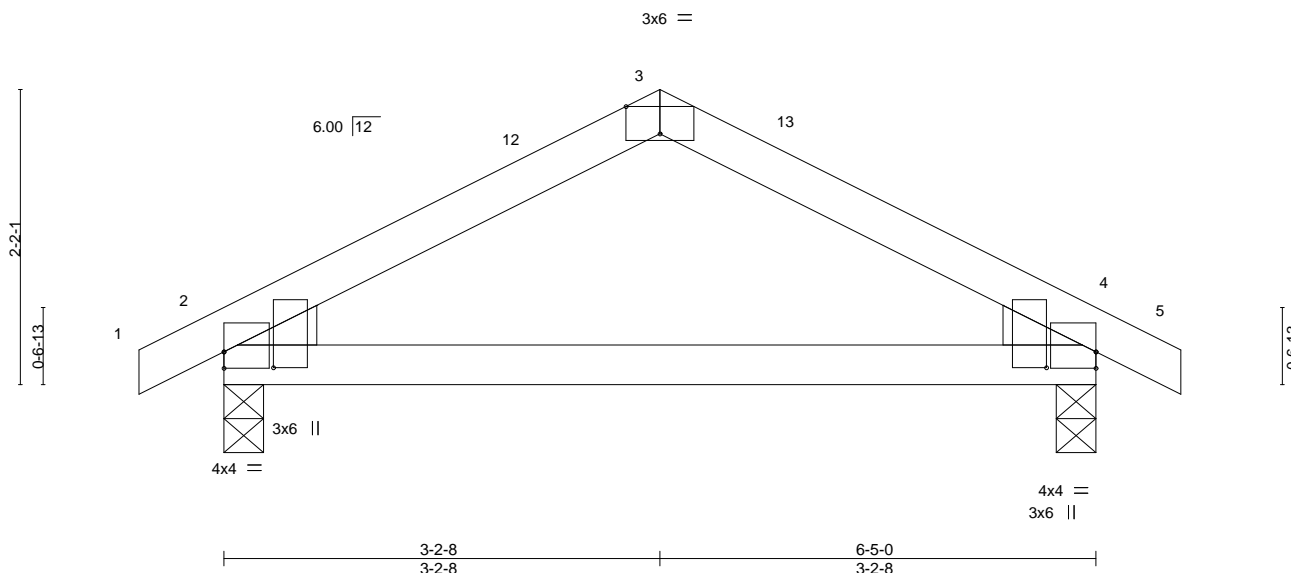


Plate Offsets (X,Y)-- [2:0-1-6,0-4-6], [2:0-0-0,0-1-7], [3:0-3-0,Edge], [4:Edge,0-1-7], [4:0-1-6,0-4-6]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	2-0-0	TC 0.16	Vert(LL) -0.02	8-11	>999	240	MT20	197/144
Snow (Pf/Pg) 15.4/20.0	Plate Grip DOL 1.15	BC 0.18	Vert(CT) -0.05	8-11	>999	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.00	Horz(CT) 0.00	2	n/a	n/a		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS						
BCDL 10.0	Code IRC2018/TPI2014						Weight: 19 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEDGE  
Left: 2x4 SPF No.2, Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 4=0-3-8  
Max Horz 2=37(LC 15)  
Max Uplift 2=-42(LC 16), 4=-42(LC 16)  
Max Grav 2=333(LC 2), 4=332(LC 2)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-263/163, 3-4=-263/163

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) -0-7-8 to 2-4-8, Interior(1) 2-4-8 to 3-2-8, Exterior(2R) 3-2-8 to 6-5-0, Interior(1) 6-5-0 to 7-0-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 15.4 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	
2523941	P3	Roof Special	1	1	I43385090

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:52 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-SOzE5UOSYLBsIPv1xqhFz6HarbsZbYDnSuiPMCyP7Zv

Job Reference (optional)

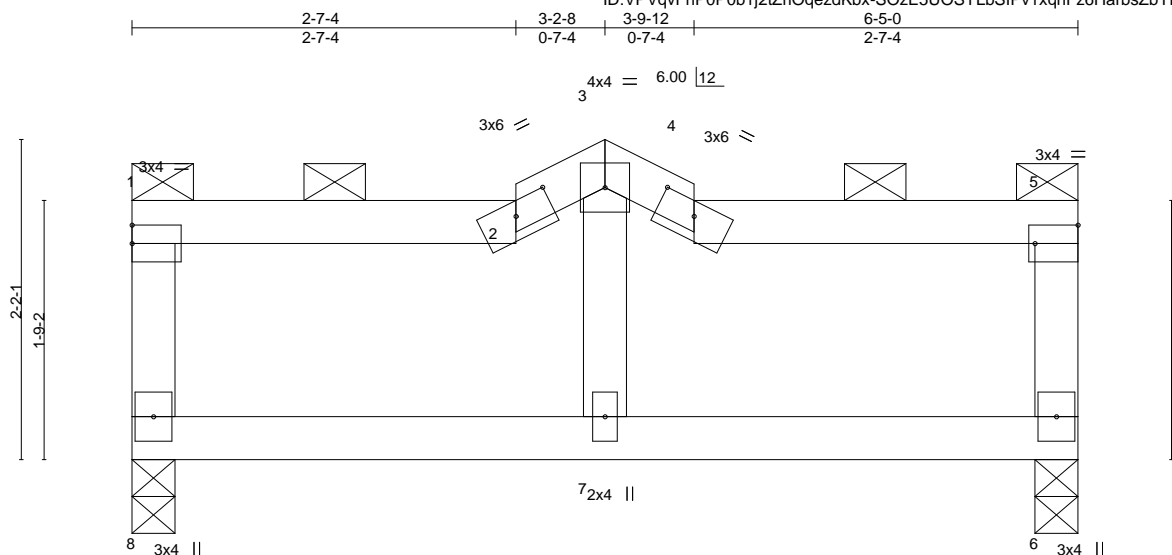

Scale = 1:15.6

Plate Offsets (X,Y)--	[2:0-3-0,0-1-2], [4:0-3-0,0-1-2], [5:Edge,0-1-8]
-----------------------	--------------------------------------------------

<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof) 25.0	2-0-0	TC 0.24	in (loc) l/defl L/d	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Plate Grip DOL 1.15	BC 0.29	Vert(LL) -0.04 7 >999 240		
TCDL 10.0	Lumber DOL 1.15	WB 0.02	Vert(CT) -0.07 7 >999 180		
BCLL 0.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.00 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014			Weight: 20 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2, 4-5.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 8=0-3-8, 6=0-3-8  
Max Horz 8=54(LC 15)  
Max Uplift 8=28(LC 12), 6=28(LC 13)  
Max Grav 8=294(LC 40), 6=294(LC 40)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-1-12 to 2-7-4, Interior(1) 2-7-4 to 3-2-8, Exterior(2E) 3-2-8 to 3-9-12, Interior(1) 3-9-12 to 6-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCCL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2523941	Truss V1	Truss Type Valley	Qty 1	Ply 1	Job Reference (optional)	I43385091
----------------	-------------	----------------------	----------	----------	--------------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:53 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-xaXcJqP4JfJwZUDVXCuWkplw?DFK?jxhYSzveyP7Zu

2-11-0 2-11-0 5-9-12 2-10-12

Scale = 1:11.8

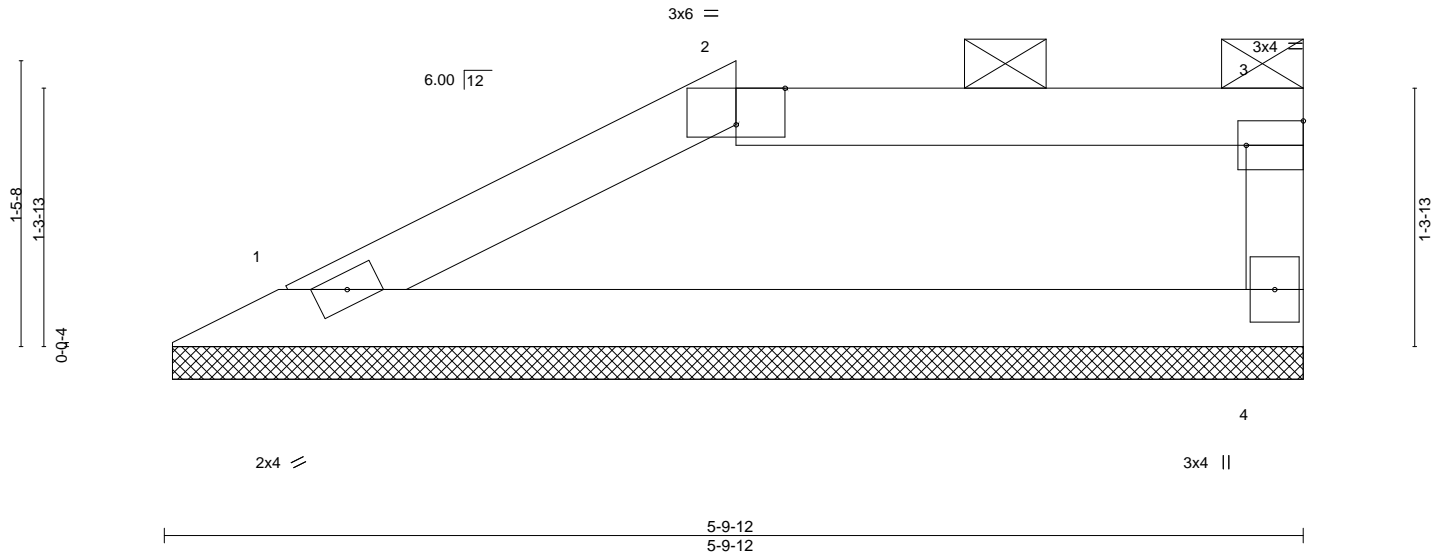


Plate Offsets (X,Y)-- [2:0-3-0,Edge], [3:Edge,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	n/a	-	n/a	999		
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-R						Weight: 14 lb	FT = 20%
BCDL 10.0										

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 5-9-12 oc purlins, except end verticals, and 2-0-0 oc purlins: 2-3.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=5-9-4, 4=5-9-4  
Max Horz 1=36(LC 15)  
Max Uplift 1=18(LC 16), 4=23(LC 13)  
Max Grav 1=227(LC 35), 4=240(LC 34)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCCL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	
2523941	V2	Valley	1	1	I43385092


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:54 2020 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-Pn5\_WAQj4zrAYi3Q3Fjj3XMngPV?3Sz4wCBWR5yP7Zt

Job Reference (optional)

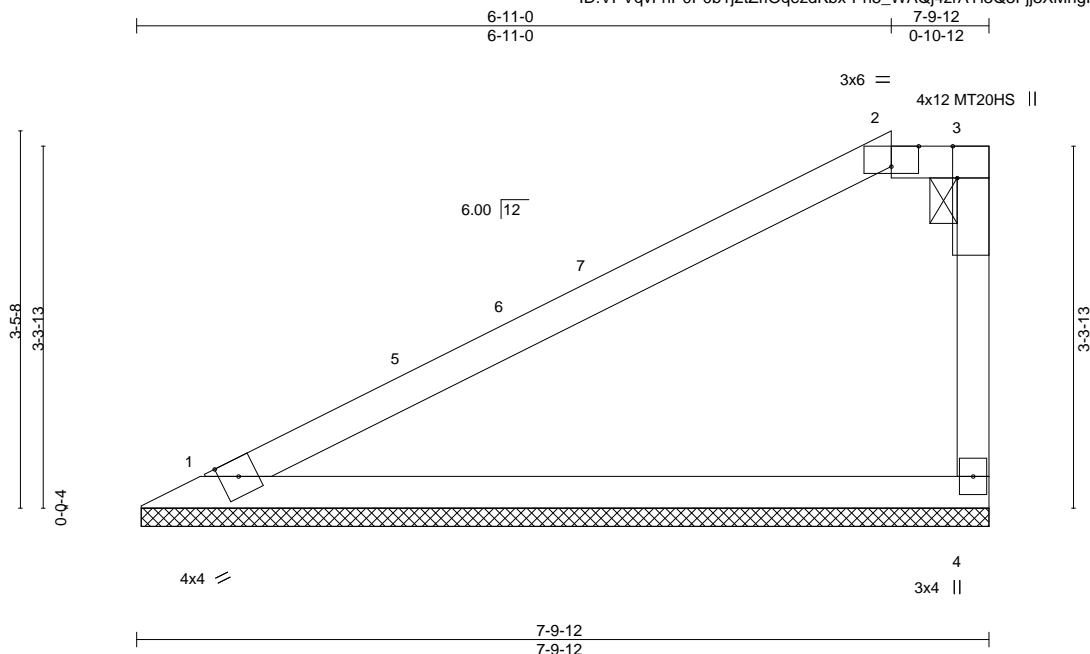

Scale = 1:21.1

Plate Offsets (X,Y)-- [2:0-3-0,Edge], [3:0-3-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof) 25.0	Plate Grip DOL	1.15	TC 0.79	Vert(LL)	n/a	-	n/a	999	MT20	197/144
Snow (Pf/Pg) 20.4/20.0	Lumber DOL	1.15	BC 0.42	Vert(CT)	n/a	-	n/a	999	MT20HS	148/108
TCDL 10.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a	n/a		
BCLL 0.0	Code IRC2018/TPI2014		Matrix-R							
BCDL 10.0									Weight: 21 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-3.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=7-9-4, 4=7-9-4  
Max Horz 1=106(LC 15)  
Max Uplift 1=22(LC 16), 4=29(LC 13)  
Max Grav 1=376(LC 35), 4=337(LC 35)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 6-11-0, Exterior(2E) 6-11-0 to 7-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCCL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=20.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10, Lu=50-0-0; Min. flat roof snow load governs. Rain surcharge applied to all exposed surfaces with slopes less than 0.500/12 in accordance with IBC 1608.3.4.
- Unbalanced snow loads have been considered for this design.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Job Reference (optional)
2523941	V4	Valley	1	1	I43385094

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:55 2020 Page 1  
ID:VPVqvFnP0P0b1j2tZrOqezdKbx-tzeNkWRLrGz19secdyEyblv2HpuGovKD9sx4zXyP7Zs

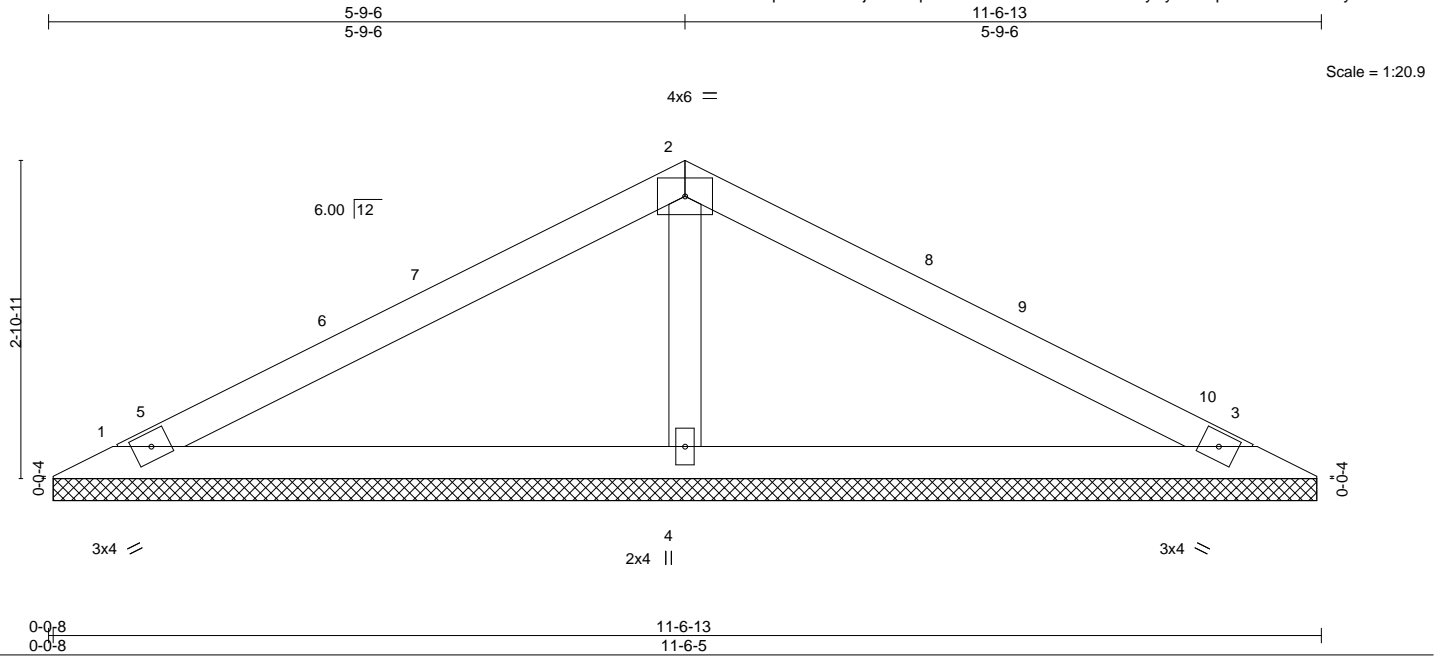

<b>LOADING</b> (psf)		<b>SPACING-</b>		<b>CSI.</b>		<b>DEFL.</b>		<b>PLATES</b>		<b>GRIP</b>	
TCLL (roof)	25.0	2-0-0		TC	0.42	in (loc)	l/defl	L/d	MT20	197/144	
Snow (Pt/Pg)	15.4/20.0	Plate Grip DOL	1.15	BC	0.22	n/a	-	n/a			
TCDL	10.0	Lumber DOL	1.15	WB	0.06	n/a	-	n/a			
BCLL	0.0	Rep Stress Incr	YES	Matrix-S		0.00	3	n/a			
BCDL	10.0	Code IRC2018/TPI2014									
								Weight: 29 lb		FT = 20%	

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=11-5-13, 3=11-5-13, 4=11-5-13  
Max Horz 1=-49(LC 14)  
Max Uplift 1=-26(LC 16), 3=-26(LC 16), 4=-23(LC 16)  
Max Grav 1=224(LC 20), 3=224(LC 21), 4=505(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 2-4=-349/169

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 5-9-6, Exterior(2R) 5-9-6 to 8-9-6, Interior(1) 8-9-6 to 10-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



October 28, 2020

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	
2523941	V5	Valley	1	1	
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					8.240 s Mar 9 2020 MiTek Industries, Inc. Tue Oct 27 18:40:56 2020 Page 1
					ID:VPVqvFnP0P0b1j2tZrOqezdKbx-L9C1xrRzca5un0DoAgmB8yRHdCGeXM2NNWgdVzyP7Zr
					Job Reference (optional)

3-9-6	7-6-13
3-9-6	3-9-6

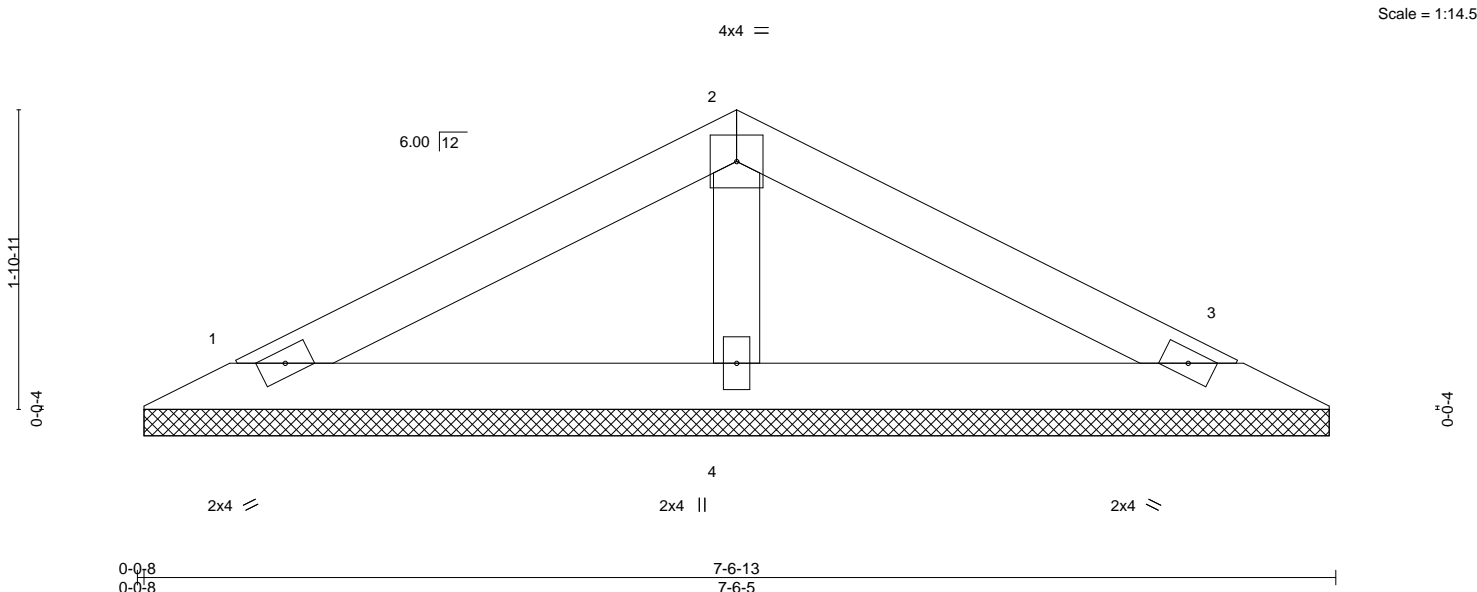

<b>LOADING</b> (psf)		<b>SPACING-</b>		<b>CSI.</b>		<b>DEFL.</b>		<b>PLATES</b>		<b>GRIP</b>	
TCLL (roof)	25.0	2-0-0		TC	0.19	in (loc)	l/defl	L/d	MT20	197/144	
Snow (Pt/Pg)	15.4/20.0	Plate Grip DOL	1.15	BC	0.08	n/a	-	n/a			
TCDL	10.0	Lumber DOL	1.15	WB	0.03	n/a	-	n/a			
BCLL	0.0	Rep Stress Incr	YES	Matrix-P		0.00	3	n/a			
BCDL	10.0	Code IRC2018/TPI2014									
								Weight: 18 lb		FT = 20%	

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SPF No.2		

<b>REACTIONS.</b>	
(size)	1=7-5-13, 3=7-5-13, 4=7-5-13
Max Horz	1=30(LC 15)
Max Uplift	1=21(LC 16), 3=21(LC 16), 4=3(LC 16)
Max Grav	1=148(LC 20), 3=148(LC 21), 4=279(LC 2)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; B=45ft; L=24ft; eave=4ft; Cat. II; Exp C; Enclosed; MWFRS (directional) and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-16; Pr=25.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pg=20.0 psf; Pf=15.4 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat C; Partially Exp.; Ce=1.0; Cs=1.00; Ct=1.10
  - Unbalanced snow loads have been considered for this design.
  - Gable requires continuous bottom chord bearing.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.





October 28,2020



# Symbols

## PLATE LOCATION AND ORIENTATION

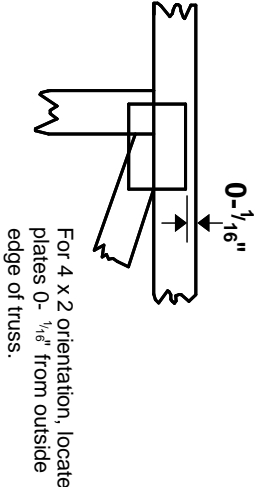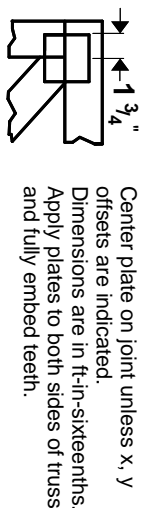

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

## PLATE SIZE


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.


## BEARING



Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

**Industry Standards:**  
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-89: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

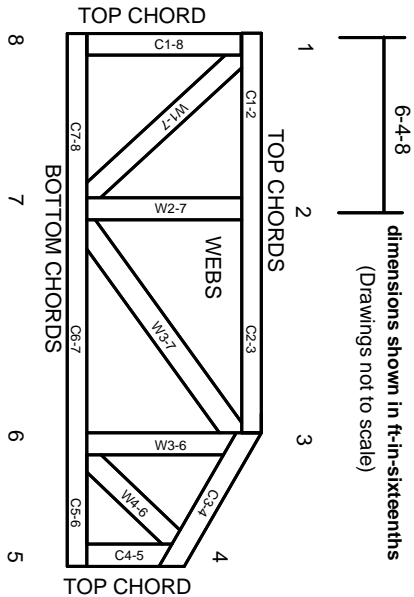

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

## PRODUCT CODE APPROVALS

ICC-ES Reports:  
ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



Mitek Engineering Reference Sheet: MII-7473 rev. 5/19/2020

# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.