

RESIDENTIAL AREA:			
RESIDENTIAL LIVING AREA	1730		
RESIDENTIAL UN-FINISHED BASEMENTS	563		
RESIDENTIAL GARAGE	684		
RESIDENTIAL LIVING AREA 2	1010		
ROOFING MATERIAL	COMP	NUMBER OF BATHROOMS	3.5
NUMBER OF BEDROOMS	4	NUMBER OF STORIES	1
NUMBER OF LIVING UNITS	1	TOTAL LIVING AREA	2740
SEWER CONNECTION FEE			



**FRONT ELEVATION**  
SCALE: 1/4" = 1'-0"



**BACK ELEVATION**  
SCALE: 1/4" = 1'-0"

COMP ROOF

ROOF & SOFFIT VENTS PER CODE

SIDING NAILING

6/12 HAND DRIVES

4/8 GUN NAILS

RELEASE FOR  
CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/29/2021



DESCRIPTION:

ELEVATIONS

MODEL:  
NEEHAM

DATE:  
8/26/20

3113 SW BLUE  
RIBBON ST.  
LEE'S SUMMIT, MO  
64082  
SUMMIT VIEW FARMS LOT 53


ARCHITECT IS NOT  
RESPONSIBLE FOR THE  
STRUCTURAL ELEMENTS OF  
THESE PLANS. A STRUCTURAL  
ENGINEER MAY NEED TO  
VERIFY ALL STRUCTURAL ASPECTS  
OF THESE PRINTS BEFORE  
CONSTRUCTION BEGINS. FIELD  
CONDITIONS MAY BE DIFFERENT  
FROM PLAN. ALL STATE AND  
LOCAL CODES TAKE PRECEDENCE OVER  
THESE PLANS. CONTRACTOR WILL BE  
RESPONSIBLE FOR PLAN INTEGRITY  
AND CODE COMPLIANCE

BUILD  
SET


THIS DRAWING IS THE  
PROPERTY OF BILLY  
SPELLERBERG AND IS  
NOT TO BE REPRODUCED,  
MODIFIED, OR USED FOR  
ANY OTHER PROJECT, OR  
EXTENSION OF THIS PROJECT,  
EXCEPT BY AGREEMENT WITH  
THIS COMPANY.

1 of 5

SHEET NO:

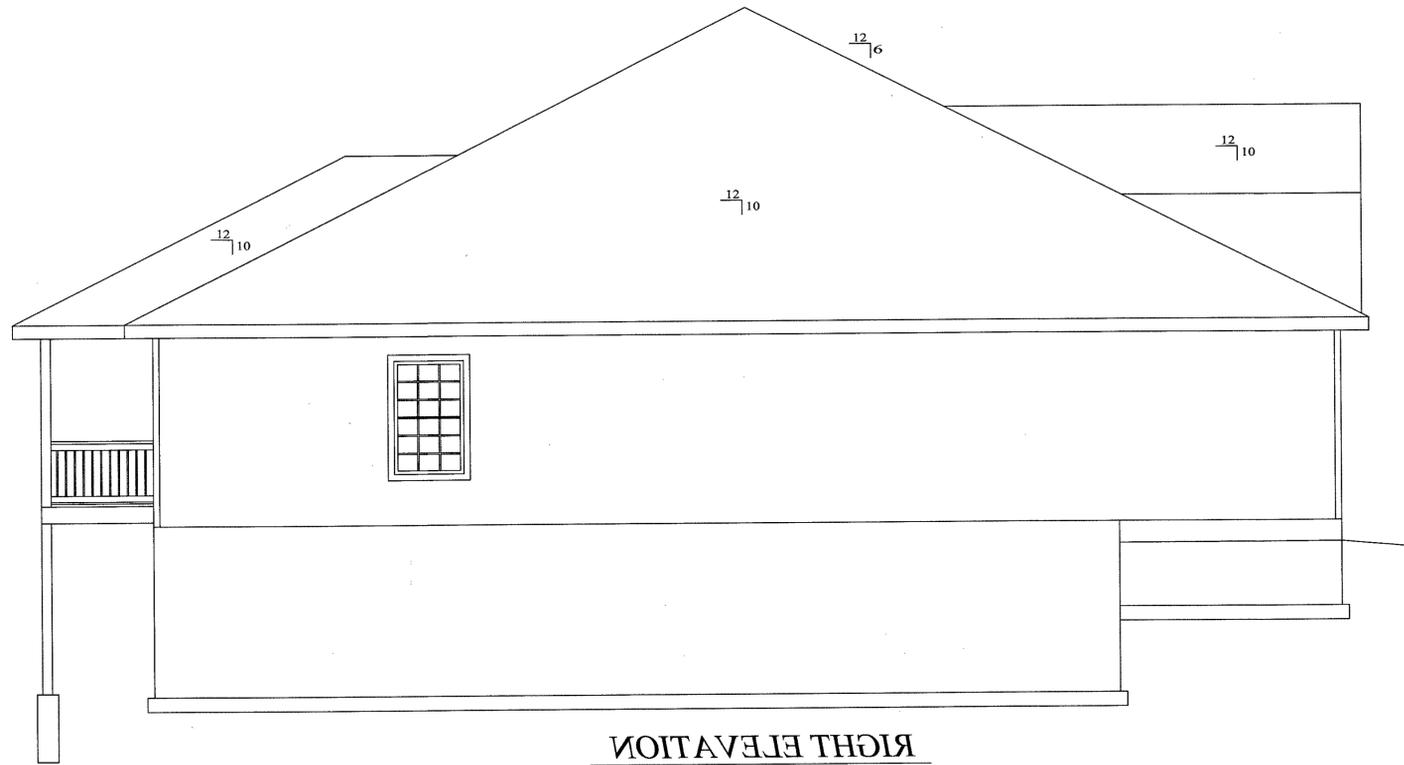

**RIGHT ELEVATION**  
SCALE: 1/4" = 1'-0"

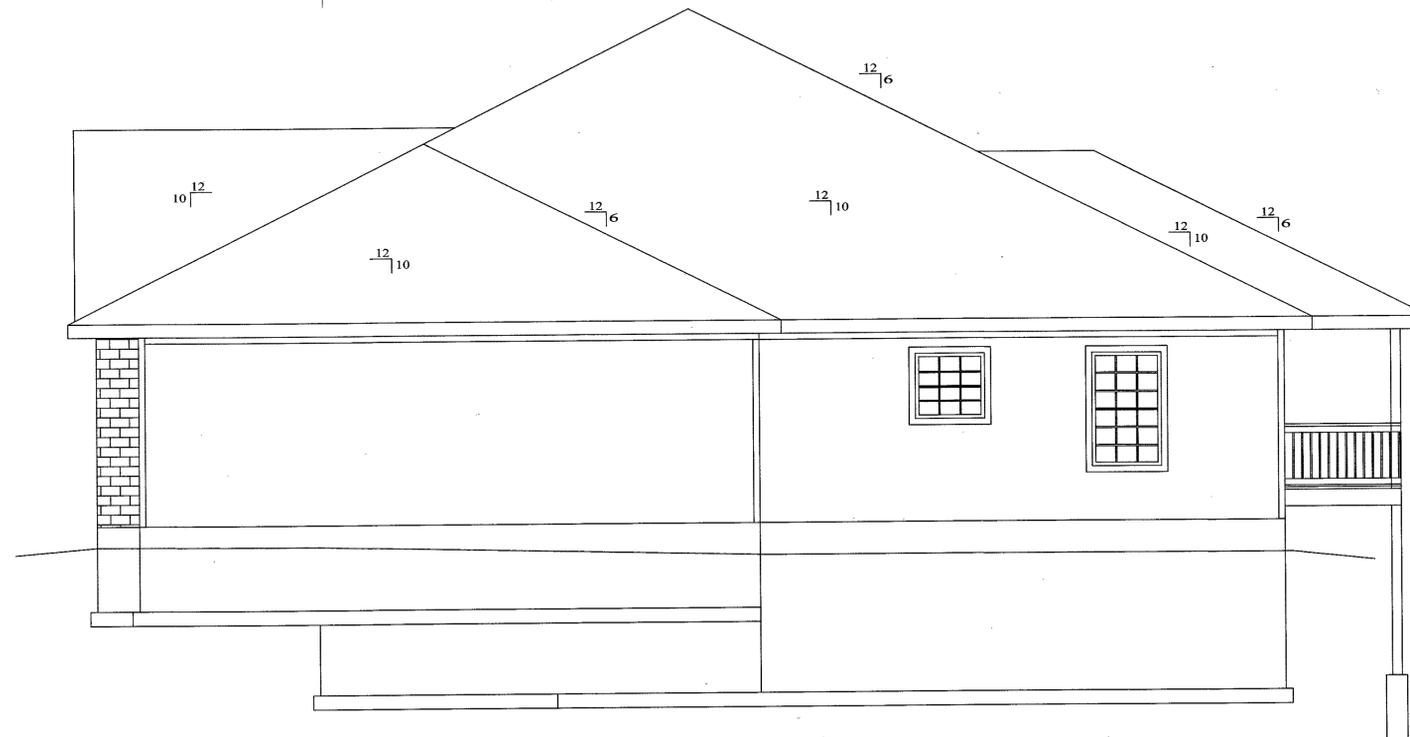

**LEFT ELEVATION**  
SCALE: 1/4" = 1'-0"

RELEASE FOR  
CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/29/2021



DESCRIPTION:

ROOF PLAN

MODEL:  
NEEHAM

DATE:  
8/26/20

3113 SW BLUE  
RIBBON ST.  
LEE'S SUMMIT, MO  
64082  
SUMMIT VIEW FARMS LOT 53


ARCHITECT IS NOT RESPONSIBLE FOR THE STRUCTURAL ELEMENTS OF THESE PLANS. A STRUCTURAL ENGINEER MAY NEED TO VERIFY ALL STRUCTURAL ASPECTS OF THESE PRINTS BEFORE CONSTRUCTION BEGINS. FIELD CONDITIONS MAY BE DIFFERENT FROM PLAN. ALL STATE AND LOCAL CODES TAKE PRECEDENCE OVER THESE PLANS. CONTRACTOR WILL BE RESPONSIBLE FOR PLAN INTEGRITY AND CODE COMPLIANCE.

BUILD SET


THIS DRAWING IS THE PROPERTY OF BILLY SPELLERBERG AND IS NOT TO BE REPRODUCED, MODIFIED, OR USED FOR ANY OTHER PROJECT, OR EXTENSION OF THIS PROJECT, EXCEPT BY AGREEMENT WITH THIS COMPANY.

2 of 5

SHEET NO:

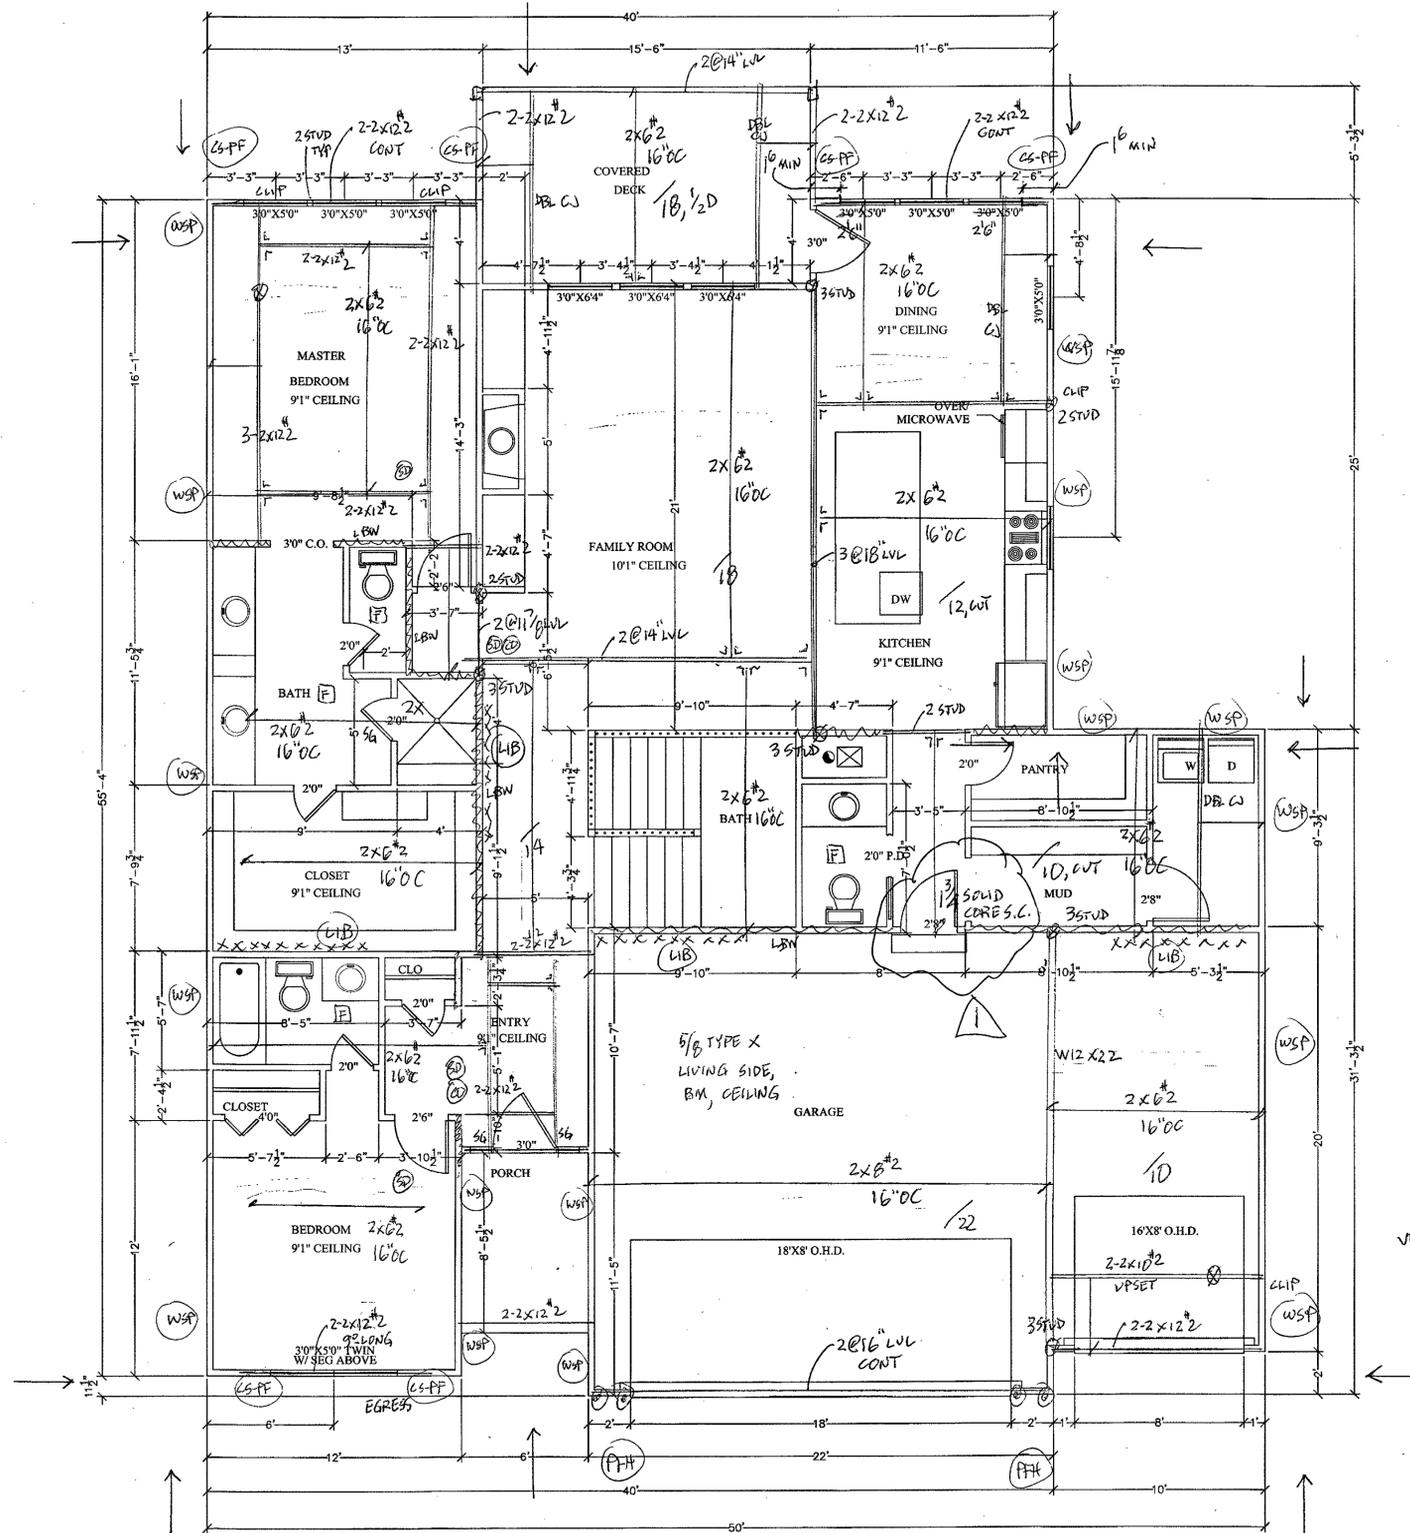

**FIRST FLOOR PLAN**  
SCALE: 1/4" = 1'-0"

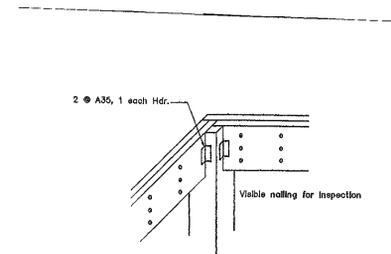

- DF/L MIN
- (CS-WSP) HOUSE IS SHEATHED W/ 7/8" OSB APA PANELS, SMART PANEL OR EQUAL, INSTALLED PER MANUF. SPECS, SHIP LAPPED PANELS REQUIRE NAILING OF OVER AND UNDER PANELS SEPARATELY.
  - (LUB) INT SHALL BE SIMPSON STRAP (CS18)
  - (CS-PF) HEADER LENGTHS ARE SHOWN FOR CS-PF
- SIDING LAPS RM  
2x4, 9' PLATE, FULL HT. STUDS  
S.C. = SELF CLOSING  
D2 GN #25 FOR WINDOWS  
CS = CONTINUOUSLY SHEATHED  
EC = END CONDITION  
SEE D2 FOR INSULATION VALUES  
EDJES, 16" LONG CS18 STRAP, CENTERED ON SUBFLOOR, FILL ALL NAIL HOLES.

VERIFY ALL VAULTS w/ BLDG

DESCRIPTION:  
**FIRST FLOOR PLAN**


MODEL:  
**NEEHAM**

DATE:  
**8/26/20**

3113 SW BLUE  
RIBBON ST.  
LEES SUMMIT, MO  
64082  
SUMMIT VIEW FARMS LOT 53

ARCHITECT IS NOT RESPONSIBLE FOR THE STRUCTURAL ELEMENTS OF THESE PLANS. A STRUCTURAL ENGINEER MAY NEED TO VERIFY ALL STRUCTURAL ASPECTS OF THESE PRINTS BEFORE CONSTRUCTION BEGINS. FIELD CONDITIONS MAY BE DIFFERENT FROM PLAN. ALL STATE AND LOCAL CODES TAKE PRECEDENCE OVER THESE PLANS. CONTRACTOR WILL BE RESPONSIBLE FOR PLAN INTERPRETATION AND CODE COMPLIANCE.

**BUILD SET**




RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI 01/29/2021

THIS DRAWING IS THE PROPERTY OF BILLY SPELLERBERG AND IS NOT TO BE REPRODUCED, MODIFIED, OR USED FOR ANY OTHER PROJECT, OR EXTENSION OF THIS PROJECT, EXCEPT BY AGREEMENT WITH THIS COMPANY.

3 of 5

SHEET NO:

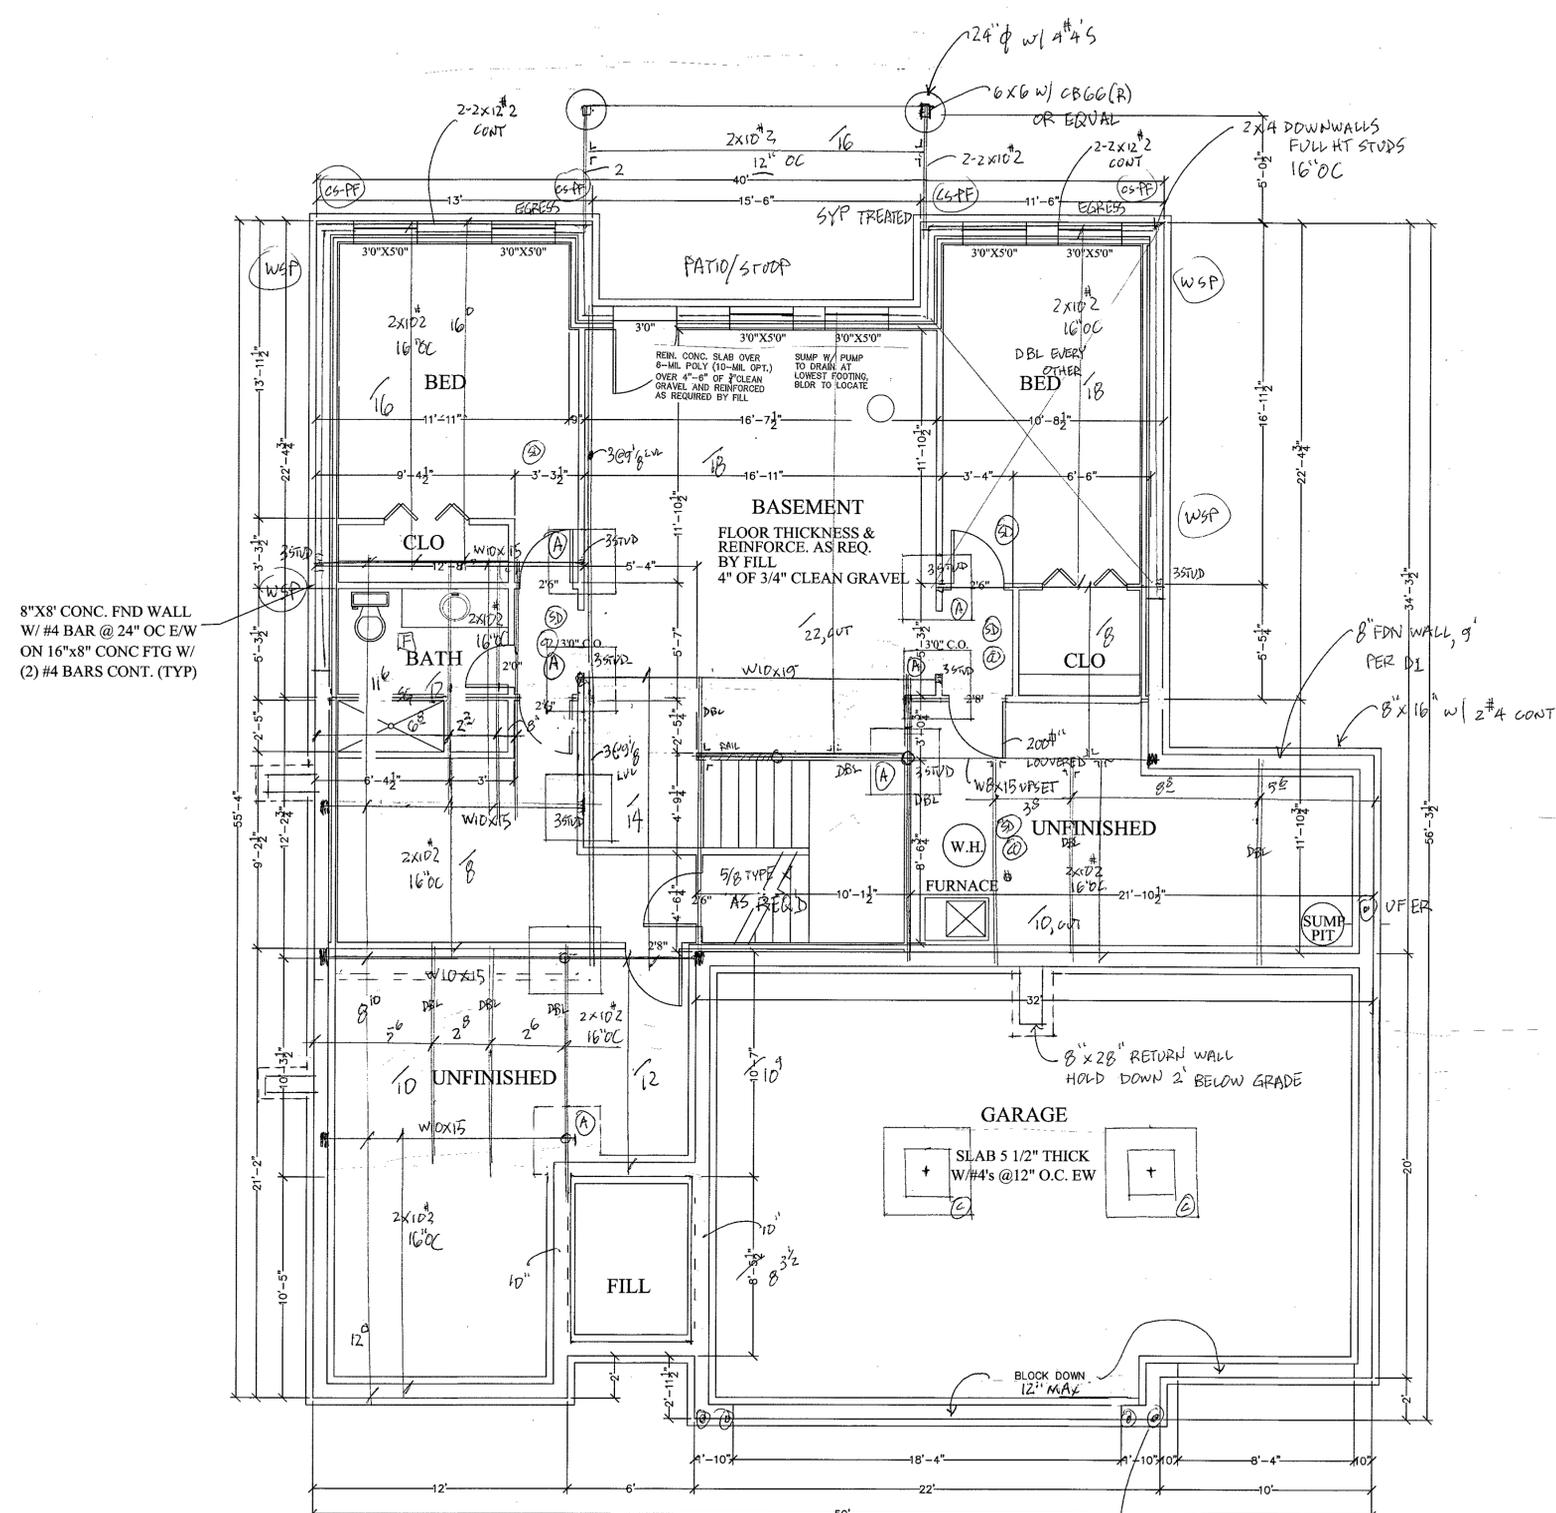

**FOUNDATION PLAN**  
SCALE: 1/4" = 1'-0"

8"X8" CONC. FND WALL  
W/ #4 BAR @ 24" OC E/W  
ON 16"X8" CONC FIG W/  
(2) #4 BARS CONT. (TYP)

- (A) 36x36x12 PAD  
W/ (8) #4'S E.W.  
3" SCH 40 COL UNO ALL PADS
- (B) 42x42x14 PAD  
W/ (7) #4'S E.W.
- (C) 48x48x16 PAD  
W/ (8) #4'S E.W.

RELEASE FOR  
CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
01/29/2021



DESCRIPTION:  
**FOUNDATION PLAN  
BASEMENT FRAMING**

MODEL:  
**NEEHAM**  
DATE:  
**8/26/20**



3113 SW BLUE  
RIBBON ST.  
LEE'S SUMMIT, MO  
64082  
SUMMIT VIEW FARMS LOT 53

ARCHITECT IS NOT  
RESPONSIBLE FOR THE  
STRUCTURAL ELEMENTS OF  
THESE PLANS. A STRUCTURAL  
ENGINEER MAY NEED TO  
VERIFY ALL STRUCTURAL ASPECTS  
OF THESE PRINTS BEFORE  
CONSTRUCTION BEGINS. FIELD  
CONDITIONS MAY BE DIFFERENT  
FROM PLAN. ALL STATE AND  
LOCAL CODES TAKE PRECEDENCE OVER  
THESE PLANS. CONTRACTOR WILL BE  
RESPONSIBLE FOR PLAN INTEGRITY  
AND CODE COMPLIANCE

**BUILD  
SET**

THIS DRAWING IS THE  
PROPERTY OF BILLY  
SPELLERBERG AND IS  
NOT TO BE REPRODUCED,  
MODIFIED, OR USED FOR  
ANY OTHER PROJECT, OR  
EXTENSION OF THIS PROJECT,  
EXCEPT BY AGREEMENT WITH  
THIS COMPANY.

4 of 5  
**SHEET NO.:**

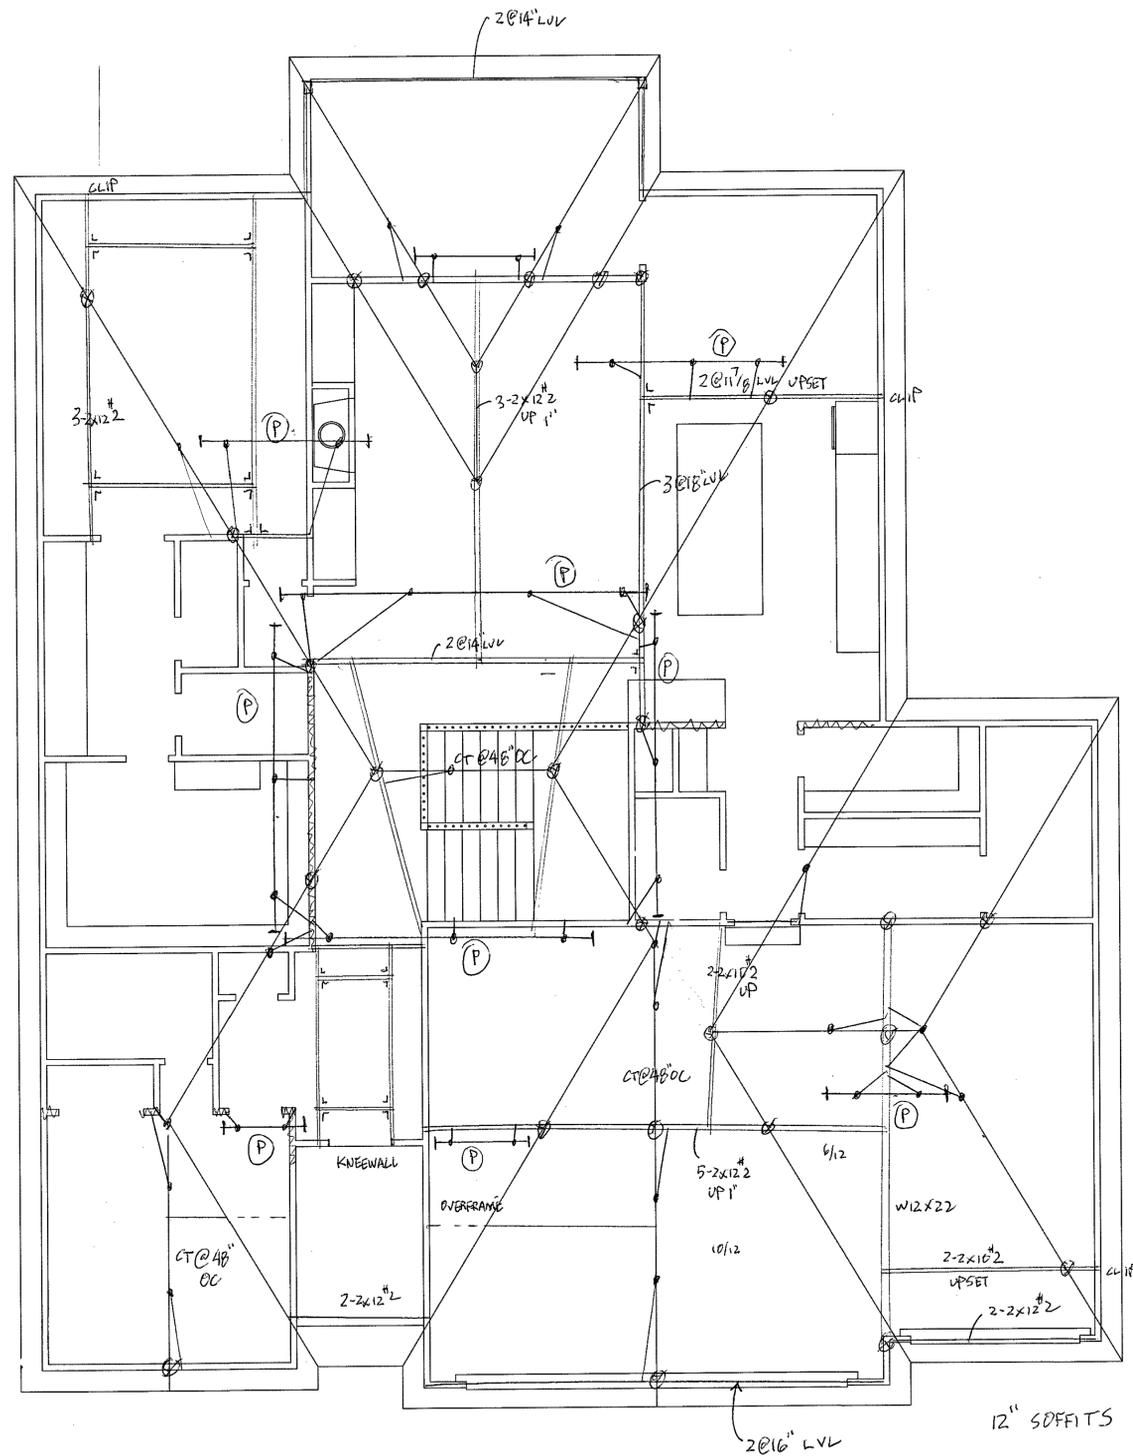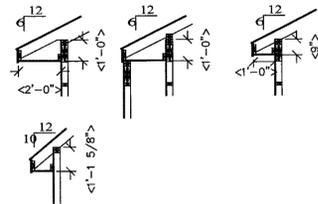

ROOF  
 ASPHALT SHINGLES - 210 MIN  
 WOOD SHINGLES/HANDS - 210 MIN  
 CONCRETE TILES - 500# MIN  
 FLASH & COUNTERFLASH ALL ROOF PENETRATIONS AND INTERSECTIONS  
 RAFTERS & COLLAR JOISTS  
 COLLAR TIES AT UPPER THIRD POINT 48" OC @ 2'-4" MIN  
 CEILING JOISTS ARE TURNED AS REQUIRED FOR RAFTER TIES  
 RESISTANCE MEMBERS AND STRIPS AS REQD  
 OUTGABING REQD @ GABLE END SOFFITS FOR  
 CORP ROOF W/ SOFFITS 2" @  
 OUTGABING REQD @ GABLE END SOFFITS FOR TILE ROOF  
 ATTIC VENTILATION  
 VENT EACH ENCLOSED ATTIC SPACE  
 NET AREA OPENING = 1/60TH OF VENTED AREA  
 UNLESS NOTED  
 RAFTERS ARE 2 X 6 @ 24" OC @ 90° CC  
 MAX SPAN 11'-4"  
 PROVIDE VERTICAL LOAD SUPPORT AT THE NOTED  
 LOAD POINTS FOR RISER VALLEYS, PURLINS & RIDGES  
 LET-IN SUPPORT LEG TO PURLIN  
 ALL RISER VALLEYS & RIDGES ARE REQD FOR  
 THE RAFTER DEPTH, PITCH AND LOADS ALL 2X8 UND

RAFTER	COMP	TILE
2 X 6	120	120
2 X 8	120	120
2 X 10	120	120

SUPPORT LEG	MAX LENGTH	MAX LENGTH
2 X 4 @ 24" SPACING	8'-0"	8'-0"
2 X 6 @ 24" SPACING	8'-0"	8'-0"
2 X 8 @ 24" SPACING	8'-0"	8'-0"
2 X 10 @ 24" SPACING	8'-0"	8'-0"

RISER JOINT CONNECTION FACTOR  
 $H_{RISER} / H_{RAFTER}$   
 1/4 15  
 1/3 15  
 1/2 15  
 2/3 15  
 3/4 15  
 1.0 15  
 1.5 15  
 2.0 15  
 2.5 15  
 3.0 15  
 3.5 15  
 4.0 15  
 4.5 15  
 5.0 15  
 5.5 15  
 6.0 15  
 6.5 15  
 7.0 15  
 7.5 15  
 8.0 15  
 8.5 15  
 9.0 15  
 9.5 15  
 10.0 15  
 10.5 15  
 11.0 15  
 11.5 15  
 12.0 15  
 12.5 15  
 13.0 15  
 13.5 15  
 14.0 15  
 14.5 15  
 15.0 15  
 15.5 15  
 16.0 15  
 16.5 15  
 17.0 15  
 17.5 15  
 18.0 15  
 18.5 15  
 19.0 15  
 19.5 15  
 20.0 15  
 20.5 15  
 21.0 15  
 21.5 15  
 22.0 15  
 22.5 15  
 23.0 15  
 23.5 15  
 24.0 15  
 24.5 15  
 25.0 15  
 25.5 15  
 26.0 15  
 26.5 15  
 27.0 15  
 27.5 15  
 28.0 15  
 28.5 15  
 29.0 15  
 29.5 15  
 30.0 15  
 30.5 15  
 31.0 15  
 31.5 15  
 32.0 15  
 32.5 15  
 33.0 15  
 33.5 15  
 34.0 15  
 34.5 15  
 35.0 15  
 35.5 15  
 36.0 15  
 36.5 15  
 37.0 15  
 37.5 15  
 38.0 15  
 38.5 15  
 39.0 15  
 39.5 15  
 40.0 15  
 40.5 15  
 41.0 15  
 41.5 15  
 42.0 15  
 42.5 15  
 43.0 15  
 43.5 15  
 44.0 15  
 44.5 15  
 45.0 15  
 45.5 15  
 46.0 15  
 46.5 15  
 47.0 15  
 47.5 15  
 48.0 15  
 48.5 15  
 49.0 15  
 49.5 15  
 50.0 15  
 50.5 15  
 51.0 15  
 51.5 15  
 52.0 15  
 52.5 15  
 53.0 15  
 53.5 15  
 54.0 15  
 54.5 15  
 55.0 15  
 55.5 15  
 56.0 15  
 56.5 15  
 57.0 15  
 57.5 15  
 58.0 15  
 58.5 15  
 59.0 15  
 59.5 15  
 60.0 15  
 60.5 15  
 61.0 15  
 61.5 15  
 62.0 15  
 62.5 15  
 63.0 15  
 63.5 15  
 64.0 15  
 64.5 15  
 65.0 15  
 65.5 15  
 66.0 15  
 66.5 15  
 67.0 15  
 67.5 15  
 68.0 15  
 68.5 15  
 69.0 15  
 69.5 15  
 70.0 15  
 70.5 15  
 71.0 15  
 71.5 15  
 72.0 15  
 72.5 15  
 73.0 15  
 73.5 15  
 74.0 15  
 74.5 15  
 75.0 15  
 75.5 15  
 76.0 15  
 76.5 15  
 77.0 15  
 77.5 15  
 78.0 15  
 78.5 15  
 79.0 15  
 79.5 15  
 80.0 15  
 80.5 15  
 81.0 15  
 81.5 15  
 82.0 15  
 82.5 15  
 83.0 15  
 83.5 15  
 84.0 15  
 84.5 15  
 85.0 15  
 85.5 15  
 86.0 15  
 86.5 15  
 87.0 15  
 87.5 15  
 88.0 15  
 88.5 15  
 89.0 15  
 89.5 15  
 90.0 15  
 90.5 15  
 91.0 15  
 91.5 15  
 92.0 15  
 92.5 15  
 93.0 15  
 93.5 15  
 94.0 15  
 94.5 15  
 95.0 15  
 95.5 15  
 96.0 15  
 96.5 15  
 97.0 15  
 97.5 15  
 98.0 15  
 98.5 15  
 99.0 15  
 99.5 15  
 100.0 15  
 100.5 15  
 101.0 15  
 101.5 15  
 102.0 15  
 102.5 15  
 103.0 15  
 103.5 15  
 104.0 15  
 104.5 15  
 105.0 15  
 105.5 15  
 106.0 15  
 106.5 15  
 107.0 15  
 107.5 15  
 108.0 15  
 108.5 15  
 109.0 15  
 109.5 15  
 110.0 15  
 110.5 15  
 111.0 15  
 111.5 15  
 112.0 15  
 112.5 15  
 113.0 15  
 113.5 15  
 114.0 15  
 114.5 15  
 115.0 15  
 115.5 15  
 116.0 15  
 116.5 15  
 117.0 15  
 117.5 15  
 118.0 15  
 118.5 15  
 119.0 15  
 119.5 15  
 120.0 15  
 120.5 15  
 121.0 15  
 121.5 15  
 122.0 15  
 122.5 15  
 123.0 15  
 123.5 15  
 124.0 15  
 124.5 15  
 125.0 15  
 125.5 15  
 126.0 15  
 126.5 15  
 127.0 15  
 127.5 15  
 128.0 15  
 128.5 15  
 129.0 15  
 129.5 15  
 130.0 15  
 130.5 15  
 131.0 15  
 131.5 15  
 132.0 15  
 132.5 15  
 133.0 15  
 133.5 15  
 134.0 15  
 134.5 15  
 135.0 15  
 135.5 15  
 136.0 15  
 136.5 15  
 137.0 15  
 137.5 15  
 138.0 15  
 138.5 15  
 139.0 15  
 139.5 15  
 140.0 15  
 140.5 15  
 141.0 15  
 141.5 15  
 142.0 15  
 142.5 15  
 143.0 15  
 143.5 15  
 144.0 15  
 144.5 15  
 145.0 15  
 145.5 15  
 146.0 15  
 146.5 15  
 147.0 15  
 147.5 15  
 148.0 15  
 148.5 15  
 149.0 15  
 149.5 15  
 150.0 15  
 150.5 15  
 151.0 15  
 151.5 15  
 152.0 15  
 152.5 15  
 153.0 15  
 153.5 15  
 154.0 15  
 154.5 15  
 155.0 15  
 155.5 15  
 156.0 15  
 156.5 15  
 157.0 15  
 157.5 15  
 158.0 15  
 158.5 15  
 159.0 15  
 159.5 15  
 160.0 15  
 160.5 15  
 161.0 15  
 161.5 15  
 162.0 15  
 162.5 15  
 163.0 15  
 163.5 15  
 164.0 15  
 164.5 15  
 165.0 15  
 165.5 15  
 166.0 15  
 166.5 15  
 167.0 15  
 167.5 15  
 168.0 15  
 168.5 15  
 169.0 15  
 169.5 15  
 170.0 15  
 170.5 15  
 171.0 15  
 171.5 15  
 172.0 15  
 172.5 15  
 173.0 15  
 173.5 15  
 174.0 15  
 174.5 15  
 175.0 15  
 175.5 15  
 176.0 15  
 176.5 15  
 177.0 15  
 177.5 15  
 178.0 15  
 178.5 15  
 179.0 15  
 179.5 15  
 180.0 15  
 180.5 15  
 181.0 15  
 181.5 15  
 182.0 15  
 182.5 15  
 183.0 15  
 183.5 15  
 184.0 15  
 184.5 15  
 185.0 15  
 185.5 15  
 186.0 15  
 186.5 15  
 187.0 15  
 187.5 15  
 188.0 15  
 188.5 15  
 189.0 15  
 189.5 15  
 190.0 15  
 190.5 15  
 191.0 15  
 191.5 15  
 192.0 15  
 192.5 15  
 193.0 15  
 193.5 15  
 194.0 15  
 194.5 15  
 195.0 15  
 195.5 15  
 196.0 15  
 196.5 15  
 197.0 15  
 197.5 15  
 198.0 15  
 198.5 15  
 199.0 15  
 199.5 15  
 200.0 15  
 200.5 15  
 201.0 15  
 201.5 15  
 202.0 15  
 202.5 15  
 203.0 15  
 203.5 15  
 204.0 15  
 204.5 15  
 205.0 15  
 205.5 15  
 206.0 15  
 206.5 15  
 207.0 15  
 207.5 15  
 208.0 15  
 208.5 15  
 209.0 15  
 209.5 15  
 210.0 15  
 210.5 15  
 211.0 15  
 211.5 15  
 212.0 15  
 212.5 15  
 213.0 15  
 213.5 15  
 214.0 15  
 214.5 15  
 215.0 15  
 215.5 15  
 216.0 15  
 216.5 15  
 217.0 15  
 217.5 15  
 218.0 15  
 218.5 15  
 219.0 15  
 219.5 15  
 220.0 15  
 220.5 15  
 221.0 15  
 221.5 15  
 222.0 15  
 222.5 15  
 223.0 15  
 223.5 15  
 224.0 15  
 224.5 15  
 225.0 15  
 225.5 15  
 226.0 15  
 226.5 15  
 227.0 15  
 227.5 15  
 228.0 15  
 228.5 15  
 229.0 15  
 229.5 15  
 230.0 15  
 230.5 15  
 231.0 15  
 231.5 15  
 232.0 15  
 232.5 15  
 233.0 15  
 233.5 15  
 234.0 15  
 234.5 15  
 235.0 15  
 235.5 15  
 236.0 15  
 236.5 15  
 237.0 15  
 237.5 15  
 238.0 15  
 238.5 15  
 239.0 15  
 239.5 15  
 240.0 15  
 240.5 15  
 241.0 15  
 241.5 15  
 242.0 15  
 242.5 15  
 243.0 15  
 243.5 15  
 244.0 15  
 244.5 15  
 245.0 15  
 245.5 15  
 246.0 15  
 246.5 15  
 247.0 15  
 247.5 15  
 248.0 15  
 248.5 15  
 249.0 15  
 249.5 15  
 250.0 15  
 250.5 15  
 251.0 15  
 251.5 15  
 252.0 15  
 252.5 15  
 253.0 15  
 253.5 15  
 254.0 15  
 254.5 15  
 255.0 15  
 255.5 15  
 256.0 15  
 256.5 15  
 257.0 15  
 257.5 15  
 258.0 15  
 258.5 15  
 259.0 15  
 259.5 15  
 260.0 15  
 260.5 15  
 261.0 15  
 261.5 15  
 262.0 15  
 262.5 15  
 263.0 15  
 263.5 15  
 264.0 15  
 264.5 15  
 265.0 15  
 265.5 15  
 266.0 15  
 266.5 15  
 267.0 15  
 267.5 15  
 268.0 15  
 268.5 15  
 269.0 15  
 269.5 15  
 270.0 15  
 270.5 15  
 271.0 15  
 271.5 15  
 272.0 15  
 272.5 15  
 273.0 15  
 273.5 15  
 274.0 15  
 274.5 15  
 275.0 15  
 275.5 15  
 276.0 15  
 276.5 15  
 277.0 15  
 277.5 15  
 278.0 15  
 278.5 15  
 279.0 15  
 279.5 15  
 280.0 15  
 280.5 15  
 281.0 15  
 281.5 15  
 282.0 15  
 282.5 15  
 283.0 15  
 283.5 15  
 284.0 15  
 284.5 15  
 285.0 15  
 285.5 15  
 286.0 15  
 286.5 15  
 287.0 15  
 287.5 15  
 288.0 15  
 288.5 15  
 289.0 15  
 289.5 15  
 290.0 15  
 290.5 15  
 291.0 15  
 291.5 15  
 292.0 15  
 292.5 15  
 293.0 15  
 293.5 15  
 294.0 15  
 294.5 15  
 295.0 15  
 295.5 15  
 296.0 15  
 296.5 15  
 297.0 15  
 297.5 15  
 298.0 15  
 298.5 15  
 299.0 15  
 299.5 15  
 300.0 15  
 300.5 15  
 301.0 15  
 301.5 15  
 302.0 15  
 302.5 15  
 303.0 15  
 303.5 15  
 304.0 15  
 304.5 15  
 305.0 15  
 305.5 15  
 306.0 15  
 306.5 15  
 307.0 15  
 307.5 15  
 308.0 15  
 308.5 15  
 309.0 15  
 309.5 15  
 310.0 15  
 310.5 15  
 311.0 15  
 311.5 15  
 312.0 15  
 312.5 15  
 313.0 15  
 313.5 15  
 314.0 15  
 314.5 15  
 315.0 15  
 315.5 15  
 316.0 15  
 316.5 15  
 317.0 15  
 317.5 15  
 318.0 15  
 318.5 15  
 319.0 15  
 319.5 15  
 320.0 15  
 320.5 15  
 321.0 15  
 321.5 15  
 322.0 15  
 322.5 15  
 323.0 15  
 323.5 15  
 324.0 15  
 324.5 15  
 325.0 15  
 325.5 15  
 326.0 15  
 326.5 15  
 327.0 15  
 327.5 15  
 328.0 15  
 328.5 15  
 329.0 15  
 329.5 15  
 330.0 15  
 330.5 15  
 331.0 15  
 331.5 15  
 332.0 15  
 332.5 15  
 333.0 15  
 333.5 15  
 334.0 15  
 334.5 15  
 335.0 15  
 335.5 15  
 336.0 15  
 336.5 15  
 337.0 15  
 337.5 15  
 338.0 15  
 338.5 15  
 339.0 15  
 339.5 15  
 340.0 15  
 340.5 15  
 341.0 15  
 341.5 15  
 342.0 15  
 342.5 15  
 343.0 15  
 343.5 15  
 344.0 15  
 344.5 15  
 345.0 15  
 345.5 15  
 346.0 15  
 346.5 15  
 347.0 15  
 347.5 15  
 348.0 15  
 348.5 15  
 349.0 15  
 349.5 15  
 350.0 15  
 350.5 15  
 351.0 15  
 351.5 15  
 352.0 15  
 352.5 15  
 353.0 15  
 353.5 15  
 354.0 15  
 354.5 15  
 355.0 15  
 355.5 15  
 356.0 15  
 356.5 15  
 357.0 15  
 357.5 15  
 358.0 15  
 358.5 15  
 359.0 15  
 359.5 15  
 360.0 15  
 360.5 15  
 361.0 15  
 361.5 15  
 362.0 15  
 362.5 15  
 363.0 15  
 363.5 15  
 364.0 15  
 364.5 15  
 365.0 15  
 365.5 15  
 366.0 15  
 366.5 15  
 367.0 15  
 367.5 15  
 368.0 15  
 368.5 15  
 369.0 15  
 369.5 15  
 370.0 15  
 370.5 15  
 371.0 15  
 371.5 15  
 372.0 15  
 372.5 15  
 373.0 15  
 373.5 15  
 374.0 15  
 374.5 15  
 375.0 15  
 375.5 15  
 376.0 15  
 376.5 15  
 377.0 15  
 377.5 15  
 378.0 15  
 378.5 15  
 379.0 15  
 379.5 15  
 380.0 15  
 380.5 15  
 381.0 15  
 381.5 15  
 382.0 15  
 382.5 15  
 383.0 15  
 383.5 15  
 384.0 15  
 384.5 15  
 385.0 15  
 385.5 15  
 386.0 15  
 386.5 15  
 387.0 15  
 387.5 15  
 388.0 15  
 388.5 15  
 389.0 15  
 389.5 15  
 390.0 15  
 390.5 15  
 391.0 15  
 391.5 15  
 392.0 15  
 392.5 15  
 393.0 15  
 393.5 15  
 394.0 15  
 394.5 15  
 395.0 15  
 395.5 15  
 396.0 15  
 396.5 15  
 397.0 15  
 397.5 15  
 398.0 15  
 398.5 15  
 399.0 15  
 399.5 15  
 400.0 15  
 400.5 15  
 401.0 15  
 401.5 15  
 402.0 15  
 402.5 15  
 403.0 15  
 403.5 15  
 404.0 15  
 404.5 15  
 405.0 15  
 405.5 15  
 406.0 15  
 406.5 15  
 407.0 15  
 407.5 15  
 408.0 15  
 408.5 15  
 409.0 15  
 409.5 15  
 410.0 15  
 410.5 15  
 411.0 15  
 411.5 15  
 412.0 15  
 412.5 15  
 413.0 15  
 413.5 15  
 414.0 15  
 414.5 15  
 415.0 15  
 415.5 15  
 416.0 15  
 416.5 15  
 417.0 15  
 417.5 15  
 418.0 15  
 418.5 15  
 419.0 15  
 419.5 15  
 420.0 15  
 420.5 15  
 421.0 15  
 421.5 15  
 422.0 15  
 422.5 15  
 423.0 15  
 423.5 15  
 424.0 15  
 424.5 15  
 425.0 15  
 425.5 15  
 426.0 15  
 426.5 15  
 427.0 15  
 427.5 15  
 428.0 15  
 428.5 15  
 429.0 15  
 429.5 15  
 430.0 15  
 430.5 15  
 431.0 15  
 431.5 15  
 432.0 15  
 432.5 15  
 433.0 15  
 433.5 15  
 434.0

**DIVISION 1 - GENERAL REQUIREMENTS**

- DESIGN AND CONSTRUCTION WORK FOR THIS PROJECT SHALL CONFORM TO THE REQUIREMENTS OF THE 2018 IRC.
- FURNISH ALL LABOR, MATERIALS, AND EQUIPMENT NECESSARY TO COMPLETE THE WORK AS SHOWN OR INFERRED BY THE DRAWINGS.
- DESIGN FACTORS:
  - A) GROUND SNOW LOAD INCLUDING DRIFTING SNOW: 20 PSF
  - B) WIND SPEED (EXPOSURE B): 115 MPH
  - C) SEISMIC CATEGORY (A), GROUND ACCELERATION = NA
- DESIGN LOADS (PSF, UNLESS NOTED OTHERWISE):
  - A) ROOF (LL/DL): SEE TABLE
  - B) FLOOR (LL/DL): SEE TABLE
  - C) CEILING (LL/DL): SEE TABLE, (0/10 TRUSSES)
- DO NOT SCALE DRAWINGS. IF DIMENSIONS ARE IN QUESTION, OBTAIN CLARIFICATION FROM A / E BEFORE CONTINUING CONSTRUCTION.
- THE CONTRACTOR SHALL EXAMINE ACTUAL JOB CONDITIONS AND BE RESPONSIBLE FOR VERIFYING ALL DIMENSIONS AND ELEVATIONS SHOWN ON THE PLANS. IF ERRORS, OMISSIONS, OR DISCREPANCIES ARE FOUND THEY SHALL BE REPORTED TO THE DESIGN PROFESSIONAL BEFORE PROCEEDING WITH THE WORK.
- DIMENSIONS FOR NEW CONSTRUCTION ARE TO FACE OF FINISH OR COLUMNS AND FACE OF CONCRETE, WOOD, OR MASONRY WALLS UNLESS OTHERWISE INDICATED. DIMENSIONS INDICATE NOMINAL DIMENSIONS RATHER THAN ACTUAL DIMENSIONS.
- CONTRACTOR IS RESPONSIBLE FOR COORDINATING ALL TRADES EVEN IF THE TRADE IS UNDER A SEPARATE CONTRACT.
- PROVIDE SUFFICIENT STUDS AND BLOCKING WHERE REQUIRED TO SUPPORT EQUIPMENT AND/OR MISCELLANEOUS ITEMS, IE, LOAD POINTS, TYPICAL CASEWORK, CABINETS, GRAB BARS ETC.
- PRETREAT FOUNDATION FOR TERMITES AS REQUIRED.
- GARAGE DOORS AND FRAMES SHALL BE DESIGNED AND INSTALLED TO MEET THE 15 MPH WIND LOAD RESISTANCE REQUIREMENTS OF DASMA 108 AND ASTM E 330-96.
- ALL EXTERIOR DOORS, INCLUDING THE DOOR LEADING FROM THE GARAGE TO THE DWELLING UNIT, SHALL INCORPORATE THE PHYSICAL SECURITY PROVISIONS OF THE JURISDICTION IN WHICH THE CONSTRUCTION TAKES PLACE.

**DIVISION 2 - EARTHWORK**

- ALL PROPERTY MARKERS SHALL BE EXPOSED.
- ALL FOOTINGS ARE DESIGNED TO BEAR ON NATURAL UNDISTURBED SOIL CAPABLE OF ADEQUATELY SUSTAINING A MINIMUM BEARING PRESSURE OF 1500 PSF. IF SUITABLE UNDISTURBED BEARING CAPACITY IS NOT ENCOUNTERED AT THE ELEVATION INDICATED ON THE DRAWINGS, CONTRACTOR SHALL NOTIFY THE ENGINEER OF RECORD IMMEDIATELY.
- ALL TOPSOIL, ORGANIC MATERIAL, AND EXISTING STRUCTURES SHALL BE REMOVED FROM BUILDING AREA AND FROM AREAS TO BE PAVED. STOCKPILE ALL TOPSOIL FOR REUSE.
- REFERENCE THE SOILS REPORT FOR ALL FILL CONDITIONS.
- OVEREXCAVATE BUILDING AREA BELOW SLAB SUBGRADE ELEVATION AND REPLACE WITH MATERIAL PER SOILS REPORT. VERIFY.
- SITE EROSION CONTROL SHALL COMPLY WITH ALL STATE AND LOCAL ORDINANCES.
- IN-SITU SOIL CONDITIONS, SEE SOILS REPORT OR 1500 PSF BEARING & 60 PCF EQUIVALENT FLUID WEIGHT.
- SOIL CONDITIONS AT THE DEPTH OF EXCAVATION FOR THE FOOTING SHALL BE UNIFORM AND CONSISTENT. NOTIFY THE ENGINEER OF RECORD OF ANY INCONSISTENCIES.
- CONTRACTOR SHALL BE RESPONSIBLE FOR REMOVING AND DISPOSING OF EXCESS EXCAVATION MATERIALS AND FOR OBTAINING AND SUPPLYING ADDITIONAL FILL MATERIAL AS REQUIRED.

**DIVISION 3 - CONCRETE**

- ALL CONCRETE WORK SHALL CONFORM TO THE REQUIREMENTS OF ACI 318 "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE" AND ACI 332 "REQUIREMENTS FOR RESIDENTIAL CONCRETE CONSTRUCTION".
  - CONCRETE MATERIALS SHALL COMPLY WITH:
    - A) CEMENT - ASTM C 150 TYPE 1
    - B) AGGREGATE - ASTM C 33 MAXIMUM AGGREGATE SIZE 3/4"
    - C) WATER - POTABLE, WATER/CEMENT RATIO 0.5 (MAX)
    - D) AIR-ENTRAINING ADMIXTURE - ASTM C 260
    - E) WATER-REDUCING ADMIXTURE - ASTM C 494, INCLUDING SUPERPLASTICIZERS
    - F) FLY ASH - ASTM C 618, CLASS C
- CONCRETE SHALL DEVELOP THE FOLLOWING MINIMUM 28 DAY DESIGN COMPRESSIVE STRENGTH (f<sub>c</sub>):
 

TYPE OF CONSTRUCTION	COMP. STRENGTH (f <sub>c</sub> )
A) FOOTINGS, WALLS, AND SLABS	SEE TABLE
B) EXTERIOR SLABS AND CURBS (AIR-ENTRAINED CONCRETE)	SEE TABLE
- CONCRETE PROPORTIONS SHALL BE ESTABLISHED ON THE BASIS OF FIELD EXPERIENCE AND/OR TRIAL MIXTURES IN ACCORDANCE WITH ACI 318-89 SECTIONS 5.2 AND 5.3. WHEN FLY ASH IS UTILIZED IN THE MIX, MIX SHALL CONTAIN A WATER-REDUCER. FLY ASH SHALL BE ADDED AT THE RATE OF NOT MORE THAN 100 POUNDS PER CUBIC YARD AND CEMENT SHALL BE REDUCED BY NOT MORE THAN 15 PERCENT BY WEIGHT.
- PROPORTION AND DESIGN MIXES TO RESULT IN CONCRETE SLUMP AT A POINT OF PLACEMENT OF NOT MORE THAN 4" TO 5".
- USE AIR-ENTRAINING ADMIXTURES IN EXTERIOR EXPOSED CONCRETE TO RESULT IN CONCRETE AT POINT OF PLACEMENT HAVING AIR CONTENT OF 5 TO 7 PERCENT ENTRAINED AIR.
- ALL PLUMBING AND ELECTRICAL ROUGH-INS MUST BE COMPLETE, INSPECTED AND APPROVED BEFORE REQUESTING THE SLAB INSPECTION.
- CONCRETE WORK EXECUTION:
  - A) MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE, UNLESS NOTED OTHERWISE ON DRAWINGS:
    - CAST AGAINST AND EXPOSED TO EARTH: 3"
    - EXPOSED TO EARTH OR WEATHER: 2"
    - NOT EXPOSED TO EARTH OR WEATHER: 1 1/2"
  - B) IN CORNERS OF GRADE BEAMS PROVIDE CORNER REINFORCEMENT. LAP TWO FEET EACH DIRECTION IN OUTSIDE FACE, MATCHING SIZE AND SPACING OF HORIZONTAL REINFORCEMENT.
  - C) PROVIDE CONTROL JOINTS IN SLABS-ON-GRADE AT NOT GREATER THAN 20 FEET ON CENTER IN EACH DIRECTION. SAW CUT CONTROL JOINTS MINIMUM 1/4 OF THE SLAB DEPTH, AS SOON AFTER SLAB FINISHING AS POSSIBLE WITHOUT DISLOCATING AGGREGATE. (DO NOT SAW CUT STRUCTURAL SLABS w/o APPROVAL).
  - D) BATCH TICKETS SHALL BE SUBMITTED TO A CONTRACTOR'S REPRESENTATIVE PRIOR TO OFF LOADING. ANY CONCRETE MORE THAN 45 MINUTES OUT PRIOR TO STARTING PLACEMENT SHALL BE REJECTED.
  - E) THE MAXIMUM ADDITION OF WATER SHALL BE LIMITED TO 1 GALLON PER YARD; NOTE THAT THIS ADDITION SHALL BE USED TO CONTROL HEAT ONLY (NOT SLUMP).
  - F) PUMPS SHALL NOT BE PRIMED IN FORMS.
- REINFORCEMENT:
  - A) ALL REINFORCING BARS SHALL BE A615, GR40 MIN. LAP SPICES 18" MIN FOR #4 BAR. SEE TABLE.
  - B) WELDED WIRE FABRIC SHALL BE ASTM A185, LAP AT LEAST ONE FULL MESH AND LACE SPICES WITH WIRE.
  - C) REBAR SHALL BE CLEAN, AND FREE FROM RUST AND OIL PRIOR TO THE PLACEMENT OF CONCRETE. REBAR SHALL BE TIED AND SECURED AS REQUIRED TO PREVENT DISPLACEMENT IN THE FORMS.
  - D) TIE STEEL TO PREVENT DISPLACEMENT. HOOK AND TIE STEEL AS POSSIBLE. TIES, CHAIRS, OR OTHER PRODUCTS SHALL BE PROTECTED WHEN LOCATED NEAR EXPOSED SURFACES.
  - E) STEEL SHALL BE STORED ON SITE ABOVE GRADE, AND COVERED AS REQUIRED FOR PROTECTION FROM RAIN AND OTHER POSSIBLE DAMAGE.
  - F) ADJUST FOUNDATION FOR SITE AND SOIL CONDITIONS AND VERIFY WITH EOR.

**DIVISION 4 - MASONRY**


- COMPRESSIVE STRENGTH OF CONCRETE MASONRY CONSTRUCTION (CMU) SHALL BE AS FOLLOWS (PSI). MASONRY STRENGTH NOT SPECIFICALLY NOTED ON PLAN SHALL BE (f<sub>m</sub>) 1500 PSI.
 

MASONRY STRENGTH (f <sub>m</sub> DESIGN)	1500
BLOCK STRENGTH	1900
MORTAR STRENGTH	1800
GROUT STRENGTH	2000
  - CONCRETE BLOCK SHALL BE HOLLOW LOAD-BEARING CONCRETE MASONRY UNITS CONFORMING TO ASTM C 90, TYPE N-III. ALL BLOCKS SHALL BE PLACED IN RUNNING BOND CONSTRUCTION (UNLESS OTHERWISE NOTED) WITH ALL VERTICAL CELLS IN ALIGNMENT.
  - MORTAR MIX SHALL CONFORM TO THE REQUIREMENTS OF ASTM C 270, TYPE M OR S. TYPE M MORTAR SHALL BE USED WHERE MASONRY IS IN CONTACT WITH SOIL.
  - GROUT SHALL CONFORM TO THE REQUIREMENTS OF ASTM C 476. USE SUFFICIENT WATER FOR GROUT TO FLOW INTO ALL JOINTS OF THE MASONRY WITHOUT SEGREGATION. ALL CELLS IN CONCRETE BLOCKS CONTAINING REINFORCING SHALL BE FILLED SOLID WITH GROUT. ALL MASONRY FINISHED FLOOR OR GRADE SHALL BE GROUTED SOLID. HOLD GROUT DOWN 1-1/2" BELOW TOP OF BLOCK AT GROUT LIFT JOINTS AND AT CONCRETE PLACED OVER MASONRY.
  - MINIMUM LINTEL, WHERE NOT ON PLANS, SHALL HAVE A MINIMUM OF 2 - #9'S CONTINUOUS HORIZONTAL BARS IN BOTTOM OF BOND BEAM OR LINTEL BLOCK AND SHALL BE GROUTED SOLID TO A MIN. DEPTH OF 24". ALL LINTEL REINFORCING AND GROUT SHALL EXTEND 2' MINIMUM PAST JAMBS UNLESS NOTED OTHERWISE ON PLANS OR DETAILS.
  - LAP REINFORCING 48 BAR DIAMETERS. STAGGER LAP SPICES A MINIMUM OF ONE LAP LENGTH.
  - MASONRY VENEER SHALL BE ATTACHED TO SUPPORT WALL, FRAMING WITH 3/8" DIAMETER WALL TIES OR DOVETAIL-TYPE METAL TIES OF EQUIVALENT STIFFNESS EMBEDDED INTO HORIZONTAL MORTAR JOINTS. MAXIMUM VERTICAL SPACING OF TIES SHALL BE 16". MAXIMUM HORIZONTAL SPACING SHALL BE 24". TIES IN ALTERNATE COURSES SHALL BE STAGGERED. PROVIDE #9 WIRE REINFORCING IN HORIZONTAL MORTAR JOINTS AT 16" OC. ENGAGE #9 WIRE WITH WALL ANCHOR TIES. CONSTRUCTION JOINTS IN MASONRY VENEER WALLS SHALL BE LOCATED PER THE DRAWINGS.
  - WATERPROOFING, DRAINAGE PLANE, AND INSTALLATION PER ADOPTED BUILDING CODE.
- DIVISION 5.5 - MISC. STRUCTURAL STEEL**
- ALL MISCELLANEOUS STRUCTURAL STEEL WORK SHALL CONFORM TO THE REQUIREMENTS OF AISC "SPECIFICATIONS FOR DESIGN, FABRICATION, AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS".
  - MISCELLANEOUS STRUCTURAL STEEL MATERIAL SHALL COMPLY WITH:
    - A) STRUCTURAL STEEL - ASTM A992
    - B) STEEL PIPE COLUMNS - ASTM A53 GRADE B (SCH 40 TP)
    - C) ANCHOR BOLTS - ASTM A307 GRADE A, NON-HEADED TYPE UNLESS OTHERWISE NOTED.
  - FITCH PLATES SHALL HAVE 3/4" DIA BOLTS @ 16" OC, STAGGERED TOP AND BOTTOM BETWEEN JOIST LAYOUT.


**RETURN WALLS**

UNBALANCED BACKFILL HT.	RETURN SPACING (HOLD DOWN 24" BELOW GRADE)
UP TO 5'	RETURN WALLS NOT REQ'D
5' TO 9'	16"-4" ON CENTER (MAX), AND/OR WITHIN 8' OF STEP DOWN

\* RETURN WALLS ALLOW FOR BACKFILL w/o FLOOR DECK IN PLACE FOR 60 PCF EQUIVALENT FLUID WEIGHT SOIL. NO HEAVY EQUIPMENT OR SURCHARGE LOADING.

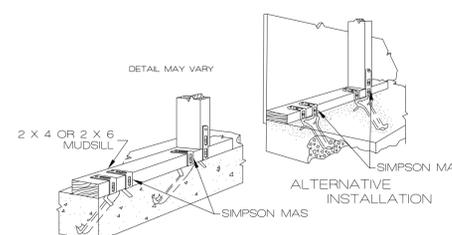

NTS 10 D1 OPT. MUDDSILL ANCHORAGE ALTERNATIVE TO J-BOLTS

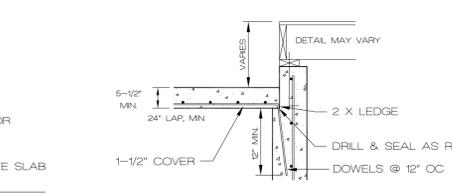




NTS 6 D1 SLAB @ WALL SLAB ON FILL CONCRETE OR CMU

**CONC STRENGTH**

FTG	REQ'D STRENGTH
WALL	3000 psi
SLAB	3500 psi
SUB-SLAB	7 SACK MIX

**DIVISION 6 - ROUGH CARPENTRY**

- ALL ROUGH CARPENTRY WORK SHALL CONFORM TO THE REQUIREMENTS OF NFPA "NATIONAL DESIGN SPECIFICATION OF WOOD CONSTRUCTION", TR "DESIGN SPECIFICATIONS FOR LIGHT METAL PLATE CONNECTED WOOD TRUSSES", APA "PLYWOOD DESIGN SPECIFICATIONS", DCC PS 1 "PRODUCT STANDARD FOR CONSTRUCTION AND INDUSTRIAL PLYWOOD", DCC PS 56 "STRUCTURAL GLUED LAMINATED TIMBER", AND APPLICABLE SECTIONS OF THE INTERNATIONAL BUILDING CODE.
  - LUMBER - S4S, S-DRY, KD, OR S-GRN GRADE MARKED, COMPLYING WITH PS 20, GRADED UNDER WWPA OR SPIB RULES.
    - STUDS: STUD GRADE
    - HEADER: #2 DOUGLAS FIR MIN TYPICAL
    - RAFTER: #2 DOUGLAS FIR
    - PLATES: #2 DOUGLAS FIR
    - BLOCKING: #2 DOUGLAS FIR
  - METAL FRAMING FASTENERS - ASTM A 153, HOT-DIP GALVANIZED FASTENERS, EQUAL TO SIMPSON STRONG-TIE CONNECTORS COMPLYING WITH APPLICABLE ICC-ES REPORTS.
  - PLYWOOD - APA RATED SHEATHING, COMPLYING TO PS 1.
  - LVL - LAMINATED VENEER LUMBER SHALL BE GRADE 2800 F-20E AND SHALL MEET THE REQUIREMENTS OF APPLICABLE ICC-ES REPORTS.
  - GLULAM BEAMS - COMBINATION 24F-V3 IN ACCORDANCE WITH AITC A1901.
- EXTERIOR WALL AND ROOF SHEATHING SHALL BE 5/8" APA RATED SHEATHING 24/0 EXTERIOR GLUED (MN) FOR 16" OC STUD SPACING. NAIL SHEATHING TO SUPPORT MEMBERS WITH 8D COMMON NAILS AT 4" ON CENTER ALONG EDGE SUPPORTS AND 12" ON CENTER ALONG FIELD SUPPORTS UNLESS NOTED OTHERWISE. PROVIDE SOLID BLOCKING AT ALL UNSUPPORTED PANEL EDGES.
  - INTERIOR SHEAR WALL SHEATHING WHERE NOTED SHALL BE 5/8" APA RATED SHEATHING 24/0 EXTERIOR GLUED (MN) FOR 16" OC STUD SPACING. NAIL SHEATHING TO SUPPORT MEMBERS WITH 8D COMMON NAILS AT 4" ON CENTER ALONG EDGE SUPPORTS AND 12" ON CENTER ALONG FIELD SUPPORTS UNLESS NOTED OTHERWISE. PROVIDE SOLID BLOCKING AT ALL UNSUPPORTED PANEL EDGES.
- ATTACH METAL FRAMING FASTENERS TO FRAMING MEMBERS WITH MINIMUM NUMBER AND SIZE OF NAILS LISTED IN THE APPLICABLE ICC-ES REPORTS.
- WOOD TRUSS SYSTEM, TRUSS JOIST SYSTEM AND GLULAM SYSTEM FOR ROOFS:
  - DESIGN, FABRICATE, AND ERECT IN ACCORDANCE WITH BCSI STANDARDS AND NDS SPECIFICATIONS.
  - DESIGN LOADS:
    - 25 PSF SNOW LIVE LOAD
    - 10 PSF DEAD LOAD TOP CHORD (20 TILE)
    - 10 PSF DEAD LOAD BOTTOM CHORD
  - SUBMIT SHOP DRAWINGS, INCLUDING DESIGN CALCULATIONS, MATERIAL STRESSES, GRADE AND SPECIES OF WOOD, AND PLACEMENT DRAWING.
- DEFAULT HEADER SIZE NOT SPECIFIED SPANNING 8'-0" MAX SHALL BE 2 - 2 X 10 #2 WITH 2 STUD SUPPORT.
- ALL HEADERS OVER 4'-0" SHALL HAVE DOUBLE TRIMMER @ EACH SUPPORT, OR AS SPECIFIED, UNO.
- SOLID BLOCKING BETWEEN JOISTS @ 36" OC FOR JOISTS PARALLEL TO THE EXTERIOR FOUNDATION WALL, MIN. 48" OR 3 JOIST SPACES.
- ALL FLUSH FRAMING @ HEADERS OR GIRDERS SHALL BE HANGERED.
- BLOCK BETWEEN JOISTS @ SUPPORTS OR OVER BEAMS.
- RATED CONSTRUCTION FOR PROJECTIONS INTO SETBACKS AS REQ'D.
- DOUBLE JOIST BELOW PARALLEL NONBEARING WALLS ON LAYOUT, SINGLE JOIST OFF LAYOUT. STRUCTURE BELOW LOAD-BEARING WALLS AS NOTED ON PLANS.

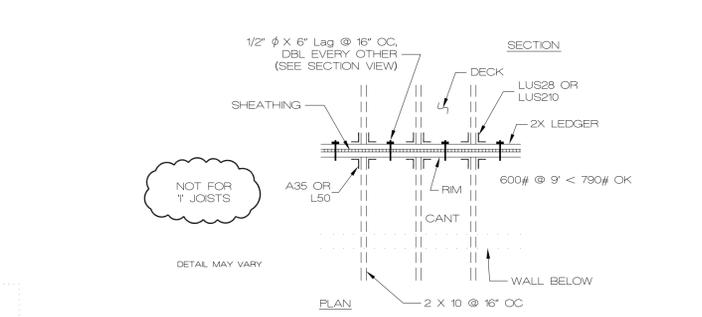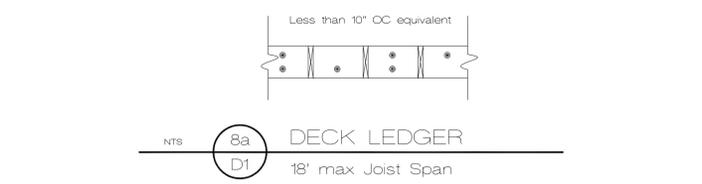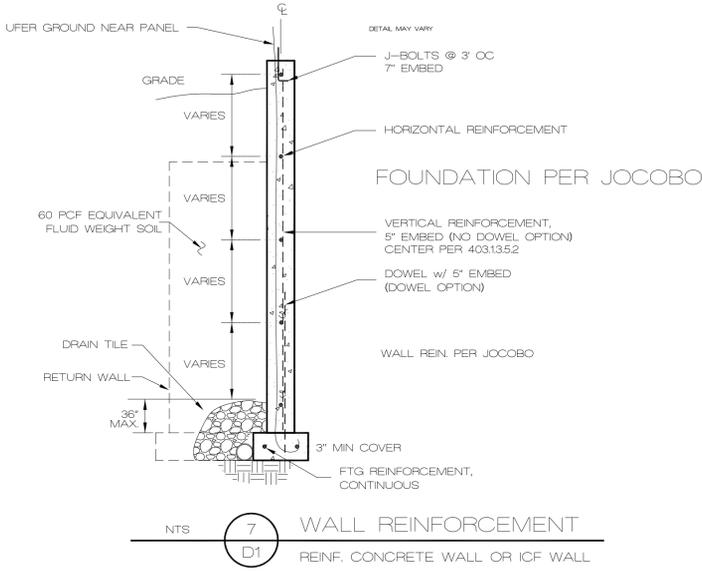

NTS 8b D1 DECK @ CANTILEVER

**FOUNDATION PER JACOBO RESIDENTIAL FOUNDATION GUIDELINE**

**WALL REINFORCING**

8" THICK	8' THICK			10' THICK		
	8'	9'	10'	8'	9'	10'
3000, GR40	16	12	12	24	16	12
3500, GR40	16	12	12	24	24	12
3000, GR60	24	16	16	24	20	16
3500, GR60	24	16	16	24	24	16

**HOR. REIN. MIN. GR40 #4**

One bar 12" from top & 24" oc max	4 #4	5 #4	4 #4	5 #4	6 #4
-----------------------------------	------	------	------	------	------


Garage Slab:  $M_{max} = \frac{w_u \cdot L^2}{16} = 27206 \#-ft$

Basement Slab:  $M_{max} = \frac{w_u \cdot L^2}{14} = 25951 \#-ft$

$a = \frac{A_s \cdot f_y}{0.85 \cdot f'_c \cdot b} = \frac{40000 \cdot 0.2}{0.85 \cdot 3500 \cdot 12} = 0.22$

$\phi M_n = \phi A_s \cdot f_y \cdot (d - \beta/2) = 0.9(0.2)(40000)(4 - 0.22(2)) = 28,008 \#-ft > 27,206 (OKAY)$

$\therefore$  Use #4 @ 12" OC EW 12'-6" (+/-) MODULE

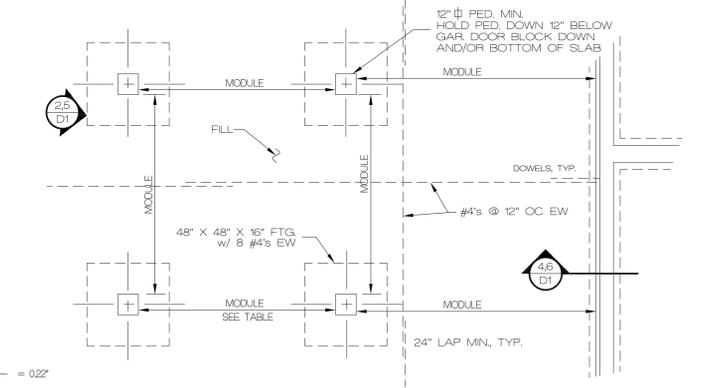

NTS 9 D1 STRUCTURAL SLAB ON FILL

DO NOT SAW CUT STRUCTURAL SLABS w/o APPROVAL. VERIFY ALL STRUCTURAL SLAB DETAILS w/ ENGINEER. DO NOT ISOLATE COLUMNS FROM STRUCTURAL SLABS.

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI 01/29/2021

**Ken Sidorowicz, PC**

P.O. Box 12089, Parkville, Missouri 64152  
Tel. (816) 741-0852 Fax (816) 741-0858




ISSUE DATE	11/2/15
REVISIONS	

**2018 DETAIL SHEET**

STATE OF MISSOURI  
KENNETH SIDOROWICZ  
NUMBER E-19986  
PROFESSIONAL ENGINEER



1/25/21

**D1**

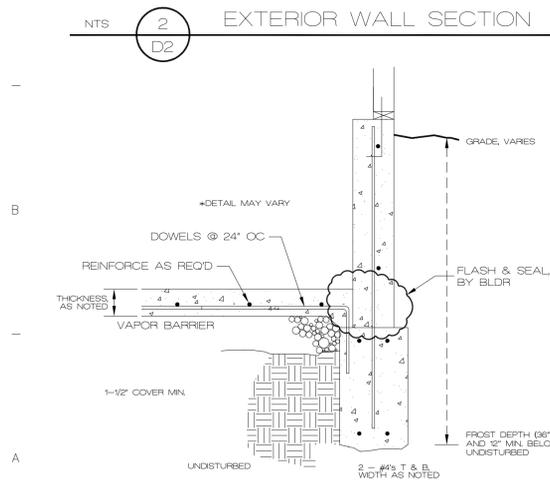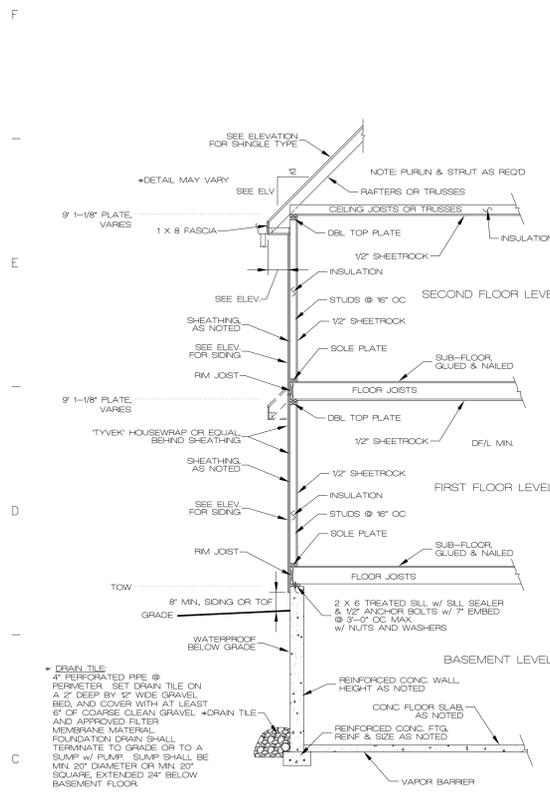
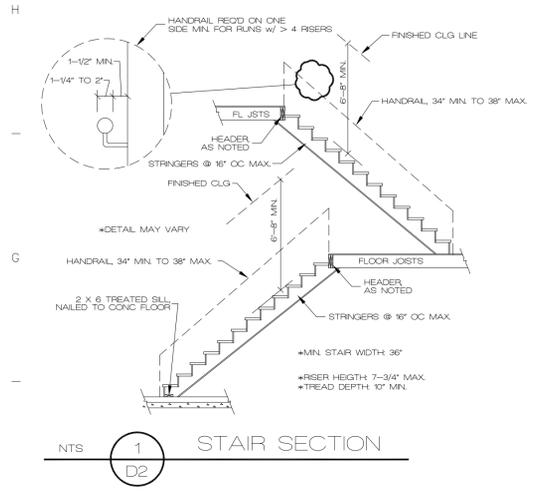


**GENERAL CODE NOTES**








- GLASS** - GLAZING IN THE FOLLOWING LOCATIONS SHALL BE OF APPROVED SAFETY GLASS MATERIALS: STORM DOORS, PANELS ADJACENT TO A DOOR WHERE THE NEAREST RAFTERS EXCEED 24" ON CENTER, AND DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR WALLS ENCLOSING STAIRWAYS AND LANDINGS WHERE THE GLASS IS WITHIN 60" OF THE TOP OR BOTTOM OF THE STAIR ENCLOSURES FOR SPAS, TUBS, SHOWERS, AND GLASS EXCEEDING 9" AFF, AND WHOSE BOTTOM EDGE IS LESS THAN 18" AFF. OR WALKING SURFACES WITHIN 48" OF A MINIMUM OF ONE EGRESS WINDOW SHALL BE PROVIDED IN EACH BEDROOM AND ONE FROM THE BASEMENT WITH A MINIMUM OPENING AREA OF 5.7 SQ. MINIMUM HEIGHT OF 24 INCHES AND MINIMUM WIDTH OF 20 INCHES. THE CREASIBLE PORTION SHALL NOT EXCEED 10 INCHES AFF. WATER RESISTANT WINDOW WELLS AS REQD.
- SMOKE DETECTORS** - PROVIDE SMOKE ALARMS IN EACH SLEEPING ROOM OUTSIDE OF EACH SLEEPING AREA AND ON EACH FLOOR AT THE STAIRS INCLUDING A MAXIMUM OF 4 ARMS SHALL BE INTERCONNECTED SO THE ACTUATION OF ONE ALARM WILL ACTIVATE ALL SMOKE DETECTORS IN THE DWELLING.
- CARBON MONOXIDE DETECTORS** REQD OUTSIDE EACH SLEEPING AREA IN DWELLING UNITS WITH FUEL-FIRED APPLIANCES AND/OR ATTACHED GARAGES, AND IN APPLIANCE AREAS.
- INSULATION REQUIREMENTS** - INSULATION VALLES SHALL COMPLY WITH APPLICABLE 2018 IRC STANDARDS.
- ATTIC VENTILATION** - THE NET FREE VENTILATION AREA SHALL BE NOT LESS THAN 1/800 OF THE AREA OF THE SPACE BEING VENTILATED. THE NET VENTILATION AREA MAY BE REDUCED TO 1/1000 IF 50% TO 100% OF THE VENTILATION AREA IS PROVIDED BY VENTILATOR LOCATED IN THE UPPER PORTION OF THE SPACE TO BE VENTILATED, AT LEAST 3 FT ABOVE EAVES OR CORNICE VENTS. RAFTERS SPACES ENCLOSED BY CEILING SHALL BE PROPERLY APPLIED TO UNDERSIDE OF RAFTERS SHALL BE SIZED TO ALLOW A MINIMUM OF 1 INCH CLEAR VENTED AIR SPACE ABOVE THE INSULATION. ATTICS WITH A MAXIMUM VERTICAL CLEAR HEIGHT OF LESS THAN 30 INCHES ARE NOT REQD TO HAVE ACCESS OPENING.
- MAKE-UP/COMBUSTION AIR** - MAKE-UP OR COMBUSTION AIR SHALL BE PROVIDED FROM OUTSIDE AS REQD FOR KIT, EXHAUST COVER 400 cfm, FURNACE OR WH THRU ROOF OR OUTSIDE WALL.
- HVAC IGNITION SOURCE** - EQUIPMENT AND APPLIANCES WITH AN IGNITION SOURCE THAT ARE LOCATED IN THE GARAGE OR GARAGE CLOSET SHALL BE ELEVATED SUCH THAT THE SOURCE OF IGNITION IS NOT LESS THAN 18" ABOVE THE FLOOR, OR ARE LISTED AS FLAMMABLE VAPOR RESISTANT AND FOR INSTALLATION WITHOUT ELEVATION.
- EXHAUST AIR** - ALL EXHAUST FANS SHALL EXHAUST DIRECTLY TO THE BUILDING EXTERIOR.
- GARAGE FLOOR SLOPE** - GARAGE FLOORS SHALL SLOPE 2% MIN. TO THE GARAGE DOORS, AN OPEN TRENCH OR AN UNTRAPPED DRAIN THAT DISCHARGES DIRECTLY TO THE TO THE EXTERIOR GRADE.
- FINISHED GRADE** - THE FINISHED GRADE OF THE YARD SHALL SLOPE 6% MIN. WITHIN THE FIRST 10 FEET, THEN 2% MIN. IN ALL OTHER AREAS.
- WINDOWS** - WINDOW FLASHING AND INSTALLATION MANUAL FROM MANUFACTURER SHALL BE ON SITE.
- WATER HEATER** - PROVIDE MEANS OF CONTROLLING PRESSURE CAUSE BY THERMAL EXPANSION IF THE WATER REGULATOR IS PROTECTED BY A PRESSURE REGULATOR.
- A WATER TEMPERATURE LIMITING DEVICE** IS REQUIRED ON BATHROOMS AND JACUZZIS LIMITING THE TEMPERATURE TO 120°F.
- SUMP** - THE SUMP PIT SHALL BE EQUIPPED WITH A PUMP AND DEDICATED RECEPTACLE. IN UNFINISHED PORTIONS OF THE BASEMENT, RECEPTABLES SHALL HAVE GFI PROTECTION.

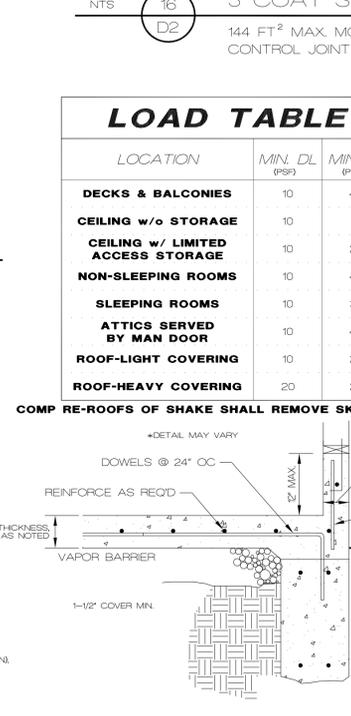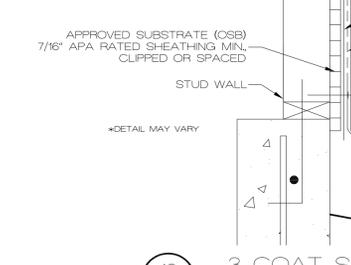

- SHOWER/WET WALLS** - USE CEMENT BOARD (INSTALLED PER MANU) BEHIND GLEU TILE. DO NOT USE GREEN BOARD. COVER ALL JOINTS WITH WATER RESISTANT SEALANT. FINISH TO EXTEND 72" ABOVE DRAIN.
- CECS** - SHALL BE LOCATED IN THE GARAGE. AT ALL KITCHEN COUNTER RECEPTACLES, IN BATHROOMS, AT ALL OUTDOOR RECEPTACLES, AND THOSE WITHIN 6' OF SINKS, SPA AREAS, GFCI WITHIN 12' AND 35' NO RECEPTACLE WITHIN 5', AND NO SWITCH WITHIN 5'. WITHIN 36" OF BATHROOM OR POWDER LAVATORY. PLUG-IN-PLANE COVERS AS REQD.
- DRYWALL** - GARAGES AND ENCLOSED SPACE BELOW STAIRS SHALL HAVE 5/8" TYPE X ON CEILING, BEAM COLUMN, AND ON COMMON WALLS WITH LIVING SPACE.
- APPLIANCES** - SHALL BE DIRECT VENT. VENT TERMINALS SHALL BE LOCATED PER CODE WITH THE BOTTOM OF VENT NOT LESS THAN 12" ABOVE FINISHED GRADE, AND DRYER SHALL HAVE 4" DIAMETER EXHAUST DUCT TO EXTERIOR WITH A MAXIMUM LENGTH OF 25 FEET. ALL DUCT SYSTEMS SHALL BE AIR TIGHT.
- FURNACE** - SHALL HAVE 18" CLEARANCE ON CONTROL SIDE, AND 12" CLEARANCE ON ALL OTHER SIDES.
- LAWN IRRIGATION** - THE POTABLE WATER SUPPLY SHALL BE PROTECTED BY BACKFLOW PREVENTION. ALL OUTDOOR RECEPTABLES AND WITHIN 6' OF ANY SINK, SPA AREAS, GFCI WITHIN 12' AND 35', NO RECEPTACLE WITHIN 5', AND NO SWITCH WITHIN 5'.
- PLUMBING EXISTENCES** - FIXTURES WITH A FLOOD LEVEL BELOW THE ELEVATION OF THE NEXT UPSTREAM PUBLIC SEWER MANHOLE COVER SHALL BE PROTECTED WITH AN APPROVED BACKWATER VALVE (INCLUDING DRAINAGE DISCHARGER). BASEMENT HOSE CONNECTIONS SHALL HAVE AN ANTI-SIPHON DEVICE INSTALLED. ACCESS TO PUMPS UNDER WHIRPOOL SHALL BE 18" X 18" MIN.
- GAS PIPING** - GAS PIPING SERVING A TOWNHOUSE SHALL NOT PASS THROUGH ADJACENT UNITS.
- ELECTRICAL EXISTENCES** - FIXTURES IN DAMP AND WET LOCATIONS SHALL BE LISTED AS SUITABLE FOR THAT LOCATION.
- RECEPTACLE OUTLETS** SHALL BE SPACED 6" MAX (MEASURED HORIZONTALLY ALONG FLOOR LINE) AND IN ANY WALL SPACE 2' WIDE OR GREATER.
- BONDING** - ALL METALLIC BODIES SHALL BE BONDED. PROVIDE BONDING TO ALL METAL PIPING, GAS, AND OTHER BUILDING SYSTEMS. PROVIDE BOND JUMPER ACROSS METALLIC HOT AND COLD WATER LINES AT THE WATER HEATER.
- BRANCH CIRCUITS** - BATHROOM RECEPTABLES SHALL BE SUPPLIED BY MINIMUM OF ONE 20-AMP BRANCH CIRCUIT. SURPLYING NO OTHER OUTLETS. PROVIDE SEPARATE 20-AMP BRANCH CIRCUIT FOR LAUNDRY. PROVIDE MINIMUM OF TWO 20-AMP SMALL APPLIANCE BRANCH CIRCUITS FOR THE KITCHEN/DINING/BREAKFAST.
- GLAZING OPENINGS** - OPENINGS IN REQD GUARDS SHALL NOT PERMIT THE PASSAGE OF A 4" SPHERE FROM THE WALKING SURFACE TO THE REQD GUARD HEIGHT.
- WINDOW SILLS** - IN DWELLING UNITS, WHERE THE OPENING OF AN OPERABLE WINDOW IS LOCATED MORE THAN 72 INCHES ABOVE FINISHED GRADE OR SURFACE BELOW, THE LOWEST PART OF THE CLEAR OPENING OF THE WINDOW SHALL BE A MIN. OF 24 INCHES AFF. OF THE ROOM IN WHICH THE WINDOW IS LOCATED. GLAZING BETWEEN THE FLOOR AND 24 INCHES SHALL BE FIRED OR HAVE OPENINGS THROUGH WHICH A 4 INCH DIA. SPHERE CANNOT PASS.

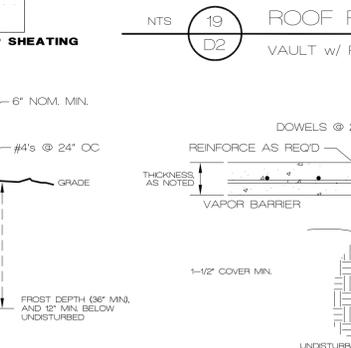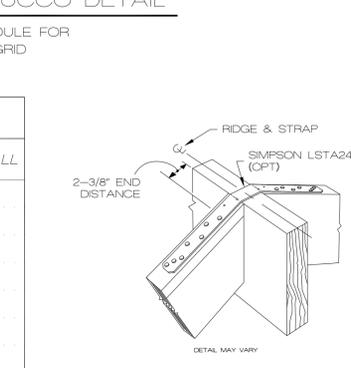

- ENERGY EFFICIENCY NOTES**
- RECESSED LIGHTING SHALL BE IC RATED, LEAKAGE RATED AND SEALED TO PREVENT LEAKAGE BETWEEN CONDITIONED AND UNCONDITIONED SPACE.
  - ALL DUCTS, AIR HANDLERS, FILTER BOXES AND BUILDING CAVITIES USED AS DUCTS SHALL BE SEALED AND INSULATED PER N103.3.
  - THE AIR CONDITIONER MUST HAVE MINIMUM SEER RATING OF 13 MIN. ANY FORKED AIR FURNACE MUST HAVE MINIMUM 78% EFFICIENCY RATING.
  - DWELLINGS MUST MEET OR EXCEED THE MINIMUM INSULATION & RESTORATION (WITH NO TRADE OFFS) REQUIREMENTS PER THE IRC TABLE N102.2.
  - THE BUILDING THERMAL ENVELOPE SHALL BE SEALED PER IRC SECTION N102.4.
  - MECHANICAL SYSTEM PIPING INSULATION SHALL COMPLY WITH N103.3.
  - HEAT PUMP SUPPLEMENTARY HEAT SHALL COMPLY WITH N103.2.
  - HVAC CONTROLS SHALL COMPLY WITH N103.1.
  - CERTIFICATE SHALL COMPLY WITH N104.4.
  - FUEL GAS LIGHTING EQUIPMENT SHALL COMPLY WITH N104.1.1.
  - BUILDING AIR LEAKAGE SHALL COMPLY WITH N102.4.
- INSULATION VALUES:**
- CEILING R-VALUE (R-49)
  - CATHEDRAL CEILING R-VALUE (R-38) Comply w/ 50' ft
  - EXTERIOR WALL (R-13) 2 x 4 (R-19) 2 x 6
  - CRANK SPACE WALL (R-13) CAVITY OR R-13 CONTINUOUS
  - GLAZING (U-FACTOR LESS THAN OR EQUAL TO 0.43)
  - FLOOR OVER UNHEATED SPACE (R-19)
  - FLOOR OVER OUTSIDE AIR (R-20)
  - BASEMENT WALLS (R-13) CAVITY OR R-10 CONTINUOUS
  - SLAB ON GRADE (R-10) FOR 2' TRENCH FOOTINGS (R-10) FOR 2' DEPTH. R-5 FOR HEATED SLABS.
  - DUCTS IN ATTIC (R-4) SUPPLY & RETURN (R-6) IF LESS THAN 9" IN DIAMETER. OTHER PORTIONS OF BUILDING (R-6) AND R-42 IF LESS THAN 3" IN DIAMETER UNLESS INSIDE THE THERMAL ENVELOPE.
- CEILING FUR DOWN**  
NTS 18 D2

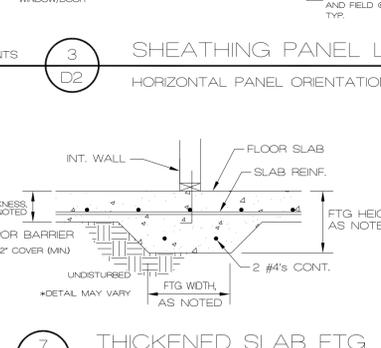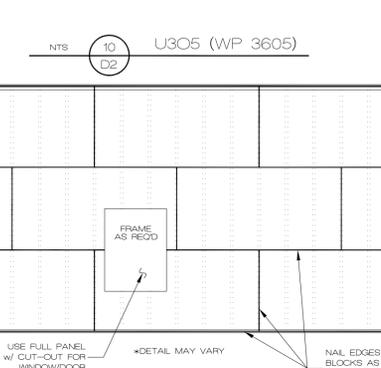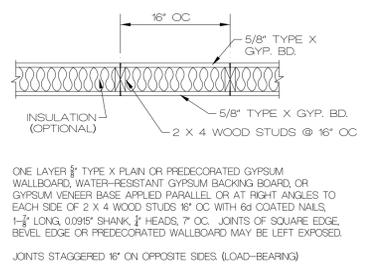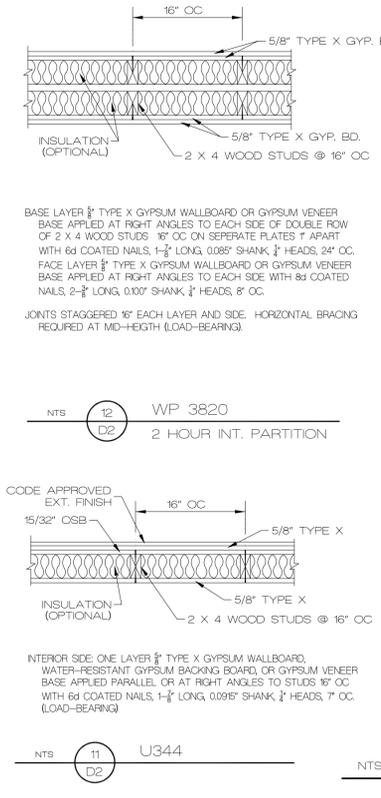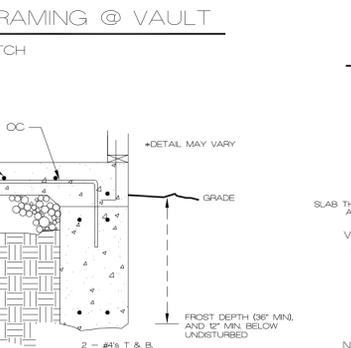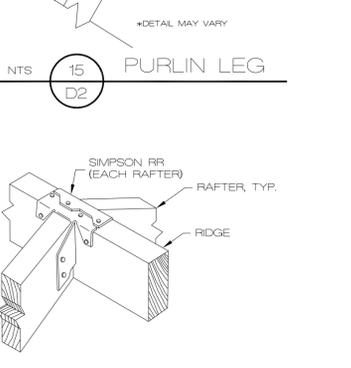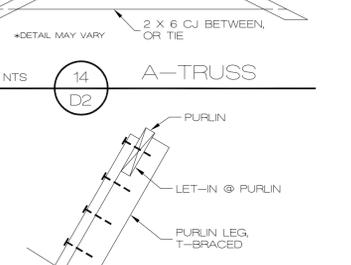

LOAD TABLE		
LOCATION	MIN. DL (PSF)	MIN. LL (PSF)
DECKS & BALCONIES	10	40
CEILING w/o STORAGE	10	10
CEILING w/ LIMITED ACCESS STORAGE	10	20
NON-SLEEPING ROOMS	10	40
SLEEPING ROOMS	10	30
ATTICS SERVED BY MAN DOOR	10	40
ROOF-LIGHT COVERING	10	20
ROOF-HEAVY COVERING	20	20

**Ken Sidorowicz, PC**

ISSUE DATE

REVISIONS

**2018 DETAIL SHEET**



**D2**

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI  
01/29/2021

P.O. Box 12089, Parkville, Missouri 64152  
Tel. (816) 741-0852 Fax (816) 741-0858

# STAPLES NOT PERMITTED IN KCMO

## FASTENER SCHEDULE FOR STRUCTURAL MEMBERS

Item	Description of building elements	Number & type of fastener (notes, ts, cl)	Spacing of fasteners
<b>Floor</b>			
1	Blocking between joists or rafters to top plate, toe nail	3-8d (2-1/2" x 0.137)	
2	Blocking joists to plate, toe nail	3-8d (2-1/2" x 0.137)	
3	Coiler plate not attached to parallel rafter, legs over partitions, face nail	3-8d	
4	Coiler to rafter, face nail or 1-1/4" x 3/8 galv. strap	3-10d (3" x 0.149)	
5	Rafter to plate, toe nail, note: trusses use 8TC clips at NLB walls and aspect holdowns	3-8d or 3-10d (3-1/2" x 0.149, 0.149)	2, toe nails side 1, 1 toe nail side 2 (note 5)
6	Floor rafter to ridge, valley or hip rafter		
7	Toe nail	4-8d (3-1/2" x 0.137)	
8	Face nail	3-8d (3-1/2" x 0.137)	
<b>Wall</b>			
9	Build-up studs at intersecting wall corners, face nail	10d (3" x 0.137)	24" oc
10	Build-up header, two pieces w/ 1/2" spacer	10d (3-1/2" x 0.137)	12" oc
11	Build-up header, two pieces	10d (3-1/2" x 0.137)	18" oc along each edge
12	Continuous header to stud, toe nail	10d (3-1/2" x 0.137)	18" oc along each edge
13	Double studs, face nail	10d (3" x 0.137)	24" oc
14	Double top plates, face nail	10d (3" x 0.137)	24" oc
15	Double top plates, min. 16" offset of end joints, face nail in lapped area	10d (3-1/2" x 0.137)	24" oc
16	Double top plates, min. 16" offset of end joints, face nail in lapped area	10d (3-1/2" x 0.137)	24" oc
17	Side plate to joint or blocking, face nail	10d (3-1/2" x 0.137)	18" oc
18	Side plate to joint or blocking at braced wall panels	3-8d (3-1/2" x 0.137)	18" oc
19	Stud to side plate, toe nail	3-8d (3-1/2" x 0.137)	
20	Top or side plate to stud, end nail	2-8d (3-1/2" x 0.137)	
21	Top plate, face all corners and intersections, face nail	2-10d (3" x 0.137)	
22	7" brace to each stud and plate, face nail	2-8d (3-1/2" x 0.137)	
23	7" x 8" sheathing to each bearing, face nail	2 staples 1-3/4"	
24	7" x 8" sheathing to each bearing, face nail	2-8d (3-1/2" x 0.137)	
25	Wider than 7" x 8" sheathing to each bearing, face nail	3 staples 1-3/4"	
26	Wider than 7" x 8" sheathing to each bearing, face nail	3-8d (3-1/2" x 0.137)	
<b>Floor</b>			
27	Joist to sill or girder, toe nail	3-8d (3-1/2" x 0.137)	
28	7/8" joist to top plate, toe nail (roof applications also)	8d (2-1/2" x 0.119)	6" oc
29	7/8" joist to top plate, toe nail	8d (2-1/2" x 0.119)	6" oc
30	7" x 8" subfloor or less to each joist, face nail	2 staples 1-3/4"	
31	2" subfloor to joist or girder, blind and face nail	2-8d (3-1/2" x 0.137)	
32	2" planks (sawn & beam) - floor and roof	2-8d (3-1/2" x 0.137)	
33	Build-up girders and beams, 2" lumber eyes	10d (3" x 0.137)	
34	Ledger strip supporting joists or rafters	3-8d (3-1/2" x 0.137)	
<b>Wood structural panels, subfloor, roof and interior wall sheathing to framing and parakeboard wall sheathing to framing</b>			
35	3/8" x 1/2"	8d common (2" x 0.119) nail (subfloor, wall) (note 5)	12 (note 6)
36	3/8" x 1/2"	8d common (2-1/2" x 0.137) nail (roof)	12 (note 6)
37	1-1/8" to 1-1/4"	10d common (3" x 0.149) nail or 8d deformed (2-1/2" x 0.137) nail	12
<b>Other wall sheathing (note 1)</b>			
38	1/2" gypsum sheathing	1-1/2" galv. roofing nail, 7/16" crown or 7" crown staple 18 ga., 1-1/4" long	6
39	5/8" gypsum sheathing	1-3/4" galv. roofing nail, 7/16" crown or 7" crown staple 18 ga., 1-1/2" long	6
40	1/2" gypsum sheathing (note 2)	1-1/2" galvanized roofing nail, staple galv.	7
41	5/8" gypsum sheathing (note 2)	1-1/2" galv. roofing nail, 7/16" crown or 7" crown staple 18 ga., 1-1/2" long	7
<b>Wood structural panels, combination subfloor underlayment to framing</b>			
42	3/4" and less	8d deformed (2" x 0.137) nail or 8d common (2-1/2" x 0.137) nail	12
43	7/8" to 1"	8d common (2-1/2" x 0.137) nail or 8d deformed (2-1/2" x 0.137) nail	12
44	1-1/8" to 1-1/4"	10d common (3" x 0.149) nail or 8d deformed (2-1/2" x 0.137) nail	12

For 8 1/8" = 254 mm, 1 foot = 3048 mm, 1 mile per hour = 0.447 m/s, 1 psi = 6896 MPa

a. All nails are smooth-common, box or deformed shank except where otherwise stated. Nails used for framing and sheathing conditions shall have minimum average bending yield strength as shown: 80 ksi (550 MPa) for shank diameter of 0.082 inch (2.08 mm), 80 ksi (550 MPa) for shank diameter larger than 0.082 inch but not larger than 0.077 inch, and 100 ksi (689 MPa) for shank diameter of 0.062 inch or less.

b. Staples are 9 gauge wire and have a minimum 700-psi tensile strength.

c. Nails shall be spaced at not more than 6 inches on center at all supports where spans are 48 inches or greater.

d. Floor-to-top-of-roof or 4-foot-to-8-foot spans shall be spaced vertically.

e. Spacing of members not treated in this table shall be verified by ECR.


f. For regions having basic wind speed of 100 mph or greater, 8d deformed nails shall be used for attaching plywood and wood structural panel sheathing to framing within minimum 48-inch distance from gable end walls. If mean roof height is more than 25 feet, use 10d minimum.

g. For regions having basic wind speed of 100 mph or less, nails for attaching wood structural panel sheathing to gable end wall framing shall be spaced 6 inches on center. When basic wind speed is greater than 100 mph, nails for attaching panel sheathing to intermediate supports shall be spaced 6 inches on center for minimum 48-inch distance from ridge, eave and gable end walls and 4 inches on center to gable end wall framing.


h. Gypsum sheathing shall conform to ASTM D3828 and shall be installed in accordance with CR 303. Fiberglass sheathing shall conform to ASTM C 208.

i. Spacing of members on floor sheathing panel edges applies to panel edges supported by framing members and at all four perimeters only. Spacing of members on roof sheathing panel edges applies to panel edges supported by framing members and at all roof panel perimeters. Blocking of roof or floor sheathing panel edges perpendicular to the framing members shall not be required except at intersection of adjacent roof planes. Floor and roof perimeter shall be supported by framing members or solid blocking.

j. Where a rafter is fastened to an adjacent parallel ceiling joist in accordance with this schedule, provide two toe nails on one side of the rafter and toe nails from the ceiling joist to top plate in accordance with this schedule. The toe nail on the opposite side of the rafter shall not be required.

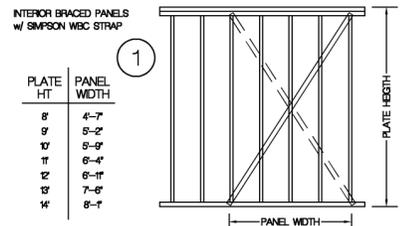


1 INT. BRACED WALL PANEL  
LIB, METAL STRAP ALT. TO LET IN 1 X 4

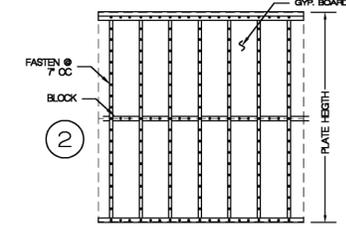


2 INT. BRACED WALL PANEL  
DRYWALL METHOD, GB

1	2	3	4	5
LIB	GB	WSP/CS-WSP	PFH	SINGLE STORY PORTAL
METAL STRAP METHOD	DRYWALL METHOD	SHEATHING METHOD	GARAGE DOOR PORTAL	
ALL METHODS				
NAIL TOP AND BOTTOM PLATES @ 3P'S TO JOISTS ABOVE AND BELOW w/ 3 @ 18d @ 16" OC				
SHEAR WALL DESCRIPTION CONSTRUCTION				
1/2" MIN. GYPSUM BOARD OVER STUDS SPACED 24" OC MAXIMUM AND FASTENED AT 7" OC WITH 5d COOLER OR #6 BUGLE HEAD. HORIZONTAL JOINTS SHALL BE BLOCKED FOR ANCHORAGE.				
7/16" STRUCTURAL SHEATHING OVER STUDS SPACED 16" OC w/ 8d COMMON NAILS AT 4" OC EDGE AND 12" FIELD. HORIZONTAL JOINTS SHALL BE PERPENDICULAR TO WALL LINE. COLLECTOR OR DRAG STRUT OVER.				
DBL JOIST MIN. BELOW BRACED WALL WHEN FRAMING BELOW IS PARALLEL TO WALL LINE OR SOLID BLOCK @ 16" OC BELOW BRACED WALL WHEN FRAMING BELOW IS PERPENDICULAR TO WALL LINE. COLLECTOR OR DRAG STRUT OVER.				
DBL JOIST MIN. BELOW BRACED WALL WHEN FRAMING BELOW IS PARALLEL TO WALL LINE OR SOLID BLOCK @ 16" OC BELOW BRACED WALL WHEN FRAMING BELOW IS PERPENDICULAR TO WALL LINE.				
6 TO 1 ASPECT RATIO. HEADER LENGTH AS SPECIFIED WITH FULL PANEL SHEATHING AT UPPER CORNERS CUT-OUT FOR THE OPENING. BLOCKING AT HORIZONTAL JOINTS. NOTE FULL 4" WIDTH CUT-OUT PANELS REQ'D AT CORNERS. STD10 & LSTA STRAPS				
HEADER LENGTH AS SPECIFIED EXTENDED TO NEXT LAYOUT STUD. 18" MINIMUM WIDTH. 9" FULL PANEL SHEATHING REQ'D WITH CUT-OUTS FOR OPENINGS. HORIZONTAL BLOCKING AT EDGES.				
1/2" BOLT SPACING FOR SHEAR WALLS IS 3' OC WITH STRAPS AS NOTED.				

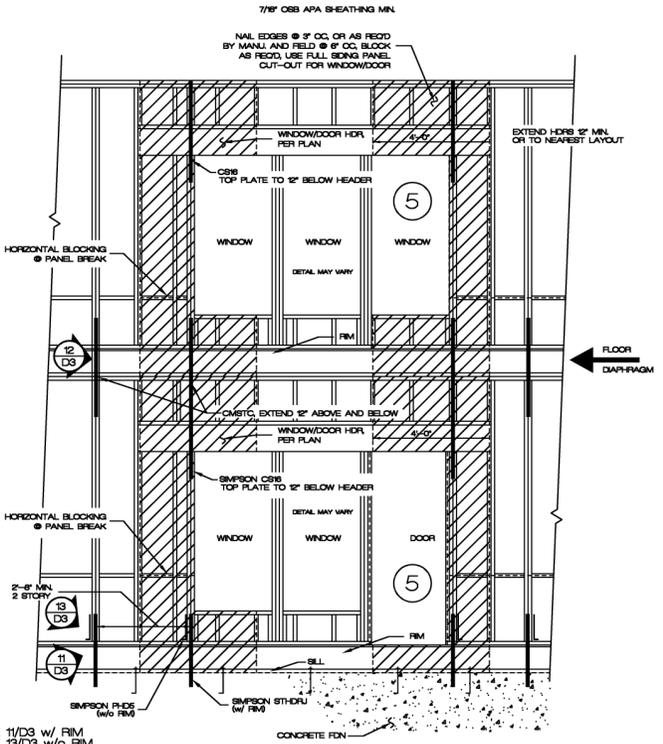


3 EXTERIOR BRACED WALL PANEL  
CS- PF MULTI STORY PORTAL


LOCATION	MIN. DL (PSF)	MIN. LL (PSF)
EXTERIOR BALCONIES	10	60
DECKS	10	40
CEILING w/o STORAGE	5	10
CEILING w/ STORAGE	10	20
NON-SLEEPING ROOMS	10	40
SLEEPING ROOMS	10	30
ROOF-LIGHT COVERING	10	25
ROOF-HEAVY COVERING	20	25

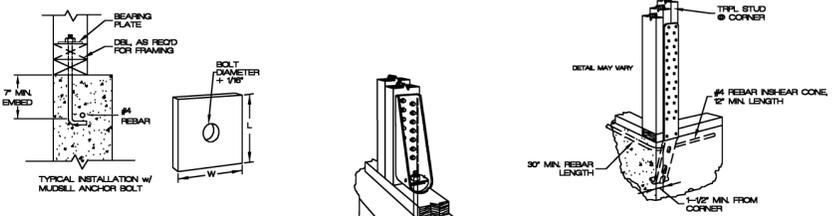


7 SIMPSON BP 1/2 - 3

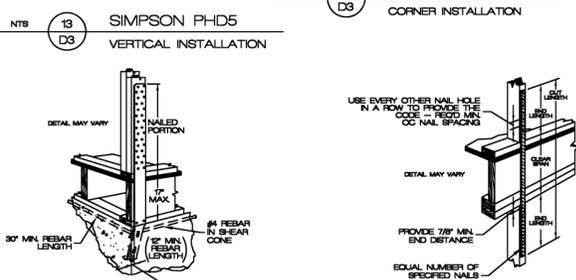


9 SIMPSON SHD CORNER INSTALLATION




10 SIMPSON SHD EDGE INSTALLATION

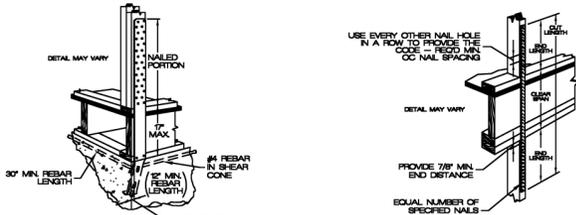


11 SIMPSON SHDRJ RIM JOIST INSTALLATION



12 SIMPSON CMSTC

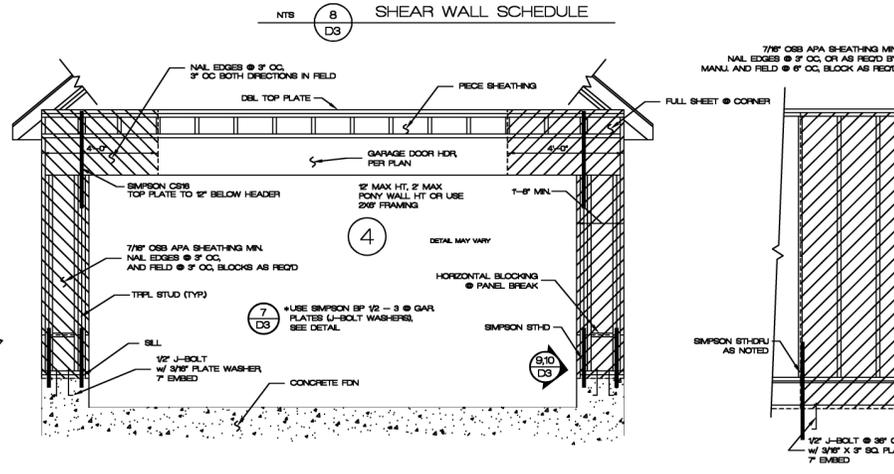

4 GARAGE DOOR PORTAL FRAME GARAGE

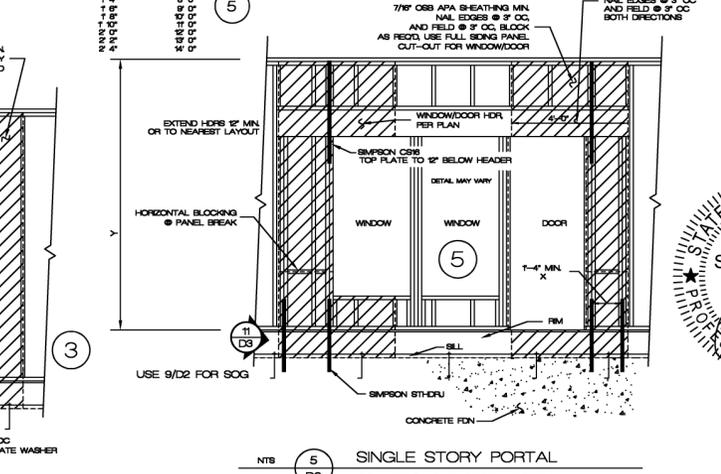

5 SINGLE STORY PORTAL CS- PF SINGLE STORY PORTAL

**Ken Sidorowicz, PC**

P.O. Box 12089, Parkville, Missouri 64152  
Tel. (816) 741-0852 Fax (816) 741-0858

ISSUE DATE  
REVISIONS

2018 DETAIL SHEET



1/25/21

**D3**

RELEASE FOR CONSTRUCTION AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI  
01/29/2021