RESIDENTIAL ENGINEERING SERVICES, LLC. SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

STATUS:


APPROVED

01.28.2021

REVIEWED BY:

BH

ENGINEER, RESIDENTIAL ENGINEERING SERVICES, LLC

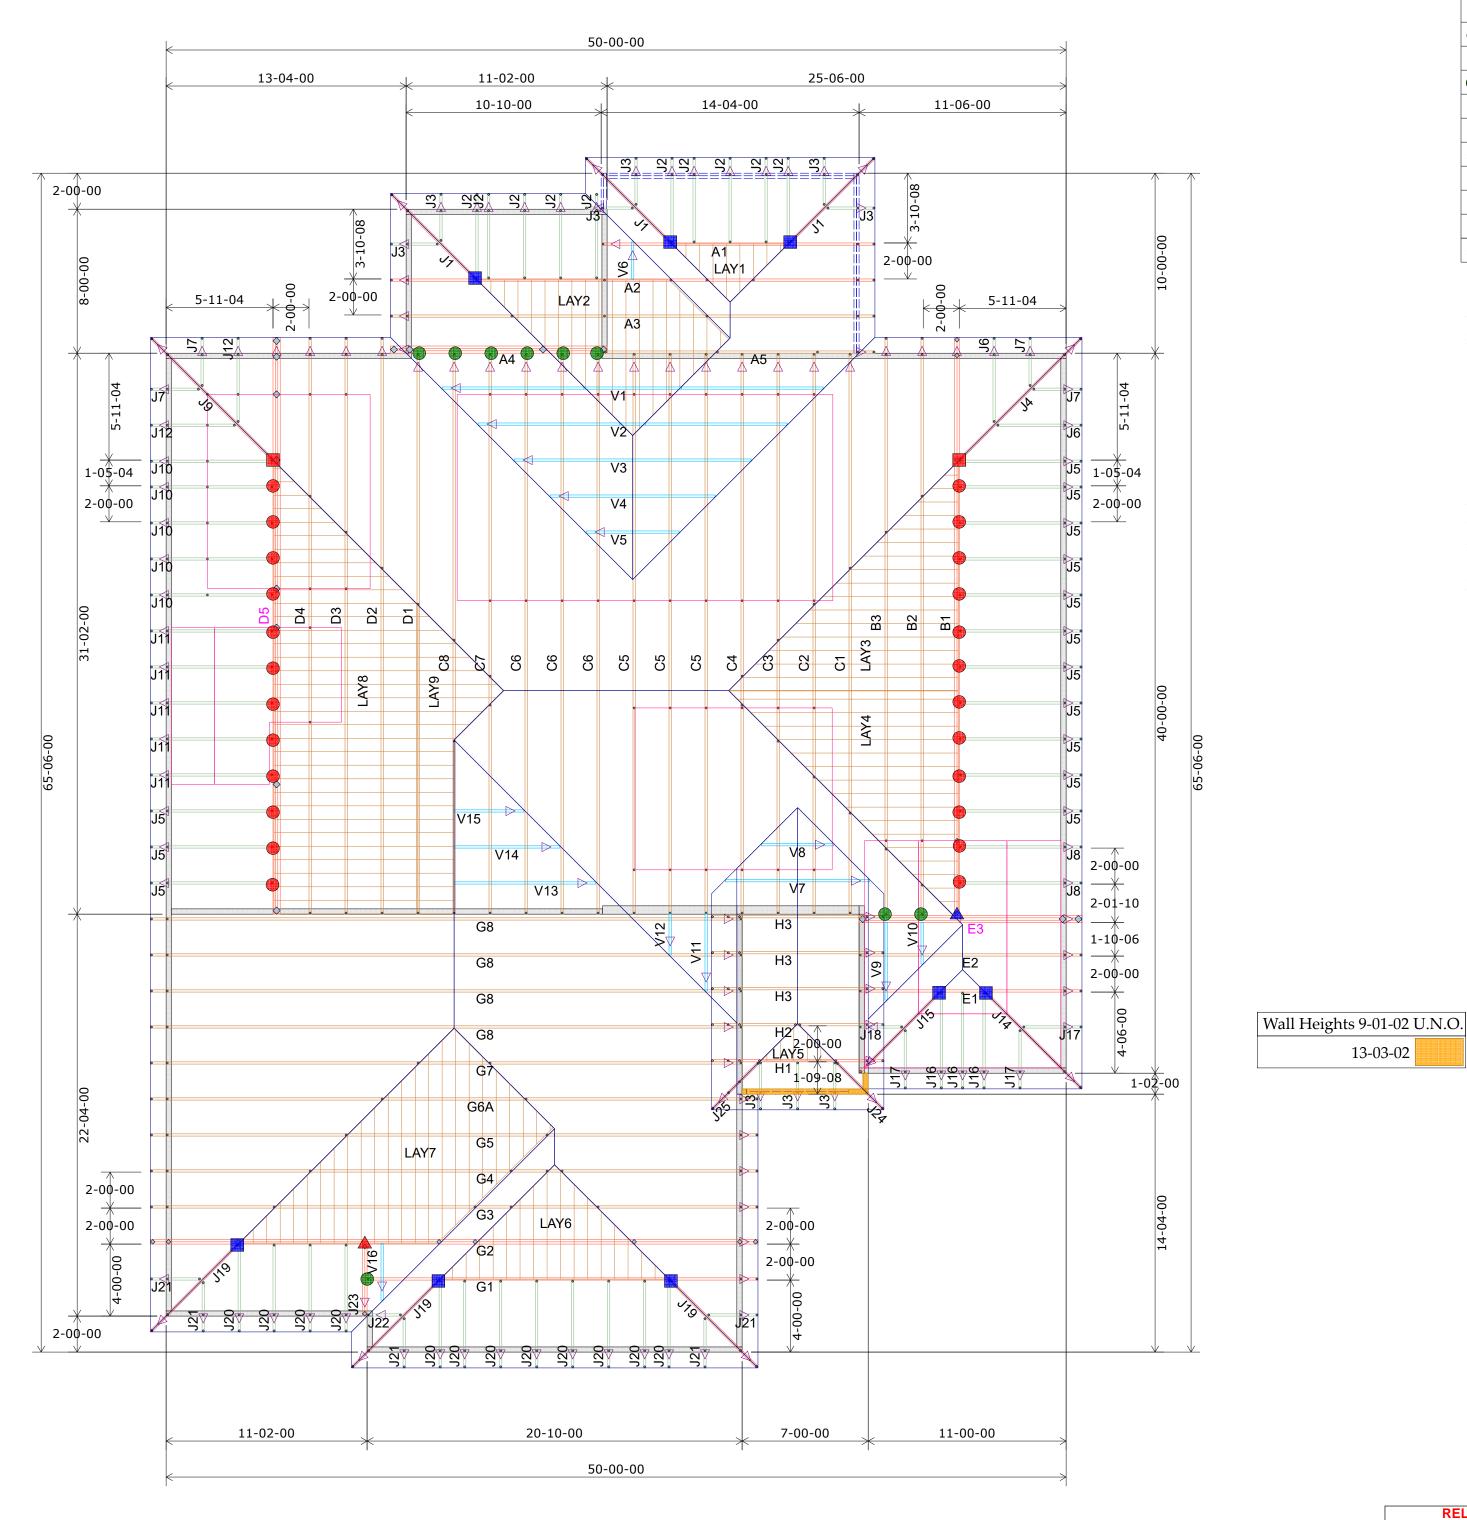

	HANGER SCHEDULE	Quantity						
	LUS24	24					40	
	LUS26	0					-42	
	HUS26	9				MO	(785) 746-4240	
A	HHUS26-2	1		lge	ن		85)	
	HGUS26-2	1		Lot 44 Woodside Ridge	2048 NW Ashurst Dr.		(7	
	HGUS28-3	0	es	side	hurs		eig	_
	LTHJA26	2	Iom	poo	As	ımi	ickt	1257
	TJC37	8	iit E	4 W.	× ×	Sun	e L	210
	TJC57	0	Summit Homes	ot 47	846	Lee's Summit	Chance Lickteig	Job # 210257
	HTS20	0	Su	ГС	20	Le	C	Jo
of	Triangle denotes the left end of the Truss as it appears on the Engineered Drawings				ldress	State		
	provided.			ne	Ad		ı.	21
1				Job Name	Job Site Address	City,	Designer	1/26/2021



Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871



Roof Truss Layout Scale: 3/16" = 1'

CONSTRUCTION AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI

13-03-02

02/01/2021

RELEASE FOR