


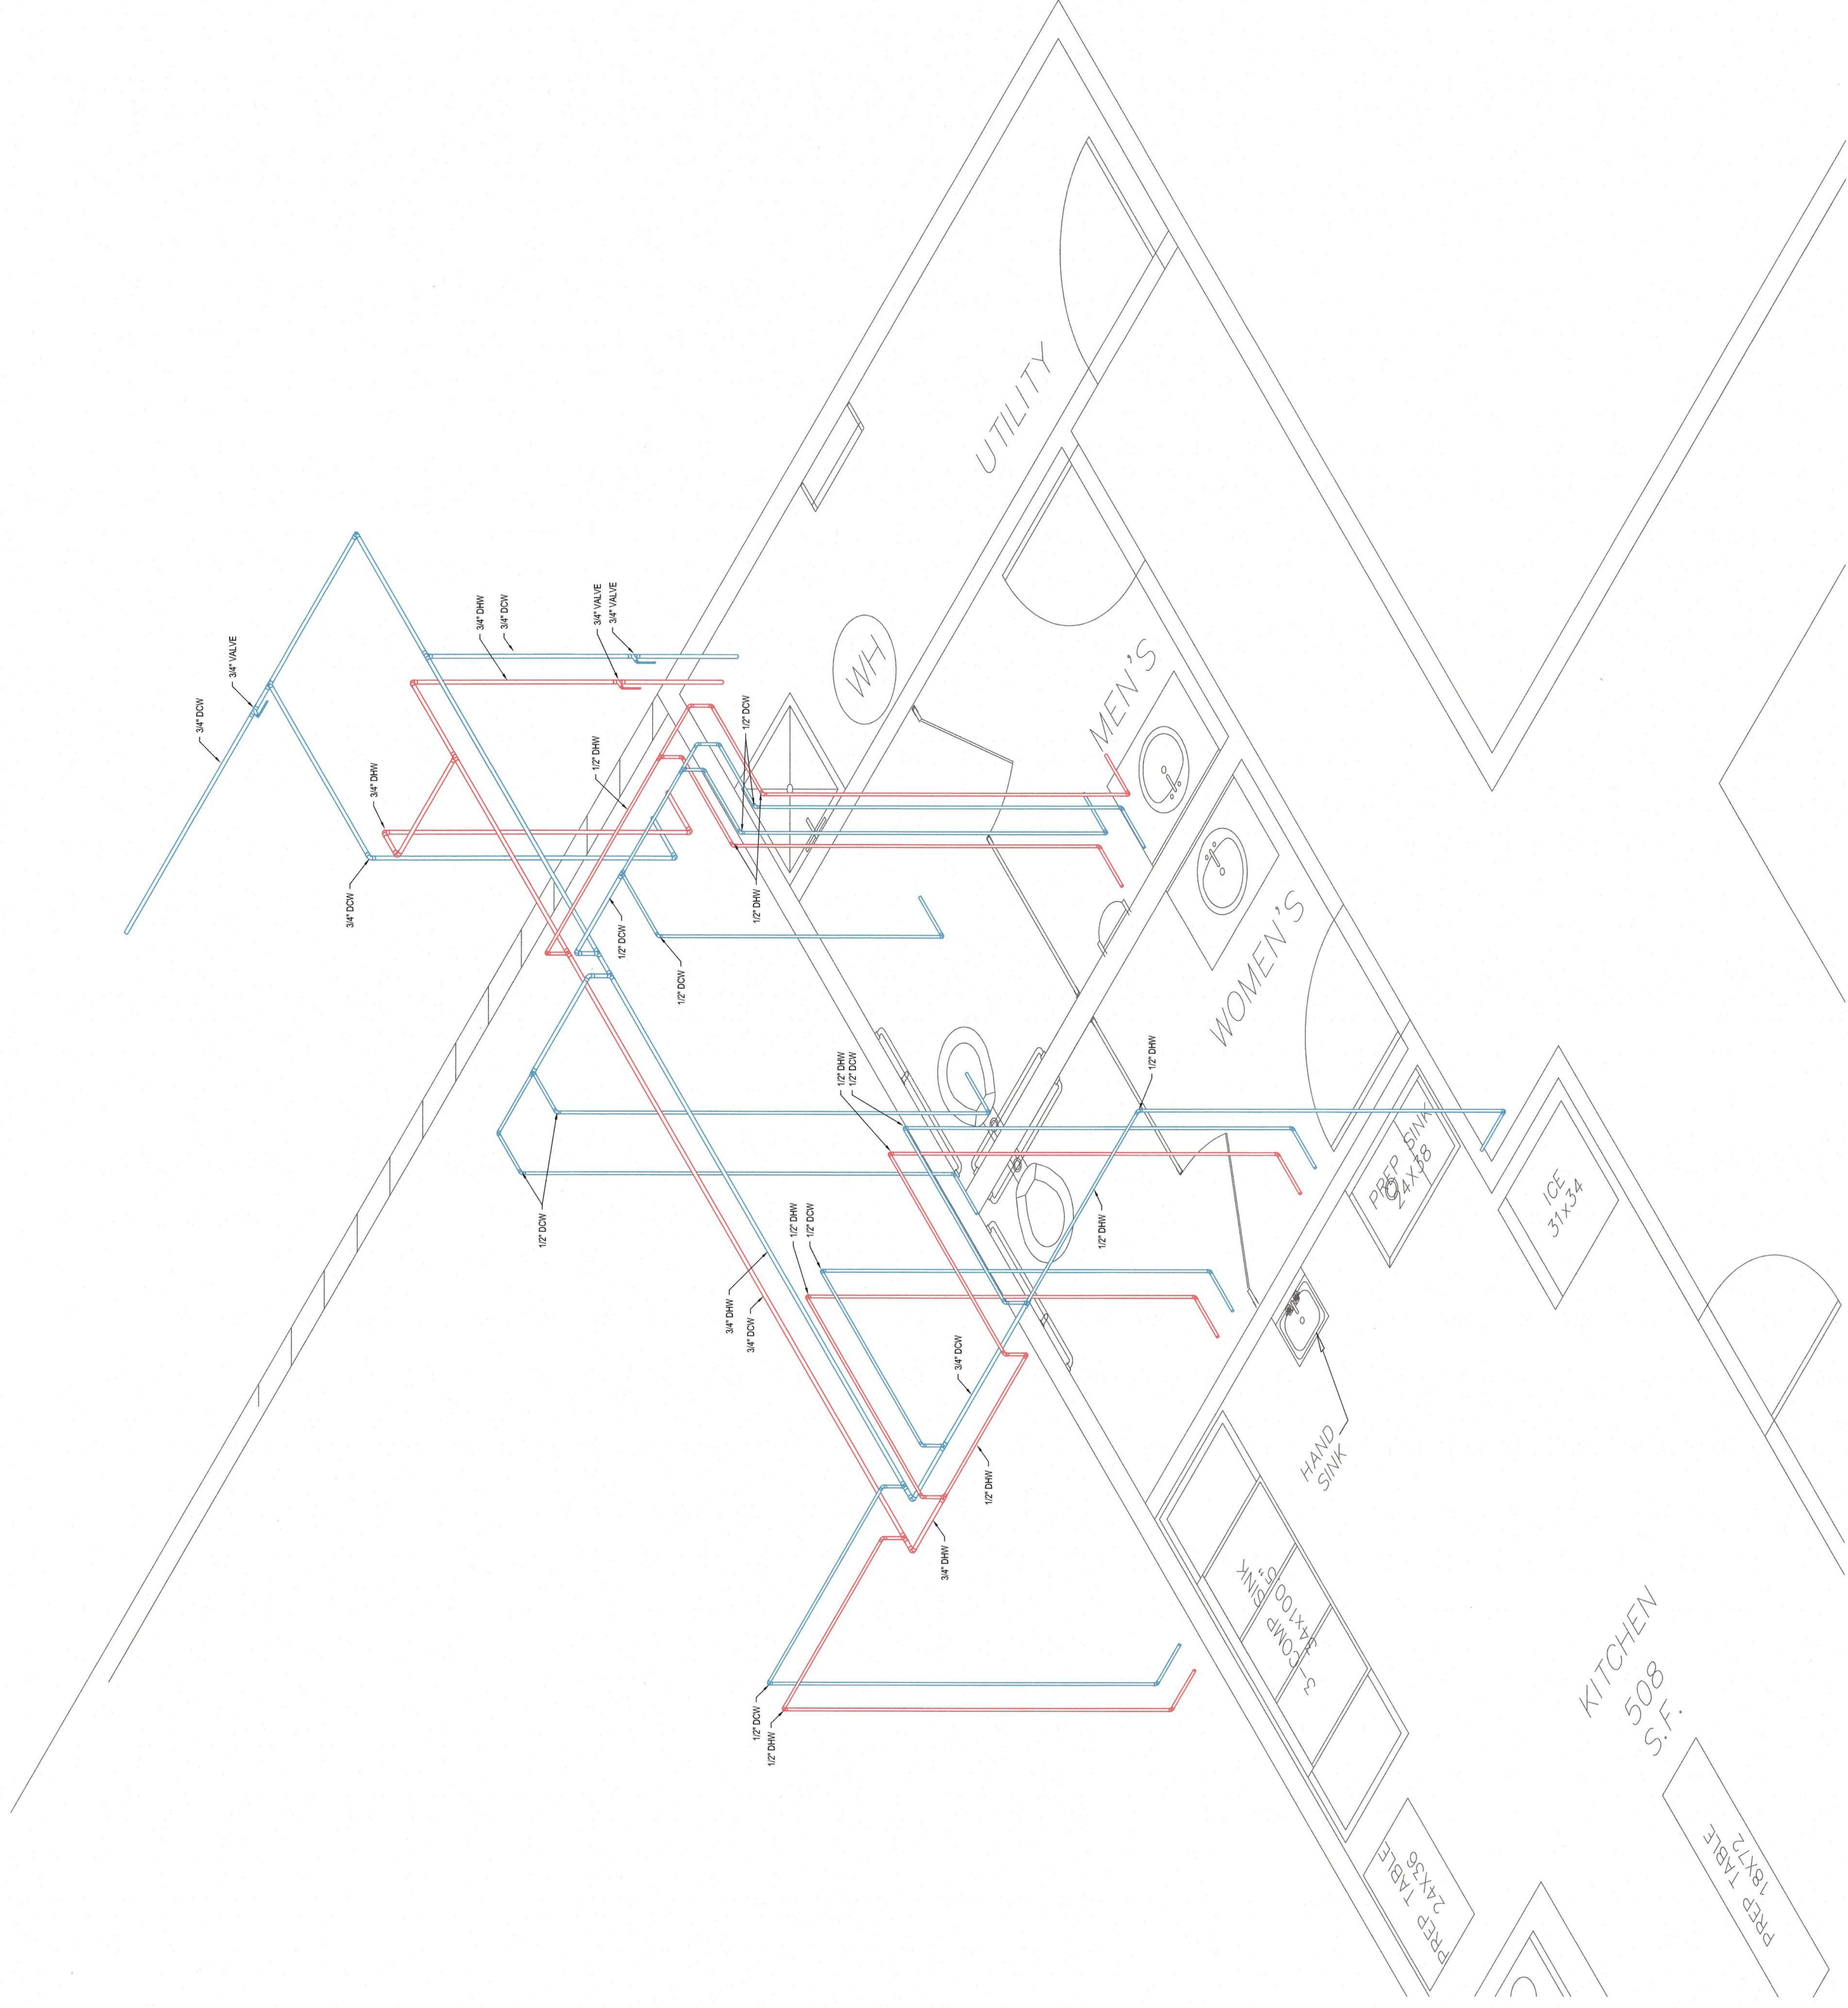

GENERAL NOTES

1. 2018 INTERNATIONAL PLUMBING CODE
2. INSTALL EXPANSION TANK ON WATER HEATER

KEY NOTES

COLDWATER
SW BLUE PARKWAY
LEE'S SUMMIT, MO 64063

[illegible]

JOB NO:	SCALE
	3/4" = 1'-0"
DRAWN BY:	CHECKED BY:
NE	TR
ISSUE DATE	
02-02-21	
SHEET TITLE	

DOMESTIC WATER SEISMETRIC RISER DIAGRAM

SHEET NO.

GENERAL NOTES

1. PIPE SLOPE AS INDICATED; SANITARY WASTE 3'-6" AT 1/8" PER FOOT, 2" AND UNDER IS 1/4" PER FOOT, VENT AT 1/8" PER FOOT
2. 2018 INTERNATIONAL PLUMBING CODE
3. PVC SCH 40 PIPE AND FITTING

KEY NOTES

KEY PLAN:

DOWN SW ISOMETRIC RISER DIAGRAM

SHEET NO:

[illegible]


JOB NO.	SCALE: $3/4" = 1'-0"$	CHECKED BY: TR	SHEET NO.
EXAMINER BY: E			
SHEET DATE: 2-02-21		SHEET TITLE:	



COLDWATER
SW BLUE PARKWAY
LEE'S SUMMIT, MO 64063



P. 816.941.5300 F. 816.941.5390 WWW.MMCONTRACTORS.COM
KANSAS CITY, MISSOURI 64145-1518

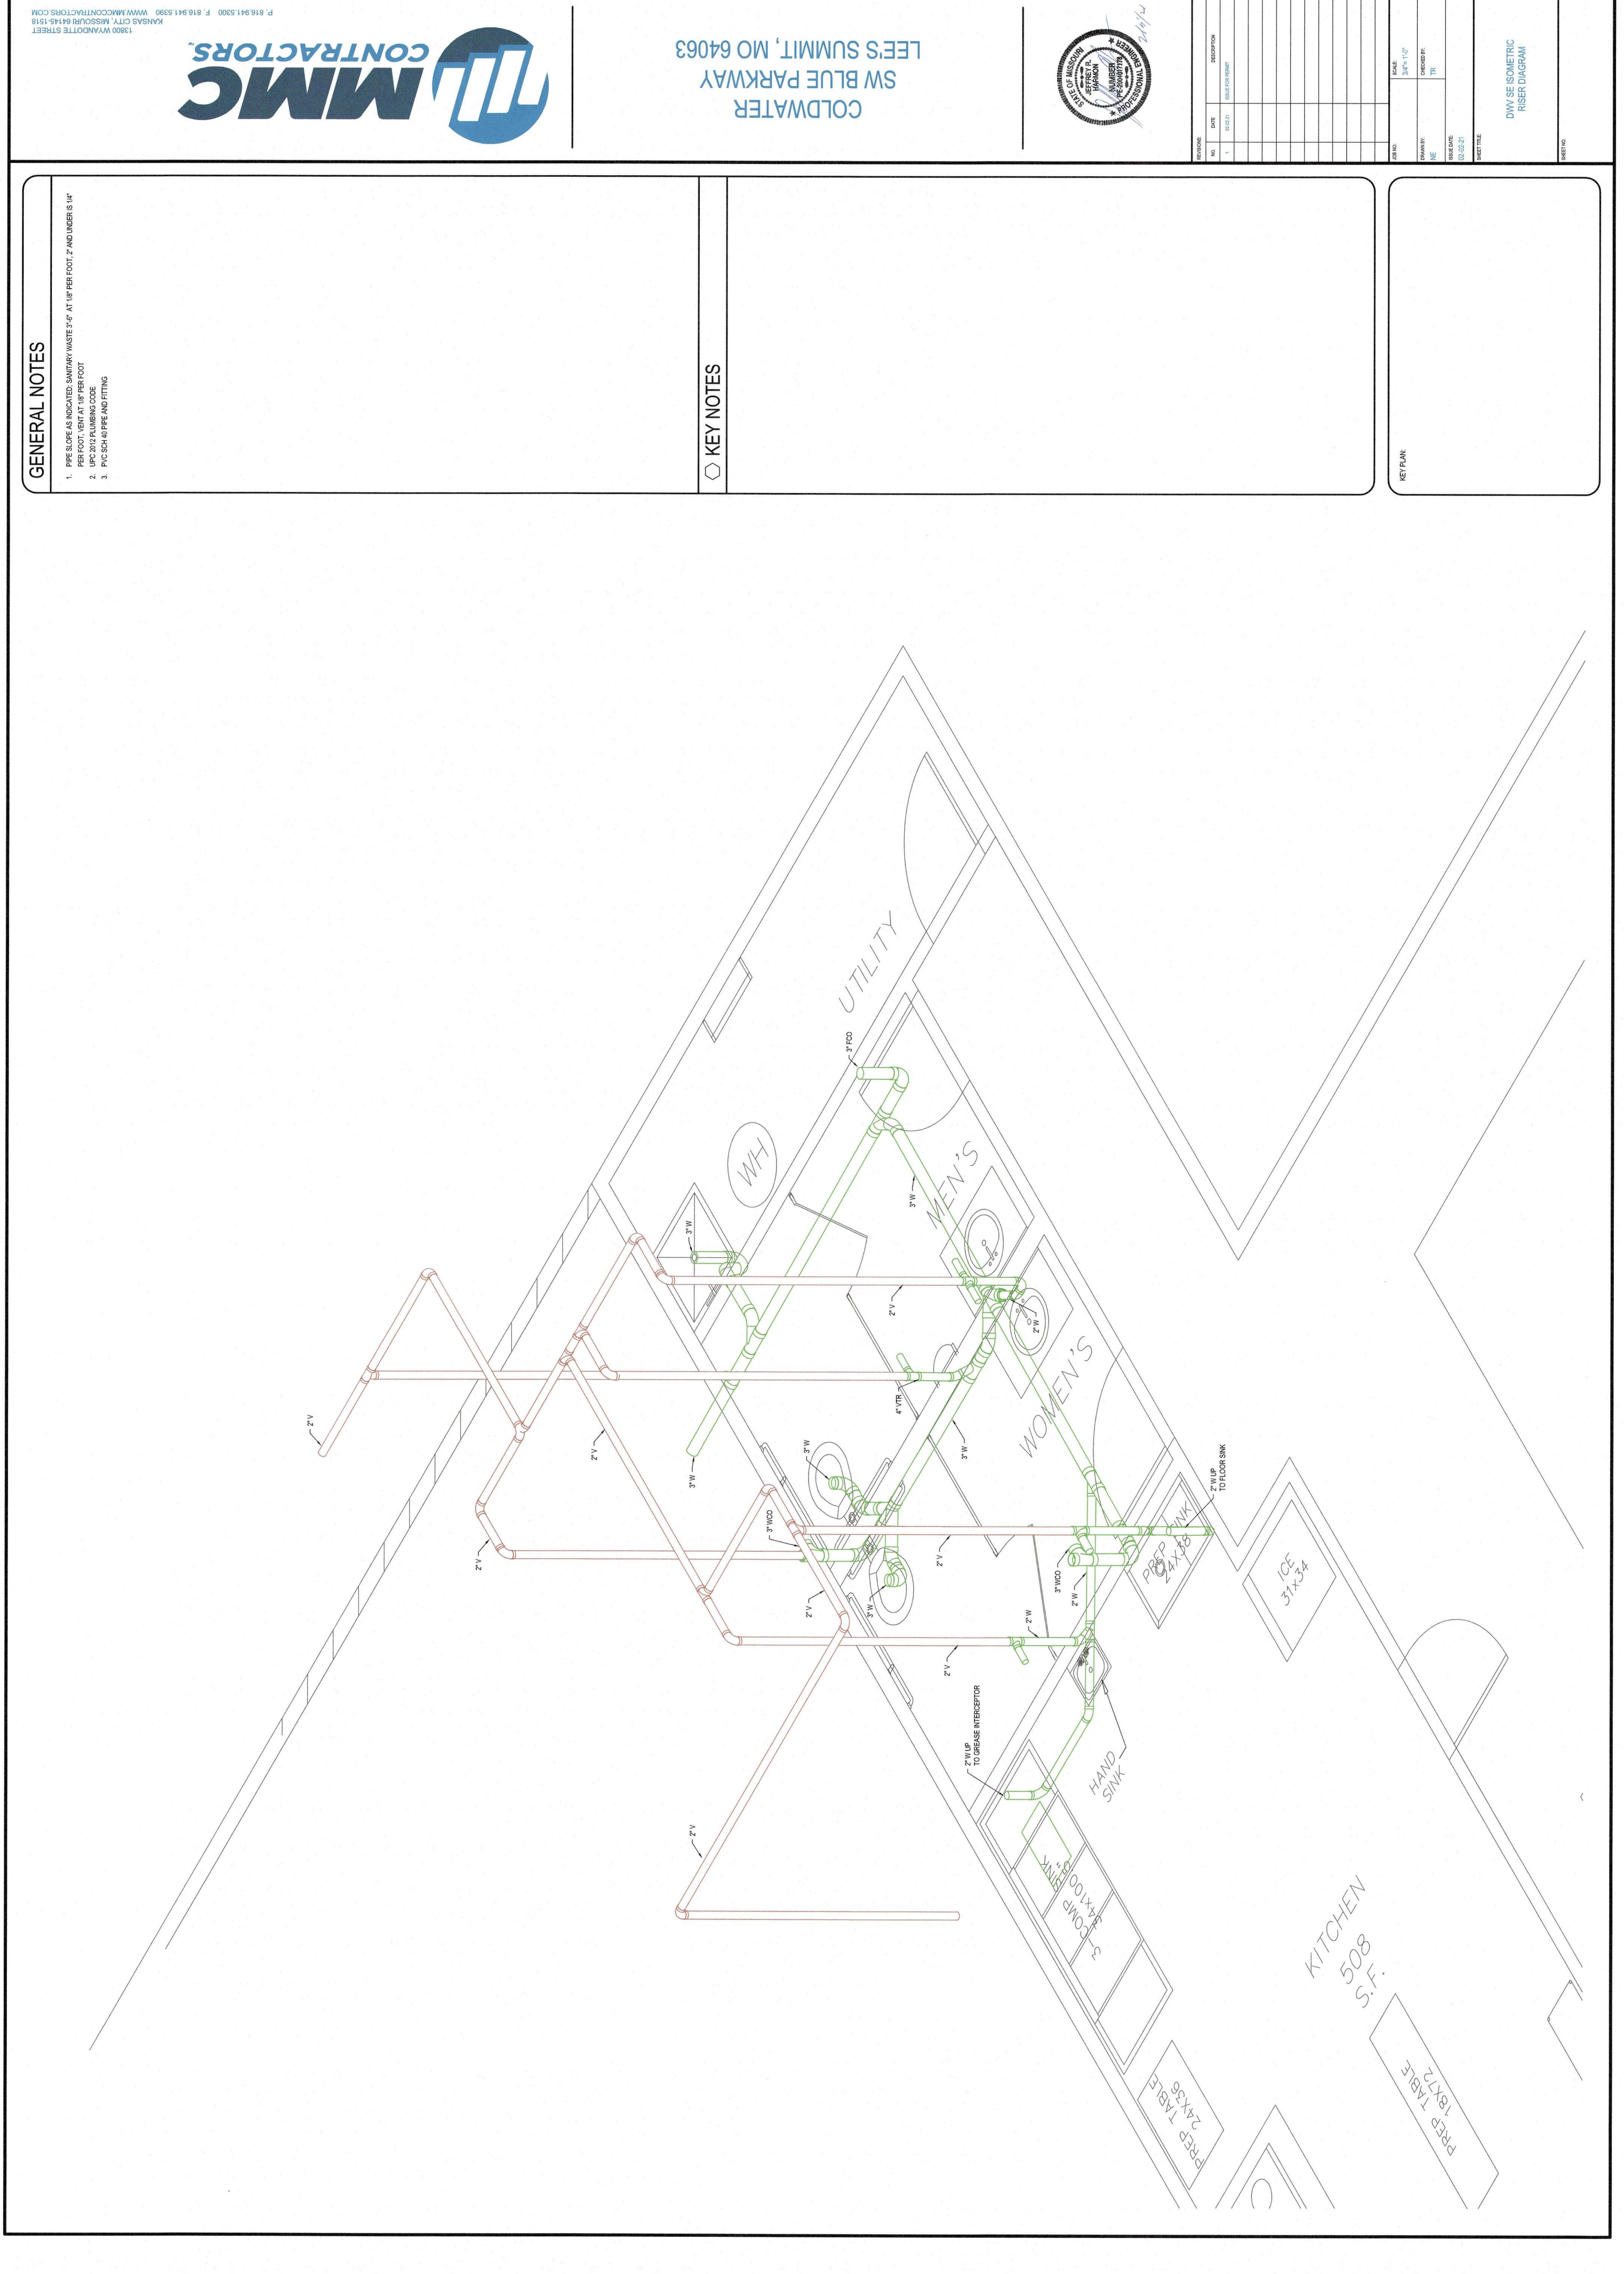

GENERAL NOTES

1. PIPE SLOPE AS INDICATED; SANITARY WASTE 3'-6" AT 1/8" PER FOOT, 2" AND UNDER IS 1/4"

1. PIPE SLOPE AS INDICATED; SANITARY WASTE 3'-5" AT 1/8" PER FOOT, 2" AND UNDER IS 1/4" PER FOOT, VENT AT 1/8" PER FOOT
2. UPC 2012 PLUMBING CODE
3. PVC SCH 40 PIPE AND FITTING

KEY NOTES

KEY PLAN:



JOINT NO.	SCALE	3/4" = 1'-0"
DOWN H.T.	CHECKED BY	TR
DATE	RISE DATE	02-02-21
SHEET NO.	DWW SE ISOMETRIC RISE R DIAGRAM	
SHEET NO.		

COLDWATER
SW BLUE PARKWAY
LEE'S SUMMIT, MO 64063

