



MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Re: 400675
Lot 19 HT



The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Wheeler - Waverly.

Pages or sheets covered by this seal: I44918052 thru I44918053

My license renewal date for the state of Missouri is December 31, 2021.

Missouri COA: Engineering 001193



February 23, 2021

Sevier, Scott ,Engineer

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Lot 19 HT	Units: 1.0	I44918052
400675	B7	PIGGYBACK BASE	1	1		Eng: TH	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Feb 12 2021 MiTek Industries, Inc. Tue Feb 23 07:30:44 2021 Page 1


ID:bWuMDBN0tjF5cDvSpwphH1zCzbQ-umyQTnEKqYx4_QovBjjHQ5bl7k3jVpoloMA57aziK7v

Job Reference (optional)

0-10-8	2-8-5	7-7-9	11-5-4	13-5-4	17-7-9	22-6-0	27-0-0	31-6-0	33-10-0	37-11-15	42-0-0
0-10-8	2-8-5	4-11-4	3-9-11	2-0-0	4-2-5	4-10-7	4-6-0	4-6-0	2-4-0	4-1-15	4-0-1

REPAIR: BREAK IN WEB 10-17 AT 2' FROM JOINT 10 AND BREAK IN WEB 12-15 AT 42" FROM JOINT 15.

Scale = 1:74.8

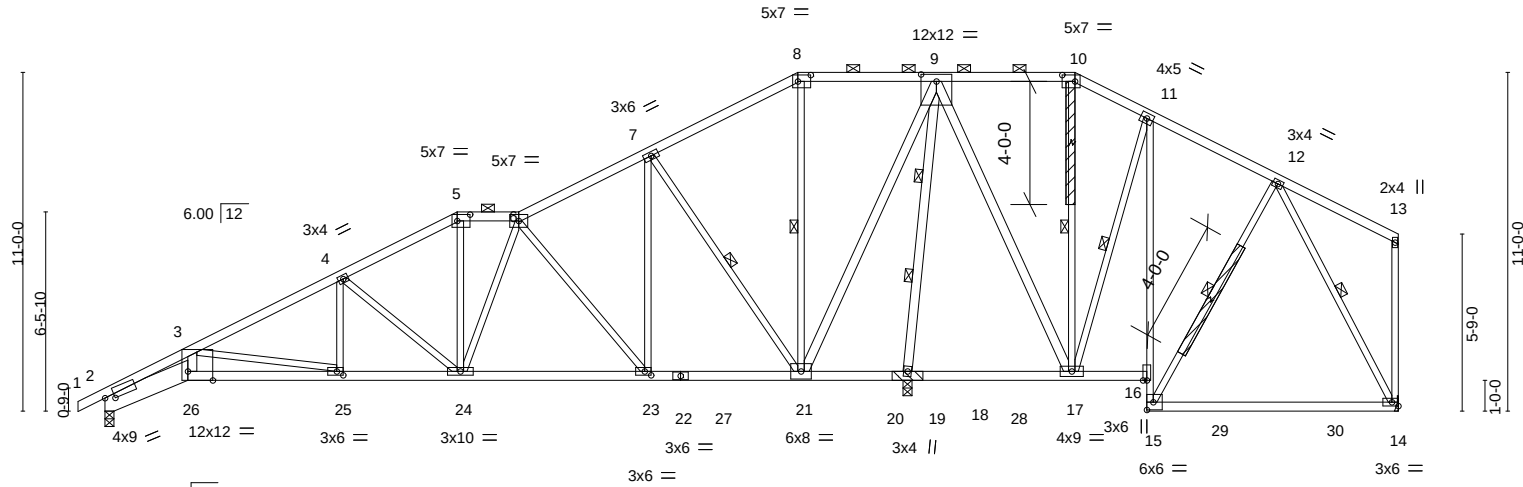

5.00 2		APPLY 2 X 4 X 4' SPF/DF/SP NO.2 SCAB(S) TO EACH FACE OF TRUSS CENTERED ON DAMAGE/SPICE OR AS SHOWN. ATTACH WITH (0.131" X 3") NAILS PER THE FOLLOWING NAIL SCHEDULE: 2 x 3'S - 1 ROW, 2 x 4'S - 2 ROWS, 2 x 6'S AND LARGER - 3 ROWS: SPACED @ 4" O.C. STAGGER NAIL SPACING FROM FRONT FACE AND BACK FACE FOR A NET 2" O.C SPACING IN THE TRUSS. USE 2" MEMBER END DISTANCE. 										
Plate Offsets (X,Y)--		[2:0-3-12,0-1-7], [5:0-5-0,0-2-8], [8:0-5-0,0-2-8], [9:0-6-0,0-2-12], [10:0-5-0,0-2-8], [23:0-2-8,0-1-8], [25:0-2-8,0-1-8], [26:0-9-11,Edge]										
LOADING (psf)		SPACING-		CSI.		DEFL.				PLATES		GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	-0.24	14-15	>808	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.89	Vert(CT)	-0.38	14-15	>495	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.83	Horz(CT)	0.13	19	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.10	25-26	>999	240	Weight: 227 lb	FT = 10%

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 2-10-12 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6, 8-10.
BOT CHORD	2x4 SPF No.2 *Except*	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x26: 2x8 SP DSS, 11-15: 2x3 SPF No.2, 14-15: 2x4 SPF 2100F 1.8E	WEBS	1 Row at midpt 7-21, 8-21, 10-17, 11-17, 12-15, 12-14
	2x3 SPF No.2 *Except*		2 Rows at 1/3 pts 9-19
	3-26,9-21,9-19,9-17: 2x4 SPF No.2		
REACTIONS.		NOTES-	
(size) 2=0-3-8, 19=(0-3-8 + bearing block) (req. 0-4-4), 14=Mechanical		1) 2x4 SPF No.2 bearing block 12" long at jt. 19 attached to front face with 2 rows of 10d (0.131"x3") nails spaced 3" o.c. 8 Total fasteners. Bearing is assumed to be SPF No.2.	
Max Horz 2=240(LC 7)		2) Unbalanced roof live loads have been considered for this design.	
Max Uplift 2=-43(LC 8), 19=-26(LC 5), 14=-66(LC 4)		3) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60	
Max Grav 2=1022(LC 21), 19=2719(LC 2), 14=490(LC 22)		4) Provide adequate drainage to prevent water ponding.	
FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.		5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.	
TOP CHORD 2-3=-3541/265, 3-4=-1686/106, 4-5=-1144/99, 5-6=-973/102, 6-7=-497/90, 7-8=-63/367, 8-9=-25/281, 9-10=-49/260, 10-11=-70/298		6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.	
BOT CHORD 2-26=-339/3168, 25-26=-302/2724, 24-25=-125/1480, 23-24=-54/884, 21-23=-11/404, 19-21=-835/98, 17-19=-602/94, 15-16=-18/319, 11-16=-17/376		7) Refer to girder(s) for truss to truss connections.	
WEBS 3-26=-70/1264, 3-25=-1271/179, 4-25=0/371, 4-24=-689/94, 5-24=-1/349, 6-24=-29/308, 6-23=-761/95, 7-23=-2/841, 7-21=-1041/115, 8-21=-413/67, 9-21=-66/1427, 9-19=-2489/81, 9-17=-18/962, 10-17=-303/51, 11-17=-525/74, 12-14=-314/172		8) Bearing at joint(s) 2 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.	
		9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 19, 14.	
		10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.	
		11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.	




February 23,2021

Job	Truss	Truss Type	Qty	Ply	Lot 19 HT	Units: 1.0	I44918053
400675	C7	Piggyback Base	1	1		Eng: TH	

Wheeler Lumber, Waverly, KS - 66871,


8.430 s Feb 12 2021 MiTek Industries, Inc. Tue Feb 23 07:30:45 2021 Page 1

ID:bWuMDBN0tjF5cDvSpwhpH1zCzbQ-MyVoh7Fybs3xbZN5IREWzJ8v87SUEIYv10vfg1ziK7u



REPAIR: 6" LONG SPLIT IN THE BOTTOM CHORD AT 5' TO THE LEFT OF JOINT 12.

Scale = 1:71.0

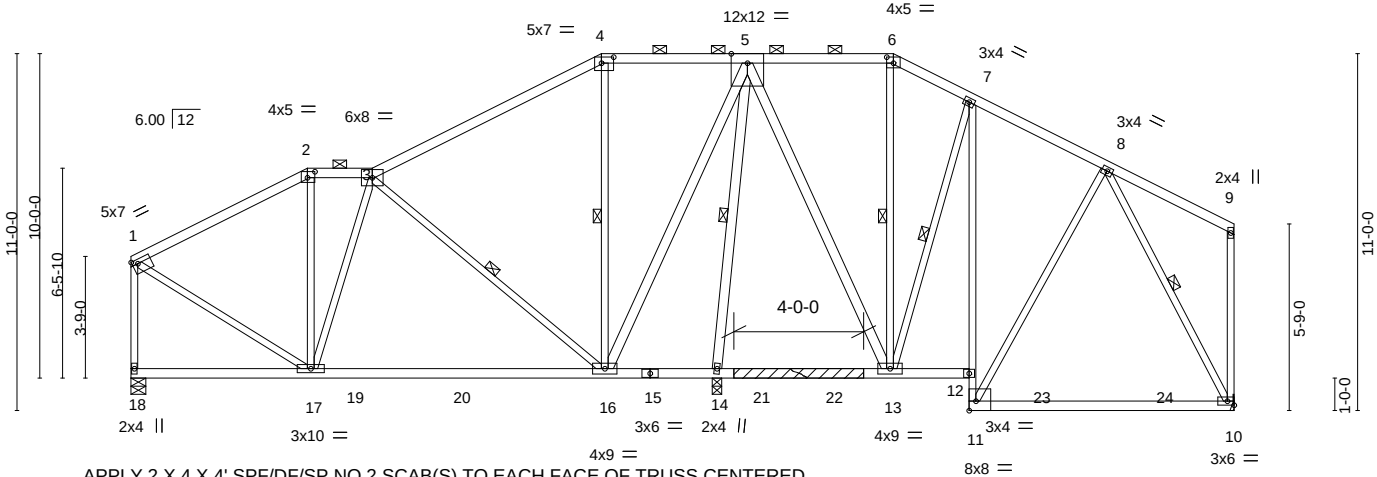

APPLY 2 X 4 X 4' SPF/DF/SP NO.2 SCAB(S) TO EACH FACE OF TRUSS CENTERED ON DAMAGE/SPLICE OR AS SHOWN. ATTACH WITH (0.131" X 3") NAILS PER THE FOLLOWING NAIL SCHEDULE: 2 x 3'S - 1 ROW, 2 x 4'S - 2 ROWS, 2 x 6'S AND LARGER - 3 ROWS: SPACED @ 4" O.C. STAGGER NAIL SPACING FROM FRONT FACE AND BACK FACE FOR A NET 2" O.C SPACING IN THE TRUSS. USE 2" MEMBER END DISTANCE.




Plate Offsets (X,Y)-- [1:0-2-0,0-1-8], [2:0-2-12,0-2-4], [4:0-4-8,0-2-4], [6:0-2-8,0-2-4], [11:Edge,0-3-8]

LOADING (psf)	SPACING-		CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.69	Vert(LL)	-0.23 10-11	>844	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.66	Vert(CT)	-0.38 16-17	>564	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.67	Horz(CT)	0.06 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	-0.03 10-11	>999	240	Weight: 187 lb	FT = 10%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
7-11: 2x3 SPF No.2, 10-11: 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except*
5-16,5-14,5-13: 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-3, 4-6.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 6-0-0 oc bracing: 14-16,13-14.
WEBS 1 Row at midpt 3-16, 4-16, 5-14, 6-13, 7-13, 8-10

REACTIONS. (size) 18=0-5-8, 14=0-3-8, 10=Mechanical
Max Horz 18=270(LC 7)
Max Uplift 18=-151(LC 8), 14=-206(LC 5), 10=-54(LC 4)
Max Grav 18=841(LC 23), 14=1762(LC 2), 10=743(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-704/131, 2-3=-572/160, 3-4=-381/172, 4-5=-257/208, 5-6=-274/167, 6-7=-343/177, 7-8=-444/154, 1-18=-790/168
BOT CHORD 17-18=-251/202, 16-17=-116/608, 12-13=-8/297, 10-11=-69/255
WEBS 3-16=-478/171, 4-16=-336/123, 5-16=-107/890, 5-14=-1628/238, 5-13=-123/585, 7-13=-258/157, 1-17=-80/660, 8-10=-529/71


- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10 except (jt=lb) 18=151, 14=206.
 - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




February 23,2021

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless X, Y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

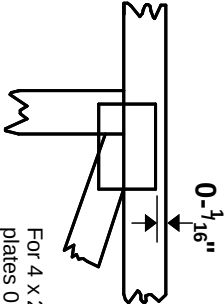

For 4 x 2 orientation, locate plates 0- $\frac{3}{16}$ " from outside edge of truss.

— This symbol indicates the required direction of slots in connector plates.

*** Plate location details available in MITek 20120 software or upon request.**

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1.1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

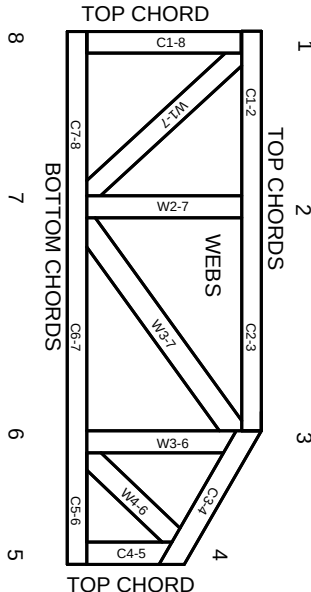

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



Mitek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.