

WOODSIDE #52

RESIDENTIAL ENGINEERING SERVICES, LLC.
SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.


STATUS:
APPROVED

03.01.2021

REVIEWED BY:
BH

ENGINEER, RESIDENTIAL ENGINEERING SERVICES, LLC


RELEASE FOR
CONSTRUCTION
AS NOTED ON PLANS REVIEW
DEVELOPMENT SERVICES
LEE'S SUMMIT, MISSOURI
03/05/2021

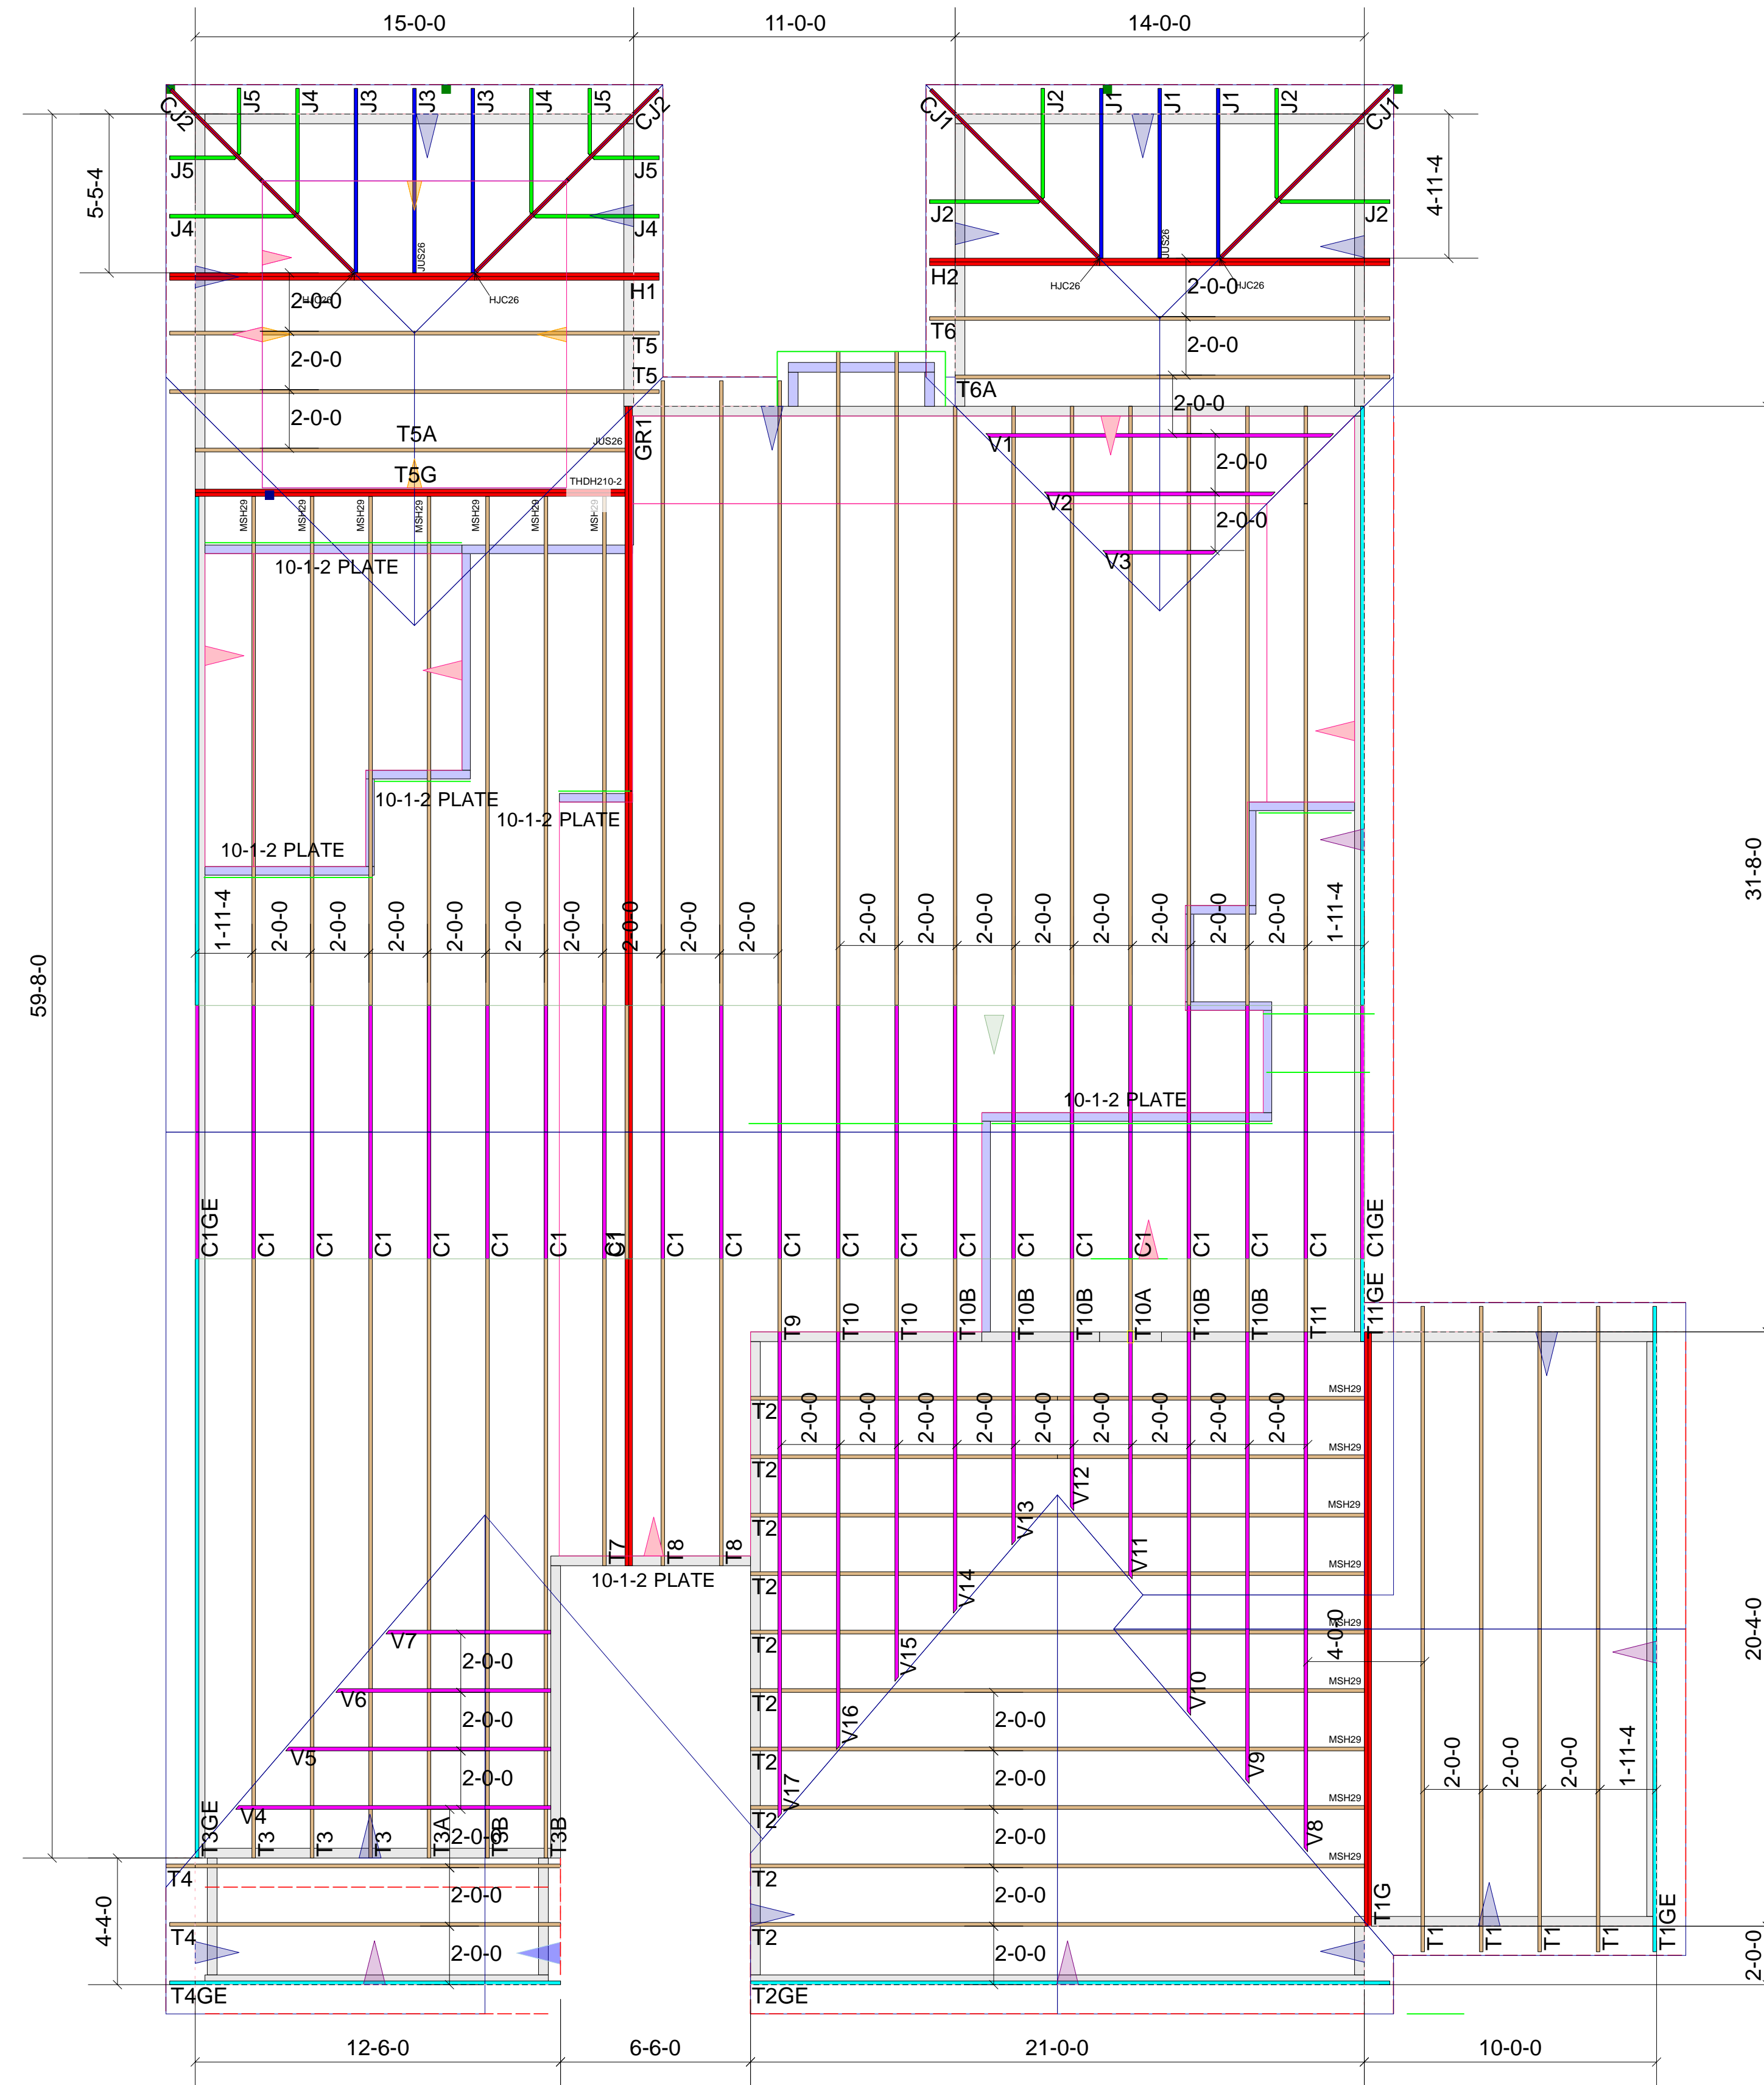

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor system and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding bracing, consult "Bracing of wood trusses" available from the Truss Plate Institute, 563 Donifiro Drive, Madison, WI 53179.

Truss performance depends not only on proper design and fabrication, but also on proper handling installation and bracing. The truss engineering and the HIB-91 SUMMARY SHEET provided should be carefully reviewed before installing any truss. If you need any additional information regarding specific installation or bracing requirements for your particular project, consult with the engineer of record or building designer for your project.

SUMMIT HOMES
BRADFORD CRAFTSMAN 3-CAR

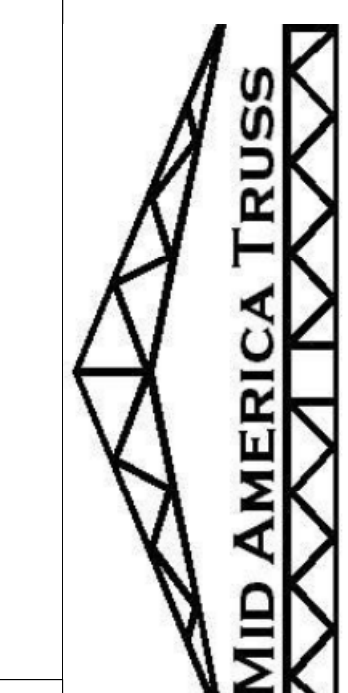

9826 BIG MEADOWS ROAD
JEFFERSON CITY MO 65101
OFFICE: (573) 395-3400
FAX : (573) 395-3410

Telephone:
Contact:
Fax:
Sales:
Date:

TRUSS LAYOUT
Scale: 1/4" = 1'-0"

<p>THDH210-2 Heavy Duty Face Mount Truss Hanger Ref. # H0US210-2</p> <p>Fasteners: Supporting Member: (H) 16d Nails Supported Member: (T) 16d Nails</p> <p>USP Structural Connectors</p>	<p>RT7A Hurricane/Seismic Anchor Ref. # H2-5A</p> <p>Fasteners: Supporting Member: (S) 8d Nails Supported Member: (S) 8d Nails</p> <p>USP Structural Connectors</p>	
<p>JUS26 Start Nail Joist Hanger Ref. # LUS26</p> <p>Fasteners: Supporting Member: (H) 16d Nails Supported Member: (H) 16d Nails</p> <p>USP Structural Connectors</p>	<p>MSH29 Adjustable Strap Hanger Ref. # THA29</p> <p>Fasteners: Supporting Member: Top Max Condition: (T) 16d Nails Face Mount Condition: (F) 8d Nail-Holes, 10d Nails Supported Member: (H) 16d Nails</p> <p>USP Structural Connectors</p>	<p>HJC26 Hip Jack Connector</p> <p>Fasteners: Supporting Member: (H) 16d Nails Supported Member: (H) 16d Nails</p> <p>USP Structural Connectors</p>