



RE: 210285
Lot 86 W0

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Site Information:

Customer: Project Name: 210285
Lot/Block:
Address:
City:

Model:
Subdivision:
State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2018/TPI2014
Wind Code: N/A
Roof Load: 45.0 psf

Design Program: MiTek 20/20 8.4
Wind Speed: 115 mph
Floor Load: N/A psf

This package includes 93 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I44063917	A1	2/12/2021	21	I44063937	E7	2/12/2021
2	I44063918	A2	2/12/2021	22	I44063938	E8	2/12/2021
3	I44063919	A3	2/12/2021	23	I44063939	E9	2/12/2021
4	I44063920	B1	2/12/2021	24	I44063940	G1	2/12/2021
5	I44063921	B2	2/12/2021	25	I44063941	G2	2/12/2021
6	I44063922	B3	2/12/2021	26	I44063942	G3	2/12/2021
7	I44063923	C1	2/12/2021	27	I44063943	G5	2/12/2021
8	I44063924	C2	2/12/2021	28	I44063944	G6	2/12/2021
9	I44063925	C3	2/12/2021	29	I44063945	G7	2/12/2021
10	I44063926	C4	2/12/2021	30	I44063946	G8	2/12/2021
11	I44063927	C5	2/12/2021	31	I44063947	G9	2/12/2021
12	I44063928	C6	2/12/2021	32	I44063948	G10	2/12/2021
13	I44063929	D1	2/12/2021	33	I44063949	H1	2/12/2021
14	I44063930	D2	2/12/2021	34	I44063950	J1	2/12/2021
15	I44063931	E1	2/12/2021	35	I44063951	J2	2/12/2021
16	I44063932	E2	2/12/2021	36	I44063952	J3	2/12/2021
17	I44063933	E3	2/12/2021	37	I44063953	J4	2/12/2021
18	I44063934	E4	2/12/2021	38	I44063954	J5	2/12/2021
19	I44063935	E5	2/12/2021	39	I44063955	J6	2/12/2021
20	I44063936	E6	2/12/2021	40	I44063956	J7	2/12/2021

The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision
based on the parameters provided by Wheeler - Waverly.

Truss Design Engineer's Name: Liu, Xuegang

My license renewal date for the state of Kansas is April 30, 2022.

Kansas COA: E-943

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.



February 12, 2021



RE: 210285 - Lot 86 W0

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Site Information:

Project Customer: Project Name: 210285

Lot/Block:

Subdivision:

Address:

City, County:

State:

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
41	I44063957	J8	2/12/2021	85	I44064001	LAY3	2/12/2021
42	I44063958	J9	2/12/2021	86	I44064002	LAY4	2/12/2021
43	I44063959	J10	2/12/2021	87	I44064003	LAY6	2/12/2021
44	I44063960	J11	2/12/2021	88	I44064004	LAY7	2/12/2021
45	I44063961	J12	2/12/2021	89	I44064005	LAY8	2/12/2021
46	I44063962	J13	2/12/2021	90	I44064006	V1	2/12/2021
47	I44063963	J14	2/12/2021	91	I44064007	V2	2/12/2021
48	I44063964	J15	2/12/2021	92	I44064008	V3	2/12/2021
49	I44063965	J16	2/12/2021	93	I44064009	V4	2/12/2021
50	I44063966	J17	2/12/2021				
51	I44063967	J18	2/12/2021				
52	I44063968	J19	2/12/2021				
53	I44063969	J20	2/12/2021				
54	I44063970	J21	2/12/2021				
55	I44063971	J22	2/12/2021				
56	I44063972	J23	2/12/2021				
57	I44063973	J24	2/12/2021				
58	I44063974	J24A	2/12/2021				
59	I44063975	J25	2/12/2021				
60	I44063976	J25A	2/12/2021				
61	I44063977	J26	2/12/2021				
62	I44063978	J27	2/12/2021				
63	I44063979	J28	2/12/2021				
64	I44063980	J29	2/12/2021				
65	I44063981	J30	2/12/2021				
66	I44063982	J31	2/12/2021				
67	I44063983	J32	2/12/2021				
68	I44063984	J33	2/12/2021				
69	I44063985	J34	2/12/2021				
70	I44063986	J35	2/12/2021				
71	I44063987	J36	2/12/2021				
72	I44063988	J37	2/12/2021				
73	I44063989	J38	2/12/2021				
74	I44063990	J39	2/12/2021				
75	I44063991	J40	2/12/2021				
76	I44063992	J41	2/12/2021				
77	I44063993	J42	2/12/2021				
78	I44063994	J43	2/12/2021				
79	I44063995	K1	2/12/2021				
80	I44063996	K2	2/12/2021				
81	I44063997	K3	2/12/2021				
82	I44063998	K4	2/12/2021				
83	I44063999	LAY1	2/12/2021				
84	I44064000	LAY2	2/12/2021				



RE: 210285
Lot 86 W0

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Site Information:

Customer: Project Name: 210285
Lot/Block:
Address:
City:

Model:
Subdivision:
State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2018/TPI2014
Wind Code: N/A
Roof Load: 45.0 psf

Design Program: MiTek 20/20 8.4
Wind Speed: 115 mph
Floor Load: N/A psf

This package includes 93 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I44063917	A1	2/12/2021	21	I44063937	E7	2/12/2021
2	I44063918	A2	2/12/2021	22	I44063938	E8	2/12/2021
3	I44063919	A3	2/12/2021	23	I44063939	E9	2/12/2021
4	I44063920	B1	2/12/2021	24	I44063940	G1	2/12/2021
5	I44063921	B2	2/12/2021	25	I44063941	G2	2/12/2021
6	I44063922	B3	2/12/2021	26	I44063942	G3	2/12/2021
7	I44063923	C1	2/12/2021	27	I44063943	G5	2/12/2021
8	I44063924	C2	2/12/2021	28	I44063944	G6	2/12/2021
9	I44063925	C3	2/12/2021	29	I44063945	G7	2/12/2021
10	I44063926	C4	2/12/2021	30	I44063946	G8	2/12/2021
11	I44063927	C5	2/12/2021	31	I44063947	G9	2/12/2021
12	I44063928	C6	2/12/2021	32	I44063948	G10	2/12/2021
13	I44063929	D1	2/12/2021	33	I44063949	H1	2/12/2021
14	I44063930	D2	2/12/2021	34	I44063950	J1	2/12/2021
15	I44063931	E1	2/12/2021	35	I44063951	J2	2/12/2021
16	I44063932	E2	2/12/2021	36	I44063952	J3	2/12/2021
17	I44063933	E3	2/12/2021	37	I44063953	J4	2/12/2021
18	I44063934	E4	2/12/2021	38	I44063954	J5	2/12/2021
19	I44063935	E5	2/12/2021	39	I44063955	J6	2/12/2021
20	I44063936	E6	2/12/2021	40	I44063956	J7	2/12/2021


The truss drawing(s) referenced above have been prepared by
MiTek USA, Inc. under my direct supervision
based on the parameters provided by Wheeler - Waverly.

Truss Design Engineer's Name: Liu, Xuegang


My license renewal date for the state of Missouri is December 31, 2022.

Missouri COA: 001193

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek. Any project specific information included is for MiTek customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

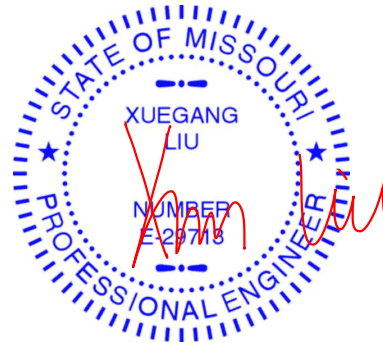

February 12, 2021



RE: 210285 - Lot 86 W0

MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Site Information:

Project Customer: Project Name: 210285

Lot/Block:

Subdivision:

Address:

City, County:

State:


No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
41	I44063957	J8	2/12/2021	85	I44064001	LAY3	2/12/2021
42	I44063958	J9	2/12/2021	86	I44064002	LAY4	2/12/2021
43	I44063959	J10	2/12/2021	87	I44064003	LAY6	2/12/2021
44	I44063960	J11	2/12/2021	88	I44064004	LAY7	2/12/2021
45	I44063961	J12	2/12/2021	89	I44064005	LAY8	2/12/2021
46	I44063962	J13	2/12/2021	90	I44064006	V1	2/12/2021
47	I44063963	J14	2/12/2021	91	I44064007	V2	2/12/2021
48	I44063964	J15	2/12/2021	92	I44064008	V3	2/12/2021
49	I44063965	J16	2/12/2021	93	I44064009	V4	2/12/2021
50	I44063966	J17	2/12/2021				
51	I44063967	J18	2/12/2021				
52	I44063968	J19	2/12/2021				
53	I44063969	J20	2/12/2021				
54	I44063970	J21	2/12/2021				
55	I44063971	J22	2/12/2021				
56	I44063972	J23	2/12/2021				
57	I44063973	J24	2/12/2021				
58	I44063974	J24A	2/12/2021				
59	I44063975	J25	2/12/2021				
60	I44063976	J25A	2/12/2021				
61	I44063977	J26	2/12/2021				
62	I44063978	J27	2/12/2021				
63	I44063979	J28	2/12/2021				
64	I44063980	J29	2/12/2021				
65	I44063981	J30	2/12/2021				
66	I44063982	J31	2/12/2021				
67	I44063983	J32	2/12/2021				
68	I44063984	J33	2/12/2021				
69	I44063985	J34	2/12/2021				
70	I44063986	J35	2/12/2021				
71	I44063987	J36	2/12/2021				
72	I44063988	J37	2/12/2021				
73	I44063989	J38	2/12/2021				
74	I44063990	J39	2/12/2021				
75	I44063991	J40	2/12/2021				
76	I44063992	J41	2/12/2021				
77	I44063993	J42	2/12/2021				
78	I44063994	J43	2/12/2021				
79	I44063995	K1	2/12/2021				
80	I44063996	K2	2/12/2021				
81	I44063997	K3	2/12/2021				
82	I44063998	K4	2/12/2021				
83	I44063999	LAY1	2/12/2021				
84	I44064000	LAY2	2/12/2021				

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063917
210285	A1	Hip Girder	1	1		
Job Reference (optional)						


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:22 2020 Page 1

ID: GTYmqTGpwjwEikz5tITZ8zVUQ7-19pk_hiCa0uGqPMJIOQ9pXYpJmTFPE4tYpA?Yy7nqJ



Scale = 1:26.1

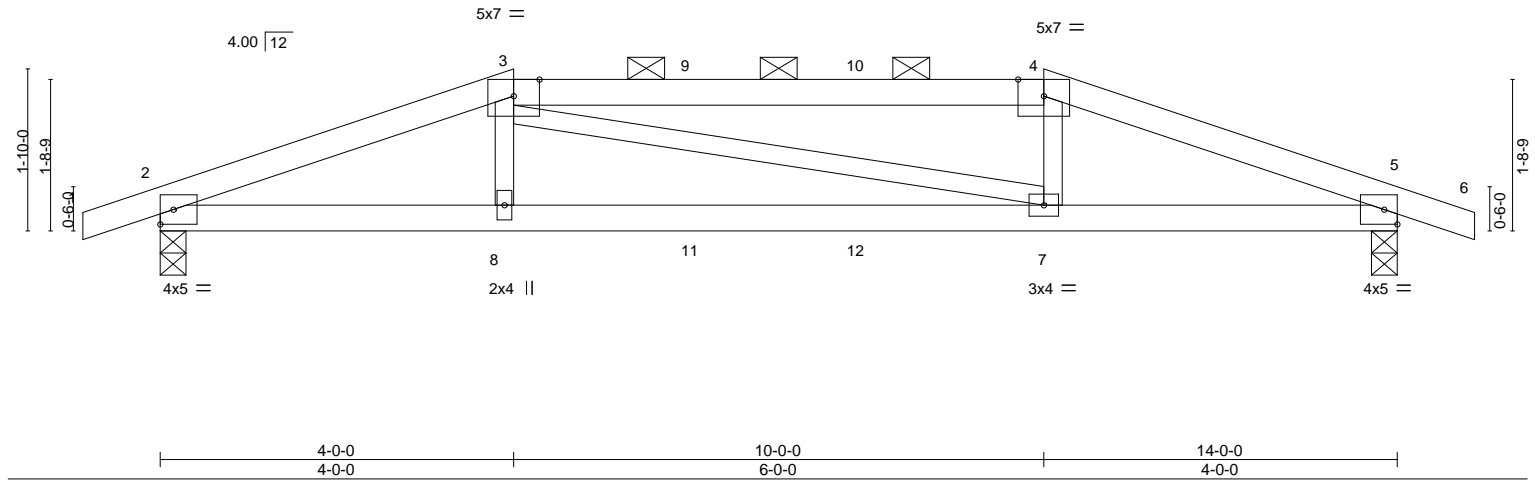

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.69	Vert(LL)	-0.09	7-8	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.78	Vert(CT)	-0.21	7-8	>784	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.16	Horz(CT)	0.05	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.08	7-8	>999	240	Weight: 42 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
3-4: 2x4 SPF 2100F 1.8E
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-8-3 oc purlins, except 2-0-0 oc purlins (4-2-15 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 8-5-5 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=0-3-8
Max Horz 2=-28(LC 9)
Max Uplift 2=-263(LC 4), 5=-263(LC 5)
Max Grav 2=1024(LC 1), 5=1024(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2374/529, 3-4=-2098/508, 4-5=-2314/516
BOT CHORD 2-8=-480/2189, 7-8=-483/2164, 5-7=-442/2121
WEBS 3-8=0/399, 4-7=0/415

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 263 lb uplift at joint 2 and 263 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 83 lb down and 72 lb up at 4-0-0, 83 lb down and 72 lb up at 6-0-12, and 83 lb down and 72 lb up at 7-11-4, and 83 lb down and 72 lb up at 10-0-0 on top chord, and 212 lb down and 69 lb up at 4-0-0, 36 lb down at 6-0-12, and 36 lb down at 7-11-4, and 212 lb down and 69 lb up at 9-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 3-4=-70, 4-6=-70, 2-5=-20



December 18, 2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063917
210285	A1	Hip Girder	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:22 2020 Page 2
ID:GTYmqTGpwjBwEikz5tITZ8zVUQ7-19pk_hiCa0uGqPMJIOQ9pXYpjlTFPE4tYpA?Yy7nqJ

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 3=-53(F) 4=-53(F) 8=-212(F) 7=-212(F) 9=-53(F) 10=-53(F) 11=-18(F) 12=-18(F)


Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063918
210285	A2	Hip	1	1		

Wheeler Lumber, Waverly, KS - 66871,


8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:22 2020 Page 1

ID:GTymqTGpwjwEikz5tITZ8zVUQ7-19pk_hiCa0uGqPMJIOQ9pXYrXrXFRI4tYpA?Yy7nqJ

Job Reference (optional)



Scale = 1:26.1

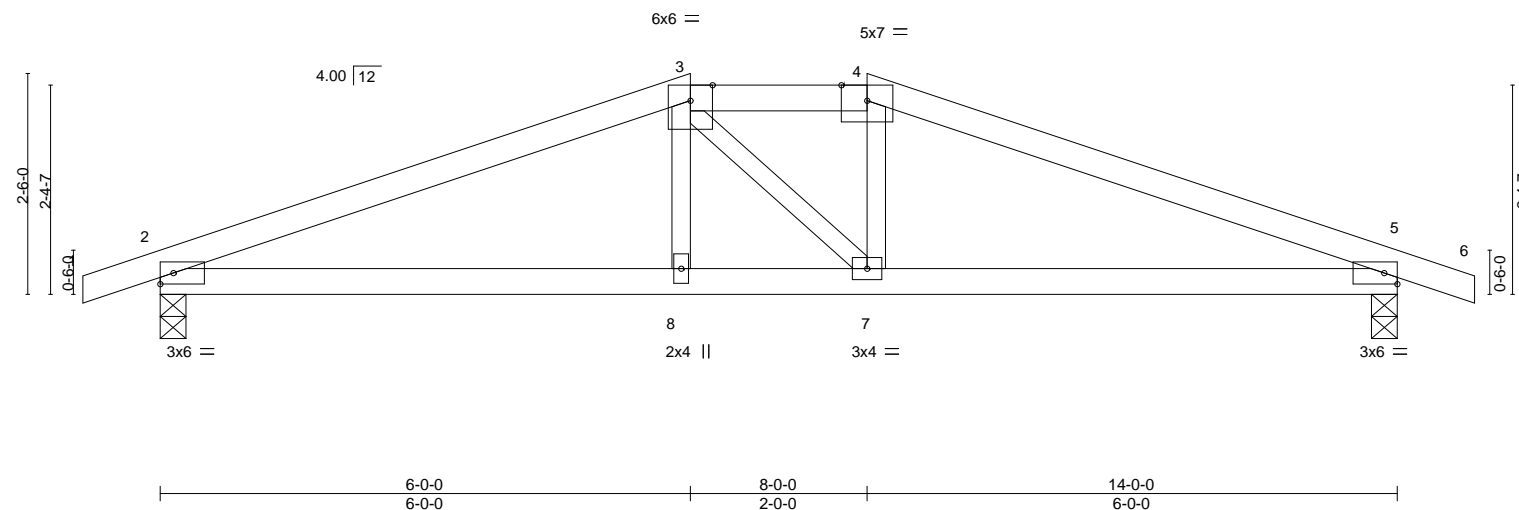

LOADING (psf)	SPACING-		CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.55	Vert(LL)	-0.04	2-8	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.45	Vert(CT)	-0.10	2-8	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.02	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.03	2-8	>999	240		
									Weight: 40 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-3-1 oc purlins, except 2-0-0 oc purlins (5-7-1 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 5=0-3-8
Max Horz 2=39(LC 8)
Max Uplift 2=141(LC 4), 5=141(LC 5)
Max Grav 2=688(LC 1), 5=688(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1163/158, 3-4=-1022/182, 4-5=-1164/157
BOT CHORD 2-8=-117/1026, 7-8=-119/1021, 5-7=-88/1027

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 141 lb uplift at joint 2 and 141 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063919
210285	A3	Common	3	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:23 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-VMN6B1iqLK06SZxWs6xOMk4zPiBx_tME6CYjX_y7nql



Scale = 1:25.3

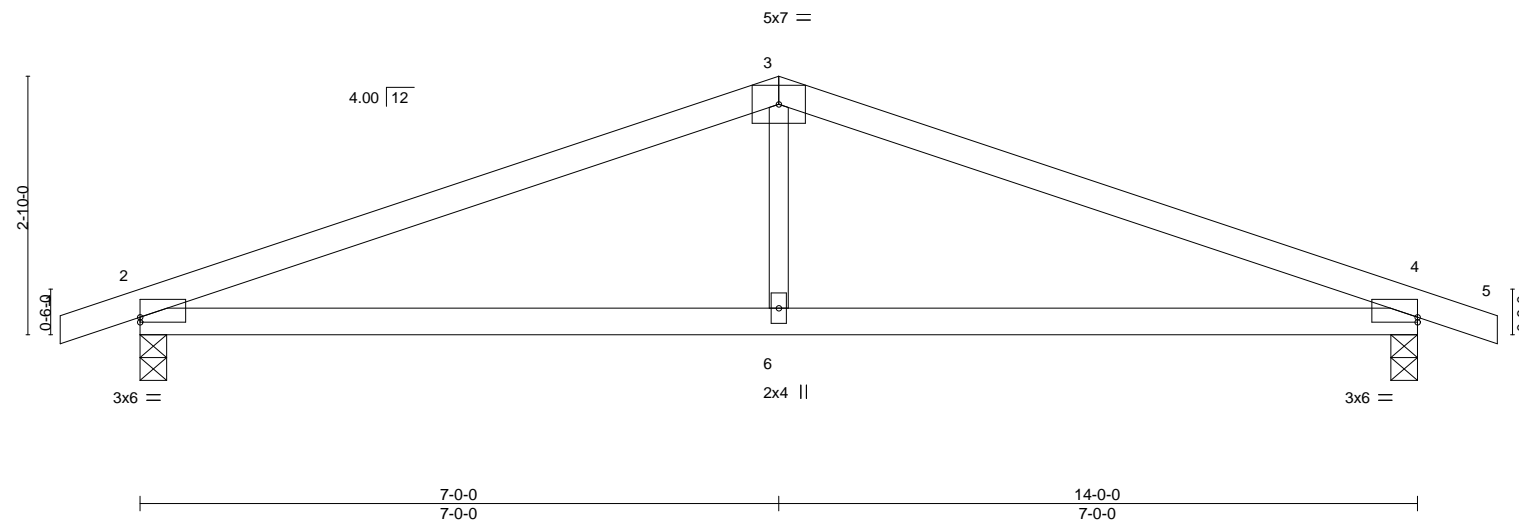


Plate Offsets (X,Y)--		[2:0-0-0,0-0-10], [4:0-0-0,0-0-10]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 25.0	Plate Grip DOL	1.15	TC 0.76
TCDL 10.0	Lumber DOL	1.15	BC 0.50
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.10
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.06 2-6 >999 360
			Vert(CT) -0.14 2-6 >999 240
			Horz(CT) 0.02 4 n/a n/a
			Wind(LL) 0.05 2-6 >999 240
			PLATES GRIP
			MT20 197/144
			Weight: 37 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-2-10 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 4=0-3-8
Max Horz 2=-46(LC 9)
Max Uplift 2=-134(LC 4), 4=-134(LC 5)
Max Grav 2=688(LC 1), 4=688(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1095/130, 3-4=-1095/130
BOT CHORD 2-6=-72/952, 4-6=-72/952
WEBS 3-6=0/331

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 134 lb uplift at joint 2 and 134 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063920
210285	B1	Hip Girder	1	1		


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:24 2020 Page 1

ID:GTYmqTGpwjwEikz5tTZ8zVUQ7-zYxUPNjS6d8z4jWiQpSdydDH5bxjLaNLsIH3Ry7nqH



Scale = 1:18.3

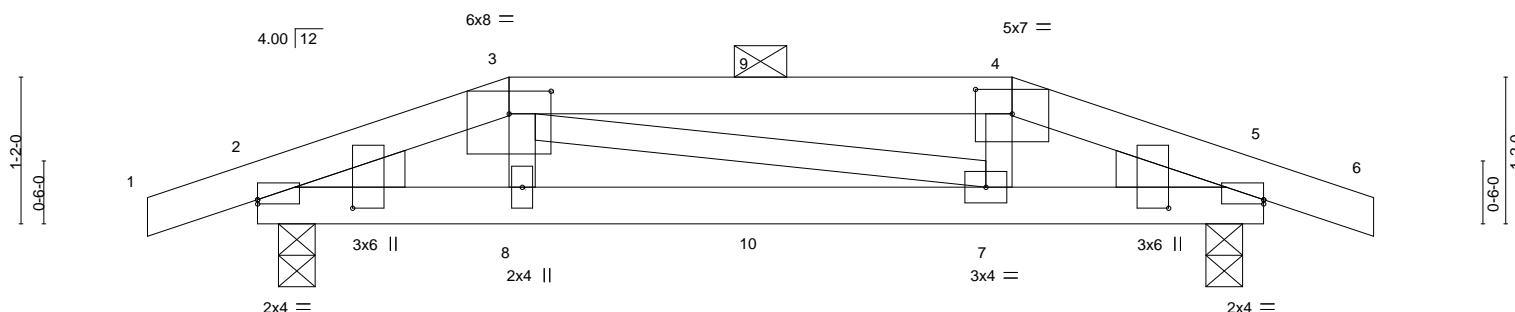

	0-2-0 0-2-0	2-0-0 1-10-0	6-0-0 4-0-0	7-10-0 1-10-0	8-0-0 0-2-0
Plate Offsets (X,Y)--	[2:0-0-13,0-9-1], [2:0-0-0,0-0-6], [3:0-4-0,0-2-3], [4:0-3-8,0-2-5], [5:Edge,0-0-6], [5:0-0-13,0-9-1]				

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.36	Vert(LL)	-0.01	7-8	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.20	Vert(CT)	-0.03	7-8	>999		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.04	Horz(CT)	0.01	5	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.01	7-8	>999	Weight: 27 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2
WEDGE

Left: 2x4 SPF No.2, Right: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 5=0-3-8
Max Horz 2=17(LC 29)
Max Uplift 2=-114(LC 4), 5=-114(LC 5)
Max Grav 2=418(LC 1), 5=418(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-613/108, 3-4=-531/99, 4-5=-615/107
BOT CHORD 2-8=-71/521, 7-8=-66/529, 5-7=-78/524

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 114 lb uplift at joint 2 and 114 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 107 lb down and 89 lb up at 2-0-0, and 54 lb down and 33 lb up at 4-0-0, and 107 lb down and 89 lb up at 6-0-0 on top chord, and 8 lb down at 2-0-0, and 8 lb down at 4-0-0, and 8 lb down at 5-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 3-4=-70, 4-6=-70, 2-5=-20



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063921
210285	B2	Common	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:25 2020 Page 1

ID:GTymqTGpwjwEikz5t1TZ8zVUQ7-SkVscjk4txGqhs5uzXzsR9AQuVxySoYXZW1qcty7nqG



Scale = 1:18.0

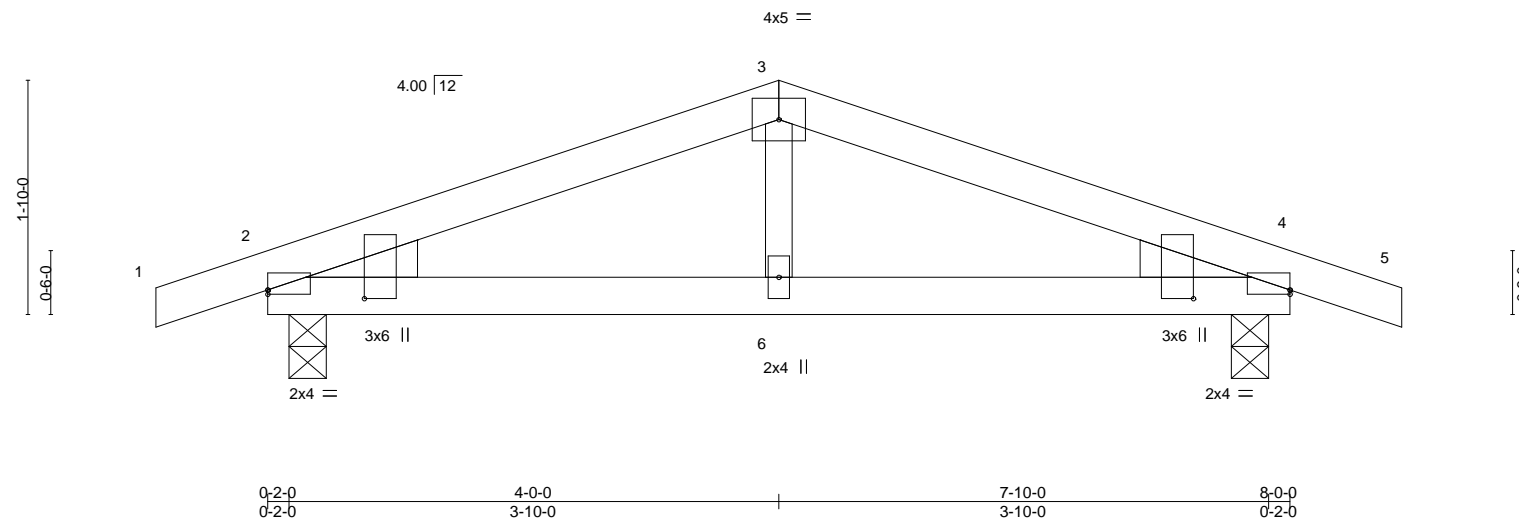


Plate Offsets (X,Y)-- [2:0-0-0,0-0-6], [2:0-0-13,0-9-1], [4:Edge,0-0-6], [4:0-0-13,0-9-1]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.24	Vert(LL)	-0.01 2-6 >999 360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.21	Vert(CT)	-0.02 2-6 >999 240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.06	Horz(CT)	0.01 4 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-P		Wind(LL)	0.01 6 >999 240	Weight: 24 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2
 WEDGE
 Left: 2x4 SPF No.2, Right: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 4=0-3-8
 Max Horz 2=29(LC 8)
 Max Uplift 2=96(LC 4), 4=96(LC 5)
 Max Grav 2=418(LC 1), 4=418(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-513/41, 3-4=-513/41
 BOT CHORD 2-6=-8/427, 4-6=-8/427

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 96 lb uplift at joint 2 and 96 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063922
210285	B3	Common	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:25 2020 Page 1

ID:GTymqTGpwjwEikz5tITZ8zVUQ7-SkVscjk4tXGqhs5uzXzsR9AQeVx_SomXZW1qcty7nqG



Scale = 1:15.8

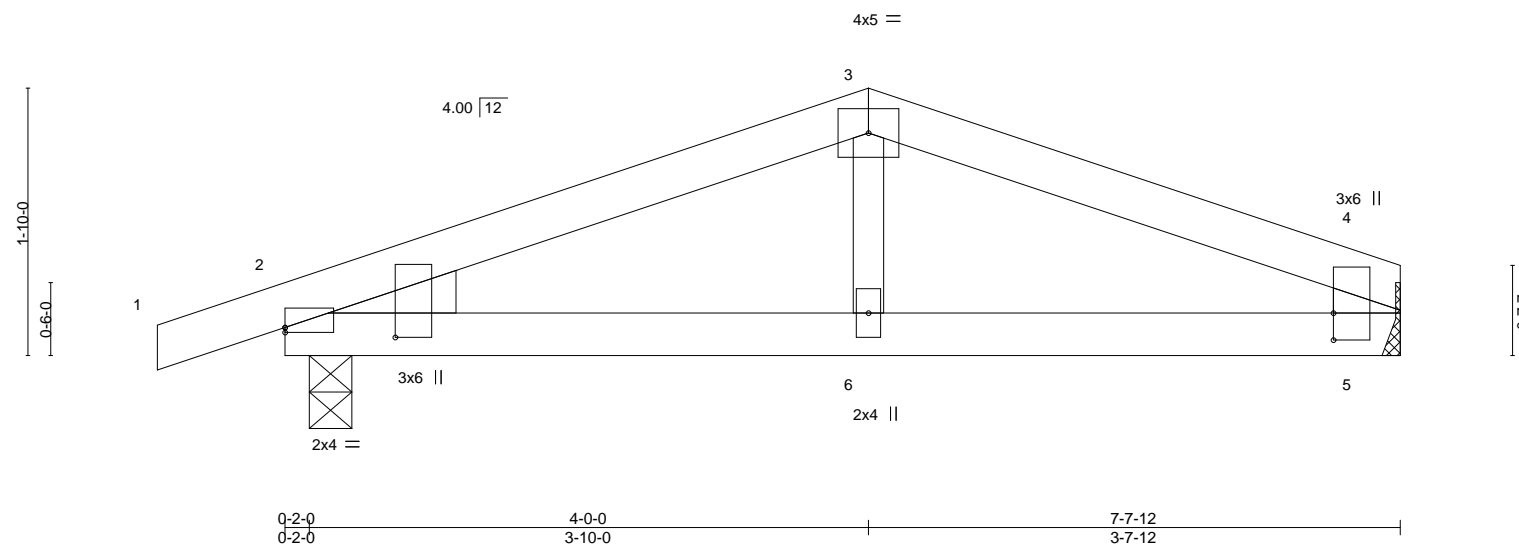


Plate Offsets (X,Y)--		[2:0-0-13,0-9-1], [2:0-0-0,0-0-6], [4:0-2-4,0-0-0]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 25.0	Plate Grip DOL	1.15	TC 0.20
TCDL 10.0	Lumber DOL	1.15	BC 0.21
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S
			DEFL. in (loc) l/defl L/d
			Vert(LL) -0.01 2-6 >999 360
			Vert(CT) -0.03 2-6 >999 240
			Horz(CT) 0.00 5 n/a n/a
			Wind(LL) 0.01 2-6 >999 240
			PLATES GRIP
			MT20 197/144
			Weight: 21 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except*
 4-5: 2x6 SPF No.2

WEDGE

Left: 2x4 SPF No.2

REACTIONS.


(size) 2=0-3-8, 5=Mechanical
 Max Horz 2=32(LC 8)
 Max Uplift 2=95(LC 4), 5=46(LC 5)
 Max Grav 2=404(LC 1), 5=322(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-479/60, 3-4=-462/59, 4-5=-269/64
 BOT CHORD 2-6=-29/398, 5-6=-29/398

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 95 lb uplift at joint 2 and 46 lb uplift at joint 5.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063923
210285	C1	Half Hip Girder	1	1	Job Reference (optional)	


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:26 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-wx3Fq3IjeFOhJ0g5XEU5_NiSpv8bB7YgoAnN8Jy7nqF



Scale = 1:26.9

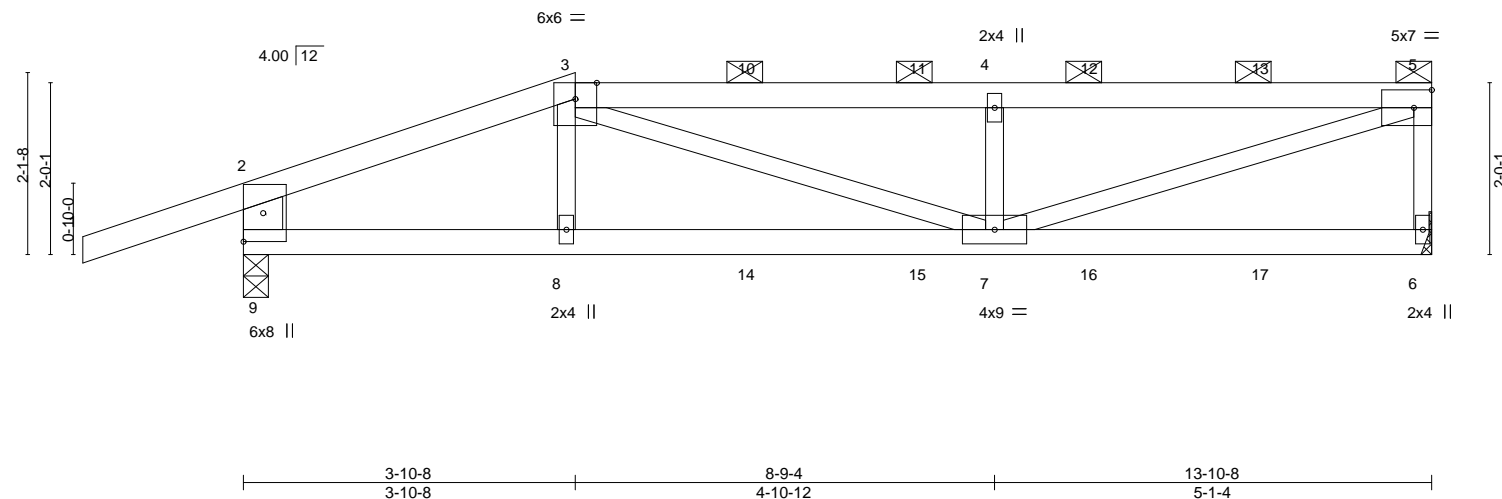

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.81	Vert(LL)	-0.10	7-8	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.83	Vert(CT)	-0.21	7-8	>785	240	197/144
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.52	Horz(CT)	0.01	6	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.10	7-8	>999	240	
									Weight: 47 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E *Except*
3-5: 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-9: 2x6 SP DSS

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-4-12 oc purlins, except end verticals, and 2-0-0 oc purlins (4-2-4 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=Mechanical, 9=0-3-8
Max Horz 9=87(LC 5)
Max Uplift 6=160(LC 5), 9=253(LC 4)
Max Grav 6=720(LC 1), 9=878(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1160/247, 3-4=-1498/345, 4-5=-1495/344, 5-6=-663/188, 2-9=-753/246
BOT CHORD 8-9=-264/1024, 7-8=-270/1024
WEBS 3-7=-114/502, 4-7=-505/235, 5-7=-350/1523

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 160 lb uplift at joint 6 and 253 lb uplift at joint 9.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 167 lb down and 129 lb up at 3-10-8, 76 lb down and 57 lb up at 5-11-4, 76 lb down and 57 lb up at 7-11-4, and 76 lb down and 57 lb up at 9-11-4, and 76 lb down and 57 lb up at 11-11-4 on top chord, and 69 lb down at 3-10-8, 28 lb down at 5-11-4, 28 lb down at 7-11-4, and 28 lb down at 9-11-4, and 28 lb down at 11-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

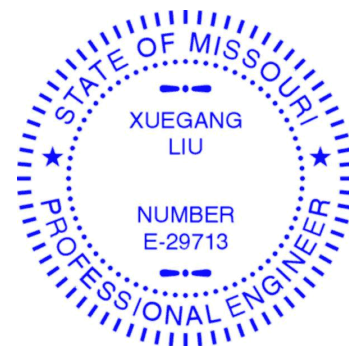

December 18, 2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063923
210285	C1	Half Hip Girder	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:26 2020 Page 2
ID:GTYmqTGpwjBwEikz5tITZ8zVUQ7-wx3Fq3ljeFOhJ0g5XEU5_NiSpv8bB7YgoAnN8Jy7nqF

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
 - Vert: 1-2=-70, 2-3=-70, 3-5=-70, 6-9=-20
- Concentrated Loads (lb)
 - Vert: 3=-50(F) 8=-22(F) 10=-27(F) 11=-27(F) 12=-27(F) 13=-27(F) 14=-13(F) 15=-13(F) 16=-13(F) 17=-13(F)




Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063924
210285	C2	Half Hip	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:27 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-O7dd1PmLPYWYxAEH5x?KWaFdJXrwayq1qWxgmy7nqE



Scale = 1:27.1

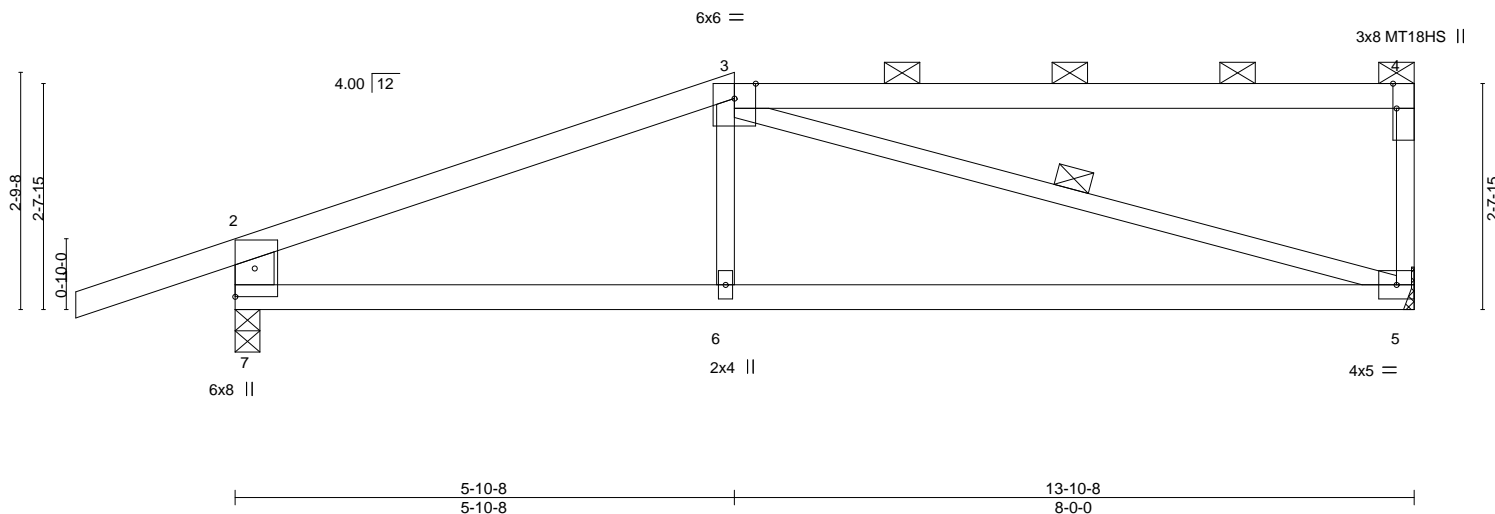


Plate Offsets (X,Y)--		[4:0-3-8,Edge]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0		Plate Grip DOL	1.15	TC 0.83		Vert(LL)	-0.15 5-6	>999	360	MT20	197/144
TCDL 10.0		Lumber DOL	1.15	BC 0.57		Vert(CT)	-0.32 5-6	>502	240	MT18HS	197/144
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.51		Horz(CT)	0.02 5	n/a	n/a		
BCDL 10.0		Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.07 5-6	>999	240		
										Weight: 45 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
3-4: 2x4 SPF 2100F 1.8E
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-7: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-1-5 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 3-5

REACTIONS.


(size) 5=Mechanical, 7=0-3-8
Max Horz 7=116(LC 7)
Max Uplift 5=-111(LC 4), 7=-206(LC 4)
Max Grav 5=598(LC 1), 7=768(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-968/149, 4-5=-284/112, 2-7=-680/222
BOT CHORD 6-7=-145/846, 5-6=-149/842
WEBS 3-6=0/281, 3-5=-784/131

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Refer to girder(s) for truss to truss connections.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 111 lb uplift at joint 5 and 206 lb uplift at joint 7.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

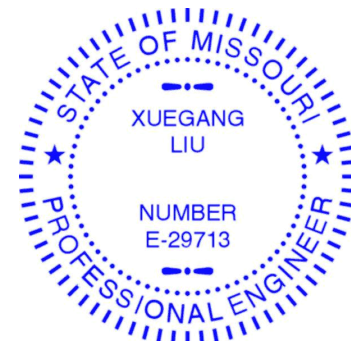

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063925
210285	C3	Half Hip	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:27 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-O7dd1PmLPYWYxAEH5x?KWaFcsJZOWVrq1qWxgmy7nqE



Scale = 1:26.6

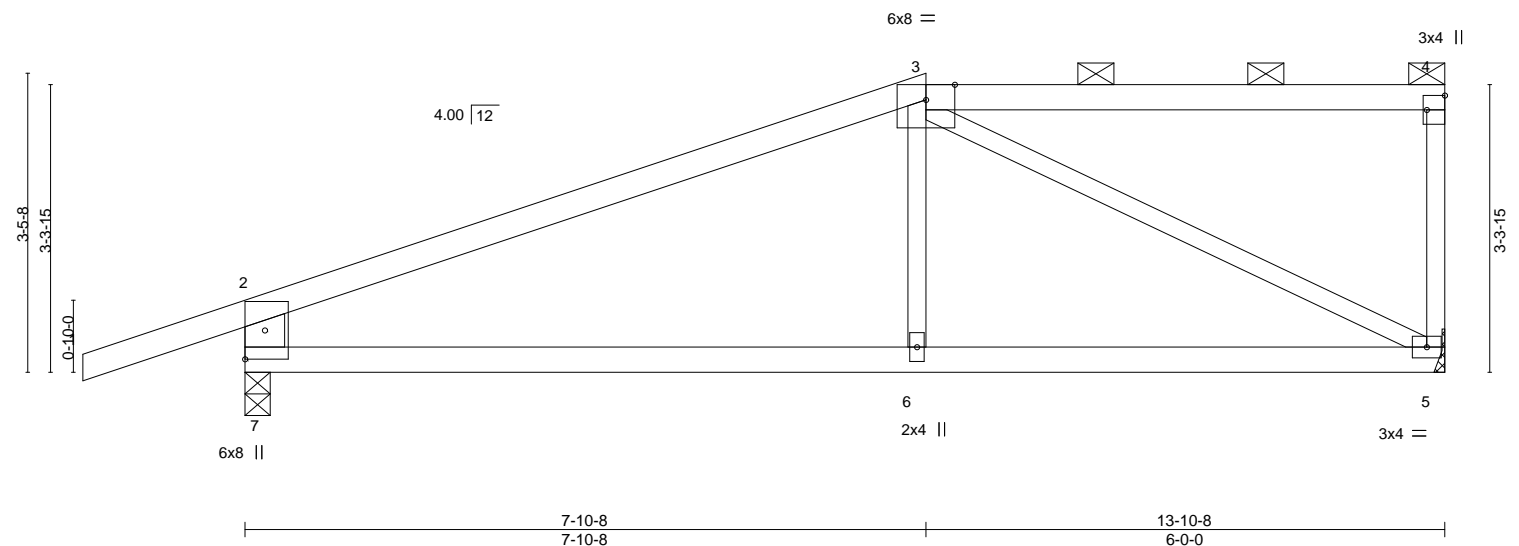


Plate Offsets (X,Y)--		[4:Edge,0-2-8]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0		Plate Grip DOL	1.15	TC 0.85		Vert(LL)	-0.07 6-7	>999	360	MT20	197/144
TCDL 10.0		Lumber DOL	1.15	BC 0.41		Vert(CT)	-0.15 6-7	>999	240		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.84		Horz(CT)	0.02 5	n/a	n/a		
BCDL 10.0		Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.02 6	>999	240	Weight: 45 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-7: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-9-12 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=Mechanical, 7=0-3-8
Max Horz 7=146(LC 5)
Max Uplift 5=113(LC 4), 7=203(LC 4)
Max Grav 5=598(LC 1), 7=768(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-837/135, 2-7=-689/248
BOT CHORD 6-7=-122/704, 5-6=-125/699
WEBS 3-6=0/298, 3-5=-757/141

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 113 lb uplift at joint 5 and 203 lb uplift at joint 7.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

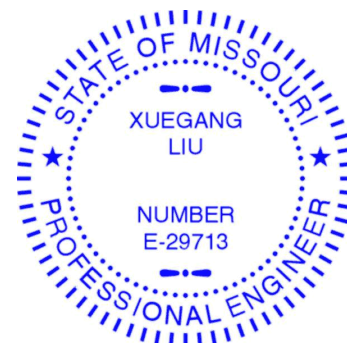

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063926
210285	C4	Half Hip	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:28 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-sJB?ElmzAsePYKpTffWZ3oooTjsEf2kzFUGUDCy7nqD

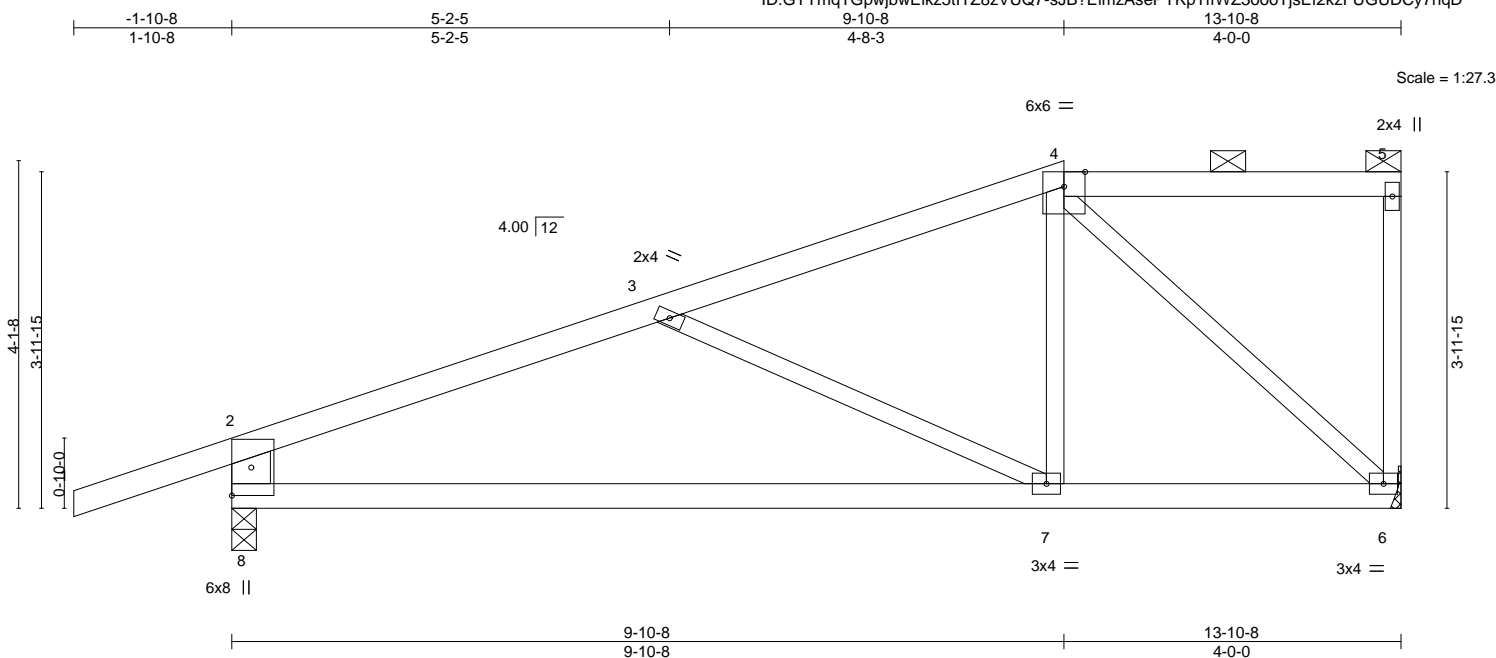

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCCL 25.0	Plate Grip DOL	1.15	TC 0.80	Vert(LL)	-0.20	7-8	>797	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.62	Vert(CT)	-0.40	7-8	>402	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.48	Horz(CT)	0.02	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.04	7	>999	240		
									Weight: 49 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except*
 2-8: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-6-4 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 6=Mechanical, 8=0-3-8
 Max Horz 8=175(LC 5)
 Max Uplift 6=117(LC 4), 8=200(LC 4)
 Max Grav 6=598(LC 1), 8=768(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-896/196, 3-4=-553/92, 2-8=-664/249
 BOT CHORD 7-8=-182/772, 6-7=-75/484
 WEBS 3-7=-309/188, 4-7=0/381, 4-6=-665/94

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 117 lb uplift at joint 6 and 200 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063927
210285	C5	Roof Special Girder	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:29 2020 Page 1

ID:GTymqTGpwjwEikz5tITZ8zVUQ7-KWkNS5nbxAnGAUOgCM2ob?Kzn69uOOM6U8?2ley7nqC



Scale = 1:30.6

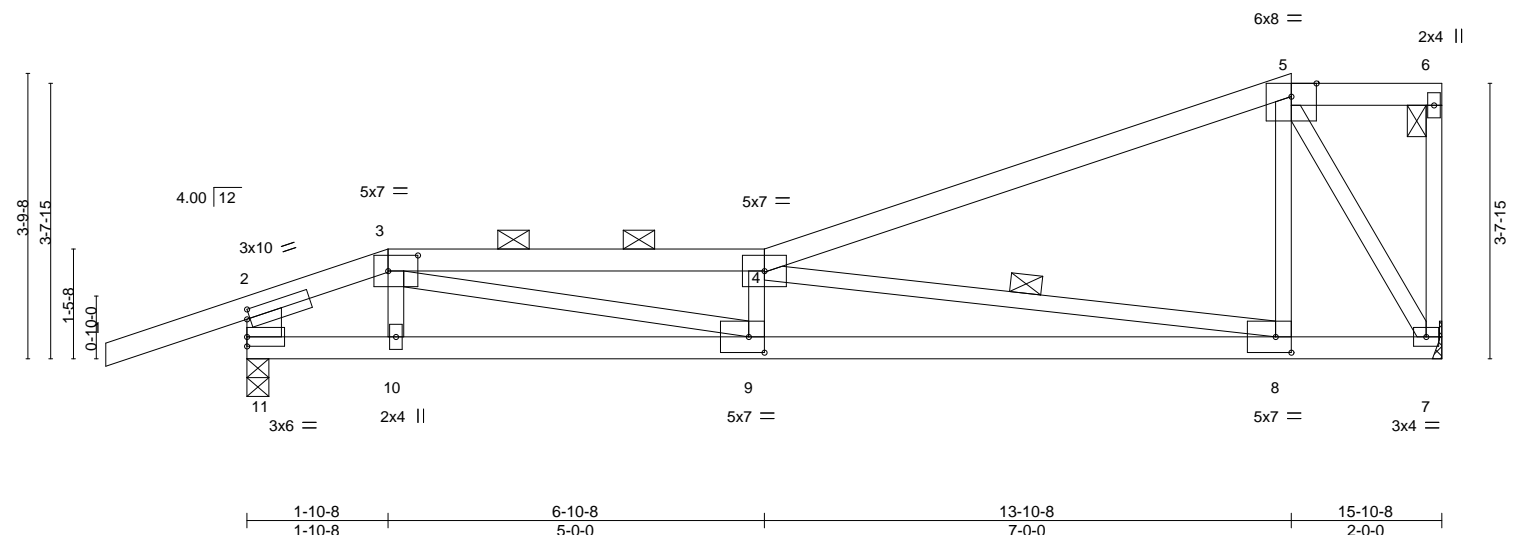


Plate Offsets (X,Y)-- [2:0-0-8,0-1-8], [3:0-4-12,0-2-8], [8:0-2-8,0-2-8], [9:0-2-8,0-2-8]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.83	Vert(LL)	-0.18	9	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.79	Vert(CT)	-0.33	8-9	>569	240		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.90	Horz(CT)	0.03	7	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.14	9	>999	240	Weight: 59 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-11: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-7-7 oc purlins, except end verticals, and 2-0-0 oc purlins (3-3-5 max.): 3-4, 5-6.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
8-10-12 oc bracing: 8-9.
WEBS 1 Row at midpt 4-8

REACTIONS.

(size) 7=Mechanical, 11=0-3-8
Max Horz 11=161(LC 5)
Max Uplift 7=136(LC 4), 11=255(LC 4)
Max Grav 7=685(LC 1), 11=816(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.



TOP CHORD 2-3=-851/195, 3-4=-2231/399, 4-5=-519/88, 2-11=-668/220
BOT CHORD 10-11=-203/722, 9-10=-198/715, 8-9=-435/2254, 7-8=-58/410
WEBS 3-9=-311/1610, 4-9=-280/159, 4-8=-1855/401, 5-8=-5/485, 5-7=-850/164

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 136 lb uplift at joint 7 and 255 lb uplift at joint 11.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 125 lb up and 185 lb up at 1-10-8 on top chord, and 25 lb down and 47 lb up at 1-10-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 5-6=-70, 7-11=-20

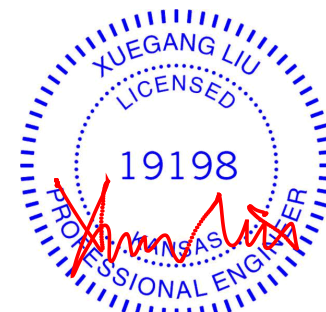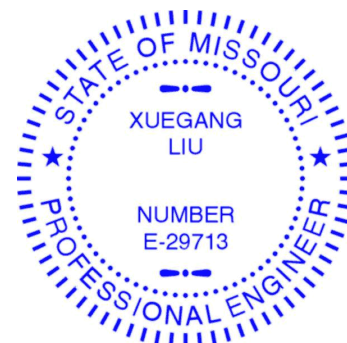

December 18, 2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063927
210285	C5	Roof Special Girder	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:29 2020 Page 2
ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-KWkNS5nbxAnGAUOgCM2ob?Kzn69uOOM6U8?2ley7nqC

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 3=38(F) 10=8(F)



Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063928
210285	C6	Roof Special	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:30 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-oilltQoDiTv7oezsm4Z18Dt5vWWf7siGj0lbH4y7nqB

Job Reference (optional)

-1-10-8	3-9-0	8-9-0	15-9-0	15-10-8
1-10-8	3-9-0	5-0-0	7-0-0	0-1-8

Scale = 1:29.5

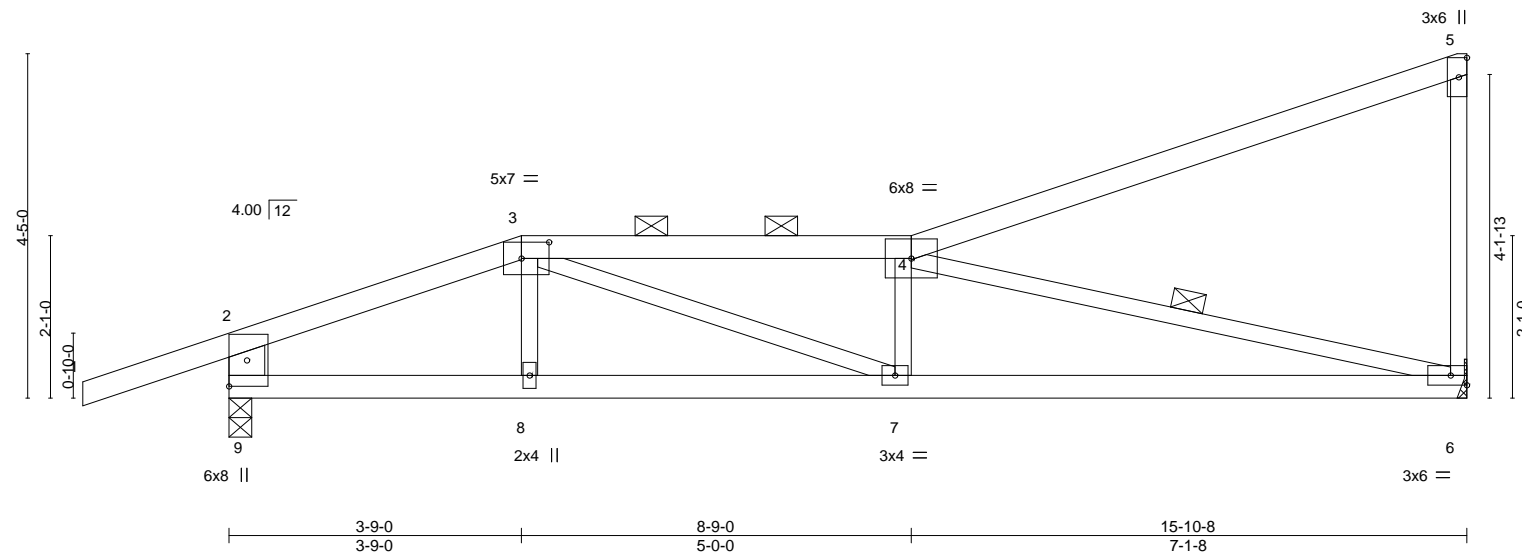


Plate Offsets (X,Y)--		[3:0-4-4,0-2-8]										
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP		
TCLL	25.0	Plate Grip DOL	1.15	TC	1.00	Vert(LL)	-0.13	7-8	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.76	Vert(CT)	-0.23	7-8	>797	240		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.83	Horz(CT)	0.03	6	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.11	7-8	>999	240	Weight: 56 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-9: 2x6 SP DSS

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-0-1 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 4-6

REACTIONS.


(size) 6=Mechanical, 9=0-3-8
Max Horz 9=195(LC 5)
Max Uplift 6=138(LC 8), 9=215(LC 4)
Max Grav 6=689(LC 1), 9=857(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1075/181, 3-4=-1585/257, 2-9=-726/217
BOT CHORD 8-9=-195/940, 7-8=-191/937, 6-7=-277/1589
WEBS 3-7=-100/689, 4-6=-1608/320

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 138 lb uplift at joint 6 and 215 lb uplift at joint 9.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063929
210285	D1	HIP GIRDER	1	1		
Job Reference (optional)						


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:31 2020 Page 1

ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-Gus8tmprTn1_PnY2Kn4GhQQPdwxBsSKPySU8pXy7nqA



Scale = 1:27.6

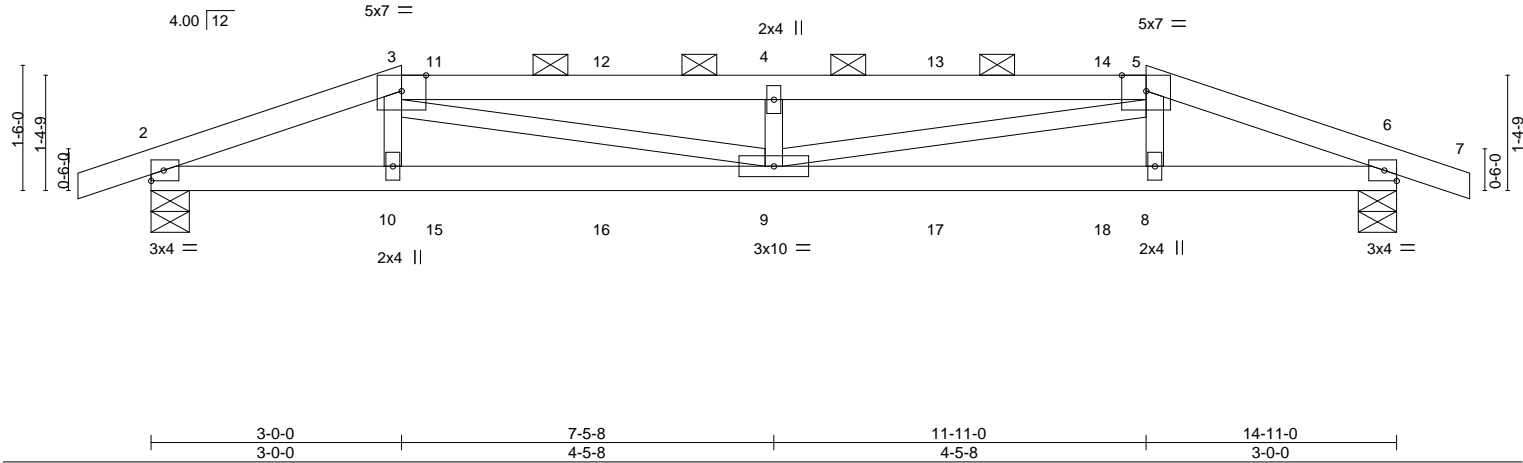

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.42	Vert(LL)	-0.10	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	-0.18				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.30	Horz(CT)	0.03				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.09	Weight: 46 lb		FT = 10%	

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-0-12 oc purlins, except
2-0-0 oc purlins (3-9-10 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-5-8, 6=0-5-8
Max Horz 2=21(LC 40)
Max Uplift 2=-210(LC 4), 6=-210(LC 5)
Max Grav 2=666(LC 1), 6=666(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-1374/361, 3-4=-1985/508, 4-5=-1985/508, 5-6=-1373/361
BOT CHORD 2-10=-319/1269, 9-10=-321/1259, 8-9=-304/1258, 6-8=-302/1267
WEBS 3-9=-180/864, 4-9=-334/144, 5-9=-181/864

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 210 lb uplift at joint 2 and 210 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 117 lb down and 133 lb up at 3-0-0, 53 lb down and 12 lb up at 3-5-8, 53 lb down and 12 lb up at 5-5-8, 53 lb down and 12 lb up at 7-5-8, 53 lb down and 12 lb up at 9-5-8, and 53 lb down and 12 lb up at 11-5-8, and 117 lb down and 133 lb up at 11-11-0 on top chord, and 26 lb down and 49 lb up at 3-0-0, 8 lb down and 7 lb up at 3-5-8, 8 lb down and 7 lb up at 5-5-8, 8 lb down and 7 lb up at 7-5-8, 8 lb down and 7 lb up at 9-5-8, and 8 lb down and 7 lb up at 11-5-8, and 26 lb down and 49 lb up at 11-10-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 3-5=-70, 5-7=-70, 2-6=-20

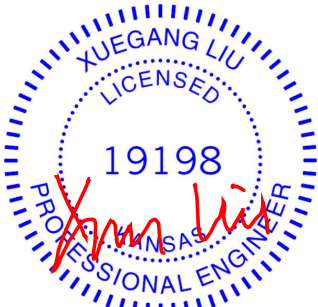

December 18,2020

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063929
210285	D1	HIP GIRDER	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:31 2020 Page 2
ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-Gus8tmpTn1_PnY2Kn4GhQQPdxBsSKPySU8pXy7nqA

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 3=37(F) 5=37(F) 10=7(F) 9=7(F) 8=7(F) 15=7(F) 16=7(F) 17=7(F) 18=7(F)


Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063930
210285	D2	HIP GIRDER	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:32 2020 Page 1

ID:GTymqTGpwjwEikz5t1TZ8zVUQ7-k4QW46pTD59r1x7EuVbVDeyWKDibvSZA6EimZy7nq9

Job Reference (optional)



Scale = 1:27.6

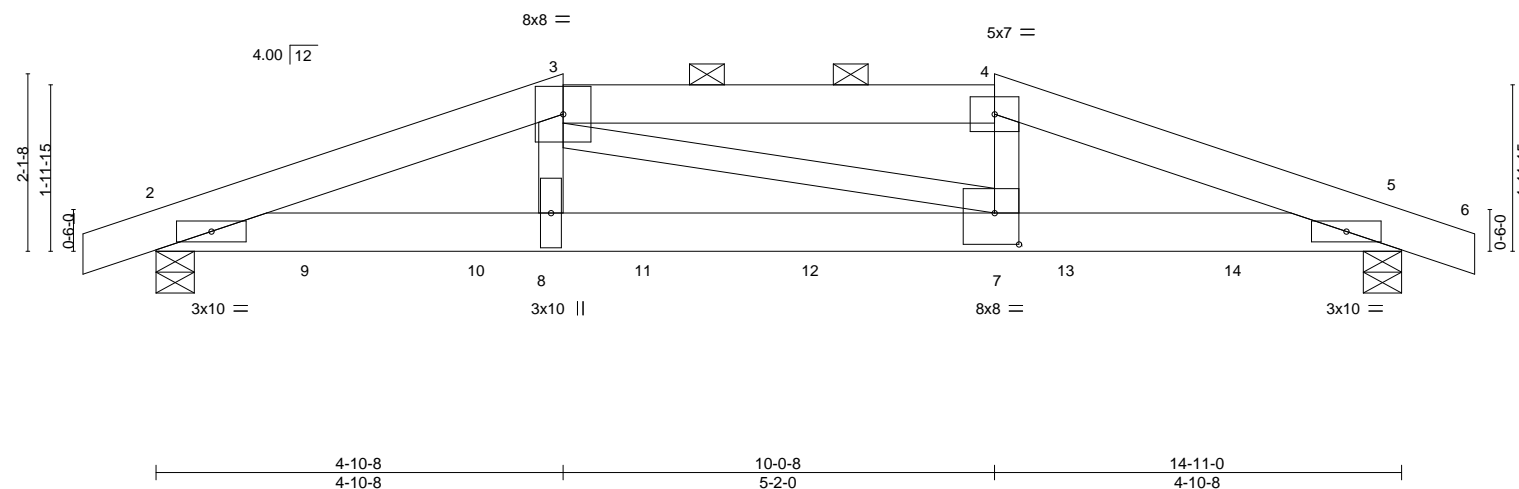


Plate Offsets (X,Y)-- [7:0-3-8,0-4-8]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.41	Vert(LL)	-0.13 7-8	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.65	Vert(CT)	-0.23 7-8	>766	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.24	Horz(CT)	0.05 5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.08 7-8	>999	240	Weight: 67 lb	FT = 10%

LUMBER-

TOP CHORD 2x6 SPF No.2
BOT CHORD 2x6 SPF 1650F 1.4E
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-5-11 oc purlins, except
2-0-0 oc purlins (3-7-1 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-5-8, 5=0-5-8
Max Horz 2=-33(LC 9)
Max Uplift 2=-234(LC 4), 5=-247(LC 5)
Max Grav 2=1678(LC 1), 5=1666(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-3896/413, 3-4=-3563/422, 4-5=-3897/422
BOT CHORD 2-8=-367/3663, 7-8=-368/3584, 5-7=-343/3647
WEBS 3-8=0/831, 4-7=-22/980

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 234 lb uplift at joint 2 and 247 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 283 lb down and 30 lb up at 1-10-12, 283 lb down and 30 lb up at 3-10-12, 283 lb down and 30 lb up at 5-10-12, 283 lb down and 30 lb up at 7-10-12, 283 lb down and 30 lb up at 9-10-12, and 283 lb down and 30 lb up at 10-11-8, and 191 lb down and 42 lb up at 12-11-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 3-4=-70, 4-6=-70, 2-5=-20

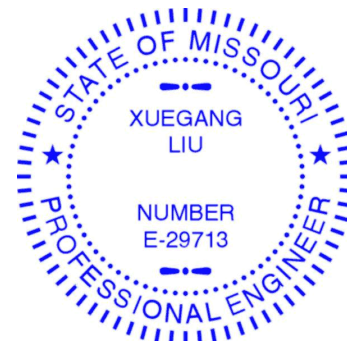

December 18, 2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063930
210285	D2	HIP GIRDER	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:32 2020 Page 2
ID:GTYmqTGpwjbwEikz5tITZ8zVUQ7-k4QW46pTD59r1x7EuVbVDeyaWKDibvSZA6EiMzy7nq9


LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 7=-283(B) 9=-283(B) 10=-283(B) 11=-283(B) 12=-283(B) 13=-283(B) 14=-191(B)



8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:34 2020 Page 1
ID:GTYmgTGowibwEikz5tITZ8zVUQ7-hTYGVorkIiPZGFHd?wdzI32nO7vf3hpqeQioQsv7ng7

-0-10-8	2-9-8	7-11-4	12-11-0	19-6-10	26-2-4	33-2-0	35-0-0
0-10-8	2-9-8	5-1-12	4-11-12	6-7-10	6-7-10	6-11-12	1-10-0

Scale = 1:61.4

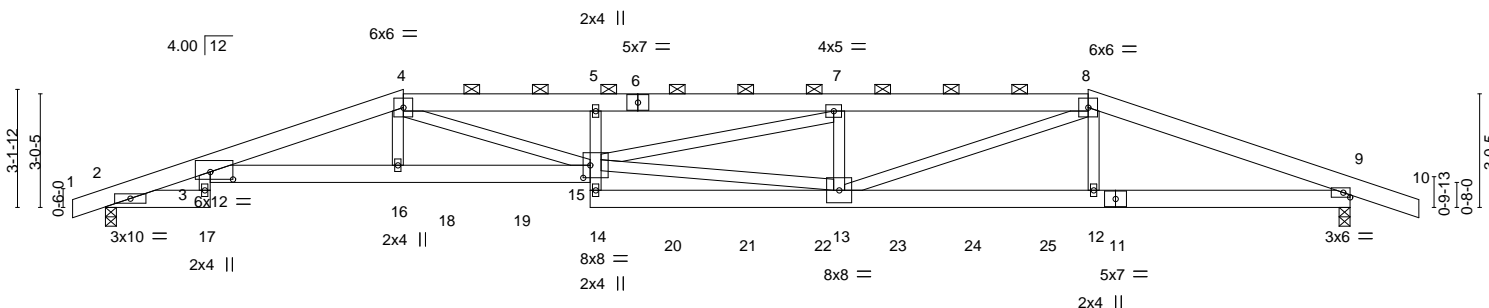

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.96	Vert(LL) -0.43 15 >928 360	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.62	Vert(CT) -0.74 15 >534 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.76	Horz(CT) 0.26 9 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S	Wind(LL) 0.27 15 >999 240	Weight: 768 lb	FT = 10%

LUMBER-

TOP CHORD 2x6 SP DSS *Except*
4-6,6-8: 2x6 SPF No.2
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 4-8.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 9=0-3-8
Max Horz 2=30(LC 29)
Max Uplift 2=-426(LC 4), 9=-447(LC 5)
Max Grav 2=3534(LC 1), 9=3678(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-1399/187, 3-4=-13451/1611, 4-5=-16061/1831, 5-7=-15456/1768, 7-8=-12453/1374, 8-9=-9224/1033
BOT CHORD	3-16=-1523/13040, 15-16=-1510/12946, 13-14=-197/1857, 12-13=-893/8452, 9-12=-900/8527
WEBS	3-17=-61/673, 14-15=-44/727, 5-15=-260/162, 4-16=-192/1514, 4-15=-325/3542, 13-15=-1124/10647, 7-15=-410/3157, 7-13=-1536/249, 8-13=-454/4414, 8-12=-124/1342

NOTES-

- 1) 4-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-7-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
Attach BC w/ 1/2" diam. bolts (ASTM A-307) in the center of the member w/washers at 4-0-0 oc.
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Unbalanced roof live loads have been considered for this design.
- 4) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 5) Provide adequate drainage to prevent water ponding.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 426 lb uplift at joint 2 and 447 lb uplift at joint 9.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

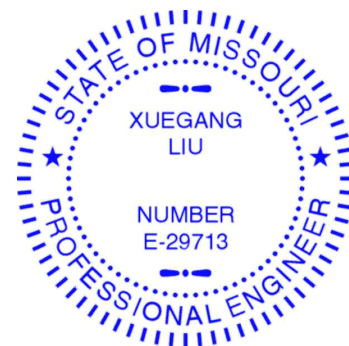

December 18, 2020

Continued on page 2



WARNING: Velly design parameters are listed in the following table and included with the key reference to the applicable code. This design is valid for use only with MiteK® connectors. This design is based only upon parameters shown, and is for the building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0
210285	E1	Hip Girder	1	4	I44063931

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:34 2020 Page 2
ID:GTYmqTGpwjBwEikz5tITZ8zVUQ7-hTYGVorkliPZGFHd?wdzl32nO7vf3hpreQjoQsy7nq7

NOTES-

11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 841 lb down and 220 lb up at 7-11-4, 262 lb down and 40 lb up at 9-0-12, 262 lb down and 40 lb up at 11-0-12, 262 lb down and 39 lb up at 13-0-12, 283 lb down and 42 lb up at 15-0-12, 283 lb down and 42 lb up at 17-0-12, 283 lb down and 42 lb up at 19-0-12, 283 lb down and 42 lb up at 21-0-12, 283 lb down and 42 lb up at 23-0-12, and 283 lb down and 42 lb up at 25-0-12, and 722 lb down and 171 lb up at 26-1-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-70, 4-8=-70, 8-10=-70, 2-17=-20, 3-15=-20, 9-14=-20
Concentrated Loads (lb)
Vert: 15=-262(F) 16=-841(F) 12=-722(F) 18=-262(F) 19=-262(F) 20=-283(F) 21=-283(F) 22=-283(F) 23=-283(F) 24=-283(F) 25=-283(F)

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063932
210285	E2	Hip	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:35 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-9f6ej8sMW0XQuPspZd8CrGa1sXDvoAF?s4SMlyl7nq6

-0-10-8	5-1-10	9-11-4	17-0-12	24-2-4	28-11-13	33-2-0	35-0-0
0-10-8	5-1-10	4-9-10	7-1-8	7-1-8	4-9-9	4-2-3	1-10-0

Scale = 1:59.4

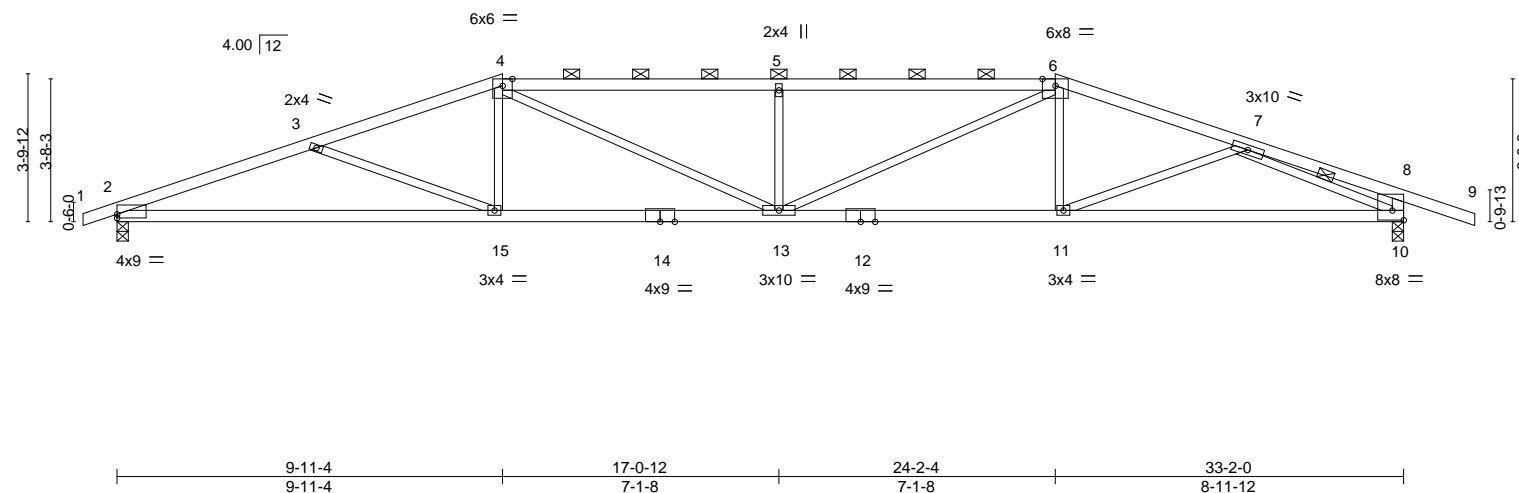


Plate Offsets (X,Y)-- [2:0-0-0,0-1-2], [10:Edge,0-3-0]		9-11-4 9-11-4		17-0-12 7-1-8		24-2-4 7-1-8		33-2-0 8-11-12	
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.66	Vert(LL)	-0.28 13	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.75	Vert(CT)	-0.52 2-15	>756	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.62	Horz(CT)	0.13 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.22 13	>999	240		
								Weight: 113 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
4-6: 2x4 SPF 2100F 1.8E
BOT CHORD 2x4 SPF 2100F 1.8E *Except*
12-14: 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
8-10: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-4 oc purlins, except end verticals, and 2-0-0 oc purlins (3-4-7 max.): 4-6.
BOT CHORD Rigid ceiling directly applied or 8-10-3 oc bracing.
WEBS 1 Row at midpt 7-10

REACTIONS.


(size) 2=0-3-8, 10=0-3-8
Max Horz 2=54(LC 8)
Max Uplift 2=302(LC 4), 10=341(LC 5)
Max Grav 2=1548(LC 1), 10=1621(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3511/679, 3-4=-3215/555, 4-5=-3675/679, 5-6=-3675/679, 6-7=-2994/505, 7-8=-424/24, 8-10=-431/138
BOT CHORD 2-15=-619/3240, 13-15=-446/3001, 11-13=-363/2801, 10-11=-436/2626
WEBS 3-15=-263/234, 4-15=0/386, 4-13=-226/916, 5-13=-628/246, 6-13=-256/1101, 6-11=0/261, 7-11=0/398, 7-10=-2539/574

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 302 lb uplift at joint 2 and 341 lb uplift at joint 10.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063933
210285	E3	Roof Special Girder	1	2	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:36 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-dsg1wUt_HJfGWZR07KgROU7D5xZgXe885kCvVky7nq5



Scale: 3/16"=1'


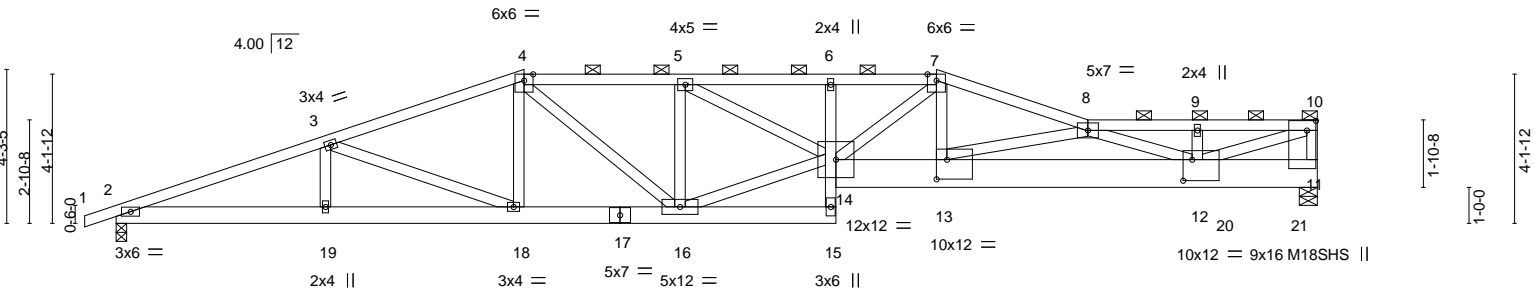



Plate Offsets (X,Y)--		[11:0-3-4,0-3-0], [12:0-3-0,0-7-0], [13:0-3-8,0-6-8]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.63	Vert(LL)	-0.31	15	>999	360	MT20	197/144	
TCDL 10.0	Lumber DOL	1.15	BC 0.72	Vert(CT)	-0.55	15	>721	240	M18SHS	197/144	
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.52	Horz(CT)	0.09	11	n/a	n/a			
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.22	15	>999	240			
									Weight: 368 lb	FT = 10%	

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 4-0-14 oc purlins, except end verticals, and 2-0-0 oc purlins (3-6-5 max.): 4-7, 8-10.
BOT CHORD	2x6 SPF No.2 *Except*	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
	6-15: 2x4 SPF No.2, 11-14: 2x10 SP DSS		
WEBS	2x4 SPF No.2 *Except*		
	8-12,10-12: 2x4 SPF 2100F 1.8E		

REACTIONS. (size) 11=0-6-0, 2=0-3-8
 Max Horz 2=105(LC 29)
 Max Uplift 11=1015(LC 5), 2=342(LC 4)
 Max Grav 11=6587(LC 1), 2=1948(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-4811/750, 3-4=-4315/685, 4-5=-4849/768, 5-6=-7178/1096, 6-7=-7182/1096,
 7-8=-7747/1127, 8-9=-9181/1224, 9-10=-9181/1224, 10-11=-3905/549
 BOT CHORD 2-19=-744/4462, 18-19=-744/4462, 16-18=-609/4034, 15-16=-113/788, 6-14=-357/119,
 13-14=-1050/7231, 12-13=-1751/11827, 11-12=-74/411
 WEBS 3-18=-467/244, 4-18=-22/346, 4-16=-204/1239, 5-16=-1857/371, 14-16=-615/4211,
 5-14=-424/2748, 7-14=-542/516, 7-13=-240/2251, 8-13=-4710/724, 8-12=-2891/551,
 10-12=-1272/9517

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc, 2x10 - 2 rows staggered at 0-2-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed;
 MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 1015 lb uplift at joint 11 and 342 lb uplift at joint 2.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and conforms to standard ANSI/TPI 1.

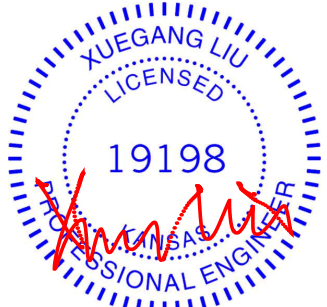

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component
Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek®
 16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0
210285	E3	Roof Special Girder	1	2	I44063933
					Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:36 2020 Page 2
ID:GTYmqTGpwjBwEikz5tITZ8zVUQ7-dsg1wUt_HJfGWZR07KgROU7D5xZgXe885kCvVky7nq5

NOTES-

- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 12) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 5086 lb down and 617 lb up at 30-8-15, and 401 lb down and 201 lb up at 32-9-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
 - Vert: 1-4=-70, 4-7=-70, 7-8=-70, 8-10=-70, 2-15=-20, 11-14=-20
- Concentrated Loads (lb)
 - Vert: 20=-5086(F) 21=-401(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063934
210285	E4	Roof Special	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:37 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-52DP7qtc2dn78i?Cg2BgwhfJ7LskG12IKOxT1By7nq4



Scale = 1:55.2


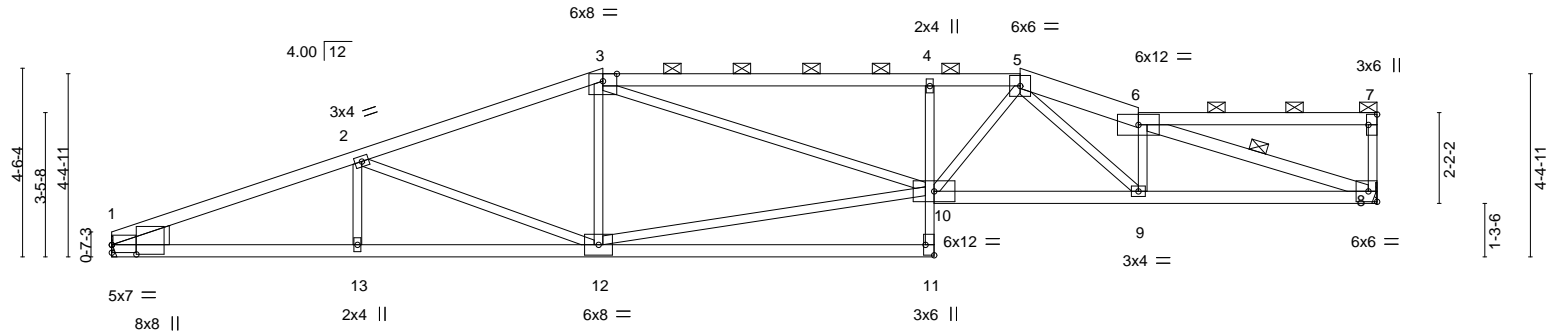


Plate Offsets (X,Y)--	[1:0-2-12,0-7-1], [1:0-0-0,0-2-4], [7:Edge,0-2-8], [11:Edge,0-2-8]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.93	Vert(LL)	-0.27 9-10	>999	360
TCDL 10.0	Lumber DOL	1.15	BC 0.92	Vert(CT)	-0.55 11-12	>657	240
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.79	Horz(CT)	0.16 8	n/a	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.15 10	>999	240
						Weight: 115 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
3-5: 2x4 SPF 2100F 1.8E, 5-6: 2x6 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
4-11: 2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except*
6-8: 2x4 SPF No.2
WEDGE
Left: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-5-1 oc purlins, except end verticals, and 2-0-0 oc purlins (2-2-0 max.): 3-5, 6-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-8

REACTIONS. (size) 8=Mechanical, 1=Mechanical
Max Horz 1=83(LC 5)
Max Uplift 8=54(LC 5), 1=53(LC 4)
Max Grav 8=1357(LC 1), 1=1357(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=3183/139, 2-3=2592/120, 3-4=3402/162, 4-5=3412/155, 5-6=3551/137
BOT CHORD 1-13=151/2923, 12-13=151/2923, 4-10=588/131, 9-10=120/2874, 8-9=127/3313
WEBS 2-12=574/101, 10-12=94/2309, 3-10=102/1165, 5-10=82/954, 5-9=20/645, 6-9=340/90, 6-8=3420/116

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 8 and 53 lb uplift at joint 1.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18,2020

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063935
210285	E5	ROOF SPECIAL	1	1		

Wheeler Lumber,
Waverly, KS - 66871,

8.430 s Nov 30 2020
MiTek Industries, Inc.
Fri Dec 18 08:19:38 2020
Page 1

ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-ZEnnLAuEpxv_IsaOElivTvCT2lDQ?RNRZ2h0Zdy7nq3

Job Reference (optional)

0-10-8 2-3-4 3-3-4 9-1-13 14-11-4 18-0-12 21-2-4 24-0-4 27-9-13 31-7-6
0-10-8 2-3-4 1-0-0 5-10-9 5-9-7 3-1-8 3-1-8 2-10-0 3-9-9 3-9-9

Scale = 1:59.8

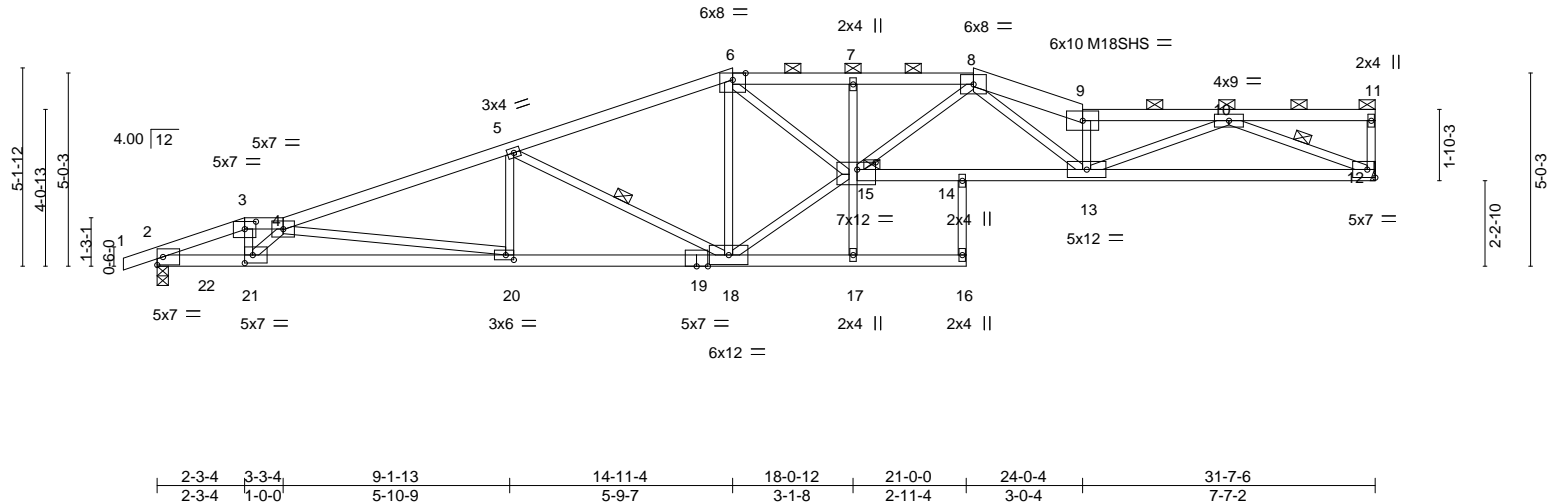


Plate Offsets (X,Y)--		[3:0-3-8,0-2-5], [15:0-5-12,0-2-4], [20:0-2-8,0-1-8], [21:0-2-8,0-2-8]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 25.0	2-0-0	TC 0.98	in (loc) l/defl L/d
TCDL 10.0	Plate Grip DOL 1.15	BC 0.89	Vert(LL) -0.42 15 >901 360
BCLL 0.0 *	Lumber DOL 1.15	WB 0.98	Vert(CT) -0.76 14-15 >496 240
BCDL 10.0	Rep Stress Incr NO	Matrix-S	Horz(CT) 0.20 12 n/a n/a
	Code IRC2018/TPI2014		Wind(LL) 0.22 14-15 >999 240
		PLATES	
		GRIP	
		MT20 197/144	
		M18SHS 197/144	
		Weight: 122 lb FT = 10%	

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-6-0 max.): 3-4, 6-8, 9-11.
8-9: 2x6 SPF No.2, 9-11: 2x4 SPF 2100F 1.8E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
BOT CHORD 2x4 SPF 2100F 1.8E *Except*	WEBS 1 Row at midpt 5-18, 10-12
16-19: 2x4 SPF No.2	JOINTS 1 Brace at Jt(s): 11, 15
WEBS 2x3 SPF No.2	


REACTIONS.	(size) 12=Mechanical, 2=0-3-8
	Max Horz 2=96(LC 8)
	Max Uplift 12=50(LC 5), 2=118(LC 4)
	Max Grav 12=1420(LC 1), 2=1755(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-3410/98, 3-4=-3227/103, 4-5=-3495/134, 5-6=-2564/115, 6-7=-4343/157, 7-8=-4346/155, 8-9=-5459/147, 9-10=-5050/114
BOT CHORD	2-21=-158/3084, 20-21=-245/4310, 18-20=-151/3279, 14-15=-131/3901, 13-14=-131/3901, 12-13=-151/2957
WEBS	3-21=-32/1334, 4-21=-1589/142, 4-20=-1045/100, 5-20=0/383, 5-18=-1021/90, 6-18=-1010/86, 15-18=-91/2853, 7-15=-282/56, 9-13=-1843/95, 6-15=-88/2487, 8-15=-45/712, 8-13=-11/1674, 10-13=0/2271, 10-12=-3139/163

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Refer to girder(s) for truss to truss connections.
 - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 50 lb uplift at joint 12 and 118 lb uplift at joint 2.
 - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 281 lb down and 48 lb up at 1-2-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 12) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
Continued on page 2

December 18,2020

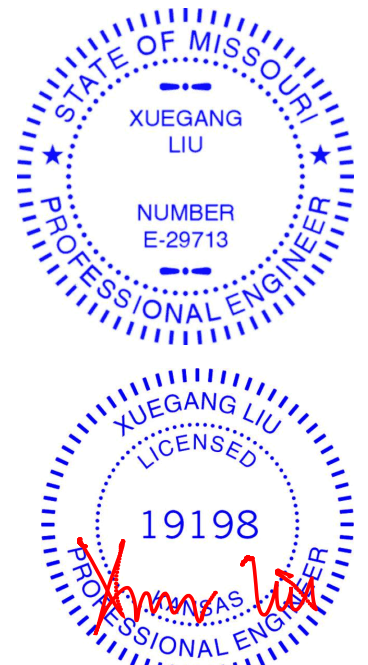

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063935
210285	E5	ROOF SPECIAL	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:38 2020 Page 2
ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-ZEnnLauEpxv_IsaOElivTvCT2lDQ?RNRZ2h0Zdy7nq3

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 3-4=-70, 4-6=-70, 6-8=-70, 8-9=-70, 9-11=-70, 2-16=-20, 12-14=-20
Concentrated Loads (lb)
Vert: 22=-281(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**
Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063936
210285	E6	Roof Special Girder	1	1		


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:41 2020 Page 1

ID:GTymqTGpwjBwEikz5tITZ8zVUQ7-_pTwzBw76sHZcKJzvuFc5Xq_HyEhCoEtF?vgAyy7nq0

0-10-8 1-6-4	2-6-4	10-2-6	16-11-4	19-2-4	21-0-0	22-0-4	26-3-8	30-6-12	31-7-6
0-10-8 1-6-4	1-0-0	7-8-2	6-8-14	2-3-0	1-9-12	1-0-4	4-3-4	4-3-4	1-0-10

Scale = 1:59.8

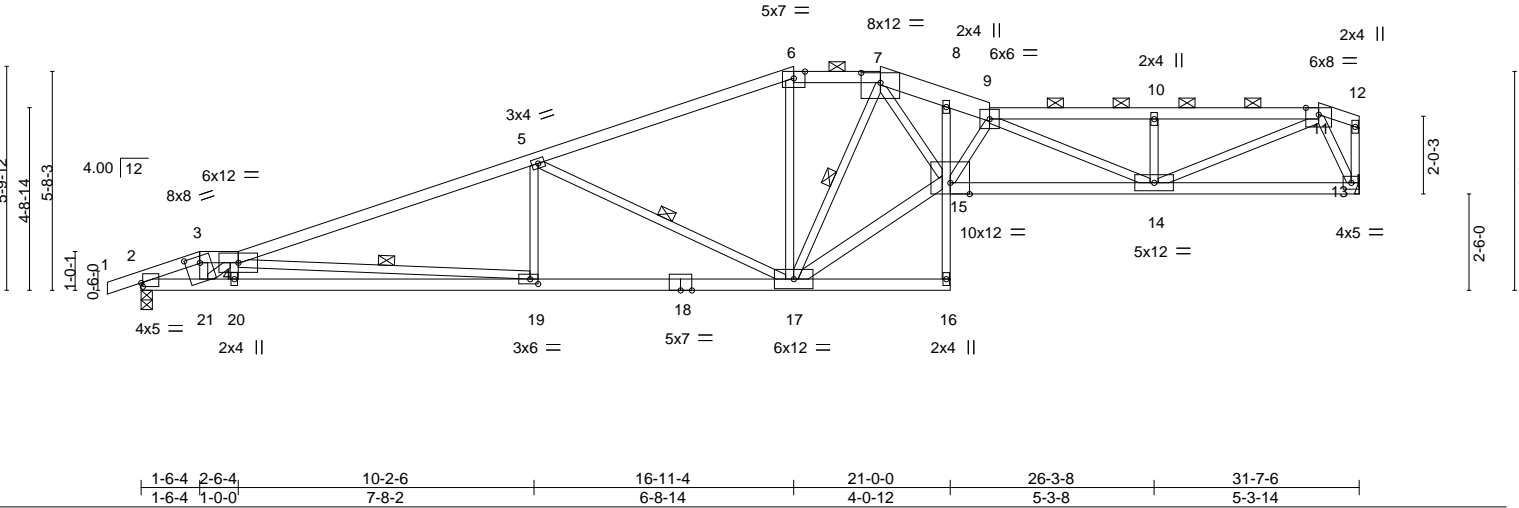

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.34	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.85	Vert(CT)	-0.61				
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.97	Horz(CT)	0.17				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.18				

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
4-6: 2x4 SPF 2100F 1.8E, 7-9: 2x6 SPF No.2

BOT CHORD 2x4 SPF 2100F 1.8E *Except*
8-16: 2x3 SPF No.2, 16-18: 2x4 SPF No.2

WEBS 2x3 SPF No.2 *Except*
15-17: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-10-5 max.): 3-4, 6-7, 9-11.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 4-19, 5-17, 7-17

REACTIONS.

(size) 2=0-3-8, 13=Mechanical
Max Horz 2=108(LC 8)
Max Uplift 2=72(LC 4), 13=43(LC 5)
Max Grav 2=1484(LC 1), 13=1410(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2766/61, 3-4=-2613/65, 4-5=-3327/97, 5-6=-2239/75, 6-7=-2046/86, 7-8=-4253/108, 8-9=-4416/96, 9-10=-3208/77, 10-11=-3210/78

BOT CHORD 2-21=-133/2426, 20-21=-142/4207, 19-20=-162/4207, 17-19=-122/3106, 8-15=0/358, 14-15=-132/4722, 13-14=-43/670

WEBS 3-21=-72/1293, 4-21=-2035/7, 4-20=-3/267, 4-19=-1106/48, 5-19=0/405, 5-17=-1179/105, 6-17=0/381, 7-17=-1510/70, 15-17=-67/3068, 7-15=-77/2834, 9-15=-1260/73, 9-14=-1667/74, 10-14=-387/81, 11-14=-55/2804, 11-13=-1502/85

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 72 lb uplift at joint 2 and 43 lb uplift at joint 13.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 46 lb down and 19 lb up at 1-6-4 on top chord, and at 1-6-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).



December 18,2020

LOAD CASE(S) Standard

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek®

16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0
210285	E6	Roof Special Girder	1	1	I44063936
Job Reference (optional)					

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:41 2020 Page 2
ID:GTYmqTGpwjBwEikz5tITZ8zVUQ7-_pTwzBw76sHZcKJzvuFc5Xq_HyEhCoEtF?vgAyy7nq0

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-70, 3-4=-70, 4-6=-70, 6-7=-70, 7-9=-70, 9-11=-70, 11-12=-70, 2-16=-20, 13-15=-20

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063937
210285	E7	Roof Special	1	1		


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:42 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-S01IBXlt9PQEuu9TbmrldNEiMYnxFA1UffEiOy7nq?

-0-10-8	8-1-13	17-0-12	20-0-0	20-4-4	24-7-8	28-10-12	30-7-6
0-10-8	8-1-13	8-10-15	2-11-4	0-4-4	4-3-4	4-3-4	1-8-10

Scale = 1:55.4

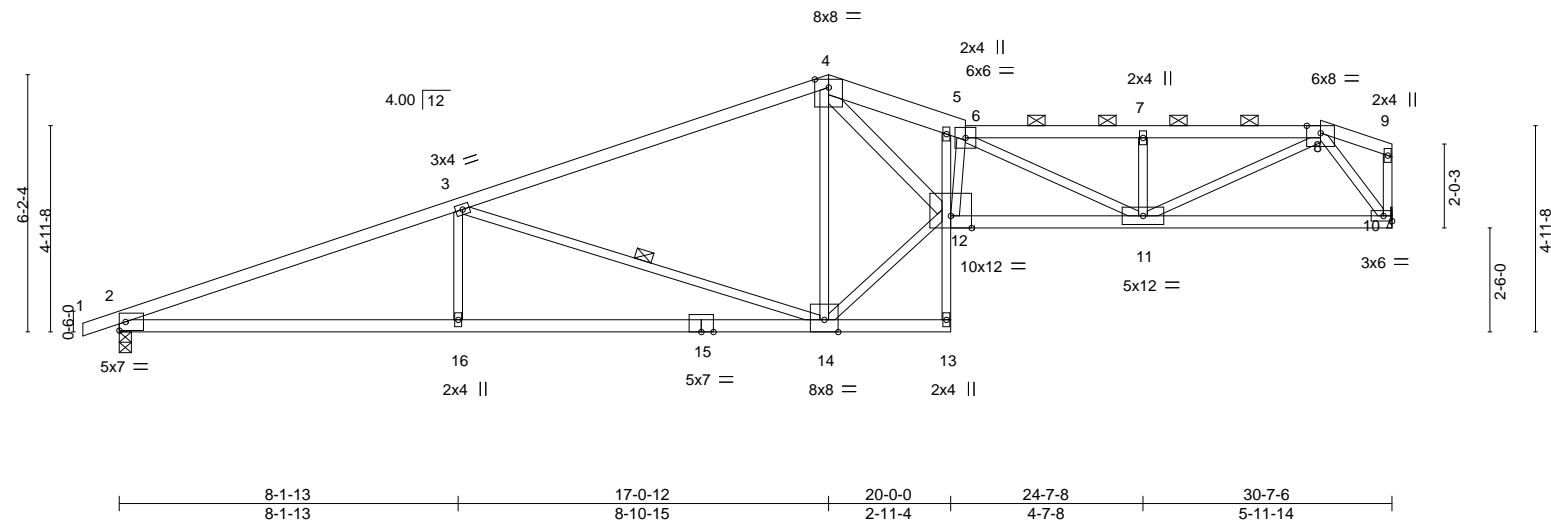

LOADING (psf)	SPACING-	2-0-0	CSL	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	-0.29	13	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.99	Vert(CT)	-0.57	14-16	>642	240	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.99	Horz(CT)	0.17	10	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.15	13	>999	240	
									Weight: 114 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
1-4: 2x4 SPF 2100F 1.8E, 4-6: 2x6 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
5-13: 2x3 SPF No.2, 10-12: 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except*
4-12: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-4-10 oc purlins, except end verticals, and 2-0-0 oc purlins (2-11-6 max.): 6-8.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 1 Row at midpt 3-14

REACTIONS.


(size) 10=Mechanical, 2=0-3-8
Max Horz 2=113(LC 8)
Max Uplift 10=39(LC 5), 2=64(LC 4)
Max Grav 10=1365(LC 1), 2=1439(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3235/77, 3-4=-2019/50, 4-5=-4161/99, 5-6=-4328/88, 6-7=-3049/69, 7-8=-3051/71
BOT CHORD 2-16=-119/2966, 14-16=-119/2966, 5-12=-34/365, 11-12=-97/4230, 10-11=-53/941
WEBS 3-16=0/370, 3-14=-1240/124, 4-14=-1006/105, 12-14=-25/2369, 4-12=-93/3249, 6-12=-1301/72, 6-11=-1325/56, 7-11=-384/81, 8-11=-29/2378, 8-10=-1556/82

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 39 lb uplift at joint 10 and 64 lb uplift at joint 2.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063938
210285	E8	Roof Special	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:43 2020 Page 1

ID:GTymqTGpwjwEikz5tITZ8zVUQ7-wCbgQtyNeTXHsdTM1J4AyyvPTlu0giPAiJOnEqy7nq_

-0-10-8	8-1-13	17-0-12	20-0-0	22-4-4	26-4-9	30-7-6
0-10-8	8-1-13	8-10-15	2-11-4	2-4-4	4-0-5	4-2-13

Scale = 1:55.6

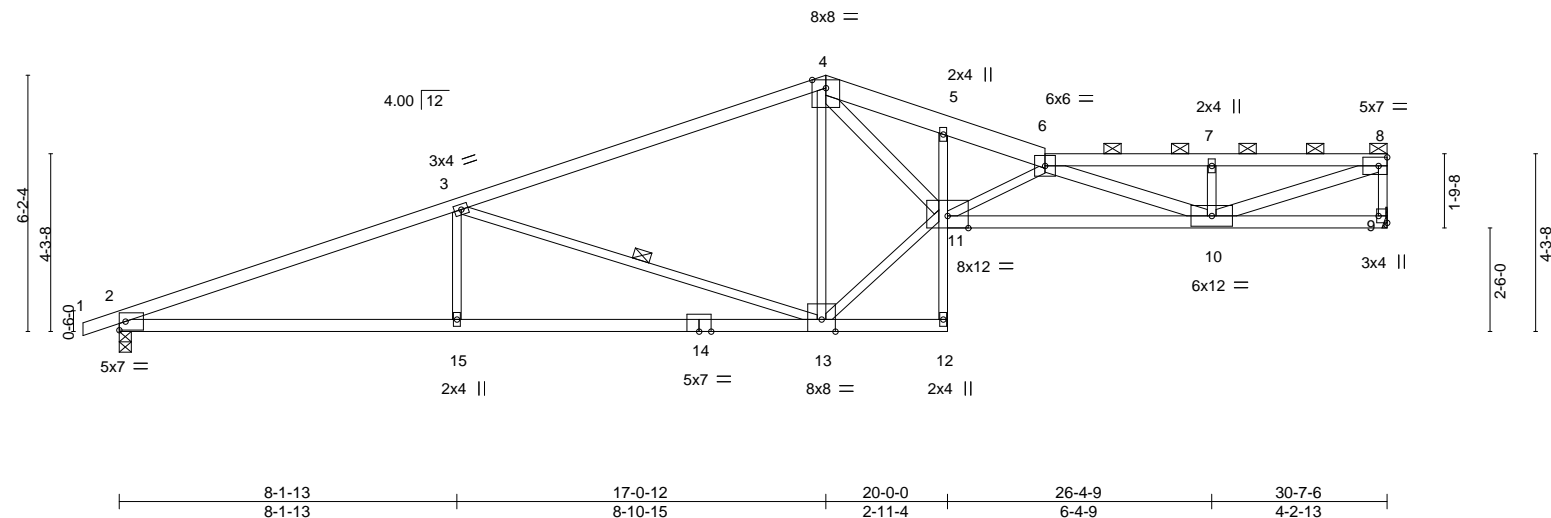


Plate Offsets (X,Y)-- [9:Edge,0-2-8]		8-1-13 8-1-13		17-0-12 8-10-15		20-0-0 2-11-4		26-4-9 6-4-9		30-7-6 4-2-13	
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP		
TCLL 25.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	-0.35	12	>999	MT20	197/144		
TCDL 10.0	Lumber DOL	1.15	BC 0.99	Vert(CT)	-0.64	13-15	>568				
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.99	Horz(CT)	0.19	9	n/a				
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.18	12	>999				
								Weight: 115 lb	FT = 10%		

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E *Except*
4-6: 2x6 SPF No.2, 6-8: 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
5-12: 2x3 SPF No.2, 9-11: 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except*
4-11,6-10,8-10: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-4-9 oc purlins, except end verticals, and 2-0-0 oc purlins (2-9-13 max.): 6-8.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 1 Row at midpt 3-13

REACTIONS.


(size) 9=Mechanical, 2=0-3-8
Max Horz 2=112(LC 8)
Max Uplift 9=38(LC 5), 2=66(LC 4)
Max Grav 9=1365(LC 1), 2=1439(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3235/82, 3-4=-2019/55, 4-5=-4109/97, 5-6=-4191/69, 6-7=-3291/61, 7-8=-3290/60, 8-9=-1311/52
BOT CHORD 2-15=-124/2966, 13-15=-124/2966, 10-11=-143/5284
WEBS 3-15=0/370, 3-13=-1239/124, 4-13=-1012/98, 11-13=-13/2379, 4-11=-84/3189, 6-11=-1594/89, 6-10=-2131/79, 7-10=-329/78, 8-10=-69/3435

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 38 lb uplift at joint 9 and 66 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

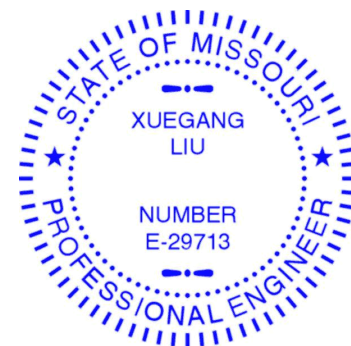

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063939
210285	E9	Roof Special	1	1		


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:44 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-0082bDz?Pnf8Tn2Yb0pJiASaC9EEP9fKxz8KmHy7npz

-0-10-8	8-1-13	17-0-12	20-0-0	24-4-4	30-7-6
0-10-8	8-1-13	8-10-15	2-11-4	4-4-4	6-3-2

Scale = 1:55.3

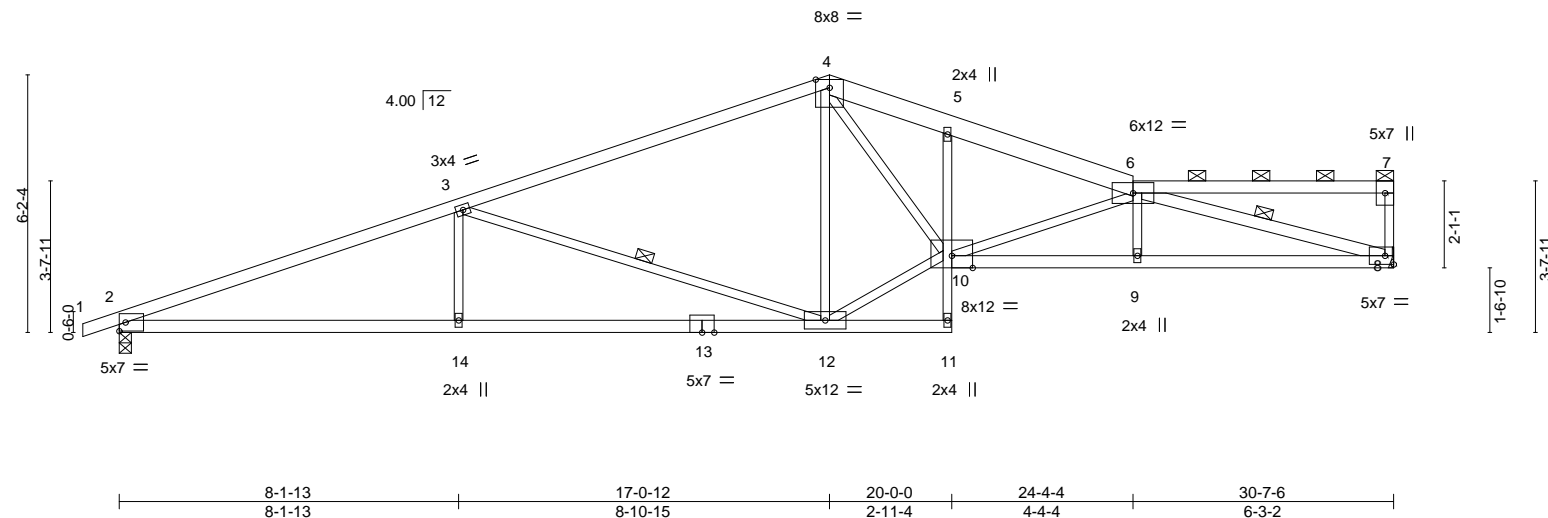

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	-0.26 9-10	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.99	Vert(CT)	-0.53 12-14	>694	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.99	Horz(CT)	0.16 8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.18 9-10	>999	240		
								Weight: 115 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E *Except*
4-6: 2x6 SPF No.2, 6-7: 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
5-11: 2x3 SPF No.2, 8-10: 2x4 SPF 2100F 1.8E
WEBS 2x3 SPF No.2 *Except*
6-8: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-4-9 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.
WEBS 1 Row at midpt 3-12, 6-8

REACTIONS.

(size) 8=Mechanical, 2=0-3-8
Max Horz 2=148(LC 8)
Max Uplift 8=-197(LC 5), 2=-248(LC 4)
Max Grav 8=1365(LC 1), 2=1439(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3234/463, 3-4=-2019/282, 4-5=-2986/429, 5-6=-3054/388
BOT CHORD 2-14=-497/2966, 12-14=-497/2966, 9-10=-511/3736, 8-9=-506/3741
WEBS 3-14=0/370, 3-12=-1239/320, 4-12=-418/153, 10-12=-215/2030, 4-10=-295/1809, 6-10=-967/166, 6-8=-3795/490

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 197 lb uplift at joint 8 and 248 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063940
210285	G1	Roof Special	1	1	Job Reference (optional)	

Wheeler Lumber,
Waverly, KS - 66871,


8.430 s Nov 30 2020 MiTek Industries, Inc.
Fri Dec 18 08:19:45 2020
Page 1

ID:zOKCXWmhF9AfmeAvSznKRizeXr3-sbiQpZzdA4o?5xdk8jkYFN?jDZbO8c4TAdtuljy7npy

0-10-8
8-1-13
17-0-12
20-0-0
22-2-8
27-11-4
33-2-0
35-0-0

0-10-8
8-1-13
8-10-15
2-11-4
2-2-8
5-8-12
5-2-13
1-10-0

Scale = 1:58.4

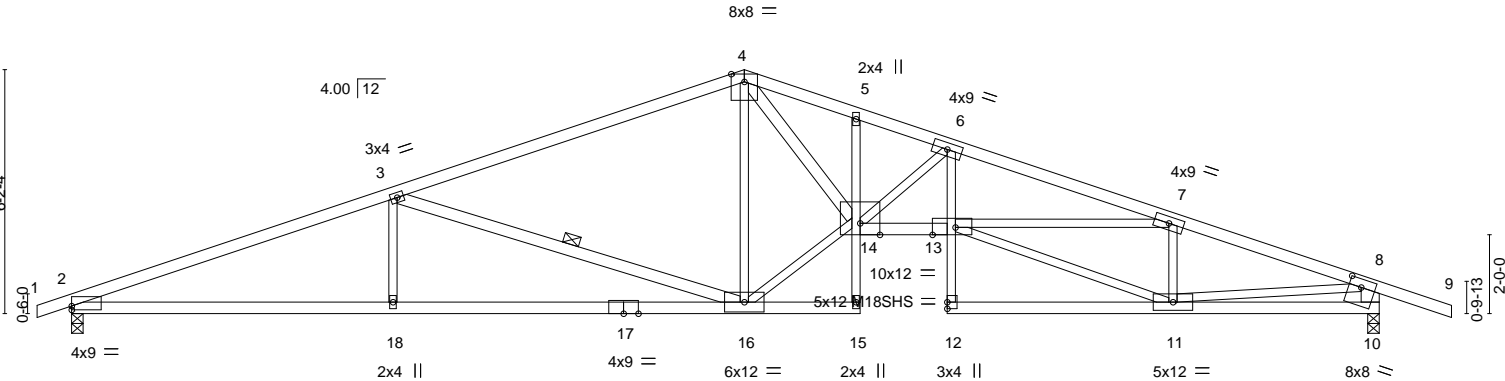

	8-1-13	17-0-12	20-0-0	22-2-8	27-11-4	33-2-0	
	8-1-13	8-10-15	2-11-4	2-2-8	5-8-12	5-2-13	
Plate Offsets (X,Y)--	[2:0-0-0,0-1-2], [10:0-3-12,0-2-8], [13:0-7-0,Edge]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.73	Vert(LL)	-0.41 13-14	>958	360
TCDL 10.0	Lumber DOL	1.15	BC 0.93	Vert(CT)	-0.74 13-14	>532	240
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.98	Horz(CT)	0.33 10	n/a	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.27 13-14	>999	240
						Weight: 130 lb	FT = 10%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF 2100F 1.8E	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF 2100F 1.8E *Except* 15-17,10-12: 2x4 SPF No.2, 5-15,6-12: 2x3 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 16-18 6-0-0 oc bracing: 14-15.
WEBS 2x3 SPF No.2 *Except* 3-16,4-14: 2x4 SPF No.2, 8-10: 2x6 SPF No.2	WEBS 1 Row at midpt 3-16
REACTIONS. (size) 10=0-3-8, 2=0-3-8	
Max Horz 2=97(LC 12)	
Max Uplift 10=302(LC 5), 2=262(LC 4)	
Max Grav 10=1623(LC 1), 2=1544(LC 1)	

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=3544/505, 3-4=2312/321, 4-5=4069/505, 5-6=4133/482, 6-7=5581/647, 7-8=2975/396, 8-10=1555/322
BOT CHORD 2-18=471/3256, 16-18=471/3256, 13-14=464/5243, 6-13=94/1331, 10-11=37/384
WEBS 3-18=0/375, 3-16=1261/325, 4-16=922/111, 14-16=197/2518, 4-14=299/3007, 6-14=1806/273, 11-13=322/2861, 7-13=219/2474, 7-11=1224/234, 8-11=322/2393

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 302 lb uplift at joint 10 and 262 lb uplift at joint 2.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063941
210285	G2	Common	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:47 2020 Page 1

ID:zOKCXWmhF9AfmeAvSznKRizeXr3-ozqBEF?uh2jKfM7G8M0Ko43UNFRcbymdxM_Nby7npw

0-10-8	8-1-13	17-0-12	24-11-3	33-2-0	35-0-0
0-10-8	8-1-13	8-10-15	7-10-7	8-2-13	1-10-0

Scale = 1:57.5

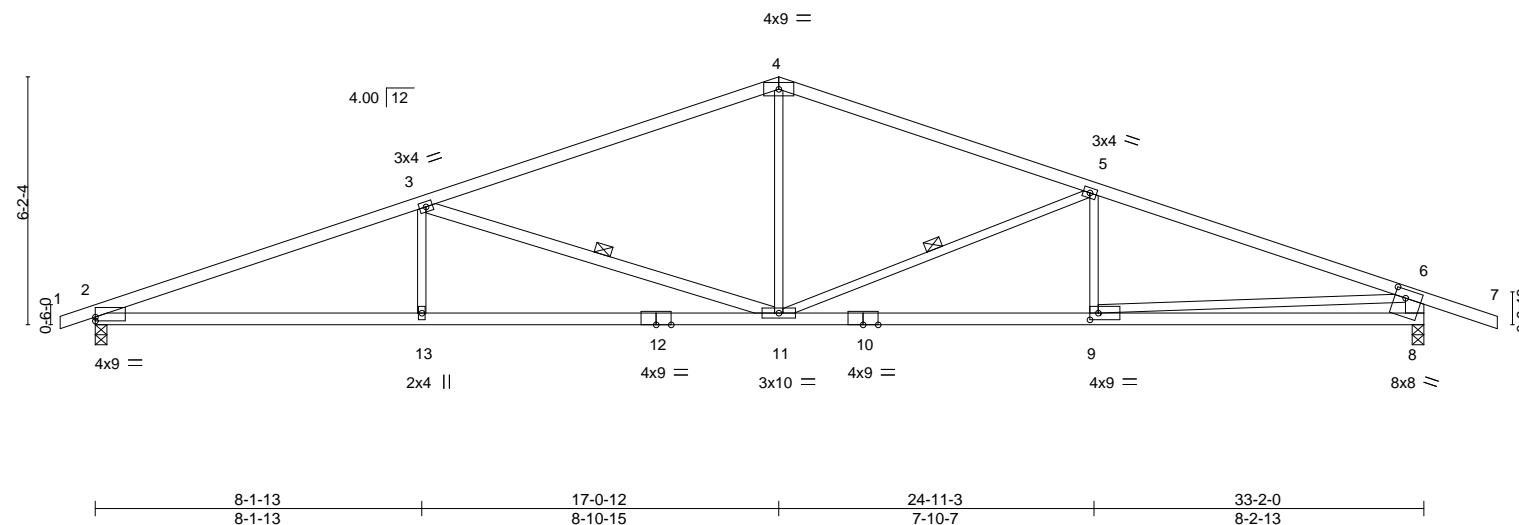


Plate Offsets (X,Y)--		[2:0-0-0,0-1-2], [8:0-3-4,0-2-8], [9:0-2-8,0-2-0]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 25.0	Plate Grip DOL 1.15	TC 0.75	in (loc) l/defl L/d
TCDL 10.0	Lumber DOL 1.15	BC 0.96	Vert(LL) -0.21 9-11 >999 360
BCLL 0.0 *	Rep Stress Incr YES	WB 0.70	Vert(CT) -0.44 11-13 >889 240
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S	Horz(CT) 0.11 8 n/a n/a
			Wind(LL) 0.15 13 >999 240
			PLATES MT20
			GRIP 197/144
			Weight: 114 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E
 BOT CHORD 2x4 SPF 2100F 1.8E *Except*
 10-12: 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except*
 3-11: 2x4 SPF No.2, 6-8: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
 2-2-0 oc bracing: 11-13.
 WEBS 1 Row at midpt 3-11, 5-11

REACTIONS.


(size) 2=0-3-8, 8=0-3-8
 Max Horz 2=97(LC 8)
 Max Uplift 2=262(LC 4), 8=302(LC 5)
 Max Grav 2=1544(LC 1), 8=1623(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=3539/506, 3-4=2319/320, 4-5=2302/337, 5-6=3064/417, 6-8=1533/344
 BOT CHORD 2-13=472/3251, 11-13=472/3251, 9-11=300/2817, 8-9=137/777
 WEBS 3-13=0/371, 3-11=1265/330, 4-11=24/853, 5-11=872/251, 6-9=213/2046

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 262 lb uplift at joint 2 and 302 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

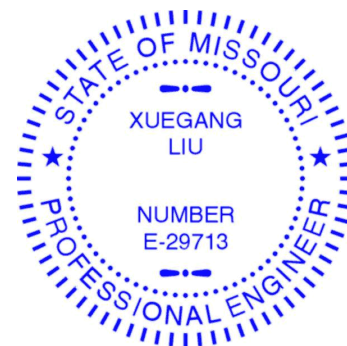

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063942
210285	G3	Common	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:48 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-G9OZR0WS?AZyPLJqstFt0dEHmciL01vsb6Yv2y7npv

0-10-8	8-1-13	17-0-12	24-11-3	32-10-8
0-10-8	8-1-13	8-10-15	7-10-7	7-11-6

Scale = 1:55.7

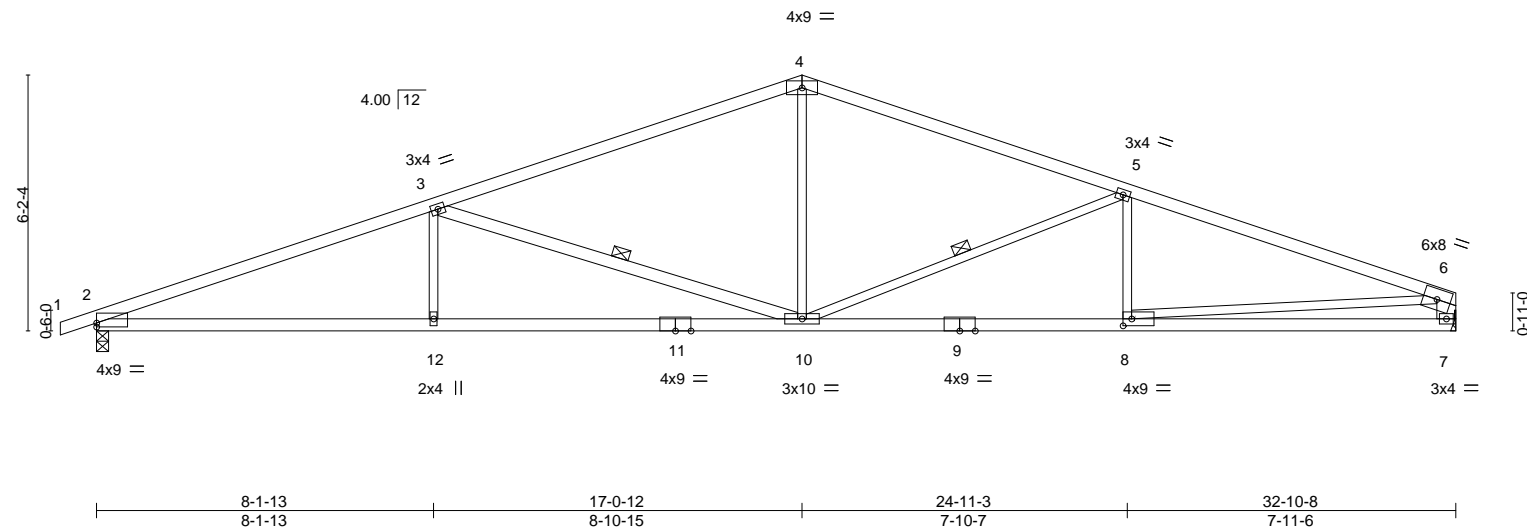


Plate Offsets (X,Y)-- [2:0-0-0,0-1-2], [8:0-2-8,0-2-0]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.74	Vert(LL)	-0.21 8-10	>999	360
TCDL 10.0	Lumber DOL	1.15	BC 0.96	Vert(CT)	-0.44 10-12	>887	240
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.78	Horz(CT)	0.11 7	n/a	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.11 12	>999	240
				PLATES	GRIP		
				MT20	197/144		
				Weight: 111 lb		FT = 10%	

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E
 BOT CHORD 2x4 SPF No.2 *Except*
 2-11: 2x4 SPF 2100F 1.8E
 WEBS 2x3 SPF No.2 *Except*
 3-10: 2x4 SPF No.2, 6-7: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
 2-2-0 oc bracing: 10-12.
 WEBS 1 Row at midpt 3-10, 5-10

REACTIONS.


(size) 2=0-3-8, 7=Mechanical
 Max Horz 2=65(LC 8)
 Max Uplift 2=-72(LC 4), 7=-36(LC 5)
 Max Grav 2=1535(LC 1), 7=1461(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-3515/100, 3-4=-2292/73, 4-5=-2277/80, 5-6=-2995/85, 6-7=-1377/78
 BOT CHORD 2-12=-86/3228, 10-12=-86/3228, 8-10=-41/2766, 7-8=-26/512
 WEBS 3-12=0/369, 3-10=-1265/131, 4-10=0/843, 5-10=-851/113, 6-8=-15/2263

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 72 lb uplift at joint 2 and 36 lb uplift at joint 7.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

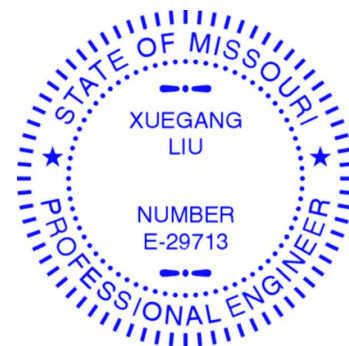

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063943
210285	G5	Roof Special	3	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:49 2020 Page 1

ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-IMyxfw18DJIQaYwWNZPUPD9R2A_O4TB35Fr5Ruy7npu

0-10-8	3-9-8	8-1-13	12-10-8	17-0-12	24-11-3	32-10-8
0-10-8	3-9-8	4-4-5	4-8-11	4-2-4	7-10-7	7-11-6

Scale = 1:55.2

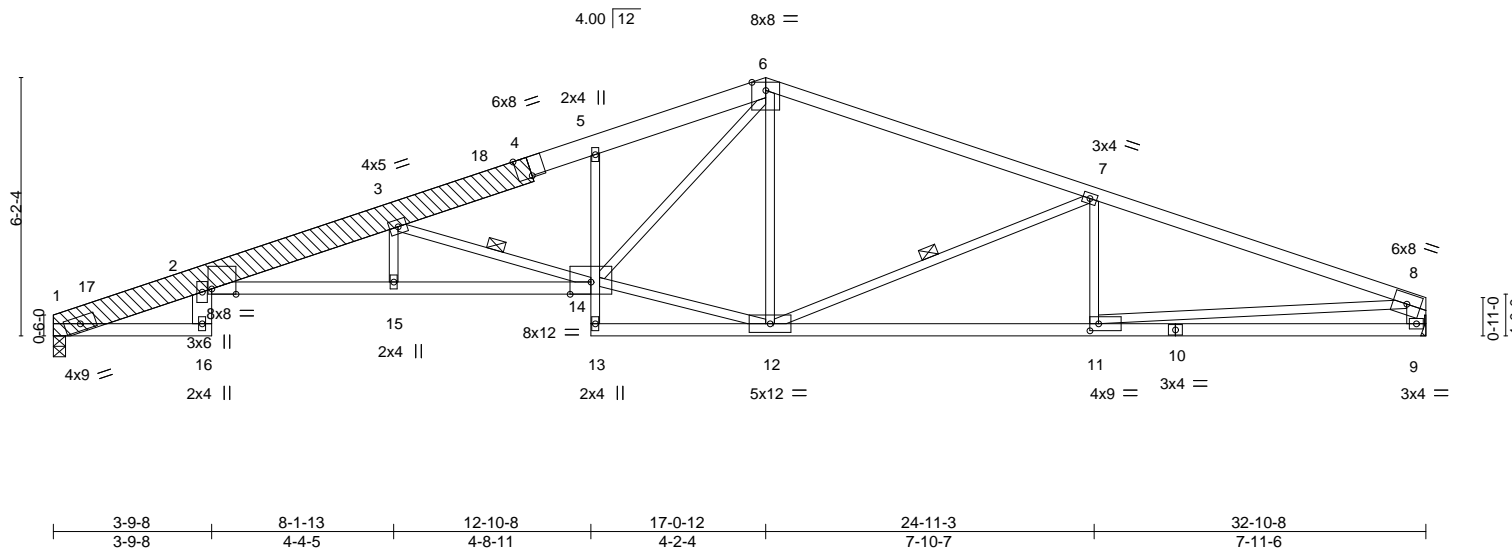


Plate Offsets (X,Y)--		[2:0-6-15,Edge], [4:0-4-0,Edge], [11:0-2-8,0-2-0]
LOADING (psf)	SPACING-	2-0-0
TCLL 25.0	Plate Grip DOL	1.15
TCDL 10.0	Lumber DOL	1.15
BCLL 0.0 *	Rep Stress Incr	YES
BCDL 10.0	Code IRC2018/TPI2014	
CSI.	DEFL.	in (loc) l/defl L/d
TC 0.62	Vert(LL)	-0.44 14-15 >895 360
BC 0.80	Vert(CT)	-0.79 14-15 >495 240
WB 0.78	Horz(CT)	0.34 9 n/a n/a
Matrix-S	Wind(LL)	0.23 14-15 >999 240
PLATES	GRIP	
MT20	197/144	
Weight: 180 lb		FT = 10%


LUMBER-
TOP CHORD 2x6 SPF No.2 *Except*
6-8: 2x4 SPF 2100F 1.8E, 1-4: 2x8 SP DSS
BOT CHORD 2x4 SPF No.2 *Except*
2-14: 2x4 SPF 2100F 1.8E, 5-13: 2x3 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-16,8-9: 2x6 SPF No.2
OTHERS 2x8 SP DSS
LBR SCAB 1-4 2x8 SP DSS one side

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-8-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 3-14, 7-12

REACTIONS. (size) 1=0-3-8, 9=Mechanical
Max Horz 1=63(LC 8)
Max Uplift 1=41(LC 4), 9=36(LC 5)
Max Grav 1=1463(LC 1), 9=1463(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=478/37, 2-3=4872/134, 3-5=3522/100, 5-6=3496/143, 6-7=2286/82,
7-8=3004/83, 8-9=1380/77
BOT CHORD 2-15=120/4843, 14-15=118/4836, 5-14=356/86, 11-12=40/2775, 9-11=28/505
WEBS 3-14=1628/97, 12-14=0/2048, 6-14=90/1862, 7-12=831/105, 8-11=12/2279

- NOTES-**
- Attached 12-1-2 scab 1 to 4, front face(s) 2x8 SP DSS with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 9-10-14 from end at joint 4, nail 2 row(s) at 2" o.c. for 2-0-0; starting at 7-3-6 from end at joint 4, nail 2 row(s) at 4" o.c. for 2-0-0; starting at 2-5-5 from end at joint 4, nail 2 row(s) at 7" o.c. for 2-0-0.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Refer to girder(s) for truss to truss connections.
 - Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 41 lb uplift at joint 1 and 36 lb uplift at joint 9.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063944
210285	G6	Hip	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:50 2020 Page 1

ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-DYWJsG1m_dQHBIvixHwjyRicmaLTptbCjvbfzwy7npt

Job Reference (optional)

-0-10-8	3-9-8	8-1-13	12-10-8	15-11-4	18-2-4	24-11-3	32-10-8
0-10-8	3-9-8	4-4-5	4-8-11	3-0-12	2-3-0	6-8-15	7-11-5

Scale = 1:58.3

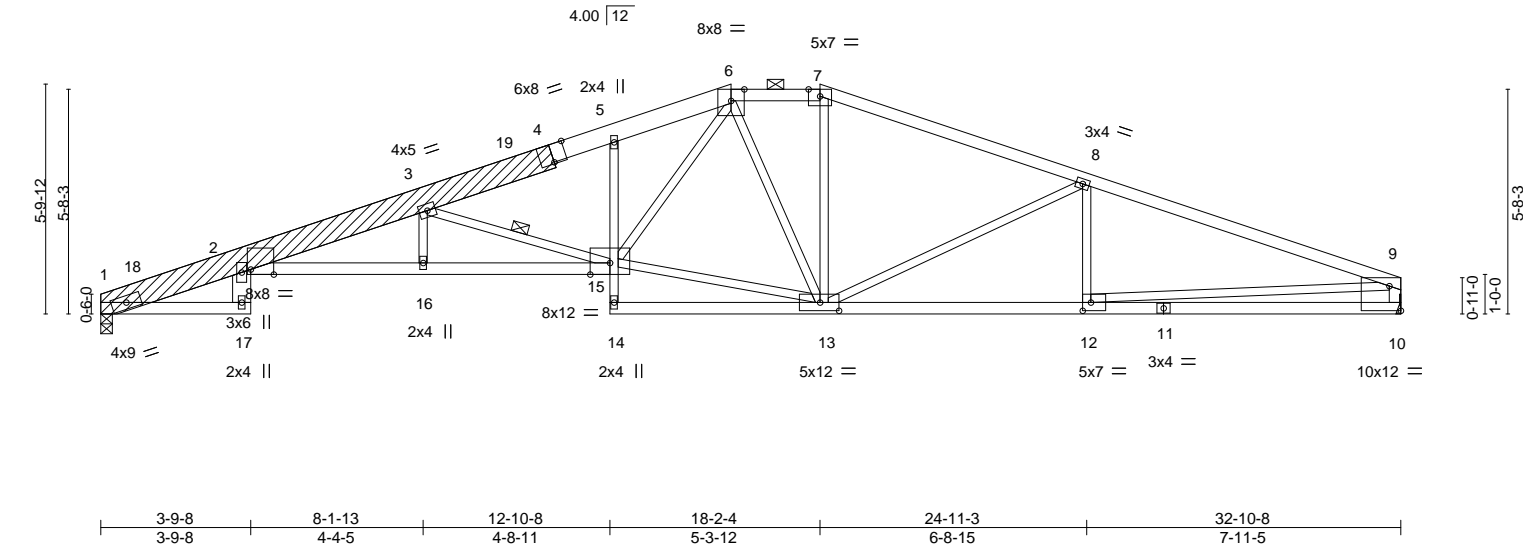


Plate Offsets (X,Y)--		[2:0-6-15,Edge], [4:0-4-0,Edge], [10:Edge,0-7-8], [12:0-2-8,0-2-8], [13:0-5-12,0-2-8]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 25.0	2-0-0	TC 0.62	in (loc) l/defl L/d
TCDL 10.0	Plate Grip DOL 1.15	BC 0.75	Vert(LL) -0.44 15-16 >896 360
BCLL 0.0 *	Lumber DOL 1.15	WB 0.96	Vert(CT) -0.79 15-16 >494 240
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.34 10 n/a n/a
	Code IRC2018/TPI2014		Wind(LL) 0.23 15-16 >999 240
		PLATES MT20	
		GRIP 197/144	
		Weight: 182 lb FT = 10%	

LUMBER-

TOP CHORD 2x6 SPF No.2 *Except*
6-7: 2x4 SPF No.2, 7-9: 2x4 SPF 2100F 1.8E, 1-4: 2x8 SP DSS

BOT CHORD 2x4 SPF No.2 *Except*
2-15: 2x4 SPF 2100F 1.8E, 5-14: 2x3 SPF No.2

WEBS 2x3 SPF No.2 *Except*
2-17: 2x6 SPF No.2, 9-10: 2x4 SPF No.2

OTHERS 2x8 SP DSS

LBR SCAB 1-4 2x8 SP DSS one side

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-7-11 oc purlins, except end verticals, and 2-0-0 oc purlins (3-9-10 max.): 6-7.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

WEBS 1 Row at midpt 3-15

REACTIONS.

(size) 1=0-3-8, 10=Mechanical
Max Horz 1=58(LC 10)
Max Uplift 1=45(LC 4), 10=41(LC 5)
Max Grav 1=1466(LC 1), 10=1466(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=480/32, 2-3=4883/151, 3-5=3539/116, 5-6=3509/151, 6-7=2195/98,
7-8=2401/87, 8-9=3018/95, 9-10=1380/83

BOT CHORD 2-16=134/4853, 15-16=132/4847, 5-15=287/77, 12-13=50/2785, 10-12=30/537

WEBS 3-15=1618/100, 13-15=1/2302, 6-15=72/1635, 6-13=588/55, 7-13=0/433,
8-13=714/98, 9-12=20/2256

NOTES-

- Attached 12-1-2 scab 1 to 4, back face(s) 2x8 SP DSS with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c.except : starting at 0-1-8 from end at joint 1, nail 2 row(s) at 2" o.c. for 2-0-0; starting at 2-9-1 from end at joint 1, nail 2 row(s) at 4" o.c. for 2-0-0; starting at 7-7-2 from end at joint 1, nail 2 row(s) at 7" o.c. for 2-0-0.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 45 lb uplift at joint 1 and 41 lb uplift at joint 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063945
210285	G7	Hip	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:51 2020 Page 1

ID:GTymqTGpwjwEikz5tITZ8zVUQ7-hk4i3c2OlwY8ps4uV_RyVeFky_f8YJRMZYKWCWny7nps

0-10-8	3-9-8	6-8-10	12-10-8	13-11-4	20-2-4	27-11-3	33-1-8	35-0-0
0-10-8	3-9-8	2-11-2	6-1-14	1-0-12	6-3-0	7-8-15	5-2-5	1-10-8

Scale = 1:58.9

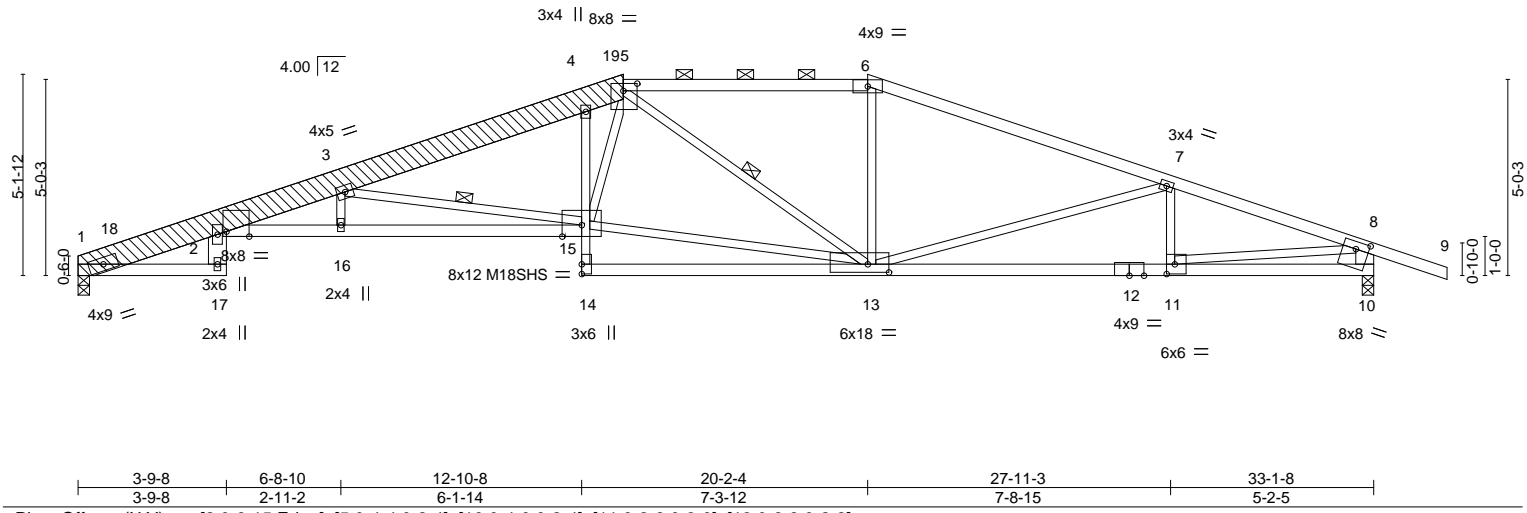


Plate Offsets (X,Y)--		[2:0-6-15,Edge], [5:0-4-4,0-2-4], [10:0-4-0,0-2-4], [11:0-2-8,0-3-0], [13:0-6-8,0-2-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL 1.15		TC	0.78	Vert(LL)	-0.47 15-16	>843	360	MT20	197/144
TCDL	10.0	Lumber DOL 1.15		BC	0.85	Vert(CT)	-0.87 15-16	>453	240	M18SHS	197/144
BCLL	0.0 *	Rep Stress Incr YES		WB	0.99	Horz(CT)	0.37 10	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.36 15-16	>999	240	Weight: 195 lb	FT = 10%

LUMBER-	BRACING-
TOP CHORD 2x8 SP DSS *Except*	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (2-9-7 max.): 5-6.
5-6: 2x4 SPF No.2, 6-9: 2x4 SPF 2100F 1.8E	BOT CHORD Rigid ceiling directly applied or 8-10-6 oc bracing.
BOT CHORD 2x4 SPF No.2 *Except*	WEBS 1 Row at midpt 3-15, 5-13
2-15: 2x4 SPF 2100F 1.8E, 4-14: 2x3 SPF No.2	
WEBS 2x3 SPF No.2 *Except*	
2-17,8-10: 2x6 SPF No.2	
OTHERS 2x8 SP DSS	
LBR SCAB 1-5 2x8 SP DSS one side	

REACTIONS.	(size) 1=0-3-8, 10=0-3-8
	Max Horz 1=75(LC 9)
	Max Uplift 1=238(LC 4), 10=325(LC 5)
	Max Grav 1=1469(LC 1), 10=1626(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-480/128, 2-3=-4979/792, 3-4=-3615/574, 4-5=-3609/629, 5-6=-2439/424, 6-7=-2652/409, 7-8=-3007/463, 8-10=-1561/342
BOT CHORD	2-16=-784/4990, 15-16=-780/4977, 4-15=-542/183, 11-13=-374/2802, 10-11=-6/272
WEBS	3-15=-1576/328, 13-15=-386/2882, 5-15=-228/1428, 5-13=-873/194, 6-13=0/408, 7-13=-454/210, 8-11=-434/2549

- NOTES-**
- Attached 14-10-3 scab 1 to 5, front face(s) 2x8 SP DSS with 2 row(s) of 10d (0.131"x3") nails spaced 9" o.c. except : starting at 0-1-8 from end at joint 1, nail 2 row(s) at 2" o.c. for 2-0-0; starting at 2-9-1 from end at joint 1, nail 2 row(s) at 4" o.c. for 2-0-0; starting at 6-1-0 from end at joint 1, nail 2 row(s) at 7" o.c. for 2-0-0.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 238 lb uplift at joint 1 and 325 lb uplift at joint 10.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063946
210285	G8	HIP	1	1		


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:52 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-9xd4Hy30WEg?R0f43hyB1snvnOzTHo0VnD4i2py7npr

-0-10-8	6-2-6	11-11-4	17-0-12	22-2-4	27-11-2	33-1-8	35-0-0
0-10-8	6-2-6	5-8-14	5-1-8	5-1-8	5-8-15	5-2-6	1-10-8

Scale = 1:60.2

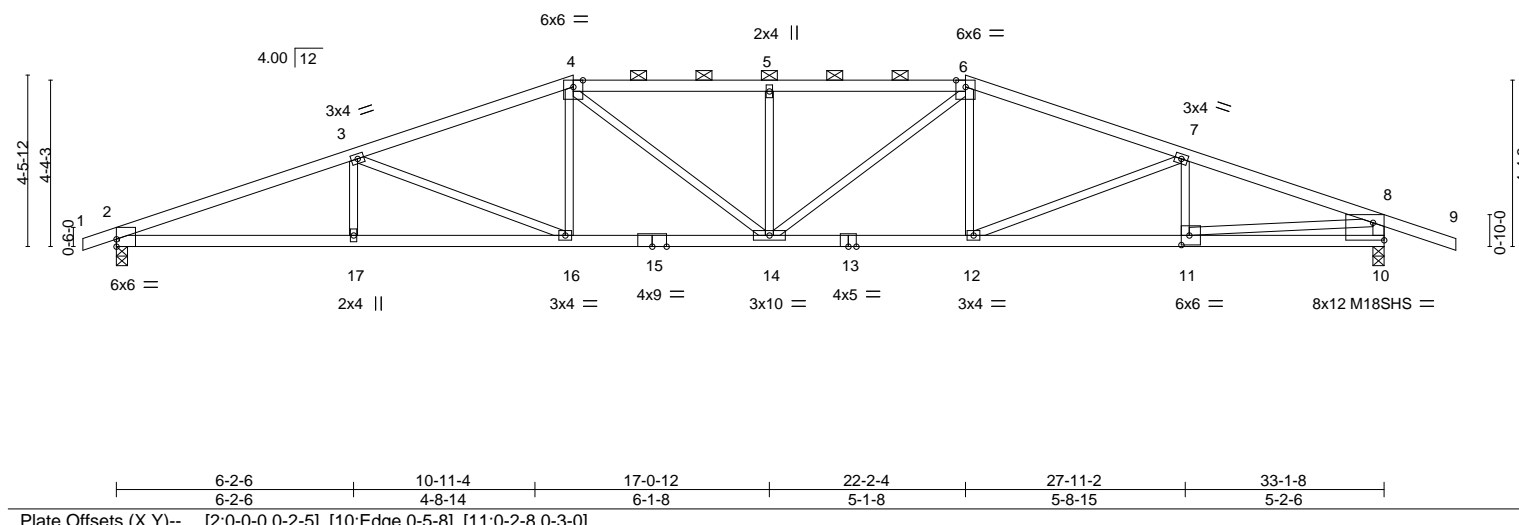

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.78	Vert(LL)	-0.27 14-16	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.97	Vert(CT)	-0.49 14-16	>806	240	M18SHS	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.84	Horz(CT)	0.14 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.20 14-16	>999	240		
								Weight: 117 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x3 SPF No.2 *Except*
 8-10: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (3-0-2 max.): 4-6.
 BOT CHORD Rigid ceiling directly applied or 2-2-0 oc bracing.

REACTIONS.


(size) 2=0-3-8, 10=0-3-8
 Max Horz 2=66(LC 12)
 Max Uplift 2=293(LC 4), 10=333(LC 5)
 Max Grav 2=1546(LC 1), 10=1622(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3590/599, 3-4=-2942/515, 4-5=-3012/538, 5-6=-3012/538, 6-7=-2812/475, 7-8=-2996/482, 8-10=-1550/354
 BOT CHORD 2-17=-547/3300, 16-17=-547/3300, 14-16=-388/2726, 12-14=-308/2612, 11-12=-387/2782, 10-11=-25/349
 WEBS 3-16=-630/202, 4-16=-12/368, 4-14=-121/538, 5-14=-460/175, 6-14=-145/659, 6-12=0/275, 8-11=-401/2449

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 293 lb uplift at joint 2 and 333 lb uplift at joint 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063947
210285	G9	HIP	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:52 2020 Page 1

ID:GTymqTGpwjwEikz5tTZ8zVUQ7-9xd4Hy30WEg?R0f43hyB1snxbO1vHsYVnD4l2py7npr

-0-10-8	5-1-10	9-11-4	17-0-12	24-2-4	28-11-13	33-1-8	35-0-0
0-10-8	5-1-10	4-9-10	7-1-8	7-1-8	4-9-9	4-1-11	1-10-8

Scale = 1:59.4

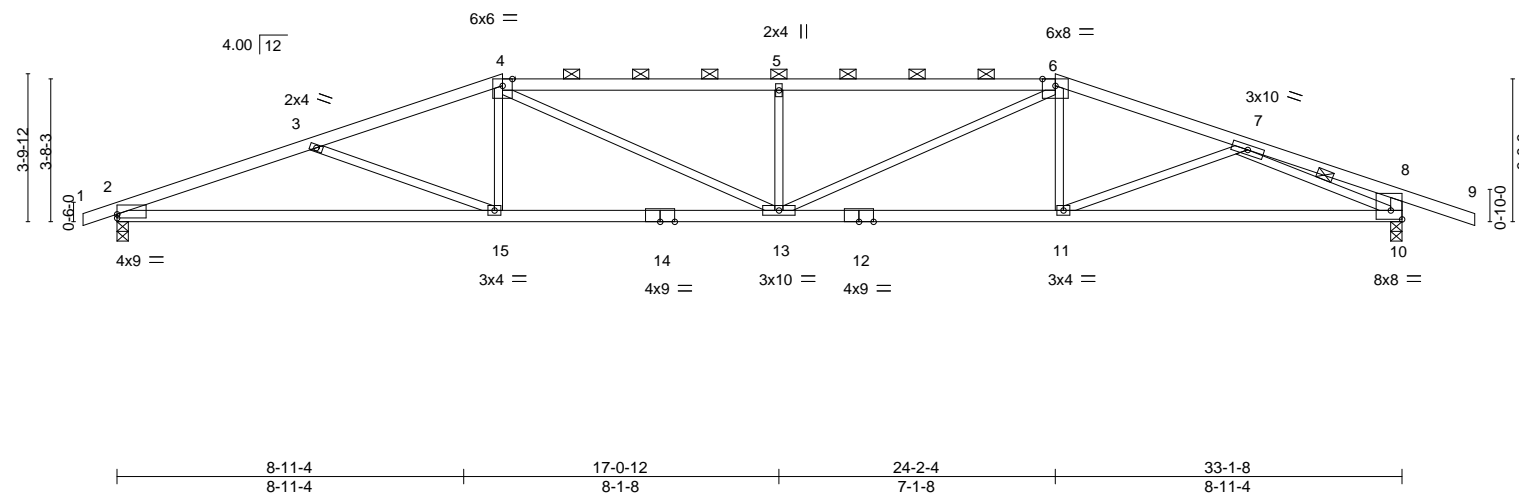


Plate Offsets (X,Y)-- [2:0-0-0,0-1-2], [10:Edge,0-2-12]		8-11-4 8-11-4		17-0-12 8-1-8		24-2-4 7-1-8		33-1-8 8-11-4	
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.66	Vert(LL)	-0.28	13	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.75	Vert(CT)	-0.52	2-15	>756		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.62	Horz(CT)	0.13	10	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.22	13	>999		
								Weight: 112 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
4-6: 2x4 SPF 2100F 1.8E
BOT CHORD 2x4 SPF 2100F 1.8E *Except*
12-14: 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
8-10: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-5 oc purlins, except end verticals, and 2-0-0 oc purlins (3-4-8 max.): 4-6.
BOT CHORD Rigid ceiling directly applied or 8-10-5 oc bracing.
WEBS 1 Row at midpt 7-10

REACTIONS.


(size) 2=0-3-8, 10=0-3-8
Max Horz 2=54(LC 12)
Max Uplift 2=302(LC 4), 10=343(LC 5)
Max Grav 2=1546(LC 1), 10=1622(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-3506/678, 3-4=-3209/554, 4-5=-3664/678, 5-6=-3664/678, 6-7=-2979/502, 7-8=-405/22, 8-10=-424/138
BOT CHORD 2-15=-618/3235, 13-15=-445/2995, 11-13=-361/2787, 10-11=-429/2595
WEBS 3-15=-263/234, 4-15=0/386, 4-13=-225/911, 5-13=-628/246, 6-13=-257/1105, 6-11=0/256, 7-11=0/411, 7-10=-2539/573

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 302 lb uplift at joint 2 and 343 lb uplift at joint 10.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

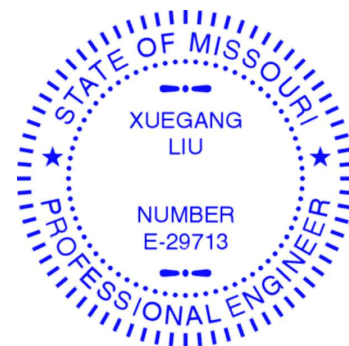

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Scale = 1:61.4

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0
210285	G10	Hip Girder	1	3	I44063948
					Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:47 2020 Page 2
ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-ozqBEF?uhi2jKFm7G8M0Ko434NNzcaemdxM_Nby7npw

NOTES-

12) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 119 lb down and 35 lb up at 6-11-4, 116 lb down and 35 lb up at 8-0-12, 116 lb down and 35 lb up at 10-0-12, 116 lb down and 35 lb up at 12-0-12, 116 lb down and 35 lb up at 14-0-12, and 116 lb down and 35 lb up at 16-0-12, and 116 lb down and 35 lb up at 18-0-12 on top chord, and 445 lb down and 133 lb up at 6-11-4, 99 lb down and 22 lb up at 7-0-0, 99 lb down and 22 lb up at 8-0-12, 99 lb down and 22 lb up at 10-0-12, 99 lb down and 22 lb up at 12-0-12, 99 lb down and 22 lb up at 14-0-12, 99 lb down and 22 lb up at 16-0-12, 99 lb down and 22 lb up at 18-0-12, 262 lb down and 39 lb up at 20-0-12, 262 lb down and 39 lb up at 22-0-12, and 262 lb down and 39 lb up at 24-0-12, and 701 lb down and 168 lb up at 25-1-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-70, 4-8=-70, 8-10=-70, 2-16=-20, 13-16=-20, 9-12=-20

Concentrated Loads (lb)

Vert: 15=-544(B=-445) 4=-95(B) 11=-701(B) 17=-95(B) 18=-95(B) 19=-95(B) 20=-95(B) 21=-95(B) 22=-95(B) 23=-99 24=-99 25=-99 26=-99 27=-99 28=-99 29=-262(B) 30=-262(B) 31=-262(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss H1	Truss Type Hip Girder	Qty 1	Ply 2	Lot 86 W0 Job Reference (optional)	I44063949
---------------	-------------	--------------------------	----------	----------	---------------------------------------	-----------

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:54 2020 Page 1
ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-5Jlqie4H2rwjgKpTA6_f6HtEoBjSliSoEXZs6hy7npp



Scale = 1:26.5

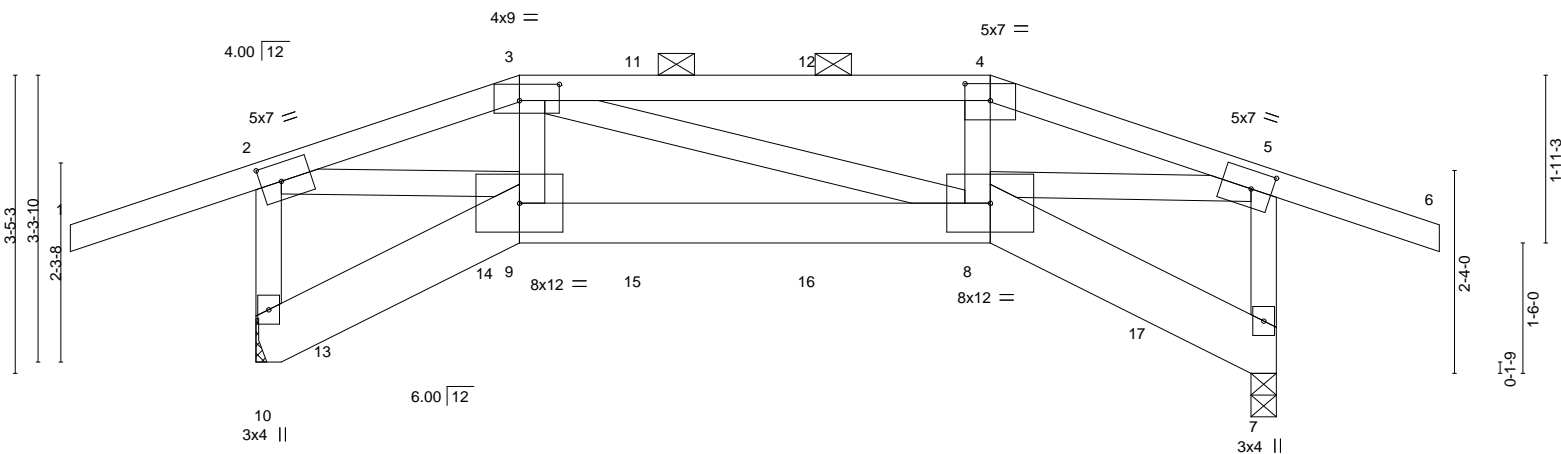


Plate Offsets (X,Y)--	[2:0-2-14,0-2-8], [3:0-5-8,0-2-4], [4:0-3-8,0-2-5], [5:0-2-14,0-2-8]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.87	Vert(LL)	-0.13	8-9	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.68	Vert(CT)	-0.23	8-9	>589	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.85	Horz(CT)	0.13	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.08	8-9	>999	240	Weight: 146 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x8 SP DSS *Except*
8-9: 2x6 SP 2400F 2.0E
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-4-10 oc purlins, except end verticals, and 2-0-0 oc purlins (3-8-8 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.


(size) 10=Mechanical, 7=0-3-8
Max Horz 10=53(LC 7)
Max Uplift 10=597(LC 4), 7=650(LC 5)
Max Grav 10=5106(LC 21), 7=4392(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-10=-3826/523, 2-3=-7224/845, 3-4=-7032/836, 4-5=-7260/862, 5-7=-3611/528
BOT CHORD 9-10=-523/716, 8-9=-771/6856, 7-8=-254/331
WEBS 2-9=-766/6895, 3-9=-48/1992, 4-8=-77/2074, 5-8=-788/6849

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-5-0 oc, 2x6 - 2 rows staggered at 0-8-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 597 lb uplift at joint 10 and 650 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18,2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

MiTek
16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063949
210285	H1	Hip Girder	1	2	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:54 2020 Page 2
ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-5Jlqie4H2rwjgKpTA6_f6HtEoBjSliSoEXZs6hy7npp

NOTES-

13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 174 lb down and 189 lb up at 3-0-6, 73 lb down and 55 lb up at 4-4-14, and 73 lb down and 55 lb up at 6-4-14, and 174 lb down and 189 lb up at 8-5-6 on top chord, and 1343 lb down and 68 lb up at 0-6-6, 1400 lb down and 70 lb up at 2-4-14, 89 lb down and 76 lb up at 3-0-6, 1390 lb down and 63 lb up at 4-4-14, 31 lb down and 24 lb up at 4-4-14, 1345 lb down and 59 lb up at 6-4-14, 31 lb down and 24 lb up at 6-4-14, 89 lb down and 76 lb up at 8-3-10, and 1345 lb down and 58 lb up at 8-3-10, and 1345 lb down and 217 lb up at 10-4-14 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 5-6=-70, 9-10=-20, 8-9=-20, 7-8=-20

Concentrated Loads (lb)

Vert: 3=28(F) 4=28(F) 9=-14(F) 8=-1359(F=-14, B=-1345) 11=-0(F) 12=-0(F) 13=-1343(B) 14=-1400(B) 15=-1398(F=-8, B=-1390) 16=-1353(F=-8, B=-1345) 17=-1345(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063950
210285	J1	Diagonal Hip Girder	2	1	Job Reference (optional)	


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:55 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-ZWJCv_5vp92alTNfkqVufUPU0b9MUMvxTBIQf8y7np0



Scale = 1:13.1

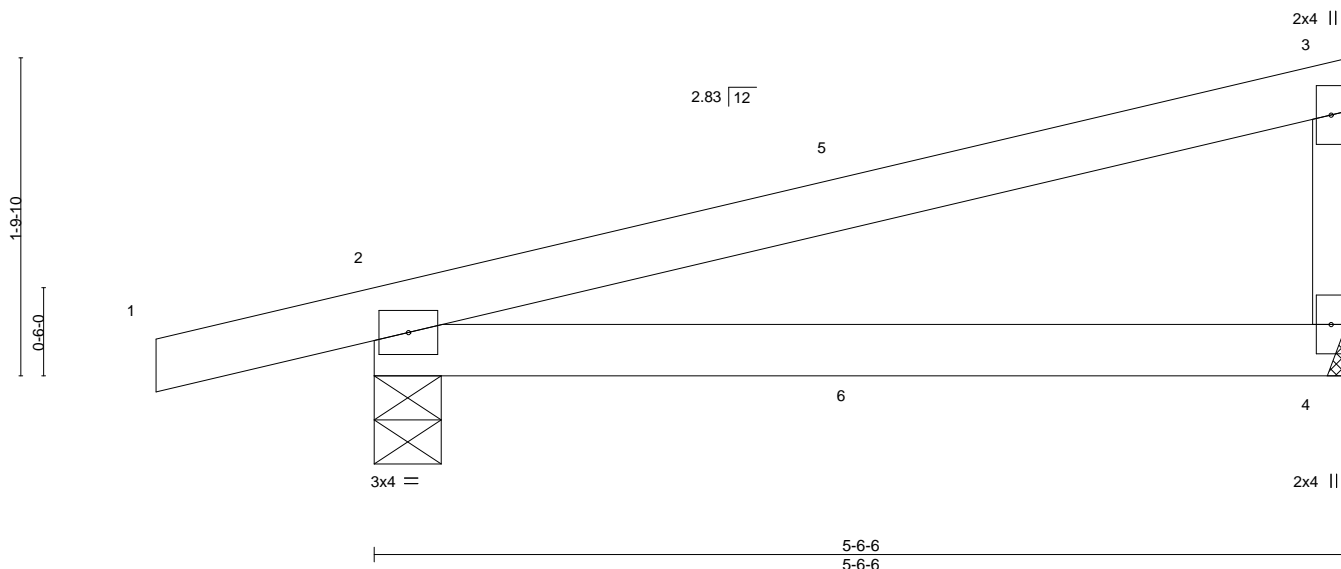

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.52	Vert(LL)	-0.05	2-4	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.32	Vert(CT)	-0.09	2-4	>696	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	240	Weight: 15 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-6-6 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 2=0-4-9
Max Horz 2=65(LC 5)
Max Uplift 4=44(LC 8), 2=109(LC 4)
Max Grav 4=222(LC 1), 2=349(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 44 lb uplift at joint 4 and 109 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 67 lb down and 34 lb up at 2-9-8, and 67 lb down and 34 lb up at 2-9-8 on top chord, and 2 lb down at 2-9-8, and 2 lb down at 2-9-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 2-4=-20



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss J2	Truss Type Jack-Open	Qty 4	Ply 1	Lot 86 W0	I44063951
---------------	-------------	-------------------------	----------	----------	-----------	-----------

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:01 2020 Page 1

ID:GTYmqTGpwjwEikz5tTZ8zVUQ7-OggTA1AgO?pj0Orp44clulfa40ETu4Oqr7mksny7npi

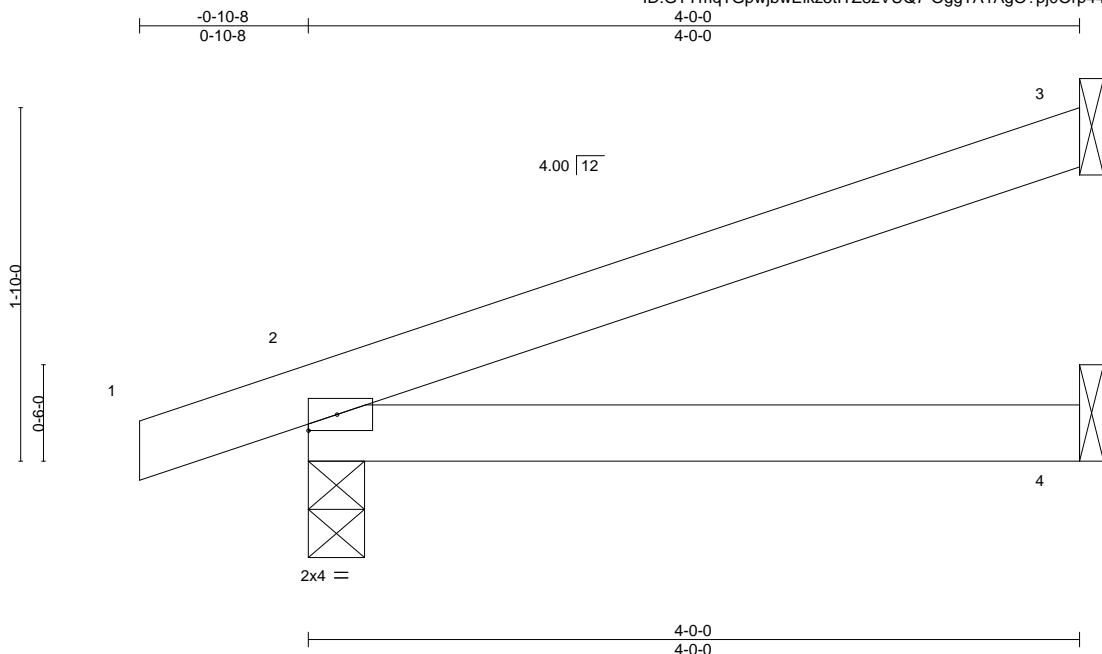

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.23	Vert(LL)	-0.01	2-4	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.14	Vert(CT)	-0.02	2-4	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	240		
									Weight: 11 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=67(LC 4)
Max Uplift 3=64(LC 8), 2=69(LC 4)
Max Grav 3=123(LC 1), 2=252(LC 1), 4=76(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 64 lb uplift at joint 3 and 69 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063952
210285	J3	Jack-Open	4	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:08 2020 Page 1
ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-h0b7eQF3I9hMT19?3ExhESq3qft1F7sSiycuy7npb

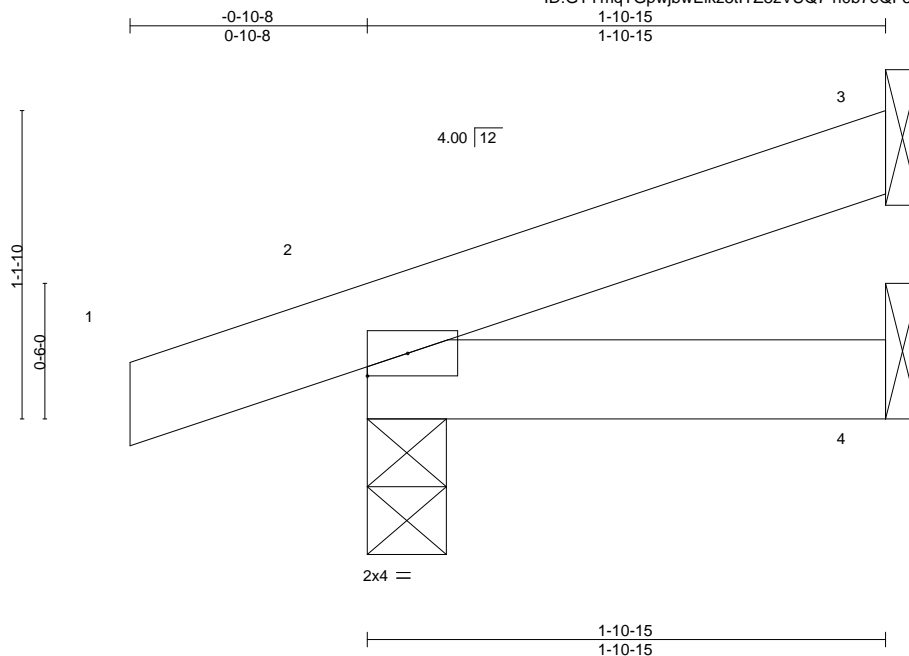

Scale = 1:8.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	-0.00	2	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	2-4	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	240	Weight: 6 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=39(LC 4)
Max Uplift 3=29(LC 8), 2=56(LC 4)
Max Grav 3=50(LC 1), 2=163(LC 1), 4=37(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 3 and 56 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063953
210285	J4	Jack-Closed Supported Gable	2	1		
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,


8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:15 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-_MWM6pLS5IZkhYvVv1sbTiE0hf2k9Pru3I9TM_y7npU

-0-4-8 1-6-0
0-4-8 1-6-0

5x7 =

Scale = 1:6.9

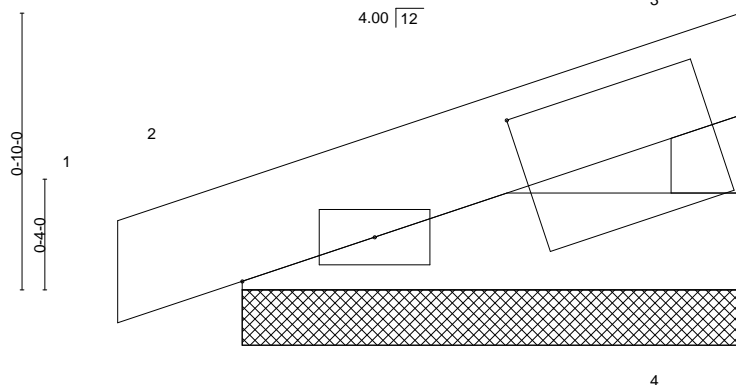

2x4 =

Plate Offsets (X,Y)--		[3:0-10-14,0-2-8]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0		Plate Grip DOL	1.15	TC 0.03		Vert(LL)	-0.00 1	n/r	120	MT20	197/144
TCDL 10.0		Lumber DOL	1.15	BC 0.02		Vert(CT)	0.00 1	n/r	120		
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.00		Horz(CT)	-0.00 4	n/a	n/a		
BCDL 10.0		Code IRC2018/TPI2014		Matrix-P						Weight: 4 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-6-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 4=1-6-0, 2=1-6-0
Max Horz 2=24(LC 5)
Max Uplift 4=12(LC 8), 2=28(LC 4)
Max Grav 4=59(LC 1), 2=93(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 2-0-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 12 lb uplift at joint 4 and 28 lb uplift at joint 2.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

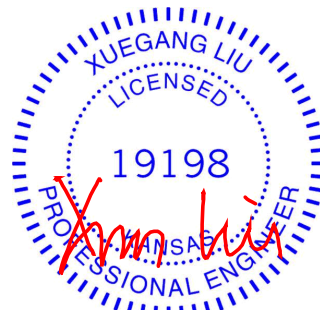

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

ID:GTYmqTGpwibwEikz5tITZ8zVUQ7-KJKf9XPawrC1oJoTiaSmAmxtSqlwqg5dDasE1By7npP



December 18, 2020




Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063955
210285	J6	Diagonal Hip Girder	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:20 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-KJKf9XPawrC1oJoTiaSmAmxqPglVqg5dDasE1By7npP

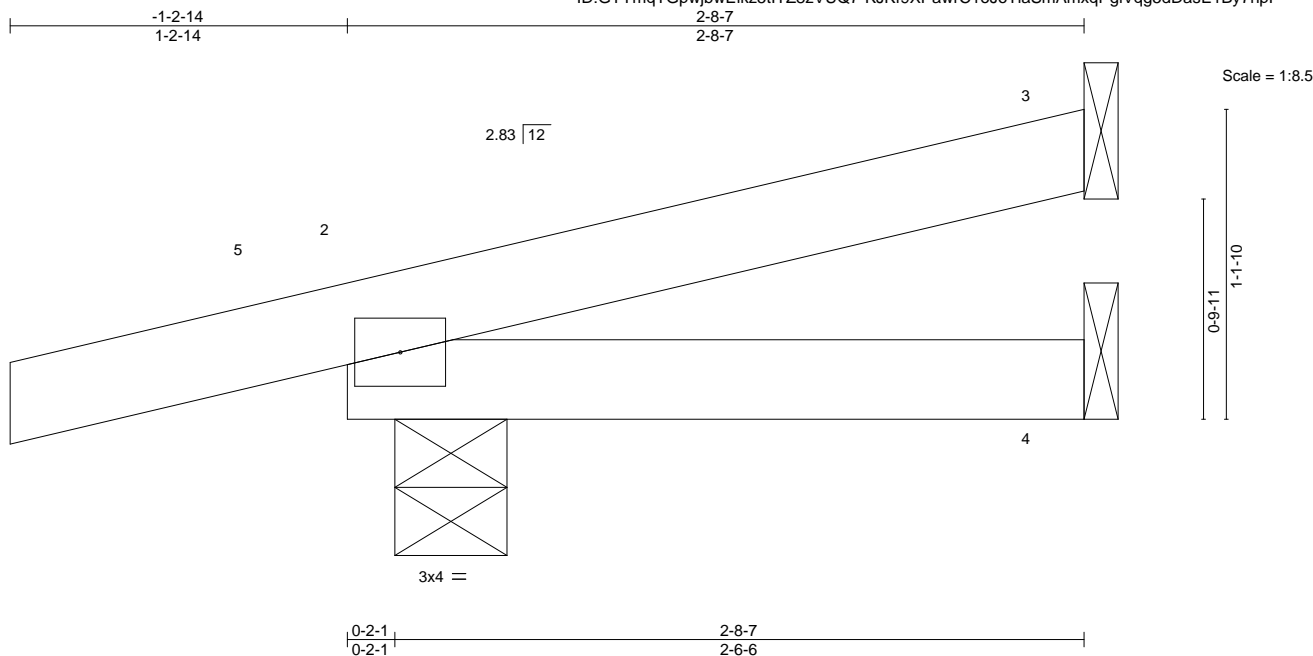

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	-0.00	2-4	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	2-4	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	240	Weight: 8 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-8-7 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-15, 4=Mechanical
Max Horz 2=45(LC 6)
Max Uplift 3=38(LC 6), 2=112(LC 6)
Max Grav 3=23(LC 1), 2=92(LC 1), 4=37(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 38 lb uplift at joint 3 and 112 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 18 lb down and 6 lb up at -1-2-14, and 18 lb down and 6 lb up at -1-2-14 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Concentrated Loads (lb)
Vert: 1=-29(F=-14, B=-14)
Trapezoidal Loads (plf)
Vert: 1=0(F=35, B=35)-to-5=-19(F=25, B=25), 5=0(F=35, B=35)-to-3=-49(F=10, B=10), 2=-2(F=9, B=9)-to-4=-14(F=3, B=3)



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063956
210285	J7	Jack-Open	3	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:21 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-pWu1MtPDh8KuPTNfHz?izU1U45sZ7KmREcoZdy7npO

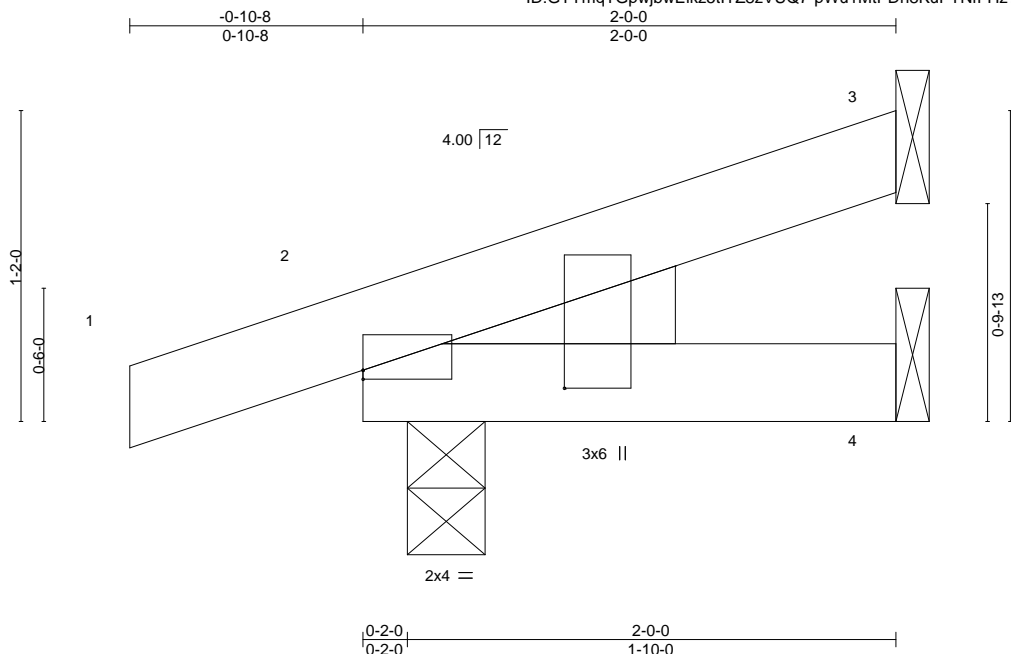

Scale = 1:8.6

Plate Offsets (X,Y)--	[2:0-0-0,0-0-6], [2:0-0-13,0-9-1]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	-0.00	2	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	2-4	>999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	Weight: 7 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEDGE
Left: 2x4 SPF No.2

BRACING-


TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 4=Mechanical, 2=0-3-8
Max Horz 2=40(LC 4)
Max Uplift 3=31(LC 8), 2=56(LC 4)
Max Grav 3=54(LC 1), 4=39(LC 3), 2=166(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 31 lb uplift at joint 3 and 56 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

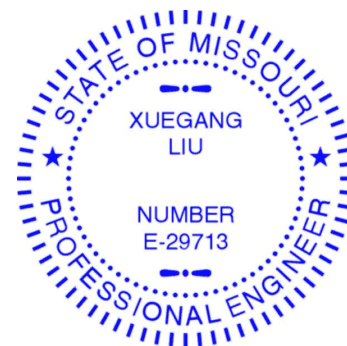

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063957
210285	J8	Diagonal Hip Girder	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,


8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:22 2020 Page 1

ID:GTymqTGpwjwEikz5tITZ8zVUQ7-HiRQaCQrSSS1dyrp?UEFB14kUOslaawguLL64y7npN

-2-7-13
2-7-13

5-6-6
5-6-6

Scale = 1:15.4

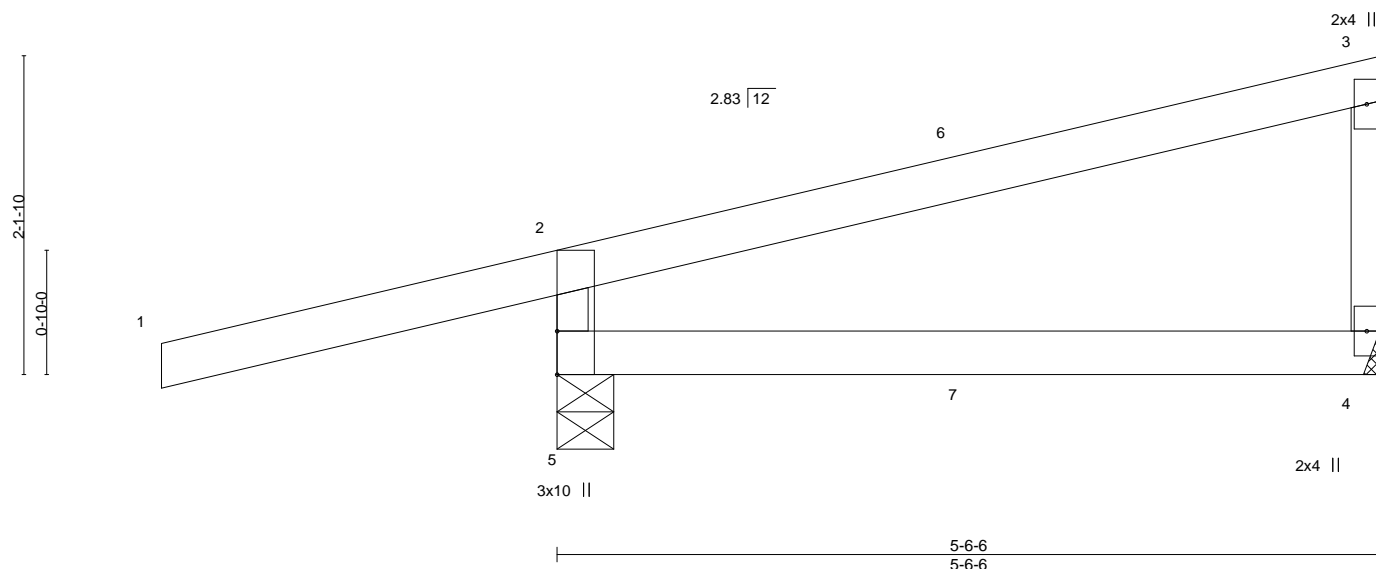

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.61	Vert(LL)	-0.03	4-5	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.24	Vert(CT)	-0.06	4-5	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	-0.01	4-5	>999	240	Weight: 17 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-6-6 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=0-4-9, 4=Mechanical
Max Horz 5=88(LC 7)
Max Uplift 5=186(LC 4), 4=34(LC 8)
Max Grav 5=475(LC 1), 4=182(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-427/216

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 186 lb uplift at joint 5 and 34 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 74 lb down and 15 lb up at 2-9-8, and 74 lb down and 15 lb up at 2-9-8 on top chord, and 6 lb down and 7 lb up at 2-9-8, and 6 lb down and 7 lb up at 2-9-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-3=-70, 4-5=-20
Concentrated Loads (lb)
Vert: 7=15(F=7, B=7)



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063958
210285	J9	Jack-Open	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:23 2020 Page 1

ID:GTymqTGpwjBwEikz5tTZ8zVUQ7-lu?onYRTDmacfnW2Ni0ToOZKvtn611q3vY5ueWy7npM

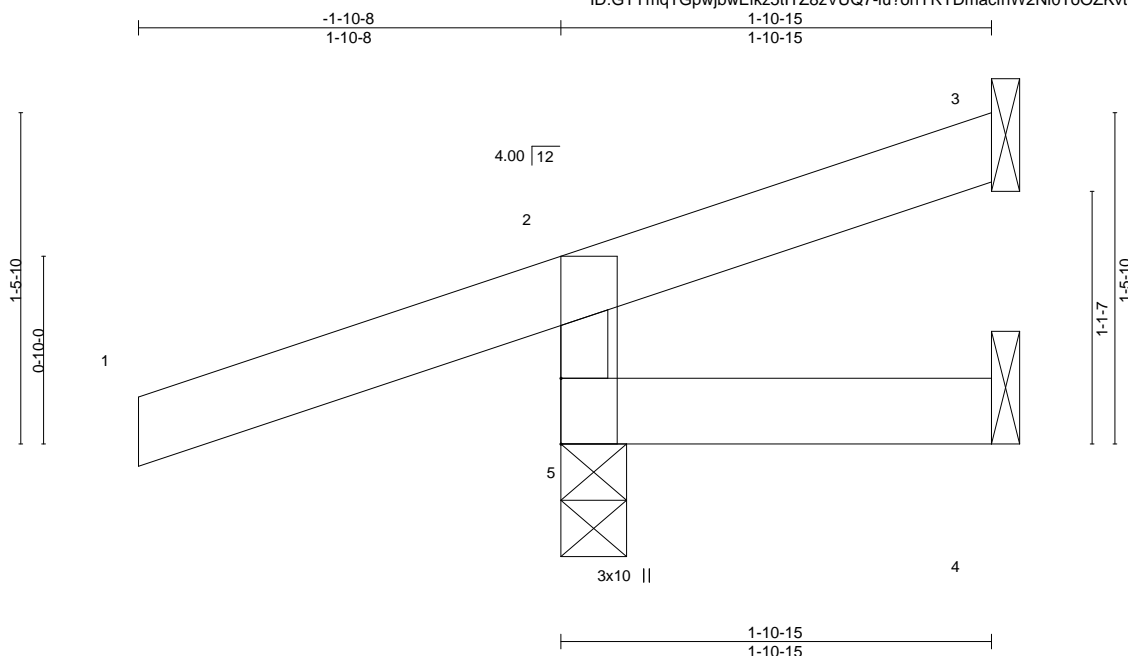

Scale = 1:10.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	0.00	5	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	5	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	-0.00	5	>999	240		
									Weight: 7 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=51(LC 4)
Max Uplift 5=130(LC 4), 3=12(LC 8)
Max Grav 5=296(LC 1), 3=4(LC 4), 4=30(LC 3)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-263/140

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 130 lb uplift at joint 5 and 12 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:55 2020 Page 1
ID:GTYmgTGpwibwEikz5tITZ8zVUQ7-ZWJCv 5vp92alTNfkqVufUPYzbCcUmvxTBIQf8v7npo

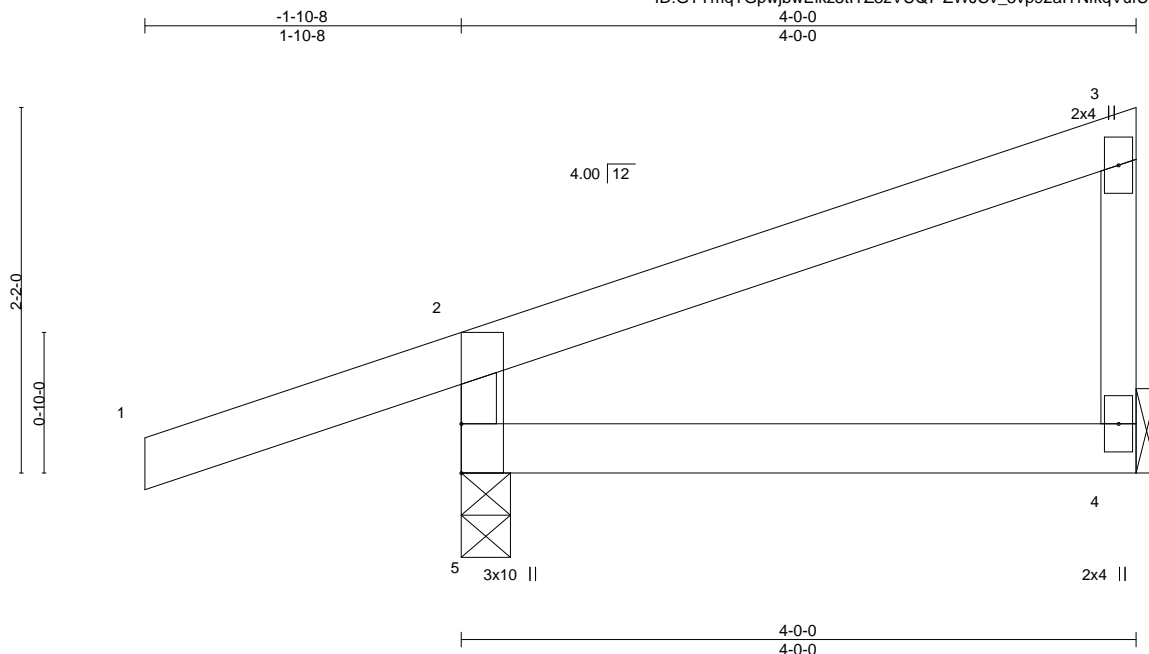

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.27	Vert(LL) -0.01 4-5 >999 360	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.11	Vert(CT) -0.02 4-5 >999 240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.00 4 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-R	Wind(LL) 0.00 4-5 >999 240	Weight: 13 lb	FT = 10%

LUMBER-

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 4=Mechanical
Max Horz 5=92(LC 5)
Max Uplift 5=-129(LC 4), 4=-28(LC 8)
Max Grav 5=345(LC 1), 4=134(LC 1)

FORCES.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-306/153

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 129 lb uplift at joint 5 and 28 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

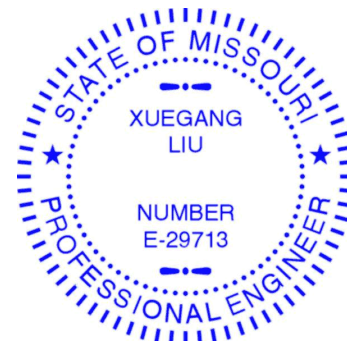

December 18, 2020

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063960
210285	J11	Jack-Closed	5	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:56 2020 Page 1
ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-1ttb7J6XaTARvdyslX17Ciyij?Z9Dp85ir2zBay7nnpn

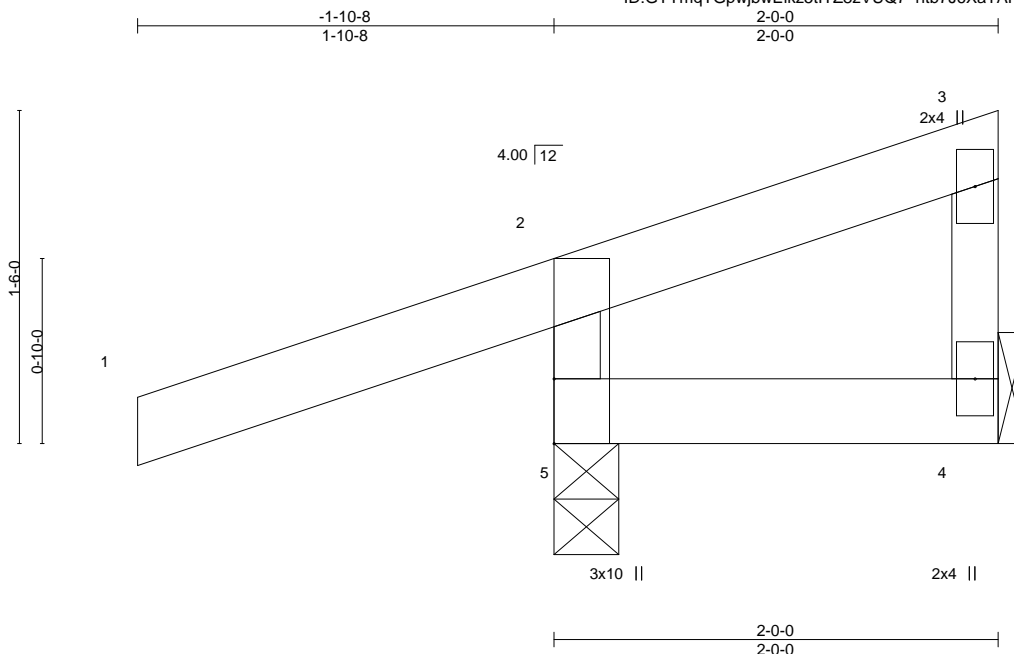

Scale = 1:10.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.00	5	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	5	>999	240	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.00	5	>999	240	
									Weight: 8 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 4=Mechanical
Max Horz 5=73(LC 7)
Max Uplift 5=139(LC 4), 4=-10(LC 5)
Max Grav 5=296(LC 1), 4=32(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-266/147

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 139 lb uplift at joint 5 and 10 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

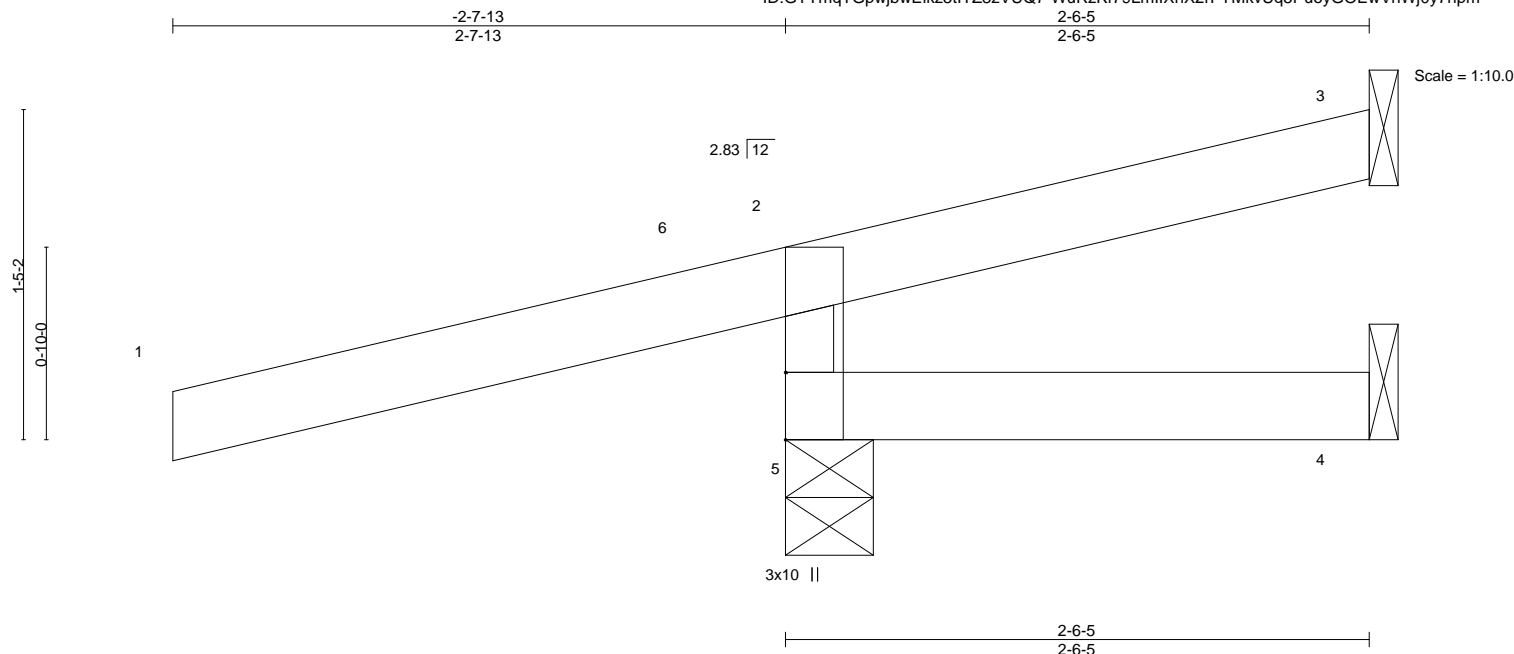

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.48	Vert(LL) 0.00 4-5 >999 360	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.13	Vert(CT) 0.00 4-5 >999 240		
BCLL 0.0 *	Rep Stress Incr NO	WB 0.00	Horz(CT) -0.01 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-R	Wind(LL) -0.00 4-5 >999 240	Weight: 9 lb	FT = 10%

LUMBER-

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 2-6-5 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=0-4-9, 3=Mechanical, 4=Mechanical
Max Horz 5=51(LC 7)
Max Uplift 5=-146(LC 4), 3=-42(LC 16), 4=-13(LC 1)
Max Grav 5=249(LC 1), 3=30(LC 4), 4=27(LC 3)

FORCES.



(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCdL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 146 lb uplift at joint 5, 42 lb uplift at joint 3 and 13 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 42 lb down and 15 lb up at -2-7-13, and 42 lb down and 15 lb up at -2-7-13 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Concentrated Loads (lb)
Vert: 1=-65(F=-33, B=-33)
Trapezoidal Loads (plf)
Vert: 1=-0(F=35, B=35)-to-6=-41(F=14, B=14), 6=0(F=35, B=35)-to-2=-7(F=31, B=31), 2=-7(F=31, B=31)-to-3=-50(F=10, B=10), 5=-2(F=9, B=9)-to-4=-14(F=3, B=3)

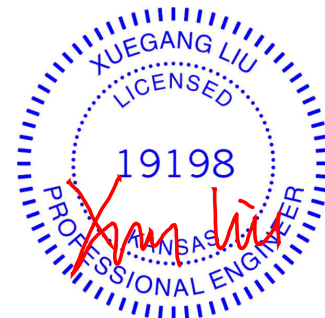

December 18, 2020

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063962
210285	J13	Jack-Open	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:57 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-WuRzKf79LmIIIXnX2rFYMKvUtSPv1yGOEwVnWj0y7npm

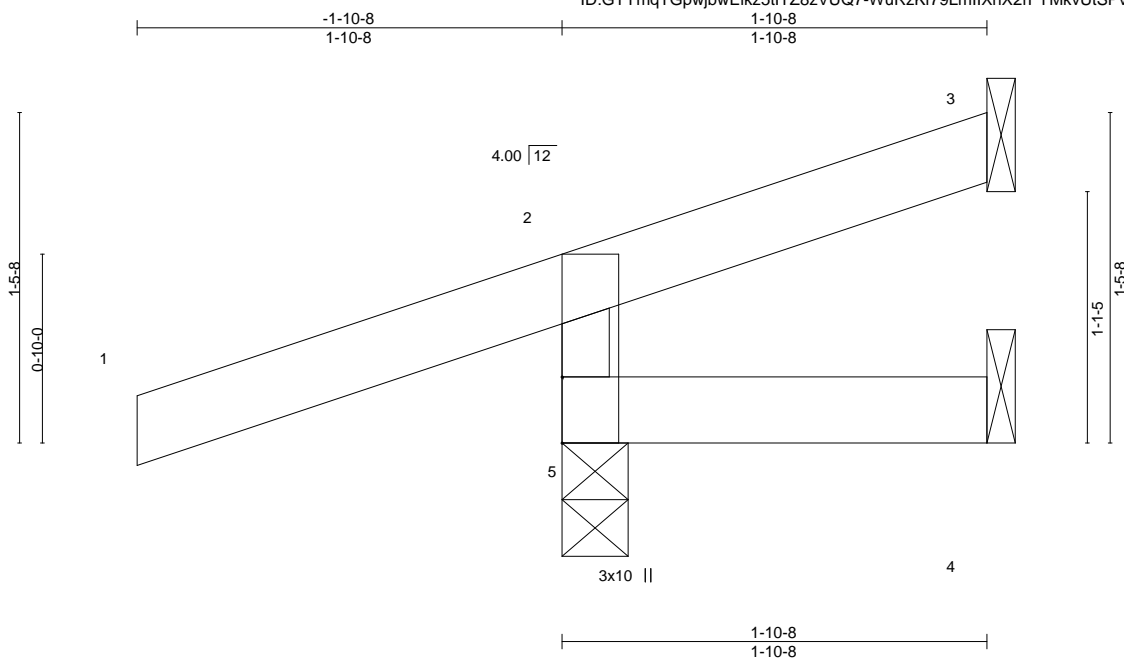

Scale = 1:10.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	0.00	5	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	5	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	-0.00	5	>999	240	Weight: 7 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-10-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=50(LC 4)
Max Uplift 5=131(LC 4), 3=11(LC 8)
Max Grav 5=296(LC 1), 3=6(LC 4), 4=29(LC 3)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-263/140

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 131 lb uplift at joint 5 and 11 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063963
210285	J14	Diagonal Hip Girder	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:58 2020 Page 1

ID:GTymqTGpwjwEikz5tTZ8zVUQ7-5?LX?8n64Q99x6EPy3bH71znoCLhjeO99X4FTy7npl

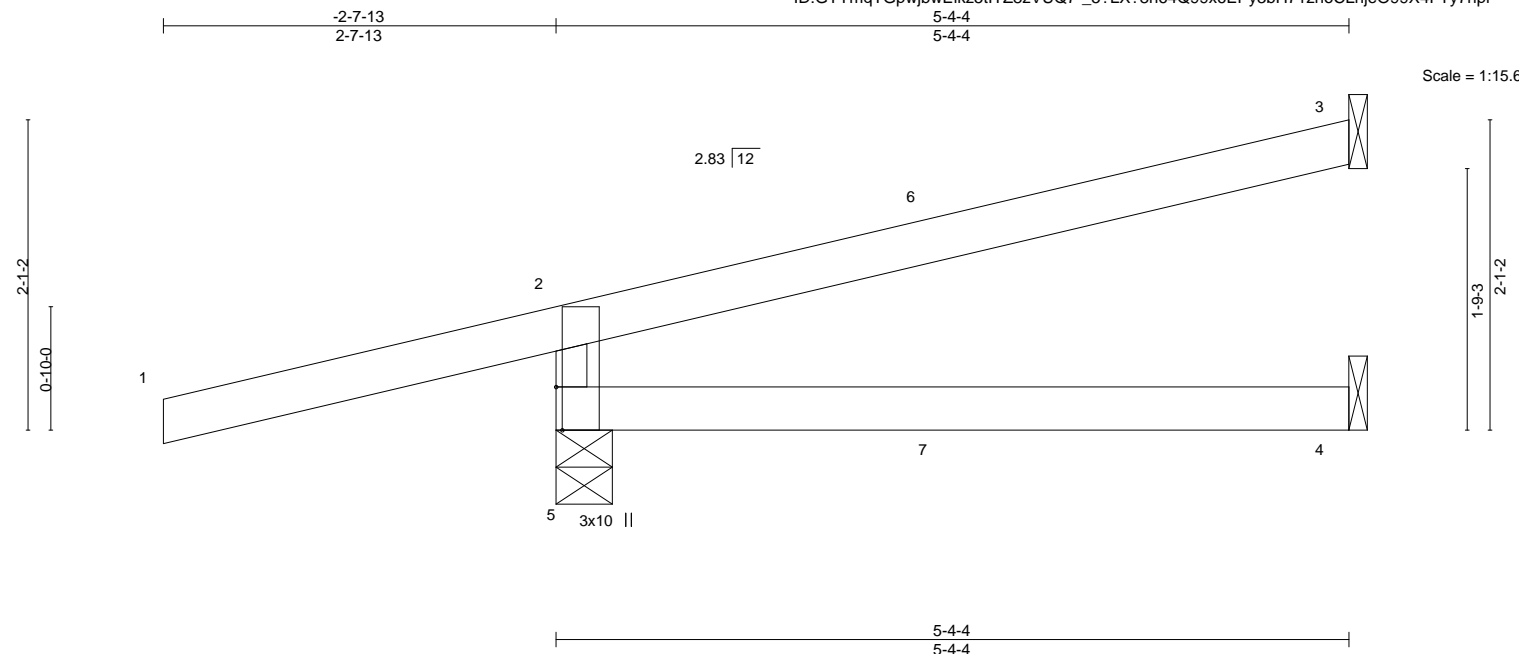


Plate Offsets (X,Y)--		[5:0-3-8,Edge]									
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.61	Vert(LL)	-0.03	4-5	>999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.06	4-5	>999		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.02	3	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-R		Wind(LL)	-0.03	4-5	>999	Weight: 16 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-4-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=0-4-9, 3=Mechanical, 4=Mechanical
Max Horz 5=76(LC 4)
Max Uplift 5=198(LC 4), 3=78(LC 8)
Max Grav 5=439(LC 1), 3=111(LC 1), 4=90(LC 3)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-5=-386/234

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 198 lb uplift at joint 5 and 78 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 62 lb down and 107 lb up at 2-7-6, and 62 lb down and 107 lb up at 2-7-6 on top chord, and 7 lb down and 8 lb up at 2-7-6, and 7 lb down and 8 lb up at 2-7-6 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-3=-70, 4-5=-20
Concentrated Loads (lb)
Vert: 6=59(F=29, B=29) 7=16(F=8, B=8)



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss J15	Truss Type Jack-Open	Qty 2	Ply 1	Lot 86 W0	I44063964
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:58 2020 Page 1

ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-_5?LX?8n64Q99x6EPy3bH712CoFHhjeO99X4FTy7npl

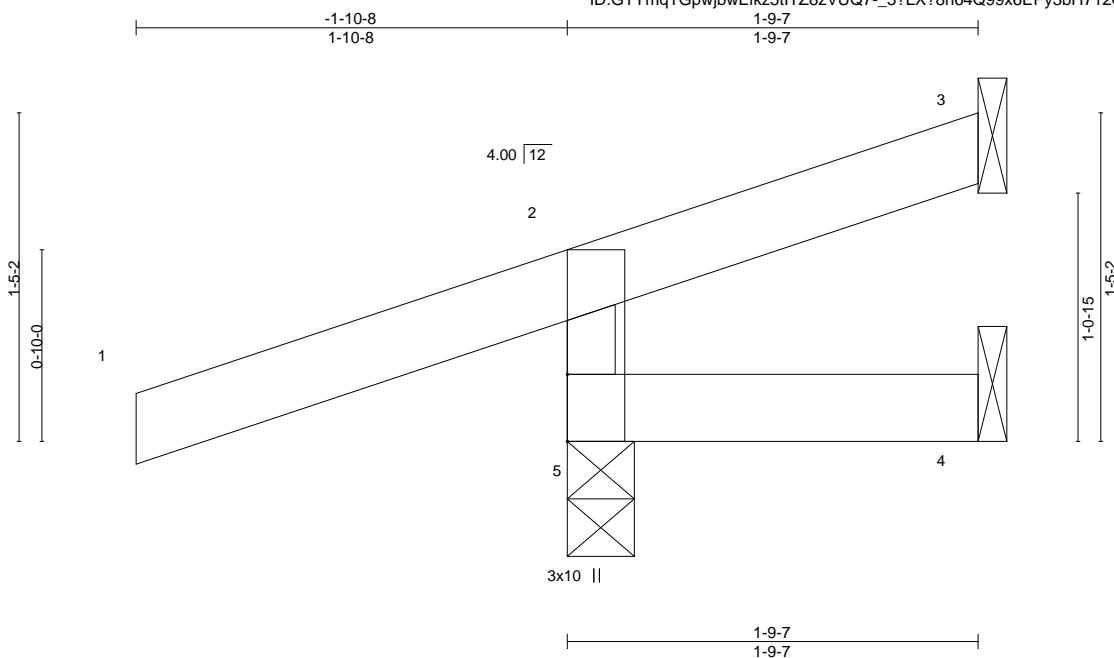

Scale = 1:10.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	0.00	5	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	0.00	5	>999	240	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	-0.00	5	>999	240	
								Weight: 7 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-9-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=49(LC 4)
Max Uplift 5=132(LC 4), 3=-9(LC 5)
Max Grav 5=296(LC 1), 3=9(LC 4), 4=27(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-263/141

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 132 lb uplift at joint 5 and 9 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063965
210285	J16	Jack-Open	5	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:19:59 2020 Page 1
ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-SHZjIL8PtOY0m5hRzgaqpKaDyCZSQAUxOpHdovy7npk

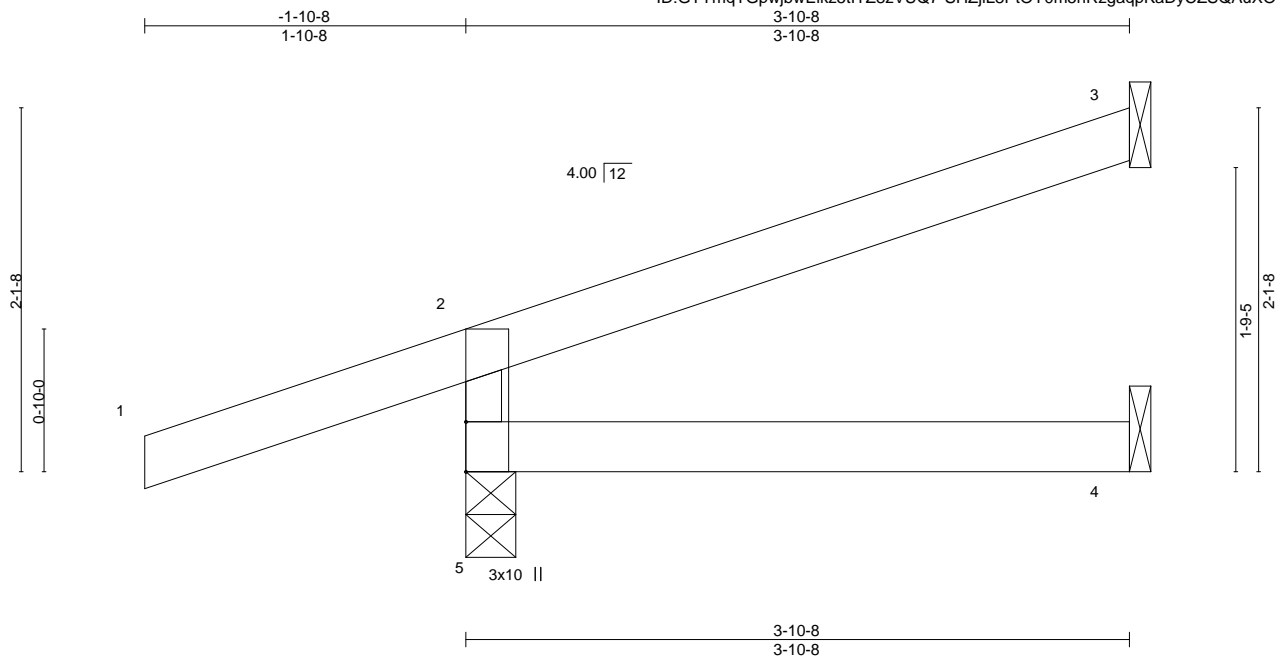

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.01	4-5	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	-0.02	4-5	>999	240	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01	3	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.00	4-5	>999	240	
									Weight: 12 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-10-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=77(LC 4)
Max Uplift 5=120(LC 4), 3=51(LC 8)
Max Grav 5=342(LC 1), 3=97(LC 1), 4=68(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-301/147

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 120 lb uplift at joint 5 and 51 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063966
210285	J17	Diagonal Hip Girder	1	1		
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:00 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-wT65yh91dhhsOFgdxN53MY6E5coE9ZCgcT0BKLy7npj



Scale = 1:23.3

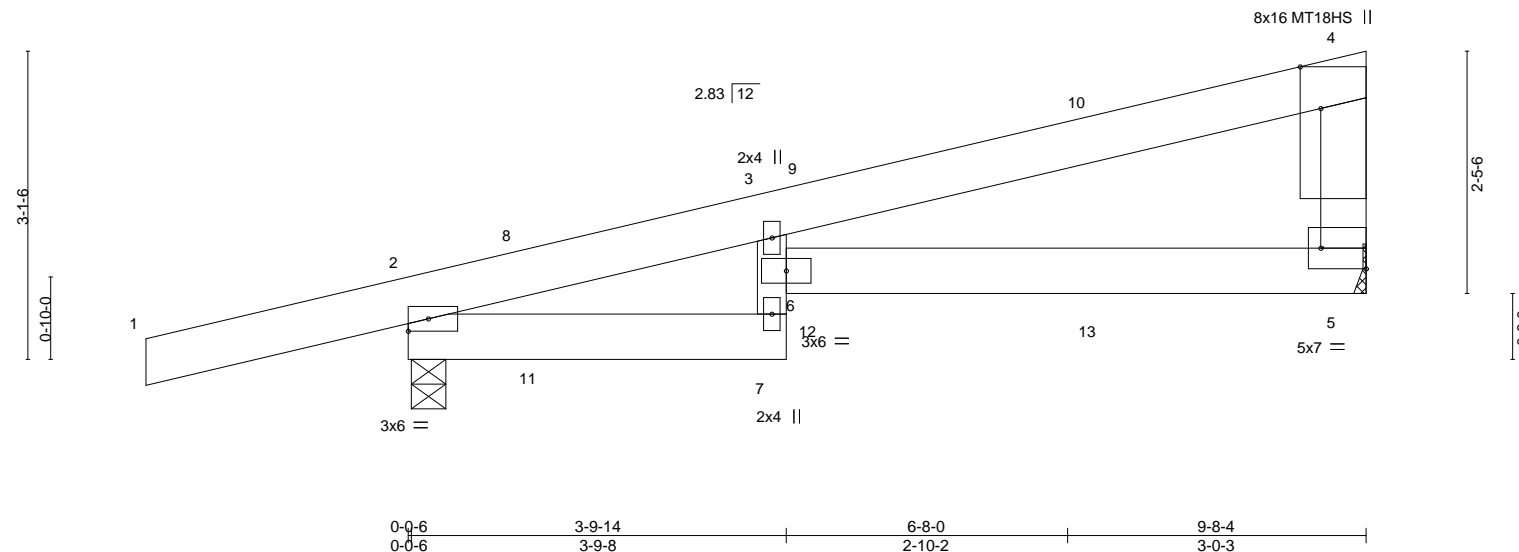


Plate Offsets (X,Y)--		[4:0-5-1,Edge], [5:Edge,0-2-8]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d
TCLL	25.0	Plate Grip DOL	1.15	TC	0.95	Vert(LL)	-0.19	7	>595
TCDL	10.0	Lumber DOL	1.15	BC	0.53	Vert(CT)	-0.36	7	>311
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.32	Horz(CT)	0.07	5	n/a
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.19	7	>572
								PLATES	GRIP
								MT20	197/144
								MT18HS	197/144
								Weight: 44 lb	FT = 10%

LUMBER-

TOP CHORD 2x6 SPF No.2
BOT CHORD 2x6 SPF No.2
WEBS 2x6 SPF No.2 *Except*
3-7: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=Mechanical, 2=0-4-3
Max Horz 2=120(LC 21)
Max Uplift 5=152(LC 8), 2=226(LC 4)
Max Grav 5=607(LC 1), 2=748(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.



TOP CHORD 2-3=-374/27, 3-4=-457/82, 4-5=-345/123
BOT CHORD 5-6=-113/445
WEBS 3-6=0/265

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left exposed; Lumber DOL=1.60 plate grip
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 152 lb uplift at joint 5 and 226 lb uplift at joint 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 69 lb down and 32 lb up at 1-3-7, 105 lb down and 65 lb up at 4-1-7, and 72 lb down and 36 lb up at 4-1-7, and 103 lb down and 56 lb up at 6-11-6 on top chord, and 3 lb down at 1-3-7, 20 lb down at 4-1-7, 35 lb down at 4-1-7, and 217 lb down and 82 lb up at 6-11-6, and 32 lb down and 28 lb up at 6-11-6 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-70, 2-7=-20, 5-6=-20

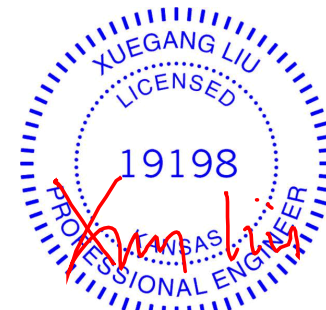

December 18, 2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0
210285	J17	Diagonal Hip Girder	1	1	I44063966
Job Reference (optional)					

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:00 2020 Page 2
ID:GTYmqTGpwjbwEikz5tITZ8zVUQ7-wT65yh91dhhsOFGdXN53MY6E5coE9ZCgcT0BKLy7npj


LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 9=-31(B) 10=-22(F) 12=-19(F=-10, B=-9) 13=-249(F=-32, B=-217)

Job 210285	Truss J18	Truss Type Jack-Open	Qty 1	Ply 1	Lot 86 W0	144063967
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:00 2020 Page 1

ID:zOKCXWmhF9AfmAvSznKRizeXr3-wT65yh91dhhsOFGdXN53MY6Oicuc9d8gcT0BKLy7npj

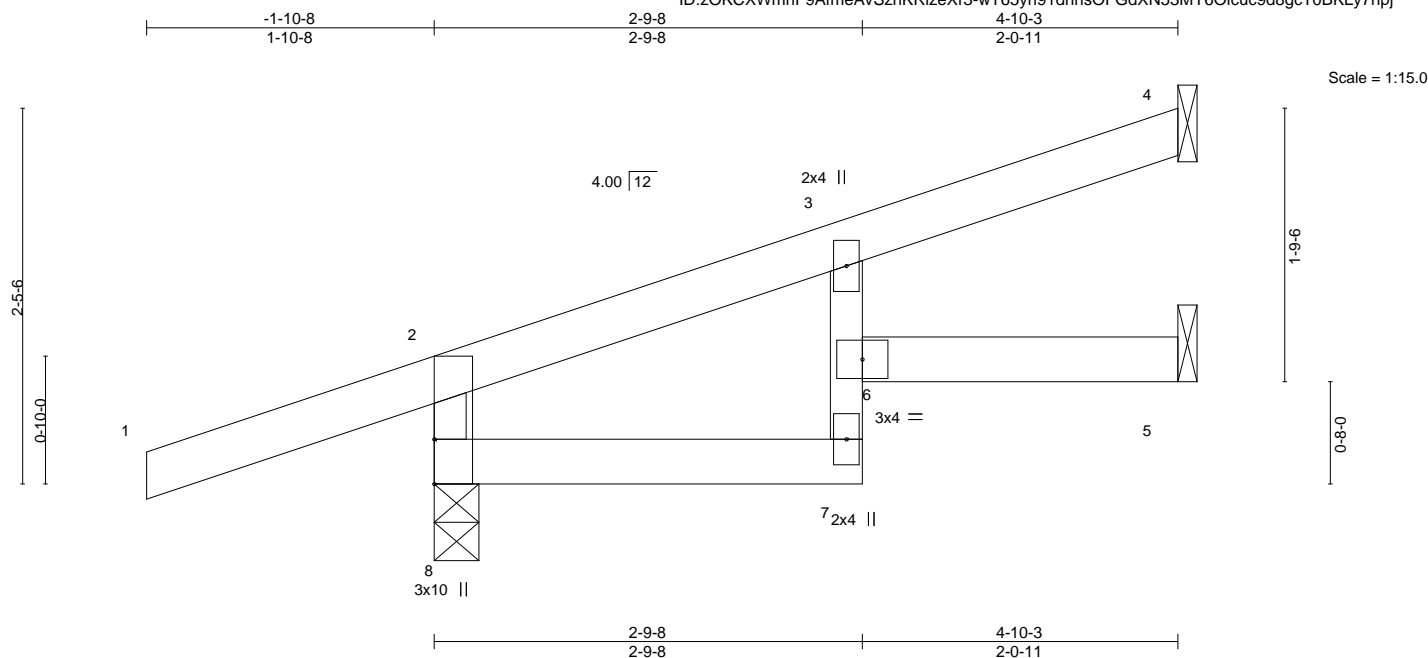

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.02	6	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	-0.04	7	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.02	6	>999	240		
									Weight: 15 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
3-7: 2x3 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-10-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 8=0-3-8, 4=Mechanical, 5=Mechanical
Max Horz 8=90(LC 4)
Max Uplift 8=121(LC 4), 4=-45(LC 8), 5=-4(LC 8)
Max Grav 8=379(LC 1), 4=121(LC 1), 5=71(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-8=-341/140

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 8, 45 lb uplift at joint 4 and 4 lb uplift at joint 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	144063968
210285	J19	Jack-Closed	3	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:01 2020 Page 1

ID:GTymqTGpwjwEikz5tTZ8zVUQ7-OggTA1AgO?pj0Orp44clulFWi0A5u4Oqr7mksny7npi

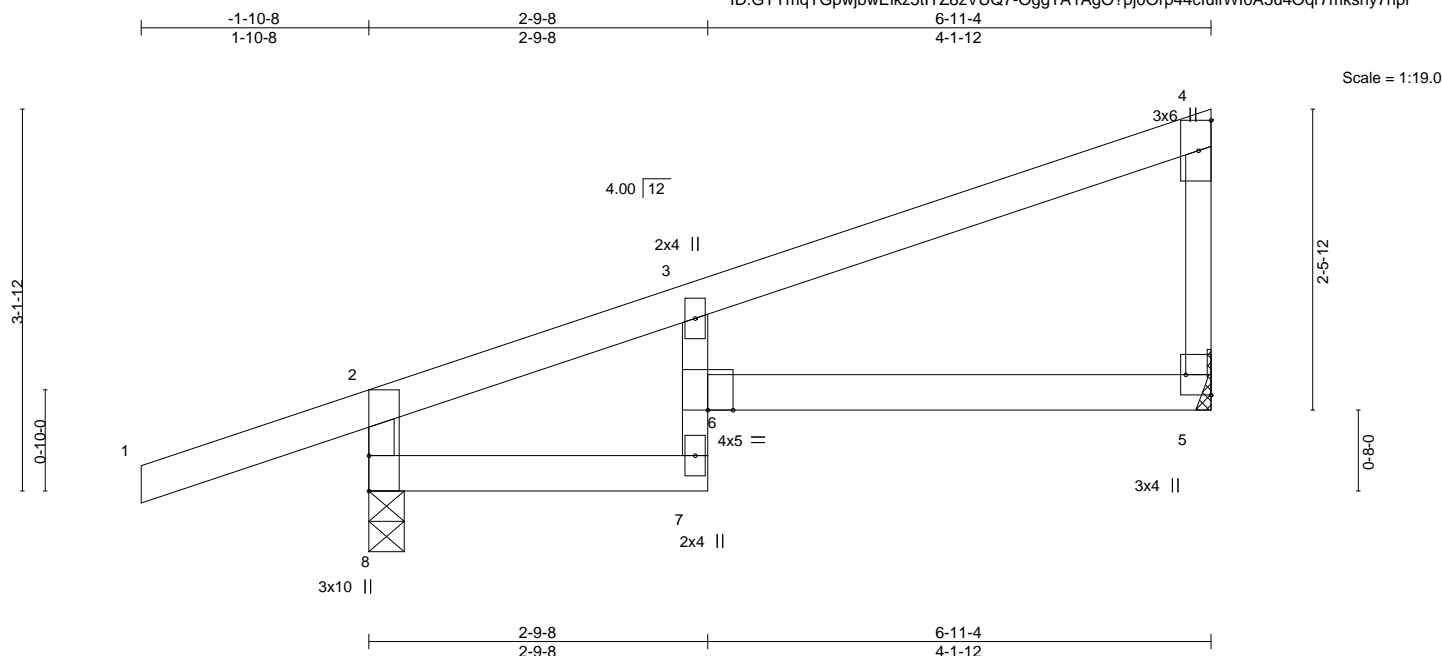


Plate Offsets (X,Y)--		[5:Edge,0-2-8]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	L/defl	L/d
TCLL	25.0	Plate Grip DOL	1.15	TC	0.47	Vert(LL)	-0.10 6	>812	360
TCDL	10.0	Lumber DOL	1.15	BC	0.42	Vert(CT)	-0.18 5-6	>439	240
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.05 5	n/a	n/a
BCDL	10.0	Code IRC2018/TPI2014		Matrix-R		Wind(LL)	0.07 6	>999	240
						PLATES		GRIP	
						MT20		197/144	
						Weight: 21 lb		FT = 10%	

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except*
 3-7: 2x3 SPF No.2
 WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 8=0-3-8, 5=Mechanical
 Max Horz 8=94(LC 5)
 Max Uplift 8=-76(LC 4), 5=-20(LC 8)
 Max Grav 8=462(LC 1), 5=282(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-8=-418/91, 2-3=-263/10

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 76 lb uplift at joint 8 and 20 lb uplift at joint 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063969
210285	J20	Jack-Open	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:02 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-ssEsNNBI9JxadYQ?eo7XRzCkCQc3dXOz4nVHOEy7nph

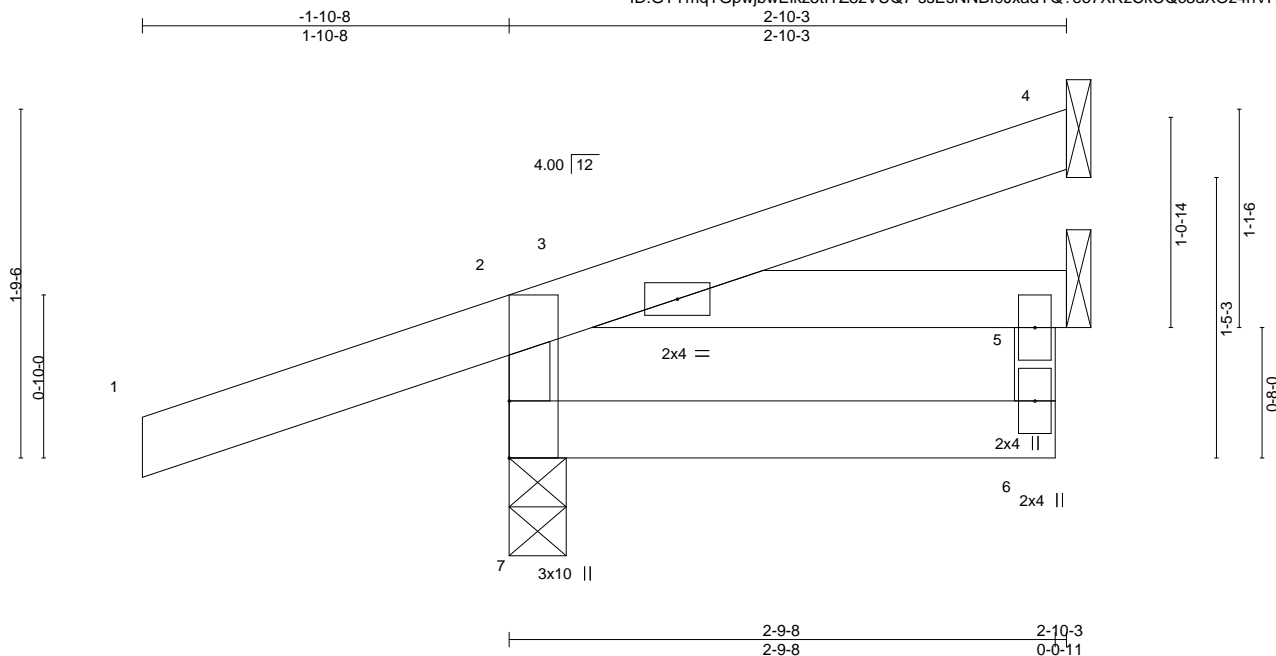

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.00	6-7	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	-0.00	6-7	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	-0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	-0.00	3	>999	240	Weight: 12 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-10-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 7=0-3-8, 4=Mechanical, 5=Mechanical
Max Horz 7=63(LC 4)
Max Uplift 7=110(LC 4), 4=30(LC 8)
Max Grav 7=330(LC 1), 4=57(LC 1), 5=91(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-7=-298/128

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 110 lb uplift at joint 7 and 30 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Wheeler Lumber, Waverly, KS - 66871, 8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:03 2020 Page 1
ID:GTYmqTGpwbEikz5tITZ8zVUQ7-K2oEbjBwwc3RFi?CCVfm_Akt7psOMU27JQFrxyg7npg
-2-7-13 4-10-2 9-8-4
2-7-13 4-10-2 4-10-2
Scale = 1:22.6

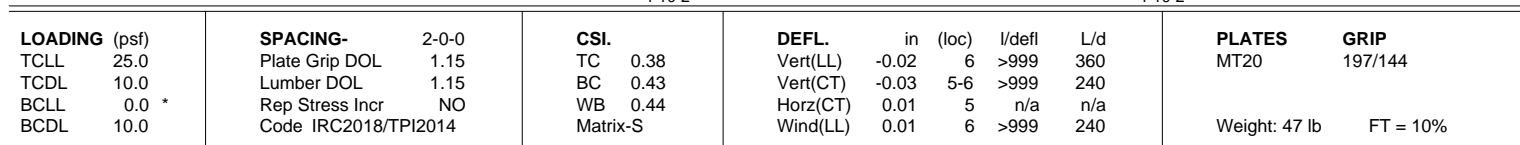

REACTIONS. (size) 5=Mechanical, 2=0-4-9
 Max Horz 2=117(LC 22)
 Max Uplift 5=-101(LC 8), 2=-220(LC 4)
 Max Grav 5=467(LC 1), 2=677(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-3=-792/124
BOT CHORD	2-6=-138/699, 5-6=-138/699
WEBS	3-5=-717/164


KLEPP AND

- NOTES-**

 - 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 101 lb uplift at joint 5 and 220 lb uplift at joint 2.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 71 lb down and 36 lb up at 4-1-7, 71 lb down and 36 lb up at 4-1-7, and 103 lb down and 75 lb up at 6-11-6, and 103 lb down and 75 lb up at 6-11-6 on top chord, and 10 lb down and 4 lb up at 4-1-7, 10 lb down and 4 lb up at 4-1-7, and 31 lb down at 6-11-6, and 31 lb down at 6-11-6 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

Figure 1. The effect of the number of nodes on the accuracy of the proposed method. The accuracy is measured by the average of 100 trials. The error bars represent the standard deviation. The number of nodes is 10, 20, 30, 40, 50, 60, 70, 80, 90, 100, 110, 120, 130, 140, 150, 160, 170, 180, 190, 200.

- LOAD CASE(S)** Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-4=-70, 2-5=-20
 Concentrated Loads (lb)
 Vert: 8=-71(F=-35, B=-35) 9=8(F=4, B=4) 10=-37(F=-19, B=-19)

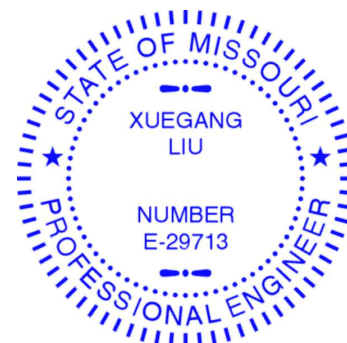

December 18, 2020



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063971
210285	J22	Jack-Open	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:03 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-K2oEbjBwwc3RFi?CCVfm_AkuQpvm_t7JQFrxy7npg

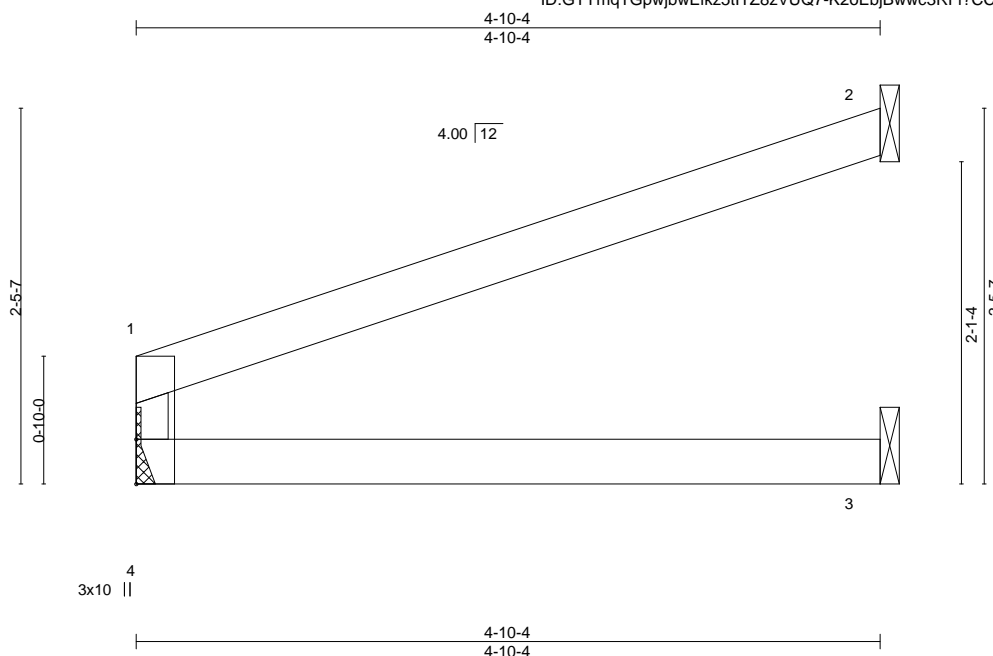

Scale = 1:15.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.02 3-4	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.21	Vert(CT)	-0.05 3-4	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.03 2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.02 3-4	>999	240	Weight: 12 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-


TOP CHORD Structural wood sheathing directly applied or 4-10-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 2=Mechanical, 3=Mechanical
Max Horz 4=56(LC 8)
Max Uplift 4=22(LC 4), 2=73(LC 8)
Max Grav 4=211(LC 1), 2=154(LC 1), 3=90(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 22 lb uplift at joint 4 and 73 lb uplift at joint 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss J23	Truss Type Jack-Open	Qty 1	Ply 1	Lot 86 W0 Job Reference (optional)	I44063972
---------------	--------------	-------------------------	----------	----------	---------------------------------------	-----------

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:04 2020 Page 1

ID:GTymqTGpwjwEikz5tITZ8zVUQ7-oEMco3CYhwBItsaOmDA?WOH76DIQ5R7GX4_OT6y7npf

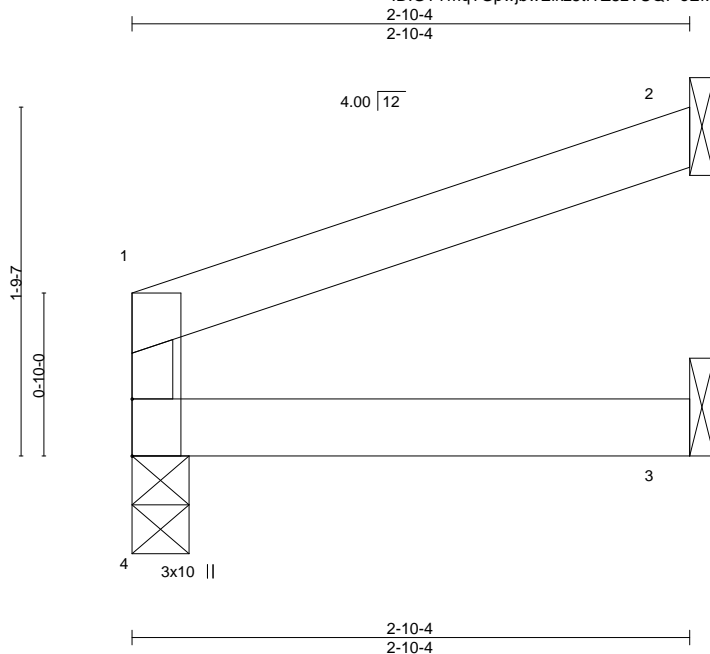

Scale = 1:11.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	-0.00	3-4	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	-0.01	3-4	>999	240	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.00	3-4	>999	240	
								Weight: 7 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-10-4 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 4=0-3-8, 2=Mechanical, 3=Mechanical
Max Horz 4=37(LC 5)
Max Uplift 4=10(LC 4), 2=44(LC 8)
Max Grav 4=121(LC 1), 2=89(LC 1), 3=52(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 10 lb uplift at joint 4 and 44 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063973
210285	J24	Jack-Open	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:04 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-oEMco3CYhwBltsaOmDA?WOH4XDFL5R7GX4_OT6y7npf

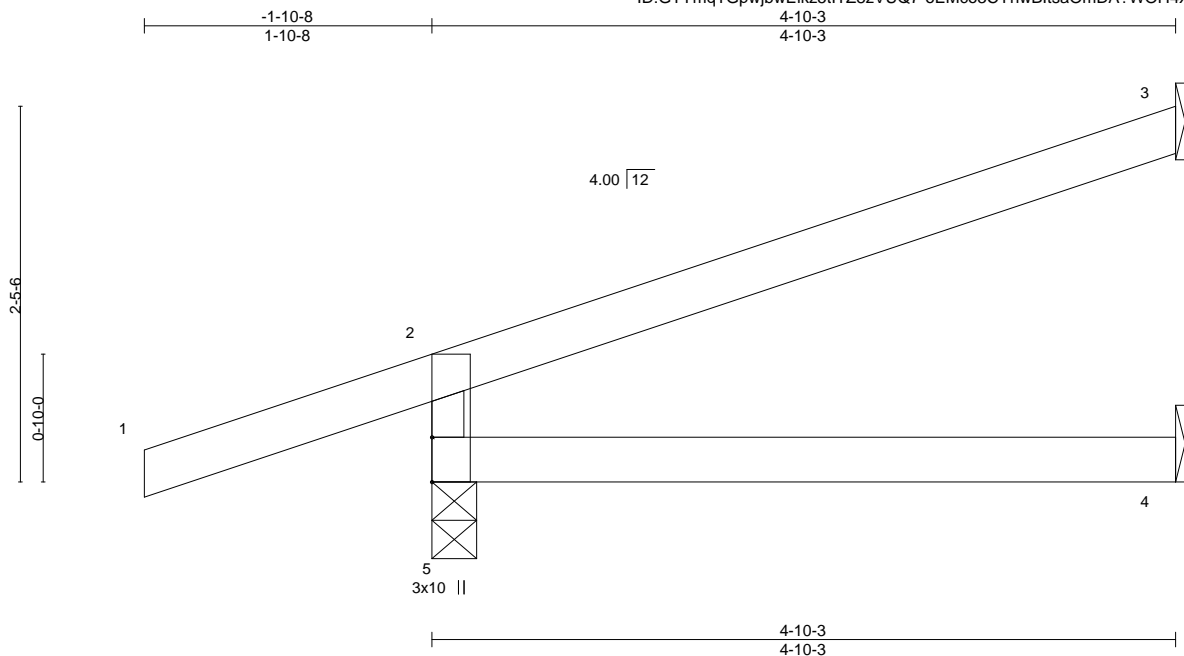

Scale = 1:15.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	-0.02	4-5	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.20	Vert(CT)	-0.05	4-5	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.01	4-5	>999	240	Weight: 14 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-10-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=90(LC 4)
Max Uplift 5=121(LC 4), 3=67(LC 8)
Max Grav 5=379(LC 1), 3=134(LC 1), 4=87(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-332/157

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 5 and 67 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:05 2020 Page 1
ID:GTYmgTGowibwEikz5tITZ8zVUQ7-HRw ?OPASEJ9V08aJwhE3bqHZdc6uNQmkkx?Zy7npe




TOP CHORD	2x6 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2

TOP CHORD	Structural wood sheathing directly applied or 4-10-10 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=91(LC 4)
Max Uplift 5=123(LC 4), 3=67(LC 8)
Max Grav 5=378(LC 1), 3=140(LC 1), 4=79(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-326/158

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 5 and 67 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063975
210285	J25	Jack-Open	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:05 2020 Page 1

ID:GTymqTGpwjwEikz5t1TZ8zVUQ7-HRw_?ODASEJ9V08aJwhE3bqFRdeoquNQmkx?Zy7npe

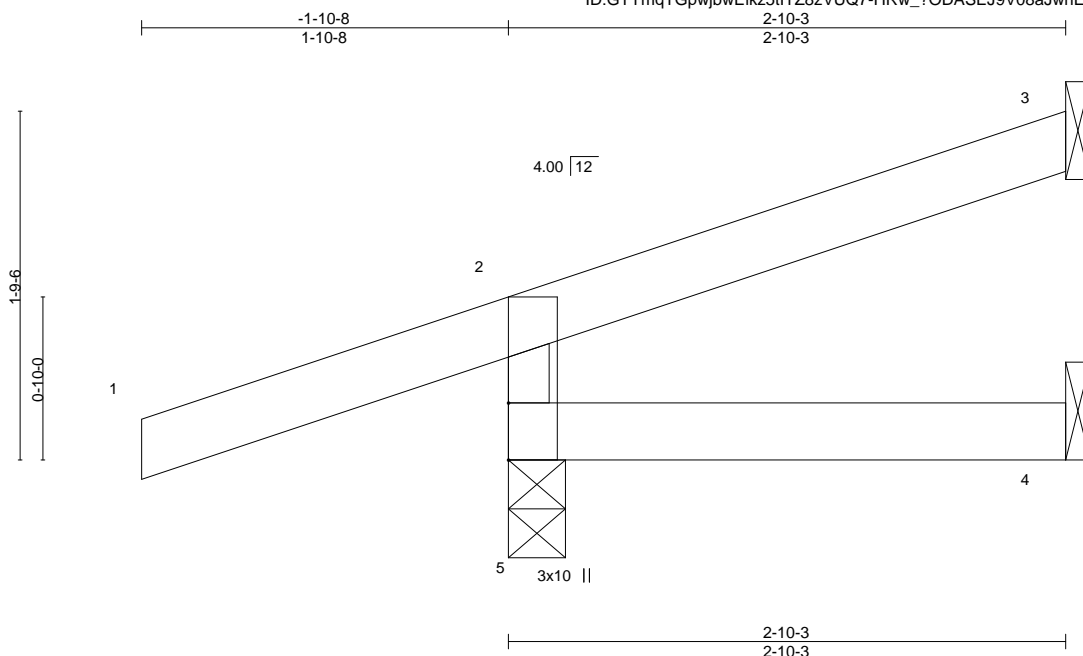

Scale = 1:11.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.00	4-5	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	4-5	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.00	5	>999	240		
									Weight: 9 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-10-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=63(LC 4)
Max Uplift 5=121(LC 4), 3=32(LC 8)
Max Grav 5=310(LC 1), 3=52(LC 1), 4=48(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-274/139

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 5 and 32 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063976
210285	J25A	Jack-Open	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:06 2020 Page 1

ID:GTymqTGpwjwEikz5tTZ8zVUQ7-ldUMdkEoDXR06AjteCTbpMQB1z2ZLdZ?OTVX?y7npd

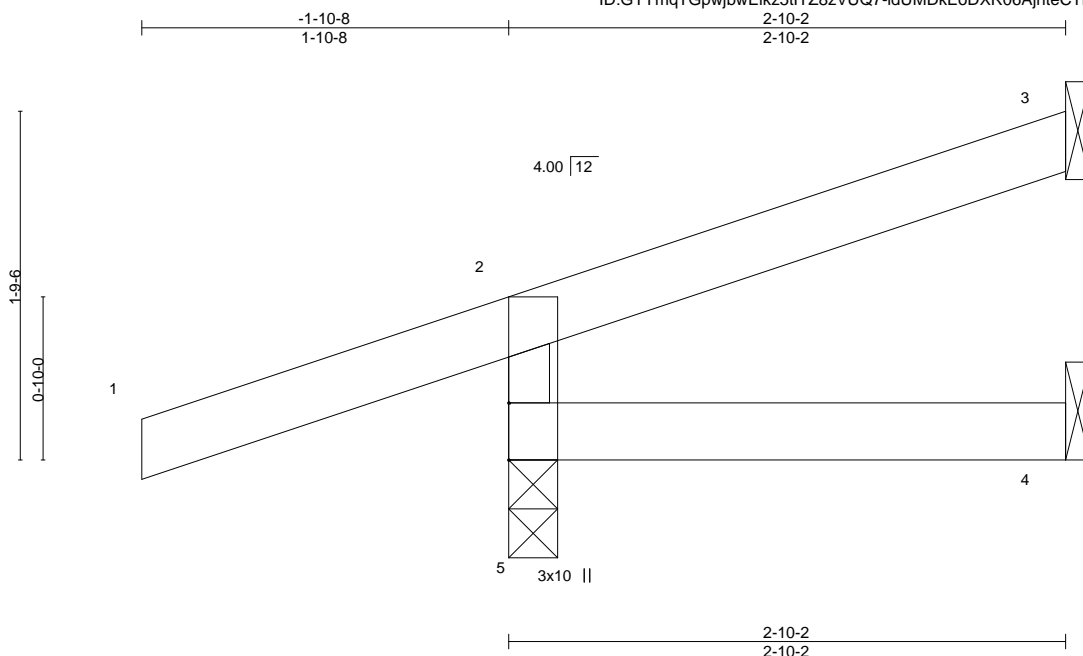

Scale = 1:11.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.00	4-5	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	4-5	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	0.00	5	>999	240		
									Weight: 9 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-10-2 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-0, 3=Mechanical, 4=Mechanical
Max Horz 5=63(LC 4)
Max Uplift 5=121(LC 4), 3=32(LC 8)
Max Grav 5=310(LC 1), 3=52(LC 1), 4=48(LC 3)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-274/139

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 5 and 32 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063977
210285	J26	Jack-Closed	7	1		
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:06 2020 Page 1

ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-IdUMDKEdXR06AjnteCTbpMKT1tkZLdZ?OTVX?y7npd

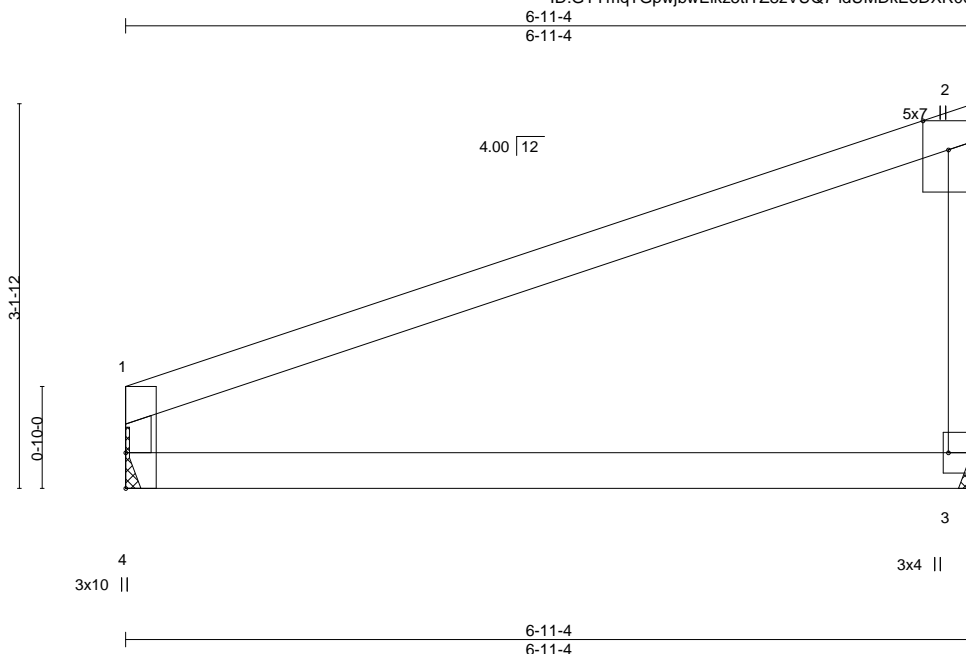

Scale = 1:18.8

Plate Offsets (X,Y)--		[3:Edge,0-2-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 25.0	Plate Grip DOL	1.15	TC 0.70
TCDL 10.0	Lumber DOL	1.15	BC 0.39
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) -0.09 3-4 >936 360
			Vert(CT) -0.18 3-4 >451 240
			Horz(CT) 0.00 3 n/a n/a
			Wind(LL) 0.02 3-4 >999 240
			PLATES
			MT20
			GRIP
			197/144
			Weight: 19 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.



(size) 4=Mechanical, 3=Mechanical
Max Horz 4=93(LC 5)
Max Uplift 4=-10(LC 4), 3=-22(LC 8)
Max Grav 4=303(LC 1), 3=303(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-4=-251/55

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 10 lb uplift at joint 4 and 22 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

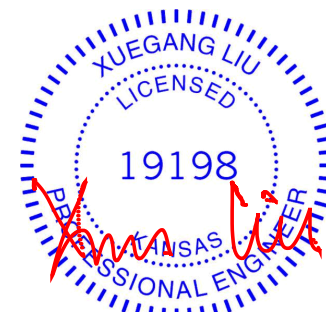

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063978
210285	J27	Diagonal Hip Girder	4	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:07 2020 Page 1
ID:GTymqTGpwbwEikz5tITZ8zVUQ7-Dp1IQ4FQ_rZtkJlZRLji80vWsRHslotiD2D24Ry7npc

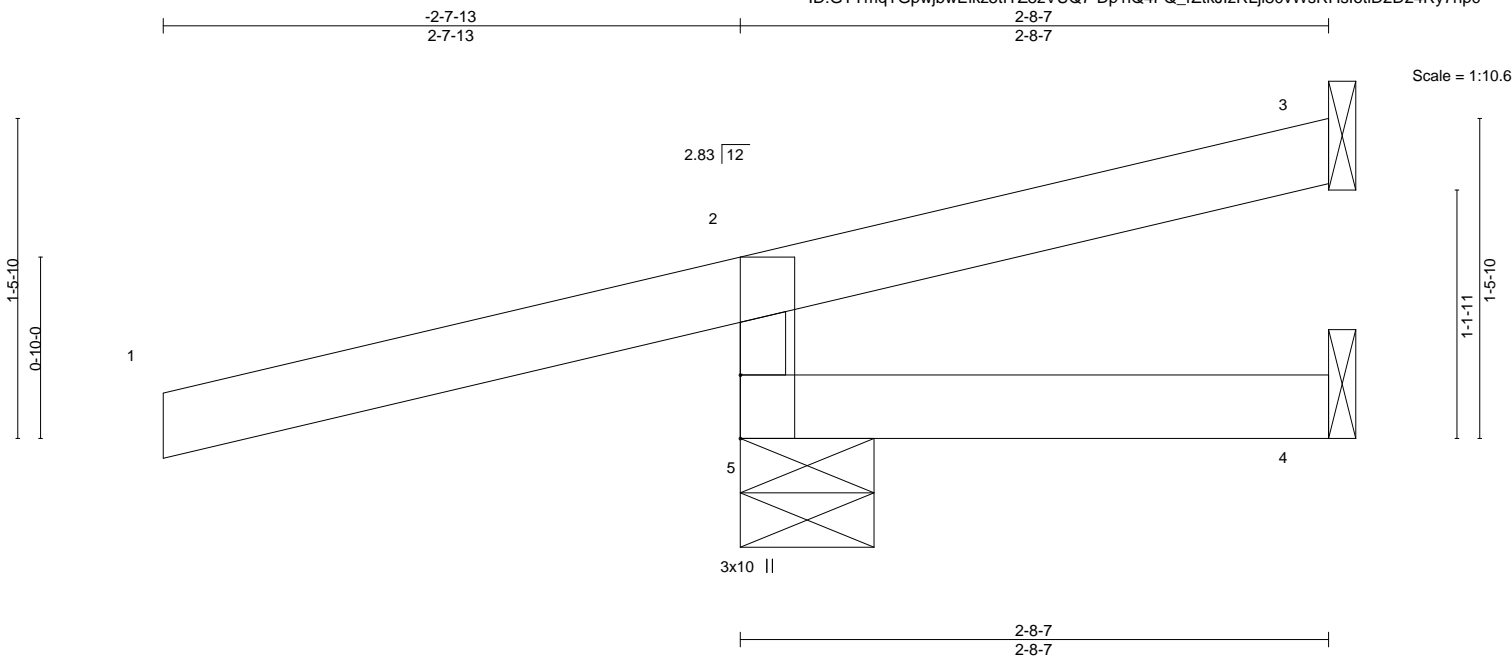

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.59	Vert(LL)	0.00	4-5	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.14	Vert(CT)	0.01	4-5	>999	240	197/144
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.01	3	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	-0.00	4-5	>999	240	
									Weight: 10 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-8-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 5=0-7-6, 3=Mechanical, 4=Mechanical
Max Horz 5=52(LC 7)
Max Uplift 5=154(LC 4), 3=48(LC 17), 4=14(LC 1)
Max Grav 5=270(LC 1), 3=28(LC 4), 4=28(LC 3)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 154 lb uplift at joint 5, 48 lb uplift at joint 3 and 14 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 46 lb down and 16 lb up at -2-7-13, and 46 lb down and 16 lb up at -2-7-13 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Concentrated Loads (lb)
Vert: 1=-71(F=-36, B=-36)
Trapezoidal Loads (plf)
Vert: 1=-0(F=35, B=35)-to-2=-48(F=11, B=11), 2=-4(F=33, B=33)-to-3=-49(F=10, B=10), 5=-0(F=10, B=10)-to-4=-14(F=3, B=3)



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063979
210285	J28	Jack-Open	12	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:07 2020 Page 1
ID:GTymqTGpwjwEikz5tITZ8zVUQ7-Dp1IQ4FQ_rZtkJzRLji80vbxRJMIotID2D24Ry7npc

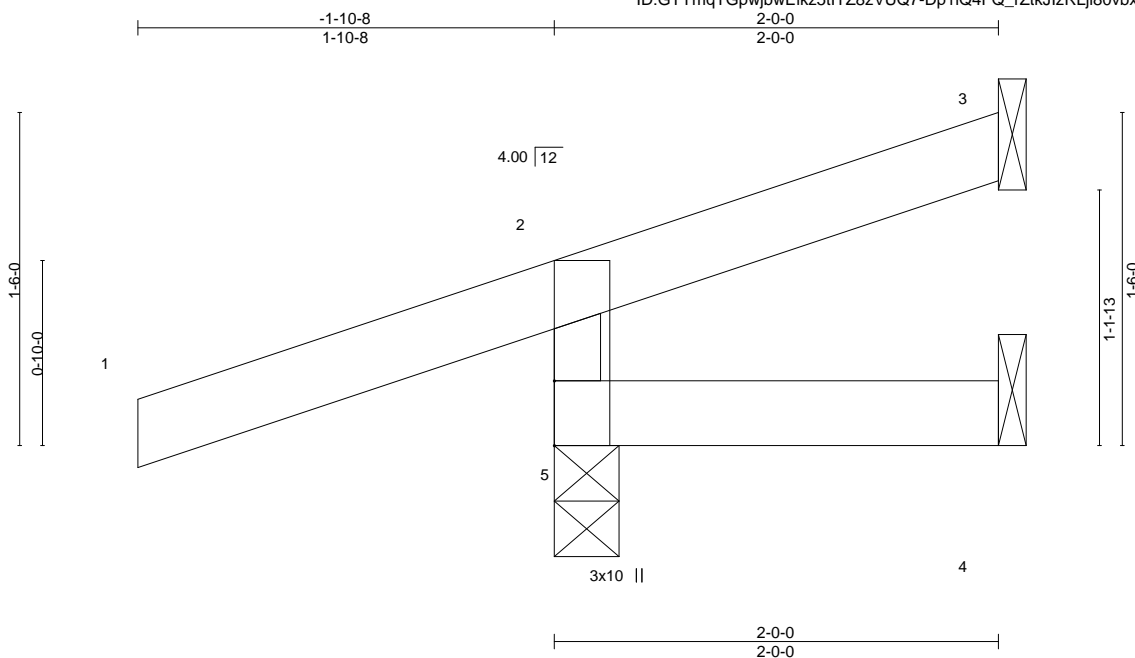

Scale = 1:10.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	0.00	5	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	5	>999	240		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R	Wind(LL)	-0.00	5	>999	240		
									Weight: 7 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-


TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=52(LC 4)
Max Uplift 5=129(LC 4), 3=14(LC 8)
Max Grav 5=296(LC 1), 3=7(LC 1), 4=32(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-263/139

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 129 lb uplift at joint 5 and 14 lb uplift at joint 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

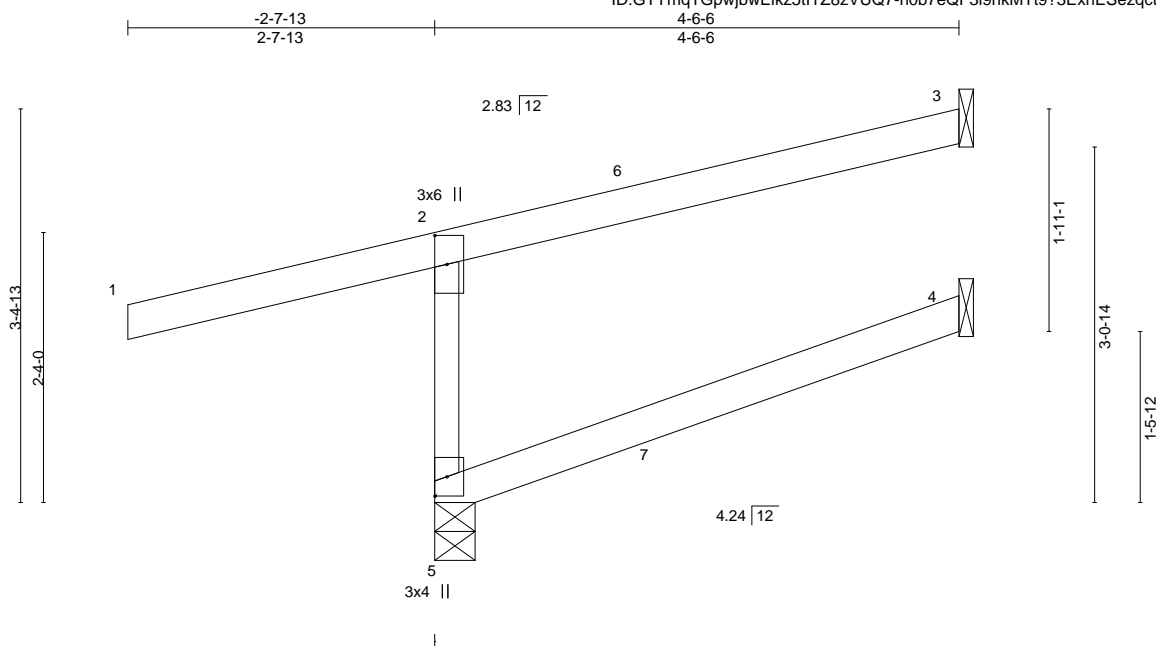


Plate Offsets (X,Y)-- [2:0-3:0-0-1-4]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES	GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.83	Vert(LL)	0.06	4-5	>921	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.22	Vert(CT)	0.05	4-5	>999	180		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.00	Horz(CT)	-0.13	3	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-R							Weight: 16 lb	FT = 10%

LUMBER-

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x3 SPF No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 4-6-6 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 5=0-4-3, 3=Mechanical, 4=Mechanical
Max Horz 5=86(LC 5)
Max Uplift 5=273(LC 4), 3=92(LC 8), 4=30(LC 5)
Max Grav 5=394(LC 1), 3=78(LC 38), 4=79(LC 3)

FORCES.


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-347/246

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 273 lb uplift at joint 5, 92 lb uplift at joint 3 and 30 lb uplift at joint 4.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 87 lb down and 179 lb up at 1-9-8, and 87 lb down and 179 lb up at 1-9-8 on top chord, and 33 lb down and 51 lb up at 1-9-8, and 33 lb down and 51 lb up at 1-9-8 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-3=-70, 4-5=-20
Concentrated Loads (lb)
Vert: 6=84(F=42, B=42) 7=8(F=4, B=4)

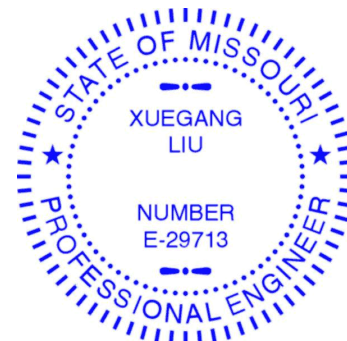

December 18, 2020



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063981
210285	J30	Jack-Open	3	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:09 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-9C9VrmGhWSpbzDSMYmlADR_xRE_QmhM?hMi98Ky7npa

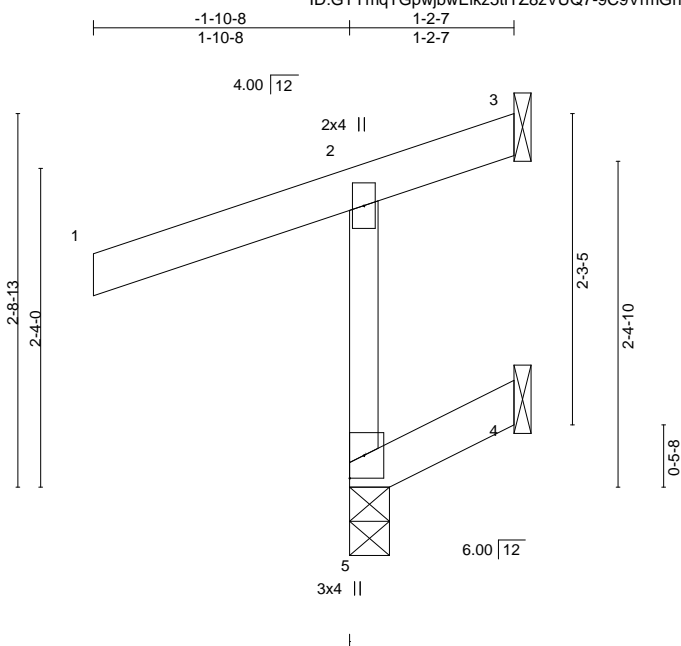

Scale = 1:16.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	0.00	5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00	5	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.03	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R						Weight: 7 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-2-7 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=71(LC 5)
Max Uplift 5=113(LC 4), 3=80(LC 1), 4=46(LC 5)
Max Grav 5=314(LC 1), 3=26(LC 4), 4=28(LC 19)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-295/142

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 113 lb uplift at joint 5, 80 lb uplift at joint 3 and 46 lb uplift at joint 4.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

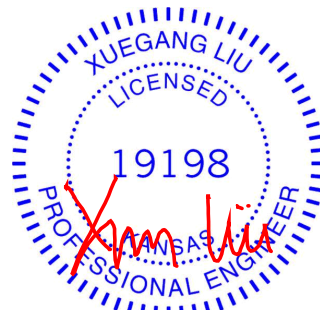

December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss J31	Truss Type Jack-Open	Qty 1	Ply 1	Lot 86 W0 I44063982
---------------	--------------	-------------------------	----------	----------	------------------------

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:10 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-dOjt36HJHmxSbn1Y6THPmfX5weKiV8c9w0Rihmy7npZ

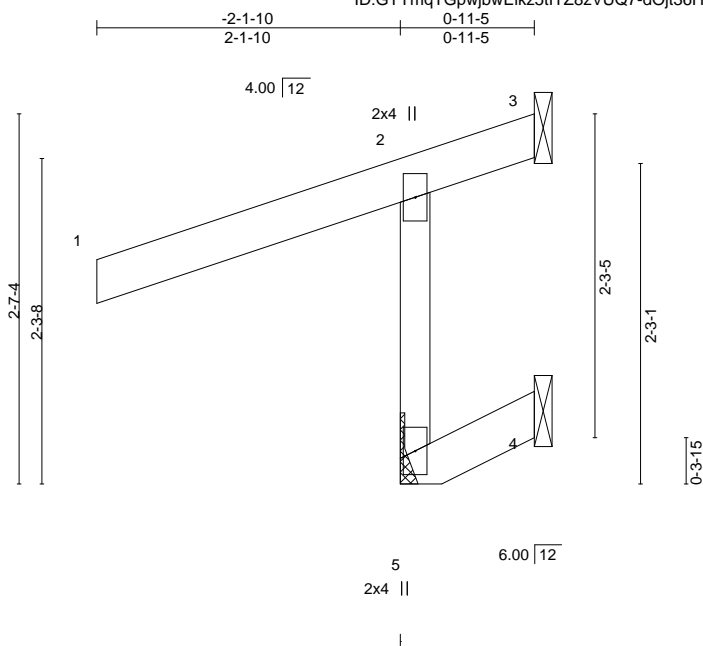

Scale = 1:16.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.35	Vert(LL)	0.00	5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00	5	>999	180		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.03	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R						Weight: 7 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 0-11-5 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.


(size) 5=Mechanical, 3=Mechanical, 4=Mechanical
Max Horz 5=69(LC 5)
Max Uplift 5=160(LC 4), 3=172(LC 1), 4=61(LC 5)
Max Grav 5=406(LC 1), 3=75(LC 4), 4=32(LC 19)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-387/194

NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 160 lb uplift at joint 5, 172 lb uplift at joint 3 and 61 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss J32	Truss Type Jack-Open	Qty 4	Ply 1	Lot 86 W0	I44063983
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:11 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-5bHFGS1x243JDxckgBoels4Go2g9Ebs18gBGDCy7npY

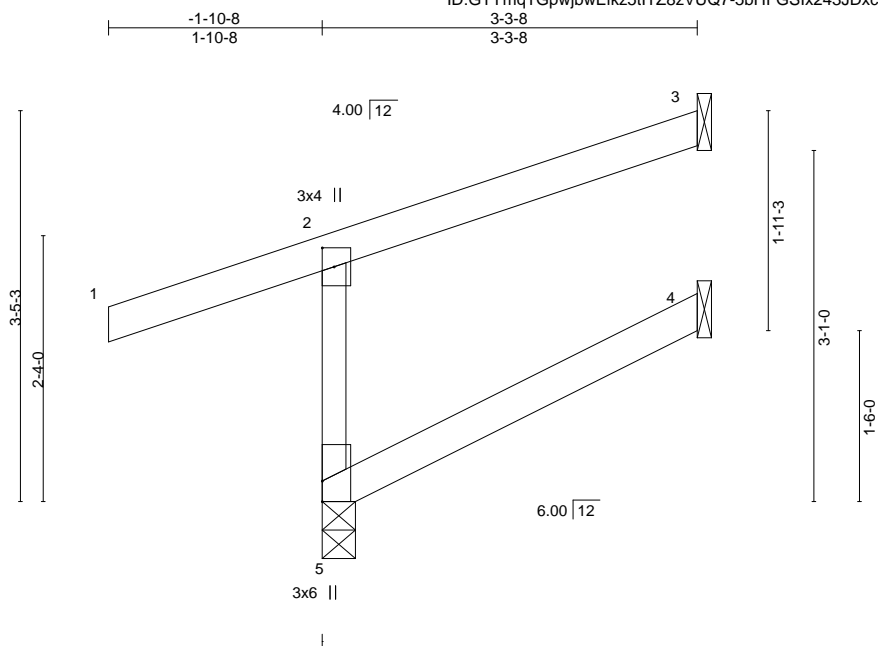

Scale = 1:20.2

Plate Offsets (X,Y)--		[2:0-2-0,0-1-4], [5:0-2-3,Edge]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	L/defl	L/d
TCLL 25.0		Plate Grip DOL	1.15	TC 0.28		Vert(LL)	-0.01 4-5	>999	360
TCDL 10.0		Lumber DOL	1.15	BC 0.12		Vert(CT)	-0.01 4-5	>999	240
BCLL 0.0 *		Rep Stress Incr	YES	WB 0.00		Horz(CT)	-0.07 3	n/a	n/a
BCDL 10.0		Code IRC2018/TPI2014		Matrix-R		Wind(LL)	0.01 4-5	>999	240
						PLATES	GRIP		
						MT20	197/144		
						Weight: 12 lb	FT = 10%		

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-3-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=90(LC 5)
Max Uplift 5=92(LC 4), 3=54(LC 8), 4=6(LC 5)
Max Grav 5=323(LC 1), 3=69(LC 1), 4=60(LC 3)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-288/128

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 92 lb uplift at joint 5, 54 lb uplift at joint 3 and 6 lb uplift at joint 4.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:12 2020 Page 1
ID:GTYmaTGpwiwbEikz5tITZ8zVUQ7-ZnreUoJZpNBAq5BwEuJtr4cMFSyMzyERNKwplvfy7npX

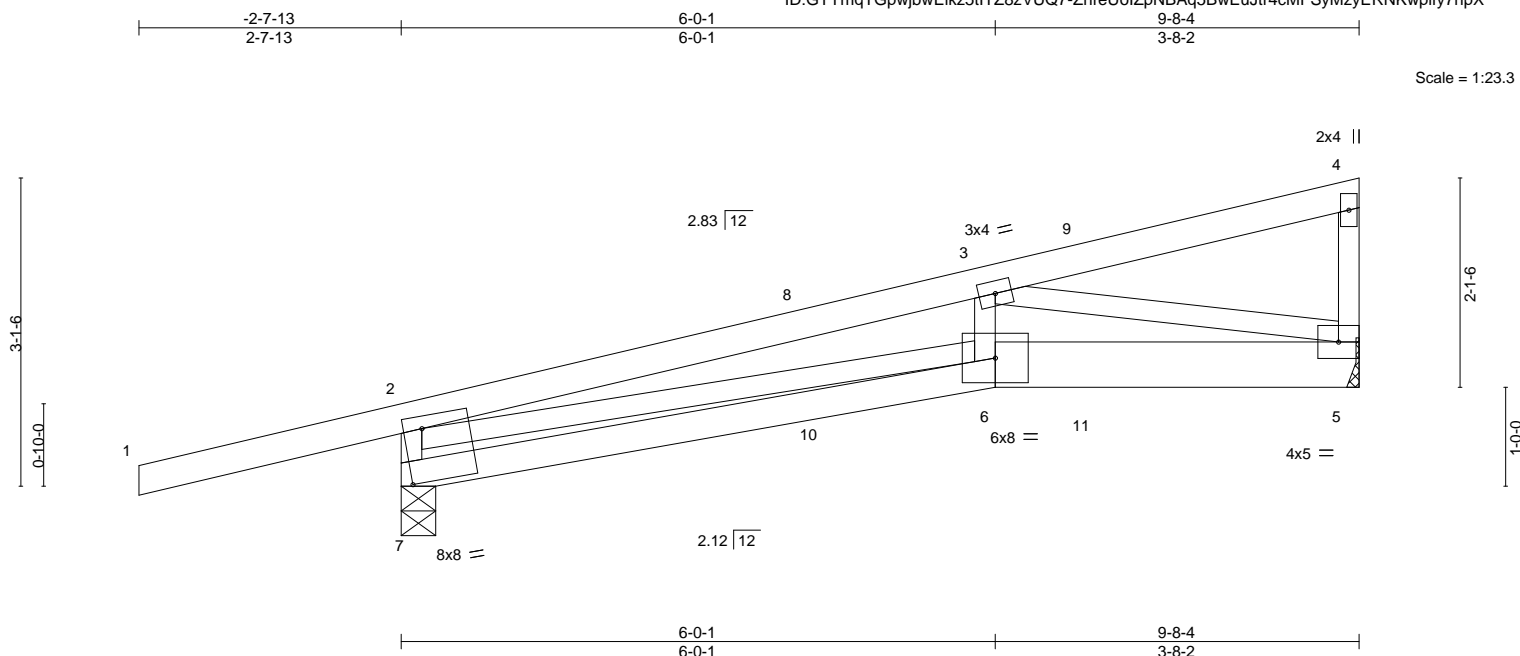


Plate Offsets (X,Y)-- [7:0-2-4,0-6-8]													
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.61	Vert(LL)	-0.06	6-7	>999	360	MT20	197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.32	Vert(CT)	-0.13	6-7	>907	240			
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.44	Horz(CT)	0.02	5	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.05	6	>999	240	Weight: 38 lb	FT = 10%	

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
5-6: 2x6 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 4-8-12 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 7=0-4-3, 5=Mechanical
Max Horz 7=113(LC 5)
Max Uplift 7=-214(LC 4), 5=-105(LC 8)
Max Grav 7=673(LC 1), 5=473(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.



TOP CHORD 2-7=-628/245, 2-3=-1247/264
BOT CHORD 5-6=-270/1183
WEBS 2-6=-242/1019, 3-6=0/299, 3-5=-1177/284

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 214 lb uplift at joint 7 and 105 lb uplift at joint 5.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 71 lb down and 36 lb up at 4-1-7, 71 lb down and 36 lb up at 4-1-7, and 103 lb down and 76 lb up at 6-11-6, and 103 lb down and 76 lb up at 6-11-6 on top chord, and 9 lb down and 4 lb up at 4-1-7, 9 lb down and 4 lb up at 4-1-7, and 31 lb down at 6-11-6, and 31 lb down at 6-11-6 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70. 2-4=-70. 6-7=-20. 5-6=-20

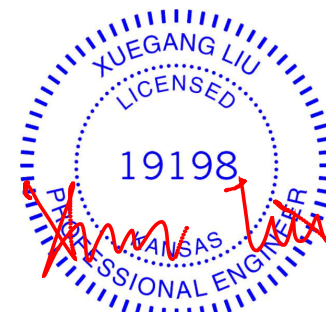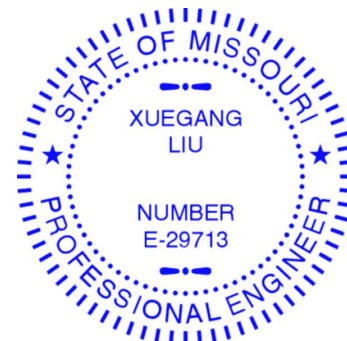

December 18, 2020

Continued on page 2



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0
210285	J33	Diagonal Hip Girder	1	1	I44063984
Job Reference (optional)					

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:12 2020 Page 2
ID:GTYmqTGpwjBwEikz5tITZ8zVUQ7-ZnreUolZpNBAq5BwEuJtr4cMFSyMzyERNKwplfy7npX

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 9=-71(F=-36, B=-36) 10=8(F=4, B=4) 11=-37(F=-19, B=-19)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063985
210285	J34	Jack-Open	7	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:12 2020 Page 1

ID:GTymqTGpwbjwEikz5tITZ8zVUQ7-ZnreUolZpNBAq5BwEuJtr4cOzSuyz2tRNKwplfy7npX

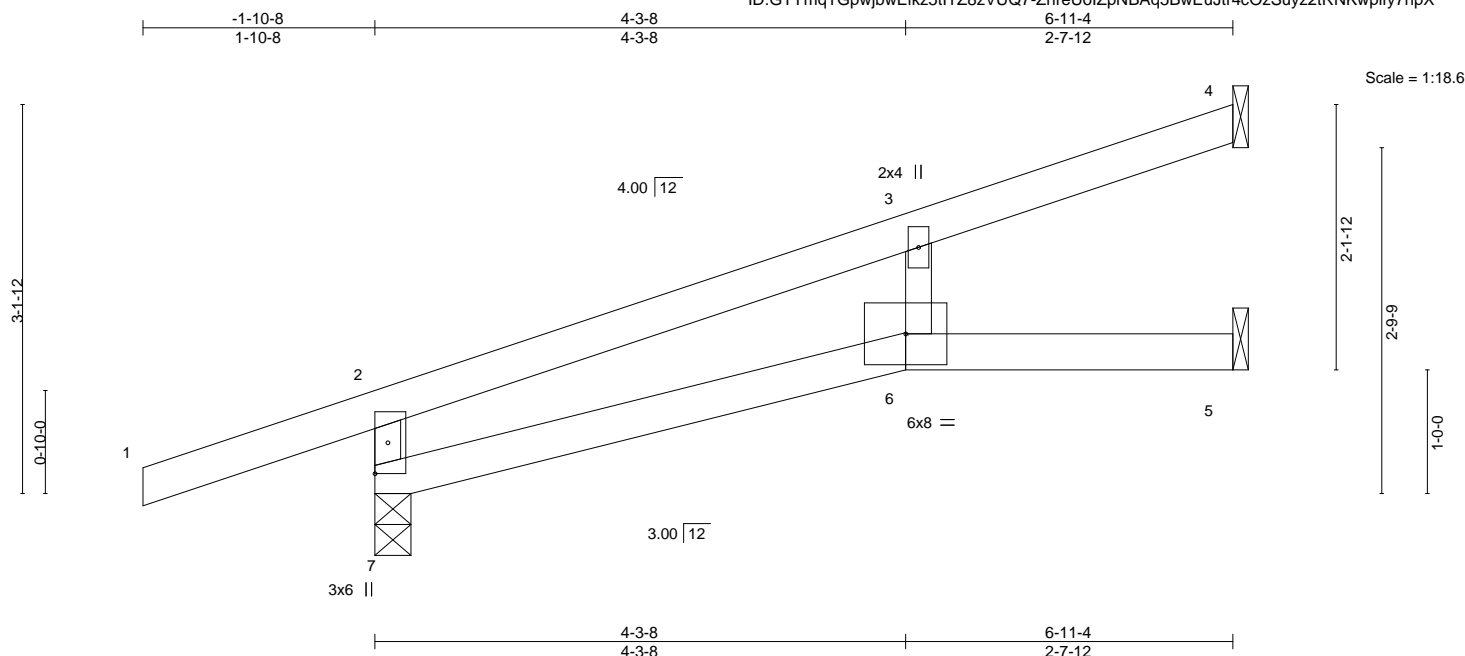

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.50	Vert(LL)	-0.13	6-7	>632	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.53	Vert(CT)	-0.24	6-7	>334	240	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.06	4	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.10	6-7	>811	240	
								Weight: 20 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

(size) 7=0-3-8, 4=Mechanical, 5=Mechanical
Max Horz 7=84(LC 4)
Max Uplift 7=66(LC 4), 4=27(LC 8), 5=2(LC 8)
Max Grav 7=463(LC 1), 4=165(LC 1), 5=119(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-7=-360/86

NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 66 lb uplift at joint 7, 27 lb uplift at joint 4 and 2 lb uplift at joint 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063986
210285	J35	Jack-Open	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:13 2020 Page 1

ID:GTymqTGpwbwEikz5tTZ8zVUQ7-2zP0h7JBahJ0SEm7ncq7OH9cGrJVivMbc_gNH5y7npW

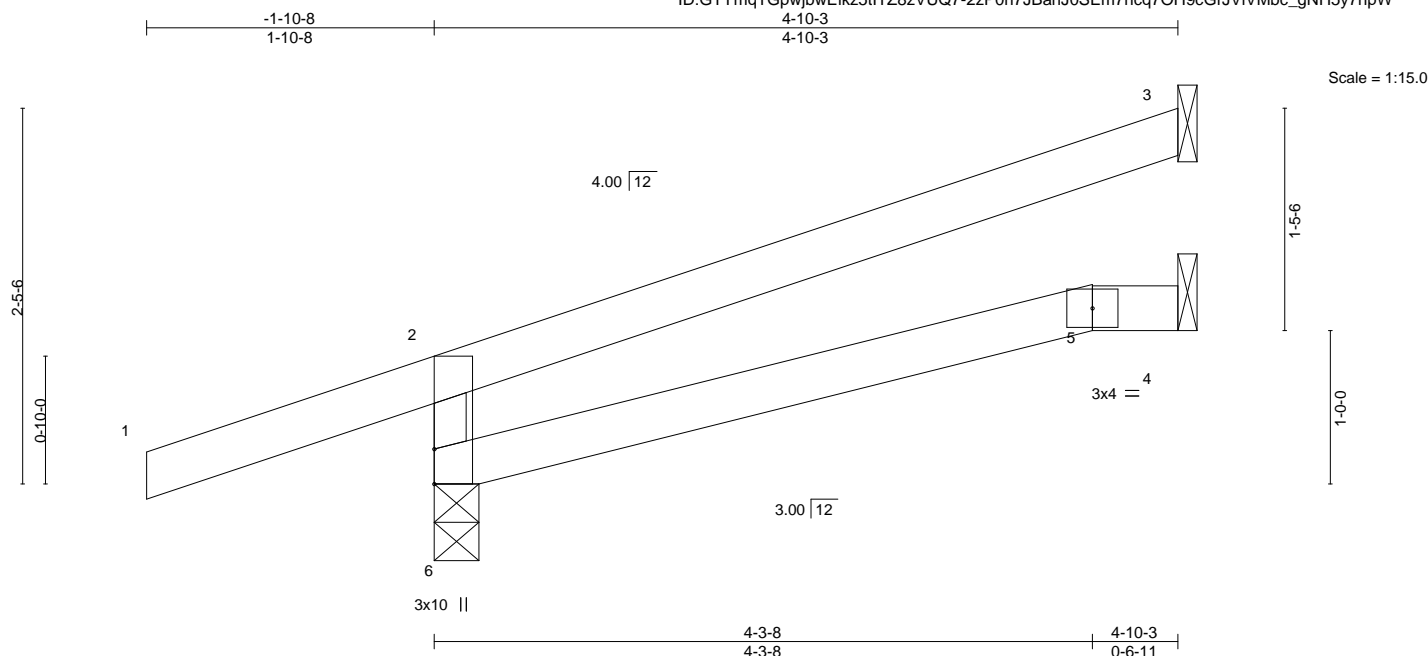


Plate Offsets (X,Y)--		[6:0-2-12,Edge]									
LOADING (psf)		SPACING-		CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.28	Vert(LL)	-0.02	5-6	>999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.19	Vert(CT)	-0.05	5-6	>999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	3	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-R		Wind(LL)	0.01	5-6	>999	Weight: 14 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-10-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.


(size) 6=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 6=89(LC 4)
Max Uplift 6=120(LC 4), 3=67(LC 8)
Max Grav 6=379(LC 1), 3=135(LC 1), 4=87(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-6=-332/157

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 120 lb uplift at joint 6 and 67 lb uplift at joint 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

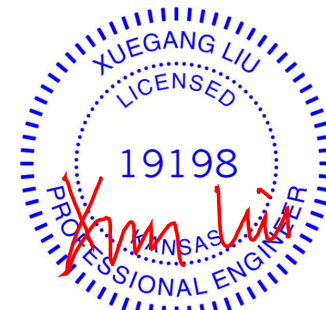

December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063987
210285	J36	Jack-Open	2	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:13 2020 Page 1

ID:GTYmqTGpwbwEikz5tlTZ8zVUQ7-2zP0h7JBahJ0SEm7ncq7OH9cQrMgiVMbc_gNH5y7npW

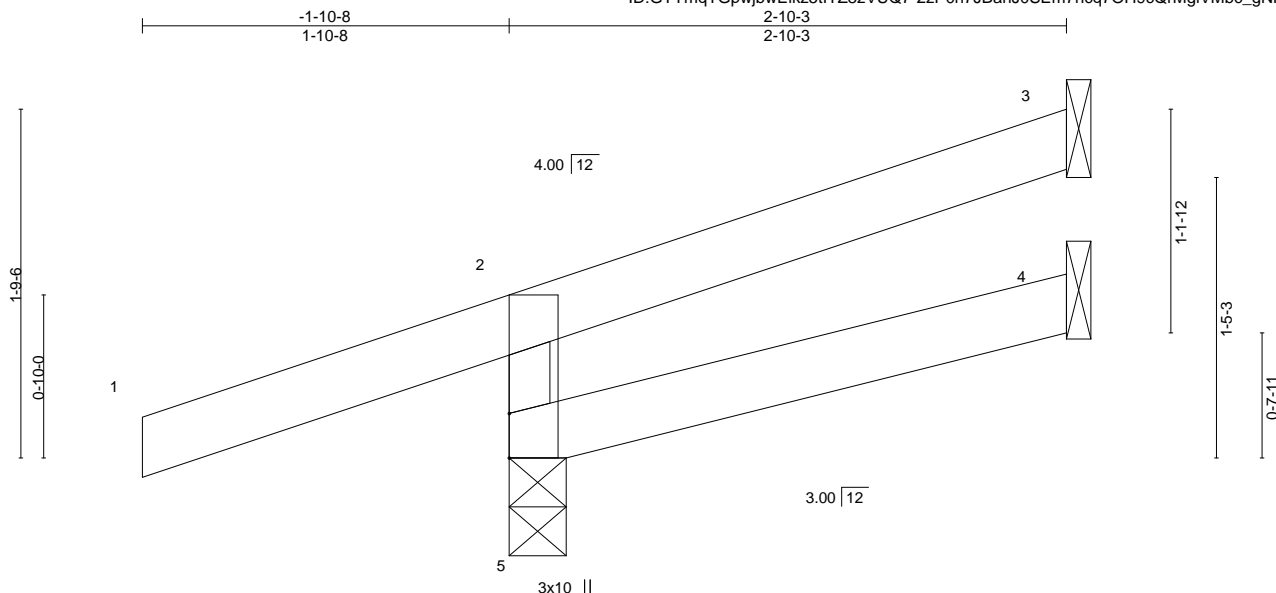

Scale = 1:11.8

Plate Offsets (X,Y)--		[5:0-2-12,Edge]									
LOADING (psf)		SPACING-		CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.27	Vert(LL)	-0.00	4-5	>999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(CT)	-0.00	4-5	>999		
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.00	Horz(CT)	-0.00	3	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-R		Wind(LL)	0.00	5	>999	Weight: 10 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-10-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 3=Mechanical, 4=Mechanical
Max Horz 5=62(LC 4)
Max Uplift 5=120(LC 4), 3=33(LC 8)
Max Grav 5=310(LC 1), 3=52(LC 1), 4=48(LC 3)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-274/139

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 120 lb uplift at joint 5 and 33 lb uplift at joint 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063988
210285	J37	Jack-Closed	5	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:14 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-WAZOuTKqK?Rt4OKJLJLMwVii9FdmQyckqePwqXy7npV

Scale = 1:19.0

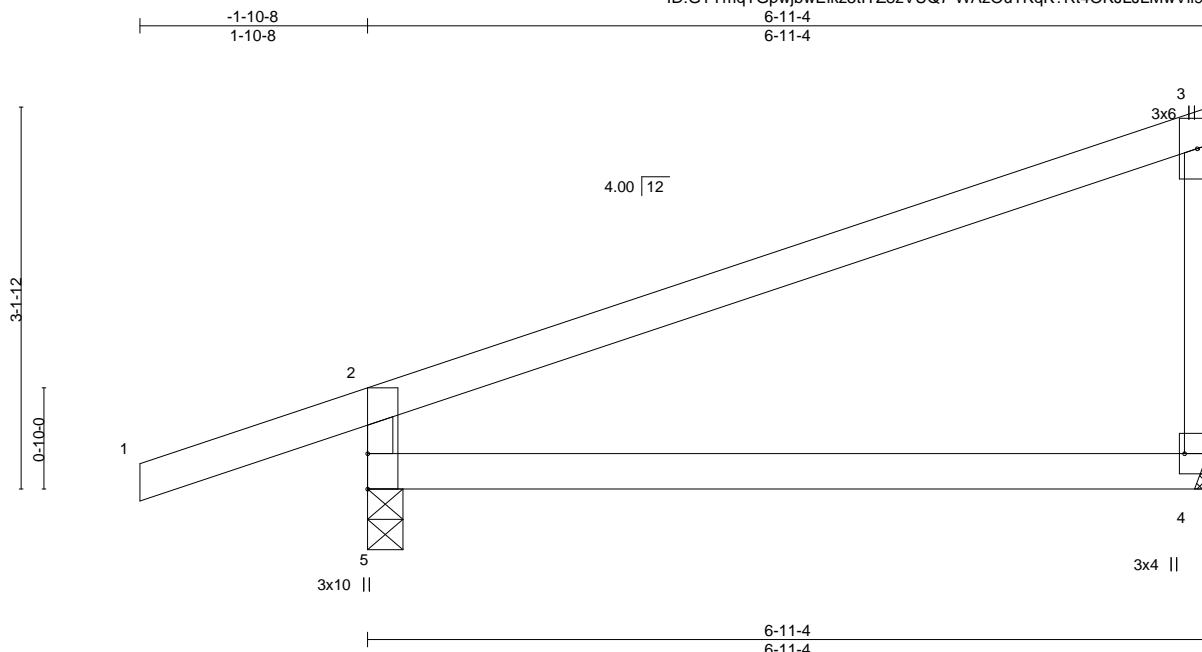


Plate Offsets (X,Y)--		[4:Edge,0-2-8]	
LOADING (psf)		SPACING-	2-0-0
TCLL 25.0		Plate Grip DOL	1.15
TCDL 10.0		Lumber DOL	1.15
BCLL 0.0 *		Rep Stress Incr	YES
BCDL 10.0		Code	IRC2018/TPI2014
		CSI.	
		TC	0.59
		BC	0.38
		WB	0.00
		Matrix-R	
		DEFL.	
		in (loc)	l/defl L/d
		Vert(LL)	-0.08 4-5 >957 360
		Vert(CT)	-0.17 4-5 >465 240
		Horz(CT)	0.00 4 n/a n/a
		Wind(LL)	0.02 4-5 >999 240
		PLATES	GRIP
		MT20	197/144
		Weight: 21 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 5=0-3-8, 4=Mechanical
Max Horz 5=103(LC 5)
Max Uplift 5=-77(LC 4), 4=-19(LC 8)
Max Grav 5=462(LC 1), 4=282(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-406/121

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 77 lb uplift at joint 5 and 19 lb uplift at joint 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063989
210285	J38	Jack-Closed	1	1	Job Reference (optional)	


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:14 2020 Page 1

ID:GTymqTGpwjwEikz5tITZ8zVUQ7-WAzOuTKqK?Rt4OKJLJLMwVimsFdOQyKkqePwqXy7npV

-0-10-8	2-9-8	5-10-3
0-10-8	2-9-8	3-0-11

Scale = 1:15.1

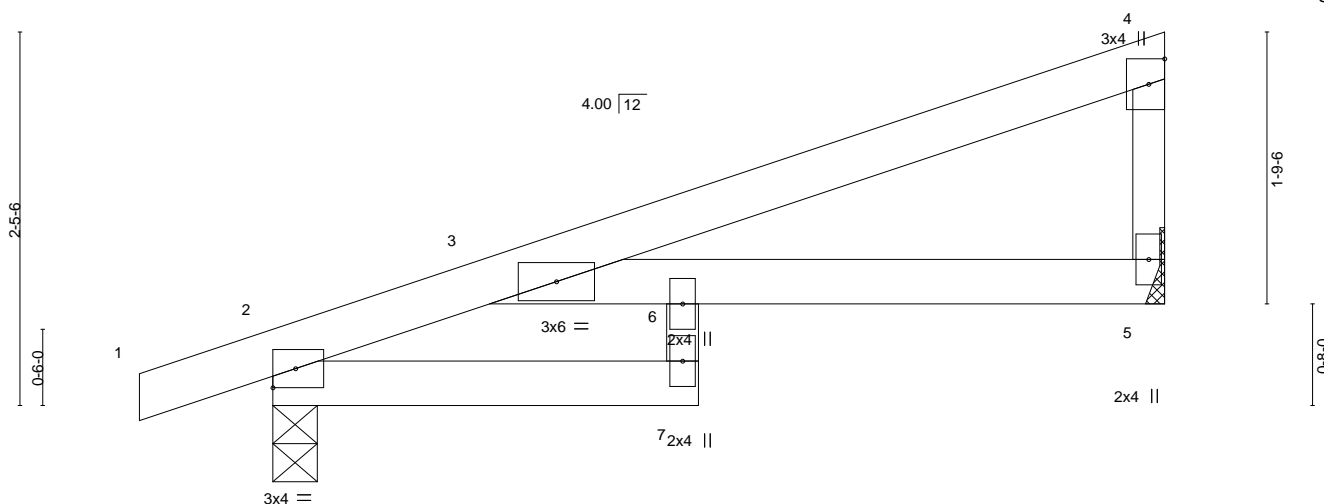

		2-9-8			5-10-3		
		2-9-8			3-0-11		
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.35	Vert(LL)	-0.05 6	>999	360
BCDL 10.0	Lumber DOL	1.15	BC 0.34	Vert(CT)	-0.10 7	>649	240
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.04 5	n/a	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Wind(LL)	0.05 6	>999	240
				PLATES		GRIP	
				MT20		197/144	
				Weight: 18 lb		FT = 10%	

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-10-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 5=Mechanical, 2=0-3-8
Max Horz 2=85(LC 5)
Max Uplift 5=54(LC 8), 2=86(LC 4)
Max Grav 5=245(LC 1), 2=330(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 5 and 86 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

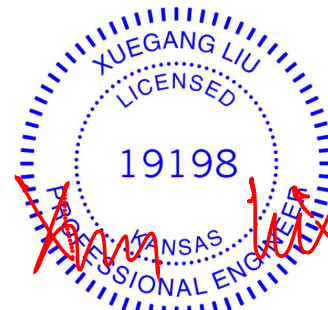

December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss J39	Truss Type Jack-Open	Qty 1	Ply 1	Lot 86 W0	I44063990
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:15 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-_MWm6pLS5lZkhYvVv1sbTiEzTf1T9Pbu3l9TM_y7npU

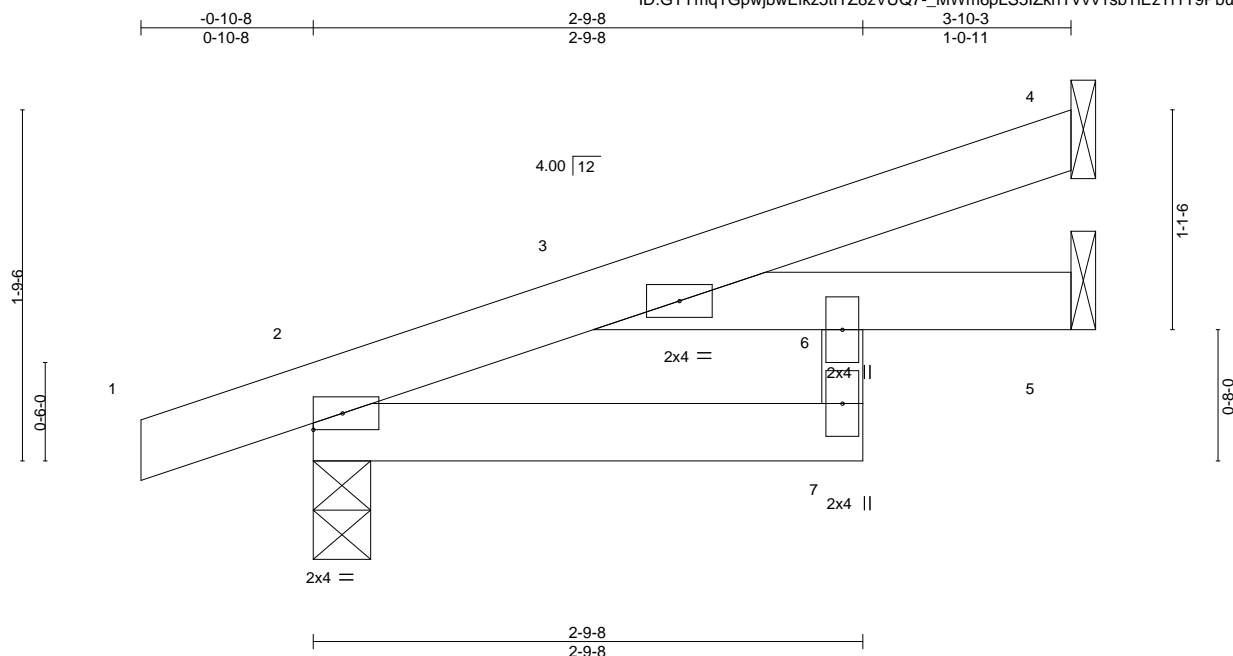

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.23	Vert(LL)	-0.02	3	>999	360	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	-0.04	3	>999	240	197/144
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.02	5	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.02	3	>999	240	
								Weight: 12 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-10-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 4=Mechanical, 2=0-3-8, 5=Mechanical
Max Horz 2=65(LC 4)
Max Uplift 4=54(LC 8), 2=61(LC 4)
Max Grav 4=130(LC 1), 2=257(LC 1), 5=74(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 54 lb uplift at joint 4 and 61 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

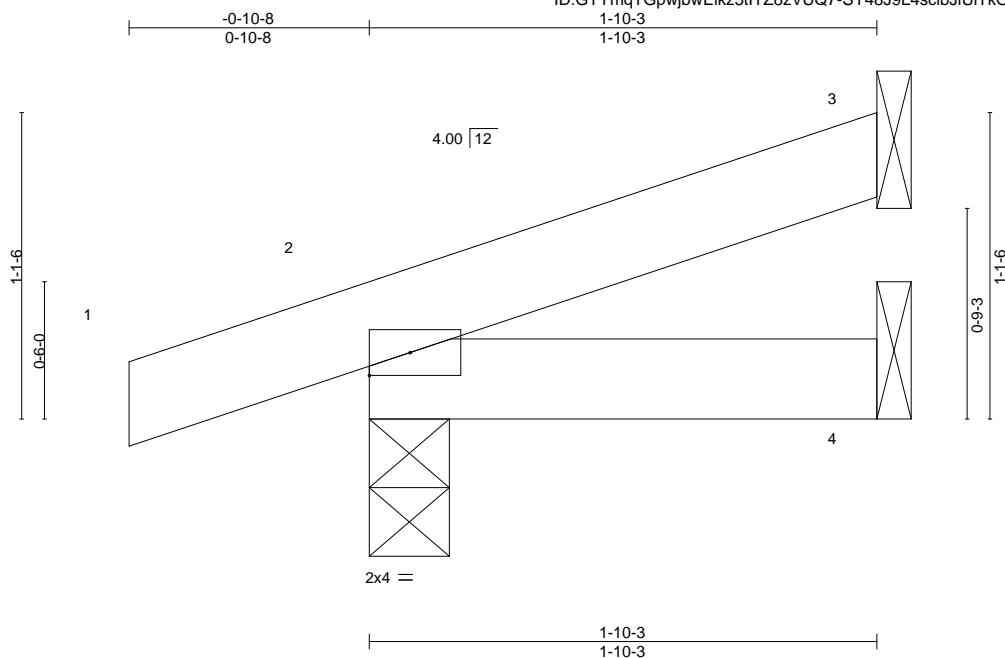

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.05	Vert(LL) -0.00 2	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(CT) -0.00 2-4	>999	240		
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.00 3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-P	Wind(LL) 0.00 2	****	240	Weight: 5 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 1-10-3 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
 Max Horz 2=38(LC 4)
 Max Uplift 3=-28(LC 8), 2=-56(LC 4)
 Max Grav 3=47(LC 1), 2=160(LC 1), 4=36(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 3 and 56 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss J41	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Lot 86 W0	I44063992
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:17 2020 Page 1

ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-wleXXVMidwqSxs3u0Sv3Y7KLTtk6dJLBXceaQsy7npS

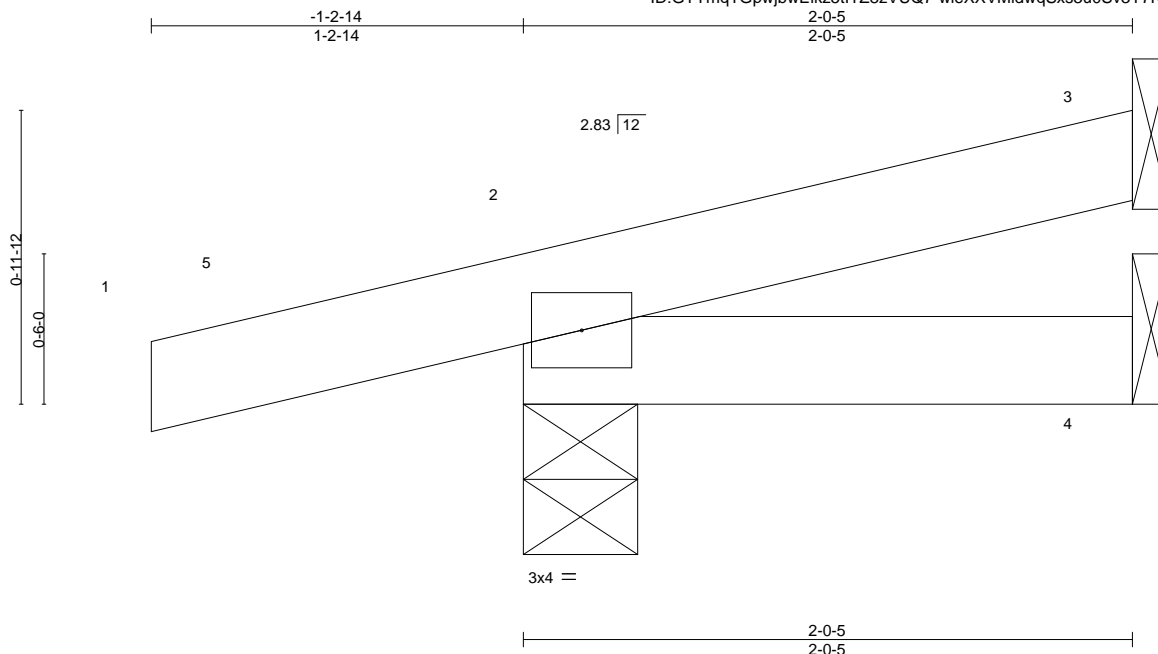

Scale = 1:7.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	-0.00	2	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	2	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	240		
									Weight: 6 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-5 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-9, 4=Mechanical
Max Horz 2=35(LC 6)
Max Uplift 3=16(LC 8), 2=127(LC 6)
Max Grav 3=23(LC 1), 2=65(LC 1), 4=28(LC 3)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 16 lb uplift at joint 3 and 127 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 7 lb down and 2 lb up at -1-2-14, and 7 lb down and 2 lb up at -1-2-14 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Concentrated Loads (lb)
Vert: 1=-11(F=-5, B=-5)
Trapezoidal Loads (plf)
Vert: 1=0(F=35, B=35)-to-5=-8(F=31, B=31), 5=0(F=35, B=35)-to-3=-50(F=10, B=10), 2=-5(F=7, B=7)-to-4=-14(F=3, B=3)



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss J42	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Lot 86 W0	I44063993
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:17 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-wleXXVMidwqSxs3u0Sv3Y7KLPTkDdJLBXceaQsy7npS

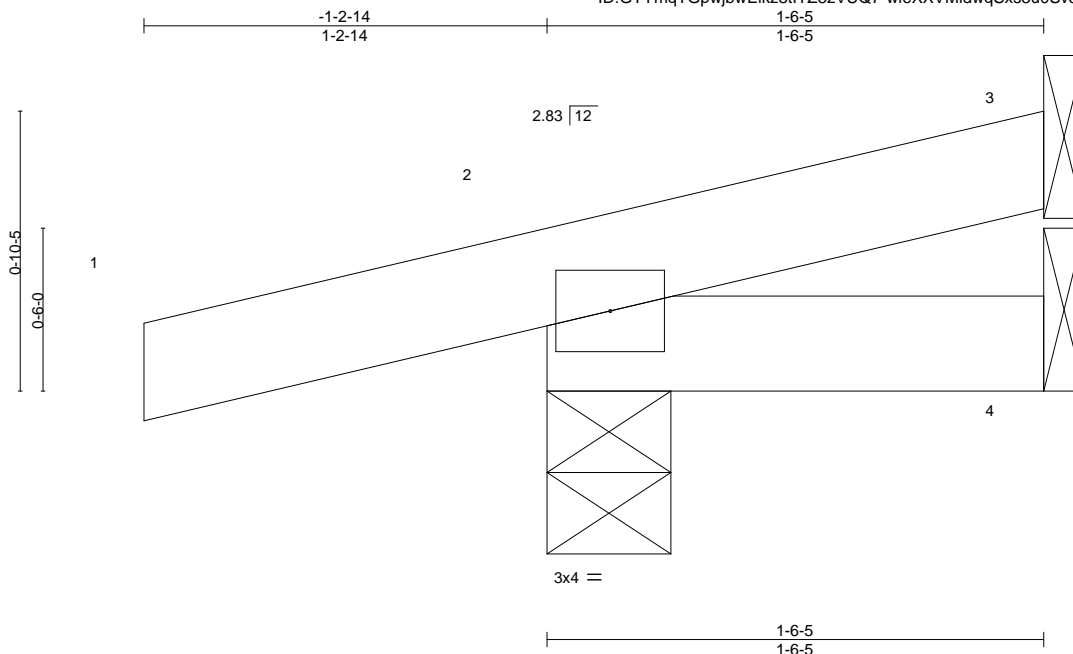

Scale = 1:7.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	-0.00	2	>999	360	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	2	>999	240		
BCLL 0.0 *	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P	Wind(LL)	0.00	2	****	240		
									Weight: 5 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-6-5 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-4-9, 4=Mechanical
Max Horz 2=30(LC 6)
Max Uplift 3=17(LC 8), 2=125(LC 6)
Max Grav 3=27(LC 1), 2=49(LC 9), 4=23(LC 3)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 3 and 125 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 0 lb down and 1 lb up at -1-2-14, and 0 lb down and 1 lb up at -1-2-14 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Concentrated Loads (lb)
Vert: 1=2(F=1, B=1)
Trapezoidal Loads (plf)
Vert: 1=0(F=35, B=35)-to-3=-50(F=10, B=10), 2=-7(F=7, B=7)-to-4=-14(F=3, B=3)



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss J43	Truss Type Jack-Closed	Qty 1	Ply 1	Lot 86 W0	I44063994
Job Reference (optional)						

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:19 2020 Page 1

ID:GTymqTGpwbwEikz5tTZ8zVUQ7-s7mHyBOy9X4AA9DH8sxXdYPhRGNb5DrT_w7hVly7npQ

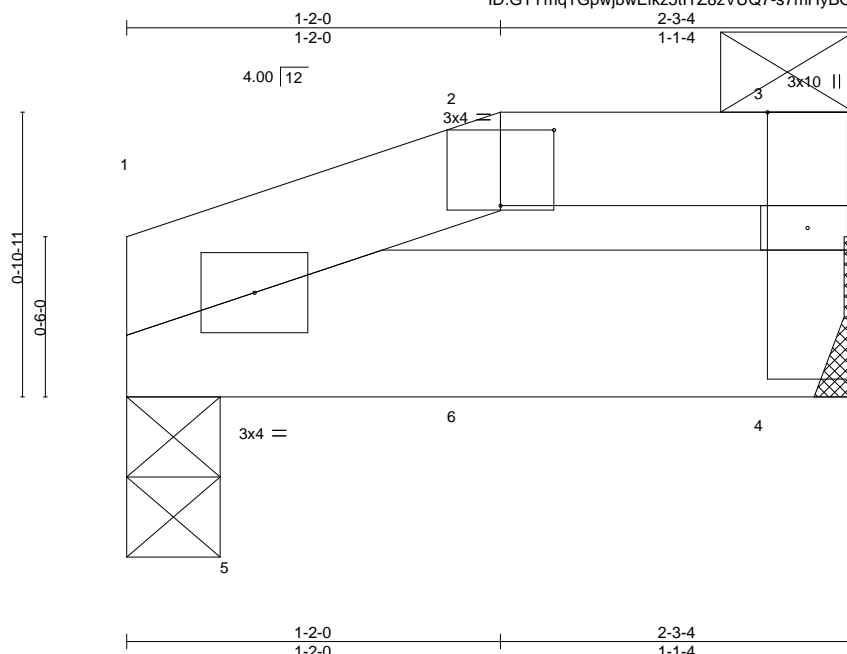

Scale = 1:7.2

Plate Offsets (X,Y)--		[2:0-2-0,0-2-13]										
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL)	-0.00	1-4	>999	360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.15	Vert(CT)	-0.00	1-4	>999	240		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-R		Wind(LL)	0.00	1-4	>999	240	Weight: 8 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF 2100F 1.8E *Except*
2-3: 2x4 SPF No.2
BOT CHORD 2x6 SP 2400F 2.0E
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-3-4 oc purlins, except end verticals, and 2-0-0 oc purlins: 2-3.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 4=Mechanical
Max Horz 1=23(LC 22)
Max Uplift 1=67(LC 4), 4=28(LC 4)
Max Grav 1=1221(LC 1), 4=301(LC 1)


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 67 lb uplift at joint 1 and 28 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 55 lb down and 18 lb up at 1-2-0 on top chord, and 1344 lb down and 66 lb up at 0-5-8, and at 1-2-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-3=-70, 1-4=-20
Concentrated Loads (lb)
Vert: 5=-1344(F)



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063995
210285	K1	Hip Girder	1	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:24 2020 Page 1

ID:GTymqTGpwbwEikz5tTZ8zVUQ7-D5ZA?uS5_3iTGx5ExQXikc6O2H_8mT_C8CqSAyy7npl

Job Reference (optional)



Scale = 1:26.1

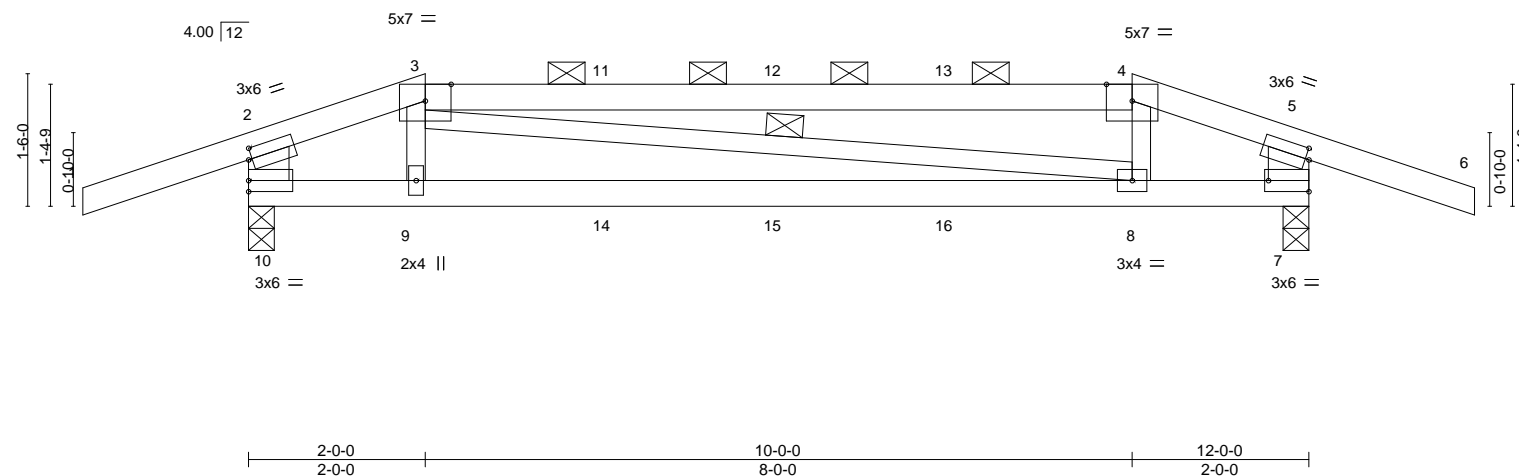


Plate Offsets (X,Y)-- [2:0-0-8,0-1-8], [5:0-0-8,0-1-8], [7:Edge,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.75	Vert(LL)	-0.13 8-9 >999 360	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.64	Vert(CT)	-0.28 8-9 >490 240		
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.07	Horz(CT)	0.01 7 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.08 8-9 >999 240	Weight: 42 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
3-4: 2x4 SPF 2100F 1.8E
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-10,5-7: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-3-8 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 3-8

REACTIONS.

(size) 10=0-3-8, 7=0-3-8
Max Horz 10=11(LC 20)
Max Uplift 10=234(LC 4), 7=234(LC 5)
Max Grav 10=615(LC 21), 7=615(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


TOP CHORD 2-3=-780/169, 3-4=-692/177, 4-5=-769/164, 2-10=-474/154, 5-7=-483/155
BOT CHORD 9-10=-123/727, 8-9=-135/727, 7-8=-123/710

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 234 lb uplift at joint 10 and 234 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 117 lb down and 133 lb up at 2-0-0, 53 lb down and 12 lb up at 4-0-12, 53 lb down and 12 lb up at 6-0-0, and 53 lb down and 12 lb up at 7-11-4, and 117 lb down and 133 lb up at 10-0-0 on top chord, and 26 lb down and 49 lb up at 2-0-0, 8 lb down and 7 lb up at 4-0-12, 8 lb down and 7 lb up at 6-0-0, and 8 lb down and 7 lb up at 7-11-4, and 26 lb down and 49 lb up at 9-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15



December 18,2020

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0
210285	K1	Hip Girder	1	1	I44063995
Job Reference (optional)					

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:24 2020 Page 2
ID:GTYmqTGpwjbwEikz5tITZ8zVUQ7-D5ZA?uS5_3iTGx5ExQXiKc6O2H_8mT_C8CqSAyy7npL

LOAD CASE(S) Standard

- Uniform Loads (plf)
 - Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 5-6=-70, 7-10=-20
- Concentrated Loads (lb)
 - Vert: 3=37(F) 4=37(F) 9=7(F) 8=7(F) 14=7(F) 15=7(F) 16=7(F)




Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063996
210285	K2	Hip	1	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:25 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-hH7YCESjINqJu4gQU72xtpfqbhKEVxjMMsa?iOy7npK



Scale = 1:26.1

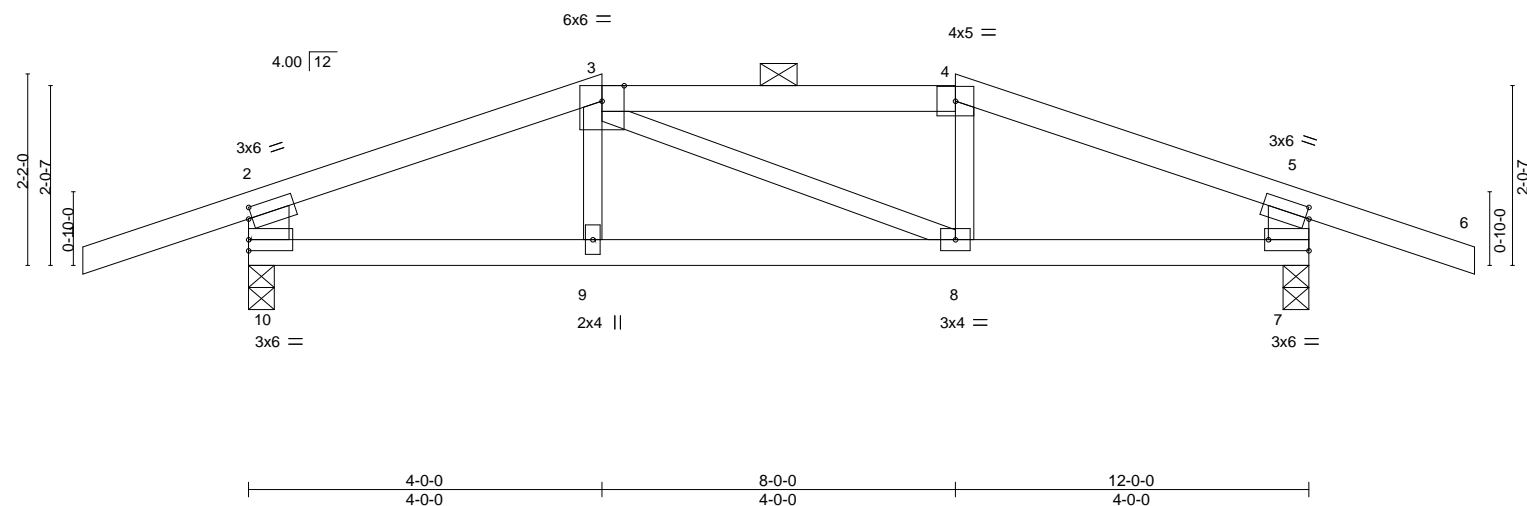


Plate Offsets (X,Y)-- [2:0-0-8,0-1-8], [5:0-0-8,0-1-8], [7:Edge,0-1-8]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.62	Vert(LL)	-0.09	8-9	>999	360	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.52	Vert(CT)	-0.16	8-9	>864	240	
BCLL	0.0 *	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.01	7	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.06	8-9	>999	240	Weight: 40 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x3 SPF No.2 *Except*
2-10,5-7: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-6-15 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 10=0-3-8, 7=0-3-8
Max Horz 10=15(LC 4)
Max Uplift 10=183(LC 4), 7=183(LC 5)
Max Grav 10=667(LC 1), 7=667(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-716/98, 3-4=-616/105, 4-5=-716/97, 2-10=-570/190, 5-7=-570/190
BOT CHORD 9-10=-40/617, 8-9=-43/616, 7-8=-39/617

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 183 lb uplift at joint 10 and 183 lb uplift at joint 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063997
210285	K3	Common	4	1		

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:26 2020 Page 1

ID:GTymqTGpwjwEikz5tITZ8zVUQ7-9ThwQaTLWgyAWEFd2qZAP1BIB5jQENWVbVJZFry7npJ



Scale = 1:25.3

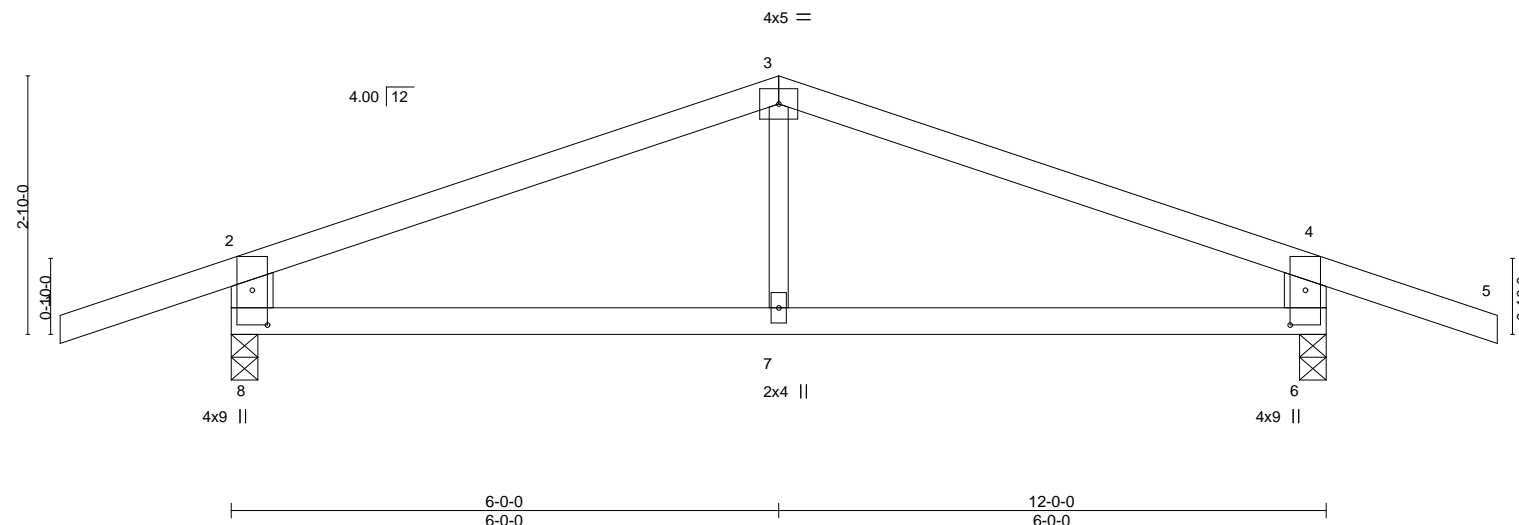


Plate Offsets (X,Y)--		[6:0-4-9,0-2-0], [8:0-4-9,0-2-0]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 25.0	Plate Grip DOL 1.15	TC 0.65	in (loc) l/defl L/d
TCDL 10.0	Lumber DOL 1.15	BC 0.33	Vert(LL) -0.05 7 >999 360
BCLL 0.0 *	Rep Stress Incr YES	WB 0.07	Vert(CT) -0.10 7 >999 240
BCDL 10.0	Code IRC2018/TPI2014	Matrix-R	Horz(CT) 0.01 6 n/a n/a
			Wind(LL) 0.03 7 >999 240
			Weight: 36 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x6 SPF No.2 *Except*
3-7: 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 8=0-3-8, 6=0-3-8
Max Horz 8=-26(LC 9)
Max Uplift 8=-170(LC 4), 6=-170(LC 5)
Max Grav 8=667(LC 1), 6=667(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-653/77, 3-4=-653/77, 2-8=-587/202, 4-6=-587/202
BOT CHORD 7-8=-13/542, 6-7=-13/542

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 170 lb uplift at joint 8 and 170 lb uplift at joint 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44063998
210285	K4	Common Girder	1	2	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:27 2020 Page 1

ID:GTymqTGpwbwEikz5tlTZ8zVUQ7-dgFJdwUzH_417OqpcY4PyEkySV3fzjHfq936nHy7npl

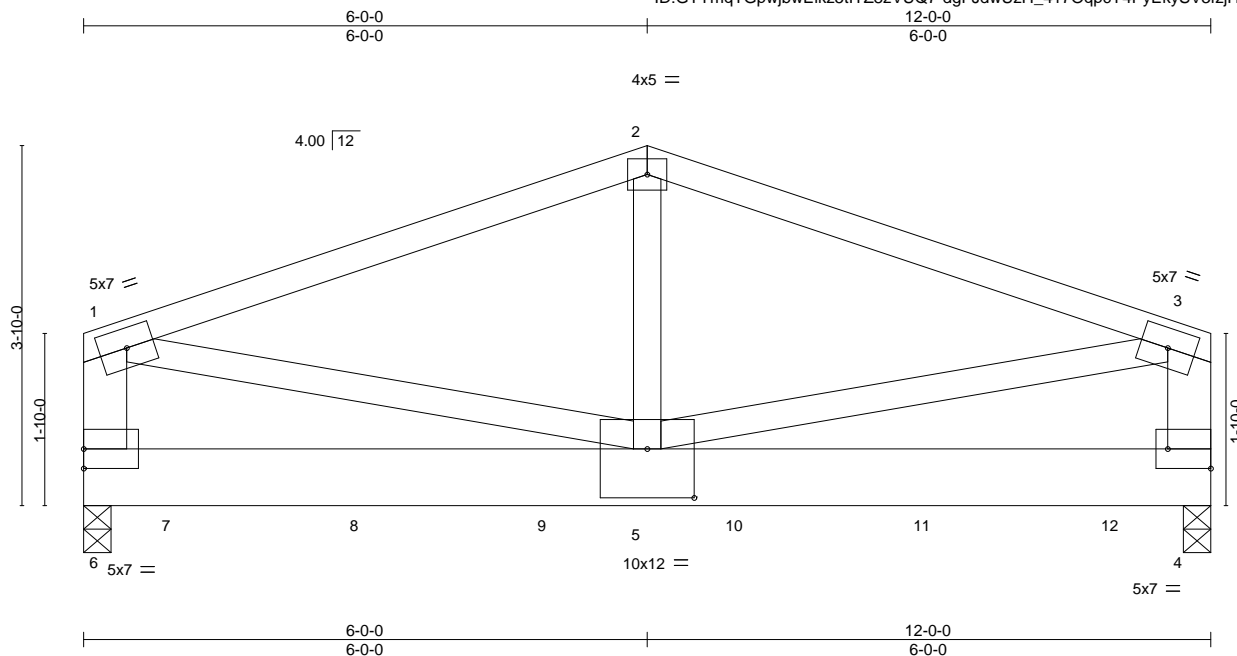

Scale = 1:24.5

Plate Offsets (X, Y)--		[4:Edge,0-2-8], [5:0-6-0,0-6-4]							
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	L/defl	L/d
TCLL	25.0	Plate Grip DOL	1.15	TC	0.49	Vert(LL)	-0.05 4-5	>999	360
TCDL	10.0	Lumber DOL	1.15	BC	0.33	Vert(CT)	-0.09 4-5	>999	240
BCLL	0.0 *	Rep Stress Incr	NO	WB	0.48	Horz(CT)	0.00 4	n/a	n/a
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S		Wind(LL)	0.03 4-5	>999	240
						PLATES		GRIP	
						MT20		197/144	
						Weight: 143 lb		FT = 10%	

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x8 SP DSS
WEBS 2x4 SPF No.2 *Except*
1-6,3-4: 2x6 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-2-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=0-3-8 (req. 0-3-13), 4=0-3-8 (req. 0-3-13)
Max Horz 6=-30(LC 6)
Max Uplift 6=-158(LC 4), 4=-162(LC 5)
Max Grav 6=4848(LC 1), 4=4852(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-4925/171, 2-3=-4925/171, 1-6=-2714/119, 3-4=-2714/119
BOT CHORD 5-6=-44/790, 4-5=-52/791
WEBS 2-5=-54/2755, 1-5=-98/3937, 3-5=-97/3936

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-7-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope); cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- WARNING: Required bearing size at joint(s) 6, 4 greater than input bearing size.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 158 lb uplift at joint 6 and 162 lb uplift at joint 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1444 lb down and 54 lb up at 1-0-0, 1441 lb down and 56 lb up at 3-0-0, 1443 lb down and 56 lb up at 5-0-0, 1443 lb down and 56 lb up at 7-0-0, and 1443 lb down and 56 lb up at 9-0-0, and 1449 lb down and 59 lb up at 11-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

Continued on page 2



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0
210285	K4	Common Girder	1	2	I44063998
					Job Reference (optional)

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:27 2020 Page 2
ID:GTYmqTGpwjbwEikz5tlTZ8zVUQ7-dgFJdwUzH_417OqpcY4PyEkySV3fzjHfq936nHy7npl

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)
 - Vert: 1-2=-70, 2-3=-70, 4-6=-20
- Concentrated Loads (lb)
 - Vert: 7=-1444(B) 8=-1441(B) 9=-1443(B) 10=-1443(B) 11=-1443(B) 12=-1449(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job Reference (optional)

Scale = 1:21.8




BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 5-10-6 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

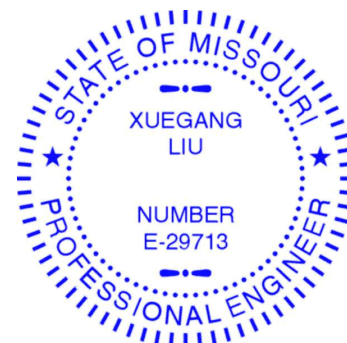

December 18.2020



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0
210285	LAY2	GABLE	1	1	144064000

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:28 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-6sphqGVc11CulYP?AFbeVSH8quR0iEgo2pofJjy7npH

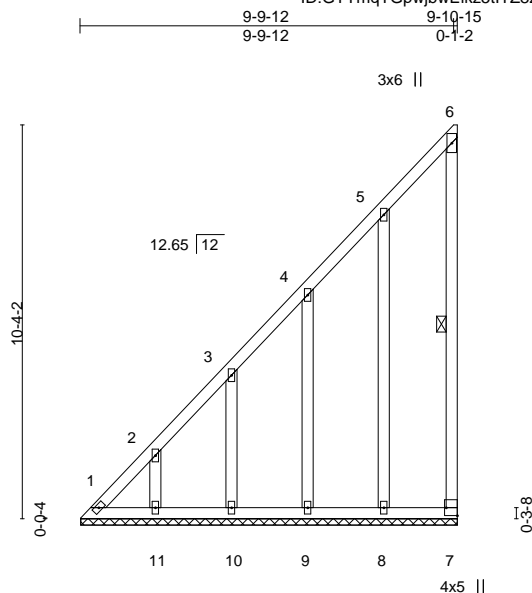

Scale = 1:60.5

Plate Offsets (X,Y)--		[7:Edge,0-3-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 25.0	Plate Grip DOL	1.15	TC 0.45
TCDL 10.0	Lumber DOL	1.15	BC 0.19
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.22
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S
			DEFL.
			in (loc) l/defl L/d
			Vert(LL) n/a - n/a 999
			Vert(CT) n/a - n/a 999
			Horz(CT) -0.00 7 n/a n/a
			PLATES
			MT20
			GRIP
			197/144
			Weight: 60 lb FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 6-7

REACTIONS.

All bearings 9-10-11.
(lb) - Max Horz 1=395(LC 5)
Max Uplift All uplift 100 lb or less at joint(s) except 1=165(LC 6), 7=147(LC 7), 11=125(LC 8), 10=126(LC 8), 9=120(LC 8), 8=136(LC 8)
Max Grav All reactions 250 lb or less at joint(s) 7, 11, 10, 9, 8 except 1=313(LC 5)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-433/287, 2-3=-369/242, 3-4=-299/194, 4-5=-279/187

NOTES-

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 165 lb uplift at joint 1, 147 lb uplift at joint 7, 125 lb uplift at joint 11, 126 lb uplift at joint 10, 120 lb uplift at joint 9 and 136 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss LAY3	Truss Type GABLE	Qty 1	Ply 1	Lot 86 W0 Job Reference (optional)	I44064001
---------------	---------------	---------------------	----------	----------	---------------------------------------	-----------

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:29 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-a2N32cWEobKINi_Cjz6t1fpPklqvRksyHTYDsAy7npG

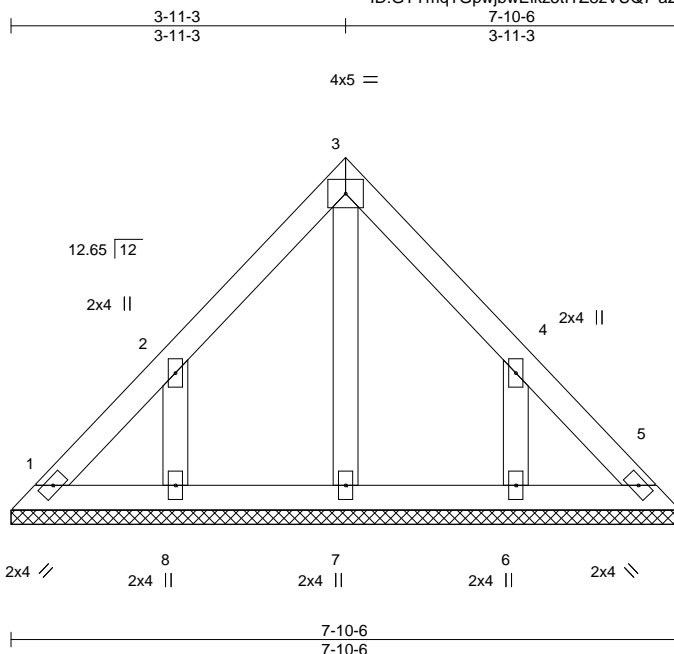

Scale = 1:27.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 28 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 7-10-6.
(lb) - Max Horz 1=100(LC 4)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=142(LC 8), 6=142(LC 9)
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7, 8, 6

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=142, 6=142.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Lot 86 W0	I44064002
210285	LAY4	Lay-In Gable	2	1	Job Reference (optional)	

Wheeler Lumber, Waverly, KS - 66871,


8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:30 2020 Page 1

ID:GTYmqTGpwjwEikz5tITZ8zVUQ7-2FwRFyWsZvSc_sZOHge6atMZqiAZA9B5W7HmOcy7npF



4x5 =

Scale = 1:54.7

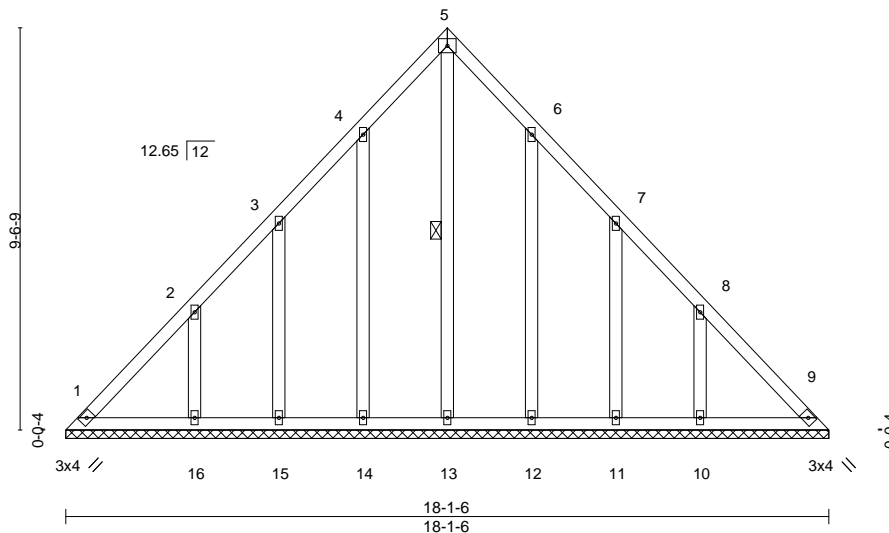

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.15	Horz(CT)	0.01	9	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 92 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 5-13

REACTIONS.


All bearings 18-1-6.
(lb) - Max Horz 1=244(LC 6)
Max Uplift All uplift 100 lb or less at joint(s) 1, 9 except 14=128(LC 8), 15=110(LC 8), 16=175(LC 8),
12=126(LC 9), 11=111(LC 9), 10=175(LC 9)
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 13, 14, 15, 12, 11 except 16=287(LC 15), 10=287(LC 16)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-300/204, 8-9=-262/147

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9 except (jt=lb) 14=128, 15=110, 16=175, 12=126, 11=111, 10=175.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss LAY6	Truss Type GABLE	Qty 1	Ply 1	Lot 86 W0 144064003
---------------	---------------	---------------------	----------	----------	------------------------

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:31 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-WRUpTHXUKDaTc?8arO9L64vk16VGveJEIn1Kw2y7npE

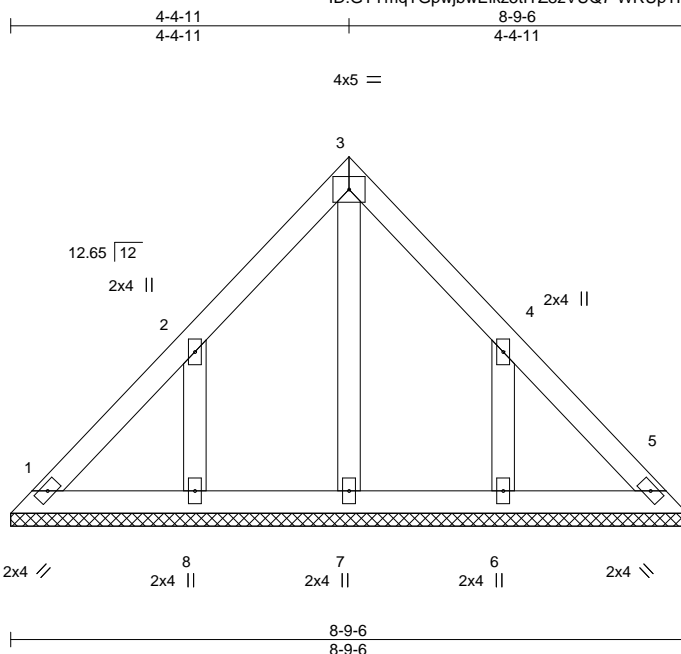

Scale = 1:29.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 33 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

All bearings 8-9-6.
(lb) - Max Horz 1=113(LC 4)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=157(LC 8), 6=157(LC 9)
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7 except 8=251(LC 15), 6=251(LC 16)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=157, 6=157.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss LAY7	Truss Type GABLE	Qty 1	Ply 1	Lot 86 W0	I44064004
---------------	---------------	---------------------	----------	----------	-----------	-----------

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:32 2020 Page 1

ID:GTymqTGpwjwEikz5tTZ8zVUQ7-_d2CgdY65WjKE9jmP5gaflRvRW6e4wOzRmtSUy7npD

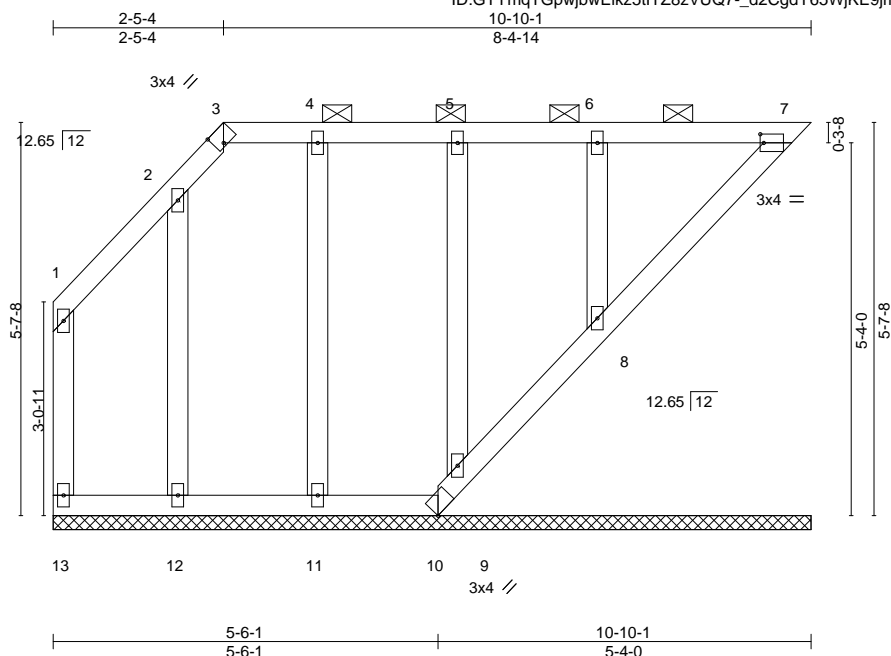

Scale = 1:33.0

Plate Offsets (X,Y)-- [3:0-1-7,Edge], [7:0-0-10,0-1-8]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	n/a	-	n/a 999
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a 999
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.07	Horz(CT)	-0.00	7	n/a n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S				
				PLATES	GRIP		
				MT20	197/144		
				Weight: 51 lb	FT = 10%		

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals, and 2'-0-0 oc purlins (6'-0-0 max.): 3-7.
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing, Except: 6'-0-0 oc bracing: 7-8.



REACTIONS.

All bearings 10-10-1.
(lb) - Max Horz 13=121(LC 5)
Max Uplift All uplift 100 lb or less at joint(s) 13, 10, 12, 11, 9, 8 except 7=110(LC 5)
Max Grav All reactions 250 lb or less at joint(s) 13, 7, 10, 12, 11, 9 except 8=262(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-6-0 tall by 2'-0-0 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13, 10, 12, 11, 9, 8 except (jt=lb) 7=110.
- 9) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 7, 9, 8.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

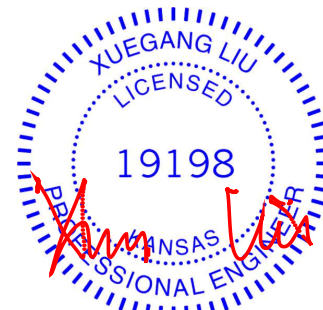

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss LAY8	Truss Type GABLE	Qty 1	Ply 1	Lot 86 W0	I44064005
---------------	---------------	---------------------	----------	----------	-----------	-----------

Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:33 2020 Page 1

ID:GTymqTGpwbwEikz5tITZ8zVUQ7-SqcauzZksqrBsJHzypBpBV_4BvBNNYSXC5WQ?xy7npC

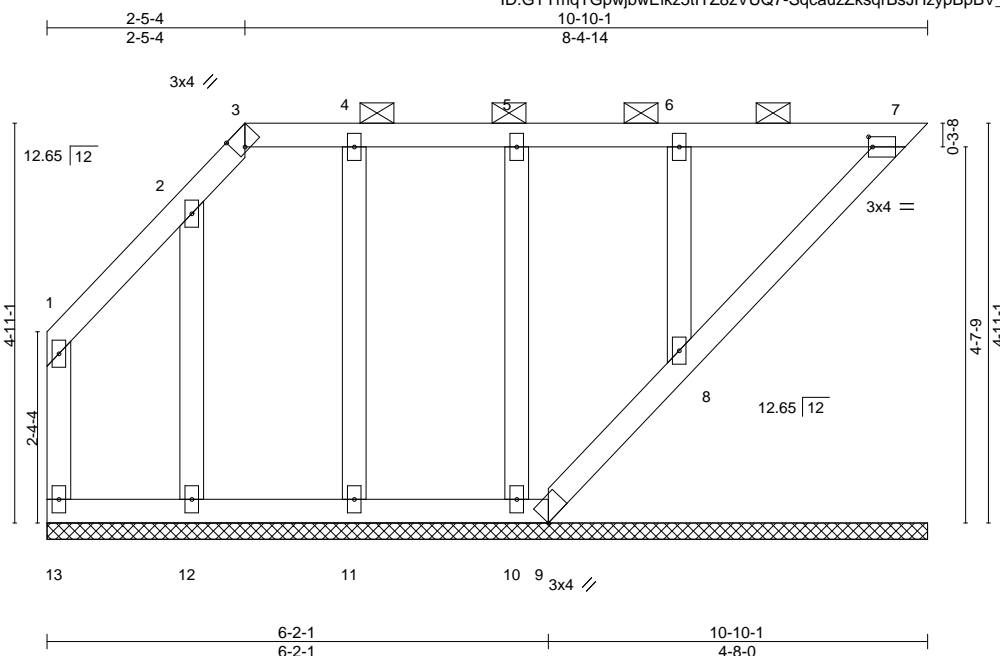

Scale = 1:28.4

Plate Offsets (X,Y)--		[3:0-1-7,Edge], [7:0-0-10,0-1-8]	
LOADING (psf)	SPACING-	2-0-0	CSI.
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09
TCDL 10.0	Lumber DOL	1.15	BC 0.05
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.06
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S
DEFL.	in (loc)	l/defl	L/d
Vert(LL)	n/a	-	n/a
Vert(CT)	n/a	-	n/a
Horz(CT)	-0.00	7	n/a
PLATES	GRIP		
MT20	197/144		
Weight: 48 lb		FT = 10%	

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-7.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 7-8.


REACTIONS.

All bearings 10-10-1.
(lb) - Max Horz 13=106(LC 5)
Max Uplift All uplift 100 lb or less at joint(s) 13, 9, 12, 11, 10, 8 except 7=100(LC 5)
Max Grav All reactions 250 lb or less at joint(s) 13, 7, 9, 12, 11, 10 except 8=261(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13, 9, 12, 11, 10, 8 except (jt=lb) 7=100.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 7, 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Wheeler Lumber, Waverly, KS - 66871, 8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:33 2020 Page 1
ID:GTYmqTGpwbwEikz5tITZ8zVUQ7-SqcauzZksqrBsJHzypBpBV_38v9nNYuXC5WQ?xy7npC
3-10-8 4-9-8 8-8-0
3-10-8 0-11-0 3-10-8
Scale = 1:16.2

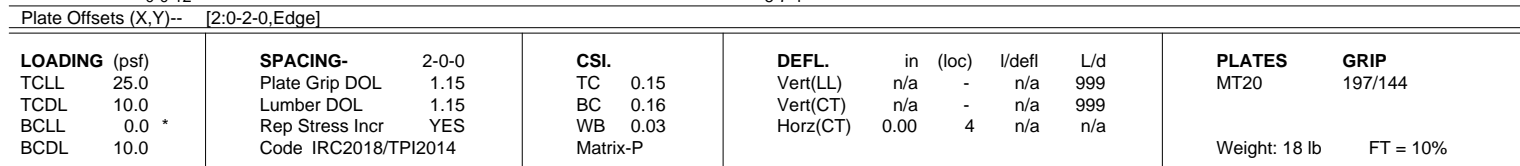


REACTIONS. (size) 1=8-6-8, 4=8-6-8, 5=8-6-8
 Max Horz 1=-16(LC 13)
 Max Uplift 1=-80(LC 4), 4=-72(LC 4)
 Max Grav 1=271(LC 1), 4=257(LC 1), 5=172(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-2=-478/191, 2-3=-433/197, 3-4=-479/200
BOT CHORD	1-5=-171/432, 4-5=-174/441

- NOTES-**

 - 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4.
 - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

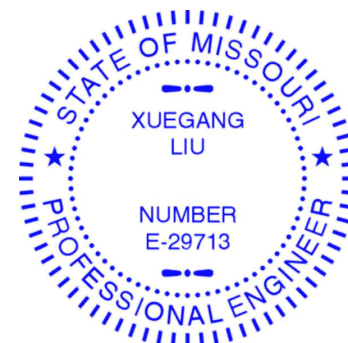


December 18, 2020

Job 210285	Truss V2	Truss Type Valley	Qty 1	Ply 1	Lot 86 W0 Job Reference (optional)	I44064007
---------------	-------------	----------------------	----------	----------	---------------------------------------	-----------


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:34 2020 Page 1

ID:GTymqTGpwbwEikz5tTZ8zVUQ7-w0Ay5JZMd8z2Tts9WWi2kjXGqJWA6?YhRIF_XNy7npB



Scale = 1:8.6

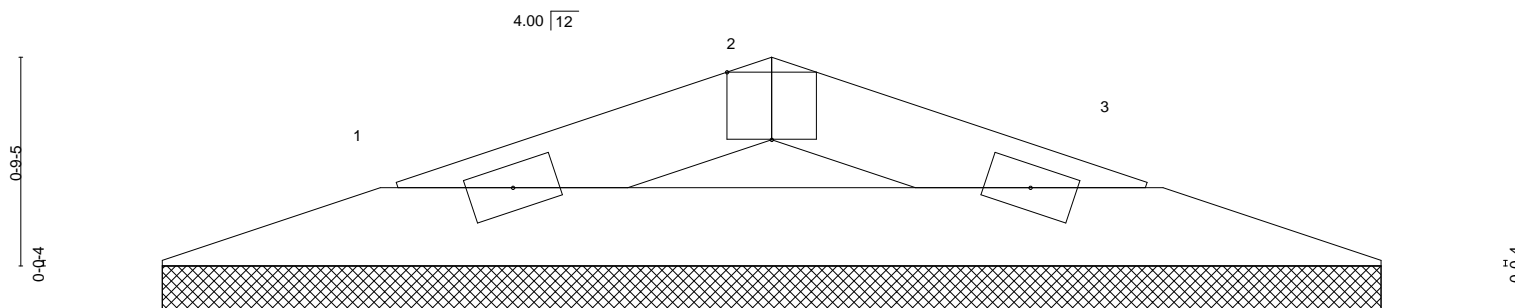

0-0-12 0-0-12		4-8-0 4-7-4	
Plate Offsets (X,Y)--		[2:0-2-0,Edge]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 25.0	Plate Grip DOL 1.15	TC 0.03	in (loc) l/defl L/d
TCDL 10.0	Lumber DOL 1.15	BC 0.08	Vert(LL) n/a - n/a 999
BCLL 0.0 *	Rep Stress Incr YES	WB 0.00	Vert(CT) n/a - n/a 999
BCDL 10.0	Code IRC2018/TPI2014	Matrix-P	Horz(CT) 0.00 3 n/a n/a
		PLATES MT20	
		GRIP 197/144	
		Weight: 9 lb FT = 10%	

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.



REACTIONS.

(size) 1=4-6-8, 3=4-6-8
Max Horz 1=8(LC 8)
Max Uplift 1=18(LC 4), 3=18(LC 5)
Max Grav 1=125(LC 1), 3=125(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

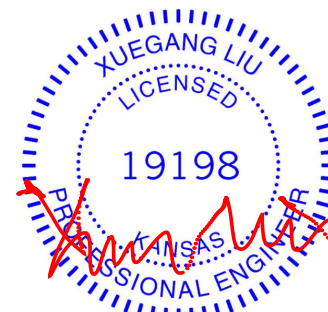

December 18,2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Scale = 1:21.4

LUMBER-

BRACING-


Structural wood sheathing directly applied or 6-0-0 oc purlins.
Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=13-4-8, 3=13-4-8, 4=13-4-8
 Max Horz 1=34(LC 8)
 Max Uplift 1=-50(LC 4), 3=-54(LC 9), 4=-54(LC 4)
 Max Grav 1=234(LC 21), 3=234(LC 22), 4=592(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4--417/124

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 210285	Truss V4	Truss Type Valley	Qty 1	Ply 1	Lot 86 W0	I44064009
---------------	-------------	----------------------	----------	----------	-----------	-----------


Wheeler Lumber, Waverly, KS - 66871,

8.430 s Nov 30 2020 MiTek Industries, Inc. Fri Dec 18 08:20:35 2020 Page 1

ID:GTymqTGpwbwEikz5tlTZ8zVUQ7-OCkKlfa?OR5v5dRL4DDHHw3O1jsorS1qf?X3py7npA



Scale = 1:17.2

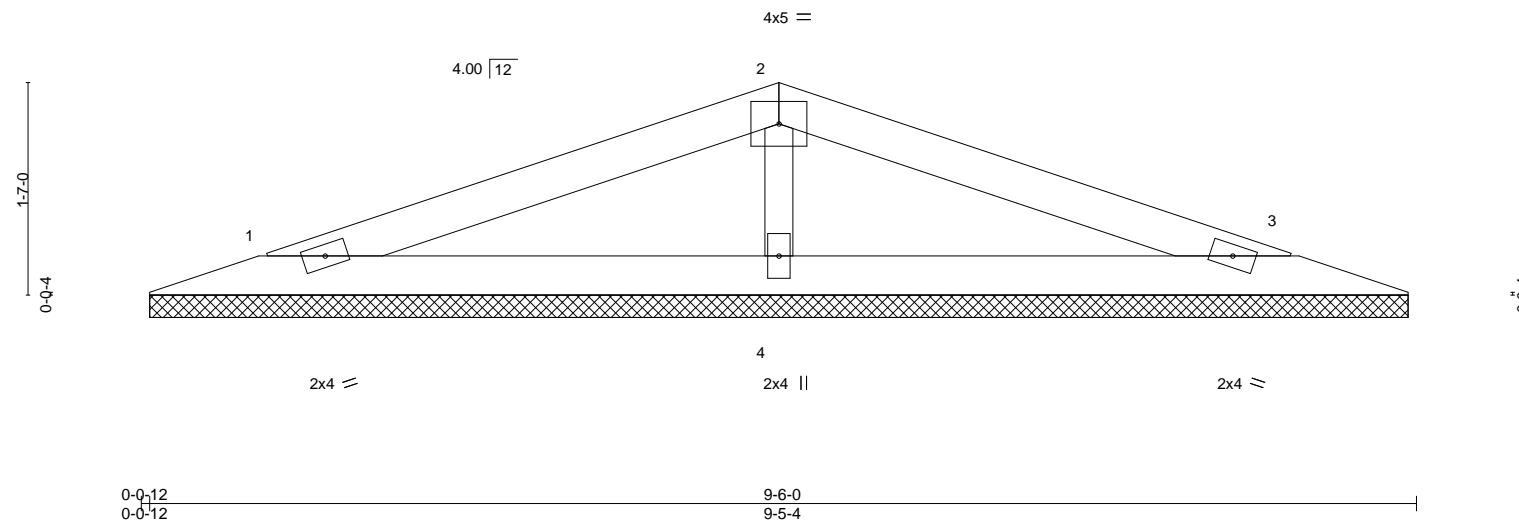

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.19	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0 *	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 21 lb	FT = 10%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x3 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.


(size) 1=9-4-8, 3=9-4-8, 4=9-4-8
Max Horz 1=23(LC 8)
Max Uplift 1=33(LC 4), 3=35(LC 9), 4=35(LC 4)
Max Grav 1=154(LC 21), 3=154(LC 22), 4=388(LC 1)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-4=-273/81

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



December 18, 2020

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Symbols

PLATE LOCATION AND ORIENTATION

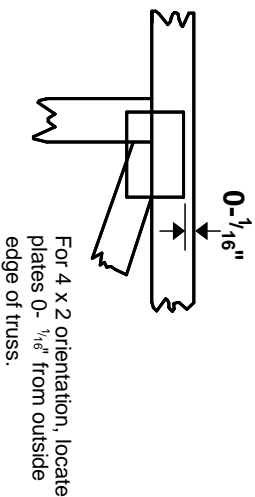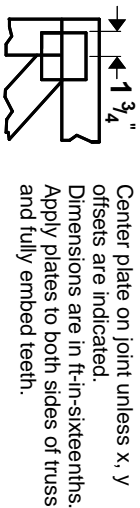


* Plate location details available in **MiTek 20/20** software or upon request.


PLATE SIZE



LATERAL BRACING LOCATION




BEARING

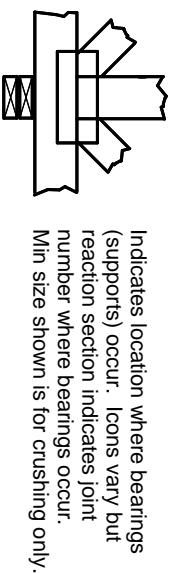

Industry Standards:
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

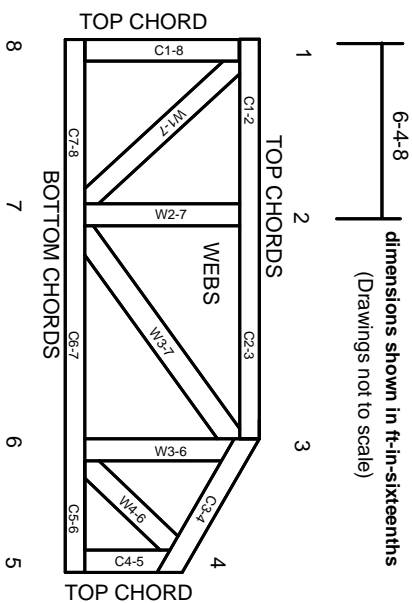

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:
ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.