



MiTek USA, Inc.
16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Re: 2685114
Summit/88 MANOR

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Valley Center).

Pages or sheets covered by this seal: I45087388 thru I45087436

My license renewal date for the state of Missouri is December 31, 2021.

Missouri COA: Engineering 001193



March 8, 2021

Sevier, Scott ,Engineer

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

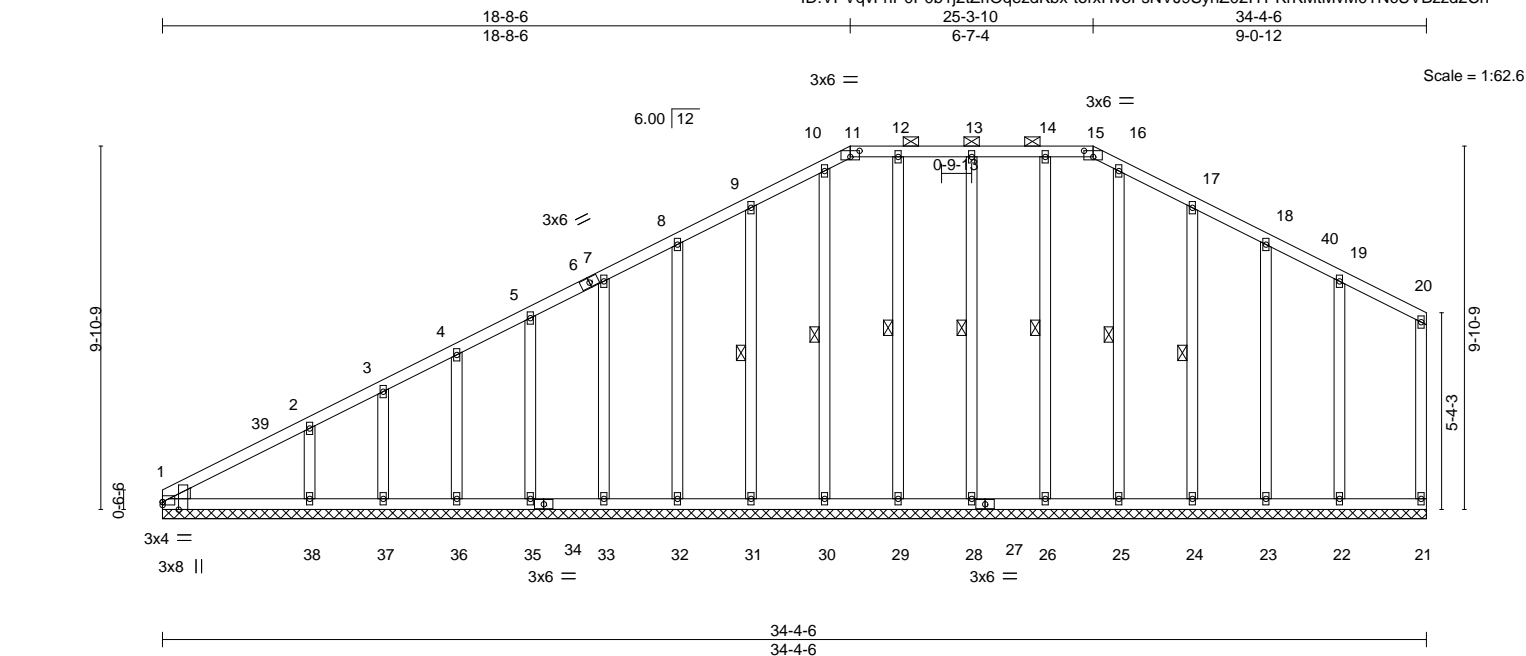


Plate Offsets (X,Y)-- [1:0-2-7,Edge], [1:0-0-0,0-1-0], [11:0-3-0,0-2-0], [15:0-3-0,0-2-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.20	Vert(LL)	n/a - n/a 999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.10	Vert(CT)	n/a - n/a 999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.13	Horz(CT)	-0.00 21 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S				Weight: 205 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2
WEDGE
Left: 2x4 SPF No.2

BRACING-

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 11-15.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 10-30, 9-31, 12-29, 13-28, 14-26, 16-25, 17-24

REACTIONS.

INS. All bearings 34-4-6.
(lb) - Max Horz 1=243(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 21, 1, 30, 31, 32, 33, 35, 36, 37,
29, 28, 26, 24, 23, 22 except 38=118(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 21, 1, 30, 31, 32, 33, 35, 36, 37,
29, 28, 26, 25, 24, 23, 22 except 38=368(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 9-10=-145/259, 10-11=-137/252, 11-12=-131/257, 12-13=-131/257, 13-14=-131/257,
14-15=-131/257, 15-16=-137/252, 16-17=-145/259

WEBS 2-38=-273/199

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-0-0 to 3-0-0, Exterior(2N) 3-0-0 to 18-8-6, Corner(3R) 18-8-6 to 21-8-6, Exterior(2N) 21-8-6 to 25-3-10, Corner(3R) 25-3-10 to 28-3-10, Exterior(2N) 28-3-10 to 34-2-10 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) Provide adequate drainage to prevent water ponding.
- 5) All plates are 2x4 MT20 unless otherwise indicated.
- 6) Gable requires continuous bottom chord bearing.
- 7) Gable studs spaced at 2-0-0 oc.
- 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 21, 1, 30, 31, 32, 33, 35, 36, 37, 29, 28, 26, 24, 23, 22 except (jt=lb) 38=118.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 8, 2021



WARNING – Velly design parameters are listed ONLY on this and INCLUDED WITHIN KEY REFERENCE 1: AISC M14-15 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f, 701f, 702f, 703f, 704f, 705f, 706f,



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	145087389
2685114	A2	Piggyback Base	5	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:41 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-L_PJUF4tdhdAncXz6jZX4csvUm3VedcccGD2jPzd2Cm

Job Reference (optional)

2-4-5 7-9-11 13-3-0 18-8-6 23-4-0 25-3-10 29-10-5 31-11-8 34-4-6 34-8-0
2-4-5 5-5-6 5-5-6 5-5-6 4-7-10 1-11-10 4-6-11 2-1-3 2-4-14 0-3-10

Scale = 1:65.4

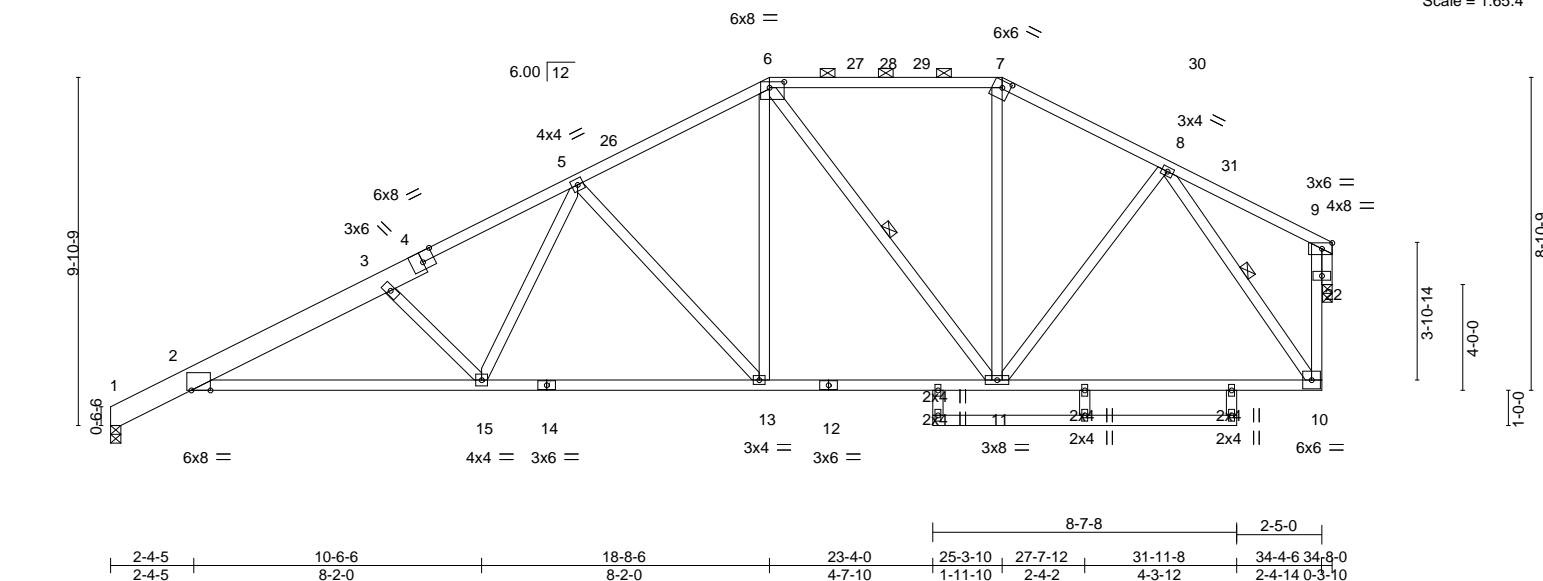

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.68	Vert(LL)	-0.28 15-25	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.75	Vert(CT)	-0.55 15-25	>743	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.94	Horz(CT)	0.19 22	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 185 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 1-4: 2x8 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (4-1-5 max.): 6-7.
BOT CHORD 2x4 SPF No.2 *Except* 2-14: 2x4 SPF 1650F 1.5E	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 6-11, 8-10
OTHERS 2x4 SPF No.2	

REACTIONS.	(size) 1=0-3-8, 22=0-3-4 Max Horz 1=254(LC 12) Max Uplift 1=207(LC 12), 22=158(LC 13) Max Grav 1=1551(LC 1), 22=1535(LC 1)
------------	---

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-685/10, 2-3=-3333/532, 3-5=-2910/482, 5-6=-1816/321, 6-7=-1220/254, 7-8=-1428/258
BOT CHORD	2-15=-667/3106, 13-15=-405/2130, 11-13=-227/1541, 10-11=-119/919, 10-22=-145/1360
WEBS	3-15=-859/283, 5-15=-155/897, 5-13=-858/261, 6-13=-135/764, 6-11=-612/170, 7-11=-37/294, 8-11=-41/550, 8-10=-1543/219

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 2-10-7, Interior(1) 2-10-7 to 18-8-6, Exterior(2R) 18-8-6 to 22-11-5, Interior(1) 22-11-5 to 25-3-10, Exterior(2R) 25-3-10 to 29-6-9, Interior(1) 29-6-9 to 34-2-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Bearing at joint(s) 1, 22 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=207, 22=158.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	145087390
2685114	A3	Piggyback Base	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:42 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-pAyhib5VO?l1Pl69gR4mdqP48APbN3vrlwzbGrzd2CI

2-4-5	7-9-11	13-3-0	18-8-6	23-4-0	25-3-10	29-11-2	31-11-8	34-4-6	34-8-0
2-4-5	5-5-6	5-5-6	5-5-6	4-7-10	1-11-10	4-7-8	2-0-6	2-4-14	0-3-10

Scale: 3/16"=1'

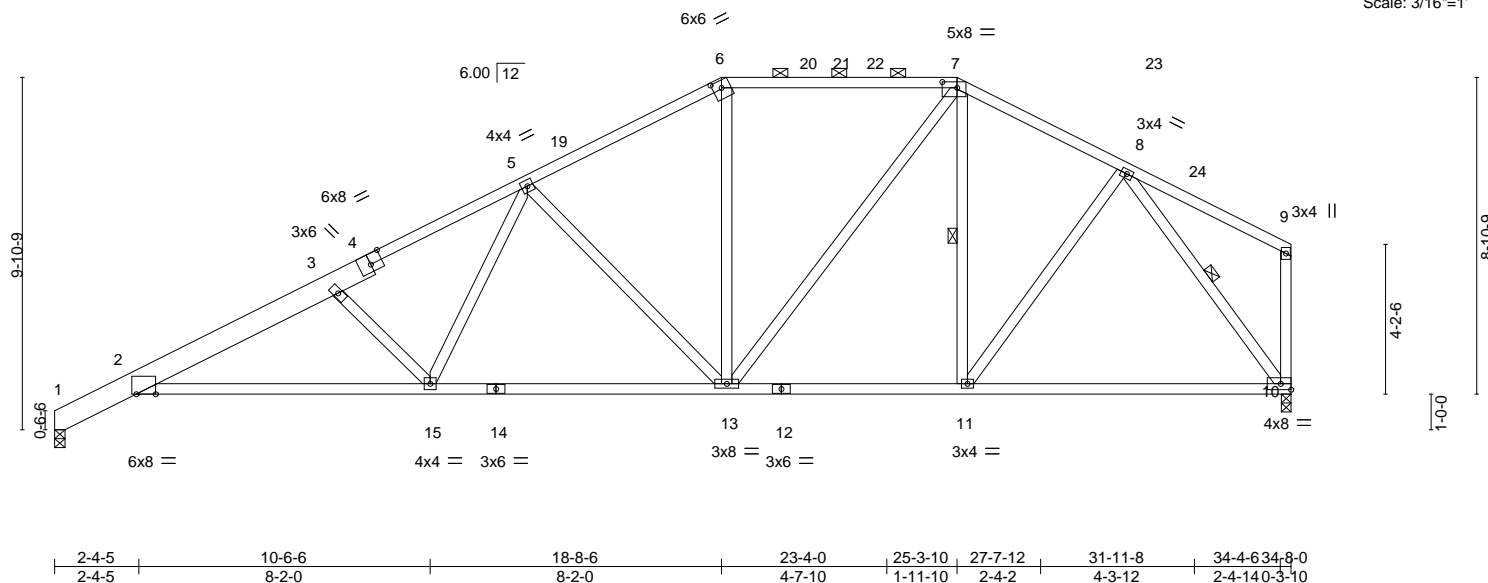


Plate Offsets (X,Y)-- [2:0-6-8,Edge], [4:0-4-0,Edge], [6:0-3-0,0-2-7], [7:0-5-0,0-2-0]													
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.69	Vert(LL)	-0.28	15-18	>999	240	MT20	197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.76	Vert(CT)	-0.55	15-18	>748	180			
BCLL	0.0	Rep Stress Incr	YES	WB	1.00	Horz(CT)	0.24	10	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 172 lb	FT = 20%	

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied, except
1-4: 2x8 SP 2400F 2.0E	2-0-0 oc purlins (3-5-10 max.): 6-7.
BOT CHORD 2x4 SPF No.2 *Except*	BOT CHORD Rigid ceiling directly applied.
2-14: 2x4 SPF 1650F 1.5E	WEBS 1 Row at midpt 7-11, 8-10
WEBS 2x4 SPF No.2	
OTHERS 2x4 SPF No.2	

REACTIONS. (size) 1=0-3-8, 10=0-3-4
Max Horz 1=221(LC 9)
Max Uplift 1=214(LC 12), 10=165(LC 13)
Max Grav 1=1564(LC 1), 10=1548(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-691/80, 2-3=-3369/532, 3-5=-2945/485, 5-6=-1822/324, 6-7=-1565/326,
7-8=-1463/276
BOT CHORD 2-15=-589/3139, 13-15=-348/2159, 11-13=-172/1248, 10-11=-172/978
WEBS 3-15=-861/274, 5-15=-145/903, 5-13=-869/258, 6-13=-15/390, 7-13=-157/609,
7-11=-252/110, 8-11=-47/522, 8-10=-1596/247

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 2-10-7, Interior(1) 2-10-7 to 18-8-6, Exterior(2R) 18-8-6 to 22-11-5, Interior(1) 22-11-5 to 25-3-10, Exterior(2R) 25-3-10 to 29-6-9, Interior(1) 29-6-9 to 34-6-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) The Fabrication Tolerance at joint 6 = 4%
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=214, 10=165.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2685114	Truss C1	Truss Type Piggyback Base	Qty 3	Ply 1	Summit/88 MANOR	I45087392
----------------	-------------	------------------------------	----------	----------	-----------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:44 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-lZ4R7H6lwc?le3FYos6EiFURfz4yrzp2IESiKkd2Cj

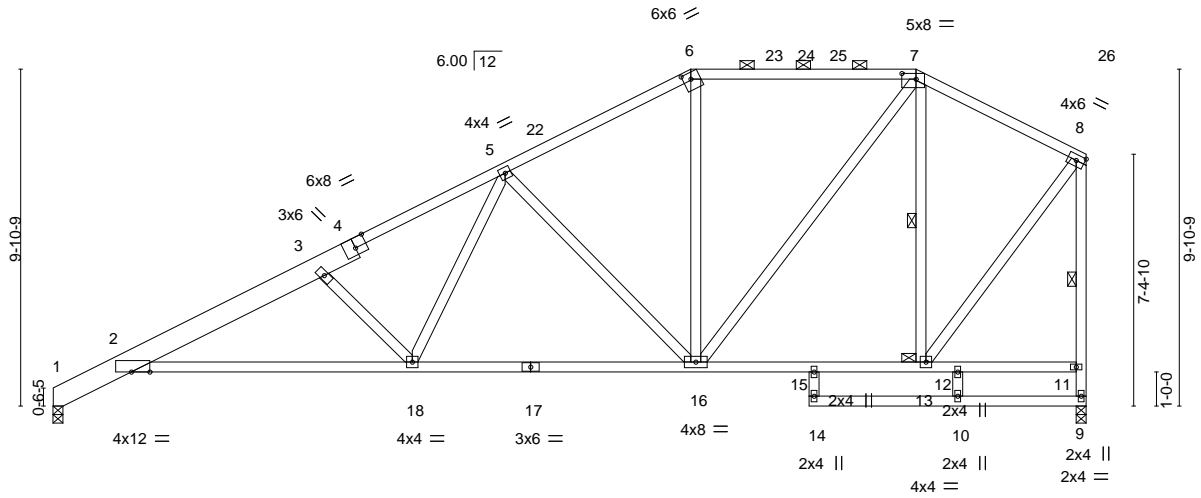



Plate Offsets (X,Y)--	[2:0-6-8,Edge], [4:0-4-0,Edge], [6:0-2-12,0-2-4], [7:0-5-0,0-2-0]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	-0.24 18-21	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.83	Vert(CT)	-0.48 18-21	>756	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.97	Horz(CT)	0.21 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 167 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
1-4: 2x8 SP 2400F 2.0E
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-3-1 max.): 6-7.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 8-9, 7-13
JOINTS 1 Brace at Jt(s): 13

REACTIONS.

(size) 9=0-3-8, 1=0-3-8
Max Horz 1=294(LC 11)
Max Uplift 9=-158(LC 12), 1=-193(LC 12)
Max Grav 9=1351(LC 1), 1=1367(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-663/103, 2-3=-2836/472, 3-5=-2429/427, 5-6=-1349/271, 6-7=-1137/278,
7-8=-792/201, 9-11=-1319/209, 8-11=-1304/209
BOT CHORD 2-18=-567/2644, 16-18=-389/1720, 15-16=-182/663, 13-15=-213/648
WEBS 3-18=-812/267, 5-18=-141/853, 5-16=-846/256, 6-16=0/252, 7-16=-178/824,
7-13=-731/183, 8-13=-169/1051

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 2-10-7, Interior(1) 2-10-7 to 18-8-6, Exterior(2R) 18-8-6 to 22-11-5, Interior(1) 22-11-5 to 25-3-10, Exterior(2R) 25-3-10 to 29-6-9, Interior(1) 29-6-9 to 30-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- The Fabrication Tolerance at joint 6 = 12%
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=158, 1=193.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	145087393
2685114	C1A	Piggyback Base	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:45 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrlOqezdKbx-DleqKc7Nhw7cGDqkLZdTFS1bdNO5aWGCXuBFsAzd2Ci

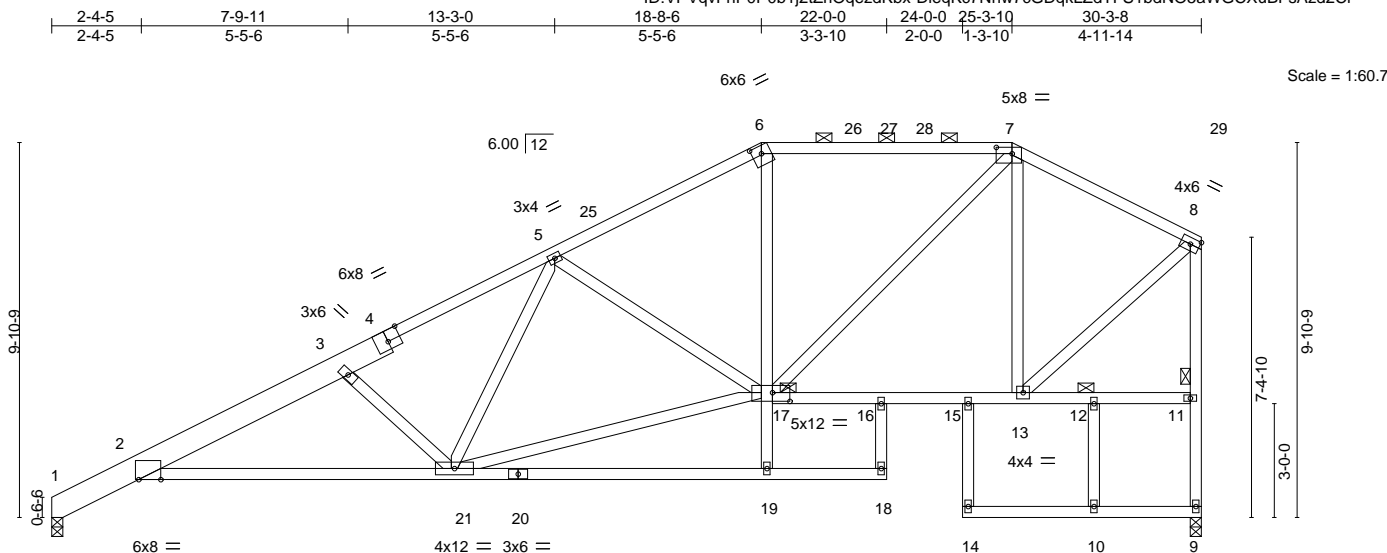

	2-4-5	10-6-6	18-8-6	22-0-0	24-0-0	25-3-10	27-5-8	30-3-8
	2-4-5	8-2-0	8-2-0	3-3-10	2-0-0	1-3-10	2-1-14	2-10-0
Plate Offsets (X,Y)--	[2:0-7-0,Edge], [4:0-4-0,Edge], [6:0-3-0,0-2-7], [7:0-5-0,0-2-0], [17:0-5-8,0-2-12]							

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.67	Vert(LL)	-0.24 21-24	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.83	Vert(CT)	-0.48 21-24	>746	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.58	Horz(CT)	0.25 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 177 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
1-4: 2x8 SP 2400F 2.0E
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-7-2 max.): 6-7.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 8-9
JOINTS 1 Brace at Jt(s): 17, 12

REACTIONS.

(size) 9=0-3-8, 1=0-3-8
Max Horz 1=294(LC 11)
Max Uplift 9=158(LC 12), 1=193(LC 12)
Max Grav 9=1351(LC 1), 1=1367(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-663/103, 2-3=-2871/485, 3-5=-2389/415, 5-6=-1702/301, 6-7=-1467/305,
7-8=-1019/172, 9-11=-1329/213, 8-11=-1307/220
BOT CHORD 2-21=-579/2686, 16-17=-233/866, 15-16=-233/866, 13-15=-233/866
WEBS 3-21=-861/279, 5-21=-48/365, 5-17=-565/218, 17-19=0/273, 6-17=0/356, 7-17=-196/905,
17-21=-447/1949, 7-13=-623/157, 8-13=-174/1108

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 2-10-7, Interior(1) 2-10-7 to 18-8-6, Exterior(2R) 18-8-6 to 22-11-5, Interior(1) 22-11-5 to 25-3-10, Exterior(2R) 25-3-10 to 29-6-9, Interior(1) 29-6-9 to 30-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- The Fabrication Tolerance at joint 6 = 8%
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=158, 1=193.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

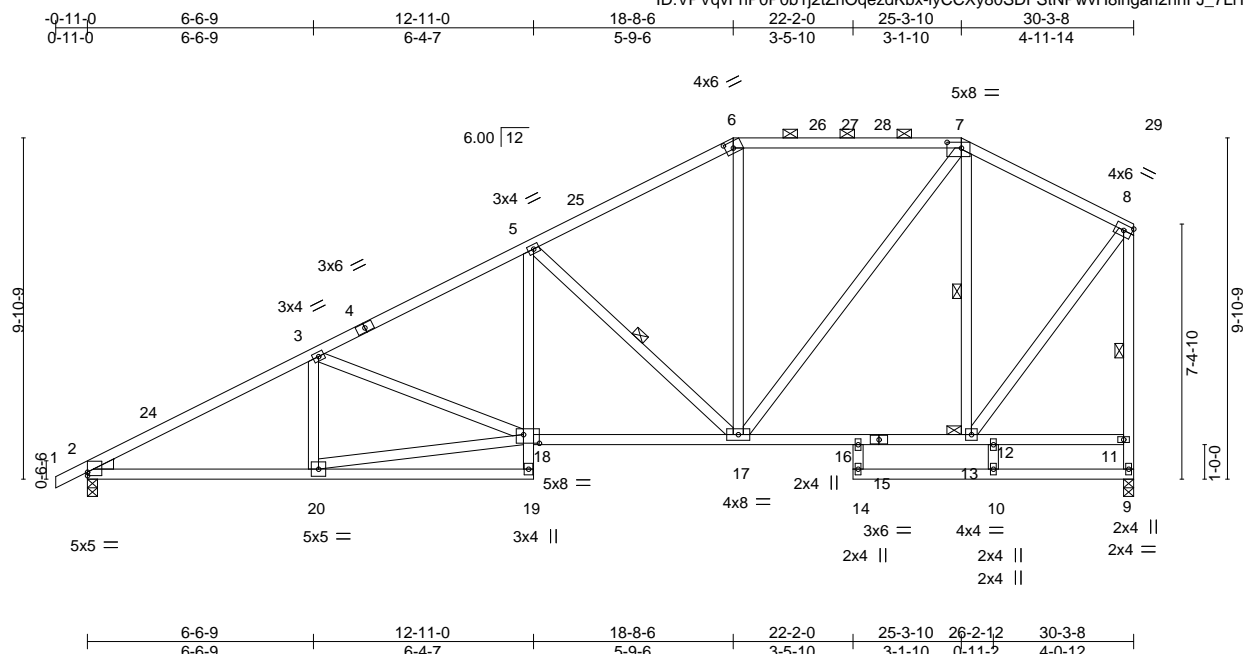


Plate Offsets (X,Y)--		[2:0-0-0,0-1-4], [6:0-2-12,0-2-4], [7:0-5-0,0-2-0], [18:0-5-8,0-3-0]		3-0-0		3-5-10		3-1-10		3-1-12		4-0-12	
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	I/defl	L/d	PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.63	Vert(LL)	-0.11 17-18	>999	240	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.65	Vert(CT)	-0.22 17-18	>999	180				
BCLL	0.0	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.08 9	n/a	n/a				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 166 lb		FT = 20%	

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 WEDGE
 Left: 2x4 SP No.3

BRACING- TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-2-11 max.): 6-7.
BOT CHORD	Rigid ceiling directly applied.
WEBS	1 Row at midpt 5-17, 8-9, 7-13
JOINTS	1 Brace at Jt(s): 13

REACTIONS. (size) 2=0-3-8, 9=0-3-8
 Max Horz 2=301(LC 11)
 Max Uplift 2=-219(LC 12), 9=-160(LC 12)
 Max Grav 2=1422(LC 1), 9=1356(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2392/355, 3-5=-2120/362, 5-6=-1371/275, 6-7=-1142/283, 7-8=-796/199,
9-11=-1321/211, 8-11=-1311/208

BOT CHORD 2-20=-435/2043, 5-18=-61/526, 17-18=-403/1821, 16-17=-179/667, 13-16=-203/657

WEBS 18-20=-419/926, 3-18=-260/119, 5-17=-927/263, 6-17=0/260, 7-13=-731/189,
8-13=-168/1057, 7-17=-186/825

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 18-8-6, Exterior(2R) 18-8-6 to 22-11-5, Interior(1) 22-11-5 to 25-3-10, Exterior(2R) 25-3-10 to 29-6-9, Interior(1) 29-6-9 to 30-1-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) The Fabrication Tolerance at joint 6 = 12%
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=219, 9=160.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TP1 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 8, 2021

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

WARNING – Velly design parameters are listed ONLY on this and INCLUDED WITHIN KEY REFERENCE 1: AISC M14-15 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f, 701f, 702f, 703f, 704f, 705f, 706f,



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	145087395
2685114	C3	PIGGYBACK BASE	4	1		


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:48 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-eKKyye9GzrVA7gZJ1iBa15f7eaQ2nw2eDsQwTVzd2Cf

2-3-8	6-8-4	11-1-0	12-11-0	18-8-6	22-2-0	25-3-10	30-3-8
2-3-8	4-4-12	4-4-12	1-10-0	5-9-6	3-5-10	3-1-10	4-11-14

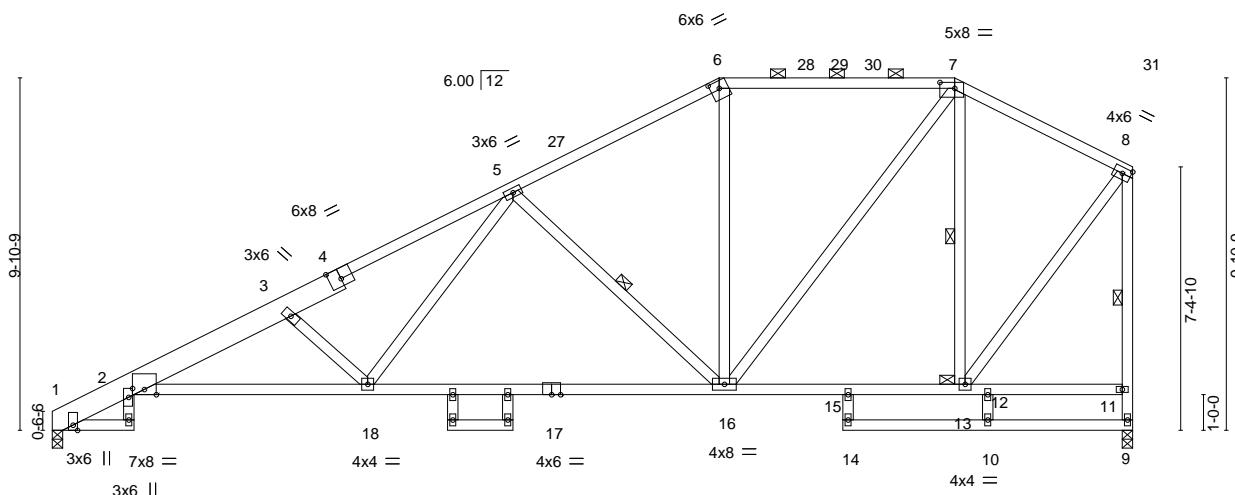

Scale: 3/16"=1'

2-3-8	8-10-2	11-1-0	12-11-0	18-8-6	22-2-0	25-3-10	26-2-12	30-3-8
2-3-8	6-6-10	2-2-14	1-10-0	5-9-6	3-5-10	3-1-10	0-11-2	4-0-12

Plate Offsets (X,Y)-- [2:0-3-0,0-1-5], [4:0-4-0,Edge], [6:0-3-0,0-2-7], [7:0-5-0,0-2-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	-0.25 16-18	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.88	Vert(CT)	-0.56 16-18	>640	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.38	Horz(CT)	0.19 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 172 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
1-4: 2x8 SP 2400F 2.0E
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-2-13 max.): 6-7.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 5-16, 8-9, 7-13
JOINTS 1 Brace at Jt(s): 13

REACTIONS.

(size) 1=0-3-8, 9=0-3-8
Max Horz 1=296(LC 12)
Max Uplift 1=-178(LC 12), 9=-172(LC 12)
Max Grav 1=1367(LC 1), 9=1351(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-602/0, 2-3=-3162/545, 3-5=-2733/475, 5-6=-1366/247, 6-7=-1143/257,
7-8=-788/146, 9-11=-1311/200, 8-11=-1298/203
BOT CHORD 2-18=-752/2992, 16-18=-409/1758, 15-16=-94/659, 13-15=-109/630
WEBS 5-16=-854/280, 6-16=0/259, 7-16=-187/840, 5-18=-186/1005, 3-18=-893/323,
7-13=-745/155, 8-13=-147/1046

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 2-10-7, Interior(1) 2-10-7 to 18-8-6, Exterior(2R) 18-8-6 to 22-11-5, Interior(1) 22-11-5 to 25-3-10, Exterior(2R) 25-3-10 to 29-6-9, Interior(1) 29-6-9 to 30-1-12 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- The Fabrication Tolerance at joint 6 = 8%
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 1 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=178, 9=172.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2685114	Truss C4	Truss Type GABLE	Qty 1	Ply 1	Summit/88 MANOR	I45087396
----------------	-------------	---------------------	----------	----------	-----------------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:49 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-6XtKA_Auk8d1kq8VaPiPPICM2_y8WQFnSW9T7xzd2Ce

-0-11-0 18-8-5 25-3-10 30-3-8
0-11-0 18-8-5 6-7-5 4-11-14

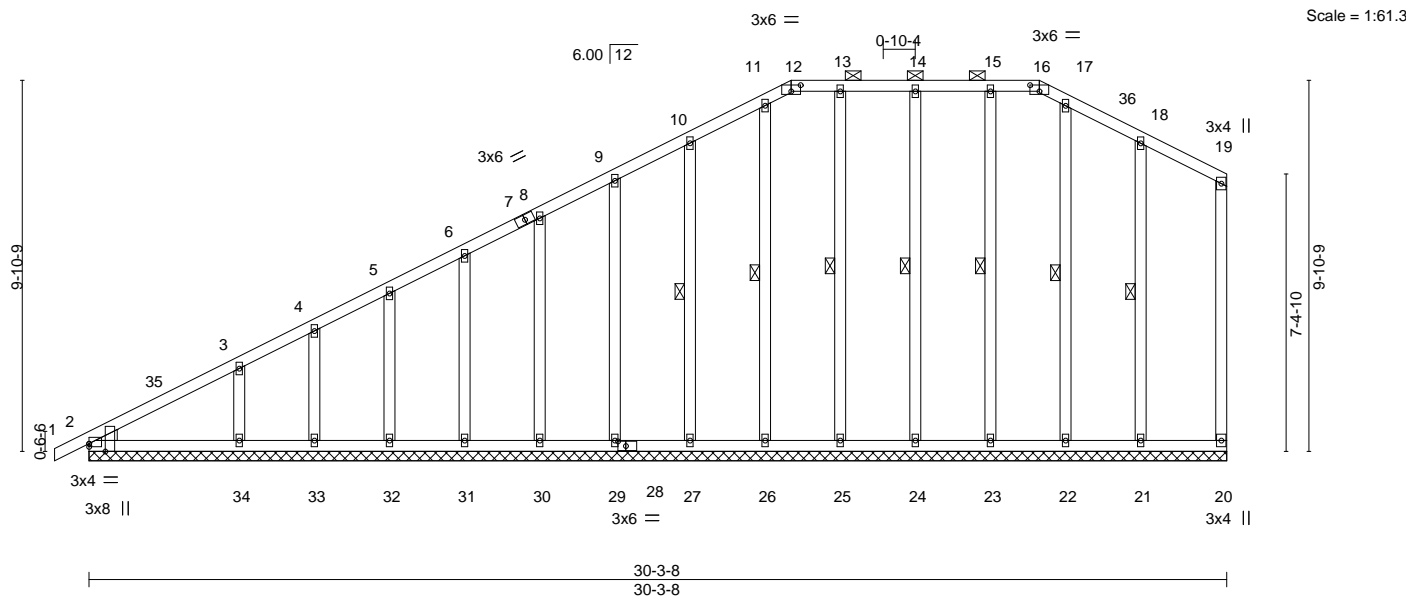


Plate Offsets (X,Y)--	[2:0-2-8,Edge], [2:0-0-0,0-1-0], [12:0-3-0,0-2-0], [16:0-3-0,0-2-0], [28:0-2-8,0-1-8]					
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.26	Vert(LL)	-0.00 1	n/r 120
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	0.01 1	n/r 120
BCLL 0.0	Rep Stress Incr	YES	WB 0.13	Horz(CT)	-0.00 20	n/a n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S			
				PLATES	GRIP	
				MT20	197/144	
				Weight: 184 lb	FT = 20%	

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2
WEDGE
Left: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 12-16.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 10-27, 11-26, 13-25, 14-24, 15-23, 17-22, 18-21

REACTIONS.

All bearings 30-3-8.
(lb) - Max Horz 2=299(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 20, 2, 27, 29, 30, 31, 32, 33, 26, 25, 24, 23, 22, 21 except 34=114(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 20, 2, 27, 29, 30, 31, 32, 33, 26, 25, 24, 23, 22, 21 except 34=352(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=328/202
WEBS 3-34=259/166

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-11-0 to 2-1-0, Exterior(2N) 2-1-0 to 18-8-5, Corner(3R) 18-8-5 to 21-8-5, Exterior(2N) 21-8-5 to 25-3-10, Corner(3R) 25-3-10 to 28-3-10, Exterior(2N) 28-3-10 to 30-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 20, 2, 27, 29, 30, 31, 32, 33, 26, 25, 24, 23, 22, 21 except (jt=lb) 34=114.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087397
2685114	D1	Hip Girder	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:50 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-ajRjNKBWVSluM_ji86DeyWkXJODDFtXgAv0YNzd2Cd

-0-11-0	2-0-0	6-0-0	10-0-0	12-0-0	12-11-0
0-11-0	2-0-0	4-0-0	4-0-0	2-0-0	0-11-0

Scale = 1:22.9

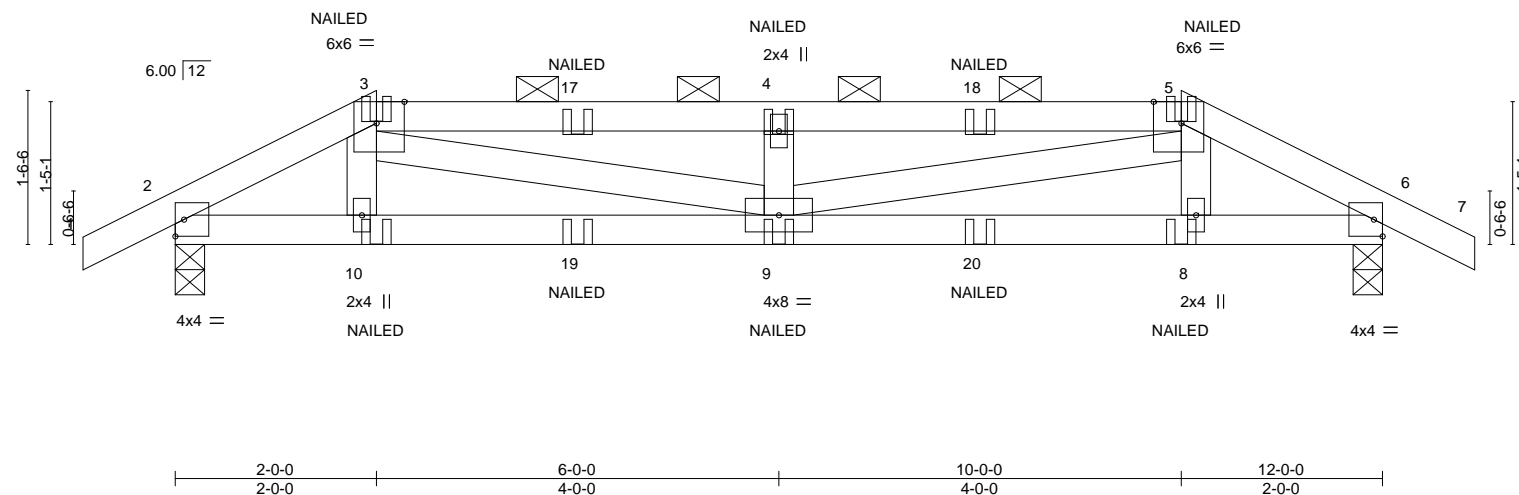


Plate Offsets (X,Y)--	[3:0-3-5,Edge], [5:0-3-5,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.29	Vert(LL) -0.05 9 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.39	Vert(CT) -0.09 9 >999 180		
BCLL 0.0	Rep Stress Incr NO	WB 0.19	Horz(CT) 0.01 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS		Weight: 43 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (4-6-5 max.): 3-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 2=0-3-8, 6=0-3-8
Max Horz 2=22(LC 8)
Max Uplift 2=106(LC 8), 6=106(LC 9)
Max Grav 2=611(LC 1), 6=611(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-899/147, 3-4=-1506/273, 4-5=-1506/273, 5-6=-899/148
BOT CHORD 2-10=-118/777, 9-10=-123/777, 8-9=-115/777, 6-8=-110/777
WEBS 3-9=-146/774, 4-9=-337/118, 5-9=-146/774

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=106, 6=106.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 3-5=-70, 5-7=-70, 11-14=-20
Concentrated Loads (lb)
Vert: 10=-3(F) 9=-2(F) 8=-3(F) 19=-2(F) 20=-2(F)



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087398
2685114	D2	HIP	1	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:51 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-2v75bgC8Gmtl_8luigktUjHjMocY_MB4vqea4qzd2Cc

Job Reference (optional)

-0-11-0	4-0-0	8-0-0	12-0-0	12-11-0
0-11-0	4-0-0	4-0-0	4-0-0	0-11-0

Scale = 1:22.9

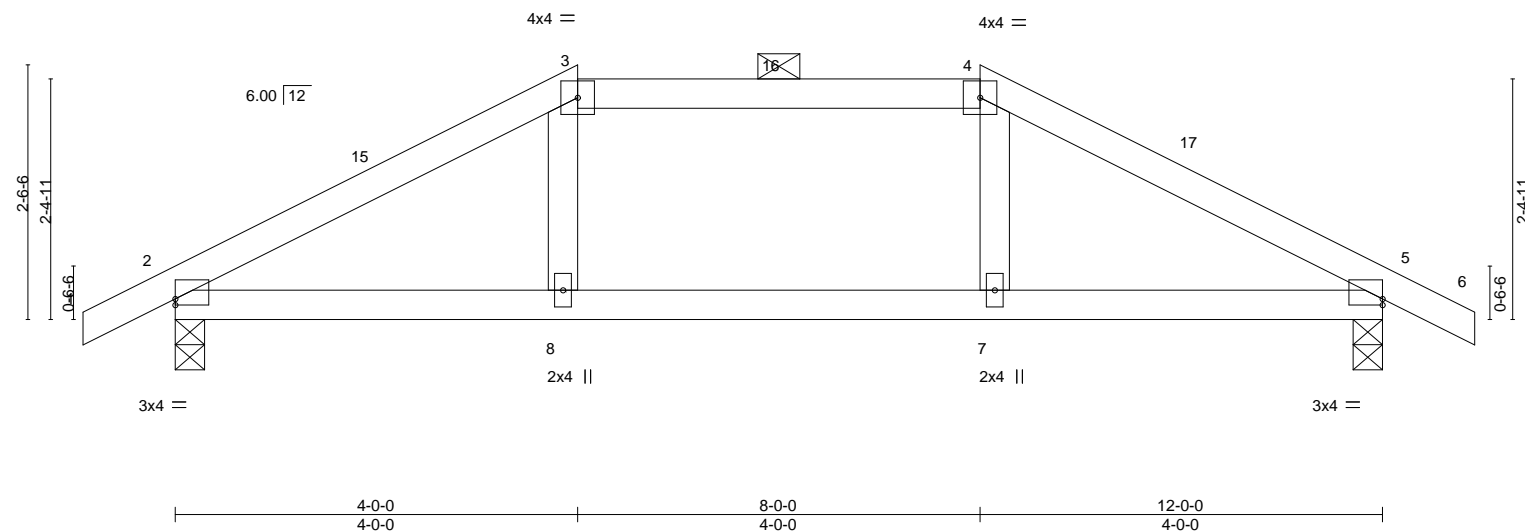


Plate Offsets (X,Y)--		[2:0-0-0,0-0-12], [5:0-0-0,0-0-12]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 25.0	2-0-0	TC 0.21	in (loc) l/defl L/d
TCDL 10.0	Plate Grip DOL 1.15	BC 0.25	Vert(LL) -0.05 8 >999 240
BCLL 0.0	Lumber DOL 1.15	WB 0.04	Vert(CT) -0.06 8 >999 180
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.02 5 n/a n/a
	Code IRC2018/TPI2014		
			PLATES MT20
			GRIP 197/144
			Weight: 35 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (6-0-0 max.): 3-4.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 2=0-3-8, 5=0-3-8
Max Horz 2=38(LC 12)
Max Uplift 2=-89(LC 12), 5=-89(LC 13)
Max Grav 2=604(LC 1), 5=604(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-832/240, 3-4=-687/243, 4-5=-832/240
BOT CHORD 2-8=-134/692, 7-8=-136/687, 5-7=-133/692

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 4-0-0, Exterior(2E) 4-0-0 to 8-0-0, Exterior(2R) 8-0-0 to 12-0-0, Interior(1) 12-0-0 to 12-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087399
2685114	D3	COMMON	3	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:52 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-W6ZTo0Cm13?cbt4t4GXF61xqsiCw0jp4E8U07cGzd2Cb




Plate Offsets (X,Y)--	[2:0-0-0,0-1-4], [4:0-0-0,0-1-4]
-----------------------	----------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.36	Vert(LL)	-0.04	6-12	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.30	Vert(CT)	-0.06	6-12	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.01	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 35 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 2=0-3-8, 4=0-3-8
Max Horz 2=-55(LC 13)
Max Uplift 2=-85(LC 12), 4=-85(LC 13)
Max Grav 2=604(LC 1), 4=604(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-730/236, 3-4=-730/236
BOT CHORD 2-6=-97/573, 4-6=-97/573
WEBS 3-6=0/260

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 6-0-0, Exterior(2R) 6-0-0 to 9-0-0, Interior(1) 9-0-0 to 12-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2685114	Truss E1	Truss Type GABLE	Qty 1	Ply 1	Summit/88 MANOR	I45087400
Builders FirstSource (Valley Center), Valley Center, KS - 67147,						Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:53 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrOqezdKbx-_l7r?MDPon7TDSSGpFmLZ8M1CbAFSfaNN87h8izd2Ca



Scale = 1:25.3

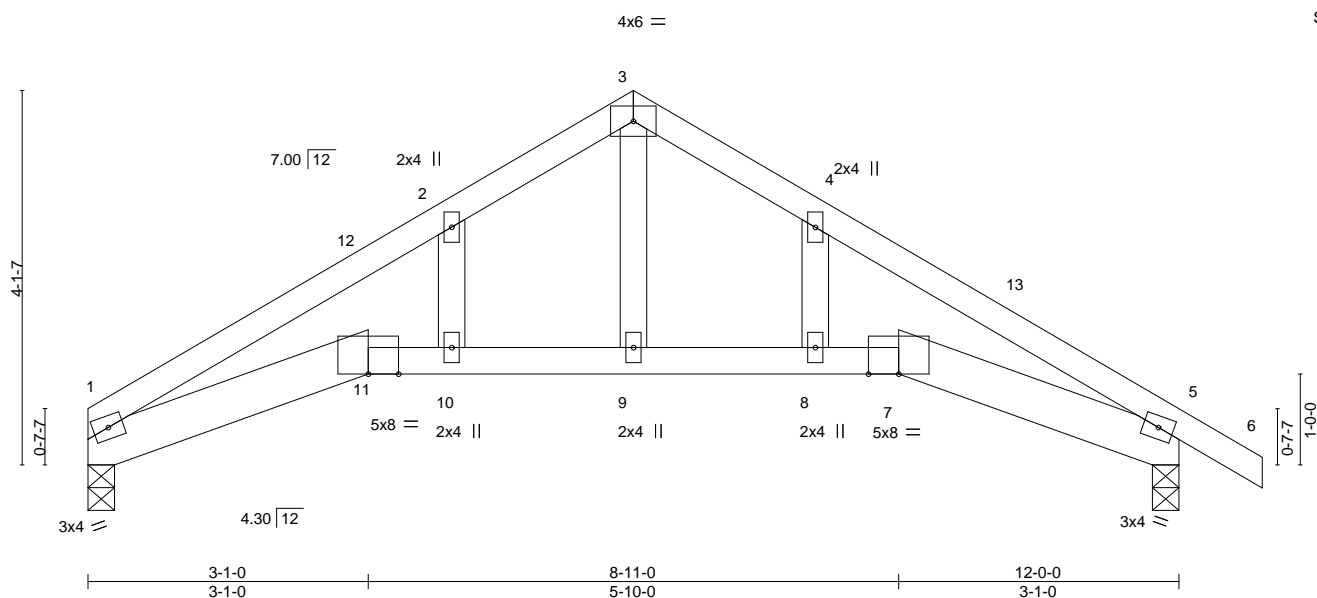


Plate Offsets (X,Y)--		[4:0-0-0,0-0-0], [5:0-0-0,0-0-0]										
LOADING (psf)		SPACING-	2-0-0	CSI.		DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.38	Vert(LL)	-0.10	11	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.18	10-11	>770	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.11	Horz(CT)	0.13	5	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S							Weight: 42 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x6 SPF No.2 *Except*
7-11: 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-3-15 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=0-3-8, 5=0-3-8
Max Horz 1=92(LC 8)
Max Uplift 1=62(LC 12), 5=84(LC 13)
Max Grav 1=524(LC 1), 5=605(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-929/228, 2-3=-778/308, 3-4=-778/308, 4-5=-935/240
BOT CHORD 1-11=-111/711, 10-11=-107/693, 9-10=-107/693, 8-9=-107/693, 7-8=-107/693,
5-7=-114/712
WEBS 3-9=-187/432

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-1-12 to 3-1-12, Exterior(2N) 3-1-12 to 6-0-0, Corner(3R) 6-0-0 to 9-0-0, Exterior(2N) 9-0-0 to 12-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 1, 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087401
2685114	E2	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:54 2021 Page 1

ID:VPVqvFnP0P0b1j2tZr1OqezdKbx-TUhdDhE1ZhGKrc0TNyla6MvD0?ceBhGWbotEh9zd2CZ

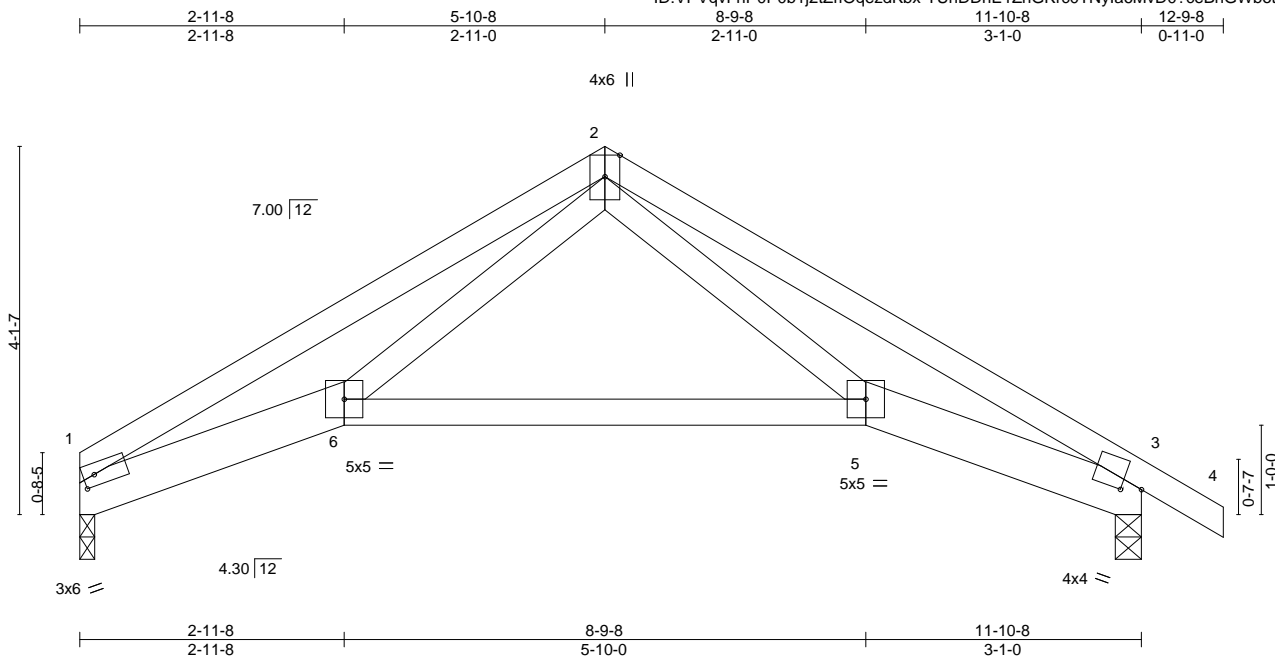


Plate Offsets (X,Y)-- [1:0-1-8,0-1-8], [3:0-2-11,0-0-15]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.31	Vert(LL)	-0.06 5-6 >999 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.29	Vert(CT)	-0.13 5-6 >999 180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.05 3 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 45 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SPF No.2 *Except*
 5-6: 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 1=0-2-0, 3=0-3-8
 Max Horz 1=90(LC 8)
 Max Uplift 1=63(LC 12), 3=82(LC 13)
 Max Grav 1=532(LC 1), 3=601(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1237/179, 2-3=-1257/182
 BOT CHORD 1-6=-84/1031, 5-6=-41/577, 3-5=-68/1054
 WEBS 2-6=-34/570, 2-5=-18/581

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 5-10-8, Exterior(2R) 5-10-8 to 8-10-8, Interior(1) 8-10-8 to 12-9-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Bearing at joint(s) 1, 3 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 1.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087402
2685114	E3	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:54 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-TUhDDhE1ZhGKrc0TNyla6MvFp?7f7BjtWbotEh9zd2CZ

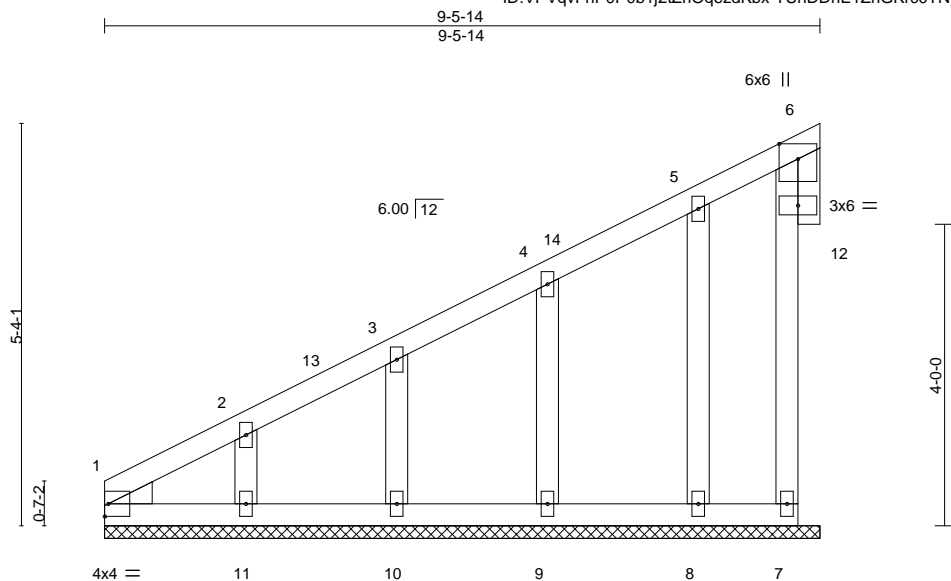

Scale = 1:30.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	n/a	-	n/a	999	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a	999	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	7	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						
								Weight: 41 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2
WEDGE
Left: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS.

All bearings 9-5-14.

(lb) - Max Horz 1=183(LC 9)

Max Uplift All uplift 100 lb or less at joint(s) 7, 11, 10, 9, 8

Max Grav All reactions 250 lb or less at joint(s) 7, 11, 10, 9, 8, 1

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-408/210, 2-3=-298/167

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-0-0 to 3-0-0, Exterior(2N) 3-0-0 to 9-2-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 11, 10, 9, 8.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2685114	Truss F1	Truss Type GABLE	Qty 1	Ply 1	Summit/88 MANOR	I45087403
----------------	-------------	---------------------	----------	----------	-----------------	-----------

ID:VPVqvFnP0P0b1j2tZrlOqezdKbx-hsXpTHYWWsZ1wpwhkyNI4NYGJrJ5NaaJGT2iuzzd0vu


8.430 s Nov 18 2020 MiTek Industries, Inc. Mon Mar 8 09:28:05 2021 Page 1

Job Reference (optional)

2-11-8	8-0-0	8-9-8	11-7-0	15-6-8	19-5-13	25-2-8
2-11-8	5-0-8	0-9-8	2-9-8	3-11-8	3-11-5	5-8-12

4x8 =

Scale = 1:59.1

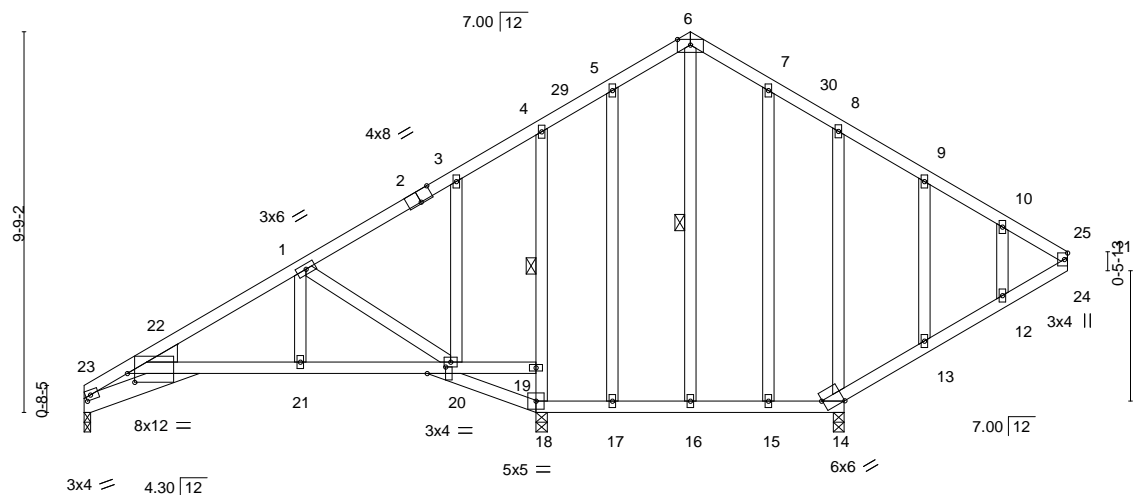

2-11-8	8-0-0	8-9-8	11-7-0	11-8-12	19-5-13	25-2-8
2-11-8	5-0-8	0-9-8	2-9-8	0-1-12	7-9-1	5-8-12

Plate Offsets (X,Y)-- [2:0-4-0,Edge], [14:0-6-4,Edge], [20:0-2-0,0-5-11], [22:0-2-4,0-2-11], [23:0-1-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.92	Vert(LL)	0.16	20-21	>888	240	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.77	Vert(CT)	-0.26	20-21	>540	180	
BCLL 0.0	Rep Stress Incr	YES	WB 0.43	Horz(CT)	0.14	18	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
Weight: 138 lb									FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2 *Except*
2-6: 2x4 SPF 1650F 1.5E
BOT CHORD 2x4 SPF No.2 *Except*
22-23: 2x6 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2
WEDGE
Left: 2x6 SPF No.2

BRACING-

TOP CHORD Sheathed.
BOT CHORD Rigid ceiling directly applied.
WEBS 1 Row at midpt 4-18, 6-16

REACTIONS.

(size) 23=0-2-0, 18=0-3-8, 14=0-3-5
Max Horz 23=242(LC 9)
Max Uplift 23=-3(LC 13), 18=-234(LC 12), 14=-139(LC 13)
Max Grav 23=332(LC 25), 18=999(LC 19), 14=868(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-22=-640/54, 3-4=-105/436, 8-9=-66/277
BOT CHORD 22-26=-304/97, 21-22=-190/548, 20-21=-192/554
WEBS 18-19=-992/256, 4-19=-873/210, 8-14=-492/131, 3-20=-24/279, 1-21=-33/261,
1-20=-748/267

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 1-9-7 to 4-9-7, Interior(1) 4-9-7 to 15-6-8, Exterior(2R) 15-6-8 to 18-6-8, Interior(1) 18-6-8 to 25-2-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 23 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 23.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 3 lb uplift at joint 23, 234 lb uplift at joint 18 and 139 lb uplift at joint 14.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

2-11-8	8-0-0	8-9-8	11-7-0	15-6-8	19-5-13	21-3-9	22-4-0	25-2-8
2-11-8	5-0-8	0-9-8	2-9-8	3-11-8	3-11-5	1-9-12	1-0-7	2-10-8

Scale = 1:61.5

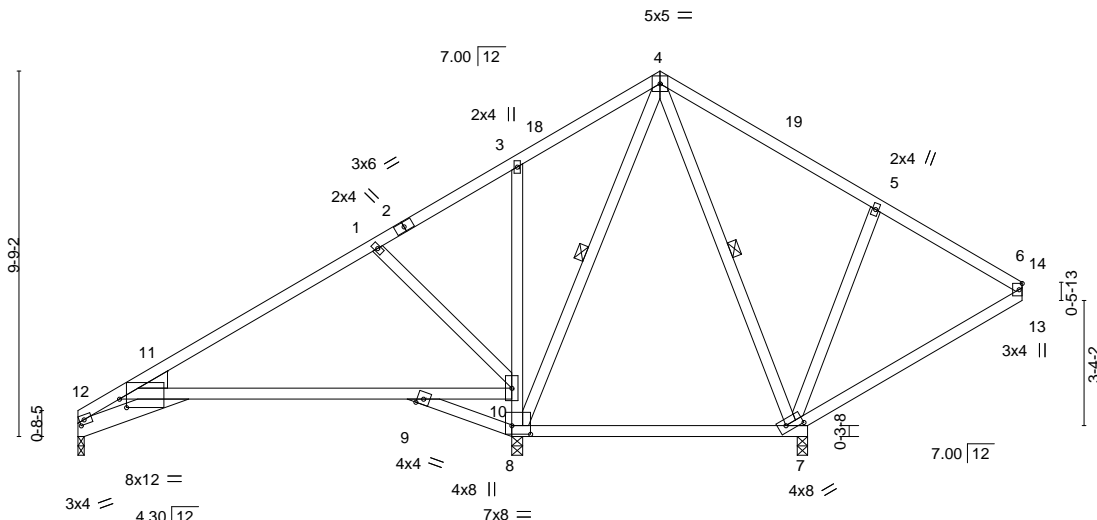

2-11-8	8-0-0	8-9-8	11-7-0	11-8-12	19-5-13	25-2-8
2-11-8	5-0-8	0-9-8	2-9-8	0-1-12	7-9-1	5-8-12

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Sheathed.
BOT CHORD	2x4 SPF No.2 *Except*	BOT CHORD	Rigid ceiling directly applied.
	11-12: 2x6 SPF No.2	WEBS	1 Row at midpt 4-8, 4-7
WEBS	2x4 SPF No.2		
WEDGE			
Left: 2x6 SPF No.2			

REACTIONS. (size) 12=0-2-0, 8=0-3-8, 7=0-3-5
 Max Horz 12=242(LC 9)
 Max Uplift 12=-103(LC 10), 8=-395(LC 12), 7=-194(LC 13)
 Max Grav 12=146(LC 9), 8=1699(LC 19), 7=715(LC 26)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-11=-231/659, 1-2=-212/750, 2-3=-207/850, 3-18=-149/731, 4-18=-133/830, 4-19=-11/354
BOT CHORD	11-15=-276/216, 9-11=-444/35, 8-9=-620/102
WEBS	1-10=-366/183, 8-10=-474/255, 4-8=-1000/195, 4-7=-175/334, 5-7=-370/182

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 1-9-7 to 4-9-7, Interior(1) 4-9-7 to 15-6-8, Exterior(2R) 15-6-8 to 18-6-8, Interior(1) 18-6-8 to 25-2-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 12.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 103 lb uplift at joint 12, 395 lb uplift at joint 8 and 194 lb uplift at joint 7.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



March 8, 2021



WARNING - verify design parameters and READ NOTES ON THIS AND INCLUDED MITER REFERENCE PAGE MM1/473 (rev. 3/19/2020) BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2685114	Truss GR1	Truss Type ROOF SPECIAL GIRDER	Qty 1	Ply 2	Summit/88 MANOR	I45087405
----------------	--------------	-----------------------------------	----------	----------	-----------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:58 2021 Page 1

ID:VPVqvFnP0P0b1j2tZr1OqezdKbx-LFwk33HXdvmlJDKEcoMWGC3w2cr37N26WPrRqwd2CV

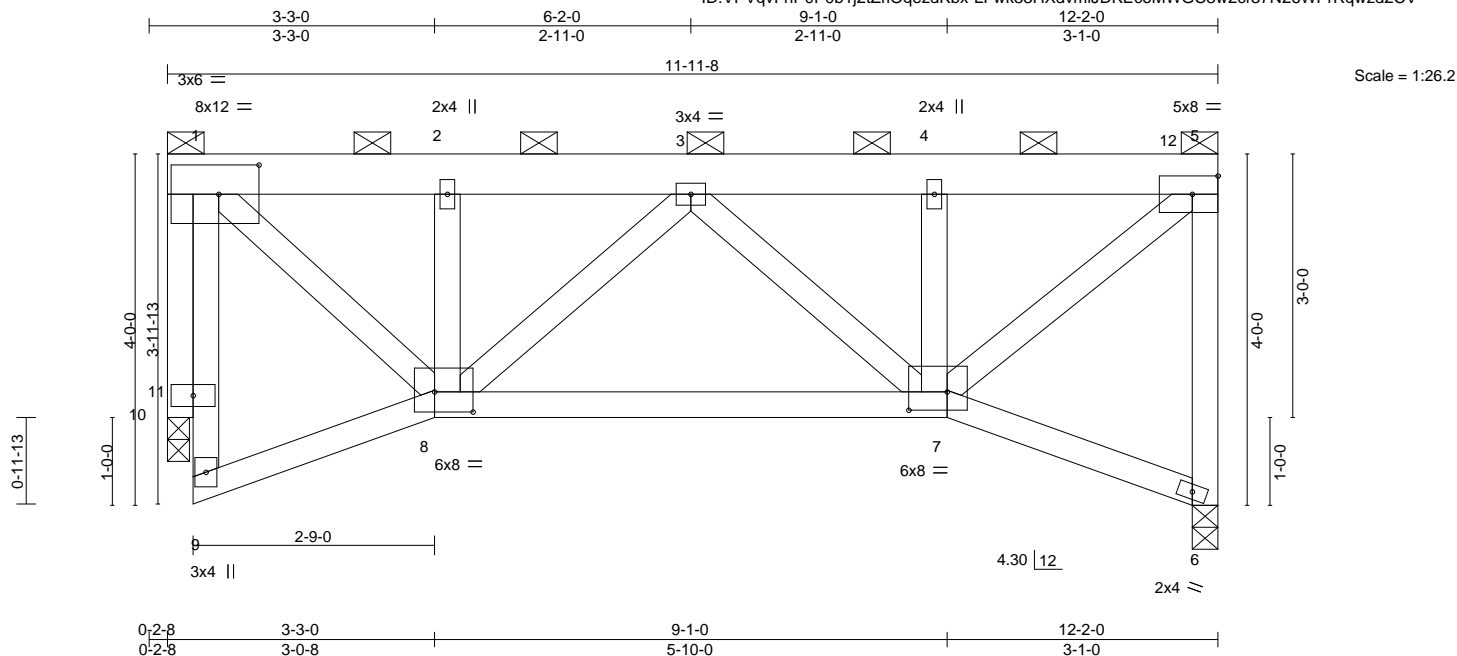


Plate Offsets (X,Y)--		[1:0-5-8,0-4-0], [7:0-5-4,0-2-8], [8:0-5-4,0-2-12]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 25.0	Plate Grip DOL 1.15	TC 0.24	in (loc) l/defl L/d
TCDL 10.0	Lumber DOL 1.15	BC 0.77	Vert(LL) -0.04 7-8 >999 240
BCLL 0.0	Rep Stress Incr NO	WB 0.67	Vert(CT) -0.10 7-8 >999 180
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS	Horz(CT) -0.07 11 n/a n/a
			PLATES MT20
			GRIP 197/144
			Weight: 146 lb FT = 20%

LUMBER-

TOP CHORD 2x6 SP 2400F 2.0E
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.): 1-5, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=0-3-8, 11=0-3-0
Max Horz 6=100(LC 7)
Max Uplift 6=666(LC 5), 11=667(LC 4)
Max Grav 6=4657(LC 15), 11=4677(LC 16)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 5-6=-4626/672, 1-2=-4183/597, 2-3=-4318/618, 3-4=-4392/650, 4-5=-4249/629
BOT CHORD 7-8=-832/5573, 8-9=-80/489
WEBS 5-7=-787/5603, 4-7=-2588/408, 2-8=-2435/378, 1-8=-755/5281, 3-7=-1602/257, 3-8=-1680/272, 1-11=-4708/672

NOTES-

- n/a
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 2 rows at 0-9-0 oc, 2x6 - 3 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 6, 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=666, 11=667.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Girder carries tie-in span(s): 34-8-0 from 0-0-0 to 11-8-0
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



March 8, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087405
2685114	GR1	ROOF SPECIAL GIRDER	1	2	Job Reference (optional)	

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-12=-798, 5-12=-70, 6-7=-20, 7-8=-20, 8-9=-20



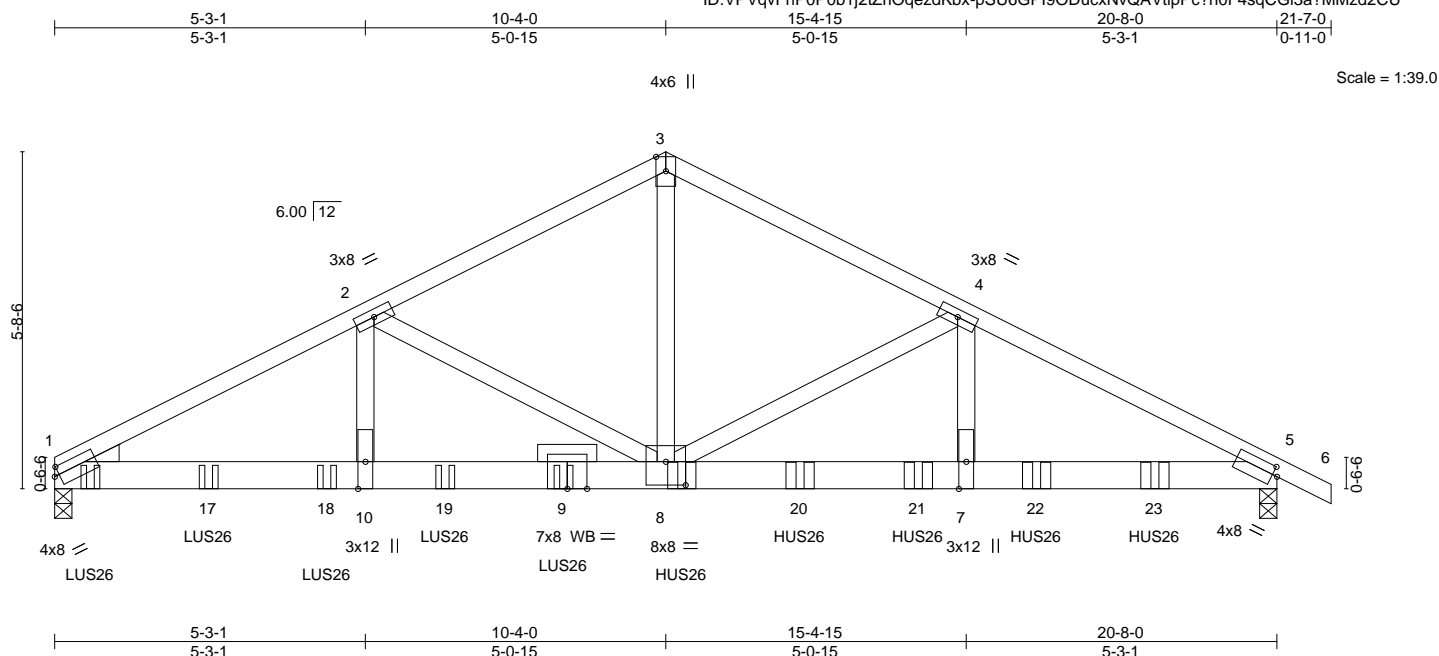


Plate Offsets (X,Y)-- [1:0-1-0,0-1-12], [5:0-1-0,0-1-12], [8:0-4-0,0-4-12]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d					PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.63	Vert(LL)	-0.15	8-10	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.53	Vert(CT)	-0.26	8-10	>962	180		
BCLL	0.0	Rep Stress Incr	NO	WB	0.67	Horz(CT)	0.06	5	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MS							Weight: 190 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SP 2400F 2.0E *Except*
 5-9: 2x6 SPF 2100F 1.8E
 WEBS 2x4 SPF No.2
 OTHERS 2x4 SPF No.2
 WEDGE
 Left: 2x4 SP No.3

BRACING-	
TOP CHORD	Structural wood sheathing directly applied or 3-6-5 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=0-3-8, 5=0-3-8
 Max Horz 1=96(LC 13)
 Max Uplift 1=578(LC 8), 5=535(LC 9)
 Max Grav 1=5927(LC 2), 5=5274(LC 2)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-2=-9397/926, 2-3=-6547/669, 3-4=-6546/670, 4-5=-9300/916
BOT CHORD	1-10=-842/832, 8-10=-842/832, 7-8=-743/8264, 5-7=-743/8264
WEBS	3-8=500/5492, 4-8=-284/380, 4-7=-166/2038, 2-8=-2925/390, 2-10=-175/2395

NOTES-

- 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-4-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-7-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 3) Unbalanced roof live loads have been considered for this design.
- 4) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=578, 5=535.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Use Simpson Strong-Tie LUS26 (4-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 0-7-4 from the left end to 8-7-4 to connect truss(es) to back face of bottom chord.
- 9) Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent spaced at 2-0-0 oc max. starting at 10-7-4 from the left end to 18-7-4 to connect truss(es) to back face of bottom chord.
- 10) Fill all nail holes where hanger is in contact with lumber.



March 8, 2021

LOAD CASE(S) S1
Continuous pipe Standard

WARNING – Velly design parameters are listed below and included within key reference 1. See MH-1413 (Rev. 3/19/2020) for more details.
Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for the building design component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087406
2685114	GR2	COMMON GIRDER	1	2	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:59 2021 Page 2
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-pSU6GPI9ODucxNvQAVtlpPc?h0F4sqCGI3a?MMzd2CU

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-3=-70, 3-6=-70, 11-14=-20
 - Concentrated Loads (lb)
 - Vert: 9=-910(B) 8=-909(B) 13=-914(B) 17=-910(B) 18=-910(B) 19=-910(B) 20=-909(B) 21=-909(B) 22=-909(B) 23=-909(B)

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 07:59:59 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-pSU6GPI9ODucxNvQAVtpPc7u0Ncs_iGI3a?MMzd2CU



LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 2-8-7 oc purlins.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.


FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 4-5=-20
Concentrated Loads (lb)
Vert: 3=-2(F) 4=-4(F)



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087408
2685114	JD2	Jack-Open	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:00 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrOqezdKbx-He2VTJo9X0TZUdkDP_Md9JSQjGbRzP_jKYuo2d2CT

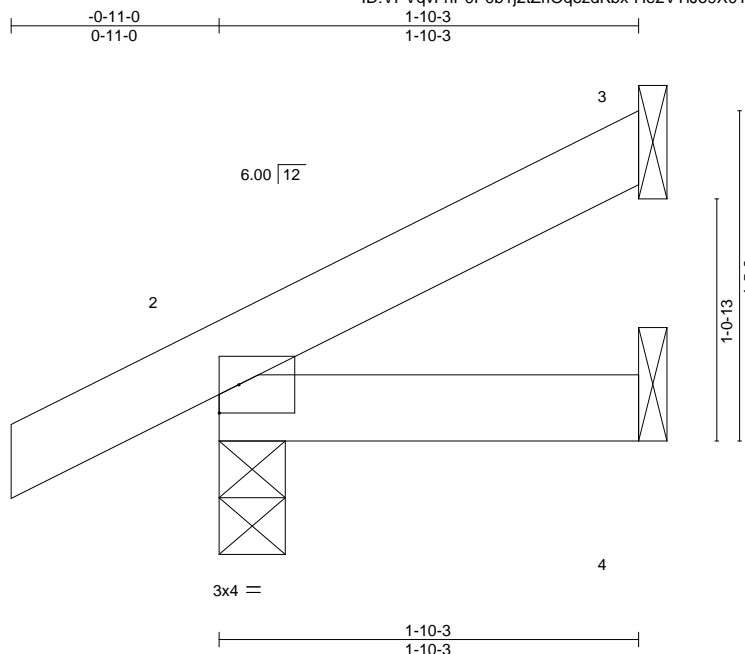

Scale = 1:10.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	-0.00	7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 6 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-10-3 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=48(LC 12)
Max Uplift 3=-25(LC 12), 2=-25(LC 12)
Max Grav 3=49(LC 1), 2=163(LC 1), 4=32(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087409
2685114	JD3	Jack-Open	3	1	Job Reference (optional)	

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:00 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-He2VTIJJo9X0TZXuDP_Md9JSQjBbRzP_jKYuoZd2CT



Scale = 1:10.5

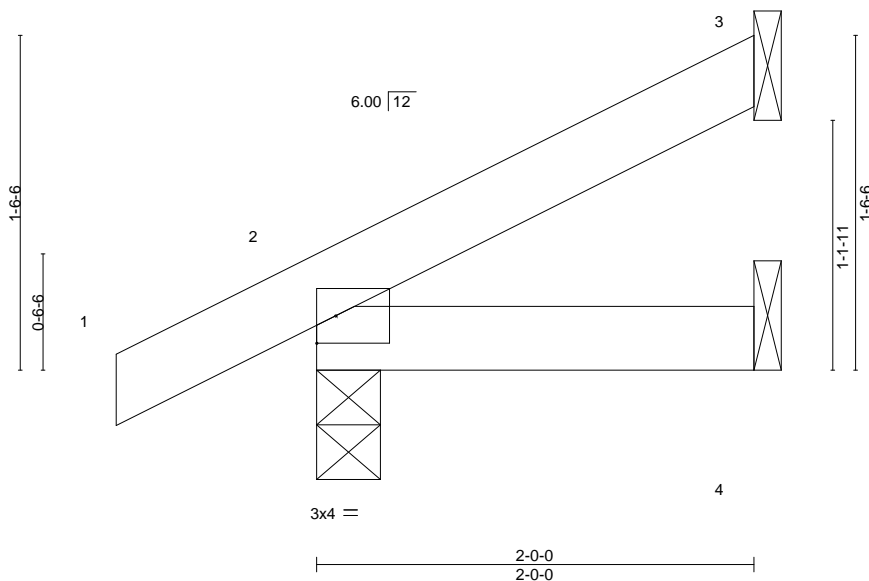

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	-0.00	7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	4-7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 6 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical
Max Horz 2=51(LC 12)
Max Uplift 3=-27(LC 12), 2=-25(LC 12)
Max Grav 3=54(LC 1), 2=168(LC 1), 4=35(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job 2685114	Truss LG1	Truss Type GABLE	Qty 1	Ply 1	Summit/88 MANOR Job Reference (optional)	I45087410
----------------	--------------	---------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:01 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-lqth5JQwq8KAg3pHwwDuqhUDq3TKuoYCN36RFzd2CS



4x4 =

Scale = 1:28.9

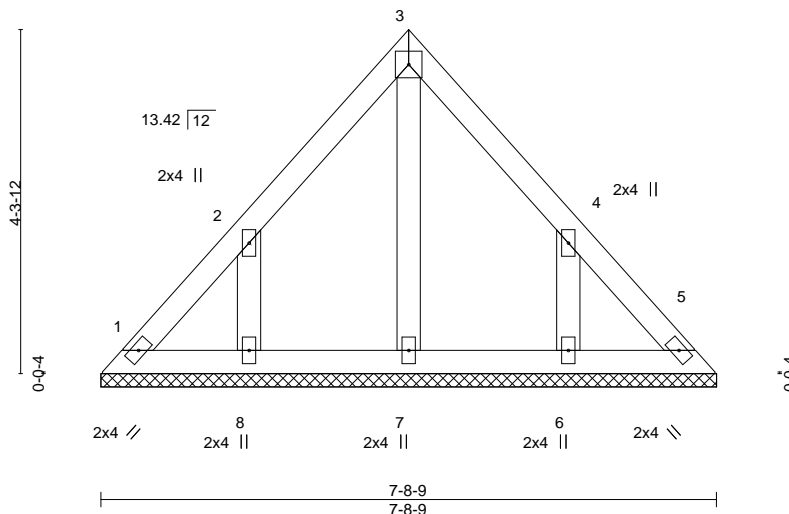

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	n/a	-	n/a	999	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	5	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						
								Weight: 29 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 7-8-9.
(lb) - Max Horz 1=96(LC 10)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=139(LC 12), 6=139(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7, 8, 6

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-15 to 3-3-15, Interior(1) 3-3-15 to 3-10-4, Exterior(2R) 3-10-4 to 6-10-4, Interior(1) 6-10-4 to 7-4-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=139, 6=139.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087411
2685114	M1	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:02 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-E1AFuRK2g8GBoqe?reRSR2Ef_EPZ3K0iR1pfzhzd2CR

0-11-0 10-4-0 20-8-0 21-7-0
0-11-0 10-4-0 10-4-0 0-11-0

4x4 =

Scale = 1:42.6

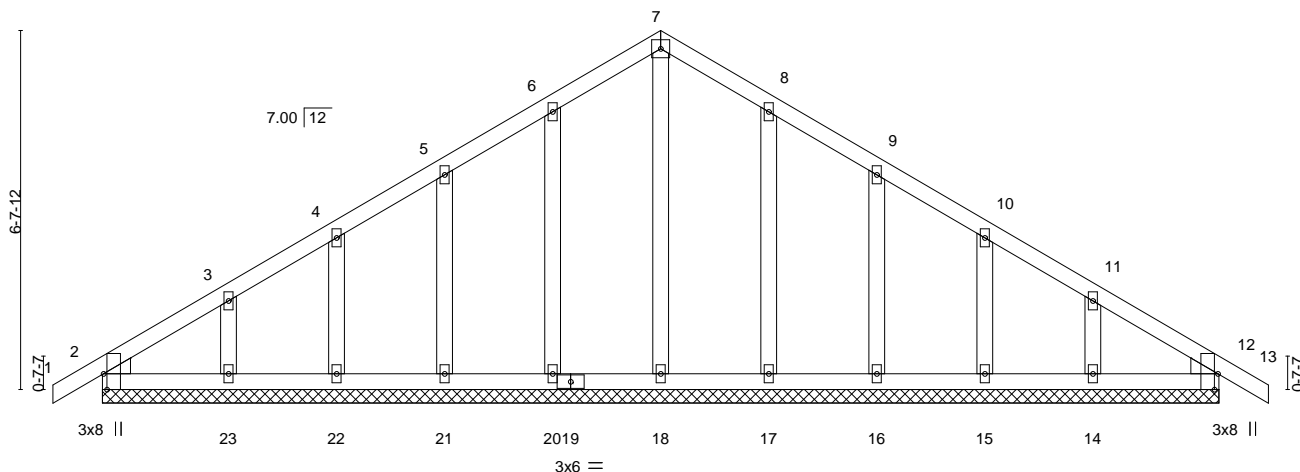


Plate Offsets (X,Y)-- [2:0-3-8,Edge], [12:0-3-8,Edge]		20-8-0 20-8-0			
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	PLATES
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	in (loc) l/defl L/d	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(LL) -0.00 12 n/r 120	GRIP 197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.09	Vert(CT) 0.00 12 n/r 120	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S	Horz(CT) 0.00 12 n/a n/a	Weight: 91 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2
WEDGE

Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 20-8-0.

(lb) - Max Horz 2=154(LC 10)

Max Uplift All uplift 100 lb or less at joint(s) 2, 20, 21, 22, 23, 17, 16, 15, 14

Max Grav All reactions 250 lb or less at joint(s) 2, 18, 20, 21, 22, 23, 17, 16, 15, 14, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-11-0 to 2-4-0, Exterior(2N) 2-4-0 to 10-4-0, Corner(3R) 10-4-0 to 13-4-0, Exterior(2N) 13-4-0 to 21-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 20, 21, 22, 23, 17, 16, 15, 14.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2685114	Truss M2	Truss Type Common	Qty 6	Ply 1	Summit/88 MANOR Job Reference (optional)	I45087412
----------------	-------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:05 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-ecrOXS Mwz3emfIMaWm_93gs52RLoGgP87?1Ja0zd2CO

0-11-0 0-11-0	5-2-2 5-2-2	10-4-0 5-1-14	15-5-14 5-1-14	20-8-0 5-2-2
------------------	----------------	------------------	-------------------	-----------------

4x6 ||

Scale = 1:41.2

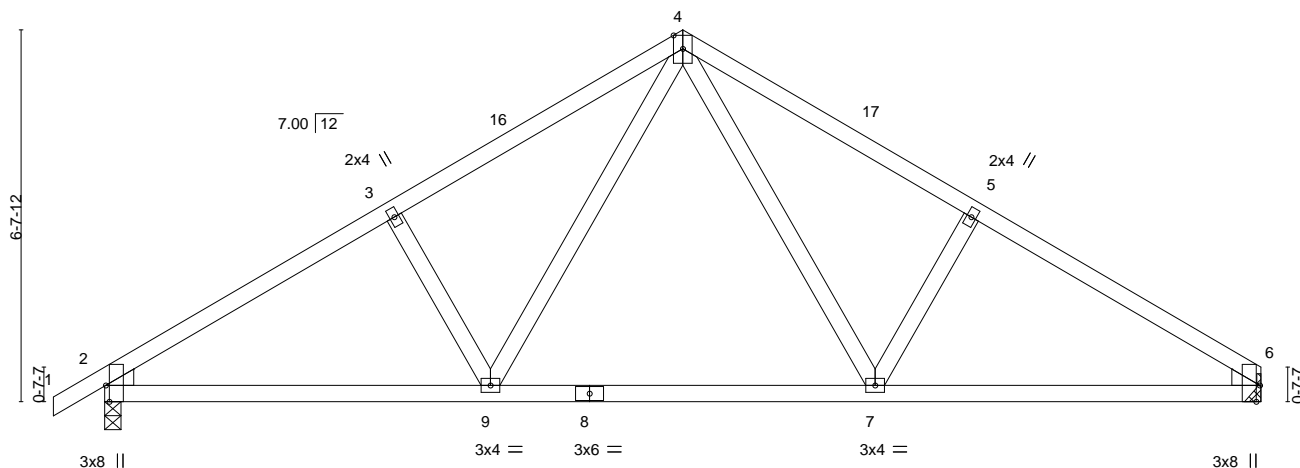


Plate Offsets (X,Y)--	[2:0-3-8,Edge], [6:0-3-8,Edge]
-----------------------	--------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.26	Vert(LL)	-0.06	7-9	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.38	Vert(CT)	-0.12	7-9	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.12	Horz(CT)	0.03	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS							
									Weight: 77 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
WEDGE

Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 2=0-3-8, 6=Mechanical
Max Horz 2=150(LC 9)
Max Uplift 2=130(LC 12), 6=112(LC 13)
Max Grav 2=996(LC 1), 6=929(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1376/178, 3-4=-1223/214, 4-5=-1228/216, 5-6=-1381/180
BOT CHORD 2-9=-182/1117, 7-9=-45/768, 6-7=-96/1123
WEBS 4-7=-114/471, 5-7=-319/175, 4-9=-112/464, 3-9=-314/174

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 10-4-0, Exterior(2R) 10-4-0 to 13-4-0, Interior(1) 13-4-0 to 20-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=130, 6=112.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087413
2685114	M3	Common	5	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:06 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-6oPmkoNZkNmdHSxm4TVObuPGorh1?7fHMfnt6Szd2CN

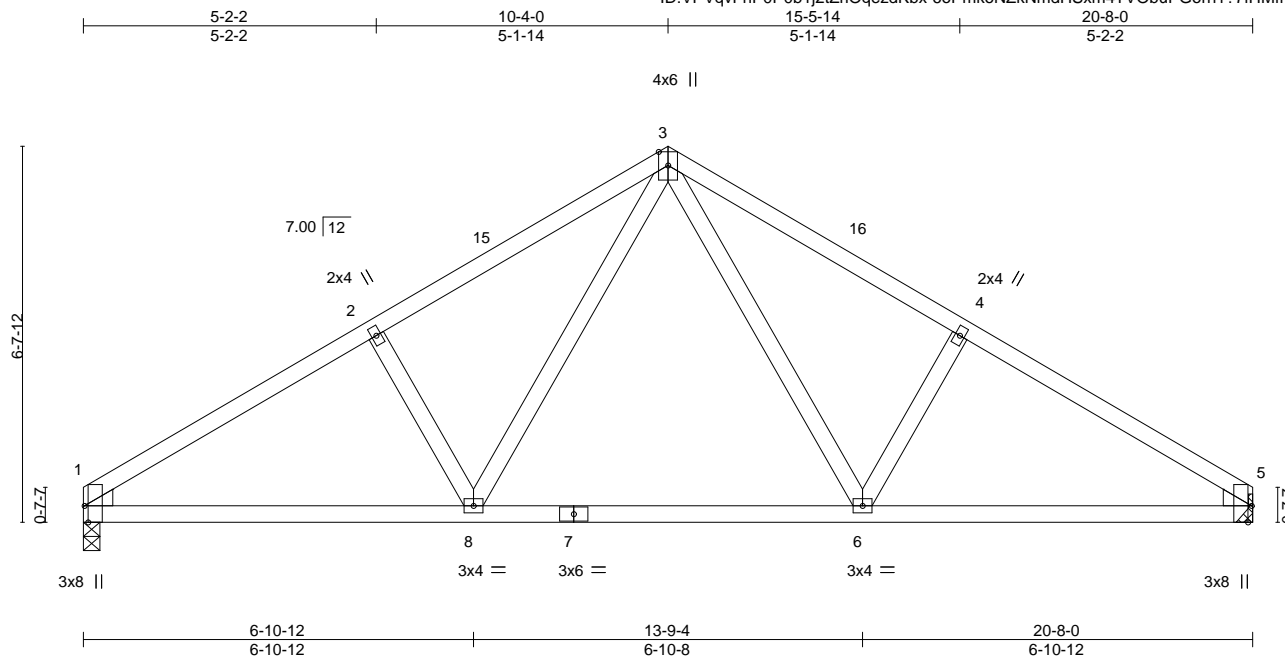


Plate Offsets (X,Y)-- [1:0-3-8,Edge], [5:0-3-8,Edge]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.26	Vert(LL)	-0.05 6-8 >999	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.38	Vert(CT)	-0.12 6-8 >999	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.12	Horz(CT)	0.03 5 n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 76 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 WEDGE
 Left: 2x4 SPF No.2, Right: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 1=0-3-8, 5=Mechanical
 Max Horz 1=-141(LC 8)
 Max Uplift 1=-112(LC 12), 5=-112(LC 13)
 Max Grav 1=930(LC 1), 5=930(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1383/180, 2-3=-1230/216, 3-4=-1230/216, 4-5=-1383/180
 BOT CHORD 1-8=-184/1125, 6-8=-45/770, 5-6=-96/1125
 WEBS 3-6=-114/471, 4-6=-319/175, 3-8=-114/471, 2-8=-319/175

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 10-4-0, Exterior(2R) 10-4-0 to 13-4-0, Interior(1) 13-4-0 to 20-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=112, 5=112.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2685114	Truss M11	Truss Type GABLE	Qty 1	Ply 1	Summit/88 MANOR	I45087414
----------------	--------------	---------------------	----------	----------	-----------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:03 2021 Page 1
ID:VPVqvFnP0P0b1j2tZr1OqezdKbx-iDkd6mLgRSO2Q_CBPLyhzFnqldoonkrghYCV7zd2CQ

0-11-0 0-11-0	10-4-0 10-4-0	20-8-0 10-4-0	21-7-0 0-11-0
------------------	------------------	------------------	------------------

Scale = 1:38.3

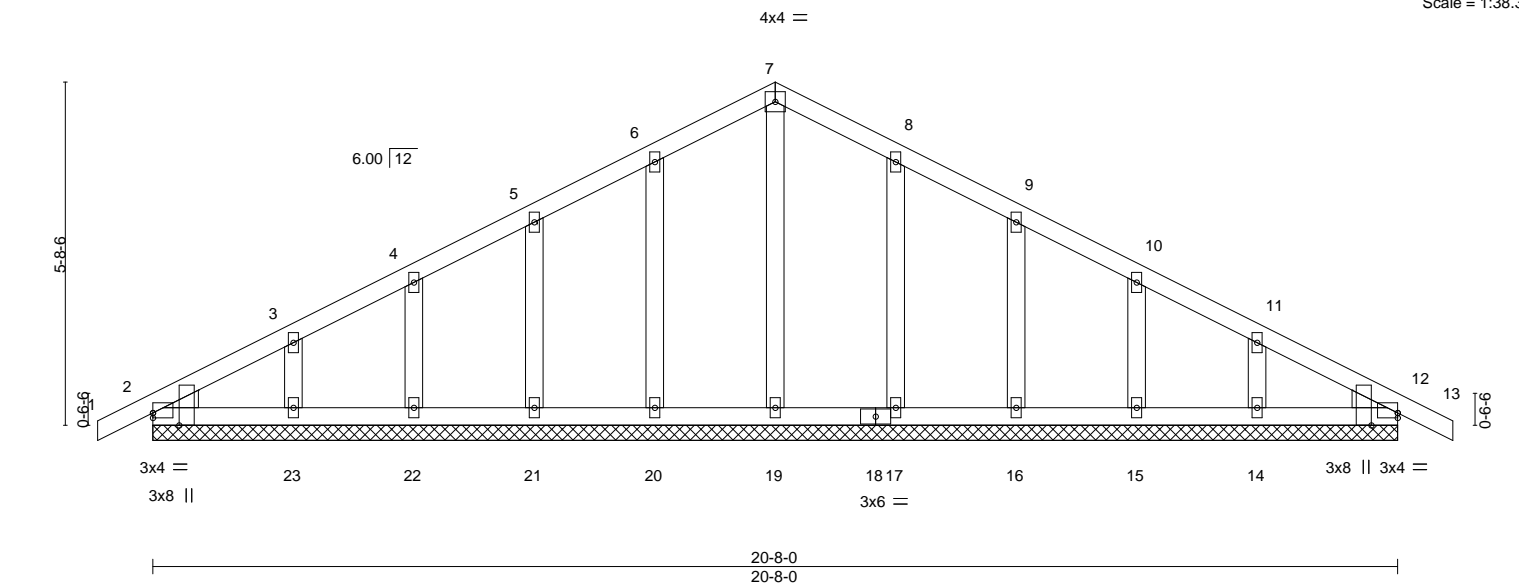


Plate Offsets (X,Y)--		[2:0-0-0,0-1-0], [2:0-2-7,Edge], [12:Edge,0-1-0], [12:0-2-7,Edge]	
LOADING (psf)	SPACING-	CSI.	DEFL.
TCLL 25.0	Plate Grip DOL 1.15	TC 0.05	in (loc) l/defl L/d
TCDL 10.0	Lumber DOL 1.15	BC 0.03	Vert(LL) -0.00 12 n/r 120
BCLL 0.0	Rep Stress Incr YES	WB 0.06	Vert(CT) -0.00 12 n/r 120
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S	Horz(CT) 0.00 12 n/a n/a
			PLATES GRIP
			MT20 197/144
			Weight: 84 lb FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2
WEDGE
Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 20-8-0.
(lb) - Max Horz 2=89(LC 12)
Max Uplift All uplift 100 lb or less at joint(s) 2, 20, 21, 22, 23, 17, 16, 15, 14, 12
Max Grav All reactions 250 lb or less at joint(s) 2, 19, 20, 21, 22, 23, 17, 16, 15, 14, 12

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-11-0 to 2-4-0, Exterior(2N) 2-4-0 to 10-4-0, Corner(3R) 10-4-0 to 13-4-0, Exterior(2N) 13-4-0 to 21-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 20, 21, 22, 23, 17, 16, 15, 14, 12.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	145087415
2685114	M12	Common	4	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:04 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-APH?J6MICiWv18nOz3TwWTJx11vnXAu?uLIm1azd2CP

0-11-0	5-3-1	10-4-0	15-4-15	20-8-0	21-7-0
0-11-0	5-3-1	5-0-15	5-0-15	5-3-1	0-11-0

Scale = 1:37.2

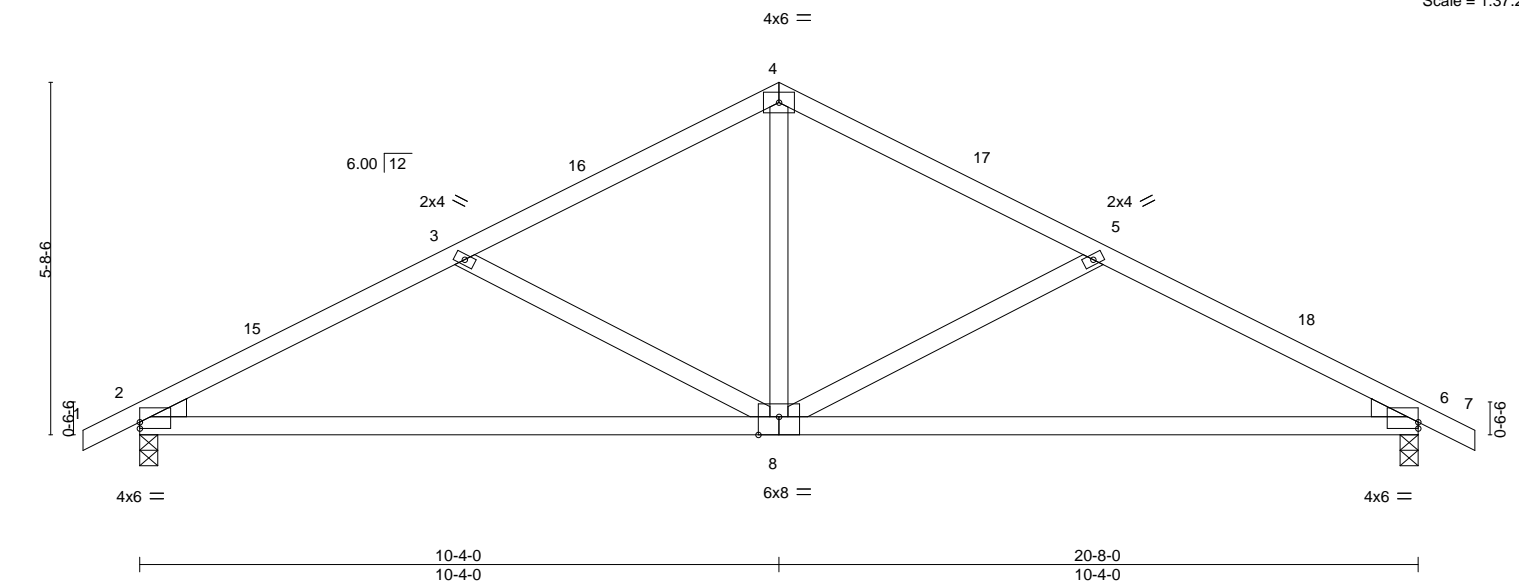


Plate Offsets (X,Y)-- [2:0-0-0,0-1-4], [6:Edge,0-1-4], [8:0-4-0,Edge]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	-0.17 8-11	>999	240
TCDL 10.0	Lumber DOL	1.15	BC 0.82	Vert(CT)	-0.35 8-11	>705	180
BCLL 0.0	Rep Stress Incr	YES	WB 0.26	Horz(CT)	0.04 6	n/a	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS				
				PLATES	GRIP		
				MT20	197/144		
				Weight: 73 lb	FT = 20%		

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
WEDGE

Left: 2x4 SP No.3, Right: 2x4 SP No.3

BRACING-

TOP CHORD Structural wood sheathing directly applied.
BOT CHORD Rigid ceiling directly applied.

REACTIONS.

(size) 2=0-3-8, 6=0-3-8
Max Horz 2=89(LC 12)
Max Uplift 2=-134(LC 12), 6=-134(LC 13)
Max Grav 2=994(LC 1), 6=994(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1524/304, 3-4=-1135/238, 4-5=-1135/238, 5-6=-1524/304
BOT CHORD 2-8=-206/1297, 6-8=-198/1297
WEBS 4-8=-64/585, 5-8=-432/192, 3-8=-432/191

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 10-4-0, Exterior(2R) 10-4-0 to 13-4-0, Interior(1) 13-4-0 to 21-7-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=134, 6=134.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087416
2685114	PB1	Piggyback	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:07 2021 Page 1


ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-a_z8x8OBVguUvbWzeB1d85xUOF6XkbTRbJWQeuzd2CM

6-7-4

6-7-4

4x4 =

Scale = 1:13.0

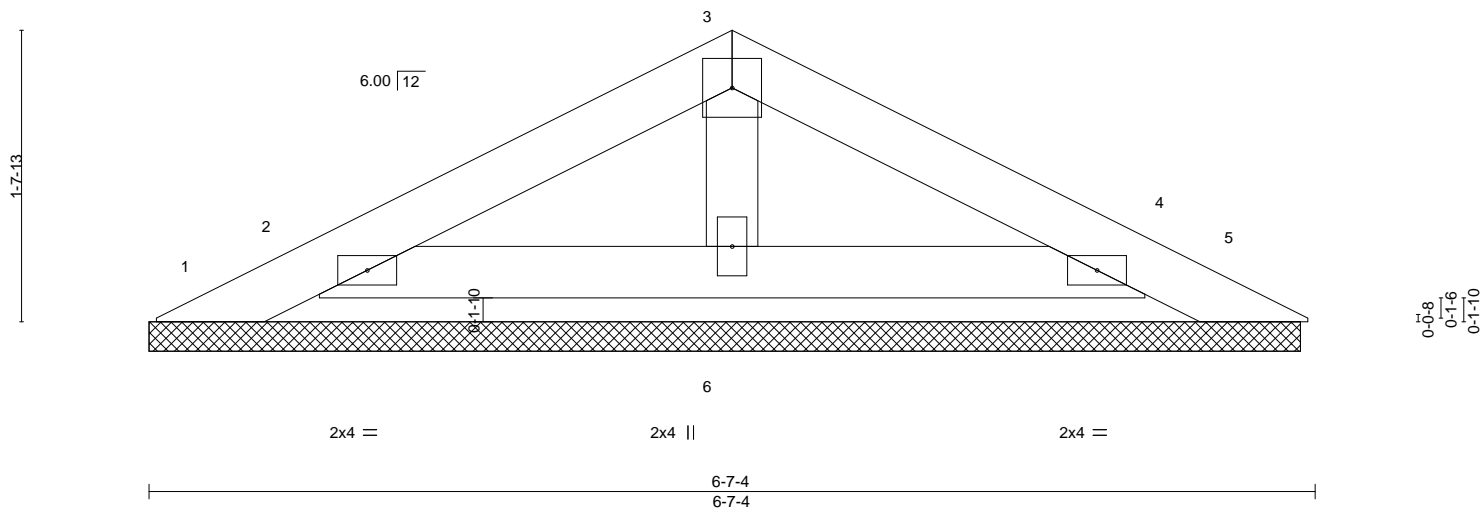

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 15 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 6-6-4.
(lb) - Max Horz 1=23(LC 13)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 2, 4
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 2, 4, 6

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 2, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087417
2685114	PB2	Piggyback	19	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:08 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-2BXW9UPpG_0LWf59CuYsgJuf2ePsT2yapzGzALzd2CL



3x6 =

Scale = 1:13.0

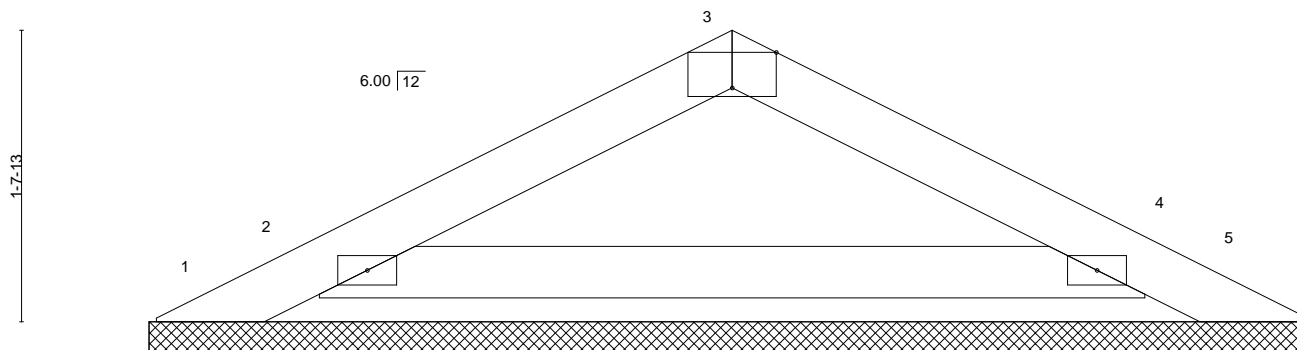

0-0-8
0-1-6
0-1-10

2x4 =

2x4 =

6-7-4

6-7-4

Plate Offsets (X,Y)-- [3:0-3-0,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.23	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 14 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 6-6-4.
(lb) - Max Horz 1=23(LC 13)
Max Uplift All uplift 100 lb or less at joint(s) 1, 5, 2, 4
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 2=307(LC 1), 4=307(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5, 2, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087418
2685114	V1	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:09 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-WN5uMqPR1I8C8vgLlc35DW1mG2IHCVJk2d?Xjnzdz2CK

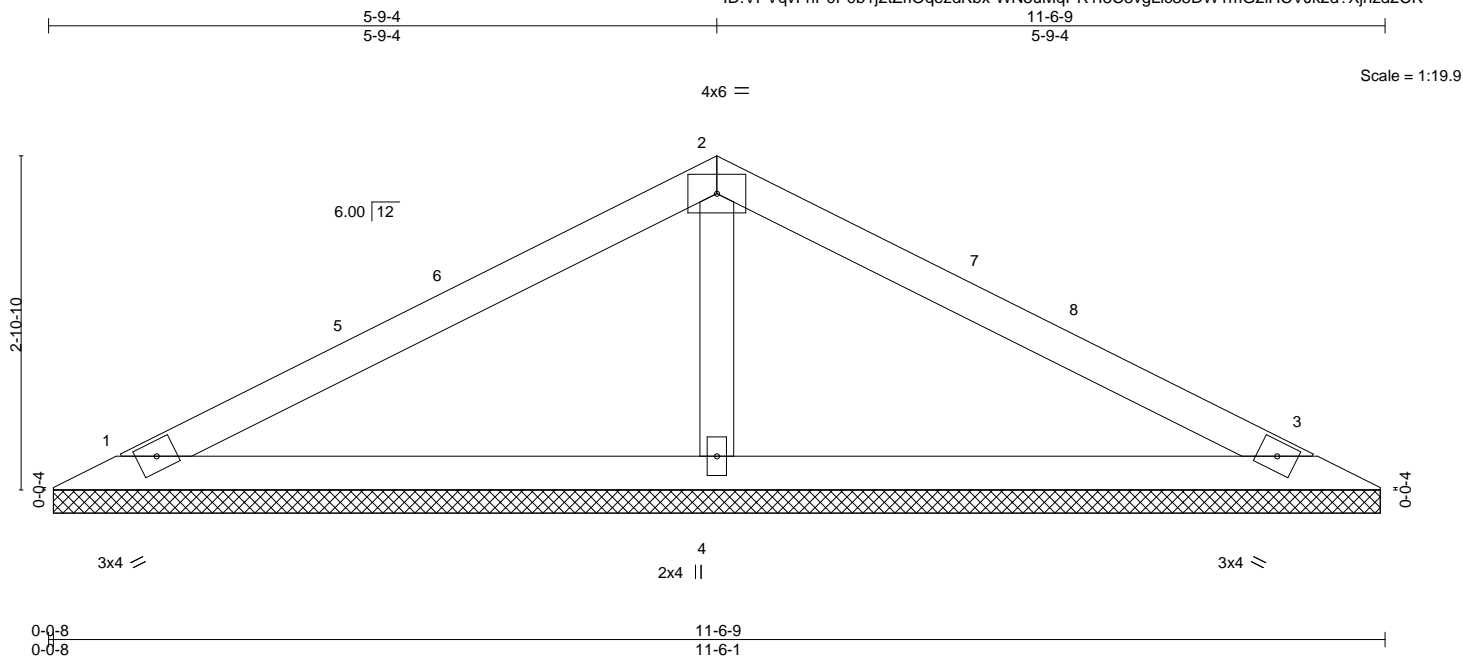

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.22	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 29 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=11-5-9, 3=11-5-9, 4=11-5-9
Max Horz 1=41(LC 12)
Max Uplift 1=40(LC 12), 3=48(LC 13), 4=36(LC 12)
Max Grav 1=214(LC 25), 3=214(LC 26), 4=504(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-4=-348/169

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 5-9-4, Exterior(2R) 5-9-4 to 8-9-4, Interior(1) 8-9-4 to 10-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087419
2685114	V2	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:16 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-pj0YqDVqNR1CU_ihgahk??p0YtA3LgWmfDCOTt2d2CD



Scale = 1:14.1

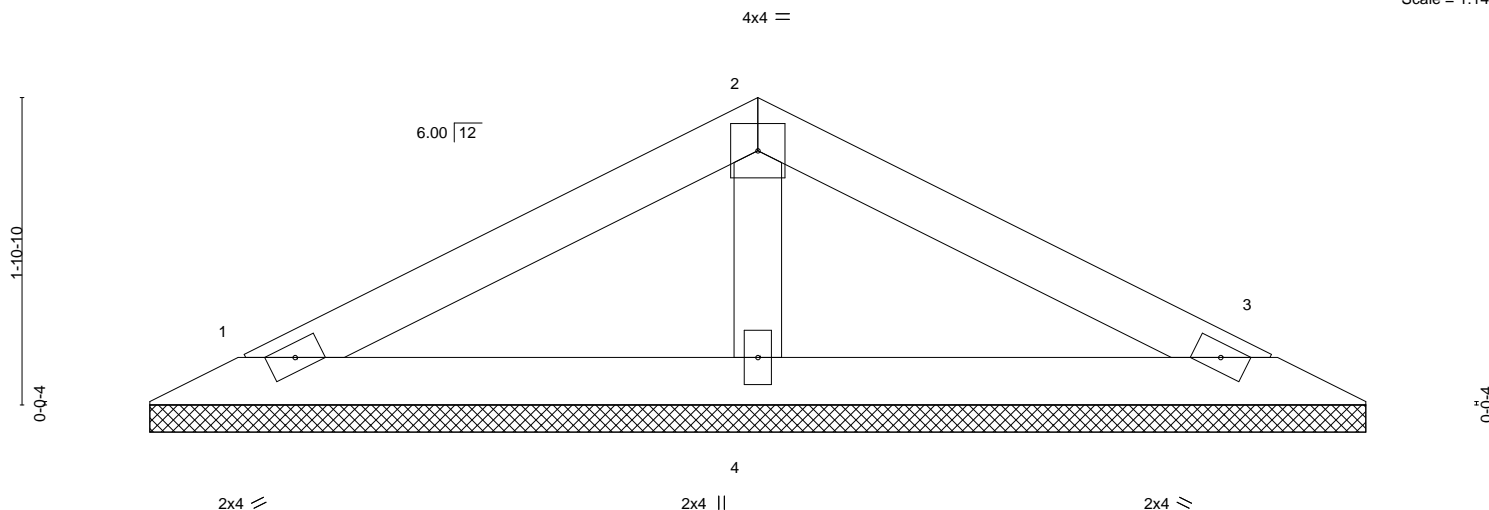

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 18 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=7-5-9, 3=7-5-9, 4=7-5-9
Max Horz 1=25(LC 13)
Max Uplift 1=30(LC 12), 3=35(LC 13), 4=11(LC 12)
Max Grav 1=144(LC 1), 3=144(LC 1), 4=278(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**
Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087420
2685114	V4	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:18 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-m68IFvW4v3HwjIs4n?jC4QuMggrkpas36XhVXmzd2CB

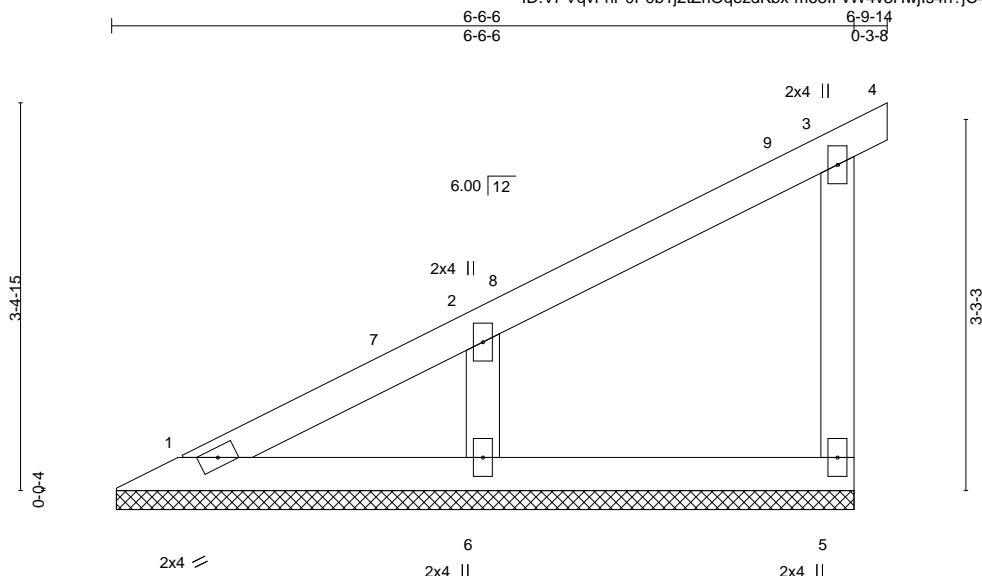

Scale = 1:20.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.14	Vert(LL)	0.00	3	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00	4	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 20 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=6-5-14, 5=6-5-14, 6=6-5-14
Max Horz 1=115(LC 9)
Max Uplift 5=35(LC 9), 6=91(LC 12)
Max Grav 1=89(LC 20), 5=143(LC 1), 6=322(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 6-9-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 6.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087421
2685114	V5	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:19 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-ElhgTFXigMPnLRRGLiERddRWI4BEY1gCLBQ33Czd2CA

4-2-10 4-2-10 4-6-2 0-3-8

Scale = 1:14.1

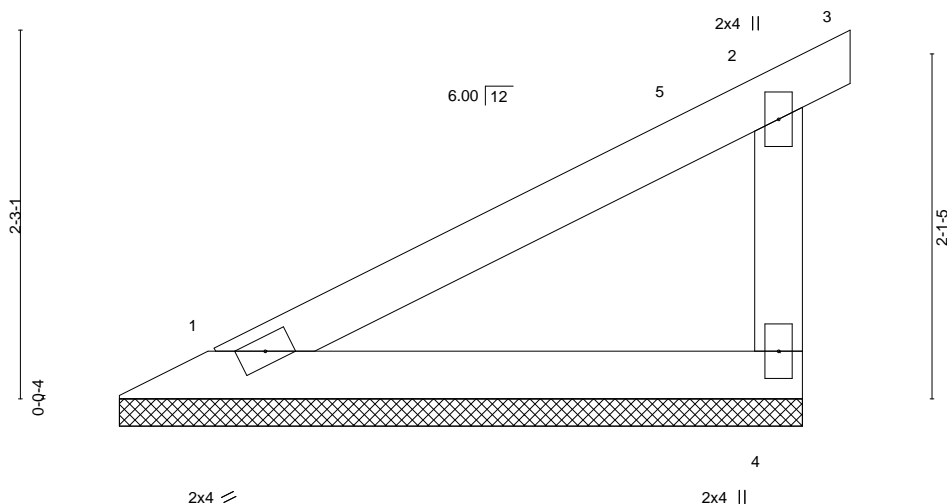

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.21	Vert(LL)	-0.00	2	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	0.00	3	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 11 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-2-10 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=4-2-2, 4=4-2-2
Max Horz 1=72(LC 9)
Max Uplift 1=-16(LC 12), 4=-49(LC 12)
Max Grav 1=153(LC 1), 4=187(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 4-6-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087422
2685114	V6	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:19 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-ElhgTFXigMPnLRRGLIERddRXo4BZY0eCLBQ33Czd2CA

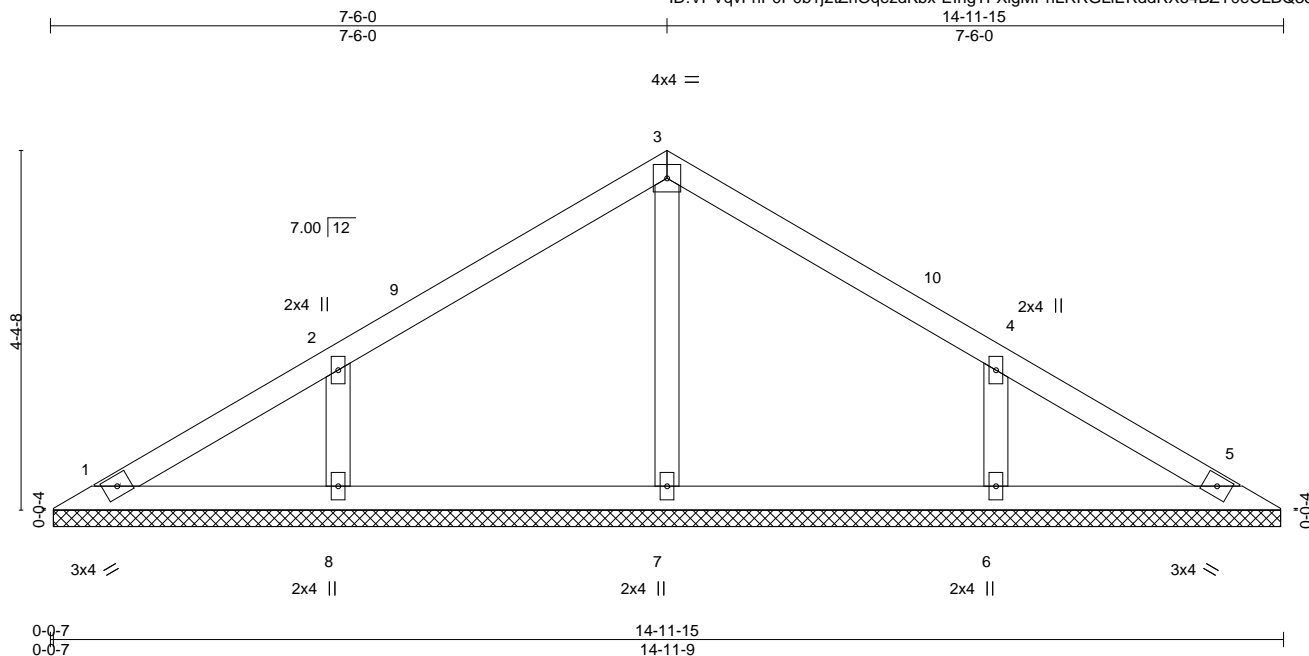

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 43 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 14-11-2.
(lb) - Max Horz 1=-95(LC 8)
Max Uplift All uplift 100 lb or less at joint(s) 1 except 8=-124(LC 12), 6=-123(LC 13)
Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 7=302(LC 1), 8=373(LC 25), 6=373(LC 26)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
WEBS 2-8=-293/153, 4-6=-293/153

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-6-8 to 3-6-0, Interior(1) 3-6-0 to 7-6-0, Exterior(2R) 7-6-0 to 10-6-0, Interior(1) 10-6-0 to 14-5-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 8=124, 6=123.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2685114	Truss V7	Truss Type Valley	Qty 1	Ply 1	Summit/88 MANOR	I45087423
Builders FirstSource (Valley Center), Valley Center, KS - 67147,						Job Reference (optional)

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:20 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-iUF2gaYLRgXeyb0TvQlqAq_eDUVhHTvLaqAccezd2C9

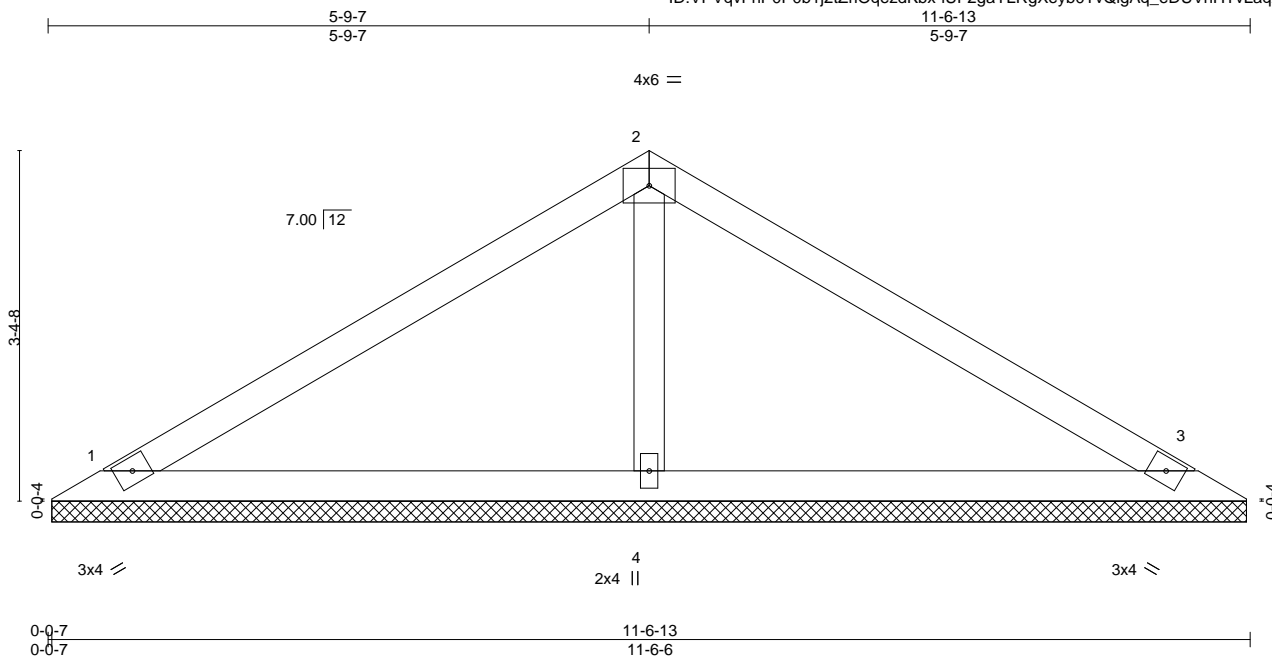

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.39	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.23	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 30 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=11-5-15, 3=11-5-15, 4=11-5-15
Max Horz 1=-72(LC 10)
Max Uplift 1=-41(LC 12), 3=-50(LC 13), 4=-33(LC 12)
Max Grav 1=223(LC 25), 3=223(LC 26), 4=497(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-4=-338/108

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-6-8 to 3-6-8, Interior(1) 3-6-8 to 5-9-7, Exterior(2R) 5-9-7 to 8-9-7, Interior(1) 8-9-7 to 11-0-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2685114	Truss V8	Truss Type Valley	Qty 1	Ply 1	Summit/88 MANOR Job Reference (optional)	I45087424
----------------	-------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:22 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-etNp5GabhHnMCv9r0ro8FF30EID6INxe18fjgXzd2C7

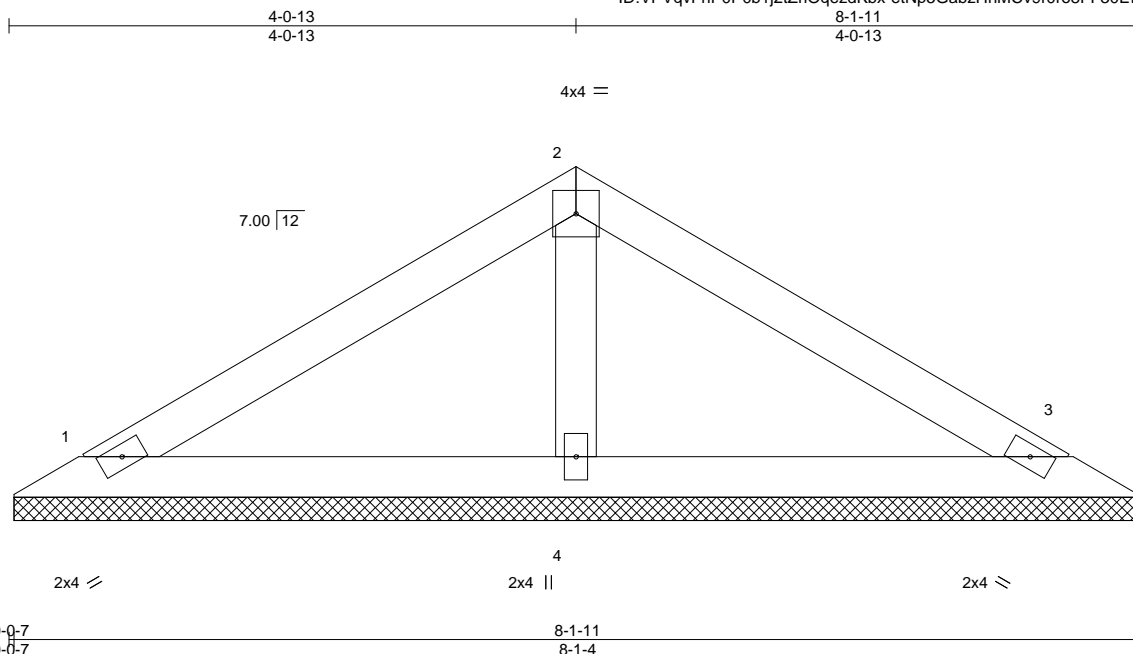

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.23	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.11	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 21 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=8-0-13, 3=8-0-13, 4=8-0-13
Max Horz 1=48(LC 9)
Max Uplift 1=34(LC 12), 3=41(LC 13), 4=9(LC 12)
Max Grav 1=167(LC 1), 3=167(LC 1), 4=302(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-6-8 to 3-6-8, Interior(1) 3-6-8 to 4-0-13, Exterior(2R) 4-0-13 to 7-0-13, Interior(1) 7-0-13 to 7-7-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087425
2685114	V9	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:25 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-2S3xjlcTGCaw3MuQhzLrsuhaBVDKy94j6tNhszd2C4

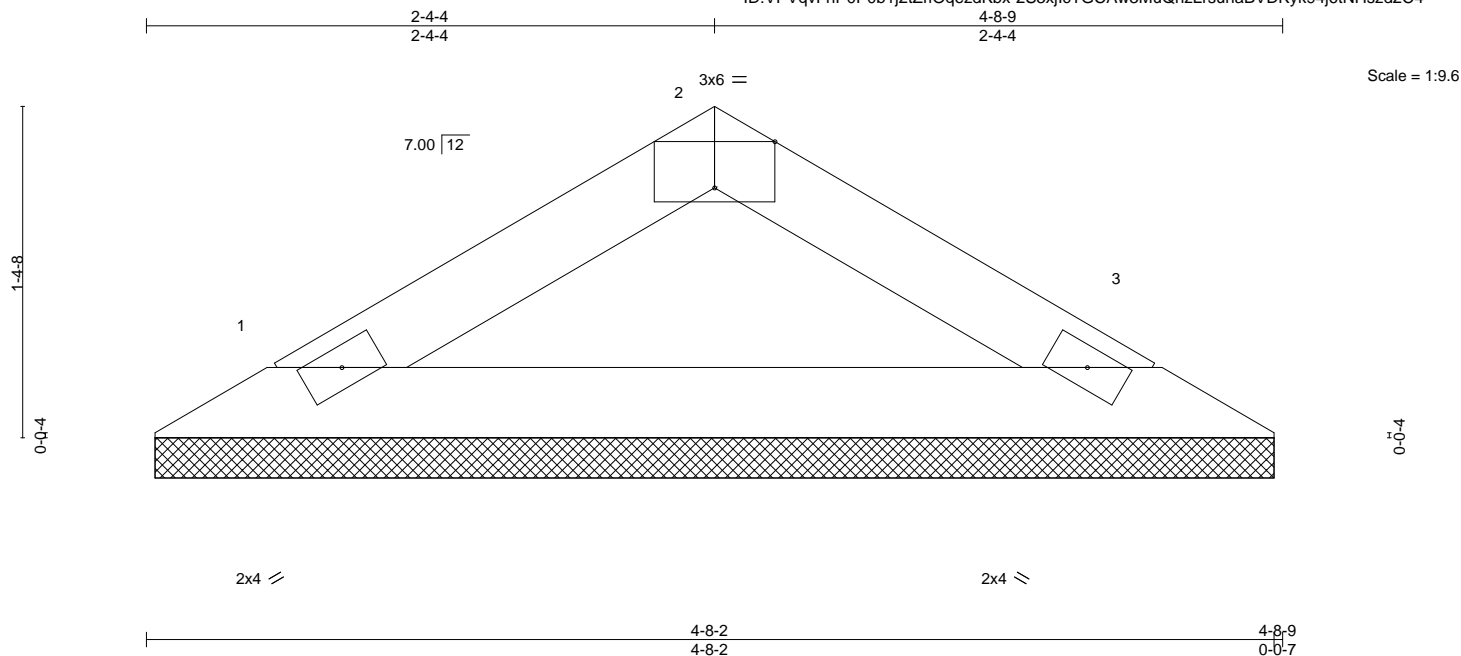


Plate Offsets (X,Y)--		[2:0-3-0,Edge]									
LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.14	Vert(CT)	n/a				
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.00				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-P							
								Weight: 10 lb		FT = 20%	

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-8-9 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=4-7-11, 3=4-7-11
Max Horz 1=-25(LC 8)
Max Uplift 1=-20(LC 12), 3=-20(LC 13)
Max Grav 1=163(LC 1), 3=163(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:10 2021 Page 1
ID:VPVqVnFP0P0b1j2iZrlQgezdBKb-?ZfHaAQ3obH2m3FYJJaKmkZ 9S7bxybtHHl4FDzd2CJ

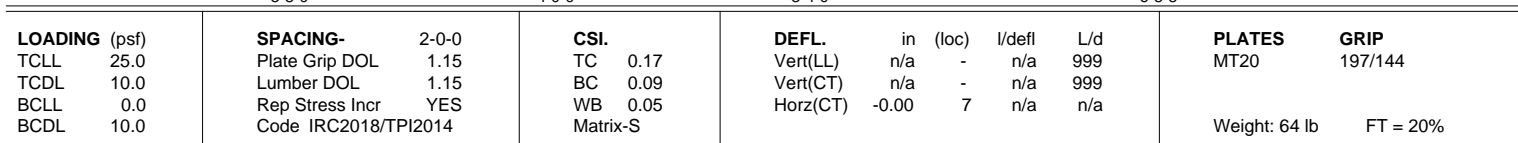

REACTIONS. All bearings 17-8-8.
 (lb) - Max Horz 1=188(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 7, 8, 10, 9 except 12=109(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 1, 7 except 8=301(LC 1), 10=280(LC 1), 9=315(LC 1), 12=372(LC 1)

NOTES-


- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-8-0, Interior(1) 3-8-0 to 7-8-0, Exterior(2R) 7-8-0 to 10-8-0, Interior(1) 10-8-0 to 17-6-12 zone; cantilever left and right exposed ; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 8, 10, 9 except (jt=lb) 12=109.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087427
2685114	V11	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:10 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-?ZfHaAQ3obH2m3FYJJJaKmkZyCS6bxyatHHI4FDzd2CJ

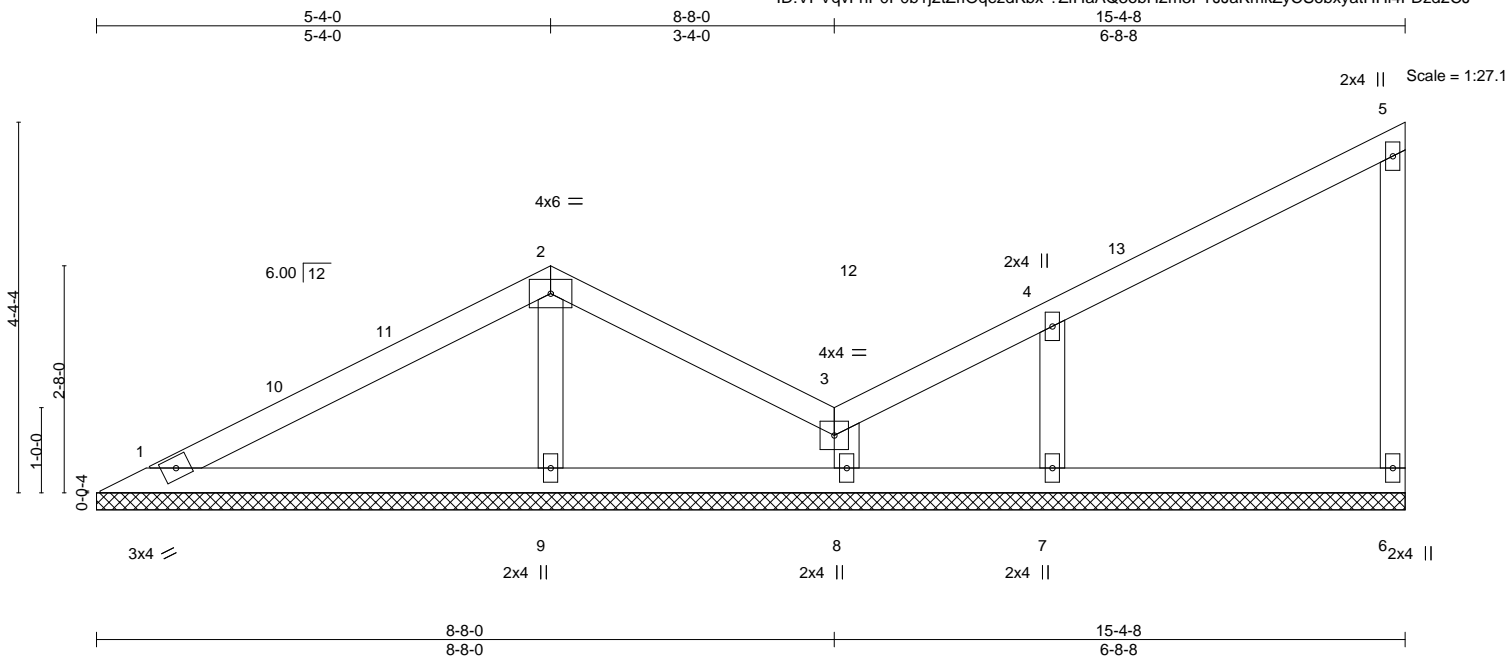

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	-0.00	6	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 46 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

All bearings 15-4-8.
(lb) - Max Horz 1=149(LC 9)
Max Uplift All uplift 100 lb or less at joint(s) 1, 6, 7 except 9=133(LC 12)
Max Grav All reactions 250 lb or less at joint(s) 1, 6, 8 except 9=373(LC 1), 7=352(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-9=-256/312, 4-7=-274/156

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 5-4-0, Exterior(2R) 5-4-0 to 8-4-0, Interior(1) 8-4-0 to 15-2-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 6, 7 except (jt=lb) 9=133.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087428
2685114	V12	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:11 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-TmDfnVRhZvPvNDqkt15Zlx69XsSAGP61VxUengzd2CI

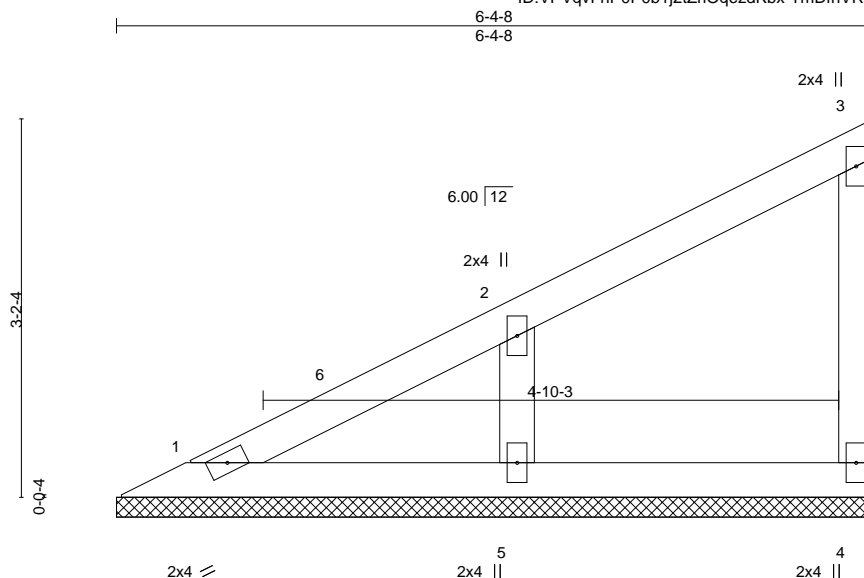

Scale = 1:19.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 19 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=6-4-8, 4=6-4-8, 5=6-4-8
Max Horz 1=105(LC 9)
Max Uplift 4=19(LC 9), 5=89(LC 12)
Max Grav 1=94(LC 20), 4=98(LC 1), 5=315(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-4-8, Interior(1) 3-4-8 to 6-2-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087429
2685114	V13	Valley	1	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:12 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrlOqezdKbx-xym1?rSJKDXm?NOwRkcor9fLpGphPseAkbEBJ6zd2CH



Scale: 1"=1'

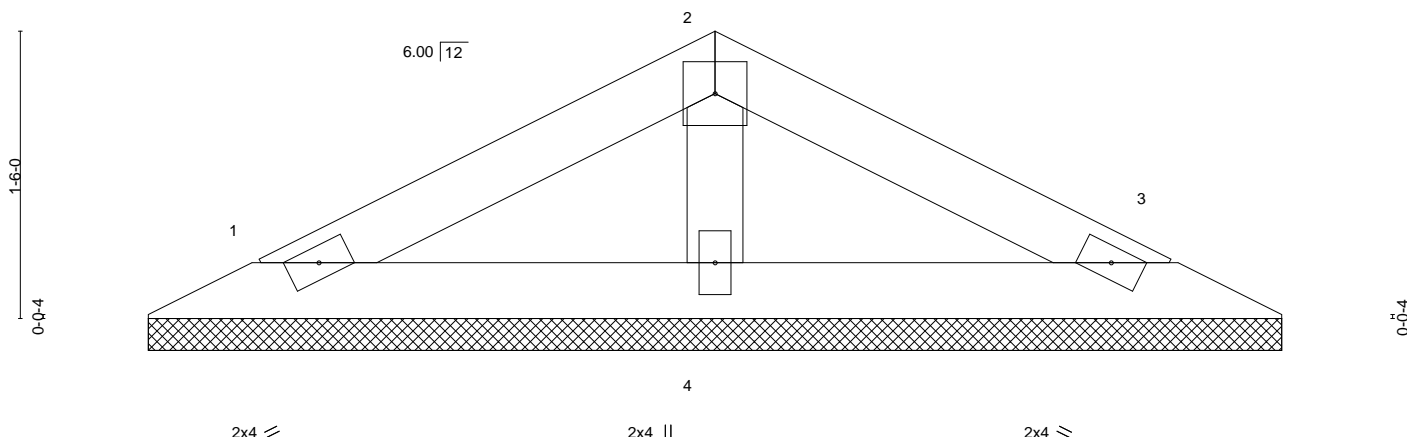

0-0-8				6-0-1						
0-0-8				5-11-9						
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.10	Vert(LL)	n/a - n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(CT)	n/a - n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00 3 n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 14 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


REACTIONS.

(size) 1=5-11-1, 3=5-11-1, 4=5-11-1
Max Horz 1=19(LC 12)
Max Uplift 1=23(LC 12), 3=26(LC 13), 4=8(LC 12)
Max Grav 1=109(LC 1), 3=109(LC 1), 4=210(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

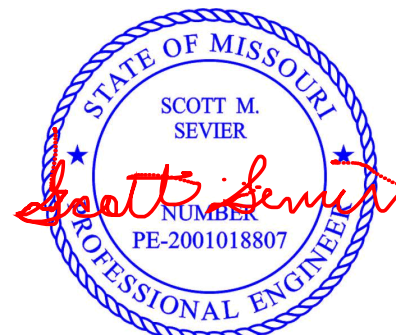

March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR	I45087430
2685114	V14	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:13 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-P8KPCBTy5WfddWz6_S71NMBU3f828JBzFzksYzd2CG

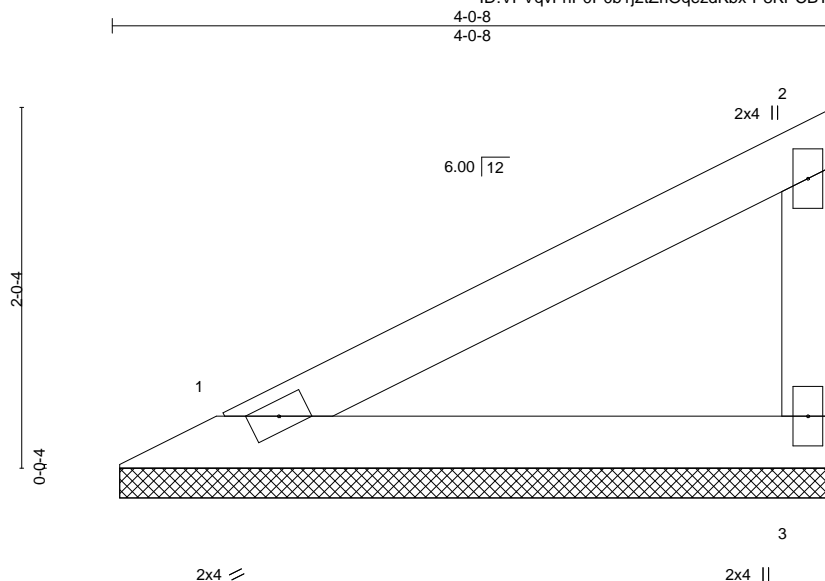

Scale = 1:12.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.19	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 11 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-8 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=4-0-0, 3=4-0-0
Max Horz 1=61(LC 9)
Max Uplift 1=-19(LC 12), 3=-34(LC 12)
Max Grav 1=147(LC 1), 3=147(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job 2685114	Truss V15	Truss Type Valley	Qty 1	Ply 1	Summit/88 MANOR Job Reference (optional)	I45087431
----------------	--------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:14 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-tKunPXTasqnUEgYJY9fGwakh93V?tmRTCvjIO_zd2CF

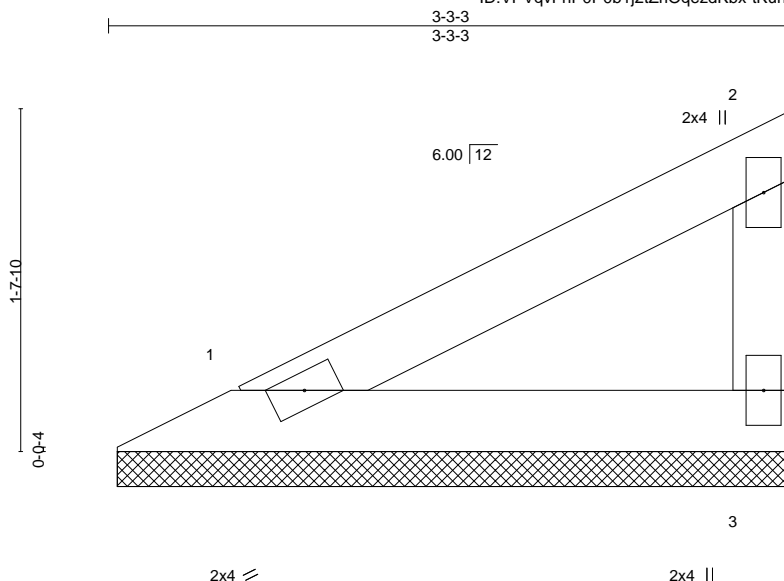

Scale = 1:11.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 8 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-3-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=3-2-11, 3=3-2-11
Max Horz 1=47(LC 9)
Max Uplift 1=-14(LC 12), 3=-26(LC 12)
Max Grav 1=112(LC 1), 3=112(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job 2685114	Truss V16	Truss Type Valley	Qty 1	Ply 1	Summit/88 MANOR Job Reference (optional)	I45087432
----------------	--------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:14 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-tKunPXTasqnUEgYJY9fGwakcq3S7tmRTCvjO_zd2CF

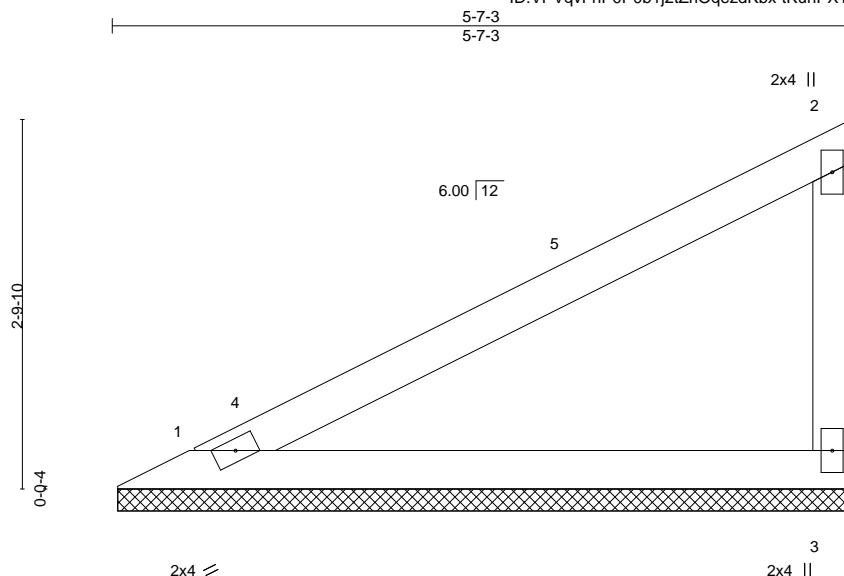

Scale = 1:17.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.45	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.24	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 15 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-7-3 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 1=5-6-11, 3=5-6-11
Max Horz 1=90(LC 11)
Max Uplift 1=-28(LC 12), 3=-51(LC 12)
Max Grav 1=217(LC 1), 3=217(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 5-5-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR
2685114	V17	Valley	1	1	I45087433
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:15 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-LXS9dtUCd8vLsq7V6sAVTnGr4TqYcDvcQZSrwRzd2CE

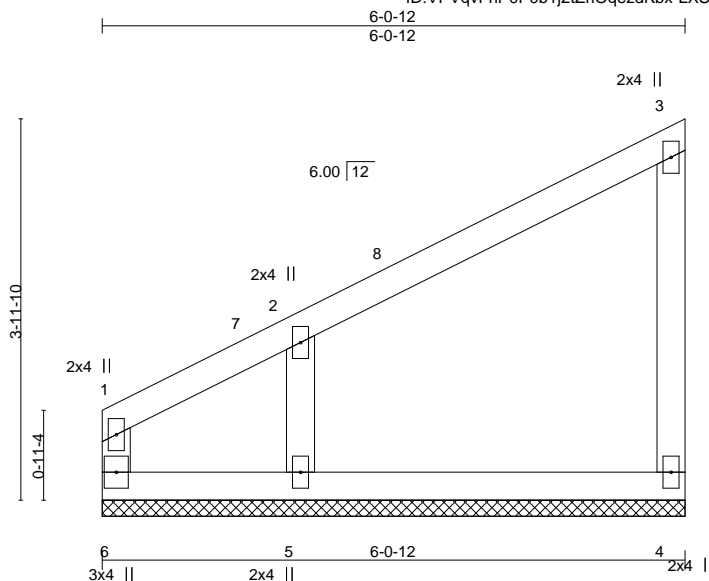

Scale: 1/2"=1'

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.16	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R						Weight: 21 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=6-0-12, 4=6-0-12, 5=6-0-12
 Max Horz 6=132(LC 11)
 Max Uplift 6=-2(LC 8), 4=-25(LC 12), 5=-123(LC 12)
 Max Grav 6=84(LC 11), 4=150(LC 1), 5=332(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-5=-261/282

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 5-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 4 except (jt=lb) 5=123.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR
2685114	V18	Valley	1	1	I45087434
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:15 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-LXS9dtUCd8vLsq7V6sAVTnGjFTmZcCzcQZSrwRzd2CE

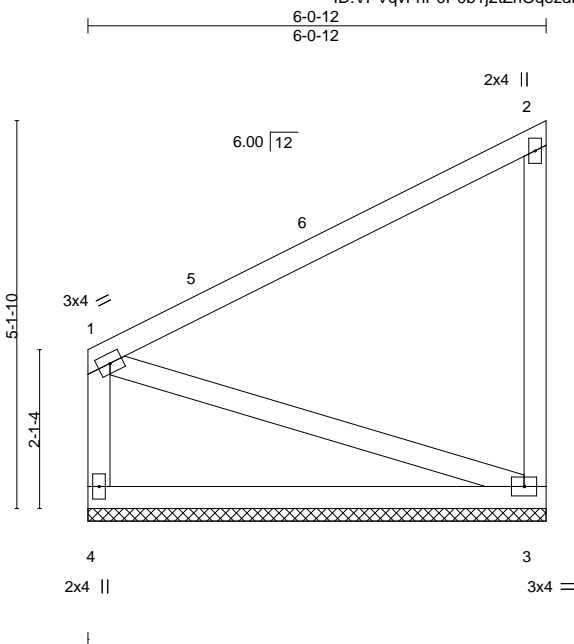

Scale = 1:30.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.66	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.36	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.11	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 28 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=6-0-12, 3=6-0-12
Max Horz 4=172(LC 11)
Max Uplift 4=-25(LC 12), 3=-78(LC 9)
Max Grav 4=260(LC 1), 3=260(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

BOT CHORD 3-4=-312/229
WEBS 1-3=-175/269

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 5-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR
2685114	V19	Valley	1	1	I45087435
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:16 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-pj0YqDVqNR1CU_ihgahk??pu?t6oLg0mfDCOTtZd2CD

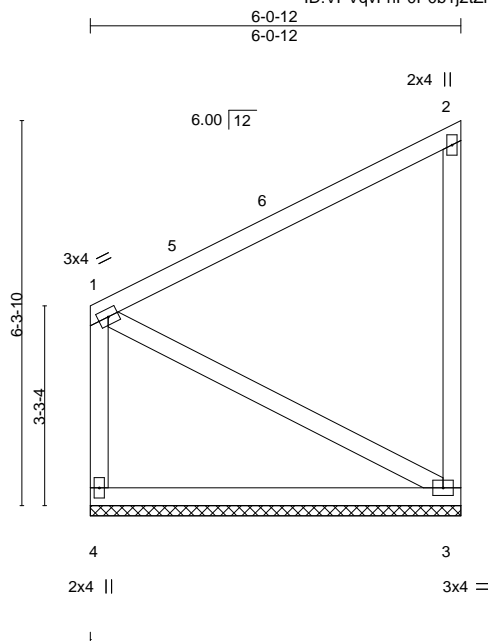

Scale = 1:37.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.66	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.36	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 31 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=6-0-12, 3=6-0-12
Max Horz 4=106(LC 12)
Max Uplift 3=129(LC 12)
Max Grav 4=260(LC 1), 3=260(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 5-11-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 3=129.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/88 MANOR
2685114	V20	GABLE	1	1	I45087436
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Feb 12 2021 MiTek Industries, Inc. Mon Mar 8 08:00:17 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrlOqezdKbx-Hvaw2ZWS8l9358HuDHCzYCM7OHVV46Vvutxy?Jzd2CC

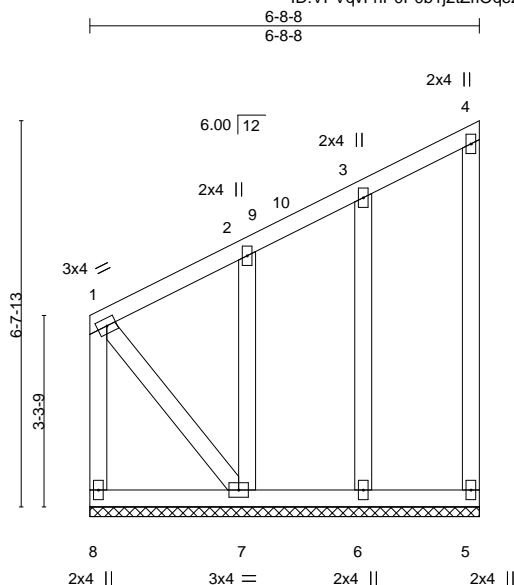

Scale = 1:39.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.43	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.11	Horz(CT)	-0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 41 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 8-8-14 oc bracing.

REACTIONS.

All bearings 6-8-8.

(lb) - Max Horz 8=225(LC 9)

Max Uplift All uplift 100 lb or less at joint(s) 8, 5, 6 except 7=196(LC 9)

Max Grav All reactions 250 lb or less at joint(s) 8, 5, 6 except 7=264(LC 19)

FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-8=-543/318, 1-2=-321/203

BOT CHORD 7-8=-462/341

WEBS 1-7=-365/607

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-1-12 to 3-1-12, Exterior(2N) 3-1-12 to 6-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 5) Gable studs spaced at 2-0-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 5, 6 except (jt=lb) 7=196.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



March 8, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Symbols

PLATE LOCATION AND ORIENTATION

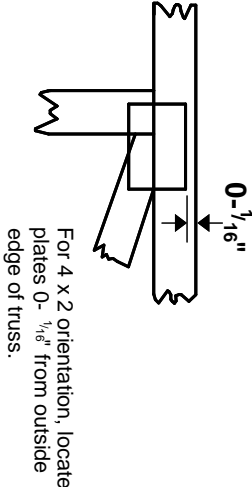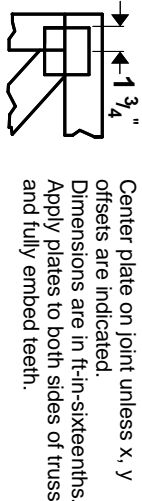

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.


This symbol indicates the required direction of slots in connector plates.

PLATE SIZE


4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION




BEARING

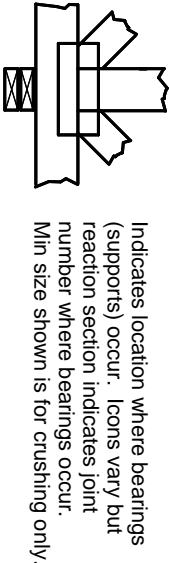

Industry Standards:
ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

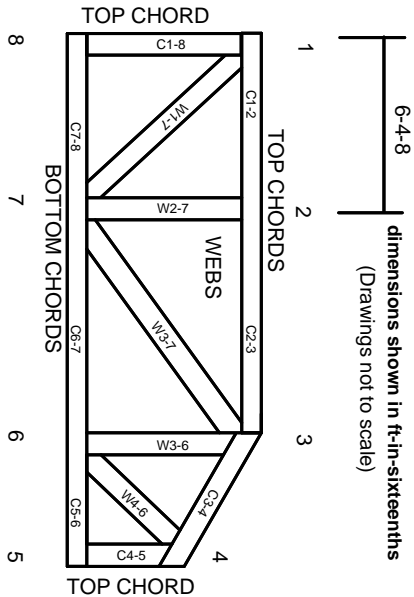

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:
ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved



MITek Engineering Reference Sheet: MII-7473 rev. 5/19/2020

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.