


- NOTES:
1. THIS WALL DESIGN IS BASED ON THE PROJECT PLANS PREPARED BY KAW VALLEY ENGINEERING DATED 7-3-19.
 2. SEE THE PROJECT PLANS FOR WALL LAYOUT.
 3. THE CONTRACTOR SHALL VERIFY ELEVATIONS PRIOR TO CONSTRUCTION.
 4. TEMPORARY EXCAVATION STABILITY DESIGN AND THE SHORING REQUIREMENTS ARE BEYOND THE SCOPE OF THIS DESIGN AND ARE THE RESPONSIBILITY OF THE CONTRACTOR.
 5. THE TWBW NOTATIONS ON THE PROJECT PLAN VIEWS ARE THE ESTIMATED ELEVATIONS PROVIDED BY THE PROJECT ENGINEER. SEE THE RETAINING WALL ELEVATION VIEWS FOR ACTUAL TOP OF WALL ELEVATIONS.
 6. ANGLE POINTS MAY BE CONSTRUCTED AS RADIUS CORNERS WITH THE APPROVAL OF THE OWNER.
 7. COORDINATE SEWER CONSTRUCTION AND UTILITY CONSTRUCTION WITH WALL CONSTRUCTION TO PREVENT DAMAGE TO GEOGRIDS AND THE RETAINING WALL SYSTEM.
 8. ALL ROOF DRAINS TO BE PIPED AROUND THE RETAINING WALLS.

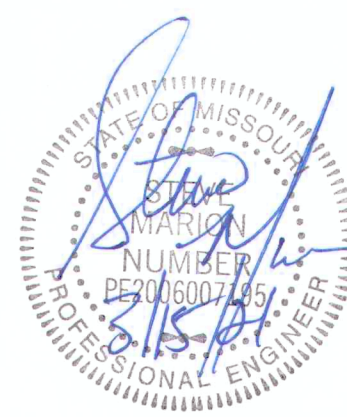


15 Ellis Avenue, Troy, MO 63379
(636) 462-4132 www.aspeninc.net


| STREETS OF WEST PRYOR LEE'S SUMMIT, MO | |
|---|--------------------|
| VENTURE | PLANELEVATION VIEW |
| Revision: WALL E ONLY, NEW SECT AT STA 2+62.5 | Date: 3-10-2021 |
| Revision: | Sheet: 1 of 2 |

MO Certificate of Authority #E-2013027915

13 JOB NUMBER: 19-3096

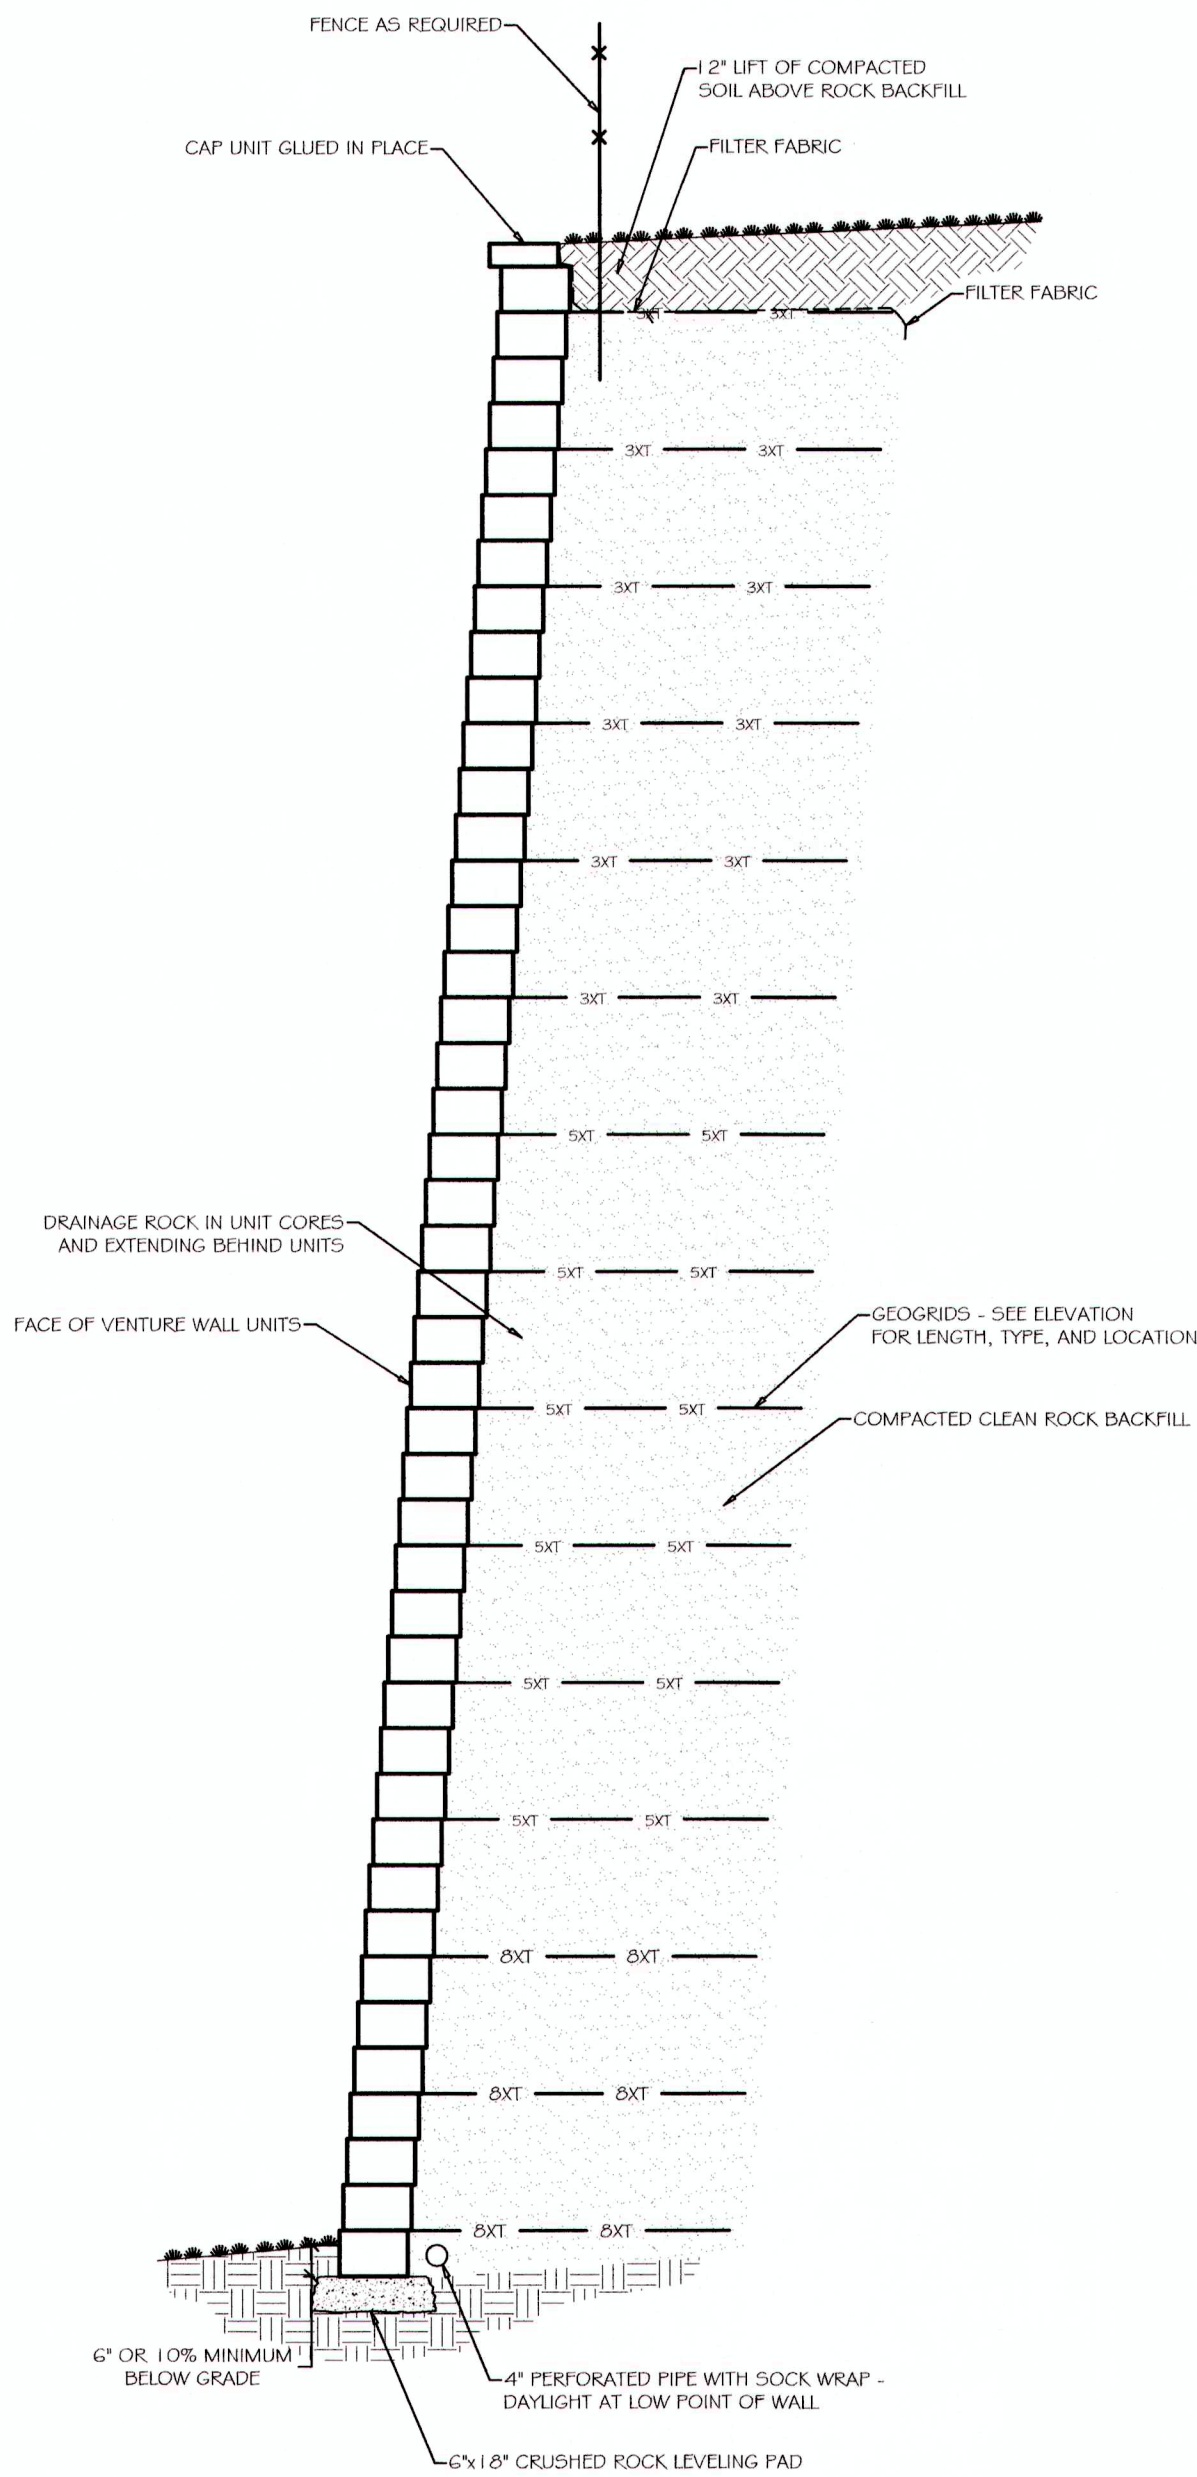


TYPICAL SECTION
NOT TO SCALE


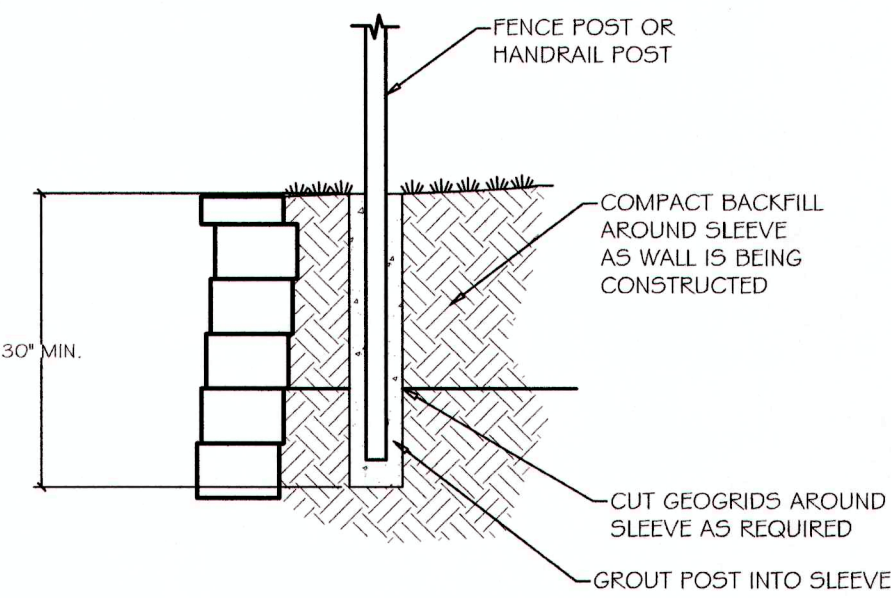


-PLACE SONOTUBE IN FILL AS BACKFILL IS BEING COMPACTED
-THE FENCE DESIGN AND SUITABILITY IS THE RESPONSIBILITY OF OTHERS


FENCE DETAIL
NOT TO SCALE

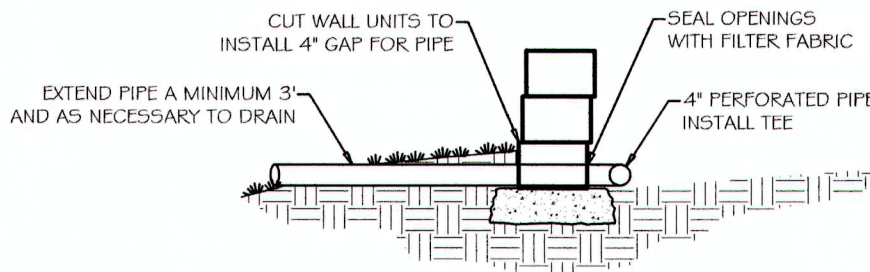


PERFORATED PIPE OUTLET - TYPE I
NOT TO SCALE

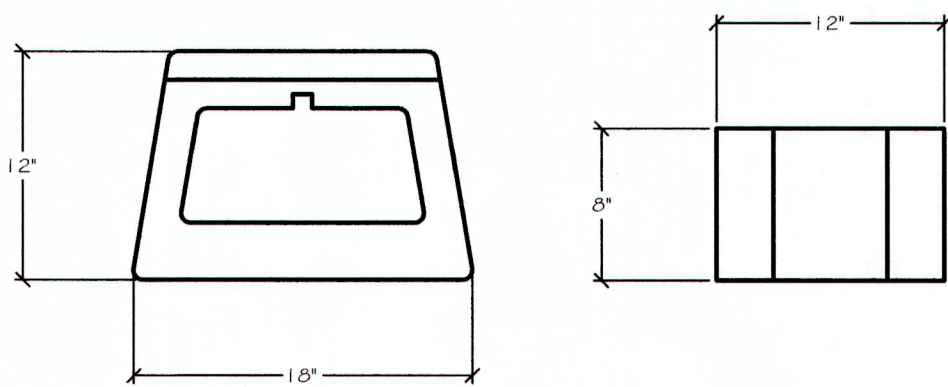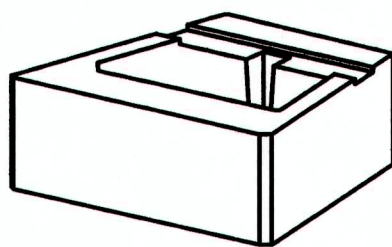

VENTURE UNIT
NOT TO SCALE

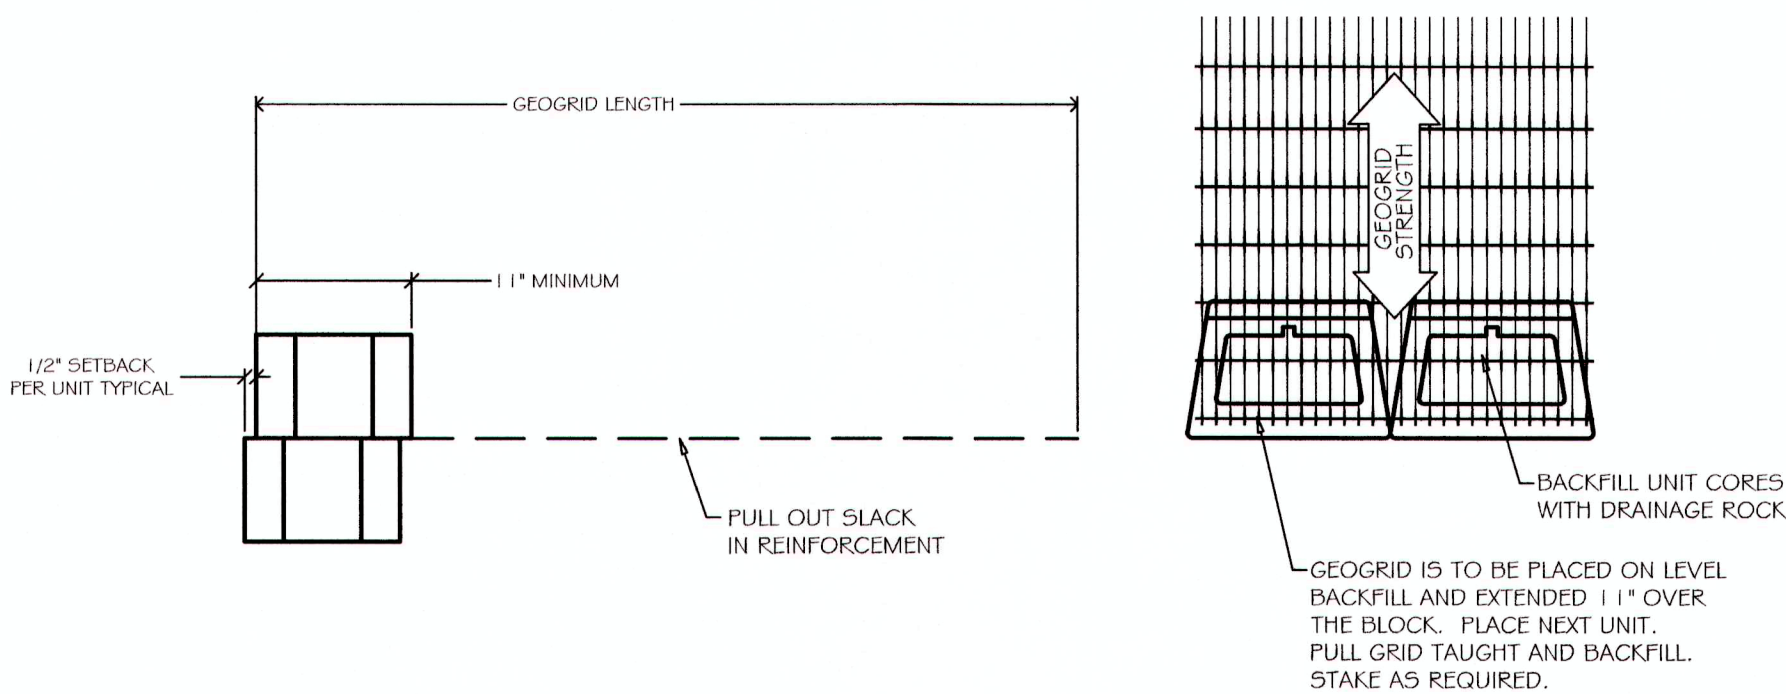

CONNECTION DETAIL
NOT TO SCALE

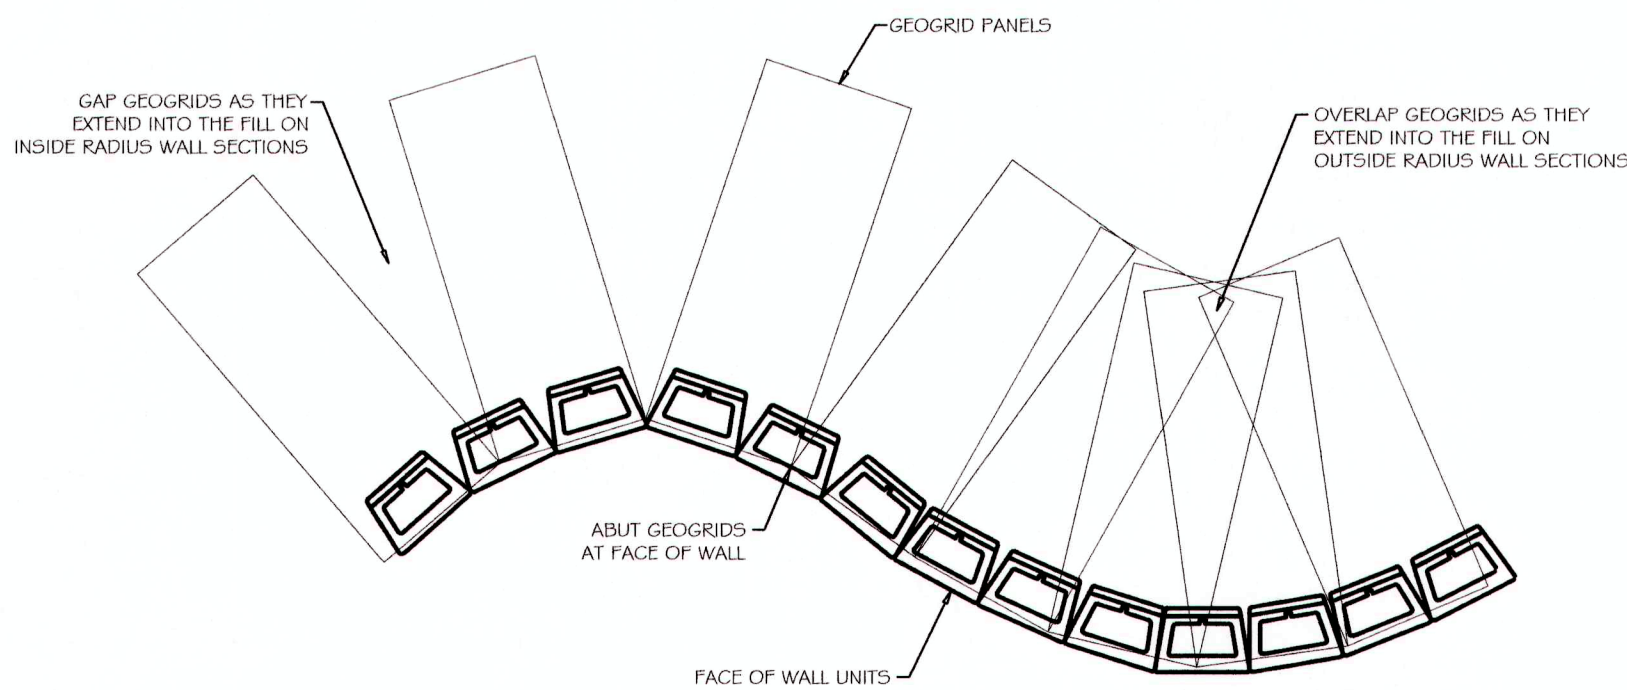

RADIUS DETAIL
NOT TO SCALE

SPECIFICATIONS FOR RETAINING WALL - STREETS OF WEST PRYOR MATERIALS

Retaining wall units shall be VENTUREblock units. The units are 18" wide x 8" tall x 12" deep with a split face finish. The color shall be chosen by the owner. Concrete wall units shall meet the requirements of ASTM C 1372 and compressive strength shall be a minimum 3000 psi and the maximum water absorption shall be limited to 8.0 percent.

The reinforced wall backfill material shall be compacted ROCK. The rock shall be crushed limestone with a maximum 1" particle size and a maximum of 5% passing the #200 sieve, similar to 1" clean gradation (drainage rock).

The geogrids shall be Miragrd 3XT, 5XT, or 8XT geogrid as indicated on the plans and as manufactured by TC Mirafi Group. The geotextile filter fabric shall be Mirafi 140NL or similar.

The leveling pad shall be constructed of crushed limestone similar to 1" or 2" minus rock gradation.

The drainage rock shall be a free draining material such a 3/4" clean crushed limestone.

The drainage pipe shall be 4" HDPE tubing with sock wrap.

WALL FOUNDATION

Foundation soil shall be excavated as required for the leveling pad and the reinforced fill zone to the depths and locations shown on the plan sheet or as directed by the site engineer. The exposed foundation soil shall be observed by a qualified technician, engineer, or owner's representative prior to construction to verify that the exposed material is suitable for a net allowable bearing pressure as shown on the elevation views (with a factor of safety of 2.0), and that the base of the excavation is free of loose soil, shale, high plastic clays, uncompacted fill, water, or frozen material. Undercut any unsuitable soil. Undercut areas shall be filled with crushed limestone and compacted to at least 95% of the material's standard Proctor maximum dry density.

The foundation shall be proof rolled with 2 passes of a vibratory compactor prior to beginning retaining wall construction.

Construct the crushed rock leveling pad to lines and grades shown on the plans. The leveling pad shall be compacted in a maximum 6" lifts with 3 passes of a vibratory compactor.

WALL CONSTRUCTION

Install the first course of units on the leveling pad. Install the next course in a running bond stack. Pull unit forward. Backfill units and continue construction.

Install the filter fabric as shown in the wall sections.

Install a 12" lift of drainage rock directly behind the wall units.

Install drainage rock in unit cores and extending behind wall units.

Cap units shall be glued in place at the top of the wall.

GEOGRID REINFORCING

The geogrids shall be cut to design lengths and placed between the blocks at the elevations shown on the plans. The geogrid's primary strength direction will be directed perpendicular to the wall face (into the fill). The geogrids placed outside a plus or minus 4" zone of the geogrid design elevation will not be accepted. The geogrid shall be placed horizontally and lay flat on the reinforced fill soil. The geogrid shall have a minimum of 11" of grid between the block layers. Slack in the geogrid shall be removed prior to placing additional backfill. The geogrids shall be installed in one continuous piece with no joints in the strength direction. The geogrids shall be placed side-by-side along the wall alignment with no overlap required.

WALL BACKFILL

Backfill shall be placed, spread, and compacted in such a manner that minimizes wrinkles and movement of the geogrid. Wall backfill material shall be placed in maximum 10" loose lifts and compacted with a minimum 2 passes of a vibratory compactor and field density testing will not be required for the drainage rock. During backfill placement the 3 foot zone directly behind the wall shall be limited to the use of hand operated compaction equipment only.

Construction equipment shall not be operated directly on the geogrid.

FENCE

The fence posts shall be grouted into Sonotubes or PVC pipe sleeves. The sleeves shall be installed into the backfill during wall construction. The backfill shall be compacted around the sleeves. The geogrids shall be cut around the sleeves as necessary.

CURB

The curb above the wall may be installed against the back of the wall units. The geogrid layers are not to be cut during curb installation. Care shall be taken in the installation of the curb so as to not move the wall.

SCOPE OF THIS RETAINING WALL DESIGN

The retaining wall design herein represents a finished structure. The retaining wall design includes a complete analysis of the internal stability of the retaining wall system and an external design analysis of the system's resistance to sliding and overturning in accordance with the NCMA and/or AASHTO Section 5 guidelines. These retaining wall plans provide the bearing pressures that the wall exerts on the foundation soils. The owner or owner's representative shall verify that the foundation soils at the retaining wall location will provide the necessary bearing capacity to support the wall system. The global stability of the entire site, as well as at the retaining wall location, is outside the scope of the retaining wall design.

The erosion protection of the soil at the face of the wall and at the top of the wall is beyond the scope of this design. Design of pipes, manholes, light standards, signs, guard rails, fences, curbs, and other materials around the retaining wall are beyond the scope of this design. Details on our plans that show any of these items are intended only for the wall contractor to know how to construct the retaining wall at these structures.

The contractor is strictly responsible for the construction means, methods, techniques, sequences or procedures, and the safety precautions and programs connected with the work.

PROTECTION OF WORK

The surface of the wall backfill shall be graded at the end of each day of work to provide positive surface drainage away from the wall. Grading shall include proper contouring of soils in adjacent areas to prevent the flow of surface water into the reinforced earth zone and to prevent the flow of surface water along the front face of the wall.

The design of the walls is based on conditions and loads imposed on the wall at completion of the project. Prior to project completion, the wall is vulnerable to damages caused by construction activity adjacent to the wall. Of particular concern is the use of grading and pavement construction equipment on the reinforced backfill at the top of the wall. Only equipment with a weight not exceeding one ton can be used in the 3 foot zone directly behind the back of the wall face.

Prior to the wall construction exceeding 5' in height the soil at the face of the wall shall be placed and compacted to the final grades. There shall be a minimum 4' wide flat area at the face of the wall and the soil shall slope away from the wall.

No changes shall be made to these plans without the written approval of Aspen.

