



1. FINAL GRADE LINE MAY VARY PER EXISTING SITE CONDITIONS. REFER TO PLOT PLAN FOR SPECIFIC SITE GRADE CONDITIONS.
2. ALL ROOFING TO BE ASPHALT COMPOSITION UNLESS NOTED OTHERWISE.
3. ROOF AND SOFFIT VENTS PER LOCAL CODES. WHERE POSSIBLE, PROVIDE ROOF VENTING ON BACK SIDE OF ROOF.
4. GUTTER AND DOWNSPOUT LOCATIONS TO BE DETERMINED BY GUTTER INSTALLER.
5. SMART PANEL SIDING ON SIDE AND REAR ELEVATIONS UNLESS NOTED OTHERWISE.
6. REFER TO STRUCTURAL SHEETS FOR EXTERIOR DECK DETAILS.



**JFE CONSTRUCTION INC.**  
1314 SW Market Street  
Lee's Summit, MO 64081  
v: 816.786.4008  
[jfeconstruction.com](http://jfeconstruction.com)

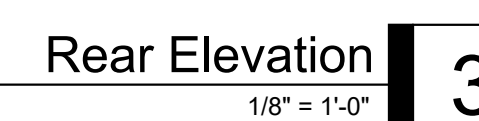

Van Deurzen and Associates, P.A. © 2021



**THE GUNNISON MODERN**  
Doelling Residence  
213 NW Ambersham Dr, Lee's Summit, MO  
Lot 119 - Woodside Ridge Subdivision

Project #: 8083-210

DATE \_\_\_\_\_

Permit: 4/16/202

## Exterior Elevations

# A100

GENERAL NOTES

- BUILDING PERMIT WILL BE REQUIRED FOR THE PROJECT. THIS SET OF DOCUMENTS TO BE SUBMITTED AS A PERMIT SET OF DRAWINGS.
- ALL CONTRACTORS SHALL VISIT THE JOB SITE AND SHALL REVIEW THE PERMIT DRAWINGS TO FAMILIARIZE HIMSELF WITH THE REQUIREMENTS AND INTENT OF THE SCOPE OF WORK. ANY DEFICIENCIES OR DISCREPANCIES DISCOVERED SHALL BE REPORTED FOR REVIEW AND CLARIFICATION PRIOR TO COMMENCING ANY WORK.
- ALL NEW CONSTRUCTION SHALL MEET LATEST EDITIONS OF ALL APPLICABLE NATIONAL, STATE, AND LOCAL BUILDING CODES - INTERNATIONAL RESIDENTIAL CODE.
- WORKMANSHIP SHALL BE OF THE HIGHEST QUALITY. QUALITY MATERIALS SHALL BE USED THROUGHOUT. ALL WORK SHALL BE DONE IN A MANNER SO AS TO MATCH ADJACENT WORK AND FINISHES AND APPROVED BY OWNER.
- CONTRACTORS SHALL REMOVE ALL CONSTRUCTION DEBRIS. ALL CONSTRUCTION DEBRIS SHALL BE CONTAINED PER CITY REQUIREMENTS.
- AREAS FOR MATERIAL STORAGE, TRASH DISPOSAL, WORKMENS PARKING, ETC. SHALL BE COORDINATED WITH THE CITY.
- ALL DIMENSIONS TO BE VERIFIED BY CONTRACTOR.
- IT IS THE RESPONSIBILITY OF THE CONTRACTORS TO COORDINATE WITH THE OWNER THE QUANTITY AND LOCATION FOR ALL LIGHTING, ELECTRICAL OUTLETS, TELEPHONE OUTLETS, AND MECHANICAL AND PLUMBING SYSTEMS AS REQUIRED.
- THE CONTRACTORS SHALL ADHERE TO THE STATE OF KANSAS ONE CALL SYSTEM, 1-800-344-7233 (MISSOURI ONE CALL SYSTEM, 1-800-344-7483). THE PERSON OR FIRM DOING EXCAVATION ON PUBLIC RIGHT OF WAY MUST GIVE NOTICE TO, AND OBTAIN INFORMATION FROM, UTILITY COMPANIES. THE CONTRACTORS SHALL NOTIFY THOSE COMPANIES WHICH HAVE FACILITIES IN THE NEAR VICINITY OF THE CONSTRUCTION TO BE PERFORMED WHEN WORK COMMENCES.

GENERAL FOUNDATION REQUIREMENTS

- ALL FOOTINGS ARE TO BE EXTENDED TO MIN 36" BELOW FINISHED GRADE.
- ALL INTERIOR FOOTINGS FOR LOAD BEARING WALLS AND COLUMNS SHALL BE ISOLATED FROM THE BASEMENT FLOOR SLAB.
- FOR ALL CONC WALL OPENINGS, FOOTING & WALL STEPS, PROVIDE ONE #4 BAR, 48" LONG DIAGONALLY AS CLOSE AS PRACTICAL TO CORNER.
- ALL REINFORCEMENT SHALL BE LAPPED A MIN OF 24" AT ENDS SPLICES AND AROUND CORNERS.
- ANCHOR BOLTS ARE TO BE SPACED @ 36" WITH 7" MIN EMBED. A BOLT SHALL BE PLACED WITHIN 12" OF THE END OF EACH PLATE SECTION.
- FASTEN JOISTS TO SILL PLATES WITH (3) 8d COM NAILS.
- WHERE JOIST IS PARALLEL TO FOUNDATION, PROVIDE SOLID BLOCKING @ 32" FOR (3) JST SPACES. FASTEN TO SILL PLATE PER NOTE 6.
- VAPOR BARRIER 6 MIL PE VAPOR RETARDER WITH JOINTS LAPPED A MIN OF 6" BETWEEN SLAB & BASE.
- DAMP PROOFING: ONE COAT (MIN) OF DAMP PROOFING OR EQUIVALENT FOUNDATION MEMBRANE SHALL BE APPLIED TO EXTERIOR WALL SURFACES BELOW GRADE. SEAL TIE HOLES, VOIDS BEFORE APPLICATION.
- FOUNDATION DRAIN: INSTALL CONT 4" PERFORATED PVC DRAIN TILE. DRAIN TILE TO BE EXTENDED TO SQUARE SUMP PIT WHICH EXTENDS A MIN 24" BELOW BASEMENT FLOOR.
- ALL FRAMING MEMBERS IN CONTACT WITH CONCRETE SHALL BE ACQ TREATED LUMBER.
- ALL STEEL FASTENERS (INCLUDING FOUND. ANCHOR BOLTS) ON ACQ TO BE (DOUBLE HOT-DIPPED) GALVANIZED.
- PROVIDE A "UPPER" GROUND PER IRC 3606.1
- EGRESS WELL REQUIREMENTS:
  - IF THE VERTICAL DISTANCE FROM THE WINDOW SILL TO ADJACENT GRADE IS GREATER THAN 44", PROVIDE A LADDER.
  - ADD DRAIN TO DAYLIGHT OR SUMP PUMP.

| COLUMN & PIER PAD SCHEDULE |             |                  |                   |
|----------------------------|-------------|------------------|-------------------|
| COLUMN MARK                | PAD SIZE    | REINFORCEMENT    | COLUMN SIZE       |
| A                          | 36"x36"x12" | (6) #4 BAR E.W.  | 3'0" SCHED 40     |
| B                          | 42"x42"x14" | (7) #4 BAR E.W.  | 3'0" SCHED 40     |
| C                          | 48"x48"x16" | (8) #4 BAR E.W.  | 3'0" SCHED 40     |
| D                          | 54"x54"x16" | (9) #4 BAR E.W.  | 3 1/2'0" SCHED 40 |
| E                          | 60"x60"x18" | (10) #4 BAR E.W. | 3 1/2'0" SCHED 40 |

- COLUMN & PIER PAD SIZES SHOWN ARE BASED ON AN ASSUMED MINIMUM ALLOWABLE SOIL BEARING CAPACITY OF 1,500 psf.
- GARAGE FOOTINGS PER DETAIL, COLUMN NOT REQUIRED UNLESS NOTED ON PLANS


I JOIST AND TRUSS NOTES

- FLOOR TRUSS OR I-JOIST LOADING SHALL BE PER THE GENERAL NOTES.
- I-JOISTS MAY BE SHOWN AS SIMPLE SPAN TO DEFINE SPANS AND BEARING POINTS, TRUSS MFG TO RUN CONTINUOUS WHERE POSSIBLE.
- COORDINATE I-JOISTS LOCATIONS WITH PLUMBING DRAIN LINES AT ALL TOILET LOCATIONS.
- JOIST BLOCKING WHERE NOTED ON PLANS MAY BE OMITTED AT HVAC AND PLUMBING LOCATIONS AS REQUIRED.
- EXACT I-JOIST OR FLOOR TRUSS LAYOUT TO BE PROVIDED BY TRUSS MANUFACTURER. DESIGN AND LAYOUT TO BE SUBMITTED TO VAN DEURZEN AND ASSOCIATES TO REVIEW FOR GENERAL CONFORMANCE TO THE DESIGN OF THE BUILDING PRIOR TO SUBMITTAL TO THE CODES ADMINISTRATION FOR PERMITTING.
- IF A CONFLICT EXISTS BETWEEN SHOP DRAWINGS AND CONTRACT SET, THE CONTRACT SET SUPERCEDES THE JOIST/TRUSS LAYOUT.

I JOIST FIRE PROTECTION

ALL I-JOIST AND OPEN WEB TRUSSES OVER UNFINISHED SPACE EXCEEDING 80 SQUARE FEET IN AGGREGATE AREA TO BE PROTECTED BY THE FOLLOWING METHOD:

- 3" MINERAL/ROCK WOOL COVERING BTM CHORD AND NETTING PER APA FORM R425 METHOD 4

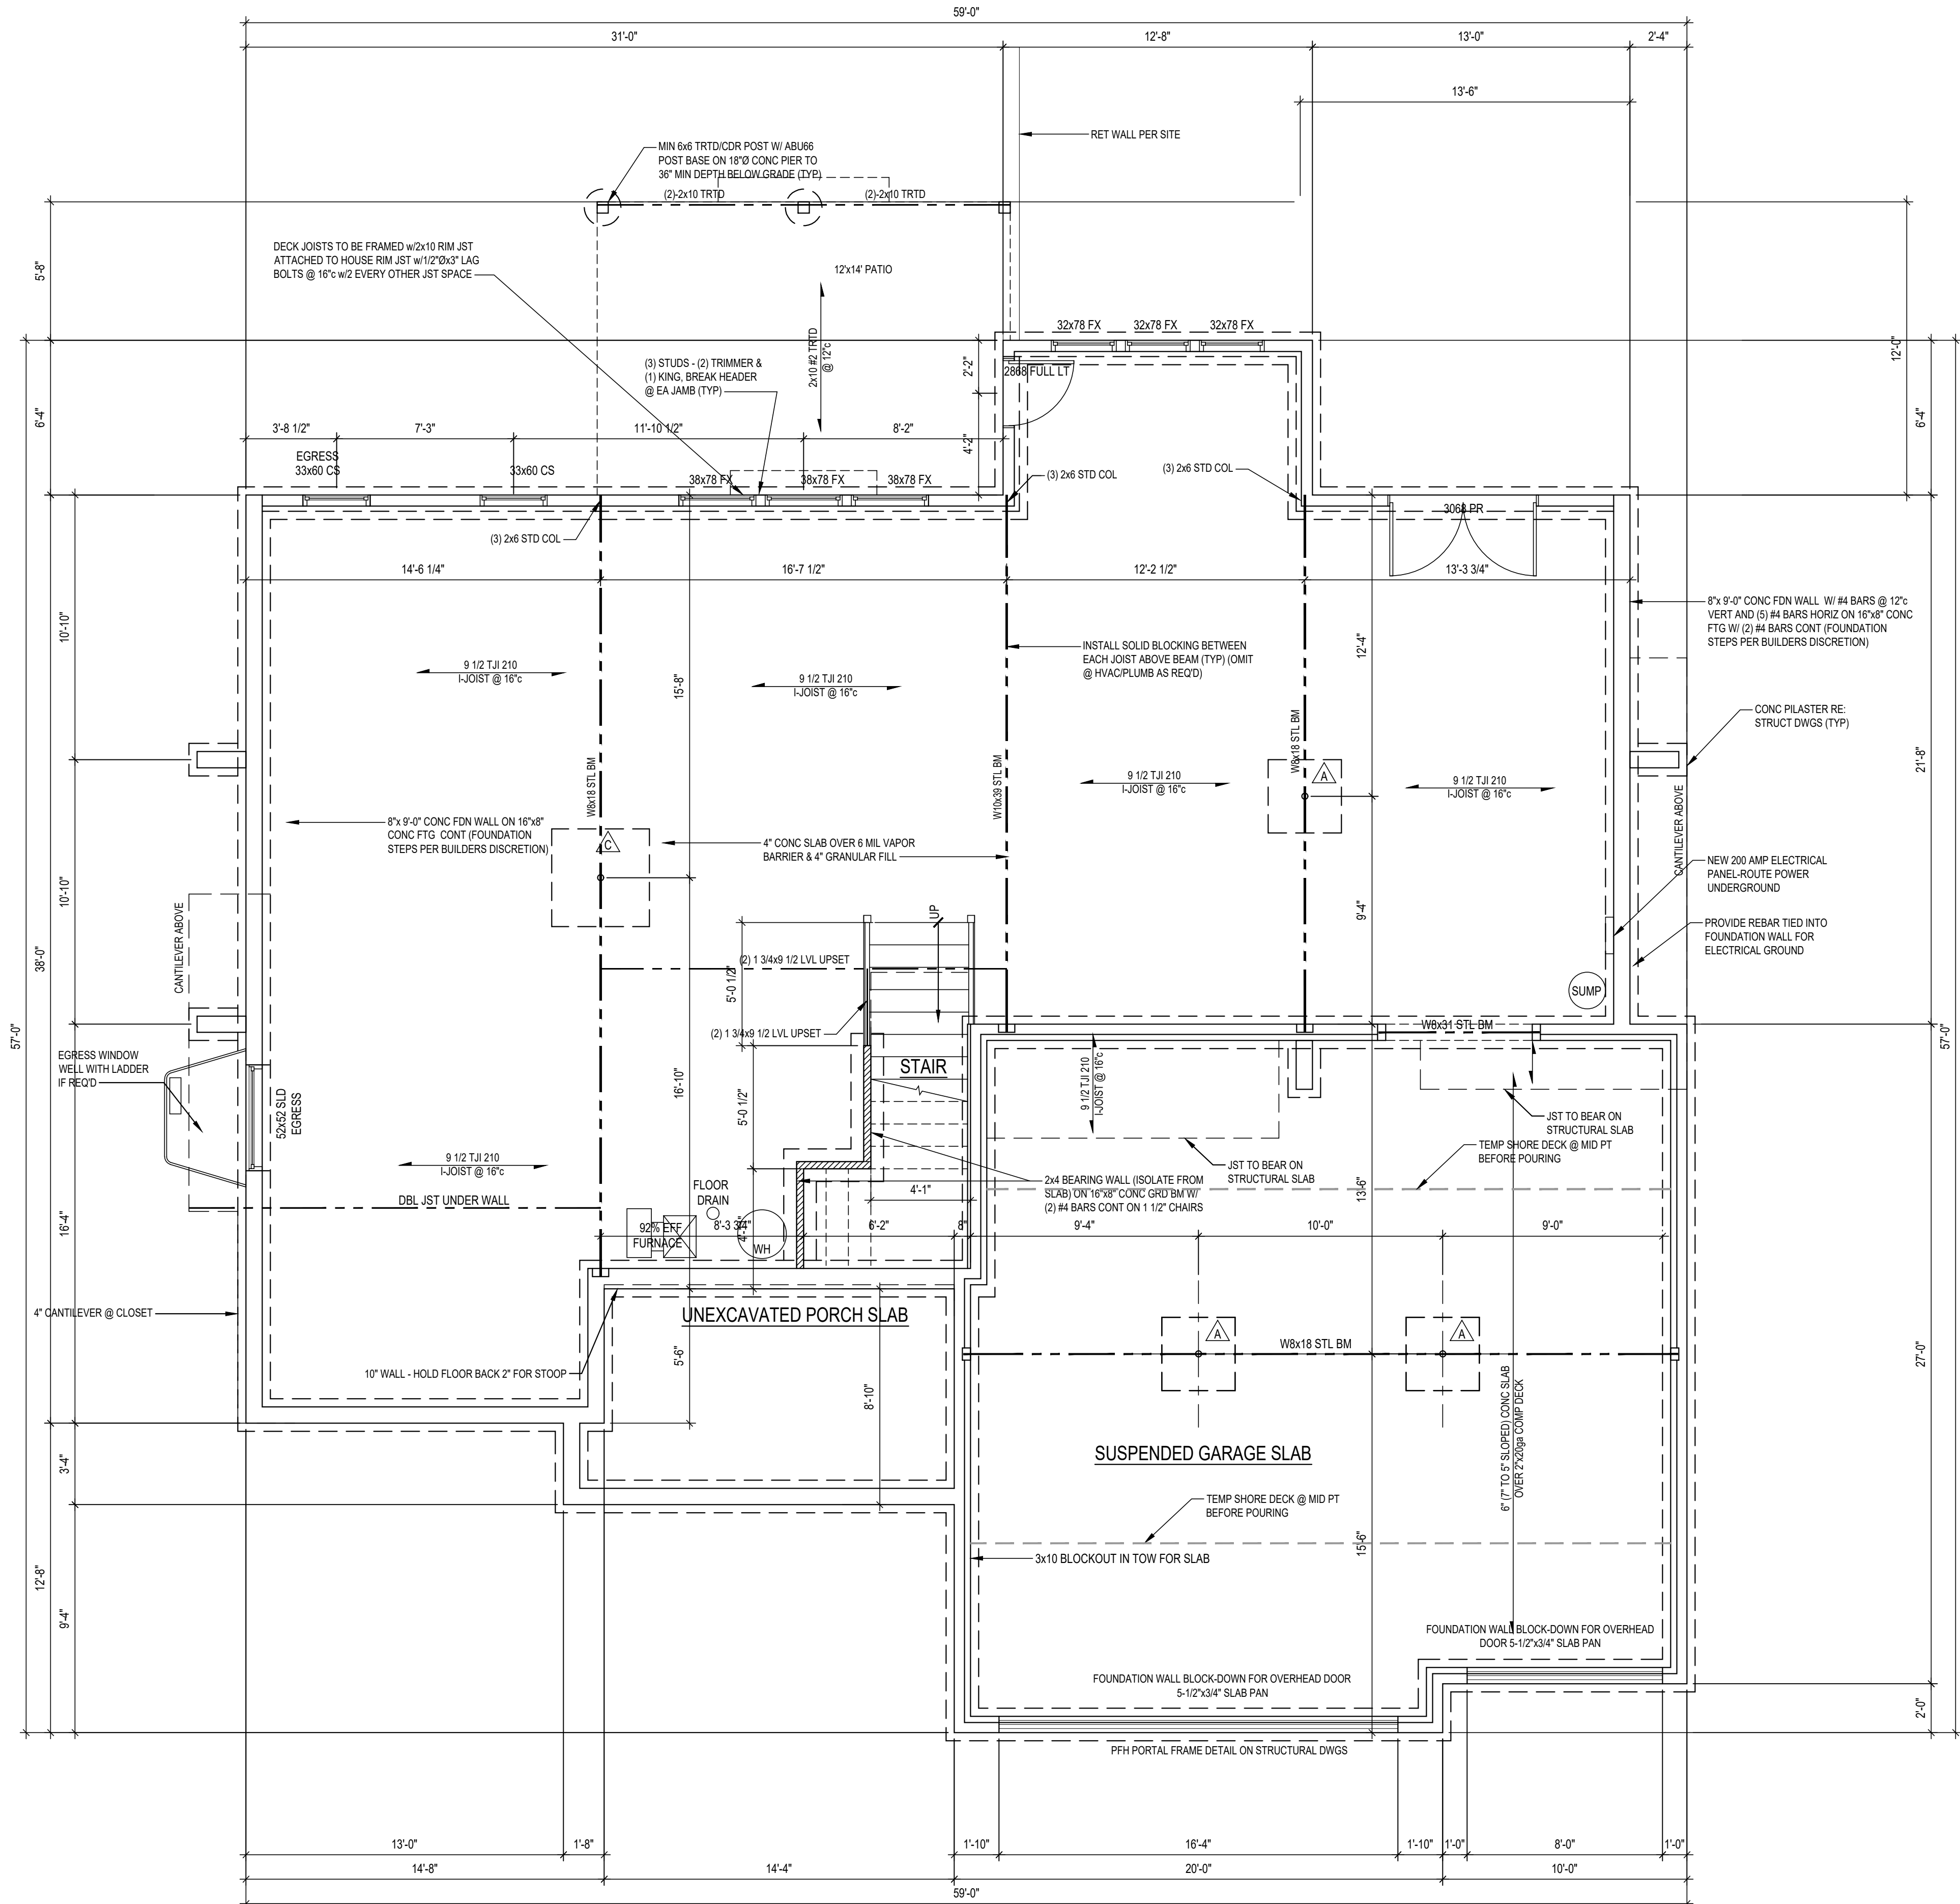

LOAD BEARING WALL  
LOAD BEARING BEAM

Foundation Plan  
1/4" = 1'-0"

1




© COPYRIGHT 2021

JFE CONSTRUCTION INC.  
1314 SW Market Street  
Lee's Summit, MO 64081  
v: 816.786.4008  
jfeconstruction.com

VAN DEURZEN & ASSOCIATES P.A.  
1101 KING STREET SUITE 130  
OVERLAND PARK, KS 66210  
(913) 451-6305 FAX (913) 451-1021  
WEB PAGE WWW.VANDEURZENASSOC.COM  
E-MAIL VJ@VANDEURZENASSOC.COM

Van Deurzen and Associates, P.A. © 2021

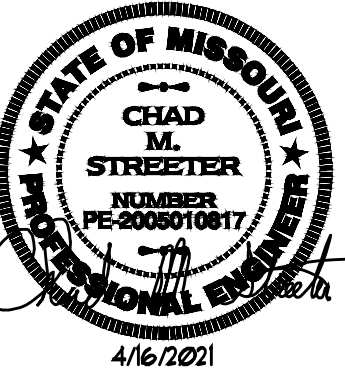

THE GUNNISON MODERN

Doelling Residence  
213 NW Ambersham Dr, Lee's Summit, MO  
Lot 119 - Woodside Ridge Subdivision

Project #: 8083-2108

DATE:

Permit: 4/16/2021

Foundation  
Plan

A101

### GENERAL PLAN REQUIREMENTS:

- ALL STUD WALL FRAMING SHALL BE CONTINUOUS FROM THE FLOOR TO ROOF OR CEILING DIAPHRAGM, U.N.O. ALL WALLS OVER 10'-0" ARE TO BE 2x6 @ 16" U.N.O.
- PROVIDE WATER-RESISTANT EXTERIOR WALL COVERING ON ALL FRAMED WALLS TO COMPLY WITH IRC SECTION 703.2.
- PROVIDE GFCI ELECTRICAL OUTLETS ON EXTERIOR, IN UNFINISHED BASEMENT, IN BATHROOMS, ABOVE KITCHEN COUNTERS, IN GARAGE, AND WITHIN 6'-0" OF ANY SINK.
- ALL EXTERIOR DOORS SERVED BY LANDING.
- INSTALL CARBON MONOXIDE DETECTORS PER IRC SECTION 315 OUTSIDE OF EACH SLEEPING AREA.
- INSTALL SMOKE DETECTORS IN EACH SLEEPING ROOM, OUTSIDE OF EACH SLEEPING AREA, WITH A MINIMUM OF ONE ON EACH FLOOR PER IRC SECTION 314.
- PROVIDE A "UFE" GROUND PER IRC 3608.1.
- REFER TO SHEET S3 FOR ALL WALL BRACING DETAILS AND/OR CALCULATIONS.
- INSTALL BLOCKING FOR TP HOLDERS, TOWEL BARS, AND TRIM BEAMS.
- GARAGE DOOR H-FRAME: THE H-FRAME FOR ATTACHMENT OF THE TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2x6 VERTICAL JAMBS RUNNING FROM FLOOR TO CEILING ATTACHED WITH 3 1/4"x120 NAILS @ 7" STAGGERED WITH (7) 3 1/4"x14x120 NAILS THRU JAMB INTO HEADER, MINIMUM 2x6 HEADER FOR ATTACHMENT OF COUNTER BALANCE SYSTEM.
- OVERHEAD GARAGE DOORS TO MEET 115 MPH WIND LOAD RESISTANCE REQUIREMENTS OF DASHA 108-17 AND ASTM E 330-02 PER IRC SECTION R 609.4.
- MAXIMUM RISE HEIGHT OF STAIRWAYS SHALL NOT EXCEED 7 3/4" AND THE TREADS SHALL PROVIDE A MINIMUM TREAD DEPTH OF 10".
- ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE (2) 2x10 D.FIR #2 UNLESS NOTED OTHERWISE ON PLANS.
- ALL HEADER BEARINGS OTHER THAN WINDOWS TO BE (2) 2x4 STUDS UNLESS NOTED OTHERWISE. WINDOW HEADER BEARING TO BE (1) 2x4 EA END UNLESS NOTED OTHERWISE.
- ALL EXTERIOR PLATE HGTS TO BE 9'-0" UNLESS OTHERWISE NOTED.
- INTERIOR PLATE HGTS AS INDICATED IN ROOM CLG HEIGHTS NOTATION.
- NO HANDRAIL IS REQ'D FOR STEPS HAVING LESS 3 RISERS OR LESS.
- ANY LUMBER IN DIRECT CONTACT WITH CONCRETE TO BE TREATED.

### ENERGY REQUIREMENTS

CONTRACTOR TO PROVIDE ENERGY AUDIT USING THE HERS ENERGY RATING SYSTEM. IN LIEU OF AN ENERGY AUDIT, THE FOLLOWING PRESCRIPTIVE REQUIREMENTS MAY BE FOLLOWED:

- ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES TO BE SEALED PER IRC SECTION N1102.2.
- THE BUILDING THERMAL ENVELOPE IS REQUIRED TO BE SEALED PER IRC SECTION N1102.4.
- CONTRACTOR TO SUBMIT "MANUAL 1" AND "MANUAL 2" CALCULATIONS FOR THE HVAC SYSTEM.
- INSULATION TO COMPLY WITH IECC AS FOLLOWS:

|                                 |                                                                                         |
|---------------------------------|-----------------------------------------------------------------------------------------|
| WALLS                           | R-13                                                                                    |
| CEILING (FLAT)                  | R-49                                                                                    |
| CEILING (VAULTED)               | R-38 (NOTE: VAULTED AREA NOT TO EXCEED 500sq ft OR 20% OF ROOF AREA, WHICHEVER IS LESS) |
| FLOORS OVER UNCONDITIONED SPACE | R-19                                                                                    |
| CRAWL SPACE WALLS               | R-13 (or R-10 CONTINUOUS)                                                               |
| BASEMENT WALLS                  | R-13 (or R-10 CONTINUOUS)                                                               |
| SLABS                           | N/R                                                                                     |
| DUCTWORK                        | N/R                                                                                     |
| WINDOWS                         | U-FACTOR 0.35 (MAX)<br>SHGC 0.40 (MAX)                                                  |
| SKYLIGHTS                       | U-FACTOR 0.55 (MAX)<br>SHGC 0.40 (MAX)                                                  |

### WINDOW AND DOOR NOTES

- VERIFY WINDOW AND DOOR SIZE WITH SUPPLIER PROVIDED CUT SHEET PRIOR TO FRAMING.
- WINDOW SUPPLIER TO CONFIRM EXACT SAFETY AND EGRESS WINDOW LOCATIONS PER LOCAL CODES.
- ALL WINDOWS TO BE LOW-E GLASS TO MEET ALL LOCAL ENERGY CODE REQUIREMENTS.
- ALL WINDOWS TO BE FRAMED TIGHT TO HEADERS UNLESS NOTED OTHERWISE ON ELEVATIONS.
- PROVIDE EGRESS WINDOW IN ALL SLEEPING ROOMS. WINDOWS SHALL COMPLY WITH THE FOLLOWING:


|                                    |           |
|------------------------------------|-----------|
| A. MINIMUM OPEN AREA               | 5.7 SF    |
| B. MINIMUM OPENING HEIGHT          | 24 INCHES |
| C. MINIMUM OPENING WIDTH           | 20 INCHES |
| D. SILL HEIGHT 44" MAX ABOVE FLOOR |           |
- WINDOW SILLS ARE TO BE 24" MIN FIN FLOOR, OR SHALL BE FIXED / IMPERMEABLE.
- ALL WINDOWS AND GLAZED DOORS SHALL COMPLY WITH 2018 IRC SECTION R308. IRC SECTION R308.4: GLAZING IN HAZARDOUS LOCATIONS SHALL BE OF APPROVED SAFETY GLAZING MATERIALS. GLASS IN STORM DOORS, INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" ARC OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR, WALLS ENCLOSING STAIRWAYS AND LANDINGS WHERE THE GLAZING IS WITHIN 60" OF THE TOP OR BOTTOM OF STAIR ENCLOSURES FOR TUBS, SHOWERS AND WHIRLPOLS, GLAZING IN FIXED OR OPERABLE PANELS EXCEEDING 9 SF AND WHOSE BOTTOM EDGE IS LESS THAN 18" ABOVE THE FLOOR OR WALKING SURFACE WITHIN 36".
- ALL OPERABLE WINDOWS SHALL HAVE FALL PROTECTION PER IRC R312.
- ALL GLAZING IN WINDOWS AND DOORS SHALL COMPLY WITH THE TEST CRITERIA FOR CATEGORY II IN ACCORDANCE WITH CPSC 16 CFR 1201.

### WALL BRACING NOTES:

SHEATHING METHOD CS-WSP, WSP, PPH, GB (or LIB), CS-PF

- ALL EXTERIOR WALLS ARE TYPE "CS-WSP" AND ARE CONTINUOUSLY SHEATHED UNLESS NOTED OTHERWISE. THE BRACED WALL NOTATIONS (IF SHOWN) REFLECT THE MINIMUM SHEATHING REQUIREMENTS PER CODE.
- IF NO NOTATIONS ARE SHOWN FOR WALLS TYPE "CS-WSP" ON PLAN, WALL IS FULLY SHEATHED AND MEETS ALL REQUIREMENTS WITH END CONDITION #1, #3, OR #4.
- EC # - END CONDITION PER IRC FIGURE R602.10.7, (FOR CONDITIONS #1, #3, & #4 NO HOLDDOWN REQUIRED).
- INTERIOR WALL BRACING NOT REQUIRED FOR BRACED WALL SPACING 80FT OR LESS.

XXXXXXXXXXXX DENOTES EXTERIOR BRACED WOOD STRUCTURAL PANEL (WSP or CS-WSP) ATTACHED PER DETAILS AND GENERAL NOTES

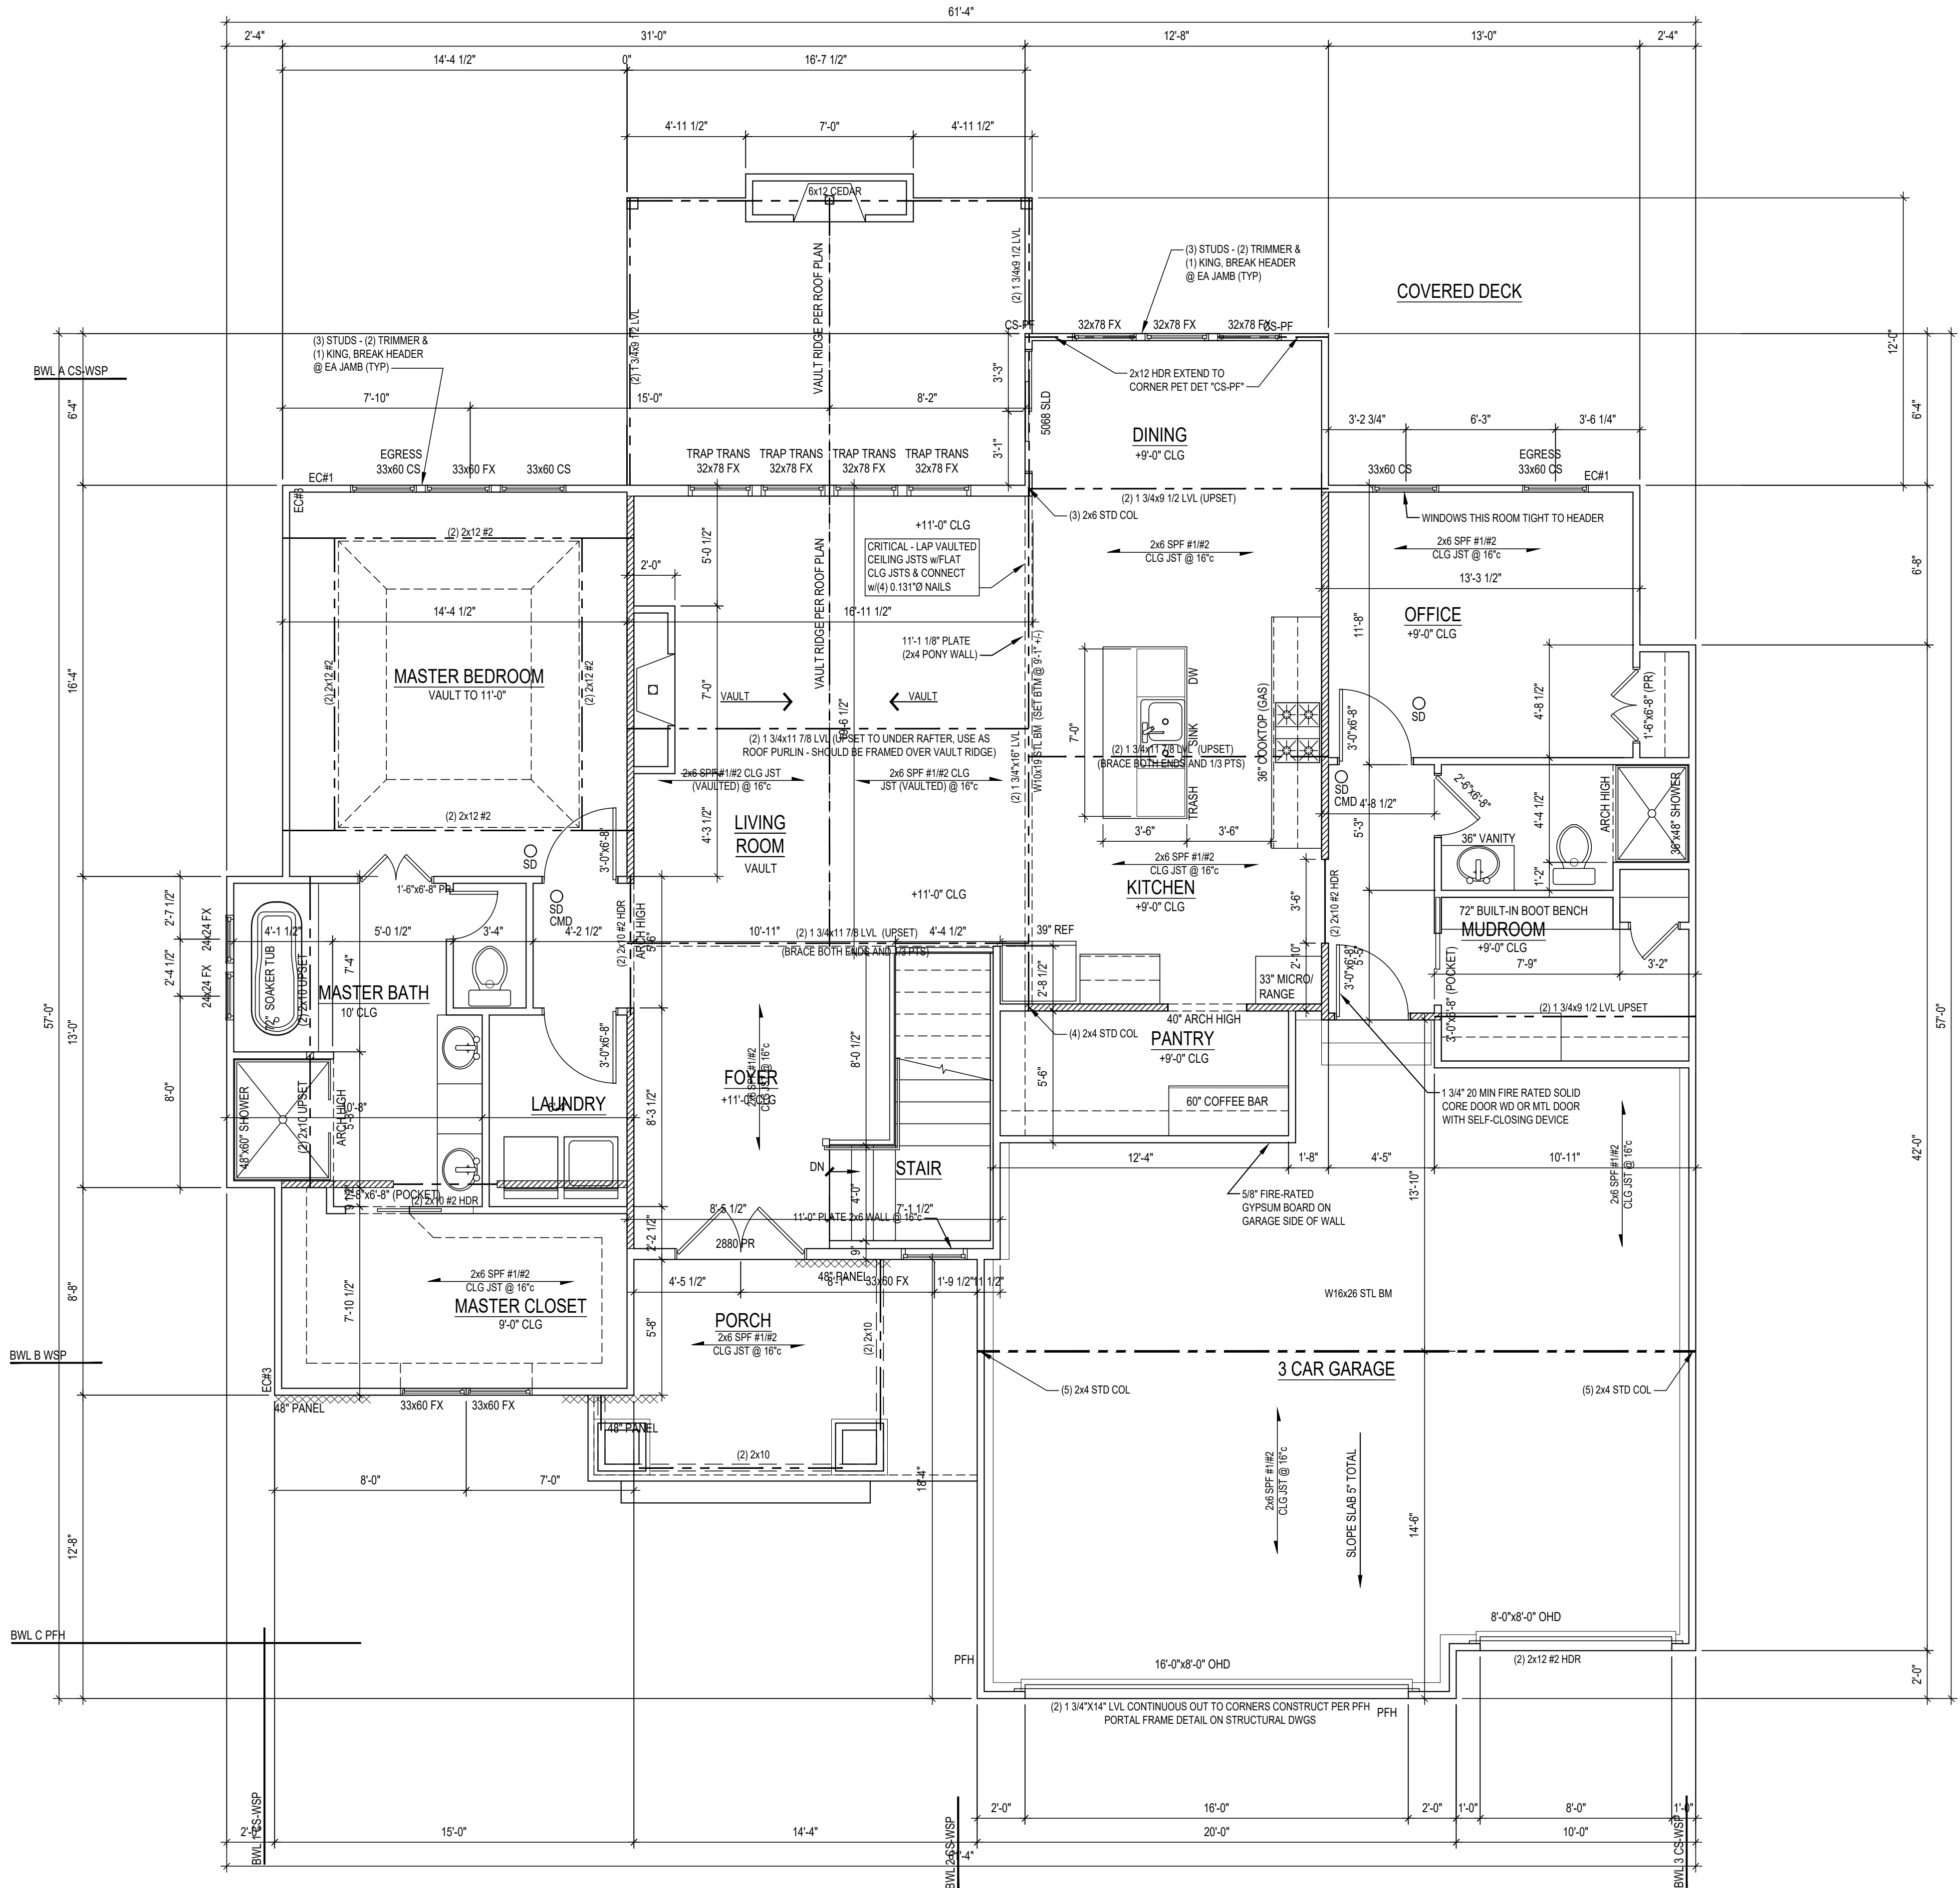

|               |         |
|---------------|---------|
| MAIN LEVEL    | 1882 SF |
| FINISH:       | 741 SF  |
| GARAGE:       | 155 SF  |
| COVERED DECK: |         |

LOAD BEARING WALL  
LOAD BEARING BEAM

First Floor Plan

1/4" = 1'-0"

1




© COPYRIGHT 2021

JFE CONSTRUCTION INC.  
1314 SW Market Street  
Lee's Summit, MO 64081  
v: 816.786.4008  
jfeconstruction.com



Van Deuren and Associates, P.A. © 2021

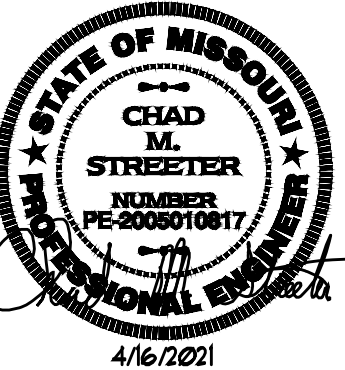

THE GUNNISON MODERN

Doelling Residence  
213 NW Ambersham Dr, Lee's Summit, MO  
Lot 119 - Woodside Ridge Subdivision

Project #: 8083-2108

DATE:

Permit: 4/16/2021

First Floor  
Plan

A102

GENERAL PLAN REQUIREMENTS:

- ALL STUD WALL FRAMING SHALL BE CONTINUOUS FROM THE FLOOR TO ROOF OR CEILING DIAPHRAGM, U.N.O. ALL WALLS OVER 10'-0" ARE TO BE 2x6 @ 16" U.N.O.
- PROVIDE WATER-RESISTANT EXTERIOR WALL COVERING ON ALL FRAMED WALLS TO COMPLY WITH IRC SECTION 703.2
- PROVIDE GFCI ELECTRICAL OUTLETS ON EXTERIOR, IN UNFINISHED BASEMENT, IN BATHROOMS, ABOVE KITCHEN COUNTERS, IN GARAGE, AND WITHIN 6'-0" OF ANY SINK.
- ALL EXTERIOR DOORS SERVED BY LANDING
- INSTALL CARBON MONOXIDE DETECTORS PER IRC SECTION 315 OUTSIDE OF EACH SLEEPING AREA
- INSTALL SMOKE DETECTORS IN EACH SLEEPING ROOM, OUTSIDE OF EACH SLEEPING AREA, WITH A MINIMUM OF ONE ON EACH FLOOR PER IRC SECTION 314.
- PROVIDE A "USER" GROUND PER IRC 3608.1.
- REFER TO SHEET S3 FOR ALL WALL BRACING DETAILS AND/OR CALCULATIONS.
- INSTALL BLOCKING FOR TP HOLDERS, TOWEL BARS, AND TRIM BEAMS.
- GARAGE DOOR H-FRAME: THE H-FRAME FOR ATTACHMENT OF THE TRACK AND COUNTER BALANCE SHALL CONSIST OF THE FOLLOWING: 2x6 VERTICAL JAMBS RUNNING FROM FLOOR TO CEILING ATTACHED WITH 3 1/4"x 120 NAILS @ 7" STAGGERED WITH (7) 3 1/4"x 120 NAILS THRU JAMB INTO HEADER, MINIMUM 2x8 HEADER FOR ATTACHMENT OF COUNTER BALANCE SYSTEM.
- OVERHEAD GARAGE DOORS TO MEET 115 MPH WIND LOAD RESISTANCE REQUIREMENTS OF DASHA 108-17 AND ASTM E 330-02 PER IRC SECTION R 609.4.
- MAXIMUM RISE HEIGHT OF STAIRWAYS SHALL NOT EXCEED 7 3/4" AND THE TREADS SHALL PROVIDE A MINIMUM TREAD DEPTH OF 10".
- ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE (2) 2x10 D.FIR #2 UNLESS NOTED OTHERWISE ON PLANS.
- ALL HEADER BEARINGS (OTHER THAN WINDOWS) TO BE (2) 2x4 STUDS UNLESS NOTED OTHERWISE. WINDOW HEADER BEARING TO BE (1) 2x4 EA END UNLESS NOTED OTHERWISE.
- ALL EXTERIOR PLATE HGTS TO BE 9'-0" UNLESS OTHERWISE NOTED.
- INTERIOR PLATE HGTS AS INDICATED IN ROOM C.L.G. HEIGHTS NOTATION.
- NO HANDRAIL IS REQ'D FOR STEPS HAVING LESS 3 RISERS OR LESS.
- ANY LUMBER IN DIRECT CONTACT WITH CONCRETE TO BE TREATED.

ENERGY REQUIREMENTS

CONTRACTOR TO PROVIDE ENERGY AUDIT USING THE HERS ENERGY RATING SYSTEM. IN LIEU OF AN ENERGY AUDIT, THE FOLLOWING PRESCRIPTIVE REQUIREMENTS MAY BE FOLLOWED:

- ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES TO BE SEALED PER IRC SECTION N1102.2.
- THE BUILDING THERMAL ENVELOPE IS REQUIRED TO BE SEALED PER IRC SECTION N1102.4.
- CONTRACTOR TO SUBMIT "MANUAL J" AND "MANUAL D" CALCULATIONS FOR THE HVAC SYSTEM.
- INSULATION TO COMPLY WITH IECC AS FOLLOWS:

|                                 |                                                                                         |
|---------------------------------|-----------------------------------------------------------------------------------------|
| WALLS                           | R-13                                                                                    |
| CEILING (FLAT)                  | R-49                                                                                    |
| CEILING (VAULTED)               | R-38 (NOTE: VAULTED AREA NOT TO EXCEED 500sq ft OR 20% OF ROOF AREA, WHICHEVER IS LESS) |
| FLOORS OVER UNCONDITIONED SPACE | R-19                                                                                    |
| CRAWL SPACE WALLS               | R-13 (or R-10 CONTINUOUS)                                                               |
| BASEMENT WALLS                  | R-13 (or R-10 CONTINUOUS)                                                               |
| SLABS                           | N/R                                                                                     |
| DUCTWORK                        | R-8                                                                                     |
| WINDOWS                         | U-FACTOR 0.35 (MAX)<br>SHGC 0.40 (MAX)                                                  |
| SKYLIGHTS                       | U-FACTOR 0.55 (MAX)<br>SHGC 0.40 (MAX)                                                  |

WINDOW AND DOOR NOTES

- VERIFY WINDOW AND DOOR SIZE WITH SUPPLIER PROVIDED CUT SHEET PRIOR TO FRAMING.
- WINDOW SUPPLIER TO CONFIRM EXACT SAFETY AND EGRESS WINDOW LOCATIONS PER LOCAL CODES.
- ALL WINDOWS TO BE LOW-E GLASS TO MEET ALL LOCAL ENERGY CODE REQUIREMENTS.
- ALL WINDOWS TO BE FRAMED TIGHT TO HEADERS UNLESS NOTED OTHERWISE ON ELEVATIONS.
- PROVIDE EGRESS WINDOW IN ALL SLEEPING ROOMS. WINDOWS SHALL COMPLY WITH THE FOLLOWING:


|                                    |           |
|------------------------------------|-----------|
| A. MINIMUM OPEN AREA               | 5.7 SF    |
| B. MINIMUM OPENING HEIGHT          | 24 INCHES |
| C. MINIMUM OPENING WIDTH           | 20 INCHES |
| D. SILL HEIGHT 44" MAX ABOVE FLOOR |           |
- WINDOW SILLS ARE TO BE 24" MIN FIN FLOOR, OR SHALL BE FIXED / IMPERMEABLE.
- ALL WINDOWS AND GLAZED DOORS SHALL COMPLY WITH 2018 IRC SECTION R308. IRC SECTION R308.4: GLAZING IN HAZARDOUS LOCATIONS SHALL BE OF APPROVED SAFETY GLAZING MATERIALS. GLASS IN STORM DOORS, INDIVIDUAL FIXED OR OPERABLE PANELS ADJACENT TO A DOOR WHERE THE NEAREST VERTICAL EDGE IS WITHIN A 24" ARC OF THE DOOR IN A CLOSED POSITION AND WHOSE BOTTOM EDGE IS WITHIN 60" OF THE FLOOR, WALLS ENCLOSEING STAIRWAYS AND LANDINGS WHERE THE GLAZING IS WITHIN 60" OF THE TOP OR BOTTOM OF STAIR, ENCLOSURES FOR TUBS, SHOWERS AND WHIRLPOOLS, GLAZING IN FIXED OR OPERABLE PANELS EXCEEDING 9 SF AND WHOSE BOTTOM EDGE IS LESS THAN 18" ABOVE THE FLOOR OR WALKING SURFACE WITHIN 36".
- ALL OPERABLE WINDOWS SHALL HAVE FALL PROTECTION PER IRC R312.
- ALL GLAZING IN WINDOWS AND DOORS SHALL COMPLY WITH THE TEST CRITERIA FOR CATEGORY II IN ACCORDANCE WITH CPSC 16 CFR 1201.

WALL BRACING NOTES:

SHEATHING METHOD CS-WSP, WSP, PPF, GB (or LIB), CS-PF

- ALL EXTERIOR WALLS ARE TYPE "CS-WSP" AND ARE CONTINUOUSLY SHEATHED UNLESS NOTED OTHERWISE. THE BRACED WALL NOTATIONS (IF SHOWN) REFLECT THE MINIMUM SHEATHING REQUIREMENTS PER CODE.
- IF NO NOTATIONS ARE SHOWN FOR WALLS TYPE "CS-WSP" ON PLAN, WALL IS FULLY SHEATHED AND MEETS ALL REQUIREMENTS WITH END CONDITION #1, #3, OR #4.
- EC # - END CONDITION PER IRC FIGURE R602.10.7, (FOR CONDITIONS #1, #3, & #4 NO HOLDDOWN REQUIRED)
- INTERIOR WALL BRACING NOT REQUIRED FOR BRACED WALL SPACING 80FT OR LESS.

XXXXXXXXXXXXX DENOTES EXTERIOR BRACED WALL WOOD STRUCTURAL PANEL (WSP or CS-WSP) ATTACHED PER DETAILS AND GENERAL NOTES  
XX" PANEL

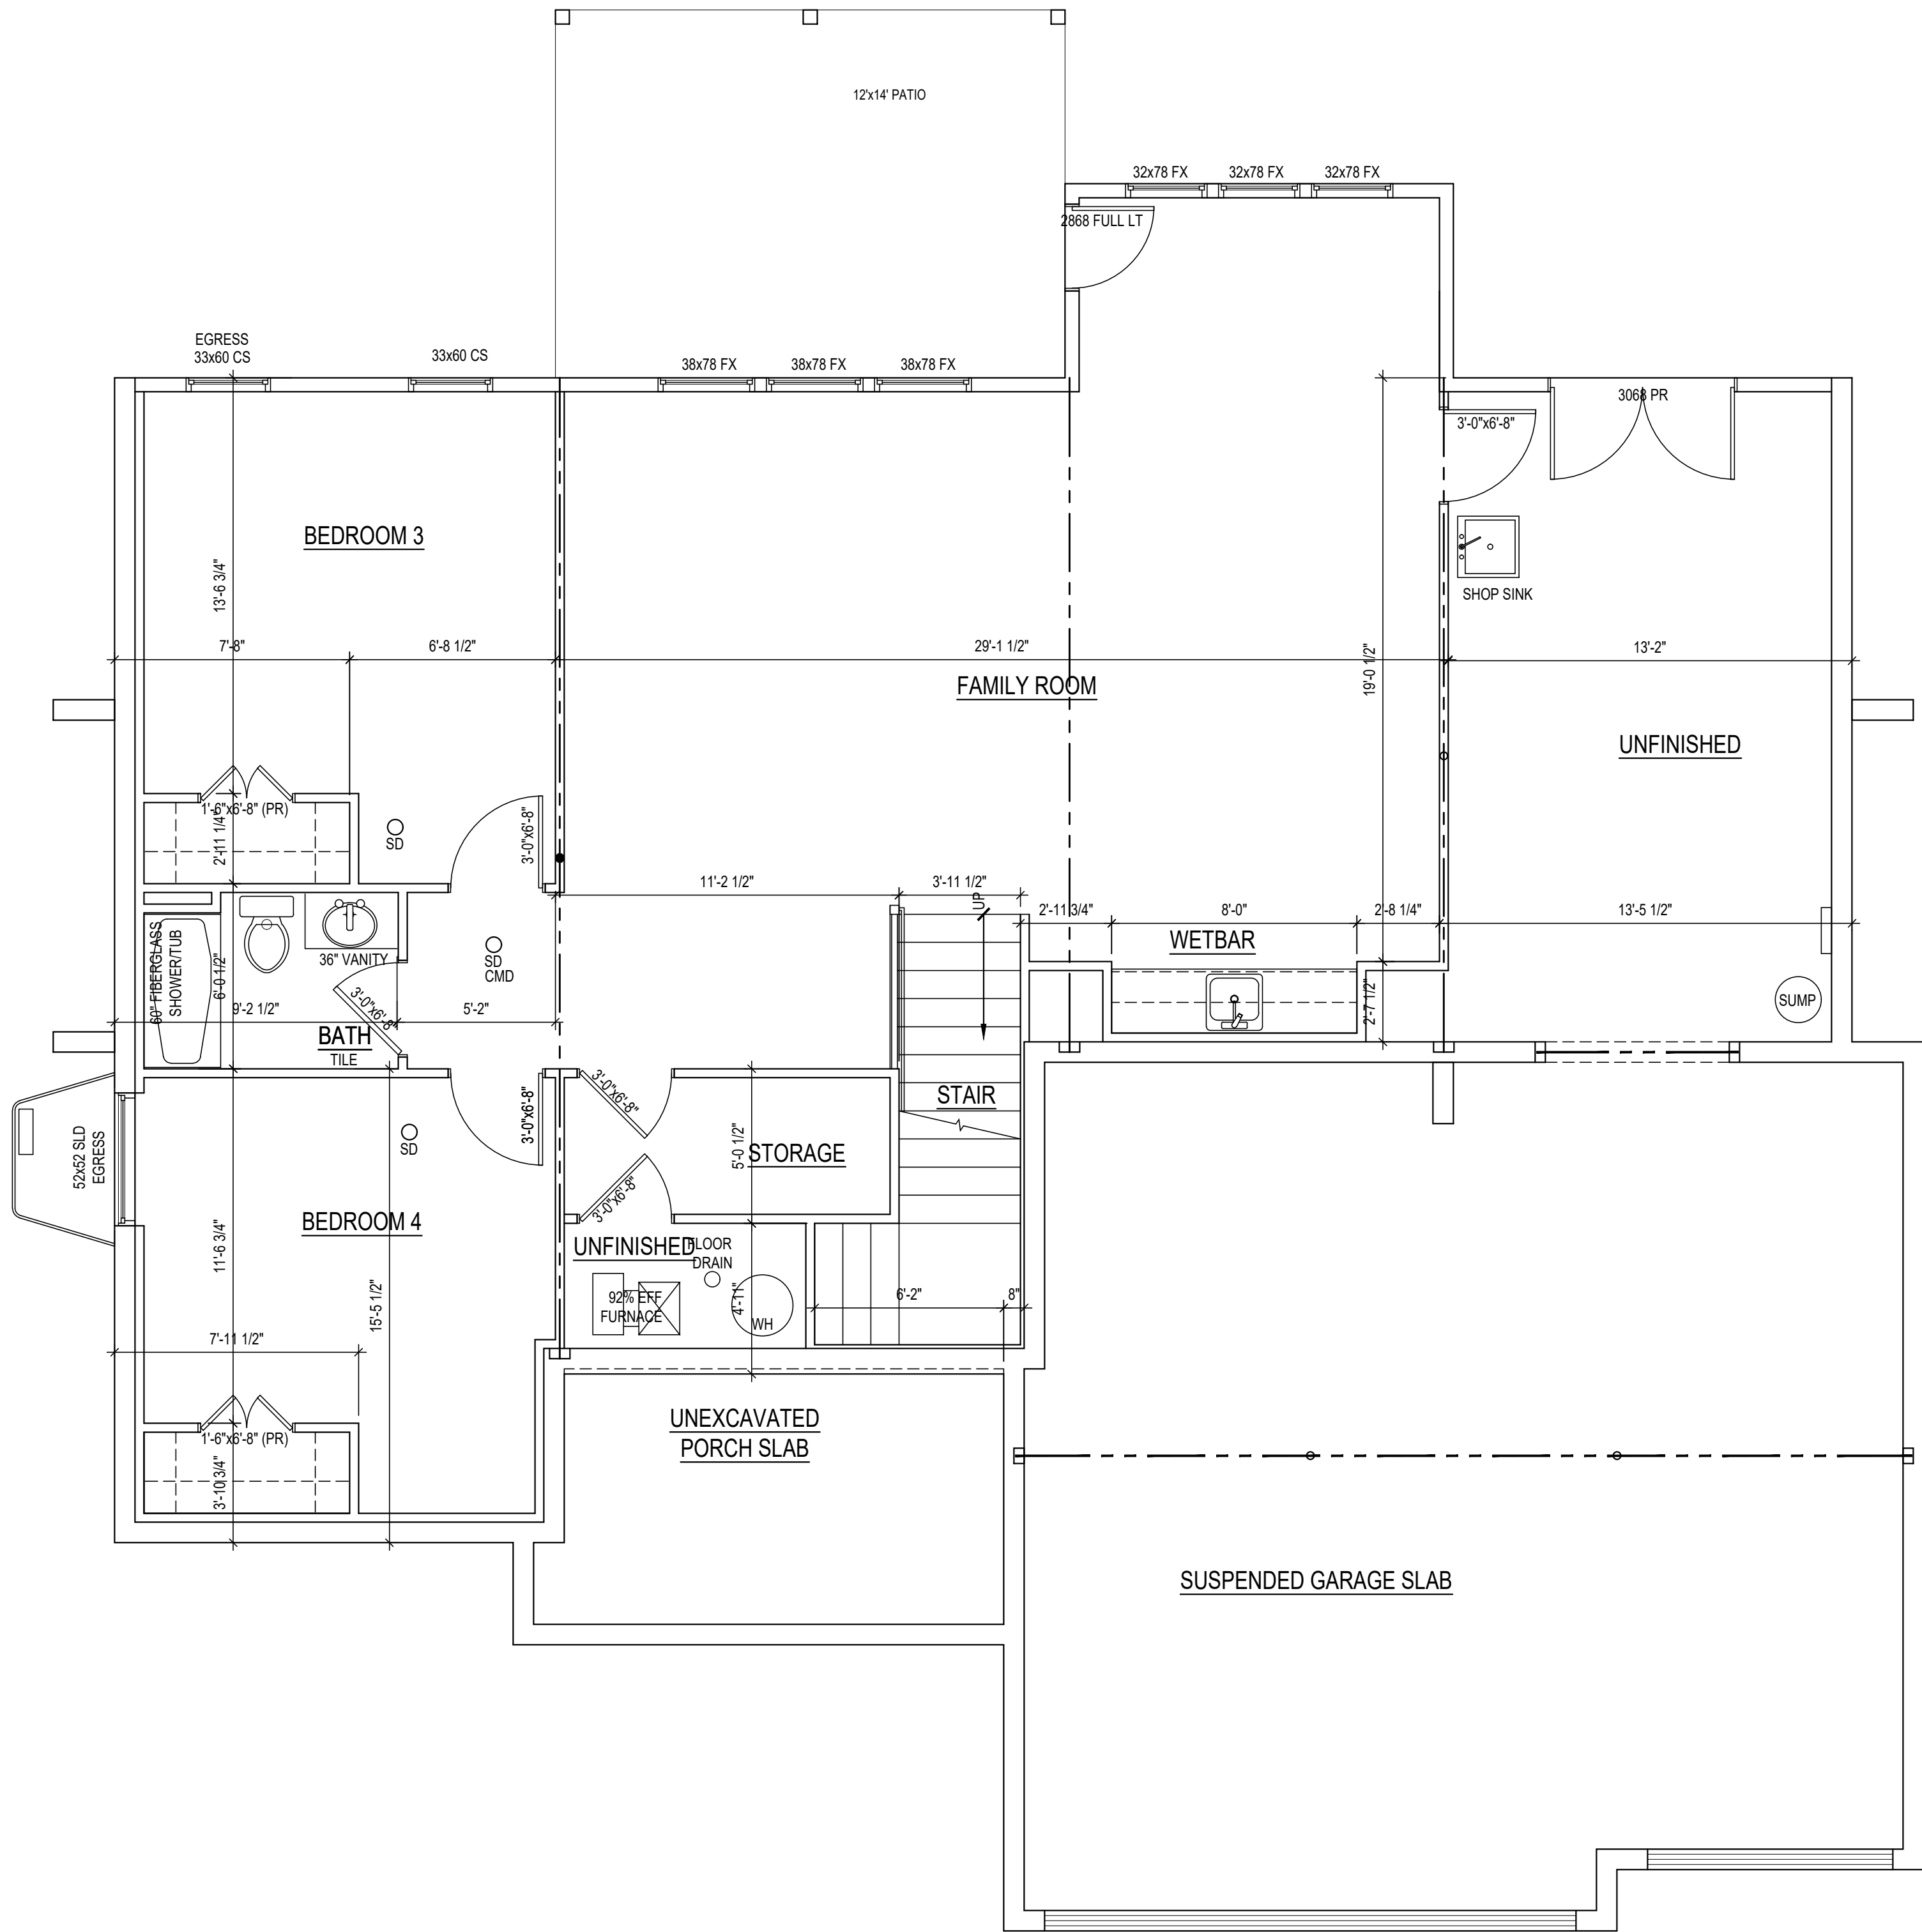

LOWER LEVEL  
FINISHED AREA: 1247 SF  
UNFINISHED: 1183 SF

Basement Finish Plan

1/4" = 1'-0"

1



© COPYRIGHT 2021

JFE CONSTRUCTION INC.  
1314 SW Market Street  
Lee's Summit, MO 64081  
v: 816.786.4008  
jfeconstruction.com



Van Deuren and Associates, P.A. © 2021



THE GUNNISON MODERN

Doelling Residence  
213 NW Ambersham Dr, Lee's Summit, MO  
Lot 119 - Woodside Ridge Subdivision

Project #: 8083-2108

DATE:

Permit: 4/16/2021

Basement Finish Plan

A103


ROOF PLAN NOTES

- ALL ROOF RAFTERS NOT CALLED OUT ARE TO BE 2x6 SPF #1/#2 @ 16"o
- ALL CEILING JOISTS NOT CALLED OUT ARE TO BE 2x6 SPF #1/#2 @ 16"o
- ALL VAULTS TO BE FURRED DOWN w/2x MATERIAL TO PROVIDE FOR R-38 INSULATION
- ALL EXTERIOR AND LOAD BEARING WINDOW AND DOOR HEADERS TO BE (2) 2x10 D.FIR #2 UNLESS NOTED OTHERWISE ON PLANS
- ALL RIDGES, HIPs, AND VALLEYS NOT MARKED SHALL BE (1) NOMINAL SIZE LARGER THAN THE INTERSECTING RAFTERS
- CEILING JOISTS AND RAFTERS SHALL BE NAILED TO EACH OTHER WITH (3) 16d COM (3 1/2"x0.162") NAILS AND THE RAFTER SHALL BE NAILED TO THE TOP WALL PLATE WITH (3) 8d COM (2 1/2"x0.131") NAILS. CEILING JOISTS SHALL BE CONTINUOUS OR SECURELY JOINED WITH (3) 16d COM (3 1/2"x0.162") NAILS WHERE THEY MEET OVER INTERIOR PARTITIONS AND ARE NAILED TO ADJACENT RAFTERS TO PROVIDE A CONTINUOUS TIE ACROSS THE BUILDING WHEN SUCH JOISTS ARE PARALLEL TO THE RAFTERS
- WHERE CEILING JOISTS ARE NOT CONNECTED TO THE RAFTERS AT THE TOP WALL PLATE (or AT LOCATIONS WHERE C.J. ARE PERPENDICULAR TO RAFTERS), INSTALL 2x4 RAFTER TIES @ 16"o WITH (3) 16d COM (3 1/2"x0.162") NAILS EA END
- RAFTER CONNECTIONS DESIGNED TO RESIST UPLIFT FORCES PER IRC TABLE 802.11. ROOF HEADERS DO NOT HAVE NOTABLE UPLIFT TO REQUIRE HOLD DOWNS. REFER TO STRUCTURAL DETAIL SHEET S1 CONNECTION TABLE FOR FASTENERS
- INSTALL 2x4 COLLAR TIES @ 48"o IN UPPER 1/3rd OF ROOF RAFTER. PROVIDE METAL FLASHING AT ALL ROOF VALLEYS
- ROOF AND SOFFIT VENTS PER LOCAL CODES. WHERE POSSIBLE, PROVIDE ROOF VENTING ON BACK SIDE OF ROOF. BATH VENTS TO VENT DIRECTLY TO THE OUTSIDE
- EXACT GUTTER AND DOWNSPOUT LOCATION BY GUTTER INSTALLER
- PER IRC SECTION R802.3 - FOR ROOF PITCHES 3/12 OR GREATER, STRUCTURAL MEMBERS THAT SUPPORT RAFTERS AND CEILING JOISTS SUCH AS RIDGE BEAMS, HIPs AND VALLEYS THAT ARE SUPPORTED BY BRACES AND/OR PURLINS AT THE ENDS ARE ARE NOT REQUIRED TO BE DESIGNED AS BEAMS AND ARE TO BE FRAMED USING LUMBER THAT IS NOMINALLY 2" WIDE BY ONE SIZE GREATER THAN ATTACHING FRAMING MEMBER (NOTE #5). THERE IS NO STRUCTURAL LINE LOADING ON THE MEMBER.

ROOF BRACING


- ROOF PURLINS TO BE PLACED APPROXIMATELY WHERE SHOWN ON PLANS. USE 2x6 STUD GRADE PURLIN PLACED PERPENDICULAR TO RAFTERS (UNLESS NOTED OTHERWISE ON PLANS)
- RIDGE, HIP, VALLEY, AND PURLIN BRACE STRUTS TO BE PLACED AS SHOWN ON PLANS. STRUTS TO BE 2x4 STUD GRADE w/ MAXIMUM UNBRACED LENGTH OF 8'-0" AND AT A 45° ANGLE w/ HORIZONTAL OR GREATER (VERTICAL WHERE POSSIBLE)
- BRACES LONGER THAN 8'-0" SHALL BE 2x4 STRONG BACK BRACES

- /// LOAD BEARING INTERIOR WALL BELOW
- LOAD BEARING BEAM BELOW
- - - 2x6 ROOF PURLIN (UNLESS NOTED OTHERWISE ON PLANS)
- - - 2x4 PURLIN/RIDGE BRACING (STRONG BACK IF OVER 8'-0" LONG)
- ⊗ 2x4 STRONG BACK POST

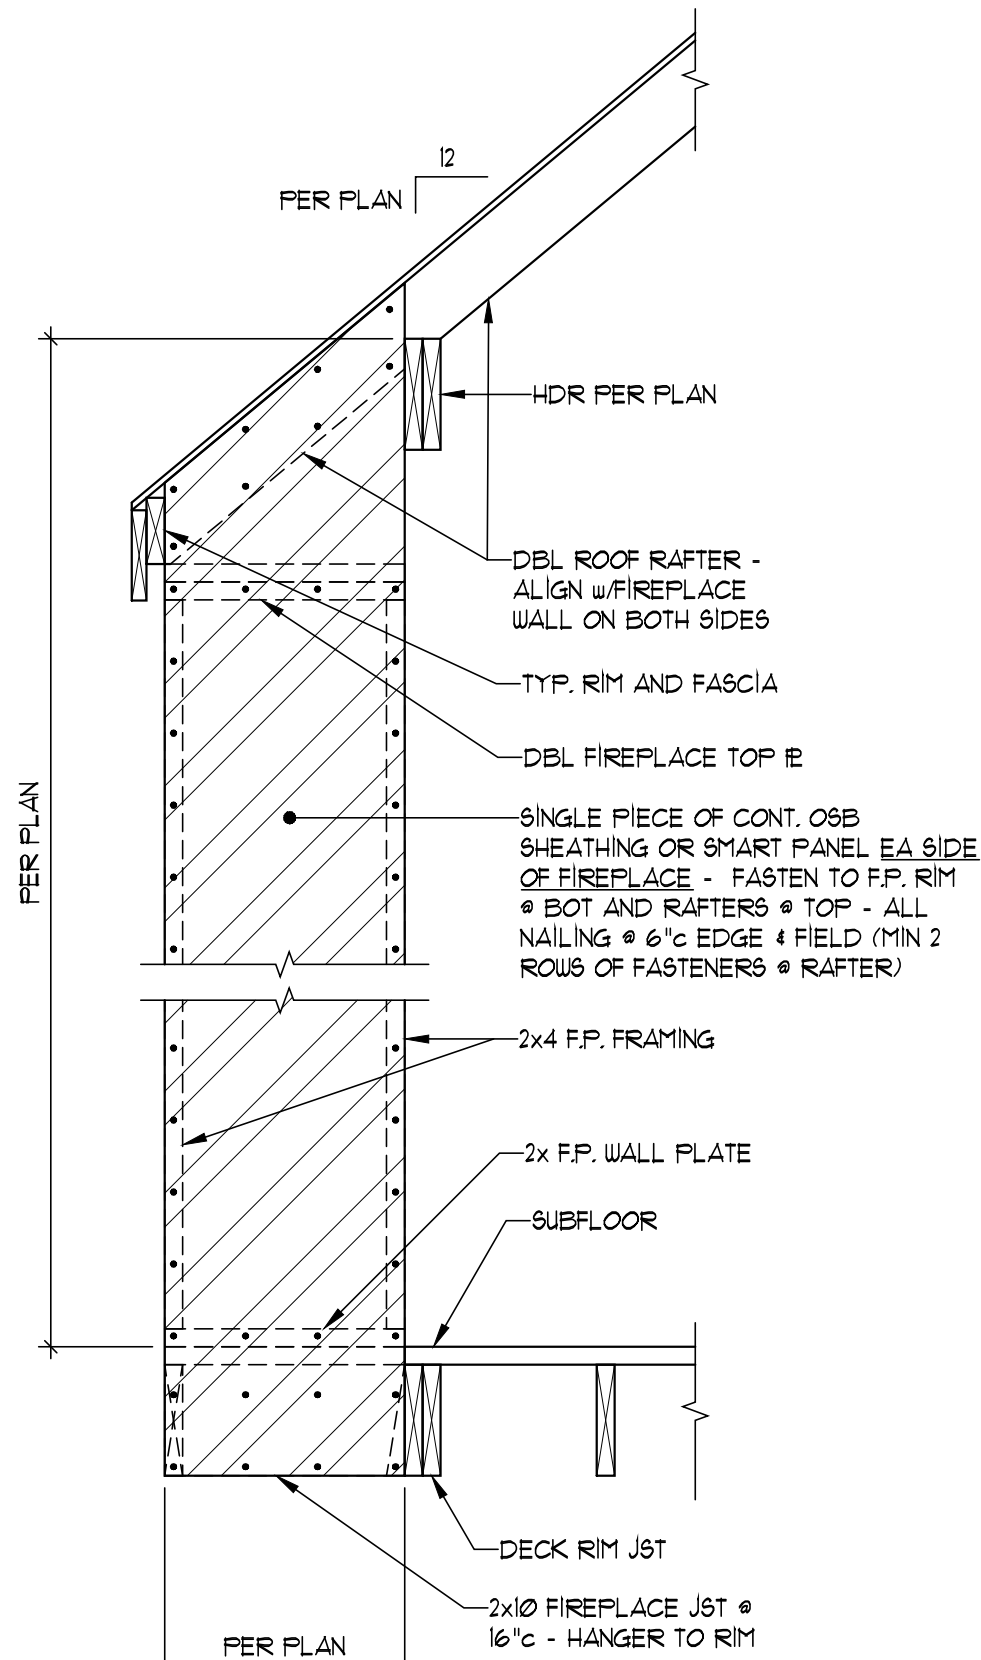

SUSPENDED FIREPLACE DETAIL  
SCALE: 3/4" = 1'-0"

INCREASE SOFFIT @ MASTER

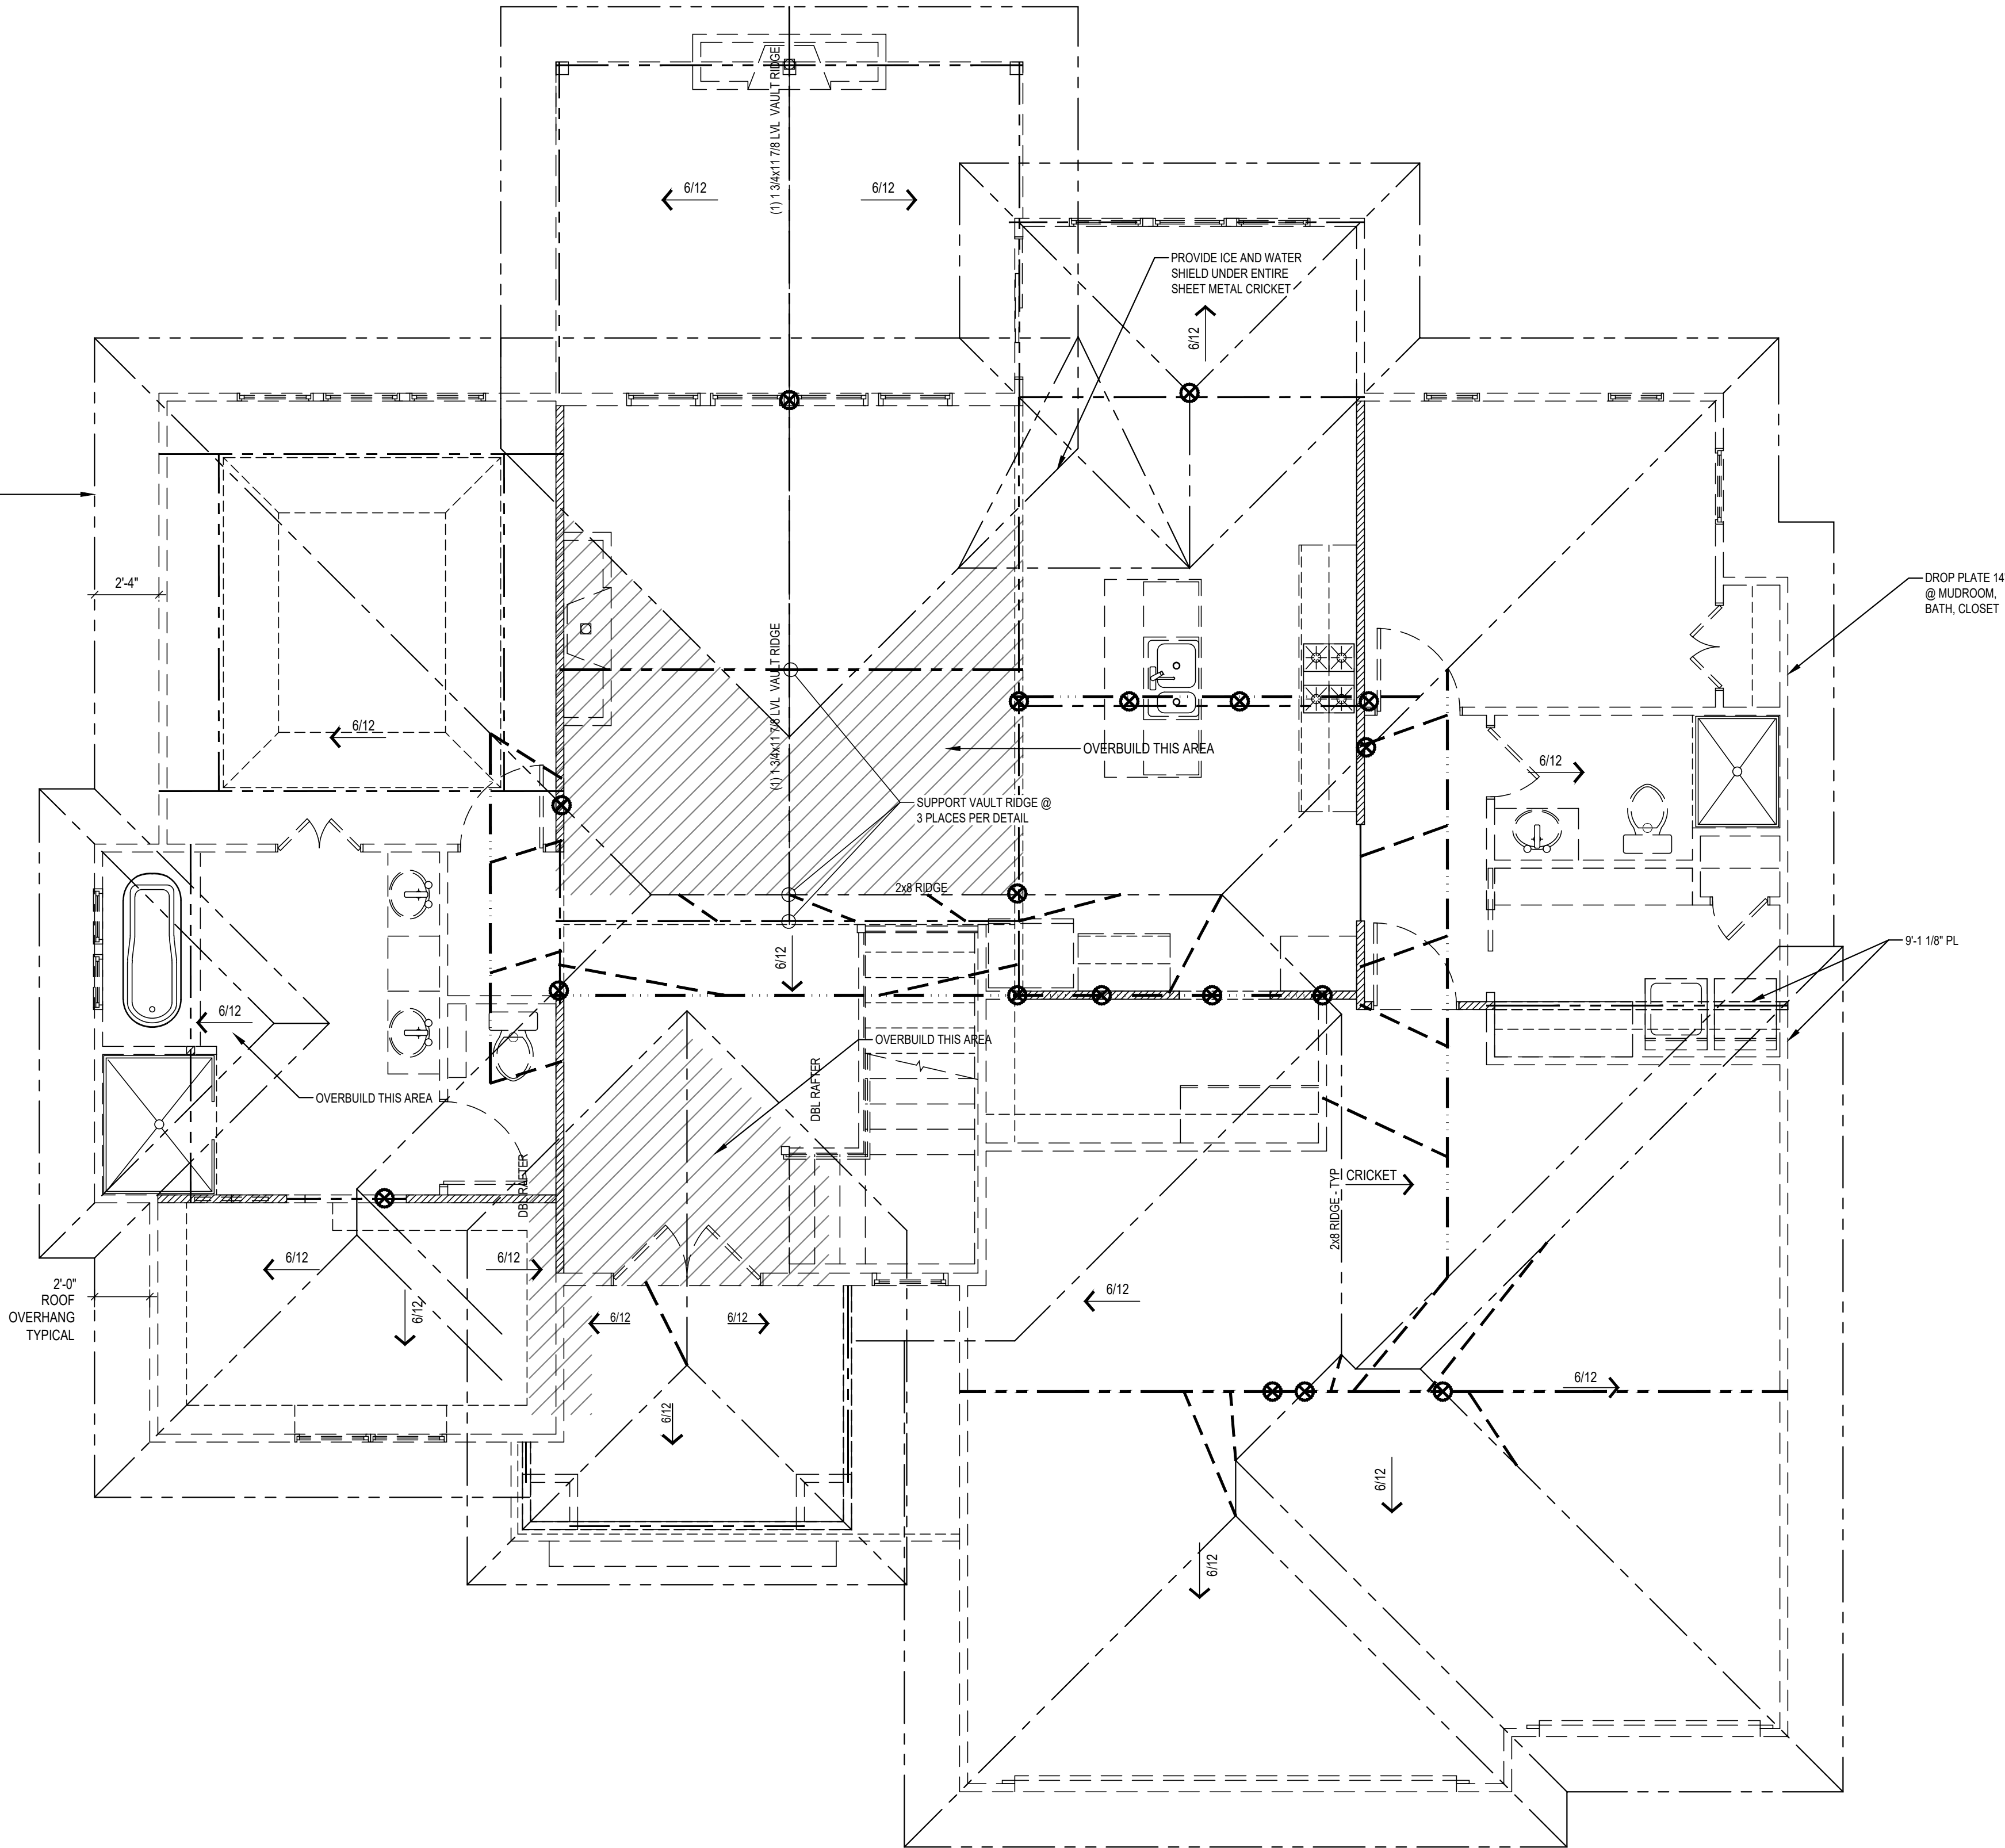

Roof Plan

1/4" = 1'-0"

1



© COPYRIGHT 2021

JFE CONSTRUCTION INC.  
1314 SW Market Street  
Lee's Summit, MO 64081  
v: 816.786.4008  
jfeconstruction.com

VAN DEUREN & ASSOCIATES P.A.  
10011 KING STREET SUITE 130  
OVERLAND PARK, KS 66210  
(913) 451-6305 FAX (913) 451-1021  
WEB PAGE WWW.VANDEURENASSOC.COM  
E-MAIL: VJ@VANDEURENASSOC.COM

Van Deuren and Associates, P.A. © 2021



THE GUNNISON MODERN

Doelling Residence  
213 NW Ambersham Dr, Lee's Summit, MO  
Lot 119 - Woodside Ridge Subdivision

Project #: 8083-2108

DATE:

Permit: 4/16/2021

Roof  
Plan

A104

# STRUCTURAL GENERAL NOTES

## DIVISION 1 - GENERAL REQUIREMENTS

- Design and construction work for this project shall conform to the requirements of the 2018 International Residential Code as amended by the City of Lee's Summit, MO
- Furnish all labor, materials and equipment necessary to complete the work as shown or inferred by the drawings.
- Design Loads:
 

|                                 |         |
|---------------------------------|---------|
| Residential (Live Loads)        | 40 PSF  |
| Sleeping rooms (Live Loads)     | 30 PSF  |
| Floor Dead Load                 | 15 PSF  |
| Floor Joist Deflection (Total)  | L/240   |
| Floor Joist Deflection (Live)   | L/360   |
| Attic Storage (Live Loads)      | 10 PSF  |
| Ceiling Dead Load               | 5 PSF   |
| Ceiling Joist Deflection        | L/240   |
| B. Roof Live Load               | 20 PSF  |
| C. Roof Snow Load               |         |
| Ground Snow Load, pg            | 20 PSF  |
| Flat Roof Snow Load, pf         | 20 PSF  |
| Snow Exposure Factor, Ce        | 1.0     |
| Snow Load Importance Factor, Is | 1.0     |
| Thermal Factor, Ct              | 1.0     |
| D. Wind Load:                   |         |
| Basic Wind Speed (Vult)         | 115 MPH |
| Risk Category                   | II      |
| Exposure                        | B       |
| Internal Pressure Coefficient   | ±0.18   |

## DIVISION 2 - EARTHWORK

- The contractor shall employ the services of a geotechnical engineer to observe, test and approve all excavation, fill and backfill work and to determine that subsurface conditions are compatible with those used in the design.
- The minimum soil bearing capacity is 1500 PSF in accordance with Table 1604.2 of the International Building Code. All footings are designed to bear on natural undisturbed soil or controlled fill capable of adequately sustaining a maximum bearing pressure of 1500 PSF. If suitable bearing capacity is not encountered at the elevation indicated on the drawing, contractor shall notify the architect immediately.
- All topsoil, organic material and existing structures shall be removed from building area and from areas to be paved. Stockpile all topsoil for reuse.
- Controlled Fill Materials:
  - Granular Fill - Granular fill shall consist of washed, evenly graded mixture of crushed stone, or crushed or uncrushed gravel, with 100 percent passing a 1 1/2 inch sieve and not more than 5 percent passing a no. 4 sieve.
  - Shrinkage-Swell controlled fill - Shrinkage-swell controlled fill shall consist of material having a relatively low plasticity with a liquid limit of less than 45 percent and a plasticity index of less than 21 percent.
  - Controlled Fill - Controlled fill shall be either granular or shrinkage-swell controlled fill as specified above and as approved by the geotechnical engineer.
- Controlled fill shall consist of material having a relatively low plasticity with a liquid limit of less than 45 percent and a plasticity index of less than 21 percent.
- Foundation Preparation:
  - Profile site to identify soft or disturbed areas. If areas are found to be unsuitable for support of footings and/or slab-on-grade please contact the Engineer of Record.
  - Backfill directly under slabs-on-grade with minimum of 4 inches of granular fill consisting of washed, evenly graded mixture of crushed stone, or crushed or uncrushed gravel, with 100 percent passing a 1 1/2 inch sieve and not more than 5 percent passing a no. 4 sieve.

- Controlled Fill and Backfill Compaction:
  - All controlled fill and backfill shall be placed in lifts having maximum loose lift thickness of 9 inches.
  - Granular Fill - Compact granular fill as determined by testing bearing elevation to a minimum of 95 percent of material's maximum dry density as determined by ASTM D 698 and to a minimum of 95 percent of material founded above footing bearing elevation.
  - Shrinkage-swell controlled fill - Compact shrinkage-swell controlled fill below footing bearing elevation to minimum of 95 percent of the material's maximum dry density as determined by ASTM D 698 and to a minimum of 95 percent for material founded above footing bearing elevation.
  - Controlled Fill - Compact controlled fill at a moisture content within a range of 0 to 4 percent above optimum moisture content.

## DIVISION 3 - CONCRETE

- All concrete work shall conform to the requirements of ACI 318 "Building Code Requirements for Reinforced Concrete" and ACI 301 "Specification for Structural Concrete Buildings."
- Concrete materials shall comply with:
  - Cement - ASTM C 150 Type I
  - Aggregate - ASTM C 33, maximum aggregate size 3/4 inch
  - Water - Potable
  - Air-entraining admixture - ASTM C 260
  - Water-reducing admixture - ASTM C 494, including superplasticizers.
  - Fly ash - ASTM C 618, Class C
- Concrete shall develop the following minimum 28 day design compressive strength (f'c):
 

| Type of Construction                                         | Compressive Strength(f'c) |
|--------------------------------------------------------------|---------------------------|
| Foundations, walls and basement slab                         | 3000 PSI                  |
| Garage Slab                                                  | 3600 PSI                  |
| C. Exterior slabs, steps, and curbs (air-entrained concrete) | 4000 PSI                  |
- Concrete proportions shall be established on the basis of field experience and trial mixtures in accordance with ACI 318-88 Sections 5.2 and 5.3. When fly ash is utilized in the mix, mix shall contain a water-reducer. Fly ash shall be added at the rate of not more than 100 pounds per cubic yard and cement shall be reduced by not more than 15 percent by weight. Proportion and design mixes to result in concrete slump at point of placement of not more than 4 inches, except grout for masonry of not more than 6 inches.
- Use air-entraining admixture in exterior exposed concrete to result in concrete at point of placement having air content of 5 to 7 percent entrained air.
- Reinforcing Steel:
  - Reinforcing bars - ASTM A 615, grade 40, deformed
  - Welded wire fabric - ASTM A 1064, lap at least one full mesh and lace splices with wire.
  - Supports for reinforcement - comply with CRSI recommendations.
- Concrete Work Execution:
  - Minimum concrete cover for exposed to earth - 3 inches
  - Exposed to earth or weather - 2 inches
  - Not exposed to earth or weather - 1 1/2 inches
- All concrete is reinforced, reinforcement does not exceed indicated with same reinforcement as noted sections.
- Protect concrete work from physical damage or reduced strength due to weather extremes:
  - In cold weather comply with ACI 308
  - In hot weather comply with ACI 305
- In corners of grade beams and walls provide corner reinforcement. Lap two feet each direction in outside face, matching size and spacing of horizontal reinforcement.
- At openings in walls, add one #4 bar (opening dimension plus 60 bar diameters) each face, each corner of opening.
- Provide one #4 bar diagonally at each face of all steps in grade beams and foundation walls.
- Provide construction joints in footings, grade beams and walls at not greater than 80 feet in any direction, key and dowel construction joints.
- Provide control joints in slabs-on-grade at not greater than 20 feet on center in each direction. Saw cut control joints minimum 1/4 of slab depth, as soon after slab finishing as possible without dislodging aggregate.
- Coordinate concrete work with architectural and mechanical drawings for concrete finishes, recessed areas, embedded items and other conditions.

## DIVISION 5.5 - MISCELLANEOUS STRUCTURAL STEEL

- All miscellaneous structural steel work shall conform to the requirements of AISC "Specifications for Design, Fabrication, and Erection of Structural Steel for Buildings".
- Miscellaneous structural steel material shall comply with:
  - Structural Steel - ASTM A 36
  - Cold-formed Steel Tubing - ASTM A 500 Grade B
  - Anchor Rods - ASTM F-1554, non-headed type unless otherwise noted.


## DIVISION 6 - ROUGH CARPENTRY

- All rough carpentry work shall conform to the requirements of NFCA "National Design Specification of Wood Construction"; TP "Design Specifications for Light Metal Plate Connected Wood Trusses"; APA "Physwood Design Specifications"; DOC PS 1 "Product Standard for Construction and Industrial Plywood"; DOC PS 58 "Structural Glued Laminated Timber" and Chapter 23 of the International Building Code.
- Rough carpentry materials shall comply with:
  - Lumber - S&S, surface dry, grade marked, complying with PS 20; graded under WWPA or SPIB rules:
 


| Joist:                                  | Stud:                                   |
|-----------------------------------------|-----------------------------------------|
| No. 2 Douglas Fir No. 2 Hem Fir         | No. 2 Spruce-Pine-Fir                   |
| Header:                                 | Joist:                                  |
| No. 2 Douglas Fir                       | No. 2 Douglas Fir                       |
| Rafter:                                 | Header:                                 |
| No. 3 Douglas Fir No. 2 Spruce-Pine-Fir | No. 2 Douglas Fir                       |
| Plates:                                 | Rafter:                                 |
| No. 3 Spruce-Pine-Fir                   | No. 3 Douglas Fir No. 2 Spruce-Pine-Fir |
| Blocking:                               | Plates:                                 |
| No. 3 Spruce-Pine-Fir                   | No. 3 Spruce-Pine-Fir                   |
  - Metal framing fasteners - ASTM A 153, hot-dip galvanized fasteners; equal to Simpson strong-tie connectors complying with IBCO No. 1258.
  - Plywood - APA rated sheathing, complying to PS 1.
  - LVL - Laminated veneer lumber shall be grade 2800 F-2 O-E and shall meet the requirements of NE-442, NE-472 or ER-4321.
  - Joist - Joist shall be fabricated from APA rated sheathing board webs, LVL flanges, utilizing waterproof type glue and shall meet requirements of NE-450, NE-466, NE-476 or IBCO PFC-3754.
  - Gypsum Sheathing Board - ASTM C 79 and UBC Standard No. 47-10.
  - Gypsum Wallboard - ASTM C 36 and UBC Standard No. 47-11.
  - Roof sheathing for standard asphalt roofing shall be 1/2 inch APA rated sheathing 24/0 exterior glued and clipped. Roof sheathing for Conc Tile shall be 5/8 inch APA rated 32/16 exterior glued and clipped. Lay sheathing with face grain perpendicular to support members and stagger end joints 4'-0". FASTEN PER SCHEDULE BELOW.
  - Roof sheathing shall be 3/4 inch APA rated sheathing 48/24 exterior glued. Lay sheathing with face grain perpendicular to support members and stagger end joints 4'-0". FASTEN PER SCHEDULE BELOW.
  - Exterior wall sheathing shall be 1/2 inch APA Rated sheathing 24/0 or 7/16 inch LP Smart Siding exterior glued. Provide solid blocking at all unsupported panel edges FASTEN PER SCHEDULE BELOW. For LP Siding, fasten through both panels at edge supports.
  - Interior shear wall sheathing where noted shall be 1/2 inch gypsum wallboard. FASTEN PER SCHEDULE BELOW.
  - In cold weather comply with ACI 308
  - Provide full depth solid blocking, 1 x 4 cross bracing, or 16 gage metal cross bracing bridging at ends of members and at 8'-0" intervals along members.

| ITEM | DESCRIPTION OF BUILDING ELEMENTS                                                                                                                        | NUMBER AND TYPE OF FASTENER <sup>a, b, c</sup>                                    |                                                                                                         | SPACING AND LOCATION                                                                       |
|------|---------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------|---------------------------------------------------------------------------------------------------------|--------------------------------------------------------------------------------------------|
|      |                                                                                                                                                         | COMMON NAIL                                                                       | PNEUMATIC NAIL                                                                                          |                                                                                            |
| ROOF |                                                                                                                                                         |                                                                                   |                                                                                                         |                                                                                            |
| 1    | Blocking between ceiling joists or rafters to top plate                                                                                                 | (4) 8d box<br>(3) 8d common<br>(3) 10d box                                        | (4) 2 1/2" × 0.113"<br>(3) 2 1/2" × 0.131"<br>(3) 3" × 0.128"<br>(3) 3" × 0.131"                        | Toe nail                                                                                   |
| 2    | Ceiling joists to top plate                                                                                                                             | (4) 8d box<br>(3) 8d common<br>(3) 10d box                                        | (4) 2 1/2" × 0.113"<br>(3) 2 1/2" × 0.131"<br>(3) 3" × 0.128"<br>(3) 3" × 0.131"                        | Per joist, toe nail                                                                        |
| 3    | Ceiling joist not attached to parallel rafter, laps over partitions                                                                                     | (4) 10d box<br>(3) 16d common                                                     | (4) 3" × 0.128"<br>(3) 3 1/2" × 0.162"<br>(4) 3" × 0.131"                                               | Face nail                                                                                  |
| 4    | Ceiling joist attached to parallel rafter (heel joint)<br>Note: Fasteners listed IRC Table R602.5.2 assuming 16" Rafter Joists & spans less than 12'-0" | (3) 16d common @ slopes greater than 4:12<br>(5) 16d common @ slopes 4:12 or less | (3) 3 1/2" × 0.162" @ slope > 4:12<br>(5) 3 1/2" × 0.162" @ slope 4:12 or less                          | Face nail                                                                                  |
| 5    | Collar tie to rafter, face nail or 11/4" × 20ga. ridge strap to rafter                                                                                  | (4) 10d box<br>(3) 16d common                                                     | (4) 3" × 0.128"<br>(4) 3" × 0.131"                                                                      | Face nail each rafter                                                                      |
| 6    | Rafter or roof truss to plate                                                                                                                           | (3) 16d box<br>(3) 10d common<br>(4) 10d box                                      | (3) 3 1/2" × 0.135"<br>(3) 3" × 0.148"<br>(4) 3" × 0.128"<br>(4) 3" × 0.131"                            | 2 toe nails on one side and 1 toe nail on opposite side of each rafter or truss            |
| 7    | Rafter refers to ridge, valley or hip rafters or roof rafter to minimum 2" ridge beam                                                                   | (4) 16d<br>(3) 10d common<br>(4) 10d box                                          | (4) 3 1/2" × 0.135"<br>(3) 3 1/2" × 0.148"<br>(4) 3" × 0.128"<br>(4) 3" × 0.131"                        | Toe nail                                                                                   |
|      |                                                                                                                                                         | (3) 16d box<br>(3) 16d common<br>(3) 10d box                                      | (3) 3 1/2" × 0.135"<br>(3) 3 1/2" × 0.162"<br>(4) 3" × 0.128"                                           | End nail                                                                                   |
| WALL |                                                                                                                                                         |                                                                                   |                                                                                                         |                                                                                            |
| 8    | Stud to stud (not at braced wall panels)                                                                                                                | 16d common<br>10d box                                                             | 3 1/2" × 0.162"<br>3" × 0.128"<br>3" × 0.131"                                                           | 24" face nail<br>16" face nail                                                             |
| 9    | Stud to stud and abutting studs at intersecting wall corners (at braced wall panels)                                                                    | 16d box<br>16d common                                                             | 3 1/2" × 0.135"<br>3" × 0.131"                                                                          | 18" face nail                                                                              |
| 10   | Build-up header (2" to 2" header with 1/2" spacer)                                                                                                      | 16d common<br>16d box                                                             | 3 1/2" × 0.162"<br>3 1/2" × 0.135"                                                                      | 16" each edge face nail<br>12" each edge face nail                                         |
| 11   | Continuous header to stud                                                                                                                               | (5) 8d box<br>(4) 8d common<br>(4) 10d box                                        | (5) 2 1/2" × 0.113"<br>(4) 2 1/2" × 0.131"<br>(4) 3" × 0.128"                                           | Toe nail                                                                                   |
| 12   | Top plate to top plate                                                                                                                                  | 16d common<br>10d box                                                             | 3 1/2" × 0.162"<br>3" × 0.128"<br>3" × 0.131"                                                           | 16" face nail<br>12" face nail                                                             |
| 13   | Double top plate splice for SDCs A-D2 with seismic braced wall line spacing < 25'                                                                       | (8) 16d common<br>(12) 16d box<br>(12) 10d box                                    | (8) 3 1/2" × 0.162"<br>(12) 3 1/2" × 0.135"<br>(12) 3" × 0.128"                                         | Face nail on each side of end joint (minimum 24" lap splice length each side of end joint) |
|      | Double top plate splice SDCs D0, D1, or D2, and braced wallline spacing ≥ 25'                                                                           | 16d common<br>16d box                                                             | 3 1/2" × 0.162"<br>3" × 0.131"                                                                          | 16" face nail<br>12" face nail                                                             |
| 14   | Bottom plate to joist, rim joist, band joist or blocking (not at braced wall panels)                                                                    | (3) 16d box<br>(2) 16d common                                                     | 3 1/2" × 0.135"<br>(3) 3 1/2" × 0.162"<br>(4) 3" × 0.131"                                               | 3 each 16" face nail<br>2 each 16" face nail<br>4 each 16" face nail                       |
| 15   | Bottom plate to joist, rim joist, band joist or blocking (at braced wall panel)                                                                         | (4) 8d box<br>(4) 16d common<br>(4) 10d box                                       | (4) 2 1/2" × 0.113"<br>(4) 3 1/2" × 0.135"<br>(4) 2 1/2" × 0.131"<br>(4) 3" × 0.128"<br>(4) 3" × 0.131" | Toe nail                                                                                   |
| 16   | Top or bottom plate to stud                                                                                                                             | (3) 16d box<br>(3) 16d common<br>(3) 10d box                                      | (3) 3 1/2" × 0.135"<br>(2) 3 1/2" × 0.162"<br>(3) 3" × 0.131"                                           | End nail                                                                                   |
| 17   | Top plates, laps at corners and intersections                                                                                                           | (3) 10d box<br>(2) 16d common                                                     | (3) 3" × 0.128"<br>(2) 3 1/2" × 0.162"<br>(3) 3" × 0.131"                                               | Face nail                                                                                  |
| 18   | 1" brace to each stud and plate                                                                                                                         | (3) 8d box<br>(2) 8d common<br>(2) 10d box<br>(2) Staples <sup>d</sup>            | (3) 2 1/2" × 0.113"<br>(2) 2 1/2" × 0.131"<br>(2) 3" × 0.128"                                           | Face nail                                                                                  |
| 19   | 1" × 6" sheathing to each bearing                                                                                                                       | (3) 8d box<br>(2) 8d common<br>(2) 10d box<br>(2) Staples <sup>d</sup>            | (3) 2 1/2" × 0.113"<br>(2) 2 1/2" × 0.131"<br>(2) 3" × 0.128"                                           | Face nail                                                                                  |
| 20   | 1" × 8" and wider sheathing to each bearing                                                                                                             | (3) 8d box<br>(3) 8d common<br>(3) 10d box<br>(3) Staples <sup>d</sup>            | (3) 2 1/2" × 0.113"<br>(3) 2 1/2" × 0.131"<br>(3) 3" × 0.128"                                           | Face nail                                                                                  |
|      | Wider than 1" × 8"                                                                                                                                      | (4) 8d box<br>(3) 8d common<br>(3) 10d box<br>(4) Staples <sup>d</sup>            | (4) 2 1/2" × 0.113"<br>(3) 2 1/2" × 0.131"<br>(3) 3" × 0.128"                                           | Face nail                                                                                  |


- a. Nails are smooth-conform, box or deformed shanks except where otherwise stated. Nails used for framing and sheathing connections shall have minimum average bending yield strength as shown. 10d for shank diameter of 0.142 inch and 10d for shank diameter of 0.142 inch but not larger than 0.177 inch, and 10d for shank diameter of 0.142 inch.
- b. Staples are 10d for shank diameter of 0.142 inch and 10d for shank diameter of 0.142 inch but not larger than 0.177 inch, and 10d for shank diameter of 0.142 inch.
- c. Nails shall be spaced at not more than 6 inches on center at all supports where spans are 48 inches or greater.
- d. Four-foot by 4-foot or 4-foot by 8-foot panels shall be applied vertically.
- e. Spacing of fasteners not included in this table shall be based on Table R602.5(2).
- f. Where the ultimate design wind speed is 130 mph or less, nails for attaching wood structural panel sheathing to gable end wall framing shall be spaced 6 inches on center. Where the ultimate design wind speed is greater than 130 mph, nails for attaching wood structural panel sheathing to intermediate supports shall be spaced 6 inches on center for minimum 48-inch distance from eaves, ends of gable end walls, and 4 inches on center to gable and wall framing.
- g. Gypsum sheathing shall conform to ASTM C 79 and shall be installed in accordance with IA 253. Fiberglass sheathing shall conform to ASTM C 208.
- h. Spacing of fasteners on floor sheathing panel edges applied to panel edges supported by framing members and required blocking and all floor sheathing only. Spacing of fasteners on roof sheathing panel edges applied to panel edges supported by framing members and required blocking. Blocking of roof or floor sheathing panel edges perpendicular to the framing members shall be provided in accordance with the provisions of the code. Prior permission shall be required by the Engineer of Record for any deviation from the provisions of the code.
- i. Where a rafter is fastened to an adjacent parallel ceiling joist in accordance with this schedule, provide two toe nails on one side of the rafter and toe nails from the ceiling joist to top plate in accordance with this schedule. The toe nail on the opposite side of the rafter shall not be required.

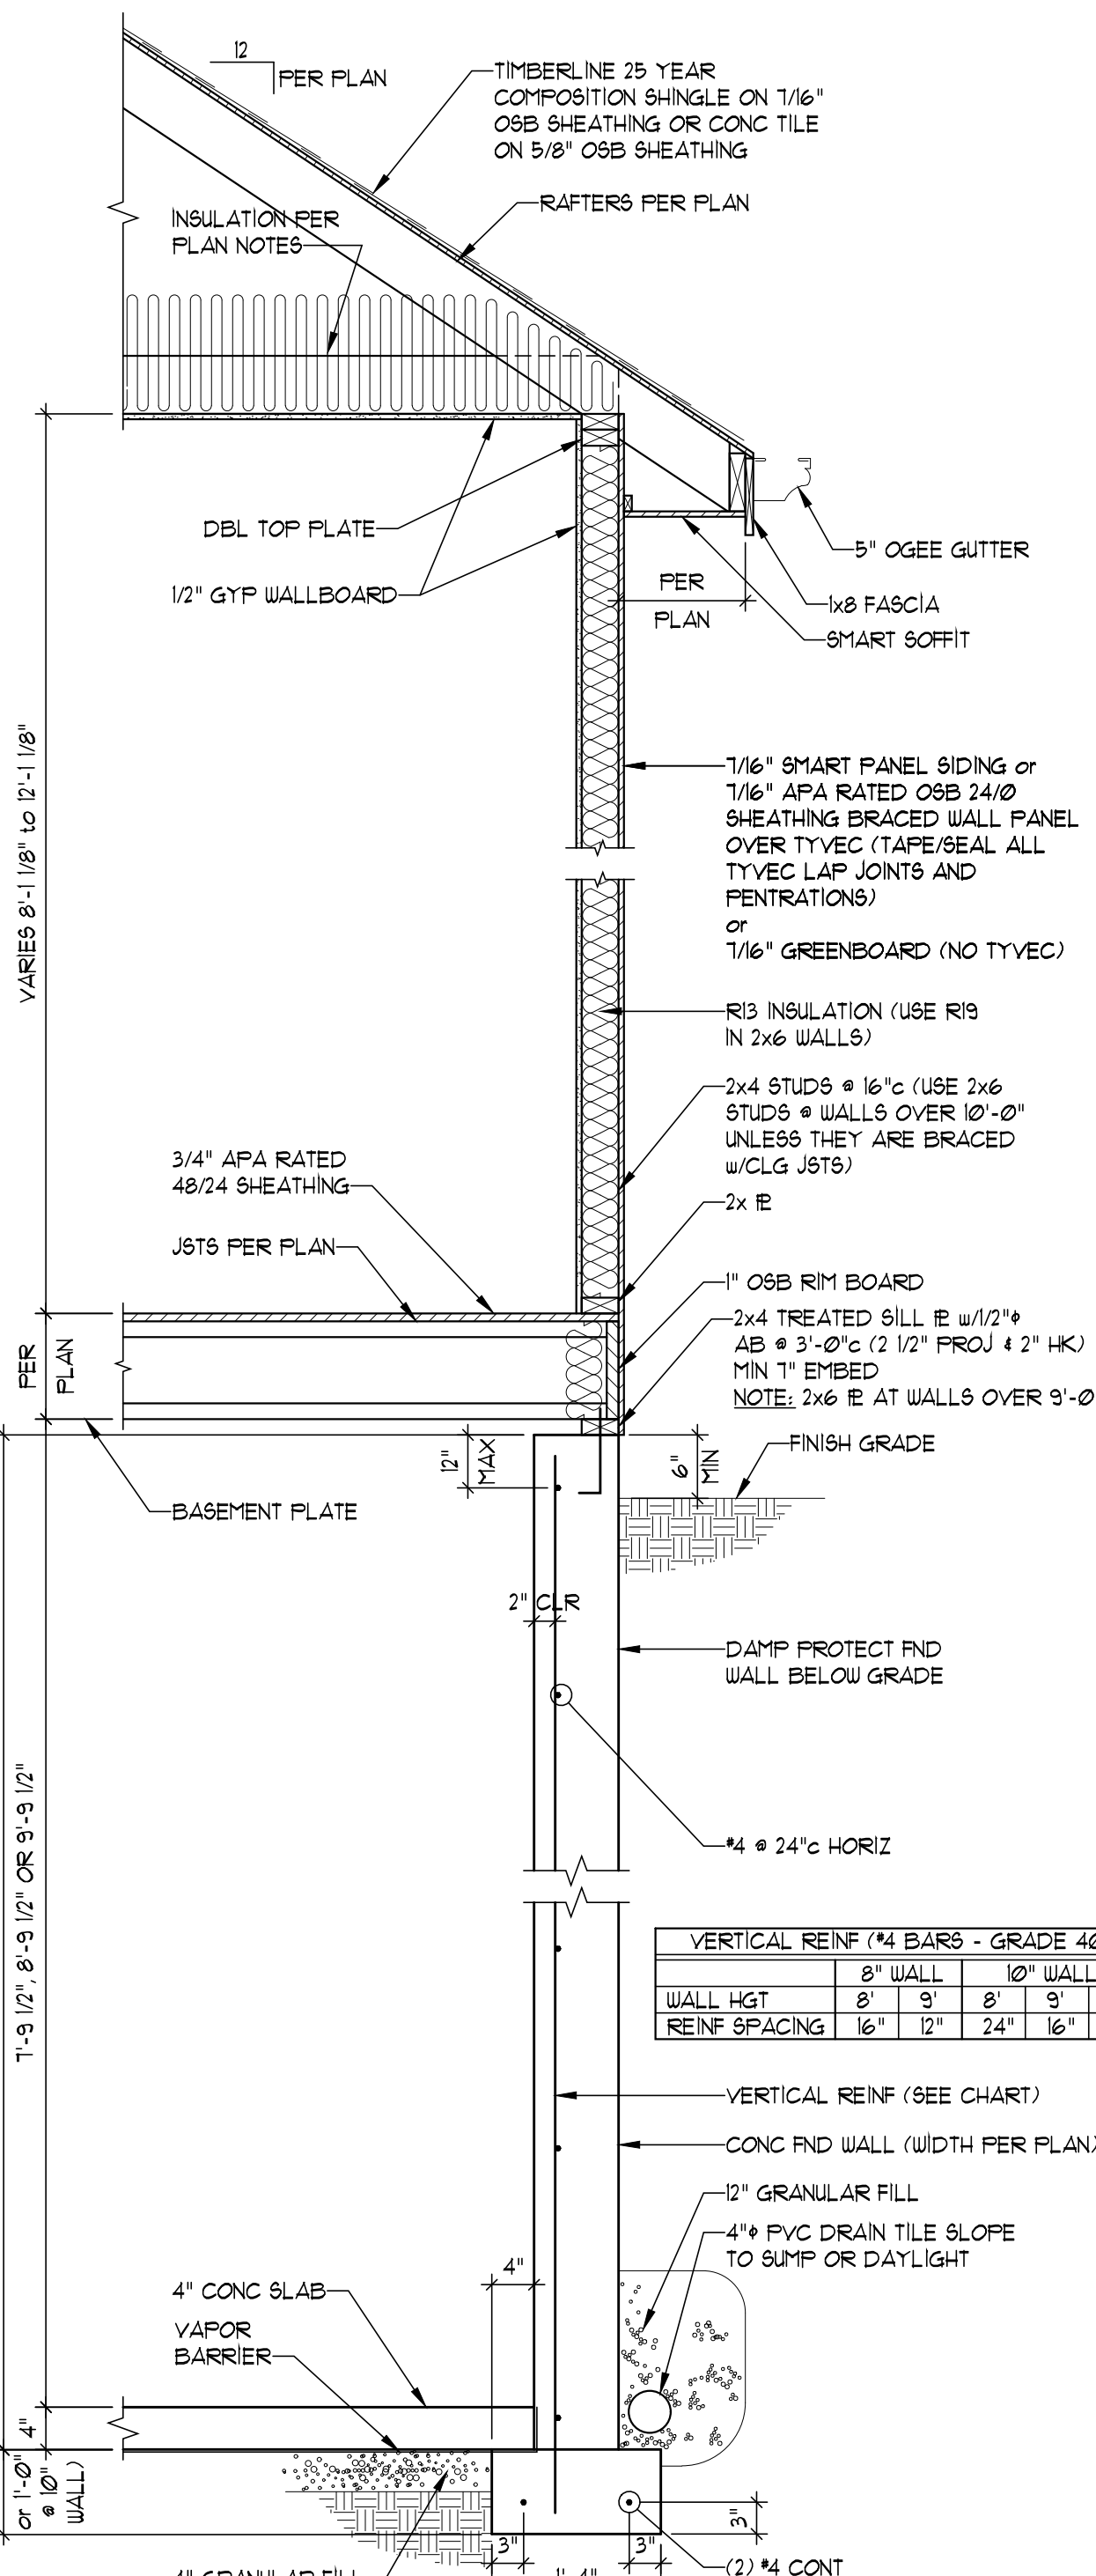


TYPICAL WALL SECTION  
SCALE: 3/4" = 1'-0"

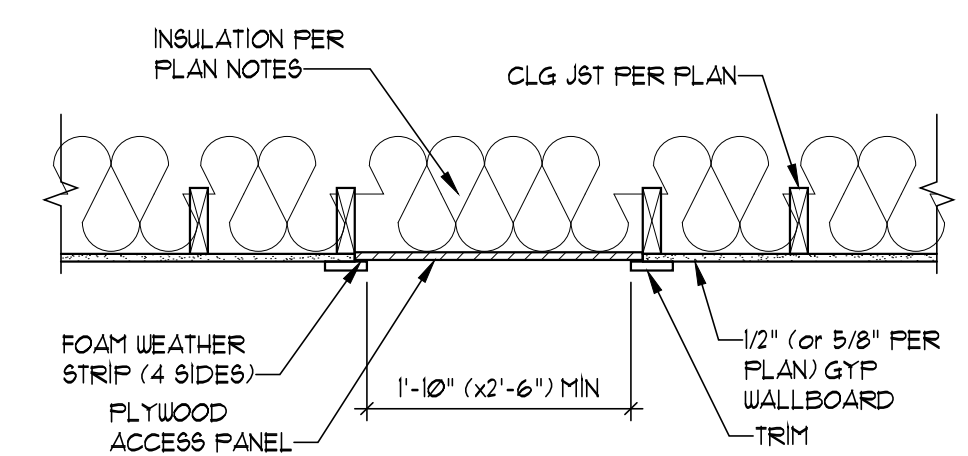

ATTIC ACCESS HATCH  
SCALE: 3/4" = 1'-0"

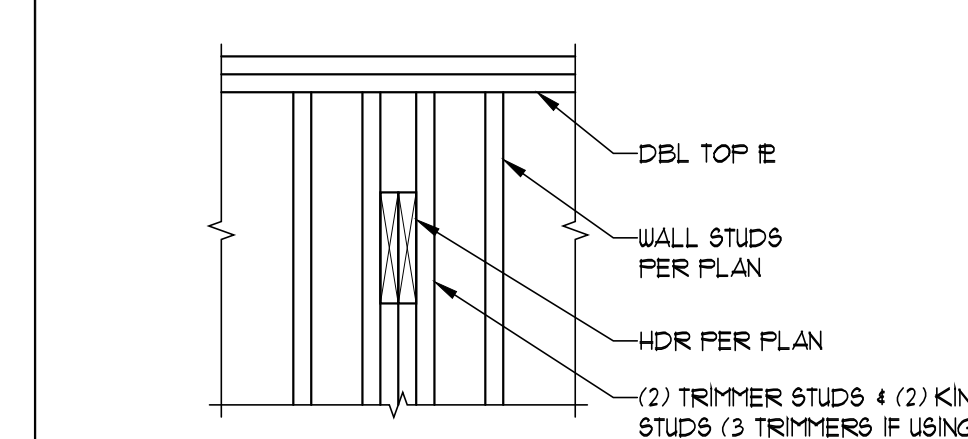


WOOD HEADER TO WALL CONNECTION  
SCALE: 3/4" = 1'-0"

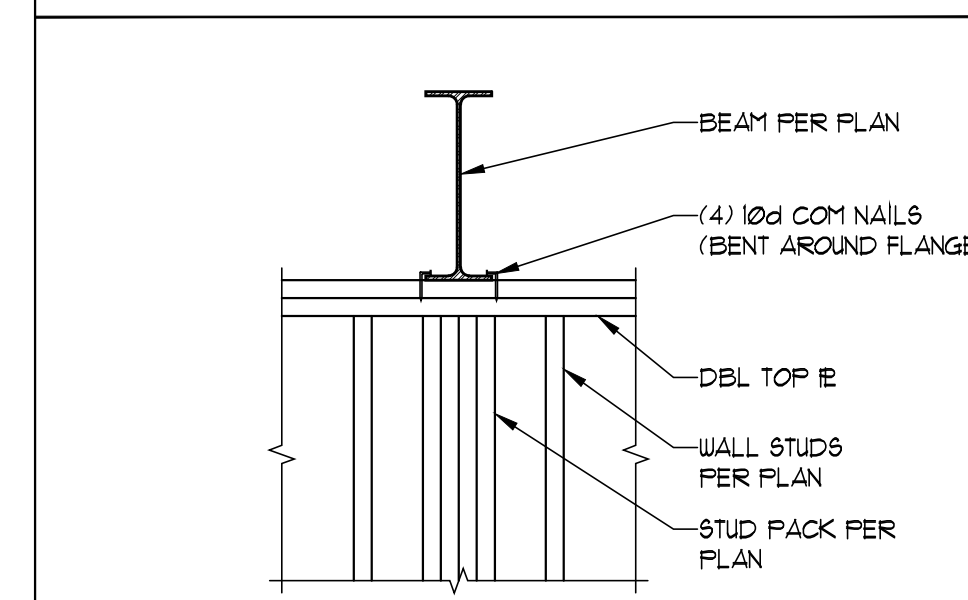


UPSET STEEL BEAM TO WALL CONN.  
SCALE: 3/4" = 1'-0"


| HANGER SCHEDULE   |          | ENGINEERED LUMBER |        |
|-------------------|----------|-------------------|--------|
| SOLID SAWN LUMBER | HANGER   | HDR SIZE          | HANGER |
| 2x6               | LU824    | 1 3/4x1 1/4       | HJ1    |
| 2x8               | LU826    | 1 3/4x3 1/4       | HJ3    |
| 2x10              | LU828    | 1 3/4x3 1/2       | HJ5    |
| 2x12              | LU8210   | 1 3/4x1 7/8       | HJ11   |
| (2) 2x6           | LU824-2  | (2) 1 3/4x1 1/4   | HJ48   |
| (2) 2x8           | LU826-2  | (2) 1 3/4x3 1/4   | HJ410  |
| (2) 2x10          | LU828-2  | (2) 1 3/4x3 1/2   | HJ410  |
| (2) 2x12          | LU8210-2 | (2) 1 3/4x1 7/8   | HJ5412 |

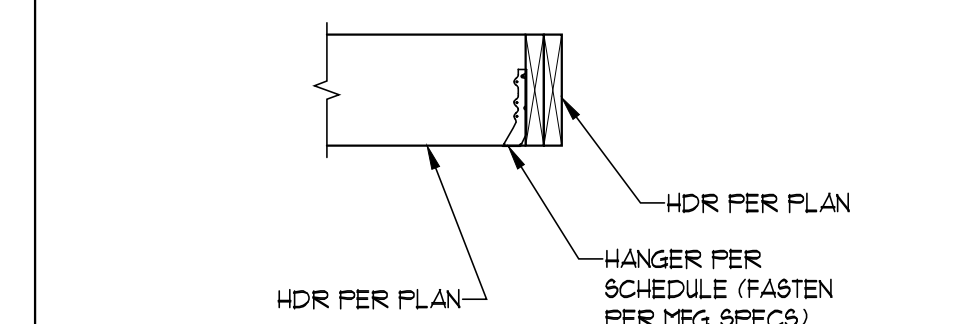


WOOD HEADER (or JST) TO HEADER CONNECTION  
SCALE: 3/4" = 1'-0"

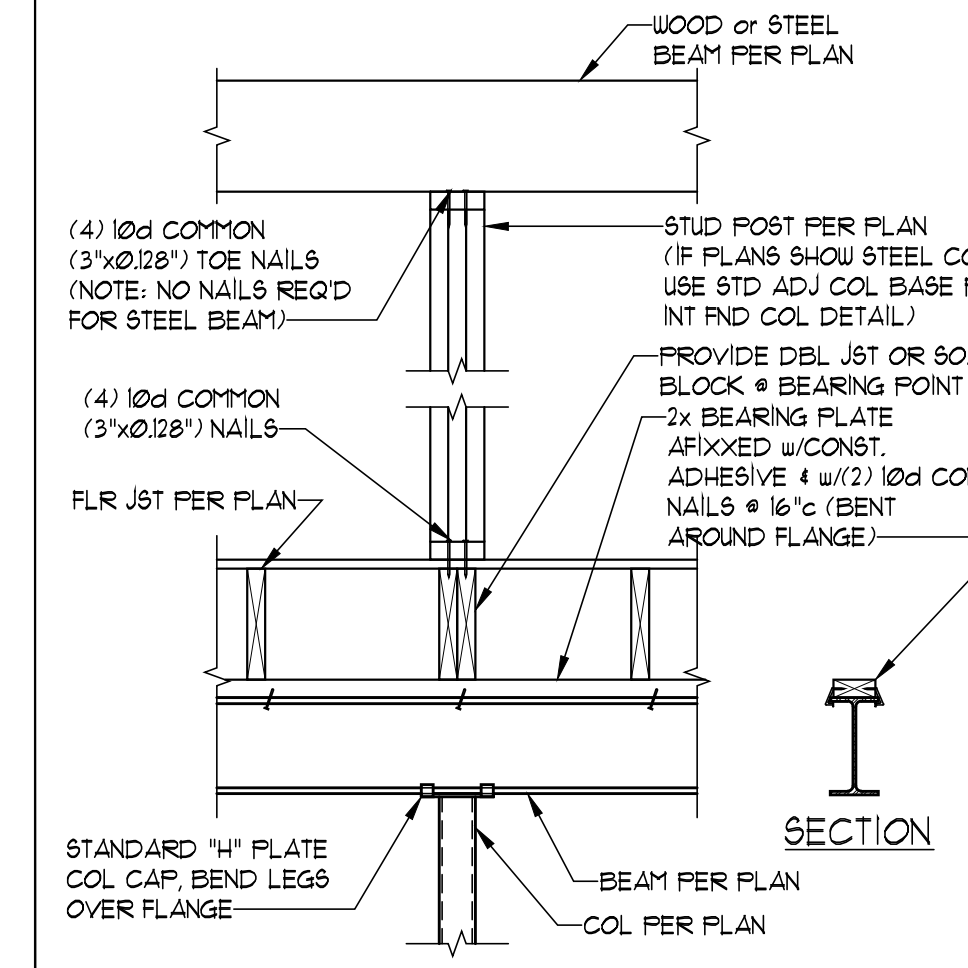


STEEL POST CAP AND MISC POST CONN DETAILS  
SCALE: 3/4" = 1'-0"

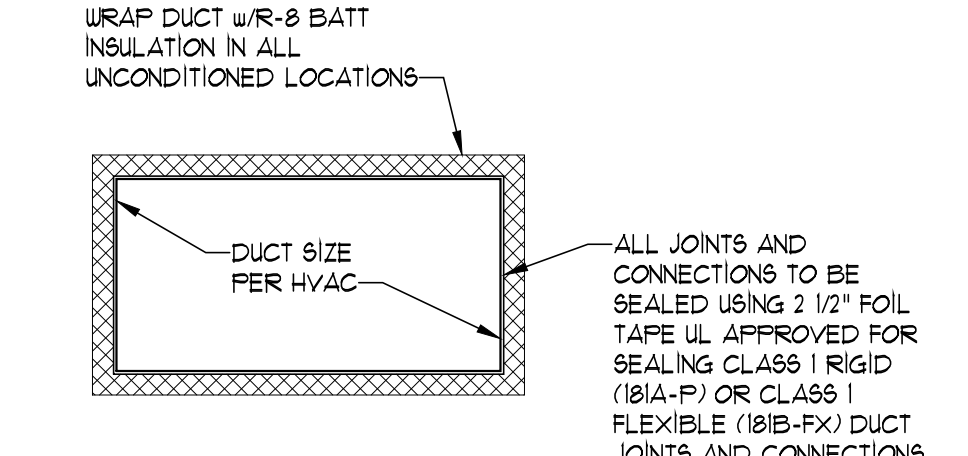


DUCT INSTALLATION  
NOT TO SCALE

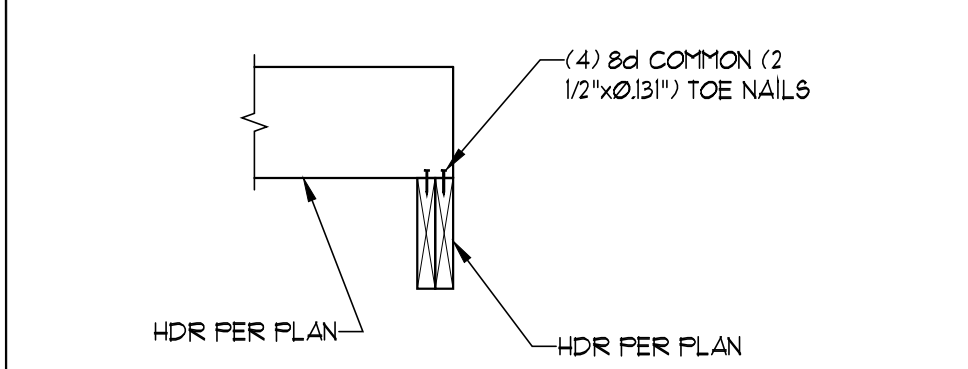


UPSET HEADER TO HEADER CONNECTION (UPSET HDR TO WALL SIM)  
SCALE: 3/4" = 1'-0"

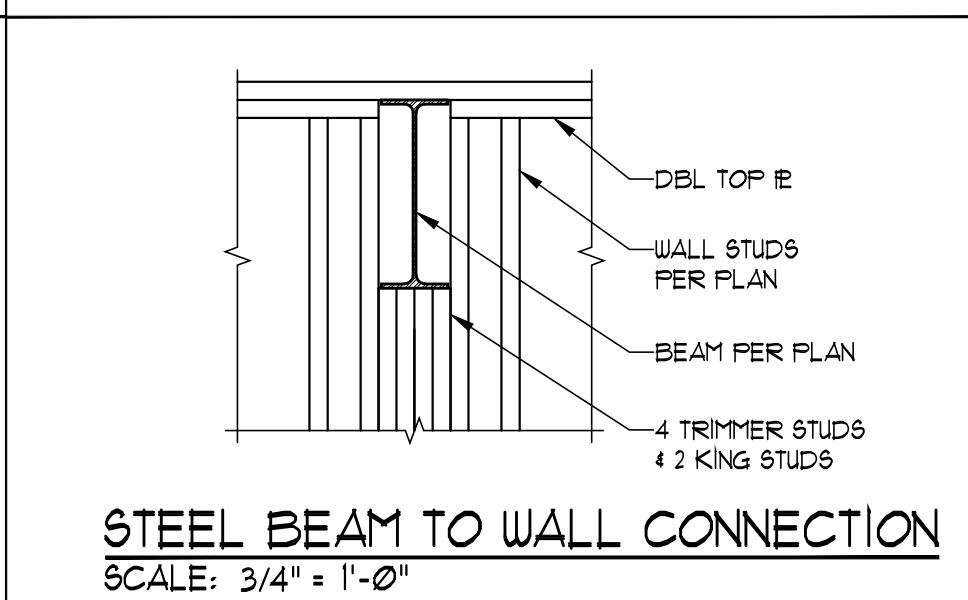


STEEL BEAM TO WALL CONNECTION  
SCALE: 3/4" = 1'-0"

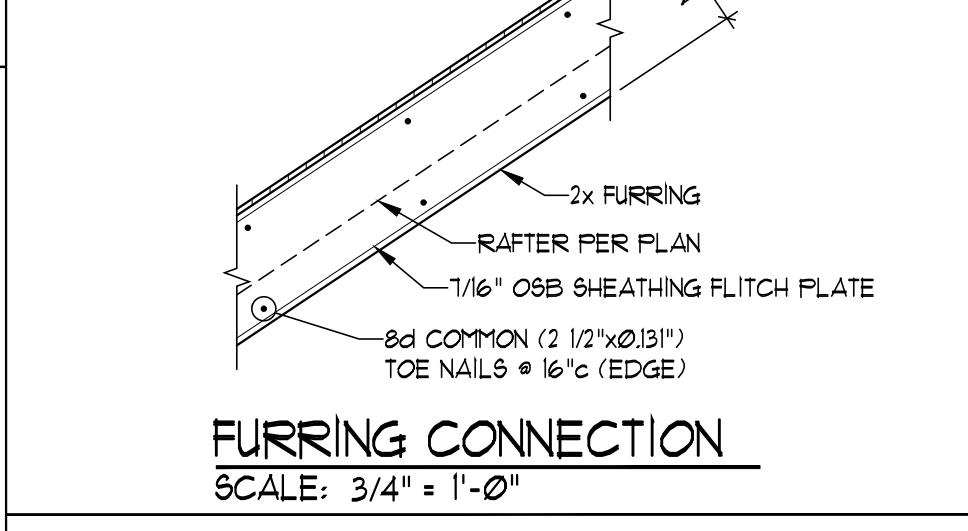


FURRING CONNECTION  
SCALE: 3/4" = 1'-0"

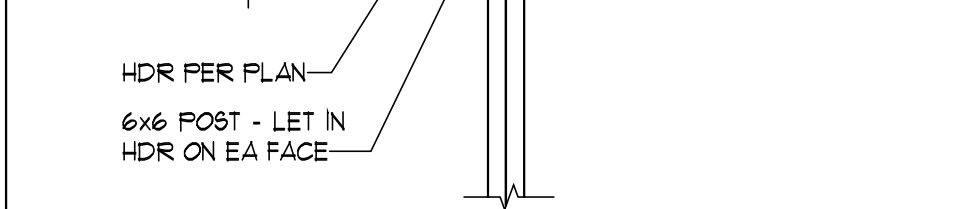

DECK ROOF AND/OR OPEN DECK HDR CONN  
SCALE: 3/4" = 1'-0"

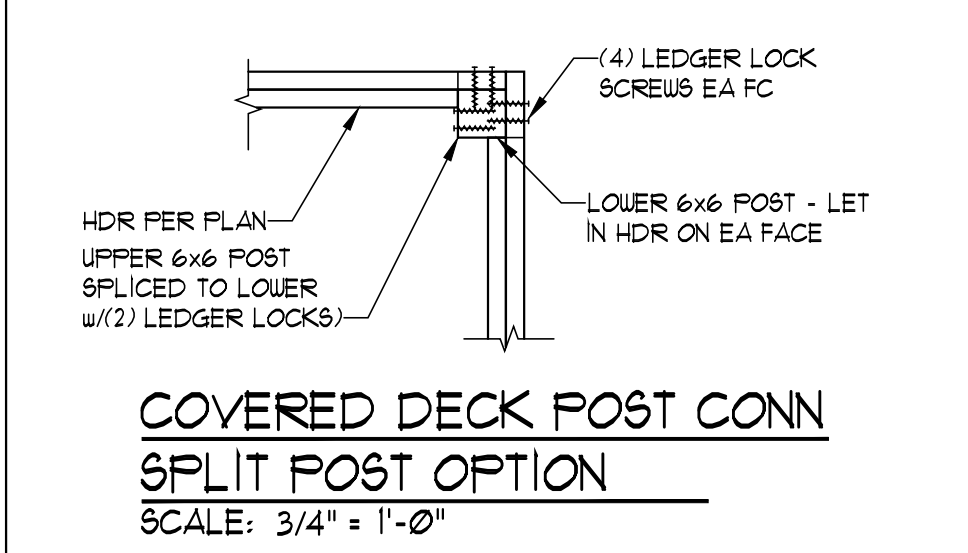

COVERED DECK POST CONN SPLIT POST OPTION  
SCALE: 3/4" = 1'-0"

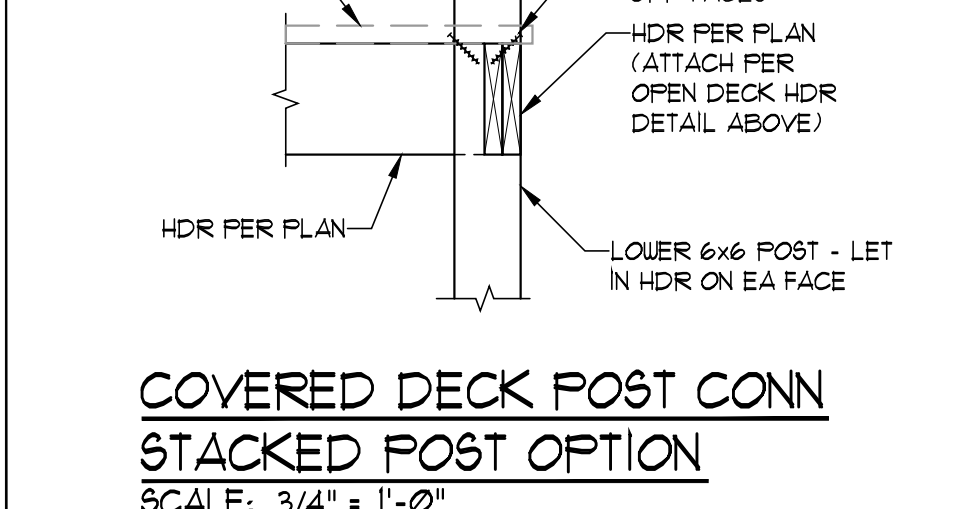

COVERED DECK POST CONN STACKED POST OPTION  
SCALE: 3/4" = 1'-0"

**JFE Construction**  
A JEFFRIES COMPANY  
© COPYRIGHT 2021  
JFE CONSTRUCTION INC.  
1314 SW Market Street  
Lee's Summit, MO 64081  
v: 816.786.4008  
jfeconstruction.com


**Van Deuren & Associates, P.A.**  
1001 KING STREET SUITE 130  
OVERLAND PARK, KS 66210  
(913) 451-6305 FAX (913) 451-1021  
WEB PAGE WWW.VANDEURENASSOCIATES.COM  
E-MAIL: VANDEUREN@VANDEURENASSOCIATES.COM  
Van Deuren and Associates, P.A. © 2021

**STATE OF MISSOURI**  
CHAD M. STREETER  
NUMBER 0000101071  
EXPIRATION DATE 12/31/2024  
4/6/2021

**THE GUNNISON MODERN**  
Doelling Residence  
213 NW Ambersham Dr, Lee's Summit, MO  
Lot 119 - Woodside Ridge Subdivision


Project #: 8083-2108  
DATE: 4/16/2021  
Permit: 4/16/2021

Framing Notes and Details  
**S100**

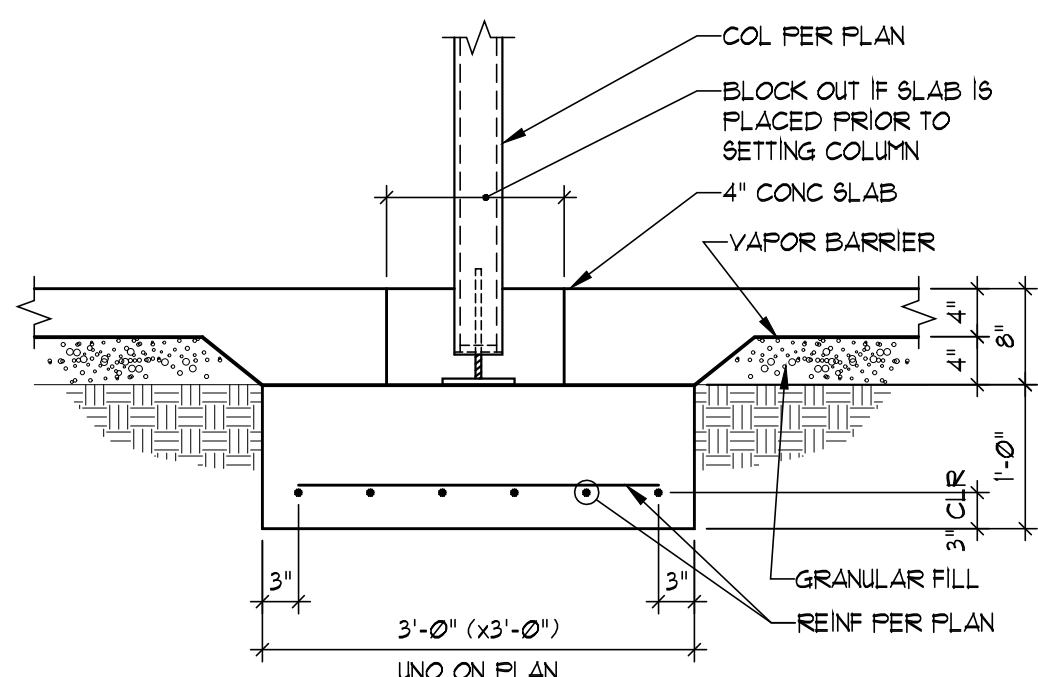


**TYPICAL INTERIOR COLUMN**  
SCALE: 3/4" = 1'-0"


| VERTICAL REINF (#4 BARS - GRADE 40) |     |     |     |     |     |
|-------------------------------------|-----|-----|-----|-----|-----|
| WALL HGT                            | 8"  | 9"  | 8"  | 9"  | 10" |
| REINF SPACING                       | 16" | 12" | 24" | 16" | 12" |

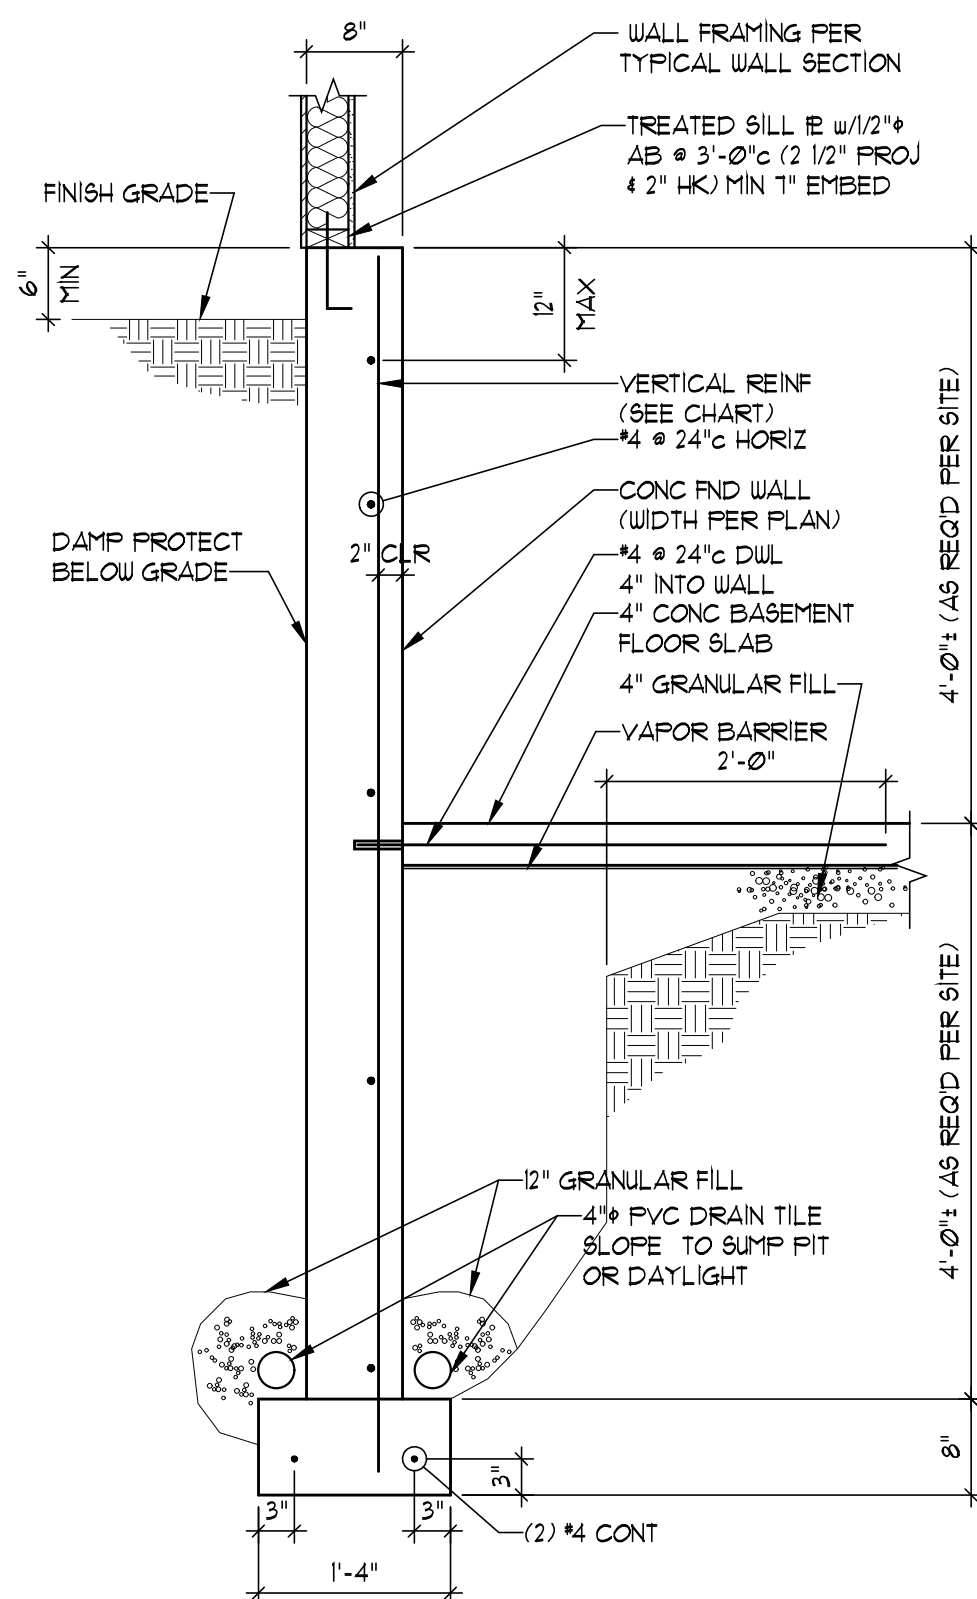

**TYPICAL DAYLIGHT SECTION**  
SCALE: 3/4" = 1'-0"

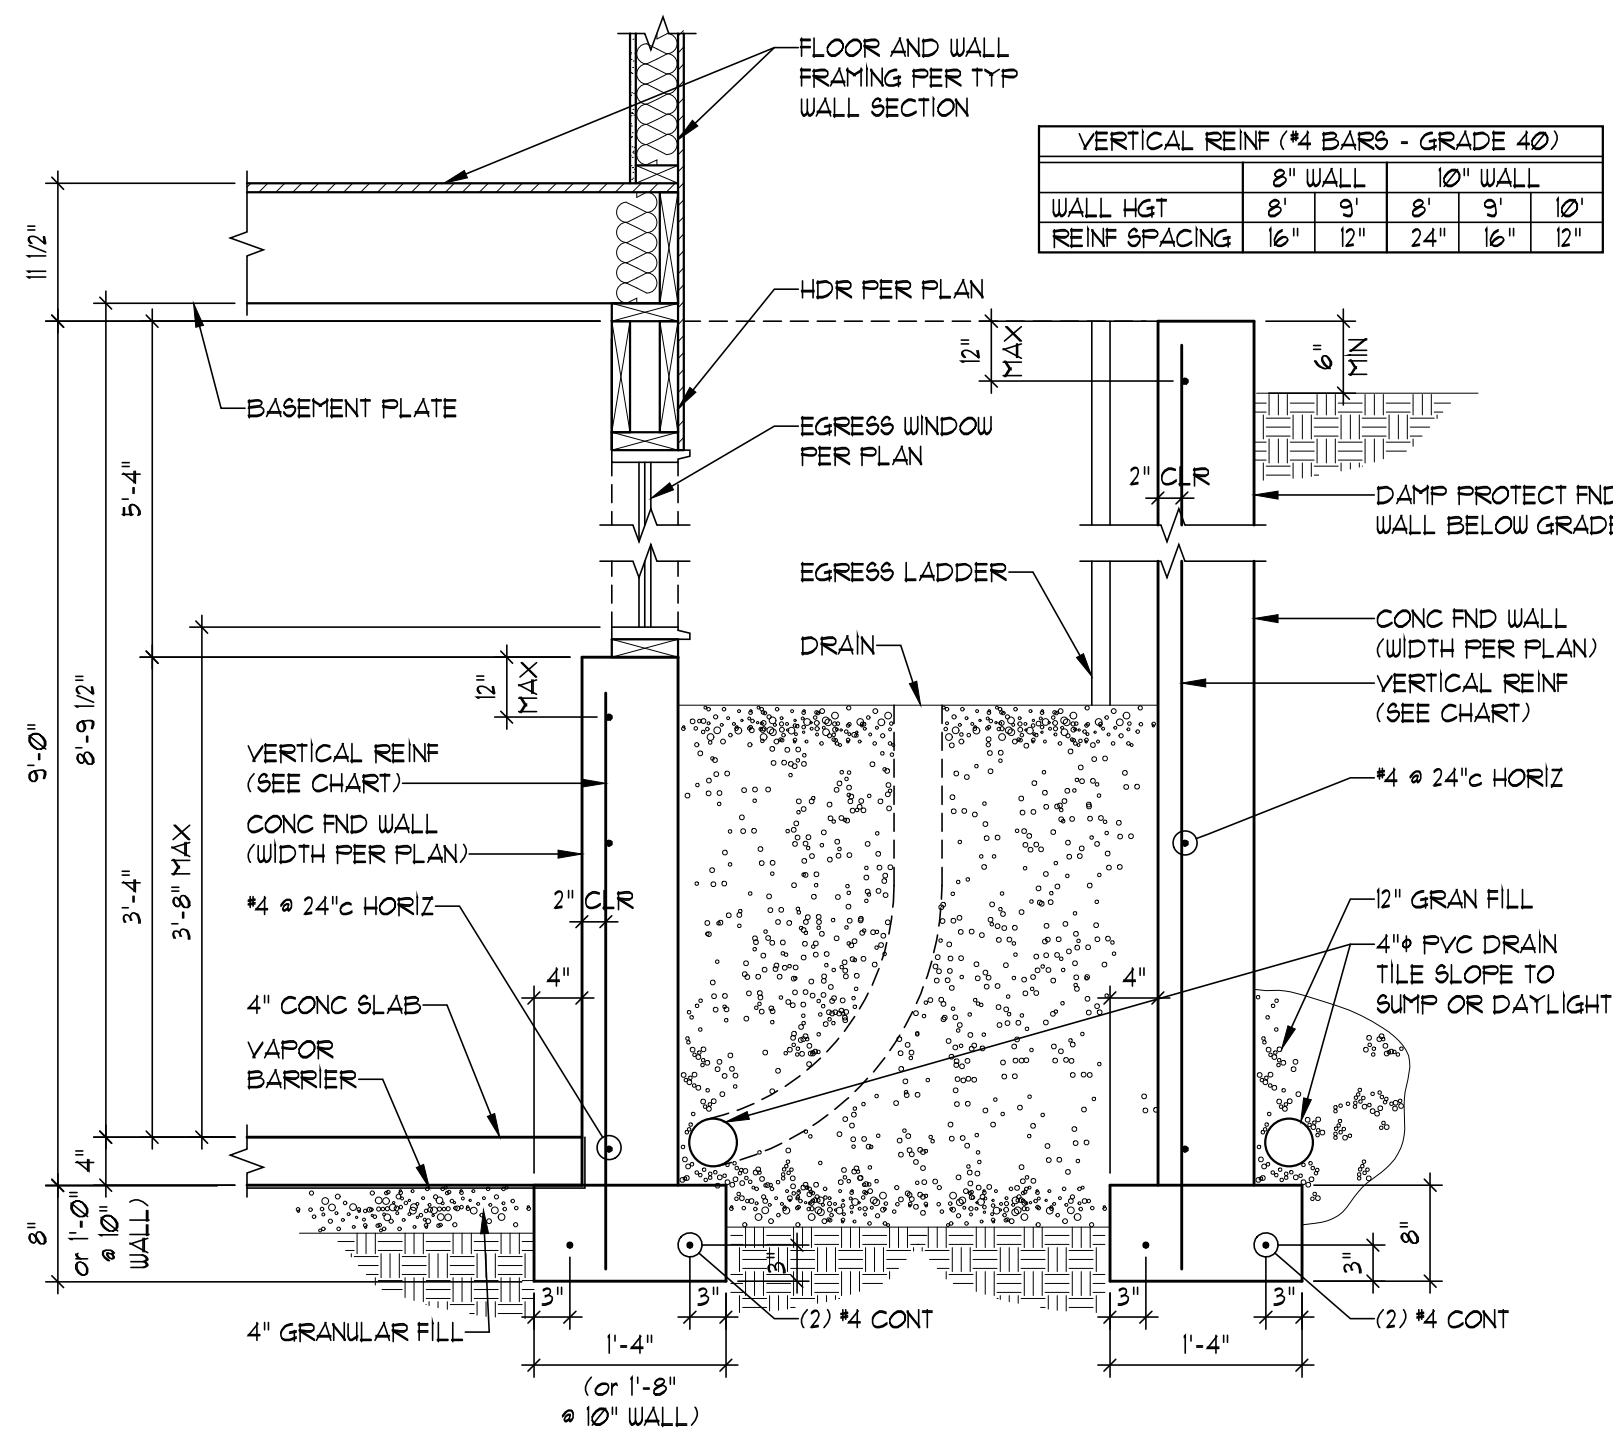


**TYPICAL WINDOW WELL**  
SCALE: 3/4" = 1'-0"

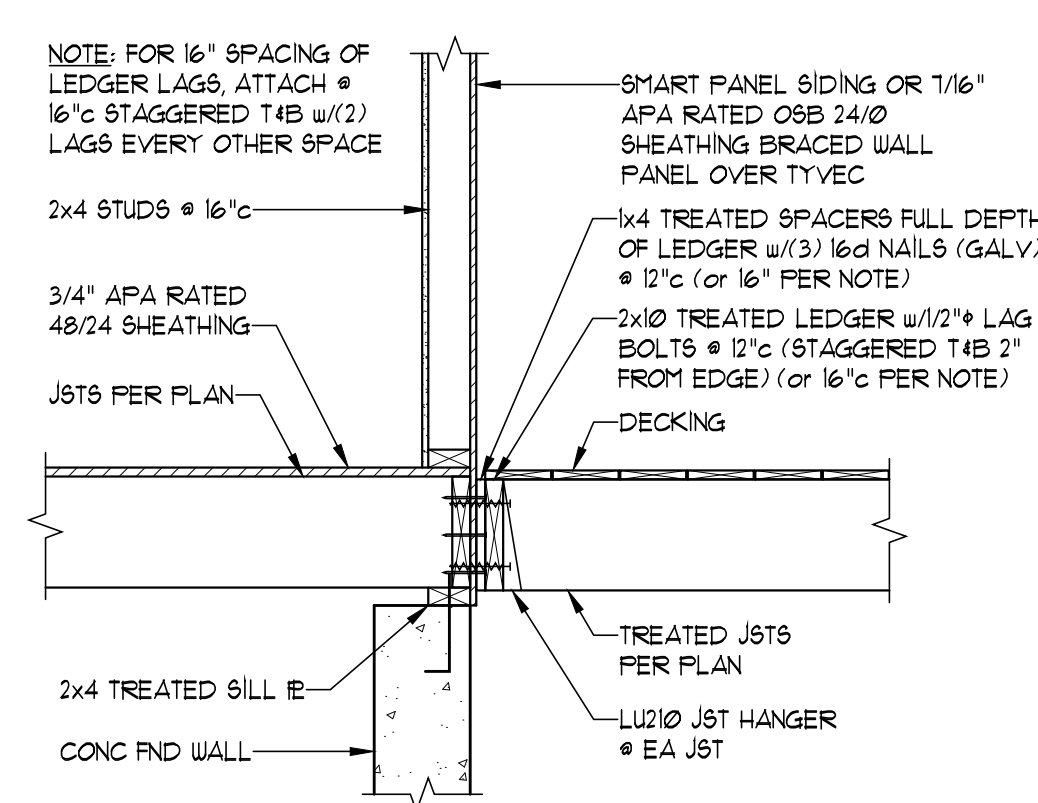


**DECK ATTACHMENT**  
SCALE: 3/4" = 1'-0"


| VERTICAL REINF (#4 BARS - GRADE 40) |     |     |     |     |     |
|-------------------------------------|-----|-----|-----|-----|-----|
| WALL HGT                            | 8"  | 9"  | 8"  | 9"  | 10" |
| REINF SPACING                       | 16" | 12" | 24" | 16" | 12" |

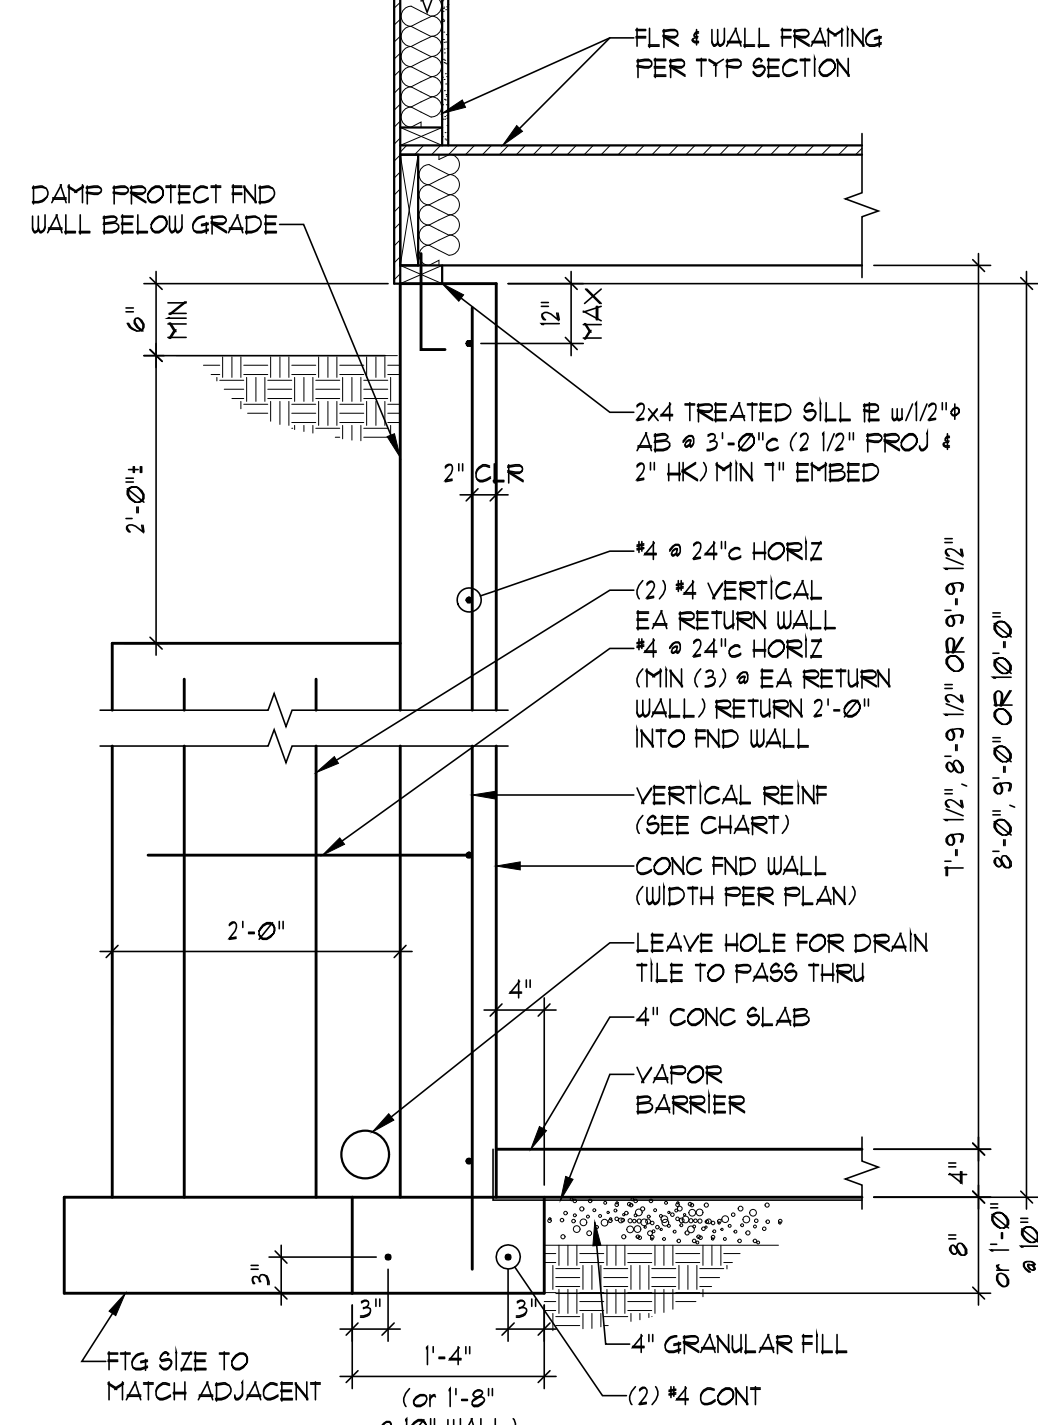


**TYPICAL PILASTER SECTION**  
SCALE: 3/4" = 1'-0"

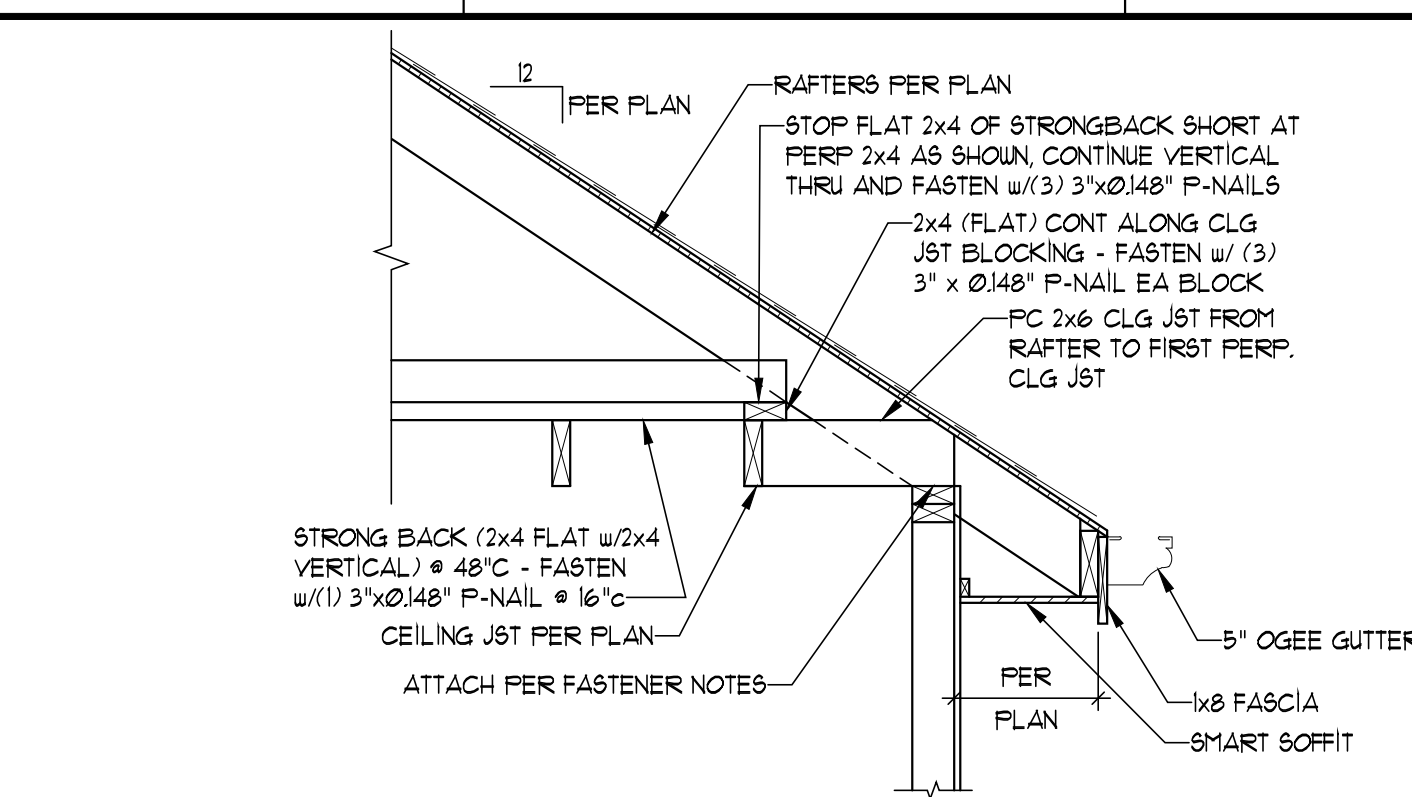


**RAFTER ATTACHMENT AT PERPENDICULAR CONDITIONS**  
SCALE: 3/4" = 1'-0"

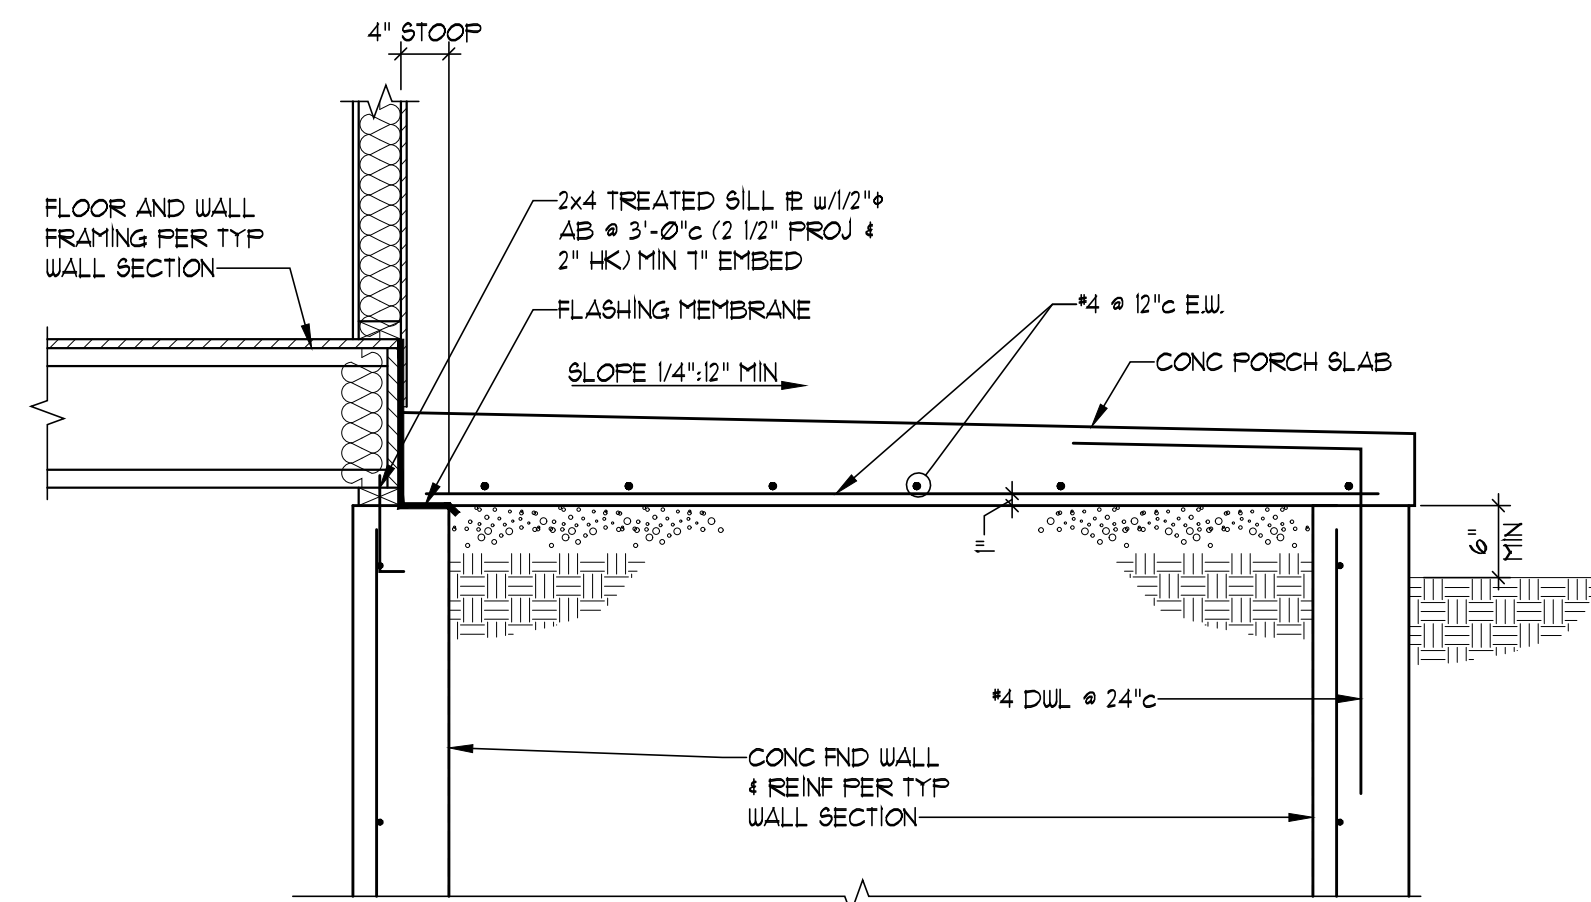


**TYPICAL SECTION THRU PORCH**  
SCALE: 3/4" = 1'-0"

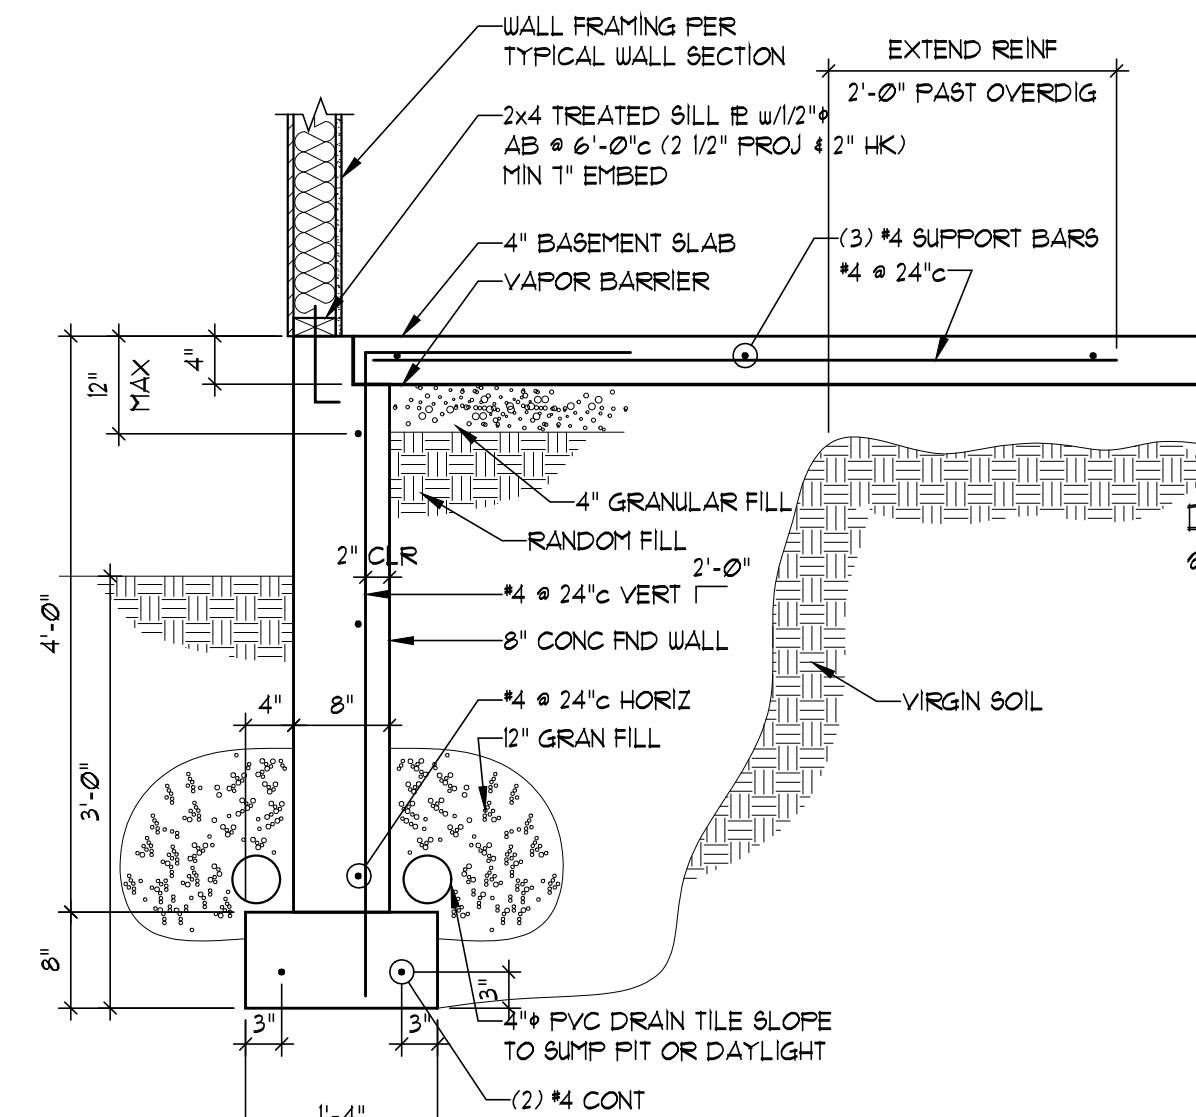


**TYPICAL WALKOUT SECTION**  
SCALE: 3/4" = 1'-0"

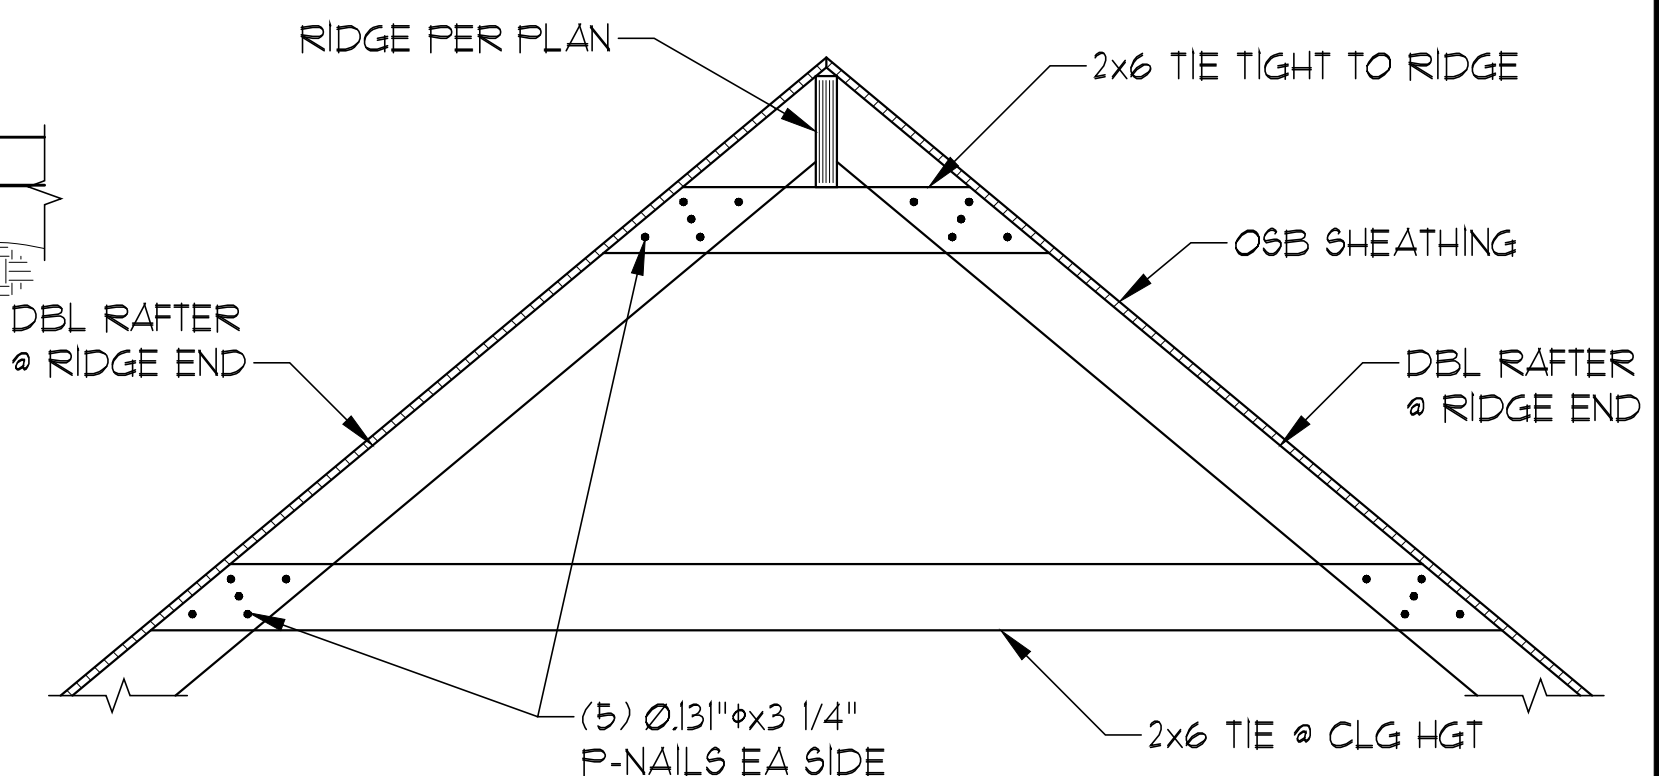


**RIDGE SUPPORT DETAIL**  
SCALE: 1/2" = 1'-0"

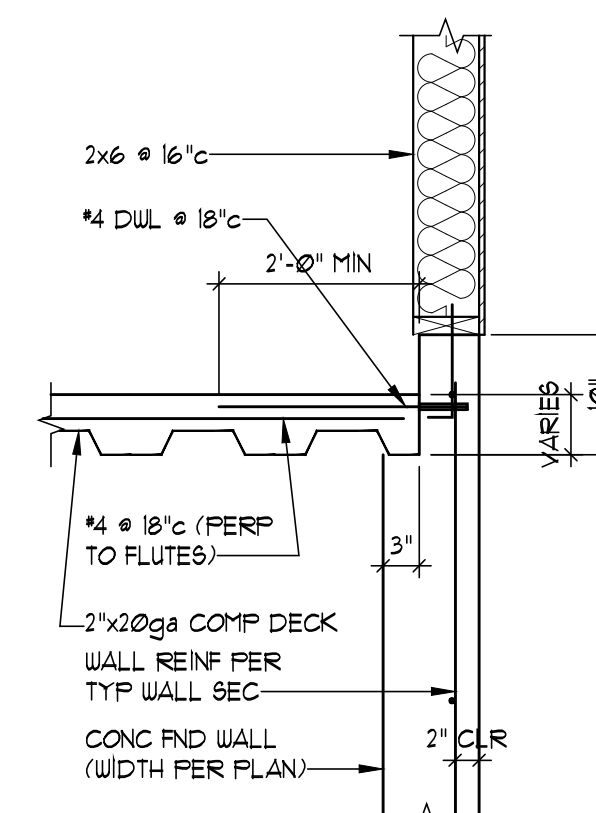


**SECTION THRU GARAGE SLAB WALL**  
SCALE: 3/4" = 1'-0"

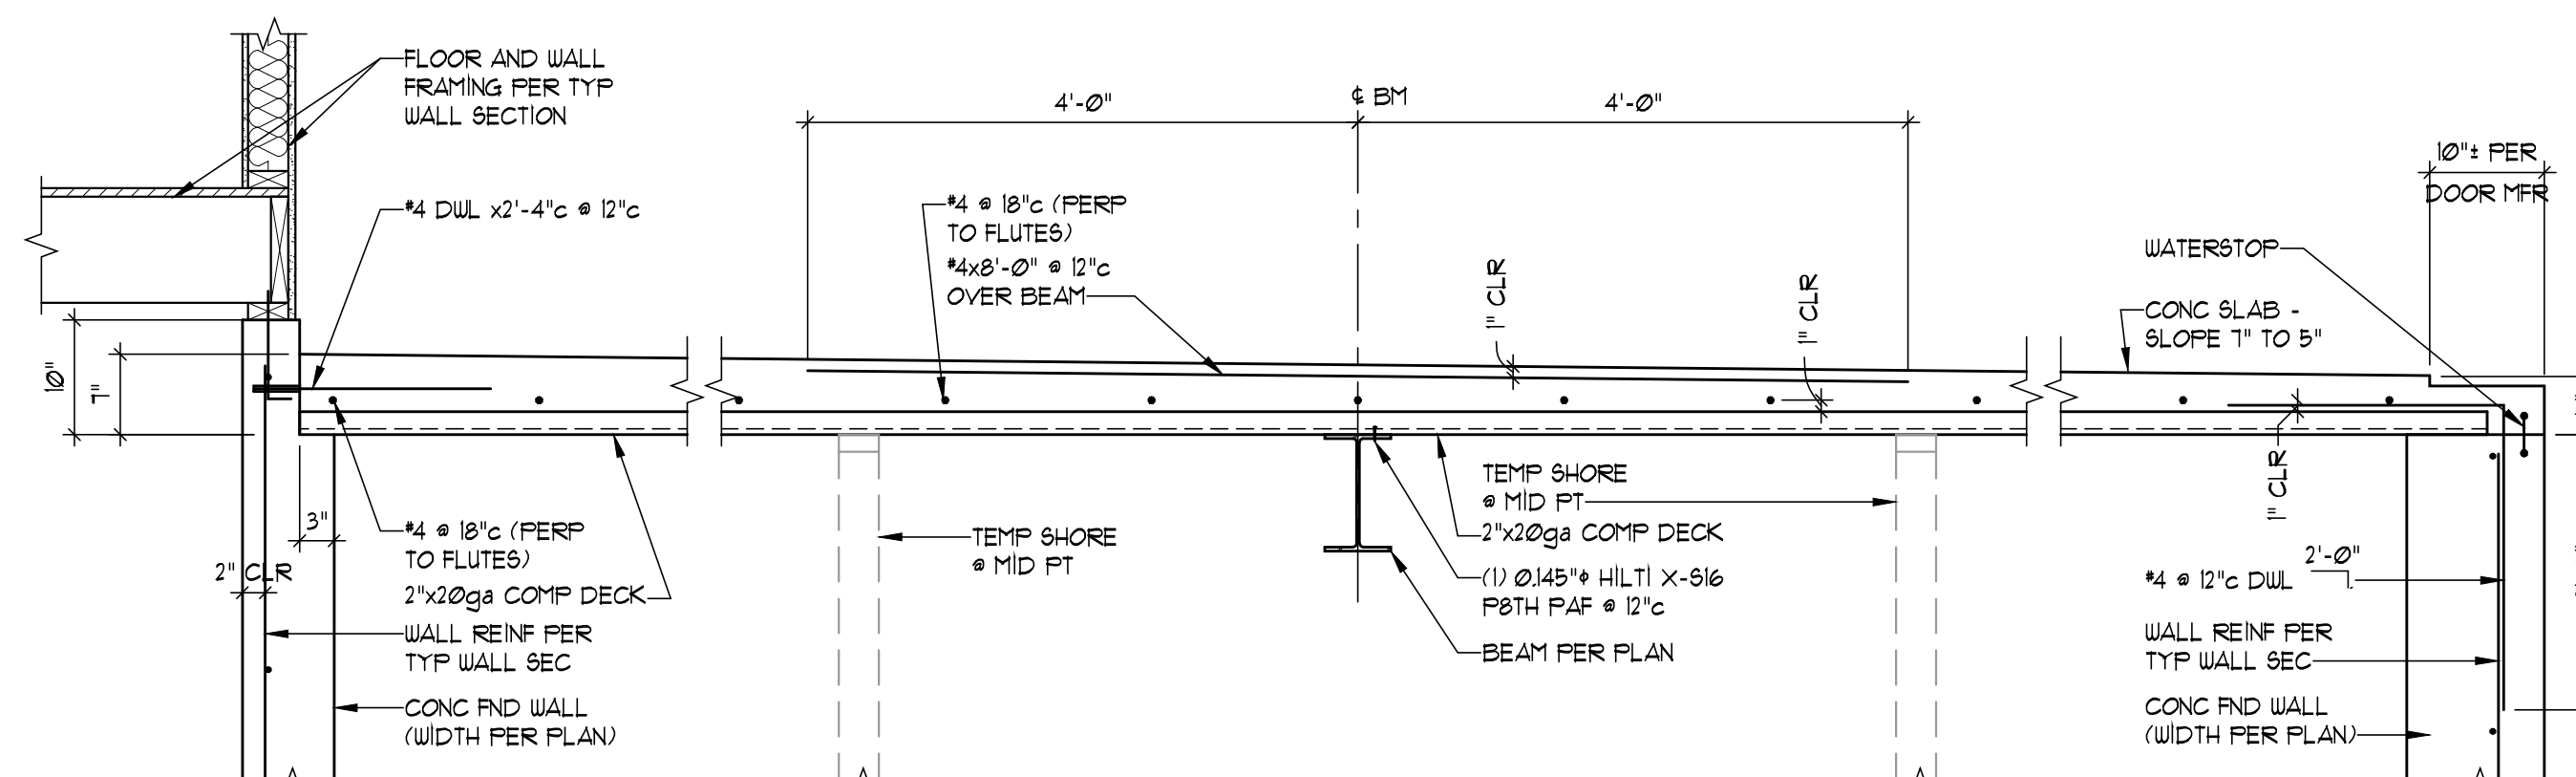

**SUSPENDED GARAGE SLAB DETAIL**  
SCALE: 3/4" = 1'-0"

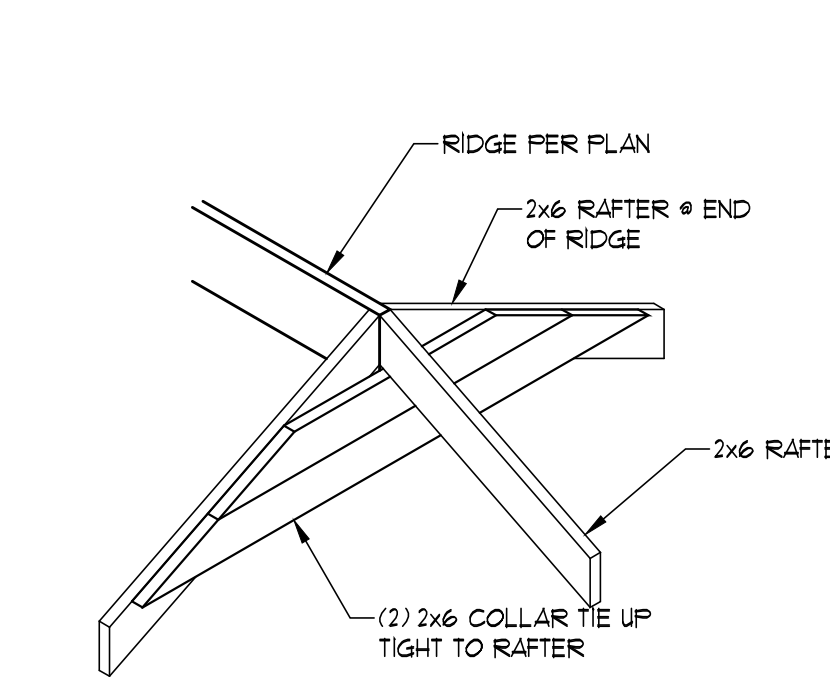

**HIP RIDGE SUPPORT**  
SCALE: 1/2" = 1'-0"

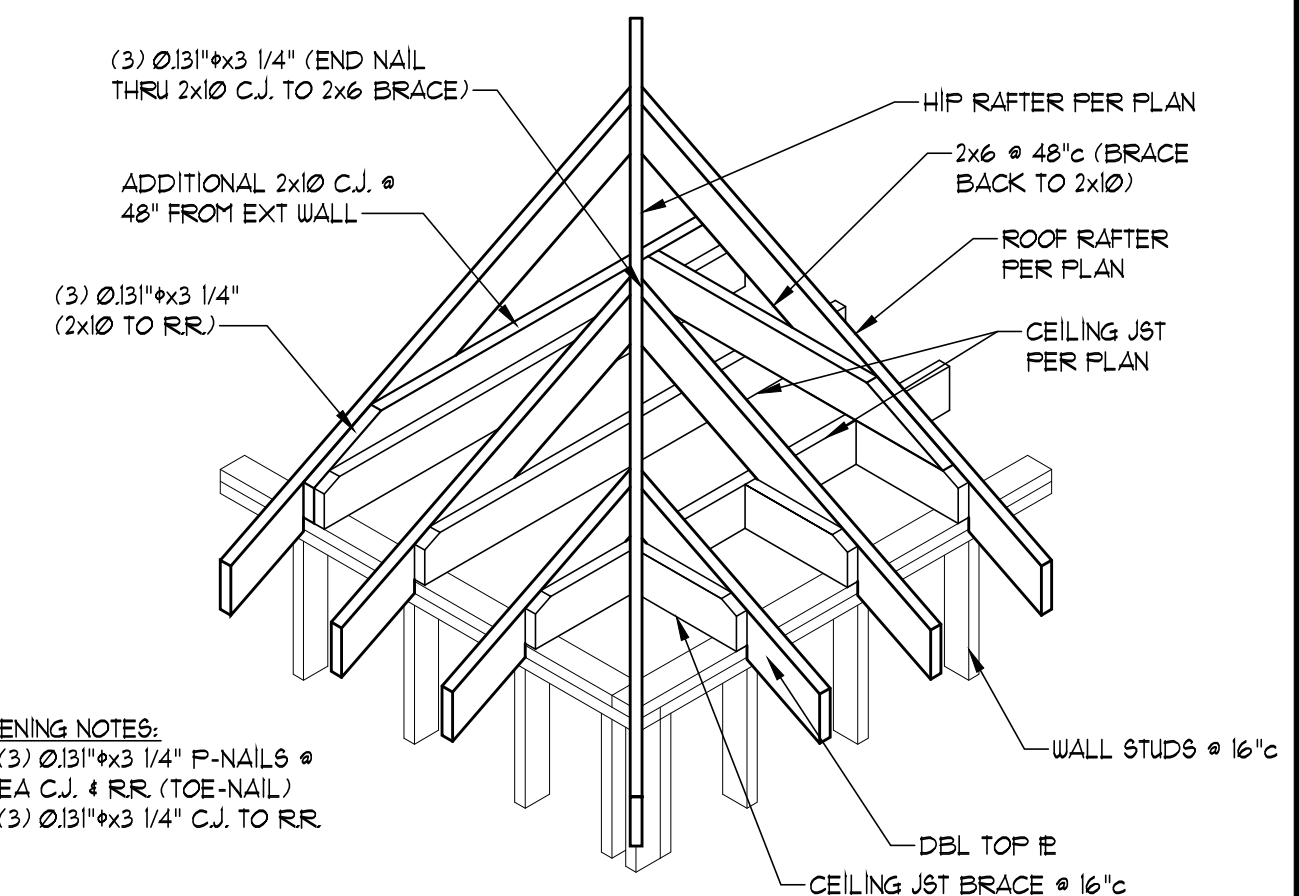

**CEILING JOIST AND ROOF RAFTER CONNECTION @ HIP**  
SCALE: 1/2" = 1'-0"




© COPYRIGHT 2021

JFE CONSTRUCTION INC.  
1314 SW Market Street  
Lee's Summit, MO 64081  
v: 816.786.4008  
jfeconstruction.com

VAN DERZUREN & ASSOCIATES, P.A.  
10211 KING STREET SUITE 130  
OVERLAND PARK, KS 66210  
(913) 451-6305 FAX (913) 451-1021  
WEB PAGE: WWW.VANDERZURENPA.COM  
E-MAIL: VANDERZUREN@VANDERZURENPA.COM

Van Derzuren and Associates, P.A. © 2021

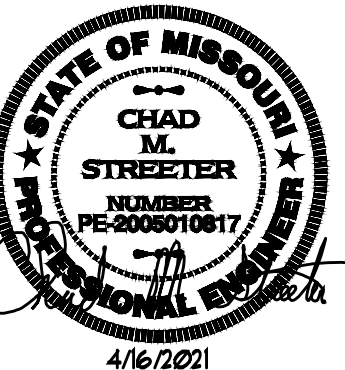

THE GUNNISON MODERN

Doelling Residence  
213 NW Ambersham Dr, Lee's Summit, MO  
Lot 119 - Woodside Ridge Subdivision

Project #: 8083-2108

DATE: 4/16/2021

Permit: 4/16/2021

Framing Notes  
and Details

S101



© COPYRIGHT 2021

JFE CONSTRUCTION INC.  
1314 SW Market Street  
Lee's Summit, MO 64081  
v: 816.786.4008  
jfeconstruction.com

VAN DEURZEN & ASSOCIATES, P.A.  
1011 KING STREET SUITE 120  
OVERLAND PARK, KS 66210  
(913) 451-6305 FAX (913) 451-1021  
WEB PAGE: WWW.VANDEURZENANDASSOCIATES.COM  
E-MAIL: VAND@VANDEURZENANDASSOCIATES.COM

Van Deurzen and Associates, P.A. © 2021



# THE GUNNISON MODERN

Doelling Residence  
213 NW Ambersham Dr, Lee's Summit, MO  
Lot 119 - Woodside Ridge Subdivision


Project #: 8083-2108

DATE:


Permit: 4/16/2021

Framing Notes  
and Details


## S102

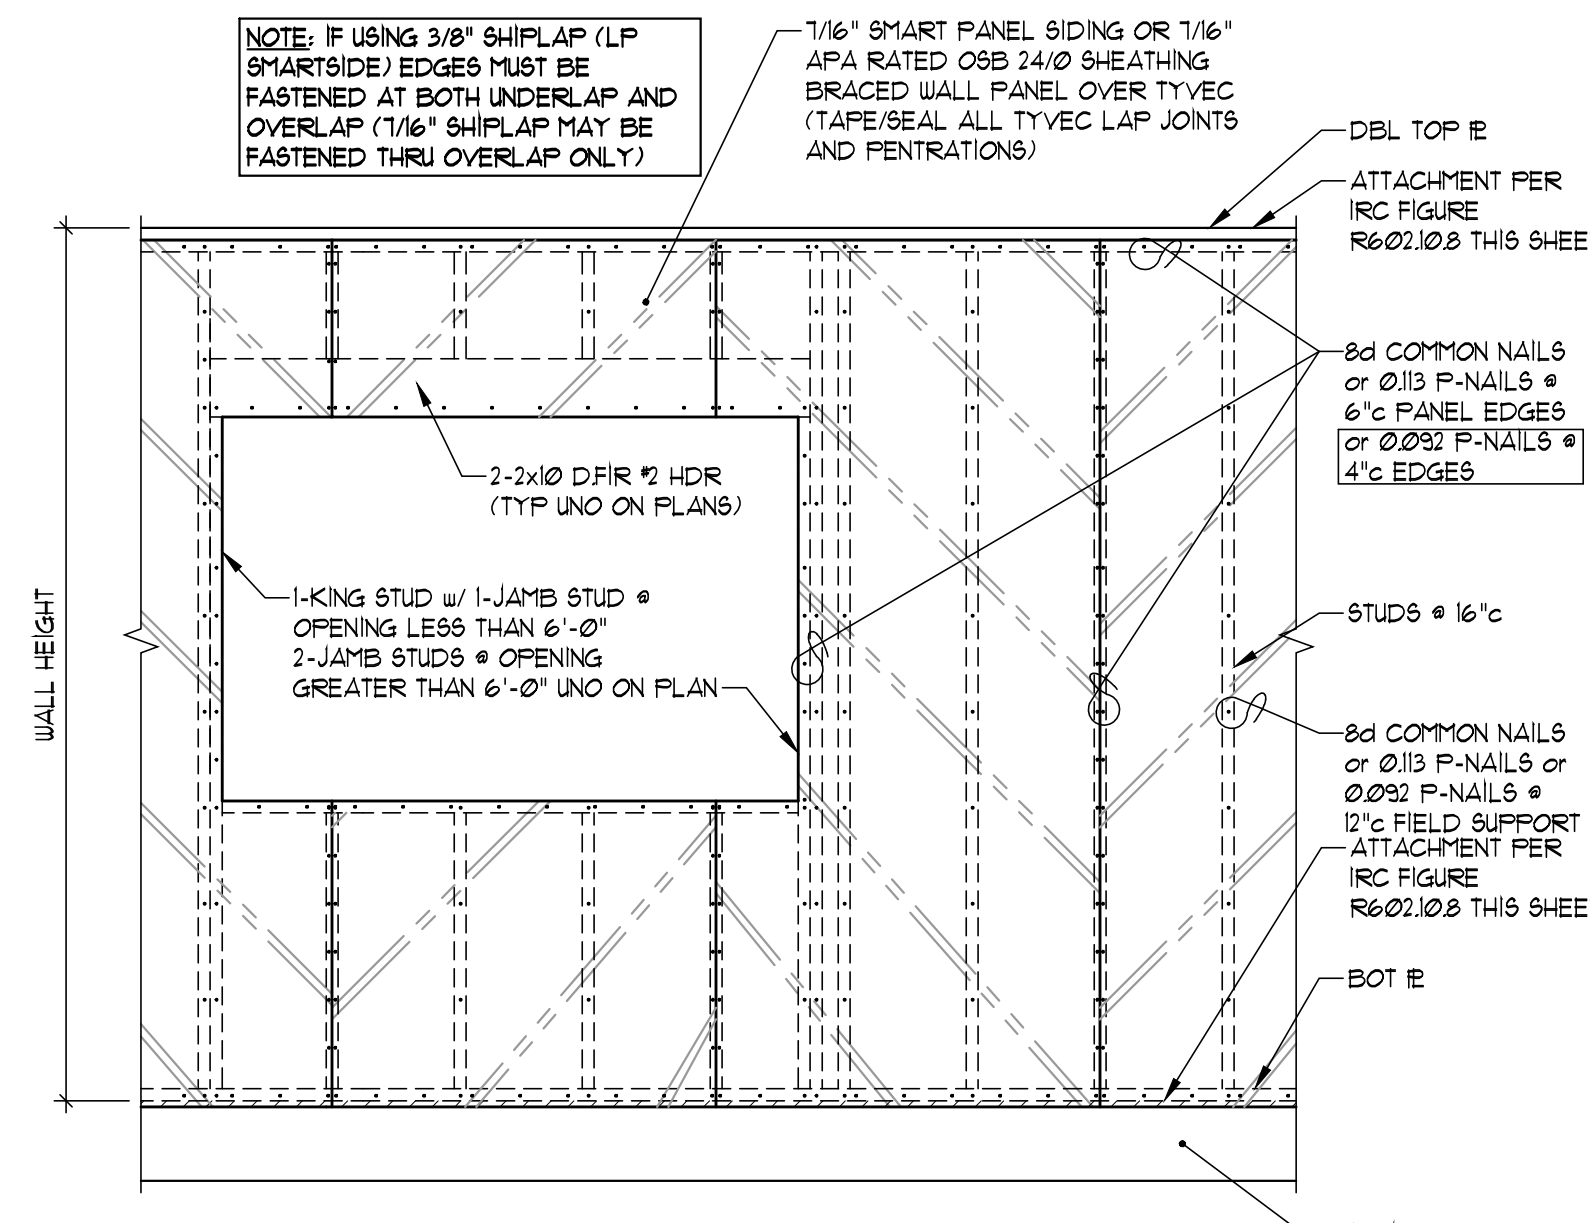

**TYPICAL EXTERIOR SHEATHING  
INSTALLATION (METHOD WSP & CS-WSP)**  
SCALE: 1/2" = 1'-0"

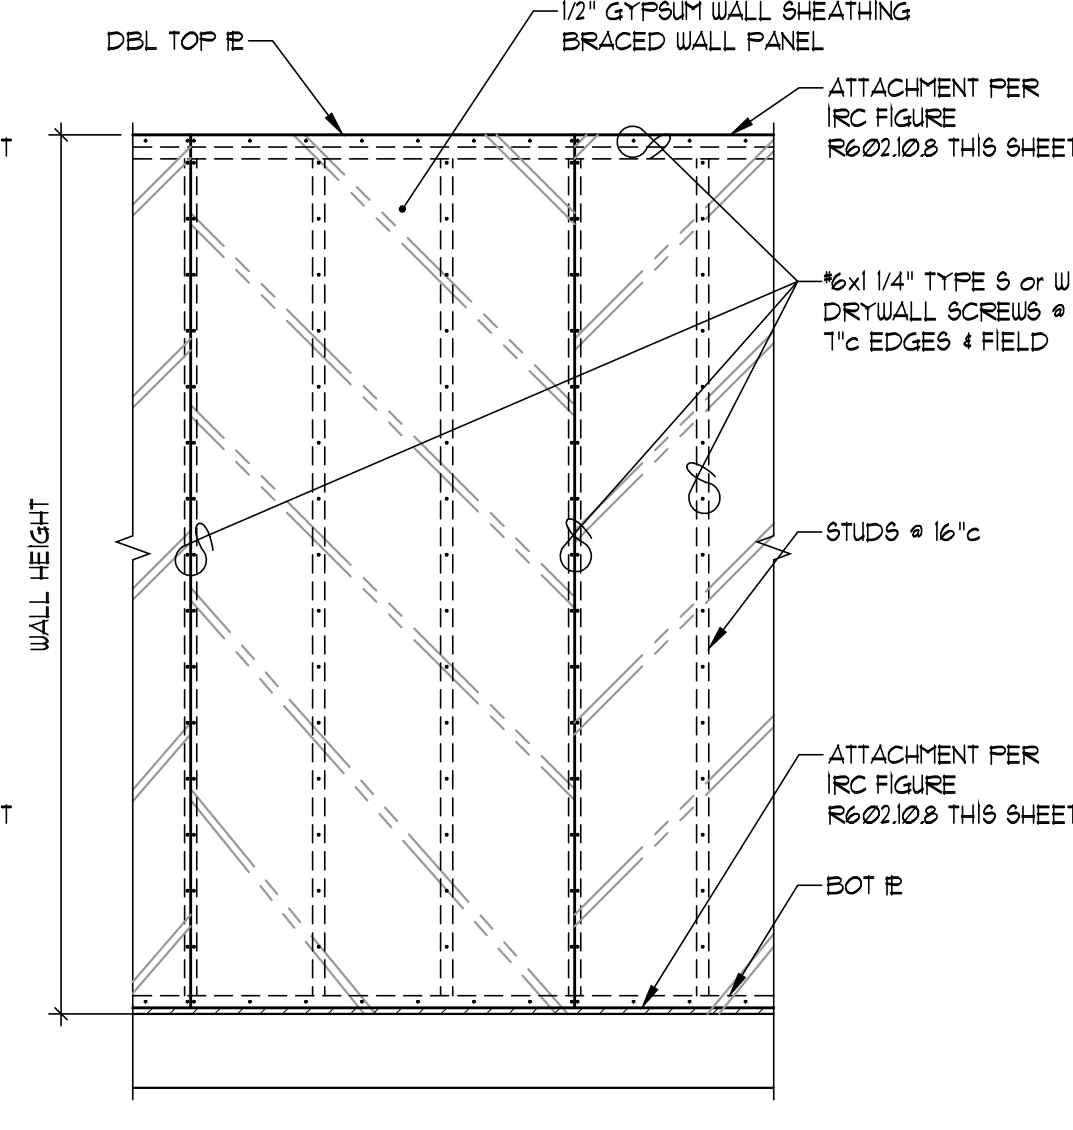


**TYPICAL INTERIOR SHEATHING  
INSTALLATION (METHOD GB)**  
SCALE: 1/2" = 1'-0"

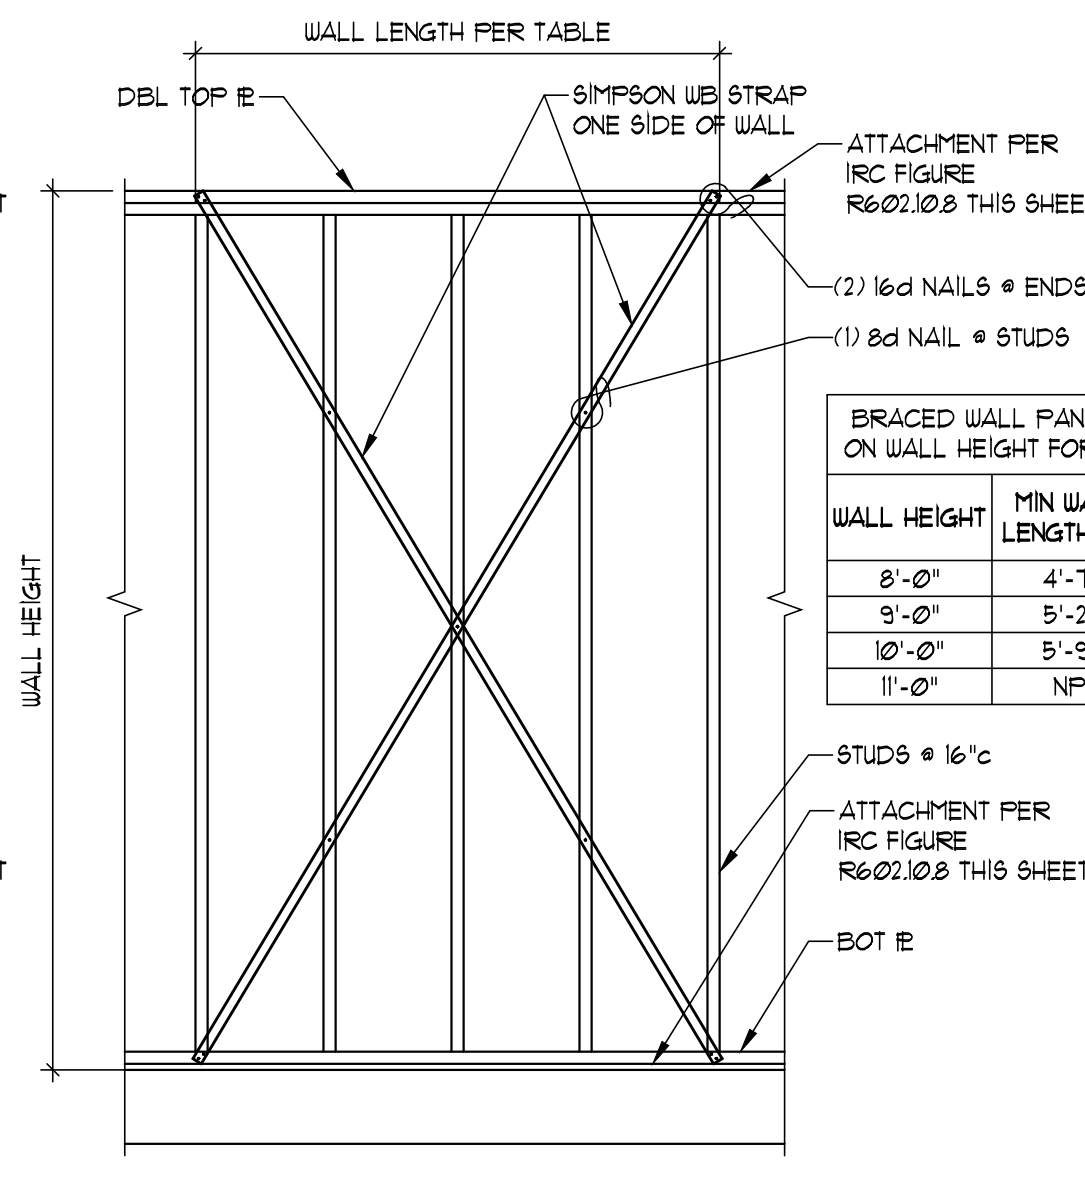


**INTERIOR SHEATHING  
INSTALLATION (METHOD LIB)**  
SCALE: 1/2" = 1'-0"


| BRACED WALL PANEL LENGTHS BASED<br>ON WALL HEIGHT FOR 2012 IRC, TYPE IIB |                        |                        |
|--------------------------------------------------------------------------|------------------------|------------------------|
| WALL HEIGHT                                                              | MIN WALL<br>LENGTH (X) | MAX WALL<br>LENGTH (X) |
| 8'-0"                                                                    | 4'-1"                  | 8'-0"                  |
| 9'-0"                                                                    | 5'-2"                  | 9'-0"                  |
| 10'-0"                                                                   | 5'-9"                  | 10'-0"                 |
| 11'-0"                                                                   | NP                     | NP                     |

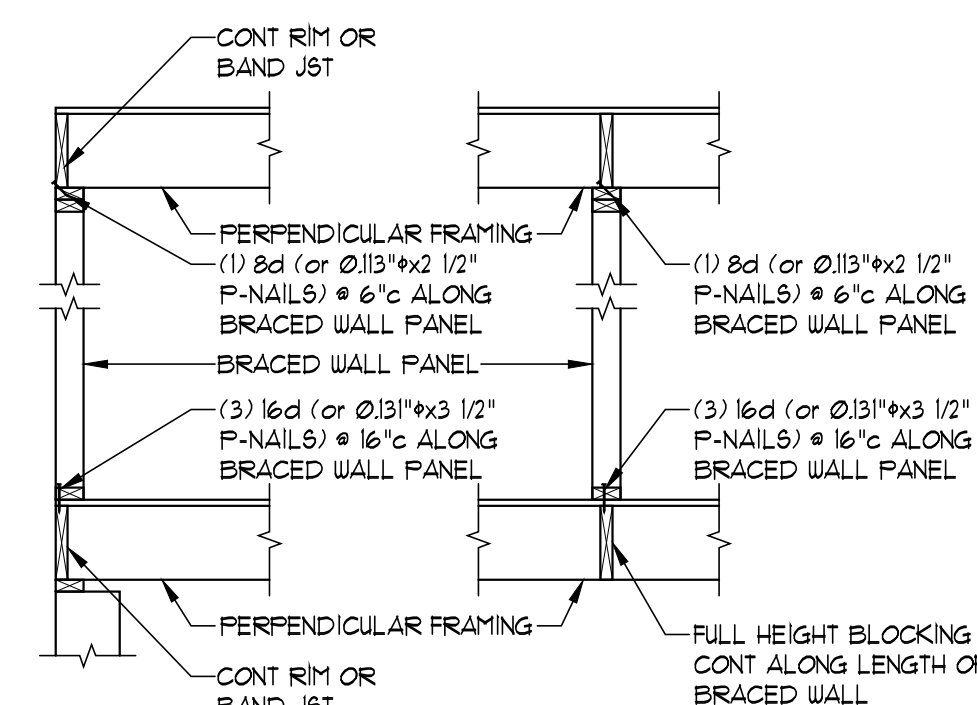

**IRC FIGURE R602.10.8(1)  
BRACED WALL PANEL CONNECTION WHEN  
PERPENDICULAR TO FLOOR/CEILING FRAMING**

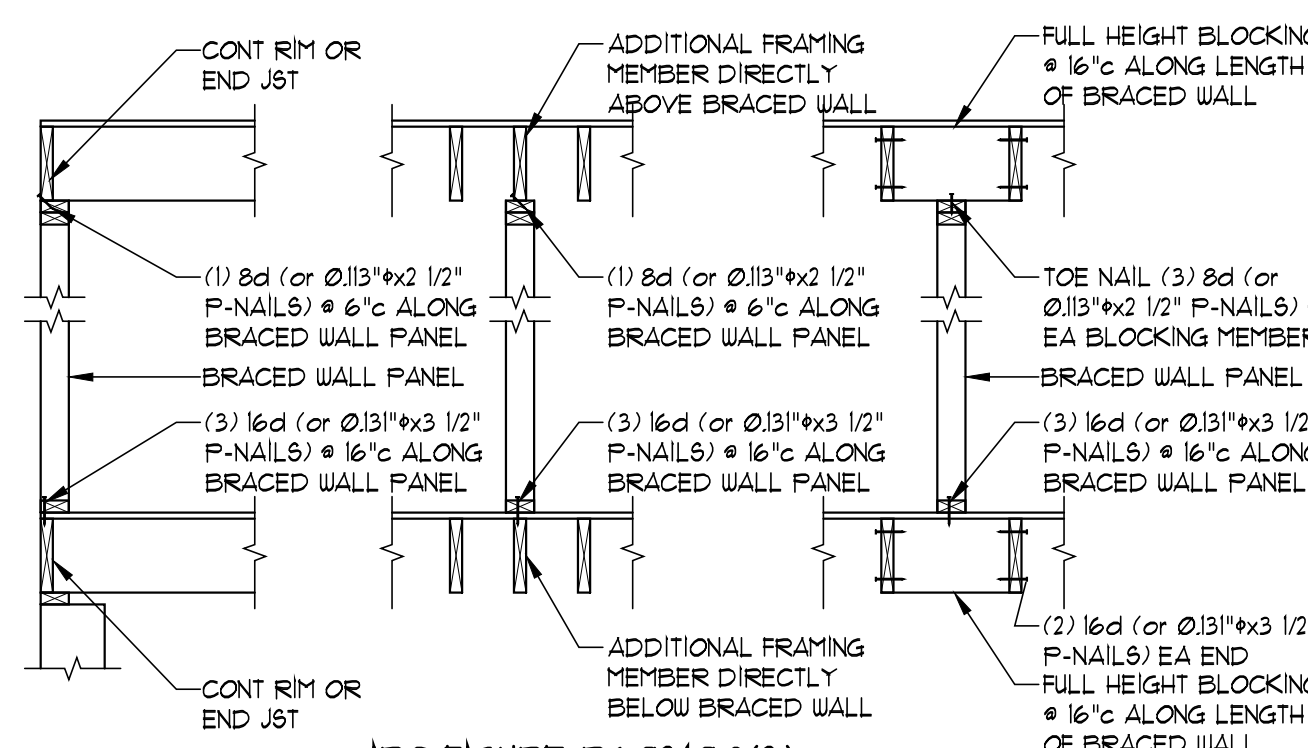


**IRC FIGURE R602.10.8(2)  
BRACED WALL PANEL CONNECTION WHEN  
PARALLEL TO FLOOR/CEILING FRAMING**

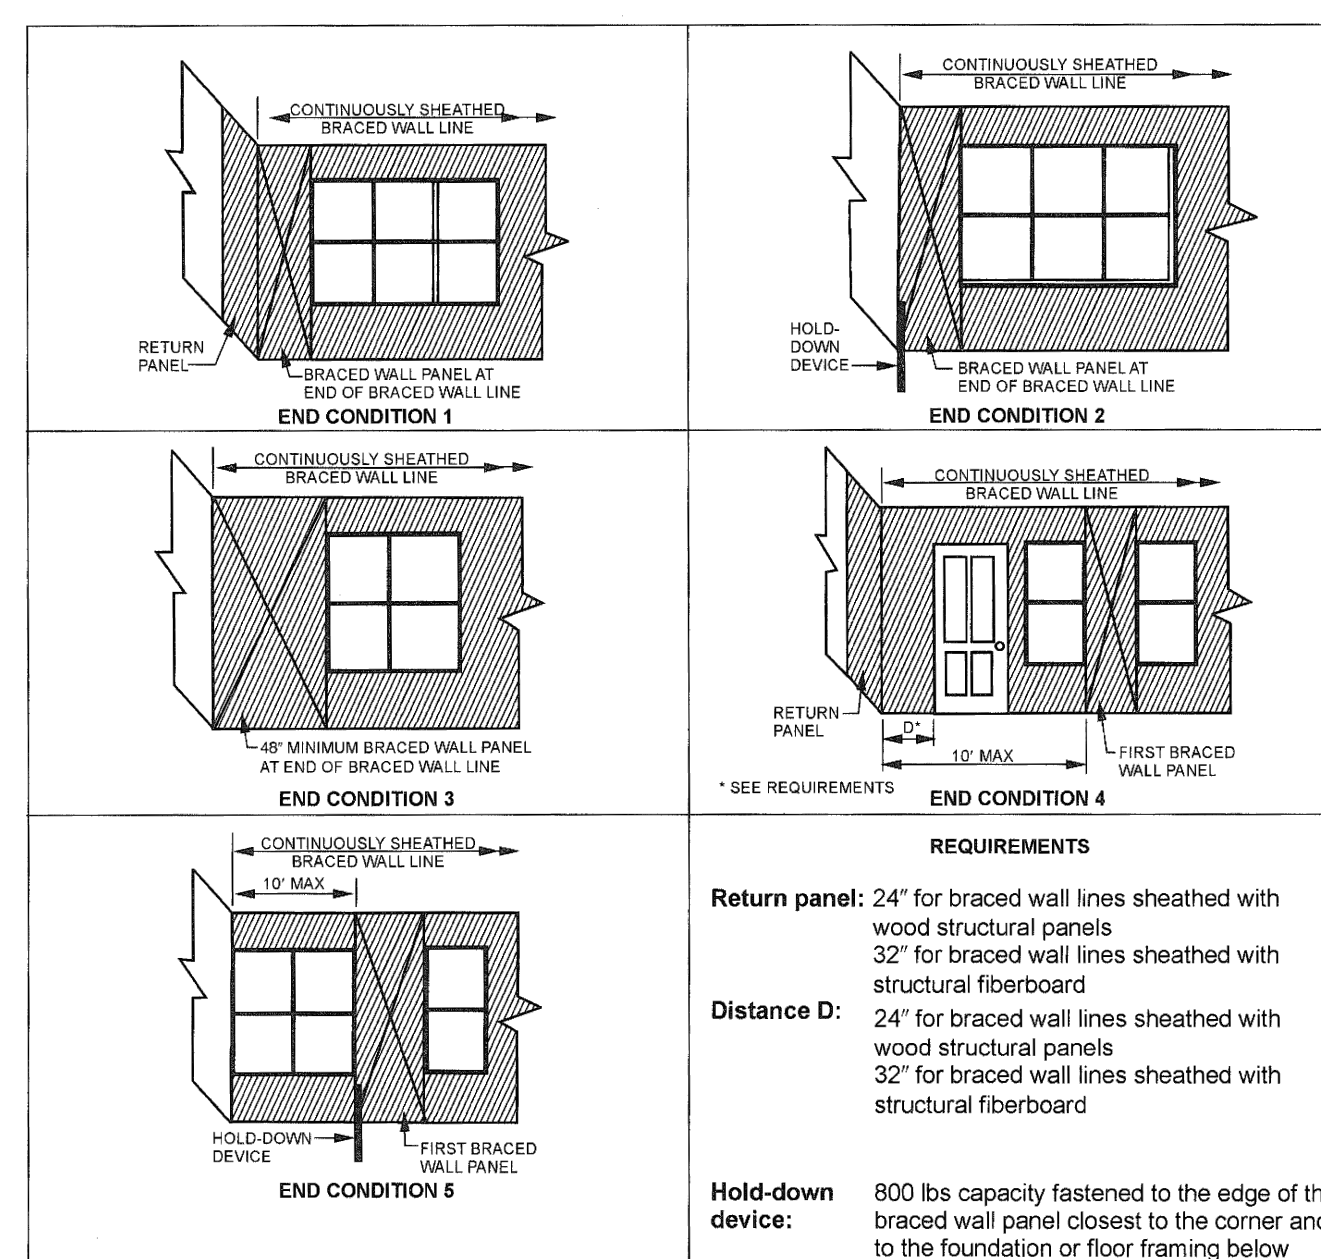


**FIGURE R602.10.7  
END CONDITIONS FOR BRACED WALL LINES WITH CONTINUOUS SHEATHING**

| TABLE 602.10.6.4<br>TENSION STRAP CAPACITY REQUIRE FOR RESISTING WIND PRESSURES<br>PERPENDICULAR TO METHOD PFH, FFG, AND CS-PF BRACED WALL PANELS |                                           |                                           |                                       |                                                                     |            |
|---------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------|-------------------------------------------|---------------------------------------|---------------------------------------------------------------------|------------|
| MINIMUM WALL<br>STUD FRAMING<br>NOMINAL SIZE<br>AND GAGE                                                                                          | MAXIMUM<br>POINT WALL<br>HEIGHT<br>(FEET) | MAXIMUM<br>TOTAL WALL<br>HEIGHT<br>(FEET) | MAXIMUM<br>OPENING<br>WIDTH<br>(FEET) | TENSION STRAP CAPACITY<br>REQUIRED (LBS) FOR V <sub>h</sub> = 15mph |            |
|                                                                                                                                                   |                                           |                                           |                                       | EXPOSURE B                                                          | EXPOSURE C |
| 2x4 #2 GRADE                                                                                                                                      | 0                                         | 10                                        | 10                                    | 1000                                                                | 1000       |
|                                                                                                                                                   | 1                                         | 10                                        | 9                                     | 1000                                                                | 1000       |
|                                                                                                                                                   |                                           |                                           | 16                                    | 1025                                                                | 2500       |
|                                                                                                                                                   |                                           |                                           | 10                                    | 1215                                                                | 2850       |
|                                                                                                                                                   |                                           |                                           | 9                                     | 1000                                                                | 1815       |
|                                                                                                                                                   |                                           |                                           | 16                                    | 2175                                                                | 4125       |
|                                                                                                                                                   |                                           |                                           | 10                                    | 2500                                                                | DESIGN     |
|                                                                                                                                                   |                                           |                                           | 9                                     | 1500                                                                | 3175       |
|                                                                                                                                                   | 2                                         | 12                                        | 16                                    | 3375                                                                | DESIGN     |
|                                                                                                                                                   |                                           |                                           | 10                                    | 3975                                                                | DESIGN     |
| 2x6 STUD GRADE                                                                                                                                    |                                           |                                           | 9                                     | 2150                                                                | DESIGN     |
|                                                                                                                                                   |                                           |                                           | 12                                    | 3175                                                                | DESIGN     |
|                                                                                                                                                   |                                           |                                           | 9                                     | 1000                                                                | 2025       |
|                                                                                                                                                   | 2                                         | 12                                        | 16                                    | 2150                                                                | 3675       |
|                                                                                                                                                   |                                           |                                           | 10                                    | 2950                                                                | DESIGN     |
|                                                                                                                                                   |                                           |                                           | 9                                     | 1750                                                                | 3125       |
|                                                                                                                                                   |                                           |                                           | 16                                    | 3400                                                                | DESIGN     |
|                                                                                                                                                   |                                           |                                           | 10                                    | 3800                                                                | DESIGN     |

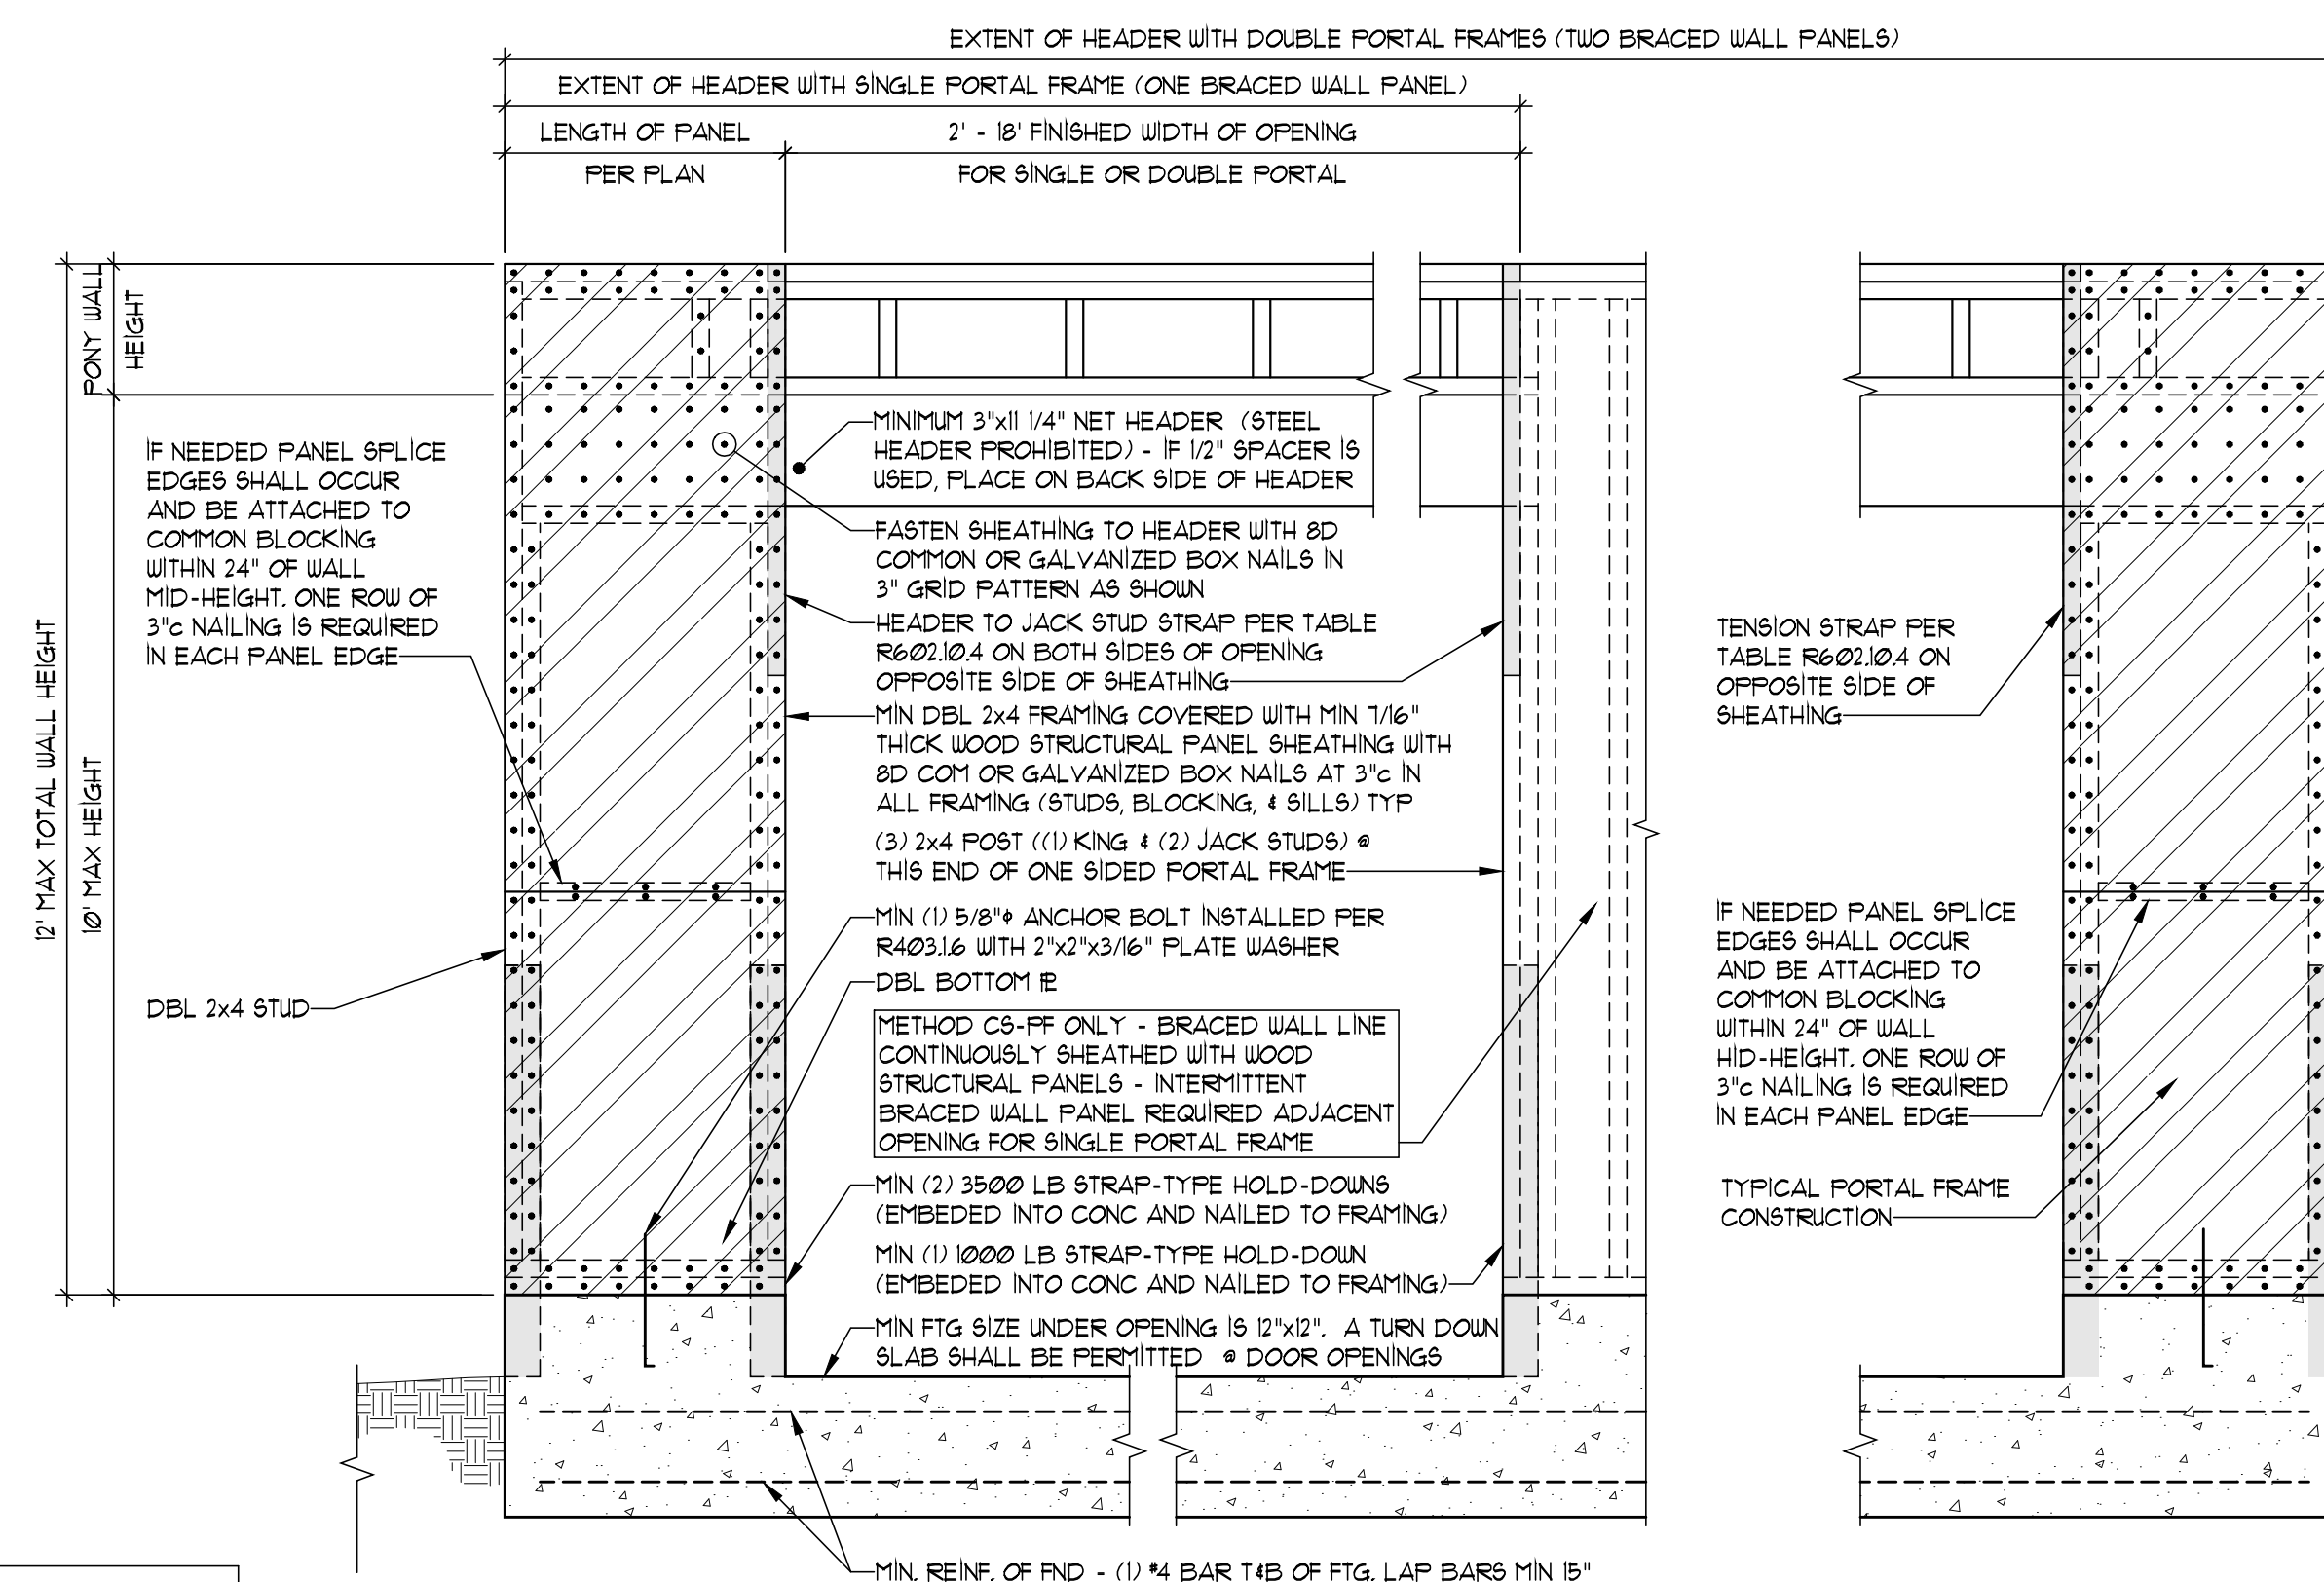


**BRACED WALL METHOD "PFH" (also HEADER ATTACHMENT FOR CS-PF)**  
SCALE: 3/4" = 1'-0"

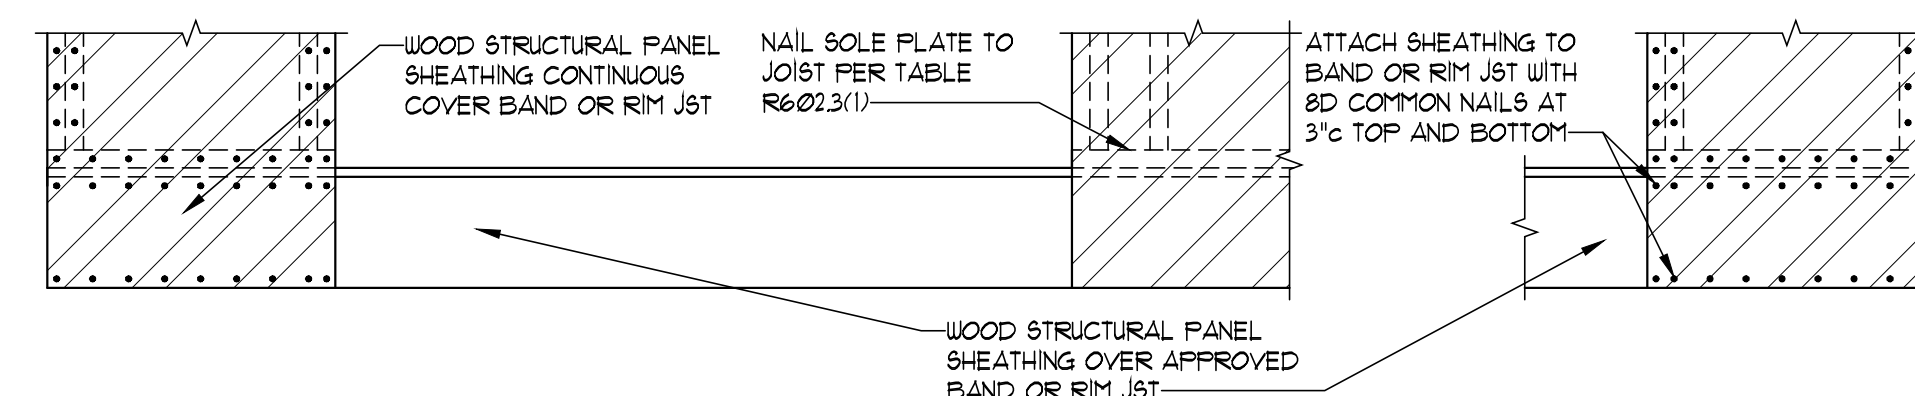

**BRACED WALL METHOD "CS-PF" (ATTACHMENT TO WOOD FLOOR)**  
(REFER TO BRACED WALL METHOD "PFH" FOR HEADER ATTACH)  
SCALE: 3/4" = 1'-0"

SECTION

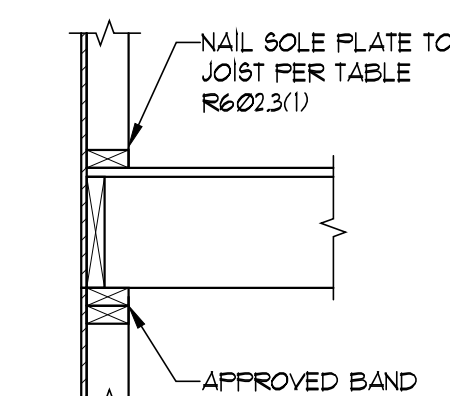

SECTION

