



MiTek USA, Inc.

16023 Swingley Ridge Rd
Chesterfield, MO 63017
314-434-1200

Re: 2742340
Roeser/1487 Winterset

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Valley Center).

Pages or sheets covered by this seal: I45732318 thru I45732449

My license renewal date for the state of Missouri is December 31, 2021.

Missouri COA: Engineering 001193



April 20, 2021

Johnson, Andrew ,Engineer

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job 2742340	Truss A1	Truss Type Hip Girder	Qty 1	Ply 1	Roeser/1487 Winterset	145732318
----------------	-------------	--------------------------	----------	----------	-----------------------	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:38:55 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-914wbWtXJhFK74zrgSZlhw44cSAK1NAPku1jnwzP4g_



Scale = 1:25.4

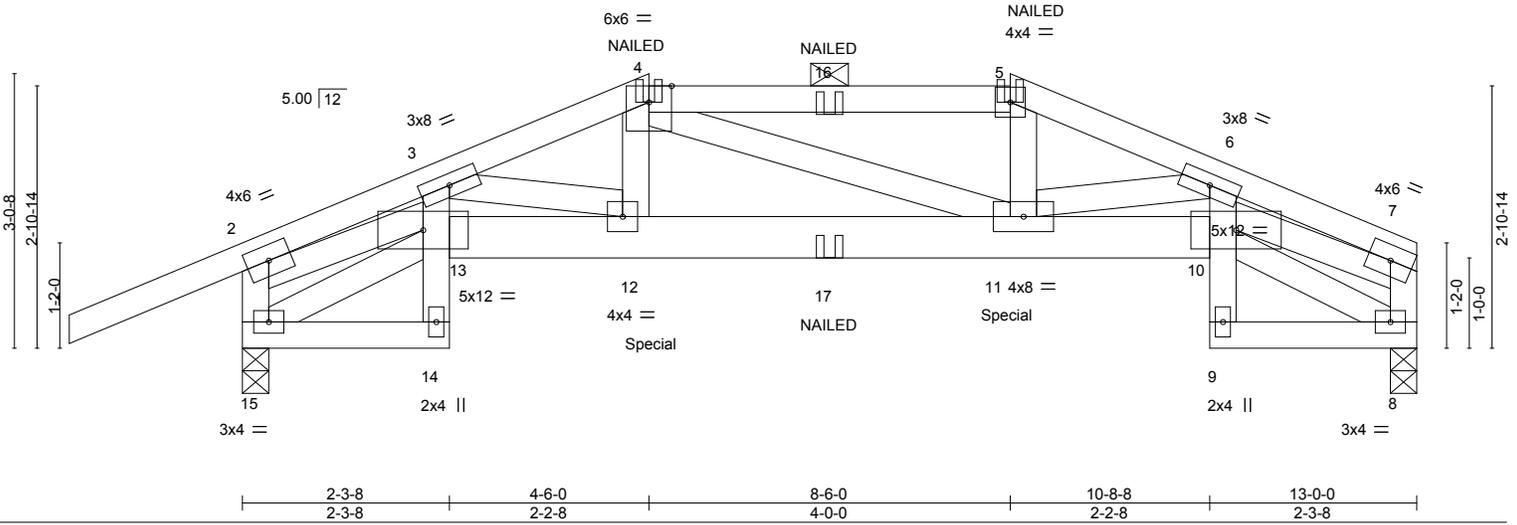

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.43	Vert(LL)	-0.06 11-12	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.48	Vert(CT)	-0.11 11-12	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.43	Horz(CT)	0.10 8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					Weight: 65 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except*
 10-13: 2x6 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-10-15 oc purlins, except end verticals, and 2-0-0 oc purlins (3-11-0 max.): 4-5.
 BOT CHORD Rigid ceiling directly applied or 9-7-14 oc bracing.

REACTIONS. (size) 15=0-3-8, 8=0-3-8
 Max Horz 15=44(LC 7)
 Max Uplift 15=-281(LC 8), 8=-234(LC 9)
 Max Grav 15=1031(LC 1), 8=854(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1899/563, 3-4=-1980/614, 4-5=-1842/582, 5-6=-1954/600, 6-7=-2036/591,
 2-15=-906/273, 7-8=-759/225
 BOT CHORD 12-13=-563/1907, 11-12=-542/1804, 10-11=-585/2019
 WEBS 4-12=-113/377, 5-11=-105/387, 2-13=-475/1685, 7-10=-509/1764

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 281 lb uplift at joint 15 and 234 lb uplift at joint 8.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 8) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 9) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 227 lb up at 4-6-0, and 227 lb down and 136 lb up at 8-5-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-4=-70, 4-5=-70, 5-7=-70, 14-15=-20, 10-13=-20, 8-9=-20
 Concentrated Loads (lb)
 Vert: 4=-37(B) 5=-37(B) 12=-227(B) 11=-227(B) 16=-37(B) 17=-31(B)



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss A4	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732319
----------------	-------------	----------------------------	----------	----------	---	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:38:57 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFf9-5QCg0CuorIW2MO7EntbmgLASMGrEVKS6CCWqrozP4fy



Scale = 1:26.7

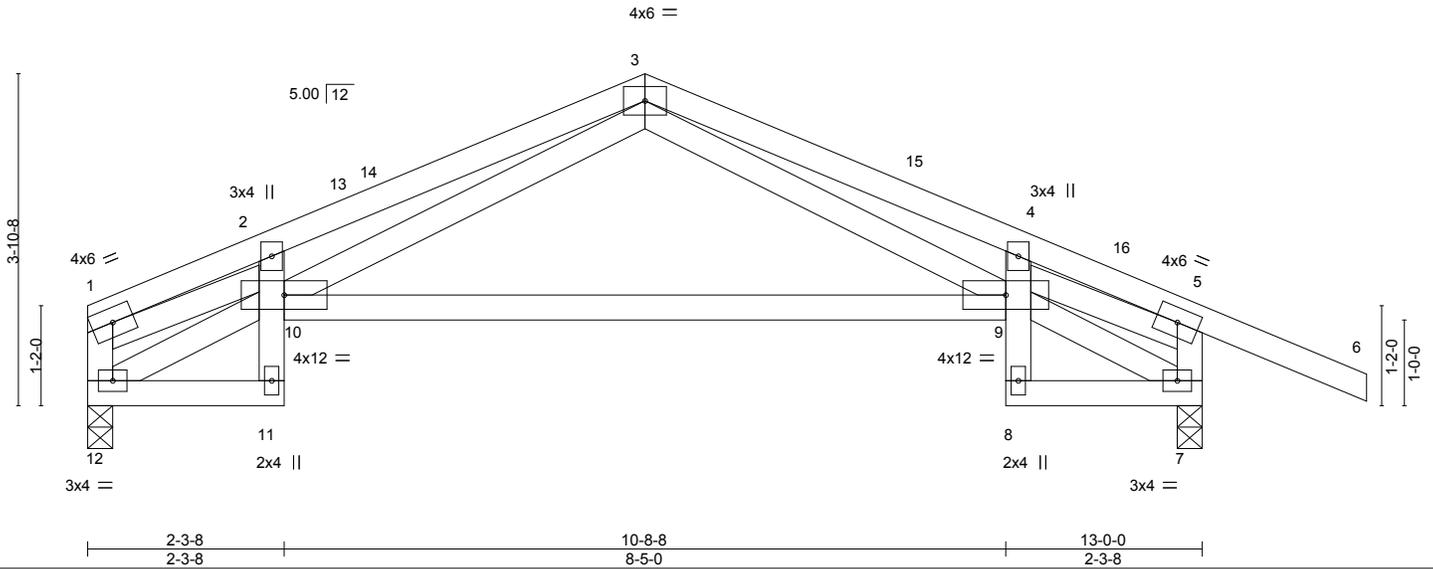

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.16 9-10	>963	240	MT20	197/144
BCLL 10.0	Lumber DOL	1.15	BC 0.52	Vert(CT)	-0.34 9-10	>448	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.25	Horz(CT)	0.08 7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 58 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 12=0-3-8, 7=0-3-8
 Max Horz 12=-42(LC 8)
 Max Uplift 12=-72(LC 12), 7=-114(LC 13)
 Max Grav 12=560(LC 1), 7=728(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-1238/305, 2-3=-1515/413, 3-4=-1398/350, 4-5=-1091/236, 1-12=-532/132,
 5-7=-660/231
 BOT CHORD 2-10=-265/145, 9-10=-121/681
 WEBS 3-9=-107/682, 3-10=-176/821, 1-10=-236/1038, 5-9=-181/981

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 6-6-0, Exterior(2R) 6-6-0 to 9-6-0, Interior(1) 9-6-0 to 14-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 72 lb uplift at joint 12 and 114 lb uplift at joint 7.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss A5	Truss Type Roof Special	Qty 2	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732320
----------------	-------------	----------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:38:58 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-acm2DXvQccev_YiQLb6?DZiehgBQEmcFQsFNNFzP4fx

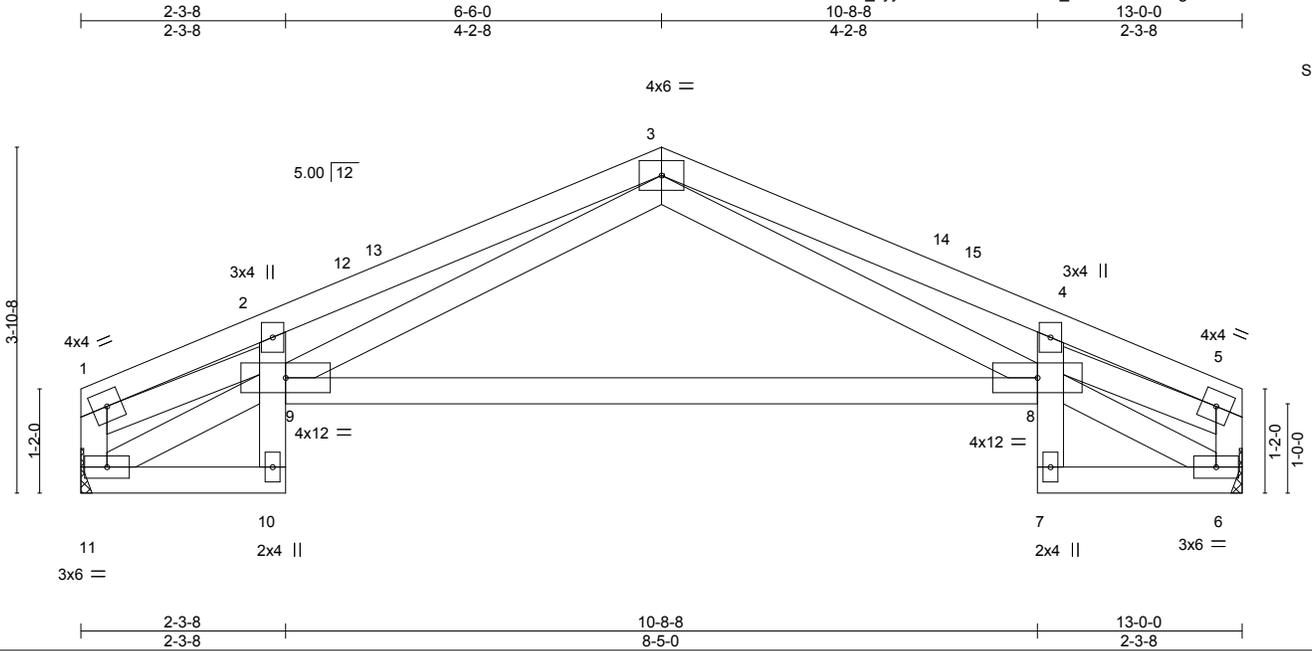

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.25	Vert(LL)	-0.16 8-9	>962	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.52	Vert(CT)	-0.34 8-9	>445	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.26	Horz(CT)	0.08 6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 56 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 11=Mechanical, 6=Mechanical
 Max Horz 11=26(LC 11)
 Max Uplift 11=-72(LC 12), 6=-72(LC 13)
 Max Grav 11=572(LC 1), 6=572(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-1267/385, 2-3=-1548/503, 3-4=-1548/456, 4-5=-1267/366, 1-11=-543/163,
 5-6=-543/163
 BOT CHORD 2-9=-265/142, 8-9=-215/710, 4-8=-265/145
 WEBS 3-8=-170/821, 3-9=-223/821, 1-9=-308/1063, 5-8=-307/1063

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 6-6-0, Exterior(2R) 6-6-0 to 9-6-0, Interior(1) 9-6-0 to 12-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 72 lb uplift at joint 11 and 72 lb uplift at joint 6.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.




April 20, 2021

Job 2742340	Truss B1	Truss Type Roof Special Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	145732321
----------------	-------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:01 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9_BSBsZxluX0Ur?Q?0jgirBK2_t9iR?Bi6qU2_ZzP4fu



Scale: 3/16"=1'

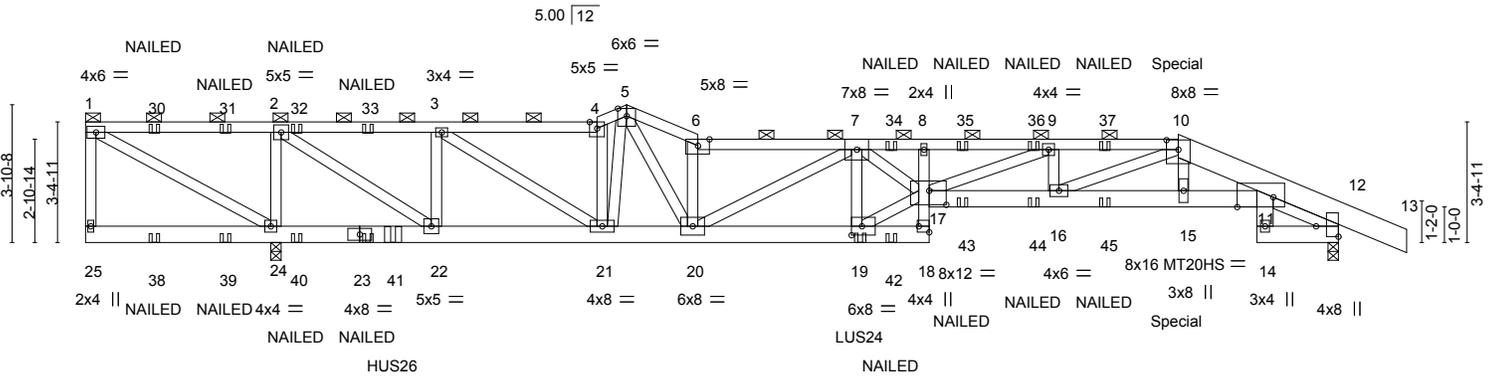


Plate Offsets (X,Y)--	[6:0-3-14,Edge], [10:0-4-0,0-3-4], [11:1-0-2,Edge], [12:Edge,0-7-8], [17:0-5-12,0-4-12], [18:Edge,0-3-8], [19:0-3-8,0-3-0]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.69	Vert(LL)	-0.37	18	>964	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.74	Vert(CT)	-0.67	18	>533	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	NO	WB 0.78	Horz(CT)	0.14	12	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						
								Weight: 381 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 10-13: 2x8 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied or 4-11-13 oc purlins, except end verticals, and 2-0-0 oc purlins (3-3-8 max.): 1-4, 6-10.
BOT CHORD 2x6 SPF No.2 *Except* 8-18: 2x4 SPF No.2, 11-17: 2x6 SPF 2100F 1.8E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 22-24.
WEBS 2x4 SPF No.2	
SLIDER Right 2x4 SPF No.2 -t 2-0-1	

REACTIONS. (size) 12=0-3-8, 24=0-3-8
 Max Horz 24=-123(LC 6)
 Max Uplift 12=-542(LC 9), 24=-745(LC 4)
 Max Grav 12=2206(LC 1), 24=3417(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-172/381, 2-3=-2693/498, 3-4=-4131/787, 4-5=-4450/850, 5-6=-5990/1197,
 6-7=-5606/1104, 7-8=-9716/2109, 8-9=-9904/2155, 9-10=-8147/1893, 10-11=-5691/1407,
 11-12=-1675/432
 BOT CHORD 22-24=-381/243, 21-22=-381/2693, 20-21=-622/3825, 19-20=-1319/6623, 18-19=-205/980,
 16-17=-1798/8147, 15-16=-1310/5615, 11-15=-1305/5586, 11-14=-95/448
 WEBS 1-24=-473/188, 2-24=-2670/628, 2-22=-640/3692, 3-22=-1348/295, 3-21=-343/1709,
 4-21=-1958/351, 5-21=-177/1088, 5-20=-754/3486, 6-20=-2518/539, 7-20=-1268/358,
 7-19=-2463/548, 17-19=-1261/6384, 7-17=-893/3978, 9-17=-284/1906, 9-16=-1076/244,
 10-16=-532/2763

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 542 lb uplift at joint 12 and 745 lb uplift at joint 24.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and Conference code and ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss B1	Truss Type Roof Special Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	I45732321
----------------	-------------	-----------------------------------	----------	-----------------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:01 2021 Page 2
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9_BSBsZxluX0Ur?Q?0jgirBK2_t9iR?Bi6qU2_ZzP4fu

NOTES-

- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 11) Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent at 8-7-11 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the right, sloping 0.0 deg. down.
- 12) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent at 21-9-3 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the right, sloping 0.0 deg. down.
- 13) Fill all nail holes where hanger is in contact with lumber.
- 14) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 15) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 238 lb down and 157 lb up at 30-8-7 on top chord, and 93 lb down and 83 lb up at 30-7-11 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-70, 4-5=-70, 5-6=-70, 6-10=-70, 10-11=-70, 11-13=-70, 18-25=-20, 11-17=-20, 14-26=-20

Concentrated Loads (lb)

Vert: 10=-117(F) 23=-40(F) 19=-558(F) 15=-93(F) 30=-83(F) 31=-83(F) 32=-83(F) 33=-83(F) 34=-63(F) 35=-37(F) 36=-37(F) 37=-37(F) 38=-40(F) 39=-40(F) 40=-40(F) 41=-770(F) 42=-36(F) 43=-31(F) 44=-31(F) 45=-31(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss B2	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset	145732322
----------------	-------------	----------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:10 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-DwUble2xnI8CQOck26Kpi5CaYVEu25d0BjA0oYzP4fl



Scale = 1:65.6

5.00 | 12


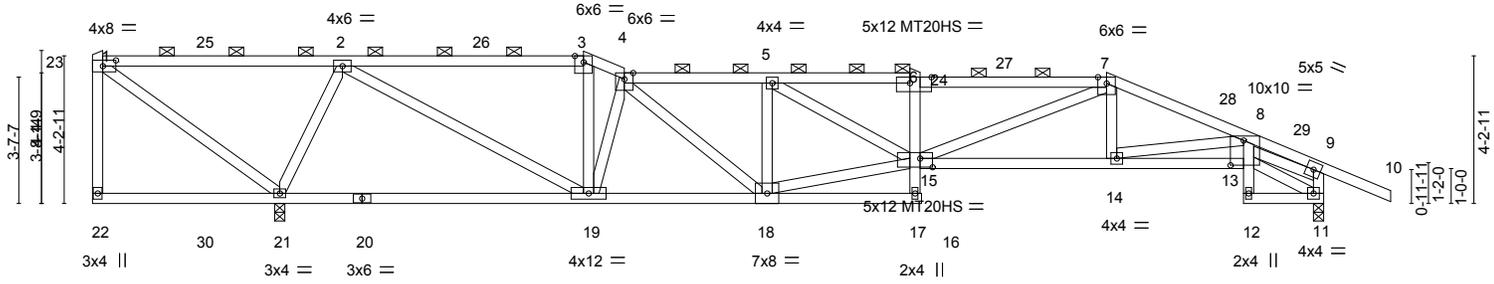


Plate Offsets (X,Y)-- [1:0-4-8,0-2-0], [6:Edge,0-2-1], [8:0-4-8,0-8-8], [15:0-4-4,0-3-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.70	Vert(LL)	-0.26	15	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.74	Vert(CT)	-0.48	15	>750	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.64	Horz(CT)	0.19	11	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS						
								Weight: 160 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (2-2-15 max.): 1-3, 4-6, 6-7, 1-23.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 21=0-3-8, 11=0-3-8
 Max Horz 21=-176(LC 10)
 Max Uplift 21=-330(LC 8), 11=-258(LC 13)
 Max Grav 21=1842(LC 1), 11=1446(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-277/287, 2-3=-1924/355, 3-4=-2068/367, 4-5=-2693/484, 5-6=-3662/627,
 6-7=-3740/639, 7-8=-2871/473, 8-9=-2776/442, 9-11=-1312/241
 BOT CHORD 19-21=-26/394, 18-19=-319/2281, 14-15=-359/2629, 13-14=-441/2866, 11-12=-42/260
 WEBS 1-21=-412/341, 2-21=-1574/352, 2-19=-261/1782, 3-19=-82/455, 4-19=-1223/269,
 7-15=-241/1217, 7-14=0/279, 6-15=-361/123, 9-13=-374/2439, 5-18=-849/197,
 15-18=-385/2613, 5-15=-176/1078, 4-18=-132/547

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 14-0-8, Exterior(2E) 14-0-8 to 15-2-8, Interior(1) 15-2-8 to 29-0-0, Exterior(2R) 29-0-0 to 32-0-0, Interior(1) 32-0-0 to 37-1-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 330 lb uplift at joint 21 and 258 lb uplift at joint 11.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job 2742340	Truss B3	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset	145732323
----------------	-------------	----------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:12 2021 Page 1
 ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-9lcl9K4CJvPwfim69XMhNWhwiJtyW0nJe1f7tRzP4fj
 1-1-8, 3-1-8, 4-3-0, 12-0-8, 13-2-8, 17-1-12, 21-4-8, 23-8-8, 25-8-0, 31-0-0, 32-11-0, 35-2-8, 37-1-8
 1-1-8, 2-0-0, 1-1-8, 7-9-8, 1-2-0, 3-11-4, 4-2-12, 2-4-0, 1-11-8, 5-4-0, 1-11-0, 2-3-8, 1-11-0
 Scale = 1:68.1

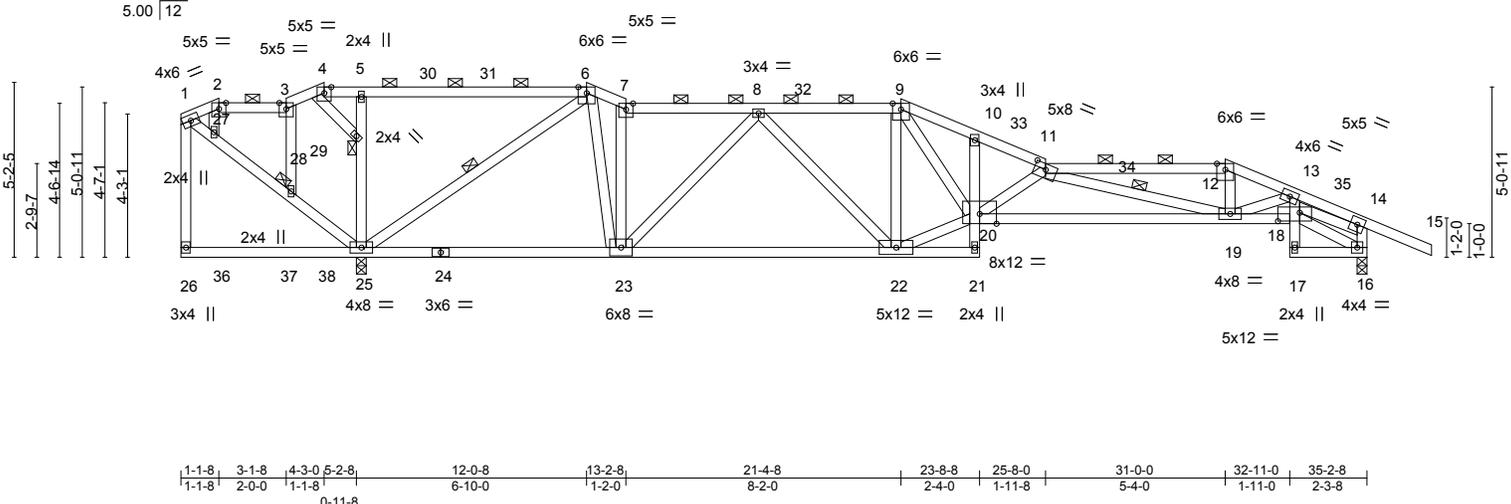


Plate Offsets (X,Y)-- [11:0-4-0-0-2-0], [18:0-7-12,0-3-0]

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.66	Vert(LL) -0.37 20 >974 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.96	Vert(CT) -0.67 19-20 >534 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.60	Horz(CT) 0.25 16 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 173 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2 *Except*
 18-20: 2x4 SPF 1650F 1.5E
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-7-0 max.): 2-3, 4-6, 7-9, 11-12.
 BOT CHORD Rigid ceiling directly applied.
 WEBS 1 Row at midpt 6-25, 11-19
 JOINTS 1 Brace at Jt(s): 28, 29

REACTIONS. (size) 16=0-3-8, 25=0-3-8
 Max Horz 25=-168(LC 8)
 Max Uplift 16=-264(LC 13), 25=-287(LC 8)
 Max Grav 16=1467(LC 26), 25=1842(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 6-7=-1745/314, 7-8=-1680/294, 8-9=-2234/418, 9-10=-3824/665, 10-11=-4031/659,
 11-12=-2974/494, 12-13=-3244/513, 13-14=-2799/454, 14-16=-1336/253
 BOT CHORD 23-25=-150/1381, 22-23=-278/2137, 19-20=-837/5308, 18-19=-421/2758, 16-17=-33/265
 WEBS 6-25=-1795/270, 7-23=-655/158, 8-23=-693/182, 9-22=-861/165, 20-22=-237/2260,
 9-20=-385/2382, 11-20=-2063/417, 11-19=-2425/434, 12-19=-61/765, 13-19=-54/310,
 6-23=-222/1326, 14-18=-376/2443, 25-29=-490/181, 5-29=-490/170, 1-27=-225/272,
 27-28=-259/276, 25-28=-255/277

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-8, Interior(1) 3-1-8 to 4-3-0, Exterior(2R) 4-3-0 to 7-3-0, Interior(1) 7-3-0 to 12-0-8, Exterior(2E) 12-0-8 to 13-2-8, Interior(1) 13-2-8 to 21-4-8, Exterior(2R) 21-4-8 to 24-4-8, Interior(1) 24-4-8 to 31-0-0, Exterior(2R) 31-0-0 to 34-0-0, Interior(1) 34-0-0 to 37-1-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 264 lb uplift at joint 16 and 287 lb uplift at joint 25.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss B4	Truss Type Roof Special Girder	Qty 1	Ply 1	Roeser/1487 Winterset 145732324
----------------	-------------	-----------------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:14 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-6hk6a06SrWfeu?wvHyPltwNF_6XE_rBc6L8ExJzP4fh



Scale = 1:65.5


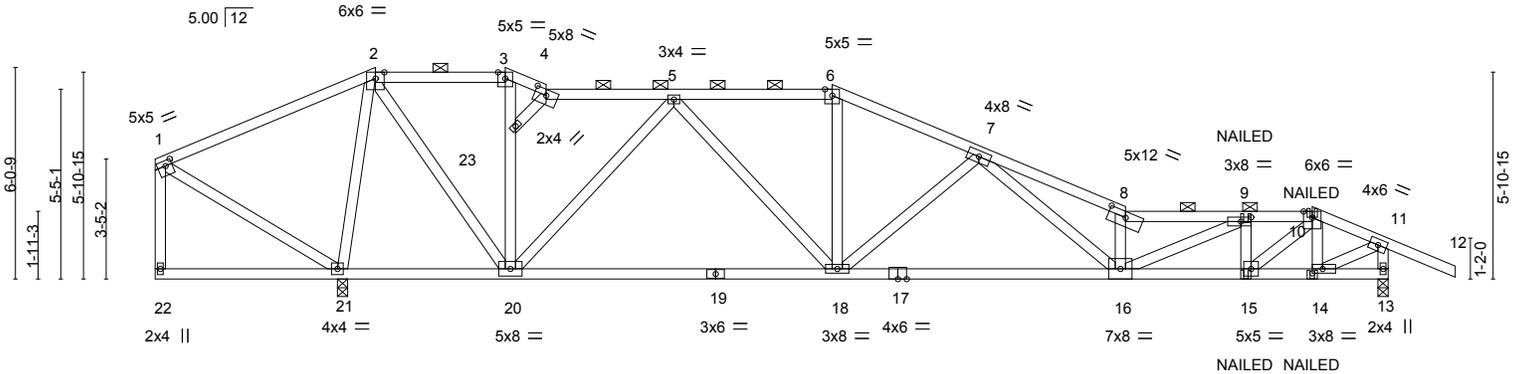


Plate Offsets (X,Y)-- [1:0-2-4,0-1-12], [4:0-4-0,0-2-0], [8:0-6-0,0-2-0], [9:0-3-8,0-1-8], [14:0-3-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.74	Vert(LL)	-0.26	16-18	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.97	Vert(CT)	-0.52	16-18	>686		
BCLL 0.0	Rep Stress Incr	NO	WB 0.93	Horz(CT)	0.08	13	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						
								Weight: 163 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-3-4 oc purlins, except end verticals, and 2-0-0 oc purlins (2-5-10 max.): 2-3, 4-6, 8-10.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (size) 21=0-3-8, 13=0-3-8
Max Horz 21=-131(LC 4)
Max Uplift 21=-221(LC 4), 13=-284(LC 9)
Max Grav 21=1839(LC 1), 13=1458(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-2=-70/331, 2-3=-907/207, 3-4=-782/162, 4-5=-956/201, 5-6=-1886/390,
6-7=-2108/402, 7-8=-4497/826, 8-9=-4265/753, 9-10=-2671/516, 10-11=-1442/271,
11-13=-1425/287
BOT CHORD 18-20=-189/1616, 16-18=-416/2616, 15-16=-473/2667, 14-15=-226/1360
WEBS 2-21=-1599/221, 2-20=-210/1378, 20-23=-268/83, 6-18=-61/529, 8-16=-1925/395,
10-14=-647/135, 1-21=-321/86, 11-14=-253/1479, 9-15=-1114/222, 10-15=-331/1756,
9-16=-285/1757, 7-16=-345/1962, 7-18=-950/258, 5-20=-1008/236, 5-18=-44/430,
4-23=-251/68

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 221 lb uplift at joint 21 and 284 lb uplift at joint 13.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 8) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-6=-70, 6-8=-70, 8-10=-70, 10-11=-70, 11-12=-70, 13-22=-20



April 20, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 2742340	Truss B4	Truss Type Roof Special Girder	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	I45732324
----------------	-------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:14 2021 Page 2
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-6hk6a06SrWfeu?wVHyPitwNF_6XE_rBc6L8ExJzP4fh

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 14=15(B) 15=-4(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss B5	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732325
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:15 2021 Page 1
 ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-atlUoL64bqnVW9Vhrfw_P8vVFW1MjPamL?tnTlzP4fg

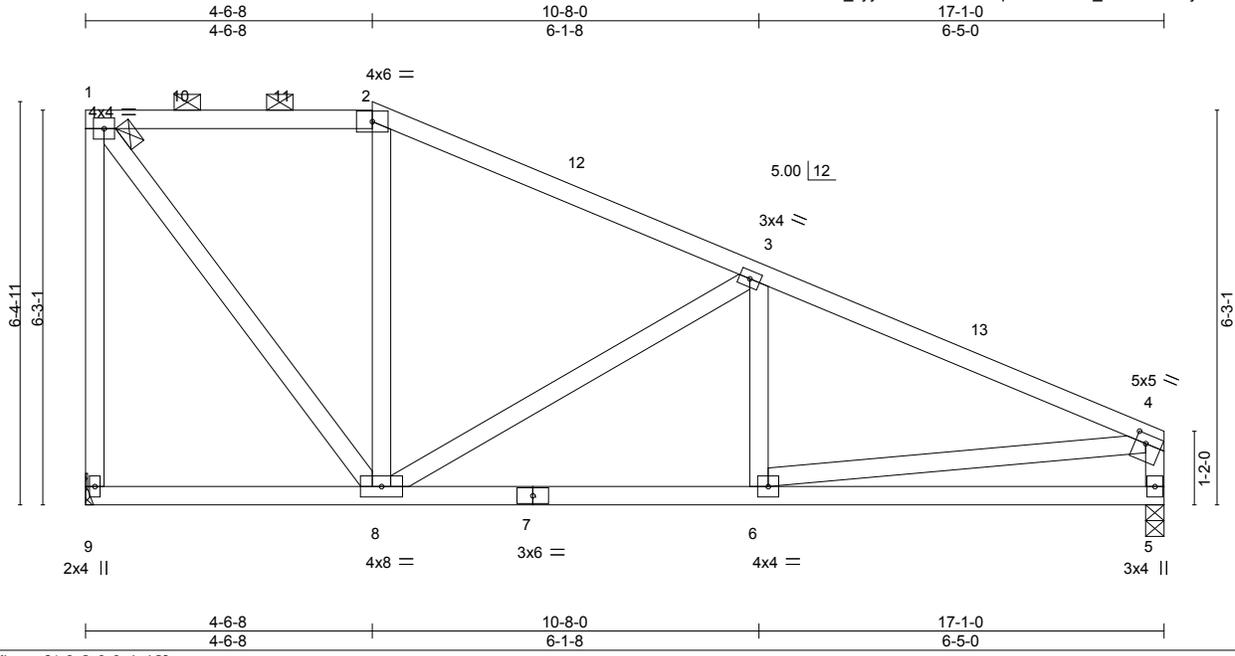


Plate Offsets (X,Y)--	[4:0-2-0,0-1-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.39	Vert(LL) -0.03 5-6 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.33	Vert(CT) -0.07 5-6 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.47	Horz(CT) 0.01 5 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 80 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 9=Mechanical, 5=0-3-8
 Max Horz 9=229(LC 8)
 Max Uplift 9=121(LC 8), 5=108(LC 13)
 Max Grav 9=756(LC 1), 5=756(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-9=-716/240, 1-2=-451/197, 2-3=-568/180, 3-4=-1083/226, 4-5=-692/177
 BOT CHORD 8-9=-158/283, 6-8=-164/928
 WEBS 1-8=-244/724, 3-8=-562/198, 4-6=-98/715

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 4-6-8, Exterior(2R) 4-6-8 to 7-6-8, Interior(1) 7-6-8 to 16-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 121 lb uplift at joint 9 and 108 lb uplift at joint 5.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20, 2021

Job 2742340	Truss B6	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Roeser/1487 Winterset 145732326
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:16 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-23ss?h7iM8vM8J4uONRDyLSh1wNDSomVzfdK0CzP4ff

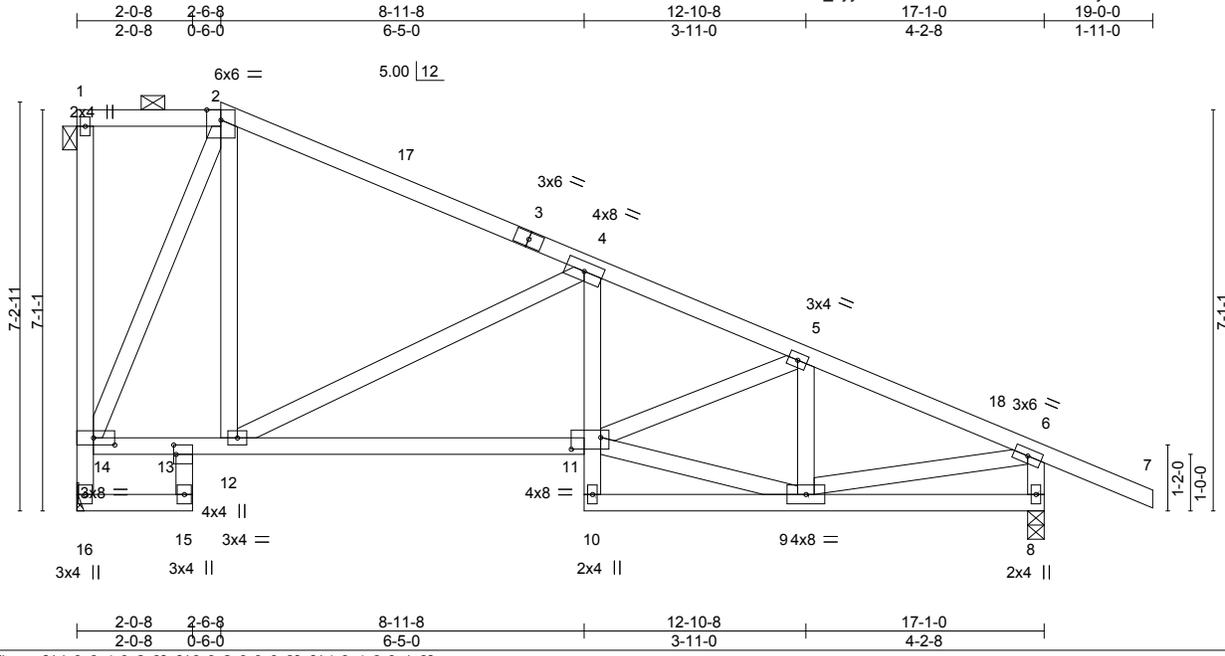

Scale = 1:40.5


Plate Offsets (X,Y)--	[11:0-6-4,0-2-8], [13:0-2-0,0-0-8], [14:0-4-8,0-1-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.38	Vert(LL) -0.05 11-12 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.36	Vert(CT) -0.11 11-12 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.75	Horz(CT) 0.03 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 95 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 16=Mechanical, 8=0-3-8
 Max Horz 16=278(LC 8)
 Max Uplift 16=124(LC 13), 8=150(LC 13)
 Max Grav 16=747(LC 1), 8=909(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 14-16=-729/167, 2-4=-425/124, 4-5=-1142/215, 5-6=-1023/182, 6-8=-859/266
 BOT CHORD 15-16=-187/260, 13-14=0/302, 12-13=-70/365, 11-12=-80/1067, 4-11=0/330
 WEBS 2-12=-65/486, 2-14=-772/154, 4-12=-849/234, 5-9=-348/84, 9-11=-46/821, 6-9=-144/861

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 2-6-8, Exterior(2R) 2-6-8 to 5-6-8, Interior(1) 5-6-8 to 19-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 124 lb uplift at joint 16 and 150 lb uplift at joint 8.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

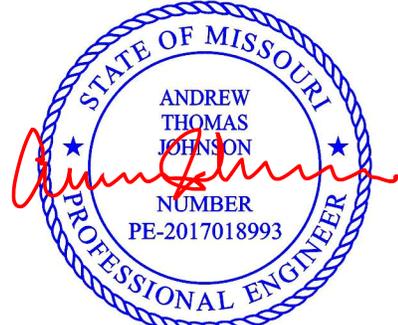

April 20,2021

Job 2742340	Truss B7	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732327
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:17 2021 Page 1
 ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-WGQED18K7R1DmTf4y4ySUZ?ruKIVBJO2oJMuYezP4fe



Scale = 1:44.3

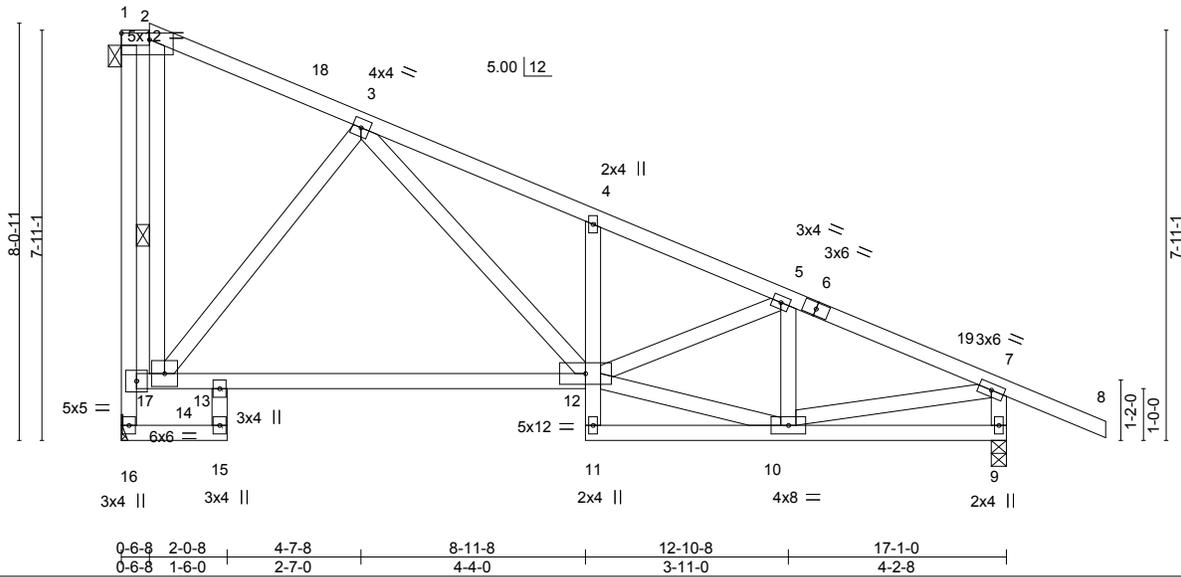


Plate Offsets (X,Y)-- [1:Edge,0-1-8]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.44	Vert(LL)	-0.12	12-13	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.42	Vert(CT)	-0.27	12-13	>755		
BCLL 0.0	Rep Stress Incr	YES	WB 0.51	Horz(CT)	0.08	9	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS						
								Weight: 97 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 1-16

REACTIONS. (size) 16=Mechanical, 9=0-3-8
 Max Horz 16=310(LC 8)
 Max Uplift 16=160(LC 13), 9=146(LC 13)
 Max Grav 16=747(LC 1), 9=909(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 16-17=-709/178, 1-17=-694/144, 3-4=-1160/268, 4-5=-1135/200, 5-7=-1030/179, 7-9=-859/263
 BOT CHORD 14-17=-66/251, 13-14=0/520, 12-13=-6/530, 4-12=-281/131
 WEBS 10-12=-50/903, 5-10=-365/84, 7-10=-146/880, 3-12=-154/795, 2-14=-136/689, 3-14=-714/207

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 0-6-8, Exterior(2R) 0-6-8 to 3-6-8, Interior(1) 3-6-8 to 19-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 160 lb uplift at joint 16 and 146 lb uplift at joint 9.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20, 2021

Job 2742340	Truss B8	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732328
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:18 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9_SzcQN9zuI94NdEGWnTh1mXy?k0lwk9C1z6R44zP4fd

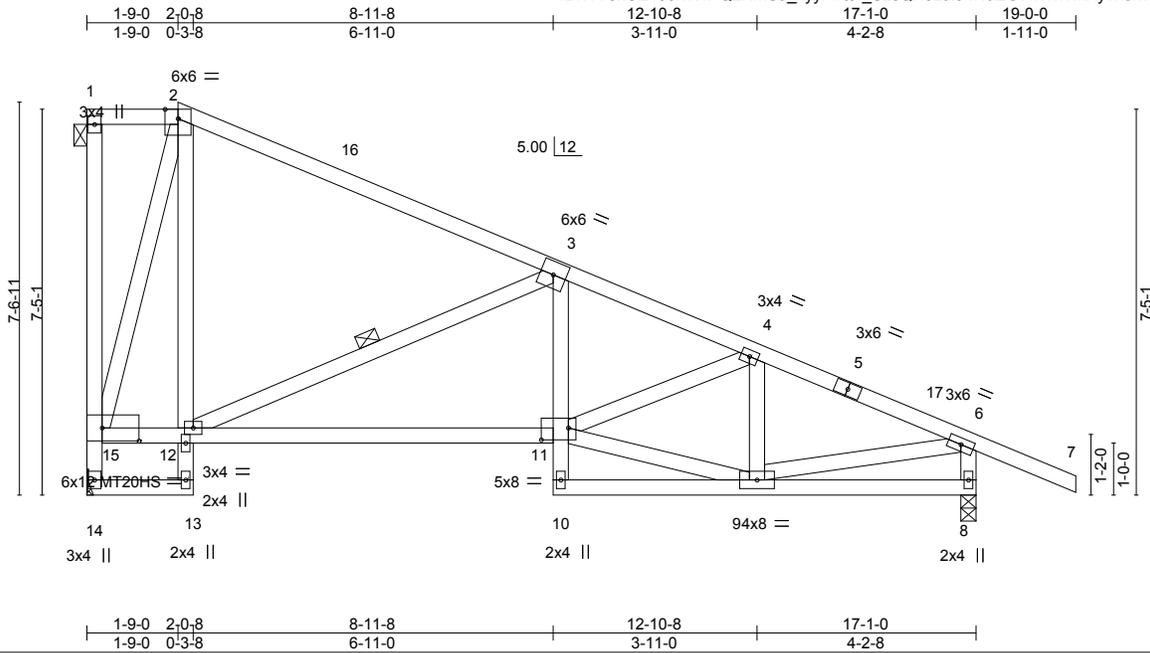

Scale = 1:44.1

Plate Offsets (X,Y)--	[11:0-6-4,0-2-12], [15:0-8-8,0-3-0]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.67	Vert(LL) -0.15 13 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.55	Vert(CT) -0.19 13 >999 180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr YES	WB 0.61	Horz(CT) 0.09 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 96 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 3-12

REACTIONS. (size) 14=Mechanical, 8=0-3-8
 Max Horz 14=-291(LC 8)
 Max Uplift 14=-123(LC 13), 8=-148(LC 13)
 Max Grav 14=783(LC 1), 8=911(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 14-15=-745/259, 2-3=-377/105, 3-4=-1151/209, 4-6=-1024/176, 6-8=-861/264
 BOT CHORD 12-15=-114/355, 11-12=-81/1093, 3-11=0/342
 WEBS 3-12=-941/264, 9-11=-33/819, 4-9=-345/78, 6-9=-137/858, 2-15=-863/154, 2-12=-60/554

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 1-9-0, Exterior(2R) 1-9-0 to 4-9-0, Interior(1) 4-9-0 to 19-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 14 and 148 lb uplift at joint 8.
 - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20,2021

Job 2742340	Truss B9	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732329
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:19 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPF19-SeX_dj9bf3Hx?moS4V_wa_4Bt7PgDpLFdr_cXzP4fc

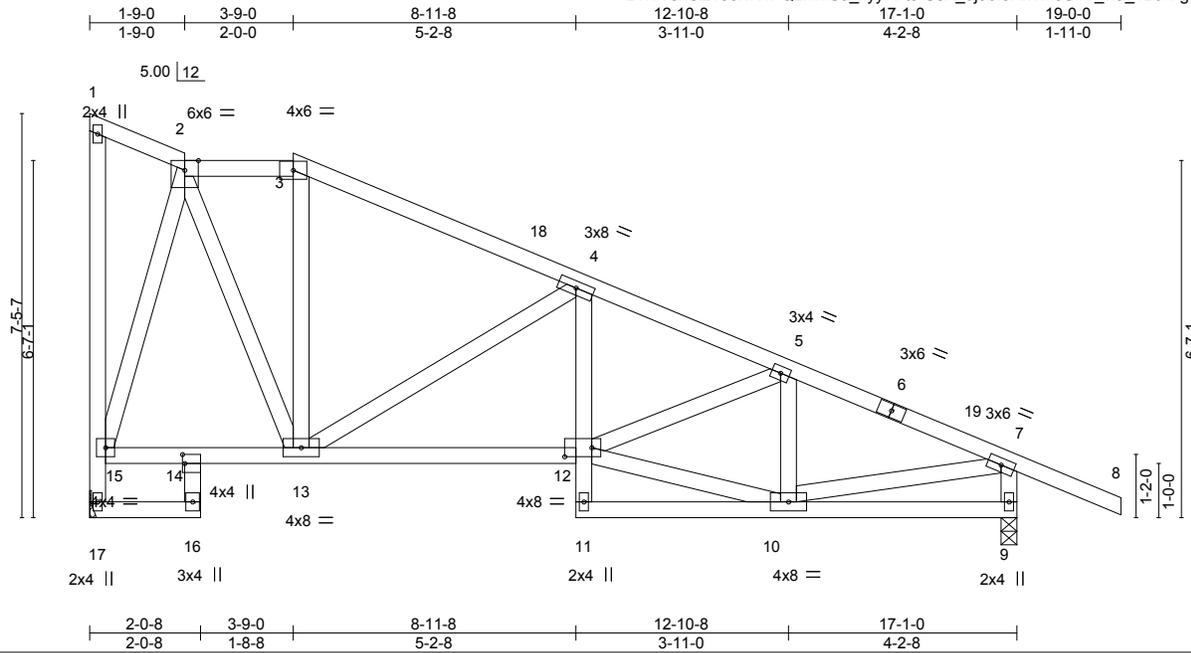

Scale = 1:42.2

Plate Offsets (X,Y)--	[12:0-6-0,0-2-0], [14:0-2-0,0-0-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.41	Vert(LL) -0.03 12 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.31	Vert(CT) -0.07 12-13 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.45	Horz(CT) 0.03 9 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 99 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 2-3.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 17=Mechanical, 9=0-3-8
 Max Horz 17=-290(LC 8)
 Max Uplift 17=-162(LC 13), 9=-151(LC 13)
 Max Grav 17=747(LC 1), 9=909(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 15-17=-725/148, 2-3=-433/136, 3-4=-539/125, 4-5=-1130/162, 5-7=-1026/152, 7-9=-859/219
 BOT CHORD 16-17=-192/269, 13-14=-109/301, 12-13=-45/1033, 4-12=-4/301
 WEBS 4-13=-706/182, 10-12=-61/822, 5-10=-349/76, 7-10=-98/869, 2-15=-687/135, 2-13=-122/625

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 1-9-0, Interior(1) 1-9-0 to 3-9-0, Exterior(2R) 3-9-0 to 7-11-15, Interior(1) 7-11-15 to 19-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 162 lb uplift at joint 17 and 151 lb uplift at joint 9.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

Job 2742340	Truss B10	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732330
----------------	--------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:02 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-SNOZ3vywfq8LS9?BaQBxNPTJ5HcPAZprLTDbW0zP4ft

Job Reference (optional)



Scale = 1:37.7

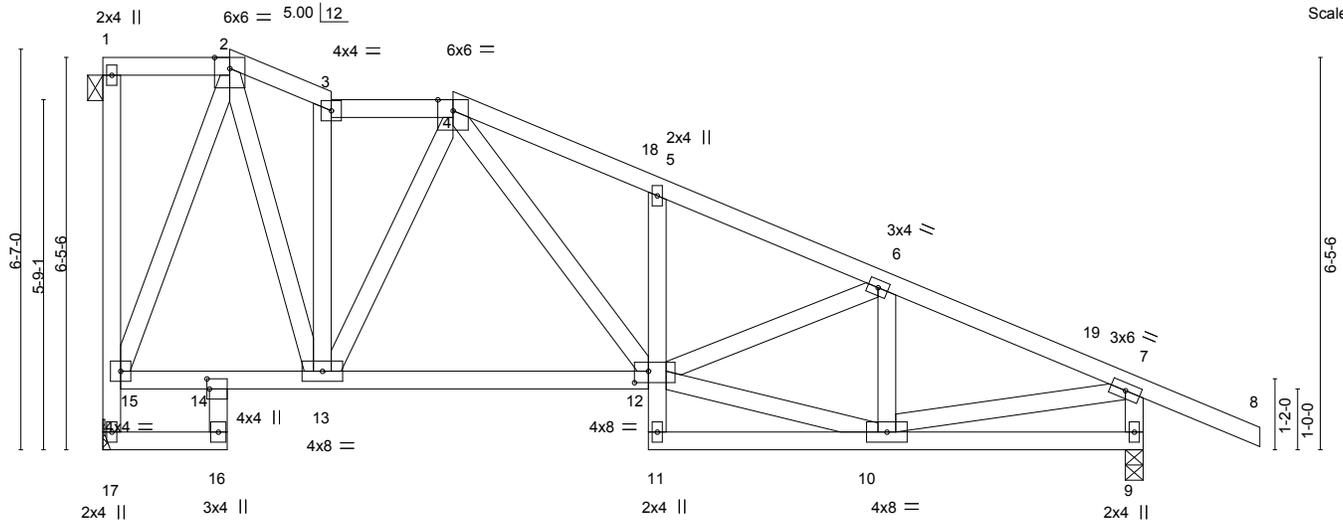


Plate Offsets (X,Y)--	[12:0-2-12,0-2-4], [14:0-2-0,0-0-8]
-----------------------	-------------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.03	12	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.26	Vert(CT)	-0.08	12-13	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.37	Horz(CT)	0.03	9	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 101 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2, 3-4.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 17=Mechanical, 9=0-3-8
 Max Horz 17=-253(LC 8)
 Max Uplift 17=-126(LC 13), 9=-156(LC 13)
 Max Grav 17=747(LC 1), 9=909(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 15-17=-726/175, 2-3=-501/182, 3-4=-462/156, 4-5=-1112/279, 5-6=-1116/226,
 6-7=-1031/195, 7-9=-859/272
 BOT CHORD 13-14=-64/312, 12-13=0/615
 WEBS 3-13=-271/112, 4-13=-356/197, 4-12=-178/630, 10-12=-75/845, 6-10=-351/95,
 7-10=-162/881, 2-15=-705/141, 2-13=-173/726

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-9-0, Interior(1) 3-9-0 to 5-9-0, Exterior(2R) 5-9-0 to 8-9-0, Interior(1) 8-9-0 to 19-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 126 lb uplift at joint 17 and 156 lb uplift at joint 9.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

Job 2742340	Truss B11	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732331
----------------	--------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:03 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-wZZxHFzYQ8GC4JaO88iAwcQUrhy9vzt_a7z82SzP4fs



Scale = 1:36.3


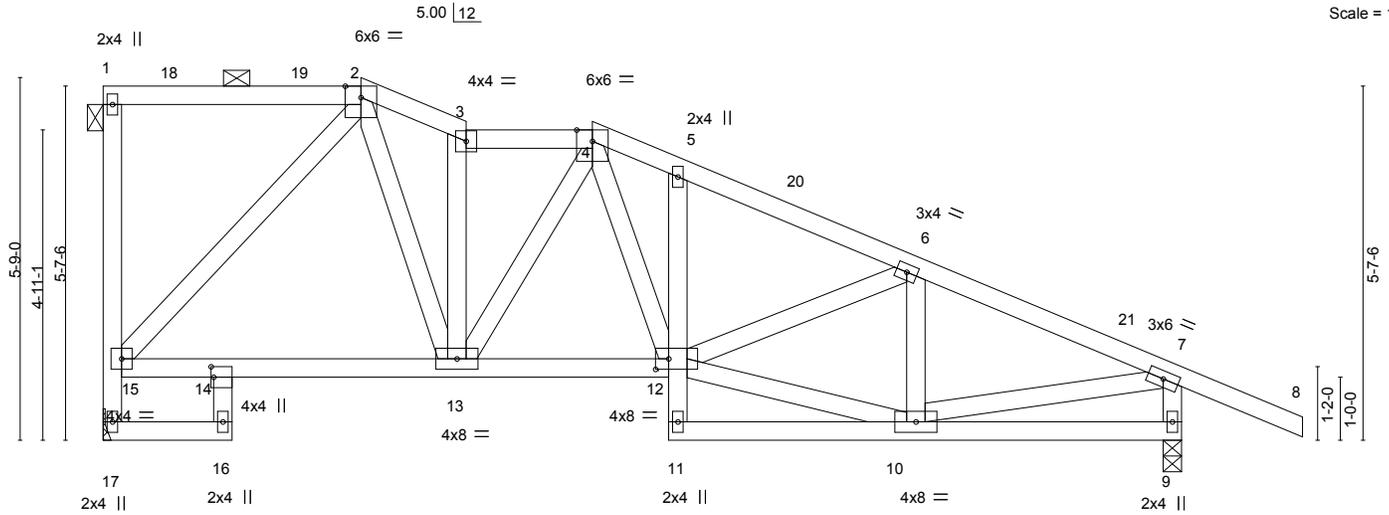



Plate Offsets (X,Y)--	[12:0-2-8,0-2-0], [14:0-2-0,0-0-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.29	Vert(LL) -0.04 13-14 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.30	Vert(CT) -0.07 13-14 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.45	Horz(CT) 0.04 9 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 96 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2, 3-4.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 17=Mechanical, 9=0-3-8
 Max Horz 17=-220(LC 10)
 Max Uplift 17=-104(LC 8), 9=-156(LC 13)
 Max Grav 17=747(LC 1), 9=909(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 15-17=-720/179, 2-3=-799/231, 3-4=-752/208, 4-5=-1054/273, 5-6=-1106/245, 6-7=-1032/207, 7-9=-859/279
 BOT CHORD 14-15=-27/526, 13-14=0/524, 12-13=-54/835
 WEBS 3-13=-367/122, 4-12=-157/393, 10-12=-98/826, 6-10=-347/103, 7-10=-173/884, 2-13=-127/652, 2-15=-751/183

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 4-1-0, Exterior(2E) 4-1-0 to 5-9-0, Interior(1) 5-9-0 to 7-9-0, Exterior(2R) 7-9-0 to 10-9-0, Interior(1) 10-9-0 to 19-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 104 lb uplift at joint 17 and 156 lb uplift at joint 9.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

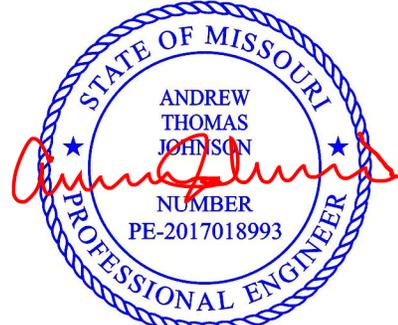


April 20,2021

Job 2742340	Truss B12	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset	145732332
----------------	--------------	----------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:04 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF9-Om7KUj_BBSO3i9ahrDPtQydf4GGeMJ8pnjibuzP4fr



Scale = 1:33.3

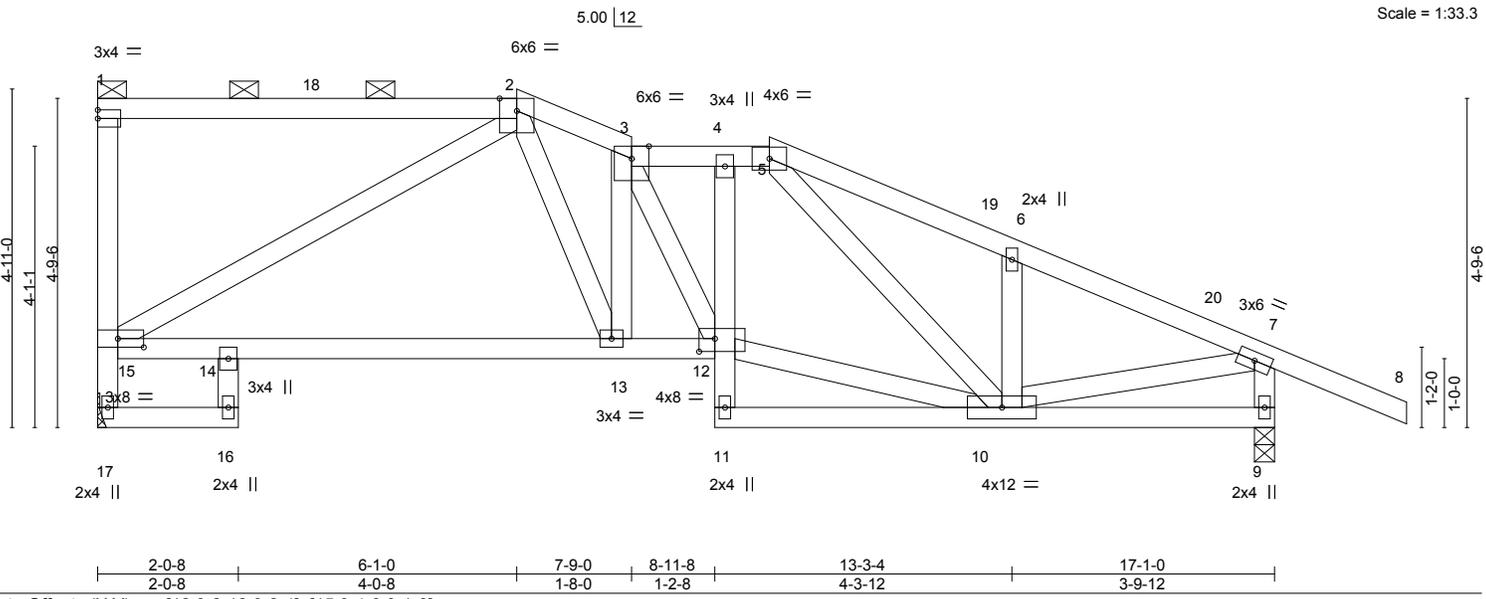


Plate Offsets (X,Y)--	[12:0-2-12,0-2-4], [15:0-4-8,0-1-8]
-----------------------	-------------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.41	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.43	Vert(LL) -0.07 13-14 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.76	Vert(CT) -0.14 13-14 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.06 9 n/a n/a		
	Code IRC2018/TPI2014			Weight: 89 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-5-15 max.): 1-2, 3-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 17=Mechanical, 9=0-3-8
 Max Horz 17=-187(LC 10)
 Max Uplift 17=-112(LC 8), 9=-151(LC 13)
 Max Grav 17=747(LC 1), 9=909(LC 26)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 15-17=-714/173, 2-3=-1143/273, 3-4=-1042/274, 4-5=-964/261, 5-6=-960/248, 6-7=-1020/213, 7-9=-864/284
 BOT CHORD 14-15=-82/873, 13-14=-78/840, 12-13=-111/1089, 4-12=-8/294
 WEBS 3-13=-365/183, 10-12=-119/868, 7-10=-185/892, 2-15=-900/236, 2-13=-69/585

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 6-1-0, Exterior(2E) 6-1-0 to 7-9-0, Interior(1) 7-9-0 to 9-9-0, Exterior(2R) 9-9-0 to 12-9-0, Interior(1) 12-9-0 to 19-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 112 lb uplift at joint 17 and 151 lb uplift at joint 9.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20, 2021

Job 2742340	Truss B14	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset	145732334
----------------	--------------	----------------------------	----------	----------	-----------------------	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:06 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-L8F4vH?Rj3enxnJzpGFTYF1_uuyR6IKRG5CofnzP4fp



Scale = 1:32.8

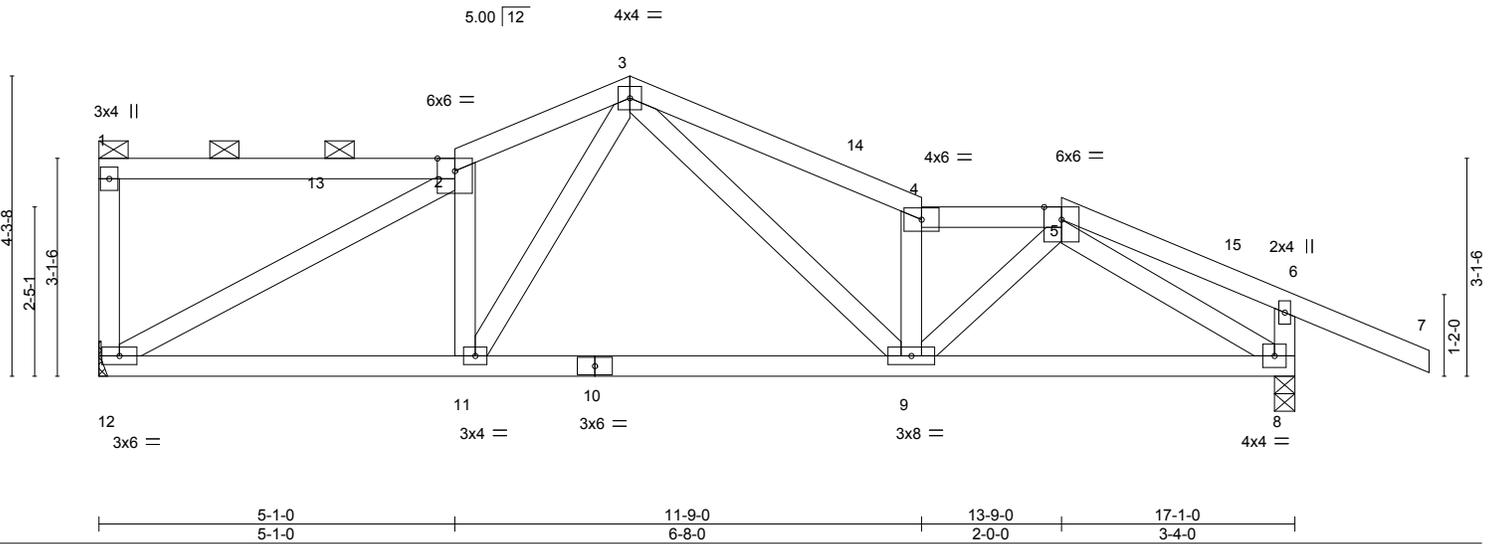

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	-0.04 9-11	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.32	Vert(CT)	-0.10 9-11	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.60	Horz(CT)	0.02 8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 76 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (5-2-12 max.): 1-2, 4-5.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 12=Mechanical, 8=0-3-8
 Max Horz 12=-119(LC 10)
 Max Uplift 12=-99(LC 12), 8=-145(LC 13)
 Max Grav 12=747(LC 1), 8=909(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-1058/292, 3-4=-1373/350, 4-5=-1259/293, 6-8=-301/164
 BOT CHORD 11-12=-142/941, 9-11=-101/775, 8-9=-125/832
 WEBS 2-12=-1036/255, 3-11=-70/369, 3-9=-164/611, 4-9=-749/231, 5-9=-118/610,
 5-8=-984/235

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 7-7-0, Exterior(2R) 7-7-0 to 10-7-0, Interior(1) 10-7-0 to 13-9-0, Exterior(2R) 13-9-0 to 16-11-4, Interior(1) 16-11-4 to 19-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 99 lb uplift at joint 12 and 145 lb uplift at joint 8.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20, 2021

Job 2742340	Truss B15	Truss Type Roof Special Girder	Qty 1	Ply 1	Roeser/1487 Winterset	145732335
----------------	--------------	-----------------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:07 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-pLpS6c03UNmeZwu9N_m64Sa3fiEeroxaVlxMBDzP4fo



Scale = 1:34.8

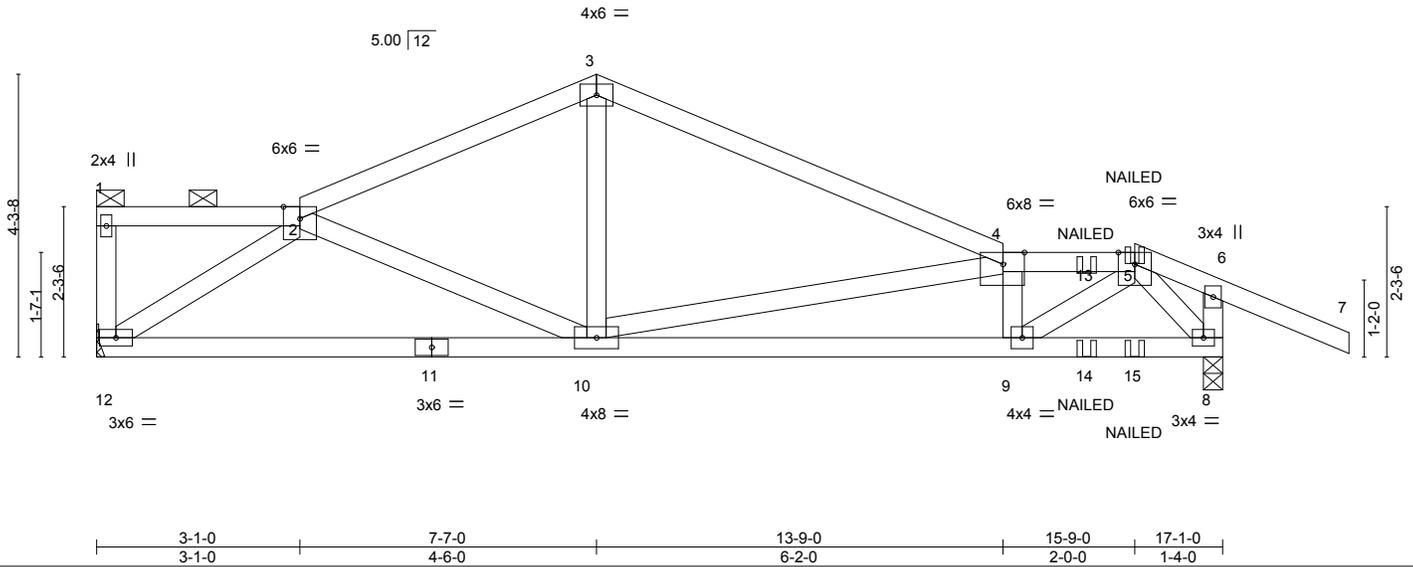


Plate Offsets (X,Y)--	[4:0-3-14,Edge]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.68	Vert(LL)	-0.07	10-12	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.58	Vert(CT)	-0.15	10-12	>999
BCLL 0.0	Rep Stress Incr	NO	WB 0.45	Horz(CT)	0.03	8	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 71 lb
							FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 4-5-11 oc purlins, except end verticals, and 2-0-0 oc purlins (4-10-13 max.): 1-2, 4-5.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SPF No.2		

REACTIONS. (size) 12=Mechanical, 8=0-3-8
 Max Horz 12=-85(LC 4)
 Max Uplift 12=-97(LC 8), 8=-154(LC 9)
 Max Grav 12=743(LC 1), 8=865(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-953/129, 3-4=-964/109, 4-5=-1343/200, 6-8=-277/104
 BOT CHORD 10-12=-99/868, 9-10=-183/1403, 8-9=-37/457
 WEBS 2-12=-1018/168, 3-10=0/374, 4-10=-619/181, 4-9=-575/140, 5-9=-163/1096, 5-8=-742/70

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 97 lb uplift at joint 12 and 154 lb uplift at joint 8.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 9) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 5-6=-70, 6-7=-70, 8-12=-20

Concentrated Loads (lb)
 Vert: 5=49(B) 14=-2(B)



April 20, 2021


Job 2742340	Truss B16	Truss Type Common	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732336
----------------	--------------	----------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:08 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-HXNqKy1hFguUA4TLwhLLdg7Lyid4aHRkkPhvkfzP4fn



Scale = 1:28.2

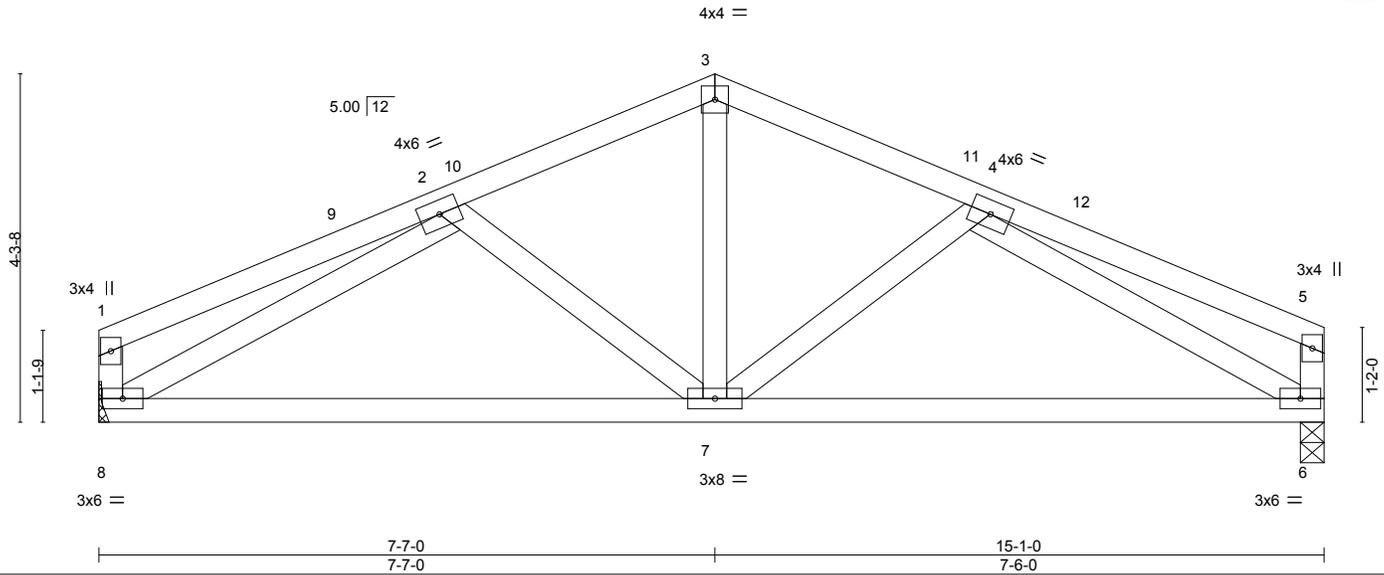

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.20	Vert(LL)	-0.06 7-8	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.44	Vert(CT)	-0.12 7-8	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.30	Horz(CT)	0.02 6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 61 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 8=Mechanical, 6=0-3-8
 Max Horz 8=25(LC 11)
 Max Uplift 8=-84(LC 12), 6=-83(LC 13)
 Max Grav 8=666(LC 1), 6=666(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-755/231, 3-4=-755/231
 BOT CHORD 7-8=-222/769, 6-7=-205/759
 WEBS 3-7=-73/331, 2-8=-712/210, 4-6=-720/211

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 7-7-0, Exterior(2R) 7-7-0 to 10-7-0, Interior(1) 10-7-0 to 14-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 84 lb uplift at joint 8 and 83 lb uplift at joint 6.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss B17	Truss Type Common Girder	Qty 1	Ply 1	Roeser/1487 Winterset 145732337
----------------	--------------	-----------------------------	----------	----------	------------------------------------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:09 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-ijxDXl2J0_0LoE1XUPpaAtfNf5xUJKmty3QTG6zP4fm



Scale = 1:28.4

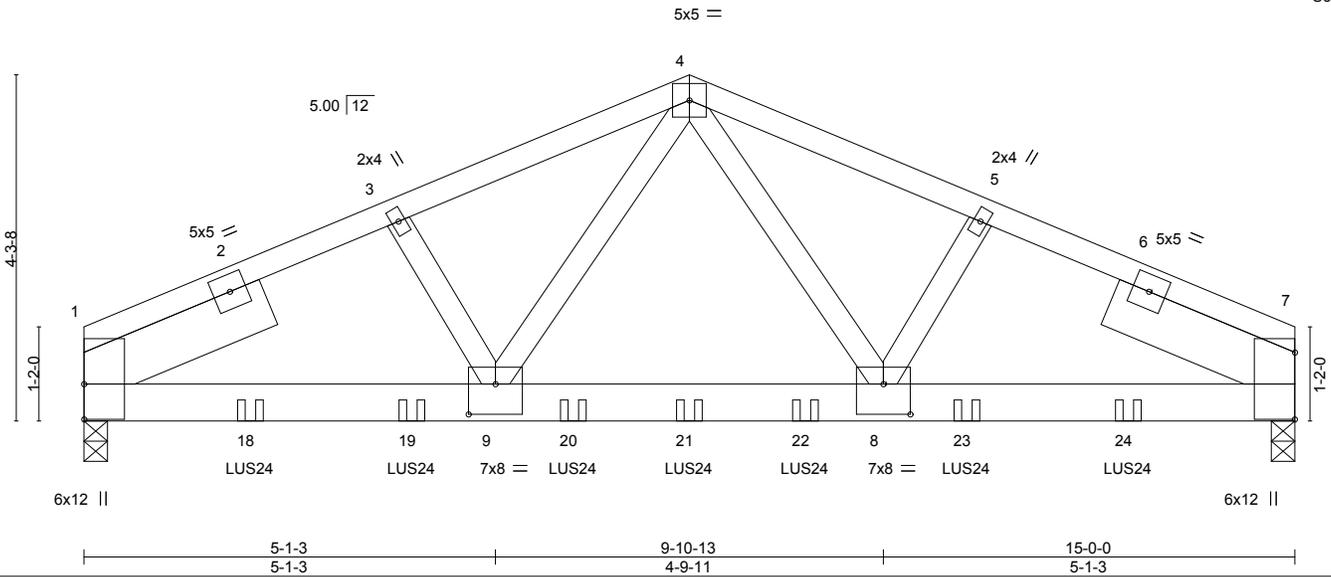

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	2-0-0	TC	0.78	Vert(LL)	-0.11	in (loc)	8-9	L/defl	>999
TCDL	10.0	Lumber DOL	1.15	BC	0.56	Vert(CT)	-0.19	L/d	240		180
BCLL	0.0	Rep Stress Incr	NO	WB	0.30	Horz(CT)	0.03		n/a		180
BCDL	10.0	Code	IRC2018/TPI2014	Matrix-MS							
										Weight: 76 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF 1650F 1.5E
BOT CHORD 2x6 SPF 2100F 1.8E
WEBS 2x4 SPF No.2
SLIDER Left 2x8 SP 2400F 2.0E -t 2-6-0, Right 2x8 SP 2400F 2.0E -t 2-6-0

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-10-9 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=0-3-8, 7=0-3-8
Max Horz 1=49(LC 12)
Max Uplift 1=-429(LC 8), 7=-429(LC 9)
Max Grav 1=2160(LC 1), 7=2160(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-3=-3166/632, 3-4=-3120/645, 4-5=-3119/645, 5-7=-3166/633
BOT CHORD 1-9=-575/2805, 8-9=-411/2256, 7-8=-525/2805
WEBS 4-8=-271/1210, 5-8=-125/275, 4-9=-271/1210, 3-9=-125/275

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 429 lb uplift at joint 1 and 429 lb uplift at joint 7.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-10-8 oc max. starting at 2-0-12 from the left end to 12-11-4 to connect truss(es) to back face of bottom chord.
 - 7) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent at 7-6-0 from the left end to connect truss(es) to back face of bottom chord.
 - 8) Fill all nail holes where hanger is in contact with lumber.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-4=-70, 4-7=-70, 10-14=-20
Concentrated Loads (lb)
Vert: 18=-404(B) 19=-433(B) 20=-433(B) 21=-433(B) 22=-433(B) 23=-433(B) 24=-404(B)



April 20, 2021

Job 2742340	Truss C1	Truss Type Roof Special Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	I45732338
----------------	-------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:22 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-tDD7GICTy_fvsEX1ldYdBciigLOOsaJnyb4fDrzP4fZ



Scale = 1:69.6

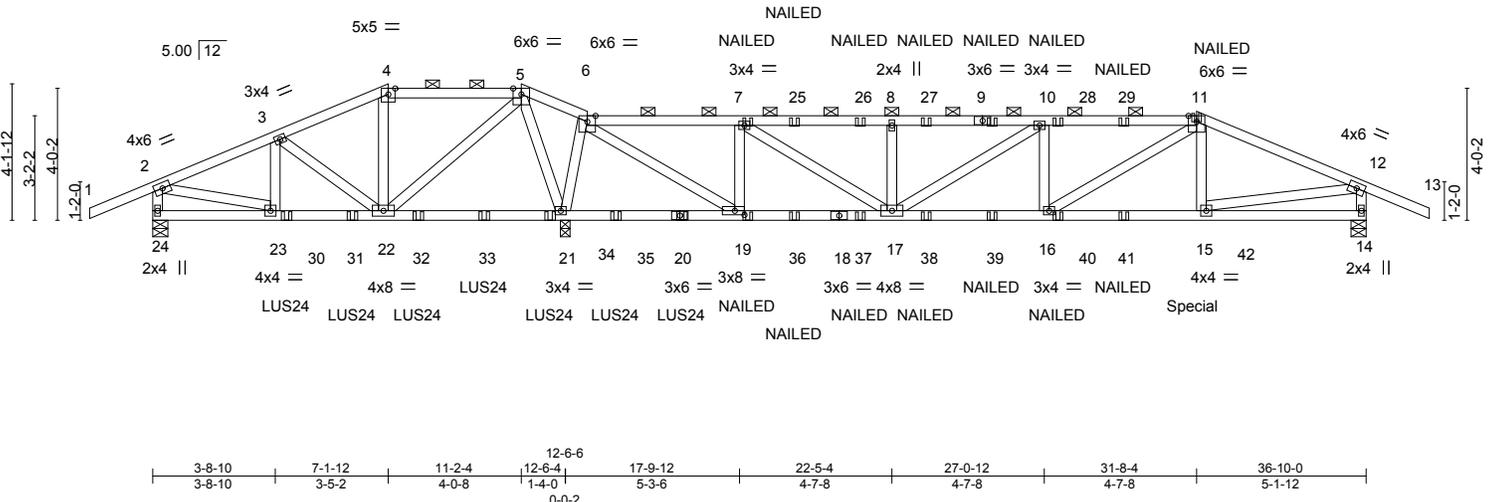


Plate Offsets (X,Y)-- [19:0-3-8,0-1-8]


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.07	16-17	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.50	Vert(CT)	-0.13	16-17	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.40	Horz(CT)	0.01	14	n/a		
BCDL 10.0	Code IRC2018/TP12014		Matrix-MS						
								Weight: 321 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5, 6-11.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 24=0-5-8, 21=0-3-8, 14=0-5-8
 Max Horz 24=-31(LC 9)
 Max Uplift 24=-191(LC 8), 21=-1014(LC 5), 14=-390(LC 9)
 Max Grav 24=775(LC 21), 21=4427(LC 1), 14=1554(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-790/217, 3-4=-300/171, 5-6=-545/2468, 6-7=-796/230, 7-8=-2232/591, 8-10=-2232/591, 10-11=-2704/722, 11-12=-2227/583, 2-24=-752/208, 12-14=-1511/407
 BOT CHORD 22-23=-179/679, 21-22=-1405/420, 19-21=-2015/532, 17-19=-145/793, 16-17=-633/2700, 15-16=-477/1996
 WEBS 3-23=-107/389, 3-22=-597/203, 5-22=-454/1972, 6-21=-1081/306, 6-19=-799/3290, 7-19=-1380/430, 7-17=-426/1705, 8-17=-498/224, 10-17=-561/153, 10-16=-253/162, 11-16=-200/834, 2-23=-167/729, 12-15=-463/1930, 5-21=-2602/609

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x4 - 1 row at 0-7-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 191 lb uplift at joint 24, 1014 lb uplift at joint 21 and 390 lb uplift at joint 14.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 4-0-0 oc max. starting at 4-0-12 from the left end to 16-0-12 to connect truss(es) to back face of bottom chord.
 - Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent at 6-0-12 from the left end to connect truss(es) to back face of bottom chord, skewed 0.0 deg to the right, sloping 0.0 deg. down.

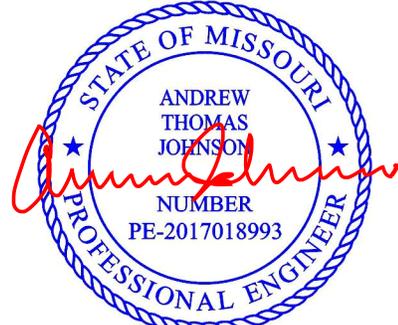

April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss C1	Truss Type Roof Special Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	I45732338
----------------	-------------	-----------------------------------	----------	-----------------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:22 2021 Page 2
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-tDD7GICTy_fVsEX1dYdBciigLOOsaJnyb4fDrzP4fZ

NOTES-

- 13) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 14) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 50 lb down at 31-5-12, and 220 lb down and 118 lb up at 31-8-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-70, 2-4=-70, 4-5=-70, 5-6=-70, 6-11=-70, 11-12=-70, 12-13=-70, 14-24=-20

Concentrated Loads (lb)

Vert: 9=-73(B) 20=-263(B) 19=-29(B) 7=-73(B) 11=-73(B) 25=-73(B) 26=-73(B) 27=-73(B) 28=-73(B) 29=-73(B) 30=-433(B) 31=-267(B) 32=-272(B) 33=-272(B) 34=-267(B) 35=-267(B) 36=-29(B) 37=-29(B) 38=-29(B) 39=-29(B) 40=-29(B) 41=-29(B) 42=-249(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss C2	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732339
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:23 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-LQnVT5D5jHnMUO6EJL3skqFqZlh0b1pxAFpCmlzP4fY



Scale = 1:44.2

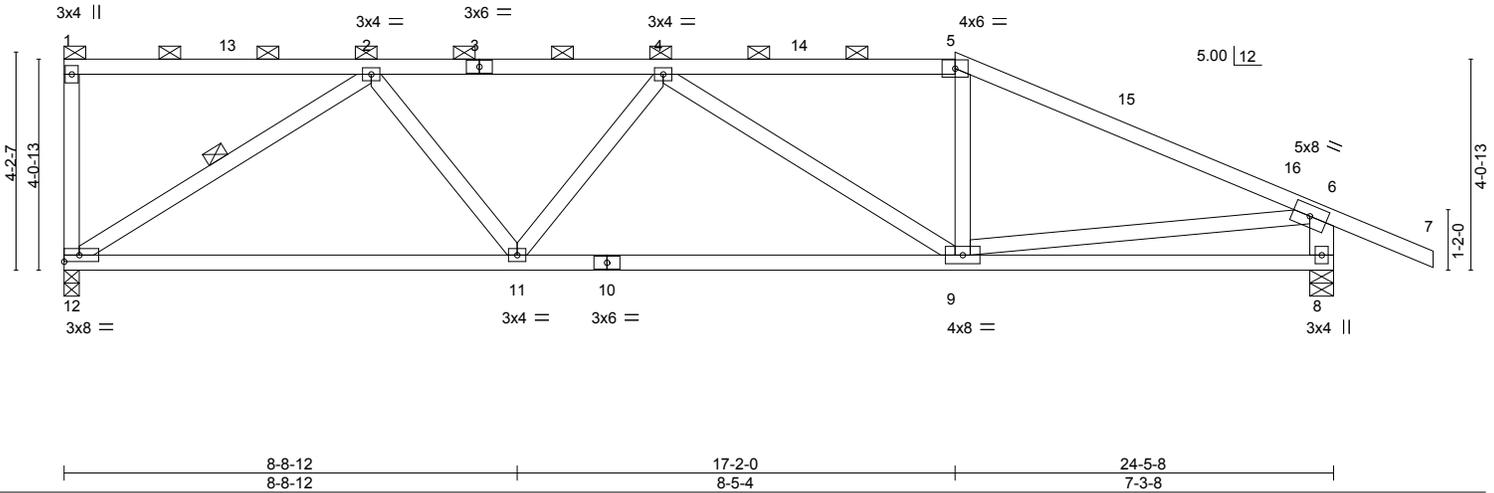

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.56	Vert(LL)	-0.13	11-12	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.67	Vert(CT)	-0.27	11-12	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.39	Horz(CT)	0.05	8	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS						
	Code IRC2018/TPI2014						Weight: 101 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-4-15 max.): 1-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2 *Except* 6-8: 2x6 SPF No.2	WEBS 1 Row at midpt 2-12

REACTIONS. (size) 12=0-3-8, 8=0-5-8
 Max Horz 12=-160(LC 8)
 Max Uplift 12=-194(LC 8), 8=-191(LC 9)
 Max Grav 12=1077(LC 1), 8=1241(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-1580/274, 4-5=-1446/254, 5-6=-1665/245, 6-8=-1172/286
 BOT CHORD 11-12=-177/1289, 9-11=-240/1737, 8-9=-84/297
 WEBS 2-12=-1483/298, 2-11=-18/491, 4-11=-263/117, 4-9=-460/111, 5-9=0/301,
 6-9=-142/1158

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 17-2-0, Exterior(2R) 17-2-0 to 20-2-0, Interior(1) 20-2-0 to 26-4-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 194 lb uplift at joint 12 and 191 lb uplift at joint 8.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

Job 2742340	Truss C3	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732340
----------------	-------------	----------------------------	----------	----------	------------------------------------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:23 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-LQnVT5D5jHnMUO6EJL3skqFnHllbyRxAFpCmlzP4fY



Scale = 1:45.0

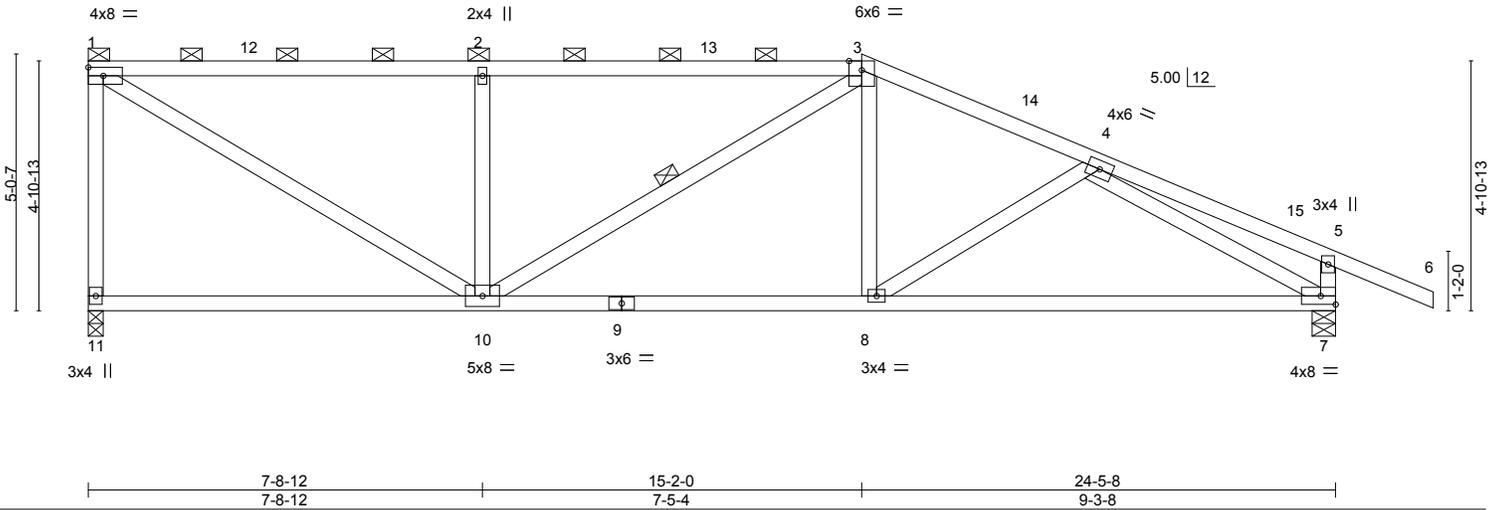

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.77	Vert(LL) -0.15	7-8 >999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.62	Vert(CT) -0.31	7-8 >945	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.73	Horz(CT) 0.04	7 n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 106 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-11-15 max.): 1-3.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 3-10

REACTIONS. (size) 11=0-3-8, 7=0-5-8
 Max Horz 11=-192(LC 10)
 Max Uplift 11=-192(LC 8), 7=-174(LC 9)
 Max Grav 11=1081(LC 1), 7=1238(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-11=-1007/217, 1-2=-1322/259, 2-3=-1324/261, 3-4=-1528/255, 4-5=-292/41, 5-7=-396/144
 BOT CHORD 8-10=-114/1364, 7-8=-150/1376
 WEBS 1-10=-265/1488, 2-10=-603/214, 3-8=0/300, 4-7=-1431/279

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 15-2-0, Exterior(2R) 15-2-0 to 18-2-0, Interior(1) 18-2-0 to 26-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 192 lb uplift at joint 11 and 174 lb uplift at joint 7.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021


Job 2742340	Truss C4	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732341
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:24 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-pcl.thQDjUbvD5YhQs2a5G1n_z85MKVX4PvZlIkzP4fX



Scale = 1:44.7

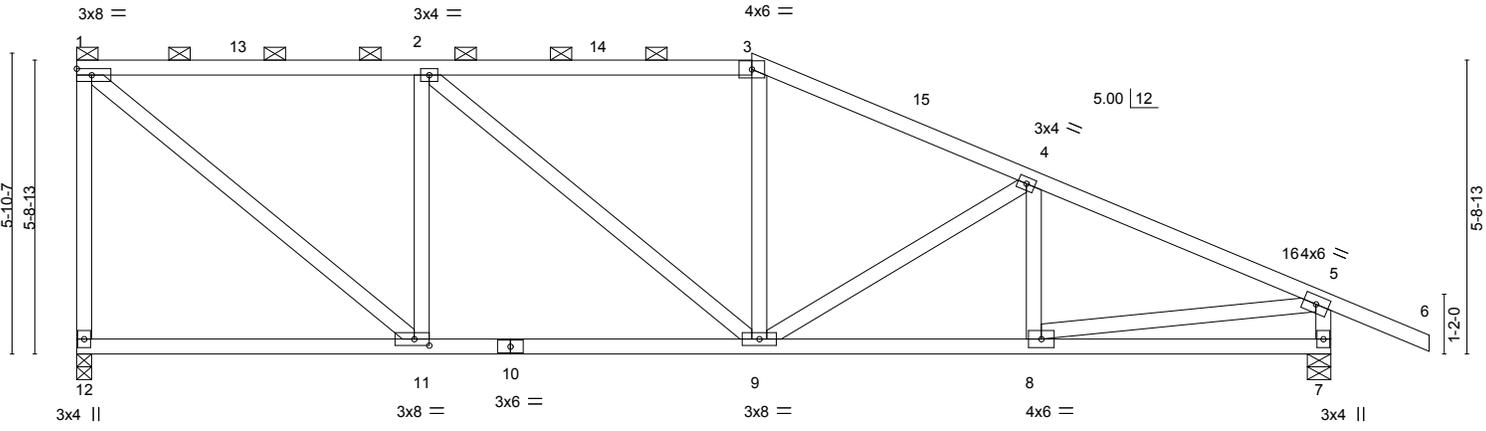

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.58	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.40	Vert(LL) -0.06 8-9 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.36	Vert(CT) -0.12 9-11 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.03 7 n/a n/a		
	Code IRC2018/TPI2014			Weight: 113 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (4-9-6 max.): 1-3.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 12=0-3-8, 7=0-5-8
 Max Horz 12=-225(LC 8)
 Max Uplift 12=-188(LC 8), 7=-171(LC 13)
 Max Grav 12=1081(LC 1), 7=1238(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-12=-1018/207, 1-2=-1018/228, 2-3=-1215/259, 3-4=-1384/253, 4-5=-1661/238,
 5-7=-1175/274
 BOT CHORD 9-11=-70/1018, 8-9=-134/1460
 WEBS 1-11=-231/1282, 2-11=-680/215, 2-9=-98/253, 4-9=-286/136, 5-8=-180/1333

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 13-2-0, Exterior(2R) 13-2-0 to 16-2-0, Interior(1) 16-2-0 to 26-4-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 188 lb uplift at joint 12 and 171 lb uplift at joint 7.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

Job 2742340	Truss C5	Truss Type Hip	Qty 1	Ply 1	Roeser/1487 Winterset 145732342
----------------	-------------	-------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:25 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-HouGumEMFv14jhGcQm5KpFKCIYQB3saEeYlJqAzP4fW



5.00 | 12

Scale = 1:45.4

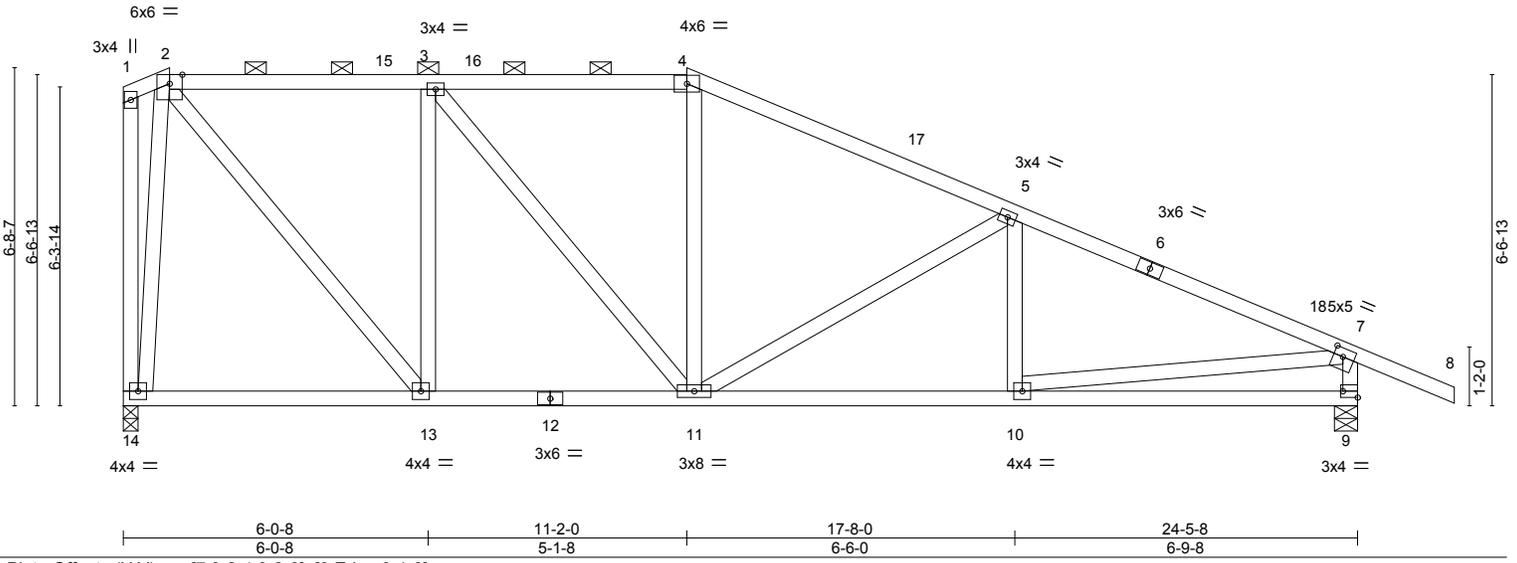

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.41	Vert(LL)	-0.06	10-11	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.43	Vert(CT)	-0.13	10-11	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.75	Horz(CT)	0.03	9	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 125 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-5-15 max.): 2-4.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 14=0-3-8, 9=0-5-8
 Max Horz 14=-250(LC 10)
 Max Uplift 14=-174(LC 8), 9=-212(LC 13)
 Max Grav 14=1081(LC 1), 9=1238(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-804/185, 3-4=-1057/251, 4-5=-1233/236, 5-7=-1688/273, 7-9=-1169/243
 BOT CHORD 11-13=-15/801, 10-11=-173/1475
 WEBS 2-13=-171/1054, 3-13=-704/182, 3-11=-111/396, 5-11=-485/158, 7-10=-133/1278, 2-14=-1064/293

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 0-11-0, Exterior(2R) 0-11-0 to 5-1-15, Interior(1) 5-1-15 to 11-2-0, Exterior(2R) 11-2-0 to 15-4-15, Interior(1) 15-4-15 to 26-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 174 lb uplift at joint 14 and 212 lb uplift at joint 9.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss C6	Truss Type Hip	Qty 1	Ply 1	Roeser/1487 Winterset	145732343
----------------	-------------	-------------------	----------	----------	-----------------------	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:26 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPft9-l?Se56F_0C9xLrrp_TcZMStLlyj9oQeNsC2sMdzP4fV



Scale = 1:46.8

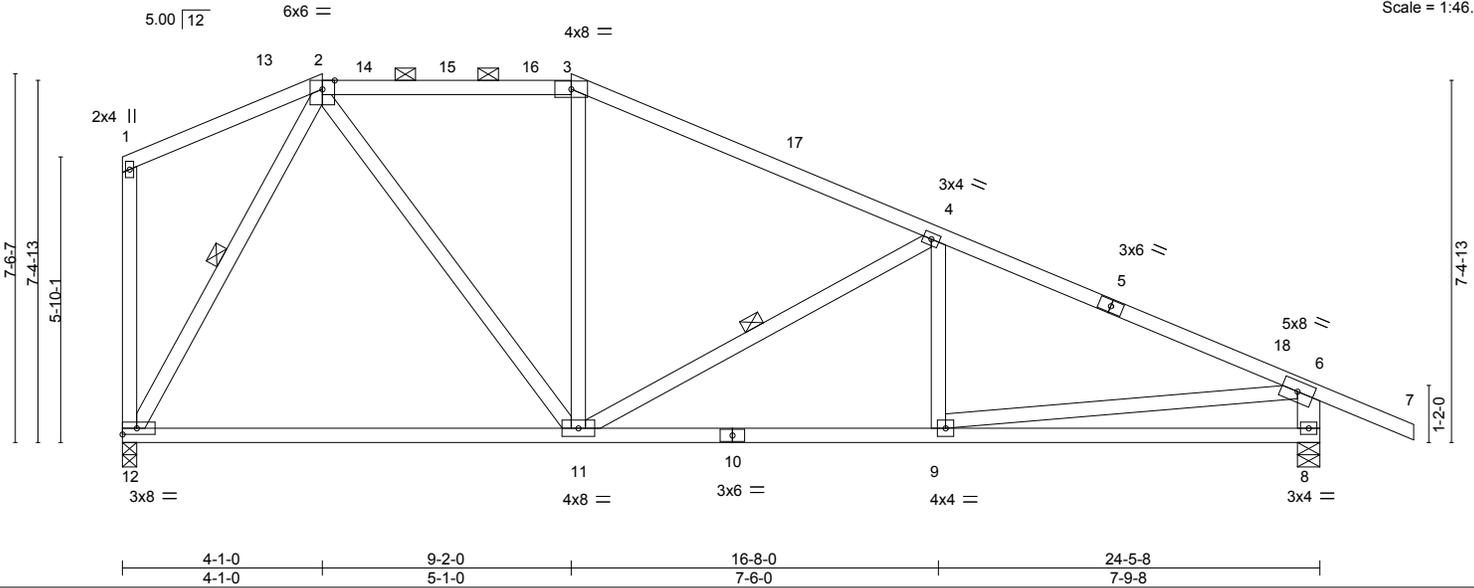

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.52	Vert(LL)	-0.18 11-12	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.64	Vert(CT)	-0.37 11-12	>784	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.32	Horz(CT)	0.03 8	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS					Weight: 116 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-11-1 max.): 2-3.
BOT CHORD 2x4 SPF No.2	Rigid ceiling directly applied.
WEBS 2x4 SPF No.2 *Except*	WEBS 1 Row at midpt 4-11, 2-12
6-8: 2x6 SPF No.2	

REACTIONS. (size) 12=0-3-8, 8=0-5-8
 Max Horz 12=-228(LC 8)
 Max Uplift 12=-124(LC 8), 8=-207(LC 13)
 Max Grav 12=1077(LC 1), 8=1241(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-899/219, 3-4=-1076/196, 4-6=-1664/261, 6-8=-1161/252
 BOT CHORD 11-12=0/493, 9-11=-152/1442, 8-9=-59/289
 WEBS 2-11=-131/718, 4-11=-628/204, 2-12=-977/220, 6-9=-126/1163

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 4-1-0, Exterior(2R) 4-1-0 to 8-3-15, Interior(1) 8-3-15 to 9-2-0, Exterior(2R) 9-2-0 to 13-4-15, Interior(1) 13-4-15 to 26-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 124 lb uplift at joint 12 and 207 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20, 2021

Job 2742340	Truss C7	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732344
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:27 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFf9-DB00JSgcWHoy?Q?YA7ougPVkM32XpXX5snQv3zP4fU

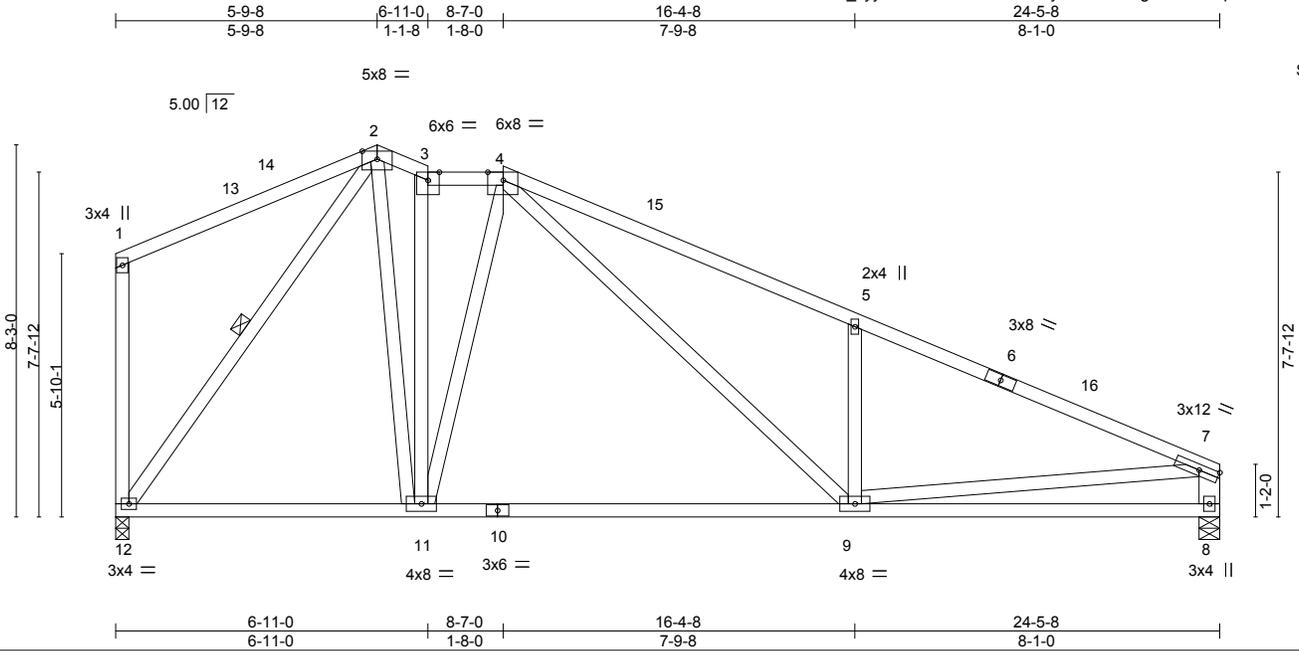

Scale = 1:50.8

Plate Offsets (X,Y)--	[4:0-4-2,Edge]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.61	Vert(LL)	-0.16	9-11	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.60	Vert(CT)	-0.34	9-11	>848
BCLL 0.0	Rep Stress Incr	YES	WB 0.53	Horz(CT)	0.02	8	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 127 lb
							FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2 *Except* 7-8: 2x6 SPF No.2	WEBS 1 Row at midpt 2-12

REACTIONS.	(size) 12=0-3-8, 8=0-5-8
	Max Horz 12=-210(LC 8)
	Max Uplift 12=-138(LC 13), 8=-163(LC 13)
	Max Grav 12=1084(LC 1), 8=1084(LC 1)

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-710/229, 3-4=-707/223, 4-5=-1698/388, 5-7=-1704/263, 7-8=-1009/191
BOT CHORD	11-12=-20/617, 9-11=-62/826, 8-9=-84/345
WEBS	2-11=-149/826, 4-11=-528/200, 4-9=-244/902, 5-9=-578/261, 2-12=-1028/200, 7-9=-117/1146

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 5-9-8, Exterior(2E) 5-9-8 to 6-11-0, Interior(1) 6-11-0 to 8-7-0, Exterior(2R) 8-7-0 to 11-7-0, Interior(1) 11-7-0 to 24-2-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 138 lb uplift at joint 12 and 163 lb uplift at joint 8.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20,2021

Job 2742340	Truss C8	Truss Type Roof Special Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	145732345
----------------	-------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:29 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-9a8mk8Hsl7YWCJZNfbAGz5UrZ9l2?gjpZAGWzyp4fS

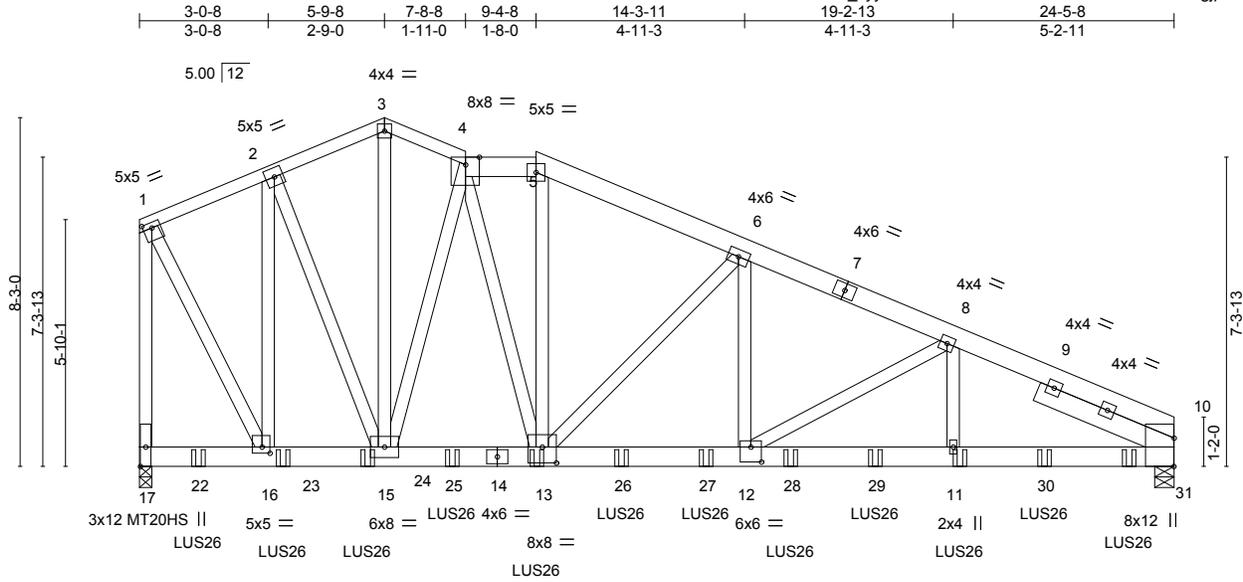

Scale = 1:54.2

Plate Offsets (X,Y)--	[1:0-2-8,0-1-8], [4:0-3-14,Edge], [10:0-8-1,Edge], [12:0-3-0,0-4-4], [13:0-4-0,0-4-8], [16:0-2-4,0-1-12]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.59	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.63	Vert(LL) -0.14 11-12 >999 240	MT20HS	148/108
BCLL 0.0	Lumber DOL 1.15	WB 0.74	Vert(CT) -0.25 11-12 >999 180		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.06 10 n/a n/a		
	Code IRC2018/TPI2014			Weight: 345 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SPF No.2 *Except* 1-3,3-4: 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 4-6-12 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.
BOT CHORD 2x6 SPF 2100F 1.8E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	
SLIDER Right 2x6 SPF No.2 -t 3-6-0	

REACTIONS. (size) 17=0-3-8, 10=0-5-8
 Max Horz 17=-201(LC 6)
 Max Uplift 17=-951(LC 9), 10=-882(LC 9)
 Max Grav 17=5452(LC 1), 10=5418(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-2371/480, 2-3=-3374/686, 3-4=-3388/685, 4-5=-4733/926, 5-6=-5202/976,
 6-8=-7460/1310, 8-10=-8610/1454, 1-17=-5055/910
 BOT CHORD 15-16=-263/2143, 13-15=-581/4078, 12-13=-1092/6892, 11-12=-1249/7709,
 10-11=-1249/7709
 WEBS 2-16=-2870/507, 2-15=-460/2542, 3-15=-479/2380, 4-15=-3692/728, 4-13=-481/2582,
 5-13=-227/1404, 6-13=-3080/565, 6-12=-383/2588, 8-12=-959/181, 8-11=-162/1386,
 1-16=-794/4557

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 951 lb uplift at joint 17 and 882 lb uplift at joint 10.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Use Simpson Strong-Tie LUS26 (4-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent spaced at 4-0-0 oc max. starting at 11-4-12 to connect truss(es) to front face of bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss C8	Truss Type Roof Special Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	I45732345
----------------	-------------	-----------------------------------	----------	-----------------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:29 2021 Page 2
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-9a8mk8Hsl7YWCJZNfbAGz5Urz9I2?gjpZAGWzyzP4fS

NOTES-

- 12) Use Simpson Strong-Tie LUS26 (4-10d Girder, 4-10d Truss) or equivalent at 7-4-12 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
- 13) Use Simpson Strong-Tie LUS26 (4-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 13-4-12 from the left end to 21-4-12 to connect truss(es) to front face of bottom chord.
- 14) Use Simpson Strong-Tie LUS26 (4-10d Girder, 3-10d Truss, Single Ply Girder) or equivalent at 23-4-12 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
- 15) Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-3=-70, 3-4=-70, 4-5=-70, 5-10=-70, 17-18=-20

Concentrated Loads (lb)

Vert: 13=-727(F) 11=-727(F) 22=-736(F) 23=-727(F) 24=-727(F) 25=-763(F) 26=-727(F) 27=-727(F) 28=-727(F) 29=-727(F) 30=-723(F) 31=-646(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss CJ1	Truss Type Jack-Open	Qty 2	Ply 1	Roeser/1487 Winterset 145732346
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:29 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-9a8mk8Hsl7YWCJZNfbAGz5Urf9s0?rLpZAGWzyp4fS

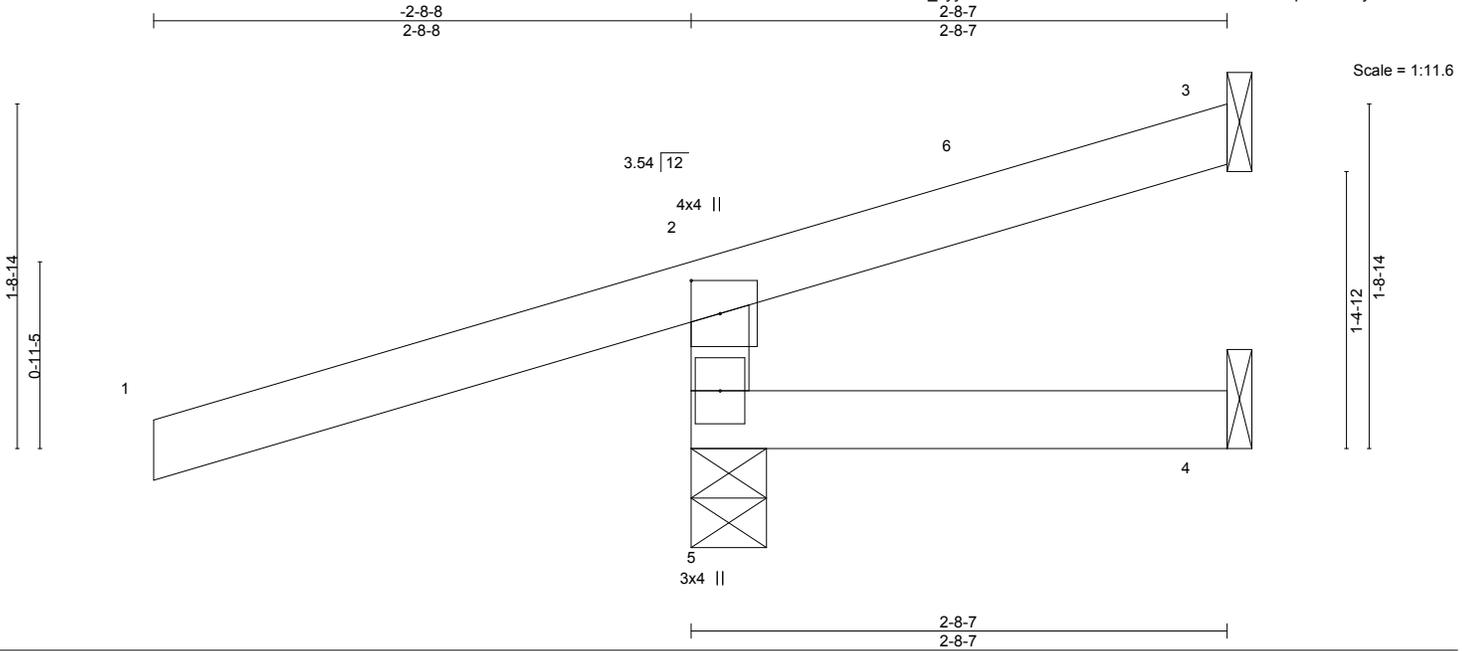

Scale = 1:11.6

Plate Offsets (X,Y)--	[2:0-2-0,0-1-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.58	Vert(LL) 0.01 4-5 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.18	Vert(CT) 0.01 4-5 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.01 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MR		Weight: 10 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-8-7 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=0-4-9, 3=Mechanical, 4=Mechanical
 Max Horz 5=58(LC 8)
 Max Uplift 5=-171(LC 8), 3=-14(LC 12), 4=-11(LC 1)
 Max Grav 5=427(LC 1), 3=10(LC 22), 4=36(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-366/339

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -2-8-8 to 1-6-6, Exterior(2R) 1-6-6 to 2-7-11 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 171 lb uplift at joint 5, 14 lb uplift at joint 3 and 11 lb uplift at joint 4.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

Job 2742340	Truss CJ2	Truss Type Jack-Open	Qty 1	Ply 1	Roeser/1487 Winterset 145732347
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:36 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-Sw3QCXNFfHQWXOckZZovmZH2u_Ff804rAmTOjz2P4fl

2-8-6
2-8-6

2-8-8
2-8-8

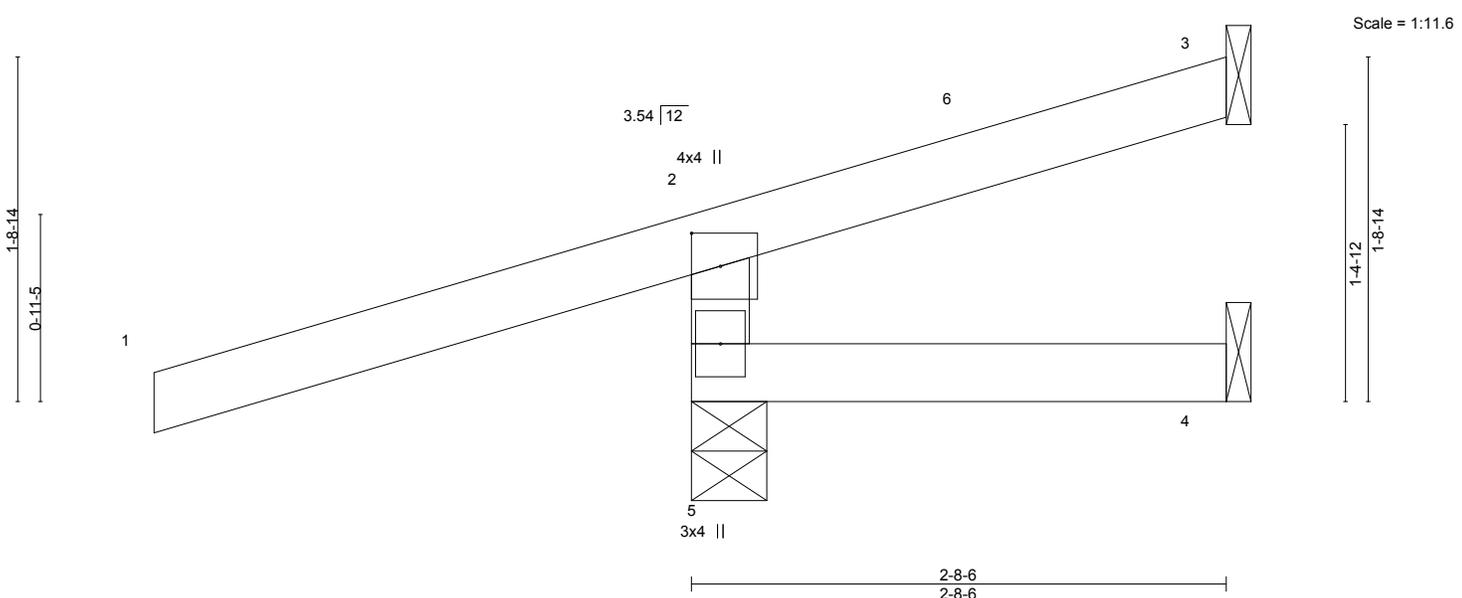


Plate Offsets (X,Y)--	[2:0-2-0,0-1-12]
-----------------------	------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.58	Vert(LL)	0.01	4-5	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	0.01	4-5	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	3	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MR						
								Weight: 10 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-8-6 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=0-4-9, 3=Mechanical, 4=Mechanical
 Max Horz 5=58(LC 8)
 Max Uplift 5=-171(LC 8), 3=-14(LC 12), 4=-11(LC 1)
 Max Grav 5=427(LC 1), 3=10(LC 22), 4=36(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-366/339

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -2-8-8 to 1-6-6, Exterior(2R) 1-6-6 to 2-7-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 171 lb uplift at joint 5, 14 lb uplift at joint 3 and 11 lb uplift at joint 4.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

Job 2742340	Truss CJ3	Truss Type Jack-Open	Qty 2	Ply 1	Roeser/1487 Winterset 145732348
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:37 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-w6doPtNtQaYN9XAw7HJ8InqDeOaStTK?QCxFUzP4fk



Scale: 1"=1'

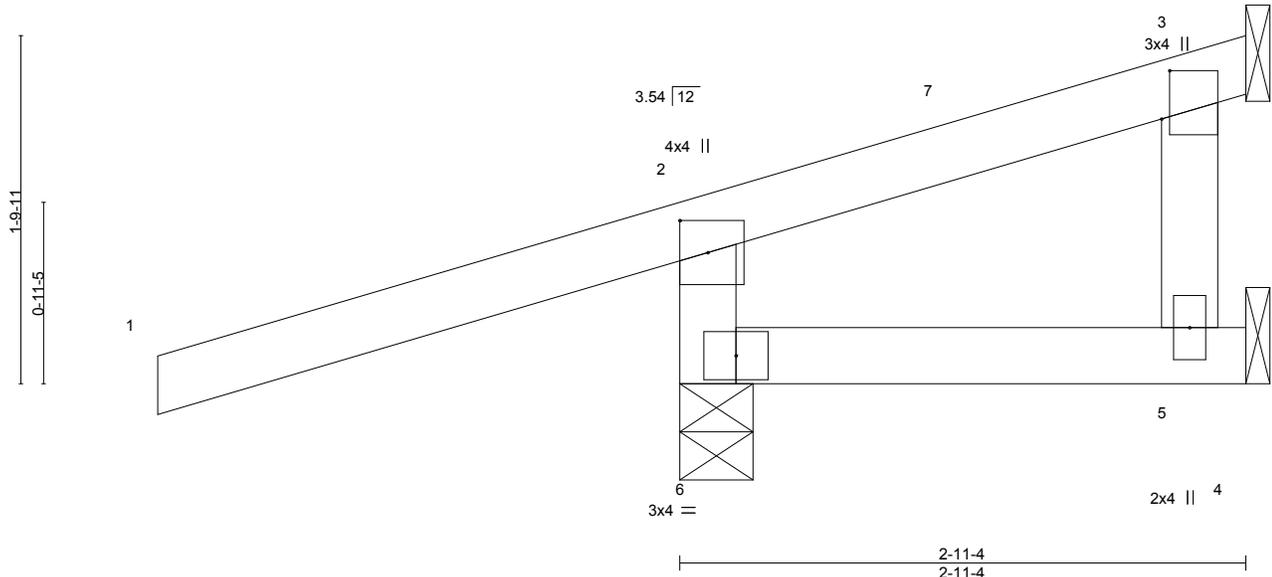


Plate Offsets (X, Y)--	[2:0-2-0,0-1-12], [3:0-3-0,0-0-8]
------------------------	-----------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.58	Vert(LL)	0.01	5-6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.21	Vert(CT)	0.01	5-6	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.02	3	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP						
								Weight: 12 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-11-4 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-4-9, 5=Mechanical, 3=Mechanical
 Max Horz 6=55(LC 8)
 Max Uplift 6=-172(LC 8), 5=-10(LC 25), 3=-48(LC 25)
 Max Grav 6=426(LC 1), 5=49(LC 3), 3=10(LC 22)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-366/339

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -2-8-8 to 1-6-6, Exterior(2R) 1-6-6 to 2-7-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 172 lb uplift at joint 6, 10 lb uplift at joint 5 and 48 lb uplift at joint 3.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.





April 20,2021

Job 2742340	Truss CJ4	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732349
----------------	--------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:38 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-PIBAdDOWBugEnh16h_qNr_MM2ouxcw68d4yVnwzP4fJ

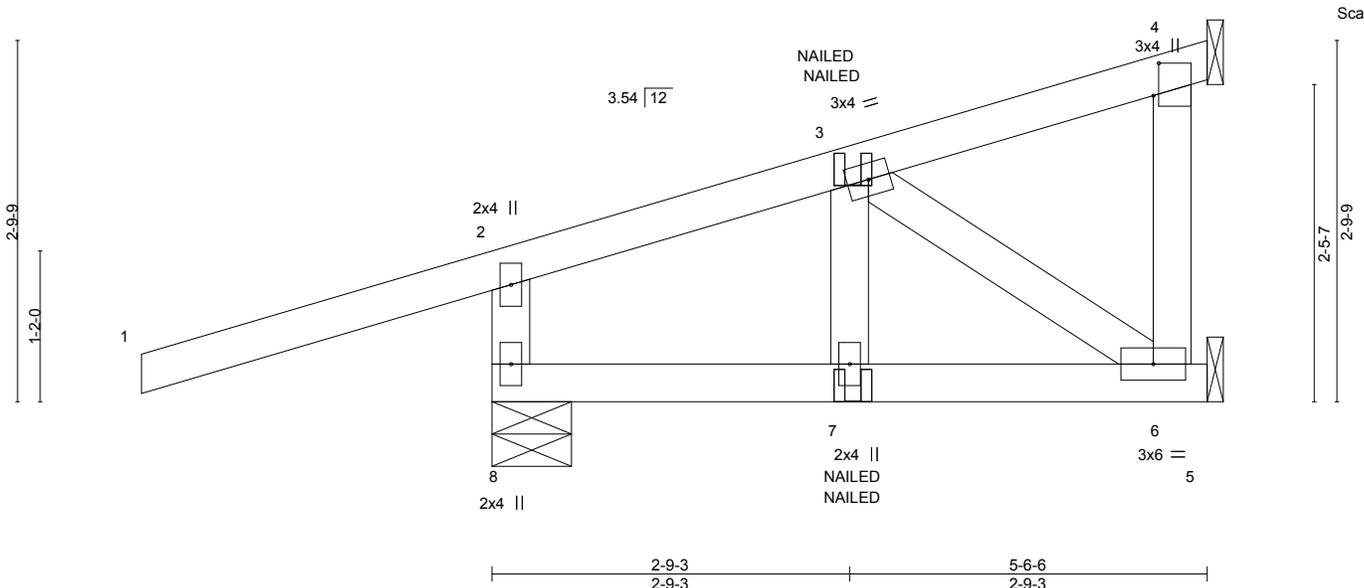

Scale = 1:17.7

Plate Offsets (X,Y)--	[4:0-3-0,0-0-8]
-----------------------	-----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.67	Vert(LL)	-0.08	7	>753	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.26	Vert(CT)	-0.08	7	>734		
BCLL 0.0	Rep Stress Incr	NO	WB 0.03	Horz(CT)	-0.08	4	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP						
								Weight: 24 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 5-6-6 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 8=0-7-6, 6=Mechanical, 4=Mechanical
 Max Horz 8=83(LC 4)
 Max Uplift 8=-155(LC 4), 6=-25(LC 5), 4=-19(LC 8)
 Max Grav 8=452(LC 1), 6=68(LC 3), 4=106(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-8=-419/194

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 155 lb uplift at joint 8, 25 lb uplift at joint 6 and 19 lb uplift at joint 4.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
 - 8) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-4=-70, 5-8=-20
Concentrated Loads (lb)
Vert: 3=70(F=35, B=35)




April 20, 2021

Job 2742340	Truss CJ5	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732350
----------------	--------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:39 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-tVIYqZP8yCo5OrKIFiLcNCvXnBGaLnlqsk2KMzP4fi



NAILED

Scale = 1:21.1

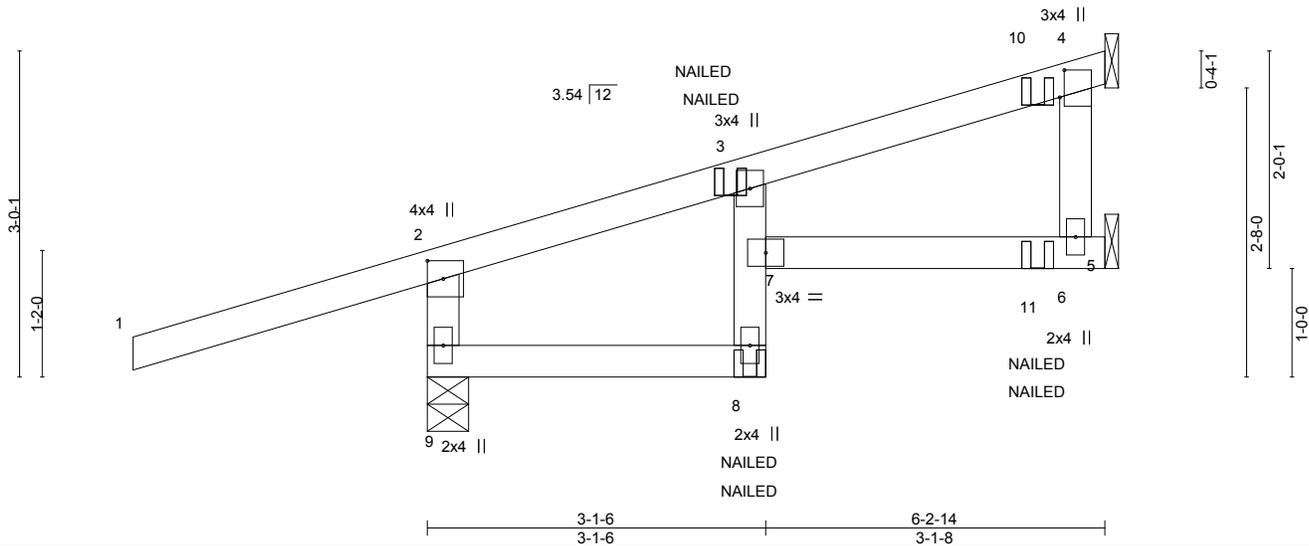


Plate Offsets (X,Y)--	[2:0-2-0,0-1-12], [4:0-3-0,0-0-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.67	Vert(LL) -0.05 7 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.17	Vert(CT) -0.07 8 >964 180		
BCLL 0.0	Rep Stress Incr NO	WB 0.00	Horz(CT) 0.02 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS		Weight: 22 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. Except: 6-0-0 oc bracing: 8-9.

REACTIONS. (size) 9=0-4-9, 6=Mechanical, 4=Mechanical
Max Horz 9=90(LC 4)
Max Uplift 9=-160(LC 4), 6=-35(LC 9), 4=-86(LC 9)
Max Grav 9=480(LC 1), 6=109(LC 3), 4=179(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-9=-424/171

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 160 lb uplift at joint 9, 35 lb uplift at joint 6 and 86 lb uplift at joint 4.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
 - 8) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-2=-70, 2-4=-70, 8-9=-20, 5-7=-20
Concentrated Loads (lb)
Vert: 3=70(F=35, B=35) 10=-54(F=-27, B=-27) 11=-35(F=-17, B=-17)



April 20,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job 2742340	Truss CJ7	Truss Type Jack-Open	Qty 1	Ply 1	Roeser/1487 Winterset 145732352
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:40 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-Lhix2vQmjVwy0?vVoPsrwPSjtbC4p3R4ORcspzP4fH

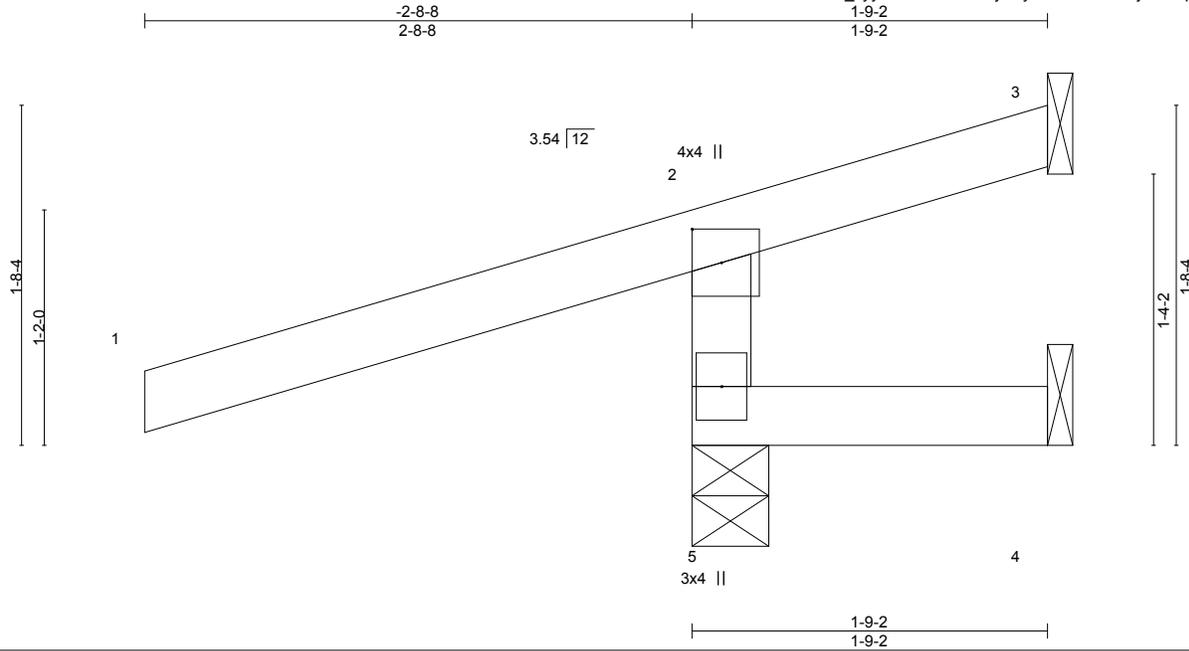

Scale = 1:11.4

Plate Offsets (X,Y)--	[2:0-2-0,0-1-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.58	Vert(LL) 0.00 4-5 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.14	Vert(CT) 0.00 4-5 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.02 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MR		Weight: 8 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 1-9-2 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=0-4-9, 3=Mechanical, 4=Mechanical
 Max Horz 5=45(LC 9)
 Max Uplift 5=-191(LC 8), 3=-75(LC 1), 4=-31(LC 1)
 Max Grav 5=450(LC 1), 3=40(LC 8), 4=19(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-387/367

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 191 lb uplift at joint 5, 75 lb uplift at joint 3 and 31 lb uplift at joint 4.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20,2021

Job 2742340	Truss CJ8	Truss Type Jack-Open	Qty 2	Ply 1	Roeser/1487 Winterset 145732353
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:40 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-LhIx2vQmjVvy0?vVoPsrwPSjtbcR4p3R4ORcspzP4fh

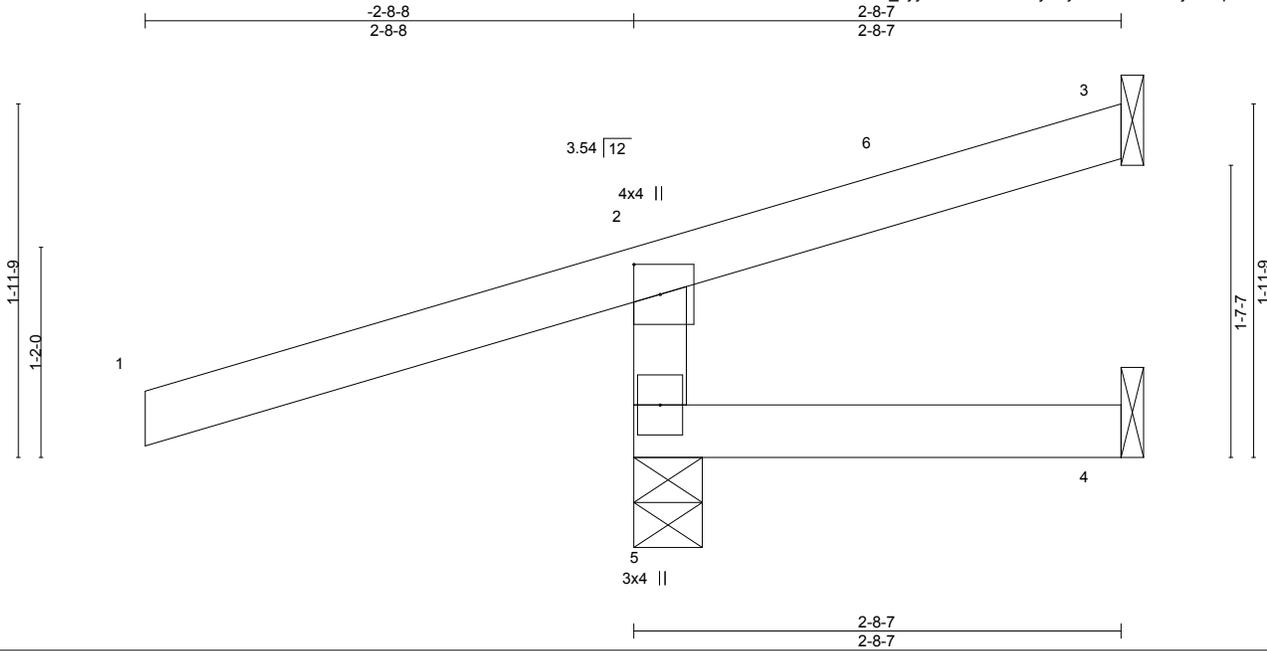


Plate Offsets (X,Y)--	[2:0-2-0,0-1-12]
-----------------------	------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.58	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.17	Vert(LL) 0.01 4-5 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Vert(CT) 0.01 4-5 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR	Horz(CT) -0.02 3 n/a n/a		
	Code IRC2018/TPI2014			Weight: 10 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-8-7 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=0-4-9, 3=Mechanical, 4=Mechanical
 Max Horz 5=54(LC 8)
 Max Uplift 5=-166(LC 8), 3=-16(LC 12), 4=-8(LC 1)
 Max Grav 5=427(LC 1), 3=8(LC 22), 4=37(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-369/337

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -2-8-8 to 1-6-6, Exterior(2R) 1-6-6 to 2-7-11 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 166 lb uplift at joint 5, 16 lb uplift at joint 3 and 8 lb uplift at joint 4.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.




April 20, 2021

Job 2742340	Truss CJ9	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732354
----------------	--------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:41 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPft9-ptsJFEQOU2pe9Uhm7O4Td_th?yOpGOaJ2A9OFzP4fG

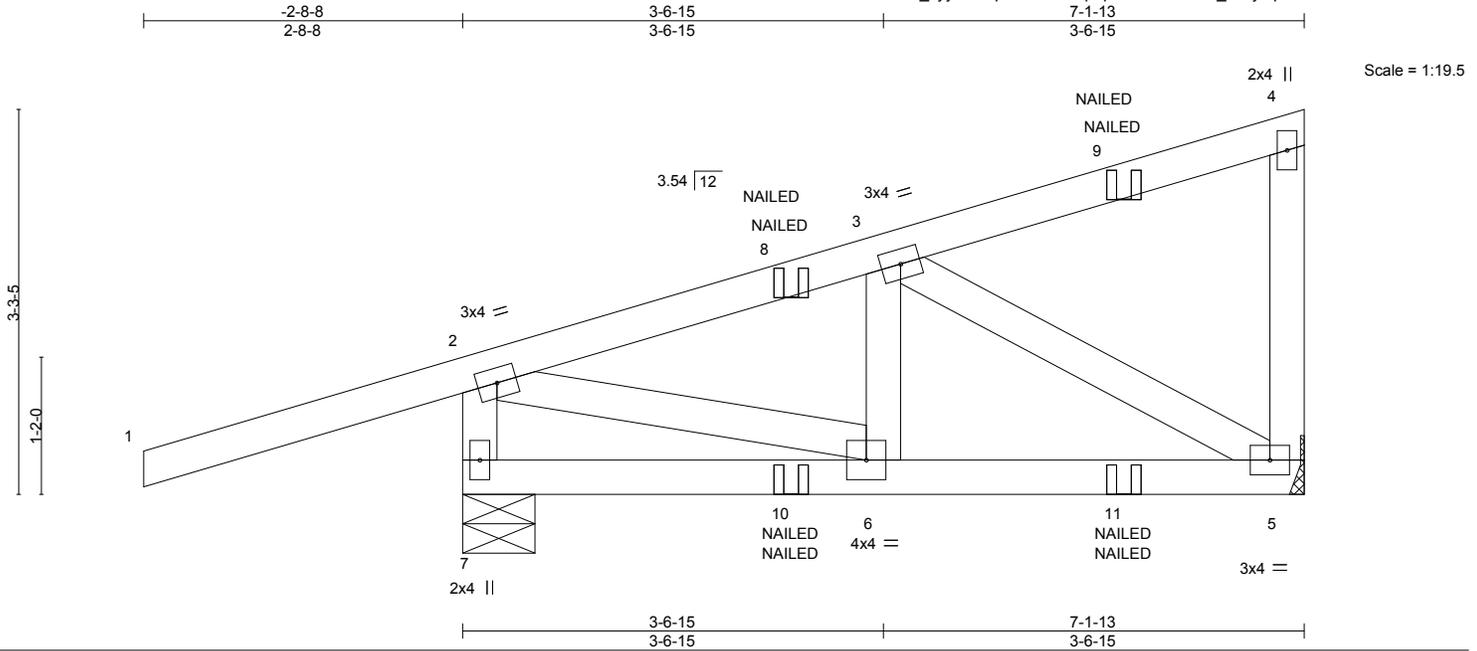

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.67	Vert(LL)	-0.01 5-6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	-0.01 5-6	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.06	Horz(CT)	-0.00 5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP					Weight: 33 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 7=0-7-6, 5=Mechanical
 Max Horz 7=102(LC 4)
 Max Uplift 7=-166(LC 4), 5=-90(LC 5)
 Max Grav 7=509(LC 1), 5=248(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-7=-483/169, 2-3=-267/70

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 166 lb uplift at joint 7 and 90 lb uplift at joint 5.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-4=-70, 5-7=-20
 Concentrated Loads (lb)
 Vert: 8=70(F=35, B=35) 9=-3(F=-2, B=-2) 11=-7(F=-3, B=-3)



April 20, 2021

Job 2742340	Truss CJ10	Truss Type Jack-Open	Qty 1	Ply 1	Roeser/1487 Winterset 145732355
----------------	---------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:30 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-emi9xUIU3RgNpT8aDjVW10PZCSklbnzq04VOzP4fR



Scale = 1:13.1

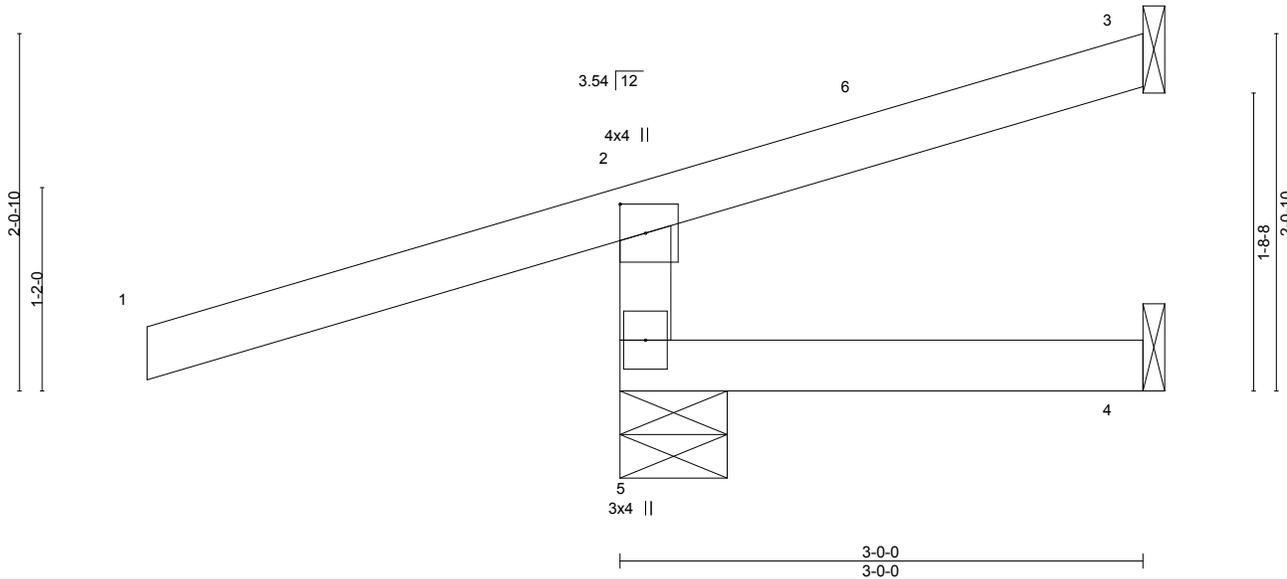


Plate Offsets (X,Y)--	[2:0-2-0,0-1-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.58	Vert(LL) 0.01 4-5 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.17	Vert(CT) 0.01 4-5 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.02 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MR		Weight: 11 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=0-7-6, 3=Mechanical, 4=Mechanical
 Max Horz 5=58(LC 8)
 Max Uplift 5=-162(LC 8), 3=-22(LC 12), 4=-1(LC 1)
 Max Grav 5=428(LC 1), 3=25(LC 1), 4=43(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-371/337

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -2-8-8 to 1-6-6, Exterior(2R) 1-6-6 to 2-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 162 lb uplift at joint 5, 22 lb uplift at joint 3 and 1 lb uplift at joint 4.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

Job 2742340	Truss CJ11	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Roeser/1487 Winterset 145732356
----------------	---------------	-----------------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:31 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-6yGX9qJ7qkoERcjmnoCk3WaDXzVwTlr60Uld2qzP4fQ



Scale = 1:23.4

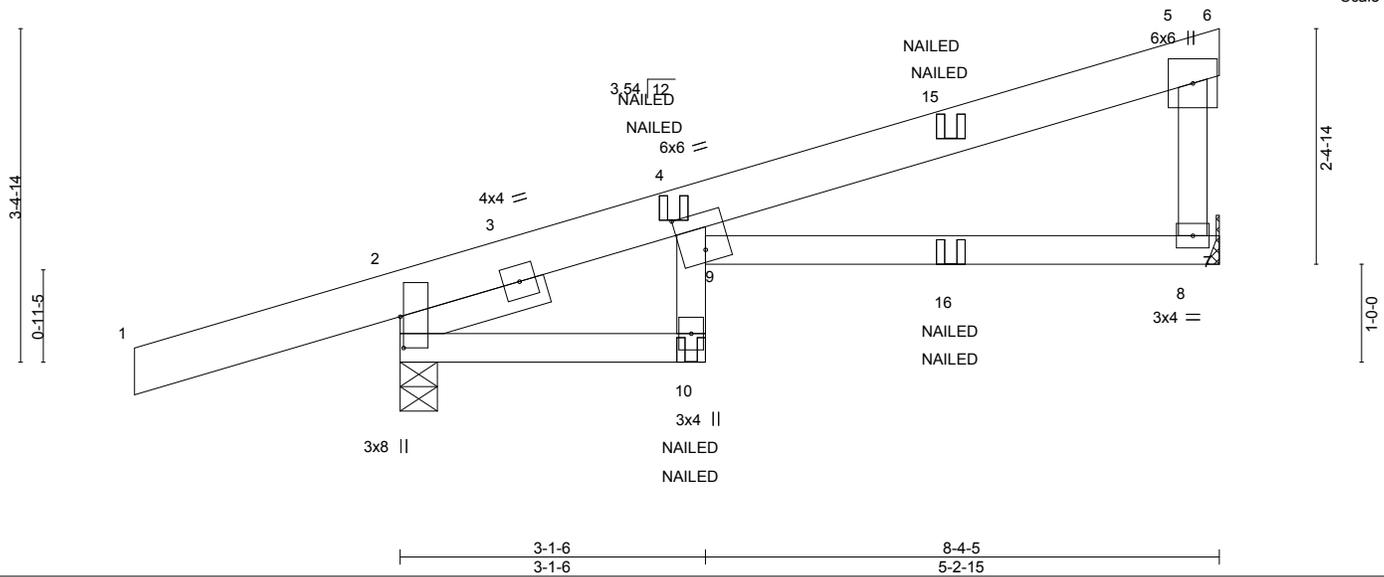


Plate Offsets (X,Y)--	[2:0-3-13,0-0-7], [4:0-3-0,0-4-8]
-----------------------	-----------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.49	Vert(LL)	0.07	8-9	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.35	Vert(CT)	-0.11	8-9	>875		
BCLL 0.0	Rep Stress Incr	NO	WB 0.00	Horz(CT)	0.04	8	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						
								Weight: 35 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 -t 1-6-14	

REACTIONS. (size) 8=Mechanical, 2=0-4-9
 Max Horz 2=104(LC 5)
 Max Uplift 8=-98(LC 8), 2=-181(LC 4)
 Max Grav 8=339(LC 21), 2=568(LC 21)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 98 lb uplift at joint 8 and 181 lb uplift at joint 2.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-5=-70, 5-6=-20, 10-11=-20, 7-9=-20
 Concentrated Loads (lb)
 Vert: 4=142(F=71, B=71) 15=-11(F=-6, B=-6) 16=-21(F=-10, B=-10)




April 20, 2021

Job 2742340	Truss CJ13	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732358
----------------	---------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:33 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-2LNHZVKNMM2xgwt9uREC8xfWInCQxeHPToEK6jzP4fO



Scale = 1:19.0

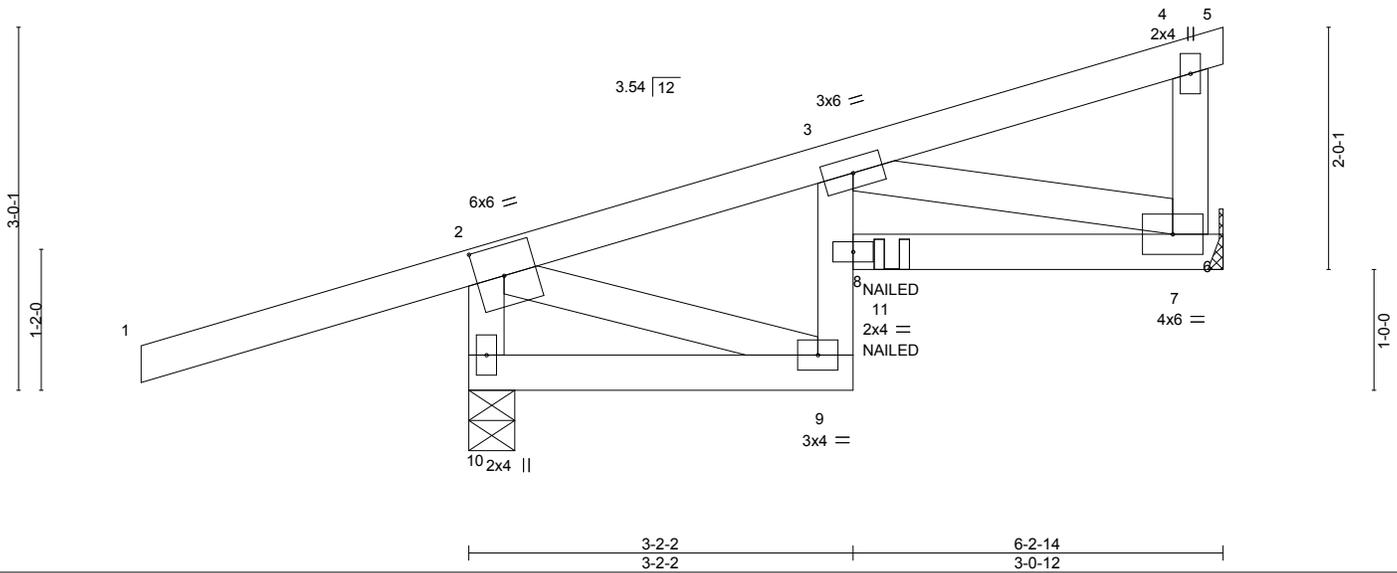


Plate Offsets (X,Y)--	[2:0-2-12,0-3-0]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.67	Vert(LL)	-0.01	8	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.22	Vert(CT)	-0.02	8	>999
BCLL 0.0	Rep Stress Incr	NO	WB 0.07	Horz(CT)	0.01	7	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 28 lb
							FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SPF No.2		

REACTIONS. (size) 10=0-4-9, 7=Mechanical
 Max Horz 10=101(LC 5)
 Max Uplift 10=-190(LC 4), 7=-82(LC 8)
 Max Grav 10=511(LC 1), 7=224(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-10=-490/206
 BOT CHORD 7-8=-165/327
 WEBS 2-9=-79/279, 3-7=-302/170

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 190 lb uplift at joint 10 and 82 lb uplift at joint 7.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)
 Vert: 1-2=-70, 2-4=-70, 4-5=-20, 9-10=-20, 6-8=-20
 Concentrated Loads (lb)
 Vert: 11=0(F=0, B=0)




April 20,2021

Job 2742340	Truss CJ14	Truss Type Diagonal Hip Girder	Qty 2	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732359
----------------	---------------	-----------------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:34 2021 Page 1
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-WXxfnrL?7fAol4SLS9IRg8Ci8AXig5LYiS_He9zP4fN



Scale = 1:18.2

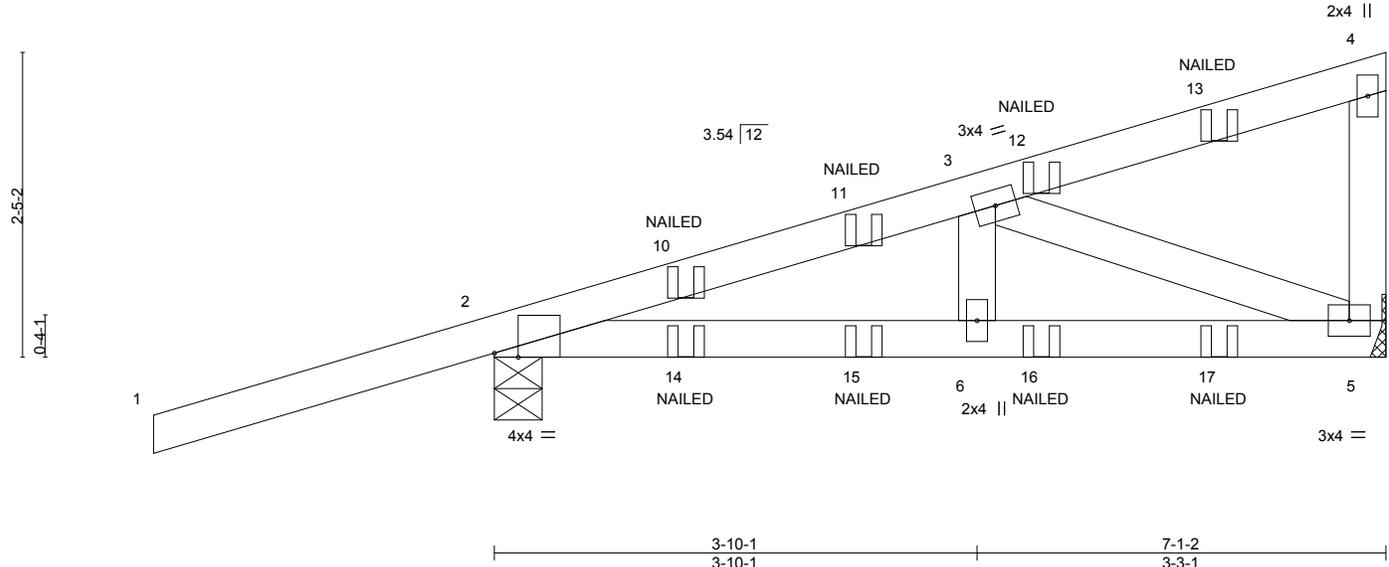


Plate Offsets (X,Y)--	[2:0-2-4,Edge]
-----------------------	----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.60	Vert(LL)	0.02	6-9	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	0.02	6-9	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.08	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP					Weight: 26 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 2=0-4-9, 5=Mechanical
 Max Horz 2=97(LC 27)
 Max Uplift 2=-164(LC 4), 5=-53(LC 8)
 Max Grav 2=481(LC 1), 5=279(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-456/46
 BOT CHORD 2-6=-63/373, 5-6=-63/373
 WEBS 3-5=-413/73

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 164 lb uplift at joint 2 and 53 lb uplift at joint 5.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)
 Vert: 1-4=-70, 5-7=-20

Concentrated Loads (lb)
 Vert: 10=34(F) 13=-14(B) 14=39(F) 15=10(B) 16=1(F) 17=-15(B)




April 20, 2021

Job 2742340	Truss CJ15	Truss Type Jack-Open	Qty 1	Ply 1	Roeser/1487 Winterset 145732360
----------------	---------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:35 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-_jV2_BMduzIfwE1X0sHgDMkxCasFPZqix6jrBbzP4fM

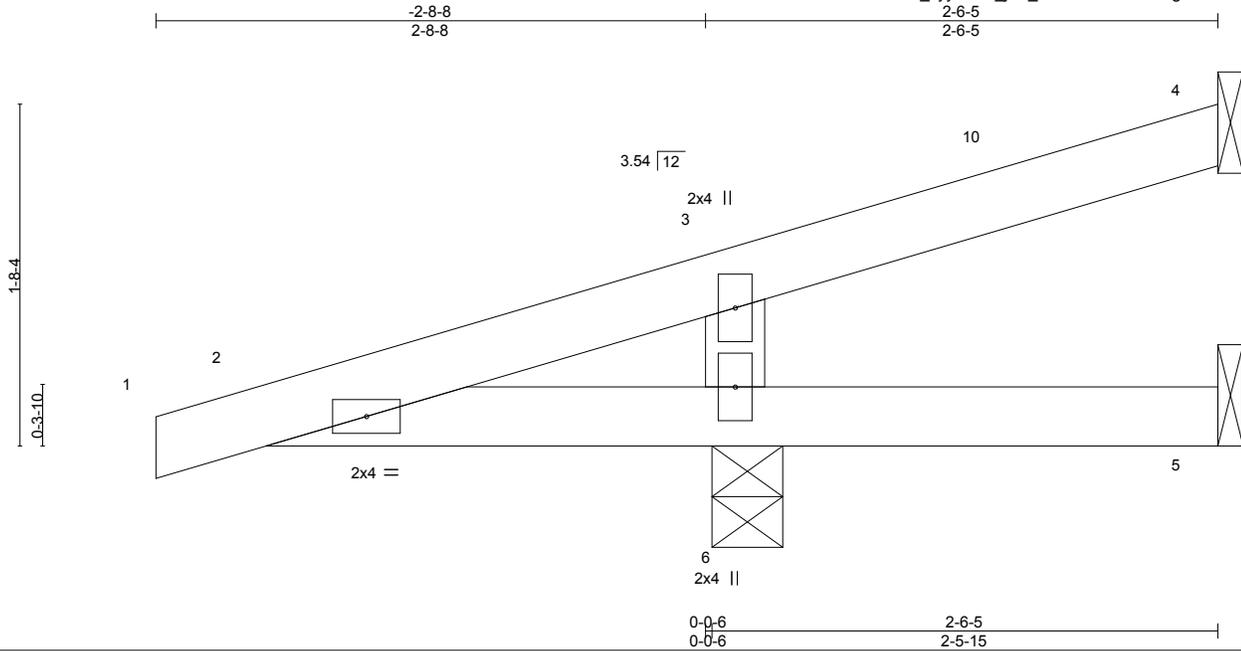

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.32	Vert(LL)	0.01	5-6	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.32	Vert(CT)	0.01	5-6	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.03	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP						
	Code IRC2018/TPI2014						Weight: 12 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-6-5 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-4-3, 4=Mechanical, 5=Mechanical
 Max Horz 6=50(LC 9)
 Max Uplift 6=-165(LC 8), 4=-18(LC 12), 5=-46(LC 1)
 Max Grav 6=497(LC 1), 4=4(LC 1), 5=32(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-6=-304/358

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -2-8-8 to 1-6-6, Exterior(2R) 1-6-6 to 2-5-9 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 165 lb uplift at joint 6, 18 lb uplift at joint 4 and 46 lb uplift at joint 5.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.




April 20, 2021

Job 2742340	Truss CJ16	Truss Type Jack-Open	Qty 1	Ply 1	Roeser/1487 Winterset 145732361
----------------	---------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:35 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-jV2_BMduzIfwE1X0sHgDMkyHasBPYqix6jrBbzP4fM

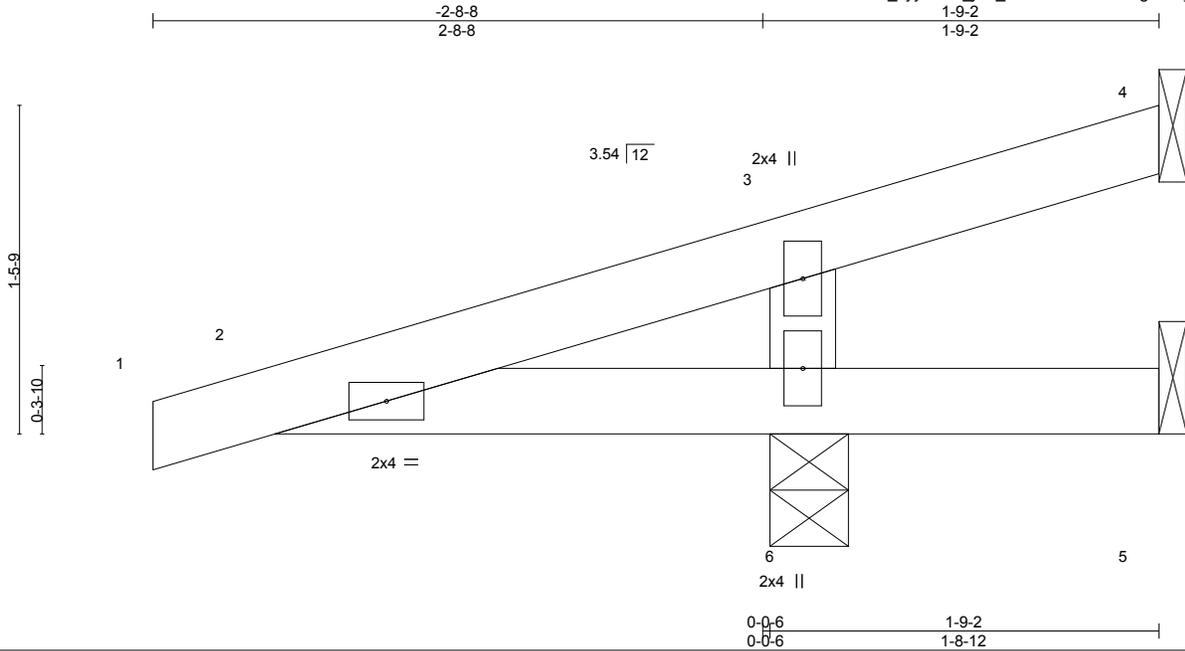

Scale = 1:10.2

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.32	Vert(LL)	-0.01 5-6	>999	240	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.32	Vert(CT)	0.01 5-6	>999	180		
BCLL 0.0	Lumber DOL 1.15	WB 0.06	Horz(CT)	-0.03 4	n/a	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MP						
	Code IRC2018/TPI2014						Weight: 10 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 1-9-2 oc purlins.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 4=Mechanical, 5=Mechanical, 6=0-4-3
 Max Horz 6=50(LC 8)
 Max Uplift 4=-56(LC 1), 5=-94(LC 1), 6=-189(LC 8)
 Max Grav 4=19(LC 8), 5=45(LC 8), 6=541(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 WEBS 3-6=-307/367

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 56 lb uplift at joint 4, 94 lb uplift at joint 5 and 189 lb uplift at joint 6.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss D1	Truss Type Half Hip Girder	Qty 2	Ply 1	Roeser/1487 Winterset 145732362
----------------	-------------	-------------------------------	----------	----------	------------------------------------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:43 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFf9-IG_3gwSe?QJXtSe4UYQYY24lwpcjH8utnMfGT8zP4fE



Scale = 1:20.9

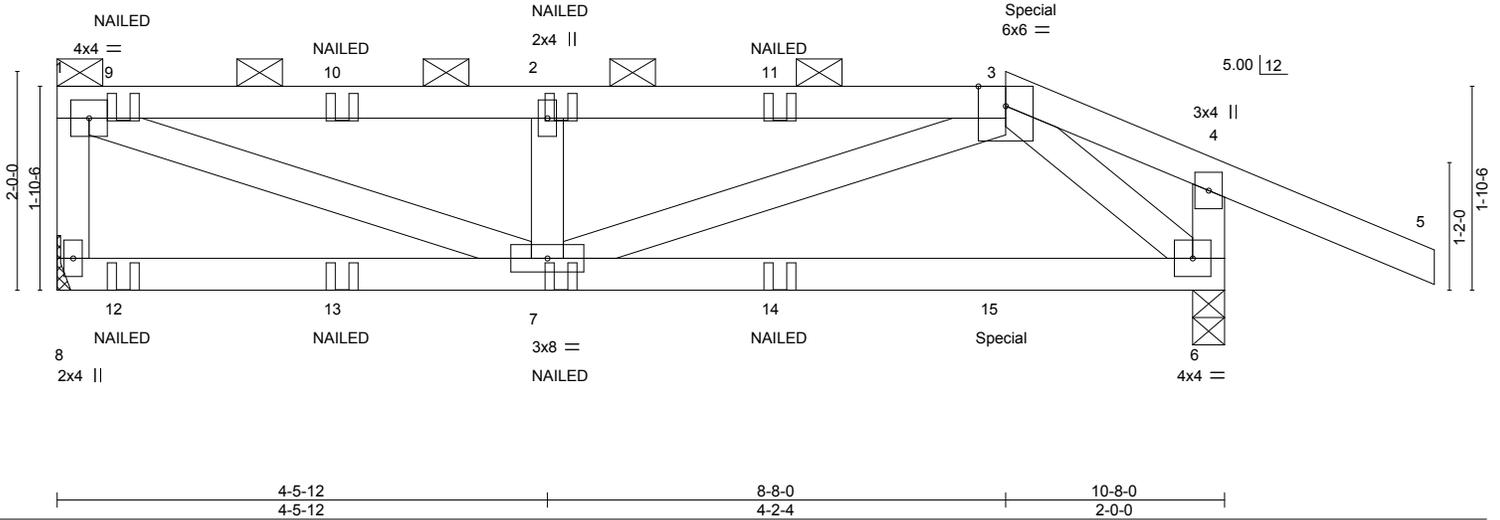

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.04	6-7	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	-0.08	6-7	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.19	Horz(CT)	0.00	6	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					Weight: 43 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-3.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 8=Mechanical, 6=0-3-8
 Max Horz 8=-73(LC 4)
 Max Uplift 8=-108(LC 4), 6=-140(LC 5)
 Max Grav 8=424(LC 21), 6=603(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-8=-397/112, 1-2=-761/176, 2-3=-764/178
 BOT CHORD 6-7=-57/349
 WEBS 1-7=-181/764, 2-7=-344/126, 3-7=-94/450, 3-6=-498/127

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 108 lb uplift at joint 8 and 140 lb uplift at joint 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 73 lb down and 27 lb up at 8-8-0 on top chord, and 29 lb down and 36 lb up at 8-7-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-3=-70, 3-4=-70, 4-5=-70, 6-8=-20
 Concentrated Loads (lb)
 Vert: 7=11(B) 12=11(B) 13=11(B) 14=11(B) 15=11(B)



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 2742340	Truss D2	Truss Type Roof Special	Qty 2	Ply 1	Roeser/1487 Winterset 145732363
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:43 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-IG_3gwSe?QJXtSe4UYQYY24FxcOH79tnMfGT8zP4fE

Job Reference (optional)



Scale = 1:21.7

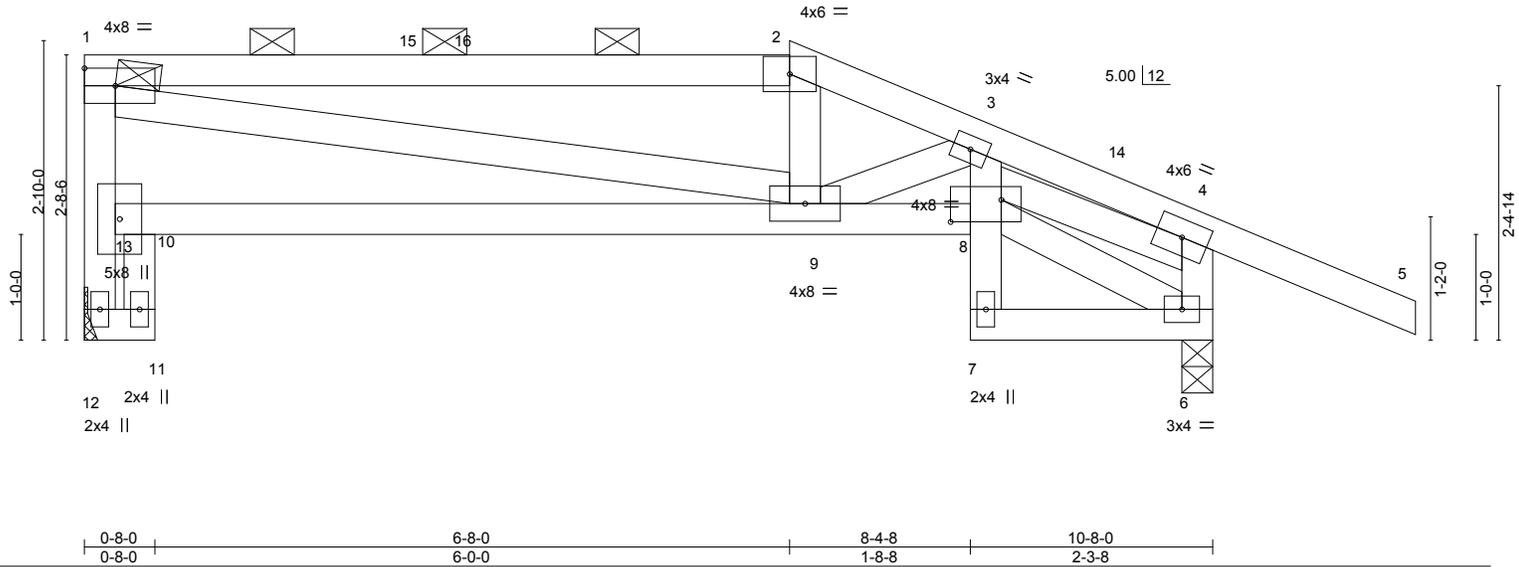

LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.53	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.30	Vert(LL) -0.05 9-10 >999 240		
BCLL 0.0	Rep Stress Incr YES	WB 0.23	Vert(CT) -0.10 9-10 >999 180		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS	Horz(CT) 0.03 6 n/a n/a		
				Weight: 48 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-1-10 max.): 1-2.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 12=Mechanical, 6=0-3-8
 Max Horz 12=-105(LC 8)
 Max Uplift 12=-85(LC 8), 6=-111(LC 9)
 Max Grav 12=453(LC 1), 6=626(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 12-13=-395/108, 1-13=-373/183, 2-3=-880/224, 3-4=-783/194, 4-6=-550/248, 1-2=-860/279
 BOT CHORD 8-9=-95/715
 WEBS 1-9=-298/656, 4-8=-138/706

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 6-8-0, Exterior(2R) 6-8-0 to 9-8-0, Interior(1) 9-8-0 to 12-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to bearing connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 85 lb uplift at joint 12 and 111 lb uplift at joint 6.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021


Job 2742340	Truss D3	Truss Type Roof Special	Qty 2	Ply 1	Roeser/1487 Winterset 145732364
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:44 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-DSYRtGTGmkROVcDG1Fxn4FcUVcyY0bD1?0Pp?azP4fD



Scale = 1:22.5

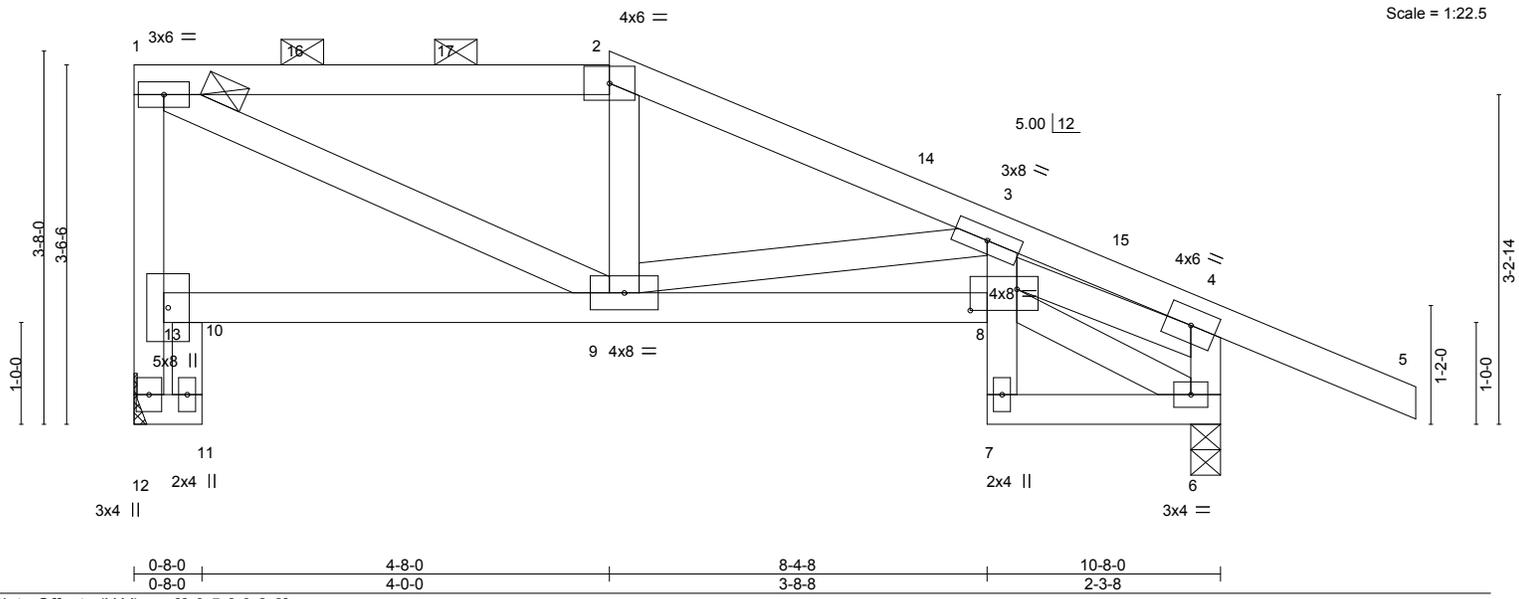


Plate Offsets (X,Y)--	[8:0-5-8,0-2-8]
-----------------------	-----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.02	8-9	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.24	Vert(CT)	-0.04	8-9	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.18	Horz(CT)	0.03	6	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 51 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 12=Mechanical, 6=0-3-8
 Max Horz 12=-138(LC 8)
 Max Uplift 12=-83(LC 8), 6=-104(LC 13)
 Max Grav 12=453(LC 26), 6=626(LC 26)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 12-13=-419/106, 1-13=-405/180, 2-3=-627/179, 3-4=-808/148, 4-6=-542/228, 1-2=-542/192
 BOT CHORD 10-13=-122/267, 9-10=-122/267, 8-9=-118/869
 WEBS 1-9=-228/544, 3-9=-334/182, 10-11=-177/262, 4-8=-130/745

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 4-8-0, Exterior(2R) 4-8-0 to 7-8-0, Interior(1) 7-8-0 to 12-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 83 lb uplift at joint 12 and 104 lb uplift at joint 6.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021


Job 2742340	Truss D4	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732365
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:45 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-hf6q5cUvX2ZE7moSbyS0dT9fFcHkl0mAEg8NX0zP4fC



Scale = 1:26.1

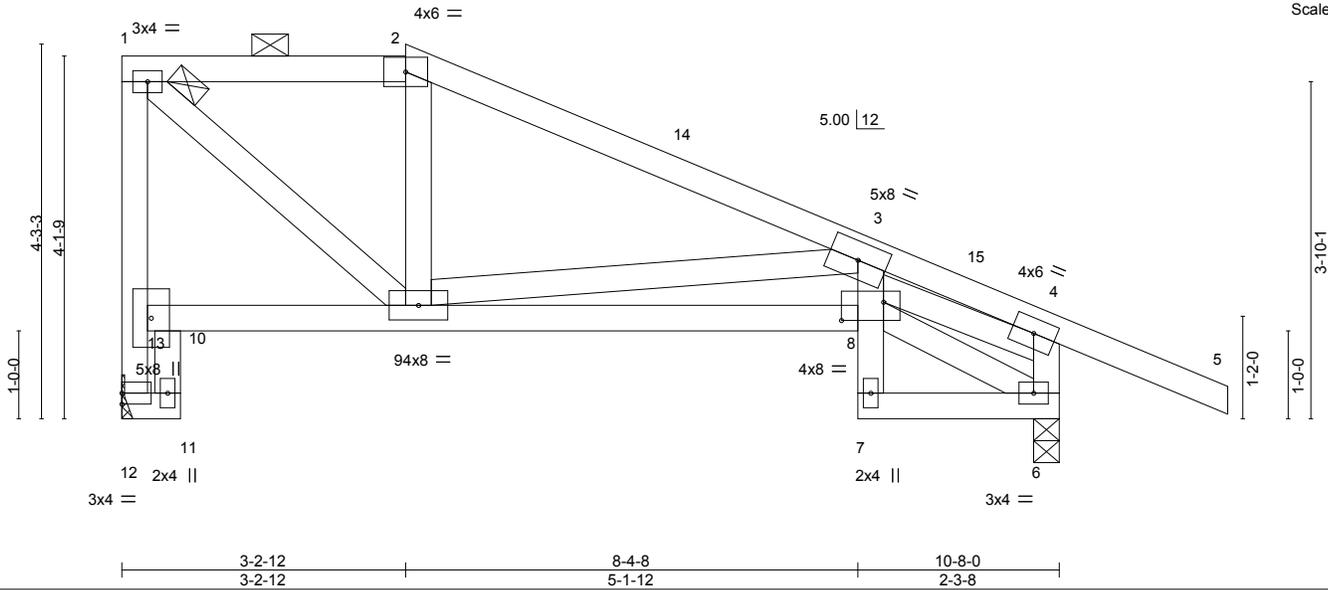



Plate Offsets (X,Y)--	[8:0-5-12,0-2-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.29	Vert(LL) -0.03 8-9 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.31	Vert(CT) -0.06 8-9 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.29	Horz(CT) 0.04 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 53 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 12=Mechanical, 6=0-3-8
 Max Horz 12=-162(LC 8)
 Max Uplift 12=-79(LC 8), 6=-108(LC 13)
 Max Grav 12=453(LC 26), 6=626(LC 26)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 12-13=-431/109, 1-13=-433/162, 2-3=-489/127, 3-4=-826/123, 4-6=-533/211, 1-2=-391/152
 BOT CHORD 10-13=-158/295, 9-10=-158/295, 8-9=-150/997
 WEBS 1-9=-196/513, 3-9=-616/280, 10-11=-204/318, 4-8=-127/778

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-2-12, Exterior(2R) 3-2-12 to 6-2-12, Interior(1) 6-2-12 to 12-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 79 lb uplift at joint 12 and 108 lb uplift at joint 6.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

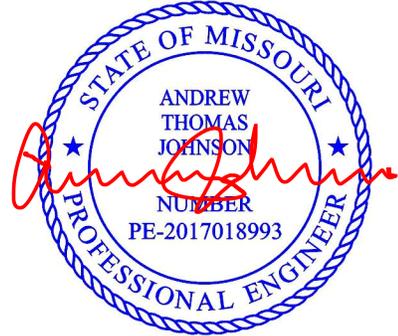


April 20,2021

Job 2742340	Truss E1	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset	145732366
----------------	-------------	----------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:46 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPF19-ArgClyUXILh5kwMf9gzFagiqP0ZOUR5KTKuw4SzP4fB



Scale = 1:36.2

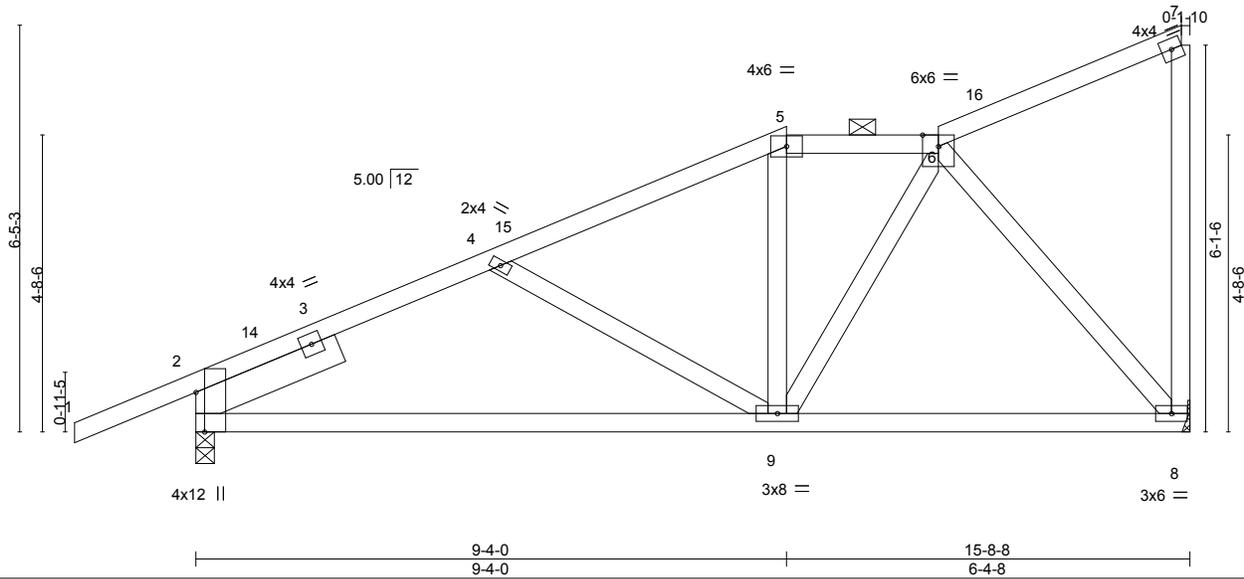


Plate Offsets (X,Y)--	[2:0-7-8,Edge], [7:0-0-1,0-0-0]
-----------------------	---------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.26	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.54	Vert(LL) -0.10 9-12 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.41	Vert(CT) -0.20 9-12 >946 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.02 8 n/a n/a		
	Code IRC2018/TPI2014			Weight: 73 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (6-0-0 max.): 5-6.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 8=Mechanical, 2=0-3-8
 Max Horz 2=247(LC 11)
 Max Uplift 8=-147(LC 12), 2=-143(LC 12)
 Max Grav 8=692(LC 1), 2=843(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-961/181, 4-5=-728/139, 5-6=-621/151
 BOT CHORD 2-9=-356/848, 8-9=-176/451
 WEBS 4-9=-261/151, 6-9=-105/344, 6-8=-675/178

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 9-4-0, Exterior(2E) 9-4-0 to 11-8-13, Interior(1) 11-8-13 to 15-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 147 lb uplift at joint 8 and 143 lb uplift at joint 2.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

Job 2742340	Truss E2	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset 145732367
----------------	-------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:56 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-tmG_ONcoxQxhxS7akm9bZn6W32_4qvQomtJSQtzP4f1



Scale = 1:36.3

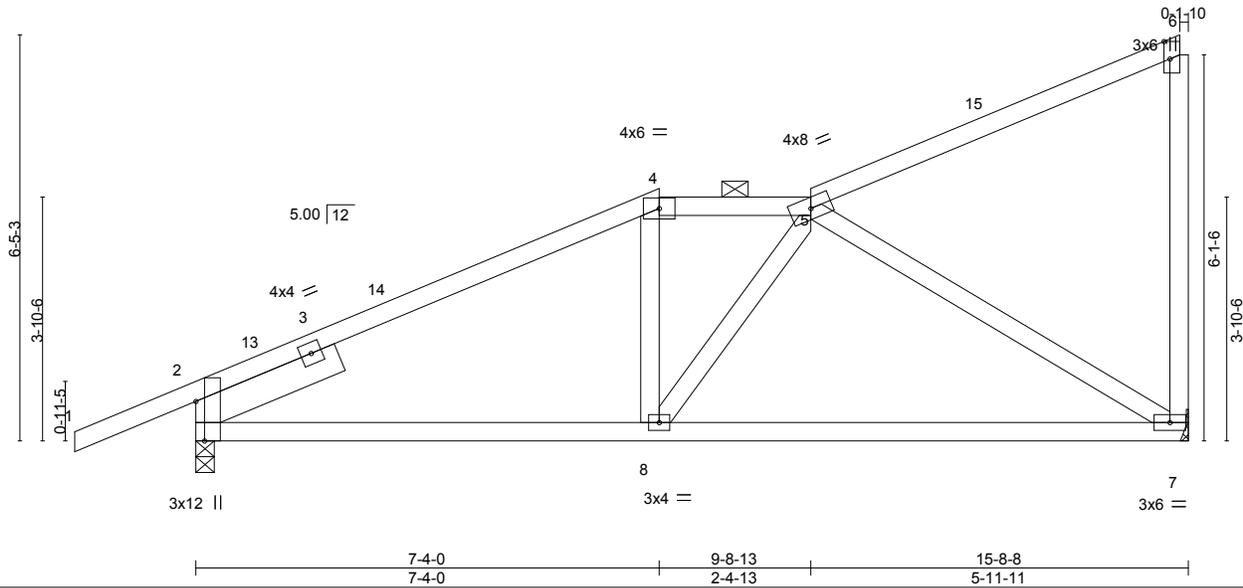


Plate Offsets (X,Y)--	[2:0-7-8,Edge], [6:0-3-5,Edge]
-----------------------	--------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.38	Vert(LL)	-0.13	7-8	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.52	Vert(CT)	-0.26	7-8	>713		
BCLL 0.0	Rep Stress Incr	YES	WB 0.68	Horz(CT)	0.02	7	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 67 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (6-0-0 max.): 4-5.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 7=Mechanical, 2=0-3-8
 Max Horz 2=226(LC 12)
 Max Uplift 7=-168(LC 12), 2=-122(LC 12)
 Max Grav 7=692(LC 1), 2=843(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-923/263, 4-5=-789/125
 BOT CHORD 2-8=-213/791, 7-8=-186/710
 WEBS 5-7=-806/217

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 7-4-0, Exterior(2E) 7-4-0 to 9-8-13, Interior(1) 9-8-13 to 15-6-12 zone; cantilever left and right exposed ; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 168 lb uplift at joint 7 and 122 lb uplift at joint 2.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job 2742340	Truss E3	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732368
----------------	-------------	----------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:58 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-p9Okp2e2T1BOAmHysBB3fCBkBsfnIt45DBoZvmzP4f?

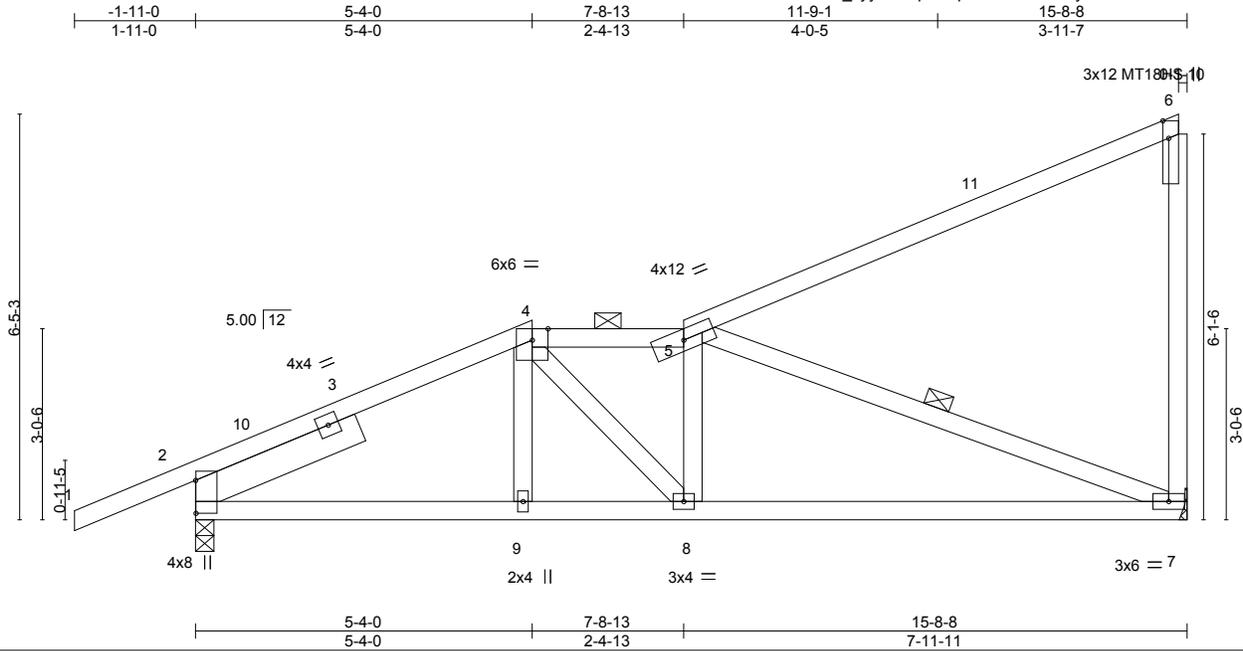


Plate Offsets (X,Y)--	[2:0-6-4,0-0-1], [6:0-3-5,Edge]
-----------------------	---------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.85	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.53	Vert(LL) -0.11 7-8 >999 240	MT18HS	197/144
BCLL 0.0	Lumber DOL 1.15	WB 0.35	Vert(CT) -0.23 7-8 >830 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) 0.02 7 n/a n/a		
	Code IRC2018/TPI2014			Weight: 70 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals, and 2-0-0 oc purlins (5-1-10 max.): 4-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 5-7
SLIDER Left 2x6 SPF No.2 -t 2-10-5	

REACTIONS. (size) 7=Mechanical, 2=0-3-8
 Max Horz 2=229(LC 12)
 Max Uplift 7=-167(LC 12), 2=-122(LC 12)
 Max Grav 7=689(LC 1), 2=843(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-1066/107, 4-5=-1059/115, 6-7=-251/123
 BOT CHORD 2-9=-244/848, 8-9=-245/845, 7-8=-233/1053
 WEBS 5-7=-1081/236, 4-8=0/317

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 5-4-0, Exterior(2E) 5-4-0 to 7-8-13, Interior(1) 7-8-13 to 15-6-3 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) All plates are MT20 plates unless otherwise indicated.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 167 lb uplift at joint 7 and 122 lb uplift at joint 2.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

Job 2742340	Truss E4	Truss Type Half Hip Girder	Qty 1	Ply 1	Roeser/1487 Winterset I45732369 Job Reference (optional)
----------------	-------------	-------------------------------	----------	----------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:00 2021 Page 2
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-IXWUEkfJ?fs6Q4RLzcDXkdH9qfLpmm5NhVHfYzP4ez

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-3=-70, 3-4=-70, 4-7=-70, 13-14=-20, 3-10=-20, 8-9=-20
Concentrated Loads (lb)
Vert: 12=-527(F) 18=-216(F) 19=-216(F) 20=-216(F)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss E5	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset 145732370
----------------	-------------	------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:01 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-Dk4tS4gxmyaz1E0XXJkmGrpGp3f8VGwXv90D45zP4ey



5x5 =

Scale = 1:28.4

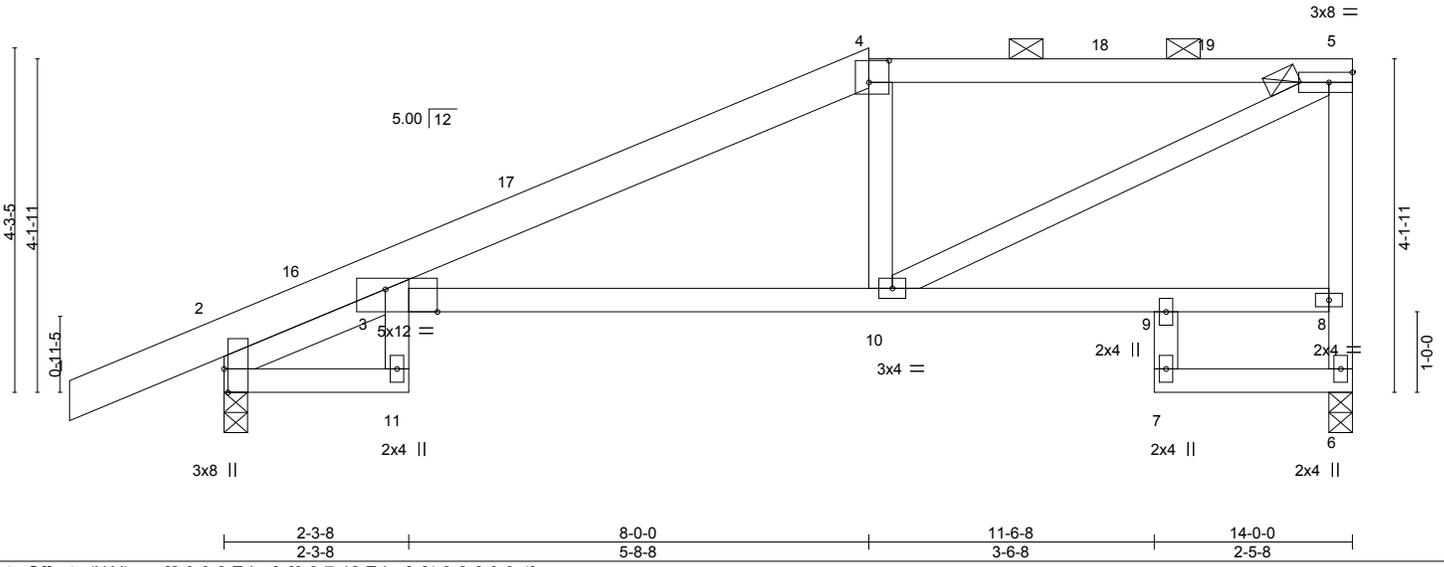


Plate Offsets (X,Y)--	[2:0-3-8,Edge], [3:0-7-12,Edge], [4:0-3-0,0-3-4]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15		TC 0.82	Vert(LL) -0.19	3-10	>859	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.65	Vert(CT) -0.37	3-10	>452	180		
BCLL 0.0	Rep Stress Incr YES		WB 0.21	Horz(CT) 0.23	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 63 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SPF No.2 *Except* 4-5: 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-11-11 max.): 4-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 -t 2-2-11	

REACTIONS. (size) 6=0-3-8, 2=0-3-8
 Max Horz 2=159(LC 11)
 Max Uplift 6=-104(LC 9), 2=-137(LC 12)
 Max Grav 6=614(LC 1), 2=767(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-13=-765/259, 3-4=-912/169, 4-5=-830/206, 6-8=-587/148, 5-8=-570/160
 BOT CHORD 3-10=-292/846
 WEBS 4-10=-268/162, 5-10=-255/872

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 8-0-0, Exterior(2R) 8-0-0 to 12-2-15, Interior(1) 12-2-15 to 13-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 104 lb uplift at joint 6 and 137 lb uplift at joint 2.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job 2742340	Truss E6	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732371
----------------	-------------	------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:01 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-Dk4tS4gxmyaz1E0XXJkmGrpPr3g_VHMXv90D45zP4ey



Scale = 1:33.9

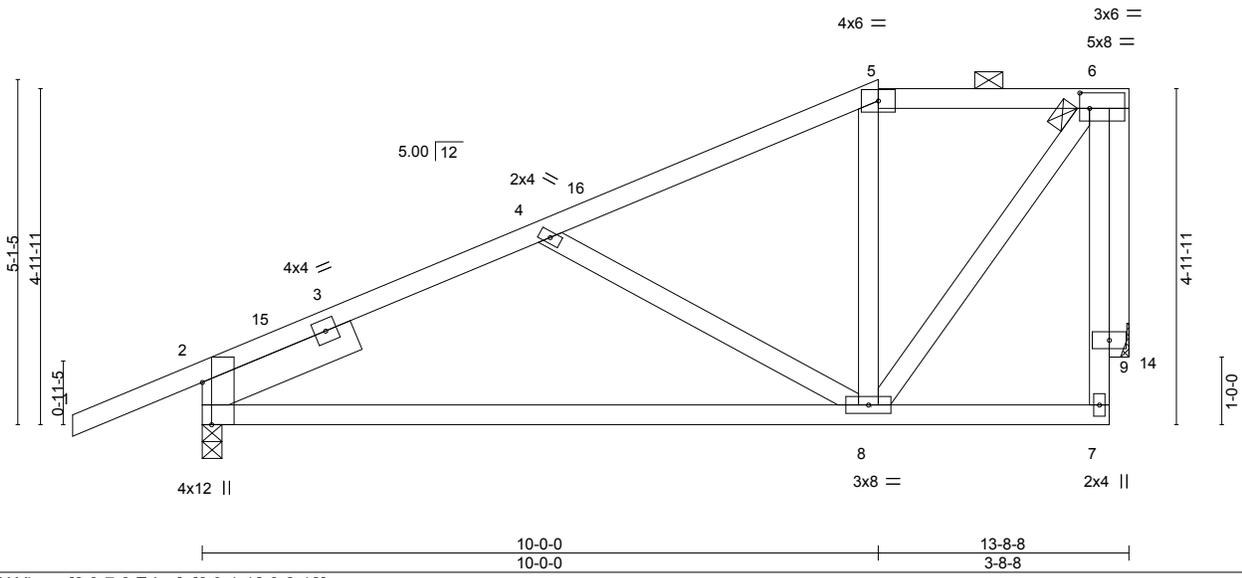


Plate Offsets (X,Y)--	[2:0-7-8,Edge], [6:0-1-12,0-2-12]
-----------------------	-----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.24	Vert(LL) -0.15	8-12	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.60	Vert(CT) -0.29	8-12	>565	180		
BCLL 0.0	Rep Stress Incr YES	WB 0.19	Horz(CT) 0.02	14	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS						
							Weight: 65 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
OTHERS 2x4 SPF No.2	
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 2=0-3-8, 14=Mechanical
 Max Horz 2=159(LC 12)
 Max Uplift 2=-114(LC 12), 14=-87(LC 12)
 Max Grav 2=757(LC 1), 14=571(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-714/144, 4-5=-484/65, 5-6=-393/98
 BOT CHORD 2-8=-253/692
 WEBS 4-8=-350/163, 6-8=-143/575, 6-14=-574/142

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 10-0-0, Exterior(2E) 10-0-0 to 13-3-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 114 lb uplift at joint 2 and 87 lb uplift at joint 14.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job 2742340	Truss E7	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset	145732372
----------------	-------------	----------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:02 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-iweFfQhZXGiqfNbj51G?p2MYVT?uEeDg8pmmdXzP4ex



Scale = 1:36.8

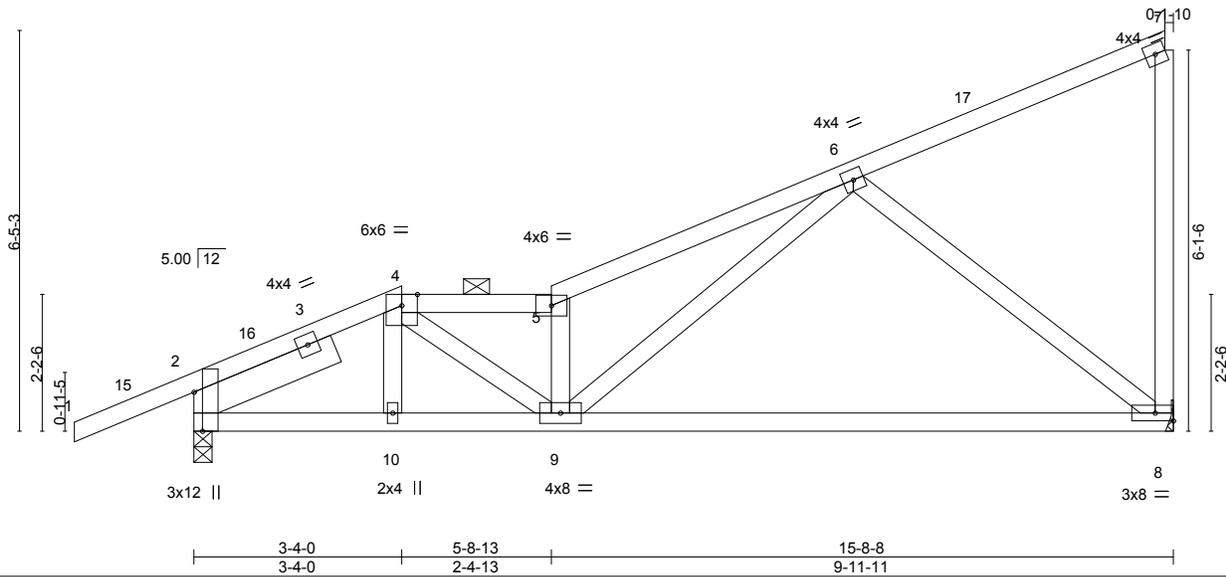


Plate Offsets (X, Y)--	[2:0-7-8, Edge], [7:0-0-1, 0-0-0]
------------------------	-----------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.38	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.68	Vert(LL) -0.23 8-9 >822 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.53	Vert(CT) -0.46 8-9 >402 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.02 8 n/a n/a		
	Code IRC2018/TPI2014			Weight: 72 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-10-12 max.): 4-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 8=Mechanical, 2=0-3-8
 Max Horz 2=247(LC 11)
 Max Uplift 8=-147(LC 12), 2=-143(LC 12)
 Max Grav 8=692(LC 1), 2=843(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-931/156, 4-5=-1370/192, 5-6=-1480/238
 BOT CHORD 2-10=-327/823, 9-10=-325/830, 8-9=-201/593
 WEBS 4-9=-65/681, 5-9=-825/180, 6-9=-124/945, 6-8=-733/218

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 3-4-0, Exterior(2E) 3-4-0 to 5-8-13, Interior(1) 5-8-13 to 15-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 147 lb uplift at joint 8 and 143 lb uplift at joint 2.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20, 2021


Job 2742340	Truss E8	Truss Type Roof Special Girder	Qty 1	Ply 1	Roeser/1487 Winterset 145732373
----------------	-------------	-----------------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:03 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPF19-A6BdsmbBlaqhHXAwfknEMGvgRTNlz27qNTVK9zzP4ew



Scale = 1:36.8

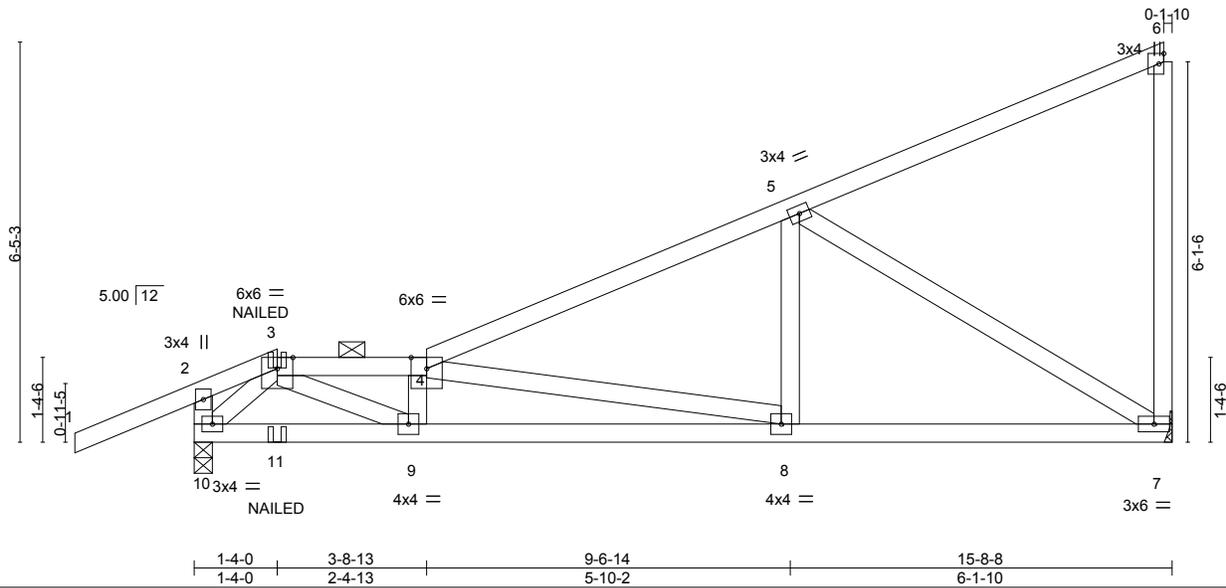

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.56	Vert(LL)	-0.06 8-9	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.54	Vert(CT)	-0.12 8-9	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.75	Horz(CT)	0.03 7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					Weight: 70 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 5-7-8 oc purlins, except end verticals, and 2-0-0 oc purlins (4-9-13 max.): 3-4.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 7=Mechanical, 10=0-3-8
 Max Horz 10=253(LC 25)
 Max Uplift 7=-147(LC 8), 10=-175(LC 8)
 Max Grav 7=676(LC 1), 10=745(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=-1475/242, 4-5=-900/129
 BOT CHORD 9-10=-221/461, 8-9=-330/1533, 7-8=-140/768
 WEBS 3-9=-165/1134, 4-9=-468/122, 4-8=-780/194, 5-8=0/380, 5-7=-882/223, 3-10=-728/100

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 147 lb uplift at joint 7 and 175 lb uplift at joint 10.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 8) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-6=-70, 7-10=-20
 Concentrated Loads (lb)
 Vert: 3=55(F) 11=56(F)




April 20, 2021

Job 2742340	Truss E9	Truss Type HALF HIP	Qty 1	Ply 1	Roeser/1487 Winterset 145732374
----------------	-------------	------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:04 2021 Page 1
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-ell?46ip3tyYuh6CSITuTRrcGkaiVzC7FthQzP4ev

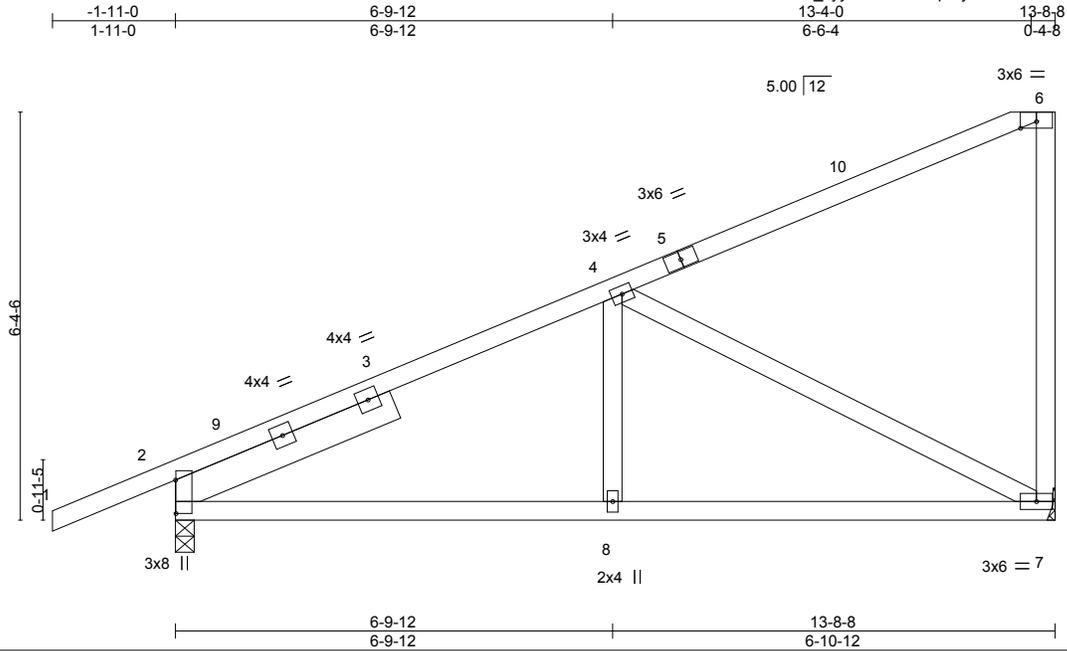

Scale = 1:35.7

Plate Offsets (X,Y)--	[2:0-6-4,0-0-1]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.53	Vert(LL)	-0.05	7-8	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.41	Vert(CT)	-0.11	7-8	>999
BCLL 0.0	Rep Stress Incr	YES	WB 0.74	Horz(CT)	0.01	7	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 60 lb
							FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	
SLIDER Left 2x6 SPF No.2 -t 3-8-14	

REACTIONS. (size) 7=Mechanical, 2=0-3-8
 Max Horz 2=233(LC 12)
 Max Uplift 7=-160(LC 12), 2=-98(LC 12)
 Max Grav 7=601(LC 1), 2=754(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-868/56
 BOT CHORD 2-8=-195/677, 7-8=-195/677
 WEBS 4-8=0/309, 4-7=-739/214

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 13-6-12 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 160 lb uplift at joint 7 and 98 lb uplift at joint 2.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.




April 20,2021

Job 2742340	Truss E10	Truss Type Roof Special Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	145732375
----------------	--------------	-----------------------------------	----------	----------	---	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:47 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-e1EaWIV93fpyM4xjrjNUUiuE0oQupDzsTh_dTcvzP4fA



Scale = 1:37.0

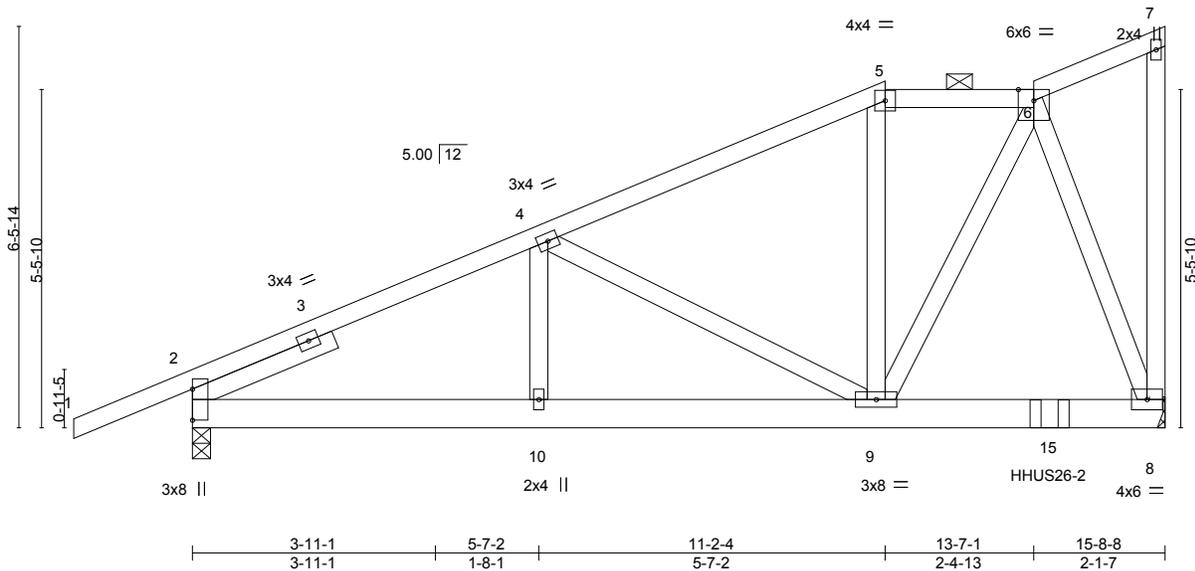

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	-0.01	10	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.59	Vert(CT)	-0.05	8-9	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.12	Horz(CT)	0.01	8	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						
								Weight: 173 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SPF No.2
 WEBS 2x4 SPF No.2
 SLIDER Left 2x4 SPF No.2 -t 2-6-0

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 8=Mechanical, 2=0-3-8
 Max Horz 2=244(LC 24)
 Max Uplift 2=49(LC 8)
 Max Grav 8=1624(LC 1), 2=958(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-1103/0, 4-5=-916/0, 5-6=-776/0
 BOT CHORD 2-10=-36/1060, 9-10=-36/1060, 8-9=0/375
 WEBS 4-9=-320/283, 6-8=-999/0, 6-9=0/906

NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-6-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 49 lb uplift at joint 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie HHUS26-2 (14-10d Girder, 4-10d Truss) or equivalent at 13-10-2 from the left end to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-5=-70, 5-6=-70, 6-7=-70, 8-11=-20



April 20, 2021

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss E10	Truss Type Roof Special Girder	Qty 1	Ply 2	Roeser/1487 Winterset I45732375 Job Reference (optional)
----------------	--------------	-----------------------------------	----------	-----------------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:47 2021 Page 2
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFT9-e1EaWIV93fpyM4xrxjNUUiuE0oQupDzsTh_dTcvzP4fA

LOAD CASE(S) Standard
Concentrated Loads (lb)
Vert: 15=-1048(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss E11	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset 145732376
----------------	--------------	------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:48 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-6DnyjeWnqzxp_EW1G50JF5n9kqISyM2cWdN18LzP4f9

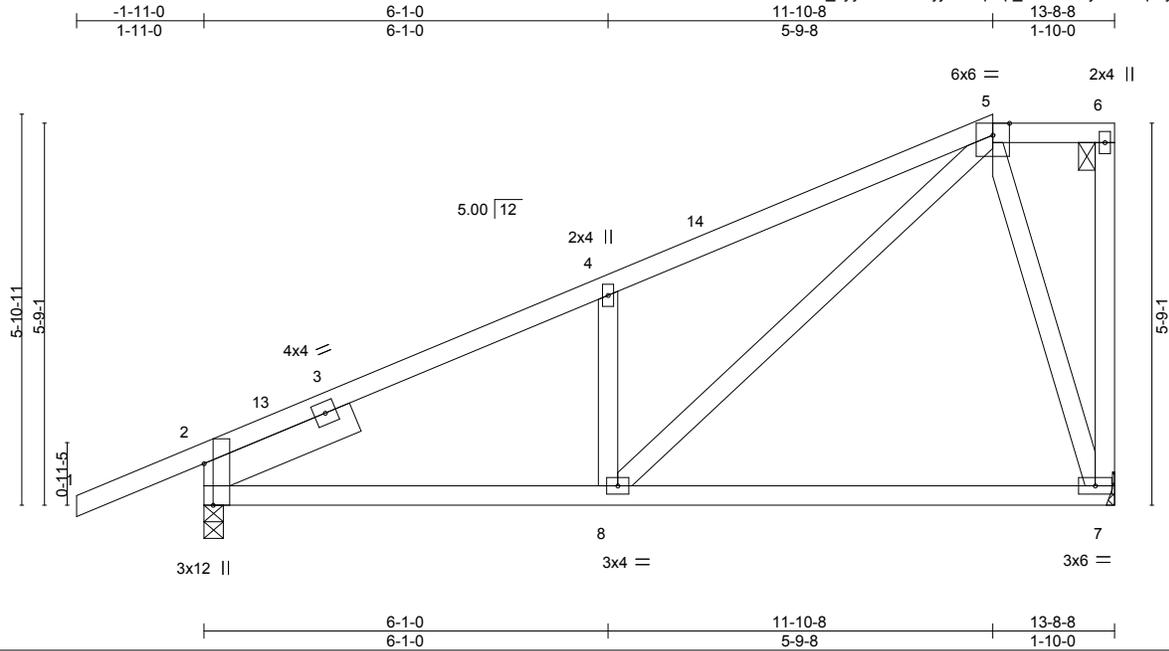

Scale = 1:34.5

Plate Offsets (X,Y)-- [2:0-7-8,Edge]	6-1-0 6-1-0	11-10-8 5-9-8	13-8-8 1-10-0		
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.33	Vert(LL) -0.09 7-8 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.37	Vert(CT) -0.18 7-8 >894 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.32	Horz(CT) 0.01 7 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 64 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (6-0-0 max.): 5-6.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 7=Mechanical, 2=0-3-8
 Max Horz 2=203(LC 12)
 Max Uplift 7=-123(LC 12), 2=-108(LC 12)
 Max Grav 7=601(LC 25), 2=754(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-798/177, 4-5=-826/180
 BOT CHORD 2-8=-200/693
 WEBS 4-8=-362/194, 5-7=-559/238, 5-8=-200/716

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 11-10-8, Exterior(2E) 11-10-8 to 13-6-12 zone; cantilever left and right exposed ; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 7 and 108 lb uplift at joint 2.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20,2021

Job 2742340	Truss E12	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset	145732377
----------------	--------------	----------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:48 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-6DnyjeWnqzxp_EW1G50JF5nB7qFLyOHcWdN18LzP4f9



Scale: 3/8"=1'

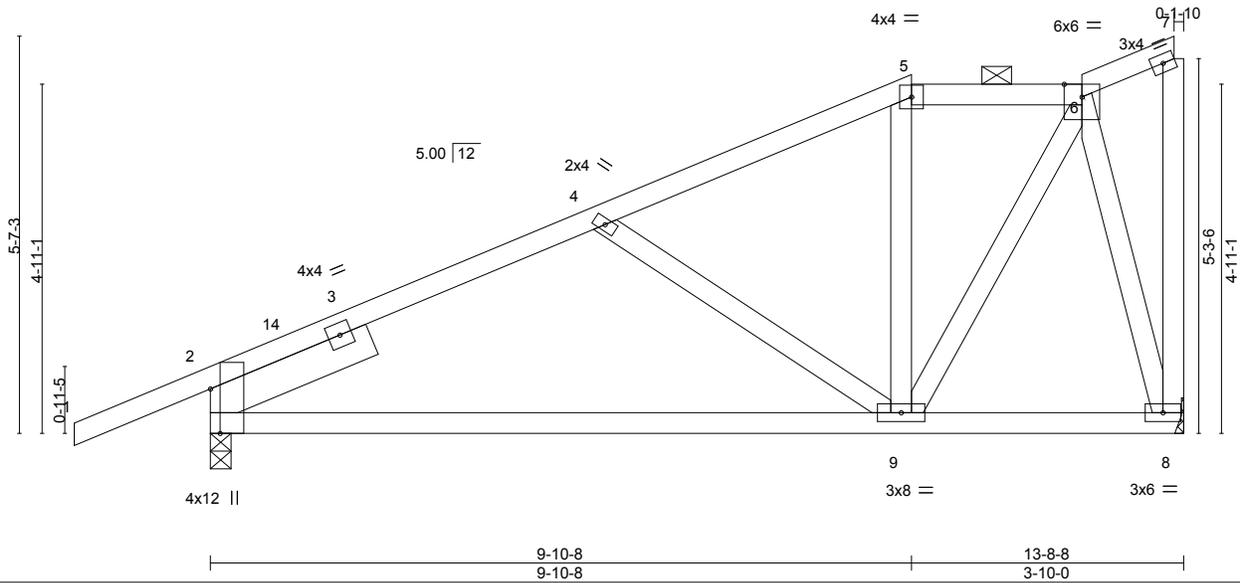


Plate Offsets (X,Y)-- [2:0-7-8,Edge], [7:0-0-1,0-0-0]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl
TCLL 25.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	-0.14	9-12 >999
TCDL 10.0	Lumber DOL	1.15	BC 0.57	Vert(CT)	-0.28	9-12 >581
BCLL 0.0	Rep Stress Incr	YES	WB 0.24	Horz(CT)	0.02	2 n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS			
						PLATES
						MT20
						GRIP
						197/144
						Weight: 67 lb
						FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2
SLIDER Left 2x6 SPF No.2 -t 2-6-0

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 8=Mechanical, 2=0-3-8
Max Horz 2=214(LC 11)
Max Uplift 8=-127(LC 12), 2=-131(LC 12)
Max Grav 8=601(LC 1), 2=754(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-4=-680/155, 4-5=-478/118, 5-6=-390/131
BOT CHORD 2-9=-311/667
WEBS 4-9=-337/174, 6-9=-152/499, 6-8=-568/169

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 9-10-8, Exterior(2E) 9-10-8 to 12-3-5, Interior(1) 12-3-5 to 13-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 127 lb uplift at joint 8 and 131 lb uplift at joint 2.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

Job 2742340	Truss E13	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset 145732378
----------------	--------------	------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:49 2021 Page 1
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-aQLKw_XPbG3gbN5DqoXynJJJ9Derjh9H6agnzP4f8

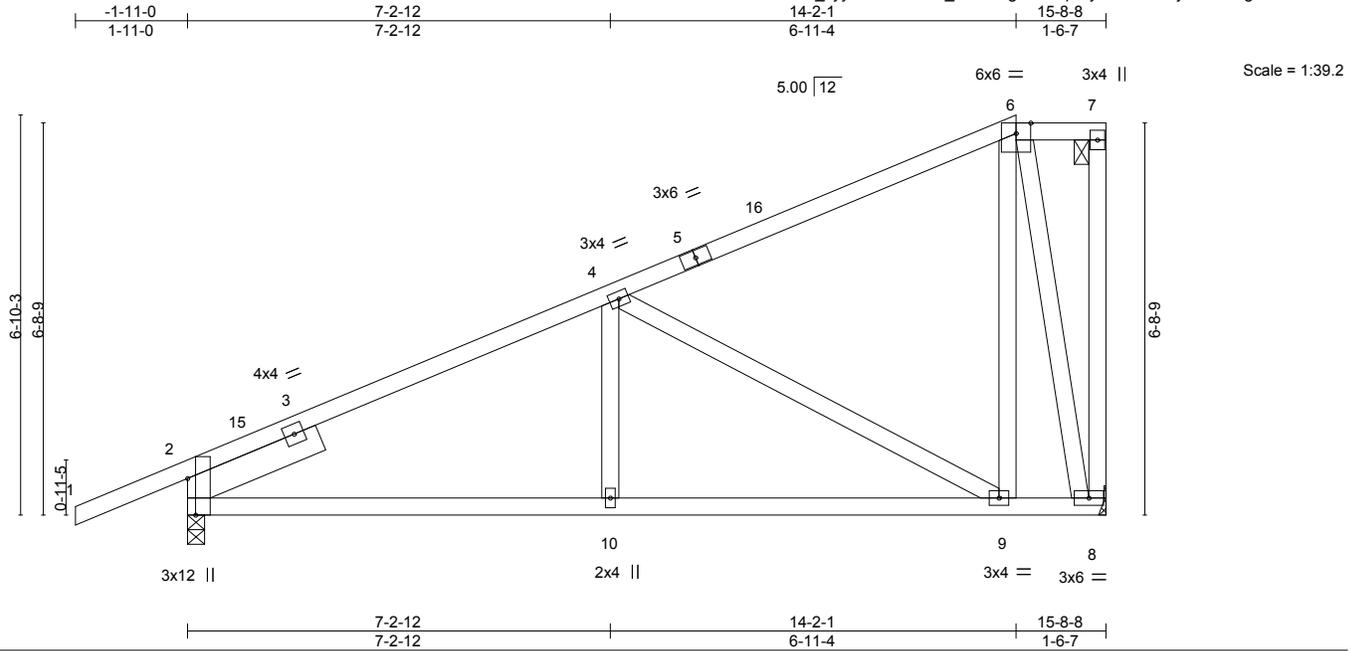


Plate Offsets (X,Y)-- [2:0-7-8,Edge]					
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc) l/defl L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.42	Vert(LL) -0.04	9-10 >999 240
TCDL 10.0	Lumber DOL	1.15	BC 0.36	Vert(CT) -0.10	9-10 >999 180
BCLL 0.0	Rep Stress Incr	YES	WB 0.74	Horz(CT) 0.02	8 n/a n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS		
				PLATES	GRIP
				MT20	197/144
				Weight: 78 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, excepting end verticals, and 2-0-0 oc purlins (10-0-0 max.): 6-7.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 8=Mechanical, 2=0-3-8
 Max Horz 2=258(LC 11)
 Max Uplift 8=-128(LC 12), 2=-140(LC 12)
 Max Grav 8=692(LC 1), 2=843(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-816/154, 4-6=-294/109
 BOT CHORD 2-10=-274/813, 9-10=-274/813
 WEBS 4-10=0/278, 4-9=-721/212, 6-9=-73/463, 6-8=-793/237

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 14-2-1, Exterior(2E) 14-2-1 to 15-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 128 lb uplift at joint 8 and 140 lb uplift at joint 2.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

Job 2742340	Truss E14	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset	145732379
----------------	--------------	------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:50 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-2cvj8JX1MaBXDXgQOW2BKWsmYdteQFovOxs7DEzP4f7

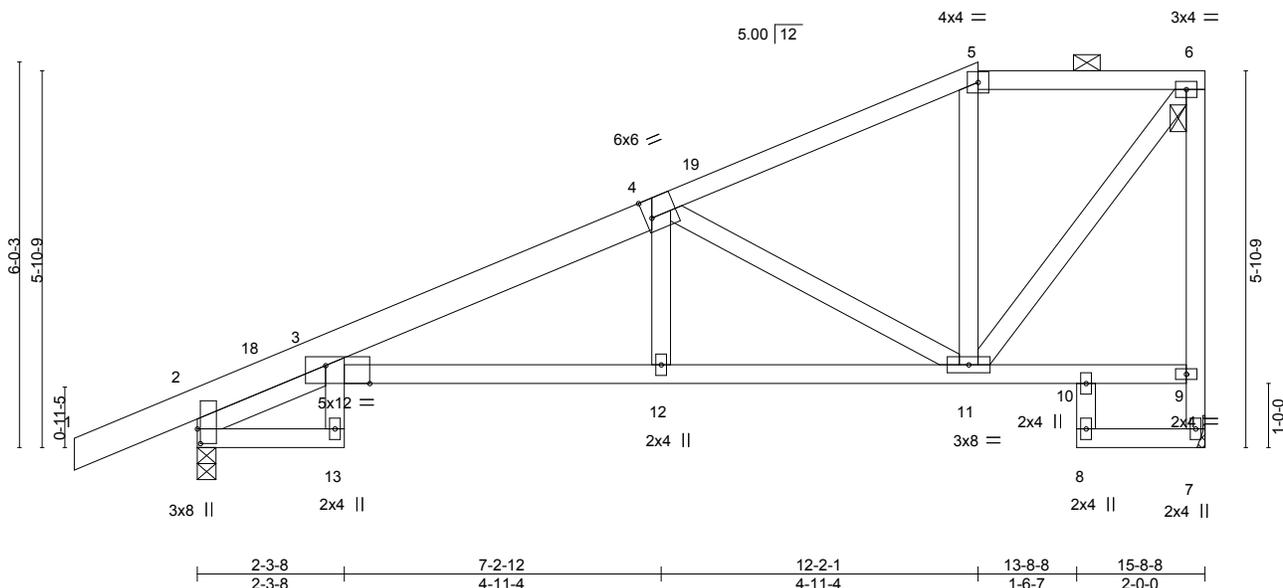


Plate Offsets (X,Y)--	[2:0-2-12,0-0-9], [3:0-8-4,Edge], [4:0-1-4,Edge]
-----------------------	--

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.95	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.78	Vert(LL) -0.19 3-12 >994 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.43	Vert(CT) -0.35 3-12 >527 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.25 7 n/a n/a		
	Code IRC2018/TPI2014			Weight: 79 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except* 1-4: 2x6 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 -t 2-2-11	

REACTIONS. (size) 7=Mechanical, 2=0-3-8
 Max Horz 2=226(LC 11)
 Max Uplift 7=-106(LC 9), 2=-141(LC 12)
 Max Grav 7=692(LC 1), 2=843(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-15=-892/257, 3-4=-1235/200, 4-5=-537/119, 5-6=-427/129, 7-9=-669/172,
 6-9=-651/167
 BOT CHORD 3-12=-399/1163, 11-12=-395/1165
 WEBS 4-11=-839/242, 6-11=-187/676

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 12-2-1, Exterior(2E) 12-2-1 to 15-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 106 lb uplift at joint 7 and 141 lb uplift at joint 2.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20, 2021

Job 2742340	Truss E15	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732380
----------------	--------------	------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:51 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-WoT5LFy7uJOrhFcyDZQtkPWn1Ct9IG3cbbhlzP4f6

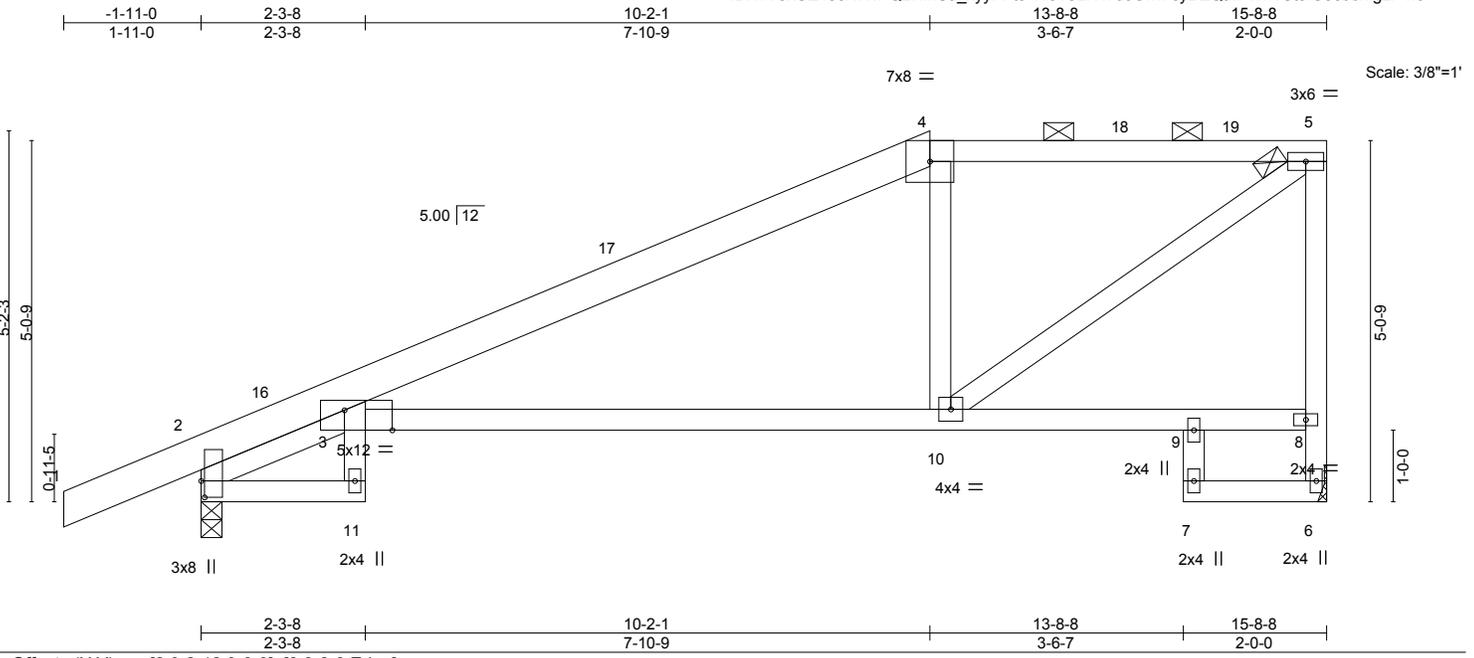

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.99	Vert(LL) -0.34 3-10 >547 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.78	Vert(CT) -0.67 3-10 >279 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.23	Horz(CT) 0.35 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 71 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x6 SPF No.2 *Except* 4-5: 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-11-1 max.): 4-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 -t 2-2-11	

REACTIONS. (size) 6=Mechanical, 2=0-3-8
 Max Horz 2=194(LC 11)
 Max Uplift 6=-113(LC 9), 2=-149(LC 12)
 Max Grav 6=692(LC 1), 2=843(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-13=-892/262, 3-4=-864/141, 4-5=-761/172, 6-8=-674/155, 5-8=-676/166
 BOT CHORD 3-10=-258/777
 WEBS 4-10=-357/189, 5-10=-237/921

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 10-2-1, Exterior(2R) 10-2-1 to 14-4-15, Interior(1) 14-4-15 to 15-6-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 113 lb uplift at joint 6 and 149 lb uplift at joint 2.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

Job 2742340	Truss E16	Truss Type Half Hip Girder	Qty 1	Ply 2	Roeser/1487 Winterset	145732381
----------------	--------------	-------------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:53 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-SBbrmLawfVZ64?P?3ebuy9Uw2rxKdfML4v4opZzP4f4

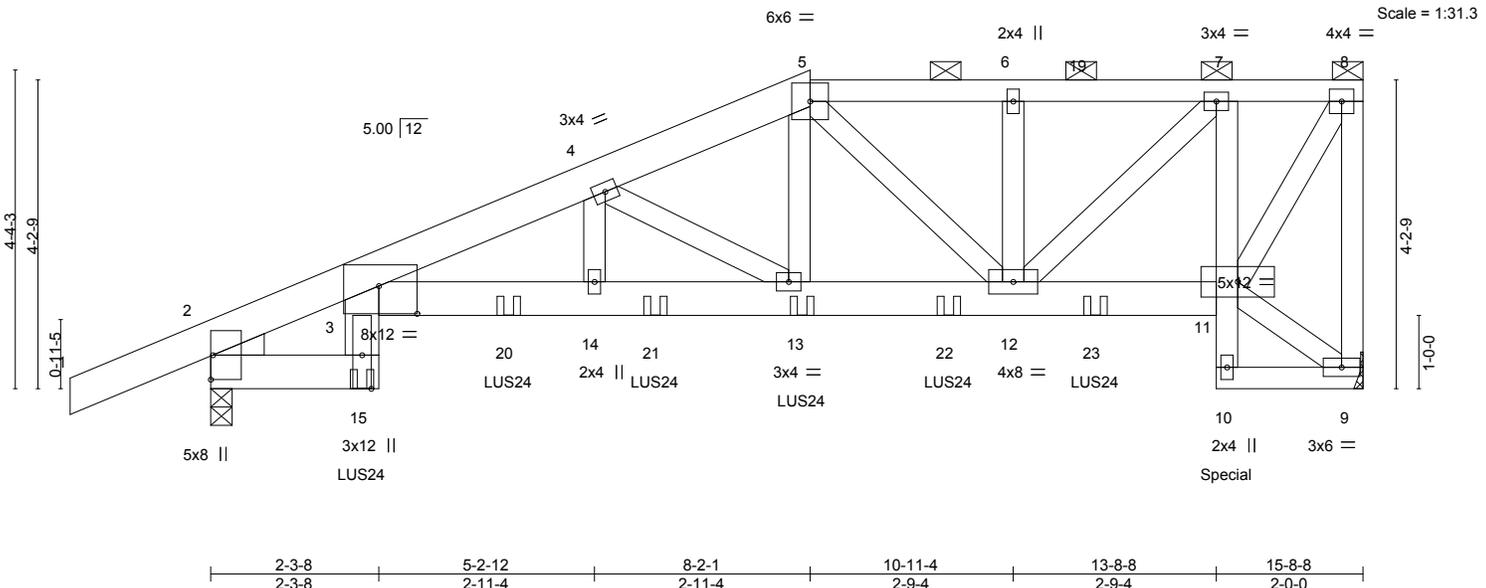



Plate Offsets (X,Y)--	[3:0-6-4,0-4-9]								
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15		TC 0.74	Vert(LL) -0.11	3-14	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.58	Vert(CT) -0.20	3-14	>939	180		
BCLL 0.0	Rep Stress Incr NO		WB 0.25	Horz(CT) 0.16	9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						
								Weight: 192 lb	FT = 20%

LUMBER-
TOP CHORD 2x6 SP 2400F 2.0E *Except*
5-8: 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2 *Except*
2-15,3-15: 2x6 SPF No.2, 3-11: 2x6 SPF 2100F 1.8E
2x4 SPF No.2
WEBS
WEDGE
Left: 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-8.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 9=Mechanical, 2=0-3-8
Max Horz 2=161(LC 7)
Max Uplift 9=-373(LC 5), 2=-394(LC 8)
Max Grav 9=1853(LC 1), 2=1920(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-17=-1162/216, 3-4=-4510/929, 4-5=-2994/632, 5-6=-2251/474, 6-7=-2251/474,
7-8=-1110/238, 8-9=-1802/387
BOT CHORD 3-15=-269/1160, 3-14=-908/4319, 13-14=-915/4344, 12-13=-578/2645, 11-12=-279/1163,
7-11=-1221/278
WEBS 4-14=-133/768, 4-13=-1889/431, 5-13=-289/1376, 5-12=-564/151, 7-12=-332/1530,
8-11=-443/2051

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed;
MWFERS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 373 lb uplift at joint 9 and 394 lb uplift at joint 2.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

Continued on page 2

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 16023 Swingley Ridge Rd Chesterfield, MO 63017
--	--

Job 2742340	Truss E16	Truss Type Half Hip Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	I45732381
----------------	--------------	-------------------------------	----------	-----------------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:53 2021 Page 2
ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-SBbrmLawfVZ64?P?3ebuy9Uw2rxKdfML4v4opZzP4f4

NOTES-

- 11) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 2-0-12 from the left end to 4-0-12 to connect truss(es) to back face of bottom chord.
- 12) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 6-0-12 from the left end to 12-0-12 to connect truss(es) to back face of bottom chord.
- 13) Fill all nail holes where hanger is in contact with lumber.
- 14) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 330 lb down and 80 lb up at 13-10-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 - Uniform Loads (plf)
 - Vert: 1-3=-70, 3-5=-70, 5-8=-70, 15-16=-20, 3-11=-20, 9-10=-20
 - Concentrated Loads (lb)
 - Vert: 15=-318(B) 13=-316(B) 11=-330(B) 20=-316(B) 21=-316(B) 22=-321(B) 23=-321(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss E17	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset	145732382
----------------	--------------	----------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:54 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFf9-xN9D_hbYQhzi9_BdL67UM18JEKhM5KVIZqLM?zP4f3

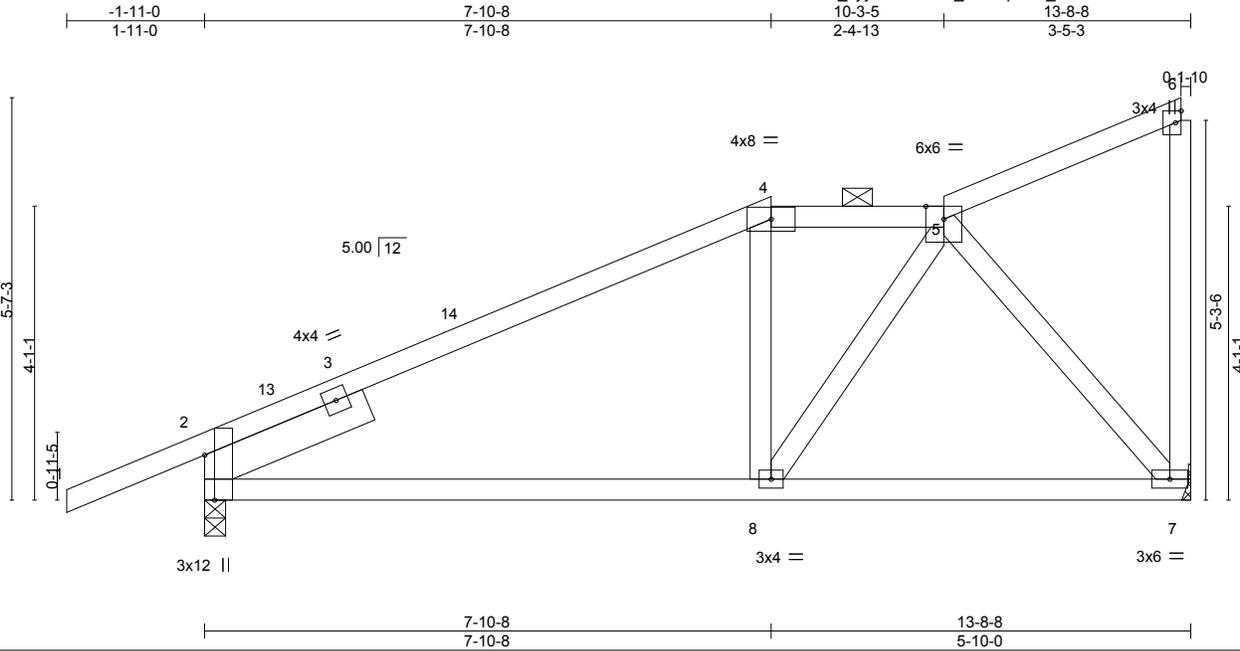

Scale: 3/8"=1'

Plate Offsets (X,Y)-- [2:0-7-8,Edge]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.46	Vert(LL)	-0.05 8-11	>999 240
TCDL 10.0	Lumber DOL	1.15	BC 0.38	Vert(CT)	-0.11 8-11	>999 180
BCLL 0.0	Rep Stress Incr	YES	WB 0.27	Horz(CT)	0.03 2	n/a n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS			
						PLATES MT20
						GRIP 197/144
						Weight: 59 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (6-0-0 max.): 4-5.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 2=0-3-8, 7=Mechanical
 Max Horz 2=214(LC 11)
 Max Uplift 2=-131(LC 12), 7=-127(LC 12)
 Max Grav 2=754(LC 1), 7=601(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-657/182, 4-5=-592/162
 BOT CHORD 2-8=-259/587, 7-8=-176/390
 WEBS 5-8=-163/367, 5-7=-587/191

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 7-10-8, Exterior(2E) 7-10-8 to 10-3-5, Interior(1) 10-3-5 to 13-6-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 131 lb uplift at joint 2 and 127 lb uplift at joint 7.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20, 2021

Job 2742340	Truss E18	Truss Type Roof Special	Qty 1	Ply 1	Roeser/1487 Winterset	145732383
----------------	--------------	----------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:54 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-xN9D_hbYQphzi9_BdL67UM1BhEKIM25VIZqLM7zP4f3

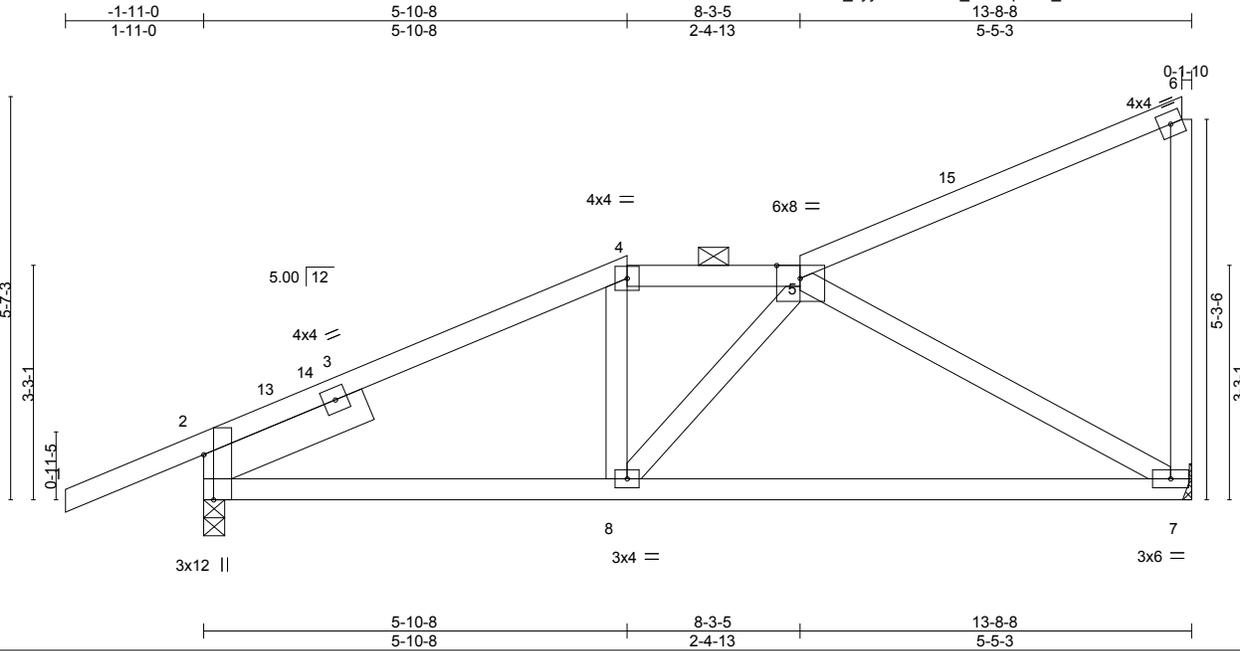

Scale: 3/8"=1'

Plate Offsets (X,Y)--	[2:0-7-8,Edge], [5:0-3-14,Edge], [6:0-0-1,0-0-0]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	-0.11	7-8	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.44	Vert(CT)	-0.22	7-8	>755	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.48	Horz(CT)	0.01	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 59 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 7=Mechanical, 2=0-3-8
 Max Horz 2=195(LC 12)
 Max Uplift 7=-145(LC 12), 2=-112(LC 12)
 Max Grav 7=601(LC 1), 2=754(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-796/232, 4-5=-683/129
 BOT CHORD 2-8=-215/688, 7-8=-187/649
 WEBS 5-7=-716/211

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 5-10-8, Exterior(2E) 5-10-8 to 8-3-5, Interior(1) 8-3-5 to 13-6-12 zone; cantilever left and right exposed ; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 145 lb uplift at joint 7 and 112 lb uplift at joint 2.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

Job 2742340	Truss E19	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Roeser/1487 Winterset 145732384
----------------	--------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:55 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-PajbB1bAB6ppJIZNB3eM1aZFxeb85NCeXDZuuRzP4f2

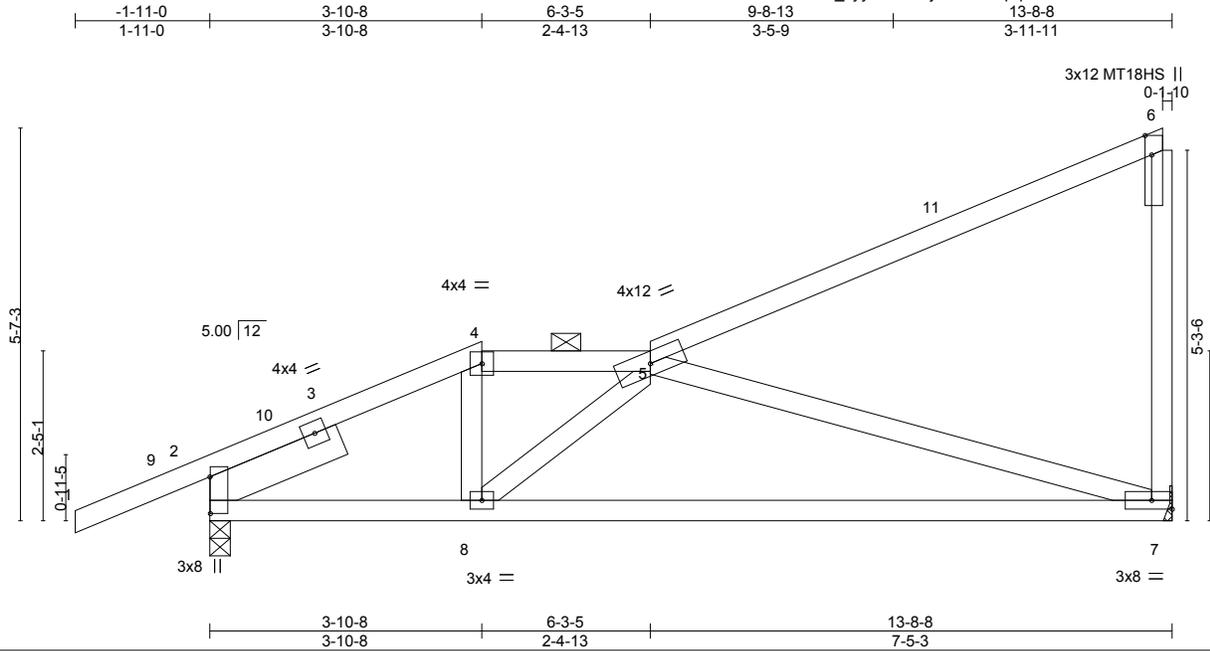


Plate Offsets (X,Y)--	[2:0-6-4,0-0-1], [6:0-3-5,Edge]
-----------------------	---------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.72	Vert(LL)	-0.27	7-8	>612	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.75	Vert(CT)	-0.54	7-8	>302	MT18HS	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 1.00	Horz(CT)	0.02	7	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						
								Weight: 58 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 5-2-3 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	
SLIDER Left 2x6 SPF No.2 -t 2-0-13	

REACTIONS. (size) 7=Mechanical, 2=0-3-8
 Max Horz 2=198(LC 12)
 Max Uplift 7=-144(LC 12), 2=-112(LC 12)
 Max Grav 7=598(LC 1), 2=754(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-970/62, 4-5=-748/86
 BOT CHORD 2-8=-200/771, 7-8=-250/955
 WEBS 4-8=0/360, 5-8=-273/90, 5-7=-952/253

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 3-10-8, Exterior(2E) 3-10-8 to 6-3-5, Interior(1) 6-3-5 to 13-6-3 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) All plates are MT20 plates unless otherwise indicated.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 144 lb uplift at joint 7 and 112 lb uplift at joint 2.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021


Job 2742340	Truss E21	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset	145732386
----------------	--------------	------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:39:58 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-p9Okp2eT1BOAmHysBB3fCBTgsimloz5DBoZVmzP4f?



Scale = 1:43.1

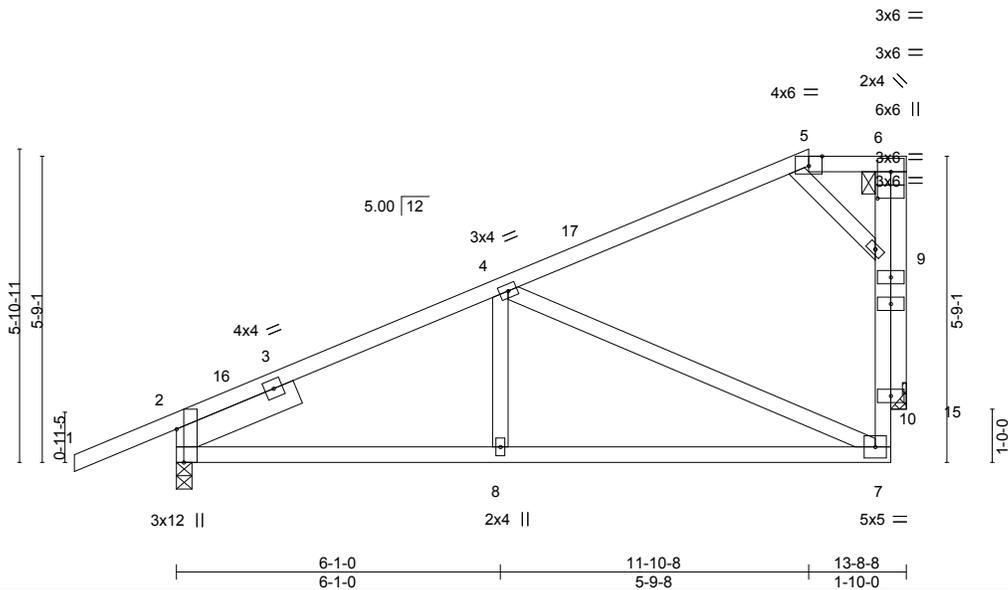


Plate Offsets (X,Y)--	[2:0-7-8,Edge], [5:0-3-0,Edge], [9:0-0-8,0-11-8]
-----------------------	--


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15		TC 0.30	Vert(LL) -0.07	7-8	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.38	Vert(CT) -0.14	7-8	>999	180		
BCLL 0.0	Rep Stress Incr YES		WB 0.68	Horz(CT) 0.02	15	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 65 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (10-0-0 max.): 5-6.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
OTHERS 2x4 SPF No.2	
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 2=0-3-8, 15=Mechanical
 Max Horz 2=203(LC 12)
 Max Uplift 2=-108(LC 12), 15=-123(LC 12)
 Max Grav 2=754(LC 1), 15=575(LC 25)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-700/157, 7-10=-46/331, 9-10=-47/334, 6-9=-204/639
 BOT CHORD 2-8=-199/691, 7-8=-199/691
 WEBS 4-8=0/271, 4-7=-631/183, 5-9=-400/207, 6-15=-576/161

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 11-10-8, Exterior(2E) 11-10-8 to 13-3-4 zone; cantilever left and right exposed ; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 108 lb uplift at joint 2 and 123 lb uplift at joint 15.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

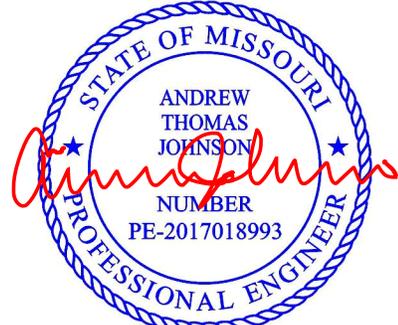

April 20,2021

Job 2742340	Truss F1	Truss Type Common Girder	Qty 1	Ply 1	Roeser/1487 Winterset 145732387
----------------	-------------	-----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:05 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFT9-6VJNHSjRqB4PWrlm9pjRh_22g0SR6Y7qn_QEszP4eu

10-4-0 12-3-0
5-2-0 1-11-0

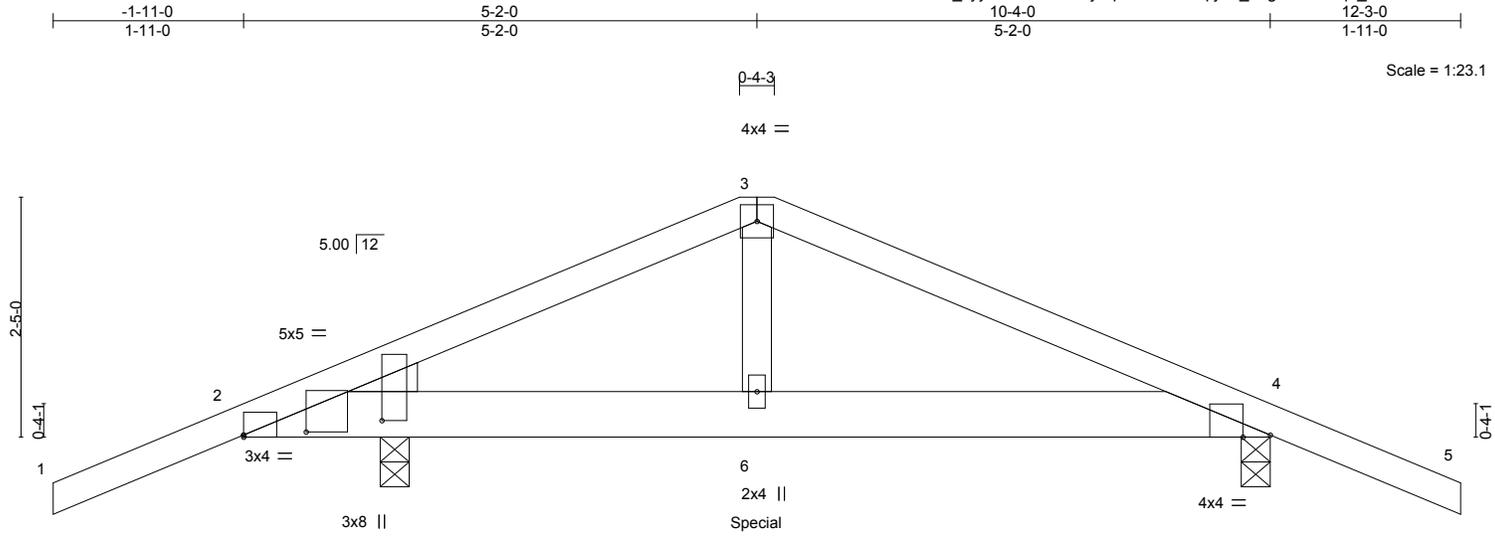


Plate Offsets (X,Y)--	[2:0-0-0,0-0-4], [2:0-1-12,1-4-11], [2:0-7-9,0-0-6], [4:0-3-5,Edge]
-----------------------	---

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.42	Vert(LL)	-0.04	6-8	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.69	Vert(CT)	-0.06	6-8	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.11	Horz(CT)	-0.01	2	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						
								Weight: 39 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x6 SPF No.2
WEBS 2x4 SPF No.2
WEDGE
Left: 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 5-10-8 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 4=0-3-8, 2=0-3-8
Max Horz 4=-46(LC 30)
Max Uplift 4=-149(LC 9), 2=-194(LC 8)
Max Grav 4=703(LC 1), 2=996(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-841/189, 3-4=-846/174
BOT CHORD 2-6=-125/731, 4-6=-125/731
WEBS 3-6=-77/449

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 149 lb uplift at joint 4 and 194 lb uplift at joint 2.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 501 lb down and 162 lb up at 5-1-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)
Vert: 1-3=-70, 3-5=-70, 2-4=-20

Concentrated Loads (lb)
Vert: 6=-501(F)



April 20,2021

Job 2742340	Truss F2	Truss Type Common	Qty 2	Ply 1	Roeser/1487 Winterset 145732388
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:06 2021 Page 1
 ID:WV5xOZ45cNK4PQ2HmSu_xyyPFf9-ahmVok4bVCG8?uVktKyzuXBv4MVAaeG3Rk_mizP4et



Scale = 1:22.7

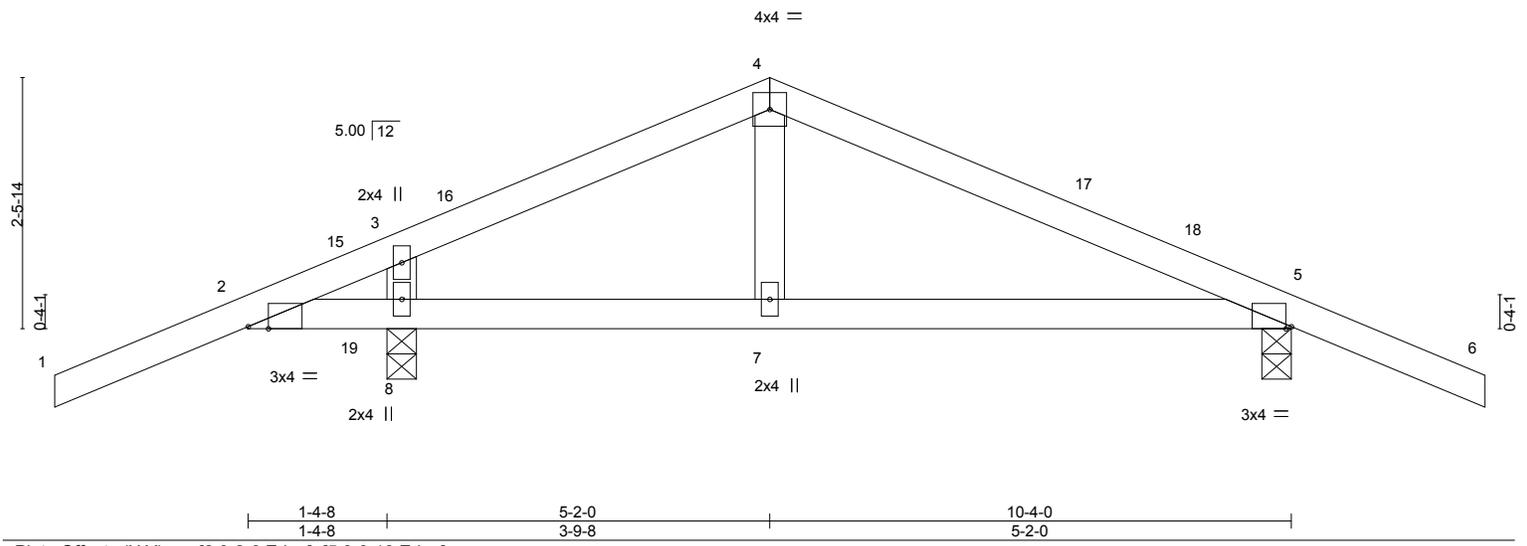


Plate Offsets (X,Y)--	[2:0-2-6,Edge], [5:0-0-10,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.54	Vert(LL) -0.06 7-14 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.64	Vert(CT) -0.11 7-14 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.06	Horz(CT) -0.00 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 32 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=0-3-8, 8=0-3-8
 Max Horz 5=-47(LC 13)
 Max Uplift 5=-95(LC 13), 8=-126(LC 8)
 Max Grav 5=496(LC 1), 8=703(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=-333/74, 4-5=-333/71
 WEBS 3-8=-445/278

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 5-2-0, Exterior(2R) 5-2-0 to 8-2-0, Interior(1) 8-2-0 to 12-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 95 lb uplift at joint 5 and 126 lb uplift at joint 8.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20,2021

Job 2742340	Truss F3	Truss Type Common	Qty 2	Ply 1	Roeser/1487 Winterset 145732389
----------------	-------------	----------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:06 2021 Page 1
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-ahtmVok4bVCG8?uVKtKyzuXF54SVAarG3Rk_mizP4et



Scale = 1:20.0

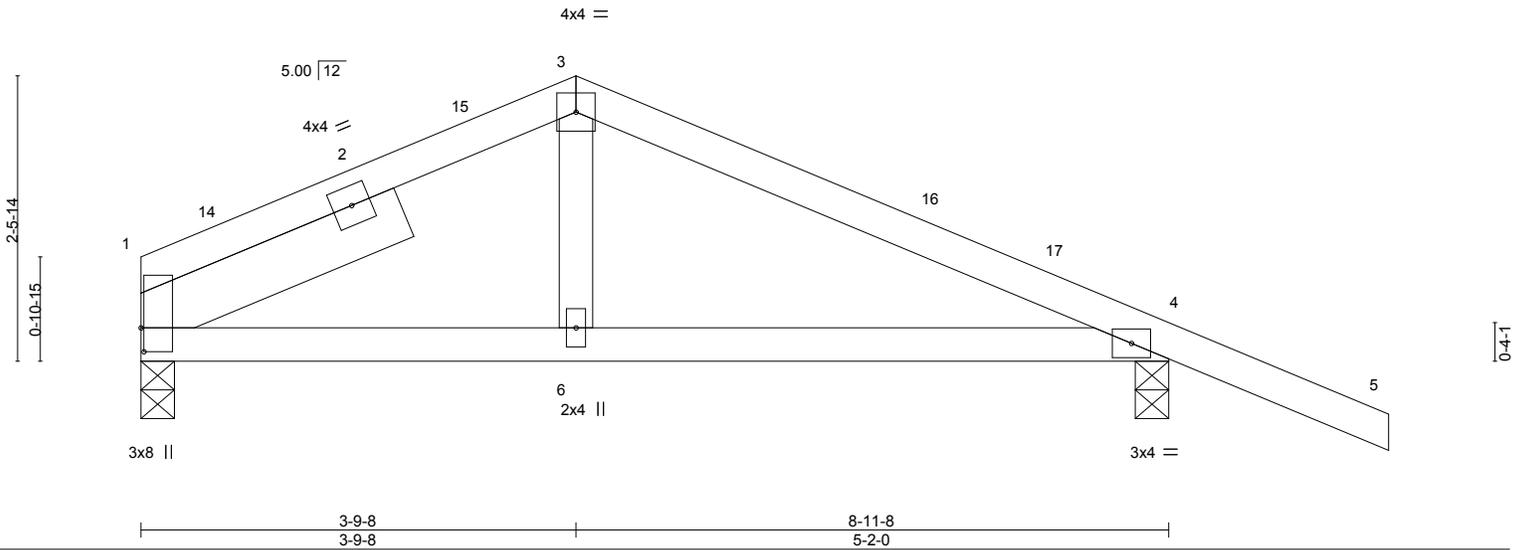


Plate Offsets (X,Y)--	[1:0-2-8,0-0-5]
-----------------------	-----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.02	6-13	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.26	Vert(CT)	-0.05	6-13	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	-0.01	1	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS						
								Weight: 31 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 1=0-3-8, 4=0-3-8
 Max Horz 4=-71(LC 13)
 Max Uplift 1=-44(LC 12), 4=-98(LC 13)
 Max Grav 1=389(LC 1), 4=552(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-3=-441/214, 3-4=-508/189
 BOT CHORD 1-6=-136/407, 4-6=-136/407

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 3-9-8, Exterior(2R) 3-9-8 to 6-9-8, Interior(1) 6-9-8 to 10-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 44 lb uplift at joint 1 and 98 lb uplift at joint 4.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss G1	Truss Type Half Hip Girder	Qty 2	Ply 1	Roeser/1487 Winterset 145732390
----------------	-------------	-------------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:07 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFT9-2tR8i7iiMoK7i9ThuarBW63PsUn7vzdPI5TXilzP4es

Job Reference (optional)



Scale = 1:23.4

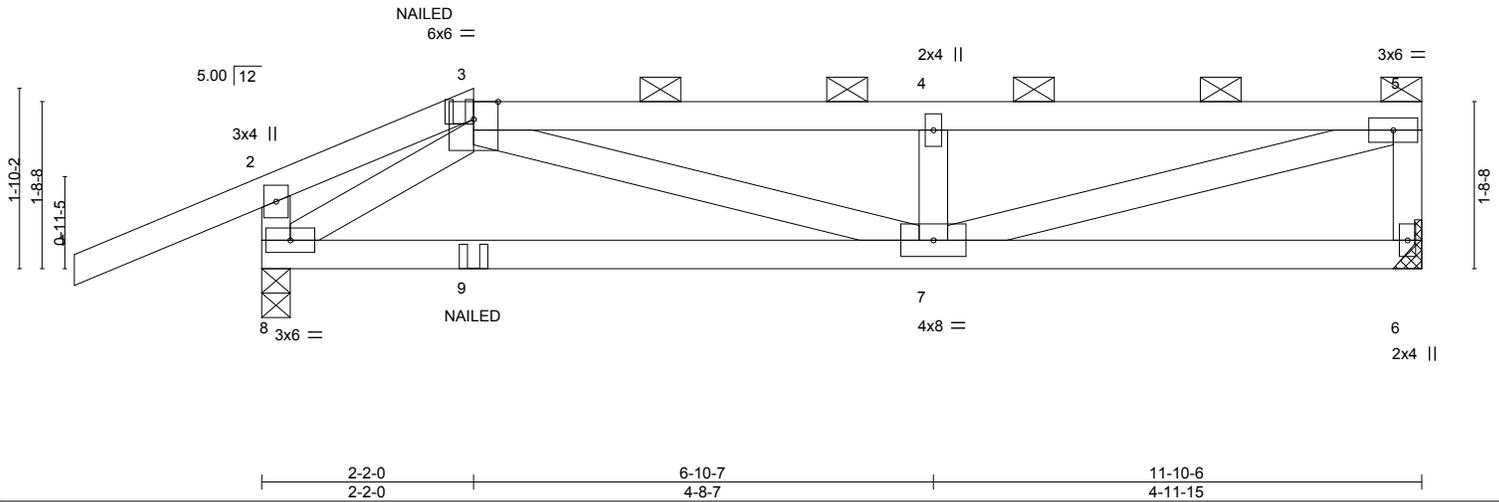

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.34	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.36	Vert(LL) -0.06 7-8 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.26	Vert(CT) -0.13 7-8 >999 180		
BCDL 10.0	Rep Stress Incr NO	Matrix-MS	Horz(CT) 0.01 6 n/a n/a		
	Code IRC2018/TPI2014			Weight: 46 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (5-3-6 max.): 3-5.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=Mechanical, 8=0-3-8
 Max Horz 8=68(LC 7)
 Max Uplift 6=94(LC 5), 8=134(LC 4)
 Max Grav 6=505(LC 22), 8=663(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 3-4=-1107/193, 4-5=-1105/192, 5-6=-458/106
 BOT CHORD 7-8=-141/498
 WEBS 3-7=-118/703, 4-7=-382/136, 5-7=-193/1078, 3-8=-658/165

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 94 lb uplift at joint 6 and 134 lb uplift at joint 8.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-5=-70, 6-8=-20
 Concentrated Loads (lb)
 Vert: 9=18(B)



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss G4	Truss Type Half Hip	Qty 2	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732393
----------------	-------------	------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:10 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-TS7GK9naejhccCGZiPu8khpUhh6MZs_3iBv3zP4ep



5x8 = 3x4 =

Scale = 1:27.7

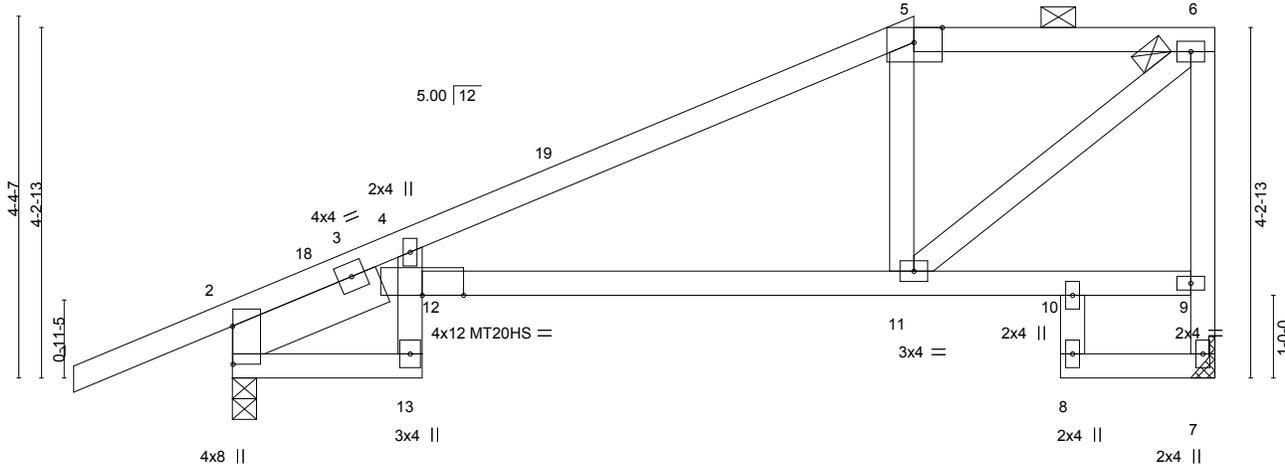


Plate Offsets (X, Y)--	[2:0-5-8,0-0-1], [5:0-4-2,Edge]
------------------------	---------------------------------

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.76	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.81	Vert(LL) -0.20 11-12 >698 240	MT20HS	148/108
BCLL 0.0	Lumber DOL 1.15	WB 0.19	Vert(CT) -0.38 11-12 >371 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.17 7 n/a n/a		
	Code IRC2018/TPI2014			Weight: 50 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (6-0-0 max.): 5-6.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
SLIDER Left 2x6 SPF No.2 -t 2-0-0	

REACTIONS. (size) 7=Mechanical, 2=0-3-8
 Max Horz 2=160(LC 11)
 Max Uplift 7=-84(LC 9), 2=-114(LC 12)
 Max Grav 7=516(LC 1), 2=672(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-577/144, 4-5=-655/140, 5-6=-585/195, 7-9=-507/166, 6-9=-543/188
 BOT CHORD 2-13=-253/441, 11-12=-267/573
 WEBS 6-11=-300/770

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 8-2-12, Exterior(2E) 8-2-12 to 11-8-10 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are MT20 plates unless otherwise indicated.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Refer to girder(s) for truss to truss connections.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 84 lb uplift at joint 7 and 114 lb uplift at joint 2.
 - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20,2021

Job 2742340	Truss GR1	Truss Type Flat Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	145732394
----------------	--------------	---------------------------	----------	----------	---	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:11 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-xfgfYVoCP1qYEmnS7Qw7gyE5i5A4rhV?DjRIRWzP4eo



Scale = 1:31.4

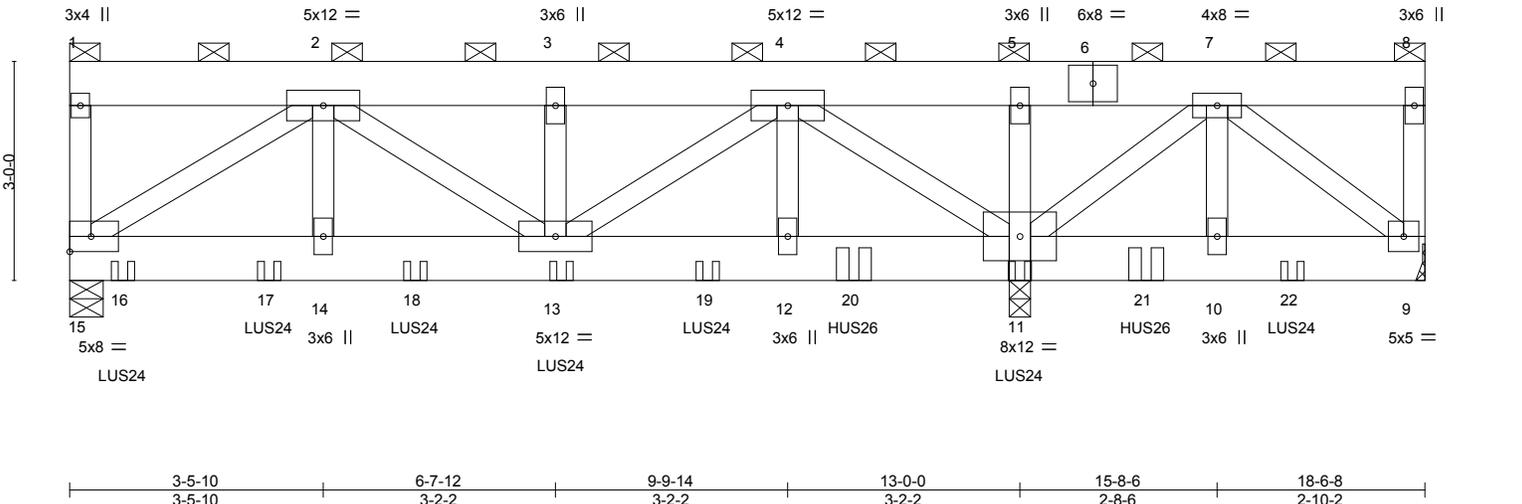

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL) -0.02	13	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.23	Vert(CT) -0.09	13	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.66	Horz(CT) 0.02	11	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					
							Weight: 302 lb	FT = 20%

LUMBER-
TOP CHORD 2x8 SP 2400F 2.0E
BOT CHORD 2x8 SP 2400F 2.0E
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD 2-0-0 oc purlins (6-0-0 max.): 1-8, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS. (size) 15=0-5-8, 9=Mechanical, 11=0-3-8
Max Horz 15=82(LC 24)
Max Grav 15=6370(LC 1), 9=1068(LC 1), 11=12249(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 1-15=-1223/0, 2-3=-7320/0, 3-4=-7320/0, 4-5=0/2638, 5-7=0/2638, 8-9=-978/0
BOT CHORD 14-15=0/6163, 13-14=0/6163, 12-13=0/4004, 11-12=0/4004, 10-11=-261/0, 9-10=-261/0
WEBS 2-15=-7439/0, 2-14=-347/784, 2-13=0/1449, 3-13=-2212/0, 4-13=0/4153, 4-12=-413/421, 4-11=-8318/0, 5-11=-3275/0, 7-11=-3178/0, 7-10=-490/277, 7-9=0/377

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.
Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc.
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide metal plate or equivalent at bearing(s) 11 to support reaction shown.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36 has been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 0-8-12 from the left end to 8-8-12 to connect truss(es) to back face of bottom chord.
 - Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent at 10-8-12 from the left end to connect truss(es) to back face of bottom chord, skewed 0.0 deg. to the right, sloping 0.0 deg. down.
 - Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 3-8-12 oc max. starting at 13-0-0 from the left end to 16-8-12 to connect truss(es) to back face of bottom chord.



April 20, 2021

Job	Truss	Truss Type	Qty	Ply	Roeser/1487 Winterset	145732394
2742340	GR1	Flat Girder	1	2	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:11 2021 Page 2
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-xfgfYVoCP1qYEmnS7Qw7gyE5i5A4rhV?DjRIRWzP4eo

NOTES-

- 15) Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent at 14-8-12 from the left end to connect truss(es) to back face of bottom chord.
- 16) Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-8=-770, 9-15=-20
Concentrated Loads (lb)
Vert: 13=-586(B) 11=-586(B) 16=-585(B) 17=-581(B) 18=-586(B) 19=-586(B) 20=-586(B) 21=-586(B) 22=-586(B)
- 2) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-8=-758, 9-15=-20
Concentrated Loads (lb)
Vert: 13=-504(B) 11=-504(B) 16=-502(B) 17=-498(B) 18=-504(B) 19=-504(B) 20=-504(B) 21=-504(B) 22=-504(B)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-8=-720, 9-15=-40
Concentrated Loads (lb)
Vert: 13=-378(B) 11=-377(B) 16=-373(B) 17=-364(B) 18=-378(B) 19=-378(B) 20=-378(B) 21=-377(B) 22=-377(B)
- 4) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-15=-8
Horz: 1-15=15, 8-9=19
Concentrated Loads (lb)
Vert: 13=96(B) 11=91(B) 16=102(B) 17=114(B) 18=96(B) 19=96(B) 20=96(B) 21=91(B) 22=91(B)
- 5) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-15=-8
Horz: 1-15=-19, 8-9=-15
Concentrated Loads (lb)
Vert: 13=96(B) 11=91(B) 16=102(B) 17=114(B) 18=96(B) 19=96(B) 20=96(B) 21=91(B) 22=91(B)
- 6) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-15=-20
Horz: 1-15=26, 8-9=9
Concentrated Loads (lb)
Vert: 13=107(B) 11=102(B) 16=111(B) 17=126(B) 18=107(B) 19=107(B) 20=107(B) 21=102(B) 22=102(B)
- 7) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-15=-20
Horz: 1-15=-9, 8-9=-26
Concentrated Loads (lb)
Vert: 13=107(B) 11=102(B) 16=111(B) 17=126(B) 18=107(B) 19=107(B) 20=107(B) 21=102(B) 22=102(B)
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-15=-8
Horz: 1-15=13, 8-9=18
Concentrated Loads (lb)
Vert: 13=96(B) 11=91(B) 16=102(B) 17=114(B) 18=96(B) 19=96(B) 20=96(B) 21=91(B) 22=91(B)
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-15=-8
Horz: 1-15=-18, 8-9=-13
Concentrated Loads (lb)
Vert: 13=96(B) 11=91(B) 16=102(B) 17=114(B) 18=96(B) 19=96(B) 20=96(B) 21=91(B) 22=91(B)
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-686, 9-15=-8
Horz: 1-15=6, 8-9=14
Concentrated Loads (lb)
Vert: 13=96(B) 11=91(B) 16=102(B) 17=114(B) 18=96(B) 19=96(B) 20=96(B) 21=91(B) 22=91(B)
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-686, 9-15=-8
Horz: 1-15=-14, 8-9=-6
Concentrated Loads (lb)
Vert: 13=96(B) 11=91(B) 16=102(B) 17=114(B) 18=96(B) 19=96(B) 20=96(B) 21=91(B) 22=91(B)
- 12) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-15=-20
Horz: 1-15=23, 8-9=7
Concentrated Loads (lb)
Vert: 13=107(B) 11=102(B) 16=111(B) 17=126(B) 18=107(B) 19=107(B) 20=107(B) 21=102(B) 22=102(B)
- 13) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Roeser/1487 Winterset	145732394
2742340	GR1	Flat Girder	1	2	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:11 2021 Page 3
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-xfgfYVoCP1qYEmnS7Qw7gyE5i5A4rhV?DjRIRWzP4eo

LOAD CASE(S) Standard

- Uniform Loads (plf)
Vert: 1-8=-694, 9-15=-20
Horz: 1-15=-7, 8-9=-23
- Concentrated Loads (lb)
Vert: 13=107(B) 11=102(B) 16=111(B) 17=126(B) 18=107(B) 19=107(B) 20=107(B) 21=102(B) 22=102(B)
- 14) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-8=-720, 9-15=-20
Concentrated Loads (lb)
Vert: 13=-257(B) 11=-257(B) 16=-253(B) 17=-249(B) 18=-257(B) 19=-257(B) 20=-257(B) 21=-257(B) 22=-257(B)
- 15) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-15=-20
Horz: 1-15=19, 8-9=7
Concentrated Loads (lb)
Vert: 13=50(B) 11=47(B) 16=53(B) 17=65(B) 18=50(B) 19=50(B) 20=50(B) 21=47(B) 22=47(B)
- 16) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-15=-20
Horz: 1-15=-7, 8-9=-19
Concentrated Loads (lb)
Vert: 13=50(B) 11=47(B) 16=53(B) 17=65(B) 18=50(B) 19=50(B) 20=50(B) 21=47(B) 22=47(B)
- 17) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-15=-20
Horz: 1-15=17, 8-9=5
Concentrated Loads (lb)
Vert: 13=50(B) 11=47(B) 16=53(B) 17=65(B) 18=50(B) 19=50(B) 20=50(B) 21=47(B) 22=47(B)
- 18) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-15=-20
Horz: 1-15=-5, 8-9=-17
Concentrated Loads (lb)
Vert: 13=50(B) 11=47(B) 16=53(B) 17=65(B) 18=50(B) 19=50(B) 20=50(B) 21=47(B) 22=47(B)
- 19) Dead + 0.6 MWFRS Wind Min. Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-712, 9-15=-8
Horz: 1-15=16
Concentrated Loads (lb)
Vert: 13=53(B) 11=55(B) 16=66(B) 17=78(B) 18=53(B) 19=53(B) 20=53(B) 21=55(B) 22=55(B)
- 20) Dead + 0.6 MWFRS Wind Min. Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-712, 9-15=-8
Horz: 8-9=-16
Concentrated Loads (lb)
Vert: 13=53(B) 11=55(B) 16=66(B) 17=78(B) 18=53(B) 19=53(B) 20=53(B) 21=55(B) 22=55(B)
- 21) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-15=-8
Horz: 1-15=15, 8-9=19
Concentrated Loads (lb)
Vert: 13=-244(B) 11=-223(B) 16=-207(B) 17=-198(B) 18=-244(B) 19=-244(B) 20=-244(B) 21=-223(B) 22=-223(B)
- 22) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-15=-8
Horz: 1-15=-19, 8-9=-15
Concentrated Loads (lb)
Vert: 13=-244(B) 11=-223(B) 16=-207(B) 17=-198(B) 18=-244(B) 19=-244(B) 20=-244(B) 21=-223(B) 22=-223(B)
- 23) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-15=-20
Horz: 1-15=26, 8-9=9
Concentrated Loads (lb)
Vert: 13=-232(B) 11=-212(B) 16=-198(B) 17=-187(B) 18=-232(B) 19=-232(B) 20=-232(B) 21=-212(B) 22=-212(B)
- 24) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-15=-20
Horz: 1-15=-9, 8-9=-26
Concentrated Loads (lb)
Vert: 13=-232(B) 11=-212(B) 16=-198(B) 17=-187(B) 18=-232(B) 19=-232(B) 20=-232(B) 21=-212(B) 22=-212(B)
- 25) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-15=-8
Horz: 1-15=13, 8-9=18
Concentrated Loads (lb)
Vert: 13=-244(B) 11=-223(B) 16=-207(B) 17=-198(B) 18=-244(B) 19=-244(B) 20=-244(B) 21=-223(B) 22=-223(B)

Continued on page 4

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Roeser/1487 Winterset	145732394
2742340	GR1	Flat Girder	1	2	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:11 2021 Page 4
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-xfgfYVoCP1qYEmnS7Qw7gyE5i5A4rhV?DjRIRWzP4eo

LOAD CASE(S) Standard

- 26) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-15=-8
Horz: 1-15=-18, 8-9=-13
Concentrated Loads (lb)
Vert: 13=-244(B) 11=-223(B) 16=-207(B) 17=-198(B) 18=-244(B) 19=-244(B) 20=-244(B) 21=-223(B) 22=-223(B)
- 27) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-686, 9-15=-8
Horz: 1-15=6, 8-9=14
Concentrated Loads (lb)
Vert: 13=-244(B) 11=-223(B) 16=-207(B) 17=-198(B) 18=-244(B) 19=-244(B) 20=-244(B) 21=-223(B) 22=-223(B)
- 28) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-686, 9-15=-8
Horz: 1-15=-14, 8-9=-6
Concentrated Loads (lb)
Vert: 13=-244(B) 11=-223(B) 16=-207(B) 17=-198(B) 18=-244(B) 19=-244(B) 20=-244(B) 21=-223(B) 22=-223(B)
- 29) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-15=-20
Horz: 1-15=23, 8-9=7
Concentrated Loads (lb)
Vert: 13=-232(B) 11=-212(B) 16=-198(B) 17=-187(B) 18=-232(B) 19=-232(B) 20=-232(B) 21=-212(B) 22=-212(B)
- 30) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-15=-20
Horz: 1-15=-7, 8-9=-23
Concentrated Loads (lb)
Vert: 13=-232(B) 11=-212(B) 16=-198(B) 17=-187(B) 18=-232(B) 19=-232(B) 20=-232(B) 21=-212(B) 22=-212(B)
- 31) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-15=-20
Horz: 1-15=19, 8-9=7
Concentrated Loads (lb)
Vert: 13=-424(B) 11=-408(B) 16=-399(B) 17=-389(B) 18=-424(B) 19=-424(B) 20=-424(B) 21=-408(B) 22=-408(B)
- 32) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-15=-20
Horz: 1-15=-7, 8-9=-19
Concentrated Loads (lb)
Vert: 13=-424(B) 11=-408(B) 16=-399(B) 17=-389(B) 18=-424(B) 19=-424(B) 20=-424(B) 21=-408(B) 22=-408(B)
- 33) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-15=-20
Horz: 1-15=17, 8-9=5
Concentrated Loads (lb)
Vert: 13=-424(B) 11=-408(B) 16=-399(B) 17=-389(B) 18=-424(B) 19=-424(B) 20=-424(B) 21=-408(B) 22=-408(B)
- 34) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-15=-20
Horz: 1-15=-5, 8-9=-17
Concentrated Loads (lb)
Vert: 13=-424(B) 11=-408(B) 16=-399(B) 17=-389(B) 18=-424(B) 19=-424(B) 20=-424(B) 21=-408(B) 22=-408(B)
- 35) Reversal: Dead + 0.6 MWFRS Wind Min. Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-712, 9-15=-8
Horz: 1-15=16
Concentrated Loads (lb)
Vert: 13=-201(B) 11=-188(B) 16=-172(B) 17=-163(B) 18=-201(B) 19=-201(B) 20=-201(B) 21=-188(B) 22=-188(B)
- 36) Reversal: Dead + 0.6 MWFRS Wind Min. Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-712, 9-15=-8
Horz: 8-9=16
Concentrated Loads (lb)
Vert: 13=-201(B) 11=-188(B) 16=-172(B) 17=-163(B) 18=-201(B) 19=-201(B) 20=-201(B) 21=-188(B) 22=-188(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss GR2	Truss Type Flat Girder	Qty 1	Ply 2	Roeser/1487 Winterset Job Reference (optional)	145732395
----------------	--------------	---------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:13 2021 Page 1
 ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-t1oPzBpTxe4GT4xrErybmNJRVnCJYClg0wrWOzP4em



Scale: 3/8"=1'


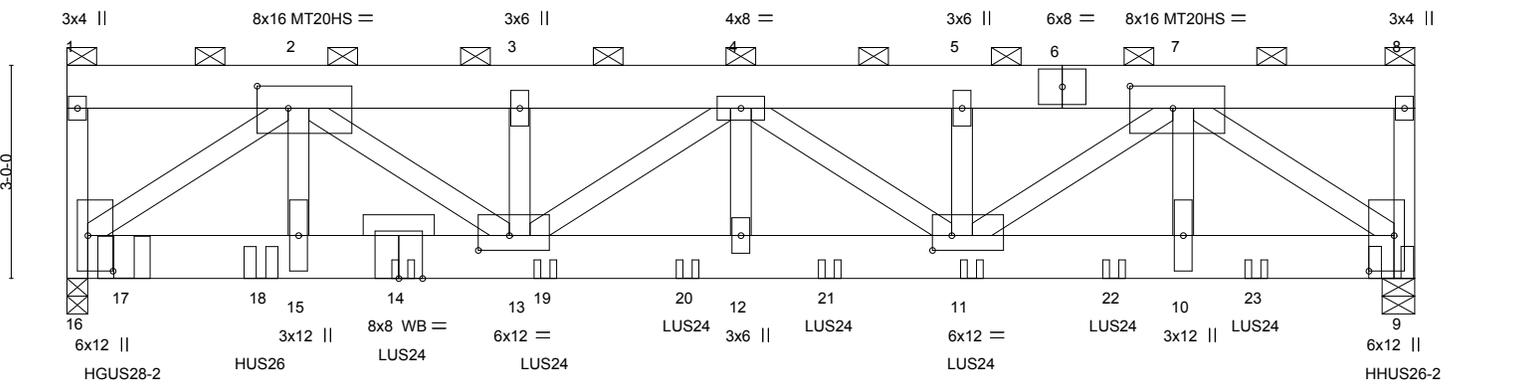


Plate Offsets (X,Y)-- [2:0-5-4,0-3-12], [7:0-7-4,0-3-12], [9:0-6-0,0-4-4], [11:0-3-4,0-2-8], [13:0-5-4,0-2-8], [16:0-6-0,0-4-4]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.31	Vert(LL)	-0.06	12	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.57	Vert(CT)	-0.30	12	>746	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	NO	WB 0.83	Horz(CT)	0.07	9	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						
								Weight: 309 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x8 SP 2400F 2.0E	TOP CHORD 2-0-0 oc purlins (5-8-9 max.); 1-8, except end verticals.
BOT CHORD 2x8 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2 *Except*	
OTHERS 2-16,2-13,4-13,4-11,7-9: 2x4 SPF 1650F 1.5E	
2x4 SPF No.2	

REACTIONS. (size) 9=0-5-8, 16=0-3-8
 Max Horz 16=-82(LC 6)
 Max Grav 9=12034(LC 1), 16=11578(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-16=-1228/0, 2-3=-18089/0, 3-4=-18089/0, 4-5=-17968/0, 5-7=-17968/0, 8-9=-1204/0
 BOT CHORD 15-16=0/11532, 13-15=0/11532, 12-13=0/20341, 11-12=0/20341, 10-11=0/11240,
 9-10=0/11240
 WEBS 2-16=-14300/0, 2-15=-62/1141, 2-13=0/8277, 3-13=-2100/0, 4-13=-2843/0,
 4-12=-199/908, 4-11=-2995/0, 5-11=-2070/0, 7-11=0/8492, 7-10=-344/752,
 7-9=-13960/0

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
 Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.
 Bottom chords connected as follows: 2x8 - 2 rows staggered at 0-5-0 oc.
 Webs connected as follows: 2x4 - 1 row at 0-7-0 oc, Except member 2-15 2x4 - 1 row at 0-9-0 oc, member 13-2 2x4 - 1 row at 0-9-0 oc, member 3-13 2x4 - 1 row at 0-9-0 oc, member 13-4 2x4 - 1 row at 0-9-0 oc, member 4-12 2x4 - 1 row at 0-9-0 oc, member 11-4 2x4 - 1 row at 0-9-0 oc, member 5-11 2x4 - 1 row at 0-9-0 oc, member 11-7 2x4 - 1 row at 0-9-0 oc, member 7-10 2x4 - 1 row at 0-9-0 oc.
 - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are MT20 plates unless otherwise indicated.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Bearing at joint(s) 9, 16 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - Provide metal plate or equivalent at bearing(s) 9 to support reaction shown.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, Contingency have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.



April 20,2021

Job	Truss	Truss Type	Qty	Ply	Roeser/1487 Winterset	145732395
2742340	GR2	Flat Girder	1	2	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:13 2021 Page 2
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-t1oPzBpTxe4GT4xrErybmNJRvnCJYCjg0wrWOzP4em

NOTES-

- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 12) Use Simpson Strong-Tie HGUS28-2 (36-10d Girder, 6-10d Truss) or equivalent at 0-9-10 from the left end to connect truss(es) to back face of bottom chord.
- 13) Use Simpson Strong-Tie HUS26 (14-10d Girder, 4-10d Truss) or equivalent at 2-8-12 from the left end to connect truss(es) to back face of bottom chord.
- 14) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 4-8-12 from the left end to 16-8-12 to connect truss(es) to back face of bottom chord.
- 15) Use Simpson Strong-Tie HHUS26-2 (14-10d Girder, 4-10d Truss) or equivalent at 18-9-12 from the left end to connect truss(es) to back face of bottom chord.
- 16) Fill all nail holes where hanger is in contact with lumber.

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-8=-770, 9-16=-20
Concentrated Loads (lb)
Vert: 14=-677(B) 11=-672(B) 9=-1841(B) 17=-1620(B) 18=-677(B) 19=-678(B) 20=-678(B) 21=-678(B) 22=-672(B) 23=-672(B)
- 2) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (plf)
Vert: 1-8=-758, 9-16=-20
Concentrated Loads (lb)
Vert: 14=-582(B) 11=-576(B) 9=-1580(B) 17=-1493(B) 18=-582(B) 19=-583(B) 20=-583(B) 21=-583(B) 22=-576(B) 23=-576(B)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
Uniform Loads (plf)
Vert: 1-8=-720, 9-16=-40
Concentrated Loads (lb)
Vert: 14=-437(B) 11=-425(B) 9=-1167(B) 17=-1285(B) 18=-437(B) 19=-438(B) 20=-438(B) 21=-438(B) 22=-425(B) 23=-425(B)
- 4) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-16=-8
Horz: 1-16=15, 8-9=19
Concentrated Loads (lb)
Vert: 14=102(B) 11=137(B) 9=377(B) 17=-923(B) 18=102(B) 19=101(B) 20=101(B) 21=101(B) 22=114(B) 23=121(B)
- 5) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-16=-8
Horz: 1-16=-19, 8-9=-15
Concentrated Loads (lb)
Vert: 14=102(B) 11=137(B) 9=377(B) 17=-923(B) 18=102(B) 19=101(B) 20=101(B) 21=101(B) 22=114(B) 23=121(B)
- 6) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-16=-20
Horz: 1-16=26, 8-9=9
Concentrated Loads (lb)
Vert: 14=113(B) 11=148(B) 9=384(B) 17=-914(B) 18=113(B) 19=113(B) 20=113(B) 21=113(B) 22=126(B) 23=133(B)
- 7) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-16=-20
Horz: 1-16=-9, 8-9=-26
Concentrated Loads (lb)
Vert: 14=113(B) 11=148(B) 9=384(B) 17=-914(B) 18=113(B) 19=113(B) 20=113(B) 21=113(B) 22=126(B) 23=133(B)
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-16=-8
Horz: 1-16=13, 8-9=18
Concentrated Loads (lb)
Vert: 14=102(B) 11=137(B) 9=377(B) 17=-923(B) 18=102(B) 19=101(B) 20=101(B) 21=101(B) 22=114(B) 23=121(B)
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-16=-8
Horz: 1-16=-18, 8-9=-13
Concentrated Loads (lb)
Vert: 14=102(B) 11=137(B) 9=377(B) 17=-923(B) 18=102(B) 19=101(B) 20=101(B) 21=101(B) 22=114(B) 23=121(B)
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-686, 9-16=-8
Horz: 1-16=6, 8-9=14
Concentrated Loads (lb)
Vert: 14=102(B) 11=137(B) 9=377(B) 17=-923(B) 18=102(B) 19=101(B) 20=101(B) 21=101(B) 22=114(B) 23=121(B)
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-686, 9-16=-8
Horz: 1-16=-14, 8-9=-6
Concentrated Loads (lb)
Vert: 14=102(B) 11=137(B) 9=377(B) 17=-923(B) 18=102(B) 19=101(B) 20=101(B) 21=101(B) 22=114(B) 23=121(B)
- 12) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-16=-20
Horz: 1-16=23, 8-9=7

Continued on page 3

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Roeser/1487 Winterset	145732395
2742340	GR2	Flat Girder	1	2	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:13 2021 Page 3
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-t1oPzBpTxe4GT4xrErybmNJRrvnCYJCJg0wrWOzP4em

LOAD CASE(S) Standard

- Concentrated Loads (lb)
Vert: 14=113(B) 11=148(B) 9=384(B) 17=-914(B) 18=113(B) 19=113(B) 20=113(B) 21=113(B) 22=126(B) 23=133(B)
- 13) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-16=-20
Horz: 1-16=-7, 8-9=-23
Concentrated Loads (lb)
Vert: 14=113(B) 11=148(B) 9=384(B) 17=-914(B) 18=113(B) 19=113(B) 20=113(B) 21=113(B) 22=126(B) 23=133(B)
- 14) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90
Uniform Loads (plf)
Vert: 1-8=-720, 9-16=-20
Concentrated Loads (lb)
Vert: 14=-297(B) 11=-289(B) 9=-798(B) 17=-1110(B) 18=-297(B) 19=-298(B) 20=-298(B) 21=-298(B) 22=-289(B) 23=-289(B)
- 15) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-16=-20
Horz: 1-16=19, 8-9=7
Concentrated Loads (lb)
Vert: 14=49(B) 11=77(B) 9=187(B) 17=-914(B) 18=49(B) 19=49(B) 20=49(B) 21=49(B) 22=60(B) 23=65(B)
- 16) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-16=-20
Horz: 1-16=-7, 8-9=-19
Concentrated Loads (lb)
Vert: 14=49(B) 11=77(B) 9=187(B) 17=-914(B) 18=49(B) 19=49(B) 20=49(B) 21=49(B) 22=60(B) 23=65(B)
- 17) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-16=-20
Horz: 1-16=17, 8-9=5
Concentrated Loads (lb)
Vert: 14=49(B) 11=77(B) 9=187(B) 17=-914(B) 18=49(B) 19=49(B) 20=49(B) 21=49(B) 22=60(B) 23=65(B)
- 18) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-16=-20
Horz: 1-16=-5, 8-9=-17
Concentrated Loads (lb)
Vert: 14=49(B) 11=77(B) 9=187(B) 17=-914(B) 18=49(B) 19=49(B) 20=49(B) 21=49(B) 22=60(B) 23=65(B)
- 19) Dead + 0.6 MWFRS Wind Min. Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-712, 9-16=-8
Horz: 1-16=16
Concentrated Loads (lb)
Vert: 14=61(B) 11=96(B) 9=261(B) 17=-923(B) 18=61(B) 19=61(B) 20=61(B) 21=61(B) 22=73(B) 23=80(B)
- 20) Dead + 0.6 MWFRS Wind Min. Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-712, 9-16=-8
Horz: 8-9=16
Concentrated Loads (lb)
Vert: 14=61(B) 11=96(B) 9=261(B) 17=-923(B) 18=61(B) 19=61(B) 20=61(B) 21=61(B) 22=73(B) 23=80(B)
- 21) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-16=-8
Horz: 1-16=15, 8-9=19
Concentrated Loads (lb)
Vert: 14=-258(B) 11=-228(B) 9=-755(B) 17=-1200(B) 18=-258(B) 19=-258(B) 20=-258(B) 21=-258(B) 22=-236(B) 23=-205(B)
- 22) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-16=-8
Horz: 1-16=-19, 8-9=-15
Concentrated Loads (lb)
Vert: 14=-258(B) 11=-228(B) 9=-755(B) 17=-1200(B) 18=-258(B) 19=-258(B) 20=-258(B) 21=-258(B) 22=-236(B) 23=-205(B)
- 23) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-16=-20
Horz: 1-16=26, 8-9=9
Concentrated Loads (lb)
Vert: 14=-246(B) 11=-217(B) 9=-749(B) 17=-1191(B) 18=-246(B) 19=-246(B) 20=-246(B) 21=-246(B) 22=-224(B) 23=-193(B)
- 24) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-16=-20
Horz: 1-16=-9, 8-9=-26

Continued on page 4

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Roeser/1487 Winterset	145732395
2742340	GR2	Flat Girder	1	2	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:13 2021 Page 4
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-t1oPzBtXe4GT4xrErybmNJRrvnCYCJg0wrWOzP4em

LOAD CASE(S) Standard

- Concentrated Loads (lb)
Vert: 14=-246(B) 11=-217(B) 9=-749(B) 17=-1191(B) 18=-246(B) 19=-246(B) 20=-246(B) 21=-246(B) 22=-224(B) 23=-193(B)
- 25) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-16=-8
Horz: 1-16=13, 8-9=18
Concentrated Loads (lb)
Vert: 14=-258(B) 11=-228(B) 9=-755(B) 17=-1200(B) 18=-258(B) 19=-258(B) 20=-258(B) 21=-258(B) 22=-236(B) 23=-205(B)
- 26) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-675, 9-16=-8
Horz: 1-16=-18, 8-9=-13
Concentrated Loads (lb)
Vert: 14=-258(B) 11=-228(B) 9=-755(B) 17=-1200(B) 18=-258(B) 19=-258(B) 20=-258(B) 21=-258(B) 22=-236(B) 23=-205(B)
- 27) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-686, 9-16=-8
Horz: 1-16=6, 8-9=14
Concentrated Loads (lb)
Vert: 14=-258(B) 11=-228(B) 9=-755(B) 17=-1200(B) 18=-258(B) 19=-258(B) 20=-258(B) 21=-258(B) 22=-236(B) 23=-205(B)
- 28) Reversal: Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-686, 9-16=-8
Horz: 1-16=-14, 8-9=-6
Concentrated Loads (lb)
Vert: 14=-258(B) 11=-228(B) 9=-755(B) 17=-1200(B) 18=-258(B) 19=-258(B) 20=-258(B) 21=-258(B) 22=-236(B) 23=-205(B)
- 29) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-16=-20
Horz: 1-16=23, 8-9=7
Concentrated Loads (lb)
Vert: 14=-246(B) 11=-217(B) 9=-749(B) 17=-1191(B) 18=-246(B) 19=-246(B) 20=-246(B) 21=-246(B) 22=-224(B) 23=-193(B)
- 30) Reversal: Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-694, 9-16=-20
Horz: 1-16=-7, 8-9=-23
Concentrated Loads (lb)
Vert: 14=-246(B) 11=-217(B) 9=-749(B) 17=-1191(B) 18=-246(B) 19=-246(B) 20=-246(B) 21=-246(B) 22=-224(B) 23=-193(B)
- 31) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-16=-20
Horz: 1-16=19, 8-9=7
Concentrated Loads (lb)
Vert: 14=-473(B) 11=-450(B) 9=-1255(B) 17=-1431(B) 18=-473(B) 19=-473(B) 20=-473(B) 21=-473(B) 22=-456(B) 23=-433(B)
- 32) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-16=-20
Horz: 1-16=-7, 8-9=-19
Concentrated Loads (lb)
Vert: 14=-473(B) 11=-450(B) 9=-1255(B) 17=-1431(B) 18=-473(B) 19=-473(B) 20=-473(B) 21=-473(B) 22=-456(B) 23=-433(B)
- 33) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-16=-20
Horz: 1-16=17, 8-9=5
Concentrated Loads (lb)
Vert: 14=-473(B) 11=-450(B) 9=-1255(B) 17=-1431(B) 18=-473(B) 19=-473(B) 20=-473(B) 21=-473(B) 22=-456(B) 23=-433(B)
- 34) Reversal: Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-738, 9-16=-20
Horz: 1-16=-5, 8-9=-17
Concentrated Loads (lb)
Vert: 14=-473(B) 11=-450(B) 9=-1255(B) 17=-1431(B) 18=-473(B) 19=-473(B) 20=-473(B) 21=-473(B) 22=-456(B) 23=-433(B)
- 35) Reversal: Dead + 0.6 MWFRS Wind Min. Left: Lumber Increase=1.60, Plate Increase=1.60
Uniform Loads (plf)
Vert: 1-8=-712, 9-16=-8
Horz: 1-16=16
Concentrated Loads (lb)
Vert: 14=-217(B) 11=-187(B) 9=-639(B) 17=-1149(B) 18=-217(B) 19=-217(B) 20=-217(B) 21=-217(B) 22=-195(B) 23=-164(B)
- 36) Reversal: Dead + 0.6 MWFRS Wind Min. Right: Lumber Increase=1.60, Plate Increase=1.60

Continued on page 5

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss GR2	Truss Type Flat Girder	Qty 1	Ply 2	Roeser/1487 Winterset I45732395 Job Reference (optional)
----------------	--------------	---------------------------	----------	-----------------	--

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:13 2021 Page 5
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-t1oPzBpTxe4GT4xrErybmNJRrvnCJYCJg0wrWOzP4em

LOAD CASE(S) Standard

Uniform Loads (plf)

Vert: 1-8=-712, 9-16=-8

Horz: 8-9=-16

Concentrated Loads (lb)

Vert: 14=-217(B) 11=-187(B) 9=-639(B) 17=-1149(B) 18=-217(B) 19=-217(B) 20=-217(B) 21=-217(B) 22=-195(B) 23=-164(B)

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss J1	Truss Type Jack-Open	Qty 7	Ply 1	Roeser/1487 Winterset 145732396
----------------	-------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:14 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-LEMnAXq5iyC75DV1oYtqlascmlE52CURvggP2rzP4el



Scale = 1:11.8

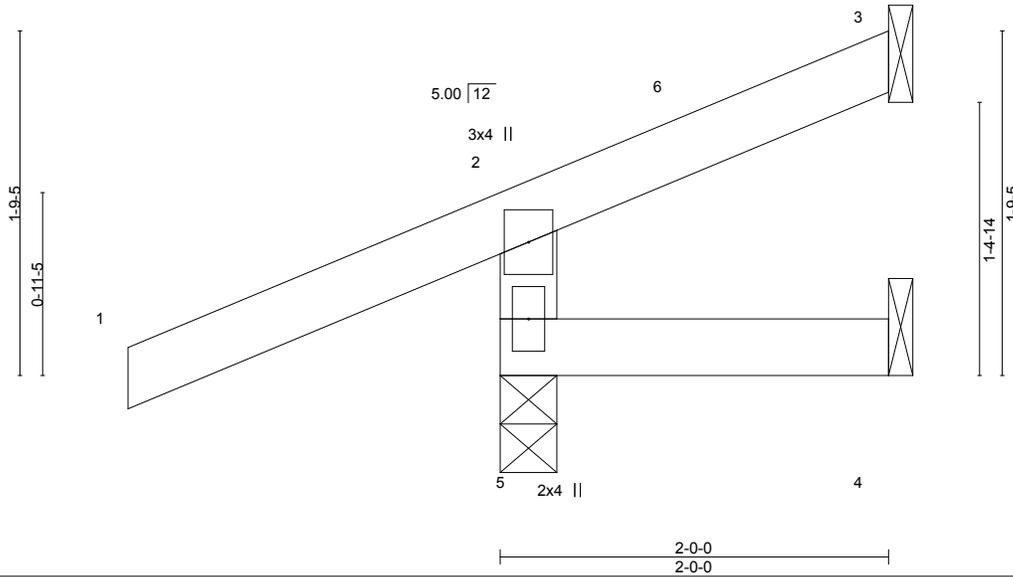

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.30	Vert(LL)	0.00	4-5	>999	240	MT20
TCDL 10.0	Plate Grip DOL 1.15	BC 0.08	Vert(CT)	0.00	4-5	>999	180	197/144
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.01	3	n/a	n/a	
BCDL 10.0	Rep Stress Incr YES	Matrix-MR						
	Code IRC2018/TPI2014							
							Weight: 8 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 3=Mechanical, 4=Mechanical
 Max Horz 5=48(LC 9)
 Max Uplift 5=76(LC 8), 3=16(LC 12), 4=5(LC 1)
 Max Grav 5=308(LC 1), 3=7(LC 22), 4=28(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-266/205

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 1-11-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 76 lb uplift at joint 5, 16 lb uplift at joint 3 and 5 lb uplift at joint 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss J2	Truss Type Jack-Open	Qty 5	Ply 1	Roeser/1487 Winterset 145732397
----------------	-------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:21 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-eahRewvU3658RIYNIW5T43ep?7dZBMDTWGsGoxzP4ee



Scale = 1:12.2

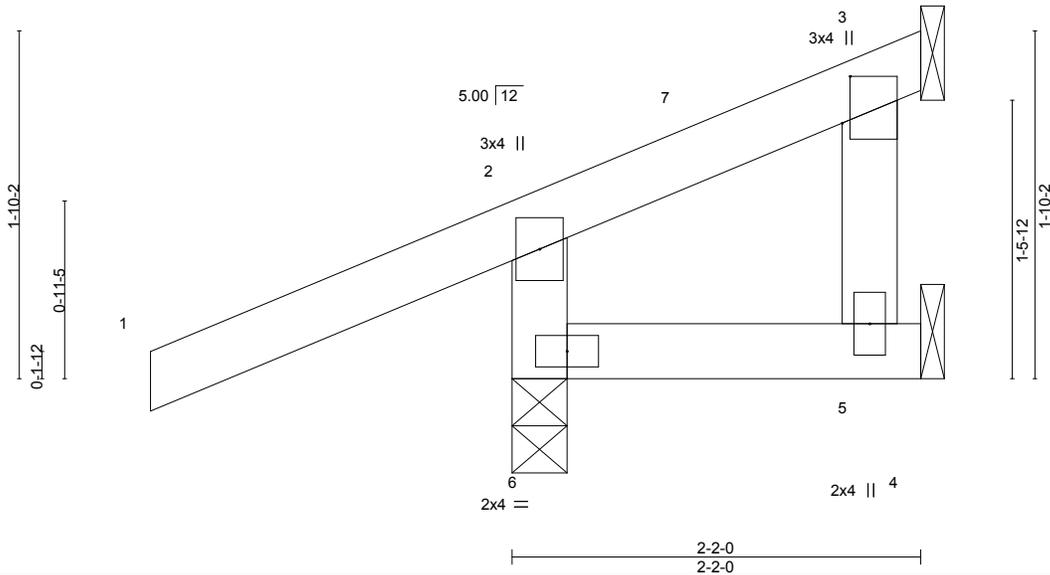


Plate Offsets (X,Y)--	[3:0-3-0,0-0-8]
-----------------------	-----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	0.00	5-6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	0.00	5-6	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	3	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP						
								Weight: 10 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=Mechanical, 3=Mechanical, 6=0-3-8
 Max Horz 6=44(LC 9)
 Max Uplift 5=-5(LC 25), 3=-39(LC 25), 6=-78(LC 8)
 Max Grav 5=37(LC 3), 3=3(LC 8), 6=308(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-266/207

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 1-10-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 5 lb uplift at joint 5, 39 lb uplift at joint 3 and 78 lb uplift at joint 6.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



April 20,2021


Job 2742340	Truss J4	Truss Type Jack-Open	Qty 2	Ply 1	Roeser/1487 Winterset 145732399
----------------	-------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:28 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-xwC46J7tPFz8nNajcUj6sXR?cx0IKXyV7s38Y1zP4eX



Scale = 1:15.7

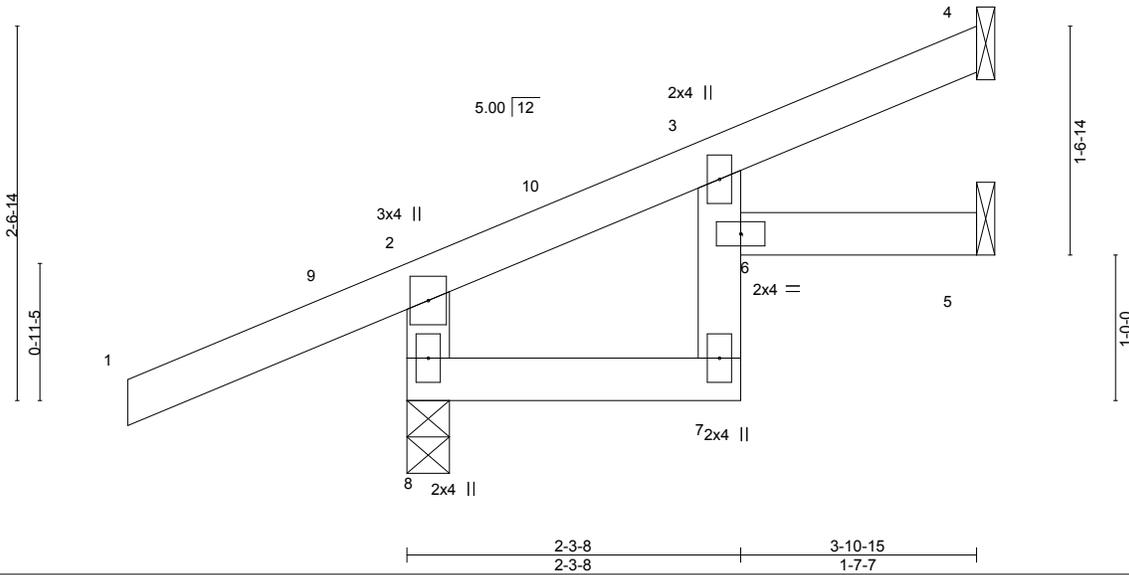

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL. in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL) -0.01	6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT) -0.01	7	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT) 0.01	5	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR				Weight: 14 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-10-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 8=0-3-8, 4=Mechanical, 5=Mechanical
 Max Horz 8=75(LC 12)
 Max Uplift 8=64(LC 8), 4=36(LC 12), 5=7(LC 12)
 Max Grav 8=351(LC 1), 4=88(LC 1), 5=54(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-8=313/203

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 3-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 64 lb uplift at joint 8, 36 lb uplift at joint 4 and 7 lb uplift at joint 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J5	Truss Type Jack-Open	Qty 2	Ply 1	Roeser/1487 Winterset 145732400
----------------	-------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:29 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-P6mSKf0VAZ5?OX9vACFLPI_BfLMG3_CfMWoi4TzP4eW

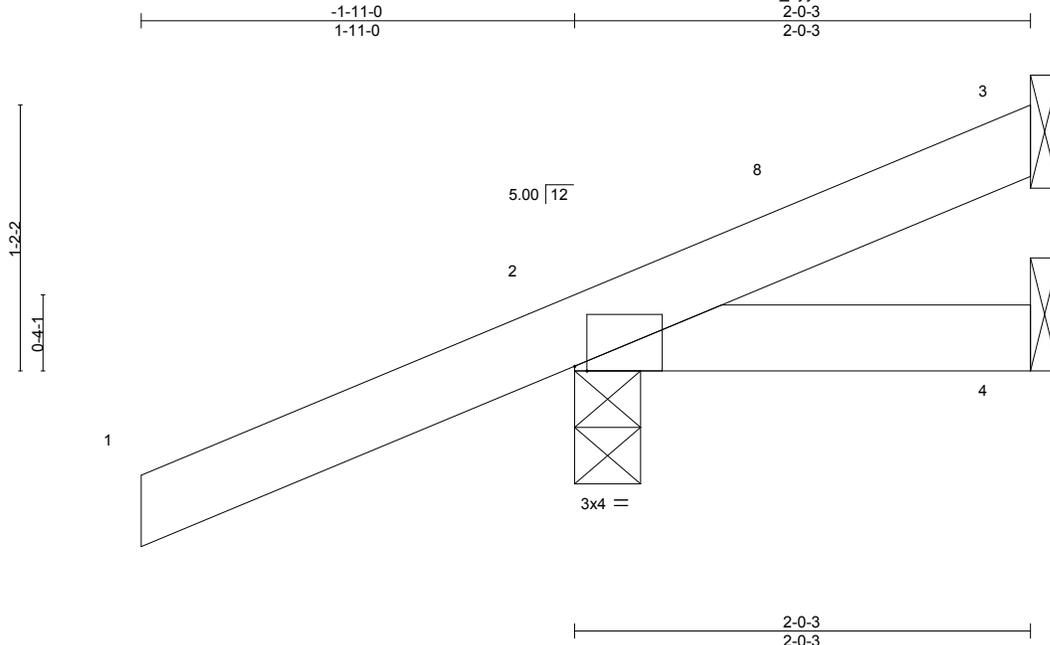

Scale = 1:10.1

Plate Offsets (X,Y)--	[2:0-0-10,Edge]	
LOADING (psf)	SPACING- 2-0-0	CSI.
TCLL 25.0	Plate Grip DOL 1.15	TC 0.25
TCDL 10.0	Lumber DOL 1.15	BC 0.04
BCLL 0.0	Rep Stress Incr YES	WB 0.00
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MP
		DEFL. in (loc) l/defl L/d
		Vert(LL) 0.00 7 >999 240
		Vert(CT) 0.00 7 >999 180
		Horz(CT) 0.00 2 n/a n/a
		PLATES MT20
		GRIP 197/144
		Weight: 7 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 2-0-3 oc purlins.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
 Max Horz 2=55(LC 12)
 Max Uplift 3=-10(LC 12), 2=-83(LC 8), 4=-3(LC 1)
 Max Grav 3=25(LC 1), 2=288(LC 1), 4=25(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) - 1-11-0 to 1-1-0, Interior(1) 1-1-0 to 1-11-7 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 10 lb uplift at joint 3, 83 lb uplift at joint 2 and 3 lb uplift at joint 4.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20,2021


Job 2742340	Truss J6	Truss Type Jack-Open	Qty 7	Ply 1	Roeser/1487 Winterset 145732401
----------------	-------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:29 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-P6mSKf0VAZ5?OX9vACFLPI_A_LLs3_2fMWoi4TzP4eW

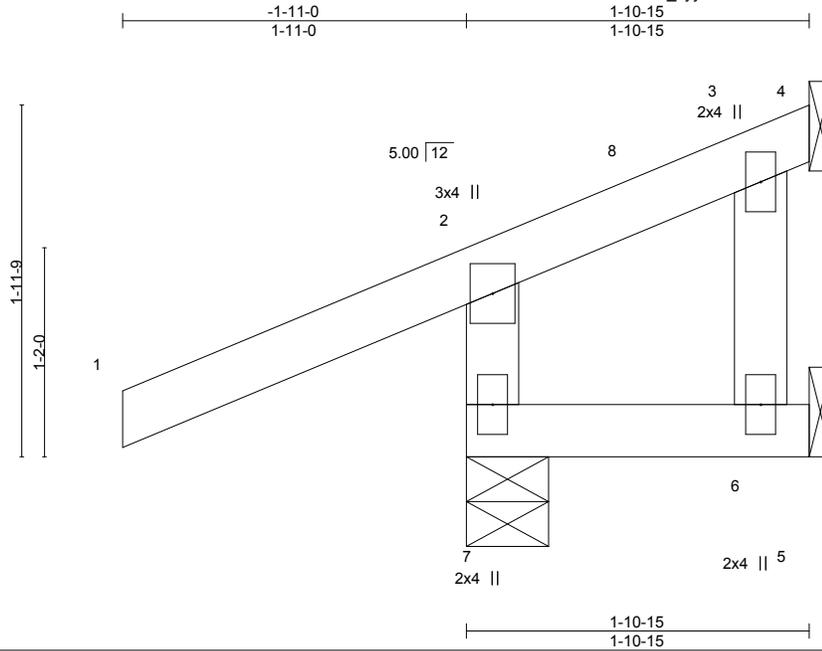

Scale = 1:12.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	0.00	6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00	6	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.01	Horz(CT)	-0.01	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP					Weight: 9 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 7=0-5-8, 4=Mechanical, 5=Mechanical
Max Horz 7=50(LC 11)
Max Uplift 7=73(LC 8), 4=15(LC 12), 5=40(LC 1)
Max Grav 7=308(LC 1), 4=34(LC 1), 5=21(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-7=-277/212

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 1-10-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 73 lb uplift at joint 7, 15 lb uplift at joint 4 and 40 lb uplift at joint 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017


Job 2742340	Truss J7	Truss Type MONO TRUSS	Qty 2	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732402
----------------	-------------	--------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:30 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-tJKqX?07xtDs0hk6kvmayyWLklhRoR6oaAYFcvzP4eV

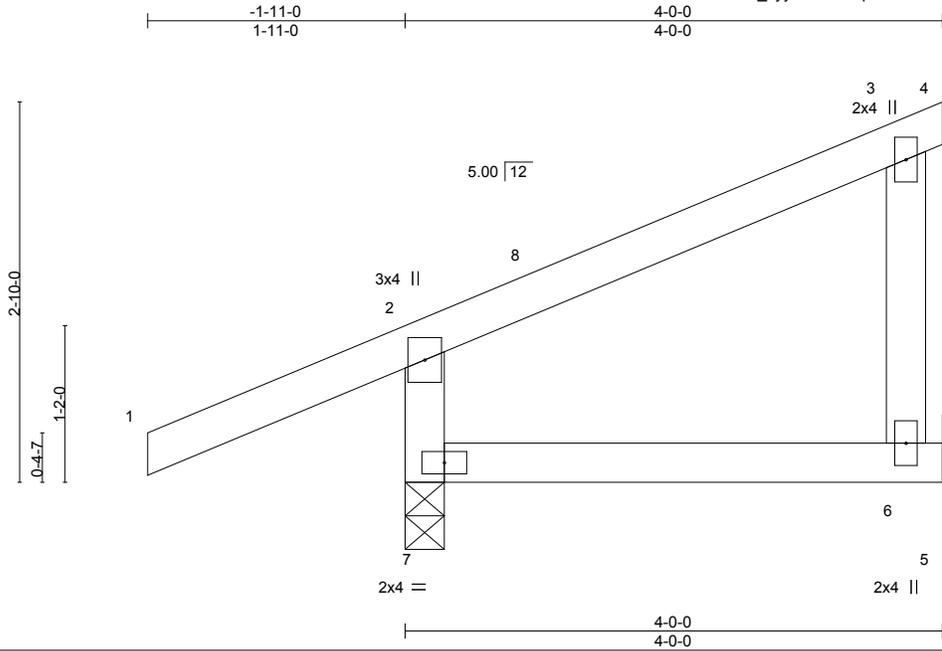

Scale = 1:17.1

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.30	Vert(LL)	-0.01	6-7	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.11	Vert(CT)	-0.02	6-7	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.02	Horz(CT)	0.00		n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MS					Weight: 15 lb	FT = 20%
	Code IRC2018/TPI2014							

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 6=Mechanical, 7=0-3-8
 Max Horz 7=74(LC 12)
 Max Uplift 6=51(LC 12), 7=58(LC 8)
 Max Grav 6=131(LC 1), 7=347(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-7=306/207

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 4-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 51 lb uplift at joint 6 and 58 lb uplift at joint 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J9	Truss Type JACK-OPEN	Qty 4	Ply 1	Roeser/1487 Winterset 145732404
----------------	-------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:31 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFT9-LVuCIL1liAMjlerJIIdHpUA3V?9?cXuhxpqHo8MzP4eU

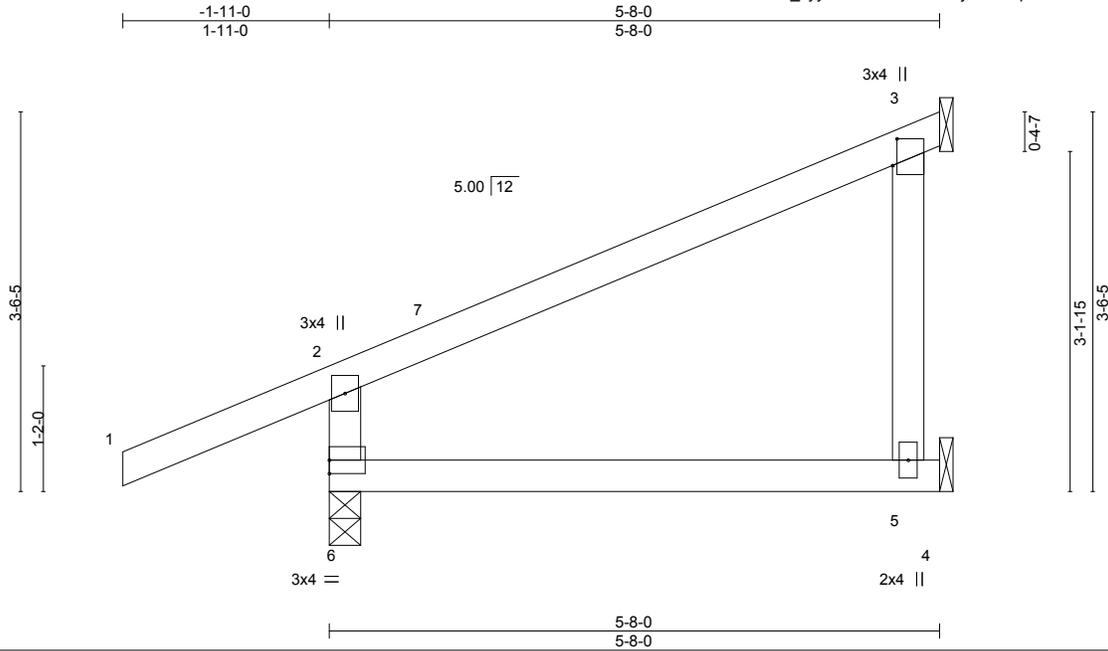

Scale = 1:21.3

Plate Offsets (X,Y)--	[3:0-3:0,0-0-8]
-----------------------	-----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	0.04	5-6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.24	Vert(CT)	-0.07	5-6	>882		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.04	3	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS						
								Weight: 20 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=0-3-8, 5=Mechanical, 3=Mechanical
 Max Horz 6=95(LC 12)
 Max Uplift 6=-58(LC 12), 3=-74(LC 12)
 Max Grav 6=408(LC 1), 5=108(LC 3), 3=153(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-6=-357/223

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 5-4-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 58 lb uplift at joint 6 and 74 lb uplift at joint 3.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 8) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



April 20,2021


Job 2742340	Truss J10	Truss Type Jack-Closed Girder	Qty 1	Ply 1	Roeser/1487 Winterset 145732405
----------------	--------------	----------------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:14 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-LEMnAXq5iyC75DV1oYTqlasfgIAA2AWRvggP2rzP4el

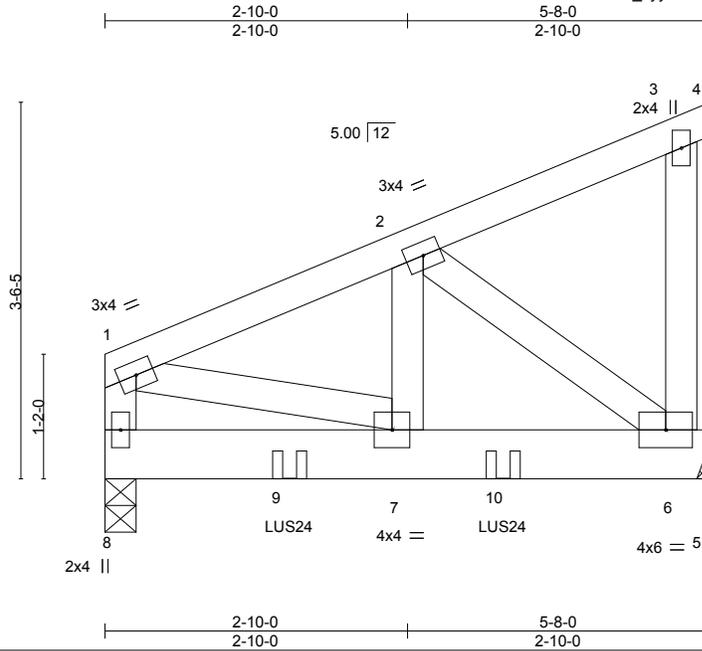

Scale = 1:21.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	-0.01	7-8	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.33	Vert(CT)	-0.02	7-8	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.19	Horz(CT)	0.00	6	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP					Weight: 29 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-8-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 8=0-3-8, 6=Mechanical
 Max Horz 8=117(LC 7)
 Max Uplift 8=-109(LC 8), 6=-140(LC 8)
 Max Grav 8=797(LC 1), 6=790(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-8=-617/94, 1-2=-824/114
 BOT CHORD 6-7=-139/739
 WEBS 1-7=-92/775, 2-7=-85/657, 2-6=-931/175

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 109 lb uplift at joint 8 and 140 lb uplift at joint 6.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 1-8-12 from the left end to 3-8-12 to connect truss(es) to front face of bottom chord.
- 7) Fill all nail holes where hanger is in contact with lumber.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-3=-70, 3-4=-20, 5-8=-20
 Concentrated Loads (lb)
 Vert: 9=-552(F) 10=-552(F)



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J11	Truss Type Jack-Closed Girder	Qty 1	Ply 1	Roeser/1487 Winterset 145732406
----------------	--------------	----------------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:15 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFf9-pQw9OtrjTGL_jN4DMG?3roOmZiQWnfyb8KPyaHzP4ek

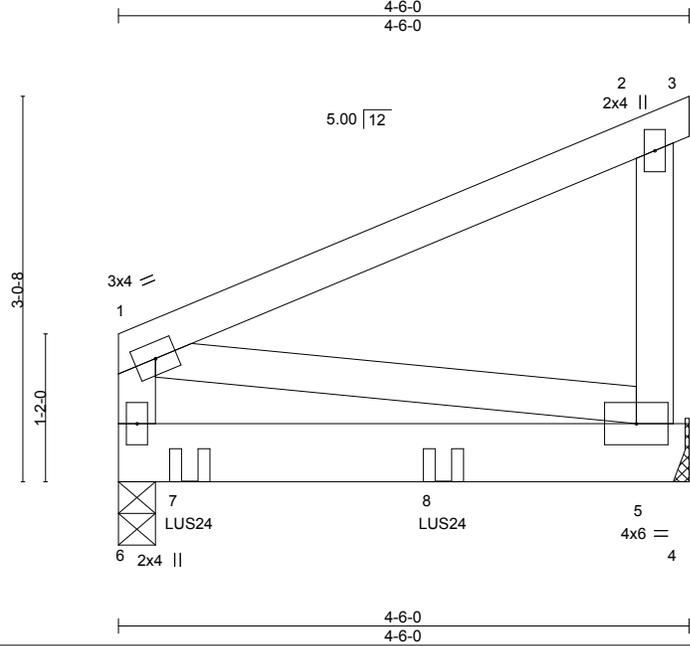

Scale = 1:18.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.36	Vert(LL)	-0.03 5-6	>999	240	MT20	197/144
BCDL 10.0	Lumber DOL	1.15	BC 0.71	Vert(CT)	-0.06 5-6	>782	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.01	Horz(CT)	-0.00 5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP					Weight: 21 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x6 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-6-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 6=0-3-8, 5=Mechanical
 Max Horz 6=98(LC 5)
 Max Uplift 6=-123(LC 8), 5=-104(LC 8)
 Max Grav 6=909(LC 1), 5=579(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 123 lb uplift at joint 6 and 104 lb uplift at joint 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 0-6-12 from the left end to 2-6-12 to connect truss(es) to back face of bottom chord.
- 7) Fill all nail holes where hanger is in contact with lumber.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-20, 4-6=-20
 Concentrated Loads (lb)
 Vert: 7=-558(B) 8=-552(B)



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J12	Truss Type Jack-Open	Qty 1	Ply 1	Roeser/1487 Winterset 145732407
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:16 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-HcUYbCsLEZTrLXFQvzWIN?xz26u5W5_kM_9W6jzP4ej

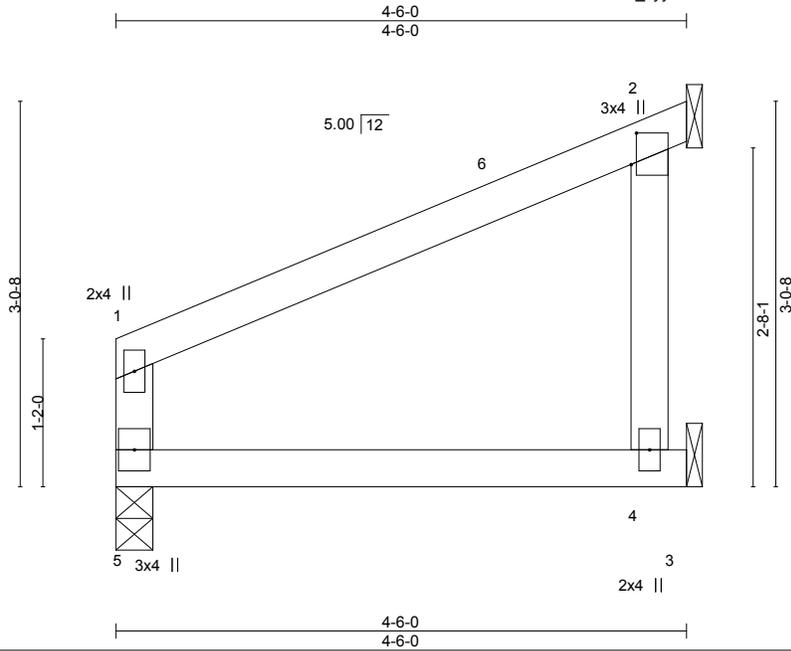

Scale = 1:18.1

Plate Offsets (X,Y)--	[2:0-3-0,0-0-8]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.25	Vert(LL) 0.02 4-5 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.18	Vert(CT) -0.03 4-5 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.00	Horz(CT) -0.03 2 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 14 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 5=0-3-8, 4=Mechanical, 2=Mechanical
 Max Horz 5=59(LC 9)
 Max Uplift 5=-7(LC 12), 2=-62(LC 12)
 Max Grav 5=183(LC 1), 4=89(LC 3), 2=133(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 4-2-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 7 lb uplift at joint 5 and 62 lb uplift at joint 2.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



April 20,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J13	Truss Type Jack-Open	Qty 7	Ply 1	Roeser/1487 Winterset 145732408
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:16 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-HcUYbCsLEZTrLxfQvzWIN?xyQ6uaW5_kM_9W6jzP4ej

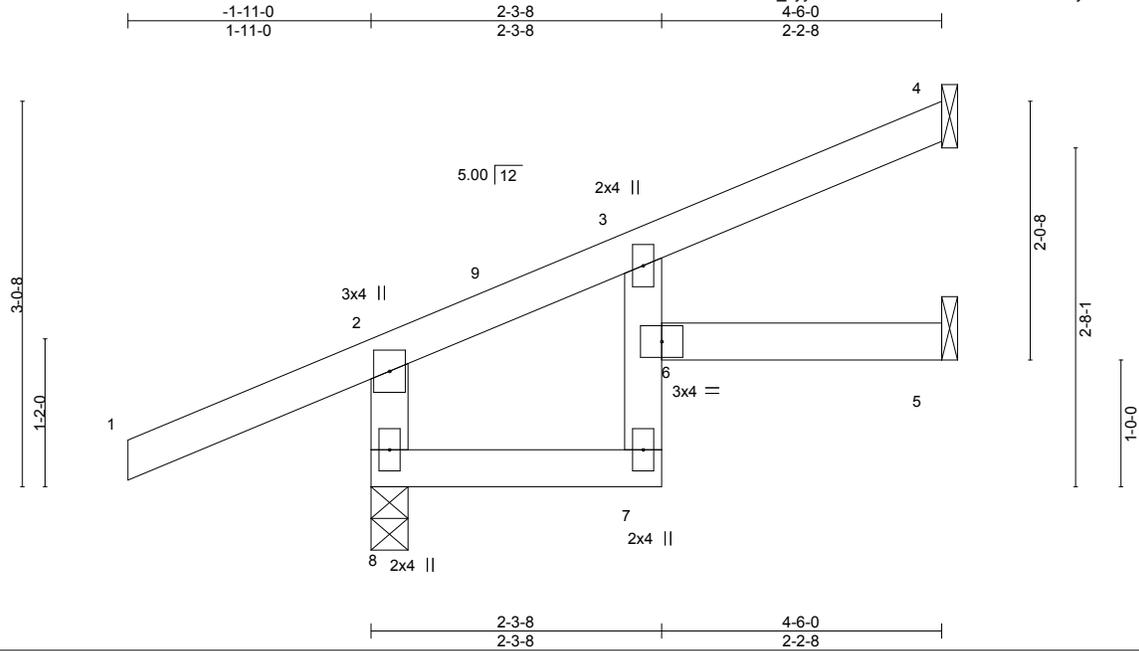

Scale = 1:18.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	0.02	6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	-0.03	6	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 16 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 8=0-3-8, 4=Mechanical, 5=Mechanical
 Max Horz 8=81(LC 12)
 Max Uplift 8=-58(LC 8), 4=-46(LC 12), 5=-9(LC 12)
 Max Grav 8=372(LC 1), 4=107(LC 1), 5=67(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-8=-327/205

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 4-5-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 58 lb uplift at joint 8, 46 lb uplift at joint 4 and 9 lb uplift at joint 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J14	Truss Type Jack-Open	Qty 2	Ply 1	Roeser/1487 Winterset 145732409
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:17 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-lp2wpYsz?tbodyEcTh1XwDU7OWFaFYeubeu3f9zP4ei



Scale = 1:16.9

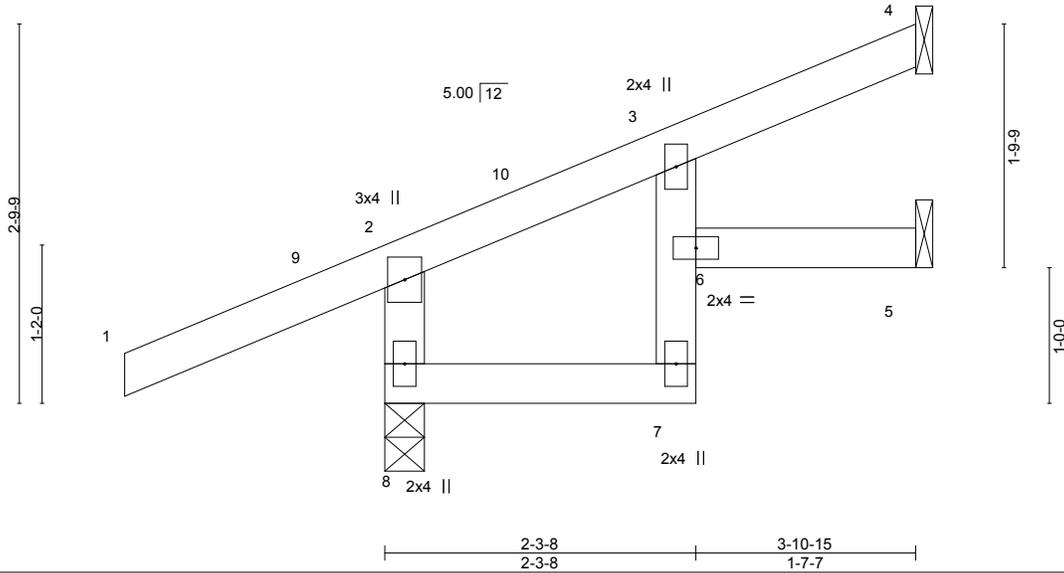

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.01	6	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	-0.01	7	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	5	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MR					Weight: 14 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 3-10-15 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 8=0-3-8, 4=Mechanical, 5=Mechanical
 Max Horz 8=72(LC 12)
 Max Uplift 8=60(LC 8), 4=37(LC 12), 5=10(LC 12)
 Max Grav 8=351(LC 1), 4=89(LC 1), 5=54(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-8=-313/203

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 3-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 60 lb uplift at joint 8, 37 lb uplift at joint 4 and 10 lb uplift at joint 5.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021


Job 2742340	Truss J15	Truss Type Jack-Open	Qty 1	Ply 1	Roeser/1487 Winterset 145732410
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:18 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-E?bl0utbmBjZarpo1OYmTQ0MPwcl_?U1qlecBczP4eh

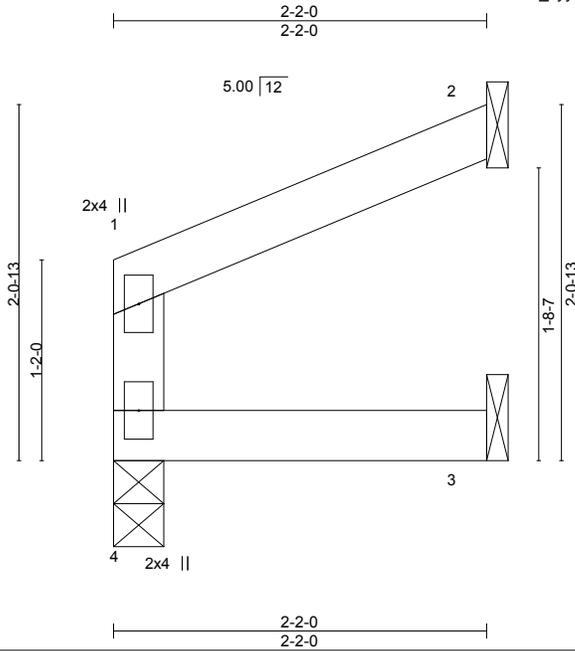

Scale = 1:13.3

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.06	Vert(LL)	-0.00	4	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.06	Vert(CT)	-0.00	3-4	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.01	2	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR					Weight: 6 lb	FT = 20%
	Code IRC2018/TPI2014							

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=0-3-8, 2=Mechanical, 3=Mechanical
 Max Horz 4=38(LC 9)
 Max Uplift 2=33(LC 12), 3=-1(LC 9)
 Max Grav 4=88(LC 1), 2=65(LC 1), 3=38(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 33 lb uplift at joint 2 and 1 lb uplift at joint 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J16	Truss Type Jack-Open	Qty 1	Ply 1	Roeser/1487 Winterset 145732411
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:18 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-E?bl0utbmBjZarpo1OYmTQ0Mowcm_?U1qlecBczP4eh

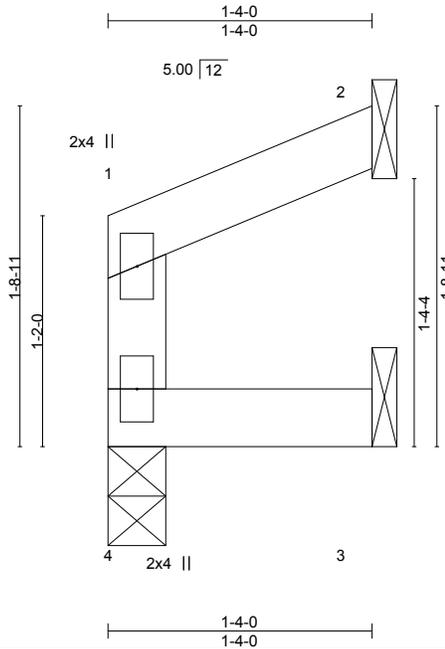

Scale = 1:11.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.04	Vert(LL)	-0.00	4	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	4	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	2	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR					Weight: 4 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-4-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=0-3-8, 2=Mechanical, 3=Mechanical
 Max Horz 4=30(LC 9)
 Max Uplift 2=22(LC 12), 3=-5(LC 9)
 Max Grav 4=53(LC 1), 2=39(LC 1), 3=23(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 22 lb uplift at joint 2 and 5 lb uplift at joint 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss J17	Truss Type Jack-Open	Qty 10	Ply 1	Roeser/1487 Winterset 145732412
----------------	--------------	-------------------------	-----------	----------	------------------------------------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:19 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-iB9gDEuDXUrQC?O_b53??eZTVJxOjSjA2yNAj2zP4eg



Scale = 1:13.0

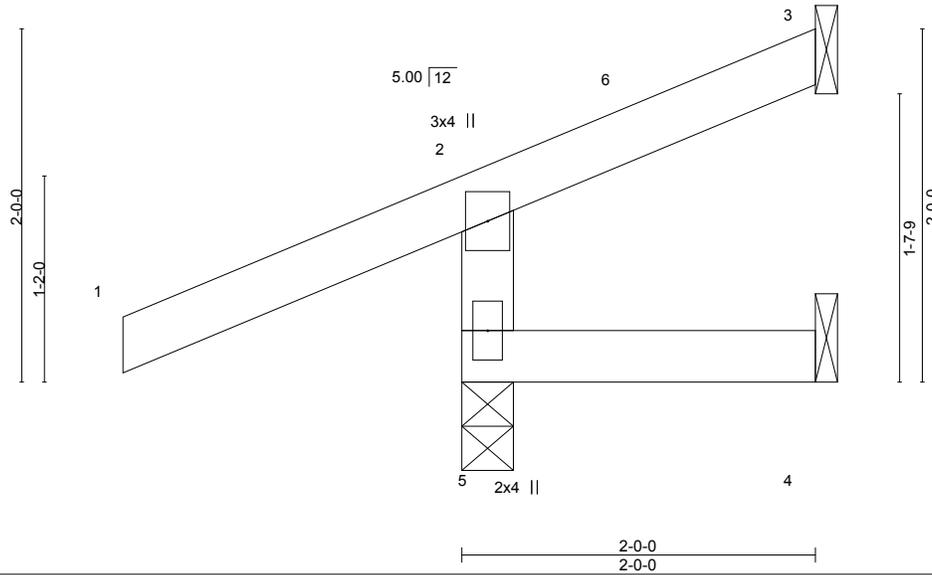

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	0.00 4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	0.00 4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01 3	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MR					Weight: 8 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 3=Mechanical, 4=Mechanical
 Max Horz 5=53(LC 9)
 Max Uplift 5=71(LC 8), 3=18(LC 12), 4=3(LC 1)
 Max Grav 5=308(LC 1), 3=5(LC 22), 4=29(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-269/202

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 1-11-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 71 lb uplift at joint 5, 18 lb uplift at joint 3 and 3 lb uplift at joint 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss J18	Truss Type Jack-Open	Qty 2	Ply 1	Roeser/1487 Winterset 145732413
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:19 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-iB9gDEuDXUrQC?O_b53??eZTfJwMjSjA2yNAj2zP4eg



Scale = 1:16.9

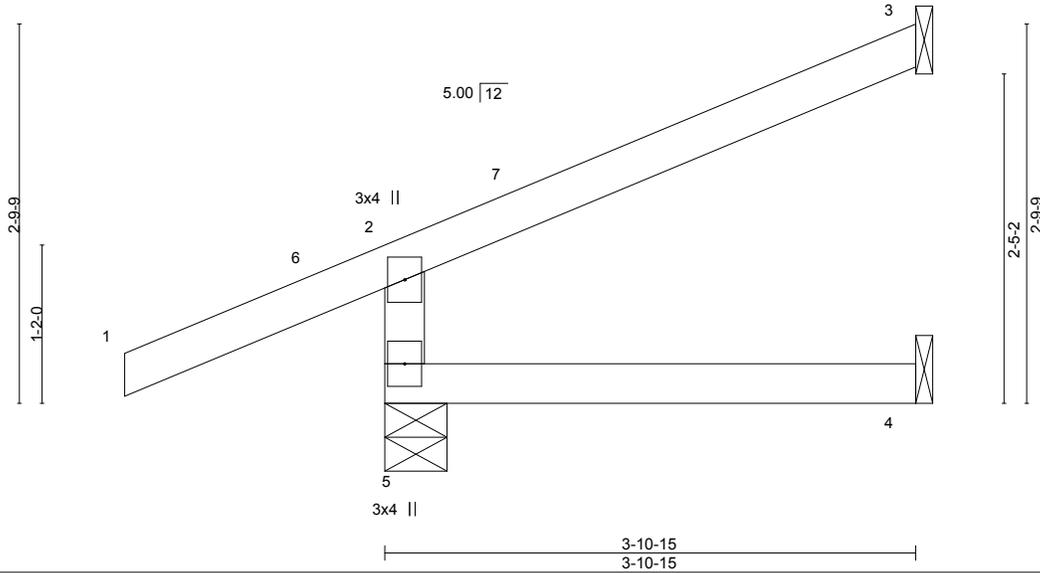

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.01 4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.14	Vert(CT)	-0.02 4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.02 3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR					Weight: 13 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-10-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-5-8, 3=Mechanical, 4=Mechanical
 Max Horz 5=72(LC 12)
 Max Uplift 5=60(LC 8), 3=51(LC 12)
 Max Grav 5=351(LC 1), 3=96(LC 1), 4=67(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=308/209

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 3-10-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 60 lb uplift at joint 5 and 51 lb uplift at joint 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J19	Truss Type Jack-Open	Qty 8	Ply 1	Roeser/1487 Winterset 145732414
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:20 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-ANj2RavslozHp8zB8paEYr6ePjFUSvzKHc7JFUzP4ef

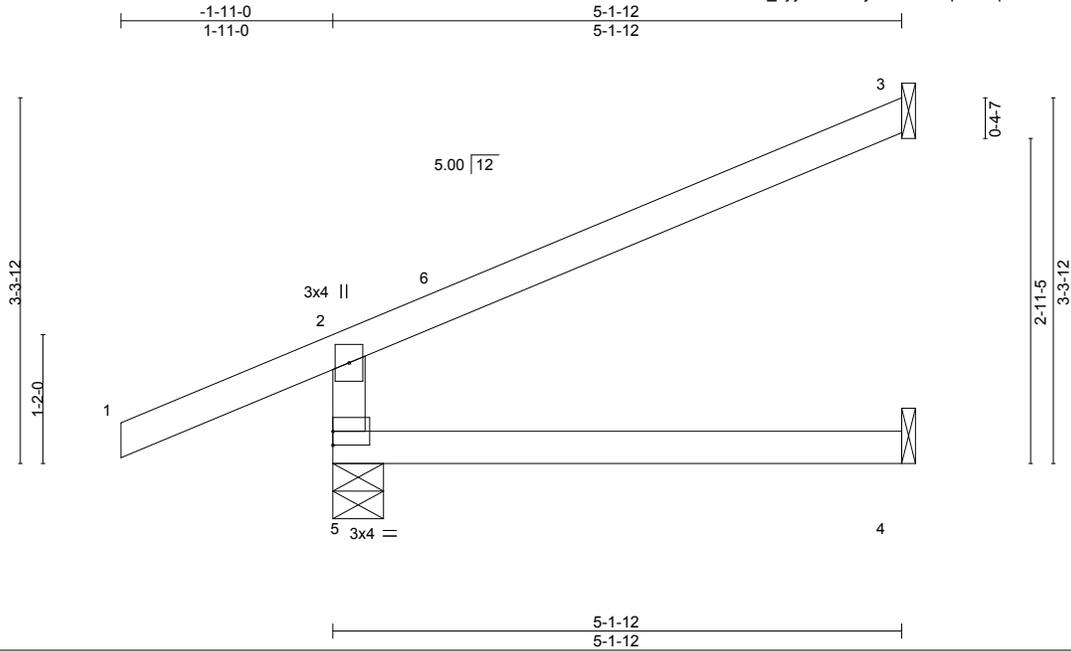

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.03	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.21	Vert(CT)	-0.06	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.04	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 16 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 5=0-5-8, 3=Mechanical, 4=Mechanical
 Max Horz 5=91(LC 12)
 Max Uplift 5=-58(LC 8), 3=-70(LC 12)
 Max Grav 5=397(LC 1), 3=143(LC 1), 4=90(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-347/222

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 5-1-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 58 lb uplift at joint 5 and 70 lb uplift at joint 3.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021

Job 2742340	Truss J21	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732416
----------------	--------------	------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:22 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-6mrpsGw6qPD_3S7ZGEdidGB_vXzJwoSdlwcqKNzP4ed



5x5 =

Scale = 1:18.9

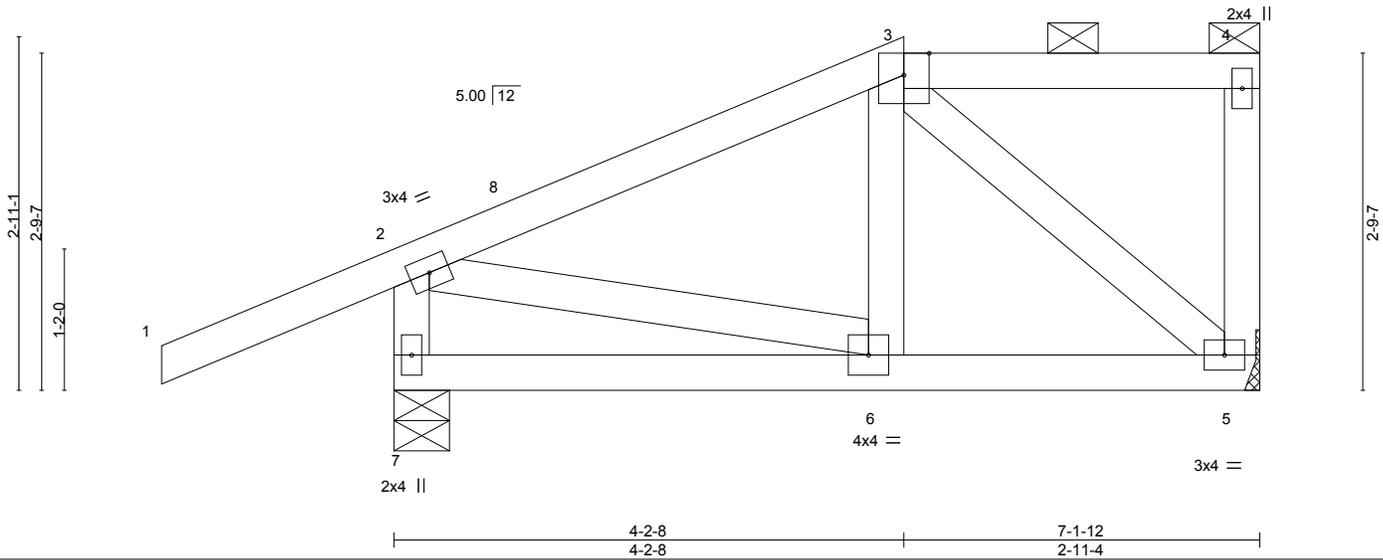

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.01 6-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	-0.02 6-7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.07	Horz(CT)	-0.00 5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 33 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 3-4.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 7=0-5-8, 5=Mechanical
 Max Horz 7=109(LC 9)
 Max Uplift 7=87(LC 8), 5=57(LC 9)
 Max Grav 7=475(LC 1), 5=287(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-268/80, 2-7=-442/247
 WEBS 3-5=-250/154

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 4-2-8, Exterior(2E) 4-2-8 to 7-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 87 lb uplift at joint 7 and 57 lb uplift at joint 5.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss J22	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732417
----------------	--------------	------------------------	----------	----------	---	-----------


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:23 2021 Page 1
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-ayPB3cxkbjLrgcimqx8xAUK9fwl_fJmzaLNspzP4ec



Scale = 1:23.6

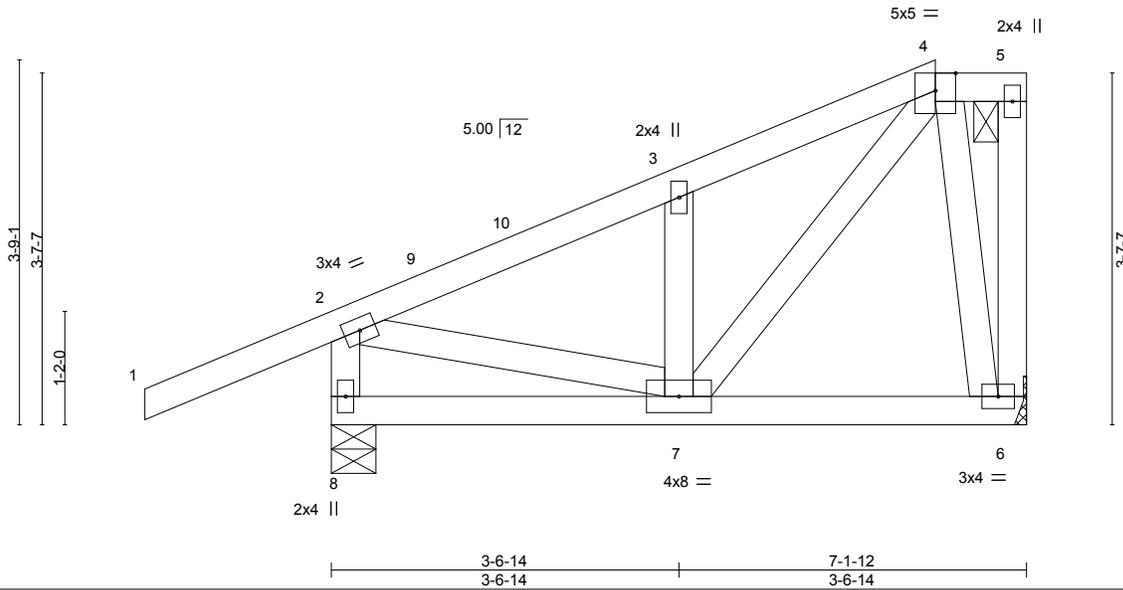

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.01 7-8	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	-0.01 7-8	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	-0.00 6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 38 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 4-5.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 6=Mechanical, 8=0-5-8
Max Horz 8=142(LC 9)
Max Uplift 6=-53(LC 9), 8=-86(LC 12)
Max Grav 6=287(LC 1), 8=475(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-296/69, 3-4=-265/103, 2-8=-446/234
BOT CHORD 7-8=-253/172
WEBS 4-7=-178/261

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 6-2-8, Exterior(2E) 6-2-8 to 7-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 53 lb uplift at joint 6 and 86 lb uplift at joint 8.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss J23	Truss Type Jack-Partial	Qty 2	Ply 1	Roeser/1487 Winterset 145732418
----------------	--------------	----------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:23 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-ayPB3cxkbjLrgcimqx8xAUk8_wEdfGlmzaLNsPzP4ec



Scale = 1:24.7

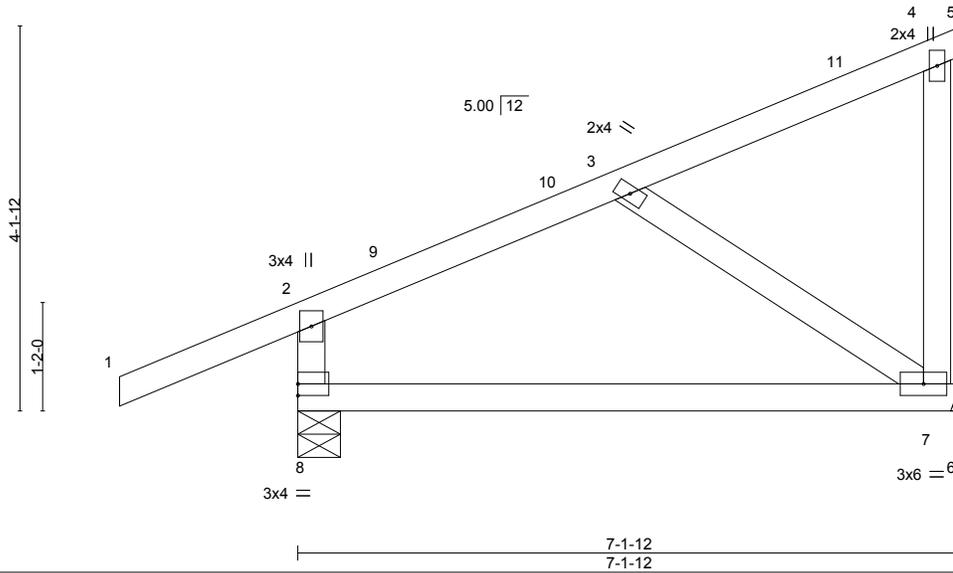

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	-0.08 7-8	>961	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.38	Vert(CT)	-0.16 7-8	>507	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00 7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 29 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 8=0-5-8, 7=Mechanical
 Max Horz 8=116(LC 12)
 Max Uplift 8=64(LC 12), 7=-75(LC 12)
 Max Grav 8=469(LC 1), 7=292(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-8=-386/214, 2-3=-253/54

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 7-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 64 lb uplift at joint 8 and 75 lb uplift at joint 7.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J24	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732419
----------------	--------------	------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:24 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-29zZHxyML1TilmGyNfAihGHKc5OivvCE5xPGzP4eb

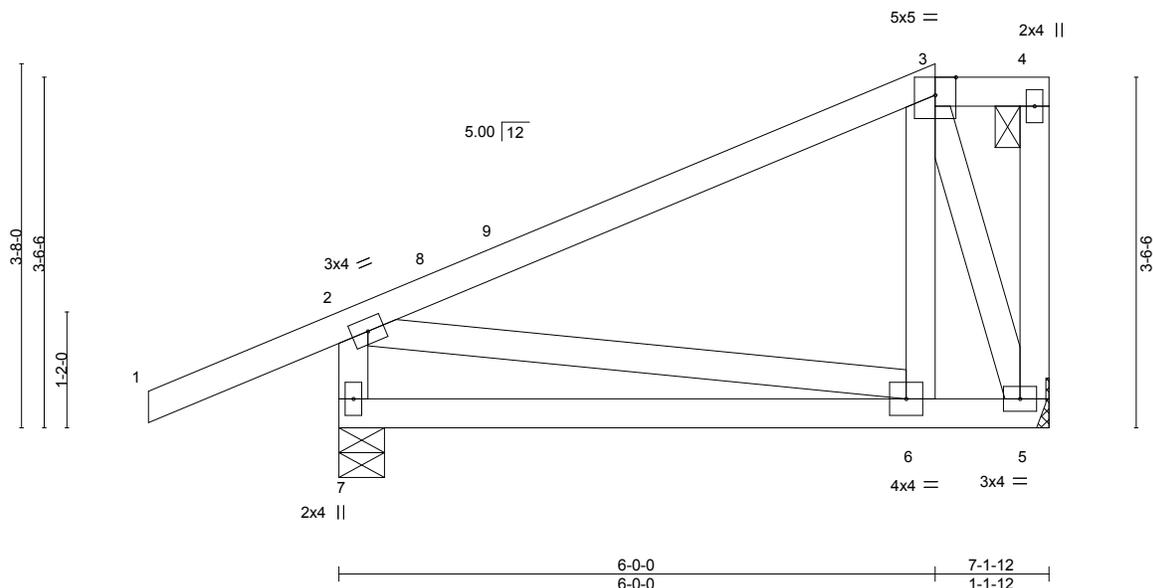

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.45	Vert(LL)	-0.03 6-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.23	Vert(CT)	-0.07 6-7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.07	Horz(CT)	-0.00 5	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS					Weight: 37 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins: 3-4.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 7=0-5-8, 5=Mechanical
 Max Horz 7=138(LC 9)
 Max Uplift 7=-87(LC 12), 5=-53(LC 9)
 Max Grav 7=475(LC 1), 5=287(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-7=-428/243
 WEBS 3-6=0/258, 3-5=-308/147

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 6-0-0, Exterior(2E) 6-0-0 to 7-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 87 lb uplift at joint 7 and 53 lb uplift at joint 5.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

Job 2742340	Truss J25	Truss Type Half Hip Girder	Qty 1	Ply 1	Roeser/1487 Winterset	145732420
					Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:25 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-XLXxUH2_6KbZwwr8xMAPFvpTKKxr79W3RuqUxizP4ea



Scale = 1:19.2

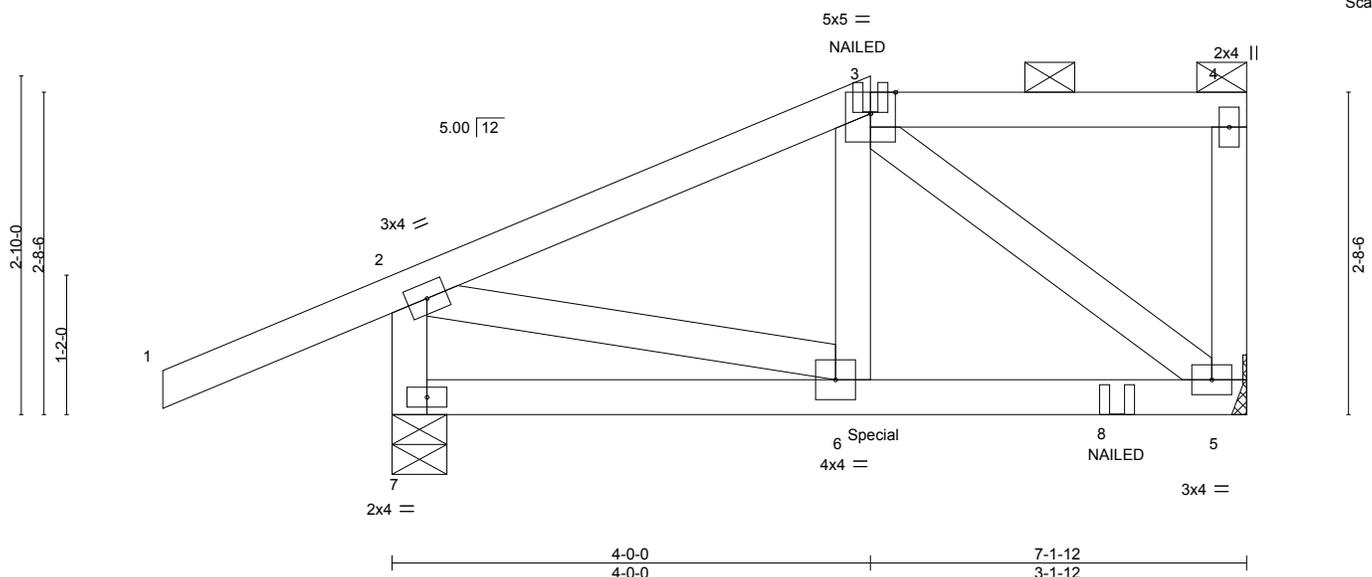

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.01 5-6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.26	Vert(CT)	-0.02 5-6	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.11	Horz(CT)	-0.00 5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP					Weight: 33 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 7=0-5-8, 5=Mechanical
 Max Horz 7=105(LC 5)
 Max Uplift 7=-138(LC 4), 5=-158(LC 5)
 Max Grav 7=549(LC 1), 5=453(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-406/119, 2-7=-524/152
 BOT CHORD 5-6=-130/307
 WEBS 3-5=-397/145, 2-6=-53/327

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 138 lb uplift at joint 7 and 158 lb uplift at joint 5.
 - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 10) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 11) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 122 lb down and 103 lb up at 4-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 12) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 5-7=-20
 Concentrated Loads (lb)
 Vert: 6=-122(F) 3=-7(F) 8=-112(F)



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J26	Truss Type Jack-Open	Qty 4	Ply 1	Roeser/1487 Winterset 145732421
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:26 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-7X4KhdzctejQX3QLV3hen6Mfk8KvsdSCfYa1T8zP4eZ

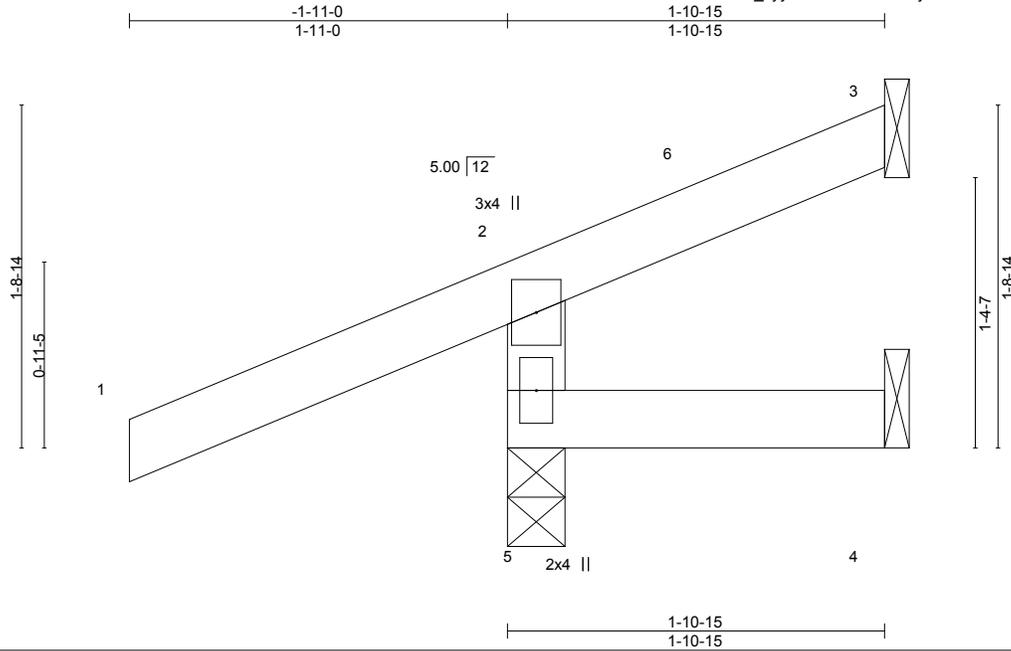

Scale = 1:11.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	0.00	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 8 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 1-10-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 3=Mechanical, 4=Mechanical
 Max Horz 5=48(LC 9)
 Max Uplift 5=78(LC 8), 3=14(LC 12), 4=7(LC 1)
 Max Grav 5=308(LC 1), 3=4(LC 17), 4=26(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-266/207

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 1-10-13 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 78 lb uplift at joint 5, 14 lb uplift at joint 3 and 7 lb uplift at joint 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss J27	Truss Type Jack-Open	Qty 4	Ply 1	Roeser/1487 Winterset	145732422
----------------	--------------	-------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:26 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-7X4KhdzctejQX3QLV3hen6Mfk8LesdBCfYa1T8zP4eZ

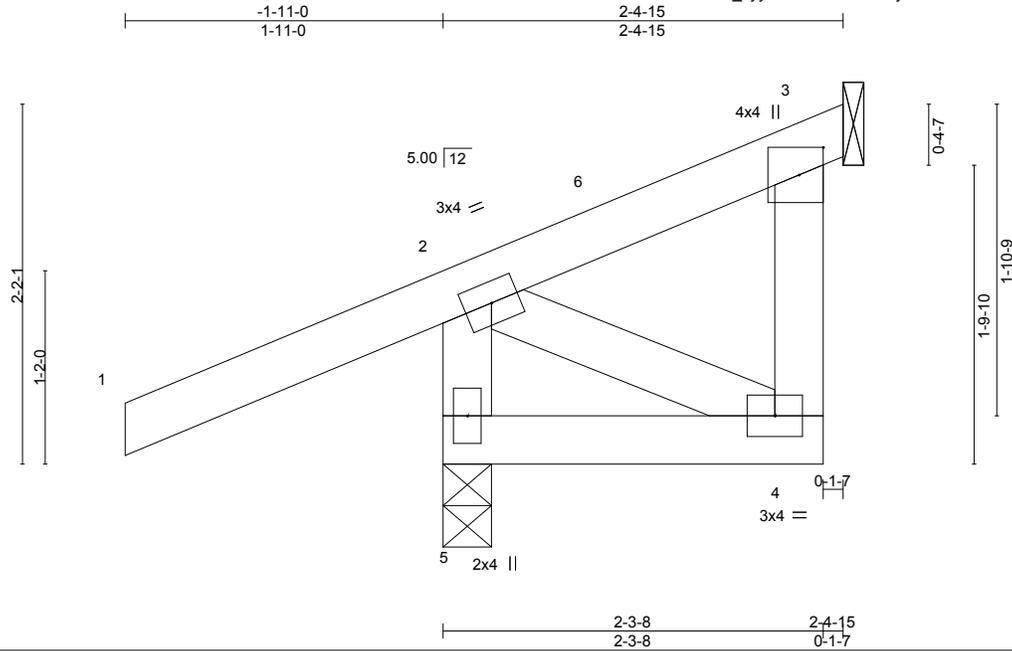

Scale = 1:13.8

Plate Offsets (X,Y)--	[3:0-2-0,0-1-12]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	-0.00	5	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	4-5	>999
BCLL 0.0	Rep Stress Incr	YES	WB 0.02	Horz(CT)	-0.00	3	n/a
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 13 lb
							FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 2-4-15 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 3=Mechanical, 3=Mechanical
Max Horz 5=52(LC 11)
Max Uplift 5=-70(LC 8), 3=-32(LC 25)
Max Grav 5=309(LC 1), 3=39(LC 3), 3=19(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-5=-289/200

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 2-2-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 70 lb uplift at joint 5 and 32 lb uplift at joint 3.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss J28	Truss Type Jack-Open	Qty 2	Ply 1	Roeser/1487 Winterset 145732423
----------------	--------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:27 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-Tkeivz_FeyrH9D?X3nCtKkur9Yhrb4iMuCJb?azP4eY

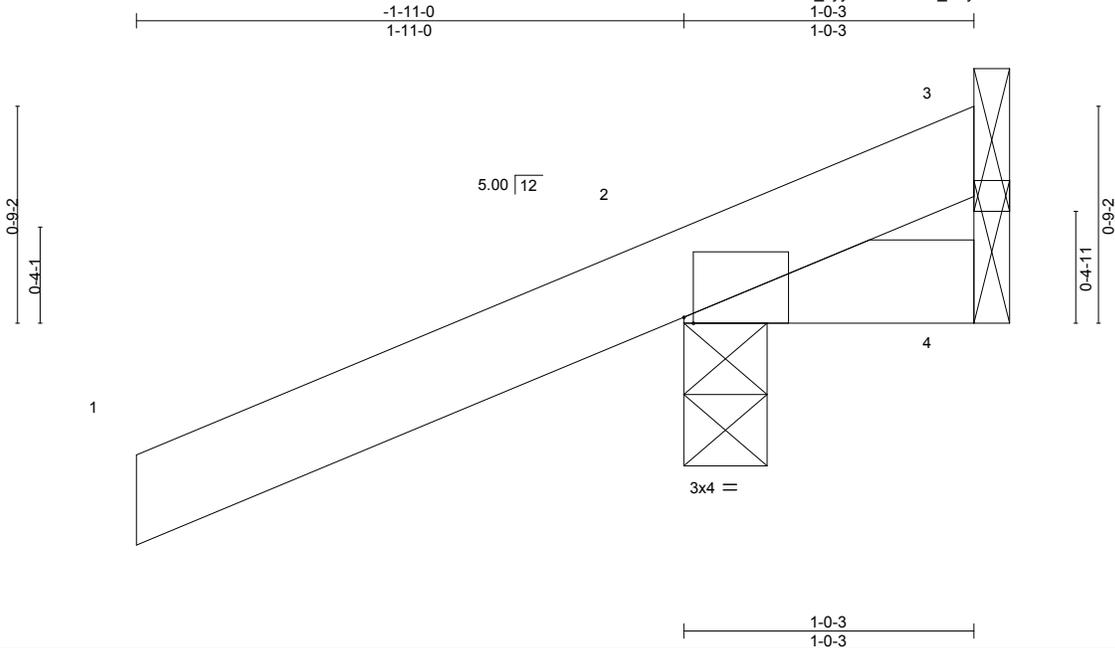


Plate Offsets (X,Y)-- [2:0-0-6,Edge]		CSI.		DEFL.				PLATES	GRIP
LOADING (psf)	SPACING- 2-0-0	TC	0.25	in	(loc)	l/defl	L/d	MT20	197/144
TCLL 25.0	Plate Grip DOL 1.15	BC	0.04	Vert(LL) 0.00	5	>999	240		
TCDL 10.0	Lumber DOL 1.15	WB	0.00	Vert(CT) 0.00	5	>999	180		
BCLL 0.0	Rep Stress Incr YES	Matrix-MP		Horz(CT) -0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014							Weight: 5 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 1-0-3 oc purlins.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 3=Mechanical, 2=0-3-8, 4=Mechanical
 Max Horz 2=42(LC 8)
 Max Uplift 3=28(LC 1), 2=111(LC 8), 4=55(LC 1)
 Max Grav 3=20(LC 8), 2=307(LC 1), 4=34(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 28 lb uplift at joint 3, 111 lb uplift at joint 2 and 55 lb uplift at joint 4.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20,2021


Job 2742340	Truss L6	Truss Type GABLE	Qty 1	Ply 1	Roeser/1487 Winterset 145732424
----------------	-------------	---------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:32 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-phSbyh2NTUUaF_uUrKo21Nbj0Z08GLV52U1MhozP4eT

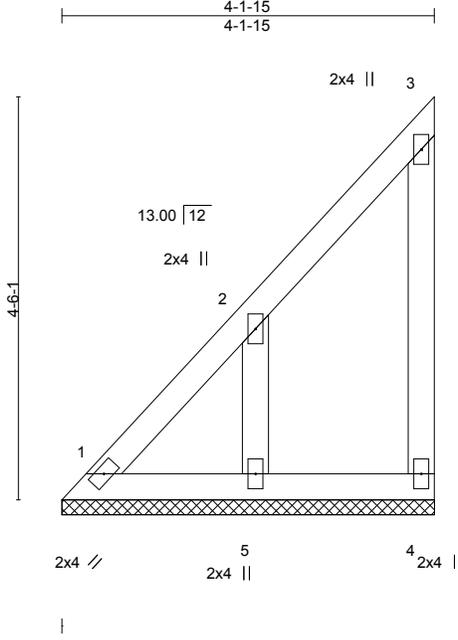

Scale = 1:25.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 18 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-1-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=4-1-15, 4=4-1-15, 5=4-1-15
 Max Horz 1=142(LC 9)
 Max Uplift 1=-37(LC 8), 4=-50(LC 9), 5=-134(LC 12)
 Max Grav 1=116(LC 20), 4=85(LC 19), 5=229(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-254/261

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 4-0-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Gable requires continuous bottom chord bearing.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 37 lb uplift at joint 1, 50 lb uplift at joint 4 and 134 lb uplift at joint 5.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss LG1	Truss Type GABLE	Qty 1	Ply 1	Roeser/1487 Winterset 145732425
----------------	--------------	---------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:32 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-phSbyh2NTUUaF_uUrKo21Nbj0Z08GLV52U1MhozP4eT

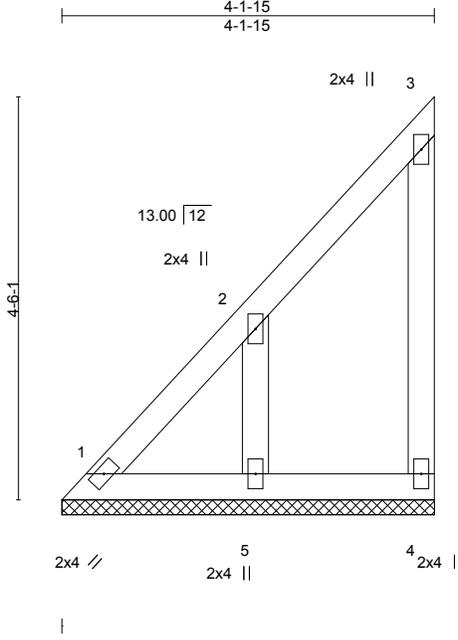

Scale = 1:25.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 18 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 4-1-15 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 1=4-1-15, 4=4-1-15, 5=4-1-15
 Max Horz 1=142(LC 9)
 Max Uplift 1=-37(LC 8), 4=-50(LC 9), 5=-134(LC 12)
 Max Grav 1=116(LC 20), 4=85(LC 19), 5=229(LC 19)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-254/261

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 4-0-3 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 37 lb uplift at joint 1, 50 lb uplift at joint 4 and 134 lb uplift at joint 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss LG2	Truss Type GABLE	Qty 1	Ply 1	Roeser/1487 Winterset 145732426
----------------	--------------	---------------------	----------	----------	------------------------------------


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:33 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-lu?z903?EocRt8ShP2JHZb8rMykQ?oJEG8mvDEzP4eS
6-1-1
6-1-1

Scale = 1:39.1

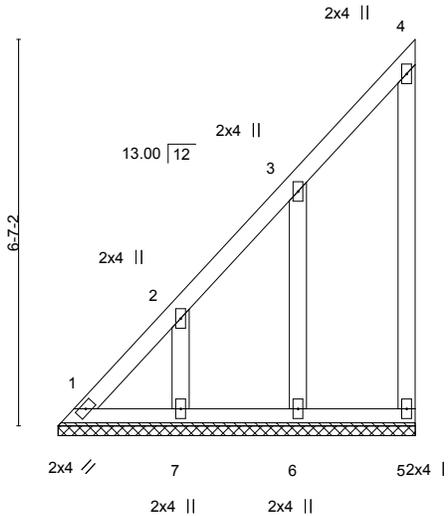

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	5	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 30 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 6-1-1.

(lb) - Max Horz 1=217(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 6=124(LC 12), 7=123(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 1, 5, 6, 7

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-401/403, 2-3=-284/289

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 5-11-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 6=124, 7=123.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss LG3	Truss Type GABLE	Qty 2	Ply 1	Roeser/1487 Winterset 145732427
----------------	--------------	---------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:34 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-m4ZLNM3e75kHV11tzlqW6oh1LM2gkBNOVoWTlqzP4eR

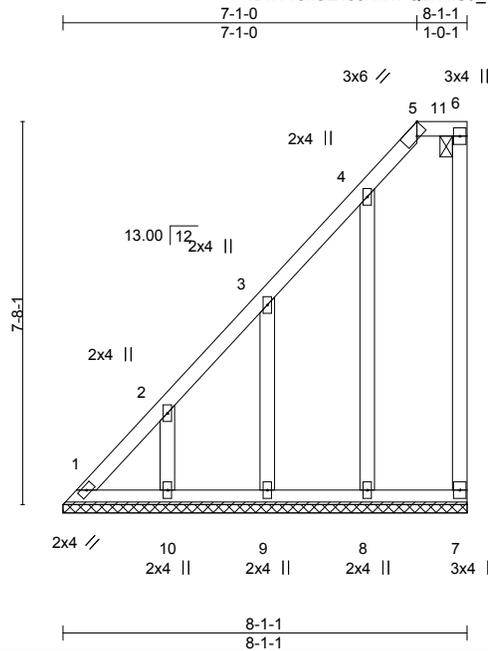

Scale = 1:45.9

Plate Offsets (X,Y)--	[5:0-2-9,Edge]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.32	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.20	Horz(CT)	-0.00	7	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S						Weight: 43 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-6.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 8-1-1.
 (lb) - Max Horz 1=263(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 7, 8 except 9=-128(LC 12), 10=-122(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 1, 7, 8, 9, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-472/468, 2-3=-356/357, 3-4=-258/272
 WEBS 4-8=-296/228

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 7-1-0, Exterior(2E) 7-1-0 to 7-11-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) Gable requires continuous bottom chord bearing.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7, 8 except (jt=lb) 9=128, 10=122.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss LG5	Truss Type GABLE	Qty 1	Ply 1	Roeser/1487 Winterset 145732428
----------------	--------------	---------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:34 2021 Page 1
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-m4ZLNm3e?5kHV11tzlqW6oh4zM4MKEhOV0WTlgzP4eR

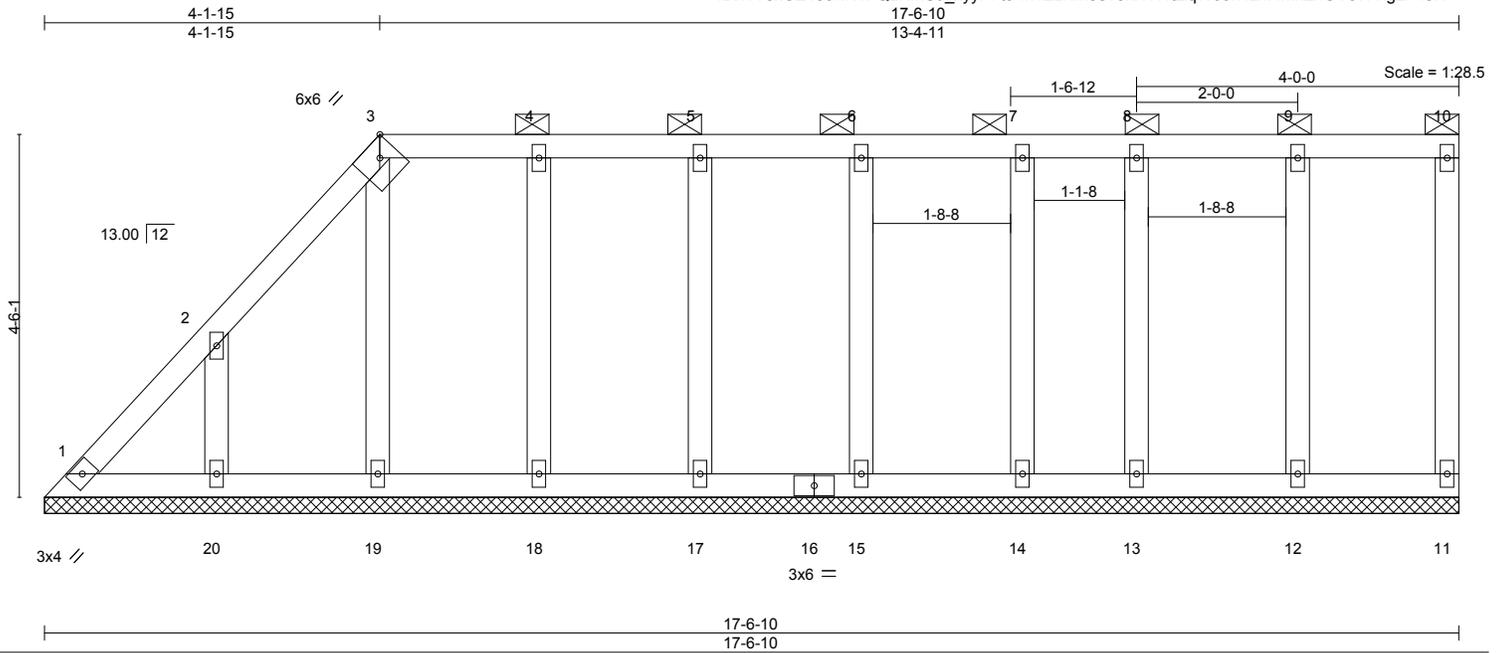

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.09	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.04	Vert(LL) n/a - n/a 999		
BCLL 0.0	Lumber DOL 1.15	WB 0.05	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) -0.00 11 n/a n/a		
	Code IRC2018/TPI2014			Weight: 80 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-10.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	
OTHERS 2x4 SPF No.2	

REACTIONS. All bearings 17-6-10.
 (lb) - Max Horz 1=151(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 11, 12, 13, 14, 15, 17, 18, 19 except 20=138(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 1, 11, 12, 13, 14, 15, 17, 18, 19, 20

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 4-1-15, Exterior(2R) 4-1-15 to 8-1-10, Interior(1) 8-1-10 to 17-4-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 11, 12, 13, 14, 15, 17, 18, 19 except (jt=lb) 20=138.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

Job 2742340	Truss LG5A	Truss Type GABLE	Qty 1	Ply 1	Roeser/1487 Winterset 145732429
----------------	---------------	---------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:35 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-EG7jai4GmPs86Sc3XSMf0DFcmPUTfhXkRF0H7zP4eQ



Scale = 1:45.7

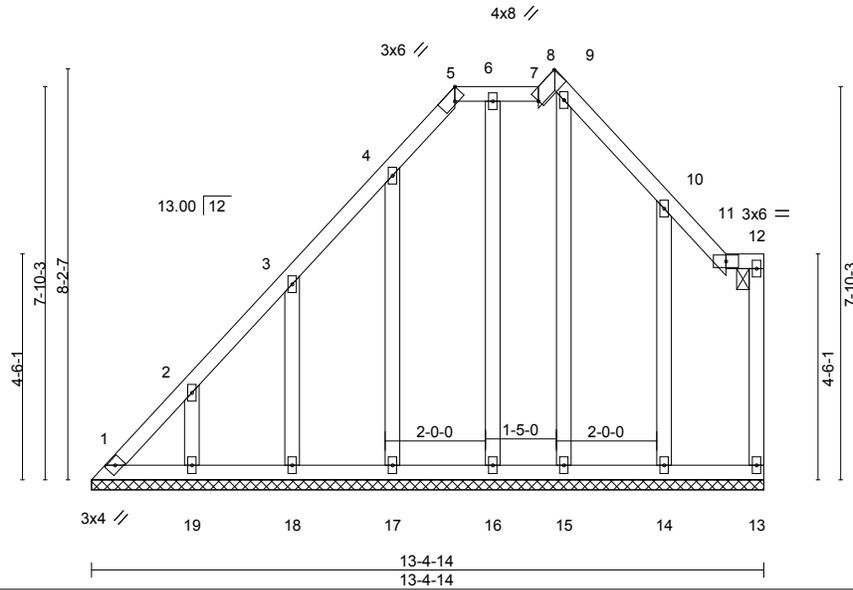


Plate Offsets (X,Y)--	[5:0-2-9,Edge], [7:0-8-1,Edge]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.09	Vert(LL) n/a - n/a 999	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.05	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.13	Horz(CT) -0.00 13 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S		Weight: 77 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.); 5-7, 11-12.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	
OTHERS 2x4 SPF No.2	

REACTIONS. All bearings 13-4-14.
 (lb) - Max Horz 1=231(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 13, 17, 16, 15 except 1=-136(LC 8), 19=-118(LC 12), 18=-131(LC 12), 14=-110(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 1, 13, 19, 18, 17, 16, 15, 14

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-275/241

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 7-2-15, Exterior(2E) 7-2-15 to 8-10-15, Interior(1) 8-10-15 to 9-2-14, Exterior(2R) 9-2-14 to 12-2-14, Interior(1) 12-2-14 to 13-3-2 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13, 17, 16, 15 except (jt=lb) 1=136, 19=118, 18=131, 14=110.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021


Job 2742340	Truss LG6	Truss Type GABLE	Qty 1	Ply 1	Roeser/1487 Winterset 145732430
----------------	--------------	---------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:36 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-iSh5o25uXj_?kcBG4At_BDmP6AkAC7yh5?ZqZzP4eP

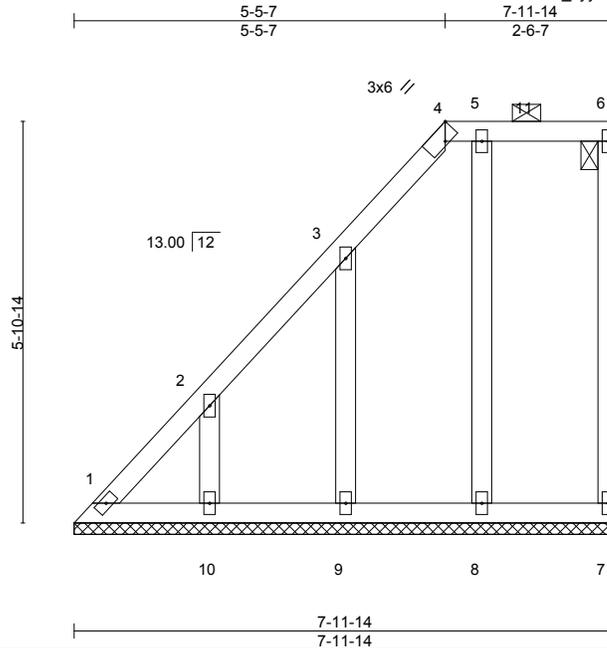

Scale = 1:33.7

Plate Offsets (X,Y)--	[4:0-2-9,Edge]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	n/a	-	n/a 999
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	n/a	-	n/a 999
BCLL 0.0	Rep Stress Incr	YES	WB 0.13	Horz(CT)	-0.00	7	n/a n/a
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 39 lb
							FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	2x4 SPF No.2		
OTHERS	2x4 SPF No.2		

REACTIONS. All bearings 7-11-14.
 (lb) - Max Horz 1=200(LC 11)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 7, 8 except 9=-105(LC 12), 10=-125(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 1, 7, 8, 9, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-354/353, 2-3=-248/254

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 5-5-7, Exterior(2E) 5-5-7 to 7-10-2 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7, 8 except (jt=lb) 9=105, 10=125.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

Job 2742340	Truss LG7	Truss Type GABLE	Qty 1	Ply 1	Roeser/1487 Winterset 145732431
----------------	--------------	---------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:37 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-AffU?O6WI06sMmmSetODkRJa_a4TxaOqBlk7M?zP4eO



Scale = 1:33.0

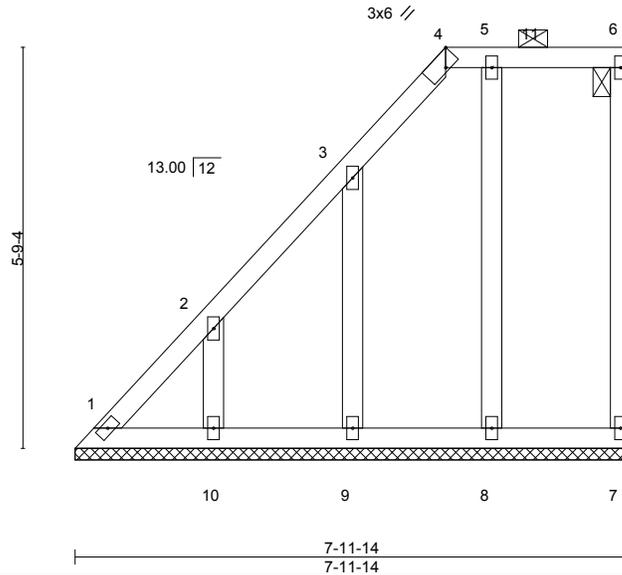


Plate Offsets (X,Y)--	[4:0-2-9,Edge]				
LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.17	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.08	Vert(LL) n/a - n/a 999		
BCLL 0.0	Lumber DOL 1.15	WB 0.12	Vert(CT) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-S	Horz(CT) -0.00 7 n/a n/a		
	Code IRC2018/TPI2014			Weight: 39 lb	FT = 20%


LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-6.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. All bearings 7-11-14.
 (lb) - Max Horz 1=196(LC 9)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 7, 8 except 9=-100(LC 12), 10=-126(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 1, 7, 8, 9, 10

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-344/343

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 5-3-15, Exterior(2E) 5-3-15 to 7-10-2 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) All plates are 2x4 MT20 unless otherwise indicated.
 - 4) Gable requires continuous bottom chord bearing.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7, 8 except (jt=lb) 9=100, 10=126.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

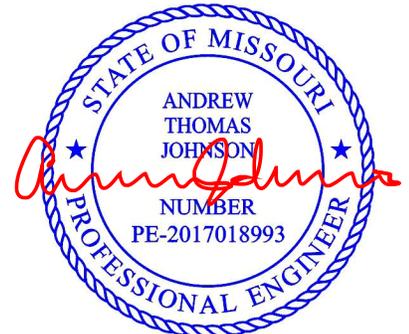

April 20,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss LG8	Truss Type GABLE	Qty 1	Ply 1	Roeser/1487 Winterset 145732432
----------------	--------------	---------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:38 2021 Page 1
ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-erpsDk782KEjzVLeCbvSGernPzRag2xzQPUGuSzP4eN

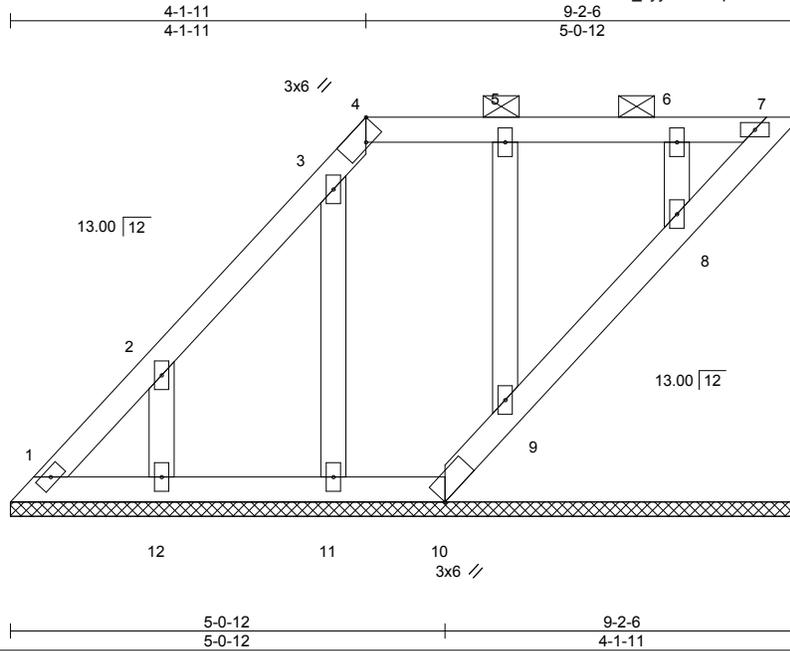

Scale = 1:26.7

Plate Offsets (X,Y)--	[4:0-2-9,Edge]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	n/a	-	n/a	999
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a	999
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	-0.00	7	n/a	n/a
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S					
							PLATES	GRIP
							MT20	197/144
							Weight: 35 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 4-7.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 7-8.
OTHERS 2x4 SPF No.2	

REACTIONS. All bearings 9-2-6.
 (lb) - Max Horz 1=154(LC 12)
 Max Uplift All uplift 100 lb or less at joint(s) 1, 7, 10, 11, 9, 8 except 12=123(LC 12)
 Max Grav All reactions 250 lb or less at joint(s) 1, 7, 10, 12, 11, 9, 8

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 4-1-11, Exterior(2R) 4-1-11 to 7-1-11, Interior(1) 7-1-11 to 8-10-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - All plates are 2x4 MT20 unless otherwise indicated.
 - Gable requires continuous bottom chord bearing.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 7, 10, 11, 9, 8 except (jt=lb) 12=123.
 - Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 7, 9, 8.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021


Job 2742340	Truss LG9	Truss Type GABLE	Qty 1	Ply 1	Roeser/1487 Winterset 145732433
----------------	--------------	---------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:39 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFT9-61NEQ47mpeMab3wqmiQhpsOx?NnNPQ17f3DDQuzP4eM

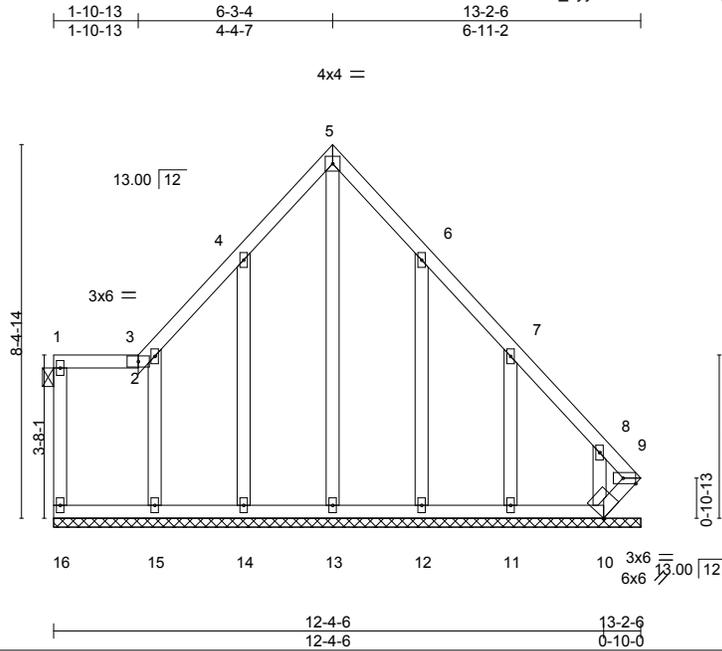

Scale = 1:51.5

Plate Offsets (X,Y)--	[9:Edge,0-1-8]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	n/a	-	n/a 999
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	n/a	-	n/a 999
BCLL 0.0	Rep Stress Incr	YES	WB 0.36	Horz(CT)	0.00	9	n/a n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 72 lb
							FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 9-10.
WEBS	2x4 SPF No.2		
OTHERS	2x4 SPF No.2		

REACTIONS. All bearings 13-2-6.
 (lb) - Max Horz 16=-225(LC 10)
 Max Uplift All uplift 100 lb or less at joint(s) 16, 15 except 9=-358(LC 11), 13=-130(LC 10), 14=-123(LC 12), 12=-118(LC 13), 11=-127(LC 13), 10=-268(LC 13)
 Max Grav All reactions 250 lb or less at joint(s) 16, 14, 15, 12, 11 except 9=422(LC 8), 13=261(LC 9), 10=309(LC 20)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 4-5=-250/261, 5-6=-250/261, 8-9=-280/250
 BOT CHORD 9-10=-256/289
 WEBS 5-13=-323/243

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 1-10-13, Interior(1) 1-10-13 to 6-3-4, Exterior(2R) 6-3-4 to 9-3-4, Interior(1) 9-3-4 to 13-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) All plates are 2x4 MT20 unless otherwise indicated.
 - 5) Gable requires continuous bottom chord bearing.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 16, 15 except (jt=lb) 9=358, 13=130, 14=123, 12=118, 11=127, 10=268.
 - 8) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 9.
 - 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021


Job 2742340	Truss M1	Truss Type Monopitch	Qty 3	Ply 1	Roeser/1487 Winterset 145732434
----------------	-------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:39 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-61NEQ47mpeMab3wqmiQhpsOuSNm9PVg7f3DDQuzP4eM

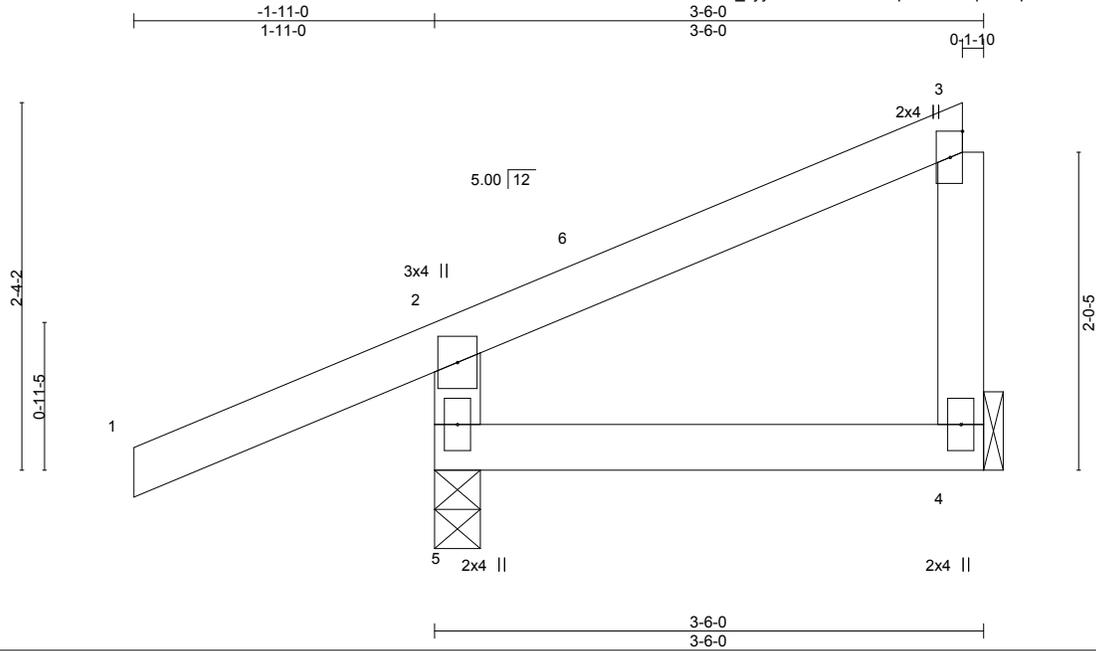

Scale = 1:14.6

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.30	Vert(LL)	-0.01	4-5	>999	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.07	Vert(CT)	-0.01	4-5	>999		
BCLL 0.0	Lumber DOL 1.15	WB 0.00	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-MR						
	Code IRC2018/TPI2014						Weight: 13 lb	FT = 20%

LUMBER-

TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-6-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS.

(size) 4=Mechanical, 5=0-3-8
 Max Horz 5=93(LC 9)
 Max Uplift 4=-28(LC 9), 5=-78(LC 8)
 Max Grav 4=98(LC 1), 5=335(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-296/227

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 3-4-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss M2	Truss Type Monopitch	Qty 7	Ply 1	Roeser/1487 Winterset 145732435
----------------	-------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:44 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-T?A7TnBveA_tiqooYr0sWv5kCOUY4mjsLx_65zP4eH

-1-11-0	2-10-8	3-0-0
1-11-0	2-10-8	0-1-8

Scale = 1:13.6

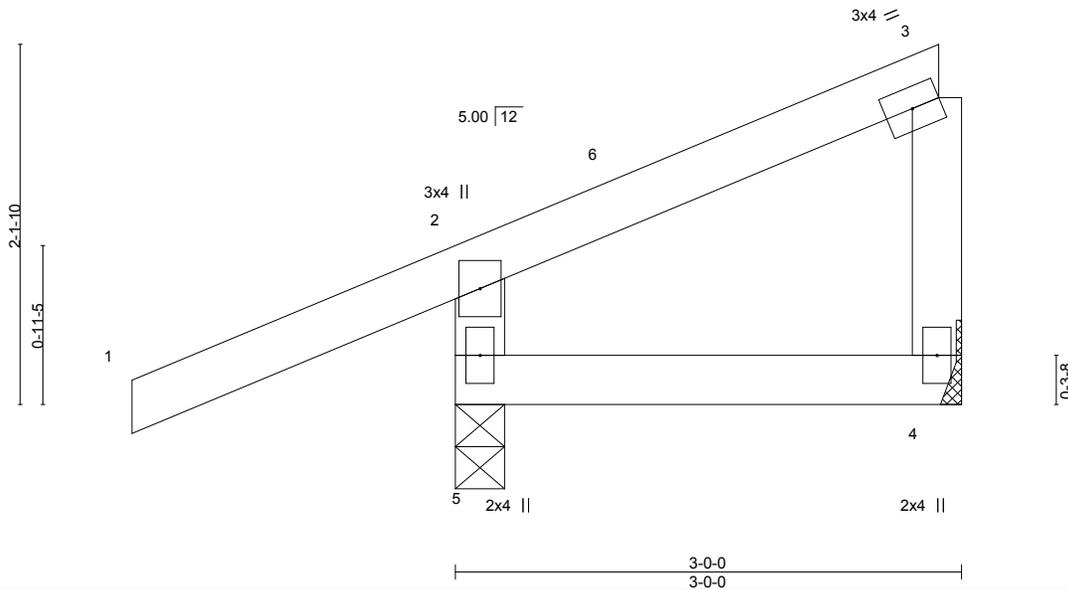


Plate Offsets (X,Y)-- [3:0-0-1,0-0-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15		TC 0.30	Vert(LL) -0.00	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.05	Vert(CT) -0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr YES		WB 0.01	Horz(CT) -0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					Weight: 12 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 3-0-0 oc purlins, except end verticals.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 5=0-3-8, 4=Mechanical
 Max Horz 5=59(LC 12)
 Max Uplift 5=-68(LC 8), 4=-26(LC 12)
 Max Grav 5=321(LC 1), 4=65(LC 3)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-5=-284/207

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 2-9-11 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 20,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss M3	Truss Type Roof Special Girder	Qty 1	Ply 1	Roeser/1487 Winterset 145732436
----------------	-------------	-----------------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:46 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-POltuTD9AnEbx8yBgG2KbKbOfC4sYYV9GfQ5A_zP4eF



Scale = 1:26.2

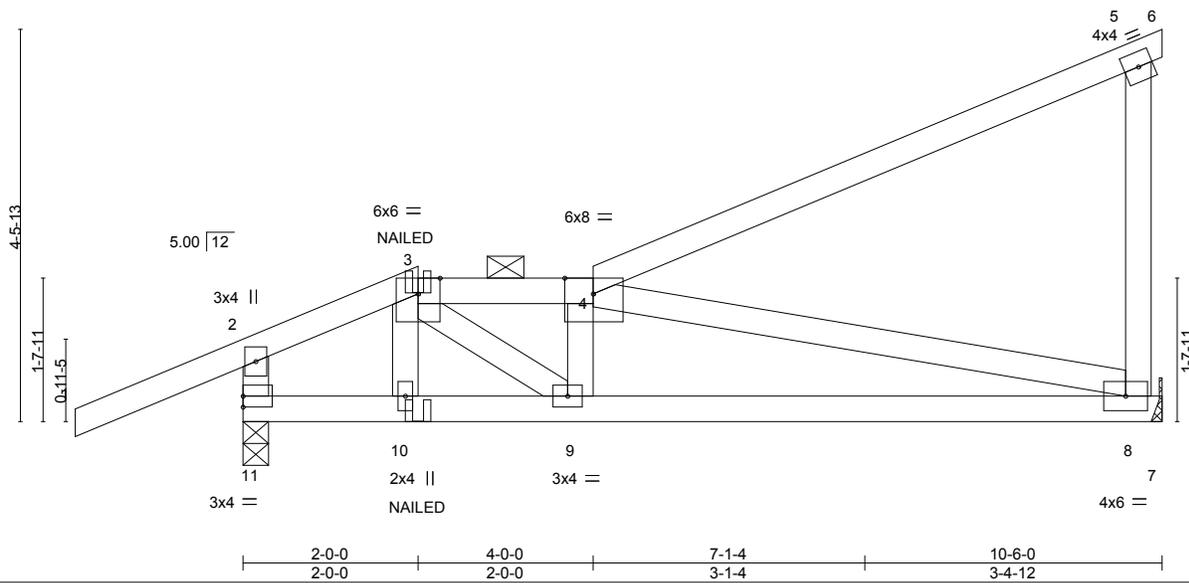


Plate Offsets (X,Y)--	[4:0-3-14,Edge]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15		TC 0.55	Vert(LL) -0.05	8-9	>999	240		MT20	197/144
TCDL 10.0	Lumber DOL 1.15		BC 0.38	Vert(CT) -0.10	8-9	>999	180			
BCLL 0.0	Rep Stress Incr NO		WB 0.57	Horz(CT) 0.01	8	n/a	n/a			
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						Weight: 44 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD 2x4 SPF No.2		TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-4.
BOT CHORD 2x4 SPF No.2		BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2			

REACTIONS. (size) 8=Mechanical, 11=0-3-8
 Max Horz 11=175(LC 7)
 Max Uplift 8=97(LC 8), 11=107(LC 8)
 Max Grav 8=450(LC 1), 11=613(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-385/54, 3-4=-784/103, 2-11=-471/106
 BOT CHORD 10-11=-115/287, 9-10=-113/303, 8-9=-140/807
 WEBS 3-9=-68/604, 4-8=-774/167

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) Provide adequate drainage to prevent water ponding.
 - 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 4) Refer to girder(s) for truss to truss connections.
 - 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 11=107.
 - 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 8) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-5=-70, 5-6=-20, 7-11=-20



April 20, 2021

Job 2742340	Truss M4	Truss Type Monopitch	Qty 1	Ply 1	Roeser/1487 Winterset 145732437
----------------	-------------	-------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:47 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-tasG5pEox5NRZIXNE_ZZ8YjECcQTH63IUJ9fjQzP4eE



Scale = 1:26.5

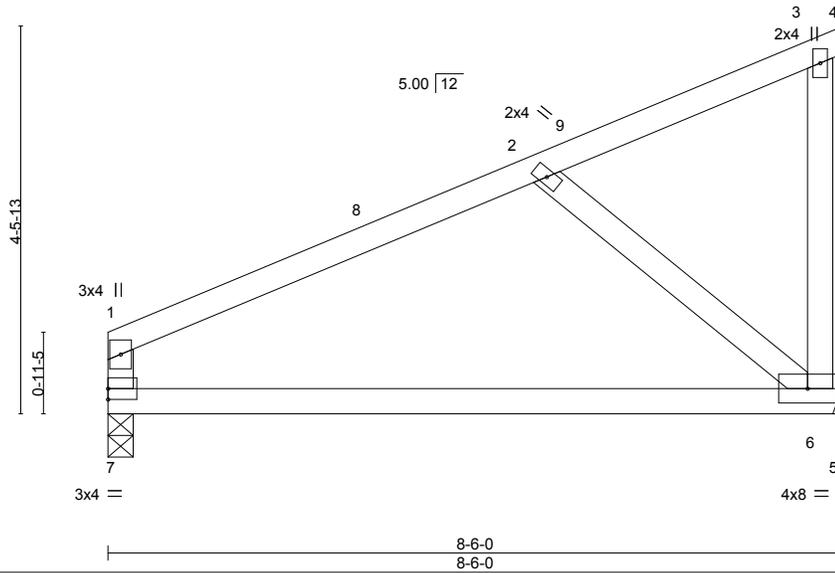

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.12 6-7	>827	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.42	Vert(CT)	-0.23 6-7	>423	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.10	Horz(CT)	0.00 6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 30 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 7=0-3-8, 6=Mechanical
 Max Horz 7=158(LC 9)
 Max Uplift 7=-46(LC 12), 6=-88(LC 12)
 Max Grav 7=364(LC 1), 6=375(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 1-2=-363/134, 1-7=-280/148
 BOT CHORD 6-7=-232/276
 WEBS 2-6=-324/251

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 8-6-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 6.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20,2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss M5	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset	145732438
----------------	-------------	------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:47 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-tasG5pEox5NRZIXNE_ZZ8YjEecMiH68IUJ9fjQzP4eE



4x4 =

Scale = 1:26.5

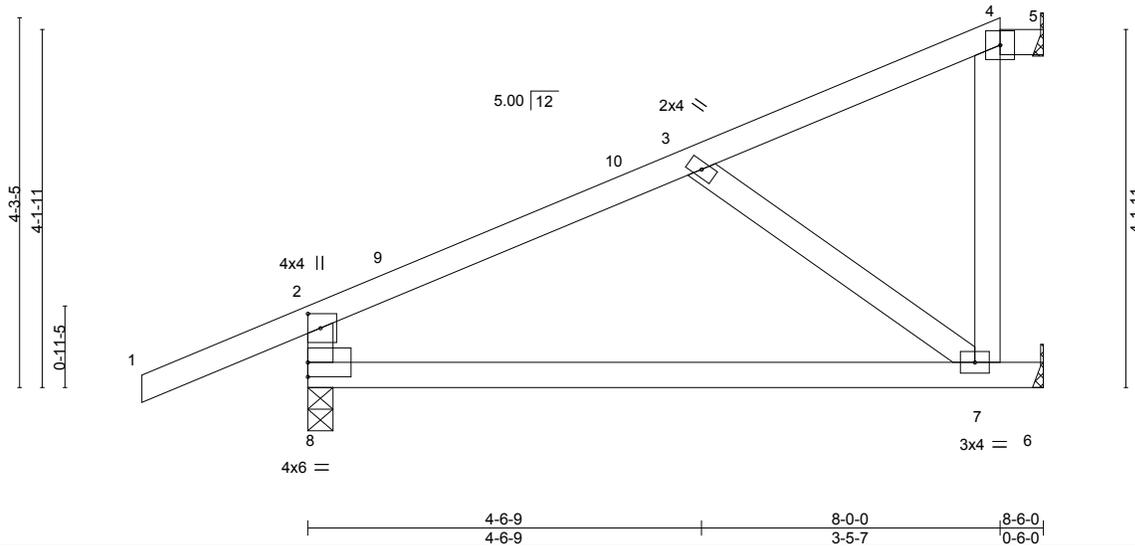


Plate Offsets (X,Y)--	[2:0-2-0,0-1-12]				
LOADING (psf)	SPACING- 2-0-0	CSI.	DEFL. in (loc) l/defl L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL 1.15	TC 0.35	Vert(LL) -0.20 7-8 >494 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.67	Vert(CT) -0.43 7-8 >231 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.10	Horz(CT) 0.00 6 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 32 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 4-5.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 8=0-3-8, 6=Mechanical
 Max Horz 8=135(LC 12)
 Max Uplift 8=-79(LC 12), 6=-86(LC 12)
 Max Grav 8=535(LC 1), 6=360(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-329/70, 2-8=-409/215
 WEBS 3-7=-309/215

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 8-0-0, Exterior(2E) 8-0-0 to 8-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 6.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd
 Chesterfield, MO 63017

Job 2742340	Truss M6	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset	145732439
----------------	-------------	------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:48 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-LmPeJ9EQiPVIAS6Znh4ogIGP_?oG0ZPSjzvCFszP4eD



Scale = 1:21.8

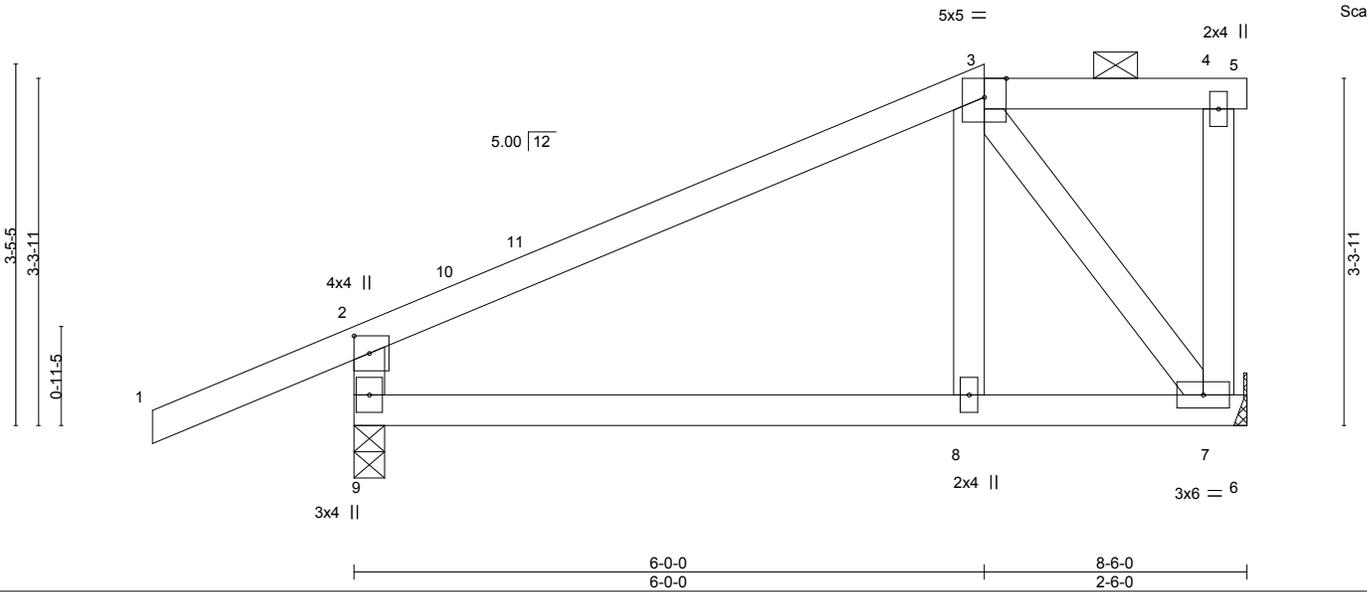


Plate Offsets (X,Y)--	[2:0-2-0,0-1-12]
-----------------------	------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	-0.02	8-9	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.20	Vert(CT)	-0.05	8-9	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.10	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 33 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 9=0-3-8, 7=Mechanical
 Max Horz 9=130(LC 9)
 Max Uplift 9=-96(LC 12), 7=-63(LC 9)
 Max Grav 9=526(LC 1), 7=356(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-327/81, 2-9=-466/250
 WEBS 3-7=-370/235

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
 - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 6-0-0, Exterior(2E) 6-0-0 to 8-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - Provide adequate drainage to prevent water ponding.
 - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - Refer to girder(s) for truss to truss connections.
 - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 7.
 - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20,2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	 <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job 2742340	Truss M7	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset 145732440
----------------	-------------	------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:49 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-qzz0WVF2Tid9ochILPc1DzpaFP7bIOWbydelnJzP4eC



Scale = 1:19.8

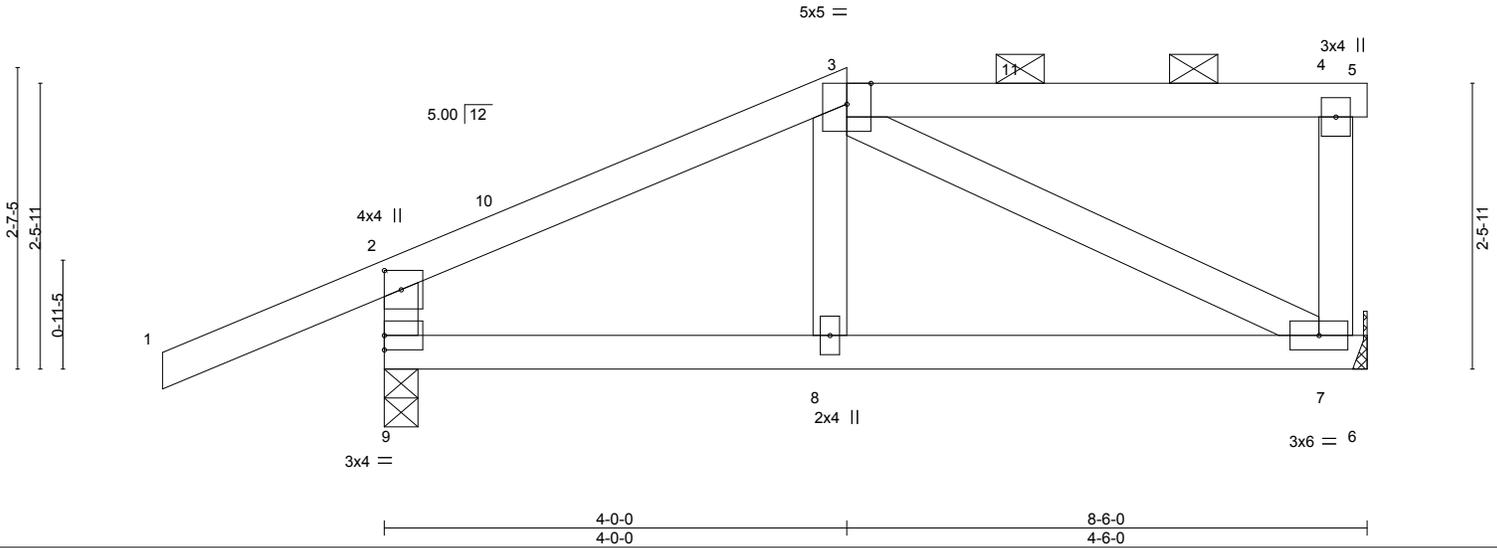


Plate Offsets (X,Y)-- [2:0-2-0,0-1-12]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.38	Vert(LL)	-0.02	7-8	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.32	Vert(CT)	-0.04	7-8	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.11	Horz(CT)	0.00	7	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 32 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-5.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 9=0-3-8, 7=Mechanical
 Max Horz 9=98(LC 9)
 Max Uplift 9=-96(LC 8), 7=-67(LC 9)
 Max Grav 9=526(LC 1), 7=356(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-387/107, 2-9=-450/239
 BOT CHORD 8-9=-178/294, 7-8=-181/293
 WEBS 3-7=-256/156

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 4-0-0, Exterior(2E) 4-0-0 to 8-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 7.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 20, 2021

Job 2742340	Truss M8	Truss Type Half Hip Girder	Qty 1	Ply 1	Roeser/1487 Winterset	145732441
----------------	-------------	-------------------------------	----------	----------	-----------------------	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:50 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-I9XOkqGgE0IQIGyv67GmALkQpTQUSNkBHOJlZP4eB



Scale = 1:19.8

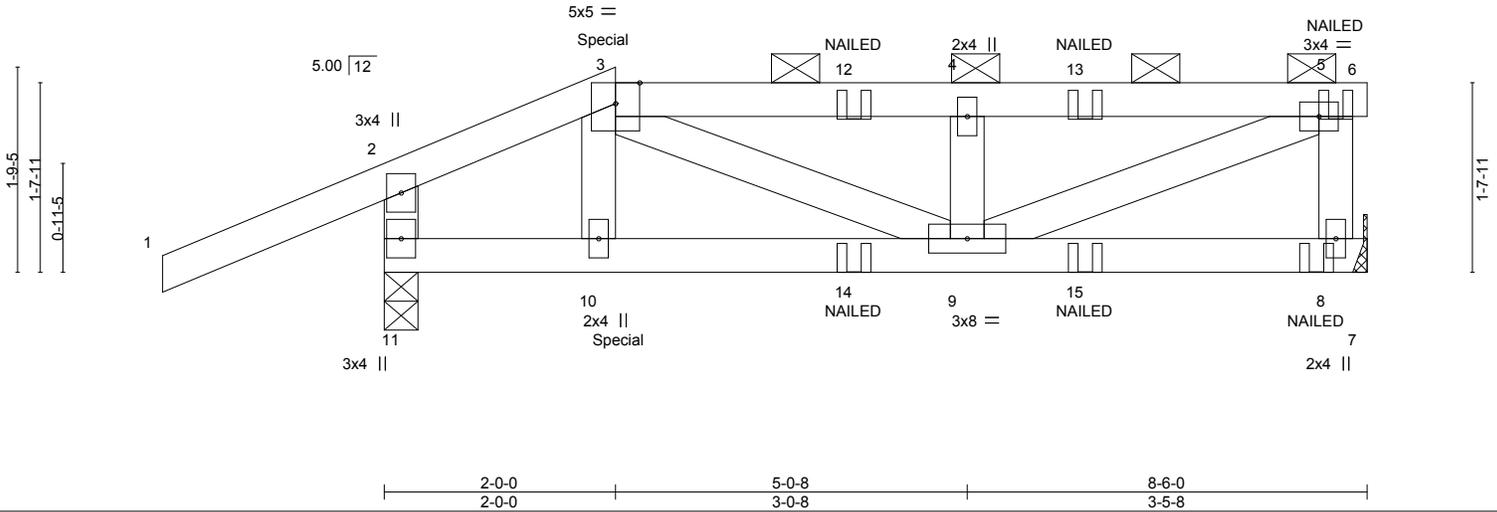

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.44	Vert(LL)	-0.02 9-10	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.28	Vert(CT)	-0.04 9-10	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.13	Horz(CT)	0.00 8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					Weight: 33 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-6.
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS. (size) 8=Mechanical, 11=0-3-8
 Max Horz 11=65(LC 35)
 Max Uplift 8=73(LC 5), 11=-109(LC 4)
 Max Grav 8=359(LC 22), 11=526(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-3=-321/54, 3-4=-539/99, 4-5=-537/98, 5-8=-319/85, 2-11=-419/103
 BOT CHORD 10-11=-70/257, 9-10=-73/262
 WEBS 3-9=-71/324, 4-9=-261/91, 5-9=-104/532

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8 except (jt=lb) 11=109.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 9) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 104 lb down and 26 lb up at 2-0-0 on top chord, and 34 lb down and 40 lb up at 2-0-0 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-5=-70, 5-6=-20, 7-11=-20



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 2742340	Truss M9	Truss Type Half Hip Girder	Qty 1	Ply 1	Roeser/1487 Winterset	145732442
----------------	-------------	-------------------------------	----------	----------	-----------------------	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:51 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-mL5mxAHl?Ktt1vr8TqeVIOuwmDqeDvSuP7ssBzP4eA



Scale = 1:19.2

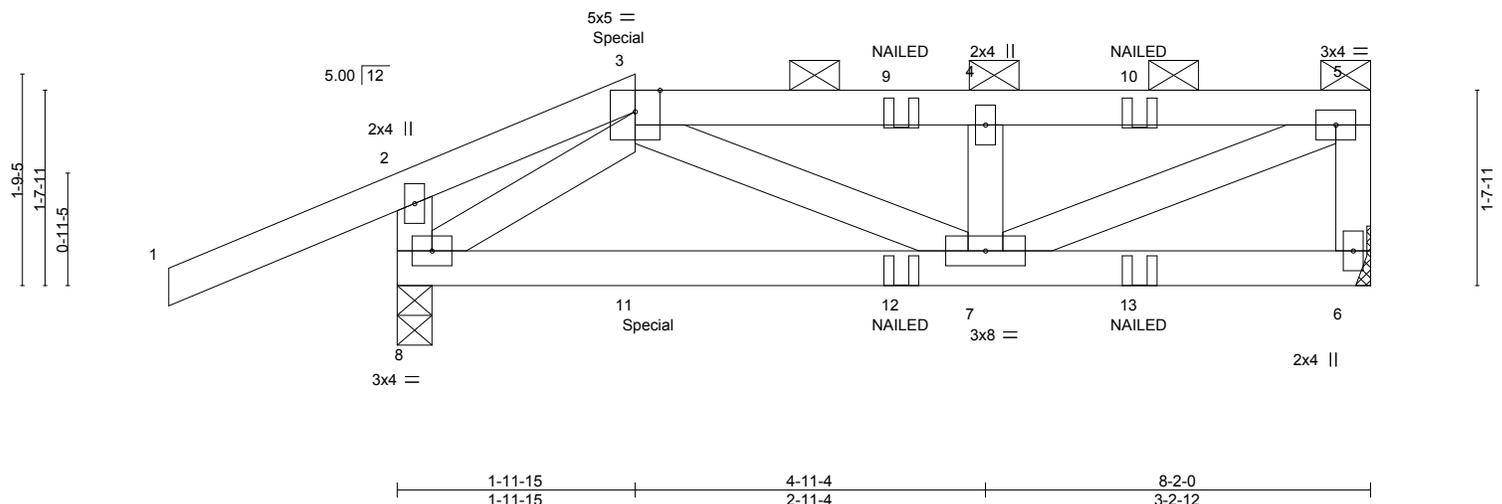

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.34	Vert(LL)	-0.02	7-8	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.22	Vert(CT)	-0.04	7-8	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.14	Horz(CT)	0.00	6	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP					Weight: 33 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 3-5.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=Mechanical, 8=0-3-8
 Max Horz 8=65(LC 7)
 Max Uplift 6=65(LC 5), 8=108(LC 4)
 Max Grav 6=338(LC 22), 8=518(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=-527/87, 4-5=-524/85, 5-6=-317/71, 2-8=-290/120
 BOT CHORD 7-8=-87/262
 WEBS 3-7=-39/302, 4-7=-262/94, 5-7=-101/572, 3-8=-354/36

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6 except (jt=lb) 8=108.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - 9) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
 - 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 105 lb down and 26 lb up at 1-11-15 on top chord, and 22 lb down and 24 lb up at 1-11-15, and 12 lb down and 16 lb up at 2-2-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
 - 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard
 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
 Uniform Loads (plf)
 Vert: 1-2=-70, 2-3=-70, 3-5=-70, 6-8=-20




April 20, 2021

Job 2742340	Truss M10	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset 145732443
----------------	--------------	------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:40 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-aExcdQ8PaxURDDV1J0xwM3x0zn1h8wEGtjznzKzP4eL



Scale = 1:19.9

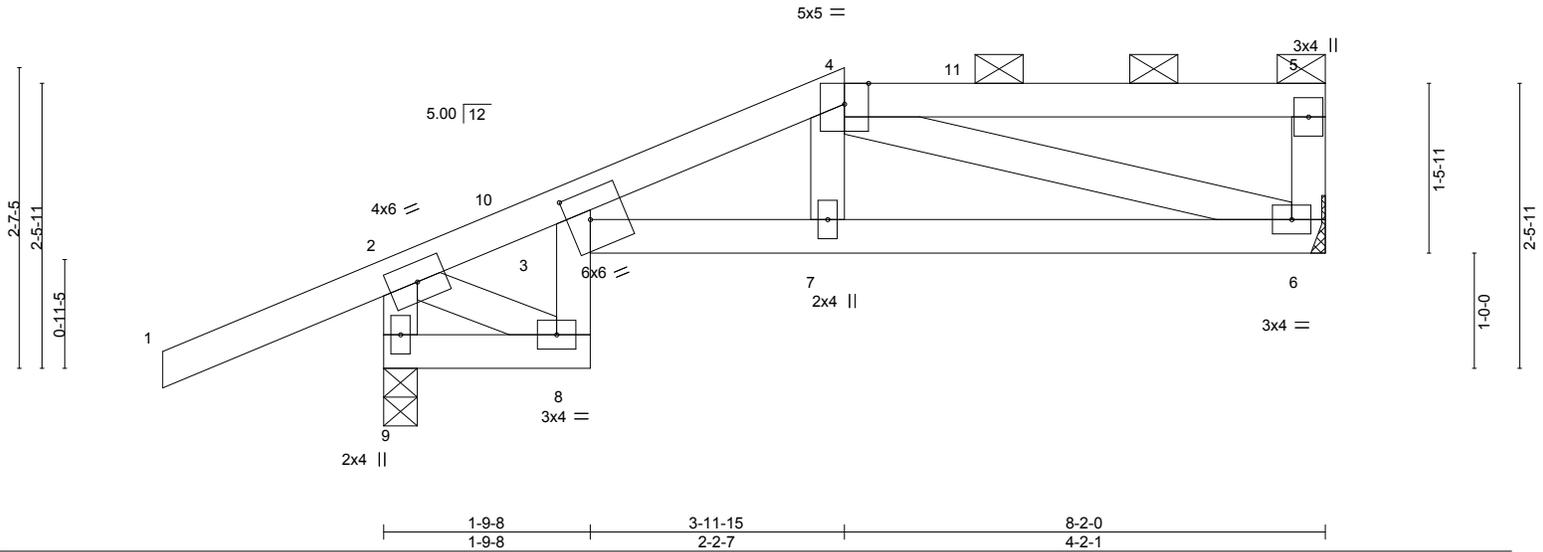


Plate Offsets (X,Y)--	[3:0-2-5,0-2-14]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.50	Vert(LL)	0.06	3-7	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.43	Vert(CT)	-0.08	3-7	>999
BCLL 0.0	Rep Stress Incr	YES	WB 0.17	Horz(CT)	0.07	6	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 31 lb
							FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 6=Mechanical, 9=0-3-8
Max Horz 9=83(LC 9)
Max Uplift 6=-61(LC 9), 9=-92(LC 8)
Max Grav 6=336(LC 1), 9=519(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-632/260, 2-9=-500/248
BOT CHORD 3-7=-304/586, 6-7=-309/580
WEBS 4-6=-521/280

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
 - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 3-11-15, Exterior(2E) 3-11-15 to 8-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 3) Provide adequate drainage to prevent water ponding.
 - 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 5) Refer to girder(s) for truss to truss connections.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 9.
 - 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
 - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 2742340	Truss M11	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset	145732444
----------------	--------------	------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:41 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-3QU_r191LFclqN4DjtS9uHTAJBMitOpQ6NikVmzP4eK



5x5 =

Scale = 1:22.1

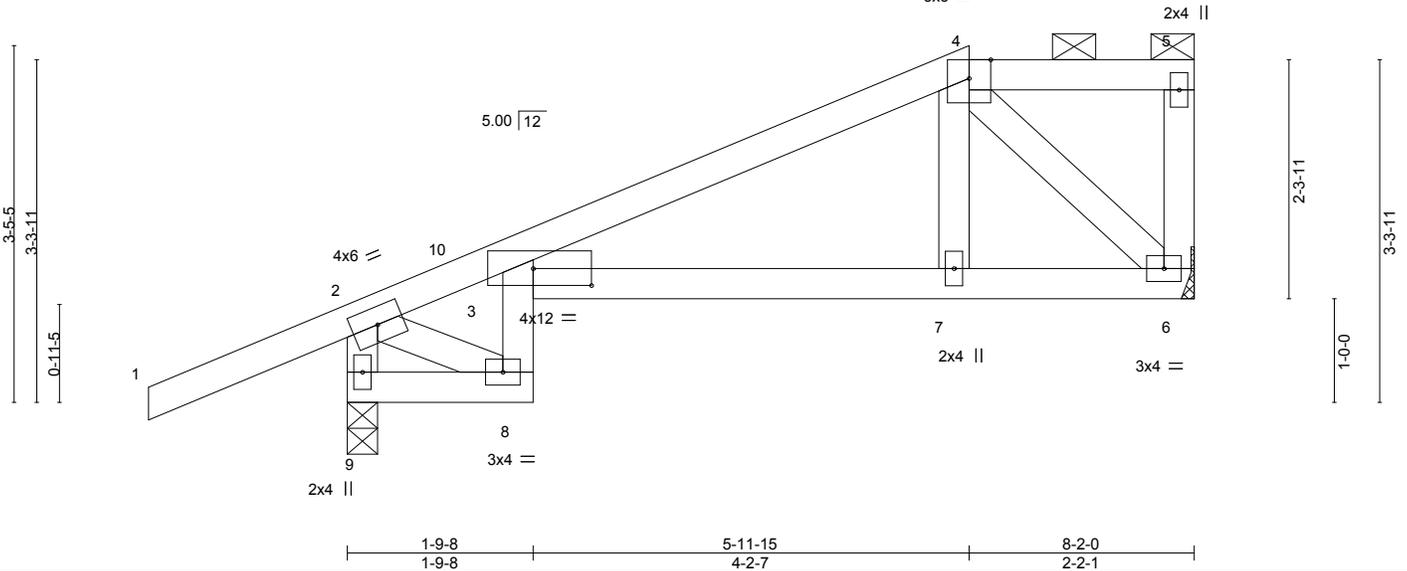


Plate Offsets (X,Y)--	[3:0-6-12,0-1-15]						
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.50	Vert(LL)	0.10	3-7	>951
TCDL 10.0	Lumber DOL	1.15	BC 0.51	Vert(CT)	-0.14	3-7	>685
BCLL 0.0	Rep Stress Incr	YES	WB 0.09	Horz(CT)	0.11	6	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS				
							PLATES
							MT20
							GRIP
							197/144
							Weight: 32 lb
							FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 4-5.
BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 6=Mechanical, 9=0-3-8
Max Horz 9=116(LC 9)
Max Uplift 6=-57(LC 9), 9=-93(LC 12)
Max Grav 6=336(LC 1), 9=519(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 3-4=-401/141, 2-9=-500/235
BOT CHORD 8-9=-252/192, 3-7=-224/344, 6-7=-223/334
WEBS 4-6=-489/299, 2-8=-219/287

NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 5-11-15, Exterior(2E) 5-11-15 to 8-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 9.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
Chesterfield, MO 63017

Job 2742340	Truss M12	Truss Type Half Hip	Qty 1	Ply 1	Roeser/1487 Winterset	145732445
----------------	--------------	------------------------	----------	----------	-----------------------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:42 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-Xc2N25Af6Zk9SXePRR_ORUOLtj7crBZL1Su1DzP4eJ



Scale = 1:25.3

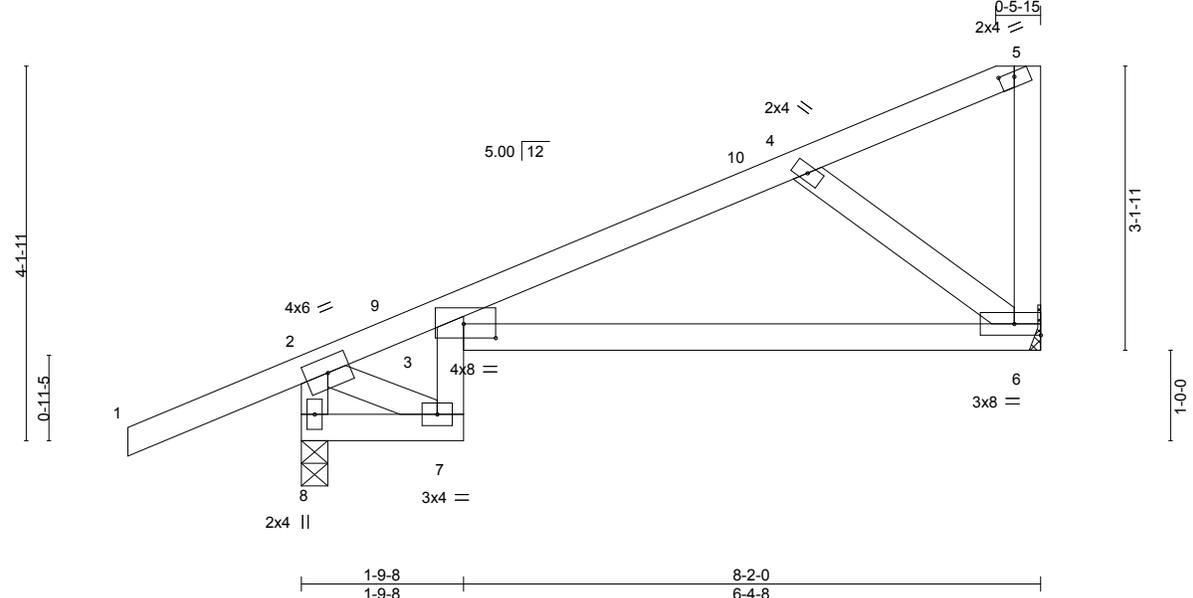


Plate Offsets (X,Y)--	[3:0-4-4,0-1-14], [5:0-2-0,0-0-11]
-----------------------	------------------------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.50	Vert(LL)	0.10	3-6	>954	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.37	Vert(CT)	-0.20	3-6	>469	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.08	Horz(CT)	0.12	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 31 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 6=Mechanical, 8=0-3-8
 Max Horz 8=154(LC 9)
 Max Uplift 6=-78(LC 12), 8=-89(LC 12)
 Max Grav 6=336(LC 1), 8=519(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 3-4=-385/101, 2-8=-500/229
 BOT CHORD 7-8=-290/244, 3-6=-240/349
 WEBS 4-6=-398/252, 2-7=-278/329

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 8-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 8.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021

<p>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job 2742340	Truss M13	Truss Type Jack-Closed	Qty 2	Ply 1	Roeser/1487 Winterset 145732446
----------------	--------------	---------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:42 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-Xc2N25Af6zk9SxePRR_ORU0KPbgCcsUZL1Su1DzP4eJ



Scale = 1:26.0

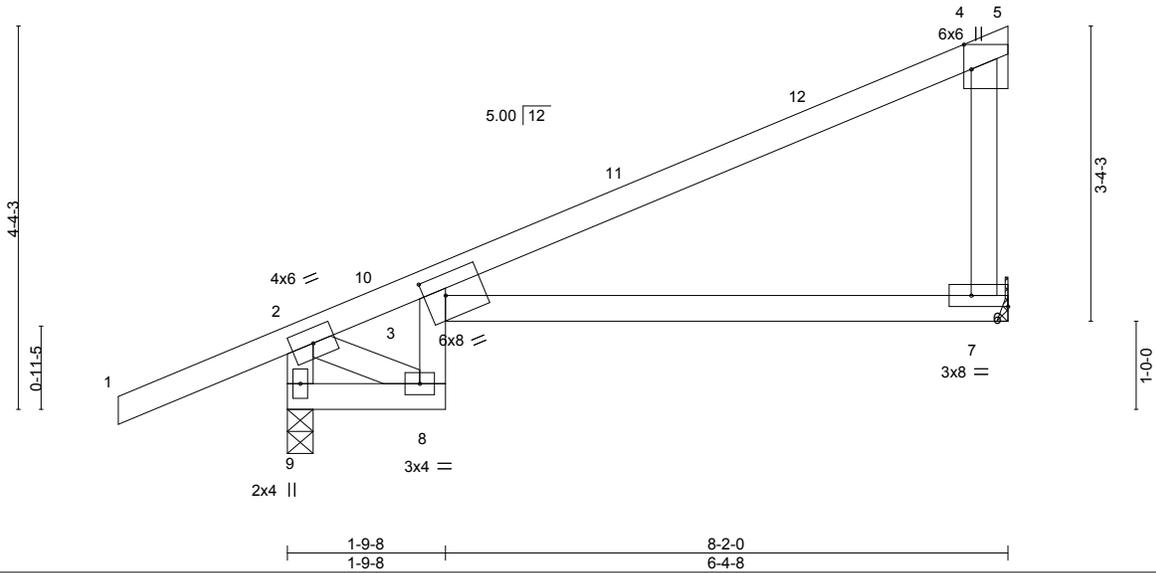


Plate Offsets (X,Y)--	[3:0-2-13,0-2-13], [4:0-3-6,Edge], [7:Edge,0-1-8]
-----------------------	---

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.57	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.56	Vert(LL) 0.15 3-7 >620 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.06	Vert(CT) -0.25 3-7 >375 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.16 7 n/a n/a		
	Code IRC2018/TPI2014			Weight: 28 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	

REACTIONS. (size) 9=0-3-8, 7=Mechanical
 Max Horz 9=154(LC 9)
 Max Uplift 9=-85(LC 12), 7=-59(LC 12)
 Max Grav 9=514(LC 1), 7=341(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-9=-495/228
 BOT CHORD 8-9=-304/241
 WEBS 2-8=-274/344

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 8-2-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 7.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021

Job 2742340	Truss M14	Truss Type Jack-Closed	Qty 1	Ply 1	Roeser/1487 Winterset 145732447
----------------	--------------	---------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:43 2021 Page 1
ID:WV5xOZ45cNK4PQ2HmSu_xyyPF19-?pclGRAHtss04hDc?8VdZiZaF_2AL14iahBRZfzP4el



Scale = 1:25.7

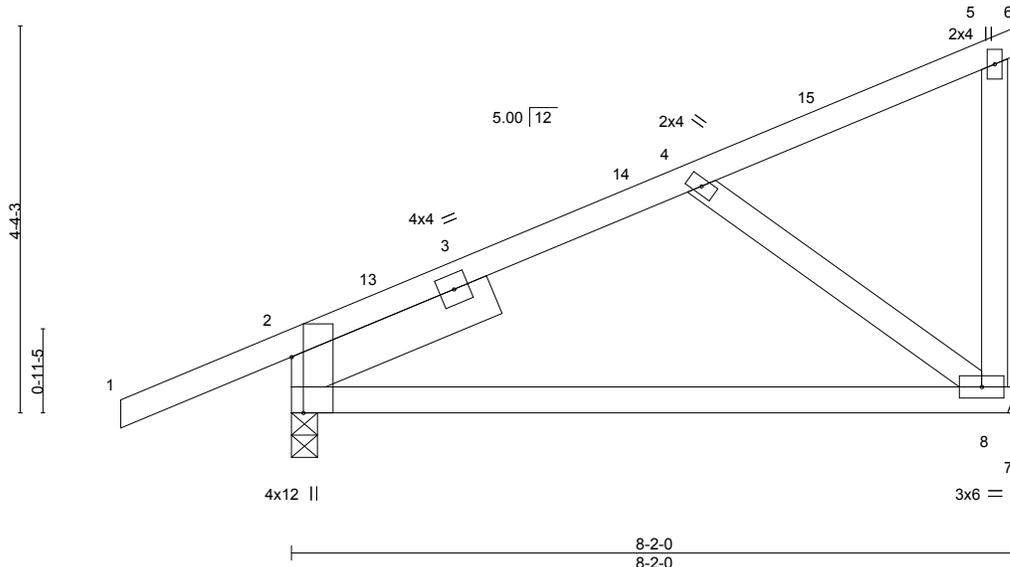


Plate Offsets (X,Y)--	[2:0-7-9,Edge]
-----------------------	----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	-0.10	8-11	>933	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.45	Vert(CT)	-0.20	8-11	>469		
BCLL 0.0	Rep Stress Incr	YES	WB 0.10	Horz(CT)	0.01	2	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS						
								Weight: 35 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
SLIDER Left 2x6 SPF No.2 -t 2-6-0	

REACTIONS. (size) 2=0-3-8, 8=Mechanical
 Max Horz 2=163(LC 11)
 Max Uplift 2=-84(LC 12), 8=-60(LC 12)
 Max Grav 2=506(LC 1), 8=350(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-4=-580/106
 BOT CHORD 2-8=-212/261
 WEBS 4-8=-323/208

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 8-2-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021

Job 2742340	Truss M20	Truss Type Jack-Closed	Qty 1	Ply 1	Roeser/1487 Winterset Job Reference (optional)	145732448
----------------	--------------	---------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:44 2021 Page 1

ID:WV5xOZ45cNK4PQ2HmSu_xyyPFt9-T?A7TnBveA_tiqooYr0sWv5kMOSS4mvsolX_65zP4eH



Scale = 1:20.5

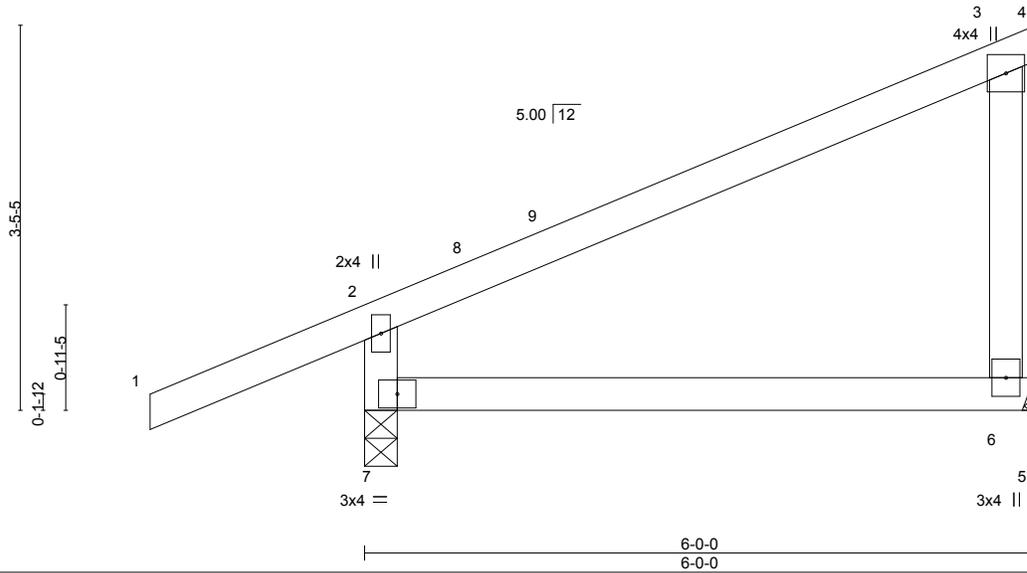

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.03 6-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	-0.05 6-7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00 6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 20 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 6=Mechanical, 7=0-3-8
 Max Horz 7=134(LC 9)
 Max Uplift 6=-57(LC 12), 7=-76(LC 12)
 Max Grav 6=236(LC 1), 7=422(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-7=-375/250

NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 6-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd
 Chesterfield, MO 63017


Job 2742340	Truss M21	Truss Type Jack-Closed	Qty 3	Ply 1	Roeser/1487 Winterset 145732449
----------------	--------------	---------------------------	----------	----------	------------------------------------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Mon Apr 19 17:40:45 2021 Page 1

ID:VV5xOZ45cNK4PQ2HmSu_xyyPFt9-xBkVh7CXPU6kN_6ZX537ev6on?pd9?1?gYeYzP4eG



Scale = 1:20.8

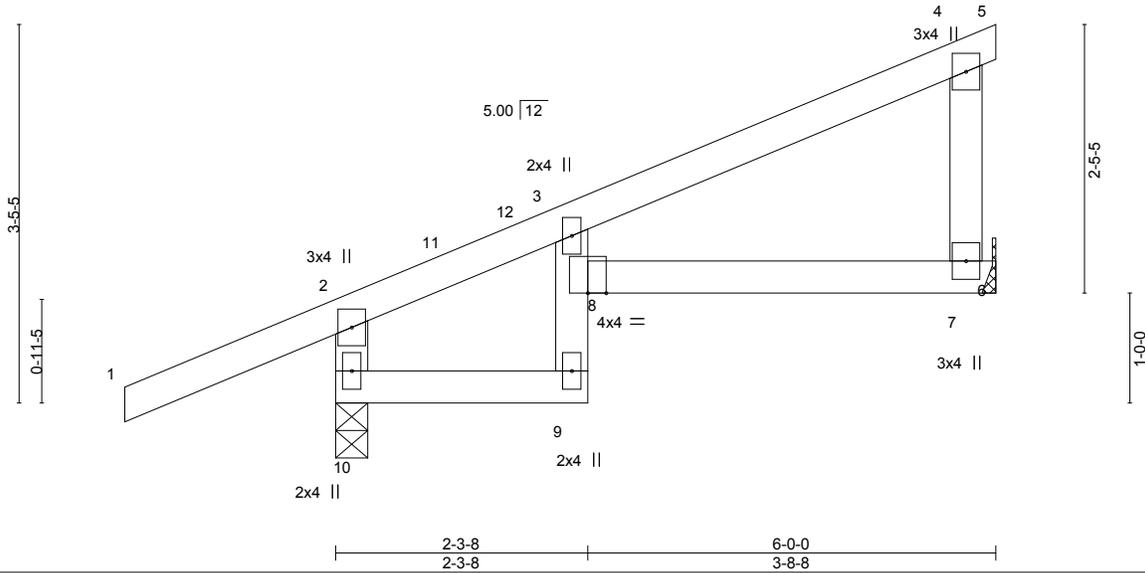

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	0.04 7-8	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.23	Vert(CT)	-0.06 7-8	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.03 7	n/a	n/a		
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-AS					Weight: 21 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 WEBS 2x4 SPF No.2

BRACING-
 TOP CHORD Structural wood sheathing directly applied, except end verticals.
 BOT CHORD Rigid ceiling directly applied.

REACTIONS. (size) 10=0-3-8, 7=Mechanical
 Max Horz 10=119(LC 9)
 Max Uplift 10=-75(LC 12), 7=-59(LC 12)
 Max Grav 10=422(LC 1), 7=236(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
 TOP CHORD 2-10=-374/221

- NOTES-**
- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 6-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 7.
 - 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
 - 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 20, 2021


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

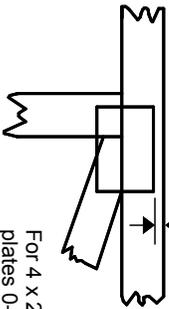

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

* Plate location details available in **MITek 20/20 software** or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TFP 1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

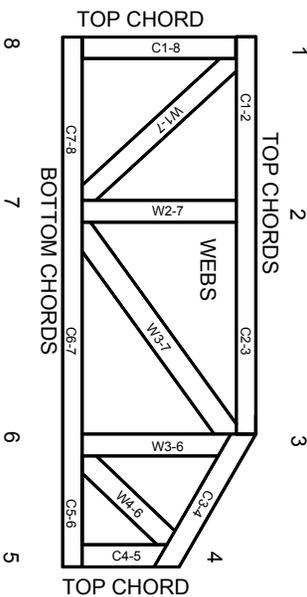

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TFP 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T or I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TFP 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TFP 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TFP 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.



MITek Engineering Reference Sheet: Mill-7473 rev. 5/19/2020