

FIXTURE NOTE:

- 2X4 LED FIXTURE
- **EMERGENCY LIGHT**

MAU-1

EXIT SIGN EXTERIOR EMERGENCY LIGHT

EQUIPMENT

FCU-1/CU-1 11.25 MCA

12.25 MCA

12.25 MCA

15 MOCP

7 30A / 240V NEMA 3R DISCONNECT SWITCH. CONFIRM SIZE AND

6 ADD 70A / 3P BREAKER. INSTALL 3-#4 1-#8 GROUND

CONFIRM WITH FINAL EQUIPMENT SELECTION.

(2) EXISTING FIXTURES TO REMAIN, CLEAN AND RELAMP

(3) CONNECT TO SPARE BREAKER IN EXISTING PANEL

(5) INTERLOCK EXHAUST FAN TO LIGHT SWITCH

LOCATION WITH FINAL EQUIPMENT SELECTION.

GENERAL NOTE:


(4) NO NEW WORK IN THIS AREA

PLAN NOTE:

1) CONNECT TO NON-SWITCHED CIRCUIT

- 1. ELECTRICAL INSTALLATION SHALL CONFORM TO CURRENT NEC AND ALL APPLICABLE LOCAL CODES INCLUDING 'ADA' REQUIREMENTS
- 2. WIRING SHALL BE #12 AWG COPPER MIN. THHN/THWN-2 INSTALLED IN CONDUIT UNLESS OTHERWISE INDICATED
- 3. CONDUIT SHALL BE 1/2" 'EMT' MIN. UNLESS OTHERWISE INDICATED. MC CABLE IS ACCEPTABLE WHERE CONCEALED.
- 4. DEVICE AND COVERPLATE SHALL BE AS DIRECTED
- 5. FIRE ALARM MODIFICATIONS BY OTHERS
- 6. HOMERUN ARROW INDICATES NUMBER OF CIRCUITS ROUTED BACK TO EXISTING PANELBOARD. UTILIZE EXISTING CIRCUITS REMAINING FROM DEMO AS APPLICABLE.CONTRACTOR TO MARKUP DRAWING WITH ACTUAL BREAKER NUMBER WHERE CIRCUIT IS TERMINATED. UTILIZE EXISTING 20A/1P BREAKERS.
- 7. A MAXIMUM OF 6 DUPLEX RECEPTACLES ON A 20A CIRCUIT. PLACE PRINTERS AND COPIERS ON DEDICATED CIRCUITS.

5 3 1	HOME RUN TO PANEL. CIRCUIT NUMBERS, PHASE,
Att.	NEUTRAL AND GROUND CONDUCTORS INDICATED. ALL CONDUCTORS TO BE #12 EXCEPT WHERE NOTED CONDUIT TO BE 1/2" OR AS NOTED ON PLANS AND SPECIFICATIONS.
	CONDUIT INSTALLED CONCEALED ABOVE CEILING OR IN WALL.
	CONDUIT INSTALLED CONCEALED BELOW FLOOR SLAB OR UNDERGROUND
\$	SINGLE POLE SWITCH, MOUNTED AT 46" O.C. A.F.F UNLESS OTHERWISE NOTED.
\$ ³	THREE-WAY SWITCH, MOUNTED AT 46" O.C. A.F.F. UNLESS OTHERWISE NOTED
\$ ^{OS}	OCCUPANCY SENSOR SWITCH MOUNTED AT 48" O.C. A.F.F. UNLESS OTHERWISE NOTED
\$	EMERGENCY LIGHTING , MOUNTED AT 7'-6" A.F.F. UNLESS OTHERWISE NOTED
	DUPLEX RECEPTACLE, MOUNTED AT 18" O.C. A.F.F. UNLESS OTHER WISE NOTED
•	SPECIAL RECEPTACLE, COORDINATE WITH EQUIPMENT
-	GFCI RECEPTACLE, MOUNTED AT 18" O.C. A.F.F. UNLESS OTHER WISE NOTED
٥	DATA OUTLET, MOUNTED AT 18" O.C. A.F.F. WITH 3/4" CONDUIT TO ABOVE CEILING
? ()	JUNCTION BOX
ď	DISCONNECT SWITCH
Ø	COMBINATION DISCONNECT AND STARTER
69	MOTOR
Ó	EXHAUST FAN
	PANELBOARD
GFCI	GROUND FAULT INTERRUPTING
WP	WEATHERPROOF
	EXIT SIGN - ARROWS AS NEEDED

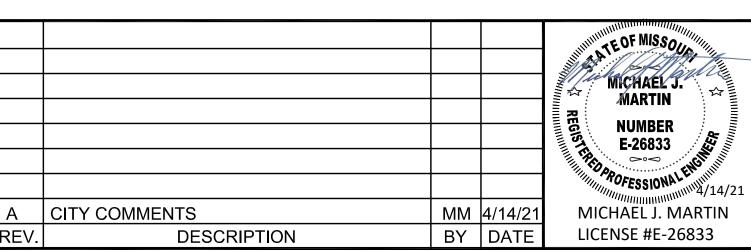

COLDWATER LEASE SPACE SW BLUE PARKWAY LEE'S SUMMIT, MO

ELECTRICAL LAYOUT



STRINGER 01/25/2021 APPROVED: DATE: MARTIN 01/25/2021 SCALE: AS SHOWN DWG. NO: