



MiTek USA, Inc.  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017  
314-434-1200

Re: 2765833  
Summit/#8 Osage

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Valley Center).

Pages or sheets covered by this seal: I45804333 thru I45804396

My license renewal date for the state of Missouri is December 31, 2021.

Missouri COA: Engineering 001193



April 23, 2021

Johnson, Andrew ,Engineer

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804333
2765833	A1	GABLE	2	1		
Job Reference (optional)						

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:32 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzboN-Bnkg6CXelsWfJ3T90ZZ7MQsRc5GWem7KzGCqG2zNtez

18-1-11 18-1-11 19-4-8 1-2-13 38-10-8 19-6-0 39-9-0 0-10-8

6.00 12

5x5 =

Scale = 1:70.6

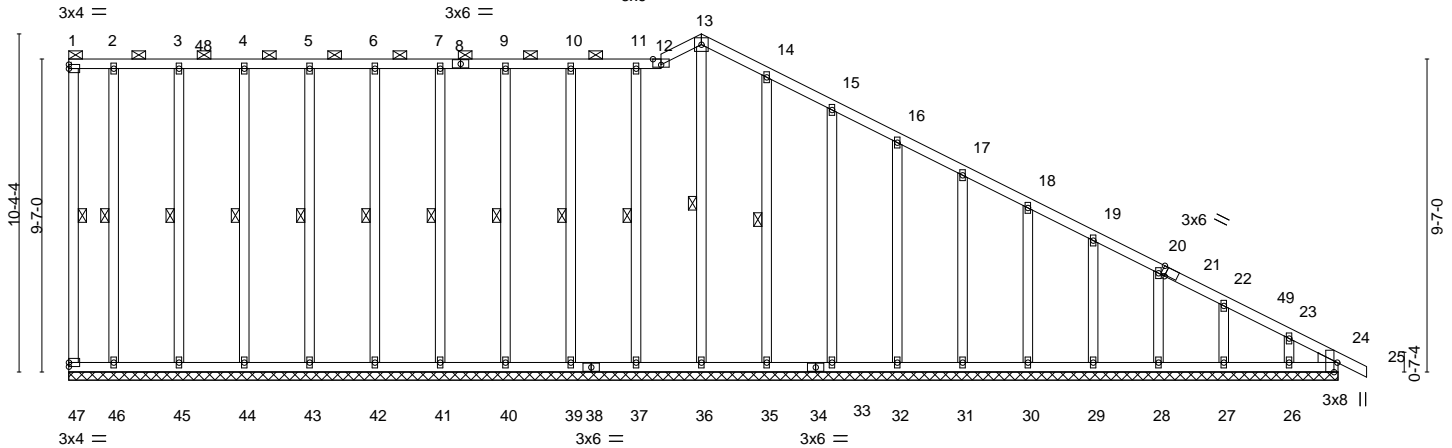


Plate Offsets (X,Y)-- [12:0-3-0,Edge], [21:0-1-9,Edge], [24:0-3-8,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.43	Vert(LL)	-0.00	25	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.23	Vert(CT)	-0.00	25	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.16	Horz(CT)	0.02	24	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S							
										Weight: 257 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-12.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 1-47, 13-36, 11-37, 10-39, 9-40, 7-41, 6-42, 5-43, 4-44, 3-45, 2-46, 14-35
OTHERS 2x4 SPF No.2	
WEDGE	
Right: 2x4 SPF No.2	

**REACTIONS.** All bearings 38-10-8.  
(lb) - Max Horz 47=315(LC 10)  
Max Uplift All uplift 100 lb or less at joint(s) 47, 36, 37, 39, 40, 41, 42, 43, 44, 45, 46, 35, 33, 32, 31, 30, 29, 28, 27, 26, 24  
Max Grav All reactions 250 lb or less at joint(s) 47, 36, 37, 39, 40, 41, 42, 43, 44, 45, 46, 35, 33, 32, 31, 30, 29, 28, 27, 26, 24

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 17-18=281/179, 18-19=331/196, 19-20=382/214, 20-22=432/231, 22-23=484/250, 23-24=580/289  
BOT CHORD 46-47=240/502, 45-46=240/502, 44-45=240/502, 43-44=240/502, 42-43=240/502, 41-42=240/502, 40-41=240/502, 39-40=240/502, 37-39=240/502, 36-37=240/502, 35-36=240/502, 33-35=240/502, 32-33=240/502, 31-32=240/502, 30-31=240/502, 29-30=240/502, 28-29=240/502, 27-28=240/502, 26-27=240/502, 24-26=240/502

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) and C-C Corner(3E) 0-1-12 to 4-0-6, Exterior(2N) 4-0-6 to 19-4-8, Corner(3R) 19-4-8 to 23-4-8, Exterior(2N) 23-4-8 to 39-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 47, 36, 37, 39, 40, 41, 42, 43, 44, 45, 46, 35, 33, 32, 31, 30, 29, 28, 27, 26, 24.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2765833	Truss A3	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Summit/#8 Osage Job Reference (optional)	145804334
----------------	-------------	----------------------------	----------	----------	---	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:07 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhN-fWLVSAybVcwi0ReuaQhLHppJkC7rLSbT0DAA?WzNteQ

8-0-5	15-9-3	19-4-8	25-10-6	32-4-5	38-10-8	39-9-0
8-0-5	7-8-13	3-7-5	6-5-14	6-5-14	6-6-3	0-10-8

Scale = 1:71.2

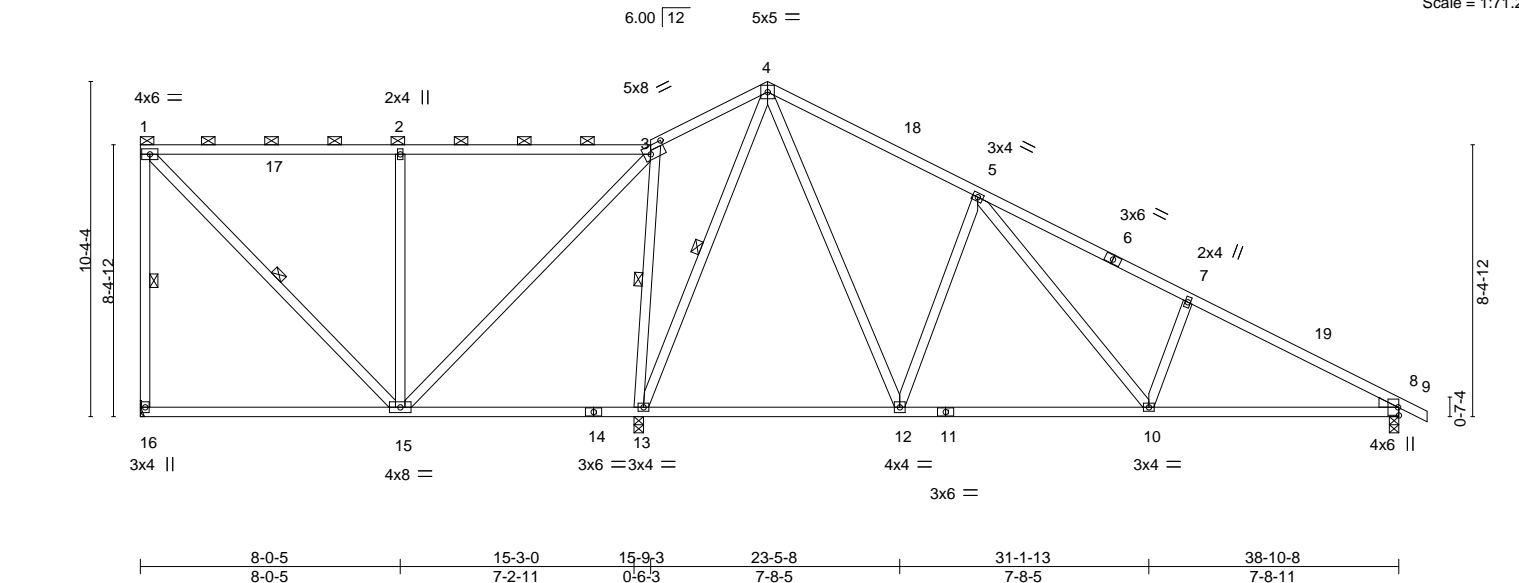


Plate Offsets (X,Y)-- [3:0-5-8,0-3-0]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES	GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.89	Vert(LL)	-0.11	15-16	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.54	Vert(CT)	-0.22	15-16	>846	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.75	Horz(CT)	0.02	8	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S							Weight: 191 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-2-2 oc purlins, except end verticals, and 2-0-0 oc purlins (5-7-10 max.): 1-3.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
WEBS 1 Row at midpt 1-16, 1-15, 4-13, 3-13

#### REACTIONS.

(size) 16=Mechanical, 13=0-3-8, 8=0-3-8  
Max Horz 16=-363(LC 8)  
Max Uplift 16=-206(LC 8), 13=-259(LC 13), 8=-205(LC 13)  
Max Grav 16=535(LC 25), 13=2164(LC 1), 8=959(LC 26)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-16=-464/228, 3-4=0/571, 4-5=-531/262, 5-7=-1245/362, 7-8=-1407/294  
BOT CHORD 15-16=-200/354, 13-15=-496/320, 10-12=0/616, 8-10=-168/1147  
WEBS 1-15=-196/329, 2-15=-641/274, 3-15=-156/926, 4-13=-1304/216, 4-12=-261/908, 5-12=-730/329, 5-10=-194/665, 7-10=-371/227, 3-13=-813/282

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-0-6, Interior(1) 4-0-6 to 19-4-8, Exterior(2R) 19-4-8 to 23-3-2, Interior(1) 23-3-2 to 39-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=206, 13=259, 8=205.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:08 2021 Page 1

ID:SlS.lxd784yT GMBI 7atyrSzbbhoN-8ivHfWzDGw2YdbD477Dag0l 7XhQE4 5dEtwiXzzNteP





TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-3.	
BOT CHORD	Rigid ceiling directly applied. Except: 4-1-0 oc bracing: 4-14	
WEBS	1 Row at midpt	5-13, 6-13


(size) 19=Mechanical, 14=0-3-8, 9=0-3-8  
 Max Horz 19=-307(LC 8)  
 Max Uplift 19=-243(LC 8), 14=-180(LC 12), 9=-283(LC 13)  
 Max Grav 19=589(LC 25), 14=1954(LC 1), 9=1035(LC 1)

TOP CHORD	1-19=-531/257, 1-2=-403/200, 2-3=-405/201, 3-4=0/398, 4-5=-288/348, 5-6=-346/319, 6-8=-1229/442, 8-9=-1532/471
BOT CHORD	18-19=-149/287, 14-16=-1870/229, 4-16=-1300/88, 13-14=-250/85, 11-13=-133/772, 9-11=-322/1295
WEBS	1-18=-274/504, 2-18=-517/220, 3-16=-587/177, 3-18=0/537, 4-13=-12/1009, 6-13=-819/313, 6-11=-83/569, 8-11=-412/222

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-0-6, Interior(1) 4-0-6 to 19-4-8, Exterior(2R) 19-4-8 to 23-3-2, Interior(1) 23-3-2 to 39-9-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 19=243, 14=180, 9=283.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TP1 1.
- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Scale = 1:81.2

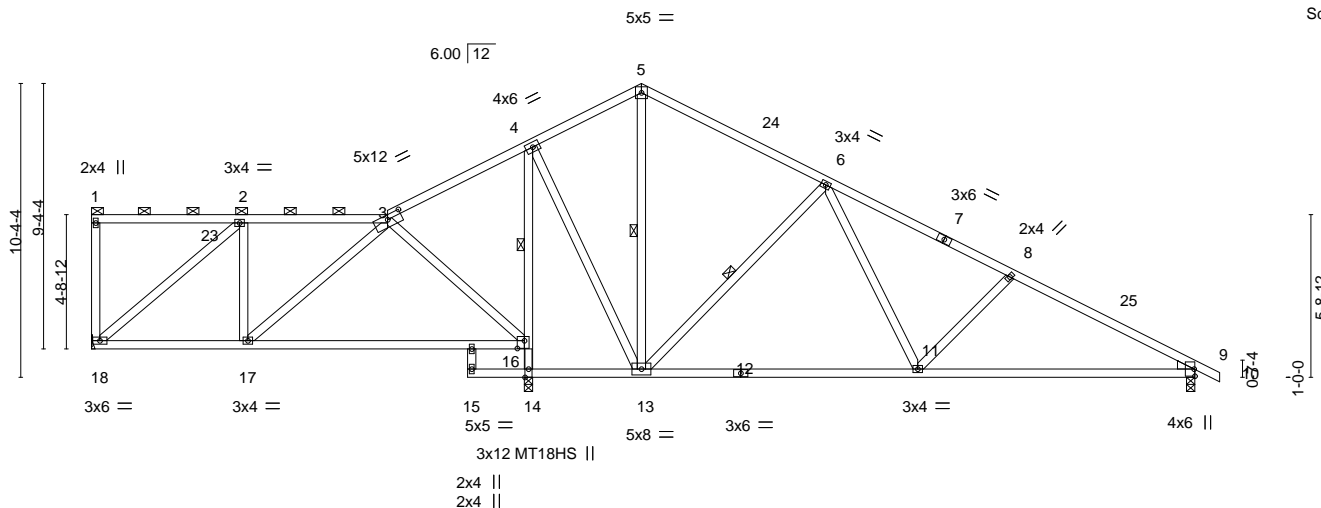

5-4-5	13-3-0	15-4-12	19-4-8	29-1-5	38-10-8
5-4-5	7-10-11	2-1-12	3-11-12	9-8-13	9-9-3

Plate Offsets (X,Y)-- [3:0-6-0,0-1-14], [16:0-3-0,0-3-4]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.43	Vert(LL)	-0.22 16-17 >837 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.72	Vert(CT)	-0.43 16-17 >421 180	MT18HS	197/144
BCLL	0.0	Rep Stress Incr	YES	WB	0.49	Horz(CT)	0.03 14 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 183 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-3.	
BOT CHORD	Rigid ceiling directly applied. Except: 1 Row at midpt 4-16 3-11-0 oc bracing: 14-16	
WEBS	1 Row at midpt	5-13, 6-13

## REACTIONS.

(size) 18=Mechanical, 14=0-3-8, 9=0-3-8  
 Max Horz 18=-268(LC 8)  
 Max Uplift 18=-224(LC 8), 14=-172(LC 12), 9=-290(LC 13)  
 Max Grav 18=584(LC 25), 14=2001(LC 1), 9=1032(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-484/191, 3-4=0/449, 4-5=-290/366, 5-6=-340/335, 6-8=-1222/457, 8-9=-1525/487  
BOT CHORD 17-18=-83/482, 16-17=-135/274, 14-16=-1957/203, 4-16=-1445/123, 13-14=-287/61,  
11-13=-147/767, 9-11=-335/1289  
WEBS 2-18=-610/257, 3-17=0/400, 3-16=-613/196, 6-13=-820/313, 6-11=-82/569,  
8-11=-412/221, 4-13=0/1001

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-0-6, Interior(1) 4-0-6 to 19-4-8, Exterior(2R) 19-4-8 to 23-3-2, Interior(1) 23-3-2 to 39-9-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=224, 14=172, 9=290.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 3f, 9f, 10f, 11f, 12f, 13f, 14f, 15f, 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2765833	Truss A6	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Summit/#8 Osage	145804337
Job Reference (optional)						


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:11 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-YHaQHY?5ZrQ7U3xpFmHRfz?cpRnHJA3xr8O8IzNteM

7-9-3	13-3-0	18-2-8	20-6-8	26-7-12	32-8-15	38-10-8	39-9-0
7-9-3	5-5-13	4-11-8	2-4-0	6-1-4	6-1-4	6-1-9	0-10-8

Scale = 1:78.7

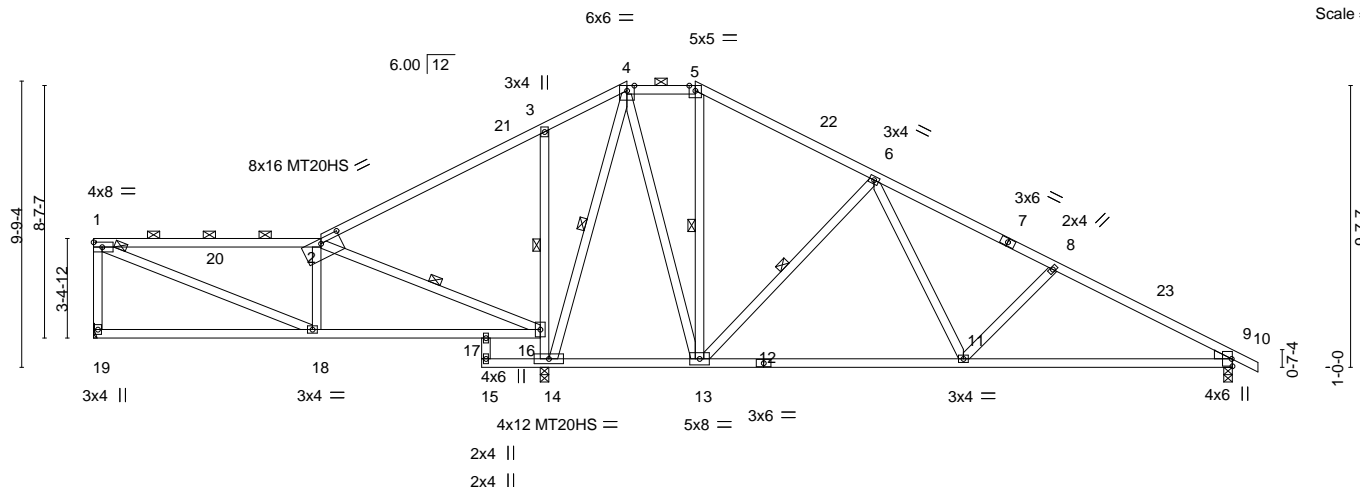

7-9-3	13-3-0	15-4-12	18-2-8	20-6-8	29-8-5	38-10-8
7-9-3	5-5-13	2-1-12	2-9-12	2-4-0	9-1-13	9-2-3

Plate Offsets (X,Y)-- [2:0-8-0,0-1-14]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	<b>L/d</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.89	Vert(LL)	-0.16	9-11	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.73	Vert(CT)	-0.34	9-11	>819
BCLL 0.0	Rep Stress Incr	YES	WB 0.52	Horz(CT)	0.03	14	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S				
						<b>PLATES</b>	<b>GRIP</b>
						MT20	197/144
						MT20HS	148/108
						Weight: 185 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-2-3 oc purlins, except end verticals, and 2-0-0 oc purlins (2-8-10 max.): 1-2, 4-5.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 13-14.  
WEBS 5-11-0 oc bracing: 3-14  
1 Row at midpt 2-16, 5-13, 6-13, 4-14

#### REACTIONS.

(size) 19=Mechanical, 14=0-3-8, 9=0-3-8  
Max Horz 19=223(LC 8)  
Max Uplift 19=162(LC 8), 14=248(LC 12), 9=269(LC 13)  
Max Grav 19=522(LC 25), 14=2068(LC 1), 9=1023(LC 26)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-19=451/185, 1-2=521/207, 2-3=0/530, 3-4=0/453, 4-5=286/311, 5-6=421/301,  
6-8=1232/413, 8-9=1509/437  
BOT CHORD 17-18=136/521, 16-17=136/521, 14-16=902/354, 3-16=510/273, 11-13=118/796,  
9-11=298/1260  
WEBS 1-18=207/484, 2-16=873/224, 6-13=756/287, 6-11=80/527, 8-11=357/211,  
4-13=152/954, 4-14=1146/27

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-0-6, Interior(1) 4-0-6 to 18-2-8, Exterior(2E) 18-2-8 to 20-6-8, Exterior(2R) 20-6-8 to 24-5-2, Interior(1) 24-5-2 to 39-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 19=162, 14=248, 9=269.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Scale = 1:73.3

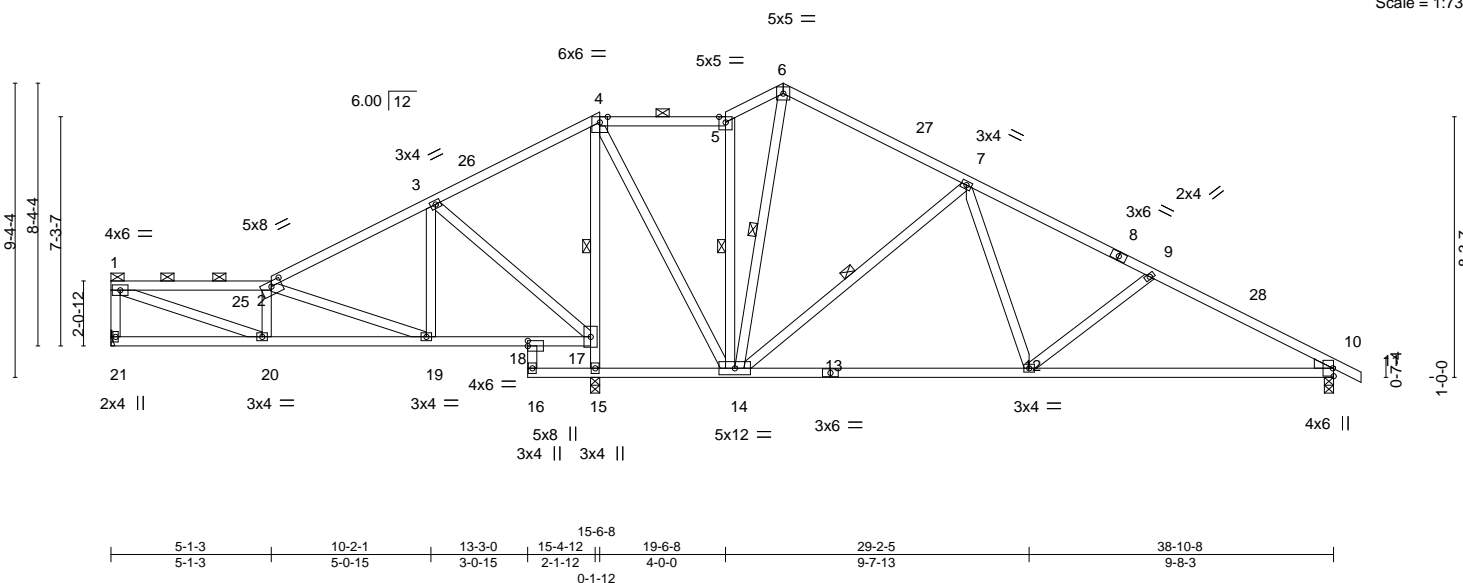


Plate Offsets (X,Y)-- [2:0-4-0-0-1-14], [18:0-0-0-0-2-0]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES	GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.36	Vert(LL)	-0.13	12-14	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.29	12-14	>972	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.55	Horz(CT)	0.03	15	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 186 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (5-10-9 max.): 1-2, 4-5.
BOT CHORD	Rigid ceiling directly applied.
WEBS	1 Row at midpt 4-15, 5-14, 6-14, 7-14

### REACTIONS.

(size) 21=Mechanical, 15=0-3-8, 10=0-3-8  
 Max Horz 21=192(LC 13)  
 Max Uplift 21=117(LC 12), 15=322(LC 12), 10=249(LC 13)  
 Max Grav 21=516(LC 25), 15=2098(LC 1), 10=988(LC 26)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-21=466/134, 1-2=845/190, 2-3=286/153, 3-4=0/531, 4-5=186/260, 5-6=207/290,  
6-7=-317/242, 7-9=1137/356, 9-10=1458/410

BOT CHORD 19-20=232/857, 17-18=135/436, 15-16=311/125, 14-15=369/156, 12-14=99/797,  
10-12=274/1237

WEBS 1-20=197/813, 15-17=1976/332, 4-17=1530/208, 4-14=162/1126, 7-14=787/280,  
7-12=48/510, 9-12=384/205, 3-19=0/324, 2-19=709/185, 3-17=670/213

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 4-0-6, Interior(1) 4-0-6 to 15-6-8, Exterior(2E) 15-6-8 to 19-6-8, Interior(1) 19-6-8 to 21-4-8, Exterior(2R) 21-4-8 to 25-3-2, Interior(1) 25-3-2 to 39-9-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 21=117, 15=322, 10=249.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 3f, 9f, 10f, 11f, 12f, 13f, 14f, 15f, 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804339
2765833	A8	ROOF SPECIAL	1	1		


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:14 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-ysGZwZ2\_smpilWgEU0J\_3HbdH0VvUbEVdpN2lczNteJ


2-5-3	7-7-13	12-10-8	16-10-8	21-4-8	27-2-6	33-0-5	38-10-8	39-9-0
2-5-3	5-2-11	5-2-11	4-0-0	4-6-0	5-9-14	5-9-14	5-10-3	0-10-8

Scale = 1:68.7

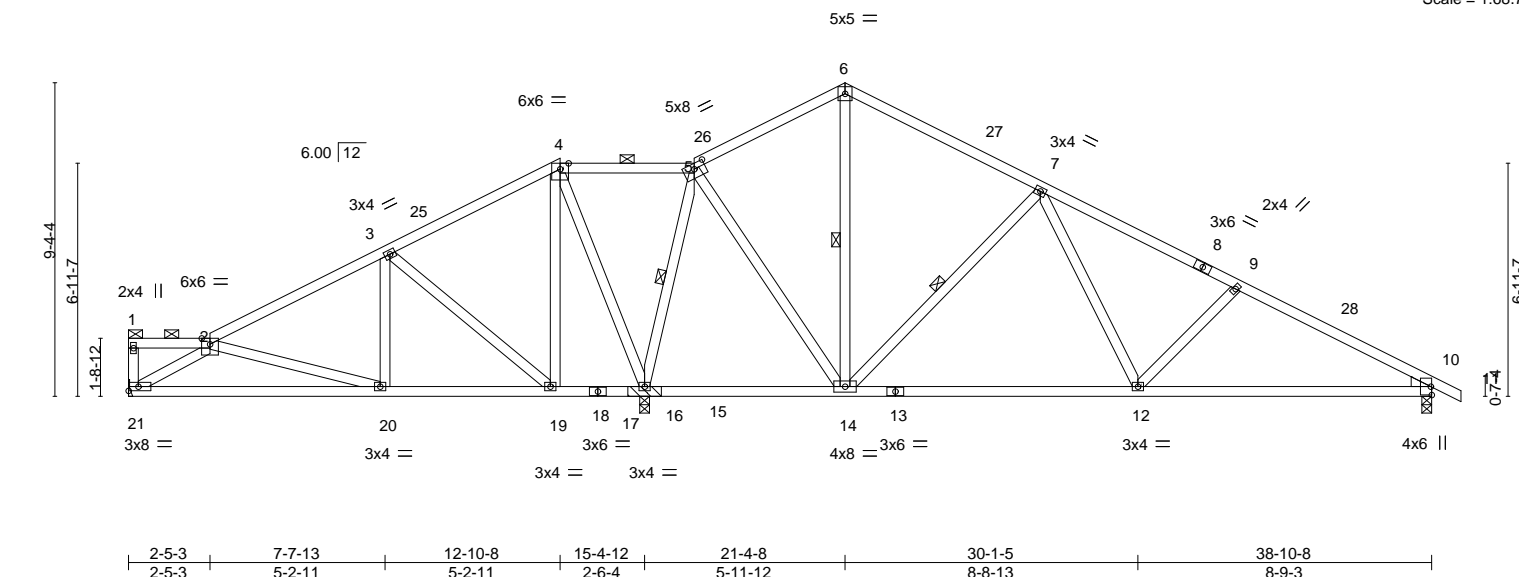



Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MITek Industries, Inc. Fri Apr 23 09:17:16 2021 Page 1  
 ID:SlSjxd784vT\_GMBLZatvrSzbhoN-vEOJLF3ENN3QbqqcbpMS8ihq0q6dSvo46s9pVzNteH  
 -0-10-8 4-3-12 8-4-0 8-11-0 11-5-8 12-4-0 19-6-0 25-3-14 31-1-13 37-0-0 37-10-8  
 0-10-8 4-3-12 4-0-4 0-7-0 2-6-8 0-10-8 7-2-0 5-9-14 5-9-14 5-10-3 0-10-8  
 Scale = 1:66.7

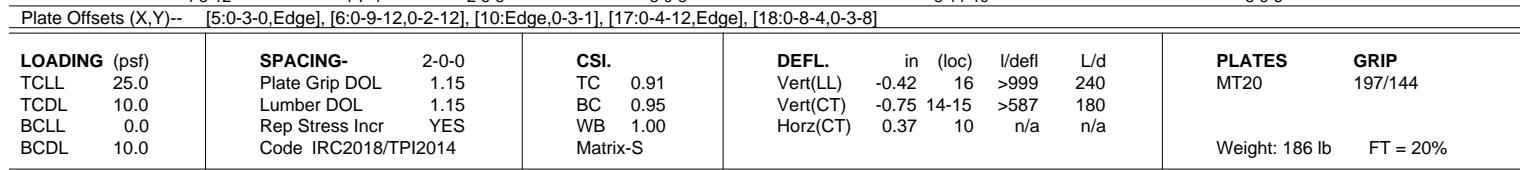

**REACTIONS.** (size) 22=0-3-8, 10=0-3-8  
 Max Horz 22=-159(LC 13)  
 Max Uplift 22=-298(LC 12), 10=-285(LC 13)  
 Max Grav 22=1746(LC 1), 10=1732(LC 1)

NOTES-

- 

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses, see **ANSI/TPI-1 Quality Criteria, DSB-89 and BCS Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**MiTek**  
 16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804341
2765833	A10	Roof Special	2	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:34 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-79rRWuZuGTmNYNcY8\_bbRrxk1umM6aKdQahwKxzNtex

-0-10-8	5-8-0	9-8-0	14-7-0	19-6-0	24-5-0	25-3-14	31-1-13	37-0-0	37-10-8
0-10-8	5-8-0	4-0-0	4-11-0	4-11-0	4-11-0	0-10-14	5-9-14	5-10-3	0-10-8

Scale = 1:67.4

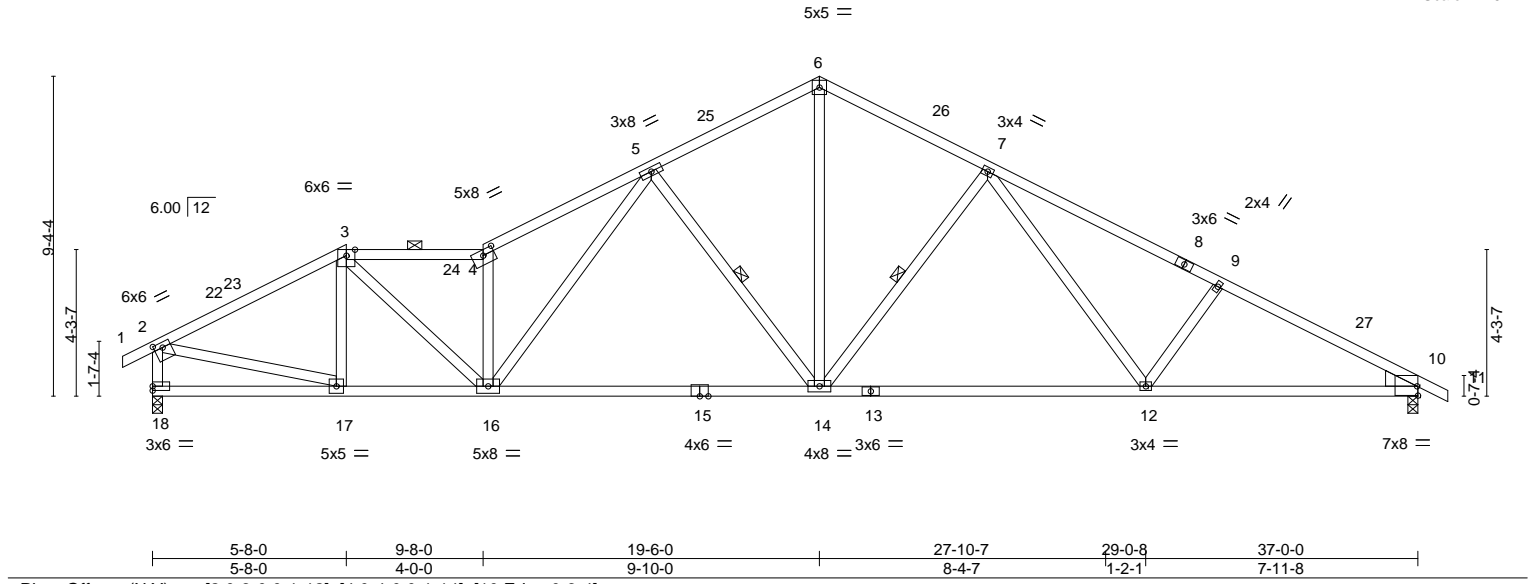

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.63	Vert(LL)	-0.23 14-16	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.91	Vert(CT)	-0.53 14-16	>832	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.56	Horz(CT)	0.12 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 165 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Right: 2x6 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-2-12 max.): 3-4.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 5-14, 7-14

#### REACTIONS.

(size) 18=0-3-8, 10=0-3-8  
Max Horz 18=162(LC 17)  
Max Uplift 18=308(LC 12), 10=287(LC 13)  
Max Grav 18=1730(LC 1), 10=1719(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=2233/398, 3-4=2946/535, 4-5=3310/642, 5-6=1999/439, 6-7=2006/439,  
7-9=2763/494, 9-10=2970/486, 2-18=1665/356  
BOT CHORD 16-17=386/1939, 14-16=339/2217, 12-14=229/2104, 10-12=345/2567  
WEBS 3-16=203/1408, 4-16=1759/392, 5-16=259/1135, 5-14=844/313, 6-14=263/1418,  
7-14=675/289, 7-12=124/520, 9-12=343/215, 3-17=379/95, 2-17=255/1816

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 5-8-0, Exterior(2R) 5-8-0 to 8-8-0, Interior(1) 8-8-0 to 19-6-0, Exterior(2R) 19-6-0 to 22-6-0, Interior(1) 22-6-0 to 37-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=308, 10=287.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021



**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:35 2021 Page 1  
ID:SlxJxd784yT GMBLZatvrSzbhoN-bMPpkEaW1nuEAXBkih7a 3Utkl86xamfEQUtNzNtew

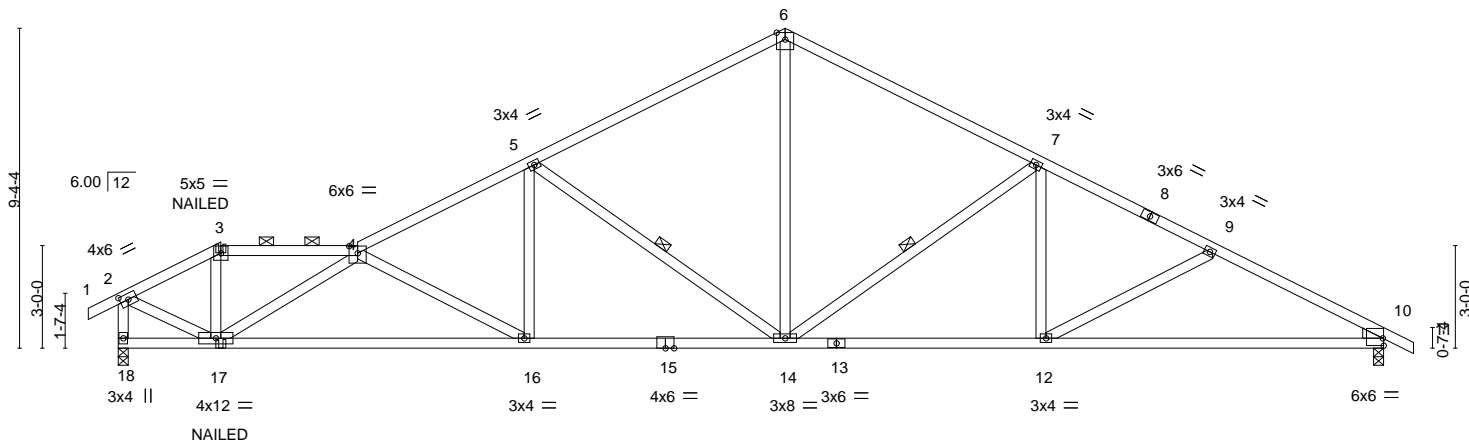

Offset (X, Y)	Offset (X, Y)	Offset (X, Y)	Offset (X, Y)	Offset (X, Y)	Offset (X, Y)	Offset (X, Y)	Offset (X, Y)	Offset (X, Y)	Offset (X, Y)
3-0-0	7-0-0	11-2-0	12-1-15	15-4-0	19-6-0	21-11-13	26-11-13	37-0-0	
3-0-0	4-0-0	4-2-0	0-11-15	3-2-1	4-2-0	2-5-13	4-11-15	10-0-3	
Plate Offsets (X, Y)--	[2-0-2-15, 0-2-0]	[4-0-3-0-0-2-8]	[10-Edge, 0-2-9]						

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc)	I/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.76	Vert(LL) -0.21 12-14	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.81	Vert(CT) -0.42 16-17	>999	180		
BCLL 0.0	Rep Stress Incr NO	WB 0.93	Horz(CT) 0.14 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS				Weight: 159 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2 \*Except\*  
4-6,6-8: 2x4 SPF 1650F 1.5E  
BOT CHORD 2x4 SPF 1650F 1.5E \*Except\*  
13-15: 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied or 2-8-11 oc purlins, except end verticals, and 2-0-0 oc purlins (4-4-5 max.): 3-4.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	1 Row at midpt                      5-14, 7-14

**REACTIONS.**

(size) 18=0-3-8, 10=0-3-8  
 Max Horz 18=-162(LC 13)  
 Max Uplift 18=-326(LC 8), 10=-291(LC 9)  
 Max Grav 18=1729(LC 1), 10=1719(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1813/316, 3-4=-1566/304, 4-5=-2944/497, 5-6=-2039/382, 6-7=-2039/389,  
7-9=-2661/442, 9-10=-2933/497, 2-18=-1737/314

BOT CHORD 16-17=-656/3331, 14-16=-438/2588, 12-14=-228/2348, 10-12=-354/2533

WEBS 6-16=-178/1220, 5-14=-1073/337, 7-14=-811/286, 7-12=0/381, 5-16=-45/589,  
4-16=-847/248, 3-17=-41/523, 2-17=-255/1767, 4-17=-2116/374

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=326, 10=291.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 8) "NAILED" indicates 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 9) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

## LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-70, 2-3=-70, 3-4=-70, 4-6=-70, 6-11=-70, 18-19=-20



April 23, 2021

Continued on page 2



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 3f, 9f, 10f, 11f, 12f, 13f, 14f, 15f, 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804342
2765833	A11	Roof Special Girder	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:35 2021 Page 2  
ID:SlsJxd784vT\_GMBLZatvrSzbhoN-bMPpkEaW1nuEAXBkih7q\_3Utkl86rxqmfEQUtNzNtew

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 17=1(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2765833	Truss A12	Truss Type Common	Qty 6	Ply 1	Summit/#8 Osage 145804343
----------------	--------------	----------------------	----------	----------	------------------------------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:37 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzboN-YkXZ9wbNzO8yPqL7p69l3UZGG6p7J?J36YvaxGzNteu

-0-10-8	5-10-3	11-8-2	17-6-0	23-3-14	29-1-13	35-0-0	35-10-8
0-10-8	5-10-3	5-9-14	5-9-14	5-9-14	5-9-14	5-10-3	0-10-8

Scale = 1:61.1

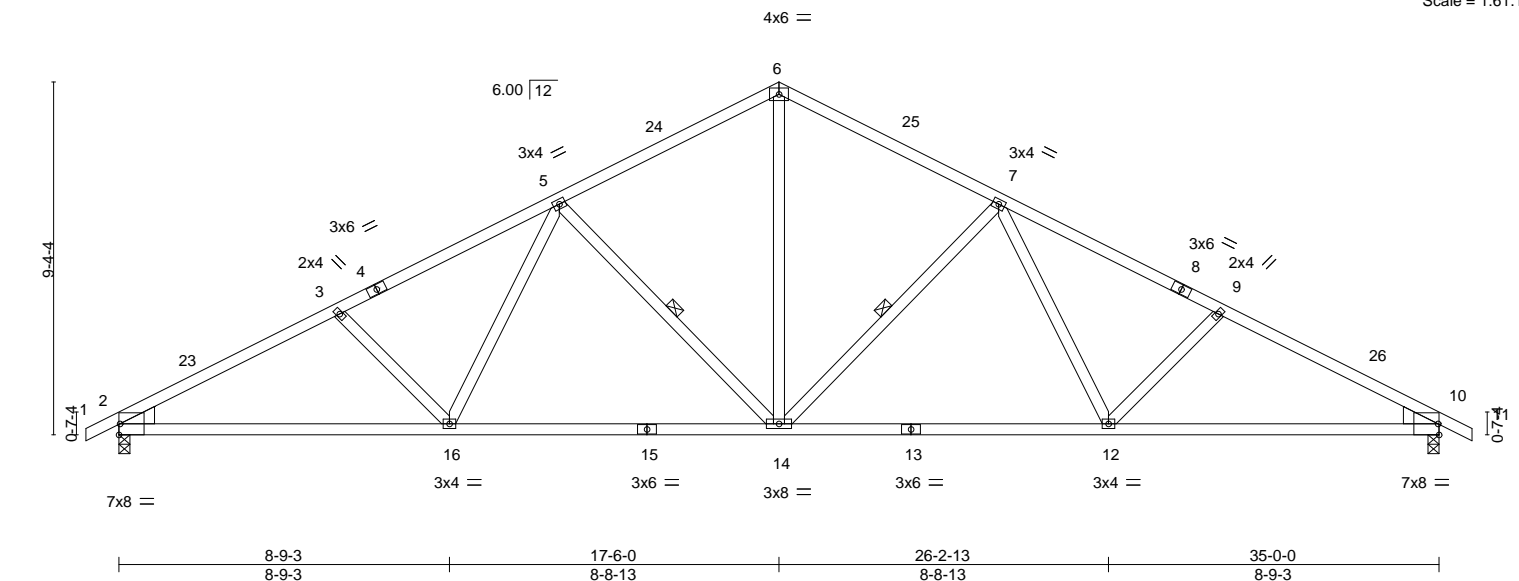

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.57	Vert(LL)	-0.19 12-14 >999 240	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.84	Vert(CT)	-0.40 12-14 >999 180				
BCLL	0.0	Rep Stress Incr	YES	WB	0.29	Horz(CT)	0.13 10 n/a n/a				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							
								Weight: 143 lb		FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Left: 2x6 SPF No.2 , Right: 2x6 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 7-14, 5-14

#### REACTIONS.

(size) 2=0-3-8, 10=0-3-8  
Max Horz 2=162(LC 12)  
Max Uplift 2=280(LC 12), 10=280(LC 13)  
Max Grav 2=1636(LC 1), 10=1636(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-2778/469, 3-5=-2530/444, 5-6=-1834/397, 6-7=-1834/397, 7-9=-2530/444, 9-10=-2778/469  
BOT CHORD 2-16=-488/2395, 14-16=-323/2019, 12-14=-208/2019, 10-12=-327/2395  
WEBS 6-14=-197/1178, 7-14=-701/281, 7-12=-73/433, 9-12=-316/194, 5-14=-701/280, 5-16=-73/433, 3-16=-316/194

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 17-6-0, Exterior(2R) 17-6-0 to 20-6-0, Interior(1) 20-6-0 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=280, 10=280.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2765833	Truss A13	Truss Type GABLE	Qty 4	Ply 1	Summit/#8 Osage 145804344
----------------	--------------	---------------------	----------	----------	------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:39 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvSzboN-U7fKabd15?Ogf8VVxxBm8vejYvhlngwMasOh08zNtes

17-6-0 17-6-0 35-0-0 35-0-0 17-6-0 35-10-8 0-10-8

Scale = 1:61.1

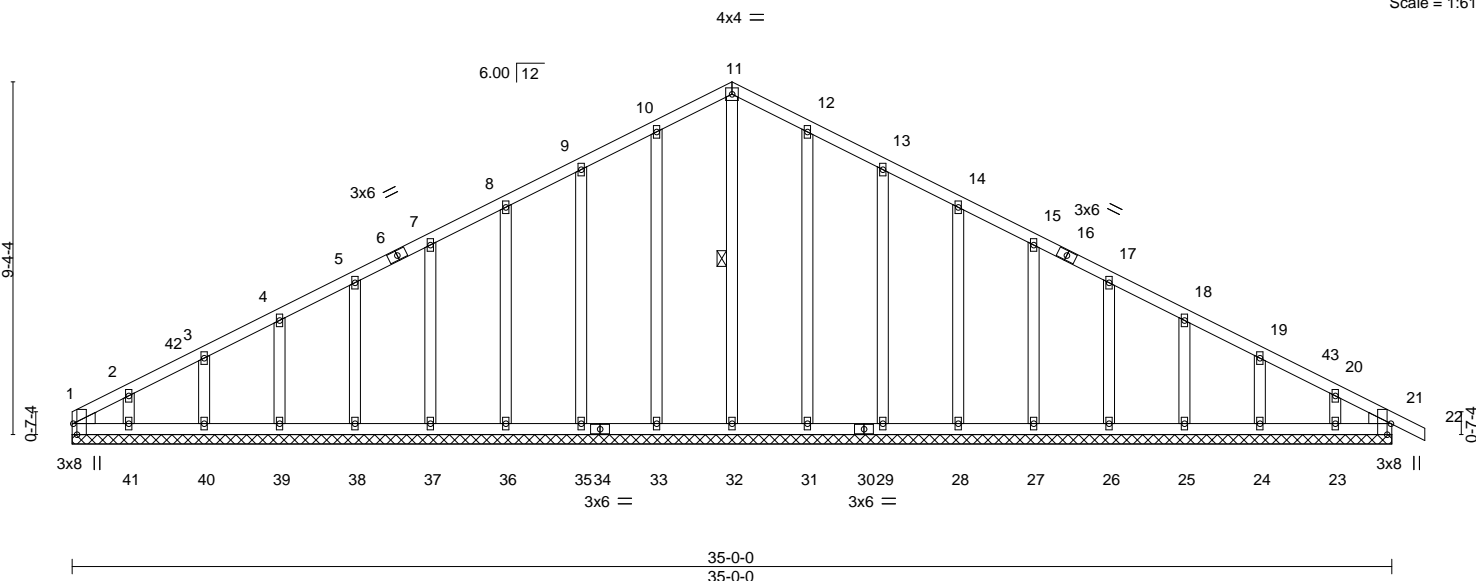


Plate Offsets (X, Y)--		[1:0-3-8, Edge], [21:0-3-8, Edge]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07
TCDL 10.0	Lumber DOL	1.15	BC 0.03
BCLL 0.0	Rep Stress Incr	YES	WB 0.17
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S
			<b>DEFL.</b> in (loc) l/defl L/d
			Vert(LL) -0.00 22 n/r 120
			Vert(CT) -0.00 22 n/r 120
			Horz(CT) 0.01 21 n/a n/a
			<b>PLATES</b> MT20
			<b>GRIP</b> 197/144
			Weight: 176 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
WEDGE  
Left: 2x4 SPF No.2, Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 11-32

#### REACTIONS.

All bearings 35-0-0.  
(lb) - Max Horz 1=-164(LC 13)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 33, 35, 36, 37, 38, 39, 40, 41, 31, 29, 28, 27, 26, 25, 24, 23, 21  
Max Grav All reactions 250 lb or less at joint(s) 1, 32, 33, 35, 36, 37, 38, 39, 40, 41, 31, 29, 28, 27, 26, 25, 24, 23, 21

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 10-11=-111/295, 11-12=-111/295

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-0-0 to 3-0-0, Exterior(2N) 3-0-0 to 17-6-0, Corner(3R) 17-6-0 to 20-6-0, Exterior(2N) 20-6-0 to 35-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 33, 35, 36, 37, 38, 39, 40, 41, 31, 29, 28, 27, 26, 25, 24, 23, 21.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804345
2765833	A14	Roof Special	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:41 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-QVm4?HeHddfOuSfu2yEEDKkuHjGDFn9f1Ato41zNteq

3-0-0	10-3-0	11-6-4	17-6-0	23-4-0	29-1-13	35-0-0	35-10-8
3-0-0	7-3-0	1-3-4	5-11-12	5-10-0	5-9-13	5-10-3	0-10-8

4x6 =

Scale = 1:65.4

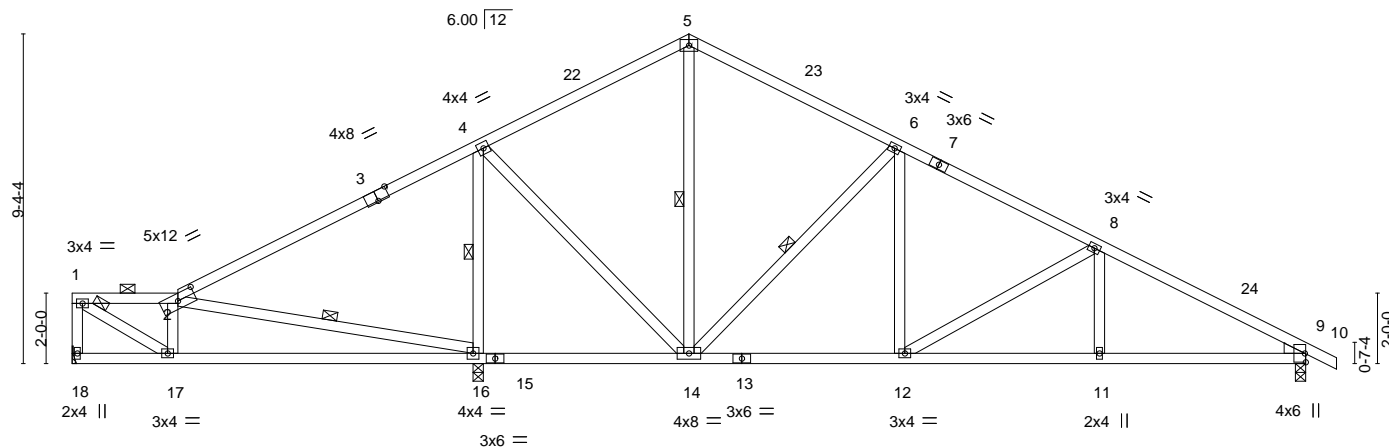

3-0-0	11-6-4	17-6-0	23-4-0	27-1-14	29-1-13	35-0-0
3-0-0	8-6-4	5-11-12	5-10-0	3-9-14	1-11-15	5-10-3

Plate Offsets (X,Y)-- [2:0-6-0,0-2-6], [3:0-4-0,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.76	Vert(LL)	-0.11 16-17	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.45	Vert(CT)	-0.22 16-17	>610	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.36	Horz(CT)	0.03 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 155 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 WEDGE  
 Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2.  
 BOT CHORD Rigid ceiling directly applied.  
 WEBS 1 Row at midpt 5-14, 4-16, 6-14, 2-16

#### REACTIONS.

(size) 18=Mechanical, 9=0-3-8, 16=0-3-8  
 Max Horz 18=-172(LC 17)  
 Max Uplift 18=-59(LC 12), 9=-216(LC 13), 16=-298(LC 12)  
 Max Grav 18=331(LC 25), 9=987(LC 1), 16=1972(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-18=-339/49, 1-2=-487/73, 2-4=-88/618, 4-5=-430/227, 5-6=-416/200, 6-8=-997/269, 8-9=-1479/325  
 BOT CHORD 16-17=-172/501, 14-16=-423/225, 12-14=-37/818, 11-12=-200/1247, 9-11=-200/1247  
 WEBS 4-16=-1648/315, 4-14=-104/1002, 6-12=-41/410, 6-14=-771/269, 8-12=-494/187, 1-17=-105/592, 2-16=-795/231

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-0-0, Interior(1) 3-0-0 to 17-6-0, Exterior(2R) 17-6-0 to 20-6-0, Interior(1) 20-6-0 to 35-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 18 except (jt=lb) 9=216, 16=298.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

 $4 \times 6 =$ 

Scale = 1:70.1

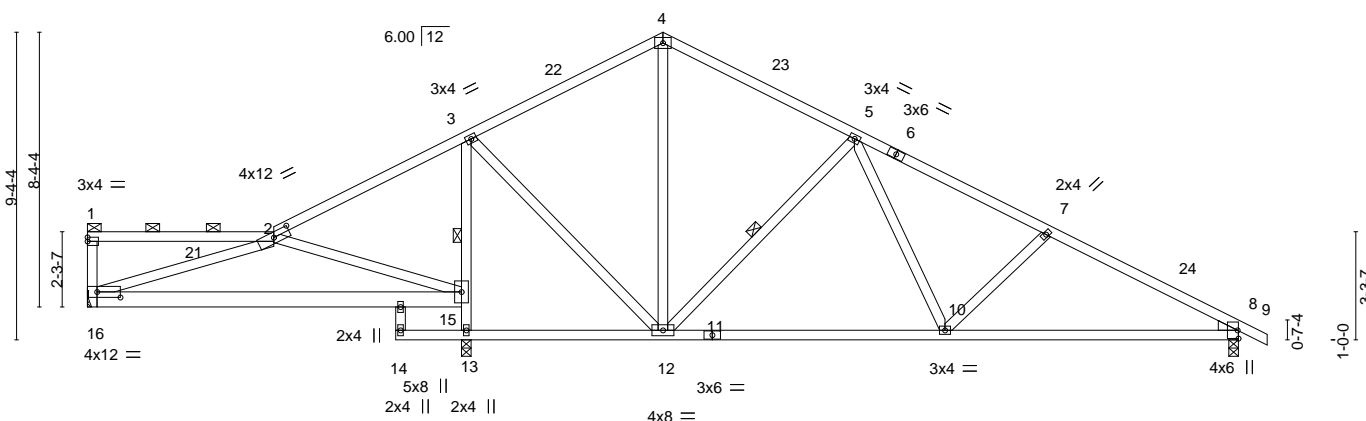

5-8-0	9-4-8	11-6-4	17-6-0	26-0-15	35-0-0
5-8-0	3-8-8	2-1-12	5-11-12	8-6-15	8-11-1

Plate Offsets (X,Y)--		[2:0-6-0,0-1-14], [16:0-8-8,0-2-0]		[2:1-2-0,0-1-14], [16:0-8-8,0-2-0]		[2:1-2-0,0-1-14], [16:0-8-8,0-2-0]		[2:1-2-0,0-1-14], [16:0-8-8,0-2-0]	
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.19 15-16 >725 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.61	Vert(CT)	-0.38 15-16 >364 180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.44	Horz(CT)	-0.03 13 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 159 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2 \*Except\*  
 15-16: 2x6 SPF No.2  
 WEBS 2x4 SPF No.2  
 WEDGE  
 Right: 2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-2.
BOT CHORD	Rigid ceiling directly applied.
WEBS	1 Row at midpt 3-13, 5-12

**REACTIONS.**

(size) 8=0-3-8, 13=0-3-8, 16=Mechanical  
Max Horz 16=-194(LC 13)  
Max Uplift 8=-263(LC 13), 13=-231(LC 12), 16=-133(LC 8)  
Max Grav 8=1090(LC 1), 13=1696(LC 1), 16=467(LC 25)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-56/301, 3-4=-649/325, 4-5=-644/302, 5-7=-1396/406, 7-8=-1669/437  
BOT CHORD 15-16=-224/560, 10-12=-130/981, 8-10=-298/1421  
WEBS 2-15=-643/261, 2-16=-433/360, 13-15=-1602/271, 3-15=-1298/230, 3-12=0/788,  
5-12=-727/279, 5-10=-69/483, 7-10=-354/197

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 17-6-0, Exterior(2R) 17-6-0 to 20-6-0, Interior(1) 20-6-0 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=263, 13=231, 16=133.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.




April 23, 2021



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 3f, 9f, 10f, 11f, 12f, 13f, 14f, 15f, 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

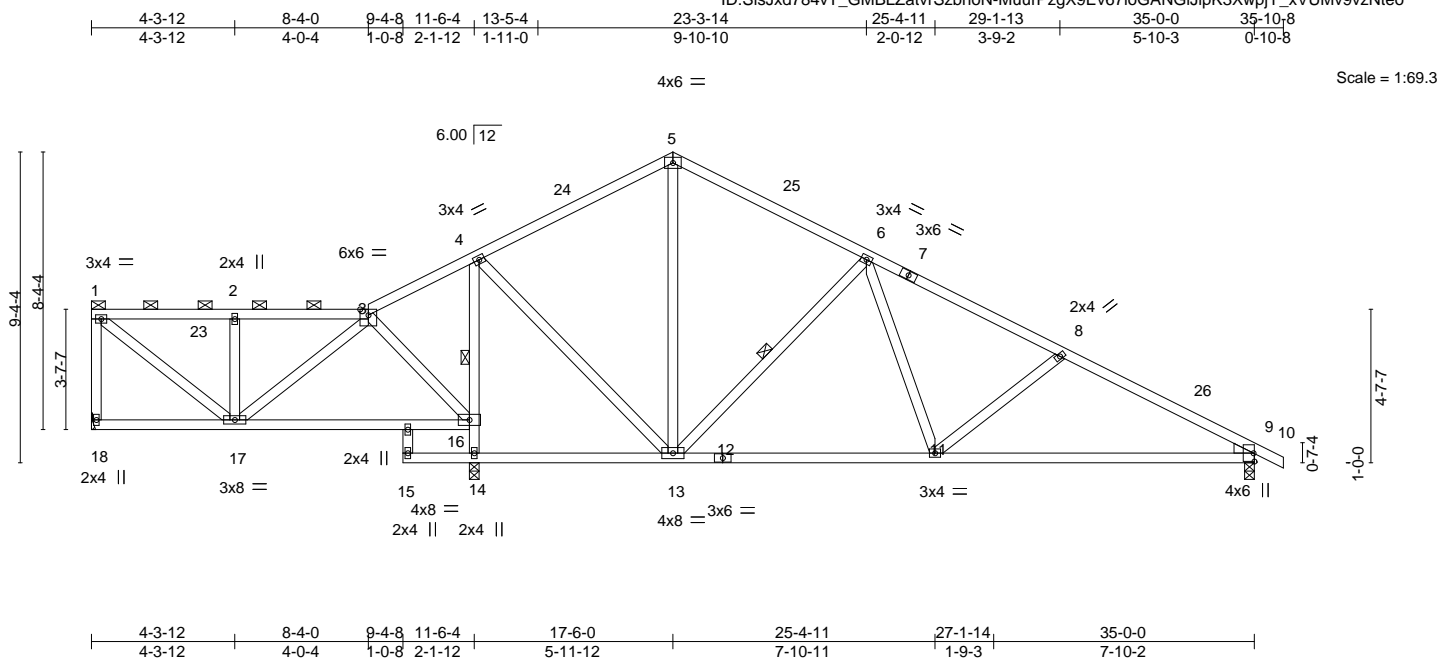

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.36	Vert(LL) -0.13 11-22 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.63	Vert(CT) -0.27 11-22 >999 180		
BCLL 0.0	Rep Stress Incr YES	WB 0.92	Horz(CT) -0.03 14 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 159 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-3.
BOT CHORD	Rigid ceiling directly applied.
WEBS	1 Row at midpt 4-14, 6-13

**REACTIONS.**

(size) 18=Mechanical, 9=0-3-8, 14=0-3-8  
 Max Horz 18=-224(LC 8)  
 Max Uplift 18=-174(LC 8), 9=-265(LC 13), 14=-205(LC 12)  
 Max Grav 18=476(LC 25), 9=1093(LC 1), 14=1685(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-18=454/178, 1-2=425/145, 2-3=427/147, 3-4=51/281, 4-5=649/328, 5-6=650/306,  
6-8=1353/393, 8-9=1668/444

BOT CHORD 11-13=130/993, 9-11=304/1423

WEBS 14-16=1588/246, 4-16=1224/189, 3-16=419/111, 4-13=0/793, 2-17=332/140,  
1-17=204/523, 3-17=0/296, 6-13=738/274, 6-11=54/470, 8-11=378/202

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16;  $V_{ult}=115\text{mph}$  (3-second gust)  $V_{asd}=91\text{mph}$ ;  $TCDL=6.0\text{psf}$ ;  $BCDL=4.2\text{psf}$ ;  $h=25\text{ft}$ ; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 17-6-0, Exterior(2R) 17-6-0 to 20-6-0, Interior(1) 20-6-0 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=174, 9=265, 14=205.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

**WARNING:** Velly design parameters are listed in the following table and included with the key reference to AISC M14-15 167, 171, 172, 173, 174, 175, 176, 177, 178, 179, 180, 181, 182, 183, 184, 185, 186, 187, 188, 189, 190, 191, 192, 193, 194, 195, 196, 197, 198, 199, 200, 201, 202, 203, 204, 205, 206, 207, 208, 209, 210, 211, 212, 213, 214, 215, 216, 217, 218, 219, 220, 221, 222, 223, 224, 225, 226, 227, 228, 229, 230, 231, 232, 233, 234, 235, 236, 237, 238, 239, 240, 241, 242, 243, 244, 245, 246, 247, 248, 249, 250, 251, 252, 253, 254, 255, 256, 257, 258, 259, 260, 261, 262, 263, 264, 265, 266, 267, 268, 269, 270, 271, 272, 273, 274, 275, 276, 277, 278, 279, 280, 281, 282, 283, 284, 285, 286, 287, 288, 289, 290, 291, 292, 293, 294, 295, 296, 297, 298, 299, 300, 301, 302, 303, 304, 305, 306, 307, 308, 309, 310, 311, 312, 313, 314, 315, 316, 317, 318, 319, 320, 321, 322, 323, 324, 325, 326, 327, 328, 329, 330, 331, 332, 333, 334, 335, 336, 337, 338, 339, 340, 341, 342, 343, 344, 345, 346, 347, 348, 349, 350, 351, 352, 353, 354, 355, 356, 357, 358, 359, 360, 361, 362, 363, 364, 365, 366, 367, 368, 369, 370, 371, 372, 373, 374, 375, 376, 377, 378, 379, 380, 381, 382, 383, 384, 385, 386, 387, 388, 389, 390, 391, 392, 393, 394, 395, 396, 397, 398, 399, 400, 401, 402, 403, 404, 405, 406, 407, 408, 409, 410, 411, 412, 413, 414, 415, 416, 417, 418, 419, 420, 421, 422, 423, 424, 425, 426, 427, 428, 429, 430, 431, 432, 433, 434, 435, 436, 437, 438, 439, 440, 441, 442, 443, 444, 445, 446, 447, 448, 449, 450, 451, 452, 453, 454, 455, 456, 457, 458, 459, 460, 461, 462, 463, 464, 465, 466, 467, 468, 469, 470, 471, 472, 473, 474, 475, 476, 477, 478, 479, 480, 481, 482, 483, 484, 485, 486, 487, 488, 489, 490, 491, 492, 493, 494, 495, 496, 497, 498, 499, 500, 501, 502, 503, 504, 505, 506, 507, 508, 509, 510, 511, 512, 513, 514, 515, 516, 517, 518, 519, 520, 521, 522, 523, 524, 525, 526, 527, 528, 529, 530, 531, 532, 533, 534, 535, 536, 537, 538, 539, 540, 541, 542, 543, 544, 545, 546, 547, 548, 549, 550, 551, 552, 553, 554, 555, 556, 557, 558, 559, 560, 561, 562, 563, 564, 565, 566, 567, 568, 569, 570, 571, 572, 573, 574, 575, 576, 577, 578, 579, 580, 581, 582, 583, 584, 585, 586, 587, 588, 589, 590, 591, 592, 593, 594, 595, 596, 597, 598, 599, 600, 601, 602, 603, 604, 605, 606, 607, 608, 609, 610, 611, 612, 613, 614, 615, 616, 617, 618, 619, 620, 621, 622, 623, 624, 625, 626, 627, 628, 629, 630, 631, 632, 633, 634, 635, 636, 637, 638, 639, 640, 641, 642, 643, 644, 645, 646, 647, 648, 649, 650, 651, 652, 653, 654, 655, 656, 657, 658, 659, 660, 661, 662, 663, 664, 665, 666, 667, 668, 669, 670, 671, 672, 673, 674, 675, 676, 677, 678, 679, 680, 681, 682, 683, 684, 685, 686, 687, 688, 689, 690, 691, 692, 693, 694, 695, 696, 697, 698, 699, 700, 701, 702, 703, 704, 705, 706, 707, 708, 709, 710, 711, 712, 713, 714, 715, 716, 717, 718, 719, 720, 721, 722, 723, 724, 725, 726, 727, 728, 729, 730, 731, 732, 733, 734, 735, 736, 737, 738, 739, 740, 741, 742, 743, 744, 745, 746, 747, 748, 749, 750, 751, 752, 753, 754, 755, 756, 757, 758, 759, 760, 761, 762, 763, 764, 765, 766, 767, 768, 769, 770, 771, 772, 773, 774, 775, 776, 777, 778, 779, 780, 781, 782, 783, 784, 785, 786, 787, 788, 789, 790, 791, 792, 793, 794, 795, 796, 797, 798, 799, 800, 801, 802, 803, 804, 805, 806, 807, 808, 809, 810, 811, 812, 813, 814, 815, 816, 817, 818, 819, 820, 821, 822, 823, 824, 825, 826, 827, 828, 829, 830, 831, 832, 833, 834, 835, 836, 837, 838, 839, 840, 841, 842, 843, 844, 845, 846, 847, 848, 849, 850, 851, 852, 853, 854, 855, 856, 857, 858, 859, 860, 861, 862, 863, 864, 865, 866, 867, 868, 869, 870, 871, 872, 873, 874, 875, 876, 877, 878, 879, 880, 881, 882, 883, 884, 885, 886, 887, 888, 889, 890, 891, 892, 893, 894, 895, 896, 897, 898, 899, 900, 901, 902, 903, 904, 905, 906, 907, 908, 909, 910, 911, 912, 913, 914, 915, 916, 917, 918, 919, 920, 921, 922, 923, 924, 925, 926, 927, 928, 929, 930, 931, 932, 933, 934, 935, 936, 937, 938, 939, 940, 941, 942, 943, 944, 945, 946, 947, 948, 949, 950, 951, 952, 953, 954, 955, 956, 957, 958, 959, 960, 961, 962, 963, 964, 965, 966, 967, 968, 969, 970, 971, 972, 973, 974, 975, 976, 977, 978, 979, 980, 981, 98



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804348
2765833	A17	Roof Special	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:45 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-JH0bqfho9pN3yfhOlAOAufhKcaBSYEyOr0DozNtem

4-10-0	5-10-0	9-4-8	11-0-0	17-6-0	23-4-0	29-1-13	35-0-0	35-10-8
4-10-0	1-0-0	3-6-8	1-7-8	6-6-0	5-10-0	5-9-13	5-10-3	0-10-8

Scale = 1:69.3

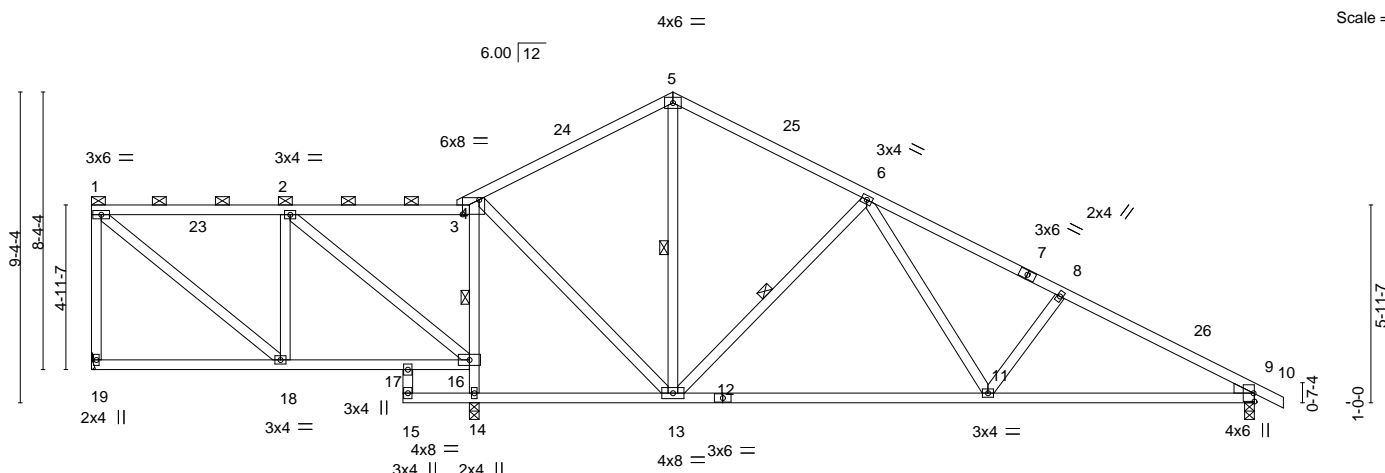


Plate Offsets (X,Y)--	[3:0-6-0,0-5-4]
-----------------------	-----------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.41	Vert(LL)	-0.17 11-13	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.61	Vert(CT)	-0.35 11-13	>798	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.91	Horz(CT)	0.02 14	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 162 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 WEDGE  
 Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 1-4.  
 BOT CHORD Rigid ceiling directly applied.  
 WEBS 1 Row at midpt 5-13, 4-14, 6-13

#### REACTIONS.

(size) 19=Mechanical, 9=0-3-8, 14=0-3-8  
 Max Horz 19=-252(LC 8)  
 Max Uplift 19=-153(LC 8), 9=-242(LC 13), 14=-213(LC 12)  
 Max Grav 19=430(LC 25), 9=1059(LC 1), 14=1750(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-19=-372/166, 1-2=-264/130, 2-3=0/252, 3-4=-12/291, 4-5=-579/277, 5-6=-583/254,  
 6-8=-1409/388, 8-9=-1622/386  
 BOT CHORD 17-18=-24/286, 16-17=-26/374, 11-13=-93/917, 9-11=-255/1377  
 WEBS 14-16=-1631/246, 4-16=-1272/232, 4-13=-37/904, 6-13=-714/286, 6-11=-97/519,  
 8-11=-335/194, 1-18=-159/307, 2-16=-542/52

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 17-6-0, Exterior(2R) 17-6-0 to 20-6-0, Interior(1) 20-6-0 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 19=153, 9=242, 14=213.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804349
2765833	A18	Roof Special	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:47 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-Ff8LFKj2CTPXcN62PDKeTb\_H8GOfMLXP6K6ihzNtek

5-10-0	9-4-8	13-8-0	17-6-0	23-3-14	29-1-13	35-0-0	35-10-8
5-10-0	3-6-8	4-3-8	3-10-0	5-9-14	5-9-14	5-10-3	0-10-8

6.00 | 12 4x6 =

Scale = 1:73.8

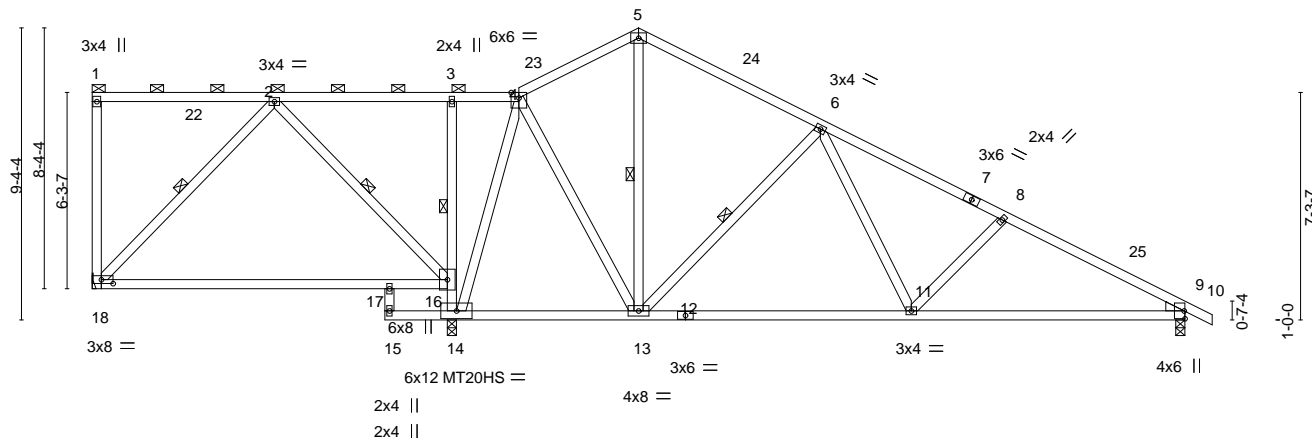


Plate Offsets (X,Y)--	[18:0-4-8,0-1-8]
-----------------------	------------------

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.47	Vert(LL)	-0.29 17-18	>465	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.66	Vert(CT)	-0.57 17-18	>239	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.96	Horz(CT)	0.03 14	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 168 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2  
 WEDGE  
 Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except  
 2-0-0 oc purlins (6-0-0 max.): 1-4.  
 BOT CHORD Rigid ceiling directly applied. Except:  
 6-0-0 oc bracing: 3-14  
 WEBS 1 Row at midpt 2-18, 2-16, 5-13, 6-13

#### REACTIONS.

(size) 14=0-3-8, 9=0-3-8, 18=Mechanical  
 Max Horz 18=300(LC 8)  
 Max Uplift 14=92(LC 12), 9=281(LC 13), 18=266(LC 8)  
 Max Grav 14=1872(LC 1), 9=1019(LC 1), 18=355(LC 25)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=0/406, 3-4=0/418, 4-5=447/366, 5-6=493/341, 6-8=1264/445, 8-9=1529/470  
 BOT CHORD 14-16=716/99, 3-16=305/139, 11-13=164/848, 9-11=328/1297  
 WEBS 2-18=131/351, 2-16=547/0, 6-13=728/278, 6-11=69/502, 8-11=357/195,  
 4-14=1031/120, 4-13=0/753

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 17-6-0, Exterior(2R) 17-6-0 to 20-6-0, Interior(1) 20-6-0 to 35-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14 except (jt=lb) 9=281, 18=266.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804350
2765833	A19	Common	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:48 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-jshkTkgzmXOEWhEywst0oWAsYdbOpmgem4gq7zNtej

5-9-5	11-6-4	17-6-0	23-3-14	29-1-13	35-0-0	35-10-8
5-9-5	5-8-15	5-11-12	5-9-14	5-9-14	5-10-3	0-10-8

4x6 =

Scale = 1:63.2

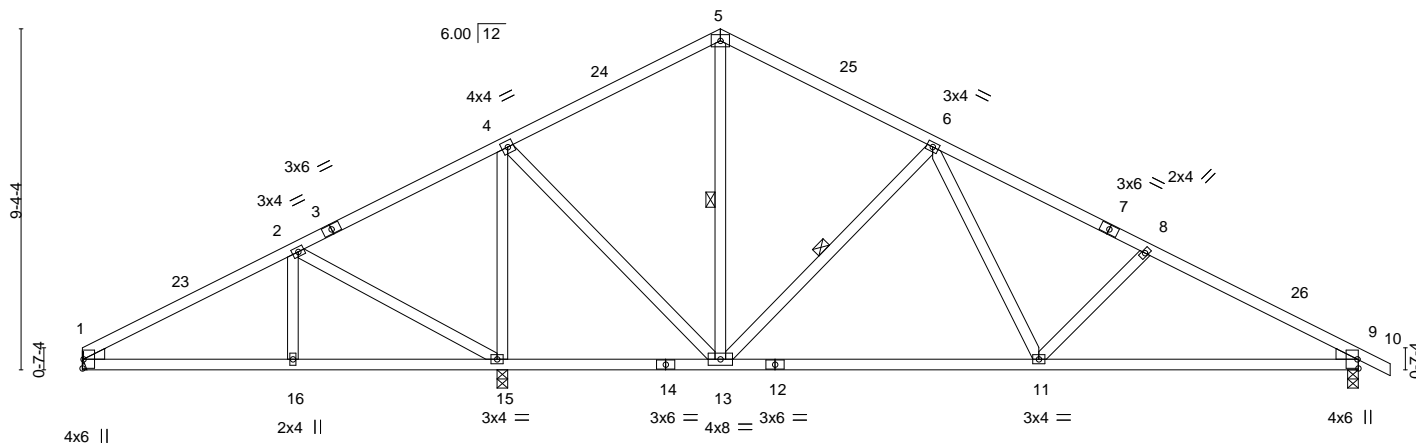

5-9-5	11-6-4	17-6-0	26-2-13	35-0-0
5-9-5	5-8-15	5-11-12	8-8-13	8-9-3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.42	Vert(LL)	-0.11 11-13	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.59	Vert(CT)	-0.24 11-13	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.95	Horz(CT)	0.03 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 145 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEBS 2x4 SPF No.2

WEDGE

Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD

Structural wood sheathing directly applied.

BOT CHORD

Rigid ceiling directly applied.

WEBS

1 Row at midpt 5-13, 6-13

#### REACTIONS.

(size) 1=Mechanical, 15=0-3-8, 9=0-3-8

Max Horz 1=170(LC 13)

Max Uplift 1=67(LC 12), 15=287(LC 12), 9=217(LC 13)

Max Grav 1=407(LC 25), 15=1869(LC 1), 9=1022(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-462/97, 2-4=-33/461, 4-5=-500/224, 5-6=-498/209, 6-8=-1269/315, 8-9=-1534/342

BOT CHORD 1-16=-139/354, 15-16=-139/354, 13-15=-332/223, 11-13=-44/851, 9-11=-215/1302

WEBS 2-15=-611/210, 4-15=-1469/248, 4-13=-102/982, 6-13=-728/282, 6-11=-79/493,

8-11=-357/201

#### NOTES-

1) Unbalanced roof live loads have been considered for this design.

2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 17-6-0, Exterior(2R) 17-6-0 to 20-6-0, Interior(1) 20-6-0 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

4) Refer to girder(s) for truss to truss connections.

5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 15=287, 9=217.

6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804351
2765833	A20	HIP	2	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:50 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzboN-fEpUtlMlwVOn6Tqrd4LuM5DcOpLE0sjLz64Zmv?zNteh

3-11-0	6-11-0	9-5-8	16-2-0	18-10-0	24-2-9	29-7-2	35-0-0	35-10-8
3-11-0	3-0-0	2-6-8	6-8-8	2-8-0	5-4-9	5-4-9	5-4-14	0-10-8

Scale: 3/16"=1'

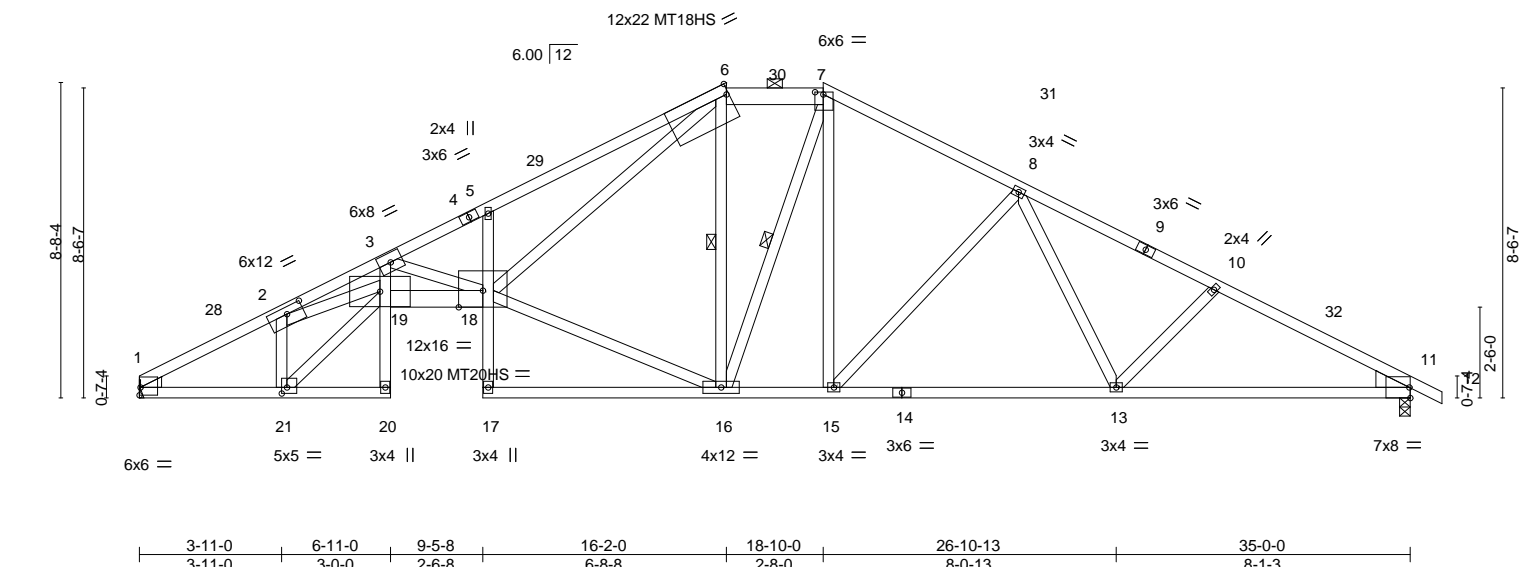

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.90	Vert(LL)	-0.51	18	>817	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.92	Vert(CT)	-0.92	18	>457	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.94	Horz(CT)	0.52	11	n/a	n/a	MT18HS	197/144
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						Weight: 181 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
4-6: 2x4 SP 2400F 2.0E, 6-7: 2x6 SPF No.2, 1-4: 2x4 SPF 1650F 1.5E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
1-20: 2x4 SPF 1650F 1.5E, 18-19: 2x6 SPF 2100F 1.8E  
WEBS 2x4 SPF No.2 \*Except\*  
2-19: 2x4 SPF 1650F 1.5E

WEDGE  
Left: 2x4 SPF No.2 , Right: 2x6 SPF No.2

REACTIONS. (size) 1=Mechanical, 11=0-3-8  
Max Horz 1=156(LC 13)  
Max Uplift 1=263(LC 12), 11=283(LC 13)  
Max Grav 1=1574(LC 1), 11=1637(LC 1)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2743/460, 2-3=-8218/1483, 3-5=-4903/856, 5-6=-4937/993, 6-7=-1674/405,  
7-8=-1958/412, 8-10=-2571/455, 10-11=-2791/477  
BOT CHORD 1-21=-490/2377, 3-19=-476/2561, 18-19=-1326/7313, 5-18=-393/230, 15-16=-137/1667,  
13-15=-242/2086, 11-13=-338/2409  
WEBS 3-18=-3125/622, 16-18=-175/1683, 6-18=-764/3554, 6-16=-630/217, 7-15=-139/575,  
8-15=-619/251, 8-13=-61/393, 10-13=-272/176, 2-21=-2010/445, 19-21=-586/2816,  
2-19=-876/5049

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-6-0, Interior(1) 3-6-0 to 16-2-0, Exterior(2E) 16-2-0 to 18-10-0, Exterior(2R) 18-10-0 to 23-9-6, Interior(1) 23-9-6 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Refer to girder(s) for truss to truss connections.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=263, 11=283.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804352
2765833	A21	HIP	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:51 2021 Page 1

ID:SlSJxd784vT\_GMBLZatvrSzbhoN-7RNs5imZGhvz5\_Qpe3PbdR8YzIb4bF87KkIKRSzNteg

6-9-3	13-6-0	17-6-0	21-6-0	28-2-13	35-0-0	35-10-8
6-9-3	6-8-13	4-0-0	4-0-0	6-8-13	6-9-3	0-10-8

Scale = 1:60.4

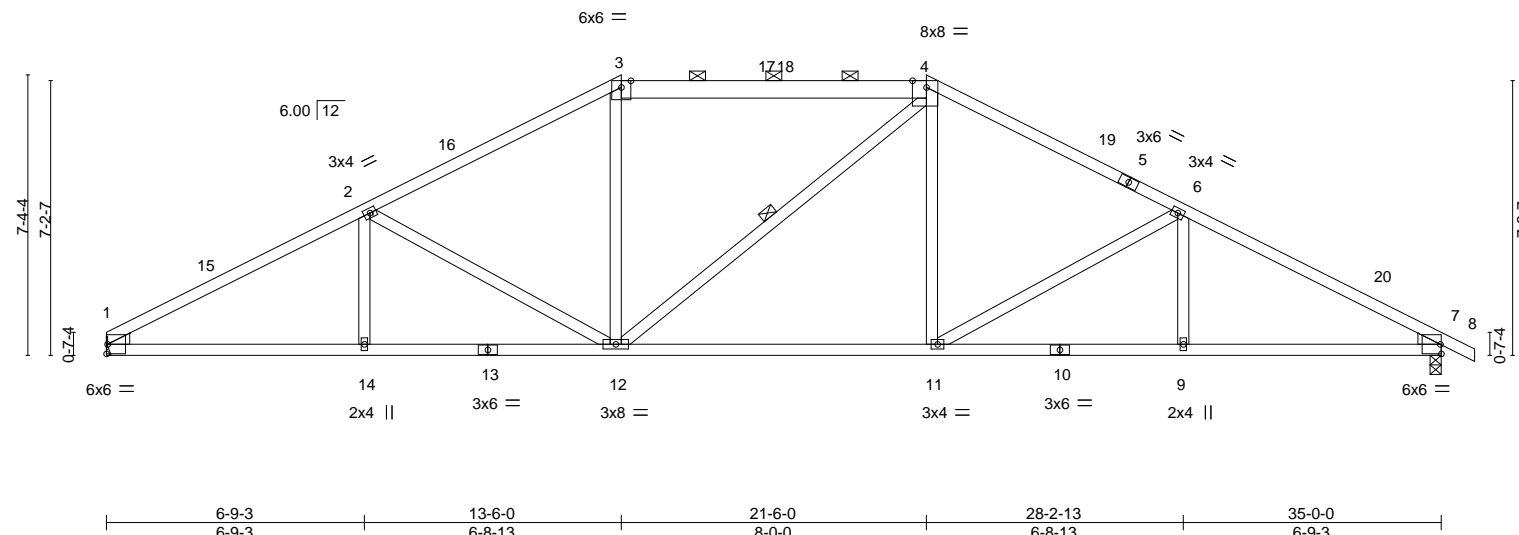


Plate Offsets (X,Y)-- [4:0-4-6,Edge]		LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
		TCLL 25.0		Plate Grip DOL 1.15		TC 0.96		Vert(LL) -0.15 11-12 >999 240		MT20		197/144	
		TCDL 10.0		Lumber DOL 1.15		BC 0.86		Vert(CT) -0.35 11-12 >999 180					
		BCLL 0.0		Rep Stress Incr YES		WB 0.59		Horz(CT) 0.13 7 n/a n/a					
		BCDL 10.0		Code IRC2018/TPI2014		Matrix-S				Weight: 143 lb		FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
3-4: 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (4-4-3 max.): 3-4.  
BOT CHORD Rigid ceiling directly applied or 8-8-9 oc bracing.  
WEBS 1 Row at midpt 4-12

#### REACTIONS.

(size) 1=Mechanical, 7=0-3-8  
Max Horz 1=-127(LC 17)  
Max Uplift 1=-268(LC 12), 7=-287(LC 13)  
Max Grav 1=1565(LC 1), 7=1638(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2818/475, 2-3=-2228/418, 3-4=-1895/414, 4-6=-2221/415, 6-7=-2811/460  
BOT CHORD 1-14=-453/2408, 12-14=-453/2408, 11-12=-176/1888, 9-11=-313/2371, 7-9=-313/2371  
WEBS 2-14=0/278, 2-12=-594/245, 3-12=-42/479, 4-11=-51/474, 6-11=-562/239, 6-9=0/274

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-12 to 3-0-12, Interior(1) 3-0-12 to 13-6-0, Exterior(2R) 13-6-0 to 17-8-15, Interior(1) 17-8-15 to 21-6-0, Exterior(2R) 21-6-0 to 25-8-15, Interior(1) 25-8-15 to 35-10-8 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=268, 7=287.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804353
2765833	A22	Hip	2	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:53 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvrsZbhoN-4pVdWOopoJ9hKIZBITR3jsE\_6ZGq3EvQo1nRVKzNtee

7-3-6	10-10-0	17-6-0	24-2-0	27-8-10	35-0-0	35-10-8
7-3-6	3-6-10	6-8-0	6-8-0	3-6-10	7-3-6	0-10-8

Scale = 1:60.4

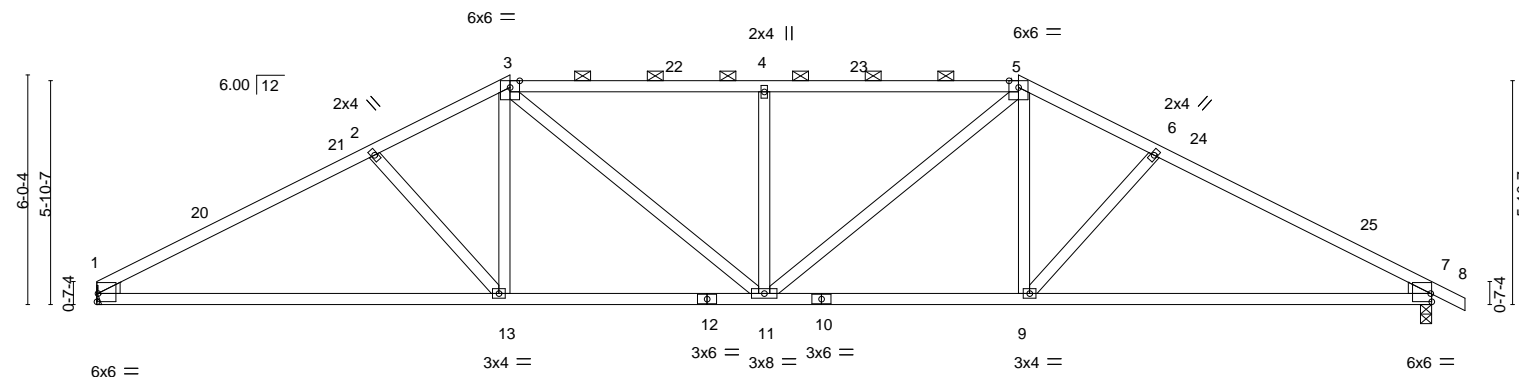

10-10-0	17-6-0	24-2-0	35-0-0
10-10-0	6-8-0	6-8-0	10-10-0

Plate Offsets (X,Y)-- [1:Edge,0-2-9], [7:Edge,0-2-9]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.64	Vert(LL)	-0.22 13-16	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.85	Vert(CT)	-0.48 13-16	>872	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.31	Horz(CT)	0.12 7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 134 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except
BOT CHORD 2x4 SPF No.2	2-0-0 oc purlins (2-11-1 max.): 3-5.
WEBS 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEDGE	
Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2	

**REACTIONS.** (size) 1=Mechanical, 7=0-3-8  
Max Horz 1=-108(LC 13)  
Max Uplift 1=-272(LC 12), 7=-292(LC 13)  
Max Grav 1=1574(LC 1), 7=1637(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-2711/481, 2-3=-2431/450, 3-4=-2534/485, 4-5=-2534/485, 5-6=-2427/449,  
6-7=-2707/479  
BOT CHORD 1-13=-418/2325, 11-13=-295/2131, 9-11=-218/2128, 7-9=-316/2319  
WEBS 2-13=-287/182, 3-13=-63/431, 3-11=-183/655, 4-11=-567/223, 5-11=-183/657,  
5-9=-62/430, 6-9=-282/181

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 10-10-0, Exterior(2R) 10-10-0 to 15-0-15, Interior(1) 15-0-15 to 24-2-0, Exterior(2R) 24-2-0 to 28-4-15, Interior(1) 28-4-15 to 35-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Refer to girder(s) for truss to truss connections.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=272, 7=292.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:55 2021 Page 1  
 ID:SlSjxd784vT\_GMBLZatvrSzbhoN-0CcNx4p3KwPPZbjatuUxohJfAM0yX46iFLGXaDzNtec  
 -0-10-8 3-7-15 4-1-3 8-2-0 12-9-2 17-6-0 22-2-14 26-10-0 30-10-13 35-0-0 35-10-8  
 0-10-8 3-7-15 0-5-4 4-0-13 4-7-2 4-8-14 4-8-14 4-7-2 4-0-13 4-1-3 0-10-8  
 Scale = 1:62

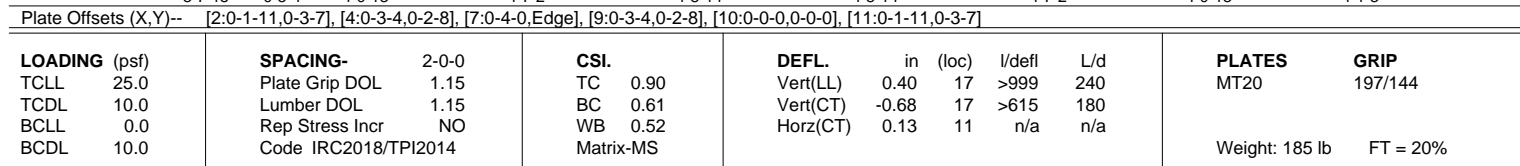

**LUMBER-**  
TOP CHORD 2x4 SPF 1650F 1.5E  
BOT CHORD 2x6 SP 2400F 2.0E \*E  
15-19: 2x6 SPF 2100F  
WEBS 2x4 SPF No.2  
WEDGE  
Left: 2x6 SP No.2 . Right: 2x6 SP No.2

**REACTIONS.** (size) 2=0-3-8, 11=0-3-8  
 Max Horz 2=-78(LC 34)  
 Max Uplift 2=-1067(LC 8), 11=-1067(LC 9)  
 Max Grav 2=3132(LC 1), 11=3132(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 2-3=-5656/1960, 3-4=-5364/1939, 4-5=-6056/2275, 5-6=-6493/2396, 6-8=-6493/2396, 8-9=-6056/2275, 9-10=-5364/1939, 10-11=-5656/1961

**BOT CHORD** 2-21=-1764/4995, 20-21=-1764/4995, 18-20=-1671/4748, 17-18=-2174/6054, 16-17=-2133/6054, 14-16=-1592/4748, 13-14=-1687/4995, 11-13=-1687/4995

**WEBS** 3-20=-253/190, 4-20=-216/779, 4-18=-792/1859, 5-18=-1030/497, 5-17=-293/654, 6-17=-505/273, 8-17=-294/654, 8-16=-1030/497, 9-16=-792/1859, 9-14=-215/779, 10-14=-253/191

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=1067, 11=1067.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 8) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 20-0-0 oc max. starting at 3-6-0 from the left end to 31-6-0 to connect truss(es) to front face of bottom chord.
- 9) Fill all nail holes where hanger is in contact with lumber.
- 10) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard  
Continued on page 2

April 23, 2021

**WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPH Quality Criteria, DSB-89 and BCSI Building Components**.

**Safety Information** - available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601.

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage
2765833	A23	Hip Girder	2	1	I45804354
Job Reference (optional)					

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:56 2021 Page 2  
ID:SlSjxd784vT\_GMBLZatvrSzbhoN-UOAI8Pqh5EXFBllmQc?mKUsQKmMBGXMsU?056fzNteb

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-70, 4-9=-70, 9-12=-70, 22-25=-20

Concentrated Loads (lb)

Vert: 17=-79(F) 6=-79(F) 13=-316(F) 21=-316(F) 28=-79(F) 29=-79(F) 30=-79(F) 31=-79(F) 32=-79(F) 33=-79(F) 34=-79(F) 35=-79(F) 36=-233(F) 37=-233(F) 38=-79(F) 39=-79(F) 40=-79(F) 41=-79(F) 42=-79(F) 43=-79(F) 44=-79(F) 45=-79(F) 46=-233(F) 47=-233(F)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**  
**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804355
2765833	A24	Common	1	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:57 2021 Page 1


ID:SlSjxd784vT\_GMBLZatvSzbbhoN-yak7LrJsXg6pvtz\_JW?tiOgrAko?VT?jfile5zNtea

Job Reference (optional)

5-10-2	6-7-13	12-4-12	13-0-3	19-4-8	25-10-6	26-4-4	32-4-5	32-10-14	38-10-8	39-9-0
5-10-2	0-9-11	5-8-15	0-7-7	6-4-5	6-5-14	0-5-14	6-0-1	0-6-9	5-11-10	0-10-8

7x8 ||

Scale = 1:70.0

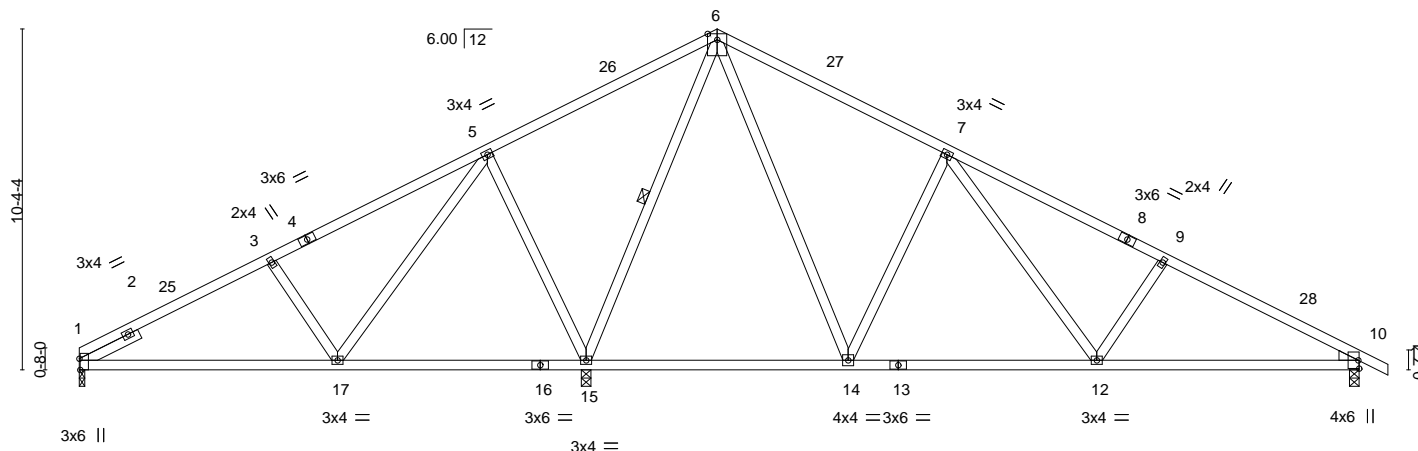

7-10-2	15-4-12	23-2-9	23-4-4	30-10-14	31-0-6	38-10-8
7-10-2	7-6-10	7-9-13	0-1-11	7-6-10	0-1-8	7-10-2

Plate Offsets (X,Y)-- [1:0-4-1,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.53	Vert(LL)	-0.06 14-15	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.46	Vert(CT)	-0.14 12-24	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.79	Horz(CT)	0.02 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 164 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 -t 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 6-15

#### REACTIONS.

(size) 1=0-2-0, 15=0-3-8, 10=0-3-8  
Max Horz 1=-189(LC 13)  
Max Uplift 1=-84(LC 12), 15=-337(LC 12), 10=-213(LC 13)  
Max Grav 1=528(LC 25), 15=2176(LC 1), 10=970(LC 26)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-601/114, 3-5=-462/128, 5-6=0/661, 6-7=-561/273, 7-9=-1228/344, 9-10=-1433/331  
BOT CHORD 1-17=-193/537, 15-17=-261/245, 12-14=-15/699, 10-12=-205/1211  
WEBS 6-15=-1445/221, 6-14=-247/887, 7-14=-735/325, 5-15=-751/330, 5-17=-150/611,  
7-12=-137/560, 3-17=-403/214, 9-12=-371/207

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 19-4-8, Exterior(2R) 19-4-8 to 22-4-8, Interior(1) 22-4-8 to 39-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 1.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1 except (jt=lb) 15=337, 10=213.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804356
2765833	A25	Roof Special	2	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:16:58 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvrSzbhoN-QnlWZ5rydrozQ3S9Y11EQvxmyayHkMM9xJVCBzNteZ


2-2-0	7-8-8	13-3-0	15-4-12	19-4-8	25-10-6	32-4-5	38-10-8	39-9-0
2-2-0	5-6-8	5-6-8	2-1-12	3-11-12	6-5-14	6-5-14	6-6-3	0-10-8

Scale = 1:80.5

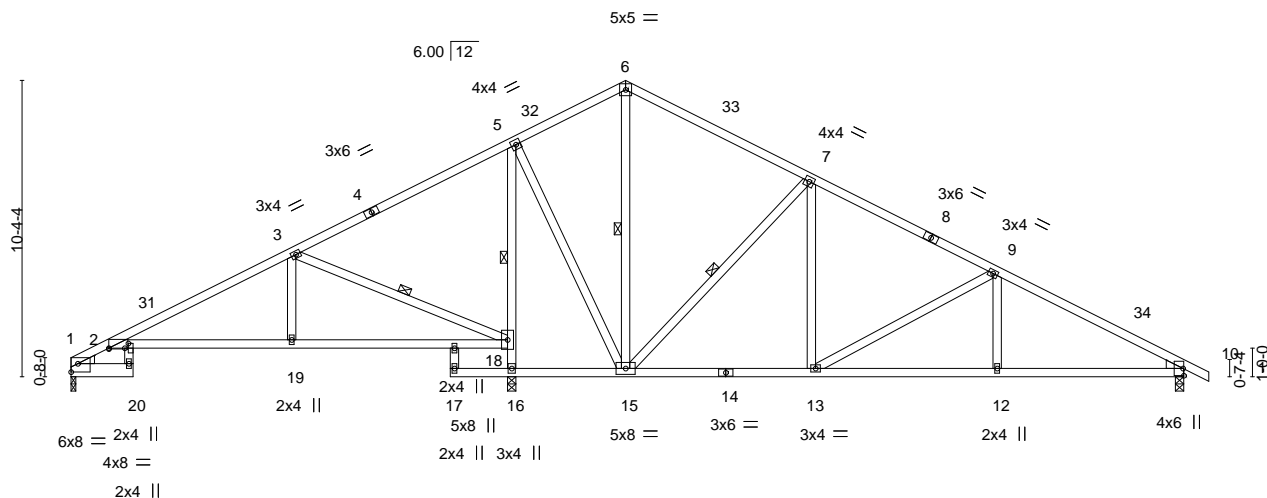



Scale = 1:79.9

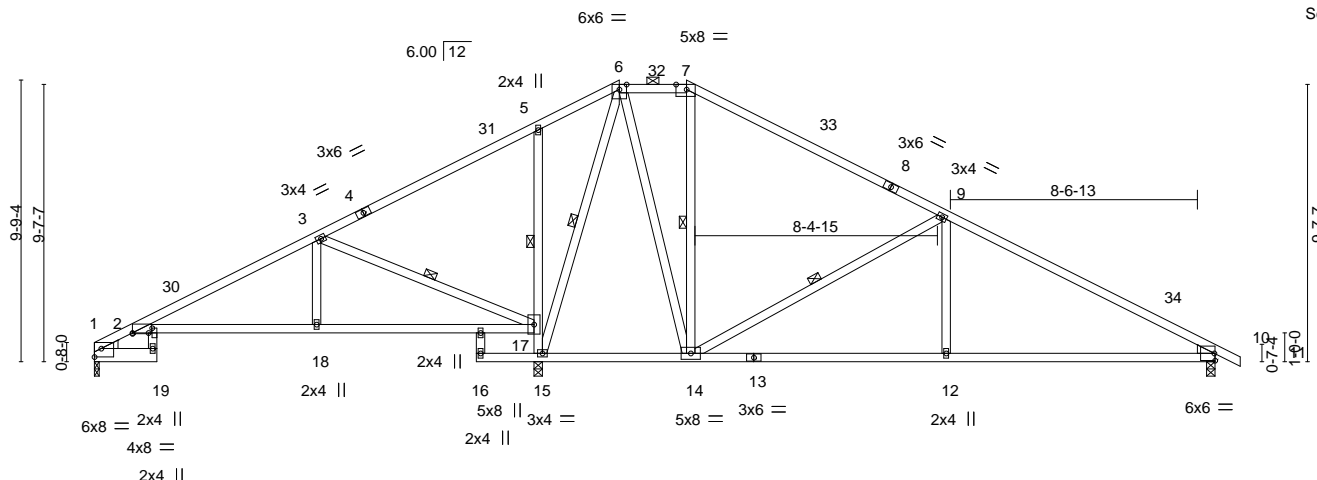

2-2-0	7-8-8	13-3-0	15-4-12	18-2-8	20-6-8	29-8-5	38-10-8
2-2-0	5-6-8	5-6-8	2-1-12	2-9-12	2-4-0	9-1-13	9-2-3

Plate Offsets (X,Y)-- [1:Edge,0-3-8], [2:0-0-0,0-0-5], [2:0-2-0,0-1-8], [7:0-4-6,Edge]													
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.90	Vert(LL)	0.28	19	>662	240	MT20	197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.97	Vert(CT)	-0.48	19	>387	180			
BCLL	0.0	Rep Stress Incr	YES	WB	0.74	Horz(CT)	0.06	15	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 172 lb	FT = 20%	

**LUMBER-**

TOP CHORD 2x4 SPF No.2 \*Except\*  
1-4: 2x4 SPF 1650F 1.5E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
1-19: 2x6 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE  
Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied, except 2-0-0 oc purlins (6-0-0 max.): 6-7.
BOT CHORD	Rigid ceiling directly applied.
WEBS	1 Row at midpt 3-17, 7-14, 5-15, 6-15, 9-14

**REACTIONS.**

(size) 1=0-2-0, 10=0-3-8, 15=0-3-8  
 Max Horz 1=177(LC 13)  
 Max Uplift 1=128(LC 13), 10=297(LC 13), 15=300(LC 12)  
 Max Grav 1=552(LC 25), 10=1058(LC 26), 15=2063(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-748/298, 3-5=-44/549, 5-6=-46/449, 6-7=-378/377, 7-9=-574/351, 9-10=-1493/468  
BOT CHORD 2-18=-206/655, 17-18=-206/655, 12-14=-290/1230, 10-12=-290/1230  
WEBS 3-18=0/393, 3-17=-1038/347, 7-14=-333/88, 15-17=-938/358, 5-17=-489/256,  
6-15=-1081/0, 6-14=-167/985, 9-14=-988/344, 9-12=0/387

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 18-2-8, Exterior(2E) 18-2-8 to 20-6-8, Exterior(2R) 20-6-8 to 24-9-7, Interior(1) 24-9-7 to 39-9-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 1.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=128, 10=297, 15=300.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 3f, 9f, 10f, 11f, 12f, 13f, 14f, 15f, 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804358
2765833	A27	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:03 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-nk5Pcpv4RNQGXqK6LadP7zedyaiPPapu5bCzslzNteU

2-2-0	8-8-8	13-3-0	15-6-8	19-6-8	21-4-8	27-2-6	29-2-5	33-0-5	38-10-8	39-9-0
2-2-0	6-6-8	4-6-8	2-3-8	4-0-0	1-10-0	5-9-14	1-11-15	3-9-15	5-10-3	0-10-8

Scale = 1:74.0

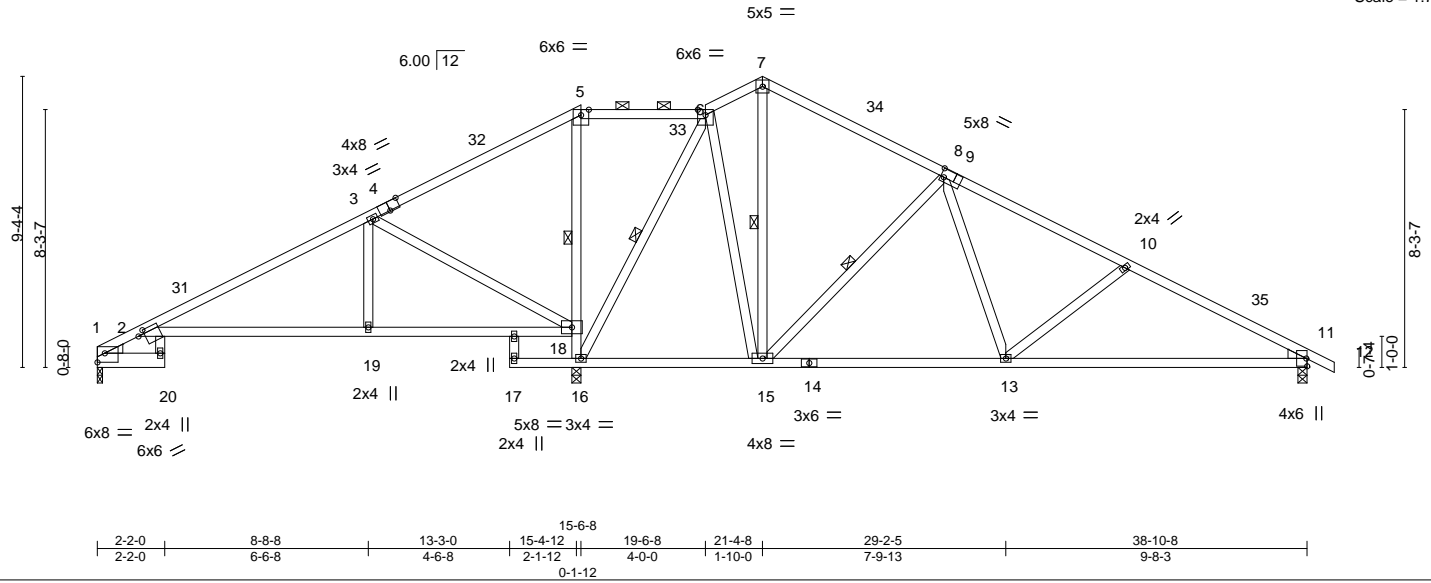


Plate Offsets (X,Y)--		[1:Edge,0-3-8], [2:0-2-7,0-1-8], [4:0-4-0,Edge], [9:0-1-4,0-3-4]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.87	Vert(LL)	0.33 19-27	>567	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.83	Vert(CT)	-0.58 19-27	>318	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.99	Horz(CT)	0.07 11	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 175 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
1-4: 2x4 SPF 1650F 1.5E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
1-20: 2x6 SPF No.2, 2-18: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2  
WEDGE  
Left: 2x4 SPF No.2, Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (10-0-0 max.): 5-6.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 5-16, 7-15, 8-15, 6-16

#### REACTIONS.

(size) 1=0-2-0, 16=0-3-8, 11=0-3-8  
Max Horz 1=171(LC 13)  
Max Uplift 1=118(LC 13), 16=332(LC 12), 11=285(LC 13)  
Max Grav 1=536(LC 25), 16=2103(LC 1), 11=1016(LC 26)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-584/276, 3-5=-41/581, 5-6=0/429, 6-7=-367/376, 7-8=-481/350, 8-10=-1188/433,  
10-11=-1509/485  
BOT CHORD 2-19=-154/491, 18-19=-154/491, 13-15=-168/849, 11-13=-340/1283  
WEBS 3-19=0/381, 3-18=-976/327, 16-18=-1060/294, 5-18=-556/165, 8-15=-742/271,  
8-13=-51/476, 10-13=-385/200, 6-15=0/660, 6-16=-1064/146

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 15-6-8, Exterior(2R) 15-6-8 to 18-6-8, Interior(1) 18-6-8 to 21-4-8, Exterior(2R) 21-4-8 to 24-4-8, Interior(1) 24-4-8 to 39-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 1.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=118, 16=332, 11=285.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804359
2765833	A28	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:05 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvSzboN-j7D91UxLz?g\_m8UUVS?ftCOj\_\_OPntVCBYvh3xezNteS

6-7-0	12-10-8	15-4-12	16-10-8	21-4-8	27-2-6	29-6-4	33-0-5	38-10-8	39-9-0
6-7-0	6-3-8	2-6-4	1-5-12	4-6-0	5-9-14	2-3-14	3-6-1	5-10-3	0-10-8

Scale = 1:68.1

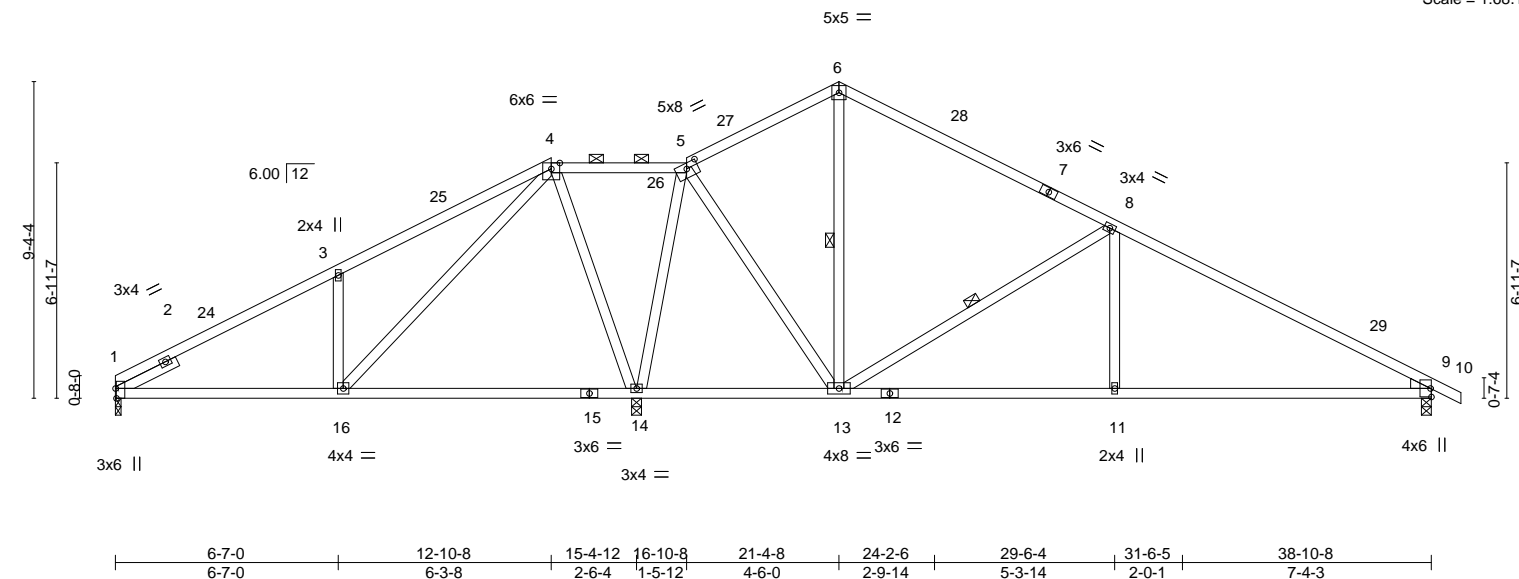


Plate Offsets (X,Y)-- [1:0-3-8,Edge], [5:0-4-0,0-1-14]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.77	Vert(LL)	0.13 11-23 >999	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.65	Vert(CT)	-0.29 11-23 >975	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.93	Horz(CT)	0.01 1 n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 162 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 WEDGE  
 Right: 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 -t 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except  
 2-0-0 oc purlins (10-0-0 max.): 4-5.  
 BOT CHORD Rigid ceiling directly applied.  
 WEBS 1 Row at midpt 6-13, 8-13

#### REACTIONS.

(size) 1=0-2-0, 9=0-3-8, 14=0-3-8  
 Max Horz 1=-171(LC 13)  
 Max Uplift 1=-122(LC 12), 9=-239(LC 13), 14=-309(LC 12)  
 Max Grav 1=560(LC 25), 9=1001(LC 1), 14=2044(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-659/169, 3-4=-755/322, 4-5=0/400, 5-6=-419/275, 6-8=-502/240, 8-9=-1365/347  
 BOT CHORD 1-16=-216/583, 11-13=-180/1114, 9-11=-180/1114  
 WEBS 3-16=-475/270, 5-14=-1152/216, 4-14=-817/236, 4-16=-291/899, 5-13=-39/846,  
 8-13=-939/334, 8-11=0/377

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 12-10-8, Exterior(2R) 12-10-8 to 15-10-8, Interior(1) 15-10-8 to 21-4-8, Exterior(2R) 21-4-8 to 24-4-8, Interior(1) 24-4-8 to 39-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate at joint(s) 1.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=122, 9=239, 14=309.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804360
2765833	B1	GABLE	2	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:17 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-NRyYb4s8hBHC\_Pp9WthhwD9CEVyh45yJmbiMxzNteG

0-10-8 5-6-4 10-9-0 15-2-12 15-11-12 20-0-0 20-10-8  
0-10-8 5-6-4 5-2-12 4-5-12 0-9-0 4-0-4 0-10-8

4x6 =

Scale = 1:49.7

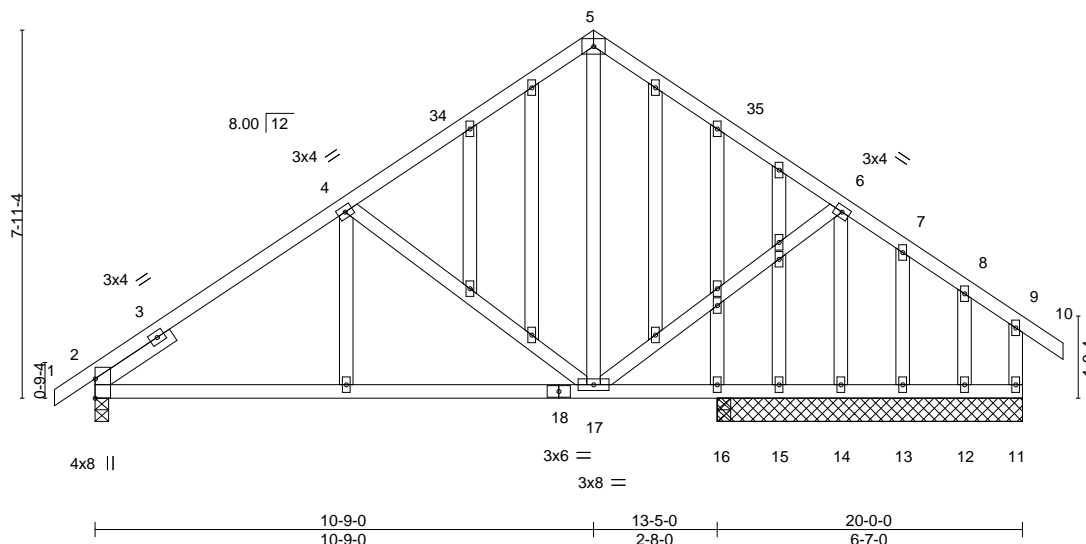


Plate Offsets (X,Y)--	[2:Edge,0-0-0]								
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.31	Vert(LL)	-0.22 17-32	>732	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.69	Vert(CT)	-0.45 17-32	>361	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.30	Horz(CT)	0.03 2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 122 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 - t 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

All bearings 6-7-0 except (jt=length) 2=0-3-8, 16=0-3-8, 16=0-3-8.  
(lb) - Max Horz 2=231(LC 11)  
Max Uplift All uplift 100 lb or less at joint(s) 11, 13, 12, 16 except 2=140(LC 12), 14=131(LC 13), 16=155(LC 3)  
Max Grav All reactions 250 lb or less at joint(s) 11, 15, 13, 12 except 2=780(LC 1), 14=891(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-915/185, 4-5=-549/170, 5-6=-545/168  
BOT CHORD 2-17=-168/708  
WEBS 4-17=-385/230, 5-17=-48/299, 6-17=-20/489, 6-14=-871/142

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 10-9-0, Exterior(2R) 10-9-0 to 13-9-0, Interior(1) 13-9-0 to 20-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 13, 12 except (jt=lb) 2=140, 14=131, 16=155.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804361
2765833	B2	ROOF SPECIAL GIRDER	2	2	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:19 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzboN-Jp3SzH67glR?SHZBHxv9mLIPm1CG9w7Fm44pQqzNteE

2-3-8	6-0-10	10-9-0	11-4-8	13-2-15	16-0-2	20-0-0	20-10-8
2-3-8	3-9-2	4-8-6	0-7-8	1-10-7	2-9-3	3-11-14	0-10-8

Scale = 1:51.0

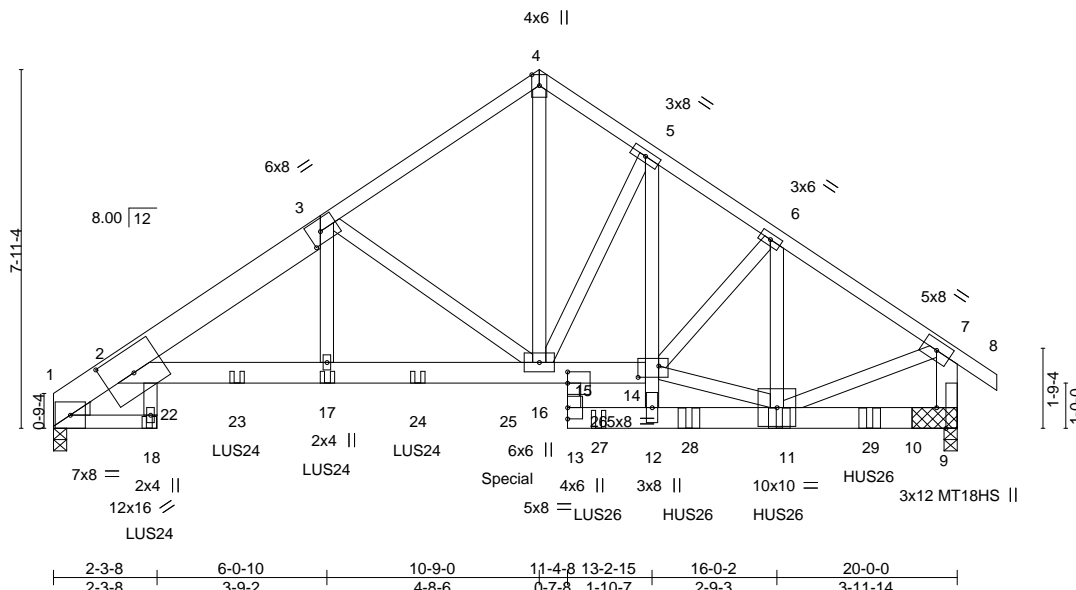


Plate Offsets (X,Y)-- [2:0-8-0,0-6-5], [3:0-3-4,0-3-0], [9:0-5-8,Edge], [14:0-5-8,0-3-0], [15:0-3-0,0-0-0]													
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.69	Vert(LL)	-0.14	2-17	>999	240	MT20	197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.63	Vert(CT)	-0.23	2-17	>999	180	MT18HS	197/144	
BCLL	0.0	Rep Stress Incr	NO	WB	0.52	Horz(CT)	0.19	9	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MS							Weight: 270 lb	FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
1-3: 2x8 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
2-14: 2x6 SPF 2100F 1.8E, 9-13: 2x6 SPF No.2  
WEBS 2x4 SPF No.2 \*Except\*  
7-9: 2x6 SPF No.2  
WEDGE  
Left: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-4-7 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 1-18.

#### REACTIONS.

(size) 9=(0-3-8 + bearing block) (req. 0-4-6), 1=0-3-8  
Max Horz 1=222(LC 7)  
Max Uplift 9=1169(LC 9), 1=844(LC 8)  
Max Grav 9=5575(LC 1), 1=3225(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-20=-1767/532, 2-3=-5555/1550, 3-4=-3917/1065, 4-5=-3826/1091, 5-6=-4948/1211,  
6-7=-5216/1134, 7-9=-4751/1037  
BOT CHORD 2-18=-149/623, 2-17=-1390/4896, 16-17=-1413/4961, 15-16=-879/4089, 14-15=-728/3326,  
12-13=-157/764, 11-12=-169/818, 9-11=-95/372  
WEBS 4-16=-1101/3963, 3-16=-2172/807, 12-14=-110/834, 5-14=-362/2284, 5-16=-2056/396,  
6-11=-280/292, 7-11=-869/4230, 11-14=-747/3640, 6-14=-337/97, 3-17=-434/1307

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x8 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-7-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-6-0 oc, 2x6 - 2 rows staggered at 0-5-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- 2x6 SPF No.2 bearing block 12" long at jt. 9 attached to each face with 3 rows of 10d (0.131"x3") nails spaced 3" o.c. 12 Total fasteners per block. Bearing is assumed to be SPF No.2.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 9=1169, 1=844.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and Conference signed and ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804361
2765833	B2	ROOF SPECIAL GIRDER	2	<b>2</b>	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:20 2021 Page 2

ID:SlSjxd784vT\_GMBLZatvrszboN-n0dqAd6lRcZs3R7OqeQOJYraWRYVuNNO?kqMyGzNteD

**NOTES-**

- 10) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 2-1-12 from the left end to 8-0-12 to connect truss(es) to back face of bottom chord.
- 11) Use Simpson Strong-Tie LUS26 (4-10d Girder, 3-10d Truss, Single Ply Girder) or equivalent at 12-0-12 from the left end to connect truss(es) to back face of bottom chord.
- 12) Use Simpson Strong-Tie HUS26 (14-10d Girder, 6-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 14-0-12 from the left end to 18-0-12 to connect truss(es) to back face of bottom chord.
- 13) Fill all nail holes where hanger is in contact with lumber.
- 14) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 335 lb down and 286 lb up at 10-0-12 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-70, 2-4=-70, 4-7=-70, 7-8=-70, 18-19=-20, 2-15=-20, 9-13=-20

Concentrated Loads (lb)

Vert: 18=-311(B) 11=-1545(B) 17=-456(B) 23=-447(B) 24=-343(B) 25=-335(B) 26=-387(B) 28=-1554(B) 29=-1554(B)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804362
2765833	B3	COMMON SUPPORTED GAB	3	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:21 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzboN-FCBCOz7NCvhibiaOMxdrnOvHr1EdyxXEOZvVizNteC

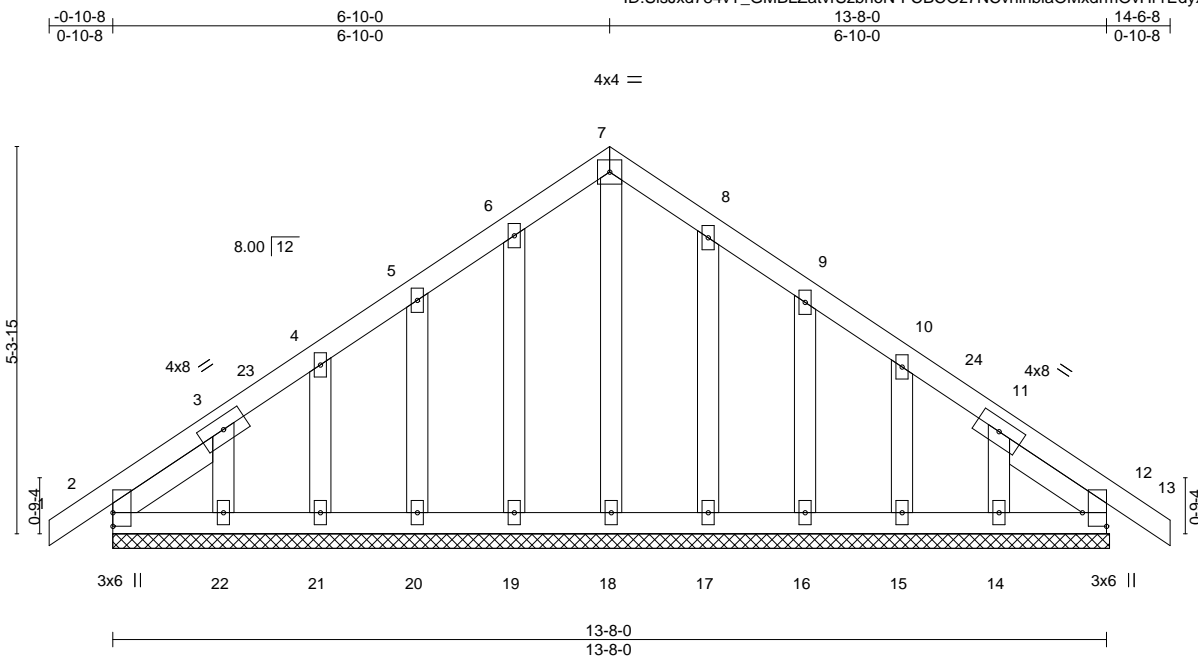


Plate Offsets (X,Y)-- [12:Edge,0-4-0]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	-0.00	12	n/r
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	13	n/r
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	12	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S				
				<b>PLATES</b>	<b>GRIP</b>		
				MT20	197/144		
				Weight: 70 lb	FT = 20%		

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 -t 1-8-11, Right 2x4 SPF No.2 -t 1-8-1

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

- All bearings 13-8-8.  
 (lb) - Max Horz 2=134(LC 10)  
 Max Uplift All uplift 100 lb or less at joint(s) 2, 12, 19, 20, 21, 22, 17, 16, 15, 14  
 Max Grav All reactions 250 lb or less at joint(s) 2, 12, 18, 19, 20, 21, 22, 17, 16, 15, 14

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 6-10-0, Corner(3R) 6-10-0 to 9-10-0, Exterior(2N) 9-10-0 to 14-6-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 19, 20, 21, 22, 17, 16, 15, 14.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

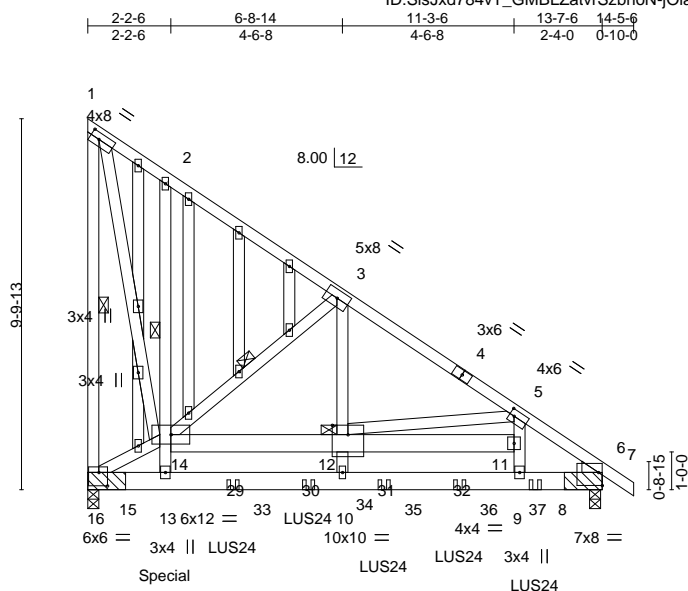


Plate Offsets (X,Y)-- [1:0-2-14,0-2-0], [5:0-1-8,0-2-0], [6:Edge,0-4-2], [12:0-5-0,0-3-0], [16:0-2-12,0-4-4]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL	1.15	TC	0.45	Vert(LL)	-0.06 11-12 >999 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.76	Vert(CT)	-0.11 11-12 >999 180		
BCLL	0.0	Rep Stress Incr	NO	WB	0.58	Horz(CT)	-0.03 16 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MS				Weight: 135 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x6 SPF No.2 \*Except\*  
2-13,5-9: 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
WEDGE  
Right: 2x4 SPF No.2

<b>BRACING- TOP CHORD</b>	Structural wood sheathing directly applied or 3-3-9 oc purlins, except end verticals.
<b>BOT CHORD</b>	Rigid ceiling directly applied or 8-9-12 oc bracing. Except: 6-0-0 oc bracing: 13-14, 2-14
<b>WEBS</b>	1 Row at midpt 1-16, 3-14
<b>JOINTS</b>	1 Brace at Jt(s): 12

**REACTIONS.** (size) 16=(0-3-8 + bearing block) (req. 0-3-10), 6=(0-3-8 + bearing block) (req. 0-3-9)  
 Max Horz 6=-377(LC 6)  
 Max Uplift 16=-774(LC 9), 6=-505(LC 9)  
 Max Grav 16=2325(LC 1), 6=2285(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	1-16=-1081/421, 1-2=-390/202, 2-3=-464/230, 3-5=-2189/551, 5-6=-2869/639
BOT CHORD	2-14=-287/127, 12-14=-687/196, 5-11=-60/399, 13-16=-624/2160, 10-13=-703/2440, 9-10=-703/2440, 6-9=-674/2324
WEBS	14-16=-2436/811, 1-14=-494/1252, 3-14=-1899/629, 3-12=-488/1835, 5-12=-862/237

**NOTES-**

- 1) 2x6 SPF No.2 bearing block 12" long at jt. 16 attached to front face with 3 rows of 10d (0.131"x3") nails spaced 3" o.c. 12 Total fasteners. Bearing is assumed to be SPF No.2.
- 2) 2x6 SPF No.2 bearing block 12" long at jt. 6 attached to front face with 3 rows of 10d (0.131"x3") nails spaced 3" o.c. 12 Total fasteners. Bearing is assumed to be SPF No.2.
- 3) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 4) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TP1 1.
- 5) All plates are 2x4 MT20 unless otherwise indicated.
- 6) Gable studs spaced at 1-4-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 16=774, 6=505.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TP1 1.
- 10) Use Simpson Strong-Tie LUS24 (4-SD9112 Girder, 2-SD9212 Truss, Single Ply Girder) or equivalent at 3-10-2 from the left end to connect truss(es) to back face of bottom chord.
- 11) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent spaced at 2-0-0 oc max. starting at 5-10-2 from the left end to 11-10-2 to connect truss(es) to back face of bottom chord.

12) Fill all nail holes where hanger is in contact with lumber.



April 23, 2021



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804363
2765833	B4	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:23 2021 Page 2  
ID:SlSjxd784vT\_GMBLZatvrSzbhoN-BbJype9dkXxQwvsyWn\_5wBT8QeY75j8qhi20ZbzNteA

- NOTES-**
- 13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 537 lb down and 217 lb up at 2-0-10 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 14) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-7=-70, 11-14=-20, 13-16=-20, 9-13=-20, 9-26=-20

Concentrated Loads (lb)

Vert: 14=-537(B) 29=-569(B) 30=-564(B) 31=-532(B) 32=-490(B) 37=-460(B)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804364
2765833	B5	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:24 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-gntL0\_AfVq3HY2R93UVKTO0QW224qlr\_wMoa51zNte9

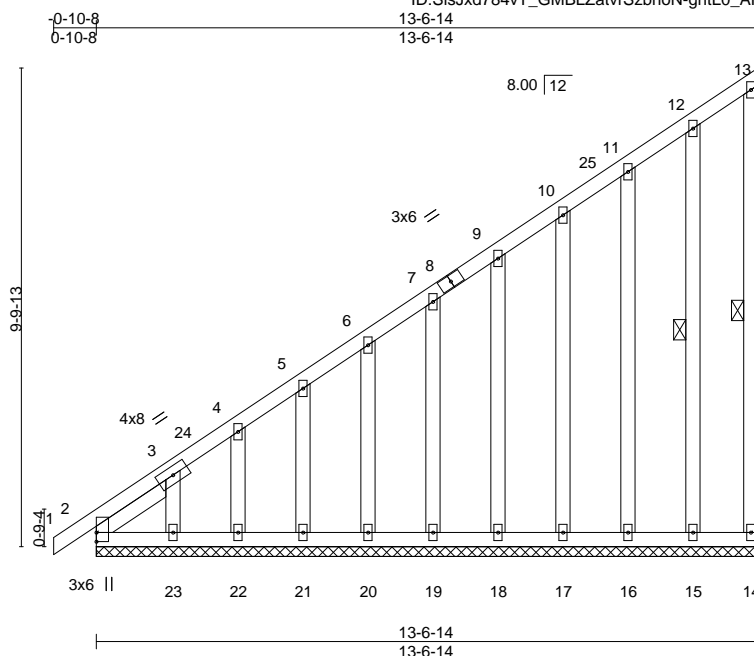

Scale = 1:47.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	0.00	1	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.01	Vert(CT)	-0.00	1	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.10	Horz(CT)	-0.00	14	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 98 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 - 1-9-7

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 13-14, 12-15

#### REACTIONS.

All bearings 13-6-14.

(lb) - Max Horz 2=388(LC 12)

Max Uplift All uplift 100 lb or less at joint(s) 14, 2, 15, 16, 17, 18, 19, 20, 21, 22 except 23=160(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 14, 15, 16, 17, 18, 19, 20, 21, 22, 23 except 2=297(LC 12)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-642/311, 3-4=-490/231, 4-5=-433/204, 5-6=-379/178, 6-7=-324/151, 7-9=-269/124

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 13-5-2 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 1-4-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 14, 2, 15, 16, 17, 18, 19, 20, 21, 22 except (jt=lb) 23=160.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**


**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job 2765833	Truss CJ1	Truss Type Jack-Closed Girder	Qty 4	Ply 1	Summit/#8 Osage I45804365
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:25 2021 Page 1  
ID:SlSjXd784vT\_GMBLZatvrSzbhoN-8zQjEKAuG8B8AC0ldC0Z0cYYwSNLZmi790X7eUzNte8

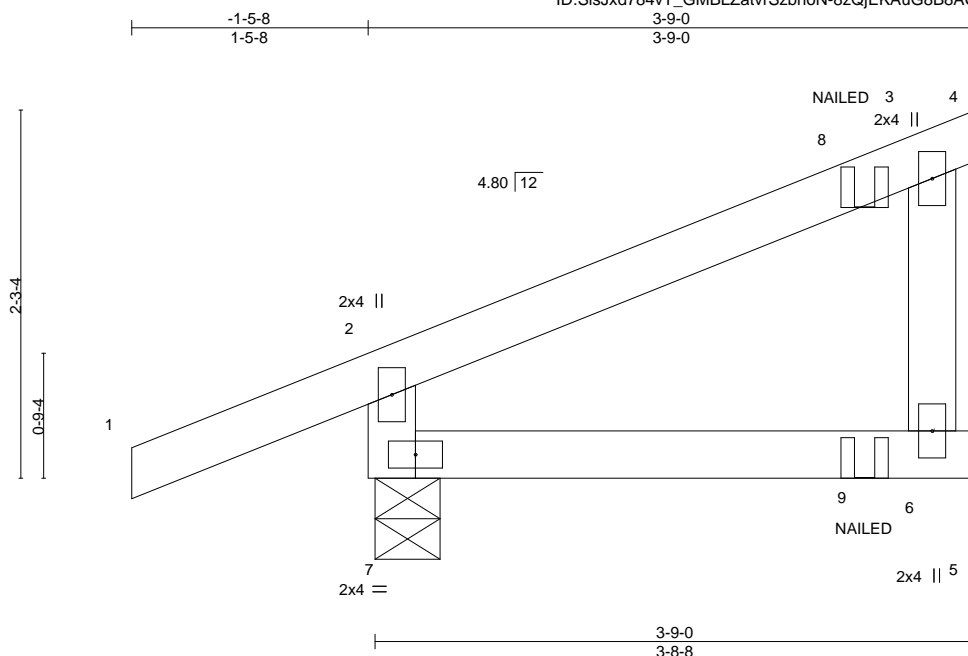

Scale = 1:14.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.20	Vert(LL)	-0.00	6-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	-0.01	6-7	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.00	Horz(CT)	-0.00	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 13 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-9-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 7=0-4-13, 6=Mechanical  
Max Horz 7=95(LC 5)  
Max Uplift 7=-86(LC 4), 6=-65(LC 5)  
Max Grav 7=291(LC 1), 6=146(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-7=-256/99

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 6.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) "NAILED" indicates 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-70, 2-3=-70, 3-4=-20, 5-7=-20  
Concentrated Loads (lb)  
Vert: 8=-1(B) 9=-13(B)



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage
2765833	CJ2	Jack-Open	2	1	I45804366
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:26 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvSzbhoN-cA\_5RgBW1SJ?nMbXBvXoYp5jksiolDyGNgHgAwzNte7

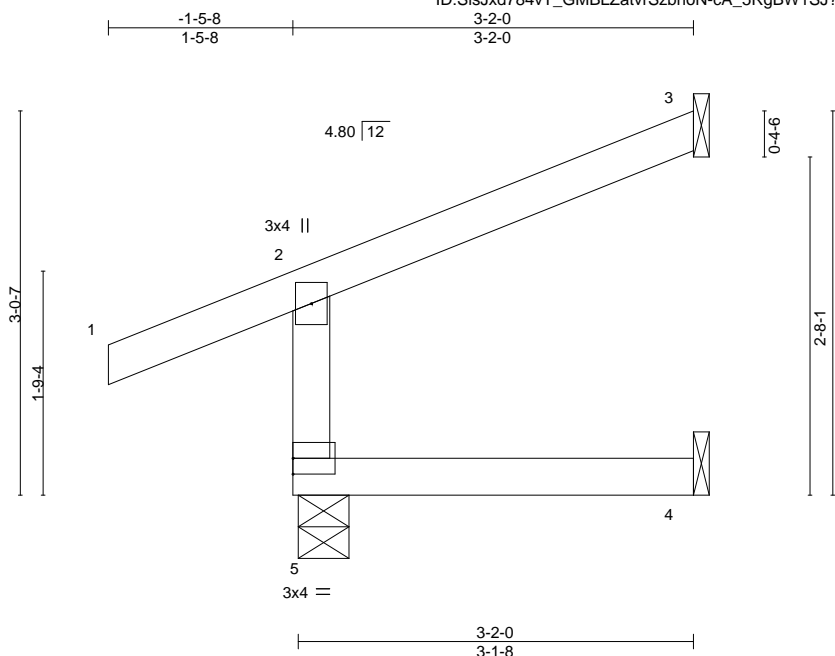

Scale = 1:18.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.19	Vert(LL)	0.01	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	-0.01	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.04	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 11 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-2-0 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-4-13, 3=Mechanical, 4=Mechanical  
Max Horz 5=79(LC 9)  
Max Uplift 5=-55(LC 8), 3=-54(LC 12), 4=-6(LC 9)  
Max Grav 5=276(LC 1), 3=77(LC 1), 4=55(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-5-8 to 2-9-7, Exterior(2R) 2-9-7 to 3-1-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3, 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage
2765833	J1	Jack-Open	18	1	I45804367

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:26 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvrSzbhoN-ca\_5RgBW1SJ?nMbXBvXoYp5i\_se9lDbGNgHgAwzNte7



Scale = 1:26.4

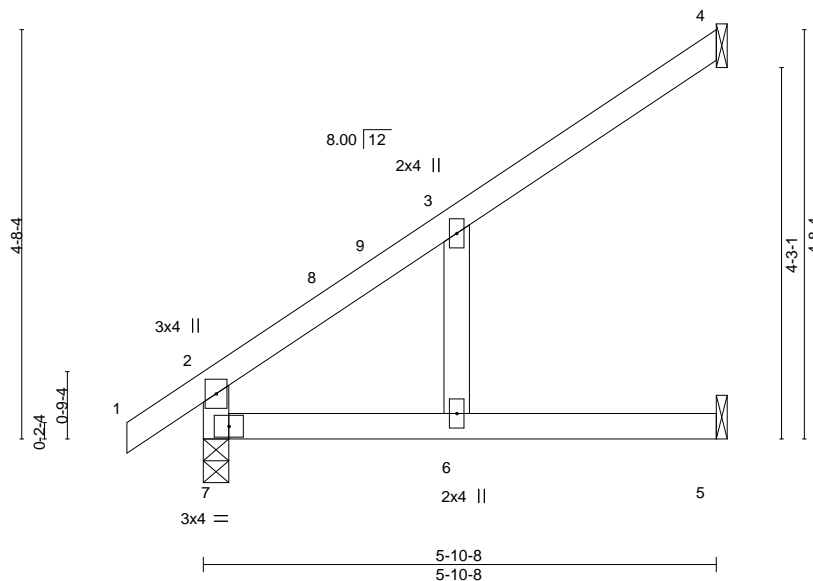

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.31	Vert(LL)	0.11	6	>603	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.42	Vert(CT)	-0.14	6	>494	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.04	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 19 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
Max Horz 7=170(LC 12)  
Max Uplift 4=-91(LC 12), 5=-31(LC 12), 7=-17(LC 12)  
Max Grav 4=158(LC 19), 5=105(LC 19), 7=333(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 5-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

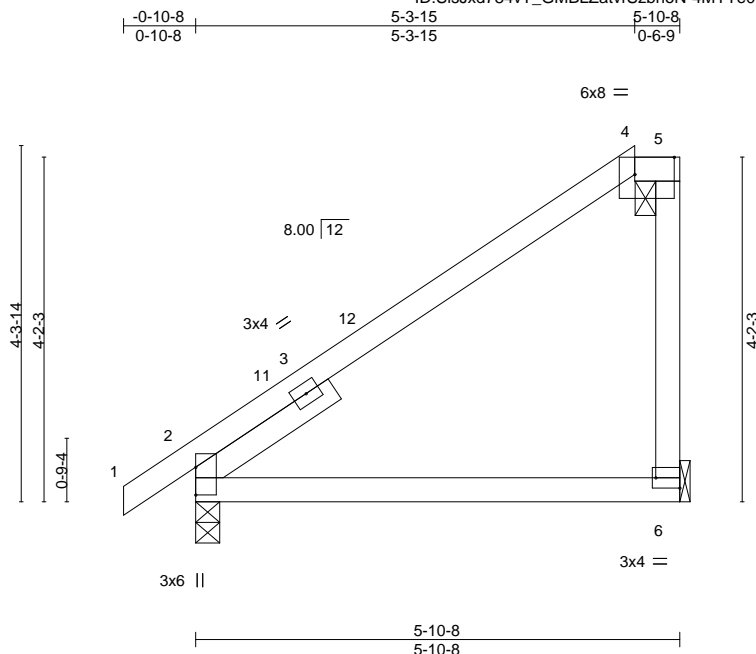

Scale = 1:28.0

Plate Offsets (X,Y)-- [4:0-5-12,Edge], [6:Edge,0-1-8]													
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.37	Vert(LL)	0.03	6-9	>999	240	MT20	197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.29	Vert(CT)	-0.05	6-9	>999	180			
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.02	2	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 22 lb	FT = 20%	

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 -t 2-0-0

<b>BRACING-</b>	
<b>TOP CHORD</b>	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 4-5.
<b>BOT CHORD</b>	Rigid ceiling directly applied.

**REACTIONS.** (size) 6=Mechanical, 2=0-3-8  
Max Horz 2=159(LC 11)  
Max Uplift 6=-78(LC 12), 2=-52(LC 12)  
Max Grav 6=262(LC 19), 2=324(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 5-3-15, Exterior(2E) 5-3-15 to 5-8-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 2.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:28 2021 Page 1  
ID:SlSjxd784vT\_GMBLZatvrSzbhoN-YY6rsMDmZ3aj1glwKZGdEA3\_fNWm7tZr\_mnFozNte5




LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins: 4-5.
BOT CHORD	2x4 SPF No.2	BOT CHORD	
WEBS	2x4 SPF No.2		
SLIDER	Left 2x4 SPF No.2 -t 2-0-0		Rigid ceiling directly applied.

**REACTIONS.** (size) 2=0-3-8, 6=Mechanical  
Max Horz 2=119(LC 11)  
Max Uplift 2=59(LC 12), 6=64(LC 9)  
Max Grav 2=324(LC 1), 6=253(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**TOP CHORD** 2-4=-350/72

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-9-15, Exterior(2E) 3-9-15 to 5-8-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 3f, 9f, 10f, 11f, 12f, 13f, 14f, 15f, 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f**




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804370
2765833	J4	Half Hip Girder	4	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:29 2021 Page 1  
ID:SlSjxd784vT\_GMBLZatvrSzbhoN-0kgE3iDOJNiafqJ6s15VASjCR3kkVZGj3eVlnFzNte4

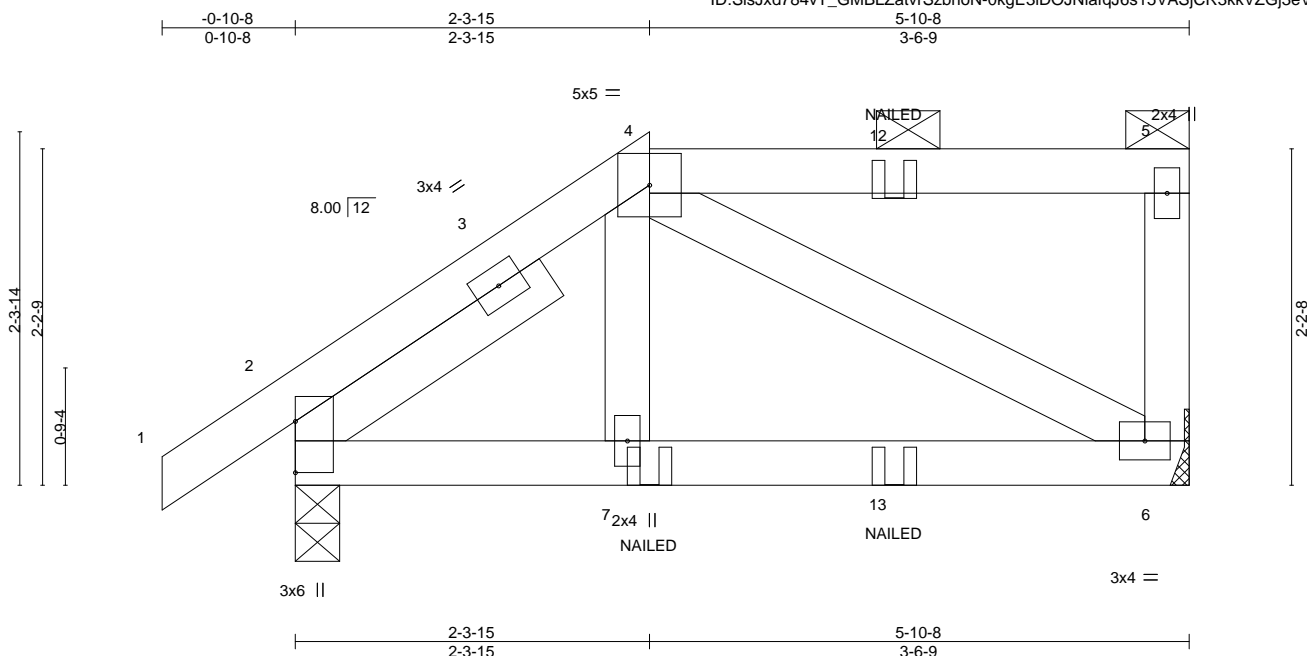

Scale = 1:15.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.01	6-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	-0.02	6-7	>999	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.09	Horz(CT)	0.00	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 26 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 -t 2-0-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-10-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 4-5.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-3-8, 6=Mechanical  
Max Horz 2=81(LC 7)  
Max Uplift 2=119(LC 8), 6=115(LC 5)  
Max Grav 2=416(LC 1), 6=336(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-373/124  
BOT CHORD 2-7=-128/296, 6-7=-124/282  
WEBS 4-6=-325/125

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=119, 6=115.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-70, 4-5=-70, 6-8=-20  
Concentrated Loads (lb)  
Vert: 7=-121(B) 12=-27(B) 13=-27(B)



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage
2765833	J5	Jack-Open	4	1	145804371
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:30 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-UxEch1E04gqRGzuJQlckjGPeT4wE1yslIFuJhzNte3

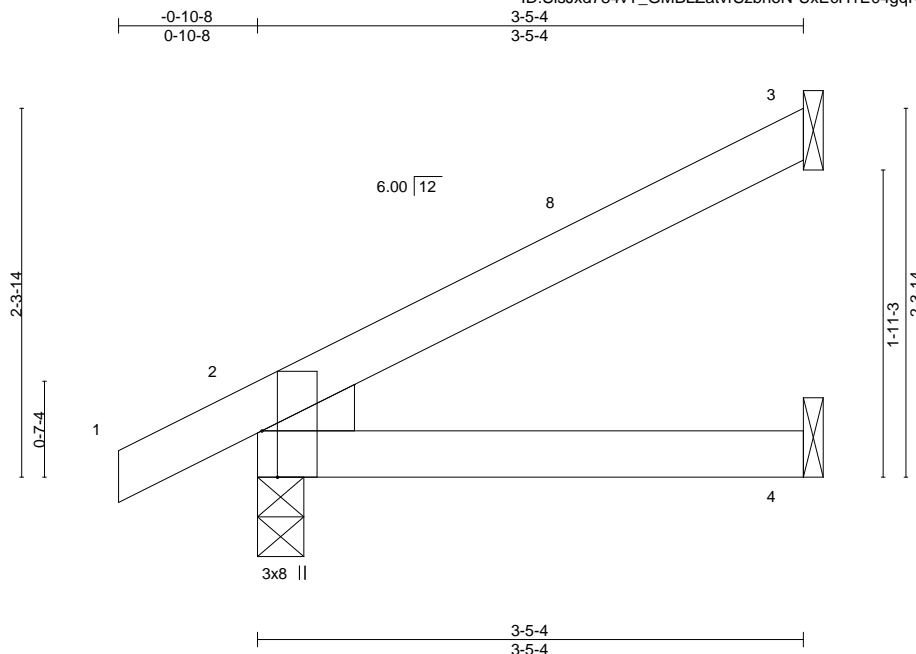

Scale = 1:14.5

Plate Offsets (X,Y)--		[2:0-3-8,Edge]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.14
TCDL 10.0	Lumber DOL	1.15	BC 0.11
BCLL 0.0	Rep Stress Incr	YES	WB 0.00
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP
			<b>DEFL.</b> in (loc) l/defl L/d
			Vert(LL) -0.01 4-7 >999 240
			Vert(CT) -0.01 4-7 >999 180
			Horz(CT) 0.00 2 n/a n/a
			<b>PLATES</b> <b>GRIP</b>
			MT20 197/144
			Weight: 10 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEDGE

Left: 2x4 SPF No.2

#### BRACING-

TOP CHORD

Structural wood sheathing directly applied or 3-5-4 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical

Max Horz 2=84(LC 12)

Max Uplift 3=52(LC 12), 2=34(LC 12), 4=3(LC 12)

Max Grav 3=97(LC 1), 2=221(LC 1), 4=61(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-4-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2, 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage
2765833	J6	Jack-Open	4	1	I45804372
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:31 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-y7o\_UNFer\_ylu7TV\_S7zFtobLtQuzUC0Xy\_Rr7zNte2

-0-10-8  
0-10-8

2-8-12  
2-8-12

Scale = 1:12.7

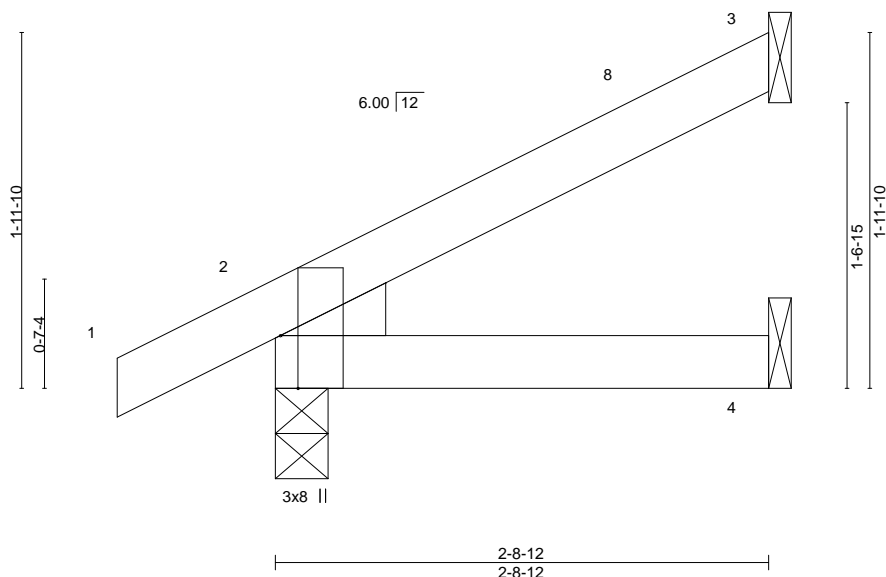


Plate Offsets (X,Y)--		[2:0-3-8,Edge]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07
TCDL 10.0	Lumber DOL	1.15	BC 0.07
BCLL 0.0	Rep Stress Incr	YES	WB 0.00
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MP
			<b>DEFL.</b> in (loc) l/defl L/d
			Vert(LL) -0.00 7 >999 240
			Vert(CT) -0.01 4-7 >999 180
			Horz(CT) 0.00 3 n/a n/a
			<b>PLATES</b> <b>GRIP</b>
			MT20 197/144
			Weight: 9 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEDGE

Left: 2x4 SPF No.2

#### BRACING-

TOP CHORD

Structural wood sheathing directly applied or 2-8-12 oc purlins.

BOT CHORD

Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 2=0-3-8, 4=Mechanical

Max Horz 2=70(LC 12)

Max Uplift 3=40(LC 12), 2=30(LC 12), 4=4(LC 12)

Max Grav 3=74(LC 1), 2=191(LC 1), 4=47(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 2-8-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 2, 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804373
2765833	LG1	GABLE	2	1		

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:32 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzboN-RJMMijGHcl49WH2hXAeCo4LmtHnQivf9mck?OazNte1



Scale = 1:50.4

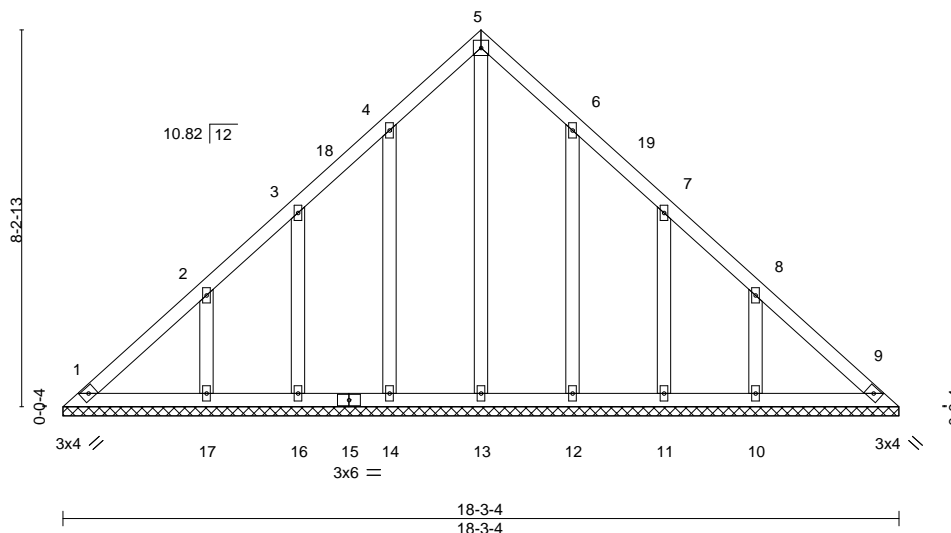

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	n/a	-	n/a	999	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	n/a	-	n/a	999	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.18	Horz(CT)	0.01	9	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						
									Weight: 84 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 18-3-4.  
(lb) - Max Horz 1=-206(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 16, 11 except 14=-112(LC 12), 17=-153(LC 12), 12=-110(LC 13), 10=-153(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 13, 14, 16, 12, 11 except 17=280(LC 19), 10=279(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-9 to 3-1-10, Interior(1) 3-1-10 to 9-1-10, Exterior(2R) 9-1-10 to 12-1-10, Interior(1) 12-1-10 to 17-10-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 16, 11 except (jt=lb) 14=112, 17=153, 12=110, 10=153.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

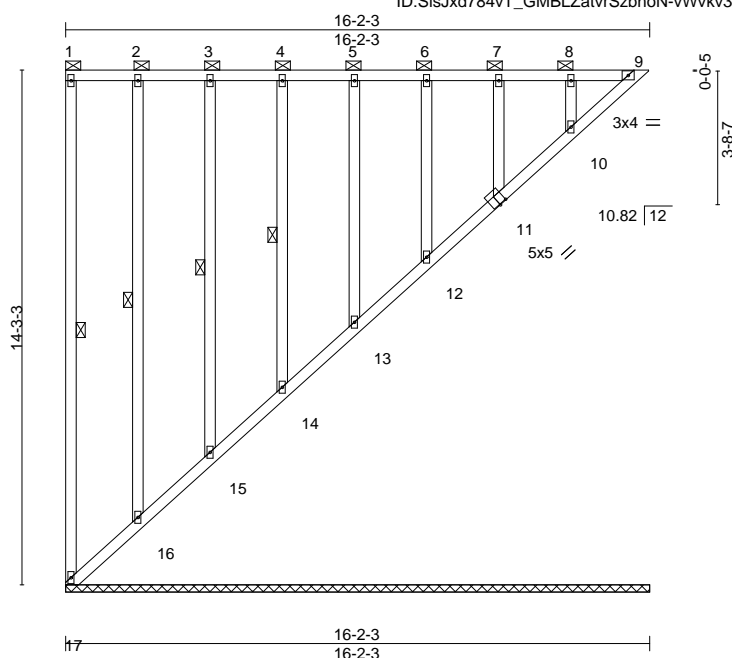

Scale: 3/16"=1'

Plate Offsets (X,Y)-- [11:0-2-8,0-0-4]												
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>	<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.12	Horz(CT)	0.00	10	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S							Weight: 113 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	2-0-0 oc purlins (6-0-0 max.): 1-9, except end verticals.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
WEBS	2x4 SPF No.2	WEBS	1 Row at midpt                      1-17, 2-16, 3-15, 4-14
OTHERS	2x4 SPF No.2		

**REACTIONS.** All bearings 16-2-3.  
(lb) - Max Uplift All uplift 100 lb or less at joint(s) 17, 9, 11, 16, 15, 14, 13, 12, 10  
Max Grav All reactions 250 lb or less at joint(s) 17, 9, 11, 16, 15, 14, 13, 12, 10

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Bearing at joint(s) 17, 9, 11, 16, 15, 14, 13, 12, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula.  
Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 17, 9, 11, 16, 15, 14, 13, 12, 10.
- 8) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 9, 11, 16, 15, 14, 13, 12, 10.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

**WARNING - Velly design parameters and READ NOTES ON THIS AND INCLUDED WITHIN KEY EXERCISE 1 AGE MH-475 (Rev. 3/19/2020) BEFORE USE.**  
Design valid for use only with MITEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage
2765833	LG3	GABLE	2	1	I45804375
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:34 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvrSzbhoN-NiT76PHX8vKslbC4fbggtVQ\_M4PNAoxSDwD5SSzNte?

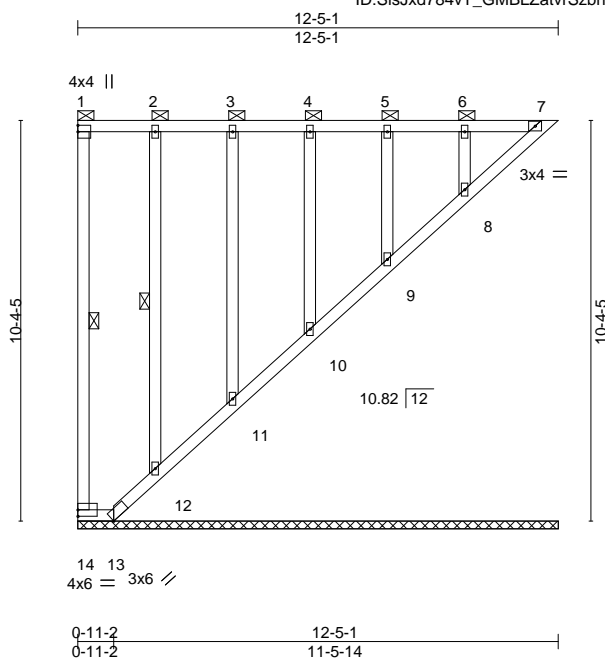

Scale = 1:59.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.60	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.27	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.13	Horz(CT)	0.01	7	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 73 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.): 1-7, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.  
WEBS 1 Row at midpt 1-14, 2-12

#### REACTIONS.

All bearings 12-5-1.

(lb) - Max Horz 14=-286(LC 10)

Max Uplift All uplift 100 lb or less at joint(s) 13, 11, 10, 9, 8 except 14=-134(LC 10), 7=-113(LC 9), 12=-113(LC 8)

Max Grav All reactions 250 lb or less at joint(s) 14, 7, 13, 12, 11, 10, 9, 8

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

BOT CHORD 11-12=-259/246, 10-11=-257/243, 9-10=-258/243, 8-9=-258/244, 7-8=-256/238

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 13, 11, 10, 9, 8 except (jt=lb) 14=134, 7=113, 12=113.
- 7) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 7, 12, 11, 10, 9, 8.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804376
2765833	M1	GABLE	1	1		
Job Reference (optional)						


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:35 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-ru1VKI9vDSjNlnGDICvQjzGDUoXvHObSayf\_vzNte\_

-0-10-8 0-10-8 8-11-8 8-11-8

Scale = 1:18.7

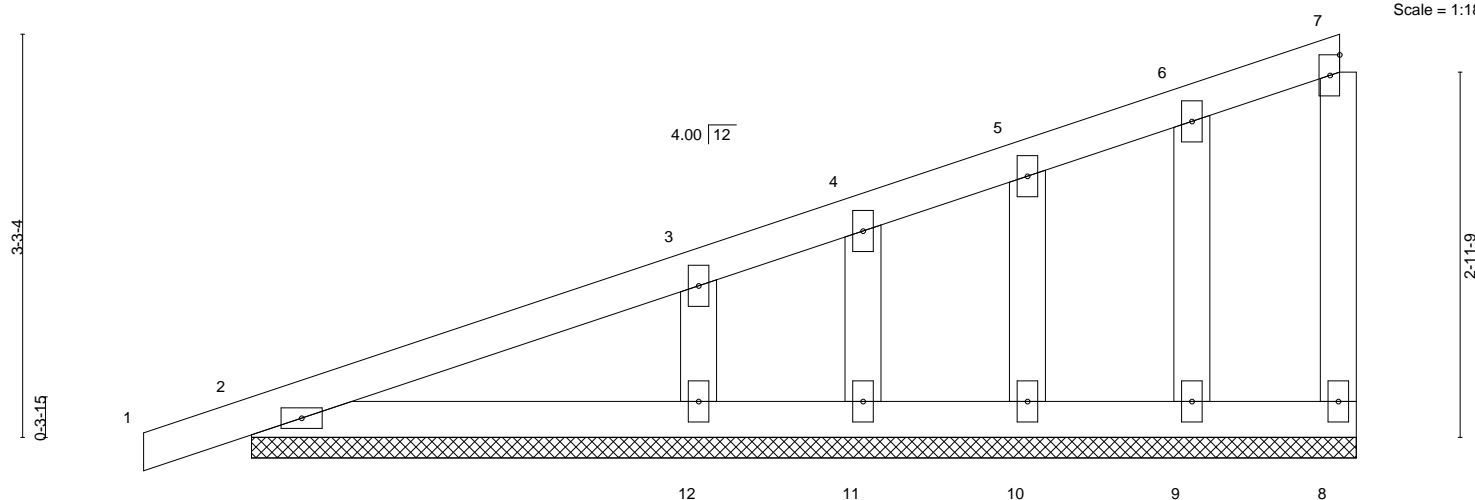

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	-0.00	1	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	0.00	1	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 33 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 8-11-8.

(lb) - Max Horz 2=137(LC 9)

Max Uplift All uplift 100 lb or less at joint(s) 8, 2, 9, 10, 11, 12

Max Grav All reactions 250 lb or less at joint(s) 8, 2, 9, 10, 11 except 12=328(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-257/126

WEBS 3-12=-249/294

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 8-9-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 1-4-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 2, 9, 10, 11, 12.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804377
2765833	M2	Monopitch	3	1	Job Reference (optional)	

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:36 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvSzboN-J5btX5JngWaa\_vMSm7j8yWwKmu2hekalhEiCWLzNtdz



Scale = 1:19.8

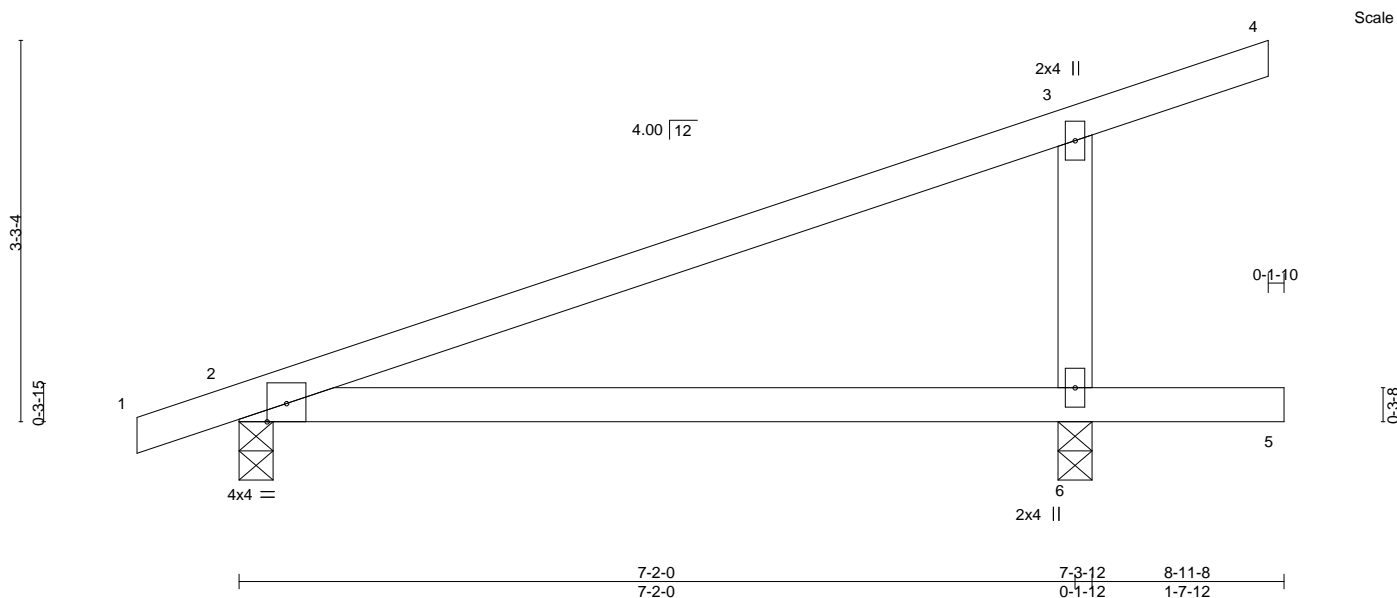

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.61	Vert(LL)	-0.12	6-9	>733	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.48	Vert(CT)	-0.24	6-9	>360	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 24 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
Max Horz 2=133(LC 8)  
Max Uplift 2=-86(LC 8), 6=-121(LC 12)  
Max Grav 2=370(LC 1), 6=488(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
WEBS 3-6=-356/306

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 8-9-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 6=121.
- 4) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 5) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804378
2765833	M3	Monopitch	24	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:36 2021 Page 1  
ID:SlSjxd784vT\_GMBLZatvrSzbhoN-J5btX5JngWaa\_vMSm?j8ywWPju6MekRihEiCWLZNtdz

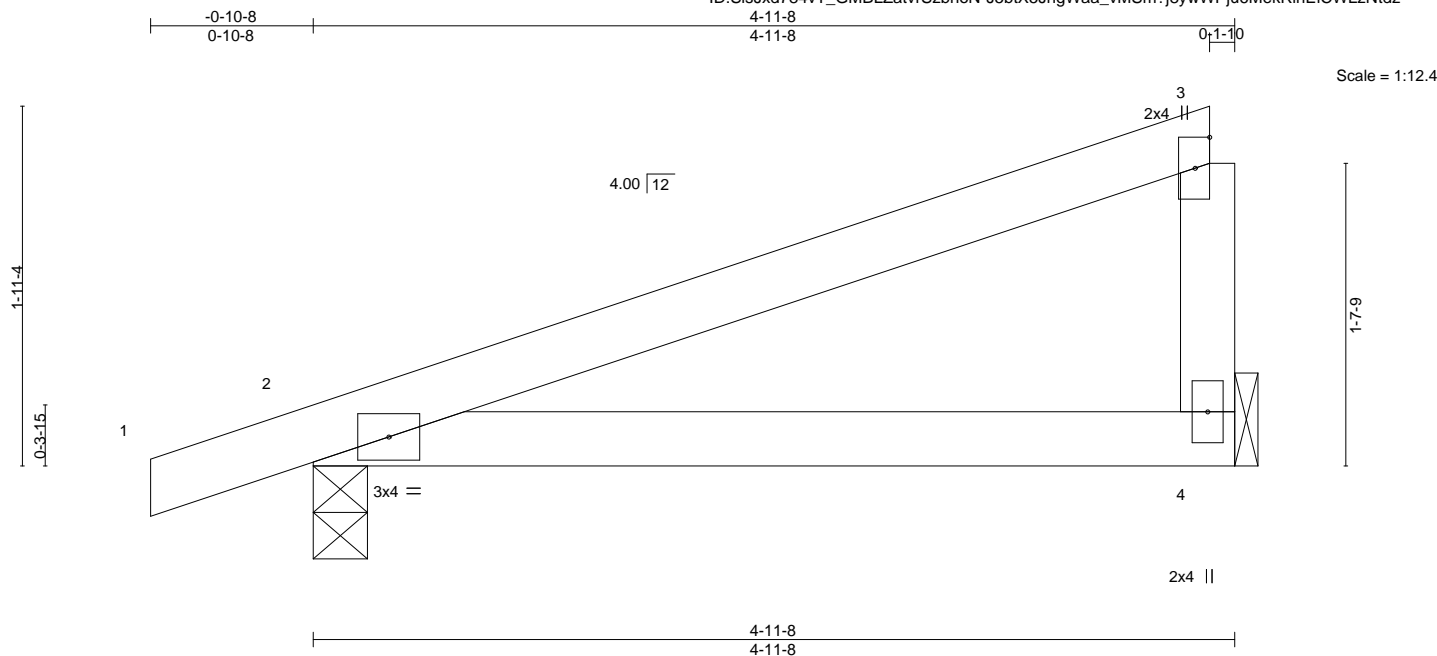

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.03	4-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.24	Vert(CT)	-0.06	4-7	>988	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 14 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 2=0-3-8  
Max Horz 2=79(LC 11)  
Max Uplift 4=53(LC 12), 2=85(LC 8)  
Max Grav 4=211(LC 1), 2=283(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 4-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 2.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804379
2765833	M4	GABLE	4	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:37 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-nH9FIRKPRqIRc2xfKjENV82cgIT?NaguVuRm2nzNtdy

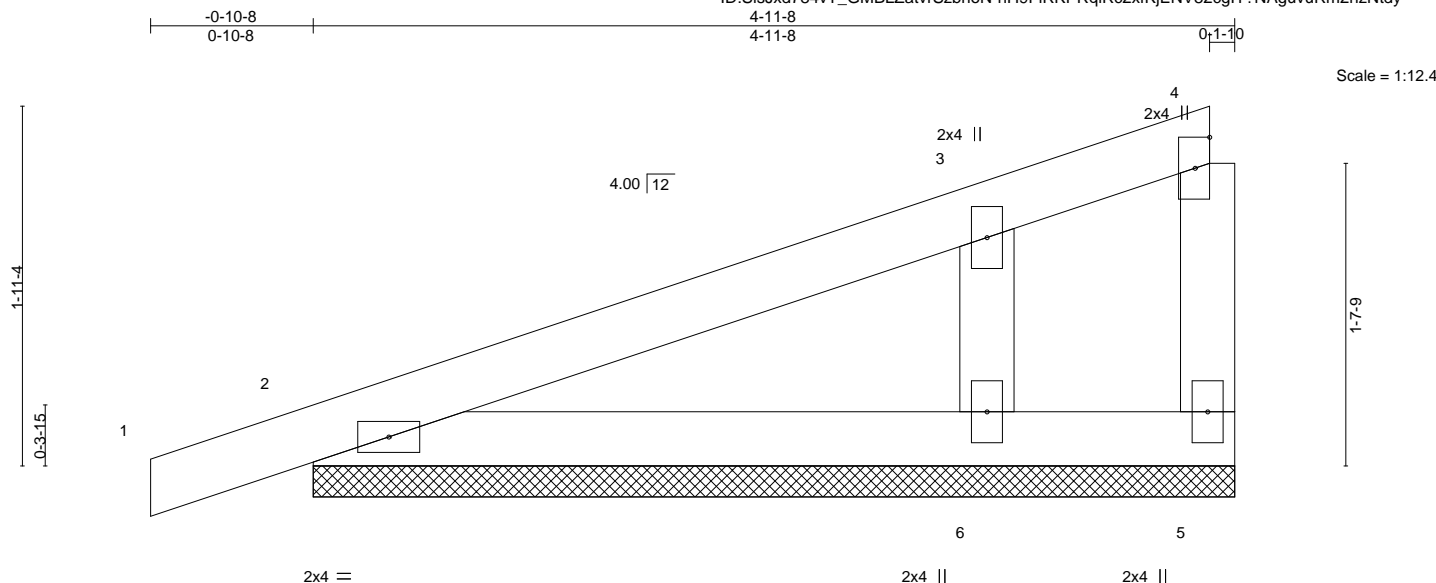

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	-0.00	1	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	0.00	1	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.07	Horz(CT)	0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 15 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-11-8 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 5=4-11-8, 2=4-11-8, 6=4-11-8  
Max Horz 2=78(LC 9)  
Max Uplift 5=-37(LC 1), 2=-64(LC 8), 6=-89(LC 12)  
Max Grav 5=15(LC 12), 2=203(LC 1), 6=326(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-6=-249/372

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 4-9-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) Gable requires continuous bottom chord bearing.
- 4) Gable studs spaced at 1-4-0 oc.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 2, 6.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804380
2765833	M5	GABLE	3	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:38 2021 Page 1


ID:SlSjxd784vT\_GMBLZatvrSzbhoN-FTjdynK1C8qIECWruQlc1LboKhqj6eD18YBjaDzNtdx

6-11-8

6-11-8

0-1-10

Scale = 1:15.6

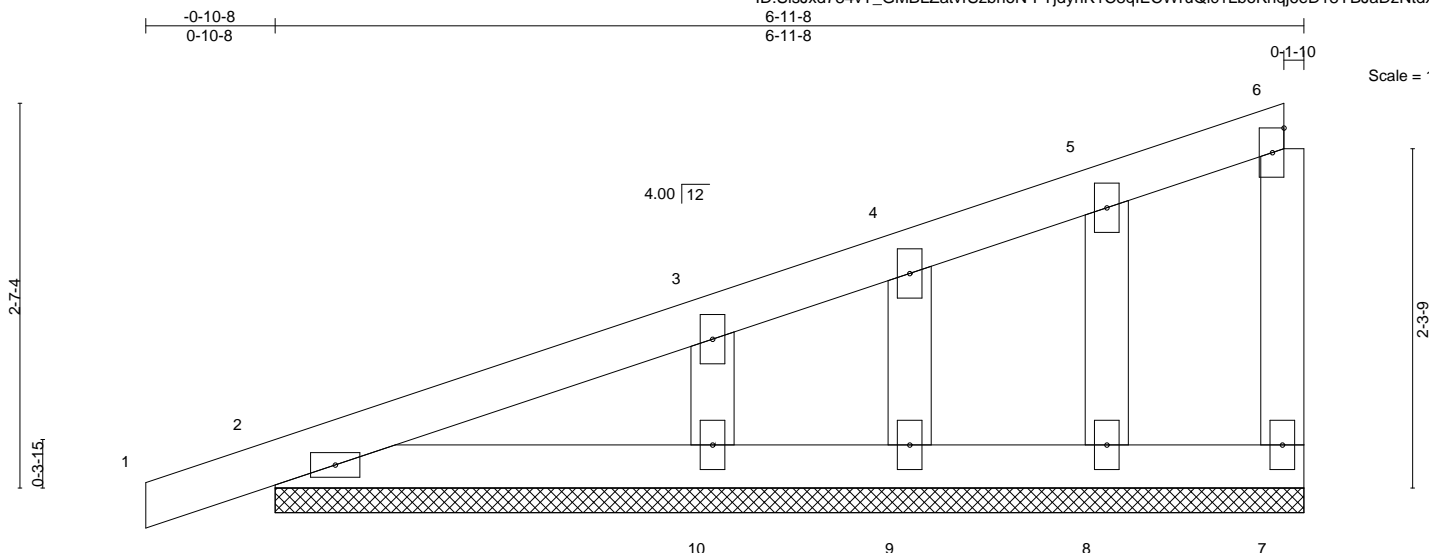

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	-0.00	1	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	0.00	1	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 24 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 6-11-8.

(lb) - Max Horz 2=108(LC 9)

Max Uplift All uplift 100 lb or less at joint(s) 7, 2, 8, 9, 10

Max Grav All reactions 250 lb or less at joint(s) 7, 2, 8, 9 except 10=252(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 3-10=-191/258

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-8, Exterior(2N) 2-1-8 to 6-9-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) Gable studs spaced at 1-4-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 2, 8, 9, 10.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017






Job 2765833	Truss V1	Truss Type Valley	Qty 1	Ply 1	Summit/#8 Osage I45804382
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:40 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvrSzboN-CsqONSMik40TWIE?rn47mg4bVUVaWdKbrgQf6zNtdv

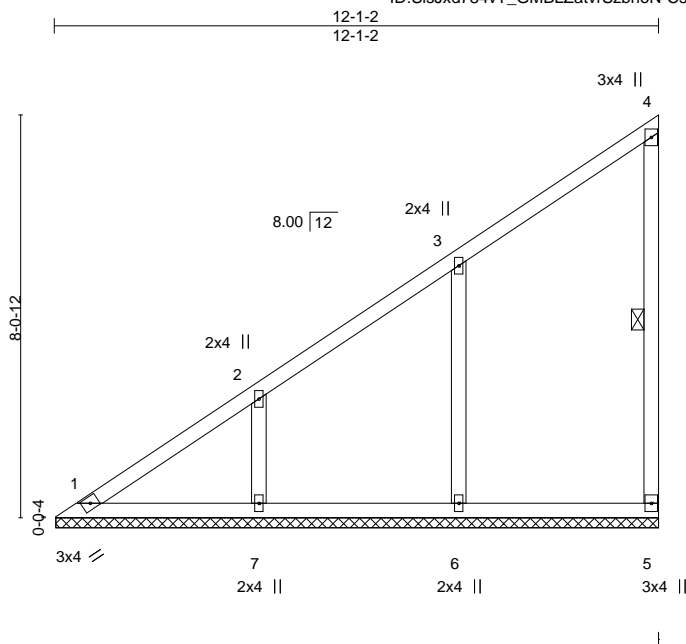

Scale = 1:46.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.36	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.16	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.14	Horz(CT)	-0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 46 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 4-5

#### REACTIONS.

All bearings 12-0-12.

(lb) - Max Horz 1=304(LC 9)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 6=164(LC 12), 7=161(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=396(LC 19), 7=392(LC 19)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-448/348, 2-3=-317/265

WEBS 3-6=-321/232, 2-7=-298/207

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 11-11-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 6=164, 7=161.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804383
2765833	V2	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:46 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-00CfeWR3Jbr9BR7NM6uUM1w6FwYV\_FRD\_n7ksmzNtdp

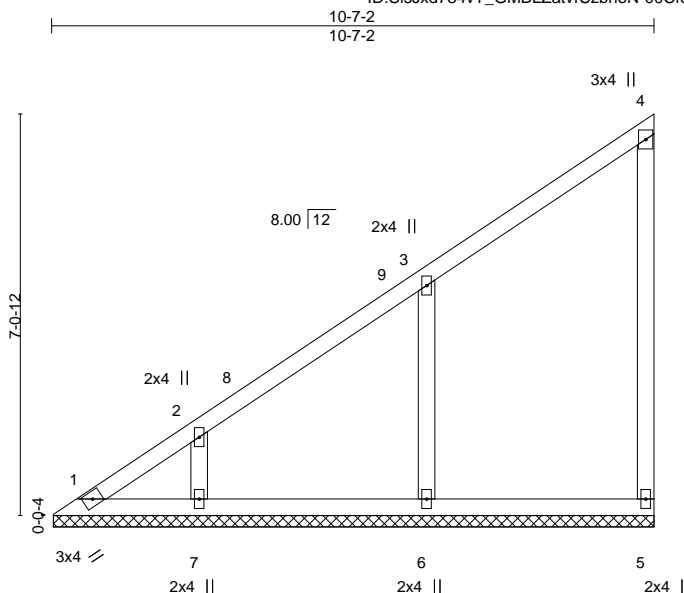

Scale = 1:40.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.13	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.09	Horz(CT)	-0.00	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 39 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 10-6-12.

(lb) - Max Horz 1=265(LC 9)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 6=122(LC 12), 7=137(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 1, 5 except 6=412(LC 19), 7=315(LC 19)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-404/272, 2-3=-319/228

WEBS 3-6=-330/240

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 10-5-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 6=122, 7=137.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage
2765833	V3	Valley	1	1	145804384
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:47 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-UCm1rrRh4vz0pbawpPjvFTH5KtNji5MCRslPCzNtdo

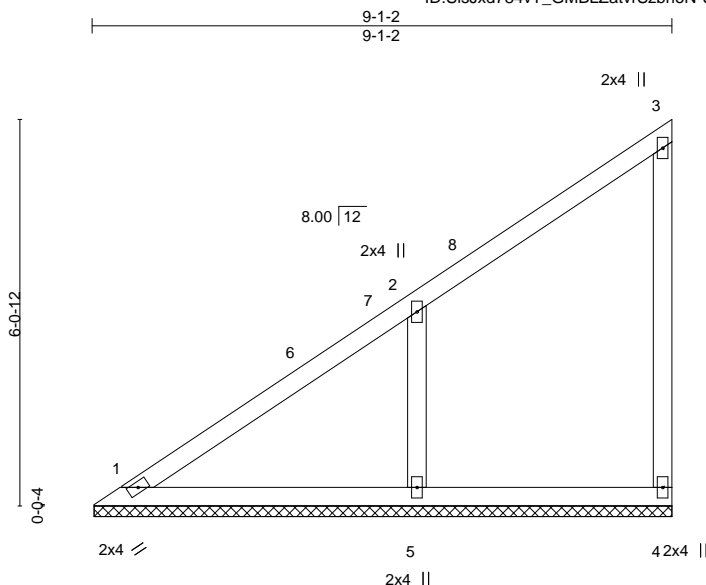

Scale = 1:36.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.28	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.07	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 32 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=9-0-12, 4=9-0-12, 5=9-0-12  
Max Horz 1=225(LC 9)  
Max Uplift 1=6(LC 8), 4=50(LC 9), 5=179(LC 12)  
Max Grav 1=192(LC 20), 4=143(LC 19), 5=489(LC 19)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-333/236  
WEBS 2-5=-377/276

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 8-11-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4 except (jt=lb) 5=179.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2765833	Truss V4	Truss Type Valley	Qty 1	Ply 1	Summit/#8 Osage I45804385
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:48 2021 Page 1  
ID:SlSjXd784vT\_GMBLZatvrSzbhoN-zOJP2BSJrC5tQIGmTXwyRS?T\_jEHSaiWR5crxezNtdn

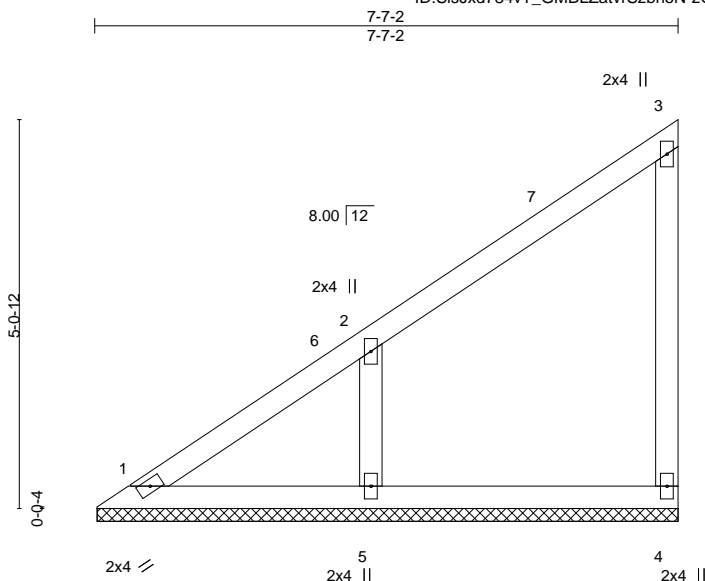

Scale = 1:30.0

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.21	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 26 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=7-6-12, 4=7-6-12, 5=7-6-12  
Max Horz 1=185(LC 9)  
Max Uplift 1=16(LC 8), 4=46(LC 9), 5=162(LC 12)  
Max Grav 1=128(LC 20), 4=154(LC 19), 5=410(LC 19)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-313/216  
WEBS 2-5=-322/259

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-7-2, Interior(1) 3-7-2 to 7-5-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4 except (jt=lb) 5=162.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2765833	Truss V5	Truss Type Valley	Qty 1	Ply 1	Summit/#8 Osage I45804386
----------------	-------------	----------------------	----------	----------	------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:49 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzboN-RbtngXTxcWDk2ury1ESB\_gYfz7a9Bd1fgLOT5zNtdm

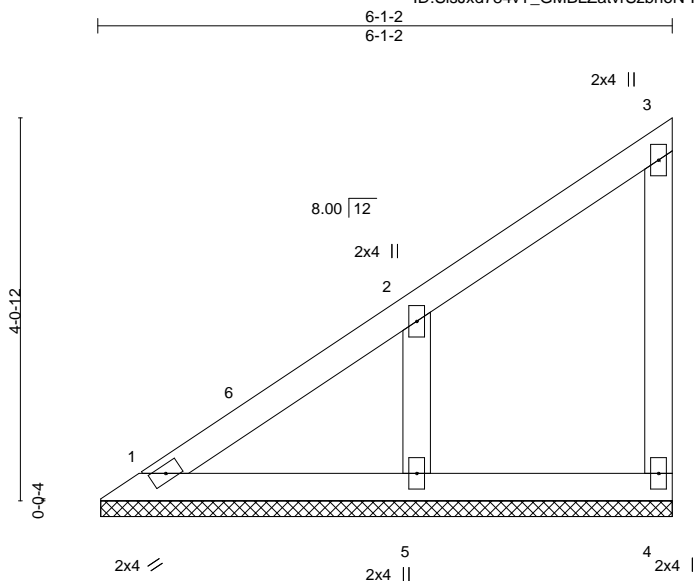

Scale = 1:24.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.13	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 20 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=6-0-12, 4=6-0-12, 5=6-0-12  
Max Horz 1=145(LC 9)  
Max Uplift 1=6(LC 8), 4=32(LC 9), 5=131(LC 12)  
Max Grav 1=120(LC 20), 4=95(LC 19), 5=320(LC 19)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-255/175  
WEBS 2-5=-251/230

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-4-10, Interior(1) 3-4-10 to 5-11-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4 except (jt=lb) 5=131.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

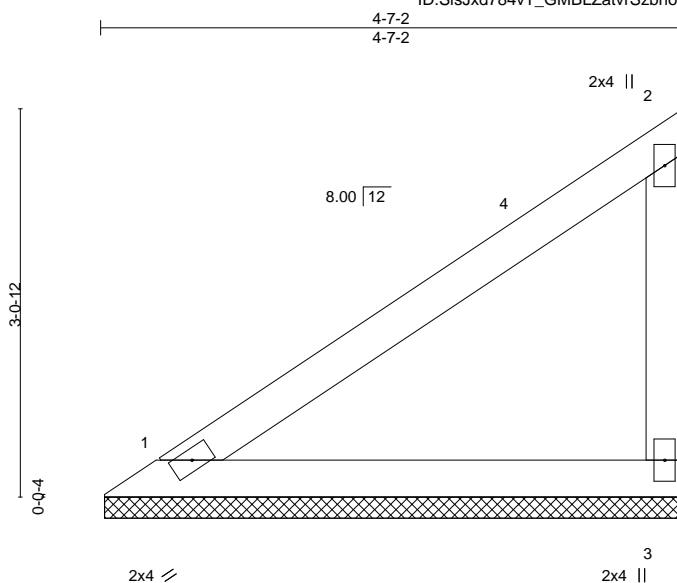

Scale = 1:18.2

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.30	Vert(LL) n/a - n/a 999	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.16	Vert(CT) n/a - n/a 999		
BCLL 0.0	Rep Stress Incr YES	WB 0.00	Horz(CT) 0.00 3 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-P		Weight: 14 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

<b>BRACING-</b>	
<b>TOP CHORD</b>	Structural wood sheathing directly applied or 4-7-2 oc purlins, except end verticals.
<b>BOT CHORD</b>	Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 1=4-6-12, 3=4-6-12  
 Max Horz 1=105(LC 9)  
 Max Uplift 1=-22(LC 12), 3=-59(LC 12)  
 Max Grav 1=179(LC 1), 3=192(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 4-5-6 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 2765833	Truss V7	Truss Type Valley	Qty 1	Ply 1	Summit/#8 Osage I45804388
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:50 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-vnRATtUZNqLbg2Q9byzQWt5r2XwVw4vpvP5y?XzNtdl

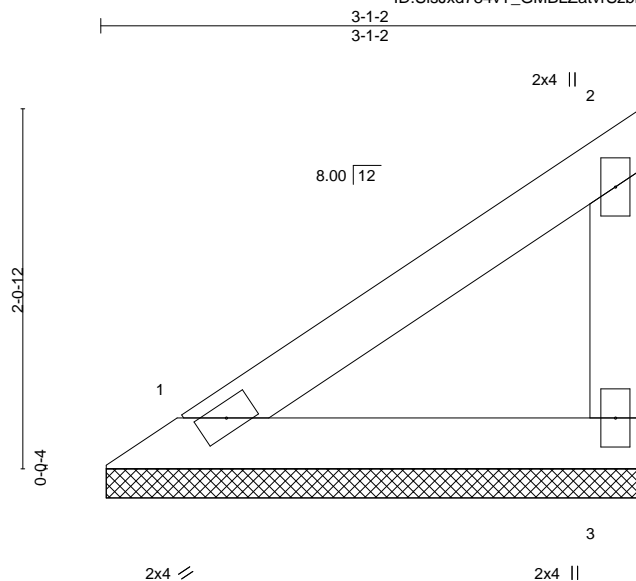

Scale = 1:13.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 9 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-1-2 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=3-0-12, 3=3-0-12

Max Horz 1=66(LC 9)

Max Uplift 1=-14(LC 12), 3=-37(LC 12)

Max Grav 1=111(LC 1), 3=119(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage
2765833	V9	Valley	2	1	I45804389
Job Reference (optional)					

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:51 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-Nz?YhDUB87TSHC?L9fUf35dzYxE3fVwy73qVYzzNtdk

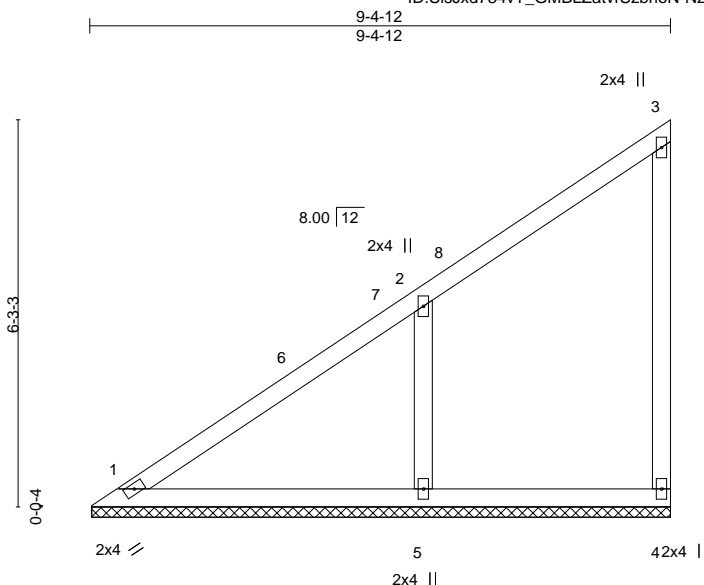

Scale = 1:37.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.31	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.16	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.08	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S						Weight: 33 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=9-4-6, 4=9-4-6, 5=9-4-6  
Max Horz 1=233(LC 9)  
Max Uplift 1=-4(LC 8), 4=-50(LC 9), 5=-183(LC 12)  
Max Grav 1=203(LC 20), 4=138(LC 19), 5=511(LC 19)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-339/242  
WEBS 2-5=-393/281

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 9-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4 except (jt=lb) 5=183.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2765833	Truss V10	Truss Type Valley	Qty 2	Ply 1	Summit/#8 Osage I45804390
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:40 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvSzboN-CsqONSMikI40TWfE?m47mg6oVVJaYhKbrgQf6zNtdv

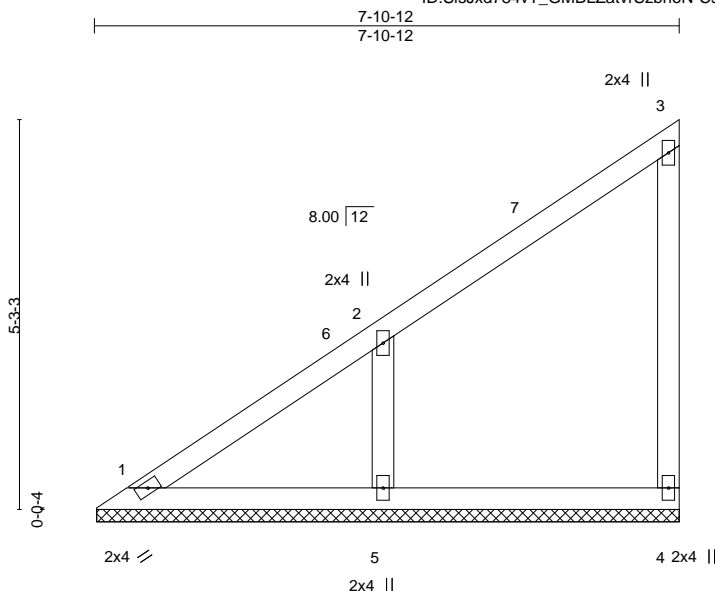

Scale = 1:31.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.11	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 27 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=7-10-6, 4=7-10-6, 5=7-10-6  
Max Horz 1=193(LC 9)  
Max Uplift 1=-14(LC 8), 4=-46(LC 9), 5=-165(LC 12)  
Max Grav 1=142(LC 20), 4=152(LC 19), 5=425(LC 19)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-318/221  
WEBS 2-5=-334/262

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 7-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4 except (jt=lb) 5=165.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2765833	Truss V11	Truss Type Valley	Qty 2	Ply 1	Summit/#8 Osage I45804391
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:41 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvrSzbhoN-g2OmaoNwV3Ct5gEQZZIjf\_DI6vriJ?zUqVPzBYzNtdu

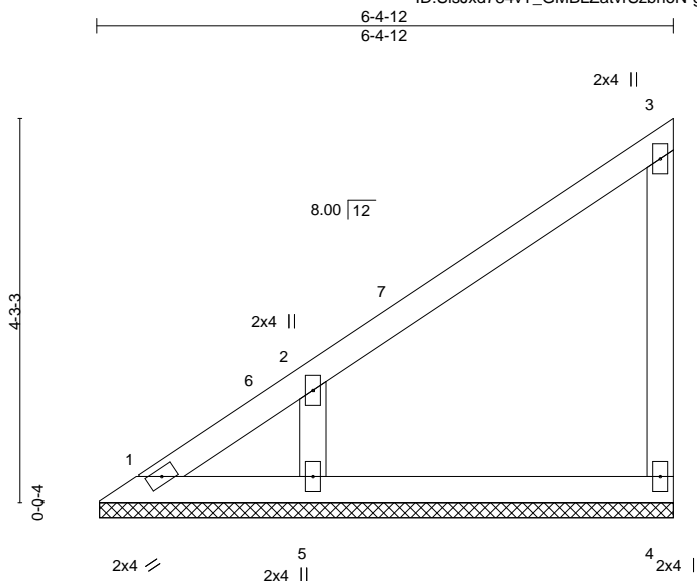

Scale = 1:25.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 21 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=6-4-6, 4=6-4-6, 5=6-4-6  
Max Horz 1=153(LC 9)  
Max Uplift 1=-36(LC 10), 4=-42(LC 9), 5=-153(LC 12)  
Max Grav 1=78(LC 9), 4=156(LC 19), 5=371(LC 19)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-300/200  
WEBS 2-5=-291/259

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 6-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4 except (jt=lb) 5=153.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2765833	Truss V12	Truss Type Valley	Qty 2	Ply 1	Summit/#8 Osage I45804392
----------------	--------------	----------------------	----------	----------	------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:42 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzboN-8Fy8o8NYGMKkiqpc7GqYCBiQJJAd2Swd399Xj?zNtdt

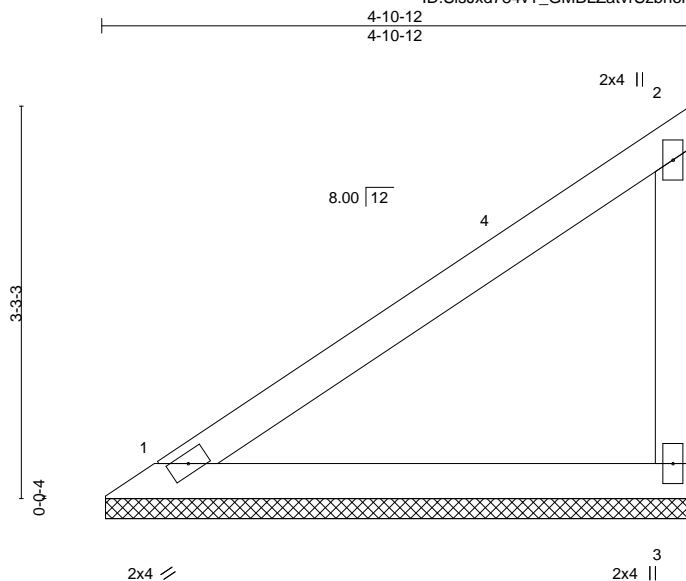

Scale = 1:19.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.35	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 15 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-10-12 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=4-10-6, 3=4-10-6  
Max Horz 1=113(LC 9)  
Max Uplift 1=-24(LC 12), 3=-63(LC 12)  
Max Grav 1=192(LC 1), 3=206(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-12 to 3-5-12, Interior(1) 3-5-12 to 4-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	145804393
2765833	V13	Valley	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:42 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvSzboN-8Fy8o8NYGMKkiqpc7GqYCBITcJBO2Swd399Xj?zNtdt

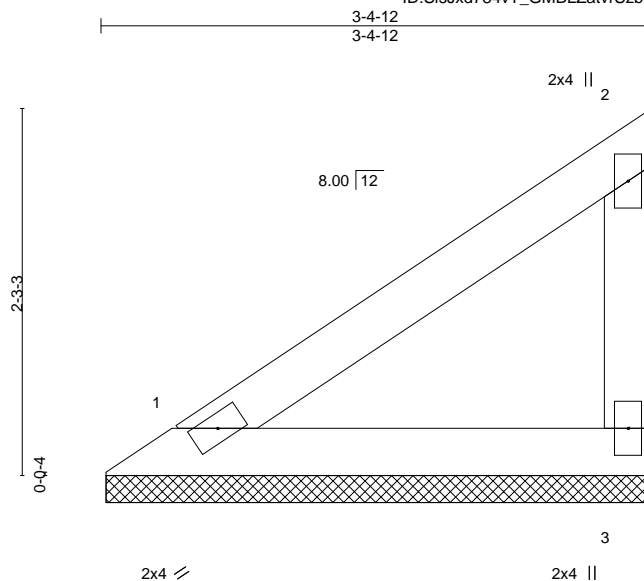

Scale = 1:14.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.14	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 10 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-4-12 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=3-4-6, 3=3-4-6  
Max Horz 1=74(LC 9)  
Max Uplift 1=15(LC 12), 3=-41(LC 12)  
Max Grav 1=125(LC 1), 3=134(LC 19)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**  
**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2765833	Truss V15	Truss Type Valley	Qty 2	Ply 1	Summit/#8 Osage 145804394
----------------	--------------	----------------------	----------	----------	------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:44 2021 Page 1

ID:SlSjXd784vT\_GMBLZatvrSzbhoN-4d4uQdPon\_bSy7z?Ehs0HcrrS6tXWM0wWTedotzNtdr

Job Reference (optional)

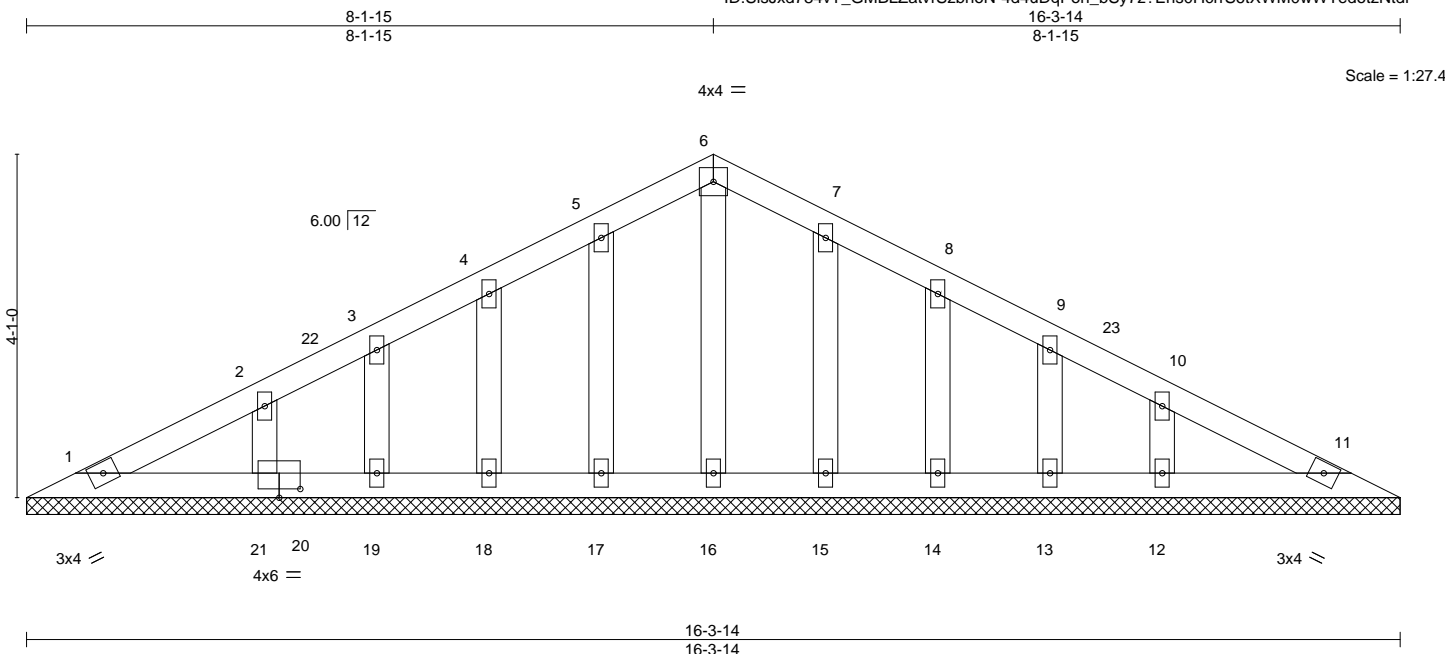


Plate Offsets (X,Y)--		[20:0-3-0,0-1-4]											
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL 1.15		TC	0.05	Vert(LL)	n/a	-	n/a	999	MT20	197/144	
TCDL	10.0	Lumber DOL 1.15		BC	0.03	Vert(CT)	n/a	-	n/a	999			
BCLL	0.0	Rep Stress Incr YES		WB	0.03	Horz(CT)	0.00	11	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S							Weight: 59 lb	FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 16-3-14.  
(lb) - Max Horz 1=66(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 17, 18, 19, 21, 15, 14, 13, 12  
Max Grav All reactions 250 lb or less at joint(s) 1, 11, 16, 17, 18, 19, 21, 15, 14, 13, 12

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-7-7 to 3-7-7, Exterior(2N) 3-7-7 to 8-1-15, Corner(3R) 8-1-15 to 11-1-15, Exterior(2N) 11-1-15 to 15-8-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable studs spaced at 1-4-0 oc.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 17, 18, 19, 21, 15, 14, 13, 12.
- 8) Non Standard bearing condition. Review required.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/#8 Osage	I45804395
2765833	V16	Valley	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:45 2021 Page 1

ID:SlSjxd784vT\_GMBLZatvrSzbhoN-YpeHQAQQYHjIIZHYBoONFpqNwpWA8Fps3I7NBKJzNtdq

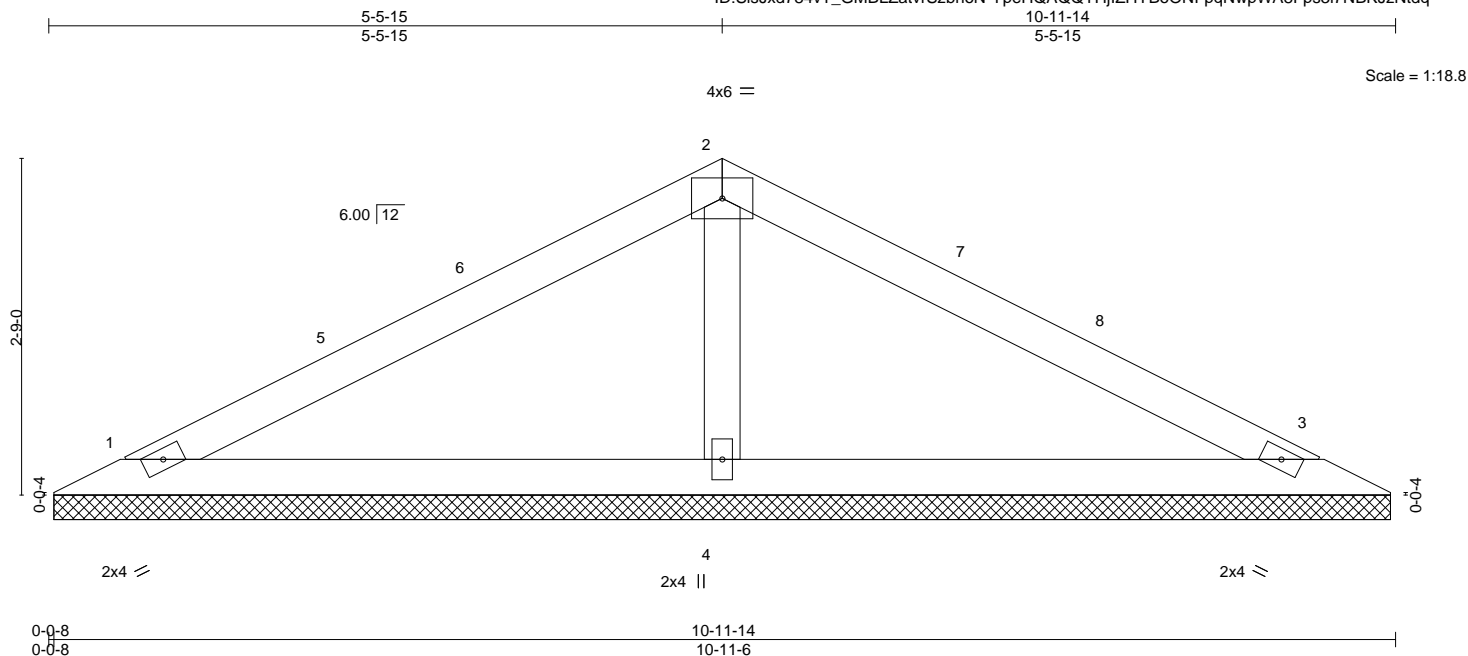

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.20	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 27 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=10-10-14, 3=10-10-14, 4=10-10-14  
Max Horz 1=43(LC 12)  
Max Uplift 1=47(LC 12), 3=55(LC 13), 4=51(LC 12)  
Max Grav 1=202(LC 25), 3=202(LC 26), 4=477(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-4=-330/192

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 5-5-15, Exterior(2R) 5-5-15 to 8-5-15, Interior(1) 8-5-15 to 10-4-5 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2765833	Truss V17	Truss Type Valley	Qty 2	Ply 1	Summit/#8 Osage 145804396
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					

8.430 s Mar 22 2021 MiTek Industries, Inc. Fri Apr 23 09:17:45 2021 Page 1  
ID:SlSjxd784vT\_GMBLZatvrSzbhoN-YpeHQAQQYHjZHYBoONFpqN\_KWA?Fpf3I7NBKJzNtdq



3x6 =

Scale = 1:11.6

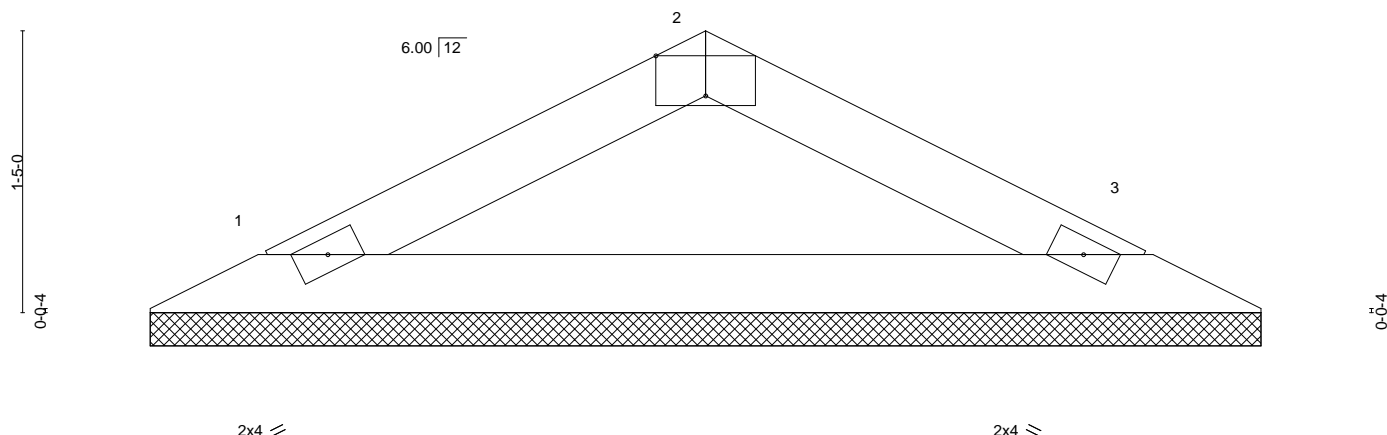

0-0-8		5-7-14							
0-0-8		5-7-6							
Plate Offsets (X,Y)-- [2:0-3-0,Edge]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.11	Vert(LL) n/a - n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.21	Vert(CT) n/a - n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.00	Horz(CT) 0.00 3 n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-P				Weight: 12 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-7-14 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=5-6-14, 3=5-6-14  
Max Horz 1=19(LC 16)  
Max Uplift 1=33(LC 12), 3=33(LC 13)  
Max Grav 1=198(LC 1), 3=198(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



April 23, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**


**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

# Symbols

## PLATE LOCATION AND ORIENTATION

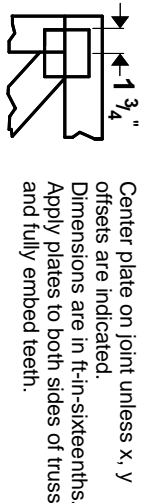

0- $\frac{1}{16}$ "

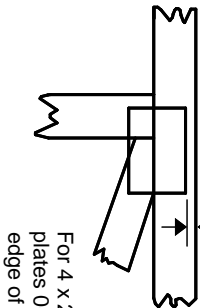

For 4 x 2 orientation, locate plates 0- $\frac{1}{16}$ " from outside edge of truss.

—  
—  
This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in **MiTek 20/20** software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

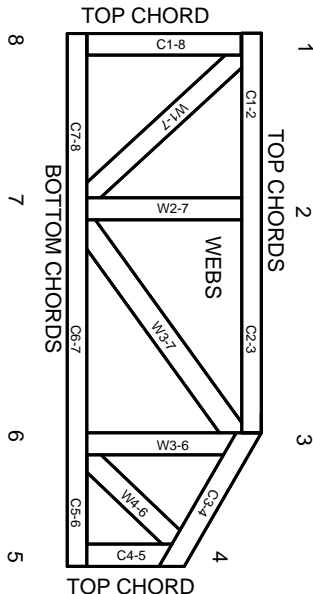

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

## PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.