



MiTek USA, Inc.  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017  
314-434-1200

Re: 2809580  
Summit/102 Hawthorne

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Valley Center).

Pages or sheets covered by this seal: I46313613 thru I46313695

My license renewal date for the state of Missouri is December 31, 2021.

Missouri COA: Engineering 001193



May 27, 2021

Sevier, Scott, Engineer

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313613
2809580	A01	HIP GIRDER	1	3	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:47 2021 Page 1

ID:tnOHGeVPJT41JASwyTKzhfUX-mHTR556dPliHmuKENqMCSZdNM2Ylp5op5vD3NzCZGQ

-0-10-8	3-9-11	7-3-14	11-7-9	15-11-3	20-2-14	24-6-8	29-3-1	33-11-9	38-8-2	42-8-8	46-0-0
0-10-8	3-9-11	3-6-3	4-3-10	4-3-10	4-3-10	4-3-10	4-8-9	4-8-9	4-8-9	4-0-6	3-3-8

Scale = 1:86.5

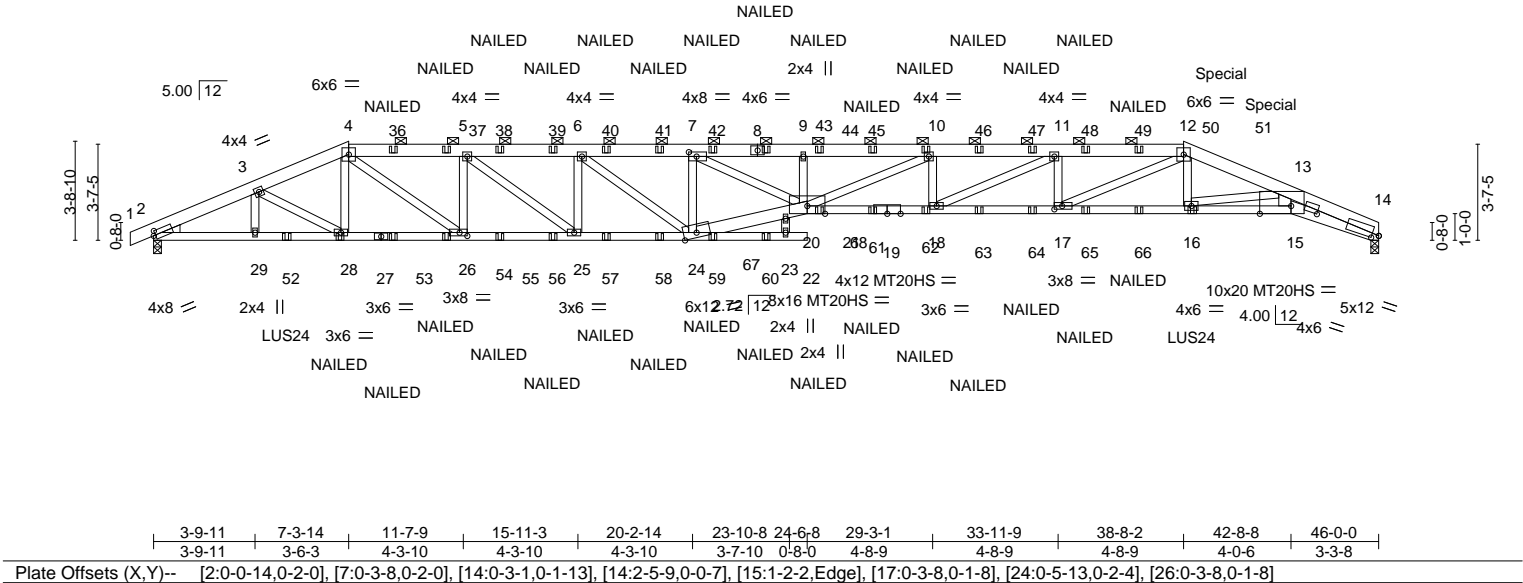

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.75	Vert(LL)	1.04	22	>533	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.88	Vert(CT)	-1.45	22	>380	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	NO	WB 0.56	Horz(CT)	0.39	14	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						Weight: 684 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x6 SPF No.2	TOP CHORD Structural wood sheathing directly applied or 5-6-0 oc purlins, except
BOT CHORD 2x4 SP 2400F 2.0E *Except*	2-0-0 oc purlins (5-6-2 max.): 4-12.
2-27: 2x4 SPF No.2, 14-15,20-24: 2x6 SPF 2100F 1.8E	BOT CHORD Rigid ceiling directly applied or 9-9-4 oc bracing. Except:
22-27: 2x4 SPF 1650F 1.5E	10-0-0 oc bracing: 20-21
WEBS 2x4 SPF No.2 *Except*	
13-15: 2x6 SPF No.2	
WEDGE	
Left: 2x4 SP No.3	

<b>REACTIONS.</b>	(size) 14=0-3-8, 2=0-3-8
	Max Horz 2=58(LC 8)
	Max Uplift 14=2648(LC 9), 2=1209(LC 8)
	Max Grav 14=3704(LC 1), 2=3884(LC 1)

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-7842/2487, 3-4=-8129/2704, 4-5=-10641/3770, 5-6=-12715/4720, 6-7=-13957/5470, 7-9=-20048/8393, 9-10=-20029/8386, 10-11=-18764/8729, 11-12=-15561/8491, 12-13=-11710/8664, 13-14=-16706/12514
BOT CHORD	2-29=-2238/6986, 28-29=-2238/6986, 26-28=-2483/7590, 25-26=-3697/10639, 24-25=-4649/12715, 18-20=-8657/18764, 17-18=-8413/15560, 16-17=-7931/10869, 15-16=-10651/14075, 14-15=-11654/15567, 21-24=-5535/14306, 20-21=-5506/14248
WEBS	3-28=-345/852, 4-26=-1529/3884, 5-26=-2115/920, 5-25=-1194/2642, 6-25=-1375/723, 6-24=-953/1598, 7-24=-3827/1773, 10-20=0/1445, 10-18=-1274/117, 11-18=-270/3584, 11-17=-2055/257, 12-17=-540/5265, 12-16=-575/1174, 13-16=-3195/2795, 13-15=-2480/3638, 9-20=-290/108, 7-20=-3292/6862

<b>NOTES-</b>	
1) 3-ply truss to be connected together with 10d (0.131"x3") nails as follows:	
Top chords connected as follows: 2x6 - 3 rows staggered at 0-4-0 oc.	
Bottom chords connected as follows: 2x4 - 1 row at 0-5-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.	
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.	
2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.	
3) Unbalanced roof live loads have been considered for this design.	
4) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60	
5) Provide adequate drainage to prevent water ponding.	
6) All plates are MT20 plates unless otherwise indicated.	
7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.	

Continued on page 2



May 27, 2021

<p><b>WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.</b></p> <p>Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see</p> <p><b>Safety Information</b> available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601</p>	<p><b>ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component</b></p> <p><b>MiTek</b></p> <p>16023 Swingley Ridge Rd Chesterfield, MO 63017</p>
--	---

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	I46313613
2809580	A01	HIP GIRDER	1	3	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:47 2021 Page 2

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-mHTR556dPliHmuKENqMCSZdNM2Ylqp5op5vD3NzCZGQ

**NOTES-**

- 8) Bearing at joint(s) 14 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=2648, 2=1209.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 11) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 12) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent at 5-0-0 from the left end to connect truss(es) to front face of bottom chord.
- 13) Use Simpson Strong-Tie LUS24 (4-10d Girder, 2-10d Truss, Single Ply Girder) or equivalent at 39-0-0 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
- 14) Fill all nail holes where hanger is in contact with lumber.
- 15) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 16) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 34 lb down and 1996 lb up at 39-0-0, and 287 lb down and 367 lb up at 41-0-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

**LOAD CASE(S)** Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-4=-70, 4-12=-70, 12-14=-70, 24-33=-20, 22-24=-20, 15-20=-20, 15-30=-20, 20-21=-20

Concentrated Loads (lb)

Vert: 28=-79(F) 10=-89(F) 18=-72(F) 16=-165(F) 36=-81(F) 37=-81(F) 38=-81(F) 39=-81(F) 40=-81(F) 41=-81(F) 42=-81(F) 43=-81(F) 44=-89(F) 45=-89(F) 46=-89(F) 47=-89(F) 48=-89(F) 49=-89(F) 50=-0(F) 51=-237(F) 52=-467(F) 53=-80(F) 54=-80(F) 55=-80(F) 56=-80(F) 57=-80(F) 58=-80(F) 59=-80(F) 60=-80(F) 61=-72(F) 62=-72(F) 63=-72(F) 64=-72(F) 65=-72(F) 66=-72(F)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**  
**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:48 2021 Page 1  
ID:tinOHGeVPJTvi41JASwyTKzhfUX-ET1pJR6FA3g8O2vRxXtR nAUXStvZE7v2lfnbqzCZGP

Scale = 1:85.7

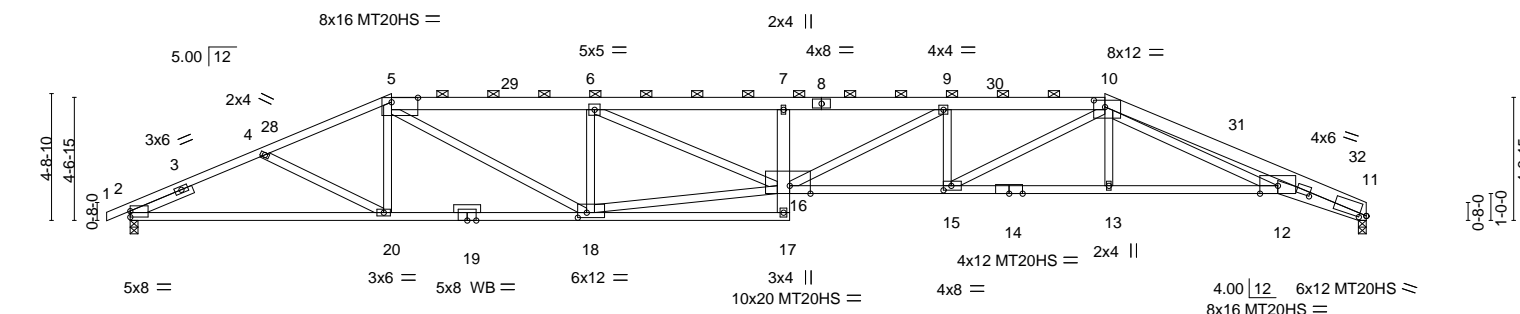

	9-8-11	17-1-10	24-6-8	30-4-14	36-3-5	39-7-10	42-8-8	46-0-0
	9-8-11	7-4-14	7-4-14	5-10-6	5-10-6	3-4-6	3-0-14	3-3-8
Plate Offsets (X,Y)--	[2:0-0-0-2-11],	[5:0-11-12-0-2-0],	[10:0-5-0-0-3-0-3],	[11:0-3-1,0-1-9],	[11:2-3-1,0-0-3],	[15:0-3-8-0-2-0],	[16:0-9-4,Edge],	[18:0-4-0-0-2-4]

<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0		Plate Grip DOL 1.15		TC 0.98		Vert(LL) -0.79 16 >701 240		MT20	197/144
TCDL 10.0		Lumber DOL 1.15		BC 0.95		Vert(CT) -1.42 15-16 >388 180		MT20HS	148/108
BCLL 0.0		Rep Stress Incr YES		WB 0.70		Horz(CT) 0.47 11 n/a n/a			
BCDL 10.0		Code IRC2018/TPI2014		Matrix-AS				Weight: 231 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x6 SPF No.2 *Except*	TOP CHORD	Structural wood sheathing directly applied, except 2-0-0 oc purlins (2-2-0 max.): 5-10. Rigid ceiling directly applied.
	1-5: 2x4 SPF No.2, 10-11: 2x6 SP 2400F 2.0E		
BOT CHORD	2x4 SP 2400F 2.0E *Except*	BOT CHORD	
	2-19: 2x4 SPF 1650F 1.5E, 11-12: 2x6 SP 2400F 2.0E		
	17-19: 2x4 SPF No.2		
WEBS	2x4 SPF No.2 *Except*		
	7-17: 2x6 SP 2400F 2.0E, 16-18,10-12: 2x4 SPF 1650F 1.5E		
OTHERS	2x4 SPF No.2		
SLIDER	Left 2x4 SPF No.2 -t 2-6-0		

**REACTIONS.** (size) 11=0-3-8, 2=0-3-8  
 Max Horz 2=74(LC 16)  
 Max Uplift 11=-272(LC 9), 2=-296(LC 8)  
 Max Grav 11=2067(LC 1), 2=2130(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD	2-4=-4093/611, 4-5=-4019/622, 5-6=-5350/900, 6-7=-7096/1185, 7-9=-7403/1227, 9-10=-6661/1086, 10-11=-8298/1160
BOT CHORD	2-20=-513/3685, 18-20=-501/3699, 17-18=-166/1101, 15-16=-982/6659, 13-15=-685/5036, 12-13=-683/5046, 11-12=-1023/7797
WEBS	16-17=-13/304, 7-16=-433/155, 4-20=-13/267, 5-20=0/270, 5-18=-361/2021, 6-18=-1402/336, 16-18=-653/4332, 6-16=-309/1879, 9-16=-172/940, 9-15=-883/232, 10-15=-352/2018, 10-13=0/321, 10-12=-358/2953

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 9-8-11, Exterior(2R) 9-8-11 to 13-11-10, Interior(1) 13-11-10 to 36-3-5, Exterior(2R) 36-3-5 to 40-6-3, Interior(1) 40-6-3 to 46-0-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=272, 2=296.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

Continued on page 2



May 27, 2021



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f, 701f, 702f, 703f, 704f, 705f, 706f, 707f,**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	I46313614
2809580	A02	HIP	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:48 2021 Page 2  
ID:tjnOHGeVPJTyi41JASwyTKzhfUX-ET1pJR6FA3q8O2vRxXtR\_nAUXStvZE7y2lfnbqzCZGP

NOTES-

- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313615
2809580	A03	HIP	1	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:50 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-As8ak78Wig4sdM3p2yvv3CFu6FY1032FV38ugizCZGN

-0-10-8	6-2-8	12-1-8	18-4-0	24-6-8	29-0-12	33-10-8	38-3-8	42-8-8	46-0-0
0-10-8	6-2-8	5-11-0	6-2-8	6-2-8	4-6-4	4-9-12	4-5-0	4-5-0	3-3-8

Scale = 1:85.9

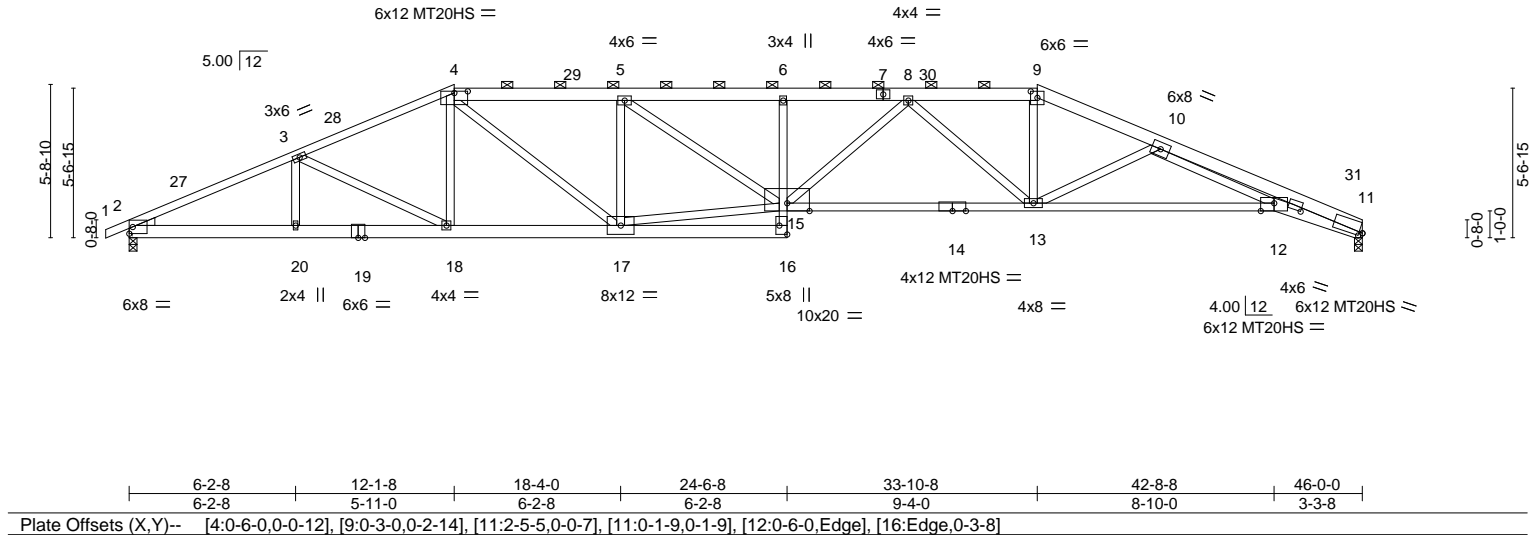

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.72	Vert(LL)	-0.59 13-15	>933	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.90	Vert(CT)	-1.16 13-15	>476	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 1.00	Horz(CT)	0.40 11	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 236 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x6 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied, except
1-4: 2x4 SPF No.2, 9-11: 2x6 SPF 2100F 1.8E	2-0-0 oc purlins (2-9-9 max.): 4-9.
BOT CHORD 2x4 SPF No.2 *Except*	BOT CHORD Rigid ceiling directly applied.
2-19: 2x6 SPF 2100F 1.8E, 14-15: 2x4 SPF 1650F 1.5E	
11-12: 2x6 SP 2400F 2.0E, 16-19: 2x6 SPF No.2	
12-14: 2x4 SP 2400F 2.0E	
WEBS 2x4 SPF No.2	
WEDGE	
Left: 2x4 SP No.3	

<b>REACTIONS.</b>	(size) 11=0-3-8, 2=0-3-8
	Max Horz 2=89(LC 16)
	Max Uplift 11=245(LC 9), 2=269(LC 8)
	Max Grav 11=2069(LC 1), 2=2132(LC 1)

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-3=-4222/541, 3-4=-3930/579, 4-5=-4474/715, 5-6=-5608/866, 6-8=-5669/870, 8-9=-4454/645, 9-10=-4810/675, 10-11=-8683/1038
BOT CHORD	2-20=-457/3812, 18-20=-457/3812, 17-18=-432/3563, 16-17=-93/486, 6-15=-373/128, 13-15=-695/5250, 12-13=-665/5406, 11-12=-919/8173
WEBS	3-18=-288/167, 4-18=-29/380, 4-17=-224/1332, 5-17=-1355/288, 15-17=-511/4057, 5-15=-189/1375, 8-15=-73/681, 8-13=-1199/254, 9-13=-164/1495, 10-13=-1133/250, 10-12=-272/3032

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 12-1-8, Exterior(2R) 12-1-8 to 16-4-7, Interior(1) 16-4-7 to 33-10-8, Exterior(2R) 33-10-8 to 38-4-15, Interior(1) 38-4-15 to 46-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=245, 2=269.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

Continued on page 2



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	I46313615
2809580	A03	HIP	1	1	Job Reference (optional)	

- NOTES-**
- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313616
2809580	A04	Hip	1	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:51 2021 Page 1

ID: tjnOHGeVPJTy41JASwyTKzhfUX-e2iyxT98T\_CjFVd?cgQ8cPo1TftjWUOKjRC9zCZGM

-0-10-8	7-4-14	14-6-5	19-6-6	24-6-8	31-5-11	37-1-2	42-8-8	46-0-0
0-10-8	7-4-14	7-1-6	5-0-2	5-0-2	6-11-3	5-7-6	5-7-6	3-3-8

Scale = 1:90.4

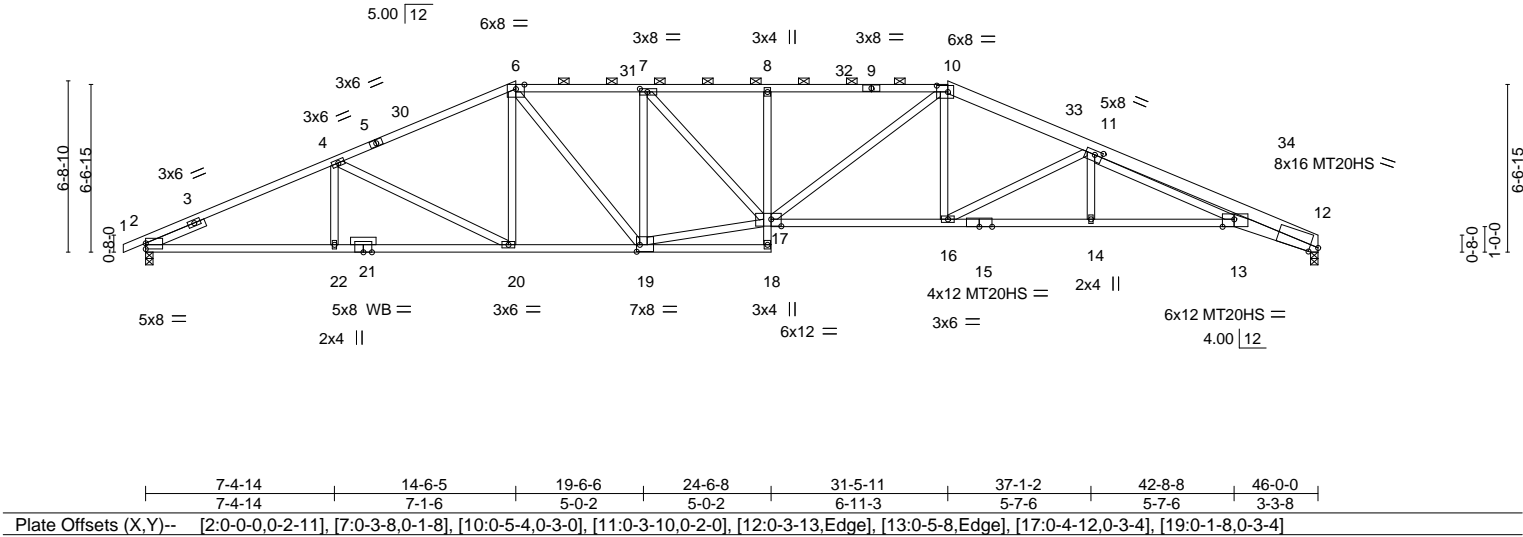

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.87	Vert(LL)	-0.56 16-17	>988	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 1.00	Vert(CT)	-1.05 16-17	>526	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.98	Horz(CT)	0.43 12	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 216 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF 1650F 1.5E *Except* 10-12: 2x6 SPF 2100F 1.8E	TOP CHORD Structural wood sheathing directly applied, except 2-0-0 oc purlins (2-4-15 max.): 6-10.
BOT CHORD 2x4 SPF 1650F 1.5E *Except* 8-18,18-21: 2x4 SPF No.2, 12-13: 2x6 SPF 2100F 1.8E 13-15: 2x4 SP 2400F 2.0E	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	
OTHERS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 -t 2-6-0	

<b>REACTIONS.</b>	(size) 12=0-3-8, 2=0-3-8 Max Horz 2=105(LC 16) Max Uplift 12=219(LC 9), 2=242(LC 8) Max Grav 12=2069(LC 1), 2=2132(LC 1)
-------------------	---

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-4=-4145/488, 4-6=-3645/503, 6-7=-3710/563, 7-8=-4493/655, 8-10=-4534/662, 10-11=-4324/581, 11-12=-8289/924
BOT CHORD	2-22=-398/3743, 20-22=-398/3743, 19-20=-341/3284, 8-17=-448/157, 16-17=-398/3943, 14-16=-531/5140, 13-14=-531/5140, 12-13=-803/7773
WEBS	4-20=-531/213, 6-20=-43/412, 6-19=-136/859, 7-19=-1224/225, 17-19=-383/3573, 7-17=-142/1154, 10-17=-150/932, 10-16=-65/762, 11-16=-1372/266, 11-14=0/286, 11-13=-316/2847

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 14-6-5, Exterior(2R) 14-6-5 to 18-9-3, Interior(1) 18-9-3 to 31-5-11, Exterior(2R) 31-5-11 to 35-8-10, Interior(1) 35-8-10 to 46-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Provide adequate drainage to prevent water ponding.
  - 4) All plates are MT20 plates unless otherwise indicated.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 12=219, 2=242.
  - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheathing be applied directly to the bottom chord.



May 27, 2021



Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	I46313616
2809580	A04	Hip	1	1	Job Reference (optional)	

NOTES-

10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313617
2809580	A05	Hip	1	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:53 2021 Page 1

ID:tnOHGeVPJTy41JASwyTKzhfUX-aRqiM9AO?bSRUpnOk5TchqtNOTa\_DUphB1MYG1zCZGK

-0-10-8	5-10-1	11-4-9	16-11-2	24-6-8	29-0-14	35-10-11	42-8-8	46-0-0
0-10-8	5-10-1	5-6-9	5-6-9	7-7-6	4-6-6	6-9-13	6-9-13	3-3-8

Scale = 1:87.5

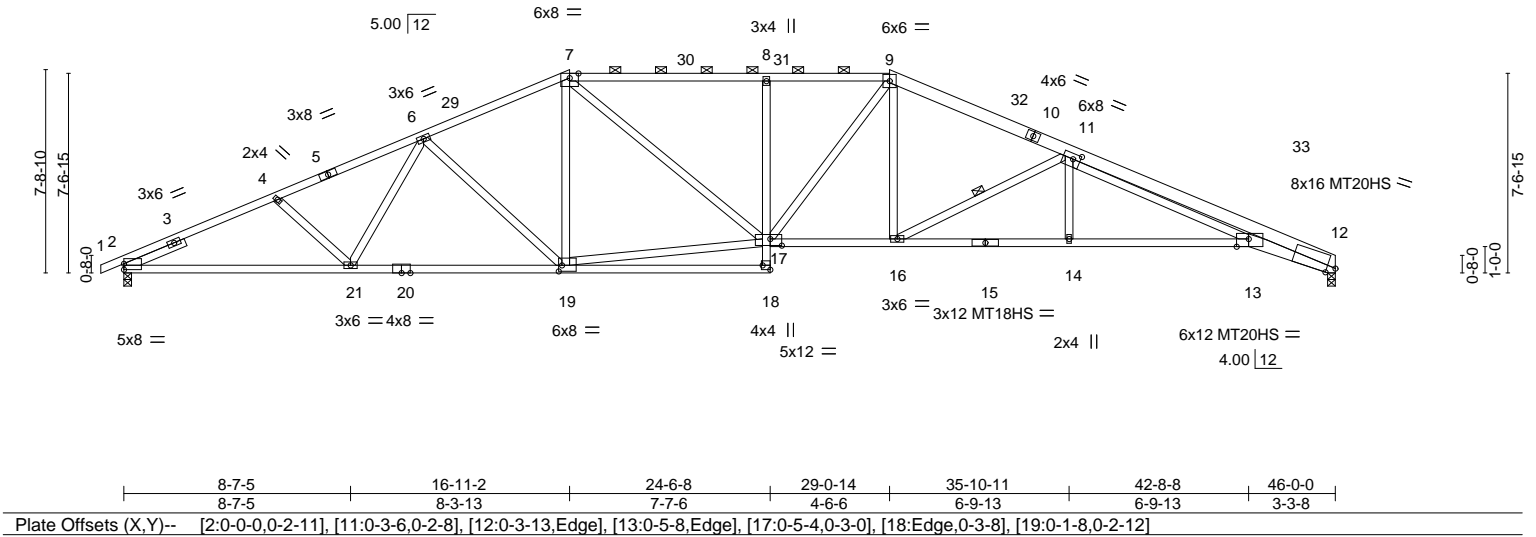

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.85	Vert(LL) -0.52 16-17 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.95	Vert(CT) -0.97 13-14 >571 180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr YES	WB 0.74	Horz(CT) 0.43 12 n/a n/a	MT18HS	197/144
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS		Weight: 220 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF 1650F 1.5E *Except*	TOP CHORD Structural wood sheathing directly applied, except
5-7: 2x4 SPF No.2, 9-10: 2x6 SPF No.2, 10-12: 2x6 SPF 2100F 1.8E	2-0-0 oc purlins (2-2-0 max.): 7-9.
BOT CHORD 2x4 SPF No.2 *Except*	BOT CHORD Rigid ceiling directly applied.
2-20,15-17: 2x4 SPF 1650F 1.5E, 12-13: 2x6 SPF 2100F 1.8E	WEBS 1 Row at midpt 11-16
13-15: 2x4 SP 2400F 2.0E	
WEBS 2x4 SPF No.2	
SLIDER Left 2x4 SPF No.2 -t 2-6-0	

<b>REACTIONS.</b>	(size) 2=0-3-8, 12=0-3-8
	Max Horz 2=121(LC 16)
	Max Uplift 2=236(LC 12), 12=219(LC 13)
	Max Grav 2=2132(LC 1), 12=2069(LC 1)

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	2-4=-4140/482, 4-6=-3963/473, 6-7=-3388/458, 7-8=-3800/522, 8-9=-3801/519, 9-11=-3964/501, 11-12=-8204/917
BOT CHORD	2-21=-454/3734, 19-21=-333/3494, 8-17=-516/175, 16-17=-279/3536, 14-16=-470/4888, 13-14=-470/4888, 12-13=-780/7691
WEBS	6-21=-36/330, 6-19=-603/212, 7-19=-54/334, 17-19=-266/2857, 7-17=-138/1087, 9-17=-104/646, 9-16=-91/820, 11-16=-1504/309, 11-14=0/342, 11-13=-375/3010

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 16-11-2, Exterior(2R) 16-11-2 to 21-2-0, Interior(1) 21-2-0 to 29-0-14, Exterior(2R) 29-0-14 to 33-3-13, Interior(1) 33-3-13 to 46-0-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=236, 12=219.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313618
2809580	B01	Hip	1	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:54 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-3dO5ZVB0mval6zMaHo\_rE2QZJtxgyvkqQh65pTzCZGJ

5-9-11	11-3-14	18-8-2	24-0-4	29-4-6	34-8-8	38-0-0	38-10-8
5-9-11	5-6-3	7-4-3	5-4-2	5-4-2	5-4-2	3-3-8	0-10-8

Scale = 1:67.4

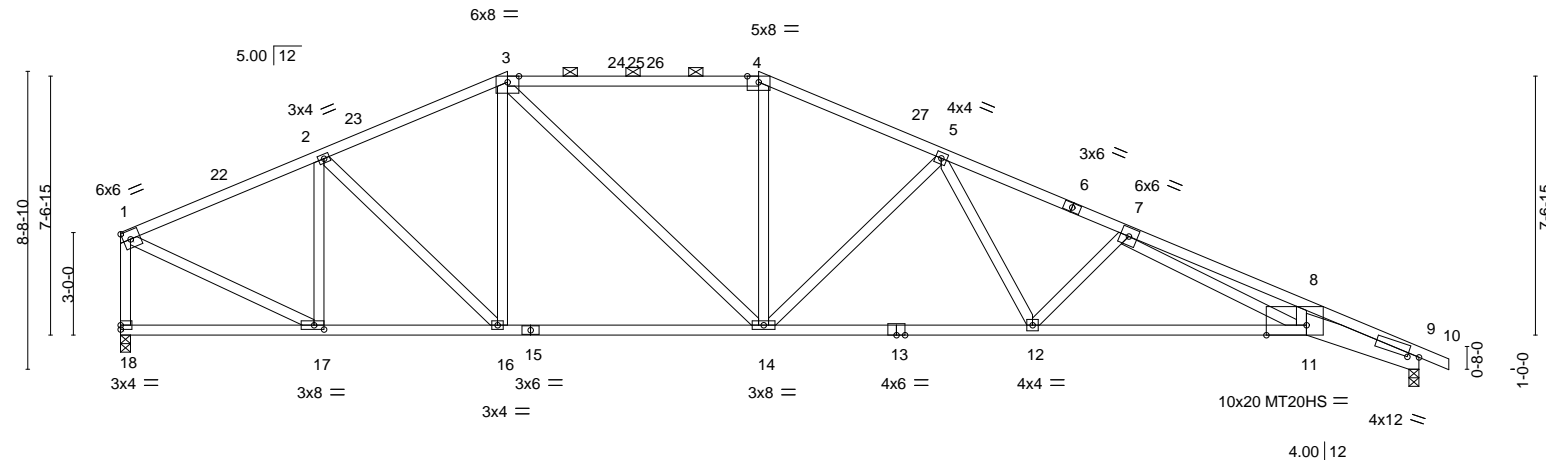

5-9-11	11-3-14	18-8-2	26-8-5	34-8-8	38-0-0
5-9-11	5-6-3	7-4-3	8-0-3	8-0-3	3-3-8

Plate Offsets (X,Y)-- [9:0-3-15,0-1-2], [11:1-2-2,Edge], [17:0-3-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.77	Vert(LL)	-0.38 11-12	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.86	Vert(CT)	-0.76 11-12	>600	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.89	Horz(CT)	0.23 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 179 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2 *Except*	TOP CHORD Structural wood sheathing directly applied, except end verticals, and
3-4: 2x4 SPF 1650F 1.5E, 6-10: 2x4 SP 2400F 2.0E	2-0-0 oc purlins (3-3-3 max.): 3-4.
BOT CHORD 2x4 SPF 1650F 1.5E *Except*	BOT CHORD Rigid ceiling directly applied.
9-11: 2x8 SP 2400F 2.0E, 13-15: 2x4 SPF No.2	
WEBS 2x4 SPF No.2	

REACTIONS.	(size)	18=0-3-8, 9=0-3-8
Max Horz	18=159(LC 13)	
Max Uplift	18=190(LC 12), 9=267(LC 13)	
Max Grav	18=1703(LC 1), 9=1765(LC 1)	

FORCES.	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-2=-1852/261, 2-3=-2079/324, 3-4=-2239/383, 4-5=-2487/382, 5-7=-3694/545, 7-8=-6876/1015, 8-9=-7088/957, 1-18=-1642/226
BOT CHORD	16-17=-140/1644, 14-16=-94/1863, 12-14=-251/2911, 11-12=-469/3916, 9-11=-838/6570
WEBS	3-14=-157/652, 4-14=-11/472, 5-14=-937/243, 5-12=-121/918, 7-12=-851/237, 7-11=-414/2774, 8-11=0/357, 2-16=-38/434, 2-17=-675/136, 1-17=-197/1764

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 11-3-14, Exterior(2R) 11-3-14 to 15-6-13, Interior(1) 15-6-13 to 18-8-2, Exterior(2R) 18-8-2 to 22-11-0, Interior(1) 22-11-0 to 38-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=190, 9=267.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313619
2809580	B02	Hip	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:56 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-?0Vr\_ADGHWq0LHWzPD0JJTVbge6QpH7t\_bCtMzCZGH

7-0-2	13-8-11	16-3-5	22-11-15	28-10-3	34-8-8	38-0-0	38-10-8
7-0-2	6-8-10	2-6-10	6-8-10	5-10-5	5-10-5	3-3-8	0-10-8

Scale = 1:67.5

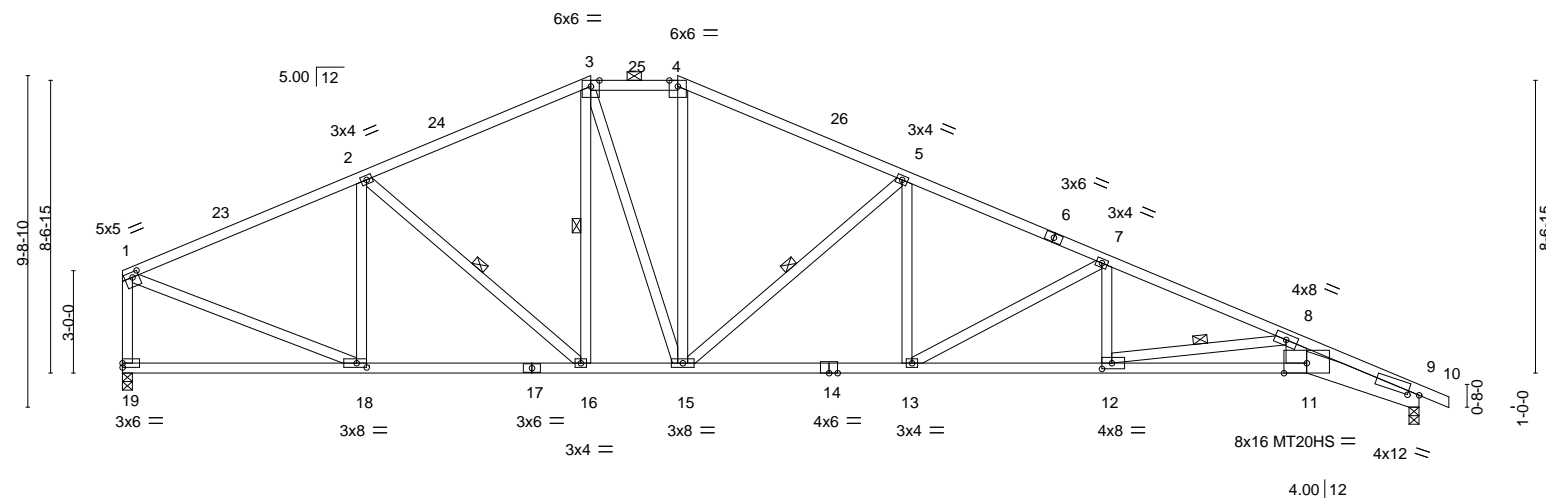


Plate Offsets (X, Y)--	[1:0-2-4,0-1-12], [9:0-3-15,0-1-2], [12:0-3-8,0-2-0], [18:0-3-8,0-1-8]
------------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.79	Vert(LL)	-0.33 11-12	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.73	Vert(CT)	-0.62 11-12	>734	180	MT20HS	187/143
BCLL 0.0	Rep Stress Incr	YES	WB 0.88	Horz(CT)	0.22 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 192 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2 \*Except\*  
 9-11: 2x8 SP 2400F 2.0E, 11-14: 2x4 SP 2400F 2.0E  
 WEBS 2x4 SPF No.2 \*Except\*  
 8-11: 2x8 SP 2400F 2.0E

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-11-10 max.): 3-4.  
 BOT CHORD Rigid ceiling directly applied.  
 WEBS 1 Row at midpt 2-16, 3-16, 5-15, 8-12

#### REACTIONS.

(size) 19=0-3-8, 9=0-3-8  
 Max Horz 19=-175(LC 13)  
 Max Uplift 19=-187(LC 12), 9=-264(LC 13)  
 Max Grav 19=1703(LC 1), 9=1765(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-2004/271, 2-3=-2039/325, 3-4=-1917/341, 4-5=-2173/339, 5-7=-3107/448,  
 7-8=-4170/580, 8-9=-7139/978, 1-19=-1635/225  
 BOT CHORD 16-18=-157/1774, 15-16=-67/1795, 13-15=-207/2798, 12-13=-419/3812, 11-12=-814/6064,  
 9-11=-869/6682  
 WEBS 2-18=-543/139, 3-15=-143/562, 4-15=-55/464, 5-15=-1147/272, 5-13=-57/667,  
 7-13=-1154/241, 7-12=-22/526, 8-12=-2279/400, 8-11=-123/1457, 1-18=-195/1831

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 13-8-11, Exterior(2E) 13-8-11 to 16-3-5, Exterior(2R) 16-3-5 to 20-6-3, Interior(1) 20-6-3 to 38-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 19=187, 9=264.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313620
2809580	B03	Roof Special	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:57 2021 Page 1

ID:tnOHGeVPJTy41JASwyTKzhfUX-TC3DCWDv2qytzQ59zwXYsg1504xc9KeH6eLIPOzCZGG

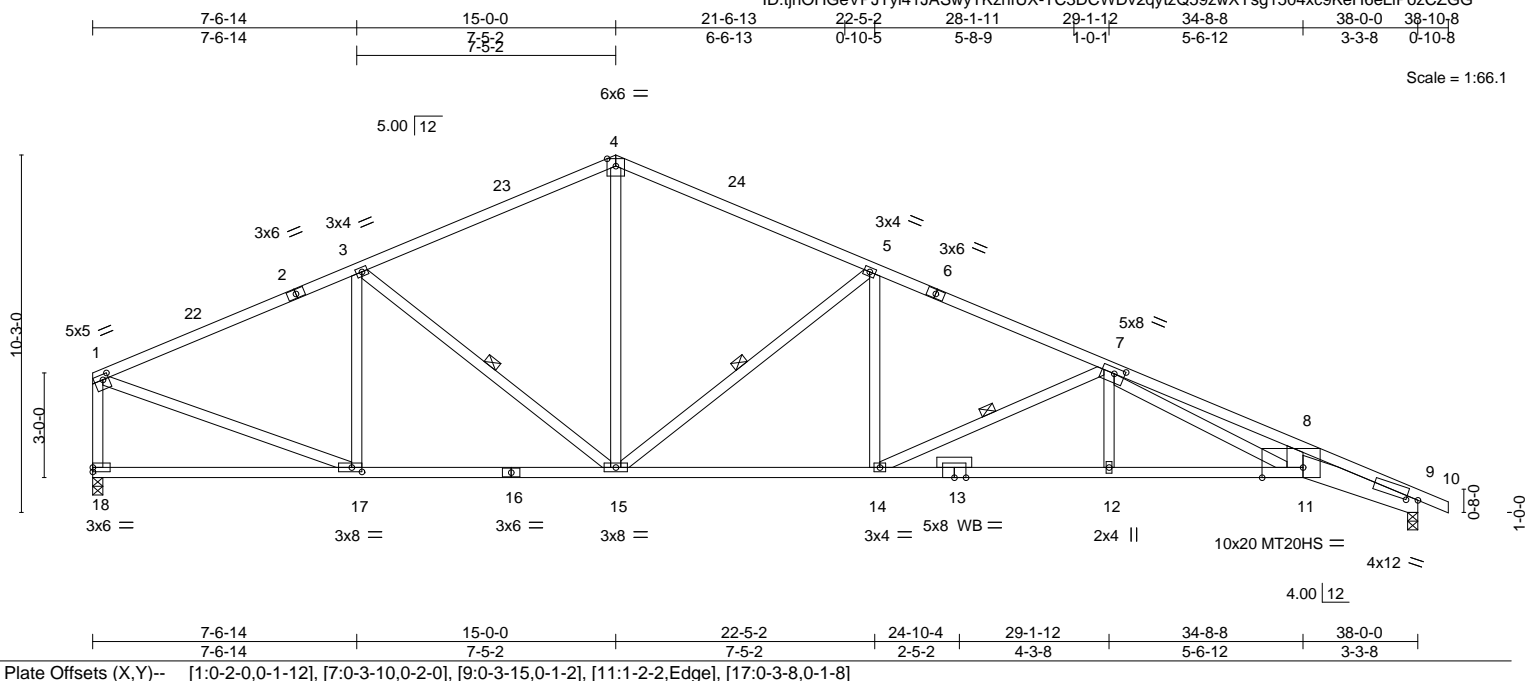

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.74	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.91	Vert(LL) -0.35 11-12 >999 240	MT20HS	148/108
BCLL 0.0	Lumber DOL 1.15	WB 0.62	Vert(CT) -0.64 11-12 >705 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.22 9 n/a n/a		
	Code IRC2018/TPI2014			Weight: 183 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
6-10: 2x4 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
9-11: 2x8 SP 2400F 2.0E, 11-13: 2x4 SP 2400F 2.0E  
WEBS 2x4 SPF No.2 \*Except\*  
8-11: 2x6 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 3-15, 5-15, 7-14

#### REACTIONS.

(size) 18=0-3-8, 9=0-3-8  
Max Horz 18=184(LC 13)  
Max Uplift 18=185(LC 12), 9=262(LC 13)  
Max Grav 18=1703(LC 1), 9=1765(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-3=-2054/272, 3-4=-2007/322, 1-18=-1629/227, 4-5=-2003/329, 5-7=-3042/431,  
7-8=-6654/997, 8-9=-6826/921  
BOT CHORD 15-17=-164/1814, 14-15=-187/2725, 12-14=-431/3910, 11-12=-431/3912, 9-11=-806/6332  
WEBS 3-17=-494/136, 3-15=-270/163, 4-15=-109/969, 8-11=0/277, 1-17=-193/1840,  
5-14=-49/669, 5-15=-1236/300, 7-12=0/309, 7-14=-1304/268, 7-11=-433/2527

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 15-0-0, Exterior(2R) 15-0-0 to 18-0-0, Interior(1) 18-0-0 to 38-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) All plates are MT20 plates unless otherwise indicated.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=185, 9=262.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2809580	Truss C01	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	146313621
----------------	--------------	----------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:27:59 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-PbB\_cCF9aRCaCkFY4La0x57STudpdFEZayqsUhzCZGE

5-3-8	6-11-8	11-9-12	12-11-11	18-4-0	25-0-0	28-3-8	29-2-0
5-3-8	1-8-0	4-10-4	1-1-15	5-4-5	6-8-0	3-3-8	0-10-8

Scale = 1:62.0

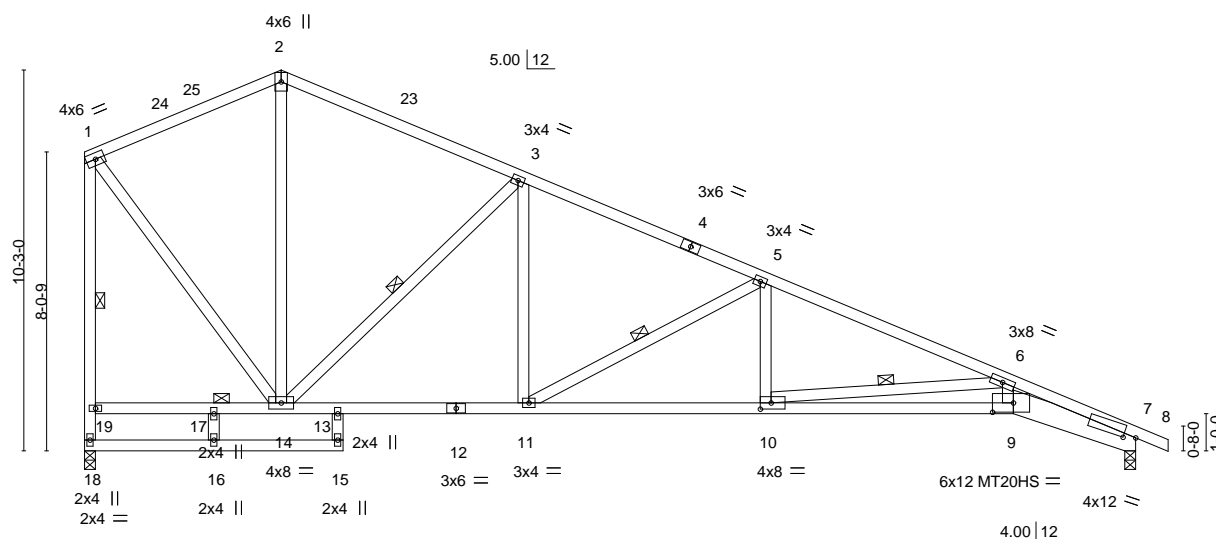


Plate Offsets (X,Y)--	[7:0-3-15,0-1-2], [9:0-6-12,0-3-0], [10:0-3-8,0-2-0]
-----------------------	--

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.62	Vert(LL)	-0.28	9-10	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.93	Vert(CT)	-0.53	9-10	>634	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.49	Horz(CT)	-0.24	18	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 149 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2 \*Except\*  
 7-9: 2x8 SP 2400F 2.0E, 9-12: 2x4 SPF 1650F 1.5E  
 WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied.  
 WEBS 1 Row at midpt 1-18, 3-14, 5-11, 6-10  
 JOINTS 1 Brace at Jt(s): 17

#### REACTIONS.

(size) 7=0-3-8, 18=0-3-8  
 Max Horz 7=-318(LC 13)  
 Max Uplift 7=-189(LC 13), 18=-204(LC 13)  
 Max Grav 7=1329(LC 1), 18=1266(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-766/145, 3-5=-1646/256, 5-6=-2687/420, 6-7=-5191/1032, 1-2=-734/156,  
 18-19=-1236/215, 1-19=-1220/220  
 BOT CHORD 7-9=-1249/4864, 13-14=-325/1448, 11-13=-327/1436, 10-11=-583/2433, 9-10=-1188/4567  
 WEBS 6-9=-206/1074, 1-14=-188/1006, 3-14=-1135/294, 3-11=-81/656, 5-11=-1133/291,  
 5-10=-27/472, 6-10=-2150/610

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 5-3-8, Exterior(2R) 5-3-8 to 8-3-8, Interior(1) 8-3-8 to 29-2-0 zone; cantilever left and right exposed; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=189, 18=204.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313622
2809580	C02	HIP	1	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:00 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-tnlMqYGnLILRupke35FTJfdlHzlMcZjocZQ07zCZGD

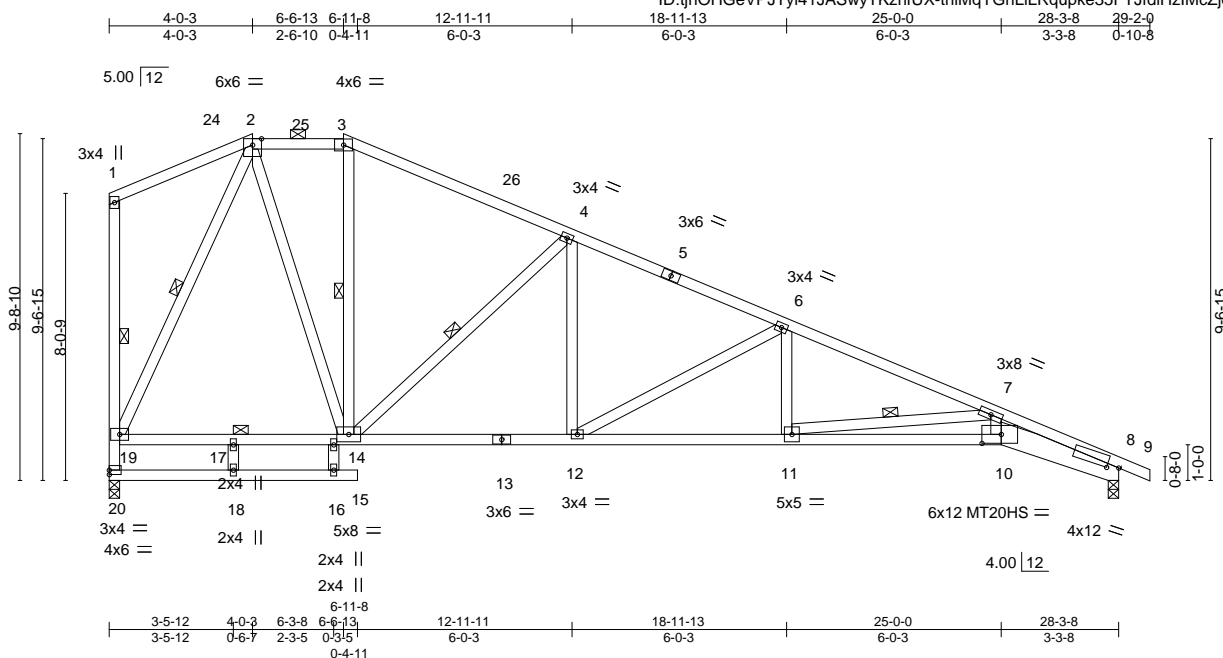

Scale: 3/16"=1'

Plate Offsets (X,Y)--											
[8:0-3-15,0-1-2], [10:0-6-8,0-3-0]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	-0.26 10-11	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.91	Vert(CT)	-0.49 10-11	>694	180	MT20HS	148/108
BCLL	0.0	Rep Stress Incr	YES	WB	0.87	Horz(CT)	0.19 8	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							
										Weight: 156 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2 \*Except\*  
8-10: 2x8 SP 2400F 2.0E, 10-13: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2

**REACTIONS.** (size) 20=0-3-8, 8=0-3-8  
Max Horz 20=-305(LC 10)  
Max Uplift 20=-180(LC 13), 8=-210(LC 13)  
Max Grav 20=1271(LC 1), 8=1330(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-782/210, 3-4=-935/203, 4-6=-1805/286, 6-7=-2793/408, 7-8=-5164/744,  
19-20=-1229/205  
BOT CHORD 17-19=0/494, 14-17=0/494, 12-14=-53/1591, 11-12=-259/2538, 10-11=-630/4532,  
8-10=-652/4832  
WEBS 4-14=-1091/266, 4-12=-59/625, 6-12=-1075/234, 6-11=-5/454, 7-11=-2012/375,  
7-10=-73/1077, 2-19=-1181/202, 2-14=-170/953

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 4-0-3, Exterior(2E) 4-0-3 to 6-6-13, Exterior(2R) 6-6-13 to 10-9-11, Interior(1) 10-9-11 to 29-2-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 20=180, 8=210.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2809580	Truss C03	Truss Type Hip	Qty 1	Ply 1	Summit/102 Hawthorne	146313623
----------------	--------------	-------------------	----------	----------	----------------------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:01 2021 Page 1

ID:tnOHGeVPJTYi41JASwyTKzhfUX-LzJk1uHP62TIR2OwCmcU0WCi1hlc531s1GJzZZzCZGC

1-7-6	6-11-8	8-11-10	14-3-12	19-7-14	25-0-0	28-3-8	29-2-0
1-7-6	5-4-2	2-0-2	5-4-2	5-4-2	5-4-2	3-3-8	0-10-8

5.00 | 12 6x8 =

Scale = 1:56.7

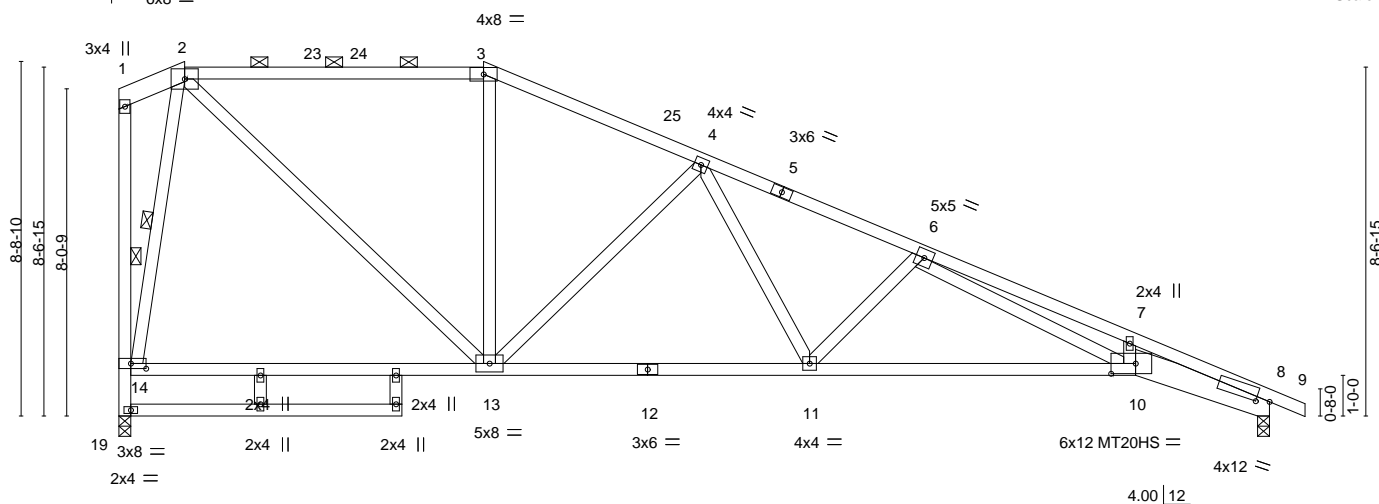

1-7-6	3-5-12	6-11-8	8-11-10	16-11-13	25-0-0	28-3-8
1-7-6	1-10-6	3-5-12	2-0-2	8-0-3	8-0-3	3-3-8

Plate Offsets (X,Y)-- [8:0-3-15,0-1-2], [10:0-7-4,0-3-0], [14:0-4-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 1.00	Vert(LL)	-0.30 10-11	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.90	Vert(CT)	-0.62 10-11	>541	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.85	Horz(CT)	0.21 8	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 148 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
1-2: 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2 \*Except\*  
8-10: 2x8 SP 2400F 2.0E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-11-15 max.): 2-3.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 1-19, 2-14

#### REACTIONS.

(size) 8=0-3-8, 19=0-3-8  
Max Horz 19=-291(LC 13)  
Max Uplift 8=-181(LC 13), 19=-172(LC 9)  
Max Grav 8=1329(LC 1), 19=1266(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1104/149, 3-4=-1253/131, 4-6=-2374/287, 6-7=-5016/643, 7-8=-5127/563,  
14-19=-1266/196  
BOT CHORD 13-14=-26/367, 11-13=-18/1739, 10-11=-216/2630, 8-10=-475/4761  
WEBS 4-13=-899/250, 4-11=-112/823, 6-11=-748/213, 6-10=-307/2267, 2-14=-1292/315,  
2-13=-181/1158

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 1-7-6, Exterior(2R) 1-7-6 to 5-10-5, Interior(1) 5-10-5 to 8-11-10, Exterior(2R) 8-11-10 to 13-2-8, Interior(1) 13-2-8 to 29-2-0 zone; cantilever left and right exposed; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 8, 19 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=181, 19=172.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:02 2021 Page 1  
ID:tinOHGeVPJTvi41JASwvTKzhfUX-a9t6FEH1tMb93Cz7lU7lZkl0Y5lGdWv0Gw2W50zCZGB

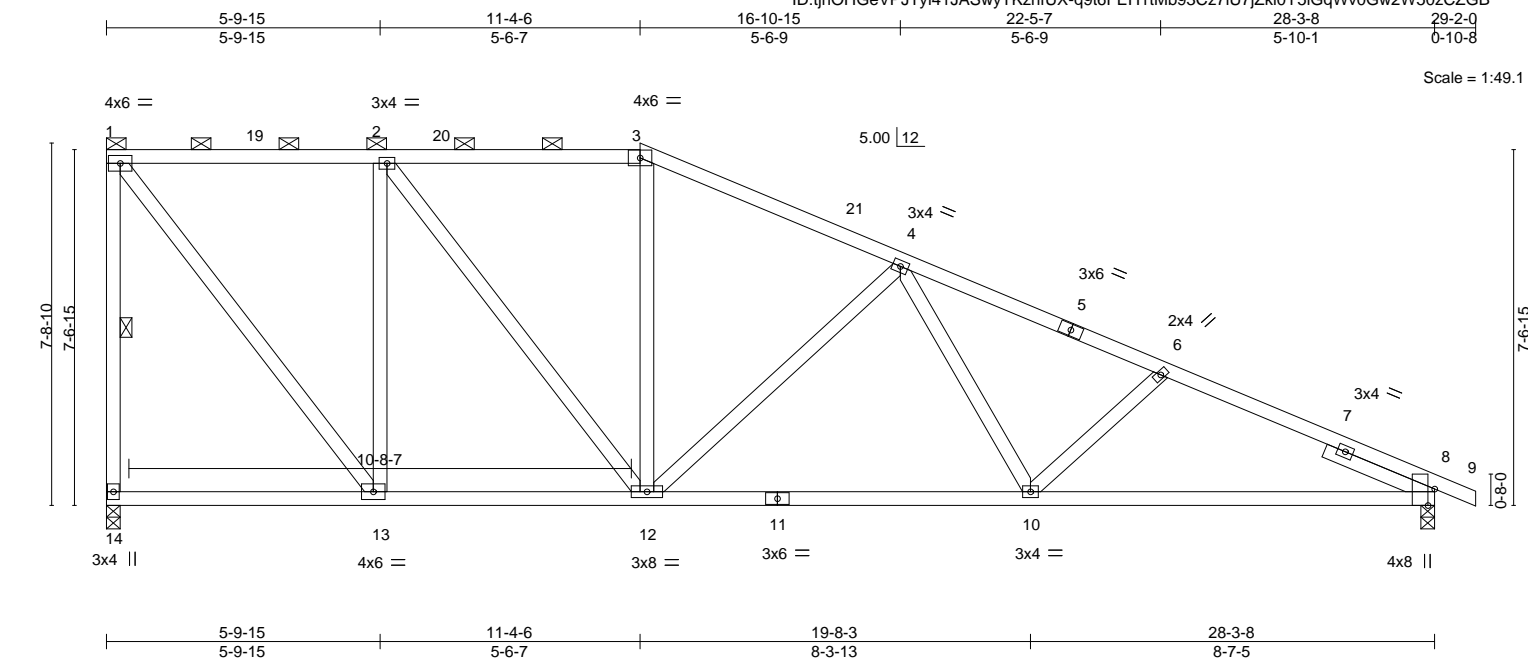


Plate Offsets (X,Y)-- [8:0-4-3,Edge]												
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>	<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.44	Vert(LL)	-0.12	10-12	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.27	10-12	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.87	Horz(CT)	0.06	8	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 133 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals, and
BOT CHORD	2x4 SPF No.2		2-0-0 oc purlins (5-0-3 max.): 1-3.
WEBS	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied.
SLIDER	Right 2x4 SPF No.2 -t 2-6-0	WEBS	1 Row at midpt 1-14

**REACTIONS.** (size) 14=0-3-8, 8=0-3-8  
 Max Horz 14=-287(LC 10)  
 Max Uplift 14=-202(LC 8), 8=-192(LC 13)  
 Max Grav 14=1266(LC 1), 8=1329(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 1-14=-1209/214, 1-2=-824/200, 2-3=-1201/236, 3-4=-1375/234, 4-6=-2123/309,  
6-8=-2335/345

**BOT CHORD** 13-14=-172/276, 12-13=0/824, 10-12=-114/1709, 8-10=-245/2104

**WEBS** 4-12=-698/217, 4-10=-40/432, 6-10=-284/155, 2-13=-931/223, 1-13=-207/1315,  
2-12=-125/610

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 11-4-6, Exterior(2R) 11-4-6 to 15-7-5, Interior(1) 15-7-5 to 29-2-0 zone; cantilever left and right exposed; and vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 14=202, 8=192.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021



**WARNING:** Velly design parameters are listed below and included with the key reference to AISC M14-15 167, § 9.5.2020 by ONE USE. Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for the building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313625
2809580	C05	Half Hip	1	1	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:04 2021 Page 1

ID:tnOHGeVPJTiy41JASwyTKzhfUX-mY\_sgvJlPzrtIV7Vtv9Be9qIWvMVIWUJjEXd9uzCZG9

2-1-8	7-11-6	13-9-3	17-5-8	21-5-12	23-3-5	24-4-8,25-6-0	28-3-8	29-2-0
2-1-8	5-9-14	5-9-14	3-8-5	4-0-4	1-9-9	1-1-3 1-1-8	2-9-8	0-10-8

Scale = 1:49.7

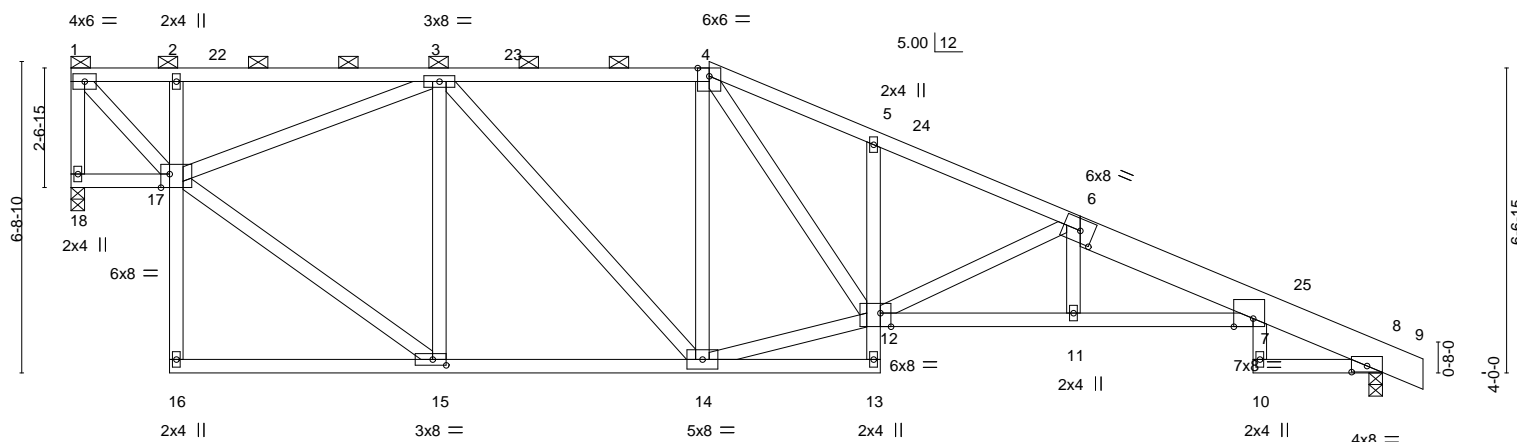

2-1-8	7-11-6	13-9-3	17-5-8	21-5-12	25-6-0	28-3-8
2-1-8	5-9-14	5-9-14	3-8-5	4-0-4	4-0-4	2-9-8

Plate Offsets (X,Y)-- [6:0-3-8,0-3-0], [7:0-5-0,Edge], [8:0-4-0,0-1-9], [12:0-2-12,Edge], [15:0-3-8,0-1-8], [17:0-2-4,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.66	Vert(LL)	-0.26	7-11	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.83	Vert(CT)	-0.47	7-11	>721		
BCLL 0.0	Rep Stress Incr	YES	WB 0.49	Horz(CT)	0.15	8	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 157 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
6-9: 2x8 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
7-12: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and  
2-0-0 oc purlins (4-6-6 max.): 1-4.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 18=0-3-8, 8=0-3-8  
Max Horz 18=195(LC 13)  
Max Uplift 18=182(LC 9), 8=203(LC 13)  
Max Grav 18=1266(LC 1), 8=1329(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-18=1200/186, 1-2=1090/183, 2-3=1125/197, 3-4=1422/274, 4-5=2335/401,  
5-6=2410/345, 6-7=3210/442, 7-8=485/105  
BOT CHORD 2-17=279/105, 14-15=100/1180, 11-12=344/3147, 7-11=350/3157  
WEBS 1-17=231/1565, 15-17=125/1421, 3-15=696/125, 3-14=65/358, 4-14=530/96,  
12-14=86/1353, 4-12=214/1271, 6-12=1086/207

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 13-9-3, Exterior(2R) 13-9-3 to 18-0-2, Interior(1) 18-0-2 to 29-2-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 18=182, 8=203.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313626
2809580	C06	Half Hip	1	1		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:06 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-ix6d5bKYxb5bYpHu\_JCfjavbyi29mO9bBY0kEnzCZG7

7-3-8	8-4-8	11-8-12	15-0-0	16-2-0	17-5-8	21-5-12	25-6-0	28-3-8	29-2-0
7-3-8	1-1-0	3-4-4	3-3-4	1-2-0	1-3-8	4-0-4	4-0-4	2-9-8	0-10-8

Scale = 1:52.2

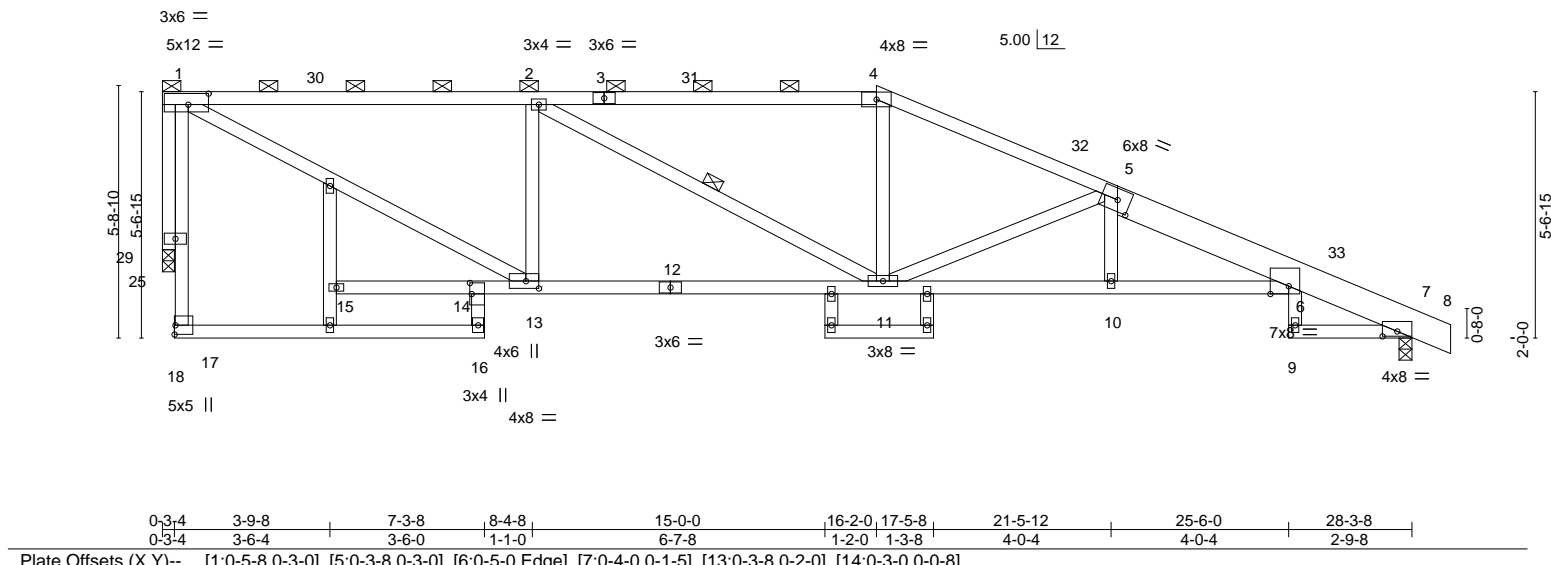


Plate Offsets (X,Y)-- [1:0-5-8,0-3-0], [5:0-3-8,0-3-0], [6:0-5-0,Edge], [7:0-4-0,0-1-5], [13:0-3-8,0-2-0], [14:0-3-0,0-0-8]										
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.86	Vert(LL)	-0.35	15	>963	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.82	Vert(CT)	-0.69	15	>486	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.60	Horz(CT)	0.25	7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 144 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
5-8: 2x8 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
6-12: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-2-0 max.): 1-4.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 2-11

#### REACTIONS.

(size) 7=0-3-8, 29=0-3-4  
Max Horz 29=166(LC 13)  
Max Uplift 7=162(LC 13), 29=178(LC 9)  
Max Grav 7=1341(LC 1), 29=1294(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=1908/289, 2-4=2105/296, 4-5=2356/298, 5-6=3214/340, 6-7=490/92  
BOT CHORD 11-13=154/1908, 10-11=259/3145, 6-10=264/3156  
WEBS 4-11=0/476, 5-11=1106/241, 2-13=735/218, 1-13=257/2011, 1-29=1302/179

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-4 to 3-5-4, Interior(1) 3-5-4 to 16-2-0, Exterior(2R) 16-2-0 to 20-4-15, Interior(1) 20-4-15 to 29-2-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Bearing at joint(s) 29 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=162, 29=178.
- 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:07 2021 Page 1

Scale = 1:52.2

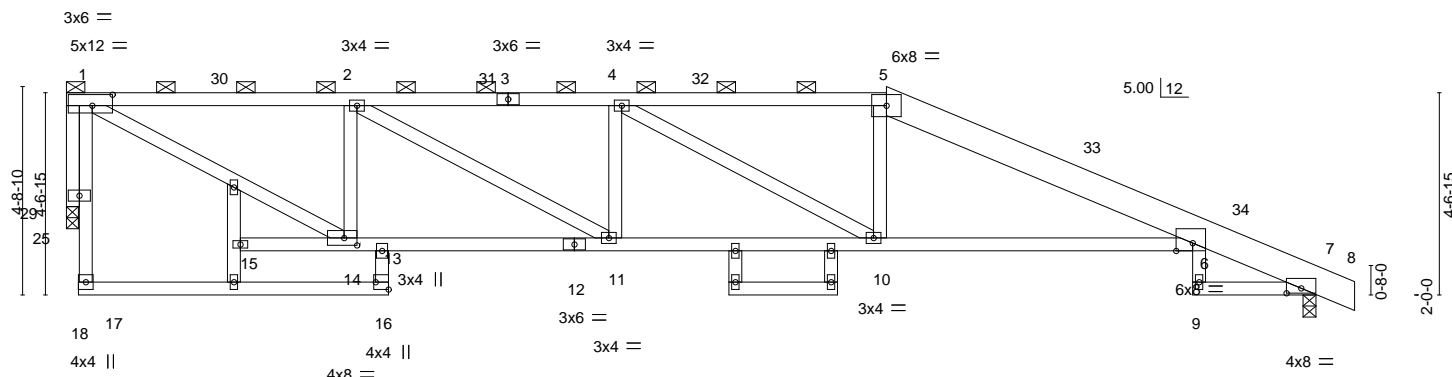

0-3-4	3-9-8	6-5-3	7-3-8	12-9-6	15-0-0	17-5-8	18-6-13	25-6-0	28-3-8
0-3-4	3-6-4	2-7-11	0-10-5	5-5-14	2-2-10	2-5-8	1-1-5	6-11-3	2-9-8
Plate Offsets (X,Y)-- [1:0-5-8,0-3-0], [6:0-4-8,Edge], [7:0-4-0,0-1-5], [14:0-3-8,0-2-0], [16:Edge,0-3-8]									

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc)	<b>L/defl</b>	<b>L/d</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.71	Vert(LL) -0.39 6-10	>871	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.99	Vert(CT) -0.74 6-10	>456	180		
BCLL 0.0	Rep Stress Incr YES	WB 0.52	Horz(CT) 0.32 7	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS				Weight: 141 lb	FT = 20%

LUMBER-		BRACING-	
TOP CHORD	2x4 SPF No.2 *Except* 5-8: 2x8 SP 2400F 2.0E	TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-2-2 max.): 1-5.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied. Except: 10-0-0 oc bracing: 10-11
WEBS	2x4 SPF No.2		
OTHERS	2x4 SPF No.2		

**REACTIONS.** (size) 7=0-3-8, 29=0-3-4  
 Max Horz 29=-134(LC 8)  
 Max Uplift 7=-215(LC 13), 29=-189(LC 9)  
 Max Grav 7=1338(LC 1), 29=1283(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 1-2=-1999/332, 2-4=-2776/437, 4-5=-2599/419, 5-6=-2737/393, 6-7=-488/110  
 BOT CHORD 13-14=-266/1862, 11-13=-225/1999, 10-11=-327/2776, 6-10=-262/2593  
 WEBS 5-10=0/297, 4-11=-307/159, 2-14=-877/207, 1-14=-304/2123, 2-11=-186/887,  
 1-29=-1297/192

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-4 to 3-5-4, Interior(1) 3-5-4 to 18-6-13, Exterior(2R) 18-6-13 to 22-9-11, Interior(1) 22-9-11 to 29-2-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearing at joint(s) 29 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=215, 29=189.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2809580	Truss C08	Truss Type Half Hip	Qty 1	Ply 1	Summit/102 Hawthorne 146313628
----------------	--------------	------------------------	----------	----------	-----------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:08 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-eJENVHMoTCLJn7RH6kE7o??\_KW1EE3uesVrlgzCZG5

7-2-8	7-3-8	13-11-13	15-0-0	17-5-8	20-11-10	25-6-0	28-3-8	29-2-0
7-2-8	0-1-0	6-8-5	1-0-3	2-5-8	3-6-2	4-6-6	2-9-8	0-10-8

Scale = 1:52.2

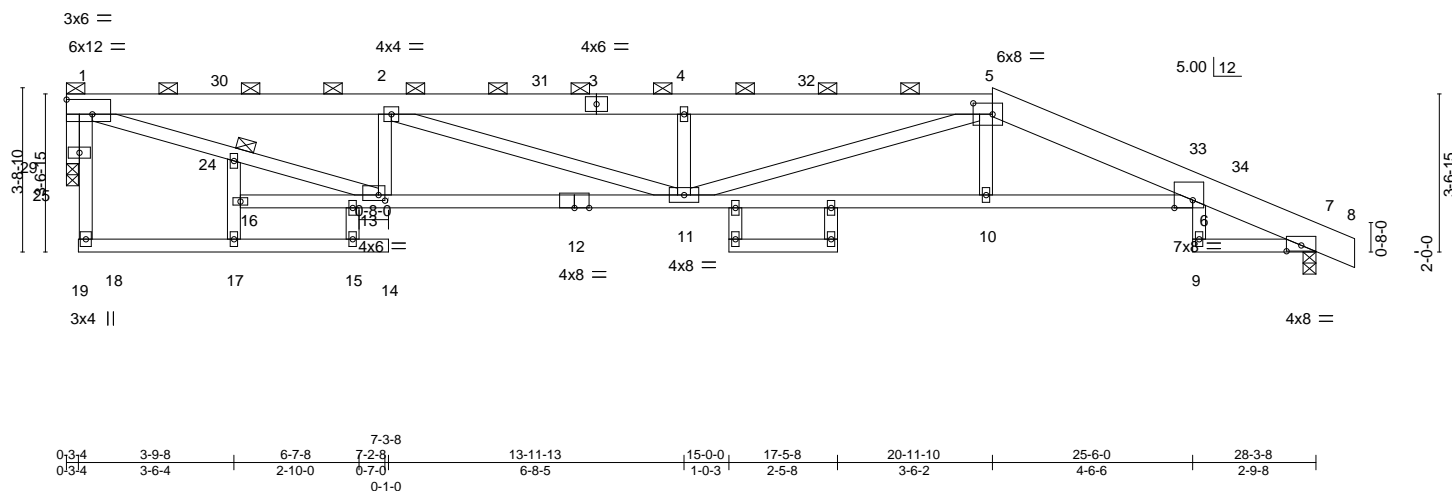


Plate Offsets (X,Y)--		[1:Edge,0-4-0], [5:0-5-4,0-3-0], [6:0-5-0,Edge], [7:0-4-0,0-1-9], [13:0-1-12,0-1-8]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.67
TCDL 10.0	Lumber DOL	1.15	BC 0.85
BCLL 0.0	Rep Stress Incr	YES	WB 0.90
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS
			<b>DEFL.</b> in (loc) l/defl L/d
			Vert(LL) -0.37 11 >903 240
			Vert(CT) -0.68 11-13 >496 180
			Horz(CT) 0.28 7 n/a n/a
			<b>PLATES</b> MT20 <b>GRIP</b> 197/144
			Weight: 144 lb FT = 20%

#### LUMBER-

TOP CHORD 2x6 SPF No.2 \*Except\*  
5-8: 2x8 SP 2400F 2.0E  
BOT CHORD 2x4 SPF No.2 \*Except\*  
6-12: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (3-3-3 max.): 1-5.  
BOT CHORD Rigid ceiling directly applied. Except: 10-0-0 oc bracing: 10-11  
JOINTS 1 Brace at Jt(s): 24, 1

#### REACTIONS.

(size) 7=0-3-8, 29=0-3-4  
Max Horz 29=122(LC 13)  
Max Uplift 7=216(LC 13), 29=210(LC 9)  
Max Grav 7=1330(LC 1), 29=1244(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-3139/571, 2-4=-4132/709, 4-5=-4132/709, 5-6=-3373/513, 6-7=-485/110  
BOT CHORD 13-16=-26/258, 11-13=-482/3139, 10-11=-423/3297, 6-10=-429/3303  
WEBS 4-11=-446/168, 5-11=-207/875, 2-13=-833/218, 1-24=-513/3151, 13-24=-503/3006,  
2-11=-252/1044, 1-29=-1284/220

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-5-4 to 3-5-4, Interior(1) 3-5-4 to 20-11-10, Exterior(2R) 20-11-10 to 25-2-8, Interior(1) 25-2-8 to 29-2-0 zone; cantilever left and right exposed; end vertical right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Provide adequate drainage to prevent water ponding.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearing at joint(s) 29 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 7=216, 29=210.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313629
2809580	C09	Half Hip Girder	1	2	Job Reference (optional)	


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:11 2021 Page 1

ID:tnjOHGeVPJTyi41JASwyTKzhfUX-3uvW8JOhl7jtea9mntnqQddUWjjcRcPKKqkVv\_zCZG2

3-7-8	6-11-8	12-3-6	15-0-0	17-5-8	17-9-0	20-5-13	23-4-6	25-6-0	28-3-8	29-2-0
3-7-8	3-4-0	5-3-14	2-8-10	2-5-8	0-3-8	2-8-13	2-10-9	2-1-10	2-9-8	0-10-8

Scale = 1:50.5

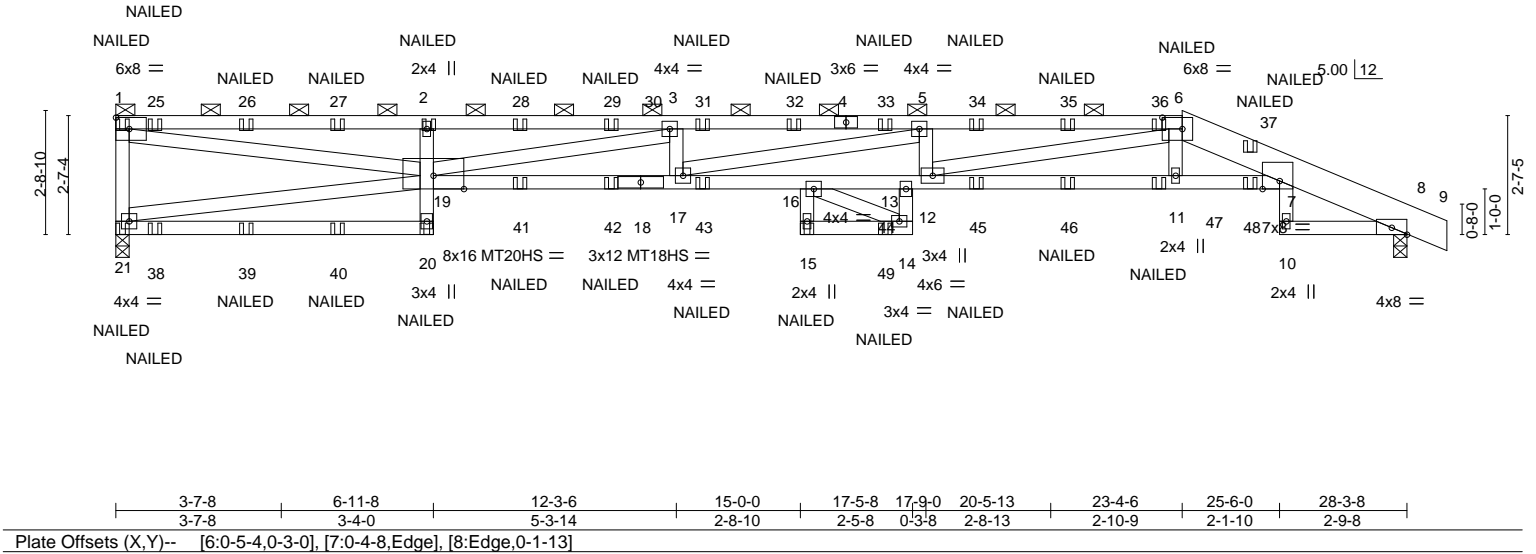

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.74	Vert(LL)	-0.64 16-17	>527	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.93	Vert(CT)	-1.16 16-17	>290	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	NO	WB 0.79	Horz(CT)	0.38 8	n/a	n/a	MT18HS	197/144
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					Weight: 255 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF 1650F 1.5E *Except* 6-9: 2x8 SP 2400F 2.0E	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (4-4-7 max.): 1-6.
BOT CHORD 2x4 SPF No.2 *Except* 18-19,7-18: 2x4 SPF 1650F 1.5E	BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 15-16,13-14.
WEBS 2x4 SPF No.2	

<b>REACTIONS.</b>	(size) 21=0-3-8, 8=0-3-8 Max Horz 21=95(LC 6) Max Uplift 21=459(LC 4), 8=422(LC 9) Max Grav 21=1892(LC 1), 8=1779(LC 1)
-------------------	--

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	1-21=1660/496, 1-2=6487/1671, 2-3=6973/1755, 3-5=9236/2349, 5-6=8784/2232, 6-7=5604/1377, 7-8=670/196
BOT CHORD	20-21=107/654, 2-19=571/248, 17-19=2279/9236, 16-17=2162/8784, 13-16=2091/8469, 12-13=2162/8784, 11-12=1342/5701, 7-11=1355/5751
WEBS	19-21=516/150, 1-19=1651/6466, 3-19=2327/647, 5-17=159/465, 5-12=573/211, 6-12=843/3166

- NOTES-**
- 1) 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc, 2x8 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - 2) All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - 3) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
  - 4) Provide adequate drainage to prevent water ponding.
  - 5) All plates are MT20 plates unless otherwise indicated.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 21=459, 8=422.
  - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - 10) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.

**LOAD CASE(S)** Standard  
Continued on page 2



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**MiTek®**  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	I46313629
2809580	C09	Half Hip Girder	1	2	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:11 2021 Page 2  
ID:tjnOHGeVPJTyi41JASwyTKzhfUX-3uvW8JOhl7jtea9mntnqQddUWjjcRcPKKqkVv\_zCZG2

LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-6=-70, 6-9=-70, 20-21=-20, 16-19=-20, 7-13=-20, 14-15=-20, 10-22=-20

Concentrated Loads (lb)

Vert: 21=-34(B) 1=-74(B) 20=-26(B) 2=-46(B) 16=-47(B) 25=-56(B) 26=-46(B) 27=-46(B) 28=-21(B) 29=-21(B) 31=-21(B) 32=-21(B) 33=-44(B) 34=-17(B) 35=-17(B) 36=-17(B) 37=-38(B) 38=-29(B) 39=-26(B) 40=-26(B) 41=-47(B) 42=-47(B) 43=-47(B) 44=-24(B) 45=-51(B) 46=-51(B) 47=-51(B) 48=-85(B)

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss D01	Truss Type GABLE	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313630
----------------	--------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:12 2021 Page 1  
ID:tjnOHGeVPJTyi41JASwyTKzhfUX-X5TuLePJWRrkGkk2LaJ3zr9pu7HNAE9UZUT2RRzCZG1

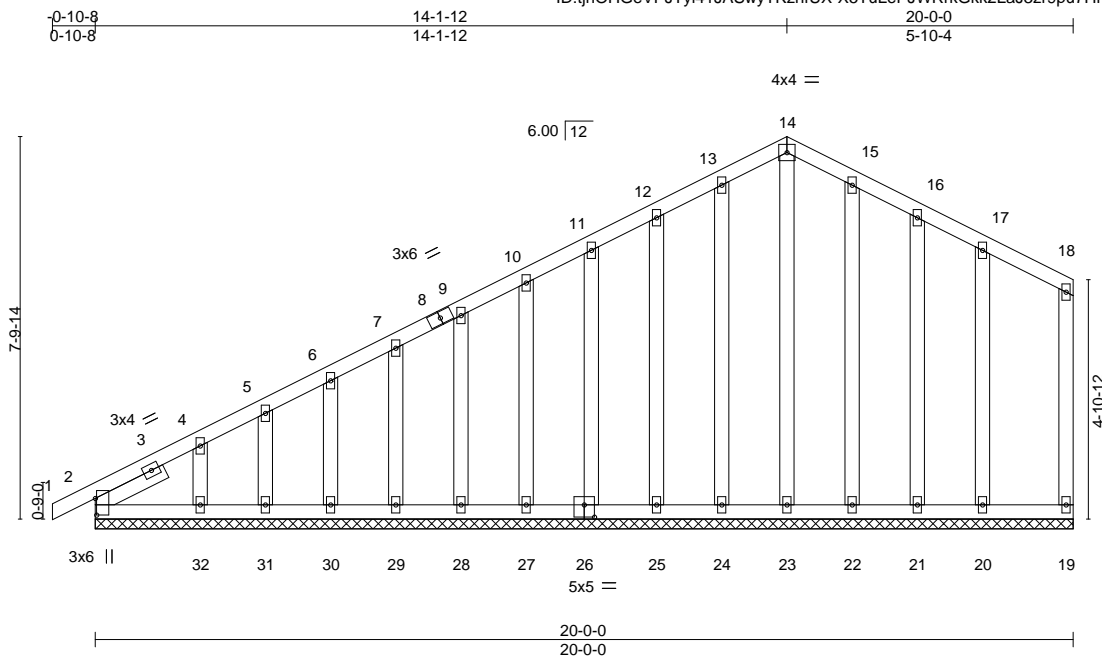


Plate Offsets (X,Y)-- [2:0-4-1,0-0-5], [26:0-2-8,0-3-0]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.12	Vert(LL)	-0.00 1 n/r 120	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.06	Vert(CT)	0.00 1 n/r 120		
BCLL	0.0	Rep Stress Incr	YES	WB	0.12	Horz(CT)	-0.00 19 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S				Weight: 126 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 - t 1-7-3

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS.** All bearings 20-0-0.  
(lb) - Max Horz 2=207(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 19, 2, 26, 23, 24, 25, 27, 28, 29, 30, 31, 32, 22, 21, 20  
Max Grav All reactions 250 lb or less at joint(s) 19, 2, 26, 23, 24, 25, 27, 28, 29, 30, 31, 32, 22, 21, 20

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-10-8 to 2-1-12, Exterior(2N) 2-1-12 to 14-1-12, Corner(3R) 14-1-12 to 17-1-12, Exterior(2N) 17-1-12 to 19-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 19, 2, 26, 23, 24, 25, 27, 28, 29, 30, 31, 32, 22, 21, 20.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss D02	Truss Type COMMON GIRDER	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313631
----------------	--------------	-----------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:14 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-TTbemKRZ225SV2uQS?LX2GF24xsxezNn0oy9WJzCZG?

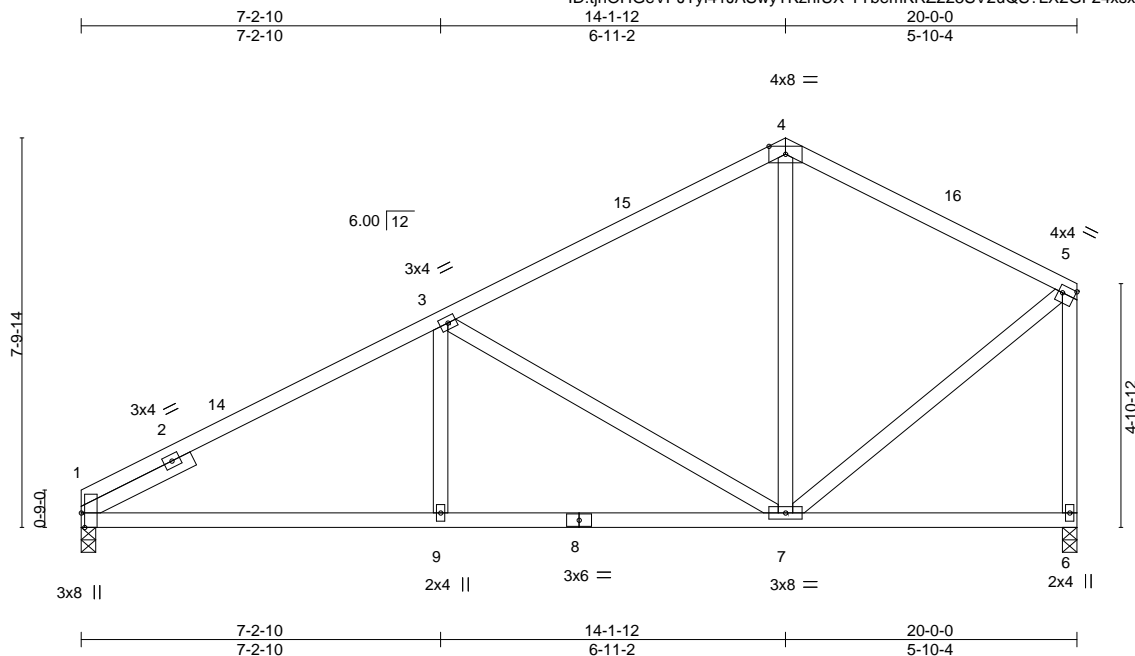


Plate Offsets (X, Y)--		[1:0-3-8, Edge], [5: Edge, 0-1-12]									
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL	1.15	TC	0.53	Vert(LL)	-0.04	7-9	>999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.44	Vert(CT)	-0.10	7-9	>999		
BCLL	0.0	Rep Stress Incr	NO	WB	0.78	Horz(CT)	0.03	6	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 86 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 - t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 1=0-3-8, 6=0-3-8  
Max Horz 1=202(LC 11)  
Max Uplift 1=124(LC 12), 6=108(LC 12)  
Max Grav 1=893(LC 1), 6=893(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-1260/259, 3-4=-693/211, 4-5=-660/205, 5-6=-842/212  
BOT CHORD 1-9=-336/1103, 7-9=-336/1103  
WEBS 3-9=0/279, 3-7=-697/224, 5-7=-140/635

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 14-1-12, Exterior(2R) 14-1-12 to 17-1-12, Interior(1) 17-1-12 to 19-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=124, 6=108.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss D03	Truss Type Common	Qty 2	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313632
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:15 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-xg91zgRBpMEJ7CTd0isnaTnDmk7QNY1wFSii2mzCZG\_

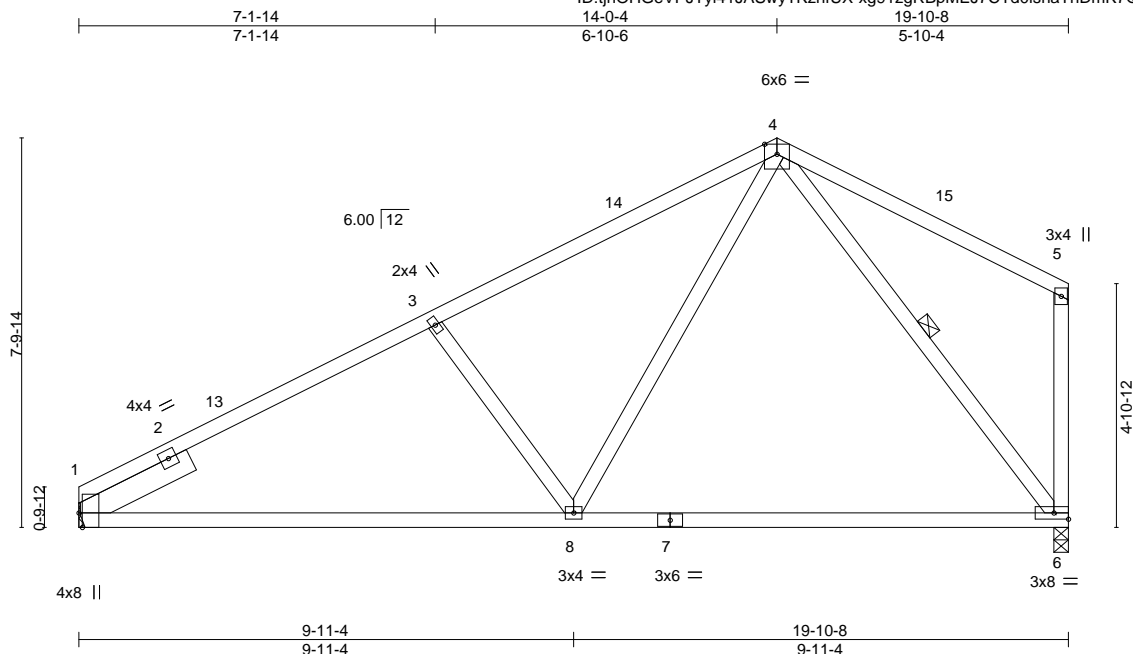


Plate Offsets (X,Y)-- [1:0-3-8,Edge]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.47	Vert(LL)	-0.20	6-8	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.74	Vert(CT)	-0.40	6-8	>597
BCLL 0.0	Rep Stress Incr	YES	WB 0.30	Horz(CT)	0.02	6	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS				
						<b>PLATES</b>	<b>GRIP</b>
						MT20	197/144
						Weight: 83 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x6 SPF No.2 - t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 4-6

#### REACTIONS.

(size) 1=Mechanical, 6=0-3-8  
Max Horz 1=201(LC 11)  
Max Uplift 1=123(LC 12), 6=107(LC 12)  
Max Grav 1=888(LC 1), 6=888(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-3=-1207/267, 3-4=-1012/273  
BOT CHORD 1-8=-340/1059, 6-8=-171/492  
WEBS 3-8=-461/227, 4-8=-117/668, 4-6=-747/213

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 14-0-4, Exterior(2R) 14-0-4 to 17-0-4, Interior(1) 17-0-4 to 19-8-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=123, 6=107.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss D04	Truss Type Roof Special Girder	Qty 1	Ply 2	Summit/102 Hawthorne 146313633
----------------	--------------	-----------------------------------	----------	----------	-----------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:16 2021 Page 1

ID:tpOHGvPJTyi41JASwyTKzhfUX-PsjPB0SpafMAIL2paQN07gKKzkSU6uk4U6RGZCzCZFz

0-10-8	4-10-0	8-0-12	10-3-8	12-10-0	18-5-14	24-1-12	30-0-0
0-10-8	4-10-0	3-2-12	2-2-12	2-6-8	5-7-14	5-7-14	5-10-4

4x6 =

Scale = 1:65.3

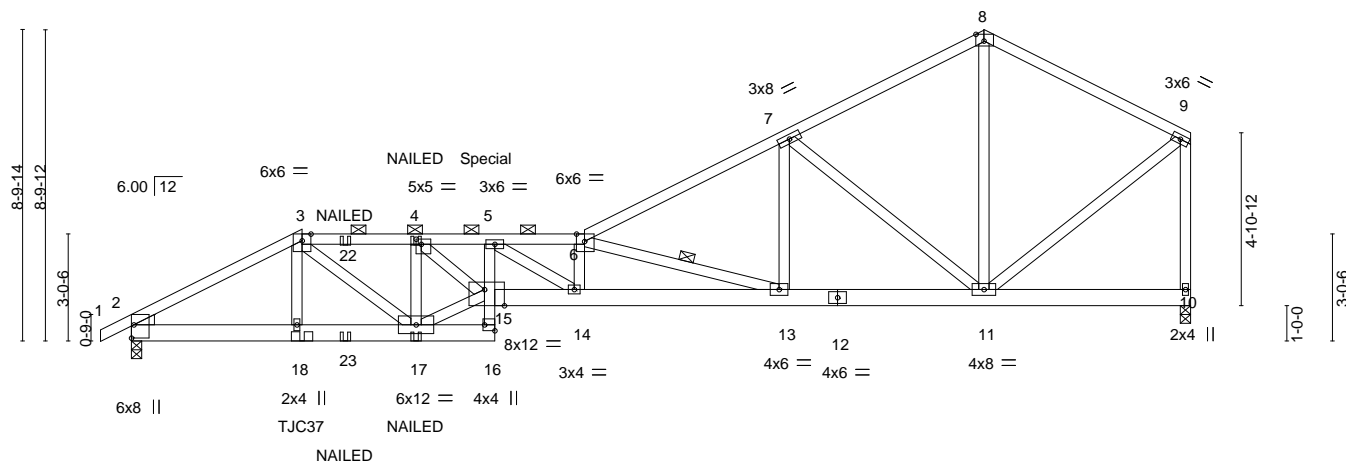

4-10-0	8-0-12	10-3-8	12-10-0	18-5-14	24-1-12	30-0-0
4-10-0	3-2-12	2-2-12	2-6-8	5-7-14	5-7-14	5-10-4

Plate Offsets (X,Y)-- [2:Edge,0-0-13], [4:0-1-12,0-1-12], [6:0-2-12,Edge], [8:0-2-12,Edge], [15:0-6-12,Edge], [16:Edge,0-3-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.76	Vert(LL)	-0.36	14	>992	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.82	Vert(CT)	-0.65	14	>553	180		
BCLL 0.0	Rep Stress Incr	NO	WB 0.72	Horz(CT)	0.12	10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS						Weight: 309 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x6 SPF No.2 "Except"  
 5-16: 2x4 SPF No.2, 12-15: 2x6 SPF 2100F 1.8E  
 WEBS 2x4 SPF No.2  
 WEDGE  
 Left: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-5-3 oc purlins, except end verticals, and 2-0-0 oc purlins (3-0-5 max.): 3-6.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
 WEBS 1 Row at midpt 6-13

#### REACTIONS.

(size) 2=0-3-8, 10=0-3-8  
 Max Horz 2=226(LC 5)  
 Max Uplift 2=470(LC 8), 10=260(LC 8)  
 Max Grav 2=2681(LC 1), 10=1844(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-4664/820, 3-4=-6275/1058, 4-5=-10841/1767, 5-6=-10450/1671, 6-7=-3865/612, 7-8=-1486/269, 8-9=-1471/286, 9-10=-1784/282  
 BOT CHORD 2-18=-828/4114, 17-18=-827/4111, 16-17=-163/955, 5-15=-826/73, 14-15=-1877/11087, 13-14=-1740/10426, 11-13=-554/3396  
 WEBS 15-17=-1069/5897, 4-15=-907/5838, 5-14=-976/425, 7-13=-333/2395, 7-11=-2776/543, 8-11=-150/916, 9-11=-220/1556, 6-14=-248/451, 6-13=-7339/1238, 4-17=-4182/715, 3-17=-392/2819

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
 Top chords connected as follows: 2x4 - 1 row at 0-3-0 oc.  
 Bottom chords connected as follows: 2x6 - 2 rows staggered at 0-9-0 oc, 2x4 - 1 row at 0-9-0 oc.  
 Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=470, 10=260.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie TJC37 (6 nail, 30-90) or equivalent at 4-10-0 from the left end to connect truss(es) to front face of bottom chord.

Continued on page 2



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**  
**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	I46313633
2809580	D04	Roof Special Girder	1	2	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:16 2021 Page 2  
ID:tjnOHGeVPJTyi41JASwyTKzhfUX-PsjPB0SpafMAIL2paQN07gKKzkSU6uk4U6RGZCzCZFz

- NOTES-**
- 11) Fill all nail holes where hanger is in contact with lumber.
  - 12) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
  - 13) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1139 lb down and 152 lb up at 10-0-12 on top chord. The design/selection of such connection device(s) is the responsibility of others.

- LOAD CASE(S)** Standard
- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
  - Uniform Loads (plf)
    - Vert: 1-3=-70, 3-6=-70, 6-8=-70, 8-9=-70, 16-19=-20, 10-15=-20
  - Concentrated Loads (lb)
    - Vert: 5=-1075(F) 18=-374(F) 4=-84(F) 17=-80(F) 22=-84(F) 23=-80(F)

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313634
2809580	D05	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:18 2021 Page 1

ID: tjnOHGeVPJTy41JASwyTKzhfUX-MFr9ciU46Hcu\_fCChrPUC5PjyY6lanVMxPwMe4zCZFx

-0-10-8	6-6-0	10-3-8	14-6-0	19-3-14	24-1-12	30-0-0
0-10-8	6-6-0	3-9-8	4-2-8	4-9-14	4-9-14	5-10-4

4x6 =

Scale = 1:60.3

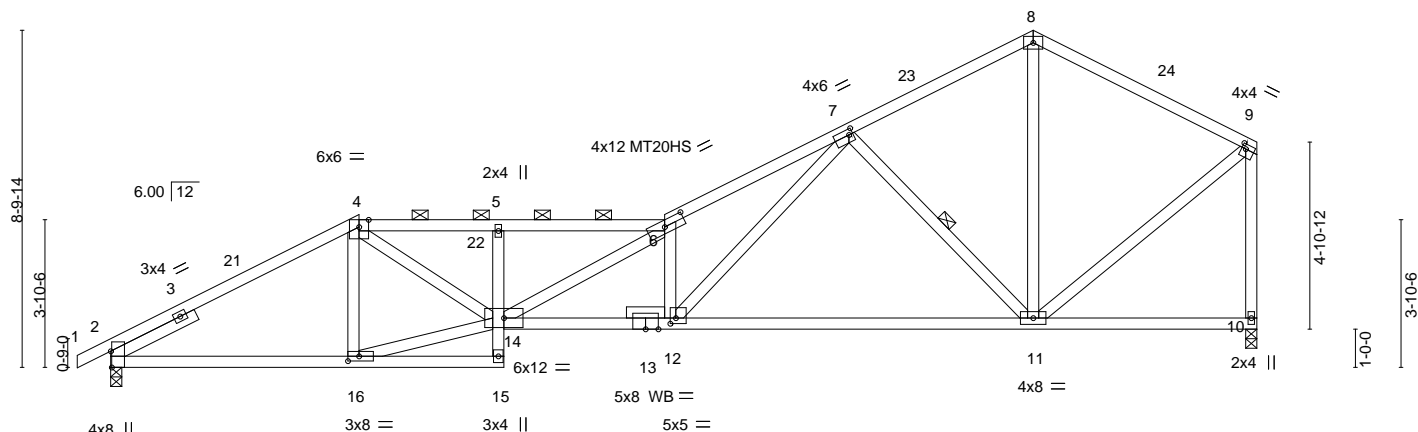

6-6-0	10-3-8	14-6-0	24-1-12	30-0-0
6-6-0	3-9-8	4-2-8	9-7-12	5-10-4

Plate Offsets (X,Y)-- [2:0-5-1,Edge], [6:0-6-8,0-2-0], [7:0-1-4,0-1-12], [9:0-1-4,0-1-8], [12:0-1-12,0-1-12], [16:0-3-8,0-1-8]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.54	Vert(LL)	-0.29 12-14	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.96	Vert(CT)	-0.60 11-12	>599	180	MT20HS	148/108
BCLL 0.0	Rep Stress Incr	YES	WB 0.71	Horz(CT)	0.12 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 138 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 - t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-9-10 max.): 4-6.  
 BOT CHORD Rigid ceiling directly applied.  
 WEBS 1 Row at midpt 7-11

#### REACTIONS.

(size) 2=0-3-8, 10=0-3-8  
 Max Horz 2=227(LC 9)  
 Max Uplift 2=230(LC 12), 10=182(LC 12)  
 Max Grav 2=1406(LC 1), 10=1343(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2179/363, 4-5=-3453/613, 5-6=-3516/629, 6-7=-4279/728, 7-8=-1040/222,  
 8-9=-1048/215, 9-10=-1304/211  
 BOT CHORD 2-16=-398/1885, 5-14=-393/121, 12-14=-656/3856, 11-12=-327/1803  
 WEBS 4-16=-400/137, 14-16=-390/1740, 4-14=-305/1909, 6-14=-400/7, 6-12=-1958/431,  
 7-12=-486/2879, 7-11=-1371/345, 8-11=-96/554, 9-11=-147/1079

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 6-6-0, Exterior(2R) 6-6-0 to 9-6-0, Interior(1) 9-6-0 to 24-1-12, Exterior(2R) 24-1-12 to 27-1-12, Interior(1) 27-1-12 to 29-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=230, 10=182.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017



Job 2809580	Truss D06	Truss Type Roof Special	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313635
----------------	--------------	----------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:19 2021 Page 1

ID: tjnOHGeVPJTiy41JASwyTKzhfUX-qROxp2UitakcpmOFYxjJyqwyUUJCiWA3gwAXzCZFw

0-10-8 4-2-12 8-2-0 10-3-8 16-2-0 24-1-12 30-0-0  
0-10-8 4-2-12 3-11-4 2-1-8 5-10-8 7-11-12 5-10-4

4x8 =

Scale = 1:60.3

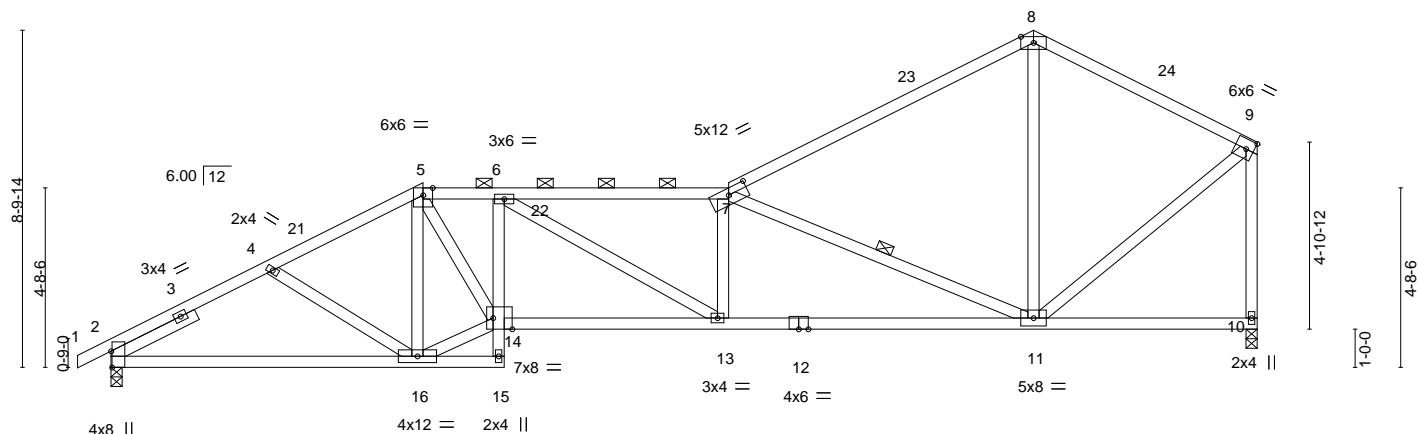

8-2-0 10-3-8 16-2-0 24-1-12 30-0-0  
8-2-0 2-1-8 5-10-8 7-11-12 5-10-4

Plate Offsets (X, Y)-- [2:0-5-1, Edge], [7:0-6-0, 0-2-1], [14:0-6-0, Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.78	Vert(LL)	-0.20 13-14	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.80	Vert(CT)	-0.38 11-13	>952	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.84	Horz(CT)	0.12 10	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 139 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 -t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-11-0 max.): 5-7.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 7-11

#### REACTIONS.

(size) 2=0-3-8, 10=0-3-8  
Max Horz 2=227(LC 9)  
Max Uplift 2=230(LC 12), 10=182(LC 12)  
Max Grav 2=1406(LC 1), 10=1343(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2164/384, 4-5=-2051/354, 5-6=-2669/499, 6-7=-2961/504, 7-8=-1103/214, 8-9=-1049/221, 9-10=-1298/217  
BOT CHORD 2-16=-436/1868, 6-14=-481/118, 13-14=-517/2724, 11-13=-513/2960  
WEBS 5-16=-739/186, 14-16=-365/1920, 5-14=-293/1649, 6-13=-17/273, 7-11=-2276/476, 8-11=-32/443, 9-11=-164/1098

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 8-2-0, Exterior(2R) 8-2-0 to 11-2-0, Interior(1) 11-2-0 to 24-1-12, Exterior(2R) 24-1-12 to 27-1-12, Interior(1) 27-1-12 to 29-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=230, 10=182.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss D07	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	146313636
----------------	--------------	----------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:20 2021 Page 1

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-ldyw1NVKeuscDzLapGSyHWU45Lqi2IHfPjPTjzCZFv

-0-10-8 5-0-12 9-10-0 10-3-8 17-10-0 24-1-12 30-0-0  
0-10-8 5-0-12 4-9-4 0-5-8 7-6-8 6-3-12 5-10-4

4x8 =

Scale = 1:62.3

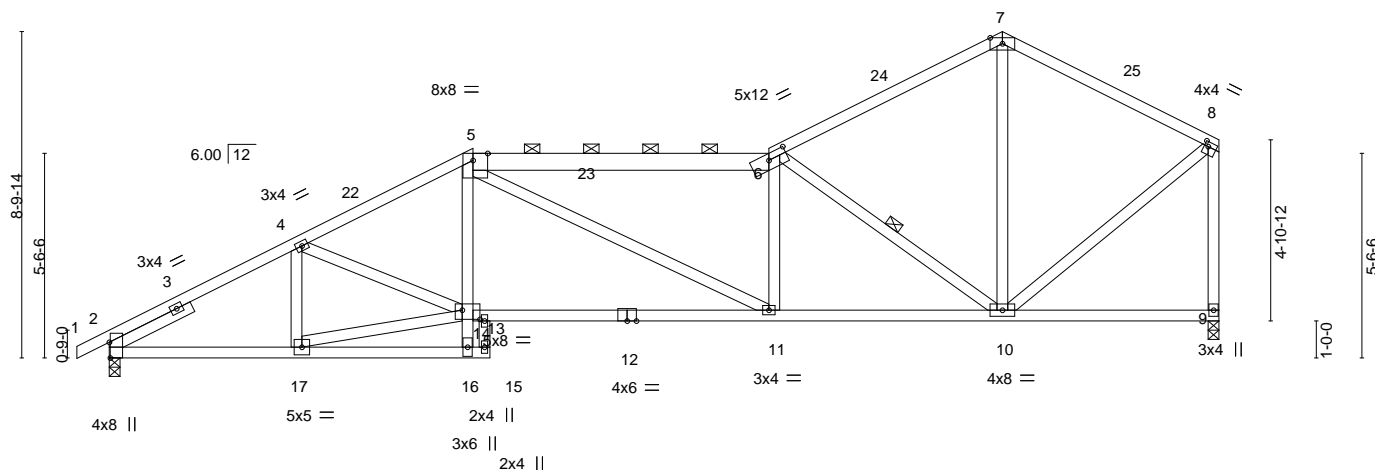

5-0-12 10-3-8 17-10-0 24-1-12 30-0-0  
5-0-12 5-2-12 7-6-8 6-3-12 5-10-4

Plate Offsets (X,Y)-- [2:0-5-1,Edge], [5:0-4-12,Edge], [6:0-6-0,0-2-1], [8:0-1-4,0-1-8], [14:0-5-12,0-3-0]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.49	Vert(LL)	-0.14 11-13	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.80	Vert(CT)	-0.32 11-13	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.50	Horz(CT)	0.09 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 146 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
5-6: 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 - t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-0-7 max.): 5-6.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 6-10

#### REACTIONS.

(size) 2=0-3-8, 9=0-3-8  
Max Horz 2=227(LC 9)  
Max Uplift 2=230(LC 12), 9=182(LC 12)  
Max Grav 2=1406(LC 1), 9=1343(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2169/365, 4-5=-2409/428, 5-6=-2314/411, 6-7=-1063/224, 7-8=-1038/221, 8-9=-1287/222  
BOT CHORD 2-17=-415/1875, 13-14=-357/2077, 11-13=-420/2127, 10-11=-391/2316, 13-15=-313/0  
WEBS 14-16=0/448, 5-14=-30/498, 4-17=-383/120, 4-14=-33/277, 6-10=-1766/377, 7-10=-71/490, 8-10=-163/1068, 14-17=-352/1826

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 9-10-0, Exterior(2R) 9-10-0 to 12-10-0, Interior(1) 12-10-0 to 24-1-12, Exterior(2R) 24-1-12 to 27-1-12, Interior(1) 27-1-12 to 29-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=230, 9=182.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

-0-10-8	5-3-8	10-3-8	11-6-0	19-6-0	24-1-12	30-0-0
0-10-8	5-3-8	5-0-0	1-2-8	8-0-0	4-7-12	5-10-4

 $4 \times 6 =$ 

Scale = 1:60.3

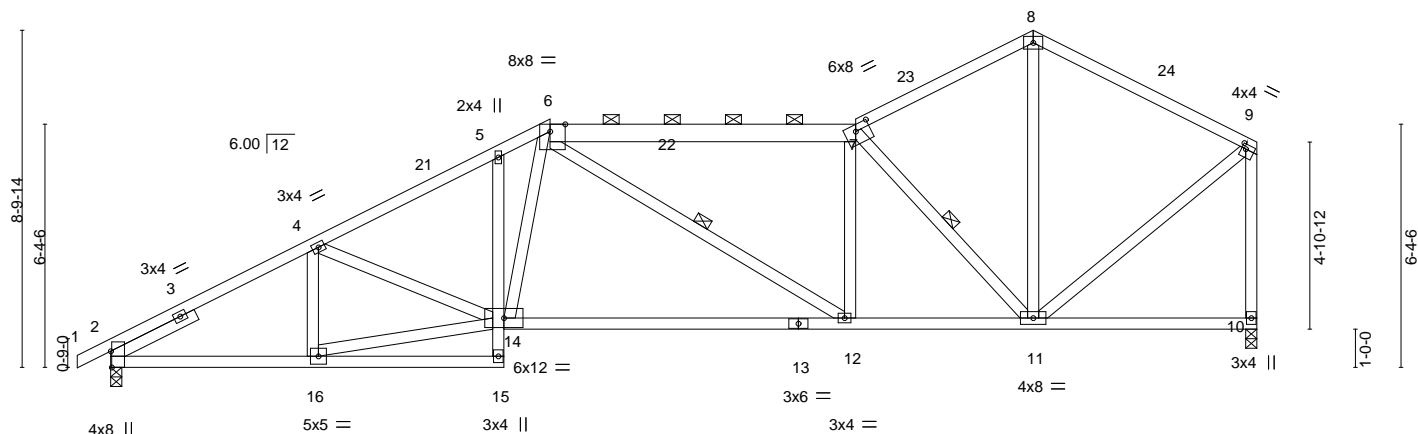

Game	Date	Score
1	5-3-8	5-3-8
2	10-3-8	5-0-0
3	11-6-0	1-2-8
4	19-6-0	8-0-0
5	24-1-12	4-7-12
6	30-0-0	5-10-4

Plate Offsets (X,Y)-- [2:0-5-1,Edge], [6:0-4-12,Edge], [7:0-4-8,0-2-0], [9:0-1-4,0-1-8]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.48	Vert(LL)	-0.21 12-14 >999 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.46 12-14 >772 180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.46	Horz(CT)	0.08 10 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 151 lb	FT = 20%

**LUMBER-**  
**TOP CHORD** 2x4 SPF No.2 \*Except\*  
 6-7: 2x6 SPF No.2  
**BOT CHORD** 2x4 SPF No.2  
**WEBS** 2x4 SPF No.2  
**SLIDER** Left 2x4 SPF No.2 -t 2-6-0

BRACING-	
TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-6-9 max.): 6-7.
BOT CHORD	Rigid ceiling directly applied.
WEBS	1 Row at midpt 6-12, 7-11

**REACTIONS.** (size) 2=0-3-8, 10=0-3-8  
 Max Horz 2=227(LC 9)  
 Max Uplift 2=-230(LC 12), 10=-182(LC 12)  
 Max Gray 2=1406(LC 1), 10=1343(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 2-4=-2178/365, 4-5=-2312/422, 5-6=-2201/444, 6-7=-1828/334, 7-8=-1027/234,  
8-9=-1032/221, 9-10=-1281/226

**BOT CHORD** 2-16=-413/1884, 12-14=-384/1886, 11-12=-321/1822

**WEBS** 4-16=-350/126, 14-16=-378/1874, 7-12=0/322, 7-11=-1454/310, 8-11=-1040/557,  
9-11=-164/1052, 6-14=-90/546

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 11-6-0, Exterior(2R) 11-6-0 to 14-6-0, Interior(1) 14-6-0 to 24-1-12, Exterior(2R) 24-1-12 to 27-1-12, Interior(1) 27-1-12 to 29-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=230, 10=182.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f, 701f, 702f, 703f, 704f, 705f, 706f, 707f,**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss D09	Truss Type ROOF SPECIAL	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313638
----------------	--------------	----------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:23 2021 Page 1

ID:tnOHGeVPJTiy41JASwyTKzhfUX-iCe2fPYCxpEA4Q49UO?fv96baZsXF6b6she7JlzCZF5

-0-10-8 5-3-8 10-3-8 11-4-12 19-4-12 24-1-12 30-0-0  
0-10-8 5-3-8 5-0-0 1-1-4 8-0-0 4-9-0 5-10-4

4x6 =

Scale = 1:60.3

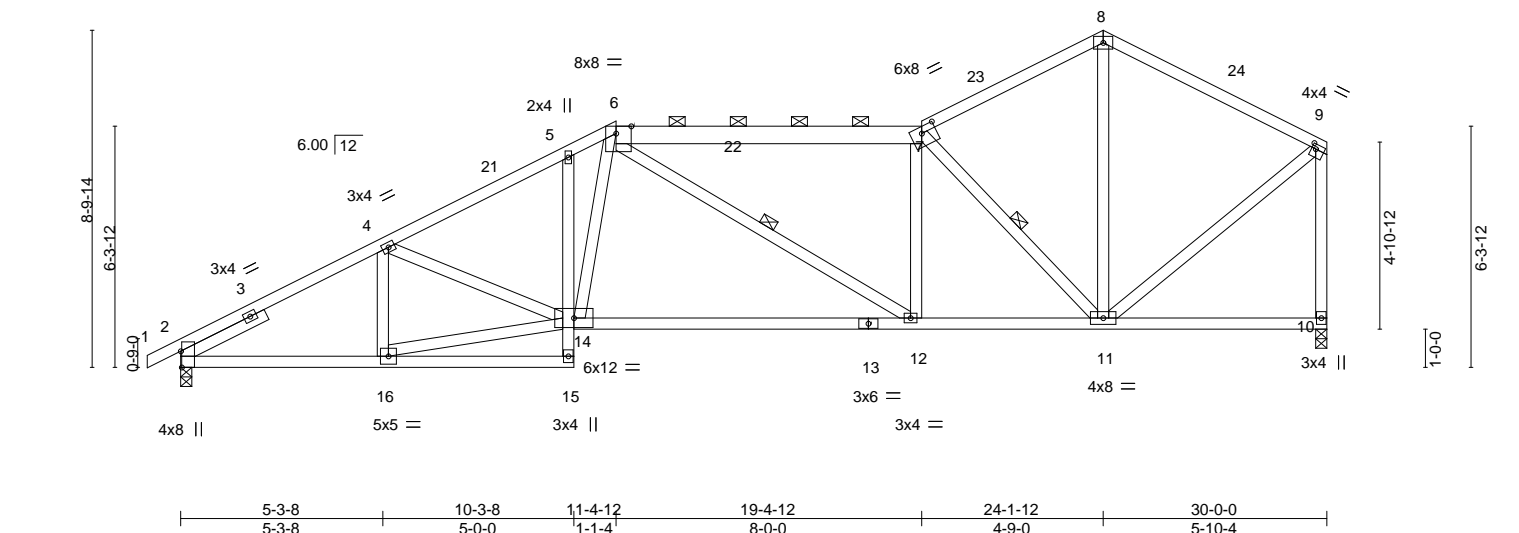


Plate Offsets (X,Y)--		[2:0-5-1,Edge], [6:0-4-12,Edge], [7:0-4-8,0-2-0], [9:0-1-4,0-1-8]									
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL	1.15	TC	0.48	Vert(LL)	-0.20 12-14	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.73	Vert(CT)	-0.45 12-14	>795	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.46	Horz(CT)	0.08 10	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 151 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2 \*Except\*  
6-7: 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 - t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-6-5 max.): 6-7.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 6-12, 7-11

#### REACTIONS.

(size) 2=0-3-8, 10=0-3-8  
Max Horz 2=227(LC 9)  
Max Uplift 2=230(LC 12), 10=182(LC 12)  
Max Grav 2=1406(LC 1), 10=1343(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2178/365, 4-5=-2312/422, 5-6=-2194/442, 6-7=-1855/338, 7-8=-1029/233,  
8-9=-1032/221, 9-10=-1281/226  
BOT CHORD 2-16=-413/1884, 12-14=-387/1901, 11-12=-325/1849  
WEBS 4-16=-350/126, 14-16=-379/1871, 7-12=0/316, 7-11=-1467/314, 8-11=-102/552,  
9-11=-163/1052, 6-14=-87/522

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 11-4-12, Exterior(2R) 11-4-12 to 14-4-12, Interior(1) 14-4-12 to 24-1-12, Exterior(2R) 24-1-12 to 27-1-12, Interior(1) 27-1-12 to 29-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=230, 10=182.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:24 2021 Page 1  
ID:tinOHGeVPJTvi41JASwTKzhfUX-AOCQslygh7M1iafl25WuSMfm4zBq Z1FJLNhskzCZFr

-0-10-8	5-0-2	9-8-12	10-3-8	17-8-12	24-1-12	30-0-0
0-10-8	5-0-2	4-8-10	0-6-12	7-5-4	6-5-0	5-10-4

 $4 \times 8 =$ 

Scale = 1:62.3

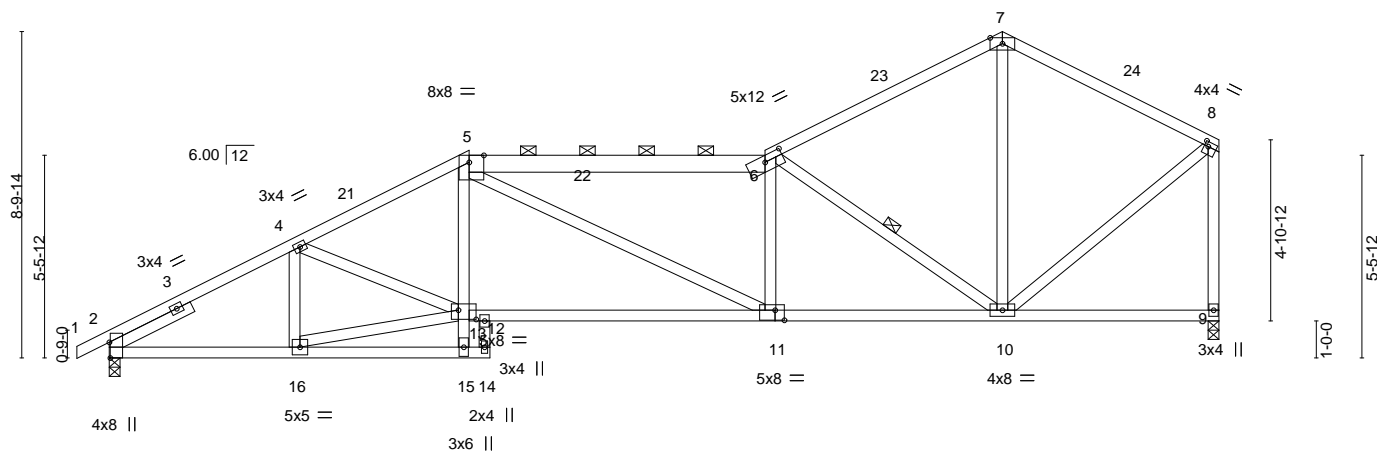

Date	Score
5-0-2	5-0-2
10-3-8	5-3-6
17-8-12	7-5-4
24-1-12	6-5-0
30-0-0	5-10-4

Plate Offsets (X,Y)-- [2:0-5-1,Edge], [5:0-4-12,Edge], [6:0-6-0,0-2-1], [8:0-1-4,0-1-8], [11:0-3-0,0-3-4], [13:0-5-12,0-3-0]												
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>	<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.49	Vert(LL)	-0.15	11-12	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.80	Vert(CT)	-0.33	11-12	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.51	Horz(CT)	0.10	9	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 146 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2 \*Except\*  
5-6: 2x6 SPF No.2

BOT CHORD 2x4 SPF No.2

WEBS 2x4 SPF No.2

SLIDER Left 2x4 SPF No.2 -t 2-6-0

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (4-0-0 max.): 5-6.
BOT CHORD	Rigid ceiling directly applied.
WEBS	1 Row at midpt 6-10

### REACTIONS.

(size) 2=0-3-8, 9=0-3-8  
Max Horz 2=227(LC 9)  
Max Uplift 2=-230(LC 12), 9=-182(LC 12)  
Max Gray 2=1406(LC 1), 9=1343(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2168/365, 4-5=-2426/429, 5-6=-2351/418, 6-7=-1065/224, 7-8=-1039/221,  
8-9=-1287/222

BOT CHORD 2-16=-415/1874, 12-13=-355/2104, 11-12=-422/2143, 10-11=-395/2354, 12-14=-267/0

WEBS 13-15=0/405, 5-13=-28/502, 4-16=-391/120, 6-10=-1796/381, 7-10=-69/486,  
8-10=-163/1069, 13-16=-349/1834, 4-13=-32/295

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 9-8-12, Exterior(2R) 9-8-12 to 12-8-12, Interior(1) 12-8-12 to 24-1-12, Exterior(2R) 24-1-12 to 27-1-12, Interior(1) 27-1-12 to 29-10-4 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=230, 9=182.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021



**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f, 701f, 702f, 703f, 704f, 705f, 706f, 707f,**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313640
2809580	D11	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:25 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-ebmp45ZTSQUuKkEYcp17\_aCv\_MZWj?kOY?7EOAzCZFq

-0-10-8	4-2-2	8-0-12	10-3-8	16-0-12	20-1-4	24-1-12	30-0-0
0-10-8	4-2-2	3-10-10	2-2-12	5-9-4	4-0-8	4-0-8	5-10-4

4x6 =

Scale = 1:60.3

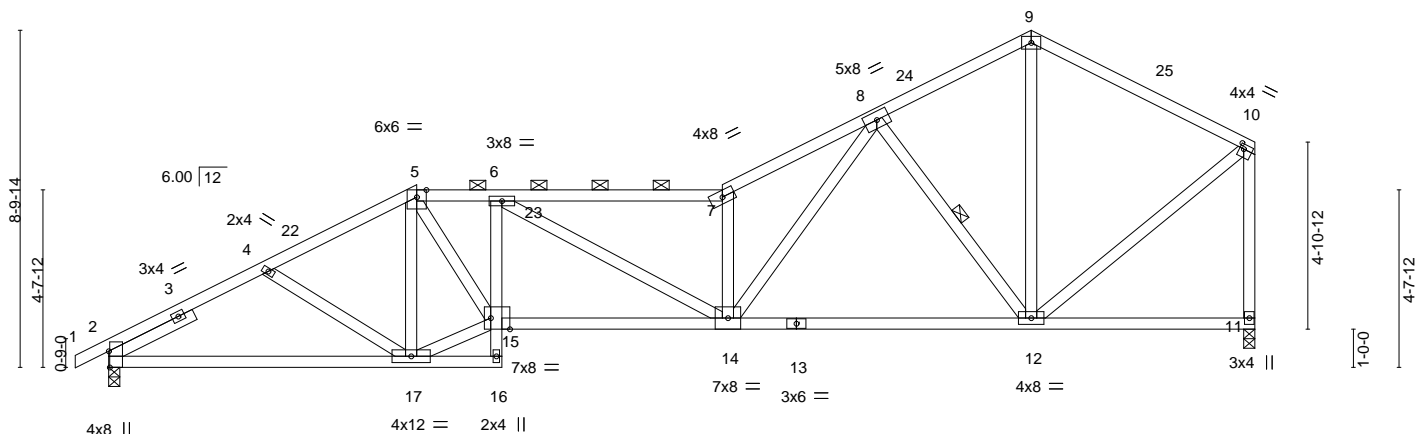

8-0-12	10-3-8	16-0-12	24-1-12	30-0-0
8-0-12	2-2-12	5-9-4	8-1-0	5-10-4

Plate Offsets (X,Y)-- [2:0-5-1,Edge], [10:0-1-4,0-1-8], [15:0-6-0,Edge]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.61	Vert(LL)	-0.21 14-15	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.69	Vert(CT)	-0.38 14-15	>939	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.55	Horz(CT)	0.11 11	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 144 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 -t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (2-8-5 max.): 5-7.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 8-12

#### REACTIONS.

(size) 2=0-3-8, 11=0-3-8  
Max Horz 2=227(LC 9)  
Max Uplift 2=230(LC 12), 11=182(LC 12)  
Max Grav 2=1406(LC 1), 11=1343(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2163/384, 4-5=-2056/355, 5-6=-2718/508, 6-7=-2975/493, 7-8=-3324/590,  
8-9=-1014/227, 9-10=-1042/217, 10-11=-1296/216  
BOT CHORD 2-17=-436/1867, 6-15=-500/115, 14-15=-532/2782, 12-14=-296/1607  
WEBS 5-17=-703/176, 15-17=-358/1901, 5-15=-298/1657, 7-14=-1801/378, 8-14=-399/2228,  
8-12=-1271/314, 9-12=-107/566, 10-12=-152/1068

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 8-0-12, Exterior(2R) 8-0-12 to 11-0-12, Interior(1) 11-0-12 to 24-1-12, Exterior(2R) 24-1-12 to 27-1-12, Interior(1) 27-1-12 to 29-10-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=230, 11=182.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss D12	Truss Type Hip Girder	Qty 1	Ply 1	Summit/102 Hawthorne 146313641
----------------	--------------	--------------------------	----------	----------	-----------------------------------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:26 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-7nJBHRa5Dkclxupk9WZMXnkAOM\_3SYvYnfsowdzCZFp

Job Reference (optional)

-1-0-8 1-0-8	2-2-0 2-2-0	6-0-0 3-10-0	9-10-0 3-10-0	12-0-0 2-2-0	13-0-8 1-0-8
-----------------	----------------	-----------------	------------------	-----------------	-----------------

Scale = 1:23.3

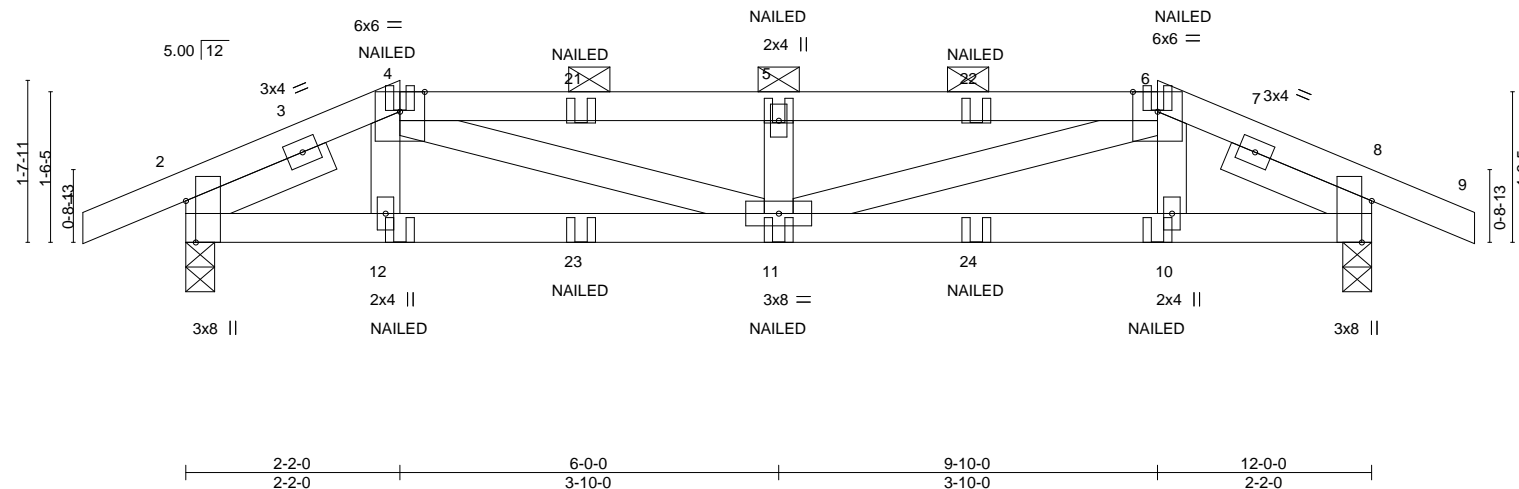


Plate Offsets (X,Y)-- [2:0-5-1,Edge], [8:0-5-1,Edge]		2-2-0 2-2-0		6-0-0 3-10-0		9-10-0 3-10-0		12-0-0 2-2-0	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.25	Vert(LL)	-0.04	11	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.35	Vert(CT)	-0.08	11	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.17	Horz(CT)	0.01	8	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MS					Weight: 46 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 -t 1-7-0, Right 2x4 SPF No.2 -t 1-7-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (4-10-2 max.): 4-6.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-3-8, 8=0-3-8  
Max Horz 2=-20(LC 13)  
Max Uplift 2=-106(LC 8), 8=-106(LC 9)  
Max Grav 2=606(LC 1), 8=606(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-792/132, 4-5=-1344/246, 5-6=-1344/246, 6-8=-792/132  
BOT CHORD 2-12=-103/711, 11-12=-107/712, 10-11=-101/712, 8-10=-96/711  
WEBS 4-11=-125/682, 5-11=-337/115, 6-11=-125/682

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=106, 8=106.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-70, 4-6=-70, 6-9=-70, 13-17=-20  
Concentrated Loads (lb)  
Vert: 12=4(F) 11=2(F) 10=4(F) 23=2(F) 24=2(F)



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 2809580	Truss D13	Truss Type Hip	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313642
----------------	--------------	-------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:28 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-3ARxi7bLILsTBBy7HxbqcCqVaadEwUUrEzLu?VzCZFh



Scale = 1:23.7


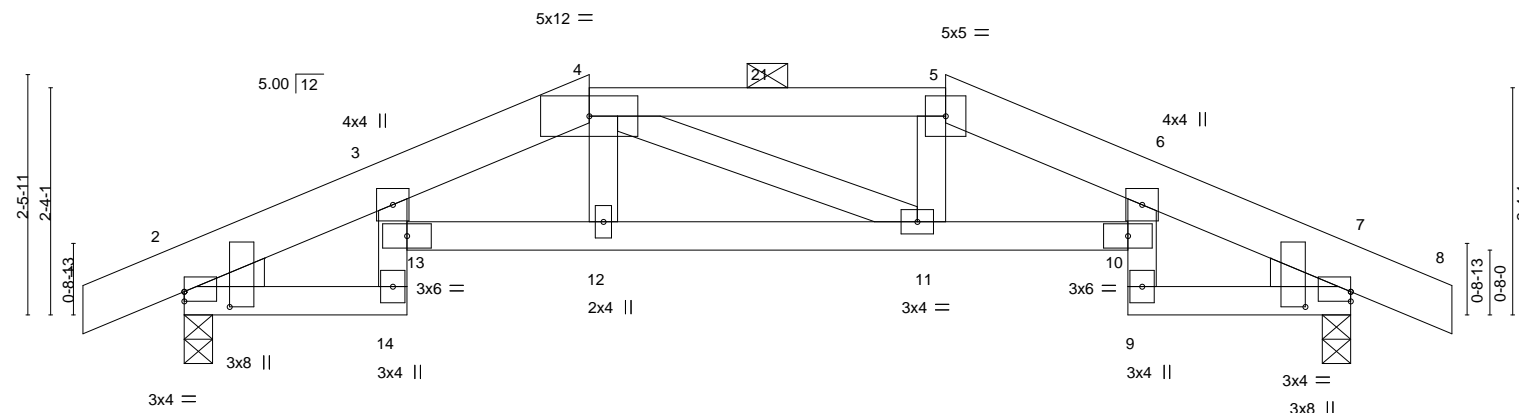


Plate Offsets (X,Y)-- [2:0-0-0,0-1-3], [2:0-1-14,0-5-10], [7:0-0-0,0-1-3], [7:0-1-14,0-5-10]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.27	Vert(LL)	-0.04	12	>999	240	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.50	Vert(CT)	-0.07	11-12	>999	180	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.05	7	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 49 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x6 SPF No.2 \*Except\*  
4-5: 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEBS 2x4 SPF No.2

WEDGE

Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (5-5-11 max.): 4-5.

BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 7=0-3-8

Max Horz 2=-34(LC 13)

Max Uplift 2=-92(LC 12), 7=-92(LC 13)

Max Grav 2=613(LC 1), 7=613(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-696/221, 3-4=-1147/331, 4-5=-1098/337, 5-6=-1148/331, 6-7=-696/220

BOT CHORD 2-14=-129/522, 12-13=-241/1087, 11-12=-239/1097, 10-11=-245/1088, 7-9=-132/522

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-8 to 2-0-11, Interior(1) 2-0-11 to 4-2-0, Exterior(2E) 4-2-0 to 7-10-0, Exterior(2R) 7-10-0 to 12-0-0, Interior(1) 12-0-0 to 13-0-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 7.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss D15	Truss Type Roof Special	Qty 2	Ply 1	Summit/102 Hawthorne Job Reference (optional)	146313643
----------------	--------------	----------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:29 2021 Page 1

ID: tjnOHGeVPJTiy41JASwyTKzhfUX-XM?JvSczWf\_KoLXJrf639QMgx\_zxfxS\_Td5SxyzCZFm



6x6 =

Scale = 1:24.6


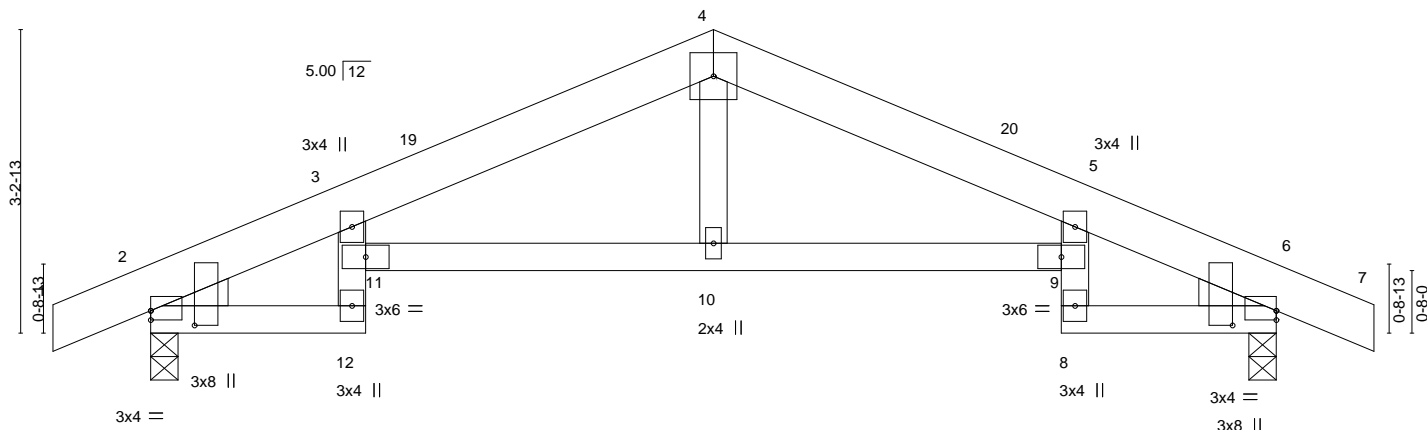


Plate Offsets (X,Y)--		[2:0-0-0,0-1-3], [2:0-1-14,0-5-10], [6:0-0-0,0-1-3], [6:0-1-14,0-5-10]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.29	DEFL.
TCDL 10.0	Lumber DOL 1.15	BC 0.47	in (loc) l/defl L/d
BCLL 0.0	Rep Stress Incr YES	WB 0.05	Vert(LL) -0.05 10-11 >999 240
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS	Vert(CT) -0.09 10-11 >999 180
			Horz(CT) 0.06 6 n/a n/a
			<b>PLATES</b> MT20
			<b>GRIP</b> 197/144
			Weight: 47 lb FT = 20%

#### LUMBER-

TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
WEDGE

Left: 2x4 SPF No.2 , Right: 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
Max Horz 2=46(LC 12)  
Max Uplift 2=89(LC 12), 6=89(LC 13)  
Max Grav 2=613(LC 1), 6=613(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-673/220, 3-4=-953/299, 4-5=-953/299, 5-6=-673/220  
BOT CHORD 2-12=-130/495, 10-11=-178/881, 9-10=-178/881, 6-8=-130/495

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-8 to 2-0-11, Interior(1) 2-0-11 to 6-0-0, Exterior(2R) 6-0-0 to 9-0-0, Interior(1) 9-0-0 to 13-0-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313644
2809580	D16	Common	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:30 2021 Page 1

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-?YZi7odbHz6BQV6VOMdlhdvrXNMCOOf7iHq?3OzCZFI



Scale = 1:22.7

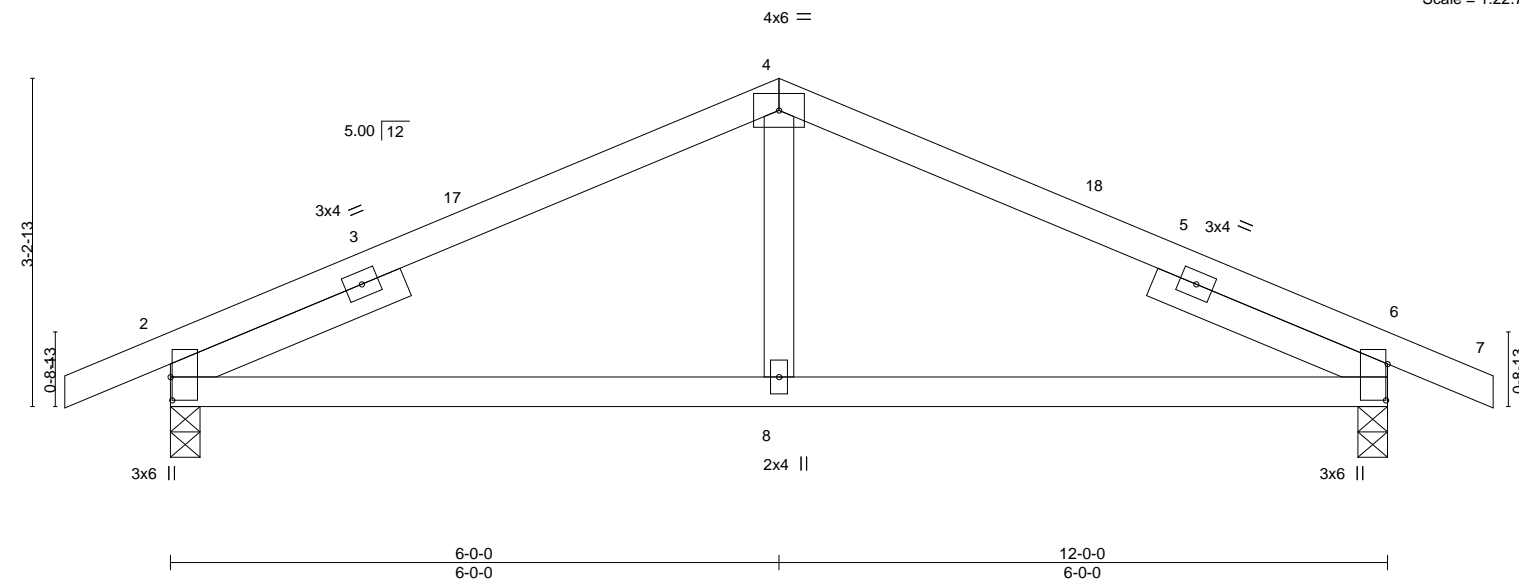


Plate Offsets (X,Y)--		[2:0-2-12,0-0-3], [6:0-4-5,0-0-3]							
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0		Plate Grip DOL	1.15	TC 0.30		Vert(LL)	-0.04 8-15	>999	240
TCDL 10.0		Lumber DOL	1.15	BC 0.28		Vert(CT)	-0.06 8-15	>999	180
BCLL 0.0		Rep Stress Incr	YES	WB 0.05		Horz(CT)	0.02 2	n/a	n/a
BCDL 10.0		Code IRC2018/TPI2014		Matrix-AS					
						<b>PLATES</b>	<b>GRIP</b>		
						MT20	197/144		
						Weight: 40 lb	FT = 20%		

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 -t 2-6-0, Right 2x4 SPF No.2 -t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
 BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
 Max Horz 2=46(LC 12)  
 Max Uplift 2=-89(LC 12), 6=-89(LC 13)  
 Max Grav 2=613(LC 1), 6=613(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-674/247, 4-6=-674/247  
 BOT CHORD 2-8=-126/612, 6-8=-126/612

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-0-8 to 1-11-8, Interior(1) 1-11-8 to 6-0-0, Exterior(2R) 6-0-0 to 9-0-0, Interior(1) 9-0-0 to 13-0-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 6.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017


Job 2809580	Truss E01	Truss Type Roof Special Girder	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313645
----------------	--------------	-----------------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:30 2021 Page 1

ID:tinOHGeVPJTiy41JASwyTKzhfUX-?YZi7odbHz6BQV6VOMdlhdvoNNMI0OV7iHq?3OzCZFI

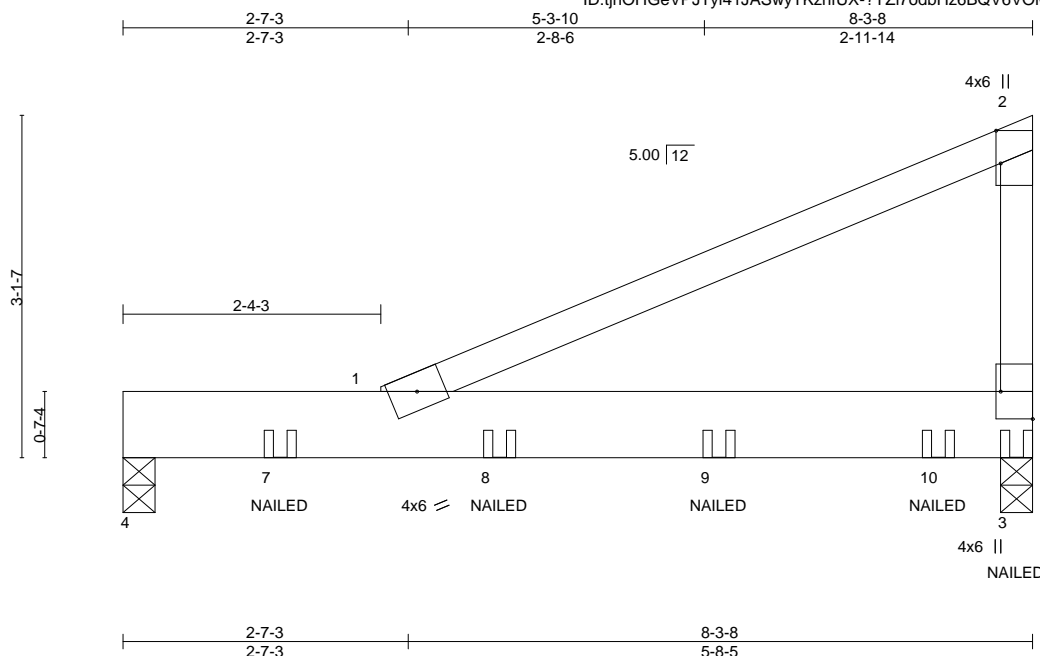

Scale = 1:21.0

Plate Offsets (X,Y)-- [2:0-3-9,Edge], [3:Edge,0-3-8]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	25.0	Plate Grip DOL	1.15	TC	0.51	Vert(LL)	-0.07 3-5	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.31	Vert(CT)	-0.12 3-5	>834	180		
BCLL	0.0	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00 3	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 35 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x8 SP 2400F 2.0E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=0-3-8, 4=0-3-8  
Max Horz 4=102(LC 5)  
Max Grav 3=761(LC 1), 4=564(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 4) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 5) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-70, 1-4=-90, 1-3=-20  
Concentrated Loads (lb)  
Vert: 3=-138(B) 7=-95(B) 8=-122(B) 9=-122(B) 10=-128(B)



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss E02	Truss Type Monopitch	Qty 1	Ply 1	Summit/102 Hawthorne	146313646
----------------	--------------	-------------------------	----------	----------	----------------------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:31 2021 Page 1

ID:tnOHGeVPJTiy41JASwyTKzhfUX-TI74K8eE2GF22fhhy38XErSuDnbq7r7HwxaZbqzCZFk

-0-10-8	2-8-5	6-2-3	8-2-0	8-3-8
0-10-8	2-8-5	3-5-14	1-11-13	0-1-8

Scale: 1/2"=1'

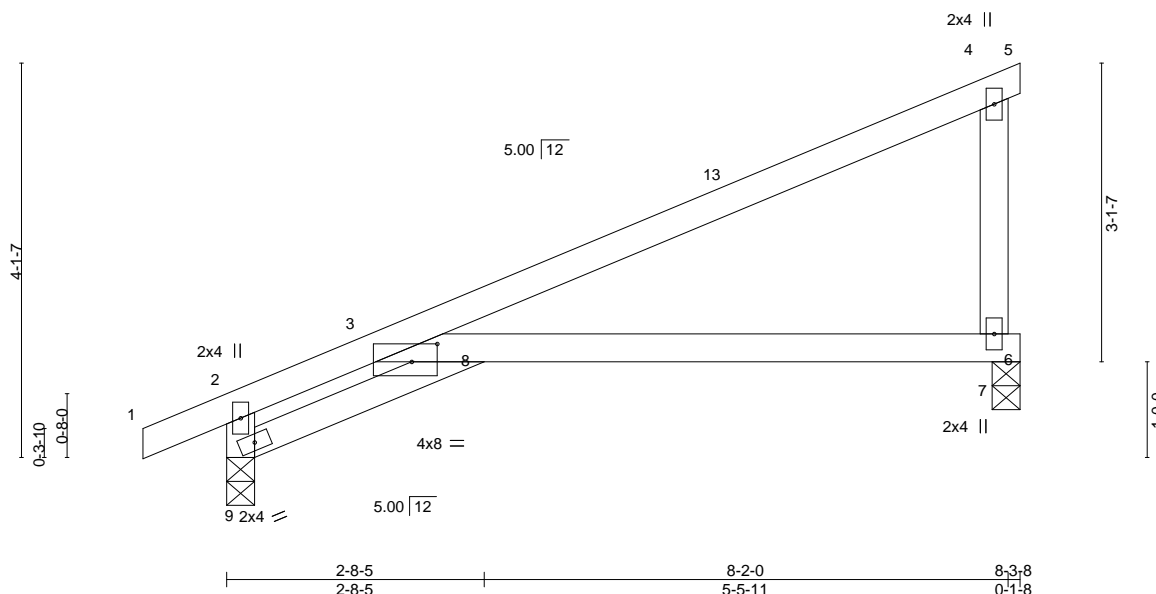


Plate Offsets (X,Y)--		[8:0-3-3,0-2-4]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d			<b>PLATES GRIP</b>		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.76	Vert(LL)	-0.24	7-8	>395	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.76	Vert(CT)	-0.45	7-8	>211	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.16	7	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 25 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 7=0-3-8, 9=0-3-8  
Max Horz 9=131(LC 12)  
Max Uplift 7=-100(LC 12), 9=-51(LC 12)  
Max Grav 7=361(LC 1), 9=430(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-9=-405/231

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-3-2, Interior(1) 2-3-2 to 8-3-8 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 9.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss E03	Truss Type HALF HIP	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313647
----------------	--------------	------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:32 2021 Page 1

ID:tnOHGeVPJTYi41JASwyTKzhfUX-xxhSYUfspaNvpGuWngmm2\_4lByEslTQ9bJ68GzCZFj

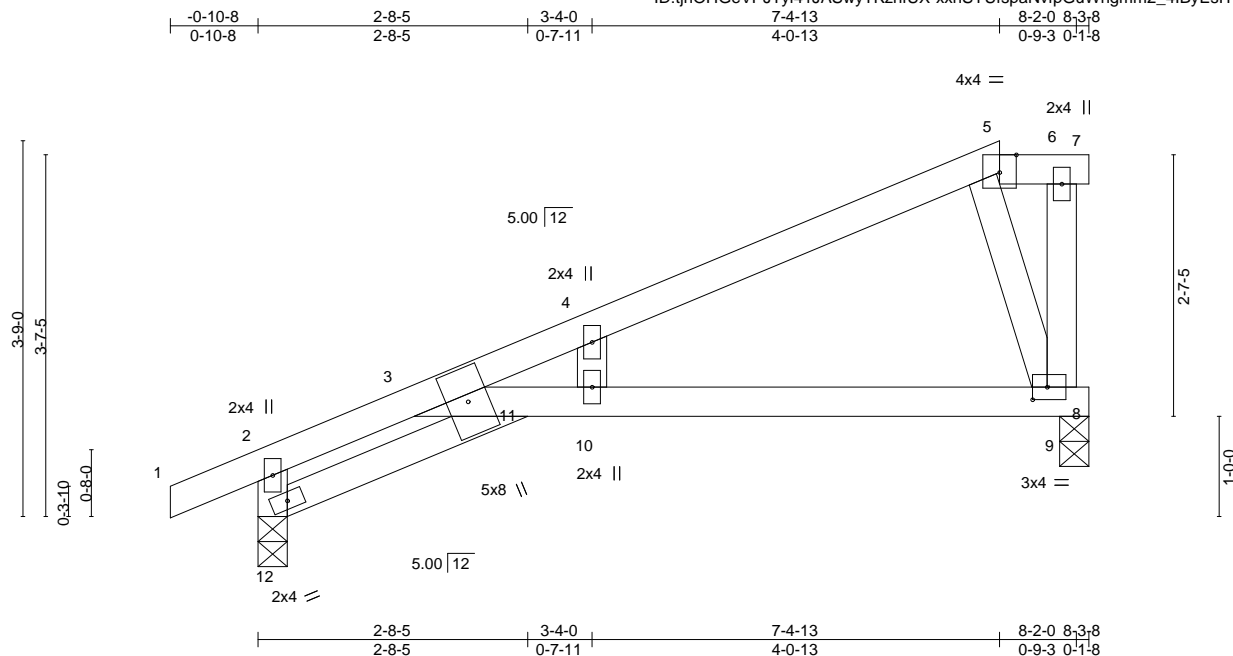

Scale = 1:23.0

Plate Offsets (X,Y)-- [5:0-2-0,Edge], [9:0-1-12,0-1-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.67	Vert(LL)	-0.23 9-10 >420 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.69	Vert(CT)	-0.42 9-10 >226 180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.15 9 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 28 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 5-7.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 9=0-3-8, 12=0-3-8  
Max Horz 12=114(LC 12)  
Max Uplift 9=78(LC 12), 12=58(LC 12)  
Max Grav 9=361(LC 1), 12=430(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-12=405/213

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-3-2, Interior(1) 2-3-2 to 7-4-13, Exterior(2E) 7-4-13 to 8-3-8 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearing at joint(s) 12 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9, 12.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 9) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 2809580	Truss E04	Truss Type HALF HIP GIRDER	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313648
----------------	--------------	-------------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:33 2021 Page 1

ID:tnOHGeVPJTiy41JASwyTKzhfUX-P7FqlqfUauVmHrz44UB?JGXHTbEBbiVaOF3fgjzCZFi



Scale = 1:18.4

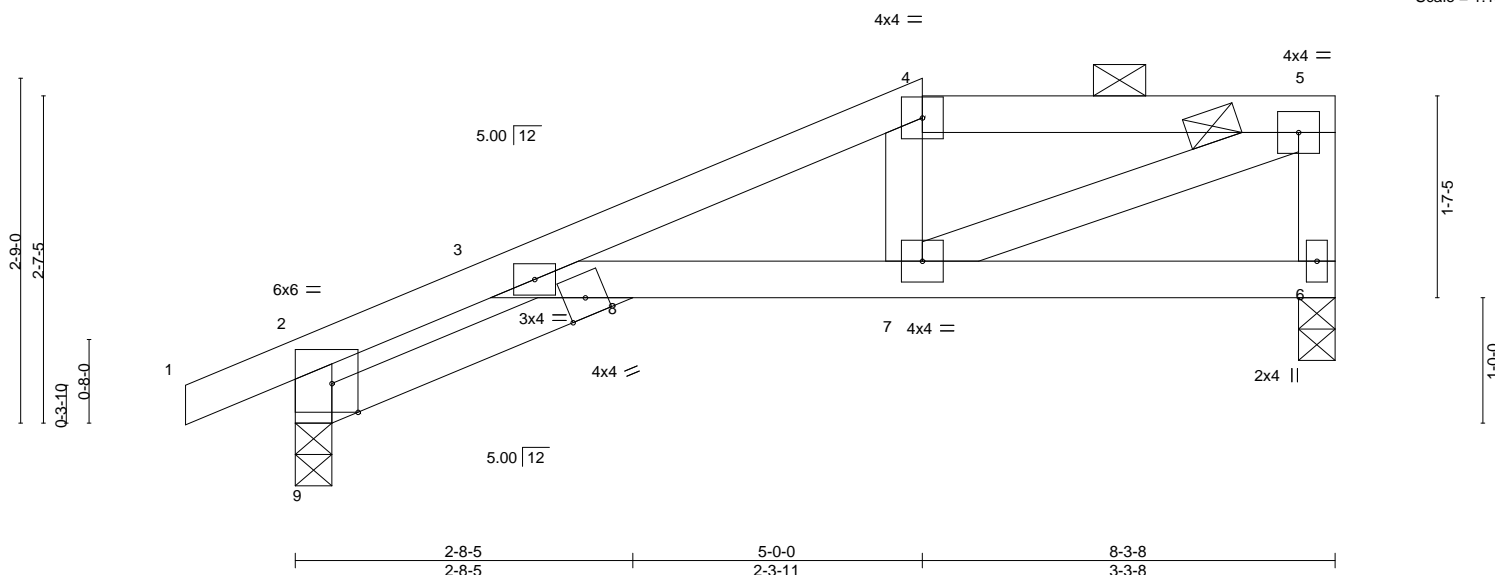


Plate Offsets (X,Y)-- [2:0-2-8,Edge]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES	GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.52	Vert(LL)	-0.07	8	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.83	Vert(CT)	-0.13	7-8	>719	180		
BCLL	0.0	Rep Stress Incr	NO	WB	0.24	Horz(CT)	0.06	6	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S							Weight: 29 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2 \*Except\*  
2-9: 2x4 SP 2400F 2.0E

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-1-8 oc purlins, except end verticals, and 2-0-0 oc purlins (5-9-13 max.): 4-5.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 6=0-3-8, 9=0-3-8  
Max Horz 9=81(LC 5)  
Max Uplift 6=-116(LC 5), 9=-85(LC 8)  
Max Grav 6=556(LC 1), 9=553(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-9=-693/151, 2-3=-780/159, 3-4=-1027/187, 4-5=-953/202, 5-6=-534/135  
BOT CHORD 8-9=-170/625, 3-8=-56/378, 7-8=-191/940  
WEBS 5-7=-199/978

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 9 except (jt=lb) 6=116.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Girder carries hip end with 0-0-0 right side setback, 5-0-0 left side setback, and 4-0-0 end setback.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 187 lb down and 65 lb up at 5-0-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-70, 2-4=-70, 4-5=-100(F=-30), 8-9=-29(F=-9), 3-8=-9(F), 6-8=-29(F=-9)



May 27, 2021

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	I46313648
2809580	E04	HALF HIP GIRDER	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:33 2021 Page 2  
ID:tjnOHGeVPJTyi41JASwyTKzhfUX-P7FqlqfUauVmHrz44UB?JGXHTbEBbiVaOF3fgjzCZF

**LOAD CASE(S)** Standard  
Concentrated Loads (lb)  
Vert: 4=-146(F)

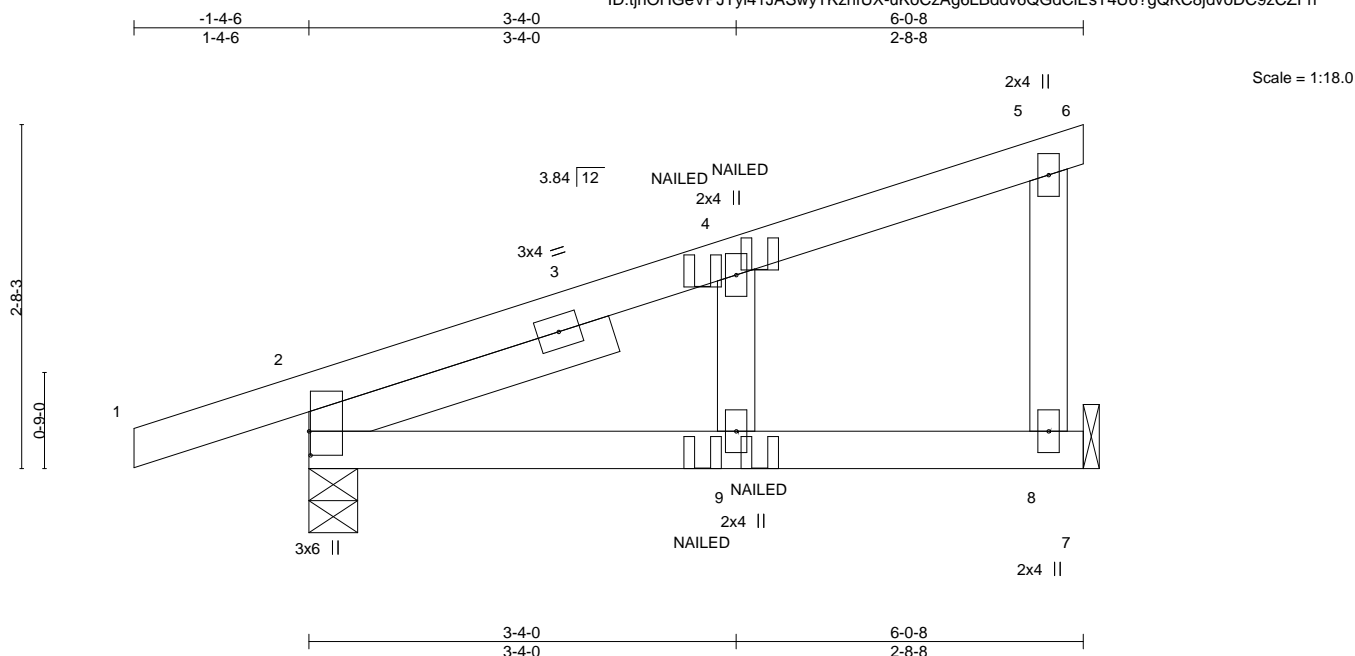


Plate Offsets (X,Y)--		[2:0-2-4,0-0-2]									
<b>LOADING</b>	(psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc)	I/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL	1.15	TC	0.39	Vert(LL)	-0.07 9-12	>962	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.45	Vert(CT)	-0.13 9-12	>522	180		
BCLL	0.0	Rep Stress Incr	NO	WB	0.02	Horz(CT)	0.03 2	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 22 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 -t 2-6-0

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

(size) 2=0-4-9, 8=Mechanical  
Max Horz 2=92(LC 4)  
Max Uplift 2=-85(LC 4), 8=-65(LC 8)  
Max Grav 2=367(LC 1), 8=260(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD      2-4=-331/82

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 8.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

## LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-5=-70, 5-6=-20, 7-10=-20  
Concentrated Loads (lb)  
Vert: 9=-1(F=0, B=-1)



May 27, 2021



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**


**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Page 1

Scale = 1:12.2




Job 2809580	Truss J03	Truss Type JACK-OPEN GIRDER	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313651
----------------	--------------	--------------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:36 2021 Page 1

ID:tjnOHGeVPJTYi41JASwyTKzhfUX-qjwzNsiMtpTK8Qafldkixu9ueoReo4U04DHJH2zCZFf

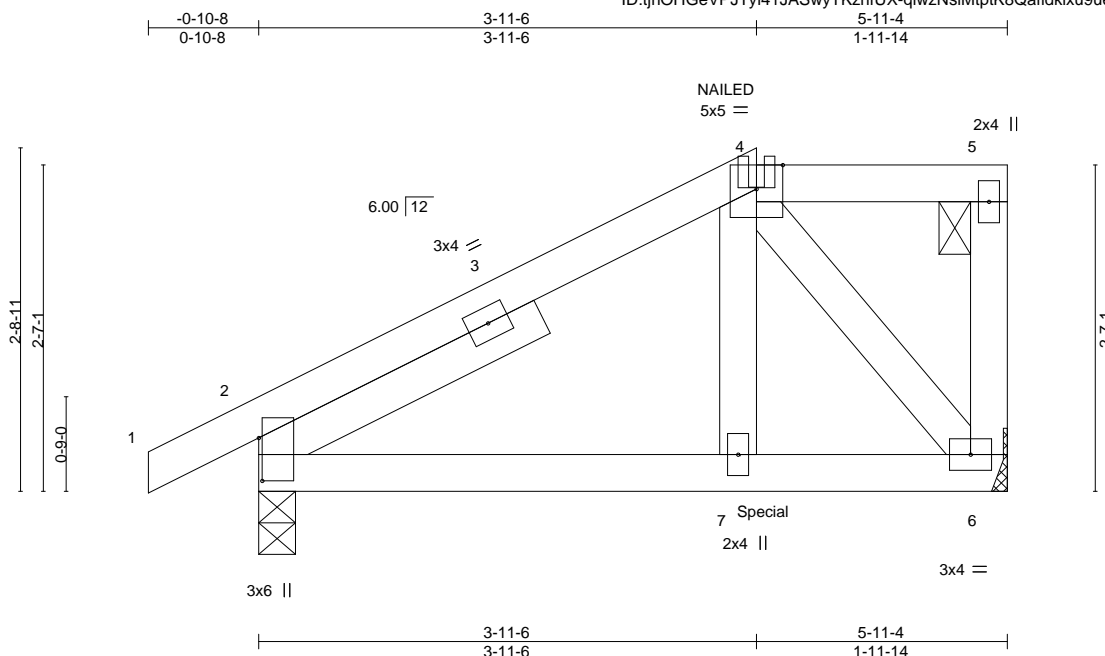

Scale = 1:18.3

Plate Offsets (X,Y)--		[2:0-4-1,0-0-5]											
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.14	Vert(LL)	0.01	7-10	>999	240	MT20	197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.15	Vert(CT)	-0.01	7-10	>999	180			
BCLL	0.0	Rep Stress Incr	NO	WB	0.10	Horz(CT)	0.00	2	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP							Weight: 26 lb	FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 -t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-4 oc purlins, except 2-0-0 oc purlins: 4-5.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-3-8, 6=Mechanical  
Max Horz 2=83(LC 8)  
Max Uplift 2=-78(LC 8), 6=-107(LC 8)  
Max Grav 2=444(LC 1), 6=487(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-380/76  
BOT CHORD 2-7=-89/345, 6-7=-86/324  
WEBS 4-7=-45/342, 4-6=-524/139

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Refer to girder(s) for truss to truss connections.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 6=107.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 270 lb down and 72 lb up at 3-11-6 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)  
Vert: 1-4=-70, 4-5=-70, 6-8=-20
- Concentrated Loads (lb)  
Vert: 4=-79(B) 7=-270(B)



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	I46313652
2809580	J04	HALF HIP	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:37 2021 Page 1

ID:tnOHGeVPJTiy41JASwyTKzhfUX-luULbCi\_e6?Bma8rJKFXT6i1XCjcXYx9Jt1tpUzCZFe

-0-10-8 2-11-10 5-7-6 5-11-4  
0-10-8 2-11-10 2-7-12 0-3-14

Scale = 1:21.4

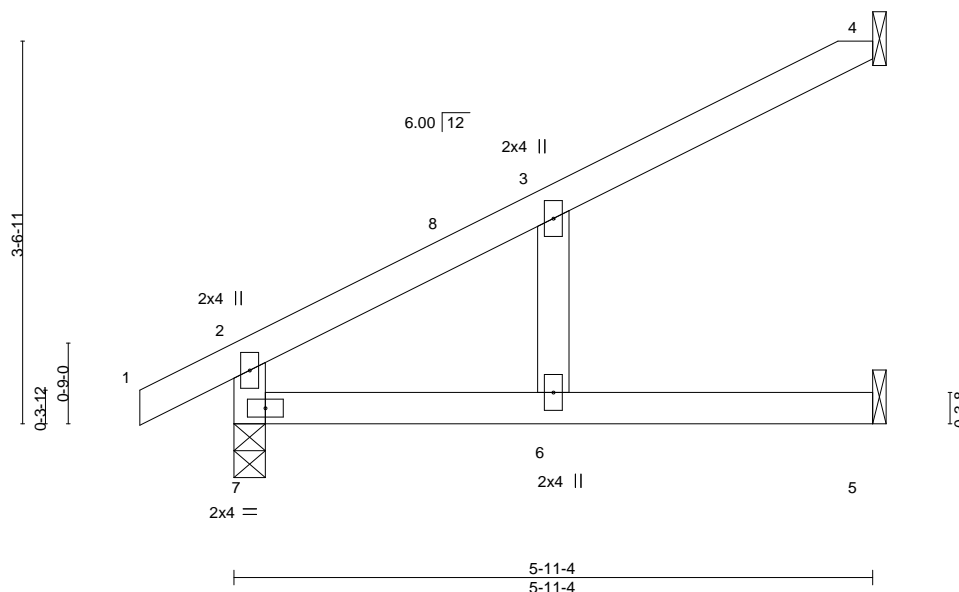

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.32	Vert(LL)	0.09	6	>770	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.42	Vert(CT)	-0.14	6	>492	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.04	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 18 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
Max Horz 7=114(LC 12)  
Max Uplift 4=64(LC 12), 5=17(LC 12), 7=32(LC 12)  
Max Grav 4=153(LC 1), 5=99(LC 1), 7=336(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 5-10-8 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



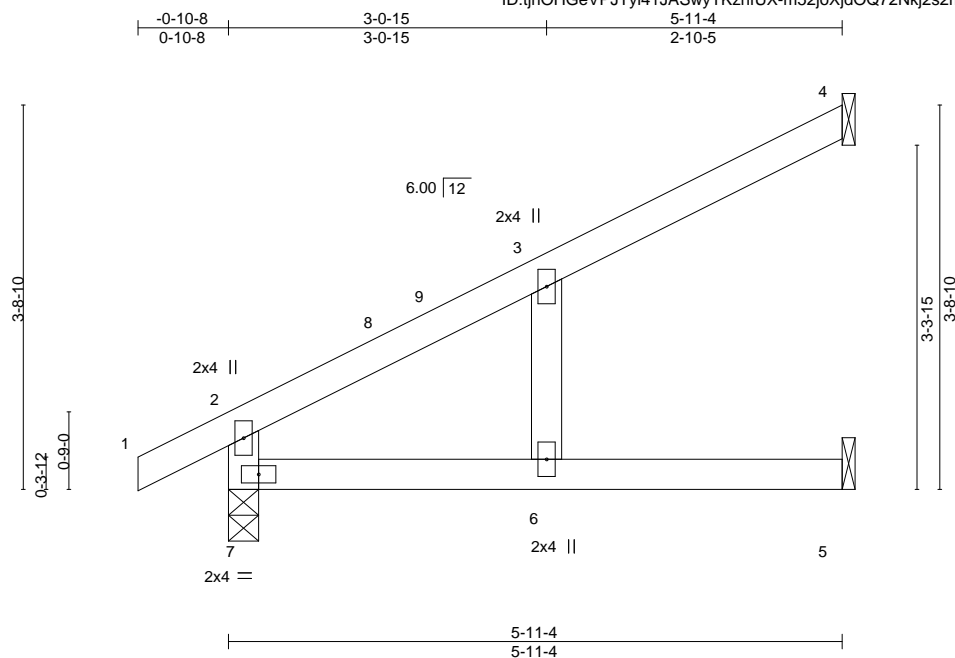

Scale = 1:22.3

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc)	<b>L/defl</b>	<b>L/d</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.31	Vert(LL) 0.10 6	>697	240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.42	Vert(CT) -0.14 6	>492	180		
BCLL 0.0	Rep Stress Incr YES	WB 0.02	Horz(CT) 0.04 4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-AS				Weight: 18 lb	FT = 20%

**LUMBER-**

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	Rigid ceiling directly applied.

**REACTIONS.**

(size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
 Max Horz 7=114(LC 12)  
 Max Uplift 4=-63(LC 12), 5=-18(LC 12), 7=-32(LC 12)  
 Max Grav 4=151(LC 1), 5=100(LC 1), 7=336(LC 1)

**FORCES.**

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 5-10-8 zone; cantilever left and right exposed ; end vertical left exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021


 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

**WARNING – Velly design parameters are listed below and included within key reference 1. See MH-1413 (Rev. 3/19/2020) for more details.**  
 Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for the building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:38 2021 Page 1  
ID:tinOHGeVPJTwi41JASwTKzhfUX-m52ioXidQQ72Nki2s2mA0JEBoc35G?9JXXmQLwzCZFd




<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied.
WEBS	2x4 SPF No.2		

**REACTIONS.** (size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
 Max Horz 7=114(LC 12)  
 Max Uplift 4=-69(LC 12), 5=-13(LC 12), 7=-31(LC 12)  
 Max Grav 4=159(LC 1), 5=96(LC 3), 7=336(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 5-10-8 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personnel injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Code**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



Job 2809580	Truss J07	Truss Type HALF HIP	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313655
----------------	--------------	------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:39 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-EHc50tkF9kFv?uIEQIIPZXnlE0UK?S9SmBW\_tNzCZFc



Scale = 1:21.6

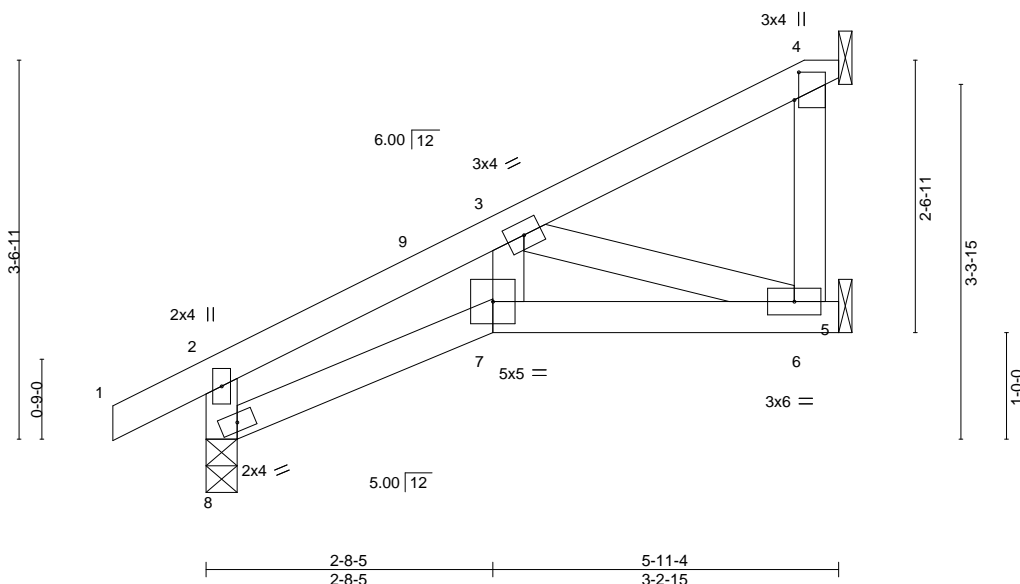


Plate Offsets (X,Y)--		[4:0-3-2,0-0-8]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d			<b>PLATES GRIP</b>		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.63	Vert(LL)	-0.14	7	>472	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	-0.25	7	>267	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.04	Horz(CT)	0.10	6	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 22 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 6=Mechanical, 4=Mechanical, 8=0-3-8  
Max Horz 8=117(LC 12)  
Max Uplift 6=19(LC 12), 4=58(LC 12), 8=30(LC 12)  
Max Grav 6=65(LC 3), 4=215(LC 1), 8=326(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-8=-301/200

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 5-8-0 zone; cantilever left and right exposed; end vertical left exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 6, 4, 8.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
- 8) Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J08	Truss Type Jack-Open	Qty 2	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313656
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:40 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-iTATDDltw1Nmd1tQ\_Spe5kJbgPqEkvcz?rFXQpZCZFb

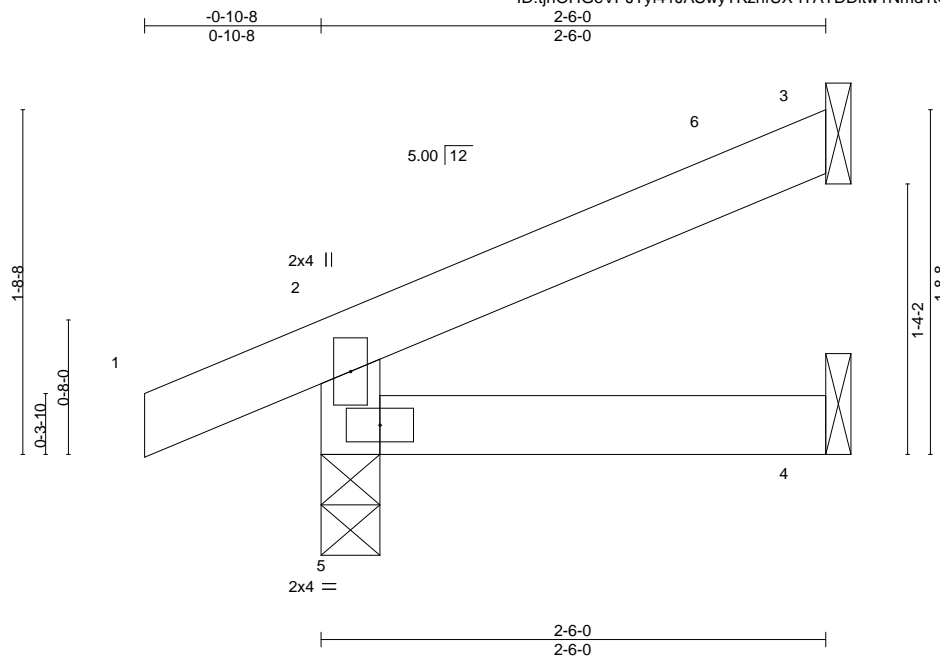

Scale = 1:11.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	-0.00	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=43(LC 12)  
Max Uplift 3=-32(LC 12), 5=-29(LC 8)  
Max Grav 3=65(LC 1), 4=42(LC 3), 5=191(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 2-5-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss J09	Truss Type Half Hip Girder	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313657
----------------	--------------	-------------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:41 2021 Page 1

ID:tnOHGeVPJT41JASwyTKzhfUX-AgksRZmVhLVdEBSyYAKteysi\_p5iTM0IEV74yFzCZFa



Scale = 1:18.0

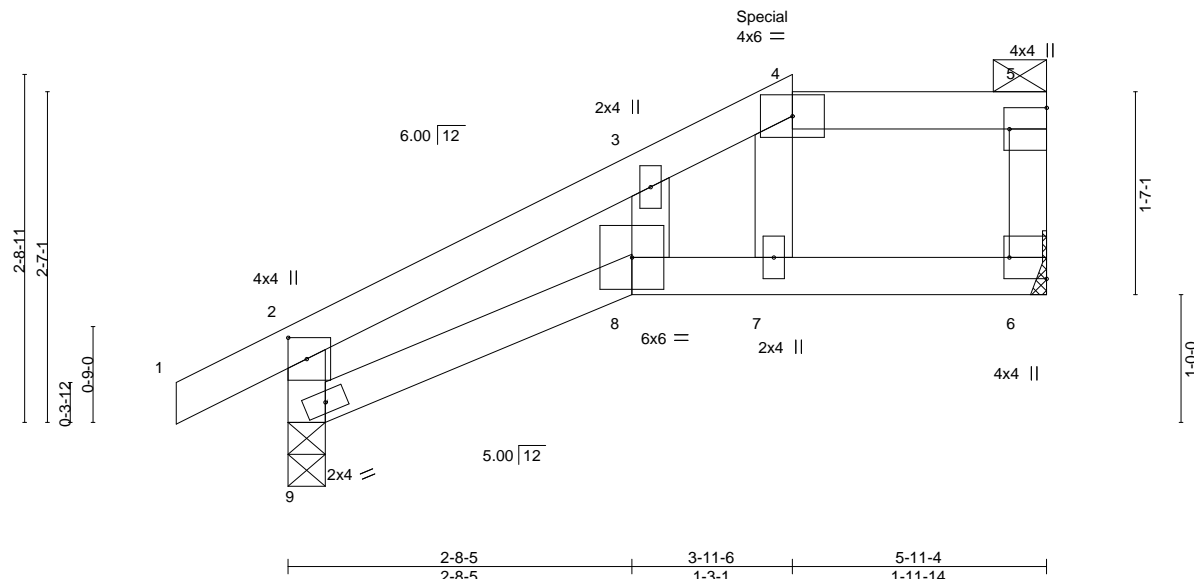


Plate Offsets (X,Y)--		[2:0-2-0,0-1-12], [5:Edge,0-3-8], [6:Edge,0-3-8]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.35
TCDL 10.0	Lumber DOL	1.15	BC 0.35
BCLL 0.0	Rep Stress Incr	NO	WB 0.05
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-MR
			<b>DEFL.</b> in (loc) l/defl L/d
			Vert(LL) 0.12 8 >564 240
			Vert(CT) 0.10 8 >658 180
			Horz(CT) -0.05 6 n/a n/a
			<b>PLATES</b> MT20 <b>GRIP</b> 197/144
			Weight: 19 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-4 oc purlins, except end verticals, and 2-0-0 oc purlins: 4-5.  
BOT CHORD Rigid ceiling directly applied or 9-10-12 oc bracing.

#### REACTIONS.

(size) 6=Mechanical, 9=0-3-8  
Max Horz 9=78(LC 5)  
Max Uplift 6=-368(LC 5), 9=-209(LC 8)  
Max Grav 6=307(LC 1), 9=361(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-335/341, 3-4=-205/274, 4-5=-223/314, 2-9=-376/282  
BOT CHORD 8-9=-303/231, 7-8=-269/208, 6-7=-301/218  
WEBS 4-7=-97/302

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=368, 9=209.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 120 lb down and 516 lb up at 3-11-6 on top chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)  
Vert: 1-2=-70, 2-4=-70, 4-5=-70, 8-9=-20, 6-8=-20
- Concentrated Loads (lb)  
Vert: 4=-88(F)



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J10	Truss Type Jack-Open	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313658
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:42 2021 Page 1

ID:tjnOHGeVPJTYi41JASwyTKzhfUX-fsHEvm7SfdUsL1p5tr6A9PwcDVTcpTvS8keUhzCZFZ

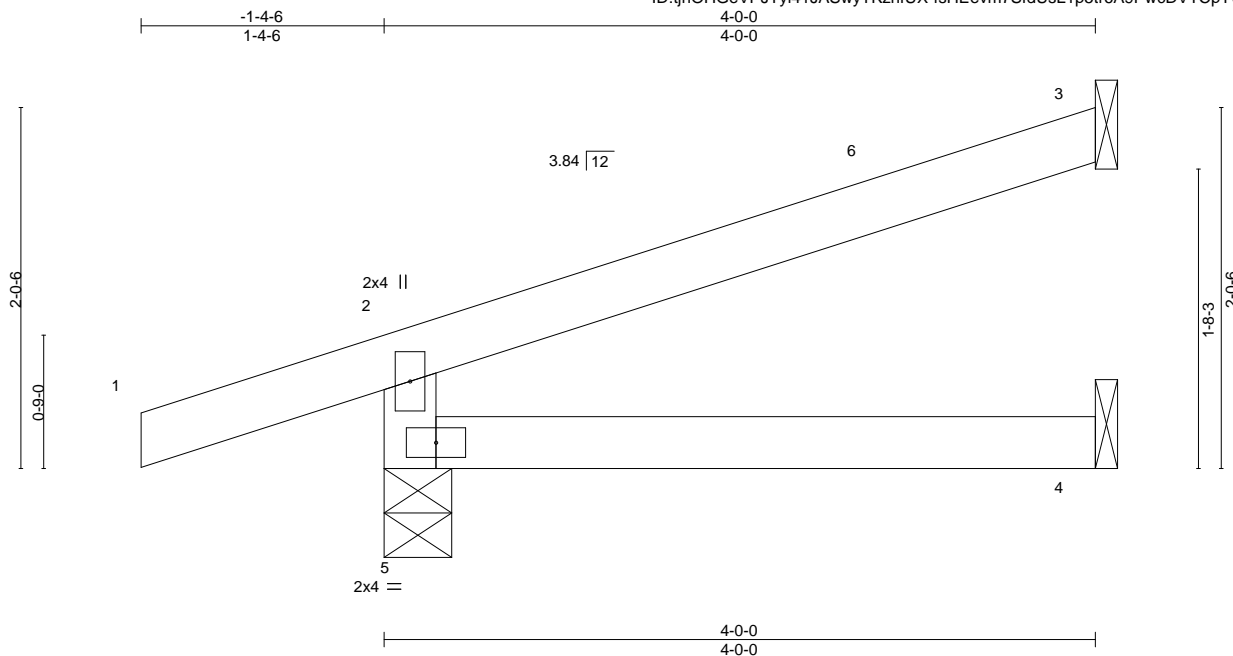

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	-0.01	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	-0.02	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.01	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 11 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 5=0-4-9, 3=Mechanical, 4=Mechanical  
Max Horz 5=61(LC 8)  
Max Uplift 5=-84(LC 8), 3=-46(LC 12)  
Max Grav 5=298(LC 1), 3=111(LC 1), 4=69(LC 3)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-5=-261/212

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-4-6 to 2-10-8, Exterior(2R) 2-10-8 to 3-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component


Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:42 2021 Page 1  
ID:tjnOHGeVJTYi41JASwTKzhfUX-fsHEvm7SfdUsL1p5tr6A9PwBDV1CpTvS8keUhzCZFZ




<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 3-4-7 oc purlins, except end verticals.
BOT CHORD	2x4 SPF No.2		
WEBS	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDD=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-3-11 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and BMS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



**WARNING:** - verify design parameters and READ NOTES ON THIS AND INCLUDED MITER REFERENCE PAGE MM1/473 (rev. 3/19/2020) BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




Job 2809580	Truss J12	Truss Type Jack-Open Girder	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313660
----------------	--------------	--------------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:43 2021 Page 1  
ID:tjnOHGeVPJTyi41JASwyTKzhfUX-72rcsFnIDylLUVc?fbMLjNx4?dp3xGj2hoUB18zCZFY

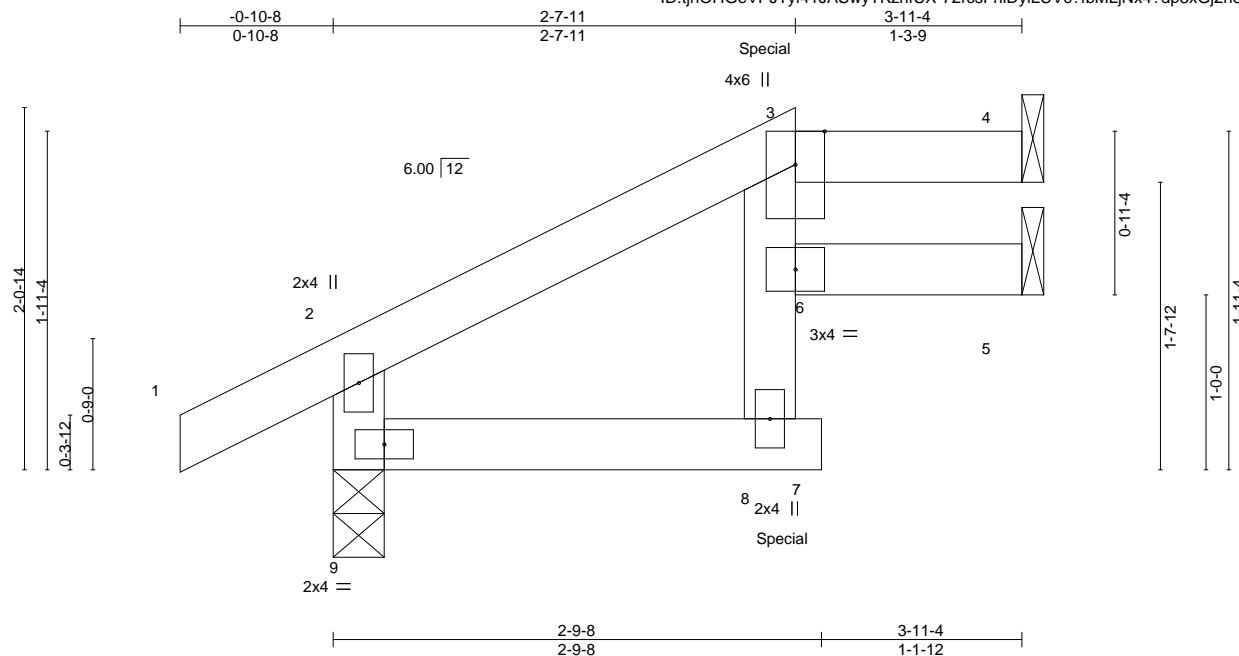

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.19	Vert(LL)	-0.01	7	>999	240	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.22	Vert(CT)	-0.03	7	>999	180	197/144
BCLL 0.0	Rep Stress Incr	NO	WB 0.00	Horz(CT)	0.01	4	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						
								Weight: 13 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-4 oc purlins, except end verticals, and 2-0-0 oc purlins: 3-4.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 5=Mechanical, 9=0-3-8  
Max Horz 9=52(LC 8)  
Max Uplift 4=33(LC 5), 5=22(LC 8), 9=48(LC 8)  
Max Grav 4=121(LC 22), 5=95(LC 1), 9=277(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-9=-253/65

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 9 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 9.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 102 lb down and 104 lb up at 2-7-11 on top chord, and 39 lb down at 2-5-15 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15
- Uniform Loads (plf)  
Vert: 1-2=-70, 2-3=-70, 3-4=-70, 8-9=-20, 7-8=-20, 5-6=-20
- Concentrated Loads (lb)  
Vert: 3=47(B) 8=-29(B)



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J13	Truss Type Jack-Open	Qty 3	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313661
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:44 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-bFP\_3boN\_GtC6fBBDItaGaUH41AkgjzBwSDIZazCZFX



Scale = 1:16.5

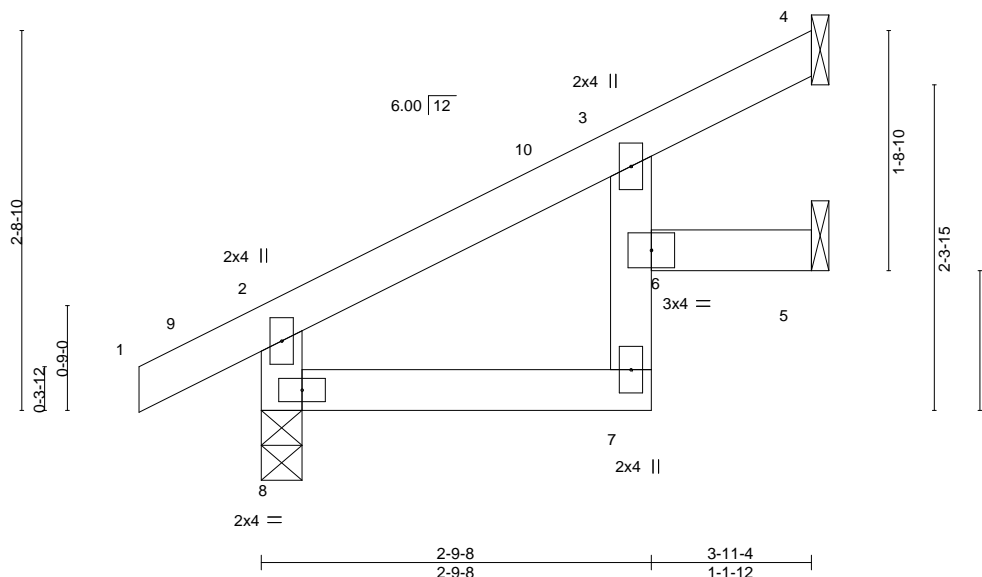

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	-0.01	6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.13	Vert(CT)	-0.01	7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	5	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 13 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-4 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 5=Mechanical, 8=0-3-8  
Max Horz 8=78(LC 12)  
Max Uplift 4=33(LC 12), 5=22(LC 12), 8=26(LC 12)  
Max Grav 4=87(LC 1), 5=71(LC 1), 8=249(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 8.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J14	Truss Type Jack-Open	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313662
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:45 2021 Page 1

ID: tjnOHGeVPJTyi41JASwyTKzhfUX-3RzMGxp0la?3jpmOn0Opoo1QRQWsPADL86zl50zCZFW

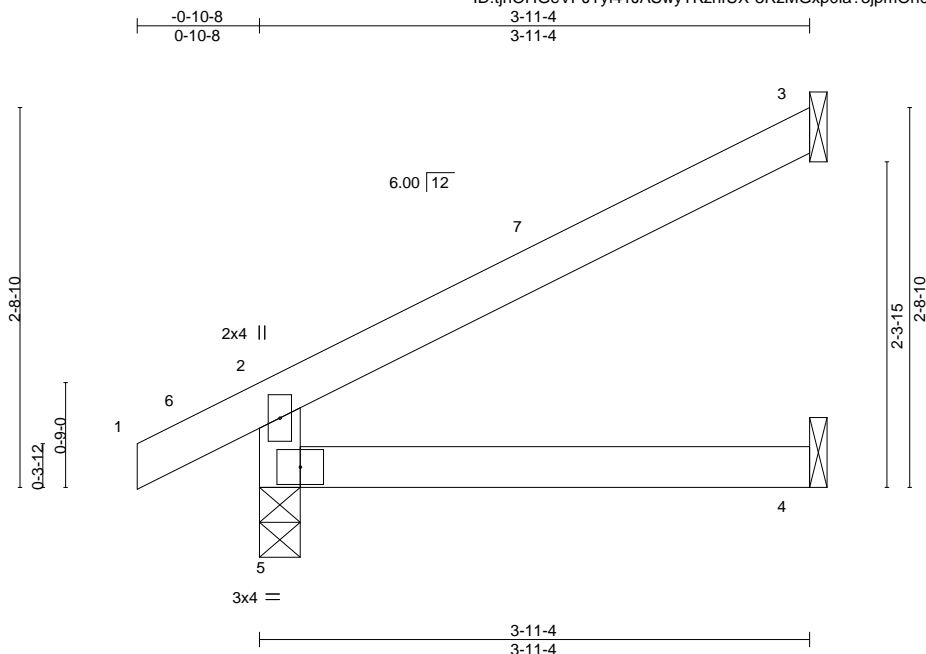

Scale = 1:16.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.20	Vert(LL)	-0.01	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.14	Vert(CT)	-0.02	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 11 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-4 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 4=Mechanical, 5=0-3-8

Max Horz 5=78(LC 12)

Max Uplift 3=-58(LC 12), 5=-26(LC 12)

Max Grav 3=114(LC 1), 4=70(LC 3), 5=249(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J15	Truss Type Jack-Open	Qty 4	Ply 1	Summit/102 Hawthorne 146313663
----------------	--------------	-------------------------	----------	----------	-----------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:45 2021 Page 1

ID:tjnOHGeVPJT41JASwyTKzhfUX-3RzMGxp0la?3jpmOn0Opoo1RxQWxPA1L86z150zCZFW

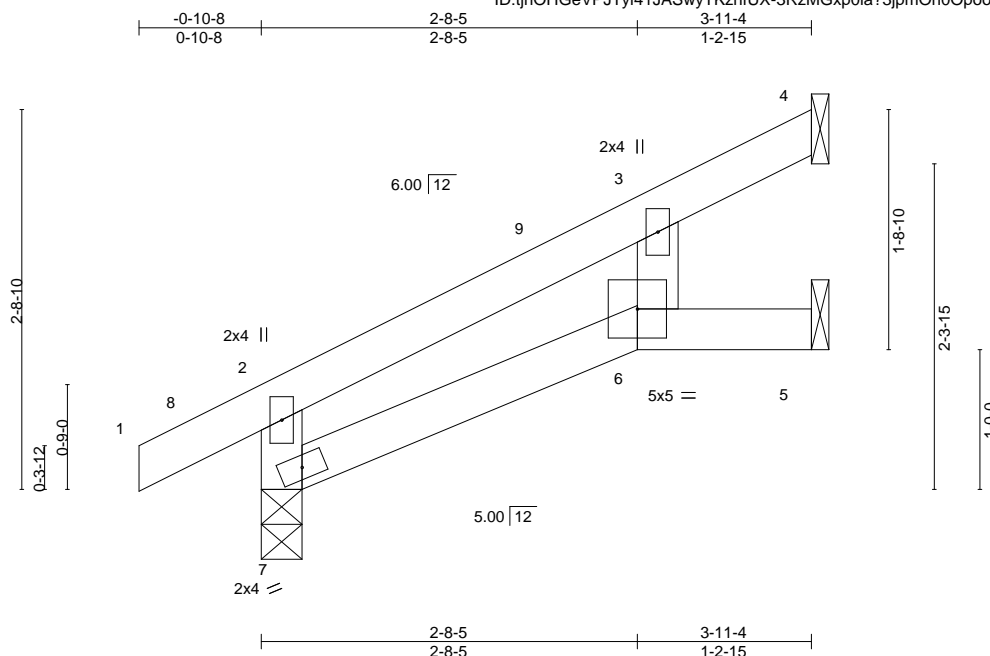

Scale = 1:16.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.16	Vert(LL)	0.02	6-7	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.13	Vert(CT)	-0.02	6-7	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.01	Horz(CT)	-0.01	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						Weight: 12 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-11-4 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
Max Horz 7=77(LC 12)  
Max Uplift 4=-36(LC 12), 5=-19(LC 12), 7=-25(LC 12)  
Max Grav 4=91(LC 1), 5=67(LC 1), 7=249(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J16	Truss Type Jack-Open	Qty 5	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313664
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:46 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-XdXlUGpeWt7wLyLaKjw2L?Zb6qr38dTUNmirdTzCZfV

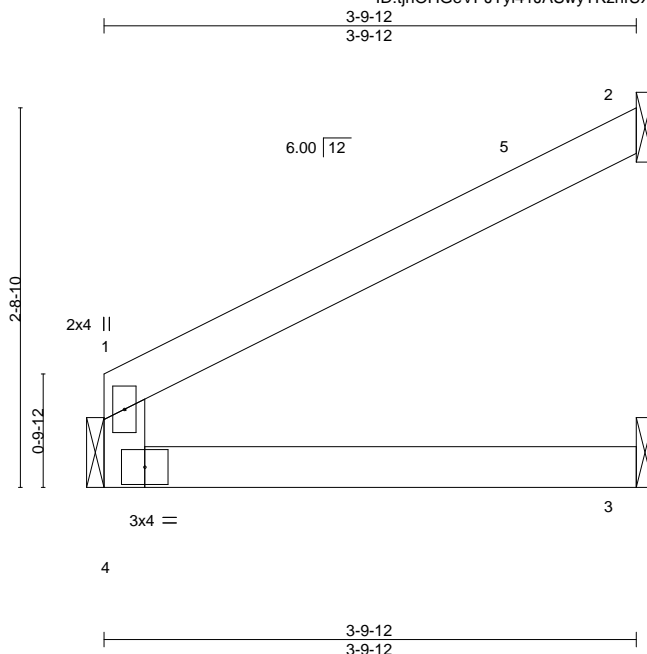

Scale = 1:16.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.20	Vert(LL)	-0.01	3-4	>999	240	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.14	Vert(CT)	-0.02	3-4	>999	180	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	2	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						
								Weight: 10 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-9-12 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=Mechanical, 3=Mechanical, 4=Mechanical  
Max Horz 4=59(LC 12)  
Max Uplift 2=58(LC 12), 4=3(LC 12)  
Max Grav 2=116(LC 1), 3=69(LC 3), 4=162(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 3-9-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2809580	Truss J17	Truss Type Jack-Open	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	146313665
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:47 2021 Page 1

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-?q57hcqGHBGnz6vmuQRHtD6jFE7Tt4MecQSPAvzCZFU

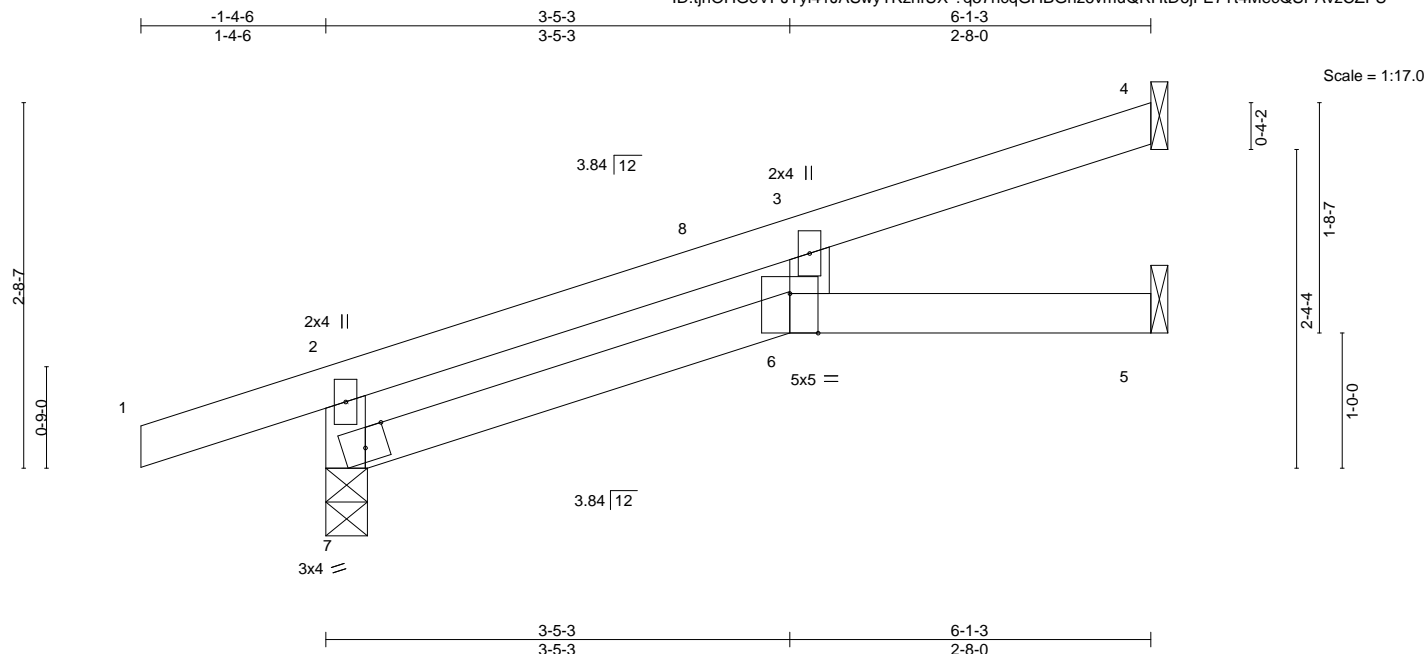


Plate Offsets (X,Y)--		[6:0-2-8,Edge], [7:0-2-0,Edge]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.37	Vert(LL)	0.10 6-7 >688 240	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.39	Vert(CT)	-0.14 6-7 >506 180				
BCLL	0.0	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.04 5 n/a n/a				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 17 lb	FT = 20%		

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 7=0-3-11, 4=Mechanical, 5=Mechanical  
Max Horz 7=85(LC 8)  
Max Uplift 7=92(LC 8), 4=50(LC 12), 5=12(LC 12)  
Max Grav 7=385(LC 1), 4=156(LC 1), 5=95(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-7=-292/191

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) -1-4-6 to 2-10-8, Exterior(2R) 2-10-8 to 6-0-7 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 7, 4, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss J18	Truss Type Jack-Open	Qty 2	Ply 1	Summit/102 Hawthorne 146313666
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:47 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-?q57hcqGHBGnz6vmuQRHtD6mfEBA4WecQSPAvzCZFU

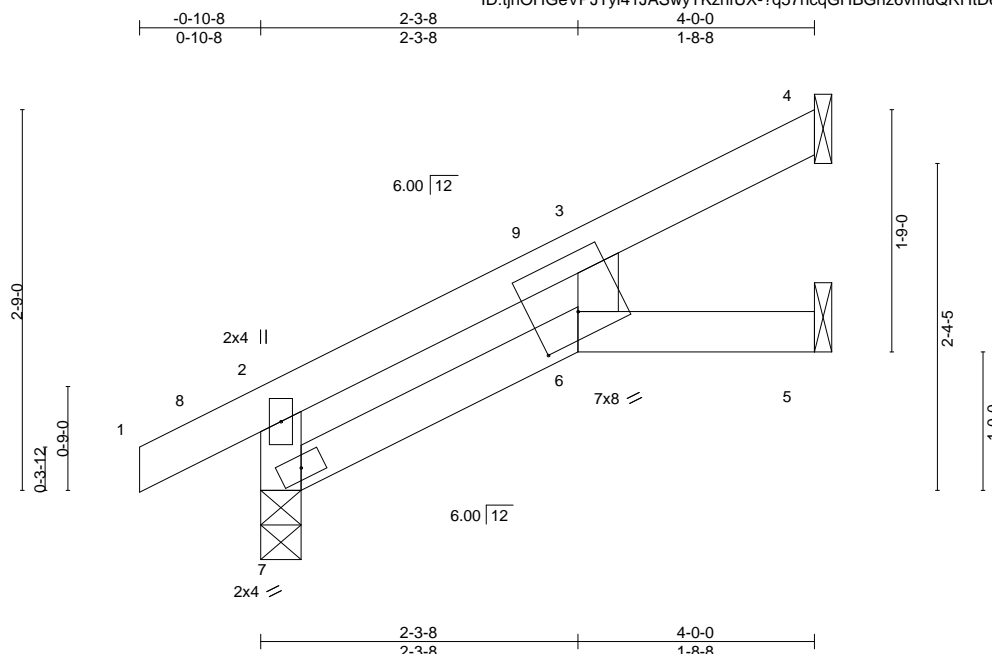

Scale = 1:16.6

Plate Offsets (X,Y)--		[6:0-4-0,0-2-4]										
LOADING	(psf)	SPACING-	2-0-0	CSI.		DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	25.0	Plate Grip DOL	1.15	TC	0.15	Vert(LL)	0.02	6	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.15	Vert(CT)	-0.02	6	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.01	Horz(CT)	-0.01	4	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 12 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
Max Horz 7=78(LC 12)  
Max Uplift 4=-44(LC 12), 5=-13(LC 12), 7=-25(LC 12)  
Max Grav 4=100(LC 1), 5=61(LC 1), 7=252(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss J19	Truss Type Jack-Open	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313667
----------------	--------------	-------------------------	----------	----------	--	-----------


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:48 2021 Page 1  
ID: tjnOHGeVPJTyi41JASwyTKzhfUX-T0fVvyru2VOdaGUzS8yWQQfy5eYScXynr4ByILzCZFT

-0-10-8 0-10-8 3-1-0 3-1-0

Scale = 1:14.4

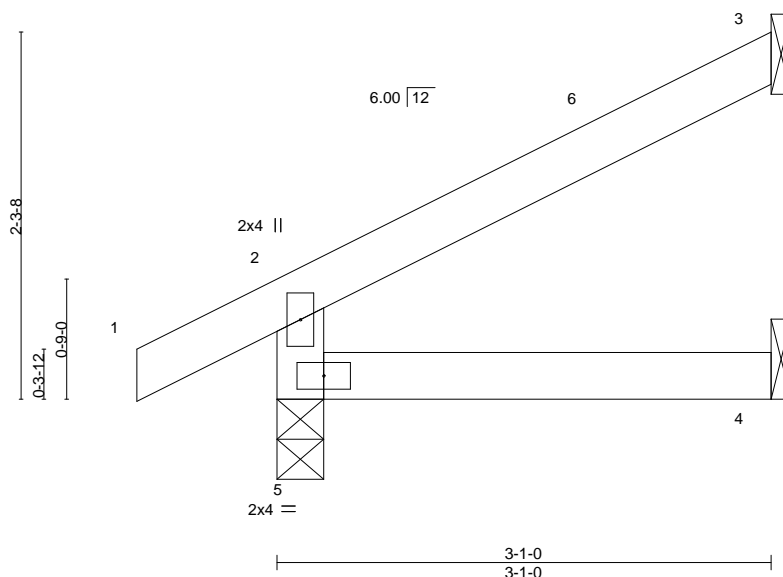

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.11	Vert(LL)	-0.00	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.08	Vert(CT)	-0.01	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.01	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 9 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-1-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=62(LC 12)  
Max Uplift 3=45(LC 12), 5=23(LC 12)  
Max Grav 3=85(LC 1), 4=54(LC 3), 5=214(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 3-0-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J20	Truss Type Jack-Open	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313668
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:49 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-xCct6lsWpoWUCQ390rTizeB7O2veL\_Cw3kxVEnzCZFS

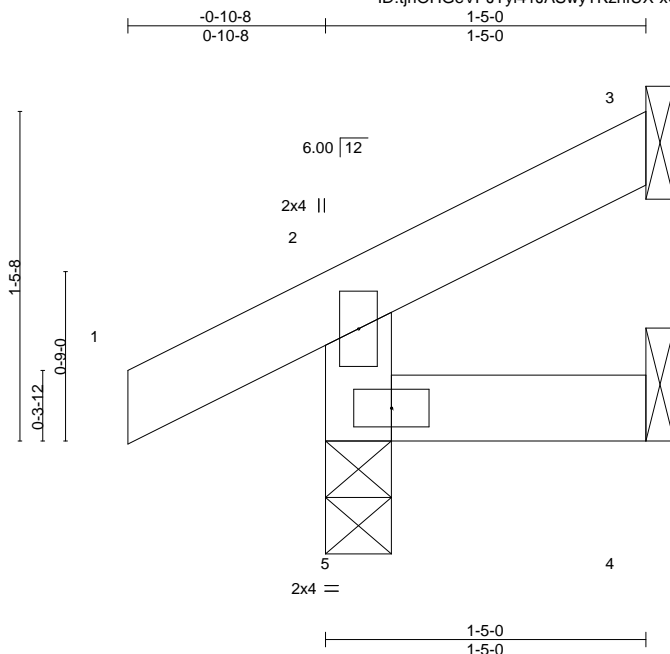

Scale = 1:10.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	0.00	5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 5 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-5-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=33(LC 9)  
Max Uplift 3=-19(LC 12), 4=-1(LC 9), 5=-21(LC 12)  
Max Grav 3=22(LC 1), 4=22(LC 3), 5=157(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 4, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss J21	Truss Type Diagonal Hip Girder	Qty 1	Ply 1	Summit/102 Hawthorne	146313669
----------------	--------------	-----------------------------------	----------	----------	----------------------	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:50 2021 Page 1

ID:tnOHGeVPJTiy41JASwyTKzhfUX-QPmFKet8a6eLqaeLZZ\_VrkGPRC54Qb4lOg3mEzCZFR

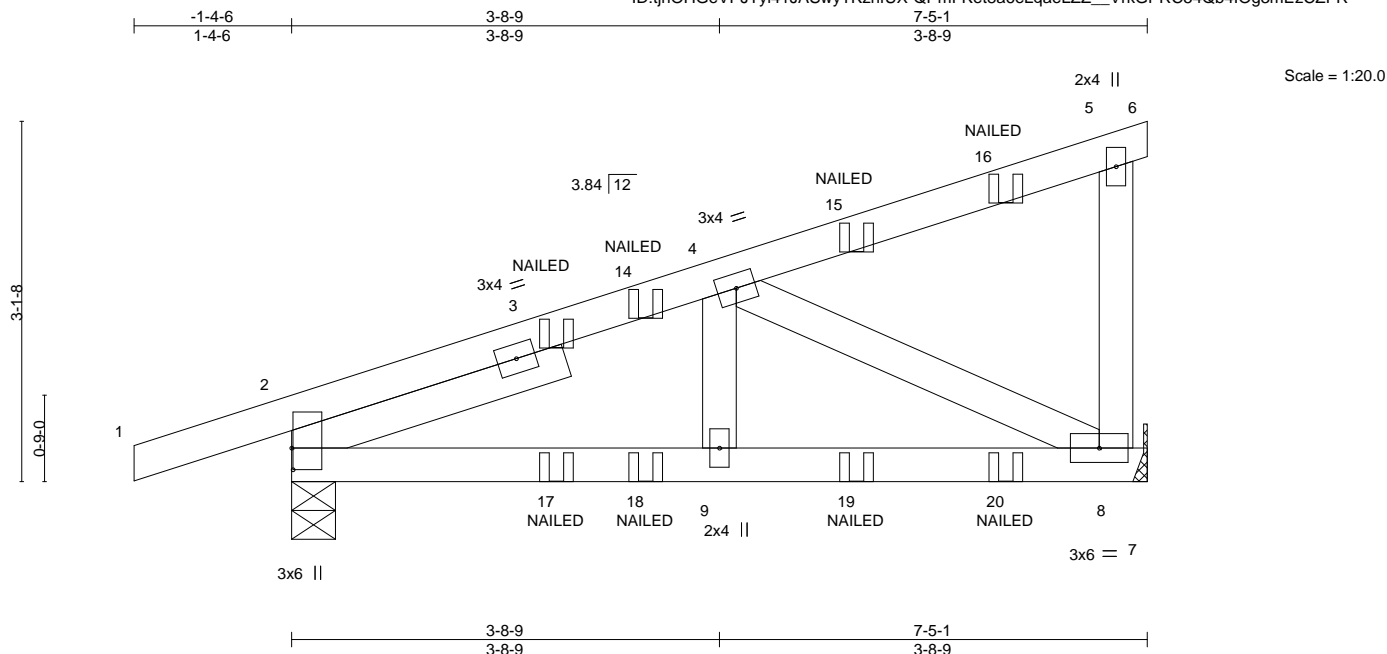


Plate Offsets (X,Y)--	[2:0-2-4,0-0-2]								
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.25	Vert(LL)	-0.01	8-9	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.20	Vert(CT)	-0.02	8-9	>999		
BCLL 0.0	Rep Stress Incr	NO	WB 0.12	Horz(CT)	0.00	8	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						
								Weight: 30 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 -t 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 2=0-4-9, 8=Mechanical  
Max Horz 2=108(LC 4)  
Max Uplift 2=99(LC 4), 8=104(LC 8)  
Max Grav 2=438(LC 1), 8=400(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-417/60  
BOT CHORD 2-9=-117/412, 8-9=-117/412  
WEBS 4-8=-456/129

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2 except (jt=lb) 8=104.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) "NAILED" indicates 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 7) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-5=-70, 5-6=-20, 7-10=-20  
Concentrated Loads (lb)  
Vert: 15=-0(B) 16=-57(F) 17=3(B) 18=-1(F) 19=-5(B) 20=-28(F)



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J22	Truss Type Jack-Open	Qty 1	Ply 1	Summit/102 Hawthorne I46313670
----------------	--------------	-------------------------	----------	----------	-----------------------------------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:51 2021 Page 1

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-ubKeX\_tmLQmCRkDX7GVD23HRjrXHpUSDx2QcJgzCZfQ

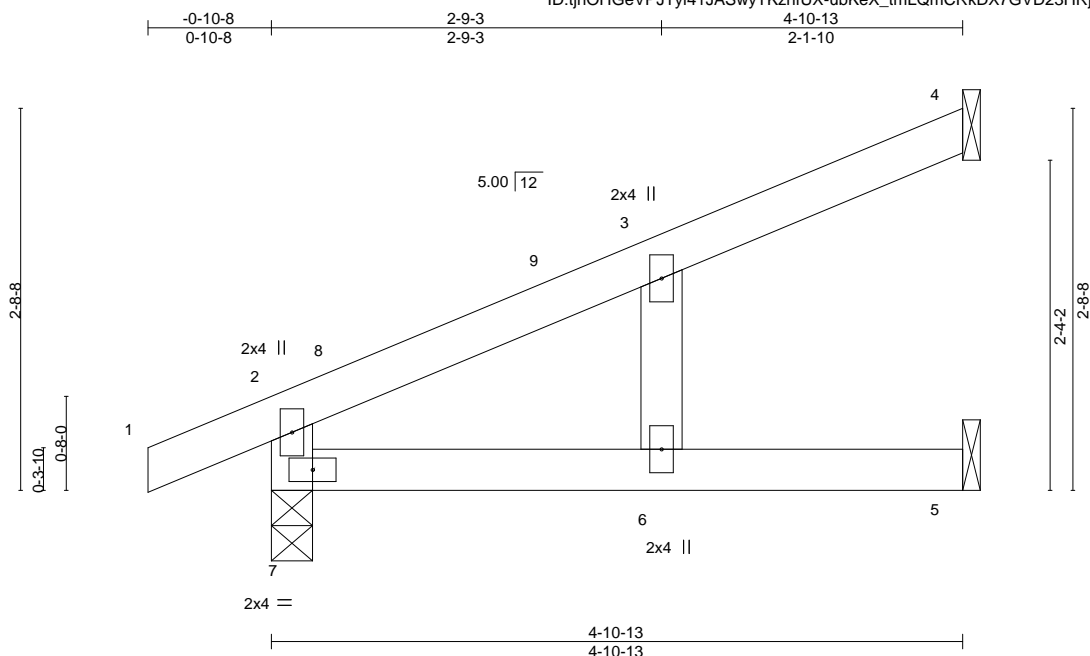

Scale = 1:16.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.21	Vert(LL)	0.04	6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.27	Vert(CT)	-0.06	6	>930	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.02	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 15 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
Max Horz 7=80(LC 12)  
Max Uplift 4=44(LC 12), 5=14(LC 12), 7=38(LC 12)  
Max Grav 4=120(LC 1), 5=83(LC 1), 7=290(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 4-10-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 2809580	Truss J23	Truss Type Jack-Open	Qty 2	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313671
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:51 2021 Page 1

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-ubKeX\_tmLQmCRkDX7GVD23HPxVqpuPDX2QcJgzCZfQ

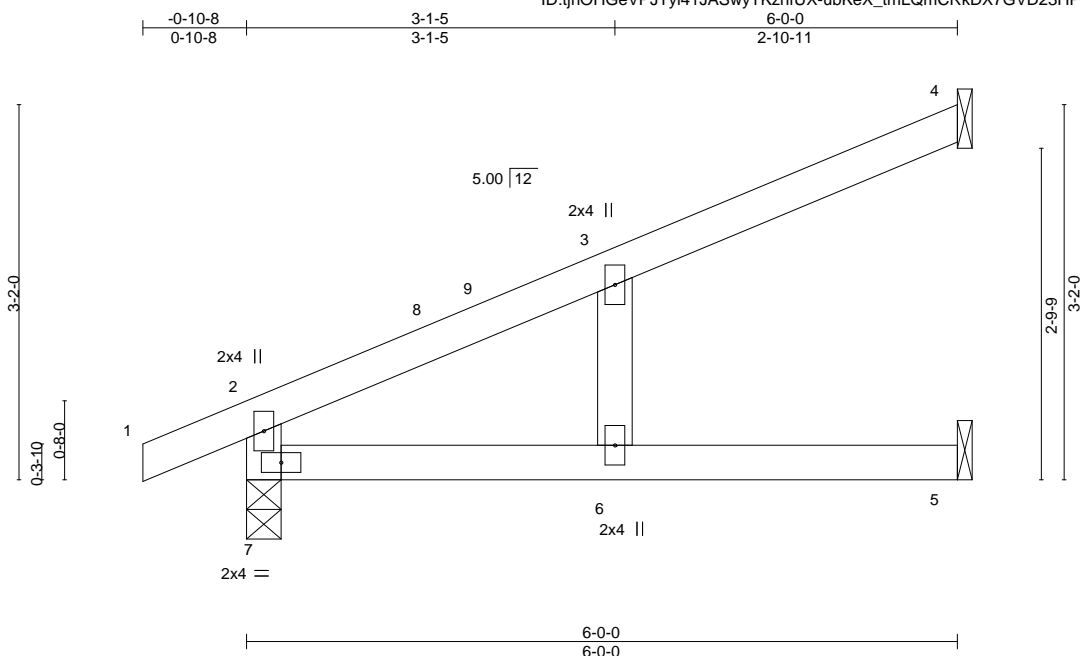

Scale = 1:19.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.32	Vert(LL)	0.09	6	>768	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.42	Vert(CT)	-0.14	6	>482	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.02	Horz(CT)	0.03	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 17 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
Max Horz 7=96(LC 12)  
Max Uplift 4=-57(LC 12), 5=-14(LC 12), 7=-43(LC 12)  
Max Grav 4=154(LC 1), 5=100(LC 1), 7=338(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 5-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss J24	Truss Type Roof Special Girder	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313672
----------------	--------------	-----------------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:52 2021 Page 1  
ID:tjnOHGeVPJTyi41JASwyTKzhfUX-Mnu0kKuP5ju33tokh\_0SaGpVOFoUYLyNmi9Ar6zCZFP

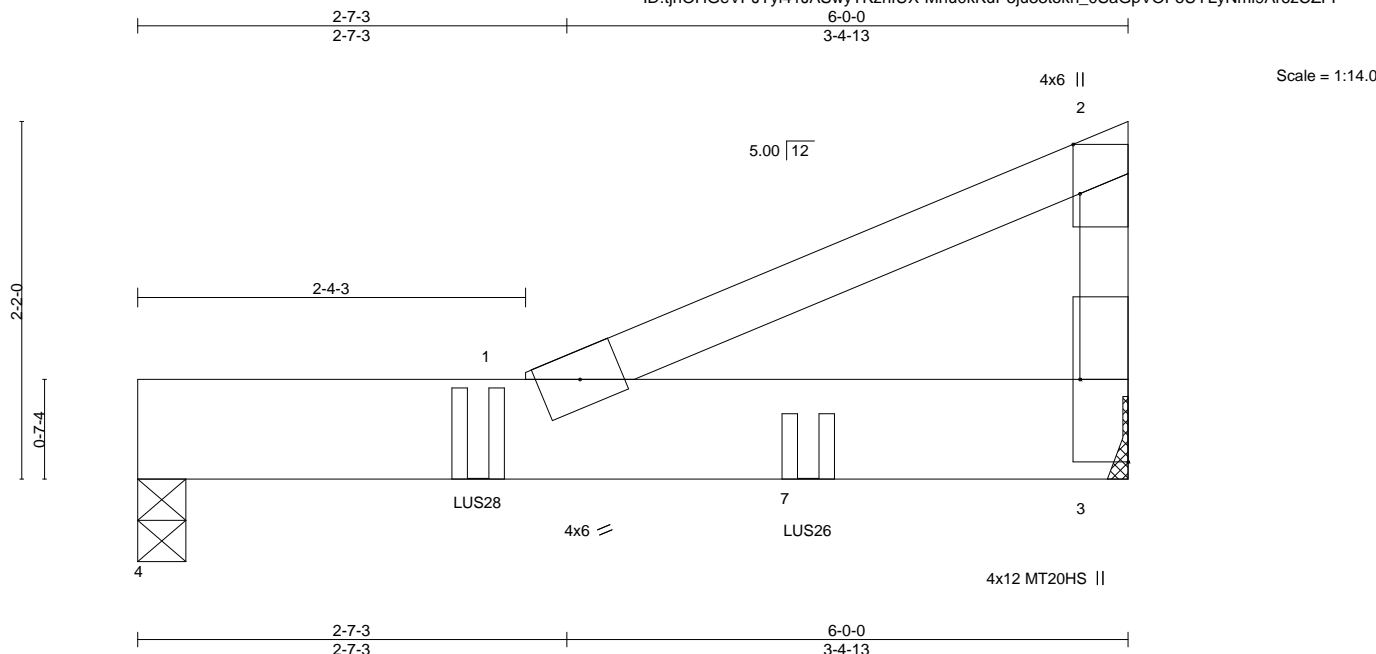


Plate Offsets (X,Y)-- [2:0-3-9,Edge], [3:Edge,0-3-8]									
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	-0.06 5 >999 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.52	Vert(CT)	-0.11 5 >620 180	MT20HS	148/108
BCLL	0.0	Rep Stress Incr	NO	WB	0.00	Horz(CT)	0.00 3 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MP				Weight: 24 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x8 SP 2400F 2.0E  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 4=0-3-8  
Max Horz 4=65(LC 7)  
Max Uplift 3=153(LC 8), 4=87(LC 8)  
Max Grav 3=1159(LC 2), 4=1058(LC 2)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-318/42  
BOT CHORD 1-3=-49/302

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Refer to girder(s) for truss to truss connections.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 3=153.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) Use Simpson Strong-Tie LUS28 (6-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent at 2-0-12 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
- 8) Use Simpson Strong-Tie LUS26 (4-10d Girder, 4-10d Truss, Single Ply Girder) or equivalent at 4-0-12 from the left end to connect truss(es) to front face of bottom chord, skewed 0.0 deg.to the left, sloping 0.0 deg. down.
- 9) Fill all nail holes where hanger is in contact with lumber.
- 10) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-70, 1-4=-90, 1-3=-20  
Concentrated Loads (lb)  
Vert: 1=-830(F) 7=-848(F)



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

146313673

Job Reference (optional)

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:53 2021 Page 1

ID:tinOHGeVPJTvj41JASwyTKzhfUX-qzSOvgv1s10wh1NwFhYh7UMnFfCiHowW MviNZzCZFO


Weight: 15 lb      FT = 20%

TOP CHORD	Structural wood sheathing directly applied, except end verticals.
BOT CHORD	Rigid ceiling directly applied.

(size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
 Max Horz 7=80(LC 12)  
 Max Uplift 4=-47(LC 12), 5=-12(LC 12), 7=-38(LC 12)  
 Max Grav 4=124(LC 1), 5=81(LC 1), 7=292(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDD=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 4-10-8 zone; cantilever left and right exposed; and vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for the individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building C**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss J26	Truss Type Jack-Open	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	146313674
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:53 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-qzSOygv1s10wh1NwFhYh7UMpNfGBHoBW\_MvjNZzCZFO

-0-10-8  
0-10-8  
2-2-6  
2-2-6

Scale = 1:12.2

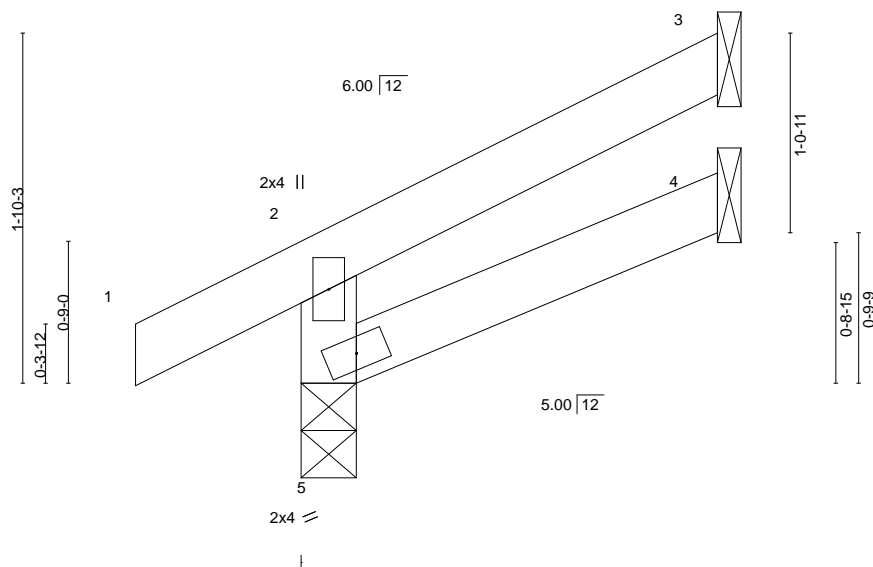

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	-0.00	5	>999	240	MT20	197/144
BCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-6 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=45(LC 12)  
Max Uplift 3=-32(LC 12), 5=-20(LC 12)  
Max Grav 3=54(LC 1), 4=36(LC 3), 5=179(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCCL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J27	Truss Type JACK-OPEN	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313675
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:54 2021 Page 1

ID:tnOHGeVPJTy41JASwyTKzhfUX-IA0m90wfdL8nIBy6oP3wfhv\_13cL0ERgD0eGv?zCZFN

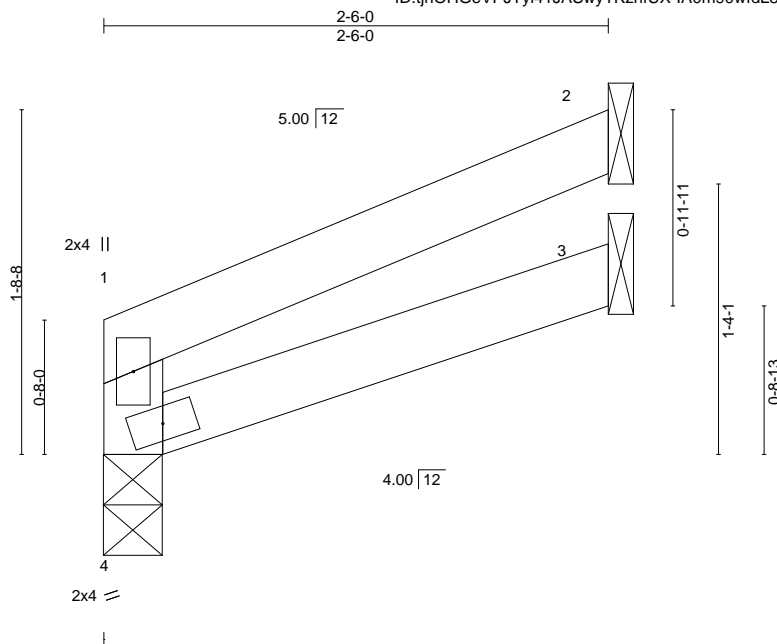

Scale = 1:11.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	-0.00 3-4	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00 3-4	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00 2	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR					Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 2=Mechanical, 3=Mechanical, 4=0-3-8  
Max Horz 4=32(LC 9)  
Max Uplift 2=34(LC 12), 4=5(LC 12)  
Max Grav 2=75(LC 1), 3=44(LC 3), 4=103(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J28	Truss Type MONOPITCH	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	146313676
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:55 2021 Page 1

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-mMa8NLwHOeGewLXJM6a9CvR81SwQlhTpSgOqSRzCZFM

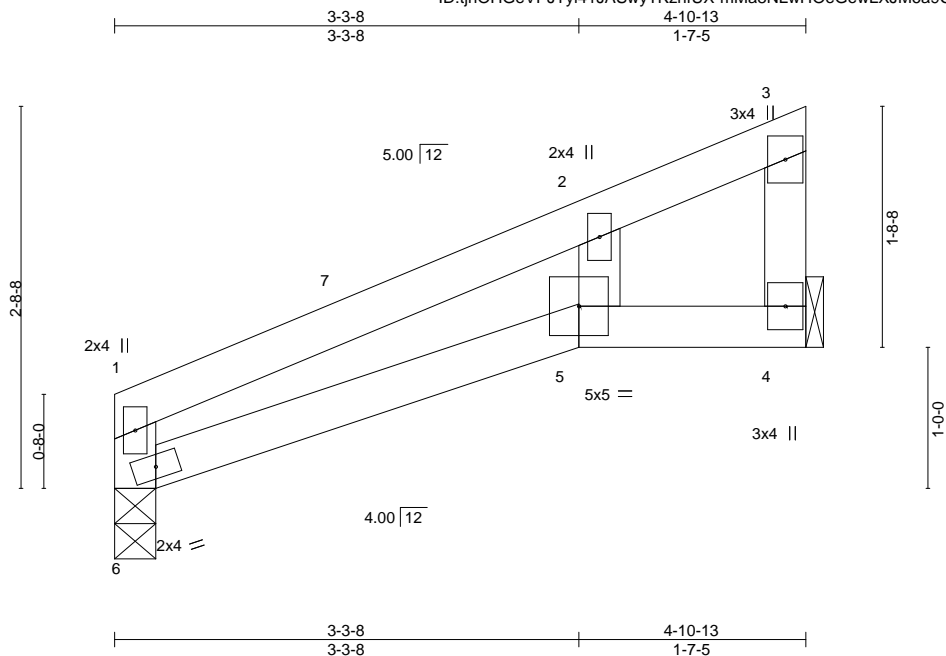

Scale = 1:16.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.19	Vert(LL)	-0.02	5-6	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	-0.03	5-6	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.01	Horz(CT)	0.01	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 14 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 4=Mechanical, 6=0-3-8  
Max Horz 6=76(LC 9)  
Max Uplift 4=-50(LC 12), 6=-25(LC 12)  
Max Grav 4=207(LC 1), 6=207(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-5-4, Interior(1) 3-5-4 to 4-9-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 6.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2809580	Truss J29	Truss Type Jack-Open Girder	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	146313677
----------------	--------------	--------------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:55 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-mMa8NLwHOeGewLXJM6a9CvR2xSu\_lhRpSgOqSRzCZFM

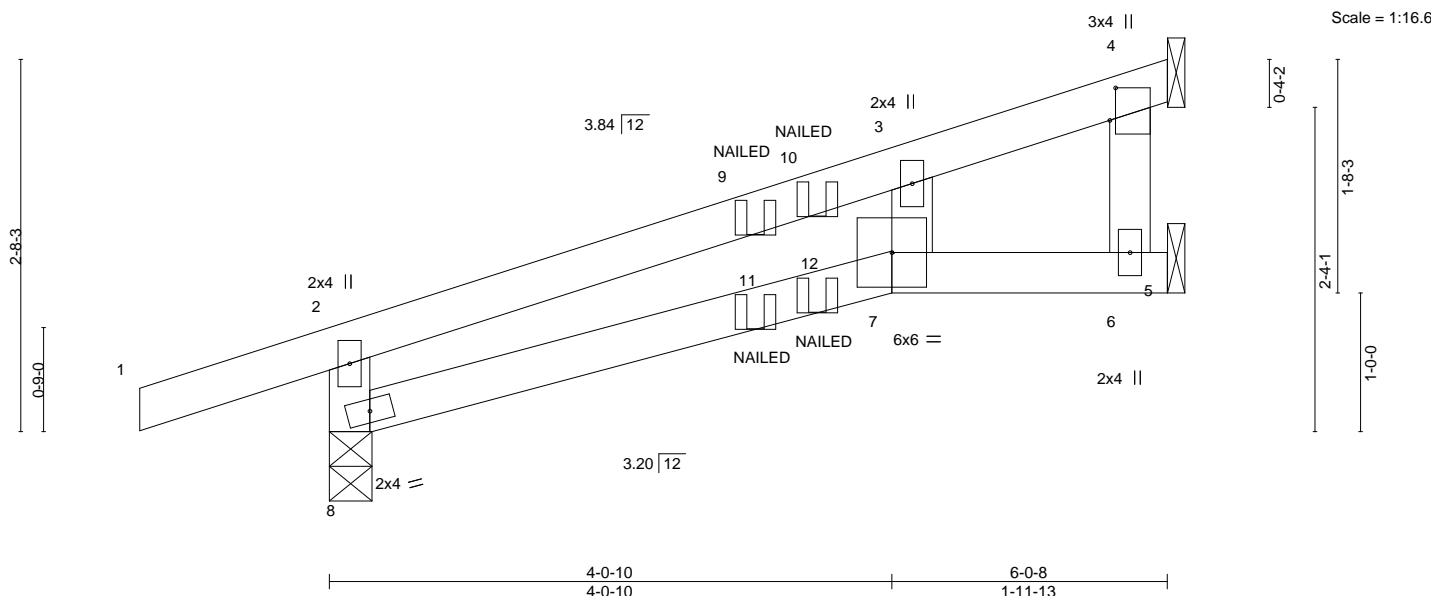



Plate Offsets (X,Y)--		[4:0-2-13,0-0-8]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	25.0	Plate Grip DOL 1.15		TC	0.51	Vert(LL)	-0.07	7-8	>987	240	MT20 197/144
TCDL	10.0	Lumber DOL 1.15		BC	0.28	Vert(CT)	-0.12	7-8	>546	180	
BCLL	0.0	Rep Stress Incr NO		WB	0.02	Horz(CT)	0.04	4	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-MS							Weight: 18 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 8=0-3-11, 6=Mechanical, 4=Mechanical  
Max Horz 8=82(LC 4)  
Max Uplift 8=91(LC 4), 6=12(LC 8), 4=44(LC 8)  
Max Grav 8=376(LC 1), 6=84(LC 1), 4=163(LC 1)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-8=-313/103

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 8, 6, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Gap between inside of top chord bearing and first diagonal or vertical web shall not exceed 0.500in.
- "NAILED" indicates 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S)

- Standard
- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-2=-70, 2-4=-70, 7-8=-20, 5-7=-20  
Concentrated Loads (lb)  
Vert: 11=-6(F) 12=0(B)



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**


**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss J30	Truss Type Jack-Open	Qty 1	Ply 1	Summit/102 Hawthorne 146313678
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:56 2021 Page 1  
ID: tjnOHGeVPJT41JASwyTKzhfUX-EY8Xahxv9yOVYV5Vwp5OI6\_KLshSU8nygK7N\_tzCZFL



Scale = 1:14.1

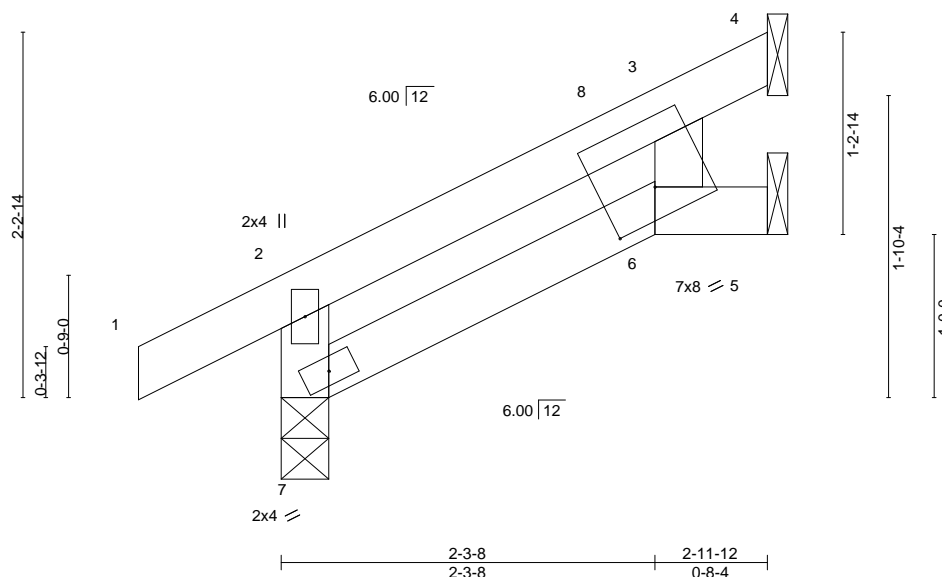


Plate Offsets (X,Y)-- [6:0-4-0,0-2-4]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	0.01	6-7	>999
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	-0.01	6-7	>999
BCLL 0.0	Rep Stress Incr	YES	WB 0.01	Horz(CT)	-0.01	4	n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP				
				<b>PLATES</b>	<b>GRIP</b>		
				MT20	197/144		
				Weight: 10 lb	FT = 20%		

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-11-12 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 4=Mechanical, 5=Mechanical, 7=0-3-8  
Max Horz 7=60(LC 12)  
Max Uplift 4=31(LC 12), 5=12(LC 12), 7=22(LC 12)  
Max Grav 4=69(LC 1), 5=43(LC 1), 7=209(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 2-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 7 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4, 5, 7.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss J31	Truss Type Jack-Open	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313679
----------------	--------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:57 2021 Page 1

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-ilhvo1yXwGWM9fghUXcdHKXVOGeADbB6v\_txWKzCZFK

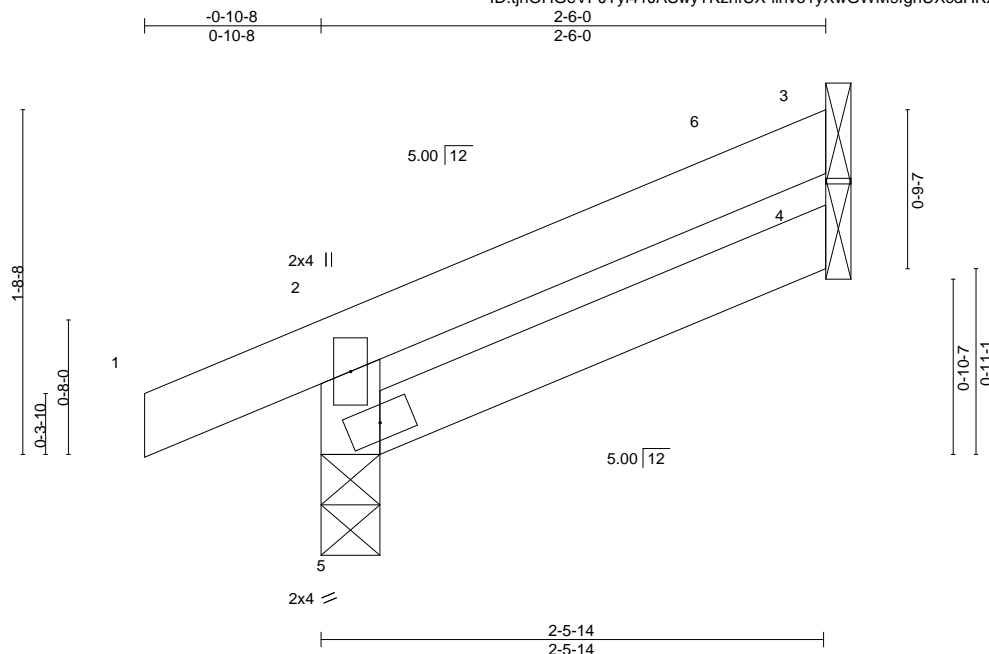

Scale = 1:11.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.07	Vert(LL)	-0.00	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.04	Vert(CT)	-0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 8 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-6-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=42(LC 12)  
Max Uplift 3=-32(LC 12), 5=-28(LC 8)  
Max Grav 3=65(LC 1), 4=42(LC 3), 5=191(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-10-8 to 2-1-8, Interior(1) 2-1-8 to 2-5-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss JD01	Truss Type Jack-Open	Qty 2	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313680
----------------	---------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:57 2021 Page 1

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-ilhvo1yXwGWM9fghUXcdHKXUmGe\_DbB6v\_txWKzCZFK

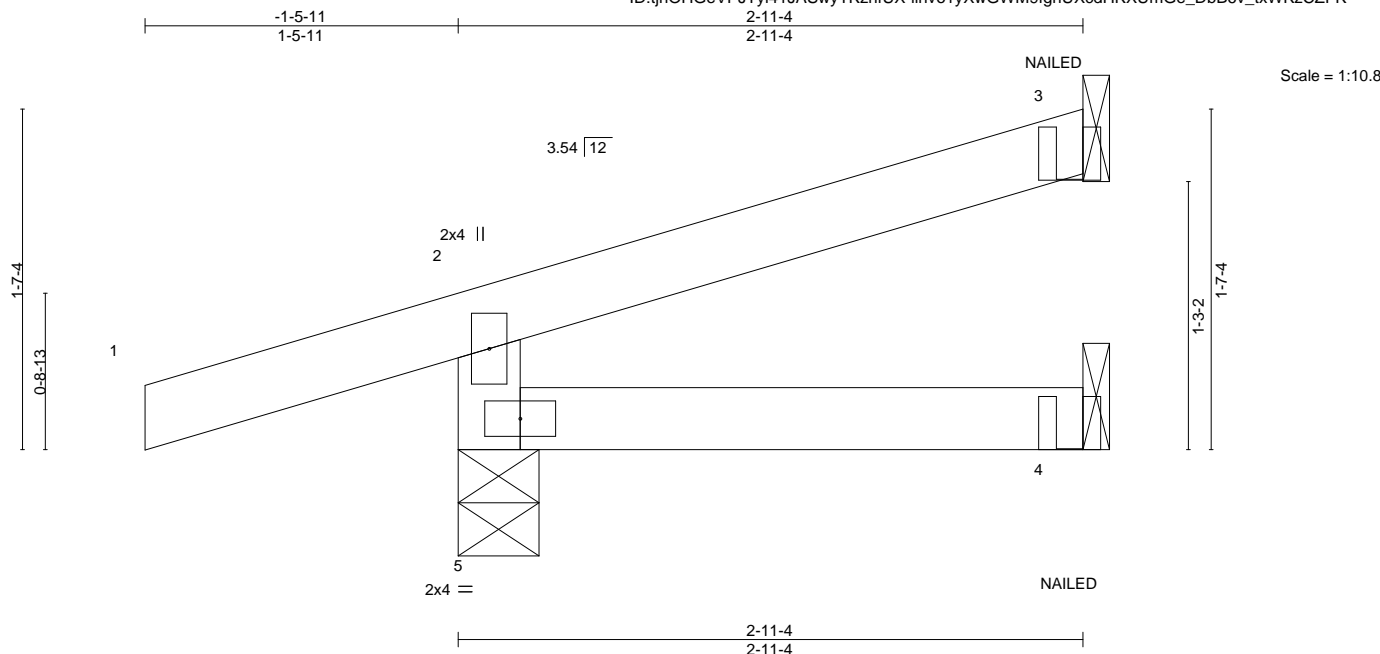

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.17	Vert(LL)	-0.00	4-5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 9 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-11-4 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 5=0-4-9, 3=Mechanical, 4=Mechanical

Max Horz 5=46(LC 8)

Max Uplift 5=88(LC 8), 3=32(LC 12)

Max Grav 5=270(LC 1), 3=69(LC 1), 4=48(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) "NAILED" indicates 3-10d (0.148"x3") or 2-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 8) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15

Uniform Loads (plf)

Vert: 1-2=-70, 2-3=-70, 4-5=-20

Concentrated Loads (lb)

Vert: 4=3(F)



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss JD02	Truss Type Jack-Open	Qty 2	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313681
----------------	---------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:58 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-BxFH?Nz9hZeDnoFu1E7sqX3gng\_ky2RF8ecU2mzCZFJ

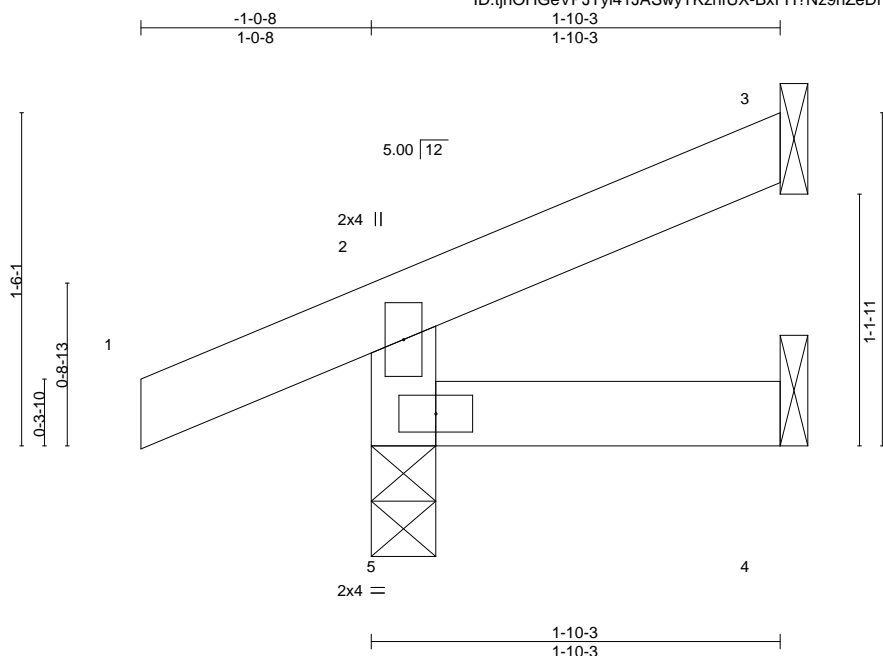

Scale = 1:10.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	I/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	-0.00	5	>999	240	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.02	Vert(CT)	-0.00	5	>999	180	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						
								Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 1-10-3 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=36(LC 9)  
Max Uplift 3=22(LC 12), 5=37(LC 8)  
Max Grav 3=37(LC 1), 4=29(LC 3), 5=188(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss JD03	Truss Type Jack-Open	Qty 3	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313682
----------------	---------------	-------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:28:59 2021 Page 1

ID:tjnOHGeVPJTyi41JASwyTKzhfUX-f7pfCjzoStm4Pyq4byf5MlcrX4JshVhPNIM1bCzCZFI

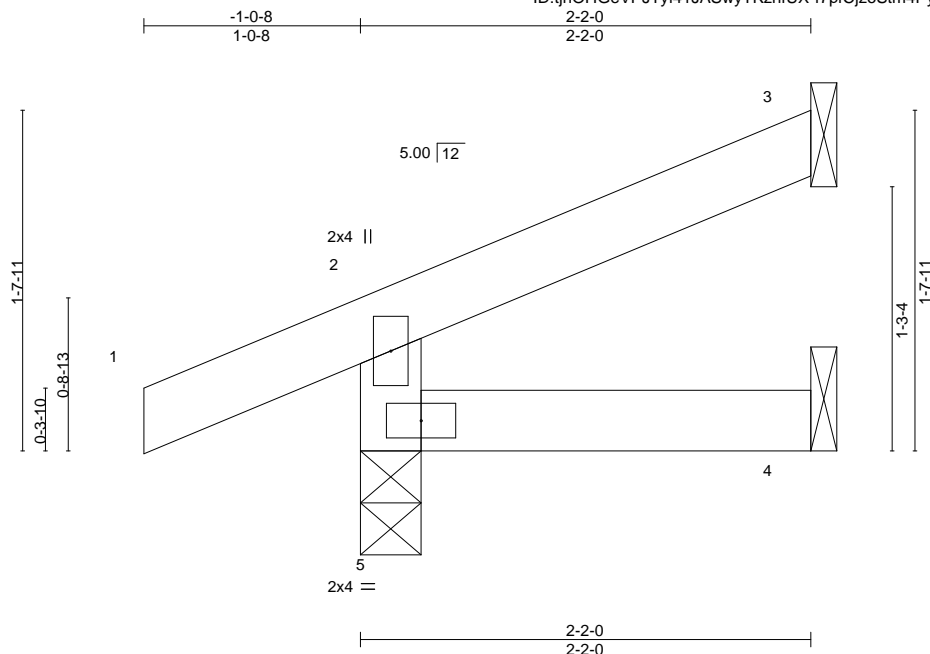

Scale = 1:11.1

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.09	Vert(LL)	-0.00	5	>999	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	-0.00	4-5	>999	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR						Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-2-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 3=Mechanical, 4=Mechanical, 5=0-3-8  
Max Horz 5=39(LC 12)  
Max Uplift 3=26(LC 12), 5=36(LC 8)  
Max Grav 3=48(LC 1), 4=35(LC 3), 5=196(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Bearing at joint(s) 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 3, 5.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job 2809580	Truss LG1	Truss Type GABLE	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	146313683
----------------	--------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:01 2021 Page 1  
ID:tnOHGeVPJTyi41JASwyTKzhfUX-bWxQdP?2\_U0neG\_SjNhZSAhAPt\_j9OSiqcr8f5zCZFG



Scale = 1:53.1

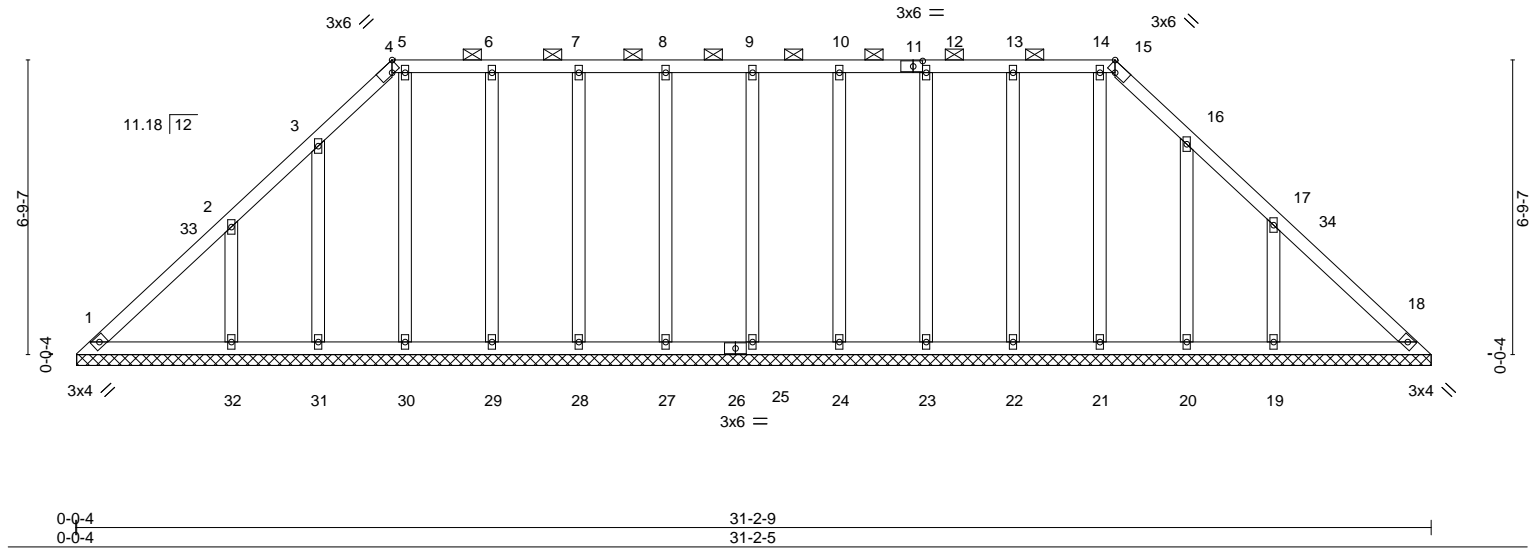


Plate Offsets (X,Y)-- [4:0-2-6,Edge], [11:0-2-10,0-1-8], [15:Edge,0-2-9]									
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	n/a - n/a	999	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.07	Vert(CT)	n/a - n/a	999	
BCLL	0.0	Rep Stress Incr	YES	WB	0.11	Horz(CT)	0.01 18 n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 157 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 4-15.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 31-2-5.  
(lb) - Max Horz 1=152(LC 8)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 31, 30, 29, 28, 27, 25, 24, 23, 22, 20 except 32=159(LC 12), 19=163(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 18, 31, 30, 29, 28, 27, 25, 24, 23, 22, 21, 20 except 32=314(LC 19), 19=320(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-7 to 3-7-0, Interior(1) 3-7-0 to 7-3-6, Exterior(2R) 7-3-6 to 11-7-0, Interior(1) 11-7-0 to 23-11-3, Exterior(2R) 23-11-3 to 28-2-2, Interior(1) 28-2-2 to 30-10-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 31, 30, 29, 28, 27, 25, 24, 23, 22, 20 except (jt=lb) 32=159, 19=163.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313684
2809580	LG2	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:02 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-3iVorl0glo8eGQZfG4Co\_NEMGHLSuqFr3GahCXzCZFF

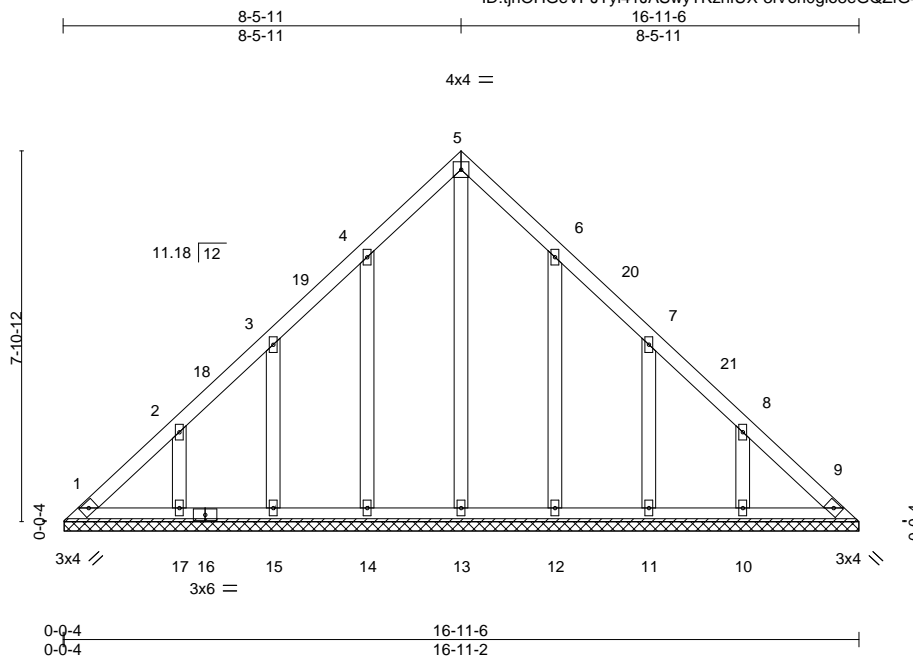

Scale = 1:49.1

Plate Offsets (X,Y)-- [6:0-0-0,0-0-0], [7:0-0-0,0-0-0], [8:0-0-0,0-0-0]												
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d			<b>PLATES</b> <b>GRIP</b>			
TCLL	25.0	Plate Grip DOL	1.15	TC	0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.04	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.00	9	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S							Weight: 78 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 16-11-2.  
(lb) - Max Horz 1=177(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 15, 14, 12, 11 except 17=112(LC 12), 10=112(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 9, 17, 15, 14, 13, 12, 11, 10

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-7 to 3-4-7, Interior(1) 3-4-7 to 8-5-11, Exterior(2R) 8-5-11 to 11-5-11, Interior(1) 11-5-11 to 16-6-15 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 15, 14, 12, 11 except (jt=lb) 17=112, 10=112.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss LG3	Truss Type GABLE	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313685
----------------	--------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:04 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-75cYQG1wHPPMVjj1OVEG3oJdz5?VMkX8Wa3oGQzCZFD

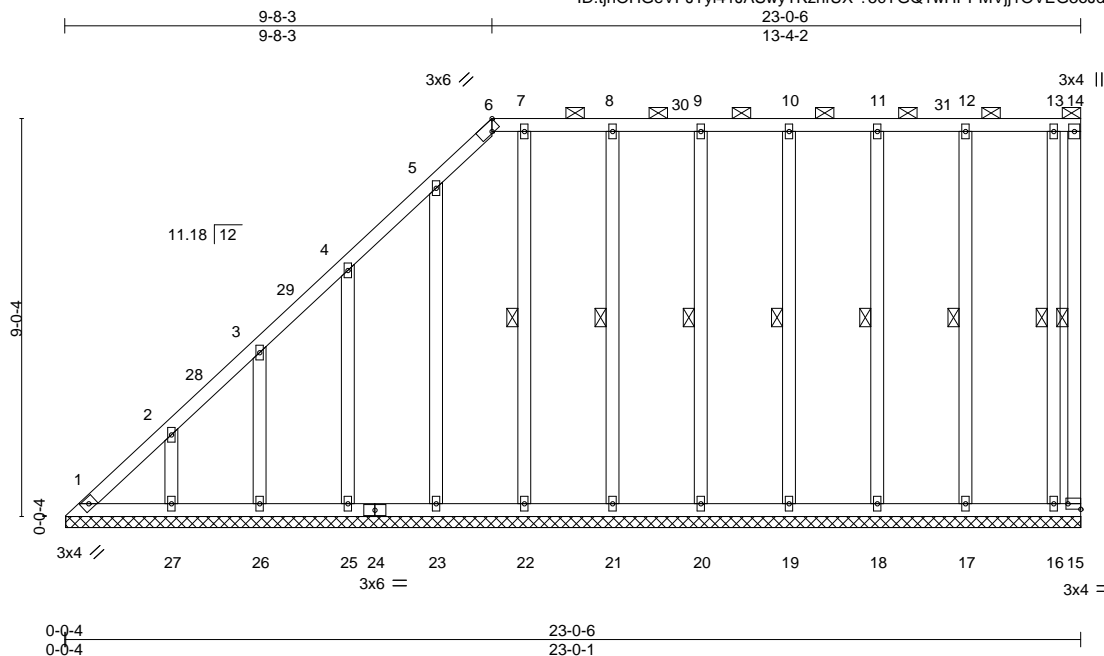

Scale = 1:52.2

Plate Offsets (X,Y)-- [6:0-2-6,Edge], [15:Edge,0-1-8]							
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0	Plate Grip DOL	1.15	TC 0.37	Vert(LL)	n/a	-	n/a
TCDL 10.0	Lumber DOL	1.15	BC 0.19	Vert(CT)	n/a	-	n/a
BCLL 0.0	Rep Stress Incr	YES	WB 0.15	Horz(CT)	-0.00	15	n/a
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S				
				<b>PLATES</b>	<b>GRIP</b>		
				MT20	197/144		
				Weight: 153 lb		FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals, and 2-0-0 oc purlins (6-0-0 max.): 6-14.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 14-15, 7-22, 8-21, 9-20, 10-19, 11-18, 12-17, 13-16

#### REACTIONS.

All bearings 23-0-2.  
(lb) - Max Horz 1=312(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 26, 23, 22, 21, 20, 19, 18, 17 except 15=133(LC 11), 27=111(LC 12), 25=105(LC 12), 16=133(LC 8)  
Max Grav All reactions 250 lb or less at joint(s) 1, 15, 27, 26, 25, 23, 22, 21, 20, 19, 18, 17, 16

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-438/289, 2-3=-368/246, 3-4=-300/211

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-7 to 3-4-7, Interior(1) 3-4-7 to 9-8-3, Exterior(2R) 9-8-3 to 13-11-2, Interior(1) 13-11-2 to 22-10-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 26, 23, 22, 21, 20, 19, 18, 17 except (jt=lb) 15=133, 27=111, 25=105, 16=133.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313686
2809580	LG4	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:05 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-THAwTm2Y1jXD7tHEyCIVc0srMUMs5AdHIDpMoszCZFC

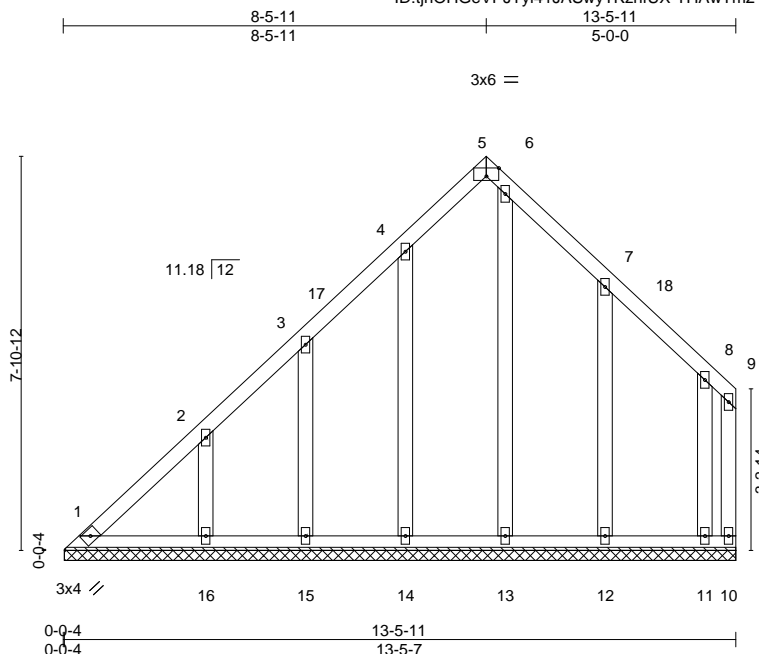

Scale = 1:46.2

Plate Offsets (X,Y)--		[5:0-3-0,Edge]											
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d				<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.13	Vert(LL)	n/a	-	n/a	999	MT20	197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.05	Vert(CT)	n/a	-	n/a	999			
BCLL	0.0	Rep Stress Incr	YES	WB	0.23	Horz(CT)	-0.00	10	n/a	n/a			
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S							Weight: 70 lb	FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 13-5-7.

(lb) - Max Horz 1=214(LC 11)

Max Uplift All uplift 100 lb or less at joint(s) 10, 15, 14, 13 except 1=-100(LC 8), 16=-124(LC 12), 12=-133(LC 13), 11=-102(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 10, 15, 14, 13, 12, 11 except 16=254(LC 19)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 6-7=-183/255

WEBS 6-13=-254/123

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-7 to 3-4-7, Interior(1) 3-4-7 to 8-5-11, Exterior(2R) 8-5-11 to 11-5-11, Interior(1) 11-5-11 to 13-3-15 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 15, 14, 13 except (jt=lb) 1=100, 16=124, 12=133, 11=102.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss LG5	Truss Type GABLE	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313687
----------------	--------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:06 2021 Page 1

ID:tnOHGeVPJTiy41JASwyTKzhfUX-yUkG63Bo1f4k1sQVwHk9DO10uiOqfXR\_tYvLizCZFB

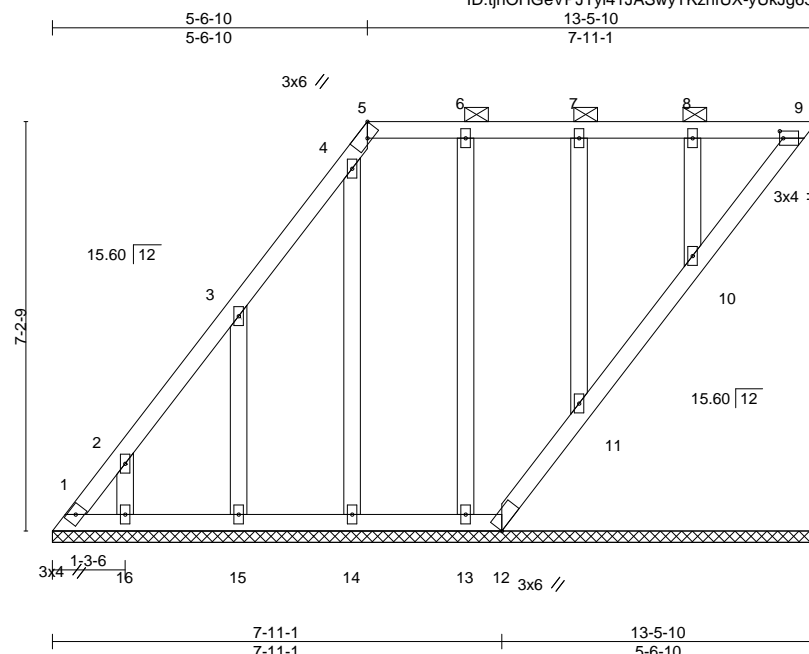

Scale = 1:40.6

Plate Offsets (X,Y)--		[5:0-2-12,Edge], [9:0-0-12,0-1-8]	
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08
TCDL 10.0	Lumber DOL	1.15	BC 0.04
BCLL 0.0	Rep Stress Incr	YES	WB 0.12
BCDL 10.0	Code	IRC2018/TPI2014	Matrix-S
			<b>DEFL.</b>
			in (loc) l/defl L/d
			Vert(LL) n/a - n/a 999
			Vert(CT) n/a - n/a 999
			Horz(CT) -0.00 9 n/a n/a
			<b>PLATES</b>
			MT20
			<b>GRIP</b>
			197/144
			Weight: 66 lb FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 5-9.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 13-5-10.

(lb) - Max Horz 1=256(LC 12)

Max Uplift All uplift 100 lb or less at joint(s) 1, 9, 12, 14, 13, 11, 10 except 16=129(LC 12), 15=175(LC 12)

Max Grav All reactions 250 lb or less at joint(s) 9, 12, 16, 15, 14, 13, 11, 10 except 1=260(LC 12)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=333/274

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-9 to 3-3-6, Interior(1) 3-3-6 to 5-6-10, Exterior(2R) 5-6-10 to 8-6-10, Interior(1) 8-6-10 to 13-2-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 9, 12, 14, 13, 11, 10 except (jt=lb) 16=129, 15=175.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 9, 11, 10.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	Summit/102 Hawthorne	146313688
2809580	LG6	GABLE	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:07 2021 Page 1  
ID: tjnOHGeVPJTyi41JASwyTKzhfUX-QglhuS4pZKnXMBRc3dozhRxCXI2eZ5NaCXIStIzCZFA

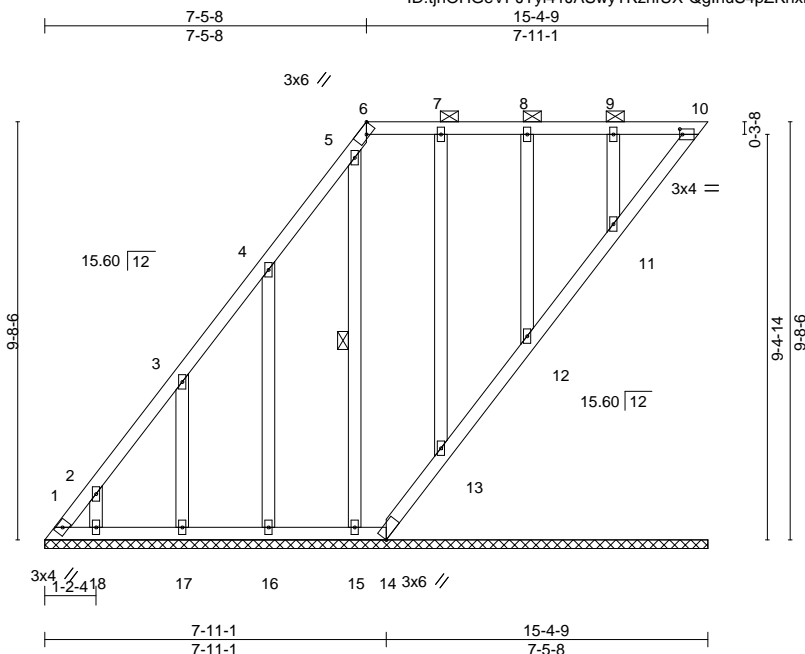

Scale = 1:53.4

Plate Offsets (X,Y)-- [6:0-2-12,Edge], [10:0-0-12,0-1-8]												
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d				PLATES	GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.03	Vert(CT)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	-0.00	10	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S							Weight: 84 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 6-10.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 5-15

#### REACTIONS.

All bearings 15-4-9.  
(lb) - Max Horz 1=347(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 10, 14, 15, 13, 12, 11 except 1=142(LC 10), 18=132(LC 12), 17=158(LC 12), 16=170(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 10, 14, 18, 17, 16, 15, 13, 12, 11 except 1=361(LC 12)

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-457/370, 2-3=-336/270

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-9 to 3-2-4, Interior(1) 3-2-4 to 7-5-8, Exterior(2R) 7-5-8 to 10-5-8, Interior(1) 10-5-8 to 15-1-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 14, 15, 13, 12, 11 except (jt=lb) 1=142, 18=132, 17=158, 16=170.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 10, 13, 12, 11.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601  
**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 2809580	Truss LG7	Truss Type GABLE	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	146313689
----------------	--------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,


8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:08 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-uss35o4RKevo\_L0pdLJCEeU0tiO0laWjRB10PBzCZF9



4x4 =

Scale = 1:26.9

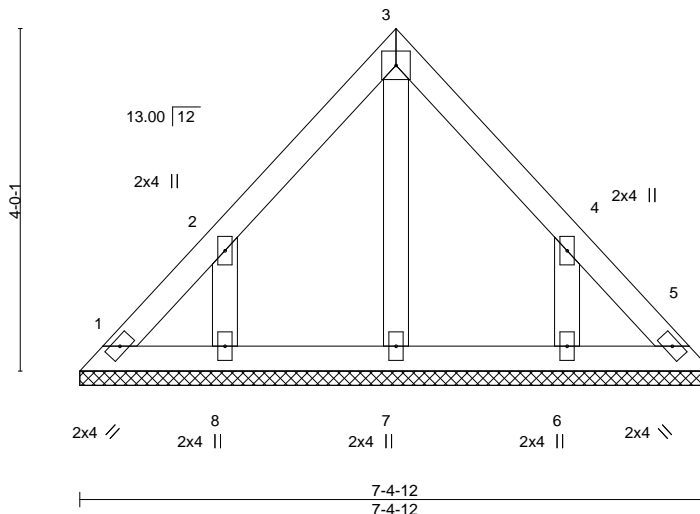

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.05	Vert(LL)	n/a	-	n/a	999	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a	999	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.03	Horz(CT)	0.00	5	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						
								Weight: 27 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 7-4-12.  
(lb) - Max Horz 1=87(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=129(LC 12), 6=128(LC 13)  
Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7, 8, 6

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-4-0 to 3-4-0, Interior(1) 3-4-0 to 3-8-6, Exterior(2R) 3-8-6 to 6-8-6, Interior(1) 6-8-6 to 7-0-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=129, 6=128.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss R1	Truss Type Flat Girder	Qty 1	Ply 2	Summit/102 Hawthorne Job Reference (optional)	I46313690
----------------	-------------	---------------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:10 2021 Page 1

ID:tnOHGeVPJTiy41JASwyTKzhUX-qF\_pWU6hsF9WDeABkmLgJ3ZeYV4zmQj0uVW7U4zCZF7

Scale = 1:13.8

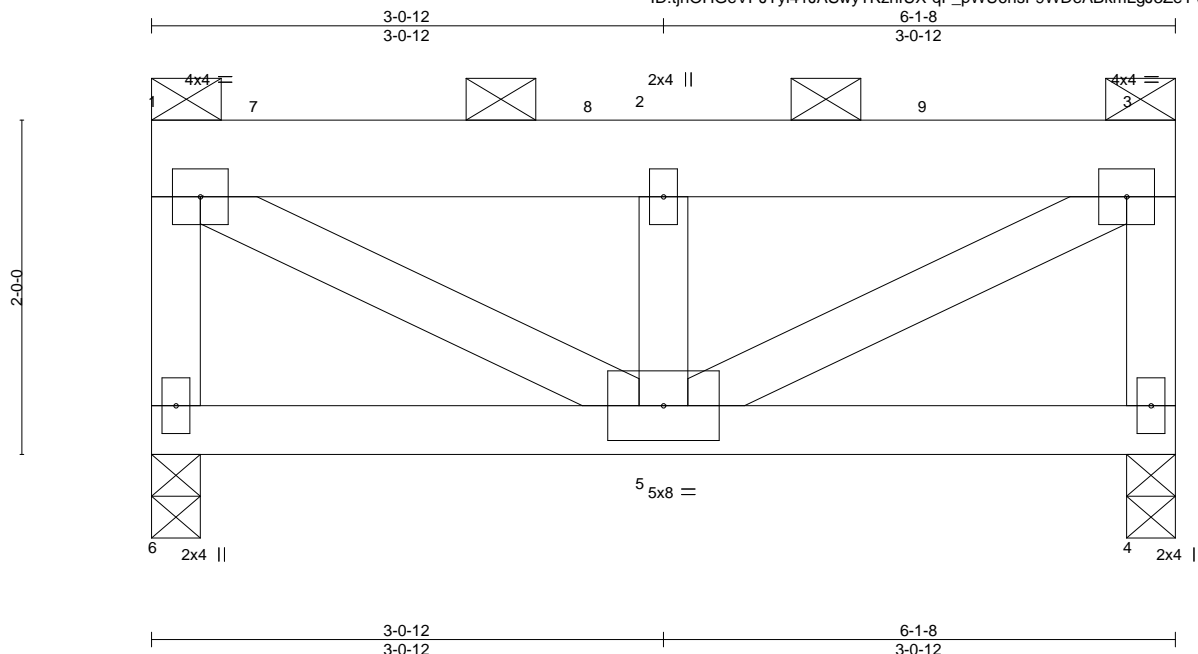

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.43	Vert(LL)	-0.01	5	>999	240	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.06	Vert(CT)	-0.02	5	>999	180	197/144
BCLL 0.0	Rep Stress Incr	NO	WB 0.30	Horz(CT)	-0.00	4	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MP						
								Weight: 58 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD 2-0-0 oc purlins (6-0-0 max.): 1-3, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 6=0-3-8, 4=0-3-8  
Max Horz 6=56(LC 5)  
Max Uplift 6=258(LC 4), 4=191(LC 5)  
Max Grav 6=2257(LC 1), 4=1893(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-6=-2211/265, 1-2=-2138/217, 2-3=-2138/217, 3-4=-1848/198  
WEBS 2-5=-2356/274, 3-5=-261/2447, 1-5=-261/2447

#### NOTES-

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 6=258, 4=191.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 1187 lb down and 153 lb up at 0-9-0, and 1213 lb down and 126 lb up at 2-9-0, and 1351 lb down and 112 lb up at 4-9-0 on top chord. The design/selection of such connection device(s) is the responsibility of others.

#### LOAD CASE(S) Standard

- Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-70, 4-6=-20  
Concentrated Loads (lb)  
Vert: 7=-1187 8=-1213 9=-1224



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of the design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss V01	Truss Type GABLE	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313691
----------------	--------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:10 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-qF\_pWU6hsF9WDeABkmlGj3ZiNV3RmUq0uVW7U4zCZF7

7-4-14

7-4-14

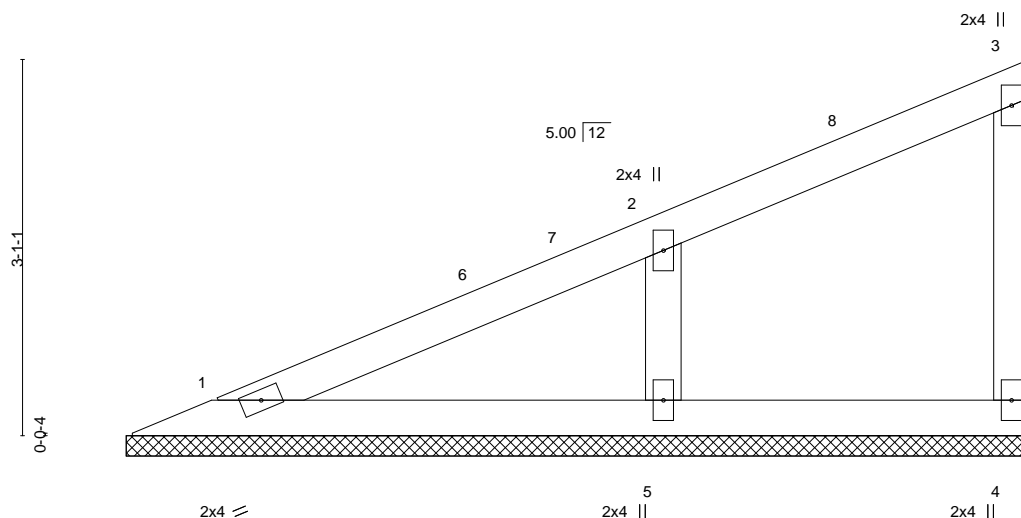

Scale = 1:18.9

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.09	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	-0.00	4	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 21 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=7-4-14, 4=7-4-14, 5=7-4-14  
Max Horz 1=107(LC 11)  
Max Uplift 1=-2(LC 12), 4=-16(LC 9), 5=-89(LC 12)  
Max Grav 1=130(LC 1), 4=85(LC 1), 5=370(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-5=-288/211

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-9-1 to 3-9-1, Interior(1) 3-9-1 to 7-3-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4, 5.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job 2809580	Truss V02	Truss Type GABLE	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313692
----------------	--------------	---------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:11 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-IRYCkq7JdZHNrolNITsvsH6qqvOLVxfA79Gg0WzCZF6

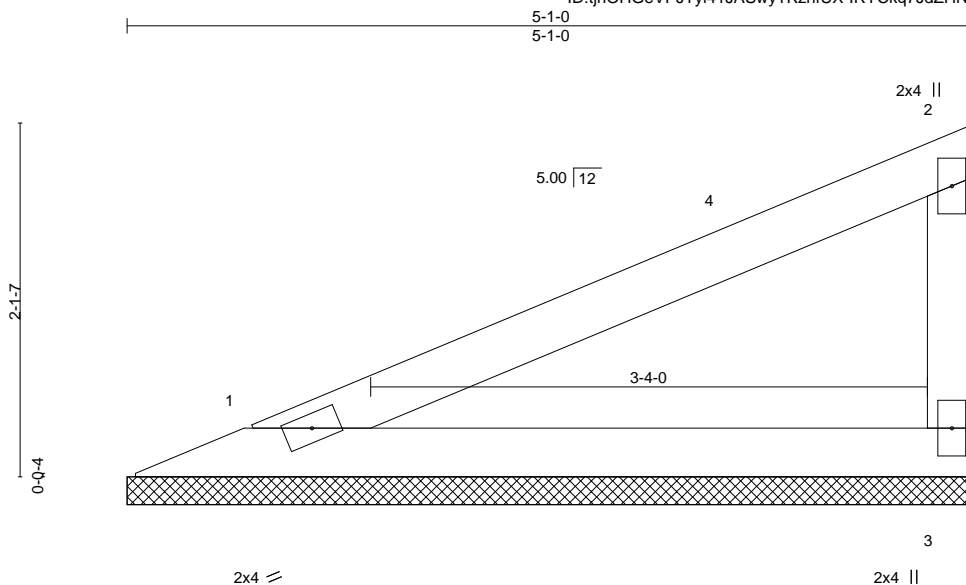

Scale = 1:13.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.33	Vert(LL)	n/a	-	n/a	999	MT20	197/144
BCDL 10.0	Lumber DOL	1.15	BC 0.18	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 13 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2

BOT CHORD 2x4 SPF No.2

WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-1-0 oc purlins, except end verticals.

BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=5-1-0, 3=5-1-0

Max Horz 1=69(LC 9)

Max Uplift 1=27(LC 12), 3=41(LC 12)

Max Grav 1=188(LC 1), 3=188(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-9-1 to 3-9-1, Interior(1) 3-9-1 to 4-11-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job 2809580	Truss V03	Truss Type Valley	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313693
----------------	--------------	----------------------	----------	----------	--	-----------

Builders FirstSource (Valley Center),


Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:12 2021 Page 1

ID:tnOHGeVPJTyi41JASwyTKzhfUX-md5ax98xOtPDTyKasBN8OUe3NJleENuJMp?DYyzCZF5

3-1-11  
3-1-11

Scale = 1:9.3

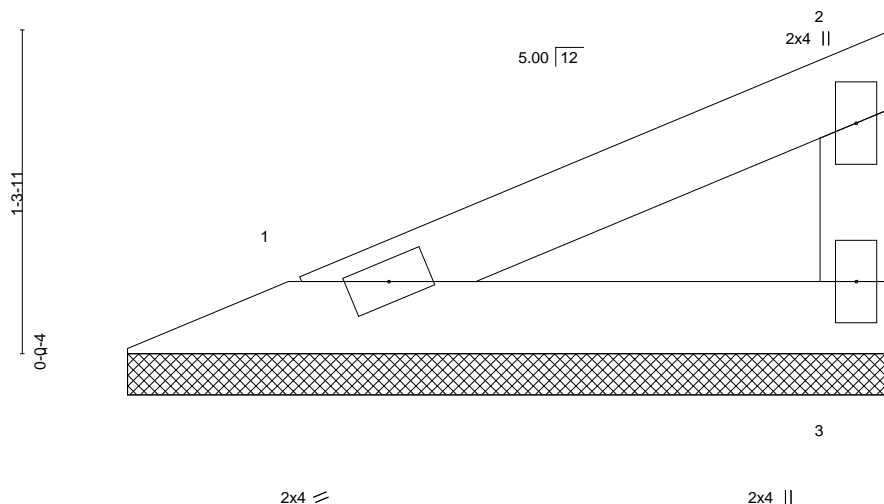

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-1-11 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=3-1-2, 3=3-1-2  
Max Horz 1=37(LC 9)  
Max Uplift 1=-14(LC 12), 3=-22(LC 12)  
Max Grav 1=101(LC 1), 3=101(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:13 2021 Page 1  
ID:tinOHGeVPJTvi41JASwvTKzhfUX-Eqfv8V8a9AX446vmQuvNxiBAhI2BzqKTbTIn4OzCZF4

[illegible]

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc)	<b>L/defl</b>	<b>L/d</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.37	Vert(LL) n/a -	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.22	Vert(CT) n/a -	n/a	999		
BCLL 0.0	Rep Stress Incr YES	WB 0.05	Horz(CT) 0.00 3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-S				Weight: 28 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD	2x4 SPF No.2	TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	2x4 SPF No.2	BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
OTHERS	2x4 SPF No.2		

**REACTIONS.** (size) 1=11-7-13, 3=11-7-13, 4=11-7-13  
 Max Horz 1=-34(LC 17)  
 Max Uplift 1=-40(LC 12), 3=-46(LC 13), 4=-39(LC 12)  
 Max Grav 1=209(LC 25), 3=209(LC 26), 4=516(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
**WEBS** 2-4=-361/179

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCFL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-9-1 to 3-9-1, Interior(1) 3-9-1 to 5-10-8, Exterior(2R) 5-10-8 to 8-10-8, Interior(1) 8-10-8 to 10-11-15 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Gable requires continuous bottom chord bearing.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

 **WARNING** - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.

**WARNING – Velly design parameters are listed ONLY on this and INCLUDED WITHIN KEY REFERENCE 1: AISC MH-143 (Rev. 3/19/2020) BY ONE USER.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for the building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job 2809580	Truss V05	Truss Type Valley	Qty 1	Ply 1	Summit/102 Hawthorne Job Reference (optional)	I46313695
----------------	--------------	----------------------	----------	----------	--	-----------


Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s May 12 2021 MiTek Industries, Inc. Wed May 26 17:29:14 2021 Page 1

ID:tjnOHGeVPJTiy41JASwyTKzhfUX-j0DKMr9CwUfxiGUyzbQcTvKOT7QXiH\_cp7UKdrzCZF3



Scale = 1:14.2

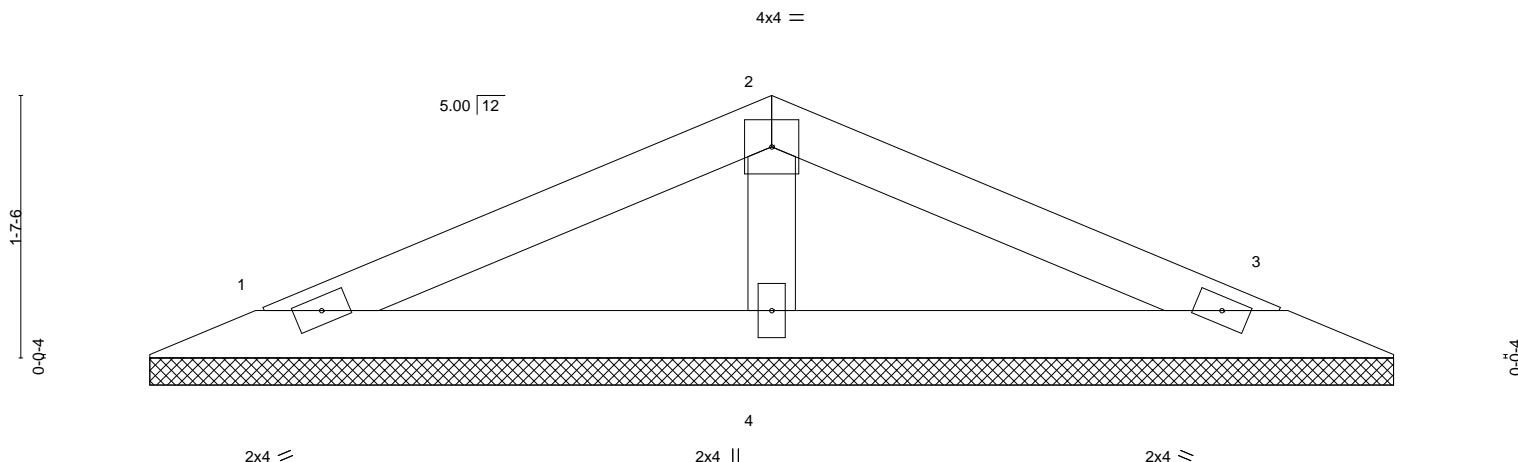

0-0-10 0-0-10	3-10-8 3-9-14	7-9-0 3-10-8
<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.17
TCDL 10.0	Lumber DOL 1.15	BC 0.08
BCLL 0.0	Rep Stress Incr YES	WB 0.03
BCDL 10.0	Code IRC2018/TPI2014	Matrix-P
<b>DEFL.</b>	<b>DEFL.</b>	<b>DEFL.</b>
Vert(LL) n/a	Vert(LL) n/a	Vert(LL) n/a
Vert(CT) n/a	Vert(CT) n/a	Vert(CT) n/a
Horz(CT) 0.00	Horz(CT) 0.00	Horz(CT) 0.00
<b>PLATES</b>	<b>GRIP</b>	<b>PLATES</b>
MT20	197/144	MT20
Weight: 18 lb	FT = 20%	Weight: 18 lb

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=7-7-13, 3=7-7-13, 4=7-7-13  
Max Horz 1=21(LC 12)  
Max Uplift 1=30(LC 12), 3=33(LC 13), 4=13(LC 12)  
Max Grav 1=139(LC 1), 3=139(LC 1), 4=283(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=15ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



May 27, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**


**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

# Symbols

## PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

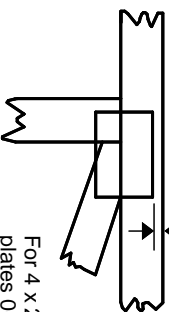

For 4 x 2 orientation, locate plates 0- 1/16" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.


\* Plate location details available in **MiTek 20/20 software** or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-89: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

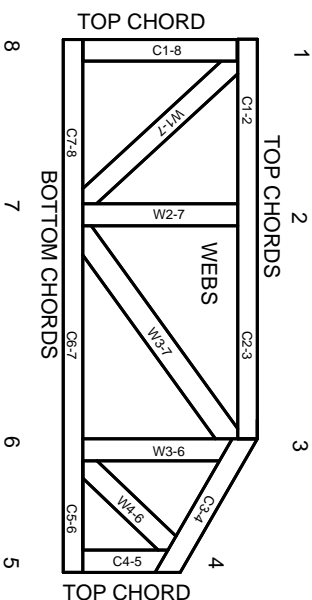

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

## PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



# General Safety Notes

**Failure to Follow Could Cause Property Damage or Personal Injury**

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.