

galvanized to the G60 Standard unless noted

4. Refer to the Truss Design Drawings for design.
5. The Truss Technician shall provide Truss-to-

Truss Connection Requirements. Any special or other connection shall be the responsibility of the Building Designer.

6. The Truss Placement Diagram and Truss Design Drawings are the property of Builders FirstSource and may not be reused or reproduced in part or in total under any circumstances without prior written

7. In some cases, field framing may be required to achieve the final appearance shown on the

8. Field framing, including valley rafters, installed over roof trusses shall have a knee brace from the rafter to the truss top chord at intervals of 48" on center (O.C.) or less. Staggel knee braces from adjacent rafters such that the load is distributed uniformly over multiple truss locations and not concentrated at one location of

9. Truss Top Chords shall be fully sheathed or have lateral bracing (purlins) spaced at 24" O.C. or less. Truss Bottom Chord Bracing shall not exceed the maximum shown on the Truss Design Drawing. Field framed bottom chord floor or celling attachments shall be spaced at 24" O.C. or less. Proper Bracing prevents buckling of individual truss members due to design loads.

10. This Placement Diagram is based upon the supporting structure being structurally adequate, dimensionally correct, square, plumb, and level to adequately support the trusses. The foundation design, structural member sizing, load transfer, bearing conditions, and the structure's compliance with the applicable building code are the responsibility of the

Owner, Building Designer, and Contractor.

11. If Piggyback Trusses are included in this project, refer to the Mitek Piggyback Connection
Detail applicable for the project details and wind load category.

12. The Contractor shall follow the SBCA TTB

Partition Separation Prevention and Solutions for truss attachment to non-load bearing walls and carefully complete these details to avoid gypsum wall board related issues. WARNING:

TRUSSES MUST BE BRACED DURING INSTALLATION. FAILURE TO DO SO MAY RESULT IN INJURY OR DEATH. Espanol -(TRUSSES (CERCHAS) DEBERAN TENER UN SOPORTE DURANTE LA INSTALACION, NO HACERLO PODRIA RESULTAR EN LESIONES O MUERTE.) 1. Trusses shall be installed in a safe manner

meeting all code, local, OSHA, TPI, and BCSI Specifications. Failure to follow these specifications may result in injury or death.

2. Buildings under construction are vulnerable to high winds and present a possible safety hazard. The Contractor is responsible for recognizing adverse weather conditions and shall take appropriate action to prevent injury or

Geaul.


3. BCSI INSTRUCTIONS SHALL BE FOLLOWED:
BCSI-B1 = Safe Truss Handling and Installation
BCSI-B2 = Installation and Temporary Restraint BCSI-B3 = Permanent Restraint BCSI-B4 = Safe Construction Loading

BCSI-B5 = Truss Damage and Modification Guidelines

BCSI-B7 = Floor Truss Installation BCSI-B8 = Toe-Nailed Connections BCSI-B9 = Multi-Ply Girders

BCSI-B10 = Post Frame Truss Installation BCSI-B11 = Fall Protection

4. Follow TPI Requirements for Long Span Trusses (>60').

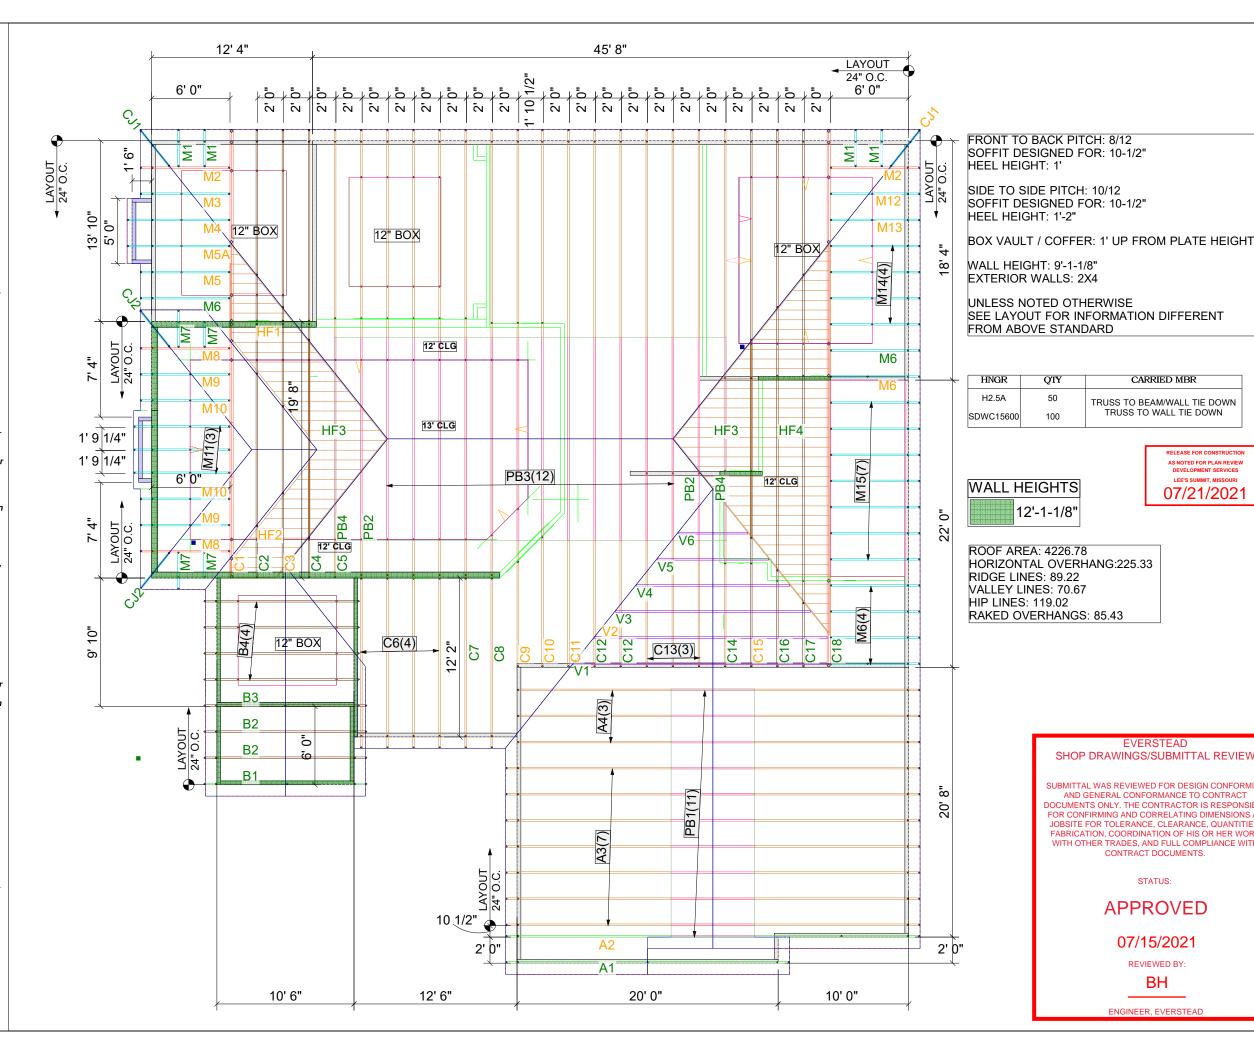

**DESIGN LOADS:** 

25 PSF TCLL 10 PSF TCDL

10 PSF BCDL

ILITY OF THE INSTALLATION
BRACING FOR HOLDING
SHALL BE DESIGNED AND
ALLERS ARE TO BE APPLIED
OADS BE APPLIED TO THE
CADS BE APPLIED TO THE
EECOMMENDATIONS ONLY
TRUSSES ARE CAPABLE OF PROPER HANDLING OF TRUSSES SHALL BE THE RESPONSIBILITY
CREW AT THE JOBSITE. TEMPORARY AND PERMANEN'S BRA
TRUSSES PLUMB AND FOR RESISTING LATERAL FORCES SHA
TRUSSES PLUMB AND FOR RESISTING LATERAL FORCES SHA
INSTALLED BY OTHERS. NO LOADS OTHER THAN THE INTALLE
TO TRUSSES UNTIL AFTER ALL BRACING AND FASTENING IS CO.
SHALL CONCENTRATED LOADS GREATER THAN DESIGN LOAD
TRUSSES. ALL TRUSS TO FRAMING CONNECTIONS ARE RECO.
AND NEED TO BE SPECIFIED BY THE BURGED ESTIMATION EDSIGNER. THE
BEING MOVED (+/-) 4th. ETHER DIRECTION

WWW.BLDR. Builders **FirstSourc** 

CARRIED MBR

TRUSS TO BEAM/WALL TIE DOWN

AS NOTED FOR PLAN REVIEW

LEE'S SUMMIT, MISSOURI

07/21/2021

TRUSS TO WALL TIE DOWN

EVERSTEAD

SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY

AND GENERAL CONFORMANCE TO CONTRACT

DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE

FOR CONFIRMING AND CORRELATING DIMENSIONS AT

JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES.

FABRICATION, COORDINATION OF HIS OR HER WORK

WITH OTHER TRADES, AND FULL COMPLIANCE WITH

CONTRACT DOCUMENTS.

STATUS:

**APPROVED** 

07/15/2021

REVIEWED BY:

BH

ENGINEER, EVERSTEAD

QTY

50

100



JOB No. 2731383	RIPTION Summit Homes - Woodside Ridge #103	DDRESS TBD	CITY TID	ESIGNER SCOTT CLEVENGER	DATE 7/1/2021
	m				

**ROOF** TRUSS LAYOUT

PAGE

1 of 1