

CEDAR SHUTTERS 3-2 X 6 VERT WITH 2-2 X 4 HORZ. WITH SMART TRIM BACKING

TOP TAPERED PORTION OF COL.  
SMART TRIM 12" BASE 10" TOP


FRONT EL.  
STUCCO  
FINISH

REAR EL.  
1/8 = 1-0

RIGHT EL.  
1/8 = 1-0

LEFT EL.  
1/8 = 1-0

RELEASE FOR  
CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI  
07/26/2021

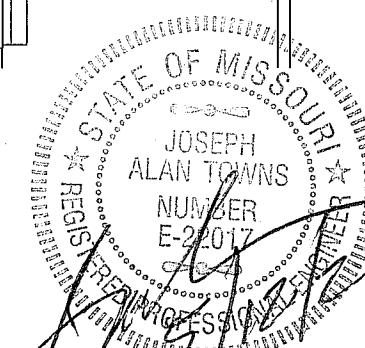

JOSEPH A. TOWNS P.E.  
MO. LIC E 22017  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY

BUILD IN ACCORDANCE WITH  
2018 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.

NICK ZVACEL CONSTRUCTION  
LOT 110 MONTICELLO  
4709 NE FREEHOLD DR  
LEE SUMMIT MO

SCALE  
1/4" = 1-0

DATE  
5-13-21

PLAN NO.

3532

SHEET NO.


1 OF 6

# COMBUSTION AIR CALCULATIONS

INPUT CAPACITY  
FURNACE = 100,000 BTU/HR  
H.W. HEATER = 50,000 BTU/HR  
TOTAL = 150,000 BTU/HR

50 CUBIC VOLUME REQ. PER 1,000 BTU/HR  
VOLUME IN UNFINISHED  
87 X 8 = 696 CU. FT.

SINCE UNFINISHED AREA DOES NOT  
PROVIDE SUFFICIENT VOLUME FOR  
NORMAL INFILTRATION, INSTALL 2  
METAL LOUVER VENTS IN WALL  
BETWEEN FAMILY ROOM AND FURNACE  
ROOM. ONE VENT SHALL BE @ MIN.  
WITHIN 12" OF THE TOP OF THE WALL,  
AND ONE VENT SHALL COMMENCE  
WITHIN 12" OF THE BOTTOM OF THE  
WALL. EACH VENT SHALL PROVIDE A  
MINIMUM FREE AREA OF 150 SQUARE  
INCHES (1" PER 1,000 BTU/HR) SINCE  
METAL LOUVERS HAVE 75% FREE AREA,  
MINIMUM LOUVER SIZE REQUIRED =  
150/75 = 200 SQ. IN.

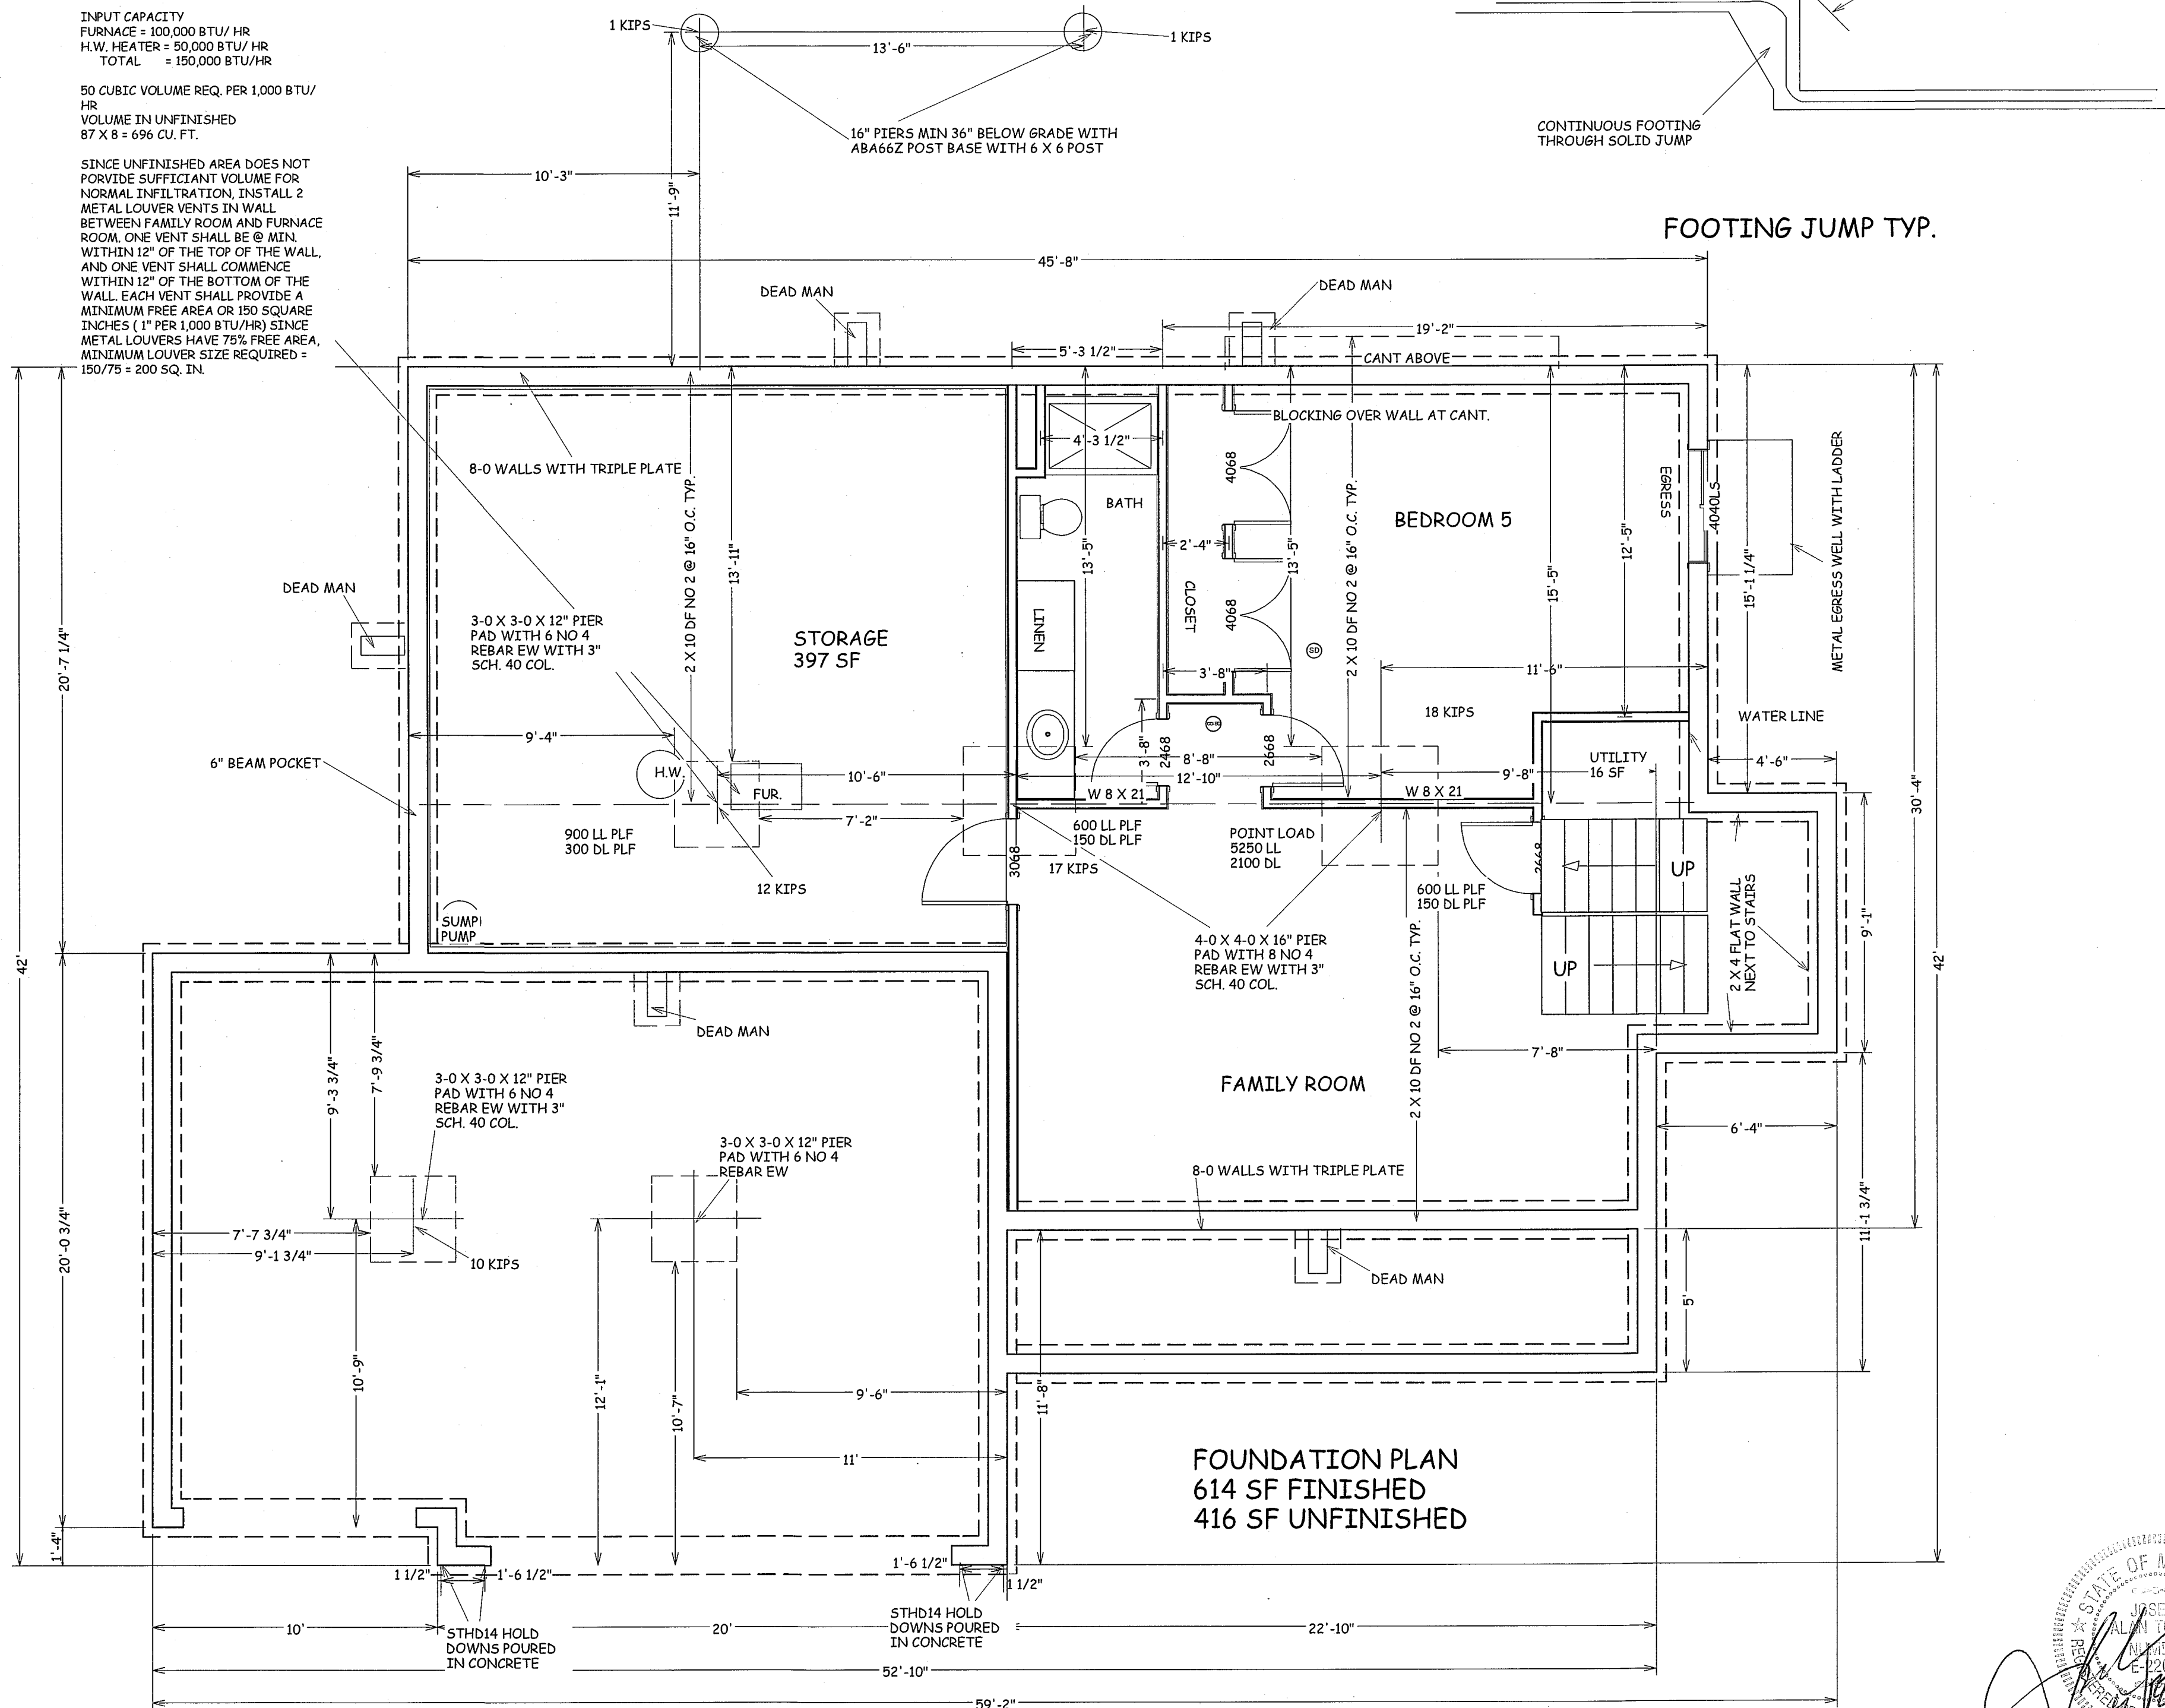

BUILD IN ACCORDANCE WITH  
2018 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.

NICK ZVACEL CONSTRUCTION  
LOT 110 MONTICELLO  
4709 NE FREEHOLD DR  
LEE SUMMIT MO

SCALE  
1/4" = 1'-0

DATE  
5-13-21

PLAN NO.

3532

SHEET NO.

2 OF 6


RELEASE FOR  
CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI

07/26/2021



JOSEPH A. TOWNS P.E.  
MO. LIC E 22017  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY



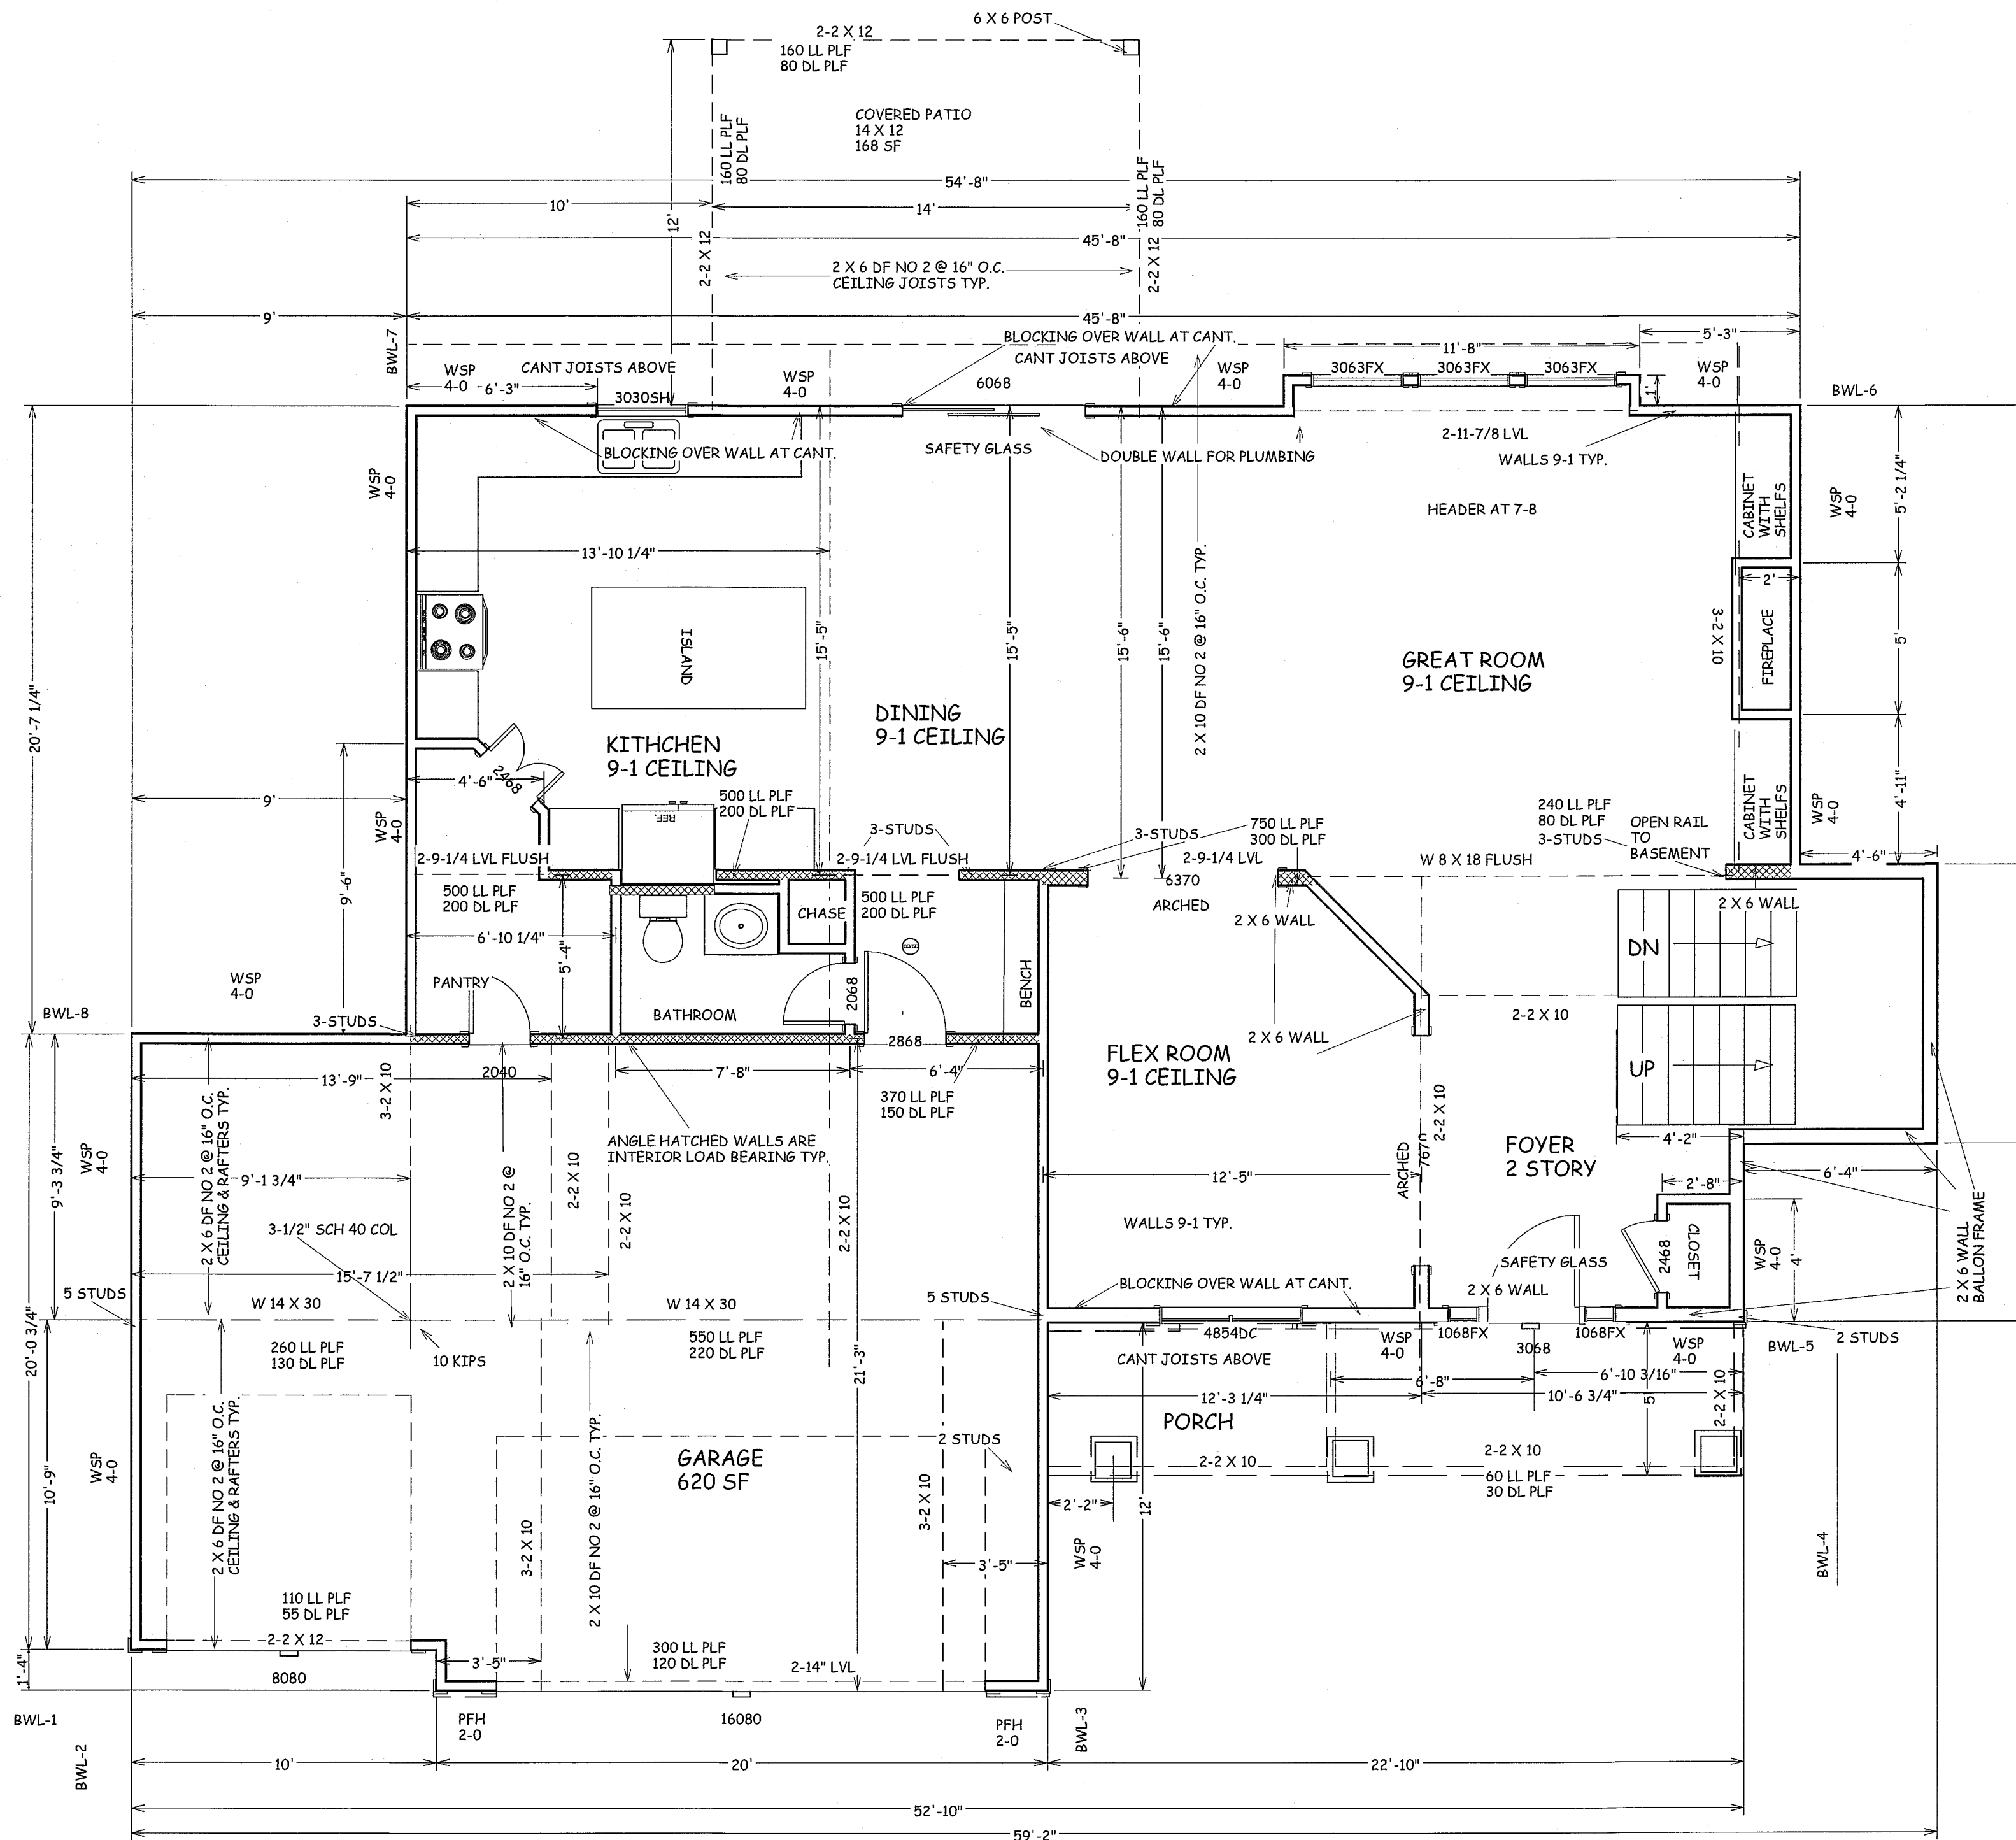

MAIN FLOOR 1212 S.F.

STATE OF MISSOURI  
JOSEPH A. TOWNS P.E.  
MO. LIC E 22017  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY

BUILD IN ACCORDANCE WITH  
2018 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.

NICK ZVACEL CONSTRUCTION  
LOT 110 MONTICELLO  
4709 NE FREEHOLD DR  
LEE SUMMIT MO

SCALE  
1/4" = 1-0

DATE  
5-13-21

PLAN NO.

3532

SHEET NO.

3 OF 6


RELEASE FOR  
CONSTRUCTION  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI

07/26/2021






ALL HIPS 2 X 8 DF NO 2 UNLESS NOTED OTHER WISE

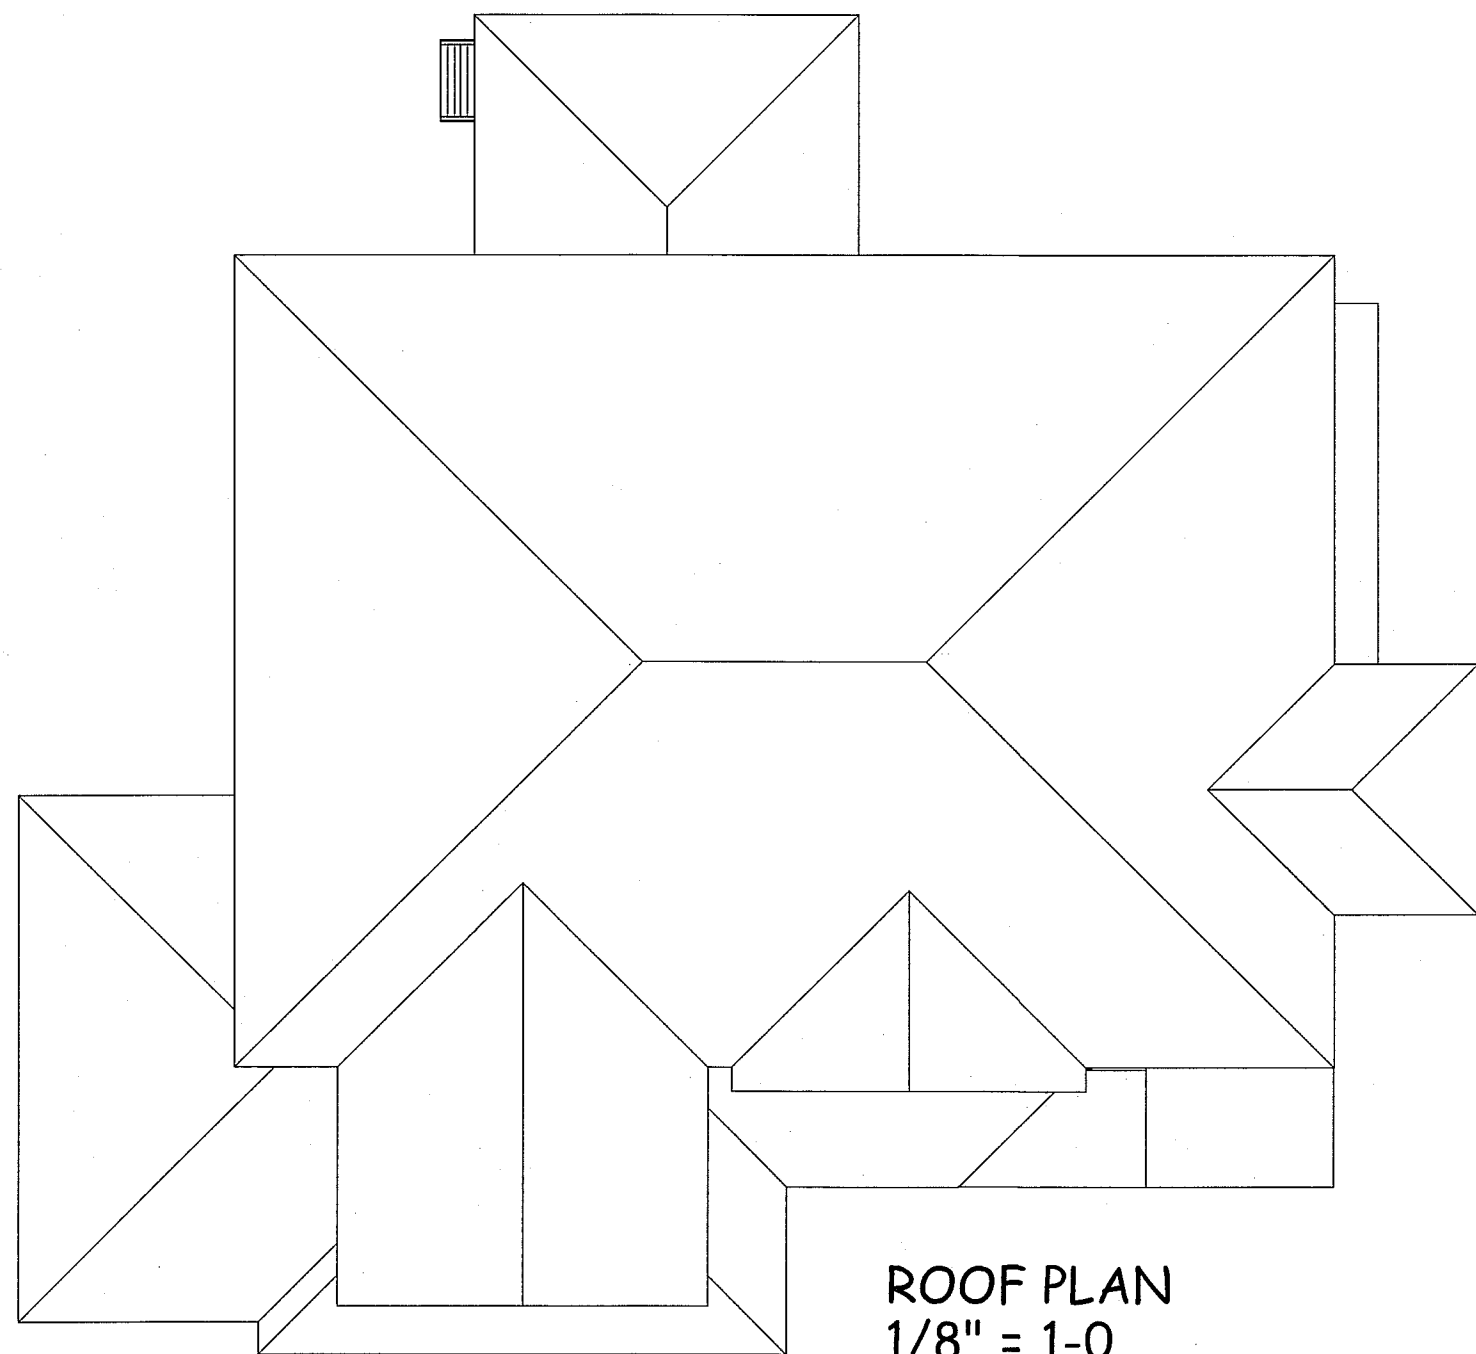


ROOF PLAN  
1/8" = 1'-0"  
ROOF PITCHES 6/12

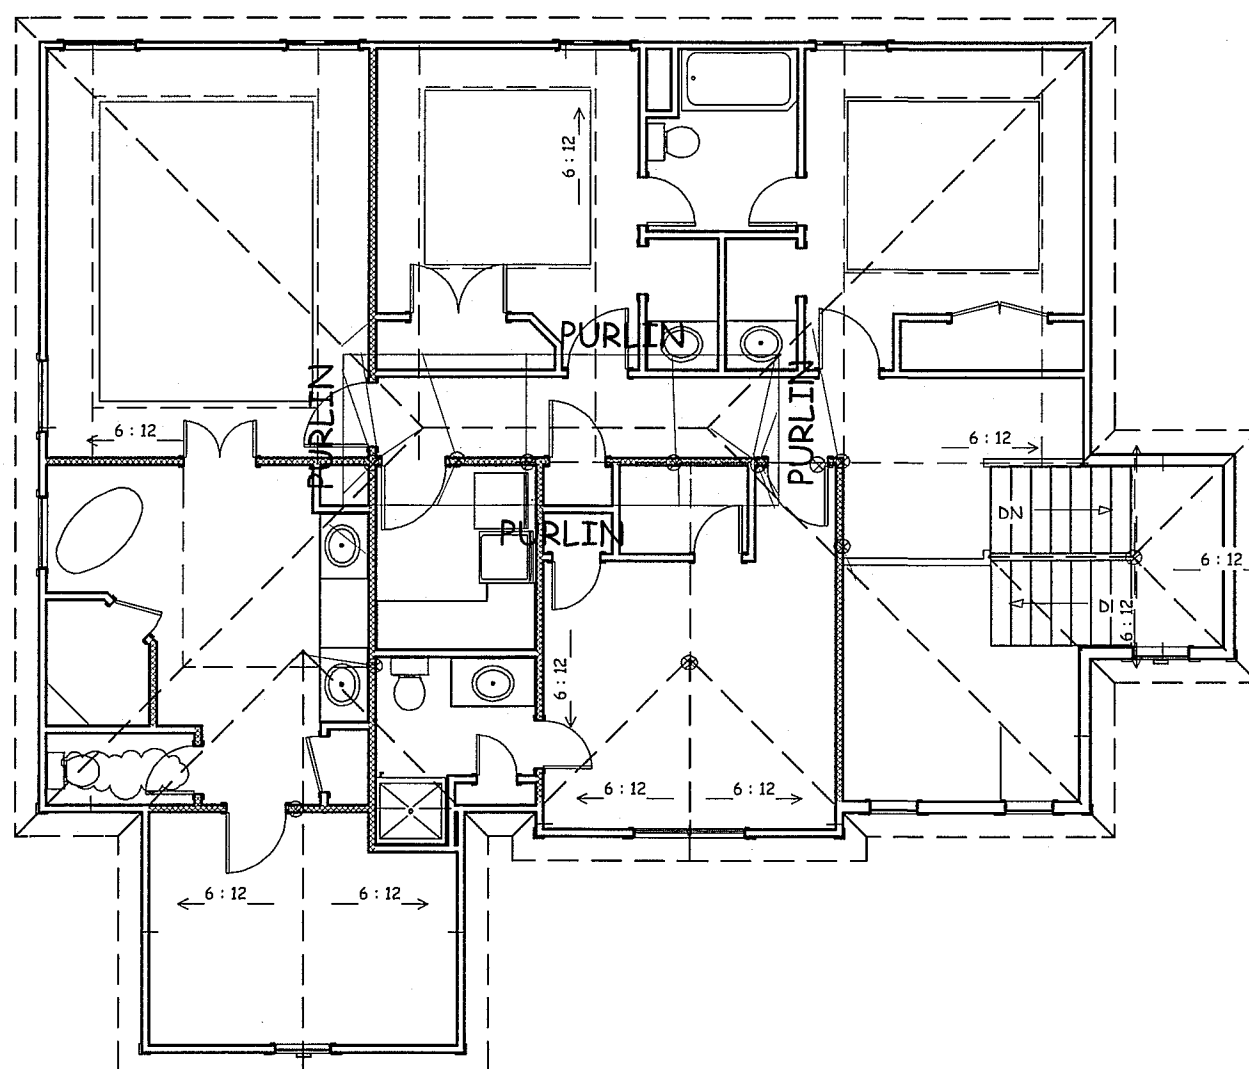

PURLIN PLAN  
SECOND FLOOR  
1/8 = 1-0

NO PURLINS NEEDED ON FIRST FLOOR

DUCTWORK NEEDS TO HAVE AN R-8 VALUE

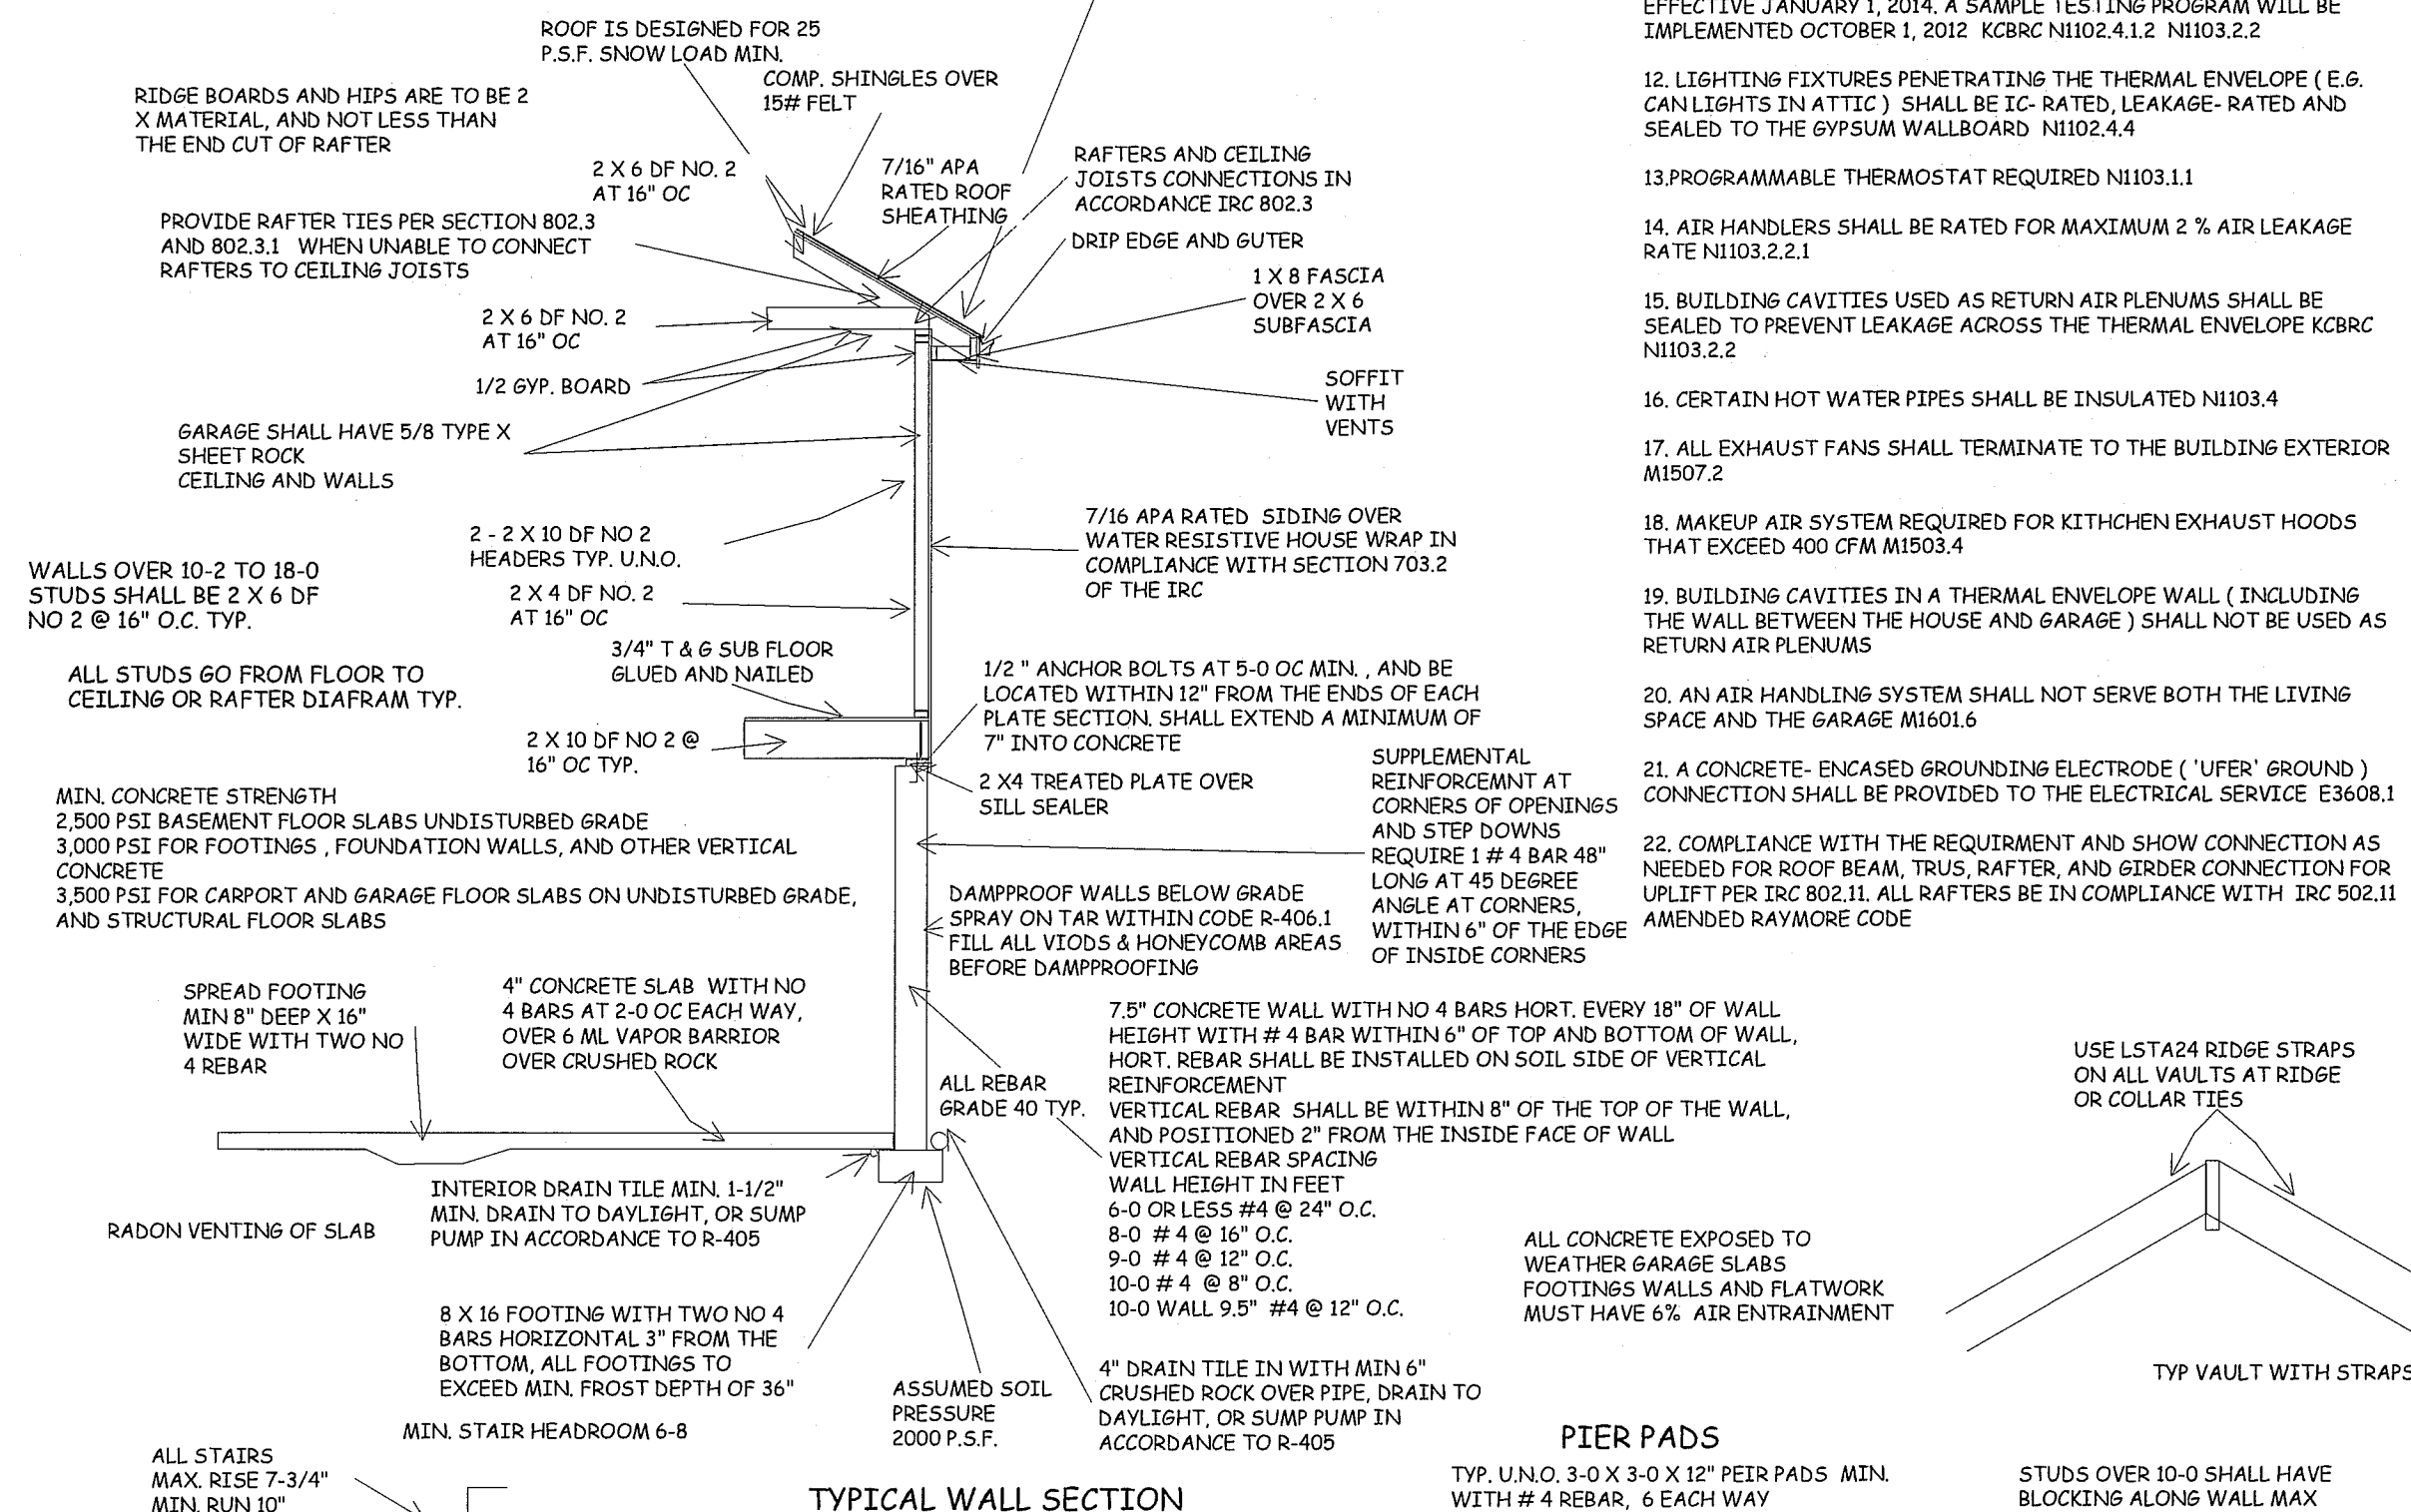


WINDOWS ARE TO HAVE FALL PROTECTION PER IBC 312.2

BEDROOM WINDOW EGRESS MINIMUM FOR A DOUBLE HUNG WINDOW IS 34 INCH CLEAR WIDTH MIN. AND 24 INCH CLEAR HEIGHT MIN. WITH A CLEAR OPENABLE AREA OF 5.7 SQUARE FEET MIN.

A CASEMENT OR SLIDER WINDOW MINIMUMS ARE 20 INCH CLEAR WIDTH MINIMUM AND 41 INCH CLEAR HEIGHT MINIMUM. WITH A MINIMUM 5.7 SQUARE FOOT OF OPENABLE AREA.

OPENING OF EGRESS WINDOW NOT MORE THAN 42" FROM THE FLOOR

TYP. U.N.O. 3-0 X 3-0 X 12" PEIR PADS MIN.  
WITH # 4 REBAR, 6 EACH WAY



EGRESS WINDOW WELL AS NEEDED  
PER SECTION 308 MIN 3-0 X 3-0  
WITH LADDER

STUDS OVER 10-0 SHALL HAVE  
BLOCKING ALONG WALL MAX  
OF 6-0 O.C.

OVERHEAD GARAGE DOORS  
MUST MEET DASHA 115 MPH  
OR IRC 2018 REQUIREMENTS

ALL POINT LOADS SHALL HAVE A MINIMUM OF 2 STUDS UNLESS NOTED OTHERWISE

**BUILD IN ACCORDANCE WITH  
2018 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.**

NICK ZVACEL CONSTRUCTION  
LOT 110 MONTICELLO  
4709 NE FREEHOLD DR  
LEE SUMMIT MO

SCALE  
1/4" = 1'-0"

DATE  
5-13-21

PLAN NO.

3532

SHEET NO.

5 OF 6

**RELEASE FOR  
CONSTRUCTION**  
AS NOTED ON PLANS REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI

07/26/2021



JOSEPH A. TOWNS P.E.  
MO. LIC E 22017  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY



EXPOSURE CATEGORY B 30-FOOT MEAN ROOF HEIGHT 10-FOOT WALL HEIGHT 2 BRACED WALL LINES		MINIMUM TOTAL LENGTH (FEET) OF BRACED WALL PANELS REQUIRED ALONG EACH BRACED WALL LINE*				
Ultimate Design Wind Speed (mph)	Story Location	Braced Wall Line Spacing (feet)	Method LIB <sup>b</sup>	Method GB	Methods DWB, WSP, SFB, PFB, FCF, HPS, BV-WSP, ABW, PFH, PFC, CS-SFB	Methods CS-WSP, CS-G, CS-PF
≤ 115		10	3.5	3.5	2.0	2.0
		20	6.5	6.5	3.5	3.5
		30	9.5	9.5	5.5	4.5
		40	12.5	12.5	7.0	6.0
		50	15.0	15.0	9.0	7.5
		60	18.0	18.0	10.5	9.0
		10	7.0	7.0	4.0	3.5
		20	12.5	12.5	7.5	6.5
		30	18.0	18.0	10.5	9.0
		40	23.5	23.5	13.5	11.5
		50	29.0	29.0	16.5	14.0
		60	34.5	34.5	20.0	17.0
		10	NP	10.0	6.0	5.0
		20	NP	18.5	11.0	9.0
		30	NP	27.0	15.5	13.0
		40	NP	35.0	20.0	17.0
		50	NP	43.0	24.5	21.0
		60	NP	51.0	29.0	25.0

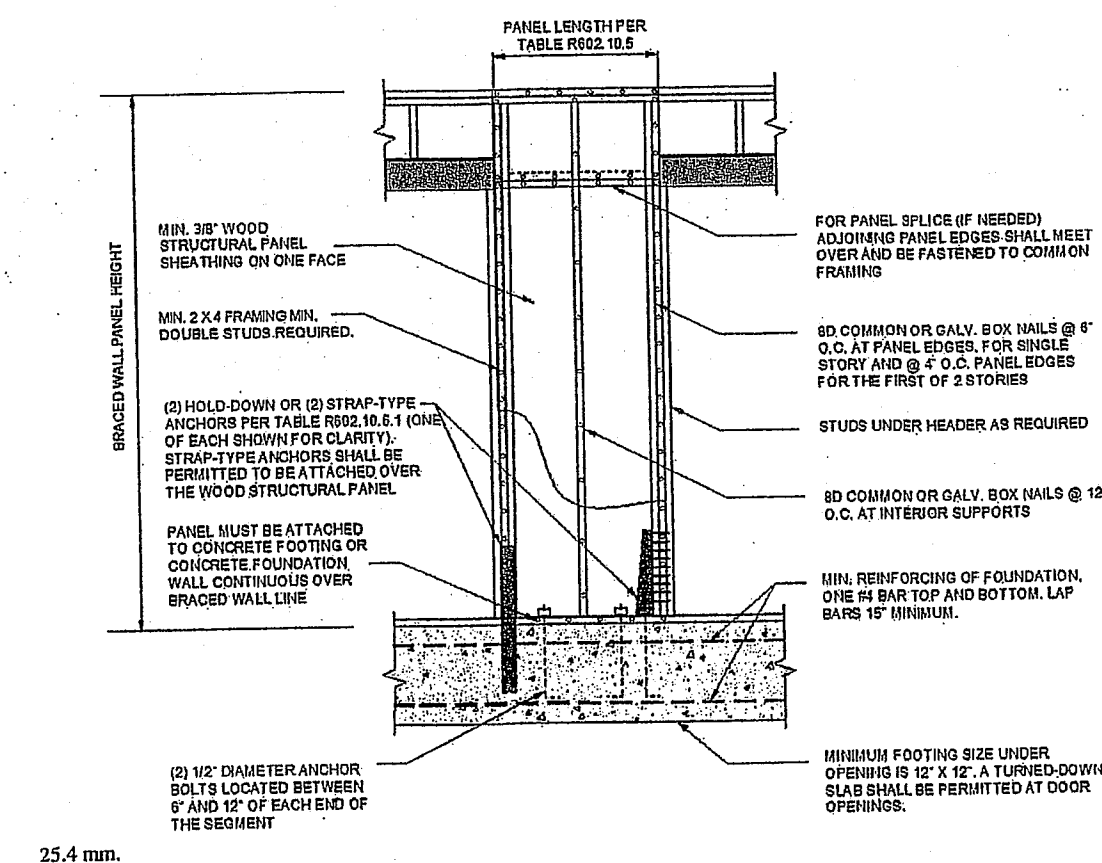


FIGURE R602.10.6.1  
METHOD ABW—ALTERNATE BRACED WALL PANEL

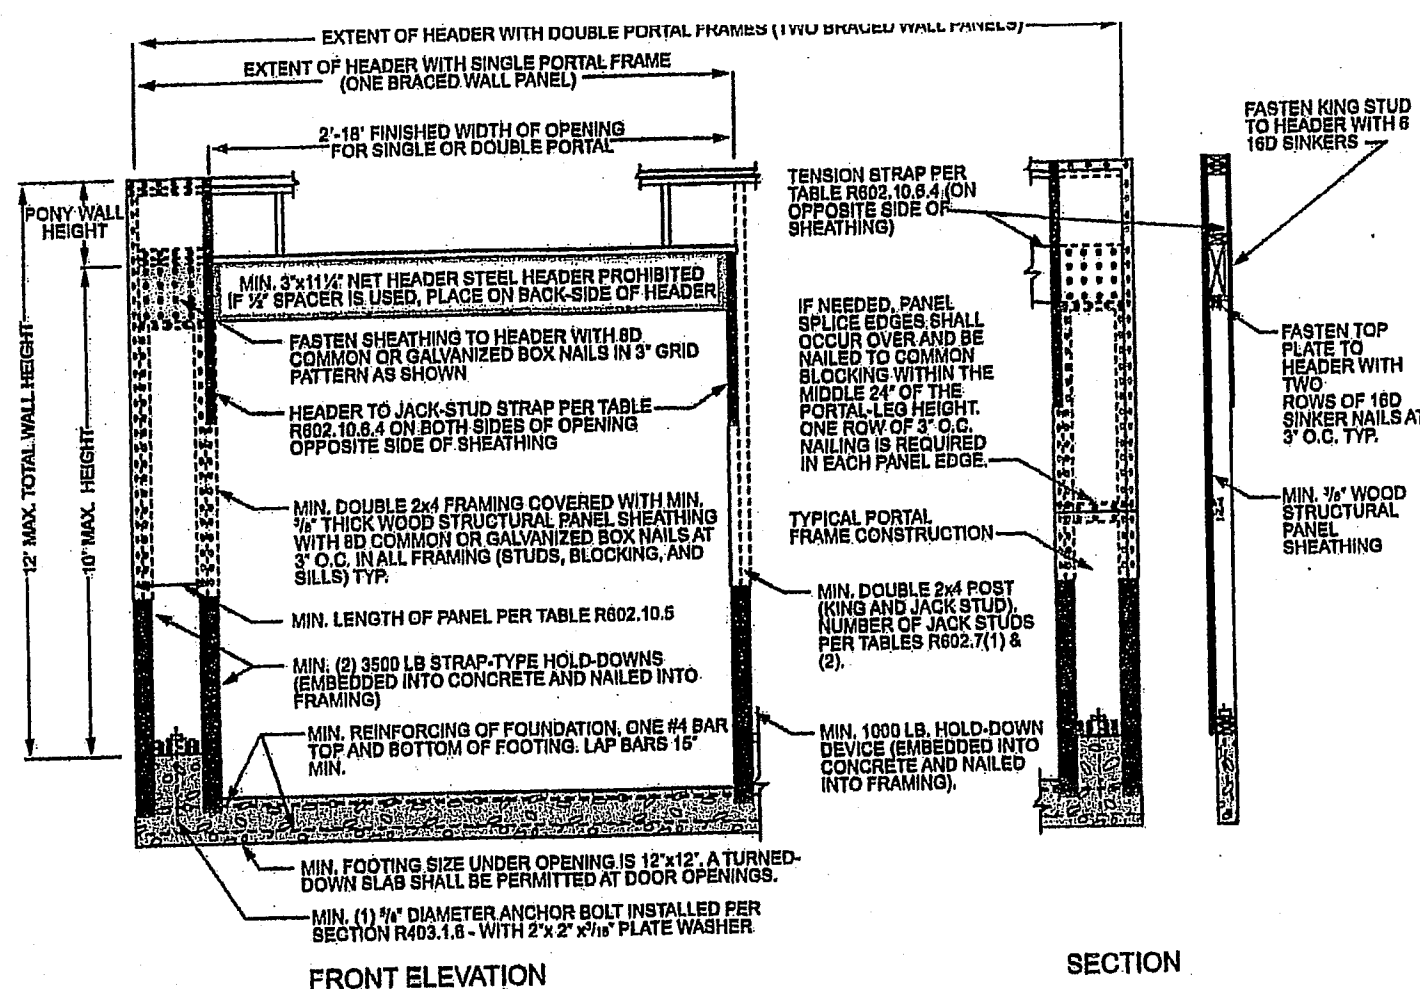


FIGURE R602.10.6.2  
METHOD PFH—PORTAL FRAME WITH HOLD-DOWNS

METHODS, MATERIAL	MINIMUM THICKNESS	FIGURE	CONNECTION CRITERIA*	
			Fasteners	Spacing
LIB Let-in-bracing	1 x 4 wood or approved metal straps at 45° to 60° angles for maximum 16\" stud spacing		Wood: 2-8d common nails or 3-8d (2 1/2\" long x 0.113\" dia.) nails Metal strap: per manufacturer	Wood: per stud and top and bottom plates Metal: per manufacturer
DWB Diagonal wood boards	3/4\" (1\" nominal) for maximum 24\" stud spacing		2-8d (2 1/2\" long x 0.113\" dia.) nails or 2 - 1 1/4\" long staples	Per stud
WSP Wood structural panel (See Section R604)	3/8\"		Exterior sheathing per Table R602.3(3) Interior sheathing per Table R602.3(1) or R602.3(2)	6\" edges 12\" field Varies by fastener
BV-WSP <sup>a</sup> Wood structural panels with stone or masonry veneer (See Section R602.10.6.5)	7/16\"	See Figure R602.10.6.5	8d common (2 1/2\" x 0.131\") nails	4\" at panel edges 12\" at intermediate supports 4\" at braced wall panel end posts
SFB Structural fiberboard sheathing	1/2\" or 3/4\" for maximum 16\" stud spacing		1 1/2\" long x 0.12\" dia. (for 1/2\" thick sheathing) 1 1/4\" long x 0.12\" dia. (for 3/4\" thick sheathing) galvanized roofing nails	3\" edges 6\" field
GB Gypsum board	1/2\"		Nails or screws per Table R602.3(1) for exterior locations Nails or screws per Table R702.3.5 for interior locations	For all braced wall panel locations: 7\" edges (including top and bottom plates) 7\" field
PBS Particleboard sheathing (See Section R605)	1/8\" or 1/4\" for maximum 16\" stud spacing		For 3/8\", 6d common (2\" long x 0.131\" dia.) nails For 1/2\", 8d common (2 1/2\" long x 0.131\" dia.) nails	3\" edges 6\" field
PCP Portland cement plaster	See Section R703.7 for maximum 16\" stud spacing		1 1/2\" long, 11 gage, 7/16\" dia. head nails or 7/8\" long, 16 gage staples	6\" o.c. on all framing members
HPS Hardboard panel siding	7/16\" for maximum 16\" stud spacing		0.092\" dia., 0.225\" dia. head nails with length to accommodate 1 1/2\" penetration into studs	4\" edges 8\" field
ABW Alternate braced wall	3/8\"		See Section R602.10.6.1	See Section R602.10.6.1

METHOD (See Table R602.10.4)	MINIMUM LENGTH* (Inches)					CONTRIBUTING LENGTH (Inches)
	8 feet	9 feet	10 feet	11 feet	12 feet	
DWB, WSP, SFB, PBS, FCF, HPS, BV-WSP	48	48	48	53	58	Actual <sup>b</sup>
GB	48	48	48	53	58	Double sided = Actual Single sided = 0.5 x Actual
LIB	55	62	69	NP	NP	Actual <sup>b</sup>
ABW	SDC A, B and C, ultimate design wind speed < 140 mph SDC D <sub>1</sub> , D <sub>2</sub> and D <sub>3</sub> , ultimate design wind speed < 140 mph	28	32	34	38	42
CS-G	Adjacent clear opening height (Inches)	24	27	30	33	36
CS-WSP, CS-SFB	≤ 64	24	27	30	33	36
	68	26	27	30	33	36
	72	27	27	30	33	36
	76	30	29	30	33	36
	80	32	30	30	33	36
	84	35	32	32	33	36
	88	38	35	33	33	36
	92	43	37	35	35	36
	96	48	41	38	36	36
	100	—	44	40	38	38
	104	—	49	43	40	39
	108	—	54	46	43	41
	112	—	—	50	45	43
	116	—	—	55	48	45
	120	—	—	60	52	48
	124	—	—	—	56	51
	128	—	—	—	61	54
	132	—	—	—	66	58
	136	—	—	—	—	62
	140	—	—	—	—	66
	144	—	—	—	—	72
METHOD (See Table R602.10.4)	Portal header height					48
	8 feet	9 feet	10 feet	11 feet	12 feet	
PFH	Supporting roof only	16	16	16	Note c	Note c
PFH	Supporting one story and roof	24	24	24	Note c	Note c
PFH		24	27	30	Note d	Note d
PFH		24	27	30	Note d	1.5 x Actual <sup>b</sup>
CS-PF	SDC A, B and C	16	18	20	Note e	Note e
CS-PF	SDC D <sub>1</sub> , D <sub>2</sub> and D <sub>3</sub>	16	18	20	Note e	Note e

For SFI: 1 inch = 25.4 mm, 1 foot = 304.8 mm, 1 mile per hour = 0.447 m/s.  
NP = Not Permitted.  
a. Linear interpolation shall be permitted.  
b. Use the actual length where it is greater than or equal to the minimum length.  
c. Maximum header height for PFH is 10 feet in accordance with Figure R602.10.6.2, but wall height shall be permitted to be increased to 12 feet with pony wall.  
d. Maximum header height for PFH is 10 feet in accordance with Figure R602.10.6.3, but wall height shall be permitted to be increased to 12 feet with pony wall.  
e. Maximum header height for CS-PF is 10 feet in accordance with Figure R602.10.6.4, but wall height shall be permitted to be increased to 12 feet with pony wall.

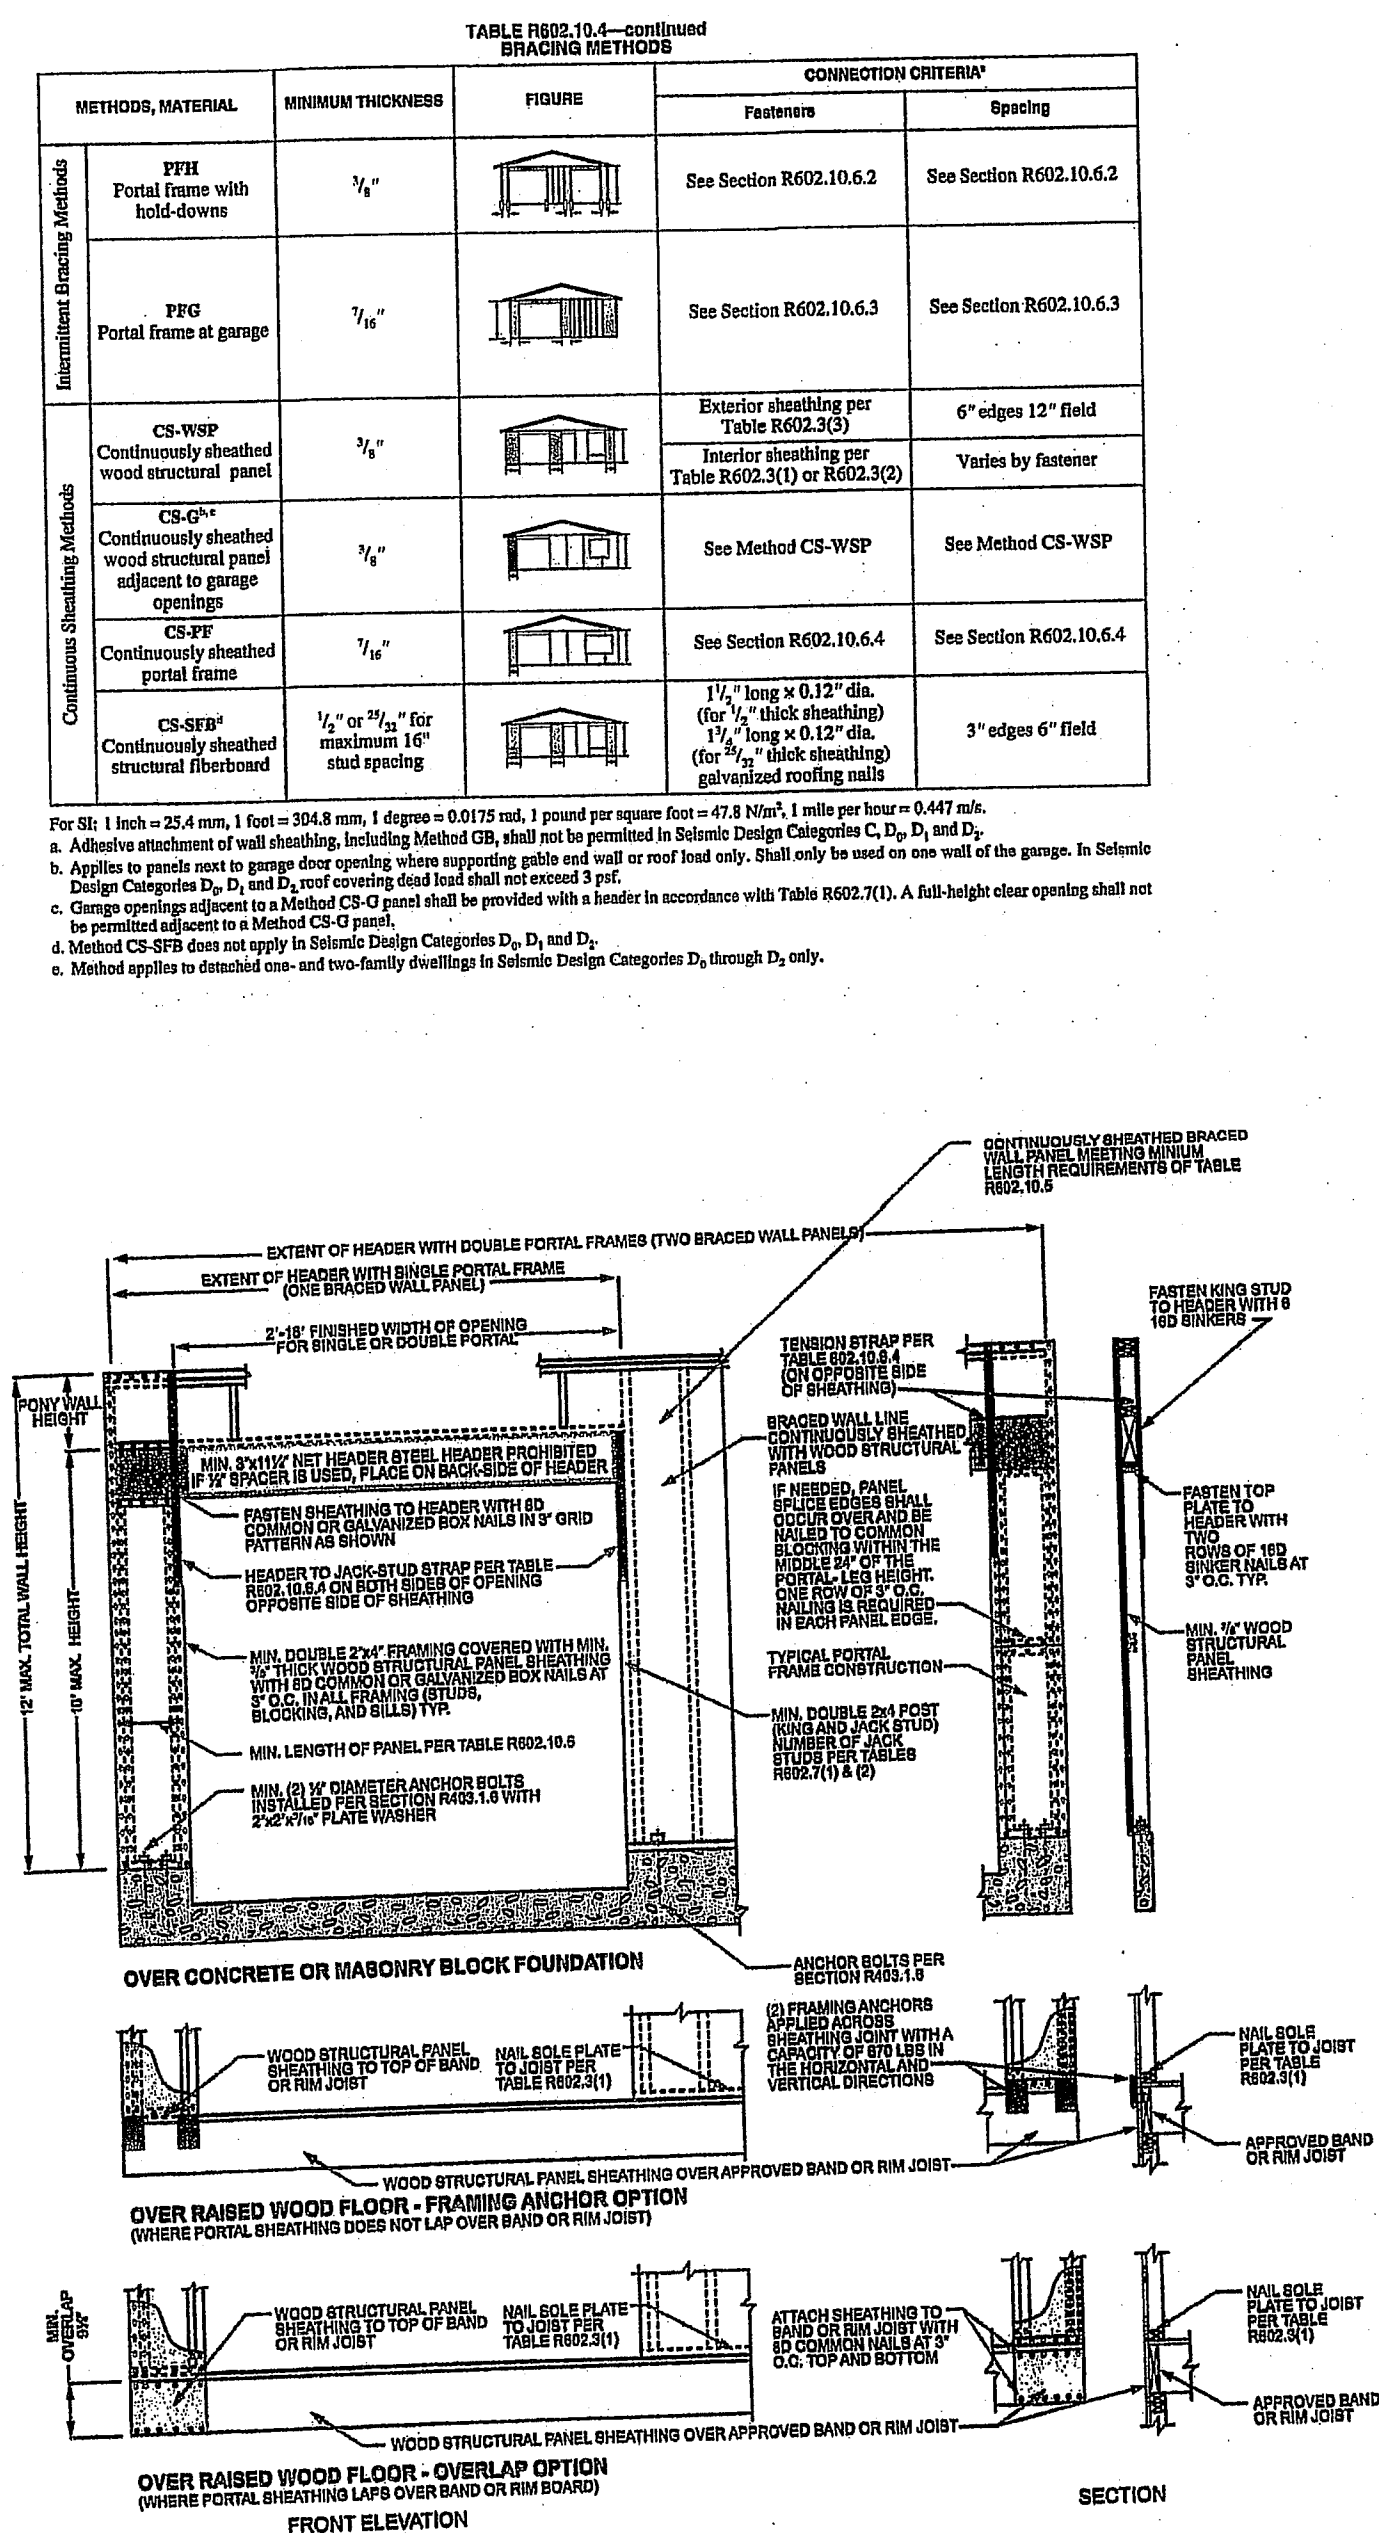


FIGURE R602.10.6.4  
METHOD CS-PF—CONTINUOUSLY SHEATHED PORTAL FRAME PANEL CONSTRUCTION

BUILD IN ACCORDANCE WITH  
2018 INTERNATIONAL  
RESIDENTIAL CODE AND  
LOCAL CODES.

NICK ZVACEL CONSTRUCTION  
LOT 110 MONTICELLO  
4709 NE FREEHOLD DR  
LEE SUMMIT MO

SCALE  
1/4" = 1'-0"

DATE  
5-13-21

PLAN NO.

3532

SHEET NO.

6 OF 6

RELEASE FOR  
CONSTRUCTION  
AS NOTED ON PLANS PERFORMED  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI

07/26/2021

JOSEPH A. TOWNS P.E.  
MO. LIC # 22017  
PROFESSIONAL SEAL  
APPLIES TO STRUCTURAL  
ELEMENTS ONLY