



MiTek USA, Inc.  
16023 Swingley Ridge Rd  
Chesterfield, MO 63017  
314-434-1200


Re: 2877185  
SUMMIT/hawthorn ridge #135/MO

The truss drawing(s) referenced below have been prepared by MiTek USA, Inc. under my direct supervision based on the parameters provided by Builders FirstSource (Valley Center).

Pages or sheets covered by this seal: I47079224 thru I47079261

My license renewal date for the state of Missouri is December 31, 2022.

Missouri COA: Engineering 001193

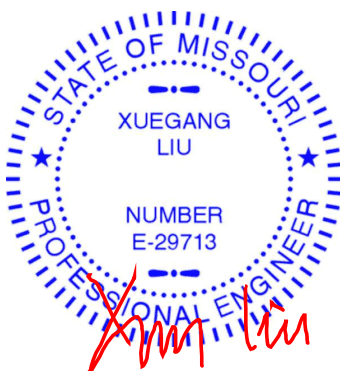


July 20, 2021

Liu, Xuegang, Engineer

**IMPORTANT NOTE:** The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to MiTek or TRENCO. Any project specific information included is for MiTek's or TRENCO's customers file reference purpose only, and was not taken into account in the preparation of these designs. MiTek or TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #13 5/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	A1	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 28 09:05:40 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-9k8pCrNbKEUeQrXDUJB2tE66rroHlVUJnq4wQDN9
34-4-10
14-0-10
08/05/2021

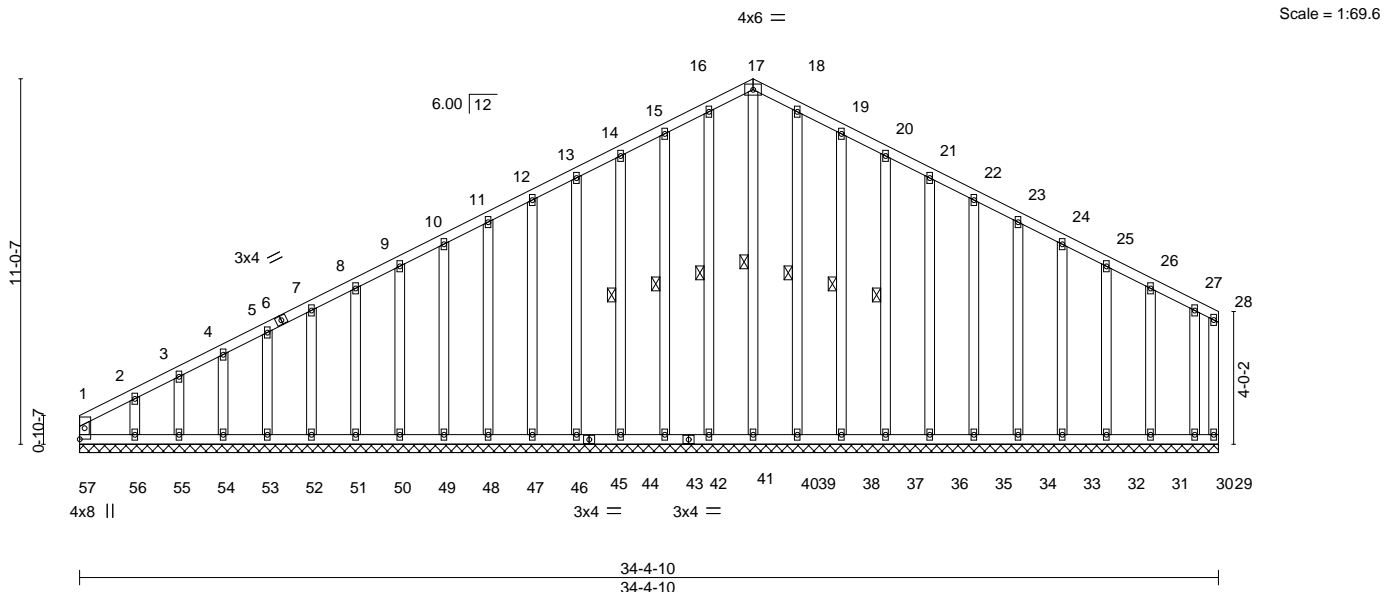


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.13	Horz(CT)	-0.00	29	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R					Weight: 265 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD 2x4 SPF No.2		TOP CHORD	Structural wood sheathing directly applied or 6'-0" oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2		BOT CHORD	Rigid ceiling directly applied or 10'-0" oc bracing.
WEBS 2x4 SPF No.2		WEBS	1 Row at midpt 17-40, 16-41, 15-43, 14-44, 18-39, 19-38, 20-37
OTHERS 2x4 SPF No.2			

**REACTIONS.** All bearings 34-4-10.  
 (lb) - Max Horz 57=244(LC 9)  
 Max Uplift All uplift 100 lb or less at joint(s) 57, 29, 41, 43, 44, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 39, 38, 37, 36, 35, 34, 33, 32, 31, 30 except 56=192(LC 12)  
 Max Grav All reactions 250 lb or less at joint(s) 57, 29, 40, 41, 43, 44, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 39, 38, 37, 36, 35, 34, 33, 32, 31, 30

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 12-13=-134/269, 13-14=-146/303, 14-15=-158/336, 15-16=-172/375, 16-17=-175/390, 17-18=-175/390, 18-19=-172/375, 19-20=-158/336, 20-21=-146/303, 21-22=-134/269  
 WEBS 17-40=-254/85

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-1-12 to 3-0-0, Exterior(2N) 3-0-0 to 20-4-0, Corner(3R) 20-4-0 to 23-4-0, Exterior(2N) 23-4-0 to 34-2-14 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) All plates are 2x4 MT20 unless otherwise indicated.
  - 5) Gable requires continuous bottom chord bearing.
  - 6) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - 7) Gable studs spaced at 1'-4" oc.
  - 8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 57, 29, 41, 43, 44, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 39, 38, 37, 36, 35, 34, 33, 32, 31, 30 except (jt=lb) 56=192.
  - 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

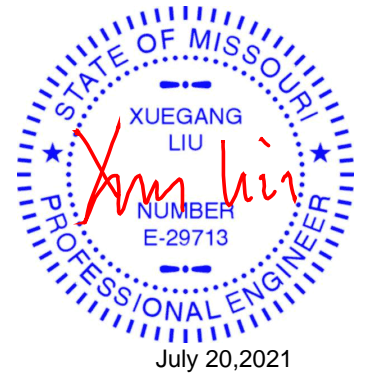

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	A2	Roof Special	5	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:05:42 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-67GadXOrslMg9HcckEWdUJkVvYF87foYAmzwwDm7

2-3-8	6-6-14	7-5-3	13-6-5	14-3-13	20-4-0	23-2-8	27-3-7	27-7-12	32-1-0	34-4-10
2-3-8	4-3-6	0-10-5	6-1-2	0-9-8	6-0-3	2-10-8	4-0-15	0-4-5	4-5-4	2-3-10

4x8 =

Scale = 1:71.8

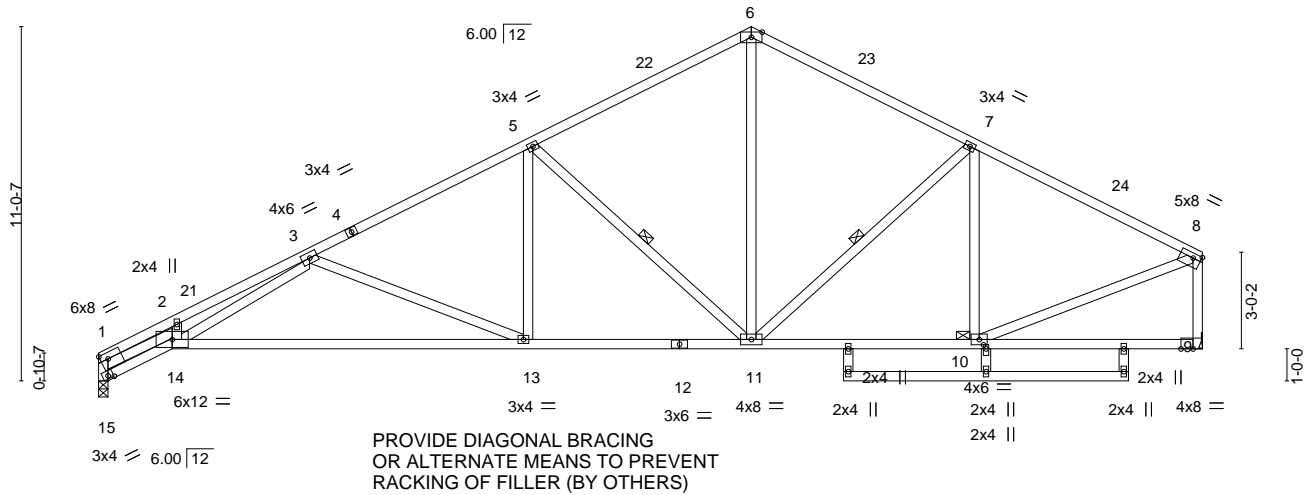

2-3-8	9-3-3	13-6-5	16-2-13	20-4-0	23-2-8	27-3-7	27-7-12	32-1-0	34-4-10
2-3-8	6-11-11	4-3-2	2-8-8	4-1-3	2-10-8	4-0-15	0-4-5	4-5-4	2-3-10

Plate Offsets (X,Y)-- [1:Edge,0-2-4], [8:Edge,0-1-12], [9:0-4-8,0-0-0], [10:0-1-8,0-1-0], [15:0-2-0,0-1-3]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.84	Vert(LL)	-0.44 13-14	>930	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.86	Vert(CT)	-0.98 13-14	>415	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.94	Horz(CT)	0.24 9	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 170 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2 "Except"  
 12-14: 2x4 SPF 1650F 1.5E  
 WEBS 2x4 SPF No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied.  
 WEBS 1 Row at midpt 7-11, 5-11  
 JOINTS 1 Brace at Jt(s): 10

**REACTIONS.**

(size) 15=0-3-8, 9=Mechanical  
 Max Horz 15=229(LC 9)  
 Max Uplift 15=267(LC 12), 9=224(LC 13)  
 Max Grav 15=1534(LC 1), 9=1534(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-15=-1634/360, 1-2=-4664/967, 2-3=-4539/1028, 3-5=-2417/447, 5-6=-1595/374,  
 6-7=-1597/370, 7-8=-1690/303, 8-9=-1467/276  
 BOT CHORD 14-15=-293/383, 13-14=-707/2836, 11-13=-382/2068, 10-11=-237/1425  
 WEBS 1-14=-751/3831, 6-11=-172/871, 7-11=-278/176, 7-10=-391/145, 8-10=-208/1453,  
 5-13=-52/587, 5-11=-1007/333, 3-13=-831/352, 3-14=-390/1471

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-1-12 to 3-1-12, Interior(1) 3-1-12 to 20-4-0, Exterior(2R) 20-4-0 to 23-4-0, Interior(1) 23-4-0 to 34-2-14 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Refer to girder(s) for truss to truss connections.
- Bearing at joint(s) 15 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 15=267, 9=224.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #13	5/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	B1	ROOF SPECIAL	3	1	Job Reference (optional)		

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,

8.430 s Jun 2 2021
MiTek Industries, Inc.
Tue Jul 20 09:05:43 2021
Page 1
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-ajpyqtPuc9tDHIFoaSIIMW5V4-Em7FtyvWvOKPwDn6

08/05/2021

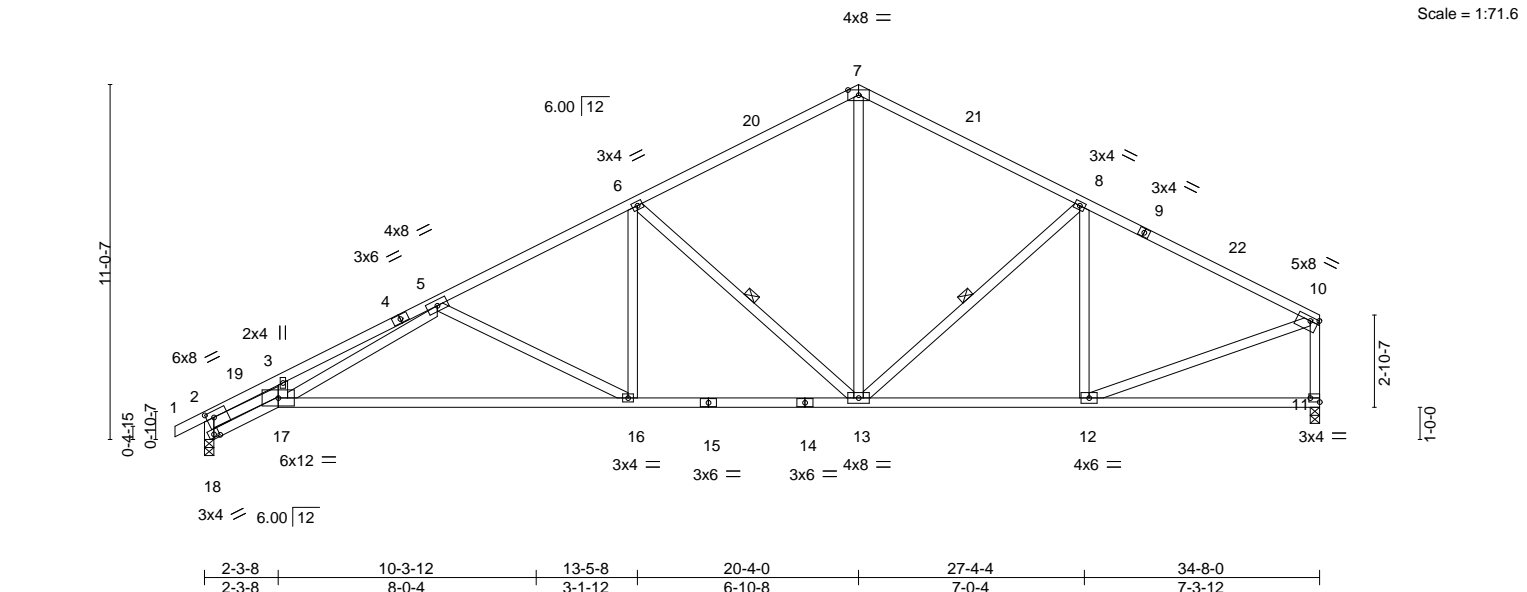



Plate Offsets (X,Y)-- [2:0-2-12,0-2-4], [10:0-3-0,0-1-8], [11:Edge,0-1-8], [18:0-2-0,0-1-3]											
LOADING (psf)		SPACING-- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d			PLATES GRIP		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.92	Vert(LL)	-0.44	16-17	>941	240	MT20 197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.85	Vert(CT)	-0.99	16-17	>418	180	
BCLL	0.0	Rep Stress Incr	YES	WB	0.94	Horz(CT)	0.25	11	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							Weight: 159 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2 "Except"	BOT CHORD Rigid ceiling directly applied.
15-17: 2x4 SPF 1650F 1.5E	WEBS 1 Row at midpt 8-13, 6-13
WEBS 2x4 SPF No.2	

**REACTIONS.** (size) 11=0-3-8, 18=0-3-8  
Max Horz 18=235(LC 9)  
Max Uplift 11=227(LC 13), 18=293(LC 12)  
Max Grav 11=1546(LC 1), 18=1622(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-18=-1715/386, 2-3=-4671/983, 3-5=-4571/1067, 5-6=-2435/455, 6-7=-1622/375, 7-8=-1627/375, 8-10=-1754/308, 10-11=-1476/278  
BOT CHORD 17-18=-294/382, 16-17=-666/2748, 13-16=-385/2093, 12-13=-241/1479  
WEBS 2-17=-765/3837, 7-13=-169/885, 8-13=-309/184, 8-12=-362/141, 10-12=-209/1484, 6-16=-64/594, 6-13=-999/329, 5-16=-736/317, 5-17=-461/1577

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 20-4-0, Exterior(2R) 20-4-0 to 23-4-0, Interior(1) 23-4-0 to 34-6-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 18 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=227, 18=293.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

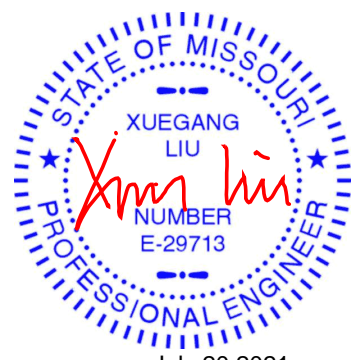

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	B1A	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,


8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:05:45 2021 Page 1

ID:VPVqVFnP0P0b1j2tZrIQezdKbx-WixiFZRk8m7xXcPBltDnDSxys6 WCTLOFesVQWvDn4

1-11-0 2-3-8 7-2-14 8-3-11 13-5-8 14-3-13 20-4-0 27-4-4 34-8-0  
 1-11-0 2-3-8 4-11-6 1-0-13 5-1-13 0-10-5 6-0-3 7-0-4 7-3-12

4x8 =

Scale = 1:72.3

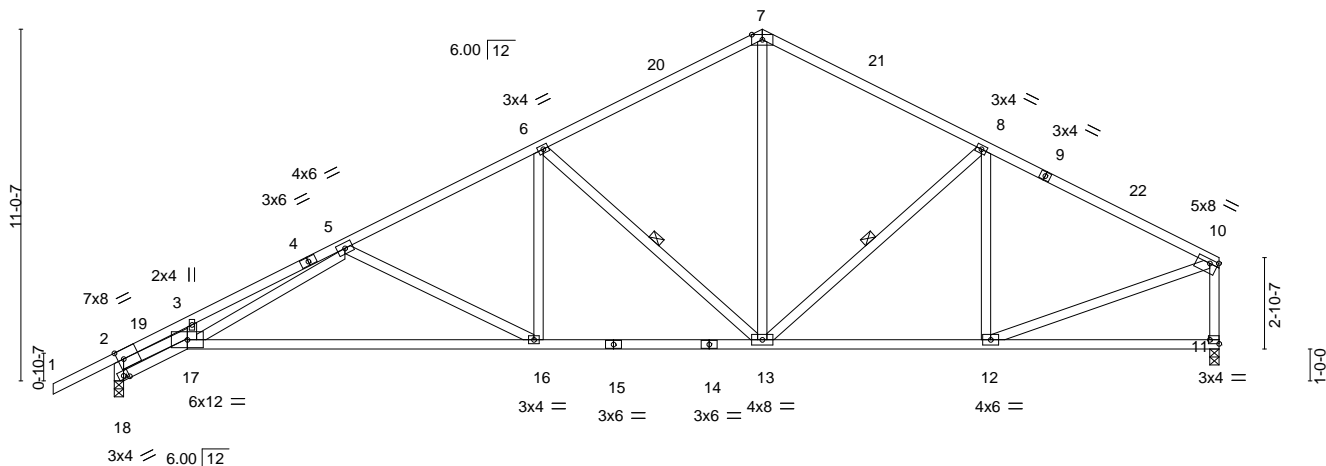

2-3-8 10-3-12 13-5-8 20-4-0 27-4-4 34-8-0  
 2-3-8 8-0-4 3-1-12 6-10-8 7-0-4 7-3-12

Plate Offsets (X, Y)-- [2:0-2-3,Edge], [10:0-3-0,0-1-8], [11:Edge,0-1-8], [18:0-2-0,0-1-3]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.88	Vert(LL)	-0.44 16-17	>941	240	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.85	Vert(CT)	-0.98 16-17	>419	180		
BCLL 0.0	Rep Stress Incr	YES	WB 0.94	Horz(CT)	0.24 11	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS					Weight: 160 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2 "Except"  
 15-17: 2x4 SPF 1650F 1.5E  
 WEBS 2x4 SPF No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied.  
 WEBS 1 Row at midpt 8-13, 6-13

**REACTIONS.**

(size) 11=0-3-8, 18=0-3-8  
 Max Horz 18=245(LC 9)  
 Max Uplift 11=227(LC 13), 18=317(LC 12)  
 Max Grav 11=1543(LC 1), 18=1696(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-18=-1733/393, 2-3=-4531/935, 3-5=-4424/1016, 5-6=-2422/450, 6-7=-1617/370,  
 7-8=-1622/374, 8-10=-1750/304, 10-11=-1473/277  
 BOT CHORD 17-18=-255/289, 16-17=-657/2720, 13-16=-381/2082, 12-13=-240/1475  
 WEBS 2-17=-759/3829, 7-13=-168/881, 8-13=-310/185, 8-12=-361/141, 10-12=-208/1480,  
 6-16=-61/591, 6-13=-990/327, 5-16=-717/311, 5-17=-417/1453

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 20-4-0, Exterior(2R) 20-4-0 to 23-4-0, Interior(1) 23-4-0 to 34-6-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 18 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=227, 18=317.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	C1	Roof Special	2	1	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,

8.430 s Jun 2 2021
MiTek Industries, Inc.
Tue Jun 22 09:05:46 2021
Page 1
ID:VPVqvFnP0P0b1j2tZrlQezdKbx-\_uV5TvRMv4Fo8m\_NralS\_9L40LEPCTPw3wkwDN3

08/05/2021

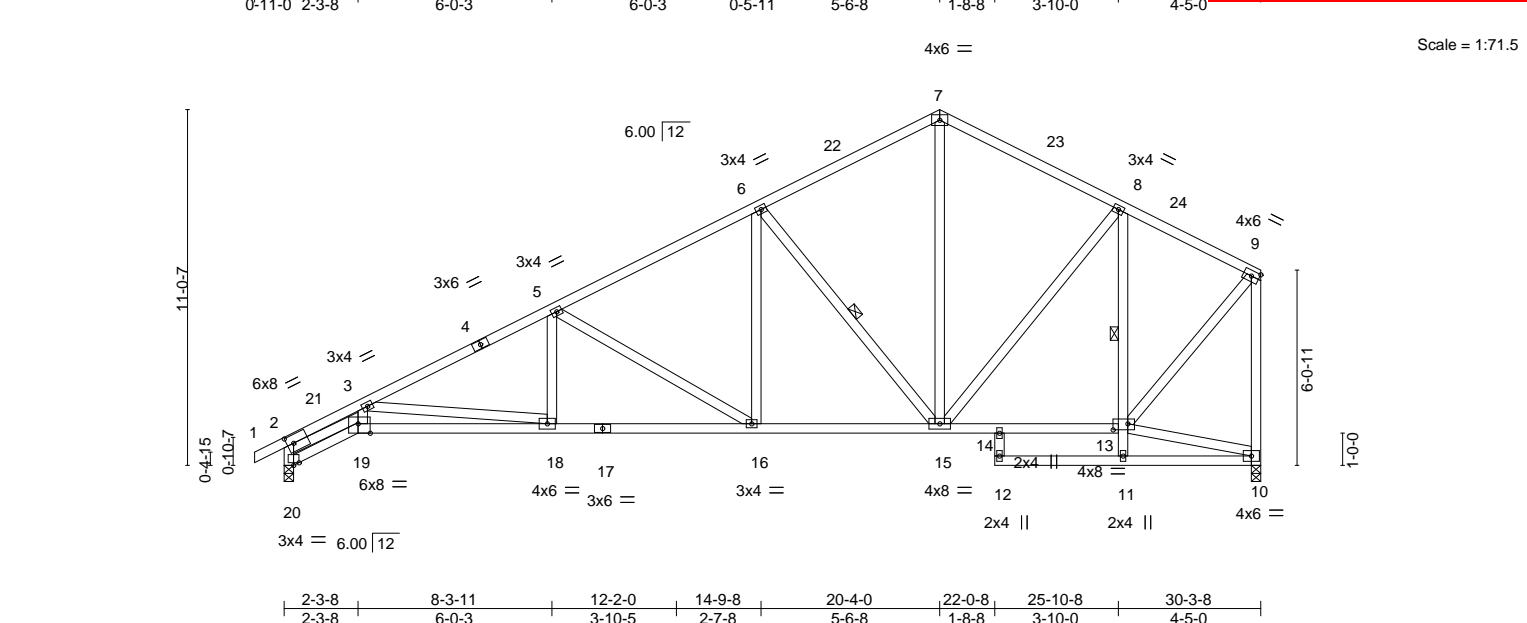


Plate Offsets (X,Y)-- [2:0-2-7,0-3-0], [13:0-5-8,0-2-4], [19:0-4-8,Edge]									
<b>LOADING</b> (psf)		<b>SPACING--</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d		<b>PLATES</b>	<b>GRIP</b>
TCLL	25.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	-0.18 18-19 >999 240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.98	Vert(CT)	-0.35 18-19 >999 180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.82	Horz(CT)	0.22 10 n/a n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS				Weight: 167 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 8-11, 6-15

**REACTIONS.** (size) 20=0-3-8, 10=0-3-8  
Max Horz 20=315(LC 9)  
Max Uplift 20=267(LC 12), 10=197(LC 12)  
Max Grav 20=1426(LC 1), 10=1349(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-20=-1428/355, 2-3=-4023/981, 3-5=-2564/505, 5-6=-1785/370, 6-7=-1140/313, 7-8=-1137/307, 8-9=-848/223, 9-10=-1287/264  
BOT CHORD 19-20=-368/409, 18-19=-1012/3418, 16-18=-552/2250, 15-16=-366/1503, 14-15=-199/715, 13-14=-189/632  
WEBS 2-19=-812/3350, 3-19=-223/651, 7-15=-145/554, 8-13=-759/214, 9-13=-220/1082, 8-15=-60/391, 6-16=-97/549, 6-15=-900/314, 5-16=-865/296, 5-18=-17/386, 3-18=-1178/481

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 20-4-0, Exterior(2R) 20-4-0 to 23-4-0, Interior(1) 23-4-0 to 30-1-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 20, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 20=267, 10=197.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	C1A	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,

8.430 s Jun 2 2021
MiTek Industries, Inc.
Tue Jul 20 09:05:48 2021
Page 1
ID:VPVqVFnP0P0b1j2tZrOgezdkBx-wHdruaTcRhVWO43ly?Lw3aa4HwtdkzKE197dwwDh1
08/05/2021

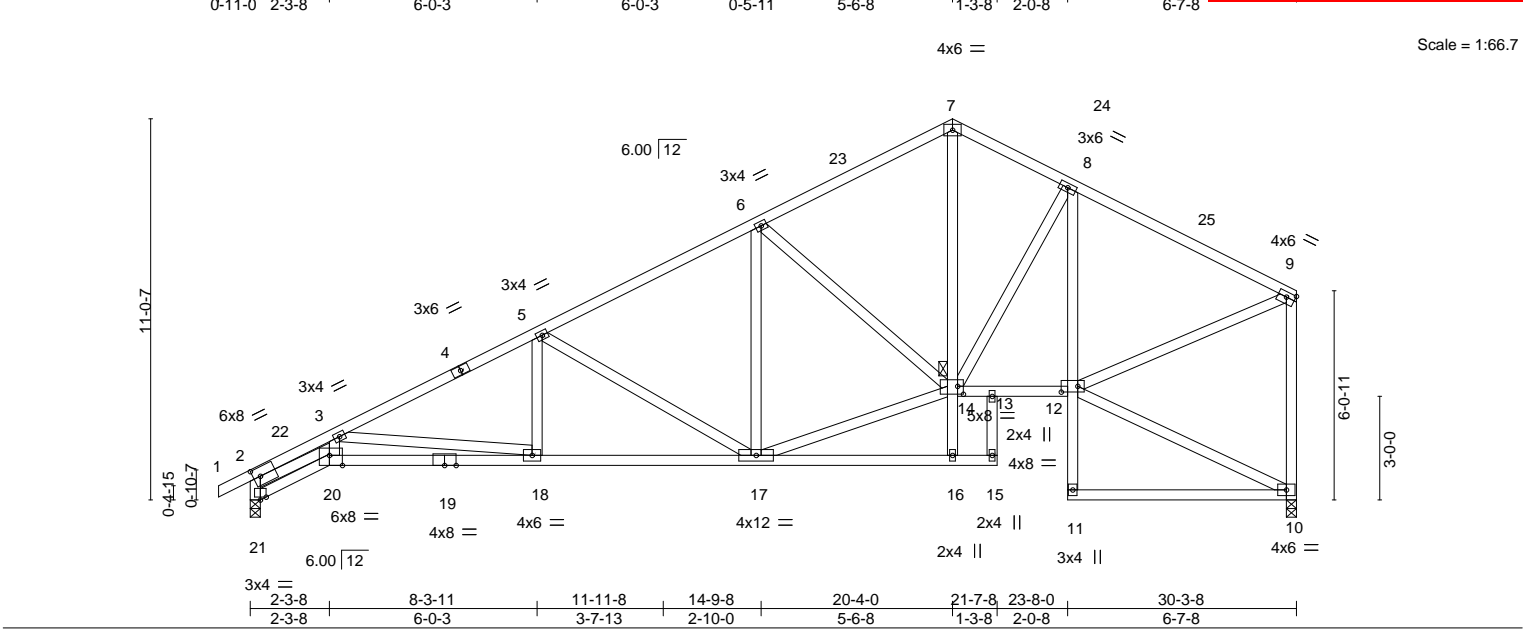


Plate Offsets (X,Y)-- [2:0-2-7,0-3-0], [9:Edge,0-1-12], [12:0-5-12,0-2-0], [14:0-2-0,0-2-12], [20:0-4-8,Edge]											
LOADING (psf)		SPACING- 2-0-0		CSI.		DEFL. in (loc) l/defl L/d		PLATES GRIP			
TCLL	25.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	-0.18 18-20	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.98	Vert(CT)	-0.35 18-20	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.82	Horz(CT)	0.24 10	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS						Weight: 172 lb	FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	JOINTS 1 Brace at Jt(s): 14

**REACTIONS.** (size) 21=0-3-8, 10=0-3-8  
Max Horz 21=315(LC 9)  
Max Uplift 21=-267(LC 12), 10=-197(LC 12)  
Max Grav 21=1426(LC 1), 10=1349(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-21=-1428/355, 2-3=-4024/981, 3-5=-2563/505, 5-6=-1786/370, 6-7=-1376/327, 7-8=-1361/360, 8-9=-1400/303, 9-10=-1288/304  
BOT CHORD 20-21=-368/409, 18-20=-1013/3419, 17-18=-552/2249, 13-14=-288/1124, 12-13=-302/1162, 8-12=-376/108  
WEBS 2-20=-812/3352, 3-20=-223/651, 7-14=-190/875, 9-12=-273/1250, 5-17=-861/296, 5-18=-17/385, 6-14=-527/248, 3-18=-1180/481, 14-17=-376/1540


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 20-4-0, Exterior(2R) 20-4-0 to 23-4-0, Interior(1) 23-4-0 to 30-1-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 21, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 21=267, 10=197.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20,2021

Builders FirstSource (Valley Center),	Valley Center, KS - 67147,
---------------------------------------	----------------------------

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:05:49 2021 Page 1  
ID:VPVqvFnP0P0b1j2tZrI0qezdKbx-PTBD5wUEC?dN?DyWis9c6JZkaP4KkZuX3?wDN0



Weight: 175 lb      FT = 20%

<b>BRACING-</b>	
<b>TOP CHORD</b>	Structural wood sheathing directly applied, except end verticals.
<b>BOT CHORD</b>	Rigid ceiling directly applied.
<b>WEBS</b>	1 Row at midpt                      9-12, 7-16

(size) 2=0-3-8, 11=0-3-8  
Max Horz 2=307(LC 11)  
Max Uplift 2=-265(LC 12), 11=-198(LC 12)  
Max Grav 2=1422(LC 1), 11=1356(LC 1)



**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**TOP CHORD** 2-10=2133/398, 4-6=-1988/400, 6-7=-1918/460, 7-8=-1146/311, 8-9=-1149/307,  
9-10=-851/224, 10-11=-1292/264

**BOT CHORD** 2-19=458/1829, 6-17=-288/127, 16-17=-367/1490, 15-16=-200/717, 14-15=-189/633

**WEBS** 17-19=-441/1760, 9-14=-773/211, 10-14=-220/1084, 8-16=-137/550, 7-16=-865/316,  
9-16=-59/407, 7-17=-208/798

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BC DL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 20-4-0, Exterior(2R) 20-4-0 to 23-4-0, Interior(1) 23-4-0 to 30-1-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Bearing at joint(s) 11 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=265, 11=198.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.





Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	C3	Roof Special	4	1	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:05:51 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-Lsl\_WcVVkct4FX1Ke7udhCQeYxU16u30CsoCyywDl

08/06/2021

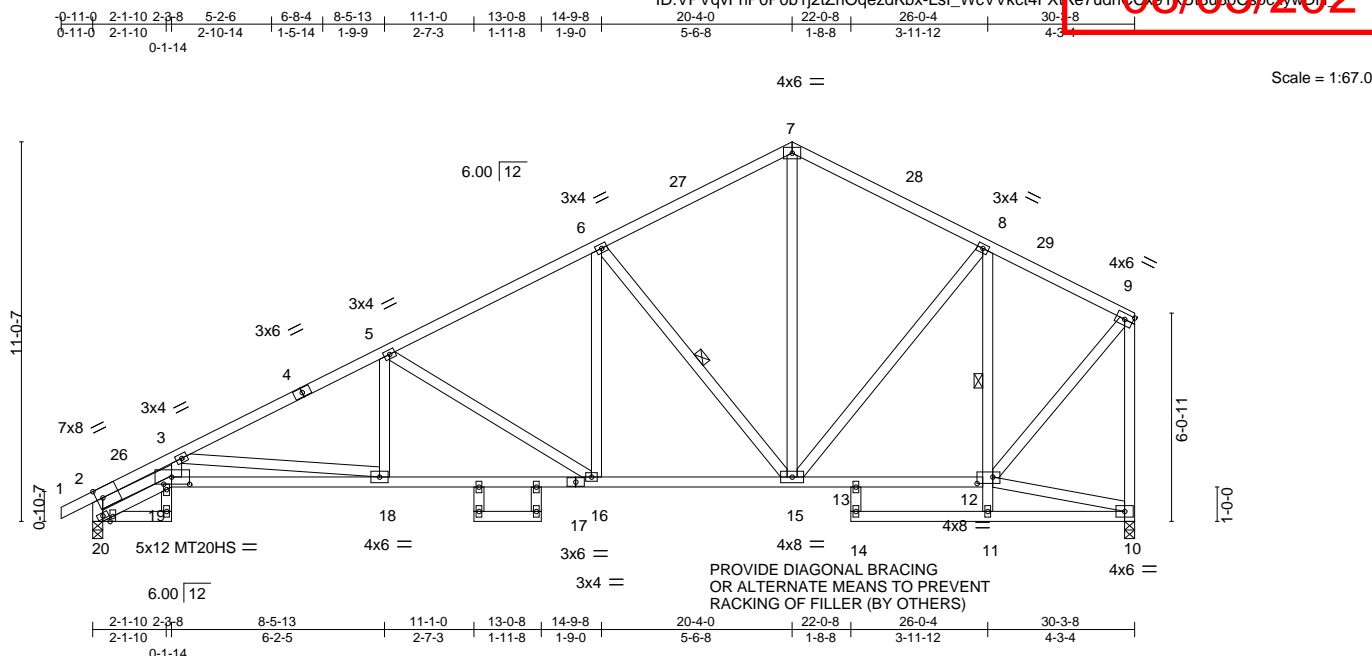


Plate Offsets (X,Y)--	[2:0-2-3,Edge], [12:0-5-8,0-2-4], [19:0-6-4,0-2-8], [19:0-1-14,0-1-0]					
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl
TCLL 25.0	Plate Grip DOL	1.15	TC 0.66	Vert(LL)	-0.19 18-19	>999 240
TCDL 10.0	Lumber DOL	1.15	BC 0.99	Vert(CT)	-0.37 18-19	>967 180
BCLL 0.0	Rep Stress Incr	YES	WB 0.94	Horz(CT)	0.22 10	n/a n/a
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS			
						Weight: 174 lb FT = 20%

LUMBER-	BRACING-
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied. Except:
WEBS 2x4 SPF No.2	8-0-0 oc bracing: 16-18
	1 Row at midpt 8-11, 6-15
REACTIONS.	
(size) 20=0-3-8, 10=0-3-8	
Max Horz 20=307(LC 11)	
Max Uplift 20=267(LC 12), 10=197(LC 12)	
Max Grav 20=1426(LC 1), 10=1349(LC 1)	
FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.	
TOP CHORD 2-3=-4033/990, 3-5=-2542/500, 5-6=-1780/372, 6-7=-1139/313, 7-8=-1137/307,	
8-9=-848/223, 9-10=-1287/263	
BOT CHORD 18-19=-1010/3448, 16-18=-545/2226, 15-16=-365/1501, 13-15=-199/715, 12-13=-189/632,	
19-20=-430/110	
WEBS 8-12=-759/214, 7-15=-143/552, 8-15=-60/392, 6-15=-896/313, 6-16=-102/556,	
9-12=-220/1081, 5-16=-851/292, 5-18=-17/387, 2-20=-1277/329, 3-18=-1232/499,	
3-19=-213/621, 2-19=-908/3826	

NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 20-4-0, Exterior(2R) 20-4-0 to 23-4-0, Interior(1) 23-4-0 to 30-1-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- All plates are MT20 plates unless otherwise indicated.
- All plates are 2x4 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 20, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 20=267, 10=197.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20,2021

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	C4	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,

8.430 s Jun 2 2021
MiTek Industries, Inc.
Tue Jun 22 09:05:57 2021
Page 1
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-p2sMjyW7Vw?xshRjBrPsECk6zLjYvMthFsbVfOWwDM2

08/05/2021

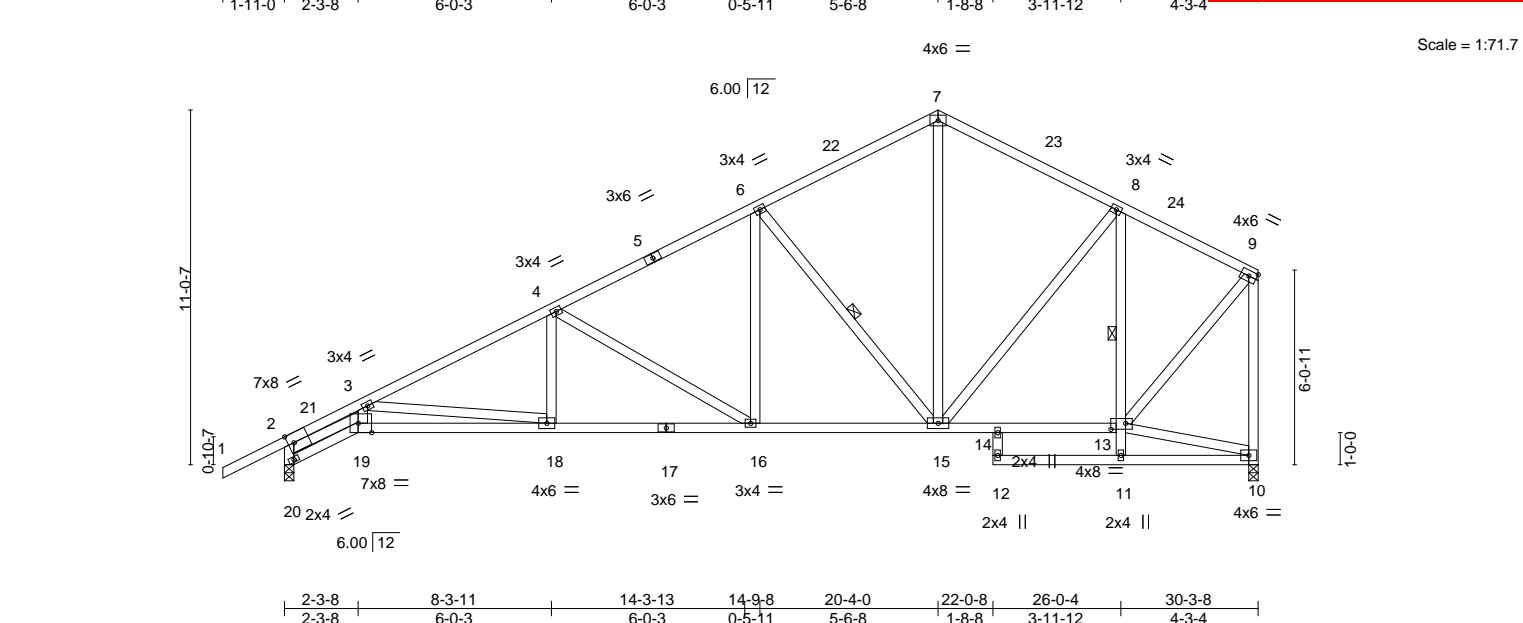



Plate Offsets (X,Y)-- [2:0-2-3,Edge], [13:0-5-8,0-2-4], [19:0-5-0,Edge]												
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d			<b>PLATES</b>		<b>GRIP</b>	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.65	Vert(LL)	-0.18	18-19	>999	240	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.94	Vert(CT)	-0.35	18-19	>999	180		
BCLL	0.0	Rep Stress Incr	YES	WB	0.90	Horz(CT)	0.21	10	n/a	n/a		
BCDL	10.0	Code	IRC2018/TPI2014		Matrix-AS						Weight: 168 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x4 SPF No.2	TOP CHORD Structural wood sheathing directly applied, except end verticals.
BOT CHORD 2x4 SPF No.2	BOT CHORD Rigid ceiling directly applied.
WEBS 2x4 SPF No.2	WEBS 1 Row at midpt 6-15, 8-11

<b>REACTIONS.</b>	(size) 20=0-3-8, 10=0-3-8
	Max Horz 20=316(LC 11)
	Max Uplift 20=291(LC 12), 10=196(LC 12)
	Max Grav 20=1499(LC 1), 10=1345(LC 1)

<b>FORCES.</b> (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD 2-3=-3880/939, 3-4=-2539/498, 4-6=-1776/368, 6-7=-1135/310, 7-8=-1132/306, 8-9=-845/221, 9-10=-1284/263
BOT CHORD 19-20=-445/99, 18-19=-976/3297, 16-18=-547/2228, 15-16=-364/1495, 14-15=-199/713, 13-14=-188/630
WEBS 3-19=-212/588, 3-18=-1078/444, 4-18=-11/382, 4-16=-849/291, 6-15=-893/312, 7-15=-144/550, 8-13=-757/213, 2-20=-1348/362, 8-15=-59/389, 2-19=-839/3678, 6-16=-95/542, 9-13=-219/1078


- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -1-11-0 to 1-1-0, Interior(1) 1-1-0 to 20-4-0, Exterior(2R) 20-4-0 to 23-4-0, Interior(1) 23-4-0 to 30-1-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 20, 10 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 20=291, 10=196.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

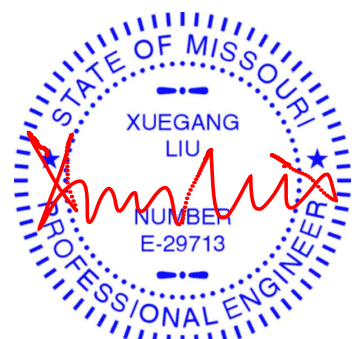

July 20,2021

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	C5	Common Supported Gable	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jun 22 09:05:54 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrOqezdKbx-IR\_68eXN1XF6?wJGSKtrp=016041a1A4TBGwDmly
30-3-8
9-11-8
08/05/2021

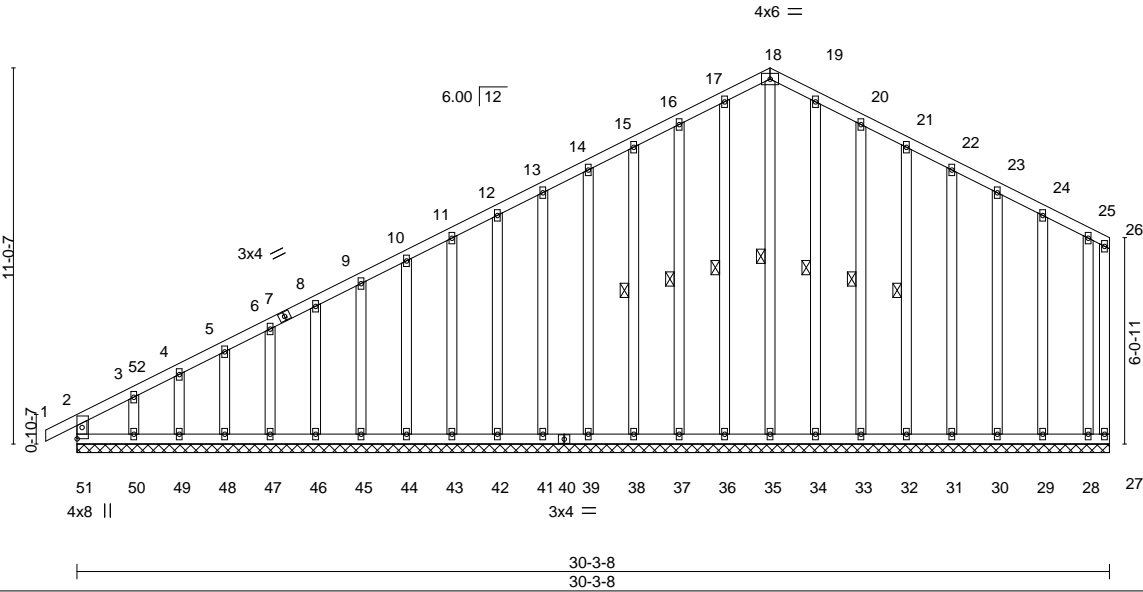


LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	-0.00	1	n/r	120	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	-0.00	1	n/r	120		
BCLL 0.0	Rep Stress Incr	YES	WB 0.11	Horz(CT)	-0.00	27	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R						Weight: 243 lb	FT = 20%

<b>LUMBER-</b>		<b>BRACING-</b>	
TOP CHORD 2x4 SPF No.2		TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD 2x4 SPF No.2		BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 2x4 SPF No.2		WEBS	1 Row at midpt 18-35, 17-36, 16-37, 15-38, 19-34, 20-33, 21-32
OTHERS 2x4 SPF No.2			

**REACTIONS.** All bearings 30-3-8.  
 (lb) - Max Horz 51=313(LC 9)  
 Max Uplift All uplift 100 lb or less at joint(s) 51, 27, 35, 36, 37, 38, 39, 41, 42, 43, 44, 45, 46, 47, 48, 49, 34, 33, 32, 31, 30, 29, 28 except 50=-204(LC 12)  
 Max Grav All reactions 250 lb or less at joint(s) 27, 35, 36, 37, 38, 39, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 34, 33, 32, 31, 30, 29, 28 except 51=273(LC 20)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
 TOP CHORD 2-3=-303/181, 15-16=-159/277, 16-17=-173/316, 17-18=-175/333, 18-19=-175/333, 19-20=-173/316, 20-21=-159/277

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TC DL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-11-0 to 2-1-0, Exterior(2N) 2-1-0 to 20-4-0, Corner(3R) 20-4-0 to 23-4-0, Exterior(2N) 23-4-0 to 30-1-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - All plates are 2x4 MT20 unless otherwise indicated.
  - Gable requires continuous bottom chord bearing.
  - Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
  - Gable studs spaced at 1-4-0 oc.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 51, 27, 35, 36, 37, 38, 39, 41, 42, 43, 44, 45, 46, 47, 48, 49, 34, 33, 32, 31, 30, 29, 28 except (jt=lb) 50=204.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

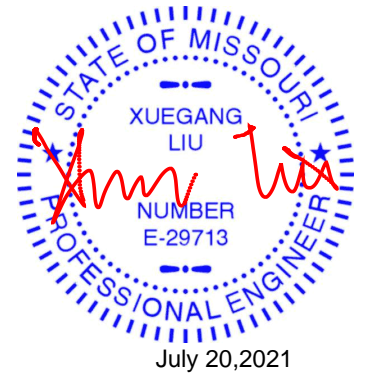


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	CJ1	Jack-Open	2	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:05:56 2021 Page 1  
ID:VPVqvFnP0P0b1j2tZr1OqezdKbx-hp6tZJZdZ9VNLIIIQgUoOGvWZIE7toATZsG9wDmV

08/05/2021

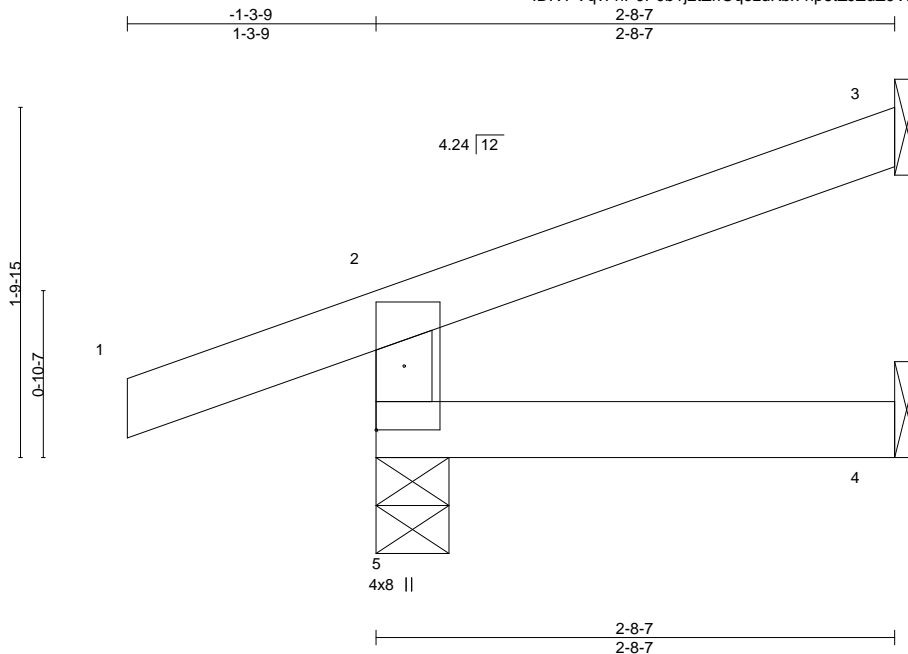

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.14	Vert(LL)	-0.00	4-5	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	4-5	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR					Weight: 8 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-8-7 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.** (size) 5=0-4-9, 3=Mechanical, 4=Mechanical  
Max Horz 5=53(LC 8)  
Max Uplift 5=-86(LC 8), 3=-36(LC 12)  
Max Grav 5=242(LC 1), 3=63(LC 1), 4=45(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Builders FirstSource (Valley Center), Valley Center, KS - 67147, 8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jun 22 09:05:57 2021 Page 1  
 ID:VPVqvFnP0P0b1j2ZrIQeqzdKbx-A0gFmfiaGJSeEzSKU\_O71xTR4d0vzhZG0073obywWDMU  
 -0-11-0 2-0-0 6-0-0 10-0-0 12-0-0 12-11-0  
 0-11-0 2-0-0 4-0-0 4-0-0 2-0-0 0-11-0

08/05/2021

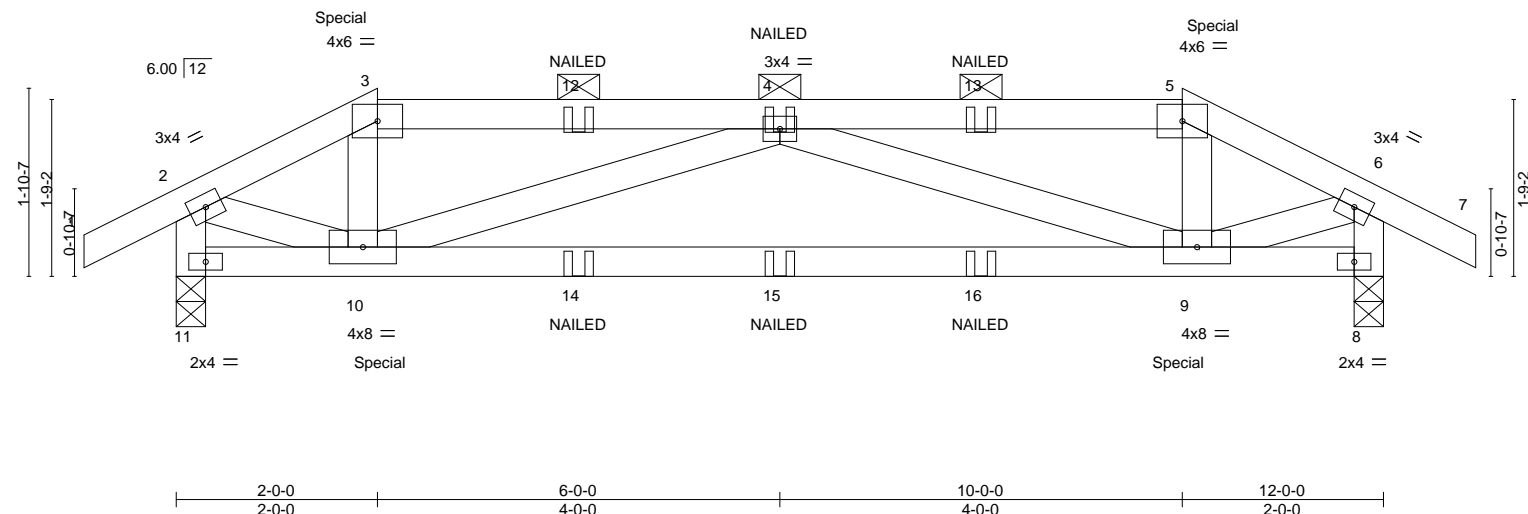

<b>LOADING</b> (psf)	<b>SPACING-</b> 2-0-0	<b>CSI.</b>	<b>DEFL.</b> in (loc) l/defl L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL 25.0	Plate Grip DOL 1.15	TC 0.21	Vert(LL) -0.09 9-10 >999 240	MT20	197/144
TCDL 10.0	Lumber DOL 1.15	BC 0.54	Vert(CT) -0.19 9-10 >729 180		
BCLL 0.0	Rep Stress Incr NO	WB 0.18	Horz(CT) 0.01 8 n/a n/a		
BCDL 10.0	Code IRC2018/TPI2014	Matrix-MS		Weight: 47 lb	FT = 20%

TOP CHORD	2x4 SPF No.2
BOT CHORD	2x4 SPF No.2
WEBS	2x4 SPF No.2

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 3-5.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

(size) 11=0-3-8, 8=0-3-8  
 Max Horz 11=24(LC 8)  
 Max Uplift 11=-159(LC 8), 8=-159(LC 9)  
 Max Grav 11=597(LC 1), 8=597(LC 1)

TOP CHORD 2-3=-672/158, 3-4=-575/153, 4-5=-575/153, 5-6=-672/158  
BOT CHORD 9-10=-318/1031  
WEBS 4-10=-495/208, 4-9=-495/208, 6-8=-632/151, 2-11=-632/151, 2-10=-129/621,  
6-9=-129/621

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDF=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Provide adequate drainage to prevent water ponding.
- 4) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 5) Bearing at joint(s) 11, 8 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 11=159, 8=159.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- 9) "NAILED" indicates 3-10d (0.148"x3") or 3-12d (0.148"x3.25") toe-nails per NDS guidelines.
- 10) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 35 lb down and 79 lb up at 2-0-0, and 35 lb down and 79 lb up at 10-0-0 on top chord, and 21 lb down and 9 lb up at 2-0-0, and 21 lb down and 9 lb up at 9-11-4 on bottom chord. The design/selection of such connection device(s) is the responsibility of others.
- 11) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-70, 3-5=-70, 5-7=-70, 8-11=-20



July 20, 2021

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

**WARNING – Velly design parameters are listed below and included with the key reference to AISC M14-15 16f, 17f, 18f, 19f, 20f, 21f, 22f, 23f, 24f, 25f, 26f, 27f, 28f, 29f, 30f, 31f, 32f, 33f, 34f, 35f, 36f, 37f, 38f, 39f, 40f, 41f, 42f, 43f, 44f, 45f, 46f, 47f, 48f, 49f, 50f, 51f, 52f, 53f, 54f, 55f, 56f, 57f, 58f, 59f, 60f, 61f, 62f, 63f, 64f, 65f, 66f, 67f, 68f, 69f, 70f, 71f, 72f, 73f, 74f, 75f, 76f, 77f, 78f, 79f, 80f, 81f, 82f, 83f, 84f, 85f, 86f, 87f, 88f, 89f, 90f, 91f, 92f, 93f, 94f, 95f, 96f, 97f, 98f, 99f, 100f, 101f, 102f, 103f, 104f, 105f, 106f, 107f, 108f, 109f, 110f, 111f, 112f, 113f, 114f, 115f, 116f, 117f, 118f, 119f, 120f, 121f, 122f, 123f, 124f, 125f, 126f, 127f, 128f, 129f, 130f, 131f, 132f, 133f, 134f, 135f, 136f, 137f, 138f, 139f, 140f, 141f, 142f, 143f, 144f, 145f, 146f, 147f, 148f, 149f, 150f, 151f, 152f, 153f, 154f, 155f, 156f, 157f, 158f, 159f, 160f, 161f, 162f, 163f, 164f, 165f, 166f, 167f, 168f, 169f, 170f, 171f, 172f, 173f, 174f, 175f, 176f, 177f, 178f, 179f, 180f, 181f, 182f, 183f, 184f, 185f, 186f, 187f, 188f, 189f, 190f, 191f, 192f, 193f, 194f, 195f, 196f, 197f, 198f, 199f, 200f, 201f, 202f, 203f, 204f, 205f, 206f, 207f, 208f, 209f, 210f, 211f, 212f, 213f, 214f, 215f, 216f, 217f, 218f, 219f, 220f, 221f, 222f, 223f, 224f, 225f, 226f, 227f, 228f, 229f, 230f, 231f, 232f, 233f, 234f, 235f, 236f, 237f, 238f, 239f, 240f, 241f, 242f, 243f, 244f, 245f, 246f, 247f, 248f, 249f, 250f, 251f, 252f, 253f, 254f, 255f, 256f, 257f, 258f, 259f, 260f, 261f, 262f, 263f, 264f, 265f, 266f, 267f, 268f, 269f, 270f, 271f, 272f, 273f, 274f, 275f, 276f, 277f, 278f, 279f, 280f, 281f, 282f, 283f, 284f, 285f, 286f, 287f, 288f, 289f, 290f, 291f, 292f, 293f, 294f, 295f, 296f, 297f, 298f, 299f, 300f, 301f, 302f, 303f, 304f, 305f, 306f, 307f, 308f, 309f, 310f, 311f, 312f, 313f, 314f, 315f, 316f, 317f, 318f, 319f, 320f, 321f, 322f, 323f, 324f, 325f, 326f, 327f, 328f, 329f, 330f, 331f, 332f, 333f, 334f, 335f, 336f, 337f, 338f, 339f, 340f, 341f, 342f, 343f, 344f, 345f, 346f, 347f, 348f, 349f, 350f, 351f, 352f, 353f, 354f, 355f, 356f, 357f, 358f, 359f, 360f, 361f, 362f, 363f, 364f, 365f, 366f, 367f, 368f, 369f, 370f, 371f, 372f, 373f, 374f, 375f, 376f, 377f, 378f, 379f, 380f, 381f, 382f, 383f, 384f, 385f, 386f, 387f, 388f, 389f, 390f, 391f, 392f, 393f, 394f, 395f, 396f, 397f, 398f, 399f, 400f, 401f, 402f, 403f, 404f, 405f, 406f, 407f, 408f, 409f, 410f, 411f, 412f, 413f, 414f, 415f, 416f, 417f, 418f, 419f, 420f, 421f, 422f, 423f, 424f, 425f, 426f, 427f, 428f, 429f, 430f, 431f, 432f, 433f, 434f, 435f, 436f, 437f, 438f, 439f, 440f, 441f, 442f, 443f, 444f, 445f, 446f, 447f, 448f, 449f, 450f, 451f, 452f, 453f, 454f, 455f, 456f, 457f, 458f, 459f, 460f, 461f, 462f, 463f, 464f, 465f, 466f, 467f, 468f, 469f, 470f, 471f, 472f, 473f, 474f, 475f, 476f, 477f, 478f, 479f, 480f, 481f, 482f, 483f, 484f, 485f, 486f, 487f, 488f, 489f, 490f, 491f, 492f, 493f, 494f, 495f, 496f, 497f, 498f, 499f, 500f, 501f, 502f, 503f, 504f, 505f, 506f, 507f, 508f, 509f, 510f, 511f, 512f, 513f, 514f, 515f, 516f, 517f, 518f, 519f, 520f, 521f, 522f, 523f, 524f, 525f, 526f, 527f, 528f, 529f, 530f, 531f, 532f, 533f, 534f, 535f, 536f, 537f, 538f, 539f, 540f, 541f, 542f, 543f, 544f, 545f, 546f, 547f, 548f, 549f, 550f, 551f, 552f, 553f, 554f, 555f, 556f, 557f, 558f, 559f, 560f, 561f, 562f, 563f, 564f, 565f, 566f, 567f, 568f, 569f, 570f, 571f, 572f, 573f, 574f, 575f, 576f, 577f, 578f, 579f, 580f, 581f, 582f, 583f, 584f, 585f, 586f, 587f, 588f, 589f, 590f, 591f, 592f, 593f, 594f, 595f, 596f, 597f, 598f, 599f, 600f, 601f, 602f, 603f, 604f, 605f, 606f, 607f, 608f, 609f, 610f, 611f, 612f, 613f, 614f, 615f, 616f, 617f, 618f, 619f, 620f, 621f, 622f, 623f, 624f, 625f, 626f, 627f, 628f, 629f, 630f, 631f, 632f, 633f, 634f, 635f, 636f, 637f, 638f, 639f, 640f, 641f, 642f, 643f, 644f, 645f, 646f, 647f, 648f, 649f, 650f, 651f, 652f, 653f, 654f, 655f, 656f, 657f, 658f, 659f, 660f, 661f, 662f, 663f, 664f, 665f, 666f, 667f, 668f, 669f, 670f, 671f, 672f, 673f, 674f, 675f, 676f, 677f, 678f, 679f, 680f, 681f, 682f, 683f, 684f, 685f, 686f, 687f, 688f, 689f, 690f, 691f, 692f, 693f, 694f, 695f, 696f, 697f, 698f, 699f, 700f, 701f, 702f, 703f, 704f, 705f, 706f, 707f,**



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	D1	Hip Girder	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI


Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.430 s Jun 2 2021 MiTek Industries, Inc.
Tue Jul 28 09:05:57 2021 Page 2
ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-A0gFmfaGJSeEzSKU\_O?1xTF40j6whzGCO7j0byw0Nu

08/05/2021

**LOAD CASE(S)** Standard  
 Concentrated Loads (lb)  
 Vert: 10=3(B) 9=3(B) 14=1(B) 15=1(B) 16=1(B)

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	D2	Hip	1	1		AS NOTED FOR PLAN REVIEW
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)	DEVELOPMENT SERVICES
						LEE'S SUMMIT, MISSOURI

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:05:56 2021 Page 1  
ID:VPVqvFnP0P0b1j2tZrOqezdKbx-eCdD\_?bu4mm5acvgY5VGTh\_FvMvW0S/n/qn2/k2/wDmt  
-0-11-0 4-0-0 8-0-0 12-0-0 0-11-0  
0-11-0 4-0-0 4-0-0 4-0-0 0-11-0  
Scale = 1:22.9

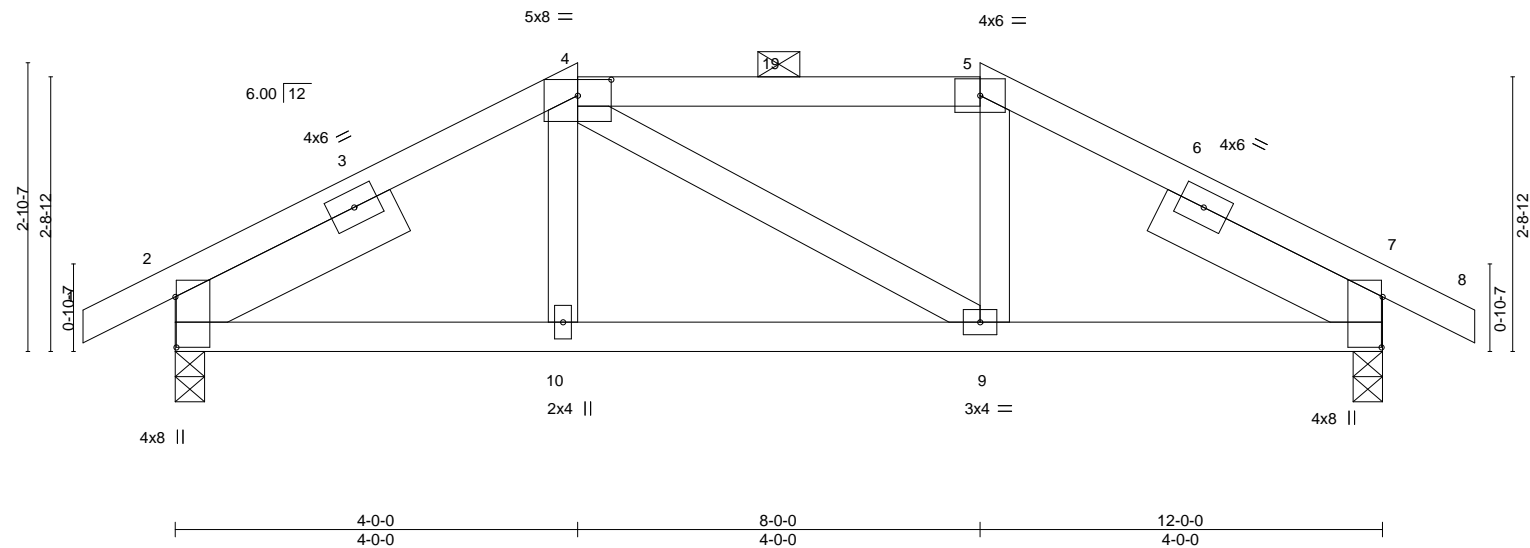

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.24	in (loc) l/defl L/d	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.23	Vert(LL) -0.02 9-10 >999 240		
BCLL 0.0	Lumber DOL 1.15	WB 0.03	Vert(CT) -0.04 9-10 >999 180		
BCDL 10.0	Rep Stress Incr YES	Matrix-AS	Horz(CT) 0.01 7 n/a n/a		
	Code IRC2018/TPI2014			Weight: 50 lb	FT = 20%

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x6 SPF No.2 2-6-0, Right 2x6 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied, except  
2-0-0 oc purlins (6-0-0 max.): 4-5.  
BOT CHORD Rigid ceiling directly applied.

**REACTIONS.** (size) 2=0-3-8, 7=0-3-8  
Max Horz 2=42(LC 12)  
Max Uplift 2=113(LC 12), 7=113(LC 13)  
Max Grav 2=604(LC 1), 7=604(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-682/266, 4-5=-586/276, 5-7=-682/266  
BOT CHORD 2-10=-151/590, 9-10=-153/586, 7-9=-154/590

- NOTES-**
- Unbalanced roof live loads have been considered for this design.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 4-0-0, Exterior(2E) 4-0-0 to 8-0-0, Exterior(2R) 8-0-0 to 12-0-0, Interior(1) 12-0-0 to 12-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=113, 7=113.
  - This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	D3	Common	3	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jun 22 09:05:59 2021 Page 1


ID:VPVqvFnP0P0b1j2tZrIQezdKbx-6On?BLbWr4uyCmJt6p1VduXOpnngvi-sRtUjwDMS

08/05/2021

-0-11-0 6-0-0 12-0-0 12-11-0  
0-11-0 6-0-0 6-0-0 0-11-0

4x6 =

Scale = 1:25.5

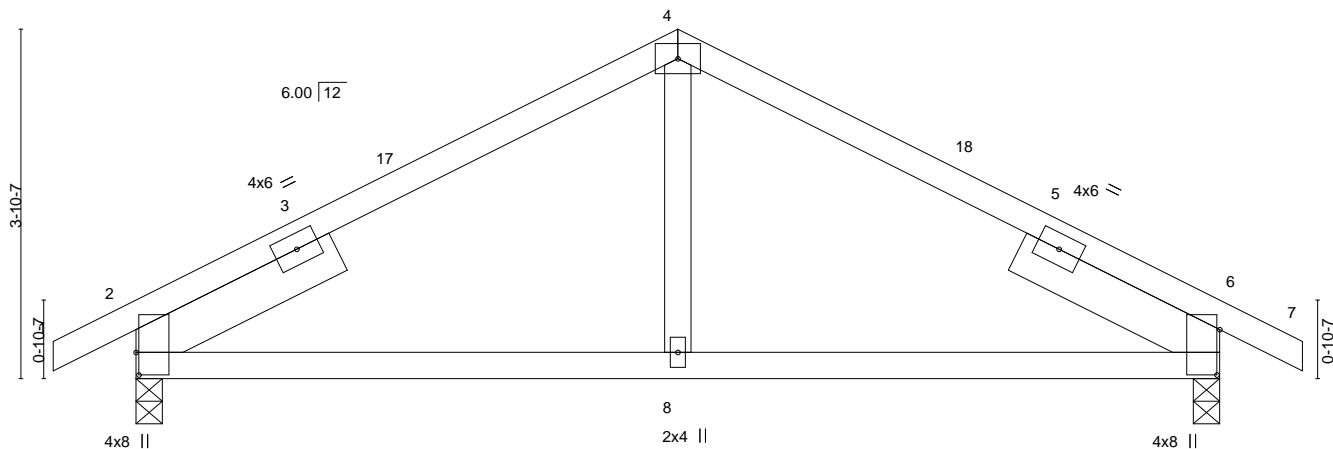

6-0-0 12-0-0  
6-0-0 6-0-0

Plate Offsets (X,Y)--		[2:0-3-0,0-0-6], [6:0-6-0,0-0-6]							
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES
TCLL 25.0	Plate Grip DOL	1.15	TC 0.29	Vert(LL)	-0.04	8-11	>999	240	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.26	Vert(CT)	-0.06	8-11	>999	180	GRIP
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.02	2	n/a	n/a	197/144
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
				Weight: 44 lb				FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x6 SPF No.2 2-6-0, Right 2x6 SPF No.2 2-6-0

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 2=0-3-8, 6=0-3-8  
Max Horz 2=61(LC 12)  
Max Uplift 2=-108(LC 12), 6=-108(LC 13)  
Max Grav 2=604(LC 1), 6=604(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-581/271, 4-6=-581/271  
BOT CHORD 2-8=-113/507, 6-8=-113/507

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 6-0-0, Exterior(2R) 6-0-0 to 9-0-0, Interior(1) 9-0-0 to 12-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=108, 6=108.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	E3	Monopitch Supported Gable	1	1	Job Reference (optional)	147079238

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jun 22 09:06:00 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-abLNPhc8cN0pqw33WYkY6bbf-0bLm4t55gPwWDMr

08/05/2021

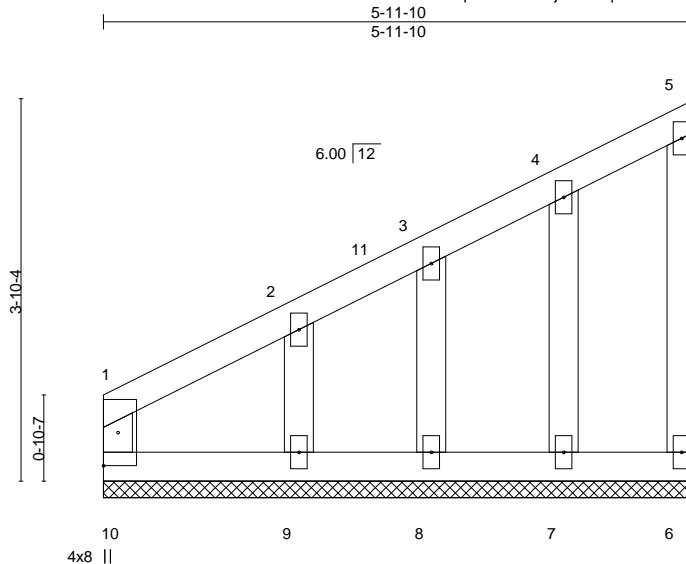

Scale = 1:23.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.15	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.15	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	6	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-R						Weight: 25 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 5-11-10 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 5-11-10.

- (lb) - Max Horz 10=142(LC 9)  
Max Uplift All uplift 100 lb or less at joint(s) 10, 6, 7, 8 except 9=104(LC 12)  
Max Grav All reactions 250 lb or less at joint(s) 10, 6, 7, 8, 9

#### FORCES.

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-2=-328/170  
WEBS 2-9=-144/260

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) 0-1-12 to 3-3-10, Exterior(2N) 3-3-10 to 5-9-14 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 3) All plates are 2x4 MT20 unless otherwise indicated.
- 4) Gable requires continuous bottom chord bearing.
- 5) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 6) Gable studs spaced at 1-4-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 10, 6, 7, 8 except (jt=lb) 9=104.
- 9) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

08/05/2021

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW
2877185	F1	Common Supported Gable	1	1	Job Reference (optional)	DEVELOPMENT SERVICES
						LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center),	Valley Center, KS - 67147,
---------------------------------------	----------------------------

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:03 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrI0gezdBxb-\_A1W1je1vIOOhNneLf6RAkh3aNGM1hiEvn3mS0FywDMo

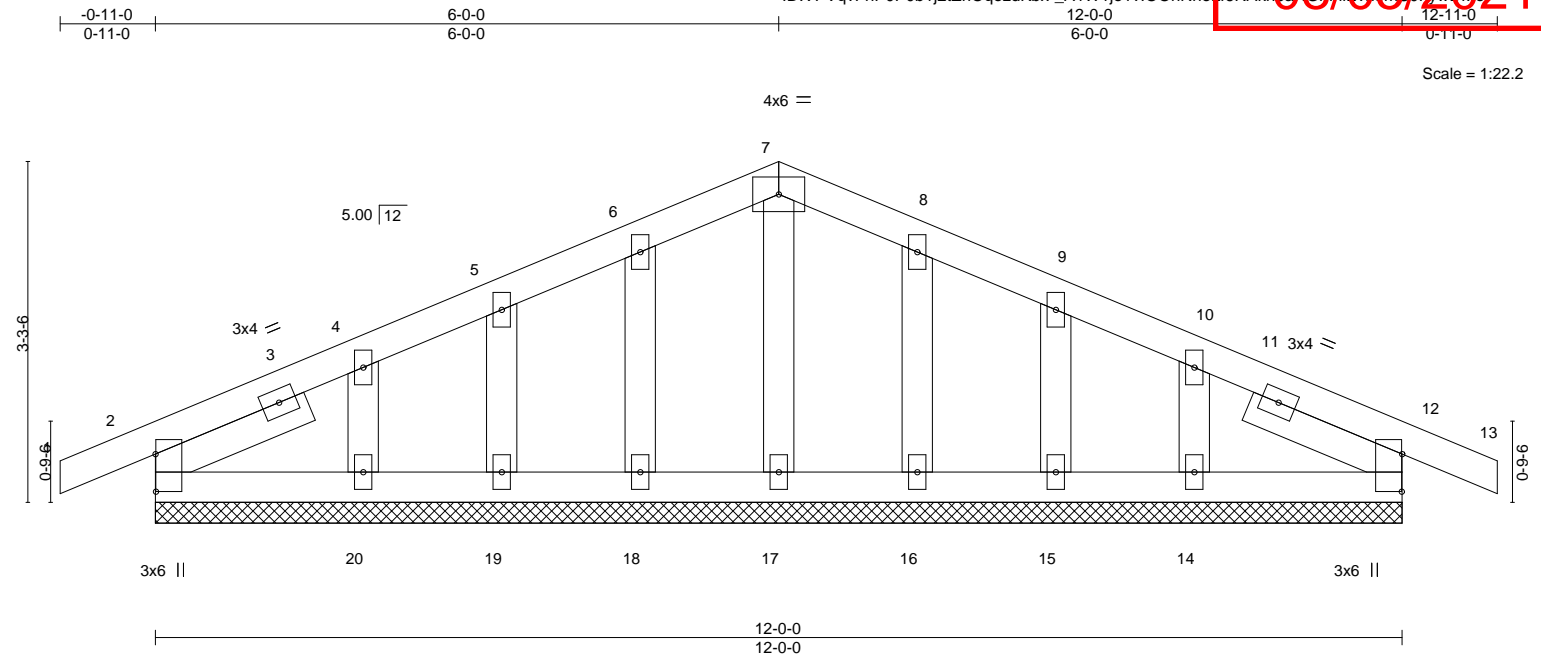


Plate Offsets (X,Y)-- [2:0-4-5,0-0-1], [12:0-4-5,0-0-1]												
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc) l/defl L/d			<b>PLATES</b>	<b>GRIP</b>		
TCLL	25.0	Plate Grip DOL	1.15	TC	0.05	Vert(LL)	-0.00	12	n/r	120	MT20	197/144
TCDL	10.0	Lumber DOL	1.15	BC	0.02	Vert(CT)	-0.00	12	n/r	120		
BCLL	0.0	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	12	n/a	n/a		
BCDL	10.0	Code IRC2018/TPI2014		Matrix-S							Weight: 49 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 1-7-6, Right 2x4 SPF No.2 1-7-6

**BRACING-**

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

**ONS.** All bearings 12-0-0.  
(lb) - Max Horz 2=51(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 2, 12, 18, 19, 20, 16, 15, 14  
Max Grav All reactions 250 lb or less at joint(s) 2, 12, 17, 18, 19, 20, 16, 15, 14

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCdL=6.0psf; BCdL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-11-0 to 2-0-0, Exterior(2N) 2-0-0 to 6-0-0, Exterior(3R) 6-0-0 to 9-0-0, Exterior(2N) 9-0-0 to 12-11-0 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) All plates are 2x4 MT20 unless otherwise indicated.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 1-4-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 2, 12, 18, 19, 20, 16, 15, 14.
- 9) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2, 12.
- 10) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

 **WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

WARNING - verify design parameters and READ NOTES ON THIS AND INCLUDED MITER REFERENCE PAGE MH-743.3 REV. 3/19/2020 BEFORE USE. Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSIT/TP1 Quality Criteria. DSB-89 and BCSI Building Co

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #13	5/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	F2	Roof Special	3	1	Job Reference (optional)		

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:05 2021 Page 1

ID:VPVqvFnP0P0b1j2tZr1QezdKbx-xY9GSOGHRwe5whx1338vF9RUEt7patCEtNF748yWLMm

3-2-0 5-10-8 8-7-0 1-10-8  
3-2-0 2-8-8 2-8-8 3-3-8

5x8 =

Scale = 1:21.9

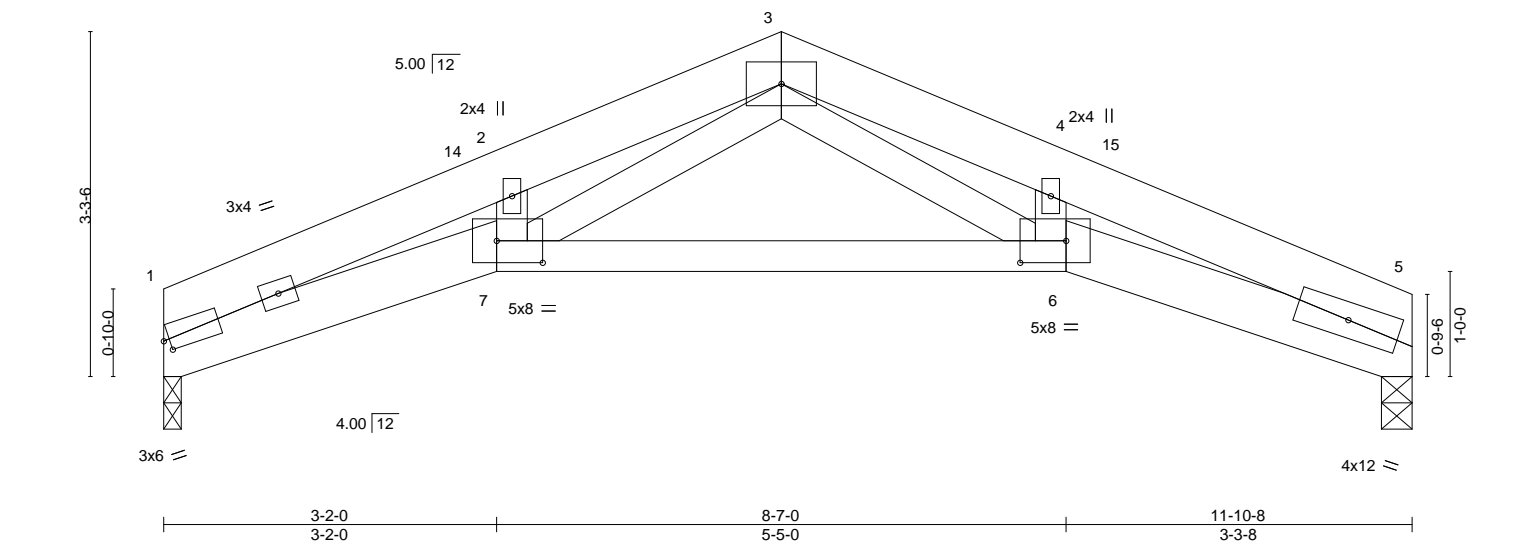


Plate Offsets (X,Y)--		[1:0-0-11,0-1-4], [6:0-5-4,0-2-8], [7:0-5-4,0-2-8]									
LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.20	Vert(LL)	-0.05	6-7	>999	240	MT20	197/144	
TCDL 10.0	Lumber DOL	1.15	BC 0.32	Vert(CT)	-0.12	6-7	>999	180			
BCLL 0.0	Rep Stress Incr	YES	WB 0.15	Horz(CT)	0.05	5	n/a	n/a			
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS								
									Weight: 50 lb	FT = 20%	

#### LUMBER-

TOP CHORD 2x6 SPF No.2  
BOT CHORD 2x6 SPF No.2 \*Except\*  
6-7: 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.

#### REACTIONS.

(size) 1=0-2-0, 5=0-3-8  
Max Horz 1=45(LC 13)  
Max Uplift 1=89(LC 12), 5=90(LC 13)  
Max Grav 1=534(LC 1), 5=534(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-1565/552, 2-3=-1426/589, 3-4=-1470/600, 4-5=-1604/560  
BOT CHORD 1-7=-471/1421, 6-7=-275/883, 5-6=-470/1463  
WEBS 3-7=-228/566, 3-6=-245/608

#### NOTES-

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 5-10-8, Exterior(2R) 5-10-8 to 8-10-8, Interior(1) 8-10-8 to 11-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Bearing at joint(s) 1, 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 5) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 1.
- 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5.
- 7) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 8) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	F3	Roof Special	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:07 2021 Page 1

ID:VPVqvFnP0b1j2tZrOqezdKbx-txG1t4iXzXupA\_5PaUANLaseZadUrhUjy90wwDMK 08/05/2021

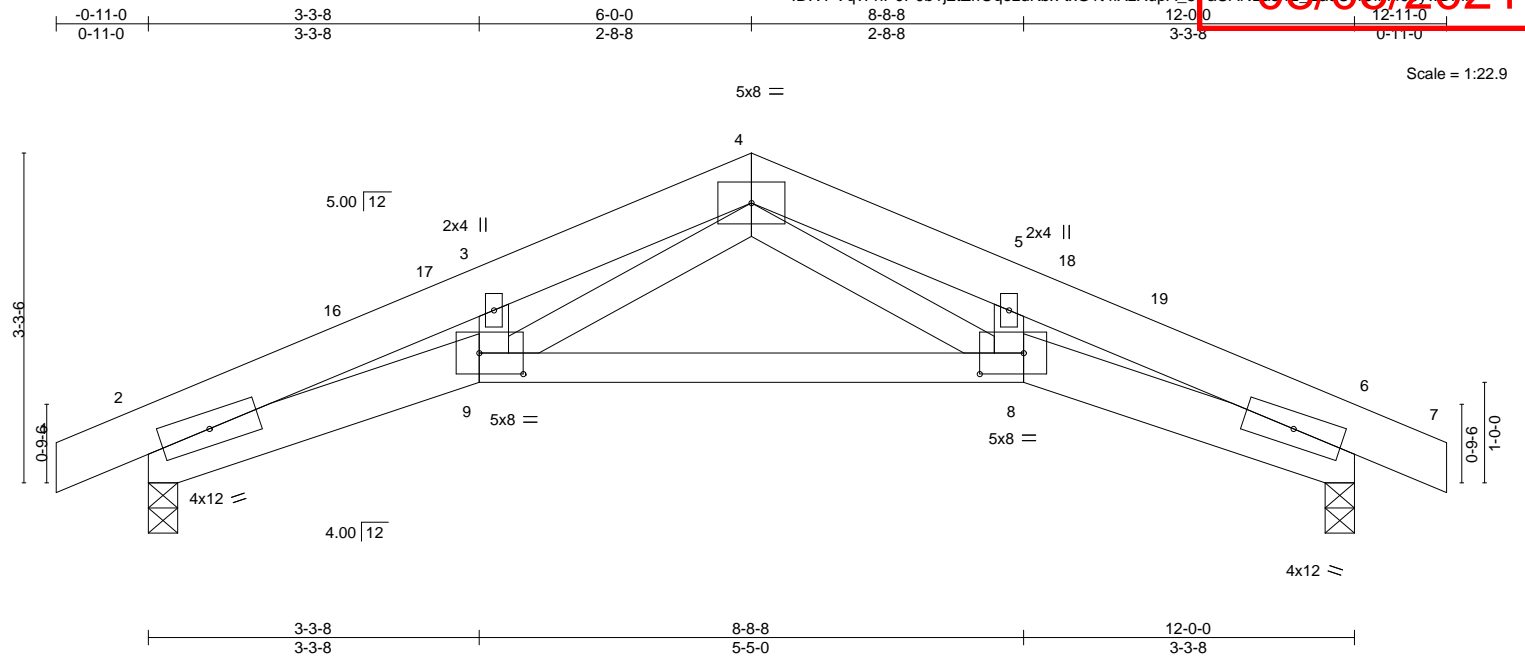


Plate Offsets (X,Y)--		[8:0-5-4,0-2-8], [9:0-5-4,0-2-8]		8-8-8		5-5-0		12-0-0		3-3-8	
<b>LOADING</b> (psf)		<b>SPACING-</b> 2-0-0		<b>CSI.</b>		<b>DEFL.</b> in (loc)		l/defl		L/d	
TCLL	25.0	Plate Grip DOL 1.15		TC	0.20	Vert(LL)	-0.05	8-9	>999	240	
TCDL	10.0	Lumber DOL 1.15		BC	0.32	Vert(CT)	-0.12	8-9	>999	180	
BCLL	0.0	Rep Stress Incr YES		WB	0.14	Horz(CT)	0.05	6	n/a	n/a	
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS							
										Weight: 54 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x6 SPF No.2  
 BOT CHORD 2x6 SPF No.2 \*Except\*  
 8-9: 2x4 SPF No.2  
 WEBS 2x4 SPF No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied.  
 BOT CHORD Rigid ceiling directly applied.

**REACTIONS.**

(size) 2=0-3-8, 6=0-3-8  
 Max Horz 2=51(LC 12)  
 Max Uplift 2=111(LC 12), 6=111(LC 13)  
 Max Grav 2=604(LC 1), 6=604(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-3=-1589/525, 3-4=-1453/568, 4-5=-1453/567, 5-6=-1589/523  
 BOT CHORD 2-9=-423/1447, 8-9=-229/886, 6-8=-420/1447  
 WEBS 4-8=-229/586, 4-9=-230/586

**NOTES-**

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 6-0-0, Exterior(2R) 6-0-0 to 9-0-0, Interior(1) 9-0-0 to 12-11-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Bearing at joint(s) 2, 6 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=111, 6=111.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	GR1	Roof Special Girder	1	2	Job Reference (optional)	

Builders FirstSource (Valley Center),
Valley Center, KS - 67147,
8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:08 2021 Page 1
ID:VPVqvFnP0P0b1j2tZrIQezdKbx-L7qP4Qi9kr0gn8ub7CictPv0nJlM9wLTDhSvYD4i
08/05/2021

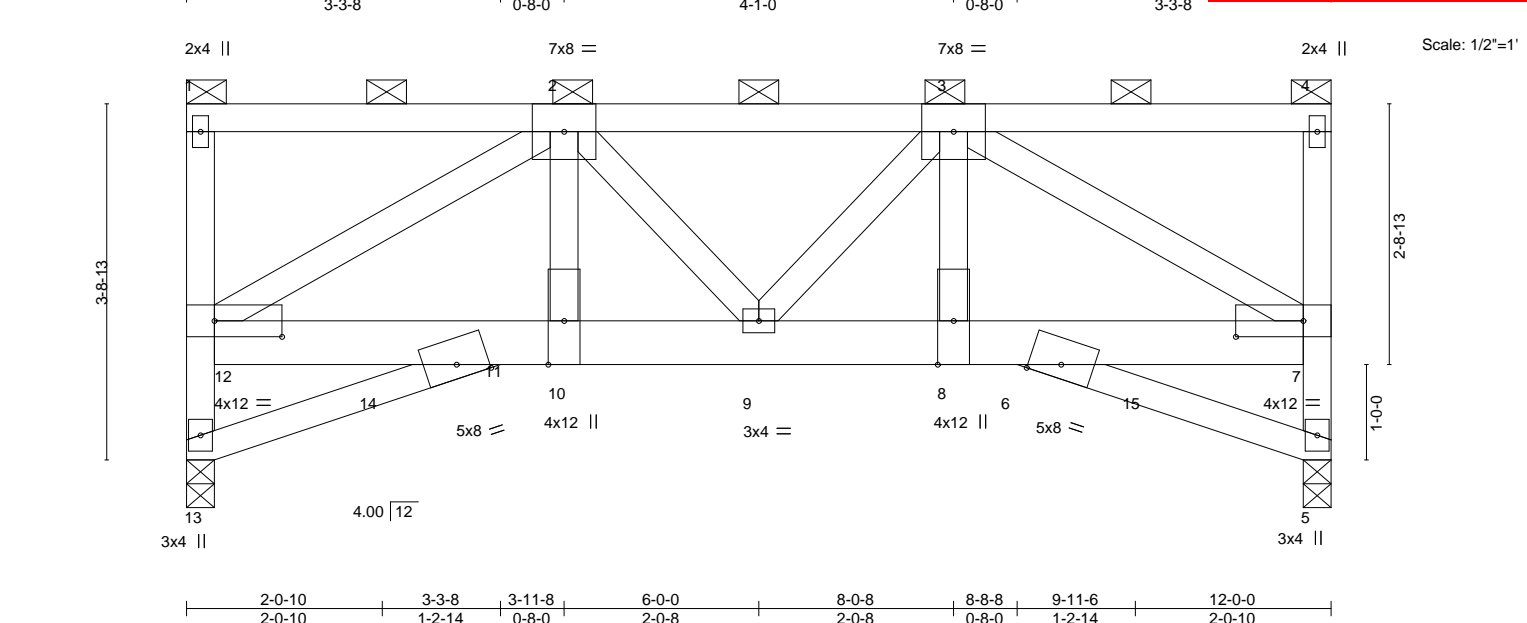


Plate Offsets (X,Y)-- [7:0-8-8,0-2-0], [12:0-8-8,0-2-0]											
<b>LOADING</b> (psf)	<b>SPACING-</b>	2-0-0	<b>CSI.</b>	<b>DEFL.</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>	
TCLL 25.0	Plate Grip DOL	1.15	TC 0.41	Vert(LL)	-0.01	10	>999	240	MT20	197/144	
TCDL 10.0	Lumber DOL	1.15	BC 0.55	Vert(CT)	-0.10	9	>999	180			
BCLL 0.0	Rep Stress Incr	NO	WB 0.62	Horz(CT)	0.07	5	n/a	n/a			
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS								
										Weight: 143 lb	FT = 20%

<b>LUMBER-</b>	<b>BRACING-</b>	
TOP CHORD 2x4 SPF No.2	TOP CHORD 2-0-0 oc purlins (4-10-5 max.): 1-4, except end verticals.	
BOT CHORD 2x4 SP 2400F 2.0E *Except*	BOT CHORD Rigid ceiling directly applied.	
7-12: 2x6 SPF 2100F 1.8E		
WEBS 2x4 SPF No.2		
<b>REACTIONS.</b>		
(size) 13=0-3-8, 5=0-3-8		
Max Horz 13=-133(LC 8)		
Max Grav 13=4320(LC 1), 5=4309(LC 1)		

<b>FORCES.</b>	(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.
TOP CHORD	12-13=-4304/0, 2-3=-6020/0, 5-7=-4292/0
BOT CHORD	11-13=0/546, 11-12=0/5143, 10-11=0/5486, 9-10=0/5486, 8-9=0/5497, 6-8=0/5497, 6-7=0/5157, 5-6=0/361
WEBS	2-10=0/2519, 2-9=0/856, 3-9=0/831, 3-8=0/2522, 2-12=-6240/0, 3-7=-6254/0

- NOTES-**
- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-7-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc, 2x6 - 2 rows staggered at 0-4-0 oc.  
Webs connected as follows: 2x4 - 1 row at 0-9-0 oc.
  - All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
  - Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3) zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - Provide adequate drainage to prevent water ponding.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - Bearing at joint(s) 13, 5 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
  - This truss is in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - Load case(s) 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
  - This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.
  - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
  - Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) . The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard
Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**  
Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

16023 Swingley Ridge Rd  
Chesterfield, MO 63017



Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO
2877185	GR1	Roof Special Girder	1	2	Job Reference (optional)

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:09 2021 Page 2

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-pKOnImjnV88XPIFohvDrQ?x=OUPW5HPr3?DmDymDmI

AS NOTED FOR PLAN REVIEW  
DEVELOPMENT SERVICES  
LEE'S SUMMIT, MISSOURI

08/05/2021

**LOAD CASE(S)** Standard

- 1) Dead + Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-70, 11-13=-20, 6-11=-20, 5-6=-20  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 2) Dead + 0.75 Roof Live (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-58, 11-13=-20, 6-11=-20, 5-6=-20  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 3) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-20, 11-13=-40, 6-11=-40, 5-6=-40  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 4) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=75, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=23, 4-5=38  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=75, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=-38, 4-5=-23  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 6) Dead + 0.6 C-C Wind (Neg. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=-33, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=-26, 4-5=-35  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 7) Dead + 0.6 C-C Wind (Neg. Internal) Case 2: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=-33, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=35, 4-5=26  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=29, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=17, 4-5=22  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=29, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=-22, 4-5=-17  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 10) Dead + 0.6 MWFRS Wind (Neg. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=9, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=28, 4-5=10  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 11) Dead + 0.6 MWFRS Wind (Neg. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=9, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=-10, 4-5=-28  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=29, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=14, 4-5=20  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 13) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=29, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=-20, 4-5=-14  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)

Continued on page 3

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI Quality Criteria, DSB-89 and BCSI Building Component****Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601
 16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	GR1	Roof Special Girder	1	2	Job Reference (optional)	147079242

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:09 2021 Page 2

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-pKOnImjnV88XPIFohvDrQ?x=OUPW5HPr3DmDywwDMi

08/05/2021

**LOAD CASE(S)** Standard

- 14) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=16, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=7, 4-5=15  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 15) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=16, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=-15, 4-5=7  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 16) Dead + 0.6 MWFRS Wind (Neg. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=9, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=26, 4-5=8  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 17) Dead + 0.6 MWFRS Wind (Neg. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=9, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=-8, 4-5=-26  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 18) Dead: Lumber Increase=0.90, Plate Increase=0.90 Plt. metal=0.90  
Uniform Loads (plf)  
Vert: 1-4=-20, 11-13=-20, 6-11=-20, 5-6=-20  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 19) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Left): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=-36, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=21, 4-5=7  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 20) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) Right): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=-36, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=-7, 4-5=-21  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 21) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 1st Parallel): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=-36, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=19, 4-5=6  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 22) Dead + 0.75 Roof Live (bal.) + 0.75(0.6 MWFRS Wind (Neg. Int) 2nd Parallel): Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=-36, 11-13=-20, 6-11=-20, 5-6=-20  
Horz: 1-13=-6, 4-5=-19  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 23) Dead + 0.6 C-C Wind Min. Down: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=-28, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=-16, 4-5=-16  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)
- 24) Dead + 0.6 C-C Wind Min. Upward: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=4, 11-13=-8, 6-11=-8, 5-6=-8  
Horz: 1-13=16, 4-5=16  
Concentrated Loads (lb)  
Vert: 10=-1515(F) 9=-1515(F) 8=-1515(F) 14=-1515(F) 15=-1515(F)

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component****Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 2060116023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	J1	Jack-Open	5	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:09 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-pKOnImjnV88XPIFchvDrQ?e9uJk5C0r32LmDxwDmJ

08/05/2021

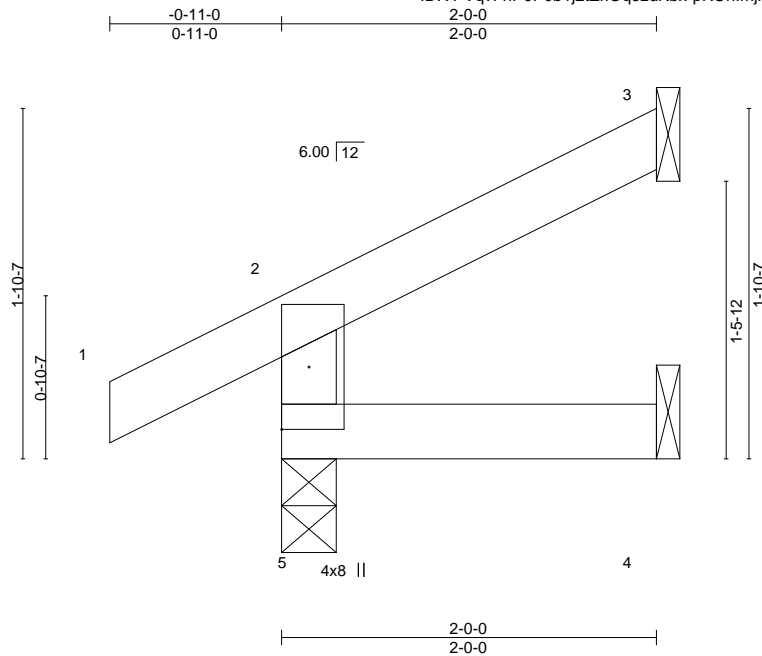

Scale = 1:12.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.08	Vert(LL)	-0.00	5	>999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	-0.00	4-5	>999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	-0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-MR					Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 5=0-3-8, 3=Mechanical, 4=Mechanical  
Max Horz 5=47(LC 12)  
Max Uplift 5=26(LC 12), 3=35(LC 12), 4=2(LC 12)  
Max Grav 5=179(LC 1), 3=46(LC 1), 4=33(LC 3)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 3, 4.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	LG1	GABLE	1	1	Job Reference (optional)	147079244

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:10 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-HWYy9V6kQSGO1Sc\_Fdk4y0LUCzgm:OfyJnLw0Mh

08/05/2021



4x6 =

Scale = 1:29.5

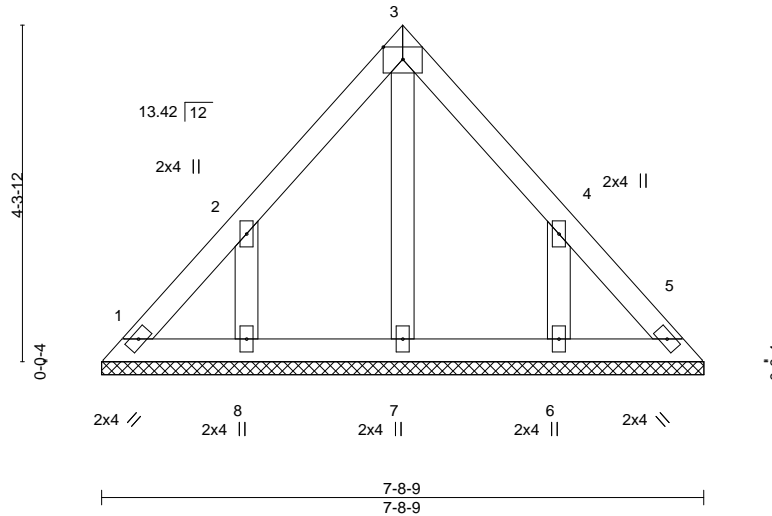


Plate Offsets (X,Y)--		[3:Edge,0-1-14]						PLATES	GRIP
<b>LOADING</b> (psf)		<b>SPACING-</b>	2-0-0	<b>CSI.</b>		<b>DEFL.</b>	in (loc)	l/defl	L/d
TCLL 25.0		Plate Grip DOL	1.15	TC 0.06		Vert(LL)	n/a	-	n/a 999
TCDL 10.0		Lumber DOL	1.15	BC 0.02		Vert(CT)	n/a	-	n/a 999
BCLL 0.0		Rep Stress Incr	YES	WB 0.03		Horz(CT)	0.00	5	n/a n/a
BCDL 10.0		Code IRC2018/TPI2014		Matrix-P					
								Weight: 29 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

All bearings 7-8-9.

(lb) - Max Horz 1=106(LC 8)

Max Uplift All uplift 100 lb or less at joint(s) 1, 5 except 8=159(LC 12), 6=159(LC 13)

Max Grav All reactions 250 lb or less at joint(s) 1, 5, 7, 8, 6

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-3-15 to 3-3-15, Interior(1) 3-3-15 to 3-10-4, Exterior(2R) 3-10-4 to 6-10-4, Interior(1) 6-10-4 to 7-4-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 5 except (jt=lb) 8=159, 6=159.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component**

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	M1	Monopitch Supported Gable	1	1	Job Reference (optional)	147079245

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:11 2021 Page 1

ID:VPVqvFnP0P0b1j2tZr1QezdKbx-liWXiSI20mOFecOApKFJvQ1-D5-RZkw40JlupwDmg

08/05/2021

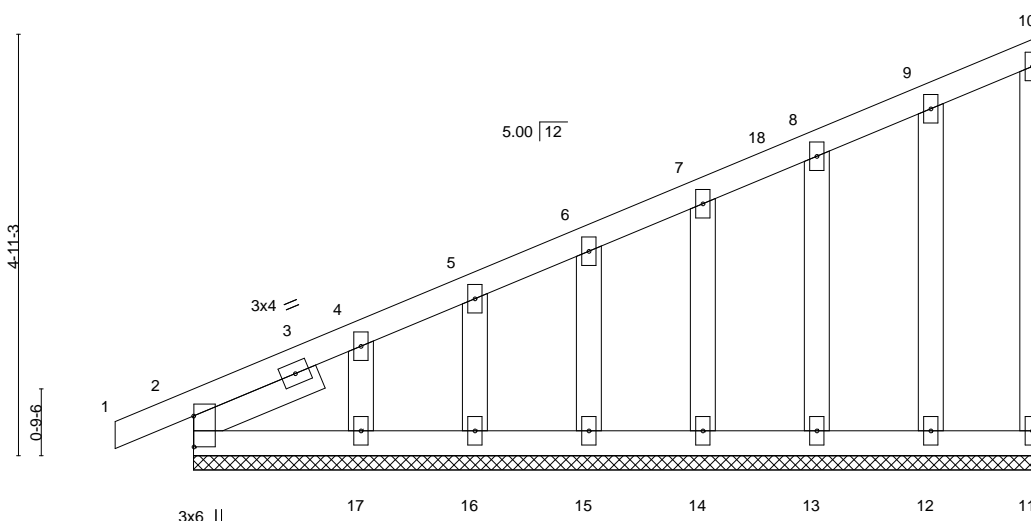

Scale = 1:27.0

Plate Offsets (X,Y)-- [2:0-4-5,0-0-1]

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.14	Vert(LL)	-0.00	1	n/r	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.07	Vert(CT)	-0.00	1	n/r		
BCLL 0.0	Rep Stress Incr	YES	WB 0.04	Horz(CT)	0.00	11	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 48 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 OTHERS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 1-7-6

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS.**

All bearings 9-11-8.  
 (lb) - Max Horz 2=197(LC 9)  
 Max Uplift All uplift 100 lb or less at joint(s) 11, 12, 13, 14, 15, 16, 17  
 Max Grav All reactions 250 lb or less at joint(s) 11, 2, 12, 13, 14, 15, 16, 17

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-395/196, 4-5=-285/156, 5-6=-251/147

**NOTES-**

- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Corner(3E) -0-11-0 to 1-11-8, Exterior(2N) 1-11-8 to 9-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 1-4-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 11, 12, 13, 14, 15, 16, 17.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 2.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	M2	Common	4	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:13 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-i5dl77mlYNfzuvYZwIHnrdG0U1B2N4dEjMgywDlJg

0-11-0	7-9-12	15-4-0	22-10-4	30-8-0	0-11-0
0-11-0	7-9-12	7-6-4	7-6-4	7-9-12	0-11-0

Scale = 1:52.1

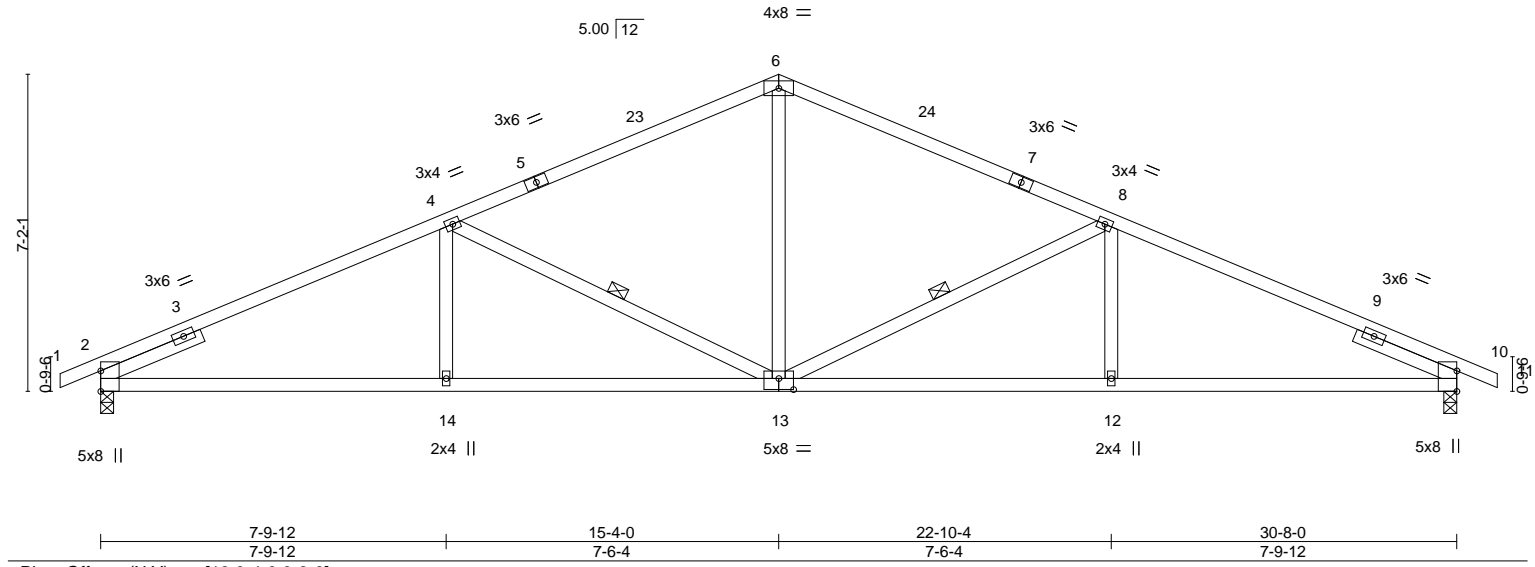


Plate Offsets (X,Y)--		[13:0-4-0,0-3-0]																			
LOADING (psf)		SPACING-		2-0-0		CSI.		DEFL.				in (loc)		l/defl		L/d		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	-0.18	12-13	>999	240	MT20	197/144									
TCDL	10.0	Lumber DOL	1.15	BC	0.87	Vert(CT)	-0.36	12-13	>999	180											
BCLL	0.0	Rep Stress Incr	YES	WB	0.25	Horz(CT)	0.12	10	n/a	n/a											
BCDL	10.0	Code IRC2018/TPI2014		Matrix-AS										Weight: 115 lb		FT = 20%					

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2  
 SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

**BRACING-**

TOP CHORD Structural wood sheathing directly applied.  
 BOT CHORD Rigid ceiling directly applied.  
 WEBS 1 Row at midpt 8-13, 4-13

**REACTIONS.**

(size) 2=0-3-8, 10=0-3-8  
 Max Horz 2=119(LC 17)  
 Max Uplift 2=253(LC 12), 10=253(LC 13)  
 Max Grav 2=1444(LC 1), 10=1444(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 2-4=-2471/415, 4-6=-1826/358, 6-8=-1826/358, 8-10=-2471/416  
 BOT CHORD 2-14=-405/2208, 13-14=-405/2208, 12-13=-286/2208, 10-12=-286/2208  
 WEBS 6-13=-80/789, 8-13=-756/275, 8-12=0/271, 4-13=-756/274, 4-14=0/271

**NOTES-**

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 15-4-0, Exterior(2R) 15-4-0 to 18-4-0, Interior(1) 18-4-0 to 31-7-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 2=253, 10=253.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 6) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601

16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Jun 2 2021

MiTek Industries, Inc.

Tue Jun 22 09:05:15 2021

Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-eTl2YpoY4\_vh7DiyzAKGfG845DfW/lacxx4RYwWDMp

AKGfG845DfW/lacxx4RYwWDMp

30-8-0

7-9-12

0-11-0

AS NOTED FOR PLAN REVIEW

DEVELOPMENT SERVICES

LEE'S SUMMIT, MISSOURI

08/05/2021

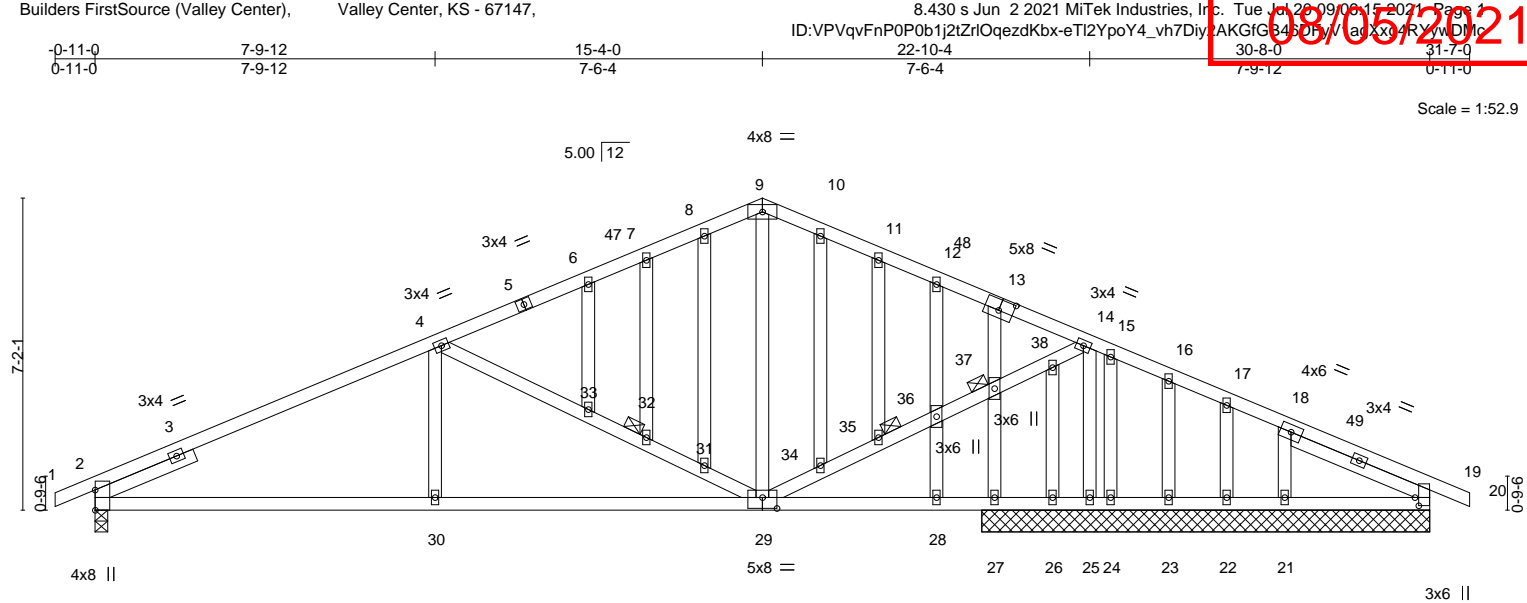


Plate Offsets (X,Y)--		[2:0-5-9,Edge], [13:0-4-0,0-3-0], [19:0-2-4,0-1-1], [29:0-4-0,0-3-0]	
LOADING (psf)		SPACING-	
TCLL 25.0		2-0-0	
TCDL 10.0		Plate Grip DOL 1.15	
BCLL 0.0		Lumber DOL 1.15	
BCDL 10.0		Rep Stress Incr YES	
		Code IRC2018/TPI2014	
		CSI.	
		TC 0.46	
		BC 0.48	
		WB 0.51	
		Matrix-AS	
		DEFL.	
		in (loc) l/defl L/d	
		Vert(LL) -0.07 29-30 >999 240	
		Vert(CT) -0.17 29-30 >999 180	
		Horz(CT) 0.03 27 n/a n/a	
		PLATES GRIP	
		MT20 197/144	
		Weight: 166 lb FT = 20%	

LUMBER-		BRACING-	
TOP CHORD 2x4 SPF No.2		TOP CHORD Structural wood sheathing directly applied.	
BOT CHORD 2x4 SPF No.2		BOT CHORD Rigid ceiling directly applied.	
WEBS 2x4 SPF No.2		JOINTS 1 Brace at Jt(s): 32, 35, 37	
OTHERS 2x4 SPF No.2			
SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 3-6-4			

**REACTIONS.** All bearings 10-3-8 except (jt=length) 2=0-3-8.  
(lb) - Max Horz 2=119(LC 12)  
Max Uplift All uplift 100 lb or less at joint(s) 25, 19, 24, 23, 22, 21 except 2=-212(LC 12), 27=-163(LC 13), 26=-184(LC 26)  
Max Grav All reactions 250 lb or less at joint(s) 19, 26, 23, 22, 19 except 2=1013(LC 1), 25=727(LC 1), 27=535(LC 26), 24=253(LC 1), 21=327(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 2-4=-1449/319, 4-6=-756/189, 6-7=-666/195, 7-8=-664/215, 8-9=-615/213, 9-10=-616/220, 10-11=-680/225, 11-12=-695/209, 12-13=-703/196, 13-14=-683/179, 15-16=0/286, 16-17=0/278, 17-18=0/260  
BOT CHORD 2-30=-317/1337, 29-30=-317/1337  
WEBS 29-34=-131/967, 34-35=-114/931, 35-36=-122/959, 36-37=-123/965, 37-38=-125/949, 14-38=-125/969, 14-25=-645/95, 4-33=-811/272, 32-33=-819/272, 31-32=-857/293, 29-31=-846/286, 4-30=0/306, 27-37=-300/108, 15-24=-262/37

- NOTES-**
- 1) Unbalanced roof live loads have been considered for this design.
  - 2) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 15-4-0, Exterior(2R) 15-4-0 to 18-4-0, Interior(1) 18-4-0 to 31-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 4) All plates are 2x4 MT20 unless otherwise indicated.
  - 5) Gable studs spaced at 1-4-0 oc.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 25, 19, 24, 23, 22, 21, 19 except (jt=lb) 2=212, 27=163, 26=184.
  - 8) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
  - 9) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20,2021



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	M6	Common	6	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:19 2021 Page 1

ID:VPVqvFnP0b1j2tZrIQeqzdKbx-WF?ZOB38DP6cq0jH0OCq6MjhXDFV/GSYLAK/wQM/

08/05/2021

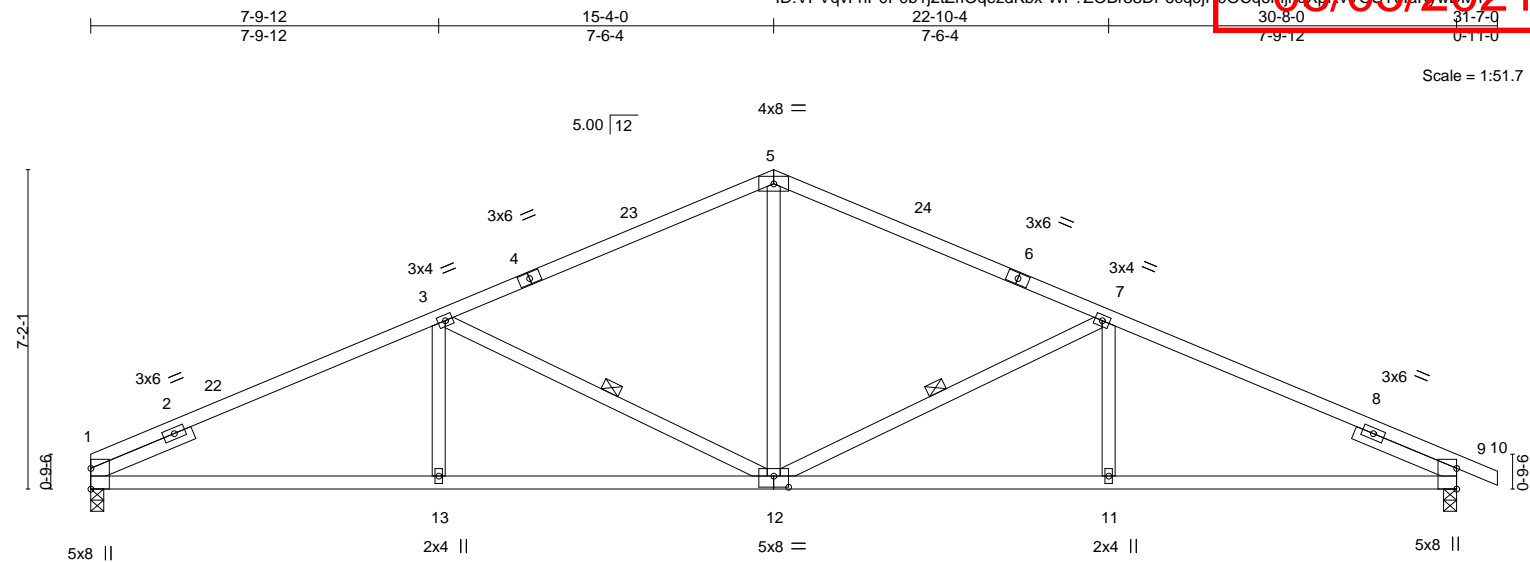


Plate Offsets (X,Y)-- [12:0-4,0-3-0]		LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
		TCLL 25.0		Plate Grip DOL 1.15		TC 0.68		Vert(LL) -0.18 11-12 >999 240		MT20		197/144	
		TCDL 10.0		Lumber DOL 1.15		BC 0.87		Vert(CT) -0.36 11-12 >999 180					
		BCLL 0.0		Rep Stress Incr YES		WB 0.26		Horz(CT) 0.12 9 n/a n/a					
		BCDL 10.0		Code IRC2018/TPI2014		Matrix-AS				Weight: 114 lb		FT = 20%	

**LUMBER-**  
TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
SLIDER Left 2x4 SPF No.2 2-6-0, Right 2x4 SPF No.2 2-6-0

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied.  
BOT CHORD Rigid ceiling directly applied.  
WEBS 1 Row at midpt 7-12, 3-12

**REACTIONS.** (size) 1=0-3-8, 9=0-3-8  
Max Horz 1=126(LC 13)  
Max Uplift 1=232(LC 12), 9=253(LC 13)  
Max Grav 1=1379(LC 1), 9=1445(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.  
TOP CHORD 1-3=-2479/417, 3-5=-1828/361, 5-7=-1828/358, 7-9=-2474/416  
BOT CHORD 1-13=-407/2216, 12-13=-407/2216, 11-12=-286/2210, 9-11=-286/2210  
WEBS 5-12=-83/791, 7-12=-756/275, 7-11=0/271, 3-12=-763/276, 3-13=0/271

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 15-4-0, Exterior(2R) 15-4-0 to 18-4-0, Interior(1) 18-4-0 to 31-7-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 1=232, 9=253.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	P1	Monopitch	4	1	Job Reference (optional)	14709250


Builders FirstSource (Valley Center),

Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:19 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-WF?ZOBr38DP6cq0jH0OCq6Mm5n0F5xEGSY6AKywb0MY

08/05/2021

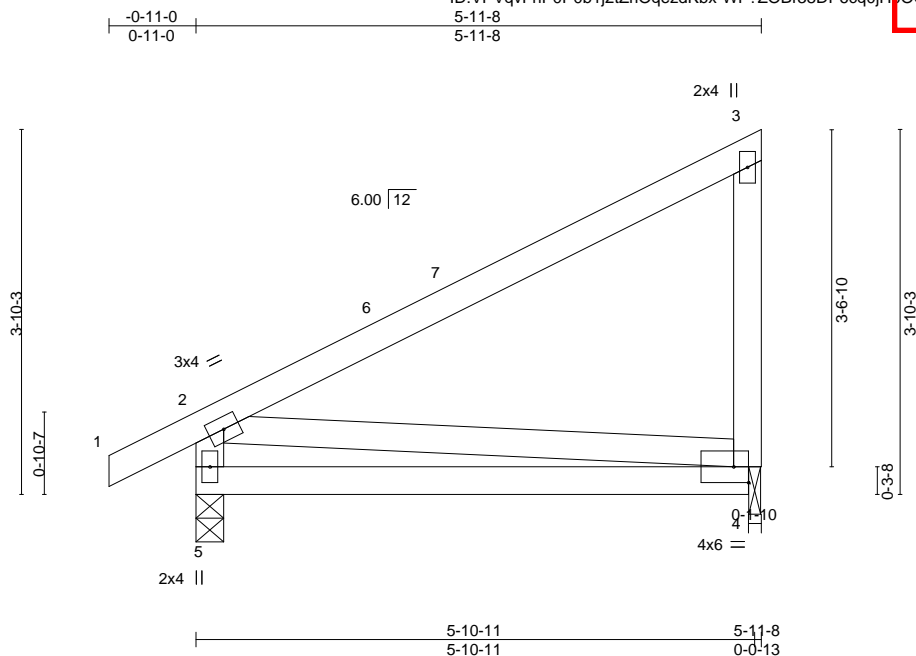

Scale = 1:24.3

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.51	Vert(LL)	-0.06	4-5	>999	240	MT20
TCDL 10.0	Lumber DOL	1.15	BC 0.34	Vert(CT)	-0.12	4-5	>550	180	197/144
BCLL 0.0	Rep Stress Incr	YES	WB 0.08	Horz(CT)	-0.00	4	n/a	n/a	
BCDL 10.0	Code IRC2018/TPI2014		Matrix-AS						
								Weight: 26 lb	FT = 20%

**LUMBER-**

TOP CHORD 2x4 SPF No.2  
 BOT CHORD 2x4 SPF No.2  
 WEBS 2x4 SPF No.2

**BRACING-**

TOP CHORD Structural wood sheathing directly applied, except end verticals.  
 BOT CHORD Rigid ceiling directly applied.

**REACTIONS.**


(size) 5=0-3-8, 4=0-1-8  
 Max Horz 5=146(LC 11)  
 Max Uplift 5=63(LC 12), 4=77(LC 12)  
 Max Grav 5=336(LC 1), 4=248(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

BOT CHORD 4-5=-294/193  
 WEBS 2-5=-280/206, 2-4=-142/250

**NOTES-**

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior(1) 2-1-0 to 5-9-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 3) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 4) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 5) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 5, 4.
- 6) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.
- 7) This truss design requires that a minimum of 7/16" structural wood sheathing be applied directly to the top chord and 1/2" gypsum sheetrock be applied directly to the bottom chord.

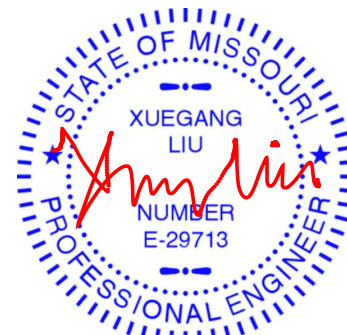

July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
 Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	V1	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jun 22 09:06:20 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-\_RZxbXshvXXzD\_avqvRMKuzDI7DA0SPtCNpmvwOMX

08/05/2021

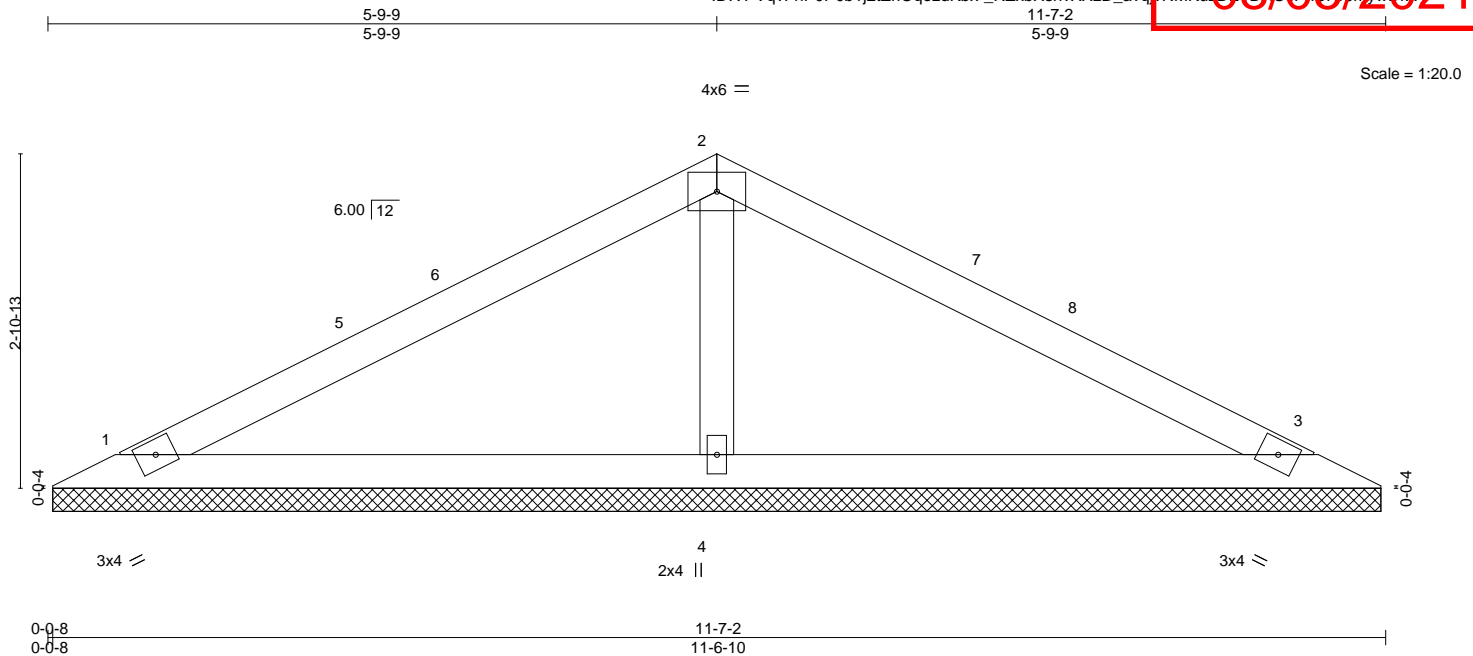

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.38	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.22	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.06	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-S					Weight: 29 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6'-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10'-0-0 oc bracing.

#### REACTIONS.

(size) 1=11-6-2, 3=11-6-2, 4=11-6-2  
Max Horz 1=46(LC 12)  
Max Uplift 1=-50(LC 12), 3=-59(LC 13), 4=-54(LC 12)  
Max Grav 1=215(LC 25), 3=215(LC 26), 4=506(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-4=-350/196

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 5-9-9, Exterior(2R) 5-9-9 to 8-9-9, Interior(1) 8-9-9 to 10-11-9 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	V2	Valley	1	1	Job Reference (optional)	

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:21 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-tCoSRuvCz1Picug3Z\_NXA3-6r016-J-6q13FYwDNT

08/05/2021

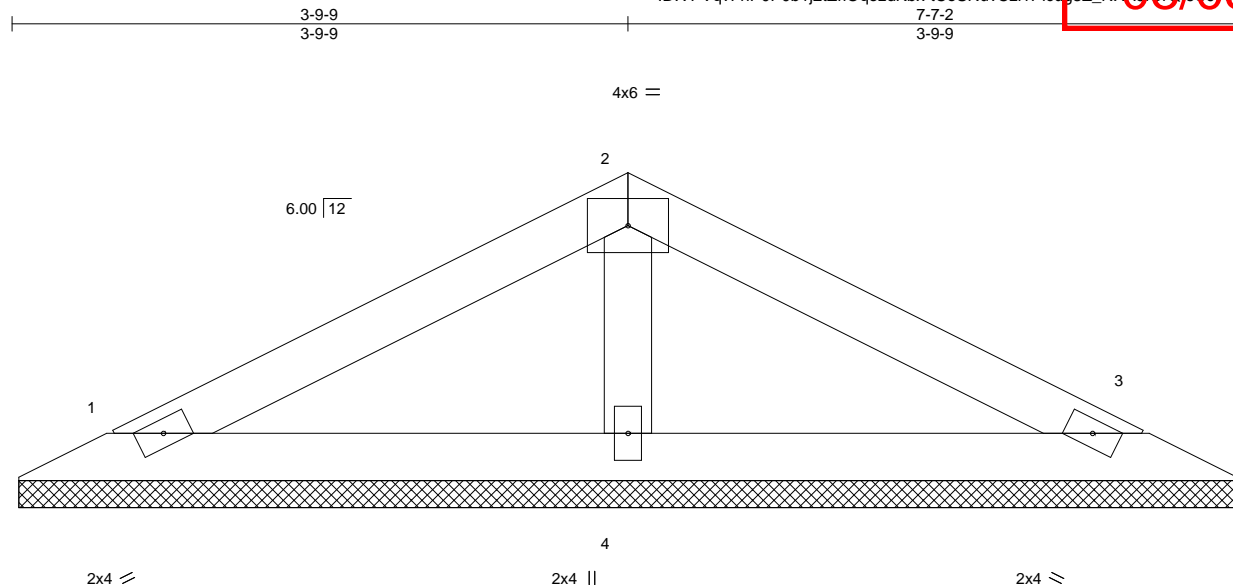

Scale = 1:14.2

LOADING (psf)		SPACING-		CSI.		DEFL.		PLATES		GRIP	
TCLL	25.0	Plate Grip DOL	1.15	TC	0.18	Vert(LL)	n/a	MT20		197/144	
TCDL	10.0	Lumber DOL	1.15	BC	0.09	Vert(CT)	n/a				
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horz(CT)	0.00				
BCDL	10.0	Code IRC2018/TPI2014		Matrix-P							
								Weight: 18 lb		FT = 20%	

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=7-6-2, 3=7-6-2, 4=7-6-2  
Max Horz 1=28(LC 16)  
Max Uplift 1=37(LC 12), 3=43(LC 13), 4=20(LC 12)  
Max Grav 1=145(LC 1), 3=145(LC 1), 4=280(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Gable requires continuous bottom chord bearing.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
- This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	V4	Valley	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jun 22 09:06:21 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOQezdKbx-tCoSRuvCz11Picu3Z\_NX431r016Cjrcq13FYwDMT

08/05/2021

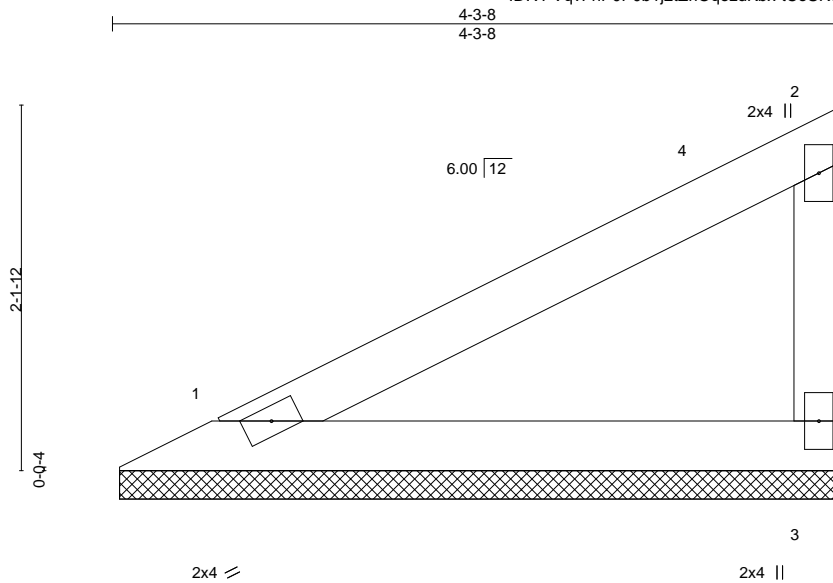

Scale = 1:13.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.23	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.12	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 11 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-3-8 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=4-3-0, 3=4-3-0  
Max Horz 1=73(LC 9)  
Max Uplift 1=27(LC 12), 3=45(LC 12)  
Max Grav 1=158(LC 1), 3=158(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 4-1-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	V5	Valley	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jun 22 09:06:25 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-LPMqfEvqj39GKfTtdGVcNwVfrOtz3rUjsozwwDMS

08/05/2021

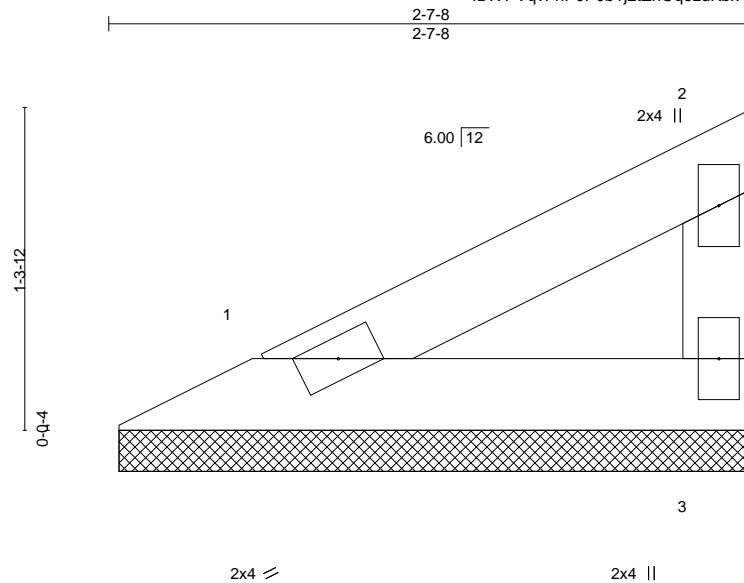

Scale = 1:9.4

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	n/a	-	n/a	999	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a	999		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P						Weight: 6 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-7-8 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.


#### REACTIONS.

(size) 1=2-7-0, 3=2-7-0  
Max Horz 1=39(LC 9)  
Max Uplift 1=-14(LC 12), 3=-24(LC 12)  
Max Grav 1=83(LC 1), 3=83(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

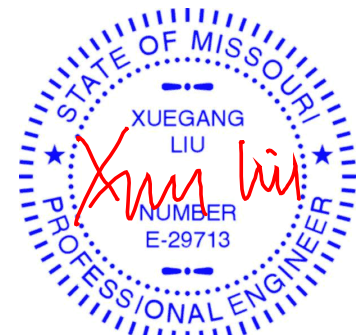

July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	V6	Valley	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:26 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-pbwCsawSUNH7xv23B\_0rcb84b7236DH38q1KQyW0MR

08/05/2021

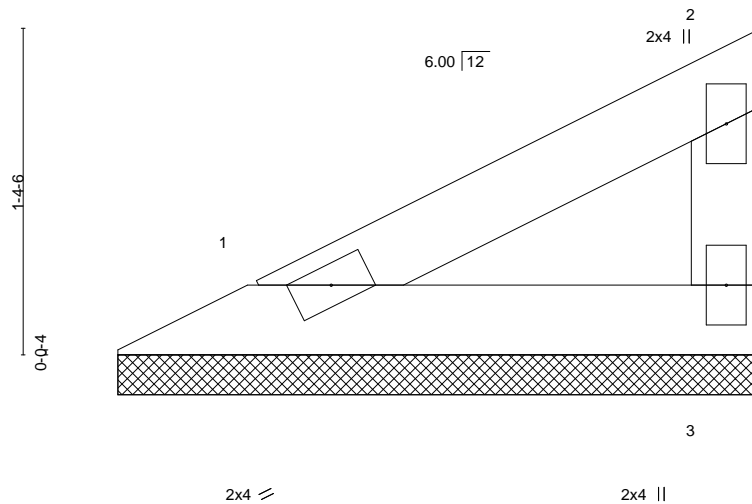

Scale = 1:9.6

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.06	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.03	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 7 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 2-8-12 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=2-8-4, 3=2-8-4  
Max Horz 1=41(LC 9)  
Max Uplift 1=15(LC 12), 3=25(LC 12)  
Max Grav 1=88(LC 1), 3=88(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	V7	Valley	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:27 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQezdKbx-HnUb3wx4FgP\_Z34FlhX49bht42R4LZTR0gssyw0MO

08/05/2021

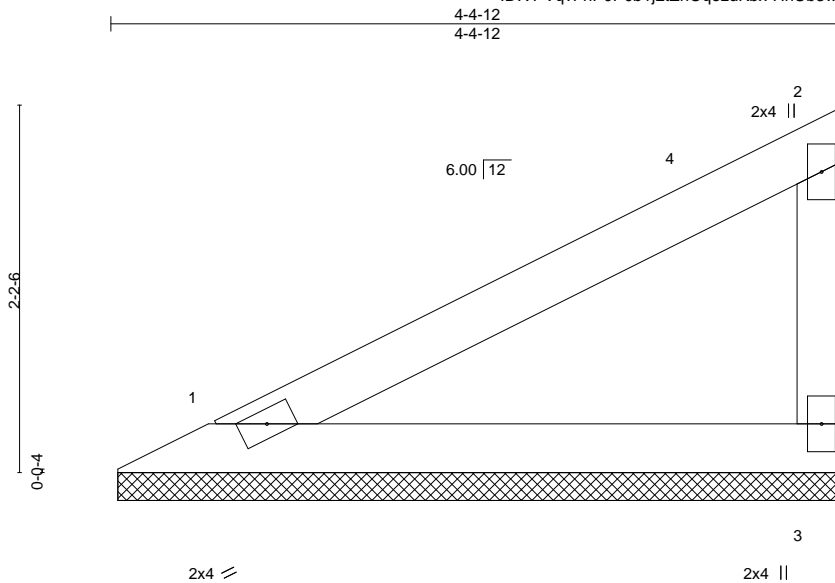

Scale = 1:13.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.24	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.13	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 12 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-4-12 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=4-4-4, 3=4-4-4  
Max Horz 1=76(LC 9)  
Max Uplift 1=27(LC 12), 3=46(LC 12)  
Max Grav 1=163(LC 1), 3=163(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 4-3-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601


ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component



16023 Swingley Ridge Rd  
Chesterfield, MO 63017

Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	V8	Valley	1	1		AS NOTED FOR PLAN REVIEW
Builders FirstSource (Valley Center), Valley Center, KS - 67147,					Job Reference (optional)	DEVELOPMENT SERVICES
					8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jun 22 09:06:28 2021 Page 1	LEE'S SUMMIT, MISSOURI

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-lz1zHGyi0\_XqBDCRIP3JhE-Sm12blaxS-GOKwDMP 08/05/2021

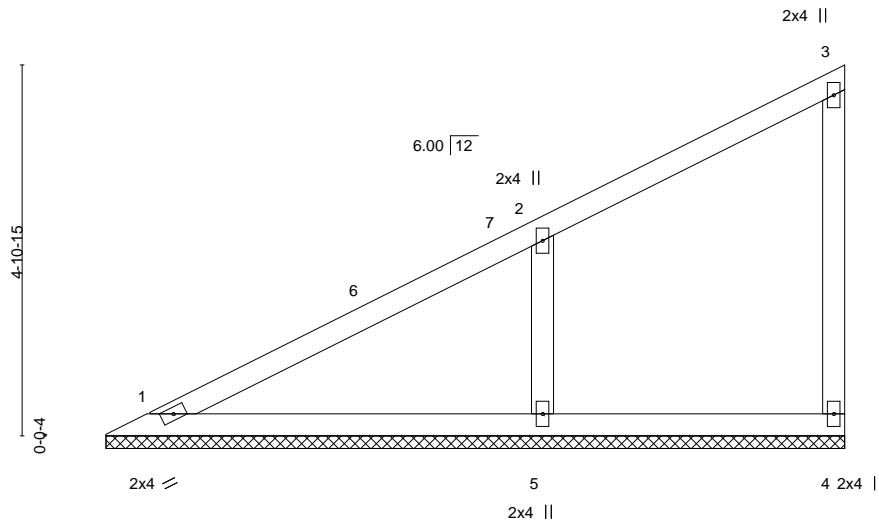

Scale = 1:30.5

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	2-0-0	TC 0.34	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Plate Grip DOL 1.15	BC 0.18	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Lumber DOL 1.15	WB 0.06	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Rep Stress Incr YES	Matrix-S					Weight: 30 lb	FT = 20%
	Code IRC2018/TPI2014							

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=9-9-6, 4=9-9-6, 5=9-9-6  
Max Horz 1=188(LC 9)  
Max Uplift 1=-2(LC 12), 4=-33(LC 9), 5=-141(LC 12)  
Max Grav 1=189(LC 1), 4=113(LC 1), 5=512(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-268/178  
WEBS 2-5=-387/278

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 9-8-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 4 except (jt=lb) 5=141.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	V9	Valley	1	1		AS NOTED FOR PLAN REVIEW
						DEVELOPMENT SERVICES
						LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:28 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-lz1zHGyi0\_XqBDCRIP3Jh0EN-6m20\_aXSG0Kw0NP

08/05/2021

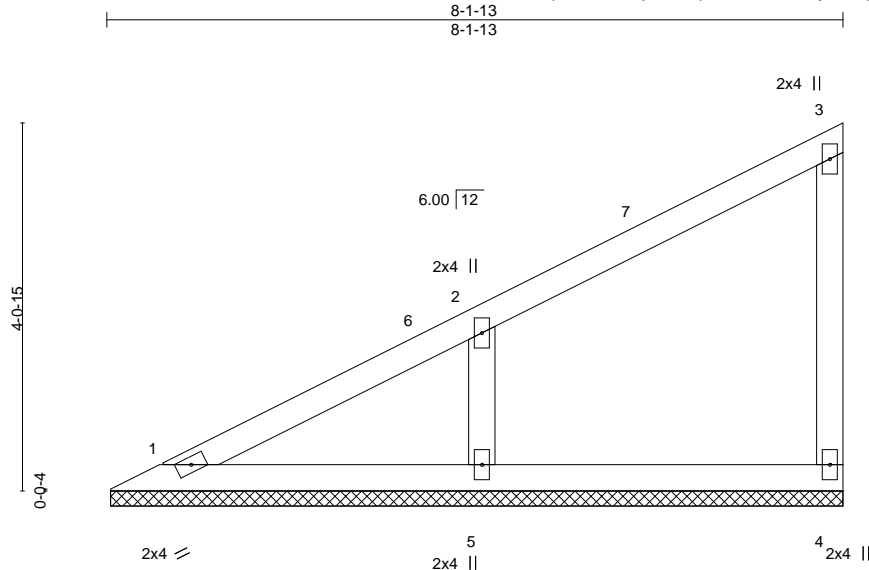

Scale = 1:25.5

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	L/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.22	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.11	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	-0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 25 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=8-1-5, 4=8-1-5, 5=8-1-5  
Max Horz 1=154(LC 9)  
Max Uplift 4=31(LC 9), 5=130(LC 12)  
Max Grav 1=121(LC 20), 4=134(LC 1), 5=415(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

TOP CHORD 1-2=-255/161  
WEBS 2-5=-323/270

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 8-0-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=130.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	V10	Valley	1	1		AS NOTED FOR PLAN REVIEW
						DEVELOPMENT SERVICES
						LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jun 22 09:06:21 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIOqezdKbx-Td6JpssJgqfqr895OF RgvXRE?400v/Fvvs7HsCvMDMv

08/05/2021

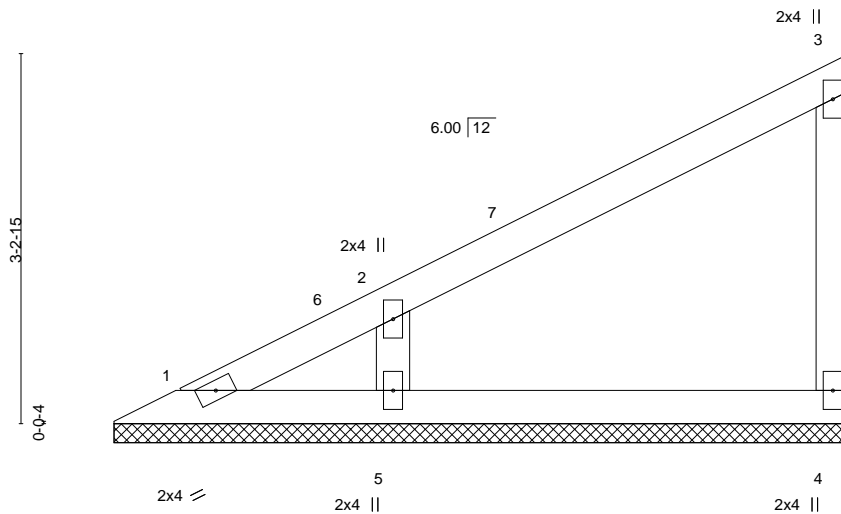

Scale = 1:20.2

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.18	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.10	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.05	Horz(CT)	0.00	4	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 19 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2  
OTHERS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=6-5-6, 4=6-5-6, 5=6-5-6  
Max Horz 1=119(LC 9)  
Max Uplift 4=37(LC 12), 5=121(LC 12)  
Max Grav 1=46(LC 9), 4=141(LC 1), 5=357(LC 1)

#### FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

WEBS 2-5=-277/272

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 6-4-2 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 4 except (jt=lb) 5=121.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20,2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

Safety Information available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017




Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI
2877185	V11	Valley	1	1	Job Reference (optional)	147079260

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:27 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrIQeqzdKbx-xqgi0CtXR8nhTlkly8yv6SLm4nqjkeE8WlyBeywDNV

08/05/2021

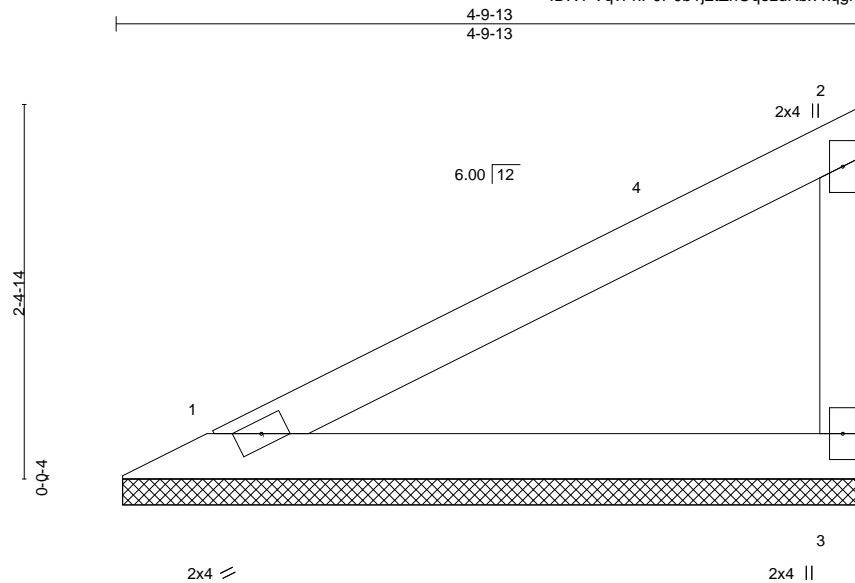

Scale = 1:14.8

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.30	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.16	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 13 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 4-9-13 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=4-9-5, 3=4-9-5  
Max Horz 1=84(LC 9)  
Max Uplift 1=31(LC 12), 3=52(LC 12)  
Max Grav 1=182(LC 1), 3=182(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) 0-7-9 to 3-7-9, Interior(1) 3-7-9 to 4-8-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601



16023 Swingley Ridge Rd  
Chesterfield, MO 63017


Job	Truss	Truss Type	Qty	Ply	SUMMIT/hawthorn ridge #135/MO	RELEASE FOR CONSTRUCTION
2877185	V12	Valley	1	1	Job Reference (optional)	AS NOTED FOR PLAN REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI

Builders FirstSource (Valley Center), Valley Center, KS - 67147,

8.430 s Jun 2 2021 MiTek Industries, Inc. Tue Jul 20 09:06:23 2021 Page 1

ID:VPVqvFnP0P0b1j2tZrOqezdKbx-P0E4EYucZCSvY4SJUWrT8\_yWVtR5aNTNAyjsW0MU

08/05/2021

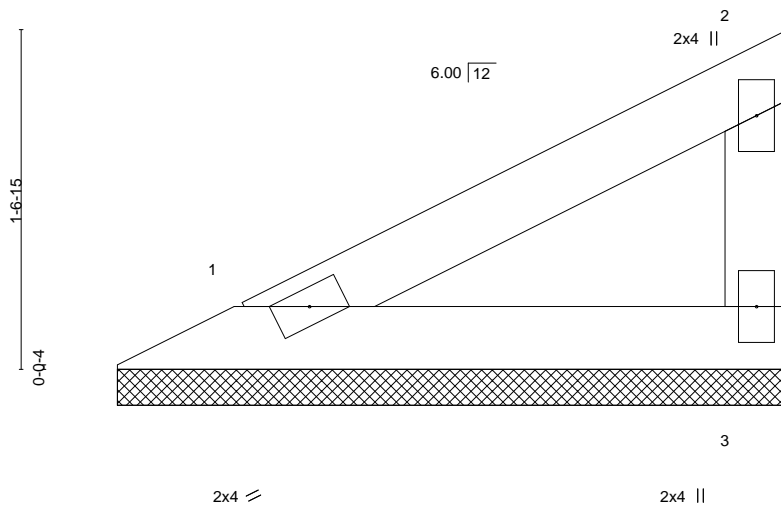

Scale = 1:10.7

LOADING (psf)	SPACING-	2-0-0	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 25.0	Plate Grip DOL	1.15	TC 0.10	Vert(LL)	n/a	-	n/a	MT20	197/144
TCDL 10.0	Lumber DOL	1.15	BC 0.05	Vert(CT)	n/a	-	n/a		
BCLL 0.0	Rep Stress Incr	YES	WB 0.00	Horz(CT)	0.00	3	n/a		
BCDL 10.0	Code IRC2018/TPI2014		Matrix-P					Weight: 8 lb	FT = 20%

#### LUMBER-

TOP CHORD 2x4 SPF No.2  
BOT CHORD 2x4 SPF No.2  
WEBS 2x4 SPF No.2

#### BRACING-

TOP CHORD Structural wood sheathing directly applied or 3-1-14 oc purlins, except end verticals.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS.

(size) 1=3-1-6, 3=3-1-6  
Max Horz 1=50(LC 9)  
Max Uplift 1=-18(LC 12), 3=-31(LC 12)  
Max Grav 1=107(LC 1), 3=107(LC 1)

**FORCES.** (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

#### NOTES-

- 1) Wind: ASCE 7-16; Vult=115mph (3-second gust) Vasd=91mph; TCDL=6.0psf; BCDL=4.2psf; h=25ft; Cat. II; Exp C; Enclosed; MWFRS (envelope) gable end zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Gable requires continuous bottom chord bearing.
- 3) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3.
- 5) This truss is designed in accordance with the 2018 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.



July 20, 2021

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 5/19/2020 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see

ANSI/TPI1 Quality Criteria, DSB-89 and BCSI Building Component

**Safety Information** available from Truss Plate Institute, 2670 Crain Highway, Suite 203 Waldorf, MD 20601




16023 Swingley Ridge Rd  
Chesterfield, MO 63017

08/05/2021

## Symbols

### PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths. Apply plates to both sides of truss and fully embed teeth.

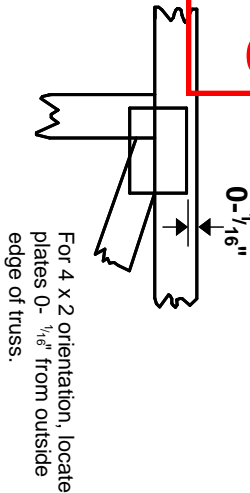

This symbol indicates the required direction of slots in connector plates.

\* Plate location details available in **MiTek 20/20** software or upon request.

### PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

### LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

### BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur. Min size shown is for crushing only.

### Industry Standards:

ANSI/TPI 1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-89: Design Standard for Bracing.  
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

## Numbering System

6-4-8 dimensions shown in ft-in-sixteenths (Drawings not to scale)

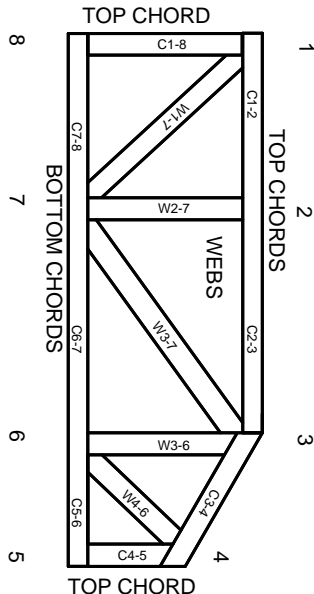

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

### PRODUCT CODE APPROVALS

ICC-ES Reports:

ESR-1311, ESR-1352, ESR1988  
ER-3907, ESR-2362, ESR-1397, ESR-3282

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TPI 1 section 6.3 These truss designs rely on lumber values established by others.

© 2012 MiTek® All Rights Reserved



MiTek Engineering Reference Sheet: MII-7473 rev. 5/19/2020



## General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TPI 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TPI 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TPI 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.