EVERSTEAD

SHOP DRAWINGS/SUBMITTAL REVIEW

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT
DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR CONFIRMING AND CORRELATING DIMENSIONS AT JOBSITE FOR TOLERANCE, CLEARANCE, QUANTITIES, FABRICATION, COORDINATION OF HIS OR HER WORK WITH OTHER TRADES, AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

STATUS:


APPROVED

09/01/2021

REVIEWED BY:

BH

ENGINEER, EVERSTEAD

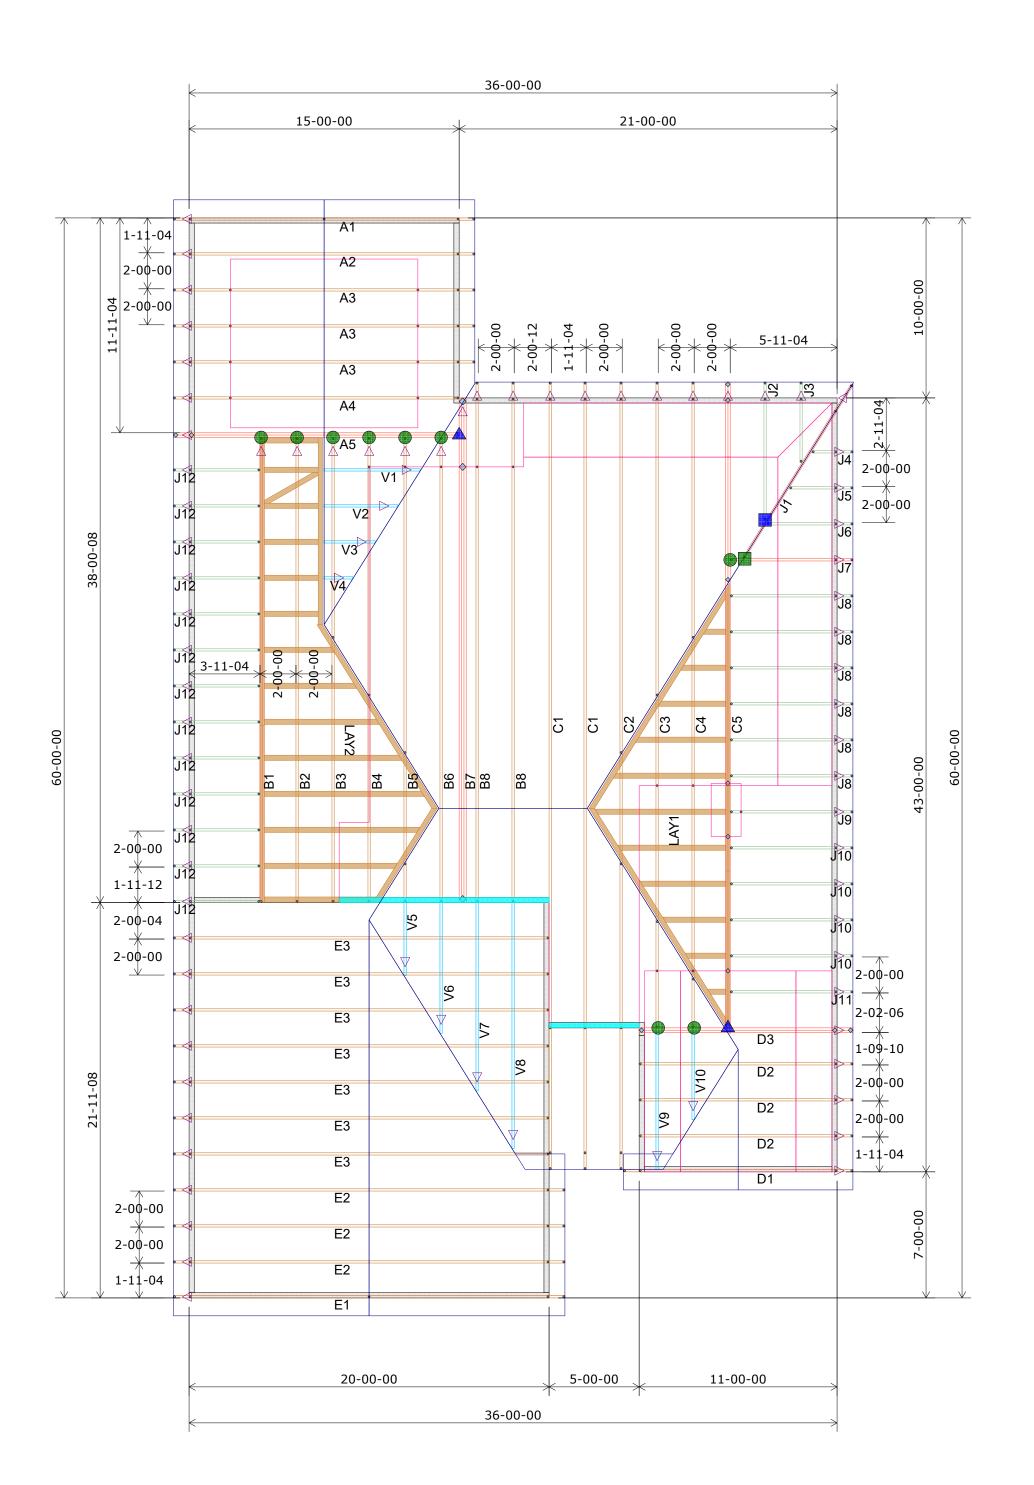

HANGER Quantity SCHEDULE LUS24 0 LUS26 0 HUS26 9 3817 SW Maryville Place
Lee's Summit MC
Chance Lickteig (785) 74
Job # B210217 ▲ HHUS26-2 0 ▲ HGUS26-2 2 ▲ HGUS28-3 0 Lot 28 Osage LTHJA26 0 TJC37 TJC57 △ HTS20 0 Triangle denotes the left end State of the Truss as it appears on the Engineered Drawings Job Name provided. Customer

Unless otherwise specified by Engineer Of Record, Wheeler Lumber, LLC recommends an uplift connection at each bearing point per the following:

of Uplift Connector 0 - 495: (1) H2.5A 495 - 990: (2) H2.5A 990 - 1245: (1) HTS20

Installation per Simpson Strong-Tie guidelines.

For Reactions greater than 1245#, refer to EOR.

RELEASE FOR CONSTRUCTION

AS NOTED ON PLANS REVIEW DEVELOPMENT SERVICES LEE'S SUMMIT, MISSOURI

09/03/2021

HIS LAYOUT IS THE SOLE SOURCE FOR FABRICATION OF TRUSSES AND VOIDS ALL PREVIOUS ARCHITECTURAL OR OTHER TRUSS LAYOUTS. REVIEW AND APPROVAL OF THIS LAYOUT MUST BE RECEIVED BEFORE ANY TRUSSES WILL BE BUILT. VERIFY ALL CONDITIONS TO INSURE AGAINST CHANGES THAT WILL RESULT IN EXTRA CHARGES TO YOU.

Wheeler Lumber 1959 Old Hwy 50 NE Waverly, KS 66871



Wall Heights 8-01-02 U.N.O. 9-01-02

Roof Truss Layout Scale: 3/16" = 1'